

MIAMI-DADE COUNTY PRODUCT CONTROL SECTION

11805 SW 26 Street, Room 208 Miami, Florida 33175-2474 T (786) 315-2590 F (786) 315-2599

www.miamidade.gov/economy

DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER) BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

Nichiha USA, Inc. 6465 E. Johns Crossing Johns Creek, GA 30097

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: NichiProducts™ Fiber-Cement Siding and Soffit

APPROVAL DOCUMENT: Drawing No. 5877-SK1, titled "Nichiha NichiProducts Assembly Drawings", sheets 1 and 15 of 15, dated 11/17/2023, prepared by Boca engineering, signed and sealed by Christopher W.C. Bowness, P.E., bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA renews NOA # 23-1031.04 and consists of this page 1 and evidence pages E-1, E-2 and E-3, as well as approval document mentioned above.

The submitted documentation was reviewed by Carlos M. Utrera, P.E.

MIAMI-DADE COUNTY
APPROVED

NOA No. 24-0507.05 **Expiration Date: July 22, 2029** Approval Date: June 6, 2024

Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

- 1. Evidence submitted under previous NOA'S
- A. DRAWINGS "Submitted under NOA # 15-1102.14"
 - 1. Drawing No. ITS N1090403, titled "NichiBoard", sheets 1 and 2 of 2 and Drawing No. ITS N2090403, titled "NichiPanel", sheets 1 and 2 of 2, both dated 03/16/2009, prepared by Nichiha USA, Inc, signed and sealed by Carl D. Fussner, P.E. on 10/13/2015.
- B. TESTS "Submitted under NOA # 09-0511.01"
 - 1. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94

along with marked-up drawings and installation diagram of NichiProducts Fiber-Cement Panels, prepared by Intertek Testing Services NA LTD, Report No. **3145127COQ-004A**, dated 08/07/08, signed and sealed by Rick Curkeet, P.E.

- 2. Test reports on 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 2) Large Missile Impact Test per FBC, TAS 201-94
 - 3) Cyclic Wind Pressure Loading per FBC, TAS 203-94 along with marked-up drawings and installation diagram of NichiBoards and EcoPlanks, prepared by Intertek Testing Services NA LTD, Report No. **3145127COQ-004B**, dated 10/24/08, signed and sealed by Rick Curkeet, P.E.
- 3. Test report on Standard Specification for Flat Non-Asbestos Fiber-Cement Sheets of NichiProducts Fiber-Cement Panels, per ASTM C1186-07, prepared by Intertek Testing Services NA LTD, Report No. 3145123COQ-005, dated 05/20/08, with a
- revision dated 02/02/09, signed and sealed by Rick Curkeet, P.E.
- 4. Test report on Surface Burning Characteristics of NichiPanel Fiber-Cement Panels, per ASTM E84-08, prepared by Intertek Testing Services NA LTD, Report No. 3145123COQ-006, dated 06/25/08, with a revision dated 04/03/09, signed and sealed by Rick Curkeet, P.E.
- 5. Test report on Standard Test Method for Behavior of Materials in a Vertical Tube Furnace at 750°C of Nichiha M series unprimed cementitious, per ASTM E136-99, prepared by Intertek Testing Services NA LTD, Report No. 3105885COQ-002, dated 10/26/06, with a revision dated 03/30/09, signed and sealed by Rick Curkeet, P.E.
- C. CALCULATIONS "Submitted under NOA # 14-0715.03"
 - 1. Anchor calculations prepared by Progressive Engineering, Inc., dated 10/22/2014, signed and sealed by Carl D. Fussner, P.E.
 - "Submitted under NOA # 09-0511.01"
 - 2. Anchor analyses prepared by Category 5 Engineering Services, Inc., dated 04/03/2009, signed and sealed by Emma T. Mellinger, P.E.

Carlos M. Utrera, P.E. Product Control Examiner NOA No. 24-0507.05 Expiration Date: July 22, 2029

Approval Date: June 6, 2024

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS

1. None.

F. STATEMENTS "Submitted under NOA # 15-1102.14"

- Drawing No. **ITS N1090403** and **ITS N2090403** statements of code conformance to the 5th edition (2014) FBC issued by Nichiha USA, Inc, dated 03/16/2009, signed and sealed by Carl D. Fussner, P.E. on 10/13/2015.
- 2. Statement letter of no financial interest issued by Progressive Engineering, Inc., dated 10/13/2015, signed and sealed by Carl D. Fussner, P.E.

2. Evidence submitted under NOA # 18-0815.06

A. DRAWINGS

1. Drawing No. ITS N1090403, titled "NichiBoard", sheets 1 and 2 of 2 and Drawing No. ITS N2090403, titled "NichiPanel", sheets 1 and 2 of 2, both dated 10/05/2018, prepared by Nichiha USA, Inc, signed and sealed by Carl D. Fussner, P.E.

B. TESTS

1. None.

C. CALCULATIONS

1. None.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS

1. None.

F. STATEMENTS

1. Statement letter of code conformance to the 6th edition (2017) FBC issued by PEI Engineering Services, Inc, dated 02/22/2018, signed and sealed by Carl D. Fussner, P.E.

Carlos M. Utrera, P.E.
Product Control Examiner
NOA No. 24-0507.05
Expiration Date: July 22, 2029
Approval Date: June 6, 2024

E - 2

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

3. Evidence submitted under NOA # 21-0312.12, 23-1031.04 and new

A. DRAWINGS

Drawing No. **5877-SK1**, titled "Nichiha NichiProducts Assembly Drawings", sheets 1 and 15 of 15, dated 11/17/2023, prepared by Boca engineering, signed and sealed by Christopher W.C. Bowness, P.E.

B. TESTS

- 1. Test reports on 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 2) Cyclic Wind Pressure Loading per FBC, TAS 203-94
 along with marked-up drawings and installation diagram of 9-1/4" NichiBoard, prepared by Intertek, Report No. **J4610.01-550-18 R1**, dated 05/17/2019 and revised on 08/07/2023, signed and sealed by Tanya A. Dolby, P.E.
- 2. Test reports on 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 2) Cyclic Wind Pressure Loading per FBC, TAS 203-94
 along with marked-up drawings and installation diagram of NichiPanel, prepared by Intertek, Report No. **J4610.05-550-18 R1**, dated 05/17/2019 and revised on 07/18/2023, signed and sealed by Tanya A. Dolby, P.E.
- 3. Test reports on 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 2) Cyclic Wind Pressure Loading per FBC, TAS 203-94
 along with marked-up drawings and installation diagram of NichiStraight/Staggered, prepared by Intertek, Report No. **J4610.07-550-18 R1**, dated 05/17/2019 and revised on 07/18/2023, signed and sealed by Tanya A. Dolby, P.E.
- 4. Test reports on 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 2) Cyclic Wind Pressure Loading per FBC, TAS 203-94
 along with marked-up drawings and installation diagram of NichiSoffit, prepared by Intertek, Report No. **J4610.06-550-18 R1**, dated 05/14/2019 and revised on 07/18/2023, signed and sealed by Tanya A. Dolby, P.E.

C. CALCULATIONS

1. Anchor calculations prepared by Boca Engineering Co., dated 11/09/2023, signed and sealed by Christopher W.C. Bowness, P.E.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS

1. None.

F. STATEMENTS

1. Statement letter of code conformance to the 8th edition (2023) of the FBC and of no financial interest, issued by Boca Engineering Co., dated 11/09/2023, signed and sealed by Christopher W.C. Bowness, P.E.

Carlos M. Utrera, P.E.
Product Control Examiner
NOA No. 24-0507.05
Expiration Date: July 22, 2029
Approval Date: June 6, 2024



PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 23-1031.04

Expiration Date 07/22/2024

By Miami-Dade Product Control

PRODUCT RENEWED as complying with the Florida Building Code NOA-No. 24-0507.05

Expiration Date <u>07/22/2029</u>

By Miami-Dade Product Control

Table 1: Wood Framing Assembly Configurations for NichiProducts¹

Assembly No.	Detail No.	Product Name	Min. Framing ²	Min. Sheathing	Fastener	Fastener Location & Spacing	Fastener Substrate	Maximum Design Pressure (ASD) (psf)
1	A2	NichiBoard 12"	2x No.2 SPF @ 16" o.c.	5/8" Plywood	6d galv. ring-shank nail, head dia.: 0.278", shank dia.: 0.119", length: 2"	Face nailed 1" from bottom of panel @ Horiz.: 8" o.c. Vert.: 5-3/8" o.c.	Sheathing	125
2	А3	NichiBoard 5-1/4", 6-1/4", 7-1/4", 8- 1/4", 9-1/4"	2x No.2 SPF @ 16" o.c.	5/8" Plywood	8d galv. ring-shank nail, head dia.: 0.279", shank dia.: 0.123", length: 2-1/2"	Face nailed 1" from bottom of panel @ Horiz.: 16" o.c. Vert.: max. 8" o.c.	Framing	85
3	A5	NichiPanel	2x No.2 SPF @ 16" o.c.	5/8" Plywood	6d galv. ring-shank nail, head dia.: 0.278", shank dia.: 0.119", length: 2"	Face nailed @ Horiz.: 6" o.c. Vert.: 6" o.c.	Sheathing	104
4	A6	NichiPanel	2x No.2 SPF @ 16" o.c.	5/8" Plywood	6d galv. ring-shank nail, head dia.: 0.278", shank dia.: 0.119", length: 2"	Face nailed @ Horiz.: 16" o.c. Vert.: 6" o.c.	Framing	75
5	A8/A9	NichiStraight/ NichiStaggered	2x No.2 SPF @ 16" o.c.	5/8" Plywood	8d galv. ring-shank nail, head dia.: 0.279", shank dia.: 0.123", length: 2-1/2"	Blind nailed ½" above keyways @ Horiz.: 16" o.c. Vert.: 7 o.c.	Framing	70
6	C10	Nichisoffit (solid)	2x No.2 SPF @ 16" o.c.	NA	6d galv. ring-shank nail, head dia.: 0.278", shank dia.: 0.119", length: 2"	Face nailed @ 6" o.c. around permitter and ea. framing member	Framing	70


- 1. Maximum wall height of 10 ft, deflection limit L/180 of wall height.
- 2. 2x wood framing tested to support attachment of cladding at maximum design pressure, species may be substituted by any exceeding S.G. 0.42. Framing must be sized by engineer or architect of record to support all building loads and deflection limit.


Table 2: Steel Framing Assembly Configurations for NichiProducts¹


Assembly No.	Detail No.	Product Name	Min. Framing ²	Min. Sheathing	Fastener Fastener Location & Spacing		Fastener Substrate	Maximum Design Pressure (ASD) (psf)
7	A2	NichiBoard 12"	1-5/8 x 5-1/2, 16 ga, 50 ksi steel @ 16" o.c.	5/8" Plywood	6d galv. ring-shank nail, head dia.: 0.278", shank dia.: 0.119", length: 2"	Face nailed 1" from bottom of panel @ Horiz.: 8" o.c. Vert.: 5-3/8" o.c.	Sheathing	125
8	А3	NichiBoard 5-1/4", 6-1/4", 7-1/4", 8- 1/4", 9-1/4"	1-5/8 x 5-1/2, 16 ga, 50 ksi steel @ 16" o.c.	5/8" Plywood	#8 screw, head dia.: 0.279", shank dia.: 0.164", length: 1.625"	Face fasten 1" from bottom of panel @ Horiz.: 16" o.c. Vert.: max. 8" o.c.	Framing	85
9	A5	NichiPanel	1-5/8 x 5-1/2, 16 ga, 50 ksi steel @ 16" o.c.	5/8" Plywood	6d galv. ring-shank nail, head dia.: 0.278", shank dia.: 0.119", length: 2"	Face nailed @ Horiz.: 6" o.c. Vert.: 6" o.c.	Sheathing	104
10	A6	NichiPanel	1-5/8 x 5-1/2, 18 ga, 33 ksi steel @ 16" o.c.	5/8" Plywood	#8 screw, head dia.: 0.279", shank dia.: 0.164", length: 1.625"	Face fasten @ Horiz.: 16" o.c. Vert.: 6" o.c.	Framing	75
11	A8/A9	NichiStraight/ NichiStaggered	1-5/8 x 5-1/2, 18 ga, 33 ksi steel @ 16" o.c.	5/8" Plywood	#8 screw, head dia.: 0.279", shank dia.: 0.164", length: 1.625"	Blind fasten ½" above keyways @ Horiz.: 16" o.c. Vert.: 7 o.c.	Framing	70
12	C10	Nichisoffit (solid)	1-5/8 x 5-1/2, 18 ga, 33 ksi steel @ 16" o.c.	NA	#8 screw, head dia.: 0.279", shank dia.: 0.164", length: 1.625"	Face fasten @ 6" o.c. around permitter and ea. framing member	Framing	70

- 1. Maximum wall height of 10 ft, deflection limit L/180 of wall height.
- Steel framing calculated to support attachment of cladding at maximum design pressure. Framing must be sized by engineer or architect of record to support all building loads and deflection limit.


TITLE		CLIENT	A STATE OF THE STA	PROJECT				
NICHIHA NI	CHIPRODUCTS ASSEMBLY DRAWINGS	NICHIHA	USA, INC	NICI	HIPRODUCTS	S MIAMI	DADE 1	NOA
	BOCA ENGINEERING	DATE	REV.	FOR PUBLICATION			СВ	
	STRUCTURAL AND CIVIL ENGINEERS	NOVEMBE	0	ISSUE			APP	
	#203-1001 CLOVERDALE AVE, VICTORIA BC VBX 4C9 250-477-7777	DRAWING NO.	SHEET NO.	SCALE		DES.	DRN.	CHK.
BOCA	INFO 0 80CAENGINEERING.COM WWW.BOCAENGINEERING.COM	5877-SK1	1 OF 15	NOT 1	TO SCALE	CB	NN	CB



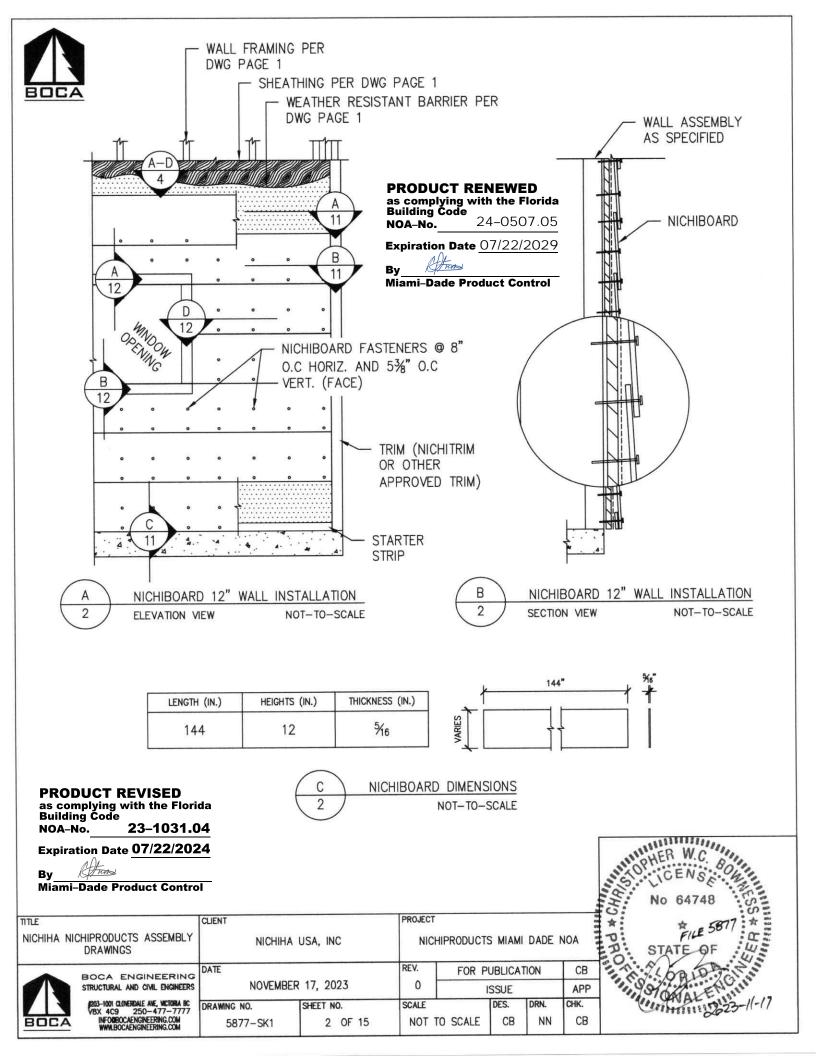

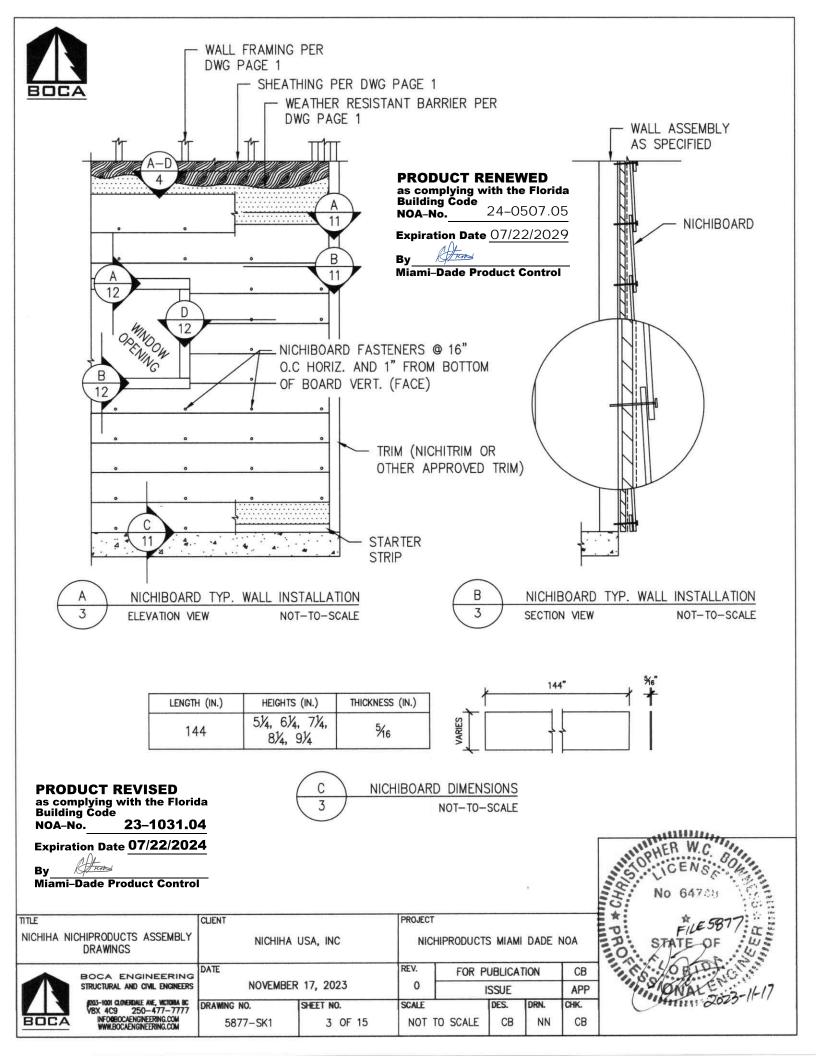






NICHIBOARD 12" WALL INSTALLATION INTO WOOD STUDS

NOT-TO-SCALE PLAN MEW

LIGHT-FRAMED STUD WALL INSTALLATION INTERIOR TO EXTERIOR

- 2x SPF No.2 WOOD STUDS @ 16" O.C.
- 2 %" PLYWOOD SHEATHING ATTACHED TO FRAMING PER CODE
- 3 WEATHER RESISTANT BARRIER TO CODE
- 6d GALV. RING-SHANK NAIL, HEAD DIA.: 0.278", SHANK DIA.: 0.119". LENGTH: 2" FACE NAILED @ 8" O.C HORIZ. AND 53/4" O.C VERT.
- NICHIBOARD 12" SIDING

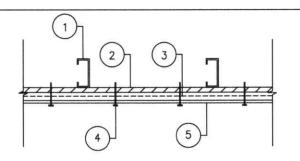

NICHIBOARD 12" WALL INSTALLATION INTO STEEL STUDS PLAN VIEW NOT-TO-SCALE LIGHT-FRAMED STUD WALL INSTALLATION INTERIOR TO EXTERIOR


- 15/x51/2" 16 GA. 50 KSI STEEL STUDS @ 16" O.C.
- 5%" PLYWOOD SHEATHING ATTACHED TO FRAMING PER CODE
- WEATHER RESISTANT BARRIER TO CODE
- 6d GALV. RING-SHANK NAIL, HEAD DIA .: 0.278", SHANK DIA .: 0.119", LENGTH: 2" FACE NAILED @ 8" O.C HORIZ. AND 5%" O.C VERT.
- NICHIBOARD 12" SIDING

ODUCT RENEWED complying with the Florida Iding Code 24-0507.05 A–No.

iration Date 07/22/2029

Hum

mi-Dade Product Control



NICHIBOARD TYP. WALL INSTALLATION INTO WOOD STUDS PLAN VIEW NOT-TO-SCALE


LIGHT-FRAMED STUD WALL INSTALLATION INTERIOR TO EXTERIOR

- 2x SPF No.2 WOOD STUDS @ 16" O.C.
- 2 %" PLYWOOD SHEATHING ATTACHED TO FRAMING PER CODE
- 3 WEATHER RESISTANT BARRIER TO CODE
- 8d GALV. RING-SHANK NAIL, HEAD DIA .: 0.279", SHANK DIA .: 0.123", LENGTH: 2½" FACE NAILED @ 16" O.C HORIZ. AND 1" FROM BOTTOM OF PANEL VERT.
- NICHIBOARD 5¼" 9¼" SIDING

PRODUCT REVISED as complying with the Florida Building Code 23-1031.04 NOA-No.

Expiration Date 07/22/2024

Strong Miami-Dade Product Control




NICHIBOARD TYP. WALL INSTALLATION INTO STEEL STUDS NOT-TO-SCALE PLAN VIEW

LIGHT-FRAMED STUD WALL INSTALLATION INTERIOR TO EXTERIOR

- 15/x51/2" 16 GA. 50 KSI STEEL STUDS @ 16" O.C.
- %" PLYWOOD SHEATHING ATTACHED TO FRAMING PER CODE
- 3 WEATHER RESISTANT BARRIER TO CODE
- #8 SCREW, HEAD DIA .: 0.279", SHANK DIA .: 0.164", LENGTH: 15%" FACE SCREWED @ 16" O.C HORIZ. AND 1" FROM BOTTOM OF PANEL VERT.
- 5 NICHIBOARD 5¼" 9¼" SIDING

PROJECT TITLE CLIENT NICHIHA NICHIPRODUCTS ASSEMBLY NICHIPRODUCTS MIAMI DADE NOA NICHIHA USA, INC DRAWINGS DATE REV. FOR PUBLICATION BOCA ENGINEERING NOVEMBER 17, 2023 0 STRUCTURAL AND CIVIL ENGINEERS ISSUE APP





(203-1001 CLONERDALE AVE, VICTORIA BC VBX 4C9 250-477-7777 INFO@BOCAENGINEERING.COM WWW.BOCAENGINEERING.COM

DRAWING NO.


5877-SK1


SHEET NO. 4 OF 15

SCALE NOT TO SCALE


DES. CB NN

DRN. CHK.

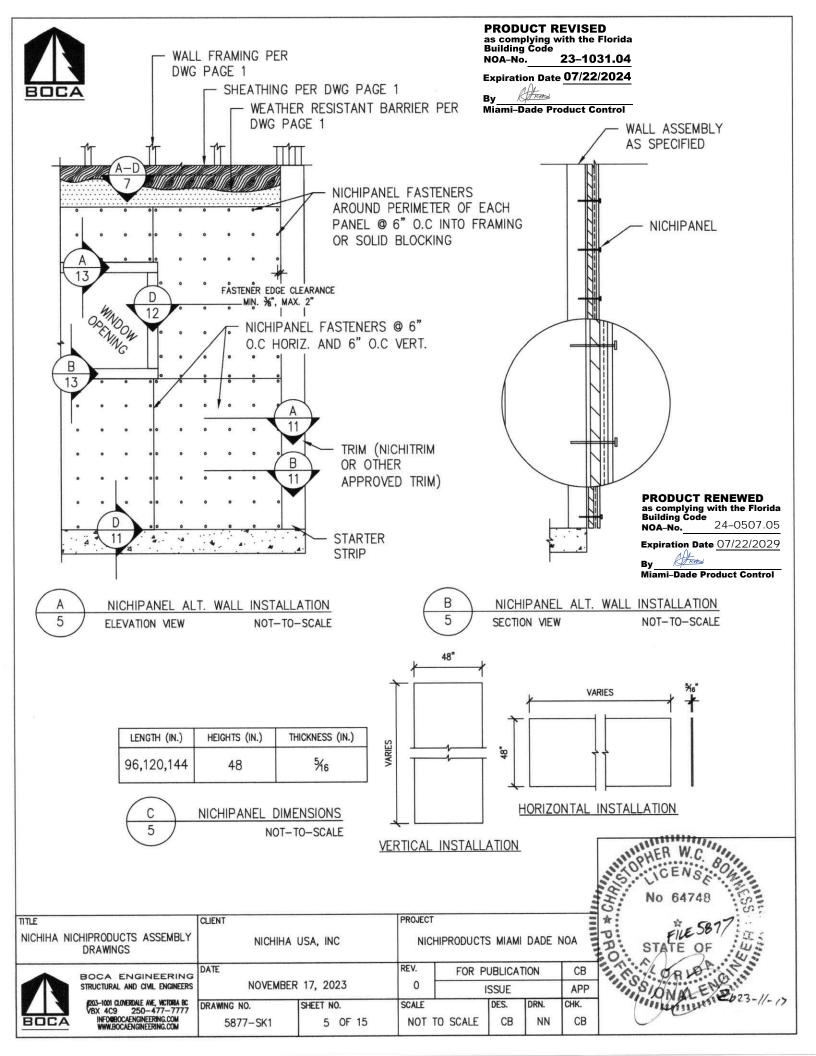

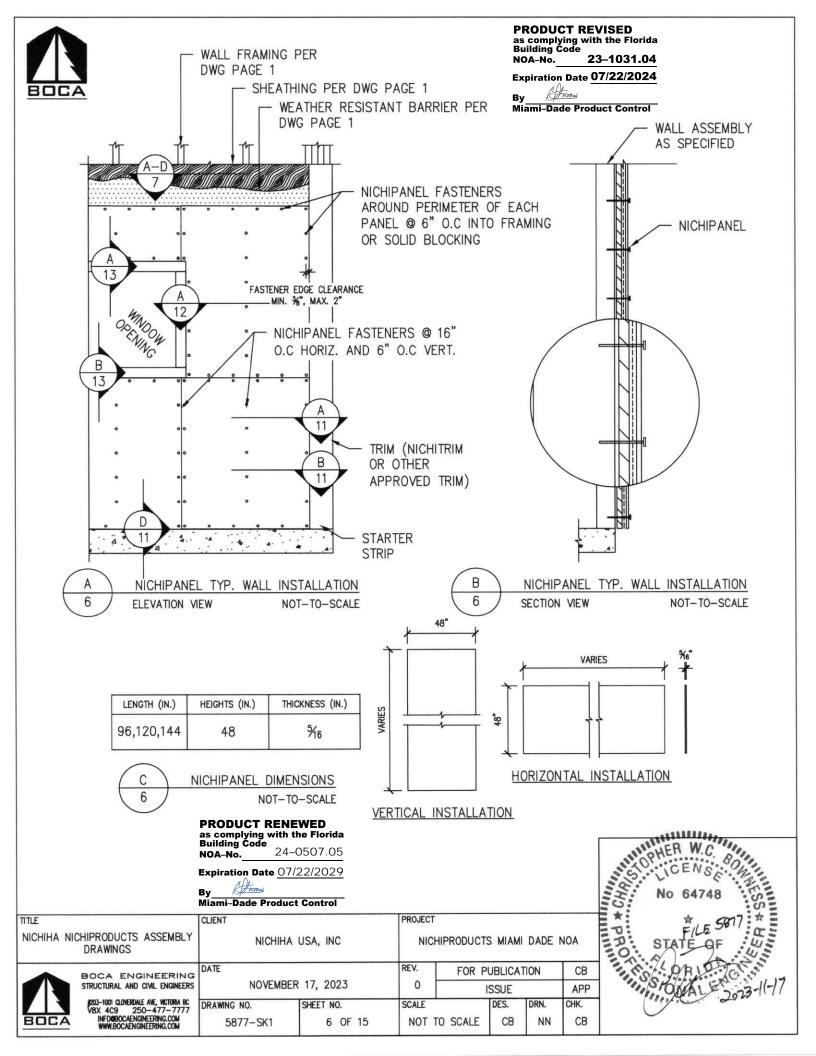






NICHIPANEL ALT. WALL INSTALLATION INTO WOOD STUDS

NOT-TO-SCALE PLAN VIEW

LIGHT-FRAMED STUD WALL INSTALLATION INTERIOR TO EXTERIOR

- 2x SPF No.2 WOOD STUDS @ 16" O.C.
- 2 %" PLYWOOD SHEATHING ATTACHED TO FRAMING PER CODE
- 3 WEATHER RESISTANT BARRIER TO CODE
- 6d GALV. RING-SHANK NAIL, HEAD DIA .: 0.278", SHANK DIA .: 0.119", LENGTH: 2" FACE NAILED @ 6" O.C HORIZ. AND 6" O.C
- NICHIPANEL SIDING




NICHIPANEL ALT. WALL INSTALLATION INTO STEEL STUDS NOT-TO-SCALE PLAN VIEW

LIGHT-FRAMED STUD WALL INSTALLATION INTERIOR TO EXTERIOR

- 15/x51/8" 16 GA. 50 KSI STEEL STUDS @ 16" O.C.
- %" PLYWOOD SHEATHING ATTACHED TO FRAMING PER CODE 2
- WEATHER RESISTANT BARRIER TO CODE 3
- #8, 1.625" LONG, 0.164" SHANK DIAMETER, 0.279" HEAD DIAMETER SCREW @ 6" O.C HORIZ. AND VERT.
- NICHIPANEL SIDING

PRODUCT RENEWED as complying with the Florida Building Code NOA-No. 24-0507.05 Expiration Date 07/22/2029 RHums

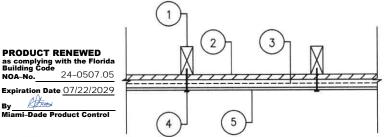

C

NICHIPANEL TYP. WALL INSTALLATION INTO WOOD STUDS PLAN VIEW

NOT-TO-SCALE

LIGHT-FRAMED STUD WALL INSTALLATION INTERIOR TO EXTERIOR

- 2x SPF No.2 WOOD STUDS @ 16" O.C.
- %" PLYWOOD SHEATHING ATTACHED TO FRAMING PER CODE
- WEATHER RESISTANT BARRIER TO CODE 3
- 6d GALV. RING-SHANK NAIL, HEAD DIA.: 0.278", SHANK DIA.: 0.119", LENGTH: 2" FACE NAILED @ 16" O.C HORIZ. AND 6" O.C VERT.
- NICHIPANEL SIDING

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 23-1031.04

Expiration Date 07/22/2024

By Miami-Dade Product Control

2 5

D

BOCA

NICHIPANEL TYP. WALL INSTALLATION INTO STEEL STUDS

PLAN VIEW

NOT-TO-SCALE

PROJECT

REV.

LIGHT-FRAMED STUD WALL INSTALLATION INTERIOR TO EXTERIOR

15/x51/2" 18 GA. 33 KSI STEEL STUDS @ 16" O.C.

CB

APP

CHK.

DRN.

NN

- 2 5/8" PLYWOOD SHEATHING ATTACHED TO FRAMING PER CODE
- 3 WEATHER RESISTANT BARRIER TO CODE
- #8 SCREW, HEAD DIA .: 0.279", SHANK DIA .: 0.164", LENGTH: 1%" FACE SCREWED @ 16" O.C HORIZ. AND 6" O.C VERT.
- NICHIPANEL SIDING

NICHIPRODUCTS MIAMI DADE NOA

TITLE NICHIHA NICHIPRODUCTS ASSEMBLY DRAWINGS

BOCA ENGINEERING STRUCTURAL AND CIVIL ENGINEERS #203-1001 CLOVERDALE AVE, VICTORIA BC VBX 4C9 250-477-7777 INFO@BOCAENGINEERING.COM WWW.BOCAENGINEERING.COM

NICHIHA USA, INC DATE

5877-SK1

CLIENT


NOVEMBER 17, 2023 DRAWING NO.


SHEET NO.

7 OF 15


FOR PUBLICATION 0 ISSUE SCALE DES. NOT TO SCALE CB

NET OPHER W.C. OPHER W.C. FILE 58

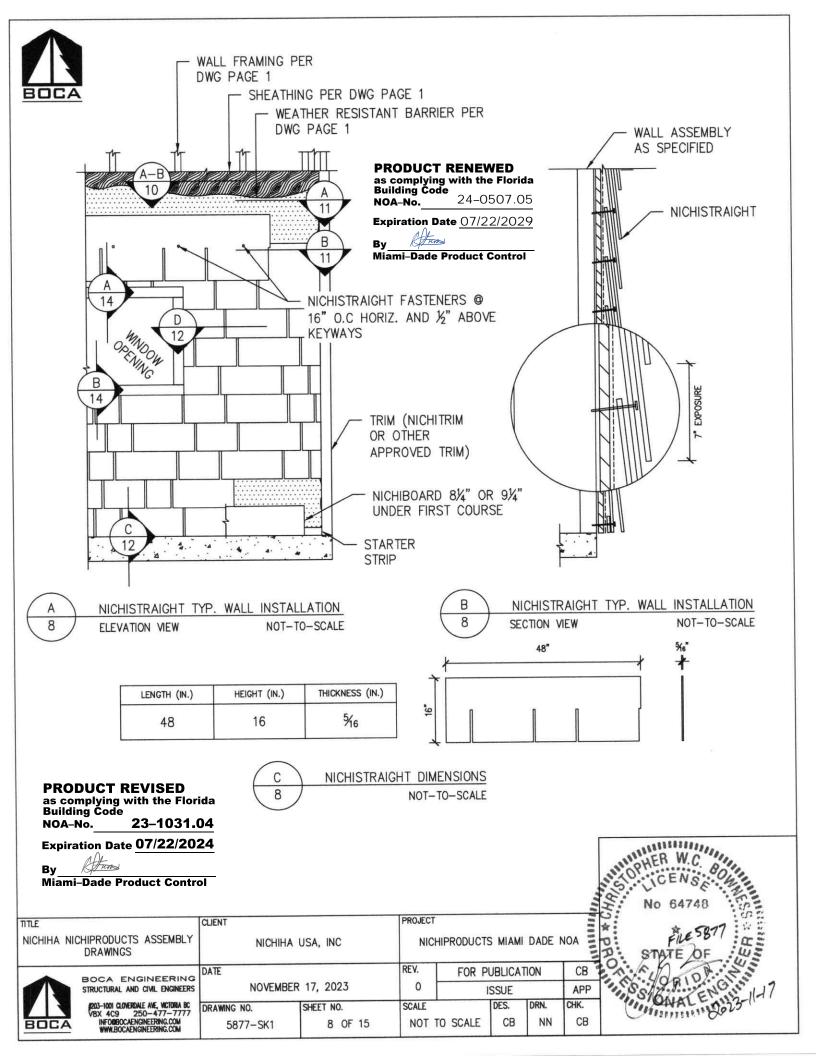

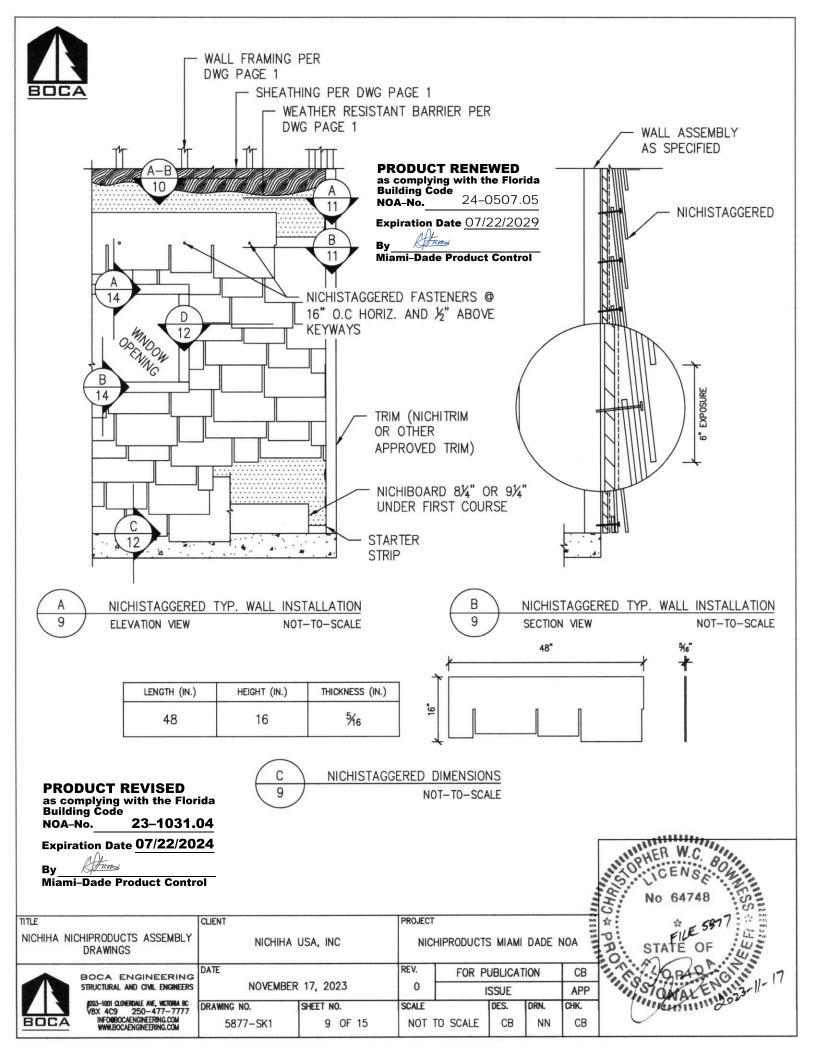





LIGHT-FRAMED STUD WALL INSTALLATION INTERIOR TO EXTERIOR

- 2x SPF No.2 WOOD STUDS @ 16" O.C.
- 2 %" PLYWOOD SHEATHING ATTACHED TO FRAMING PER CODE
- WEATHER RESISTANT BARRIER TO CODE
- 8d GALV. RING-SHANK NAIL, HEAD DIA .: 0.279", SHANK DIA .: 0.123", LENGTH: 21/2" BLIND NAILED @ 16" O.C HORIZ. AND 1/2" ABOVE KEYWAYS VERT.
- NICHISTRAIGHT/STAGGERED SIDING


10

10

NICHISTRAIGHT/STAGGERED TYP. WALL INSTALLATION INTO WOOD STUDS


PLAN VIEW


NOT-TO-SCALE



LIGHT-FRAMED STUD WALL INSTALLATION INTERIOR TO EXTERIOR 15/8×5½" 18 GA. 33 KSI STEEL STUDS @ 16" O.C. 2 56" PLYWOOD SHEATHING ATTACHED TO FRAMING PER CODE WEATHER RESISTANT BARRIER TO CODE 3 #8 SCREW, HEAD DIA.: 0.279", SHANK DIA.: 0.164", LENGTH: 1%" BLIND SCREWED @ 16" O.C HORIZ. AND ½" ABOVE KEYWAYS VERT.

NICHISTRAIGHT/STAGGERED TYP. WALL INSTALLATION INTO STEEL STUDS NOT-TO-SCALE PLAN VIEW

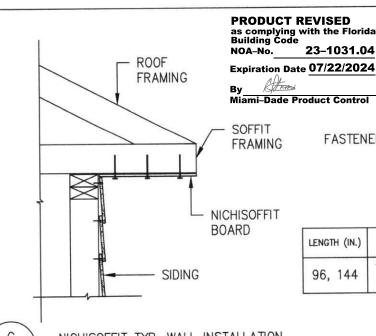

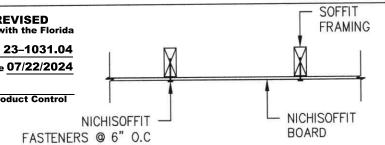

NICHISTRAIGHT/STAGGERED SIDING

10 FRONT ELEVATION VIEW

CB

NOT TO SCALE

NN

CB

NOT-TO-SCALE

HEIGHTS (IN.) THICKNESS (IN.) LENGTH (IN.) 12, 16, 24, 96, 144 1/4 48

D

C SIDE ELEVATION VIEW

NICHISOFFIT TYP. WALL INSTALLATION NOT-TO-SCALE

5877-SK1

PRODUCT RENEWED

as complying with the Florida Building Code 24-0507.05 NOA-No.

Expiration Date 07/22/2029


E NICHISOFFIT DIMENSIONS 10 NOT-TO-SCALE


NICHISOFFIT TYP. WALL INSTALLATION

Hum Miami-Dade Product Control PROJECT CLIENT TITLE NICHIHA NICHIPRODUCTS ASSEMBLY NICHIPRODUCTS MIAMI DADE NOA NICHIHA USA, INC DRAWINGS REV. DATE FOR PUBLICATION CB BOCA ENGINEERING NOVEMBER 17, 2023 0 APP STRUCTURAL AND CIVIL ENGINEERS ISSUE #203-1001 CLOVERDALE AVE, VICTORIA BC VBX 4C9 250-477-7777 INFOGBOCAENGINEERING.COM WWW.BOCAENGINEERING.COM DES. DRN. CHK. SCALE SHEET NO. DRAWING NO.

10 OF 15

WASHING HER W.C. STOPHER W.C. No 64746 FILE 587

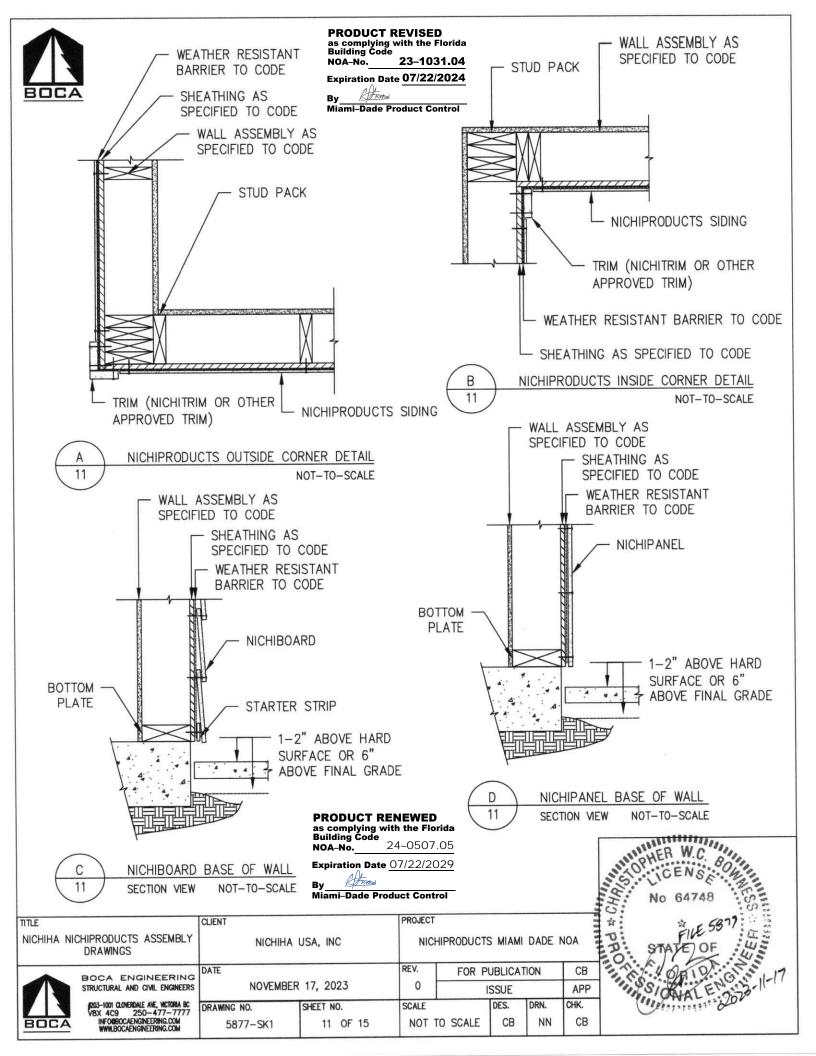

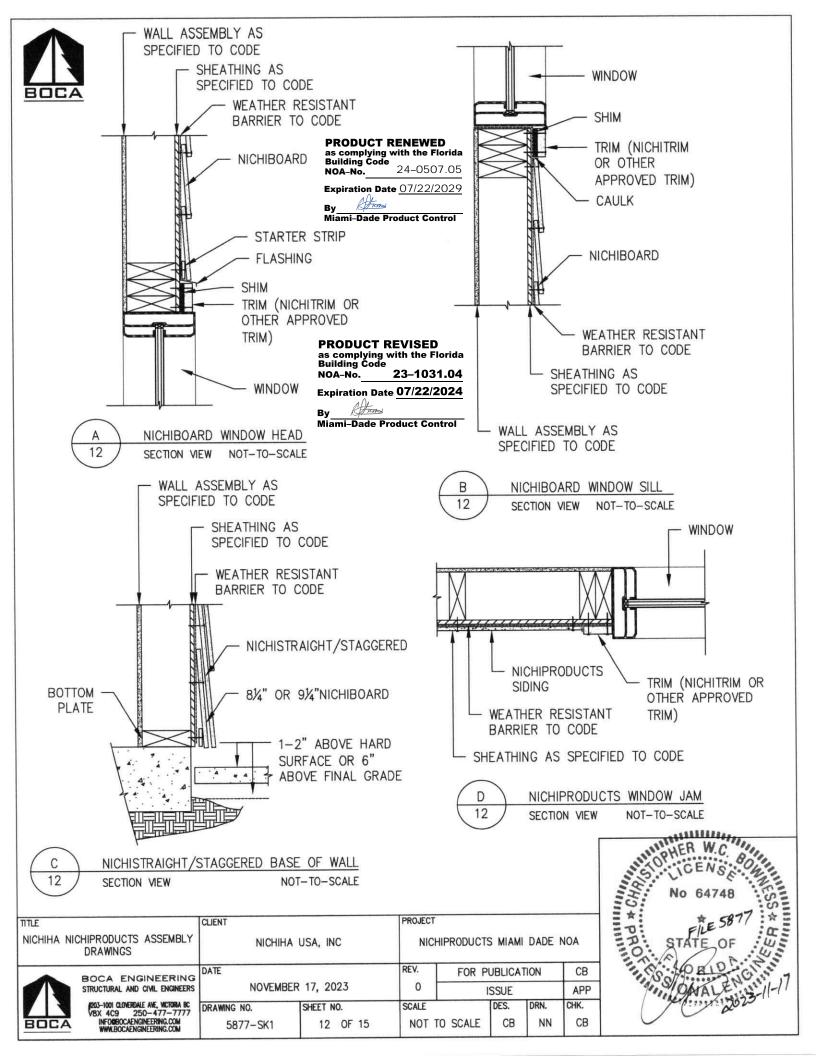





BOCA ENGINEERING


STRUCTURAL AND CIVIL ENGINEERS

#203-1001 CLONERDALE AVE, WCTORIA BC VBX 4C9 250-477-7777 INFOBBOCAENGINEERING.COM WWW.BOCAENGINEERING.COM

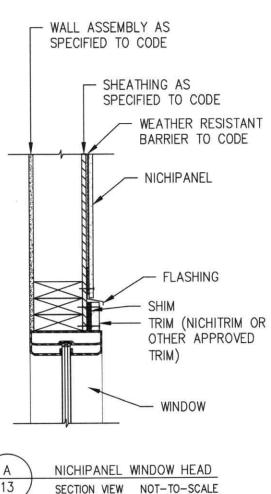

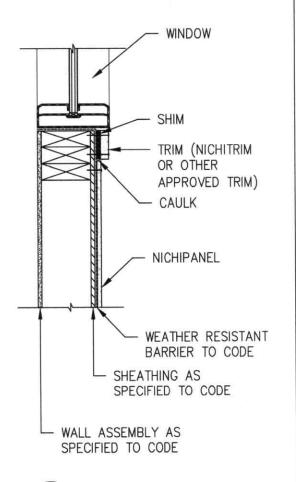



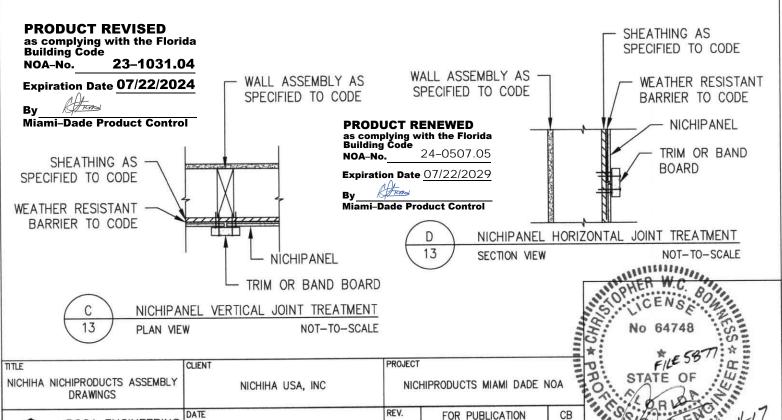

0

SCALE

NOT TO SCALE

ISSUE

DES.

CB

DRN.

NN

APP

CB

CHK.


NOVEMBER 17, 2023

DRAWING NO.

5877-SK1

SHEET NO.

13 OF 15

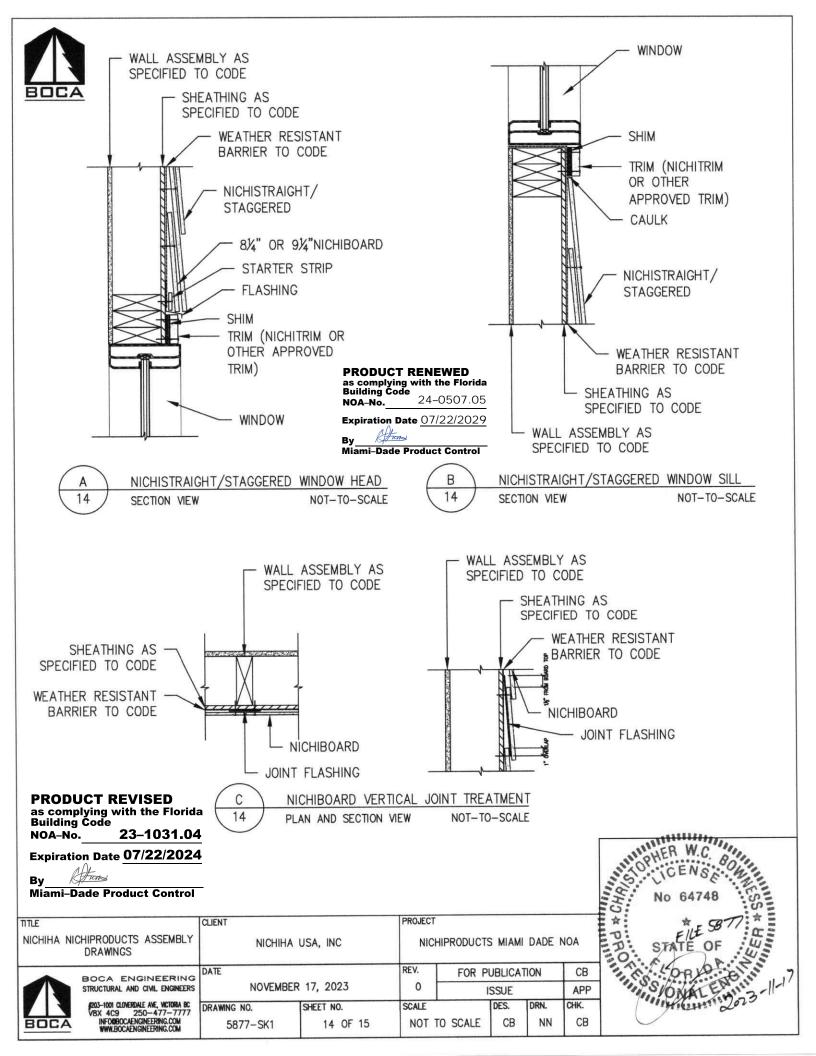



PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 23-1031.04

Expiration Date 07/22/2024

By Huns

Miami-Dade Product Control

PRODUCT RENEWED as complying with the Florida Building Code NOA-No. 24-0507.05

Expiration Date 07/22/2029

By Huns

Miami-Dade Product Control

LEGEND AND SYMBOLS





TESTING AND CODE COMPLIANCE

1. THE SIDING PRODUCT ASSEMBLY SHOWN IS DESIGNED TO COMPLY WITH THE 8TH EDITION (2023) FLORIDA BUILDING CODE (FBC) HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING TEST STANDARDS FOR IMPACT, WIND PRESSURE, AND WIND-DRIVEN RAIN: TAS 201-94, TAS 202-94, TAS 203-94.

2. THE STRUCTURAL FRAMING AND SHEATHING SHALL BE DESIGNED AND ANCHORED TO PROVIDE LATERAL BRACING AND PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. FRAMING DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF

THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.

THESE DRAWINGS APPLY TO THE TESTING ASSEMBLY ONLY AND DO NOT IMPLY THAT THE SIGNATORY ENGINEER IS THE DESIGNER OF RECORD FOR ANY FUTURE CONSTRUCTION ON WHICH THEY ARE USED.

4. SOME NON-STRUCTURAL COMPONENTS NOT SHOWN AND DO NOT IMPACT STRENGTH FOR ATTACHMENT. TO BE INSTALLED PER CODE AND MAY INCLUDE: FLASHING, INTERIOR INSULATION, INTERIOR FINISH.

INSTALLATION

THE INSTALLATION DETAILS DESCRIBED ARE OF THE LABORATORY TESTED ASSEMBLY AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, THE LICENSED ENGINEER OR ARCHITECT PREPARED SITE—SPECIFIC DOCUMENTS SHALL BE USED.

SHEATHING

1. WOOD-BASED STRUCTURAL SHEATHING TO CONFORM TO US DOC PS1-09 OR PS2-10 U.N.O.

FASTENERS

NAILS TO CONFORM TO ASTM F1667

METAL SCREWS TO CONFORM TO ASTM C1513

FRAMING

1. METAL FRAMING MEMBERS MINIMUM 18 GAUGE U.NO., 33ksi, COMPLIANCE WITH ANSI S100-16

2. WOOD FRAMING MIN. 2x4 S.G. 0.42, COMPLIANCE WITH US DOC PS20-05

FIBER CEMENT

1. FIBER CEMENT CLADDING TO CONFORM TO ASTM C1186-08(16) GRADE A TYPE 2

TITLE	1	CLIENT	PROJECT					
NICHIHA NIC	CHIPRODUCTS ASSEMBLY DRAWINGS	NICHIH.	A USA, INC	NICH	HPRODUCT:	S MIAMI	DADE 1	AON
_	BOCA ENGINEERING	DATE		REV.	FOR P	UBLICA"	TION	CB
STRUCTURAL AND CIVIL ENGINEERS		NOVEMBER 17, 2023		0	ISSUE			APP
BOCA	#203-1001 CLOVERDALE ANE, VICTORIA BC VBX 4C9 250-477-7777 INFO@BOCAENGINEERING.COM WWW.BOCAENGINEERING.COM	DRAWING NO. 5877-SK1	SHEET NO. 15 OF 15	SCALE NOT T	O SCALE	DES. CB	DRN. NN	CHK. CB

