



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION

11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599

www.miamidade.gov/economy

American Warming & Ventilating a div. of Mestek, Inc.
7301 International Drive
Holland, OH 43528

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Model LE-54 5" Aluminum Louver System

APPROVAL DOCUMENT: Drawing No. **1686-1**, titled "LE-54 Impact Louver System", sheets 1 through 10 of 10, dated 12/19/2024, prepared by American Warming & Ventilating a div. of Mestek, Inc., signed and sealed by Wayne K. Helmila, P.E., bearing the Miami-Dade County Product Control revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **renews and revises** NOA # **23-0713.07** and consists of this page 1 and evidence pages E-1, E-2, E-3 and E-4, as well as approval document mentioned above.

The submitted documentation was reviewed by **Carlos M. Utrera, P.E.**




02/19/25

NOA No. 25-0106.04
Expiration Date: January 6, 2026
Approval Date: February 27, 2025
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. Evidence submitted under previous NOAs

A. DRAWINGS “Submitted under NOA # 11-1117.15”

1. Drawing No. 1670, titled “LE-54 Impact Louver System”, sheets 1 through 10 of 10, dated 07/23/2009, with revision A1 dated 11/07/2011, prepared by W. W. Schaefer Engineering & Consulting, P.A., signed and sealed by Warren W. Schaefer, P.E.

B. TESTS “Submitted under NOA # 09-1015.10”

1. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram, of “EA-52 Aluminum Louver Systems”, prepared by Hurricane Test Laboratory, Inc., Report No. **0198-0305-09**, dated 09/29/2009, signed and sealed by Vinu J. Abraham, P.E.
2. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram, of “EA-52 Aluminum Louver Systems”, prepared by Hurricane Test Laboratory, Inc., Report No. **0198-0715-09**, dated 09/30/2009, signed and sealed by Vinu J. Abraham, P.E.

C. CALCULATIONS “Submitted under NOA # 14-0513.08”

1. Wood screw calculations prepared by W.W. Schaefer Engineering & Consulting, P.A., dated 04/14/2014, signed and sealed by Warren W. Schaefer, P.E.

“Submitted under NOA # 09-1015.10”
2. Structural calculations prepared by W.W. Schaefer Engineering & Consulting, P.A., dated 10/06/2009, signed and sealed by Warren W. Schaefer, P.E.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS

1. None.

F. STATEMENTS “Submitted under NOA # 14-0513.08”

1. Statement letter of code conformance to 2010 and 5th edition (2014) FBC issued by W. W. Schaefer Engineering & Consulting, P.A., dated 04/14/2014, signed and sealed by Warren W. Schaefer, P.E.
2. No financial interest letter issued by W. W. Schaefer Engineering & Consulting, P.A., dated 04/14/2014, signed and sealed by Warren W. Schaefer, P.E.



Carlos M. Utrera, P.E.
Product Control Examiner
NOA No. 25-0106.04

Expiration Date: January 6, 2026
Approval Date: February 27, 2025

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

2. Evidence submitted under NOA # 17-0713.10

A. DRAWINGS

1. Drawing No. **1670**, titled “LE-54 Impact Louver System”, sheets 1 through 10 of 10, dated 07/23/2009, with revision B1 dated 07/05/2017, prepared by W. W. Schaefer Engineering & Consulting, P.A., signed and sealed by Warren W. Schaefer, P.E.

B. TESTS

1. None.

C. CALCULATIONS

1. None.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS

1. None.

F. STATEMENTS

1. Statement letter of code conformance to the 5th Edition (2014) and 6th Edition (2017) FBC issued by W. W. Schaefer Engineering & Consulting, P.A., dated 07/05/2017, signed and sealed by Warren W. Schaefer, P.E.
2. Company name change request letter issued by W.W. Schaefer Engineering & Consulting, P.A., dated 07/05/2017, signed by Warren W. Schaefer, P.E.

3. Evidence submitted under NOA # 20-0622.20

A. DRAWINGS “Submitted under NOA # 19-0401.02”

1. Drawing No. **1670**, titled “LE-54 Impact Louver System”, sheets 1 through 10 of 10, dated 07/23/2009, with revision C1 dated 03/14/2019, prepared by W. W. Schaefer Engineering & Consulting, P.A., signed and sealed by Warren W. Schaefer, P.E.

B. TESTS

1. None.

C. CALCULATIONS

1. None.



Carlos M. Utrera, P.E.
Product Control Examiner
NOA No. 25-0106.04
Expiration Date: January 6, 2026
Approval Date: February 27, 2025

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS

1. None.

F. STATEMENTS

1. Statement letter of code conformance to the 6th edition (2017) and 7th edition (2020) of the FBC issued by W. W. Schaefer Engineering & Consulting, P.A., dated 06/03/2020, signed and sealed by Warren W. Schaefer, P.E.
"Submitted under NOA # 19-0401.02"
2. Statement letter of no financial interest issued by W. W. Schaefer Engineering & Consulting, P.A., dated 03/14/2019, signed and sealed by Warren W. Schaefer, P.E.

4. Evidence submitted under NOA # 23-0713.07

A. DRAWINGS

1. None.

B. TESTS

1. None.

C. CALCULATIONS

1. None.

D. QUALITY ASSURANCE

1. Miami-Dade County Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS

1. None.

F. STATEMENTS

1. Statement letter of code conformance to the 7th edition (2020) and 8th edition (2023) of the FBC issued by W. W. Schaefer Engineering & Consulting, P.A., dated 07/01/2023, signed and sealed by Warren W. Schaefer, P.E.



Carlos M. Utrera, P.E.
Product Control Examiner
NOA No. 25-0106.04
Expiration Date: January 6, 2026
Approval Date: February 27, 2025

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

5. NEW EVIDENCE SUBMITTED

A. DRAWINGS

1. Drawing No. **1686-1**, titled "LE-54 Impact Louver System", sheets 1 through 10 of 10, dated 12/19/2024, prepared by American Warming & Ventilating a div. of Mestek, Inc., signed and sealed by Wayne K. Helmila, P.E.

B. TESTS

1. None.

C. CALCULATIONS

1. Louver A520 anchorage calculations, prepared by Rice Engineering, dated 01/02/2025, signed and sealed by Wayne K. Helmila, P.E.

D. QUALITY ASSURANCE

1. Miami-Dade County Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS

1. None.



F. STATEMENTS

1. Statement letter of code conformance to the 8th edition (2023) of the FBC and of no financial interest, issued by Rice Engineering, dated 01/07/2025, signed and sealed by Wayne K. Helmila, P.E.
2. Verification test contract letter, issued by Intertek, dated 02/14/2025, signed by Austin L. Wilcox, product engineer.



Carlos M. Utrera, P.E.
Product Control Examiner
NOA No. 25-0106.04
Expiration Date: January 6, 2026
Approval Date: February 27, 2025

PANEL LOAD TABLE (WITH SIDE CLIPS)		
PANEL WIDTH (IN.)	(1) CLIP SPACING (IN.)	ALLOWABLE PRESSURE (+/- PSF)
36	8	120
	13	104
	18	75
42	8	120
	13	89
	18	64
48	8	120
	13	78
	18	56
54	8	120
	13	69
	18	50
60	8	120
	13	62
	18	45
(1) CLIP SPACING WITHIN SLEEVE MOUNTED LOUVERS MAY NOT VARY AND SHALL ALWAYS BE 8".		

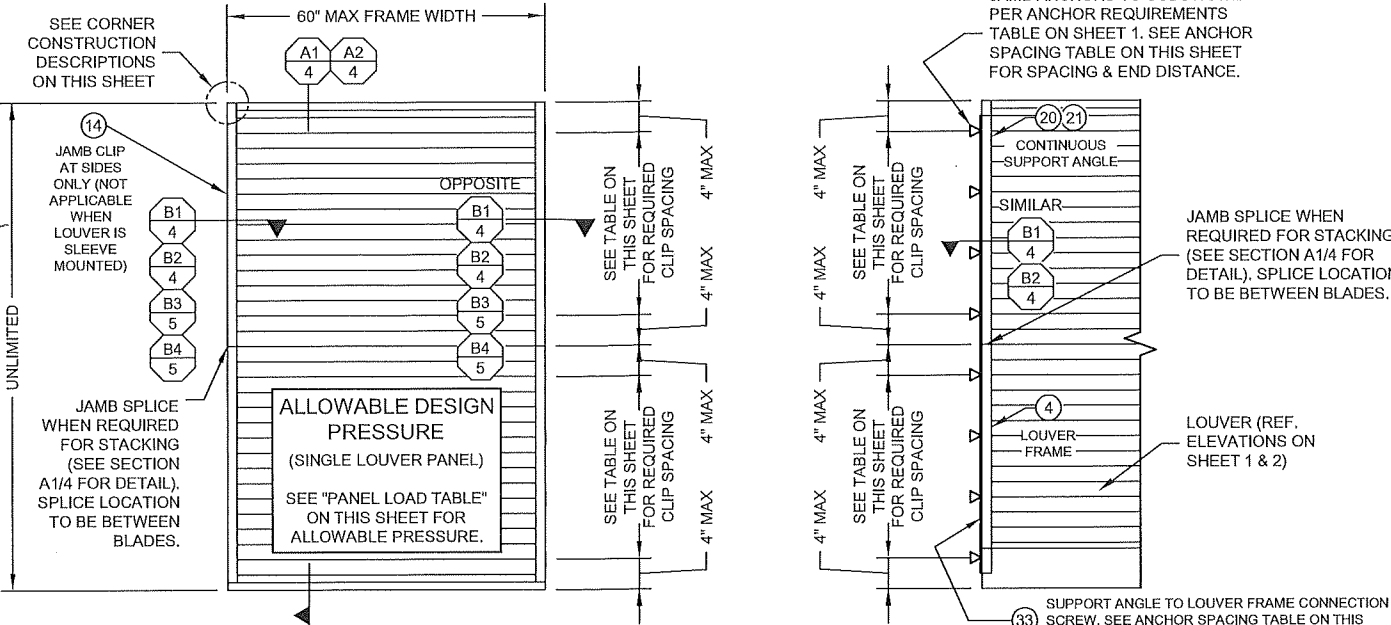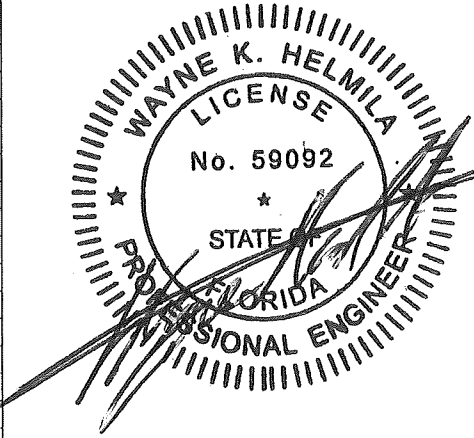

PANEL ANCHOR SPACING/PRESSURE TABLE (WITH CONTINUOUS SIDE SUPPORT ANGLE)					
PANEL WIDTH (IN.)	ANGLE TO SUBSTRATE ANCHORS		ANGLE TO LOUVER FRAME SCREWS		ALLOWABLE PRESSURE (+/- PSF)
	SPACING	END DIST.	SPACING	END DIST.	
	(IN.)	(IN.)	(IN.)	(IN.)	
36	8	4	4	2	120
	13	7 1/2	7 1/2	3 3/4	104
	18	9	9	4 1/2	75
42	8	4	4	2	120
	13	7 1/2	7 1/2	3 3/4	89
	18	9	9	4 1/2	64
48	8	4	4	2	120
	13	7 1/2	7 1/2	3 3/4	78
	18	9	9	4 1/2	56
54	8	4	4	2	120
	13	7 1/2	7 1/2	3 3/4	69
	18	9	9	4 1/2	50
60	8	4	4	2	120
	13	7 1/2	7 1/2	3 3/4	62
	18	9	9	4 1/2	45

GENERAL NOTES

- THESE LOUVER SYSTEMS HAVE BEEN TESTED, ANALYZED, & APPROVED FOR DESIGN PRESSURES NOT TO EXCEED THOSE SHOWN IN THE ALLOWABLE DESIGN PRESSURE TABLE(S).
- OPENINGS, BUCKING, & BUCKING FASTENERS MUST BE PROPERLY DESIGNED & INSTALLED TO TRANSFER WIND LOADS TO THE STRUCTURE. IT SHALL BE THE RESPONSIBILITY OF THE PERMIT HOLDER TO VERIFY THE STRUCTURAL INTEGRITY OF THE EXISTING STRUCTURE TO SUPPORT THE LOADS SUPERIMPOSED BY THE LOUVERS.
- ALL HARDWARE & FASTENERS SHALL BE IN ACCORDANCE WITH THESE DRAWINGS & SHALL NOT VARY UNLESS SPECIFICALLY MENTIONED ON THE DRAWINGS. SPECIFIED ANCHOR EMBED TO BASE MATERIAL SHALL BE BEYOND WALL FINISH OR STUCCO.
- THE DETAILS & SPECIFICATIONS SHOWN HEREIN REPRESENT THE PRODUCTS TESTED & PROPOSED FOR IMPACT, CYCLIC, & UNIFORM STATIC AIR PRESSURE TESTING IN CONFORMANCE WITH THE FLORIDA BUILDING CODE PROTOCOLS TAS-201, 202, & 203 FOR LARGE MISSILE IMPACT LOUVERS.
- THESE LOUVER SYSTEMS HAVE BEEN DESIGNED IN ACCORDANCE WITH AND MEET THE REQUIREMENTS OF THE FLORIDA BUILDING CODE (FBC) INCLUDING HIGH VELOCITY HURRICANE ZONES (HVHZ).
- IMPACT SHUTTERS ARE NOT REQUIRED WITH THESE LOUVER SYSTEMS.
- ALL ANCHORS SECURING LOUVER FRAME TO PRESSURE TREATED BUCKS OR WOOD FRAMING SHALL BE CAPABLE OF RESISTING CORROSION CAUSED BY THE PRESSURE TREATING CHEMICALS IN THE WOOD.
- DETERMINE THE POSITIVE & NEGATIVE DESIGN LOADS TO USE WHEN REFERENCING THESE DOCUMENTS IN ACCORDANCE WITH THE GOVERNING CODE AND GOVERNING WIND VELOCITY. FOR WIND LOAD CALCULATIONS IN ACCORDANCE WITH THE FLORIDA BUILDING CODE, A DIRECTIONALITY FACTOR OF KD = 0.85 MAY BE APPLIED PER THE ASCE-7 STANDARD.
- NO INCREASE IN ALLOWABLE STRESS HAS BEEN USED IN THE CERTIFICATION OF THIS PRODUCT. WIND LOAD DURATION FACTOR CD = 1.6 WAS USED FOR WOOD SCREW ANALYSIS ONLY.
- MATERIALS, INCLUDING BUT NOT LIMITED TO STEEL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF FLORIDA BUILDING CODE CHAPTER 20.
- EACH LOUVER ASSEMBLY SHALL BE PERMANENTLY LABELED AS FOLLOWS:

AMERICAN WARMING AND VENTILATING
BOWLING GREEN, OH
MIAMI-DADE COUNTY PRODUCT CONTROL APPROVED
- THESE LOUVERS ARE NOT TESTED FOR WATER INFILTRATION RESISTANCE; THEREFORE THE LOUVERS ARE TO BE INSTALLED IN A LOCATION WHERE THE ROOM BEHIND THE LOUVER IS DESIGNED TO DRAIN WATER PENETRATING INTO THE ROOM, AND THE ROOM WILL HOUSE WATER RESISTANT/WATER PROOF EQUIPMENT, COMPONENTS OR SUPPLIES.
- MULLED PANELS MAY BE HORIZONTALLY INSTALLED TO AN UNLIMITED NUMBER. VERTICAL STACKING OF MULLED PANELS MAY OCCUR PROVIDING A STRUCTURAL SUPPORT IS DESIGNED & INSTALLED BY OTHERS TO SUPPORT ALL LOADS TRANSFERRED FROM THE LOUVER ASSEMBLY (SINGLE PANELS MAY RUN TO UNLIMITED HEIGHT PER ELEVATION IF NO MULLION EXISTS).

RICE
ENGINEERING
105 School Creek Trail
Luxemburg, WI 54217
Phone: (920) 617-1042
Fax: (920) 617-1100
www.rice-inc.com
Florida Firm No: F-01000005061
Certificate of Authorization: #9092
Wayne K. Helmila
Registration No: 59092

EXTERIOR ELEVATION:
SINGLE WIDE LOUVER PANEL
(ARCHITECTURAL & NON-ARCHITECTURAL)
SCALE: 1/2" = 1'-0"

INTERIOR ELEVATION:
(OPTIONAL SIDE JAMB INSTALLATION WITH
CONTINUOUS SIDE ANGLES)
SCALE: 1/2" = 1'-0" (FOR DETAIL NOT SHOWN,
SEE OTHER ELEVATIONS)

ANCHOR REQUIREMENTS TABLE				
JAMB ANCHORS				
SUBSTRATE	FASTENER	QTY PER SPACING	MIN. EMBED	MIN. EDGE
WOOD (MIN. GR. 3 & G=0.55)	1/4" DIA. S.S. LAG SCREW	2	2-3/8"	1-1/2"
A36 STEEL (MIN. 1/8" THK.)	1/4-14 300 SERIES Fy=65ksi S.S. SCREW	2	FULL	1/2"
METAL STUD (MIN. 16 GA. 33 KSI)	1/4-14 300 SERIES Fy=65ksi S.S. SCREW	2	FULL	1/2"
ALUMINUM (MIN. 1/8" THK. 6063-T5)	1/4-14 300 SERIES Fy=65ksi S.S. SCREW	2	FULL	1/2"
CMU (MIN. C-90)	1/4 300 SERIES S.S. MASONRY SCREW	2	2"	4"
CONCRETE (MIN. 4000 PSI)	1/4" DIA. S.S. WEDGE ANCHOR	2	1-3/4"	2"
CONCRETE [ALT.] (MIN. 3000 PSI)	3/8" DIA. S.S. CONCRETE SCREW	1	2"	2"
NON-REINFORCED MULLION END CLIP ANCHORS				
SUBSTRATE	FASTENER	QTY PER CLIP	MIN. EMBED	MIN. EDGE
WOOD (MIN. GR. 3 & G=0.55)	1/4" DIA. S.S. LAG SCREW	8	2-3/8"	1-1/2"
A36 STEEL (MIN. 1/8" THK.)	1/4-14 300 SERIES Fy=65ksi S.S. SCREW	8	FULL	1/2"
METAL STUD (MIN. 16 GA. 33 KSI)	1/4-14 300 SERIES Fy=65ksi S.S. SCREW	8	FULL	1/2"
ALUMINUM (MIN. 1/8" THK. 6063-T5)	1/4-14 300 SERIES Fy=65ksi S.S. SCREW	8	FULL	1/2"
CONCRETE (MIN. 4000 PSI)	1/4" DIA. S.S. WEDGE ANCHOR	8	1-3/4"	3-3/4"
CONCRETE [ALT.] (MIN. 3000 PSI)	3/8" DIA. S.S. CONCRETE SCREW	8	2-1/2"	3-1/2"
TUBE MULLION END CLIP ANCHORS				
SUBSTRATE	FASTENER	QTY PER END	MIN. EMBED	MIN. EDGE
WOOD (MIN. GR. 3 & G=0.55)	1/4" DIA. S.S. LAG SCREW	10	2-1/4"	1-1/2"
A36 STEEL (MIN. 1/8" THK.)	1/4-14 300 SERIES Fy=65ksi S.S. SCREW	8	FULL	1/2"
METAL STUD (MIN. 16 GA. 33 KSI)	1/4-14 300 SERIES Fy=65ksi S.S. SCREW	8	FULL	1/2"
ALUMINUM (MIN. 1/8" THK. 6063-T5)	1/4-14 300 SERIES Fy=65ksi S.S. SCREW	8	FULL	1/2"
CONCRETE (MIN. 3000 PSI)	1/2" S.S. WEDGE ANCHOR	2	3-3/4"	5"
1. Concrete screws shall be Hilti KWIK HUS-EZ stainless steel. 2. CMU screws shall be Dewalt Aggre-Gator HWH 300 Series stainless steel. 3. Wedge anchors shall be Hilti KWIK Bolt T22 stainless steel. 4. CMU is applicable at jamba only.				

NOTE: SINGLE LOUVER PANELS MAY BE STACKED/SPICED VERTICALLY OR THE LOUVER PANEL MAY RUN VERTICALLY TO INFINITE HEIGHT PROVIDING OPENING IS PROPERLY DESIGNED BY OTHERS TO SUPPORT THE LOUVER PANELS.

SLEEVE SPlicing NOTE FOR SLEEVE MOUNTED LOUVERS:

SLEEVE MAY BE SPICED ALONG HORIZONTAL OR VERTICAL RUNS PROVIDING SPICE DOES NOT OCCUR WITHIN 12" OF ANY VERTICAL MULLION CENTERLINE.

CORNER & BLADE END CONSTRUCTION:

FRAME HEAD: HORIZONTAL MEMBER IS SQUARE CUT, BUTTED TO VERTICAL MEMBERS, & FASTENED WITH TWO (2) NO. 7 X 1-1/4" SMS HEX HEAD SCREWS INTO THE HORIZONTAL MEMBERS SCREW SPLINES.

FRAME SILL: VERTICAL MEMBERS ARE ANGLE CUT, BUTTED TO HORIZONTAL MEMBER, & FASTENED WITH TWO (2) NO. 7 X 1-1/4" SMS SCREWS INTO THE VERTICAL MEMBERS SCREW SPLINES.

BLADE END: HORIZONTAL BLADES ARE SQUARE CUT, BUTTED TO VERTICAL MEMBERS, & FASTENED WITH TWO (2) NO. 7 OR NO. 8 X 1-1/4" SMS SCREWS INTO THE BLADE SCREW SPLINES.

THESE DRAWINGS ARE APPLICABLE ONLY TO THE PRODUCT SPECIFIED. THEY MAY NOT BE USED FOR THE ASSEMBLY AND/OR INSTALLATION OF ANY OTHER PRODUCT NOR MAY THEY BE USED FOR RATIONAL AND/OR LOCAL APPROVAL OF ANY PRODUCT NOT PRODUCED BY THE MANUFACTURER STATED ON THESE DRAWINGS.

www.qwv.com

A MESTEK COMPANY

219 S. CHURCH STREET, SUITE 200
BOWLING GREEN, OHIO 43402

This drawing and the information contained therein is the property of MESTEK, Inc. and cannot be reproduced in whole or in part, nor delivered to others without the express written permission of MESTEK, Inc.

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 25-0106.04
Expiration Date 01/06/2026
By
Miami-Dade Product Control

LE-54 IMPACT
LOUVER SYSTEM

REVISIONS			
REV.	DATE	DESCRIPTION	BY


DATE: 19 DEC, 2024
DRAWN BY: MTC
CHECKED BY: JMC

34656-STD


SHEET No.: 1 of 10
SCALE: 1/2" = 1'-0"
REV. -----

MULLION ALLOWABLE DESIGN PRESSURE (NON-ARCHITECTURAL LOUVERS)				
MAXIMUM MULLION SPAN (IN.)	MAXIMUM LOAD WIDTH (IN.)	ALLOWABLE PRESSURE (+/- PSF)		
		WITH NO TUBE MULLION	WITH 4" X 3" X 3/16" TUBE MULLION	WITH 4" X 3" X 1/4" TUBE MULLION
120	60	30.6	46.1	61.4
	54	34.0	51.2	68.3
	48	38.3	57.6	76.8
	42	43.7	65.8	87.8
	36	51.0	76.8	102.4
	30	61.2	92.2	120.0
	24	76.5	115.2	120.0
	18	102.0	120.0	120.0
108	60	42.0	63.2	84.3
	54	46.6	70.2	93.6
	48	52.5	79.0	105.3
	42	60.0	90.3	120.0
	36	70.0	105.3	120.0
	30	84.0	120.0	120.0
	24	104.9	120.0	120.0
	18	120.0	120.0	120.0
96	60	56.3	90.0	120.0
	54	62.5	100.0	120.0
	48	70.3	112.5	120.0
	42	80.4	120.0	120.0
	36	93.8	120.0	120.0
	30	112.5	120.0	120.0
	24	120.0	120.0	120.0
	18	120.0	120.0	120.0
84	60	64.3	120.0	120.0
	54	71.4	120.0	120.0
	48	80.4	120.0	120.0
	42	91.8	120.0	120.0
	36	107.1	120.0	120.0
	30	120.0	120.0	120.0
	24	120.0	120.0	120.0
	18	120.0	120.0	120.0
72	60	75.0	120.0	120.0
	54	83.3	120.0	120.0
	48	93.8	120.0	120.0
	42	107.1	120.0	120.0
	36	120.0	120.0	120.0
	30	120.0	120.0	120.0
	24	120.0	120.0	120.0
	18	120.0	120.0	120.0
60	60	90.0	120.0	120.0
	54	100.0	120.0	120.0
	48	112.5	120.0	120.0
	42	120.0	120.0	120.0
	36	120.0	120.0	120.0
	30	120.0	120.0	120.0
	24	120.0	120.0	120.0
	18	120.0	120.0	120.0
48	60	112.5	120.0	120.0
	54	120.0	120.0	120.0
42	60	120.0	120.0	120.0

NOTES:
1. SEE ELEVATION FOR DIMENSIONING OF LOAD WIDTH.
2. ALLOWABLE UNIT PRESSURE SHALL BE THE LESSER OF THE PRESSURE SHOWN IN THIS TABLE & THAT SPECIFIED FOR THE INDIVIDUAL LOUVER PANEL.

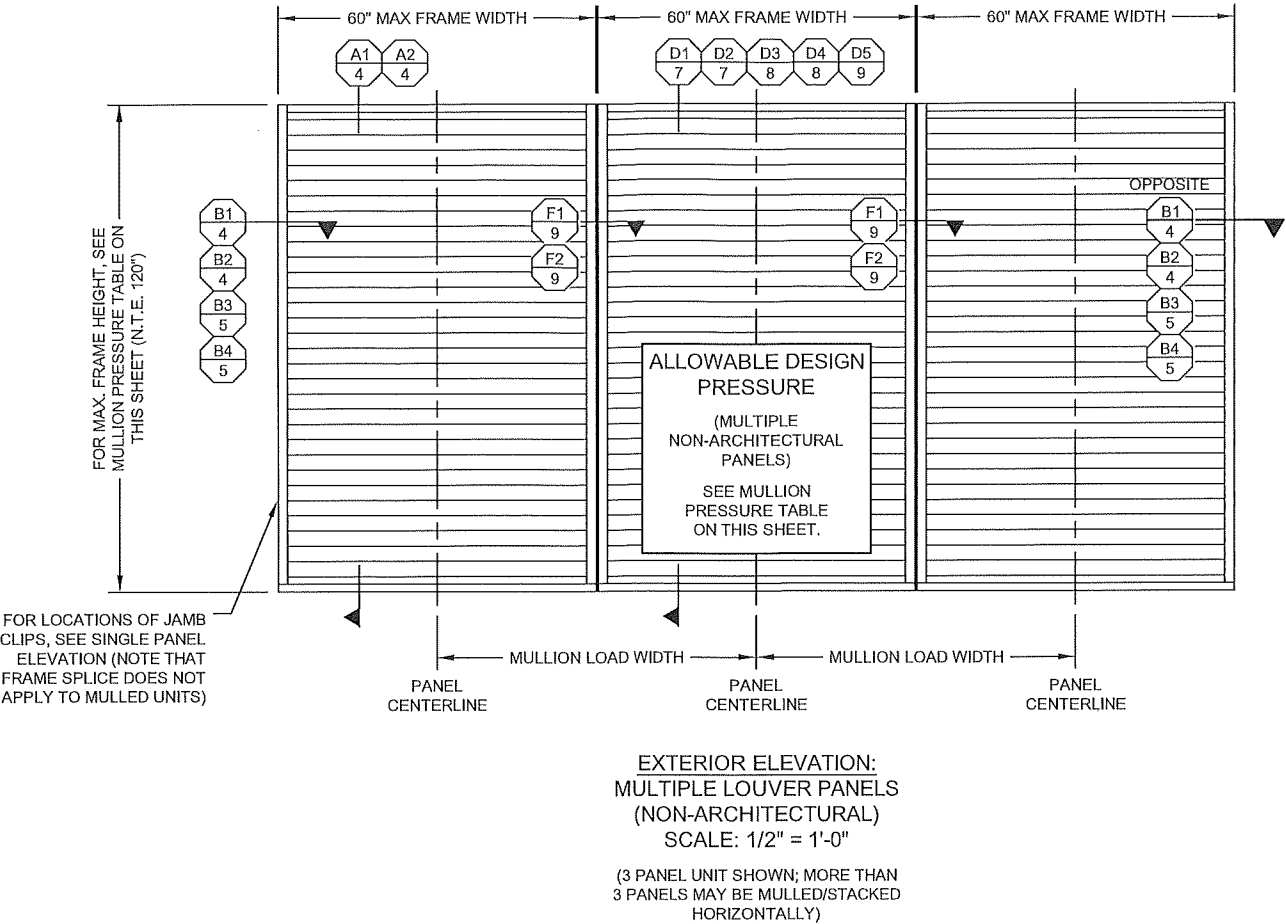

PRODUCT REVISED
as complying with the Florida Building Code
NOA-No. 25-0106.04
Expiration Date 01/06/2026
By *[Signature]*
Miami-Dade Product Control

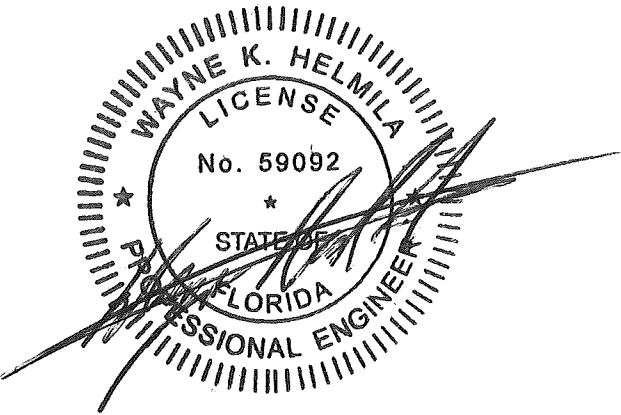


JAN 3 0 2025

RICE
ENGINEERING
105 School Creek Trail
Luxemburg, WI 54217
Phone: (920) 617-1042
Fax: (920) 617-1100
www.rice-inc.com
Florida Firm No: F-01000005061
Certificate of Authorization: #9090
Wayne K. Helmila
Registration No: 59092

 www.qwv.com A MESTEK COMPANY 219 S. CHURCH STREET, SUITE 200 BOWLING GREEN, OHIO 43402 <small>This drawing and the information contained therein is the property of MESTEK, Inc. and cannot be reproduced in whole or in part, nor delivered to others without the express written permission of MESTEK, Inc.</small>	CERTIFICATION	LE-54 IMPACT LOUVER SYSTEM	REVISIONS				DATE: 19 DEC, 2024	SHEET No.: 2 of 10
			REV.	DATE	DESCRIPTION	BY	DRAWN BY: MTC CHECKED BY: JMC	SCALE: 1/2" = 1'-0" REV. ----


MULLION ALLOWABLE DESIGN PRESSURE (ARCHITECTURAL LOUVERS)		
MAXIMUM MULLION SPAN (IN.)	MAXIMUM LOAD WIDTH (IN.)	ALLOWABLE PRESSURE (+/- PSF)
120	60	61.4
	54	68.3
	48	76.8
	42	87.8
	36	102.4
	30	120.0
108	60	84.3
	54	93.6
	48	105.3
	42	120.0
96	60	120.0


NOTES:
 1. SEE ELEVATION FOR DIMENSIONING OF LOAD WIDTH.
 2. ALLOWABLE UNIT PRESSURE SHALL BE THE LESSER OF THE PRESSURE SHOWN IN THIS TABLE & THAT SPECIFIED FOR THE INDIVIDUAL LOUVER PANEL.

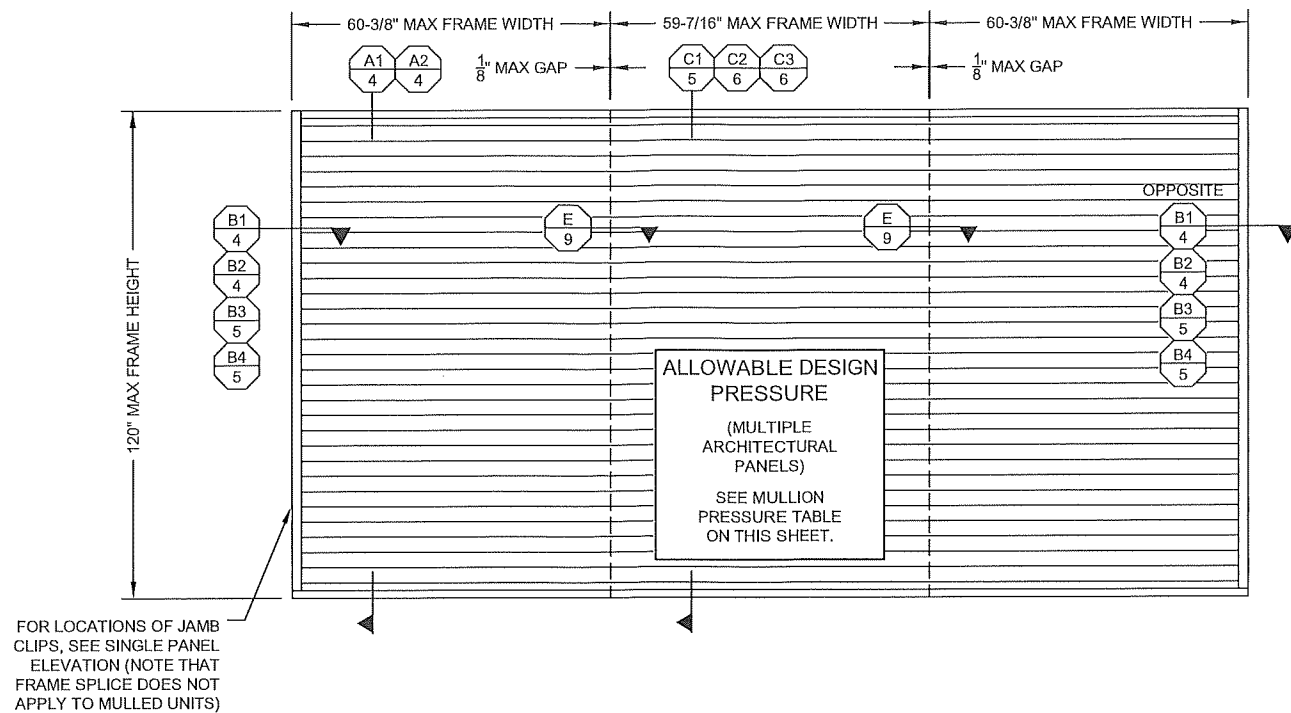

EXTERIOR ELEVATION:
MULTIPLE LOUVER PANELS
(ARCHITECTURAL)
SCALE: 1/2" = 1'-0"

(3 PANEL UNIT SHOWN; MORE THAN
3 PANELS MAY BE MULLED/STACKED
HORIZONTALLY)

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 25-0106.04
Expiration Date 01/06/2026
By 
Miami-Dade Product Control

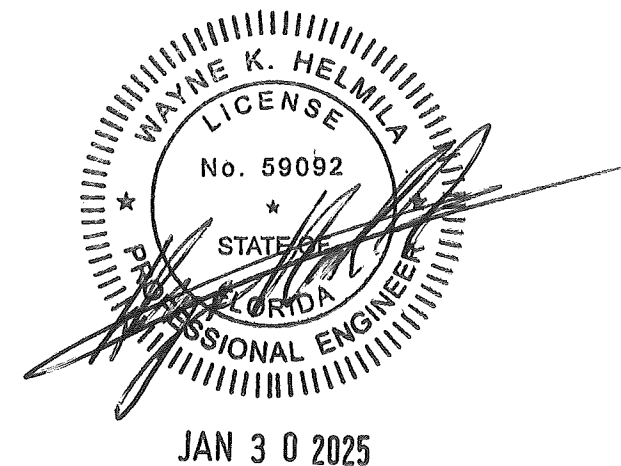


<div><div>qwv</div><div>www.qwv.com</div><div>A MESTEK COMPANY</div><div>219 S. CHURCH STREET, SUITE 200 BOWLING GREEN, OHIO 43402</div><div><div>This drawing and the information contained therein is the property of MESTEK, Inc. and cannot be reproduced in whole or in part, nor delivered to others without the express written permission of MESTEK, Inc.</div></div></div>	CERTIFICATION	LE-54 IMPACT LOUVER SYSTEM	REVISIONS				DATE: 19 DEC, 2024	SHEET No.: 3 of 10
			REV.	DATE	DESCRIPTION	BY	DRAWN BY: MTC	
							CHECKED BY: JMC	
								SCALE: 1/2" = 1'-0"
							34656-STD	REV. ----


RICE
ENGINEERING

105 School Creek Trail
Luxemburg, WI 54217
Phone: (920) 617-1042
Fax: (920) 617-1100
www.rice-inc.com


Florida Firm No: F-01000005061
Certificate of Authorization: #9090
Wayne K. Helmila
Registration No: 59092

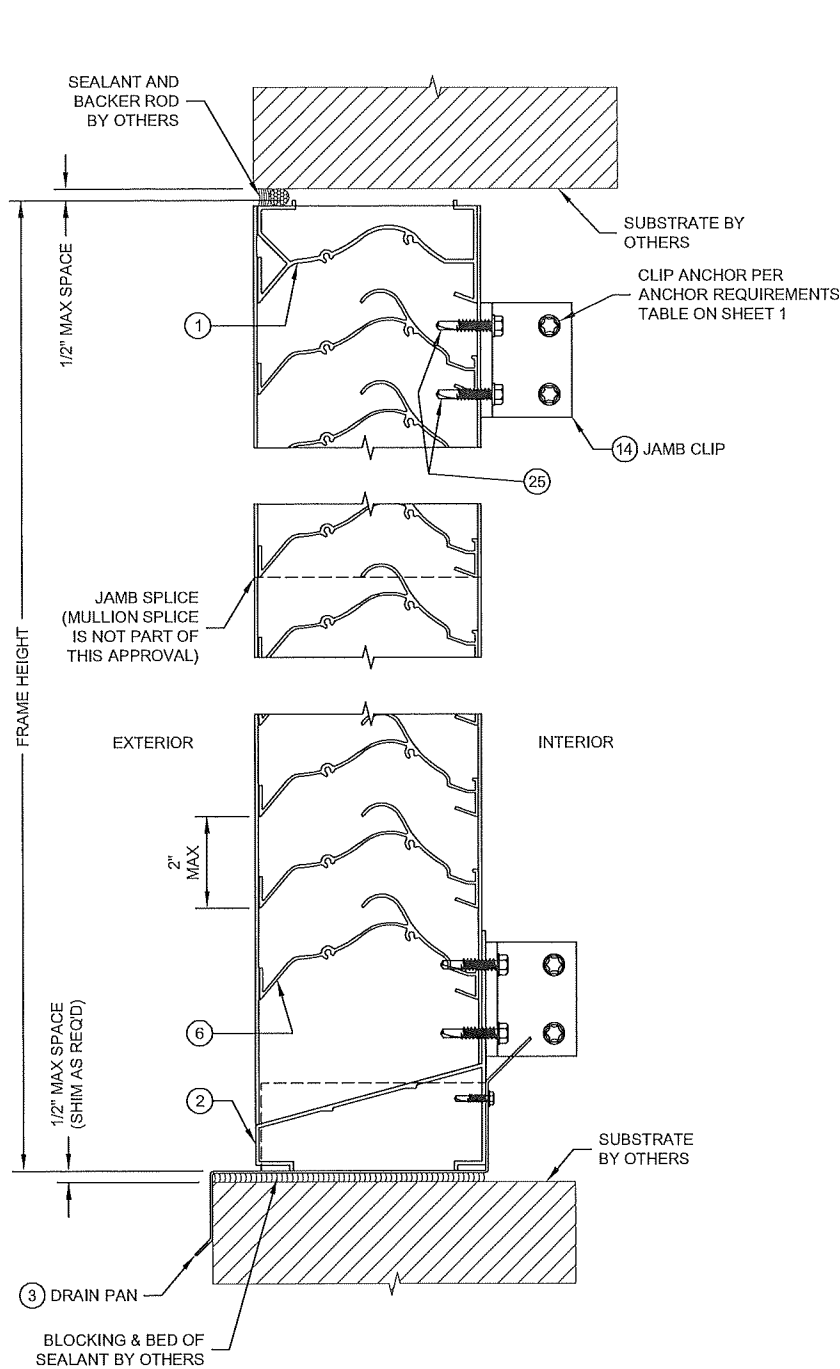

SECTION A1
SCALE: 3" = 1'-0"

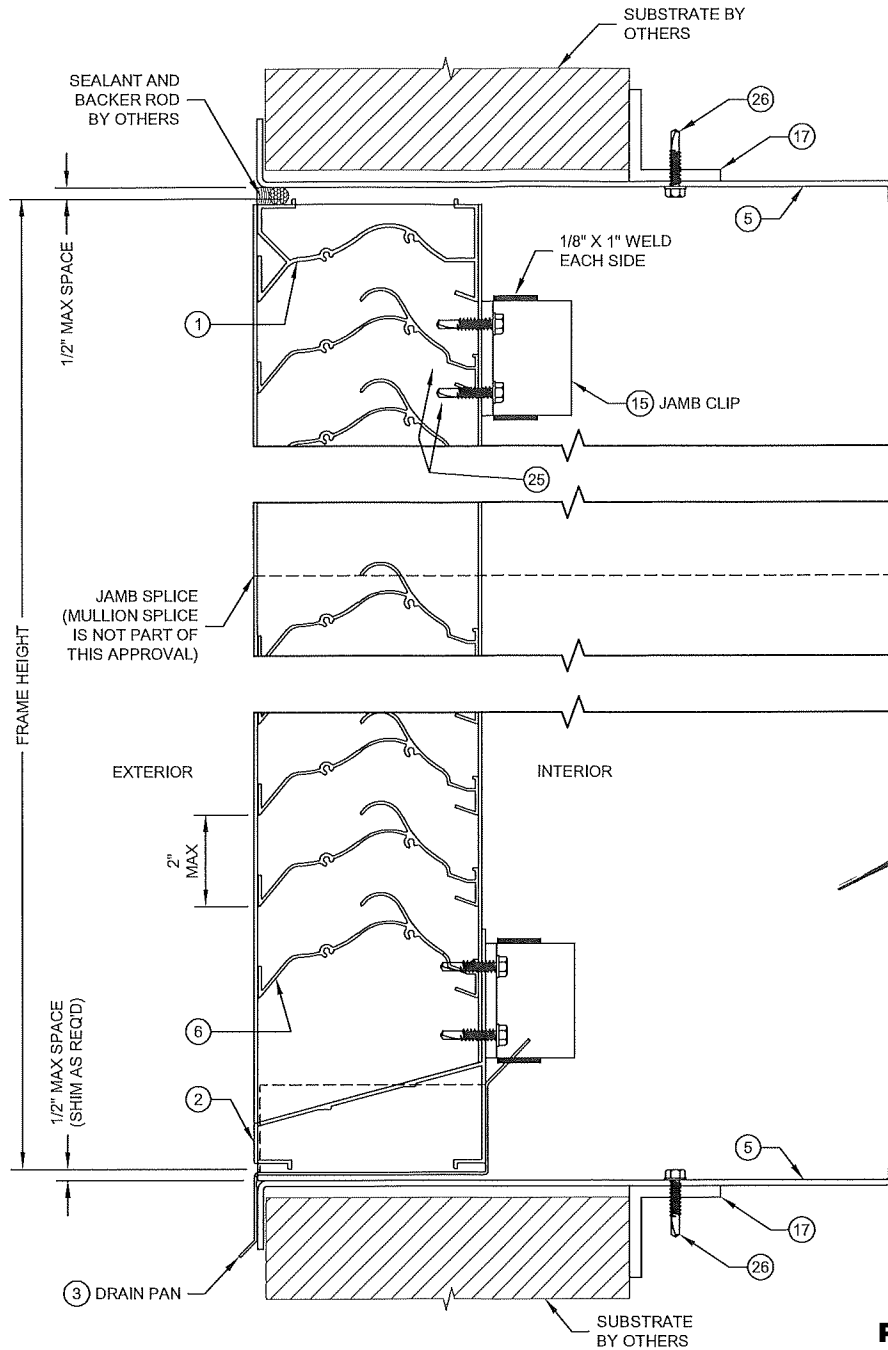


SECTION A2
SCALE: 3" = 1'-0"
(SLEEVE MOUNT)

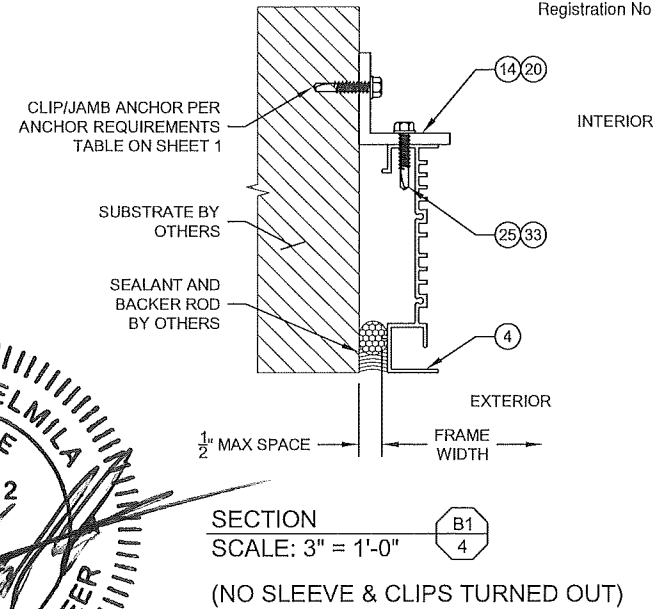


SECTION B1
SCALE: 3" = 1'-0"

(NO SLEEVE & CLIPS TURNED OUT)

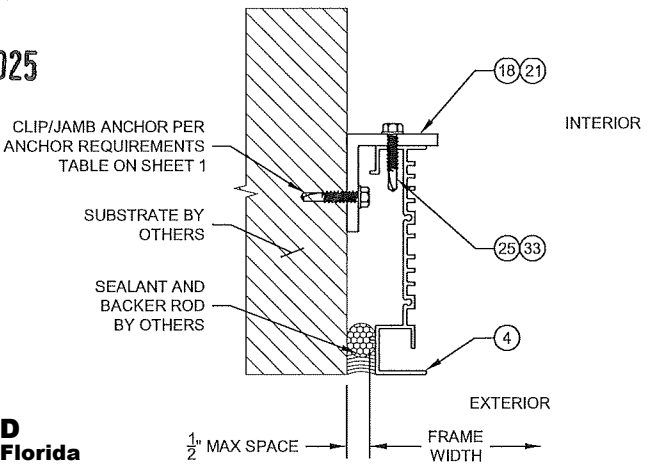

SECTION B2
SCALE: 3" = 1'-0"

(NO SLEEVE & CLIPS TURNED IN)

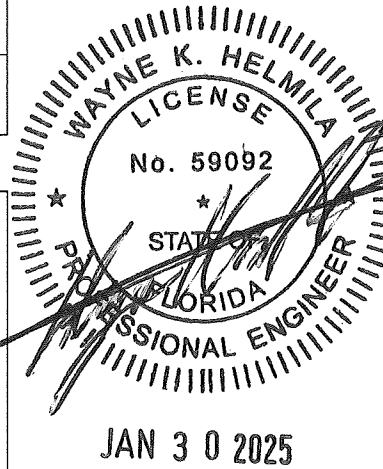

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 25-0106.04
Expiration Date 01/06/2026
By Miami-Dade Product Control

qvw
www.qvw.com

A MESTEK COMPANY
219 S. CHURCH STREET, SUITE 200
BOWLING GREEN, OHIO 43402

This drawing and the information contained therein is the property of MESTEK, Inc. and cannot be reproduced in whole or in part, nor delivered to others without the express written permission of MESTEK, Inc.

CERTIFICATION

LE-54 IMPACT
LOUVER SYSTEM

REVISIONS

REV.	DATE	DESCRIPTION	BY

DATE: 19 DEC, 2024
DRAWN BY: MTC
CHECKED BY: JMC


34656-STD

SHEET No.:
4 of 10


SCALE:
3" = 1'-0"

REV.


RICE
ENGINEERING
105 School Creek Trail
Luxemburg, WI 54217
Phone: (920) 617-1042
Fax: (920) 617-1100
www.rice-inc.com
Florida Firm No: F-01000005061
Certificate of Authorization: #9090
Wayne K. Helmila
Registration No: 59092

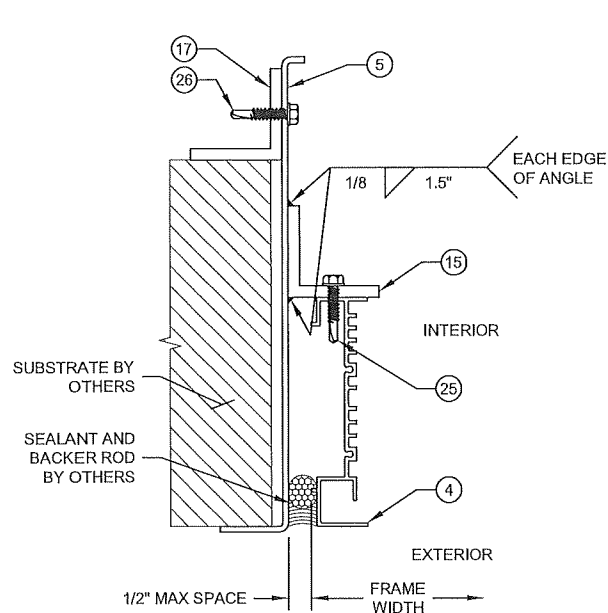


SECTION
SCALE: 3" = 1'-0" **B3**
5
(WITH SLEEVE & CLIPS TURNED OUT)

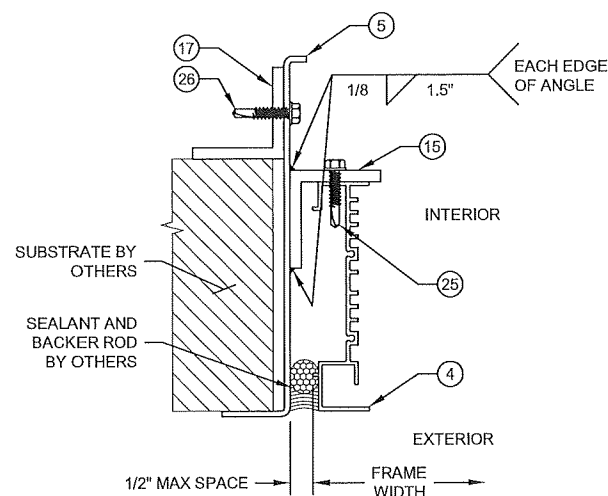

SECTION
SCALE: 3" = 1'-0" **B4**
5
(WITH SLEEVE & CLIPS TURNED IN)

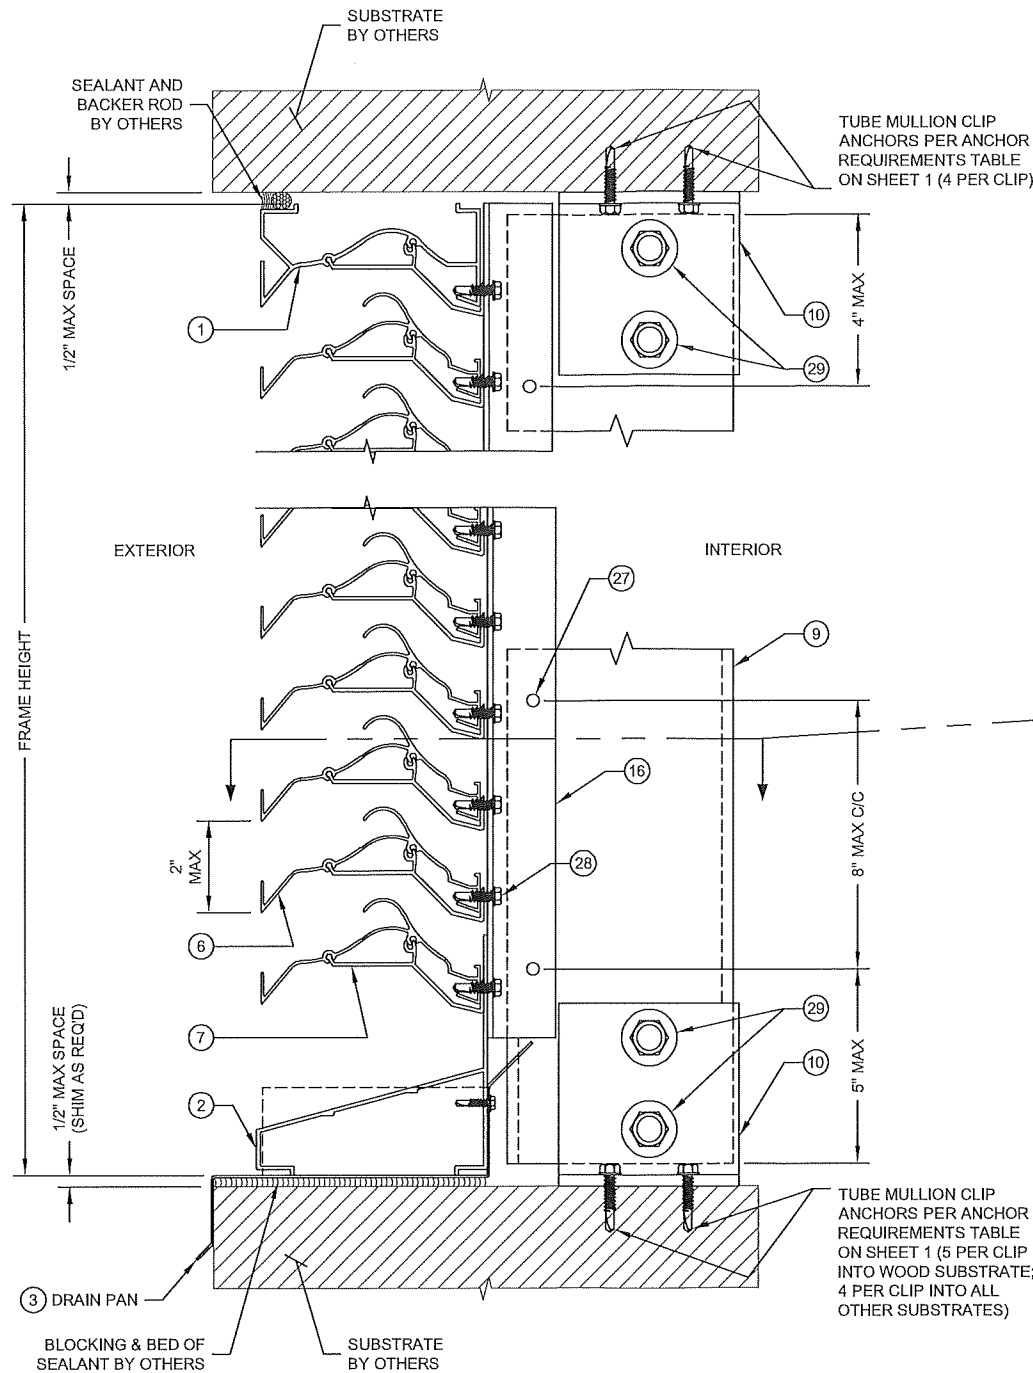


SECTION
SCALE: 3" = 1'-0" **C1**
5
(ARCHITECTURAL LOUVER WITHOUT PERIMETER SLEEVE; INSTALLED INTO WOOD, STEEL, ALUMINUM, OR METAL STUD SUBSTRATE)

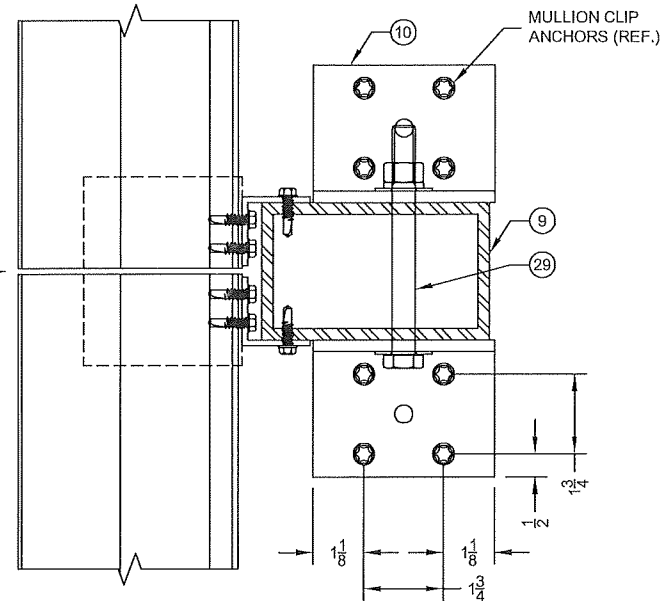


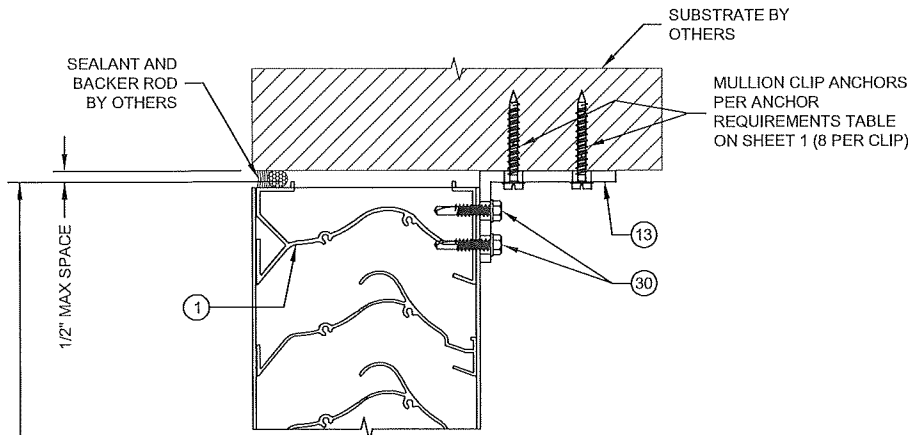
(FOR DETAIL NOT SHOWN,
SEE SECTION E/9)

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 25-0106.04
Expiration Date 01/06/2026
By *[Signature]*
Miami-Dade Product Control

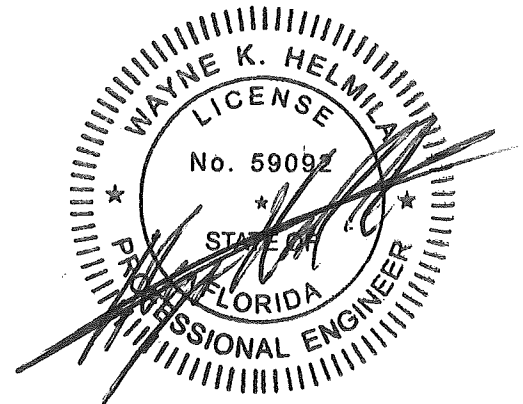

JAN 30 2025

<div> www.qwv.com</div> <div>A MESTEK COMPANY</div> <div>219 S. CHURCH STREET, SUITE 200 BOWLING GREEN, OHIO 43402</div> <div><small>This drawing and the information contained therein is the property of MESTEK, Inc. and cannot be reproduced in whole or in part, nor delivered to others without the express written permission of MESTEK, Inc.</small></div>	CERTIFICATION	LE-54 IMPACT LOUVER SYSTEM	REVISIONS				DATE: 19 DEC, 2024	SHEET No.: 5 of 10
			REV.	DATE	DESCRIPTION	BY	DRAWN BY: MTC	
							CHECKED BY: JMC	SCALE: 3" = 1'-0"
							34656-STD	REV. ---




RICE


ENGINEERING

105 School Creek Trail
Luxemburg, WI 54217
Phone: (920) 617-1042
Fax: (920) 617-1100
www.rice-inc.com

Florida Firm No: F-0100005061
Certificate of Authorization: #9090
Wayne K. Helmila
Registration No: 59092

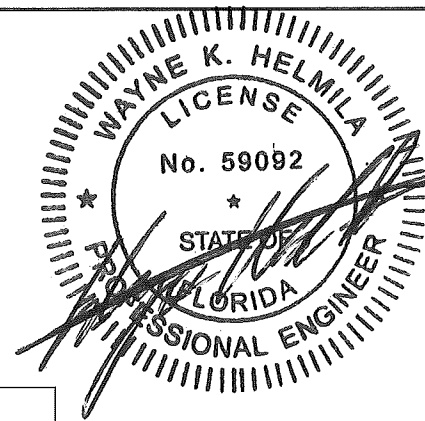

JAN 30 2025

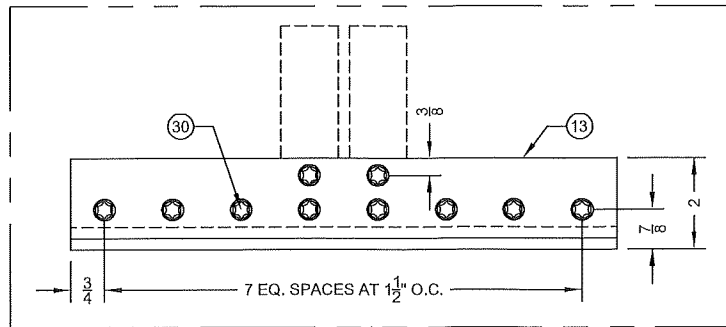


PRODUCT REVISED
as complying with the Florida
Building Code

NOA-No. 25-0106.04




Expiration Date 01/06/2026

By *[Signature]*
Miami-Dade Product Control

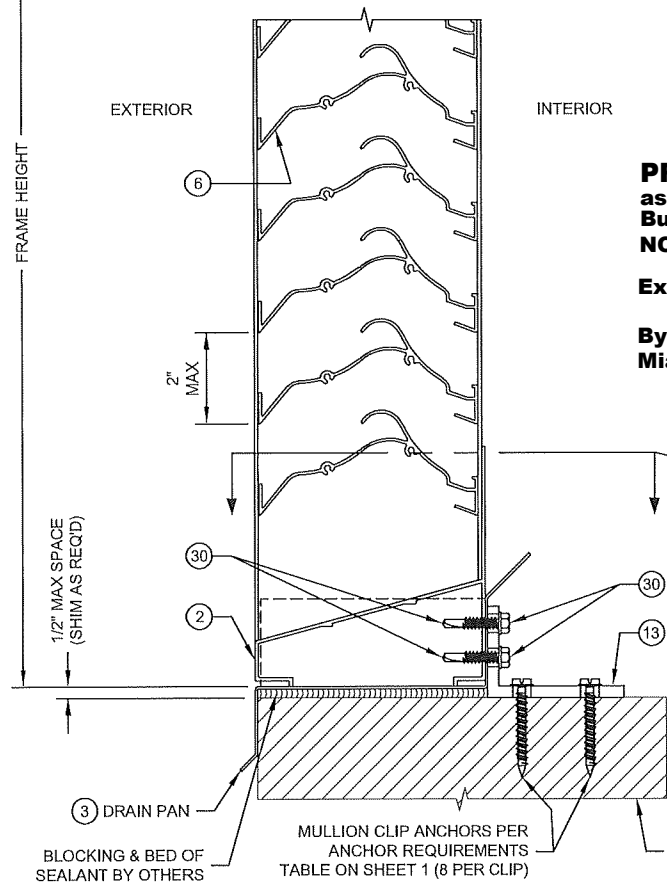

SECTION
SCALE: 3" = 1'-0" D1
7

(NON-ARCHITECTURAL LOUVER WITHOUT
PERIMETER SLEEVE & WITHOUT TUBE MULLION;
INSTALLED INTO ALL SUBSTRATES)

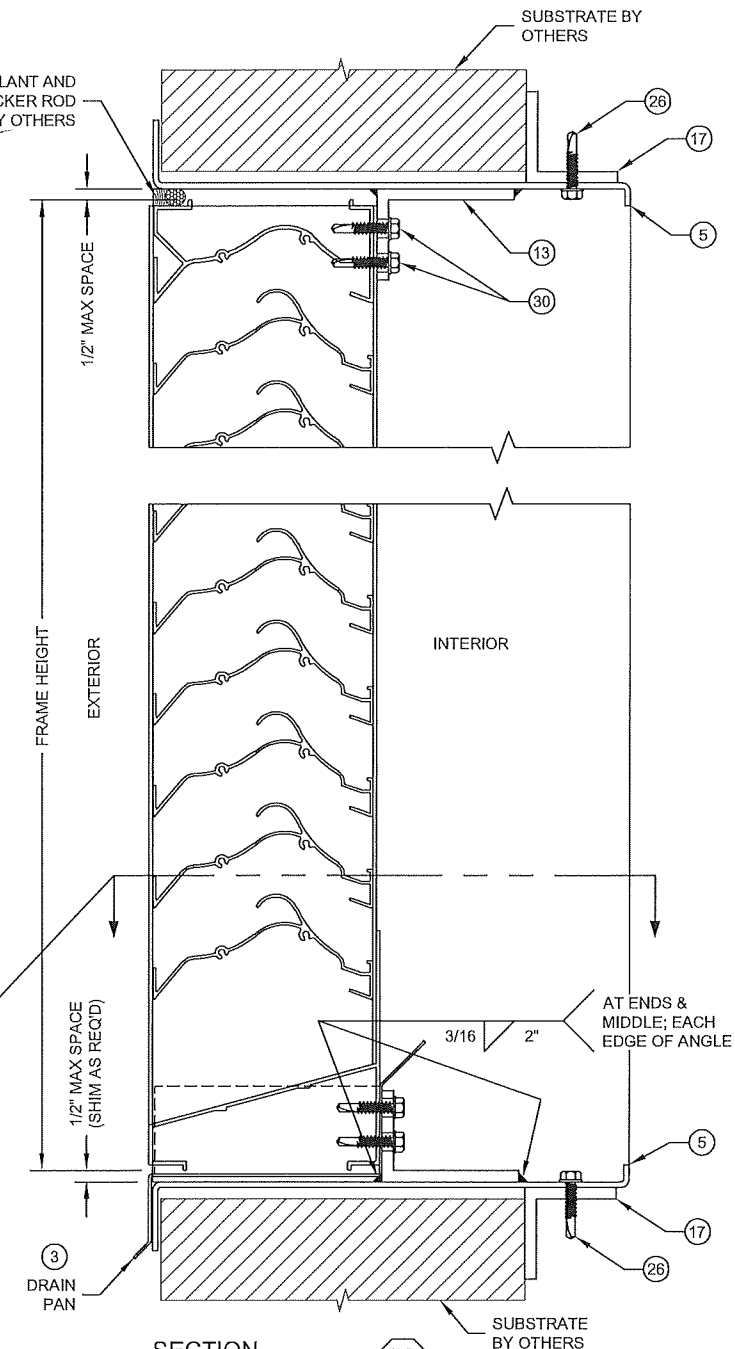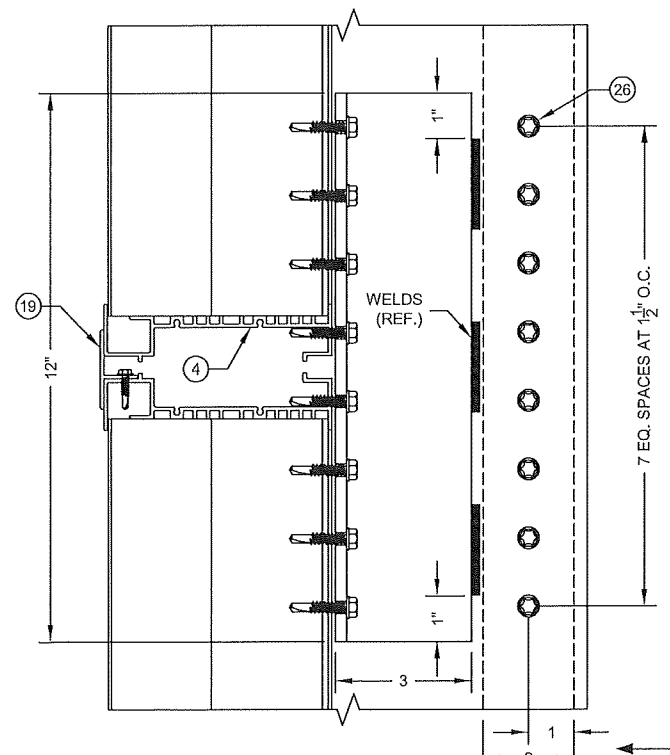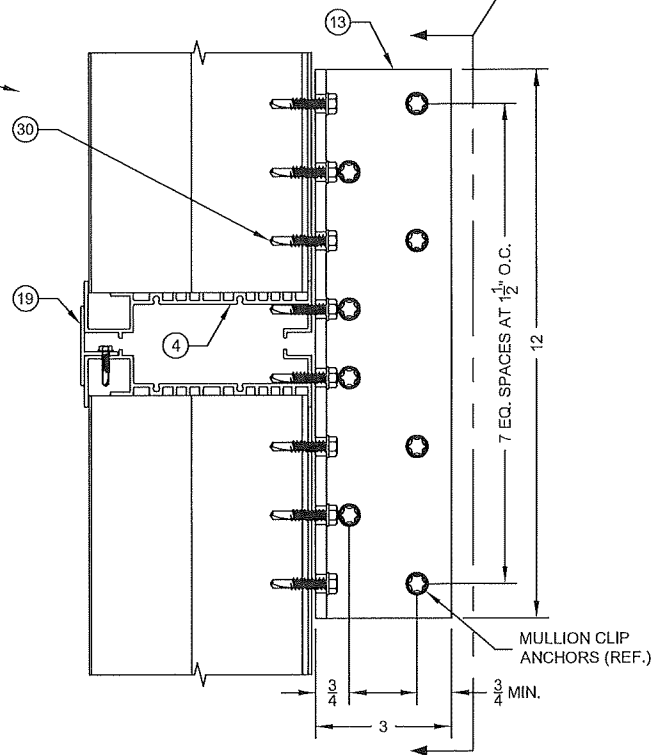

SECTION
SCALE: 3" = 1'-0" D2
7

(NON-ARCHITECTURAL LOUVER WITH
PERIMETER SLEEVE & WITHOUT TUBE MULLION;
INSTALLED INTO ALL SUBSTRATES)

(FOR DETAIL NOT SHOWN, SEE SECTION D1/7)

POSITION OF THE SLEEVE PERIMETER SUPPORT ANGLE VARIES WITH SUBSTRATE THICKNESS & MAY BE POSITIONED UNDER THE MULLION END SUPPORT ANGLE. WHEN THIS OCCURS, THE SLEEVE ANGLE ATTACHMENT SCREWS SHALL MOVE WITH THE ANGLE & MAY BE POSITIONED TO RUN THROUGH THE MULLION END ANGLE AND SLEEVE.

qvw
www.qvw.com

A MESTEK COMPANY

219 S. CHURCH STREET, SUITE 200
BOWLING GREEN, OHIO 43402

This drawing and the information contained therein is the property of MESTEK, Inc. and cannot be reproduced in whole or in part, nor delivered to others without the express written permission of MESTEK, Inc.

CERTIFICATION

LE-54 IMPACT
LOUVER SYSTEM

REVISIONS

REV.	DATE	DESCRIPTION	BY


DATE: 19 DEC, 2024
DRAWN BY: MTC
CHECKED BY: JMC

34656-STD


SHEET No.:
7 of 10


SCALE:
3" = 1'-0"












REV.

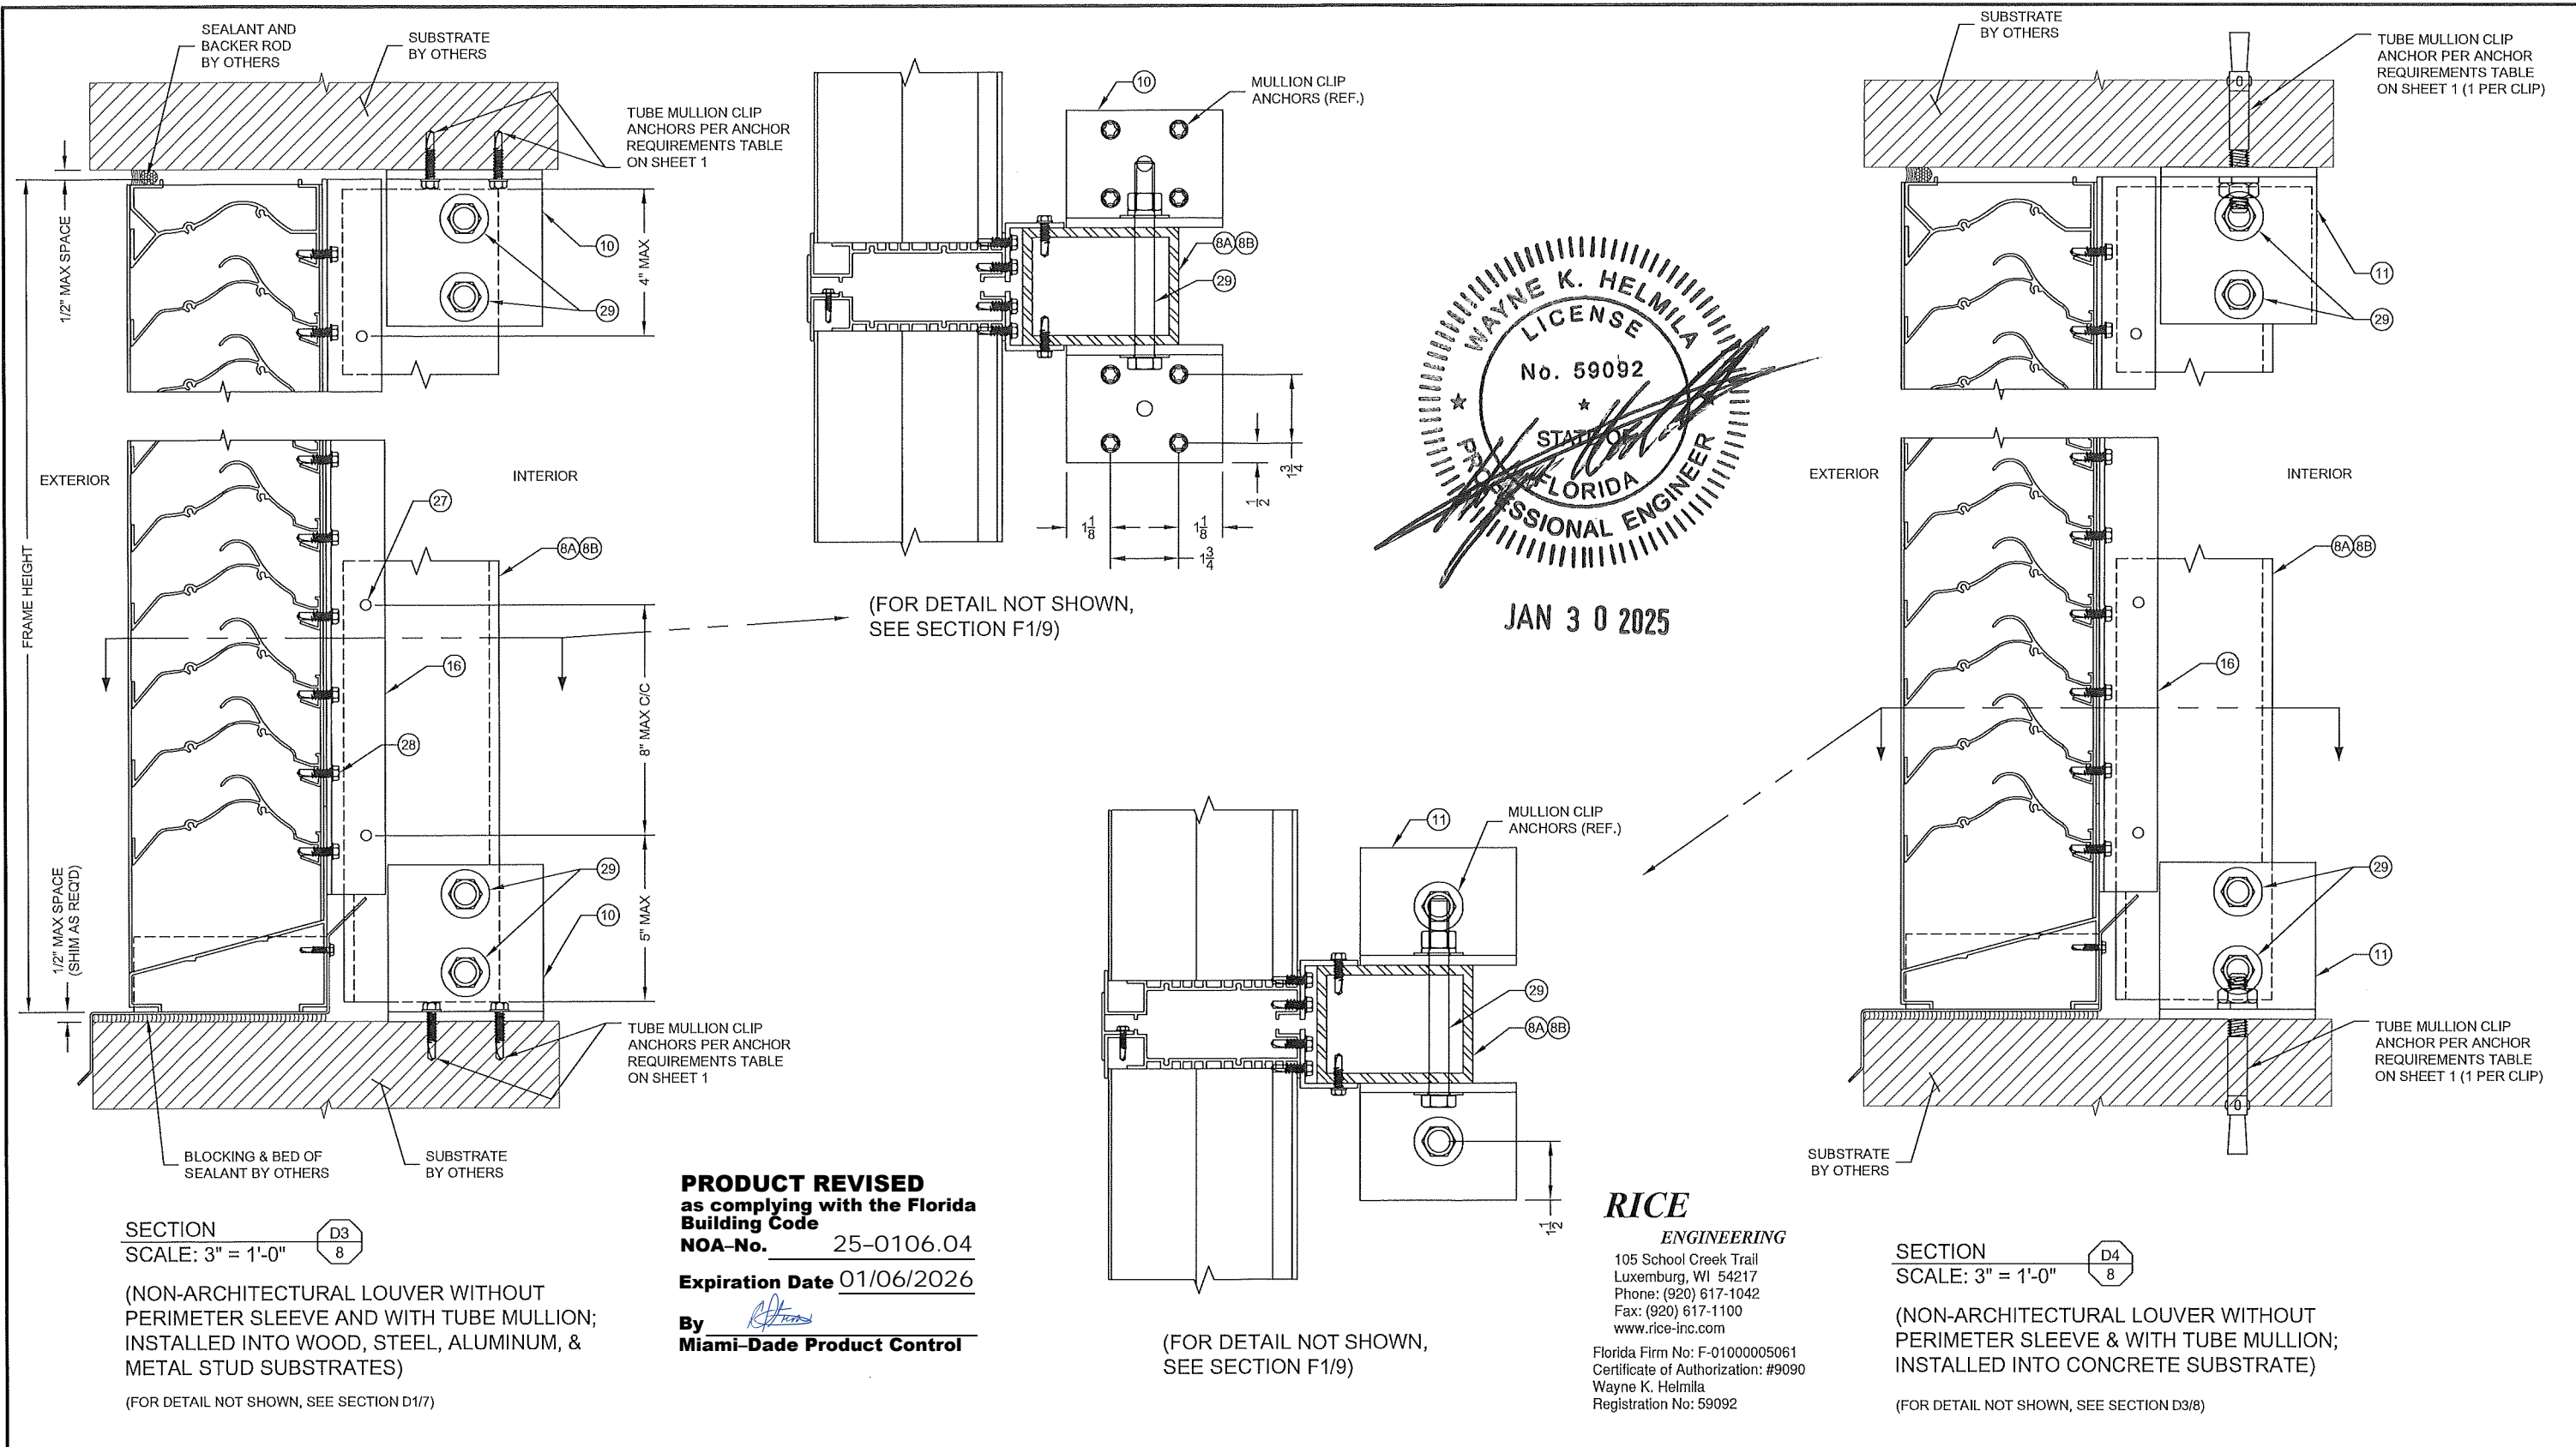

<div><div>awv</div><div>www.awv.com</div><div>A MESTEK COMPANY</div><div>219 S. CHURCH STREET, SUITE 200</div><div>BOWLING GREEN, OHIO 43402</div><div><small>This drawing and the information contained therein is the property of MESTEK, Inc. and cannot be reproduced in whole or in part, nor delivered to others without the express written permission of MESTEK, Inc.</small></div></div>	CERTIFICATION	LE-54 IMPACT LOUVER SYSTEM	REVISIONS				DATE: 19 DEC, 2024	SHEET No.: 8 of 10
			REV.	DATE	DESCRIPTION	BY	DRAWN BY: MTC	
							CHECKED BY: JMC	
								SCALE: 3" = 1'-0"
							34656-STD	REV. ----

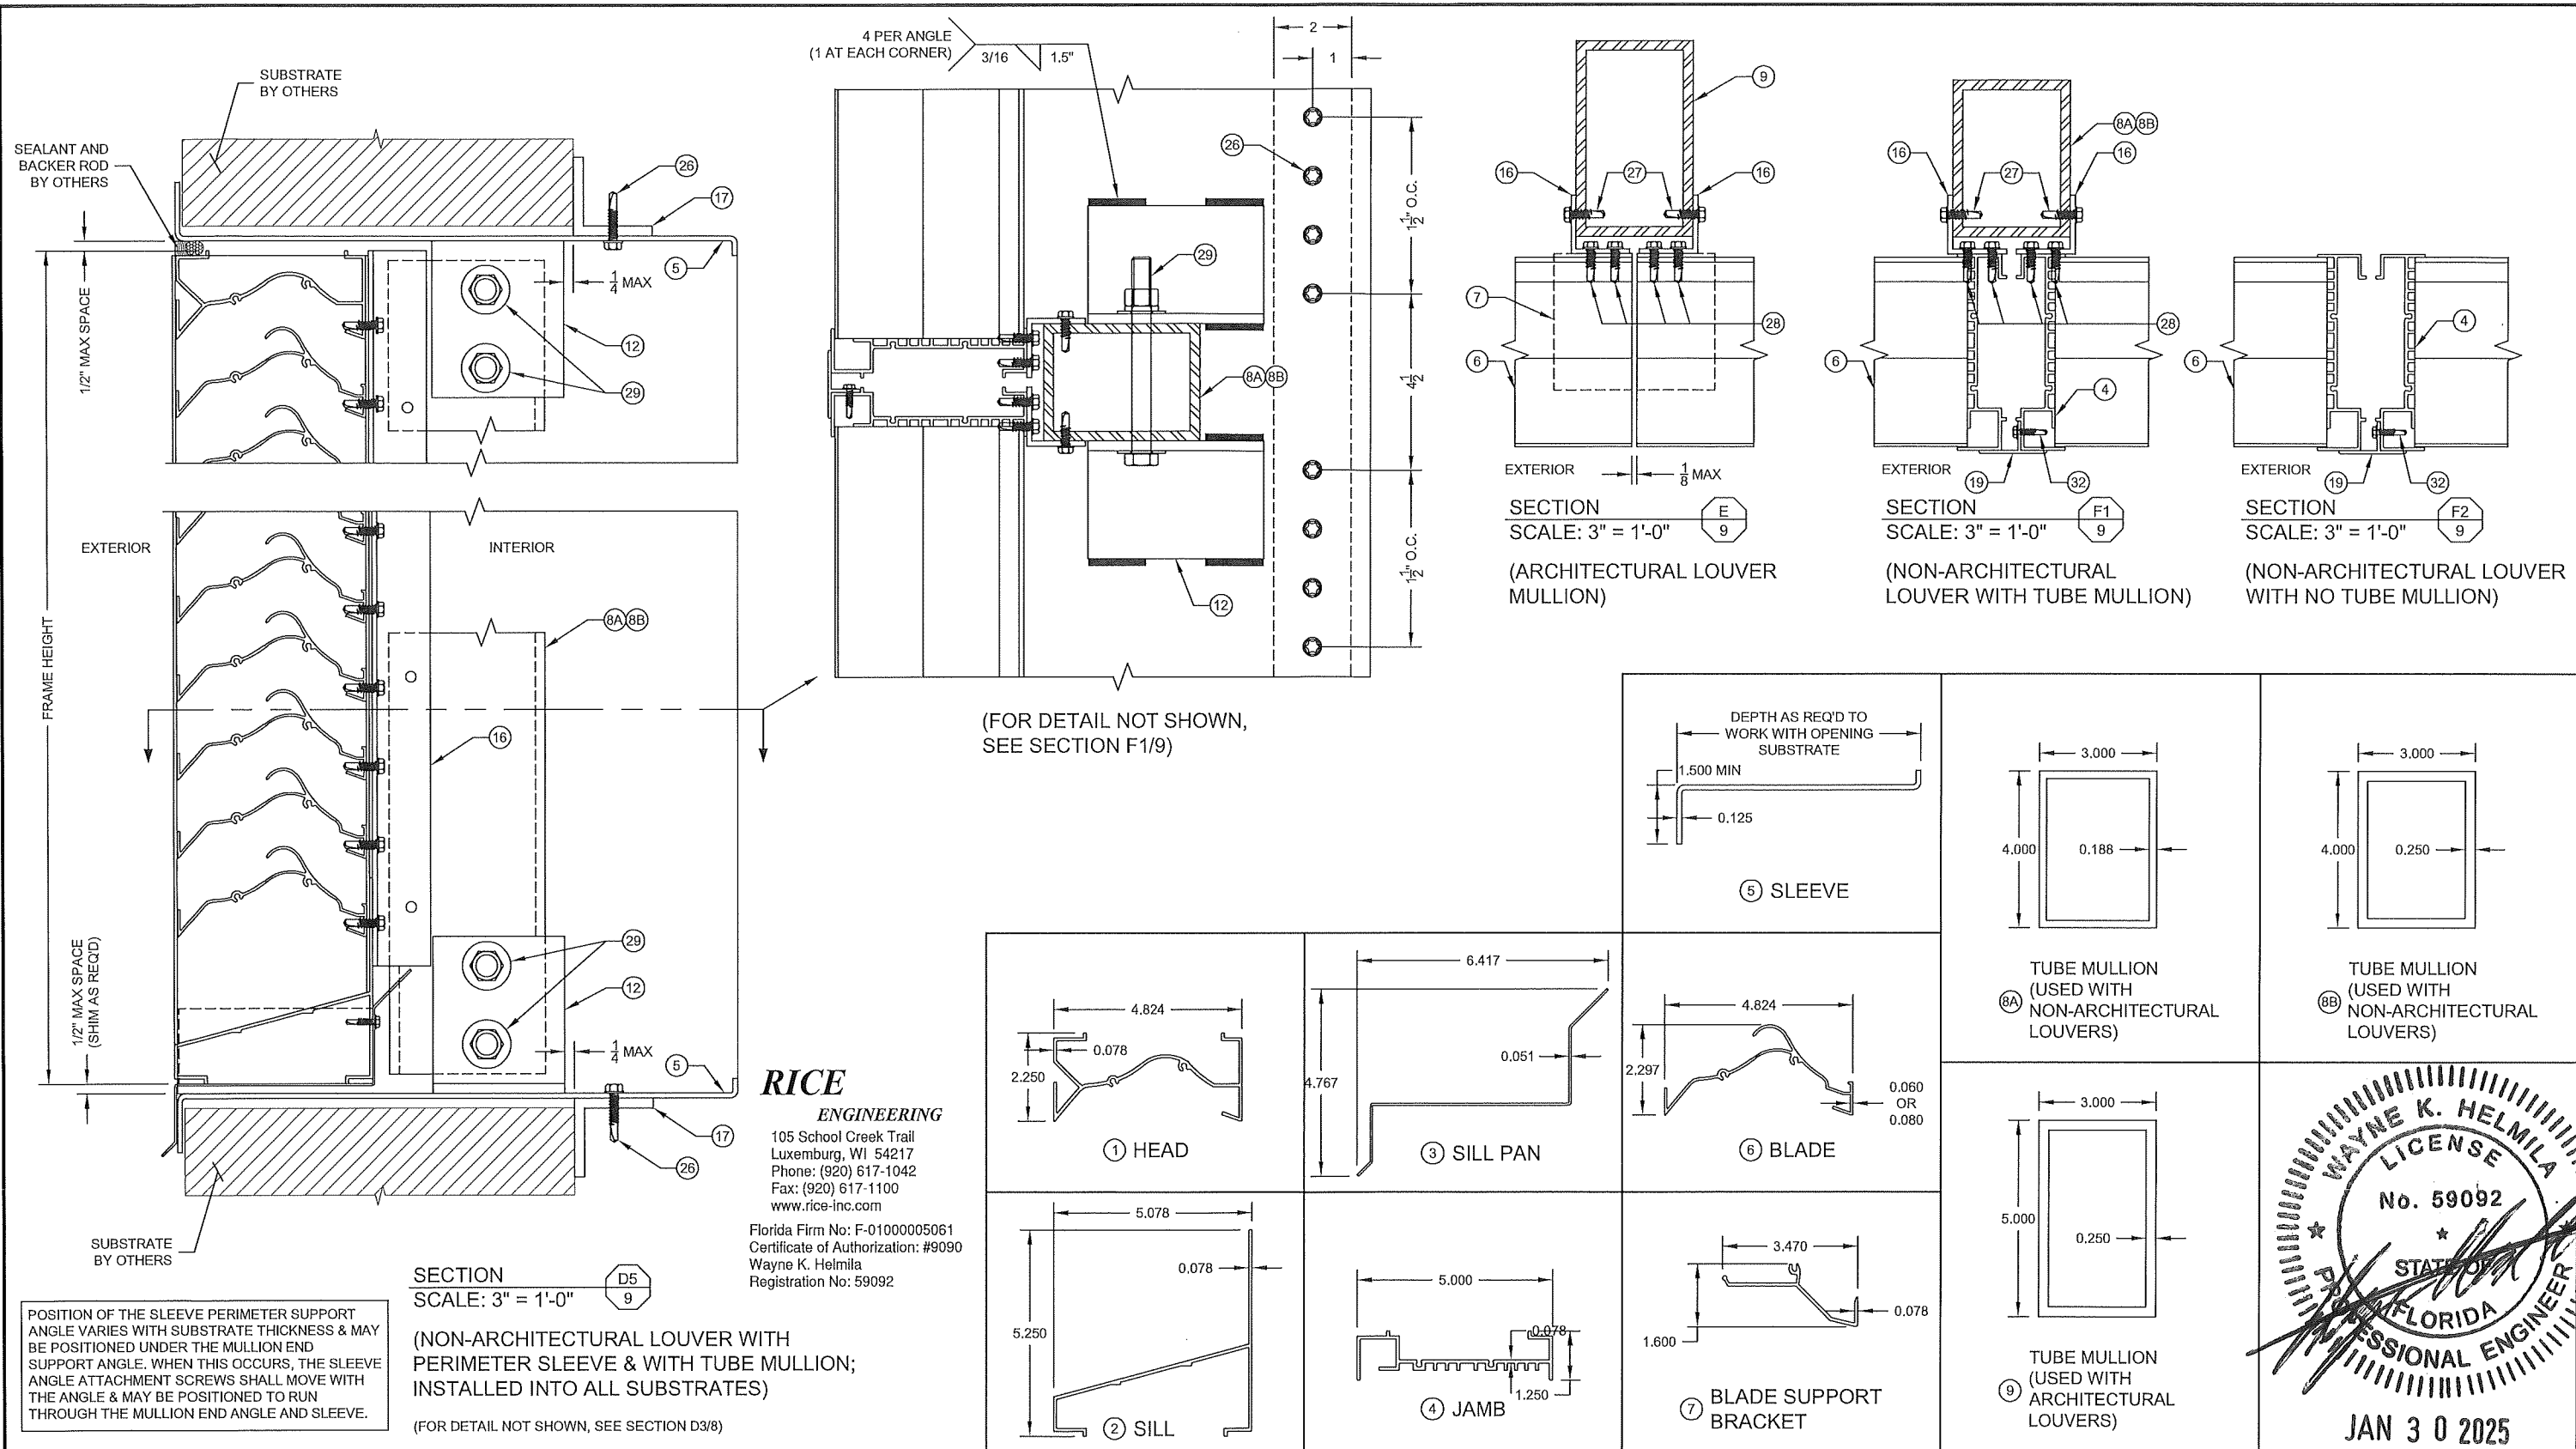


<div><div>awv</div><div>www.awv.com</div><div>A MESTEK COMPANY</div><div>219 S. CHURCH STREET, SUITE 200 BOWLING GREEN, OHIO 43402</div><div><small>This drawing and the information contained therein is the property of MESTEK, Inc. and cannot be reproduced in whole or in part, nor delivered to others without the express written permission of MESTEK, Inc.</small></div></div>	<div><div>PRODUCT REVISED</div><div>as complying with the Florida Building Code</div><div>NOA-No. 25-0106.04</div><div>Expiration Date 01/06/2026</div><div>By </div><div>Miami-Dade Product Control</div></div>	<div>LE-54 IMPACT LOUVER SYSTEM</div>	<table><tr><th colspan="4">REVISIONS</th></tr><tr><th>REV.</th><th>DATE</th><th>DESCRIPTION</th><th>BY</th></tr><tr><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td></tr></table>	REVISIONS				REV.	DATE	DESCRIPTION	BY																									<table><tr><td>DATE: 19 DEC, 2024</td><td>SHEET No.: 9 of 10</td></tr><tr><td>DRAWN BY: MTC</td><td> </td></tr><tr><td>CHECKED BY: JMC</td><td> </td></tr><tr><td> </td><td>SCALE: 3" = 1'-0"</td></tr><tr><td>34656-STD</td><td>REV. ----</td></tr></table>	DATE: 19 DEC, 2024	SHEET No.: 9 of 10	DRAWN BY: MTC		CHECKED BY: JMC			SCALE: 3" = 1'-0"	34656-STD	REV. ----
	REVISIONS																																													
	REV.	DATE	DESCRIPTION	BY																																										
DATE: 19 DEC, 2024	SHEET No.: 9 of 10																																													
DRAWN BY: MTC																																														
CHECKED BY: JMC																																														
	SCALE: 3" = 1'-0"																																													
34656-STD	REV. ----																																													

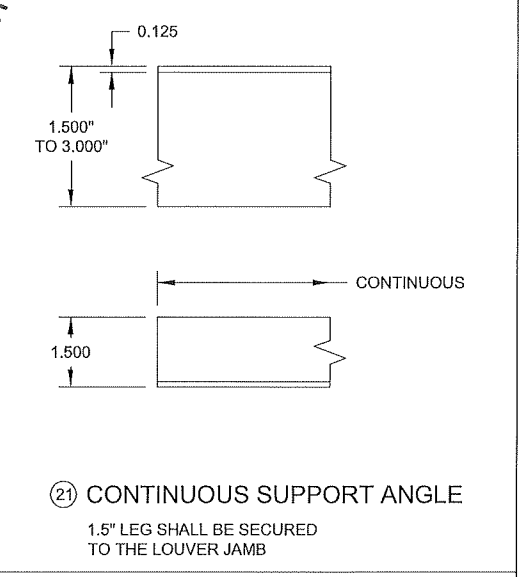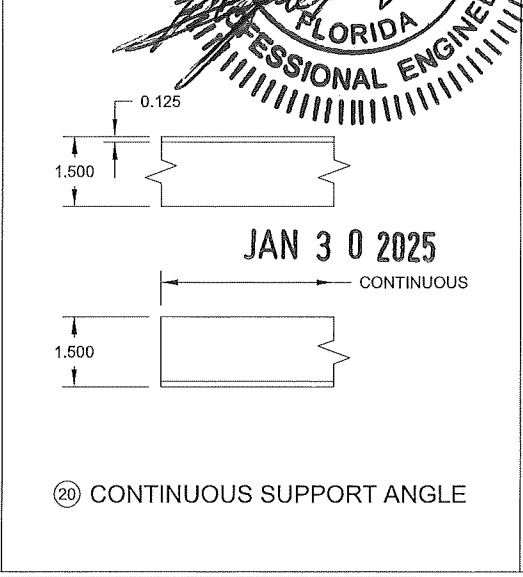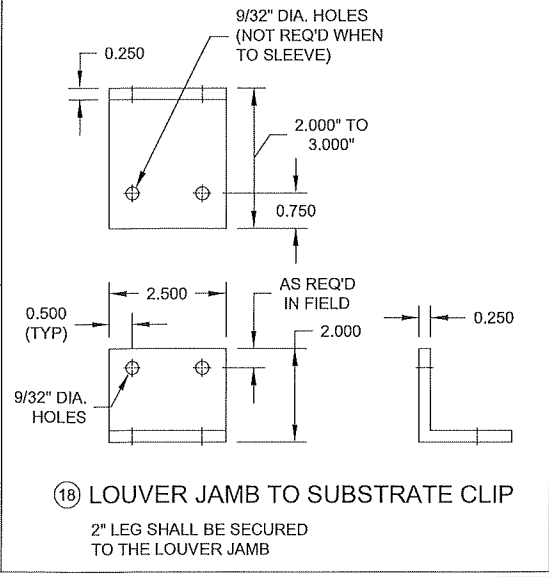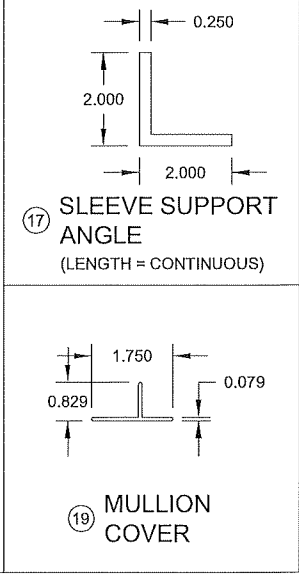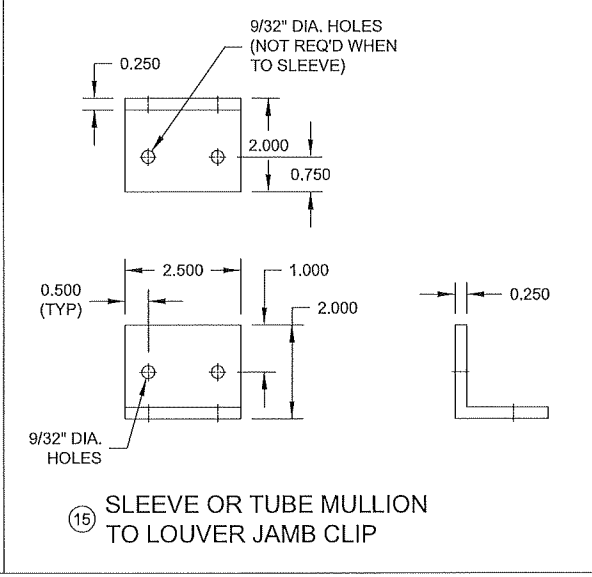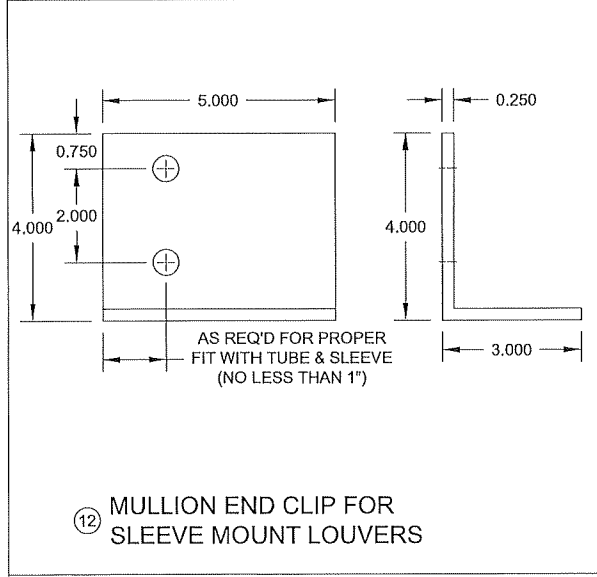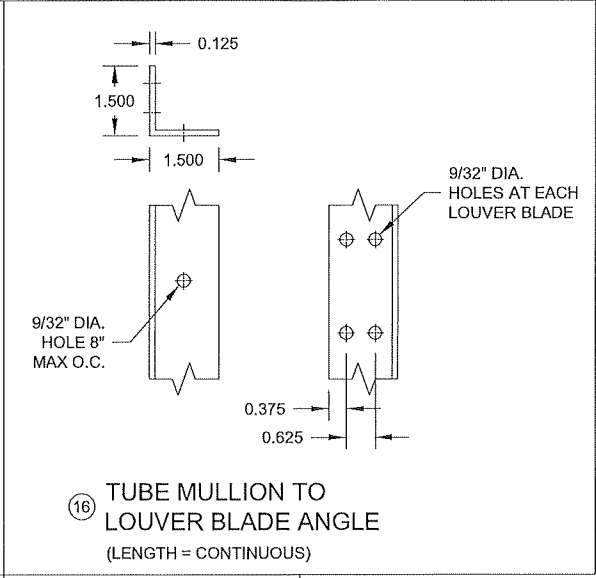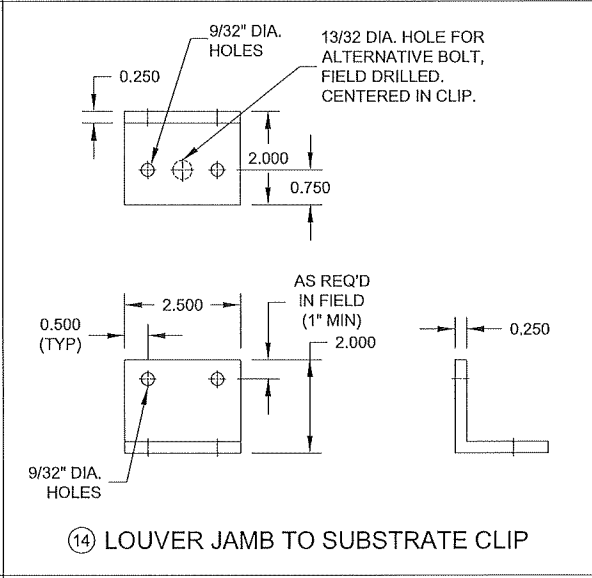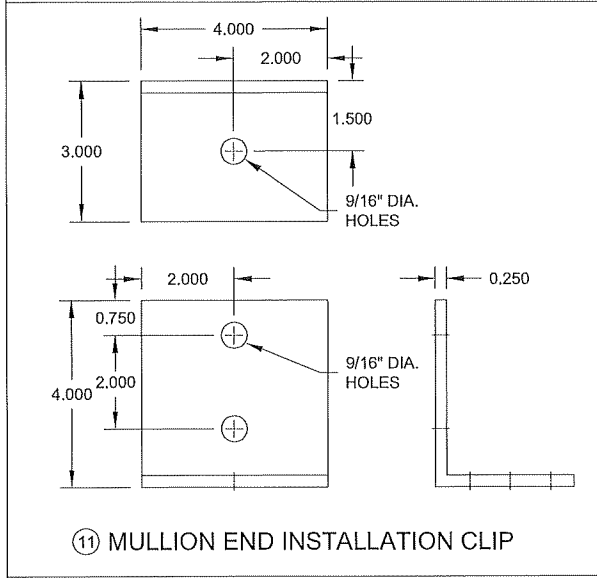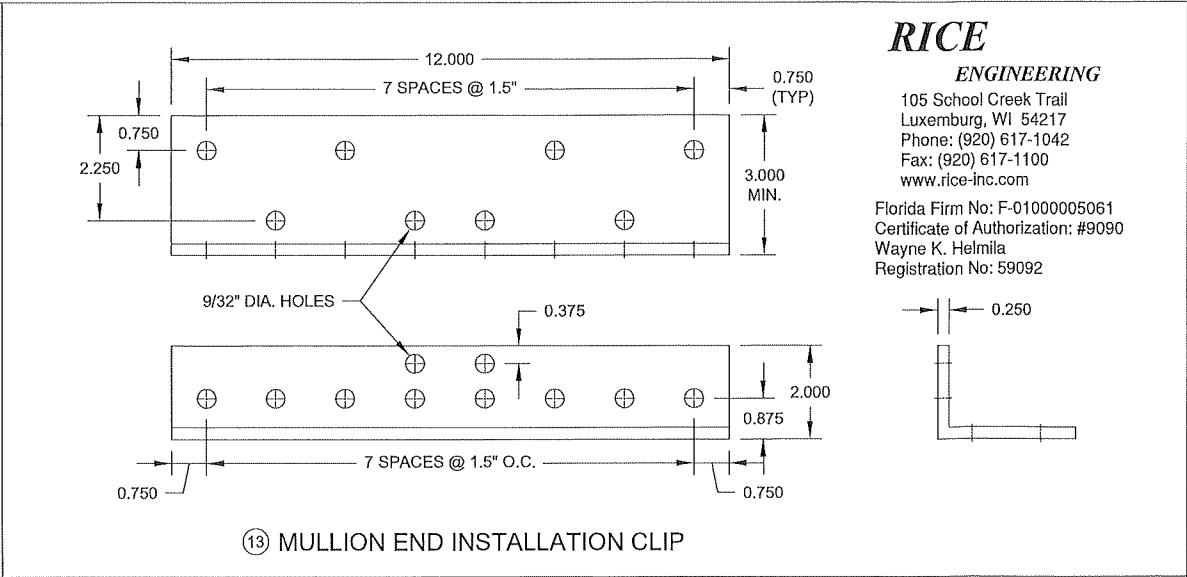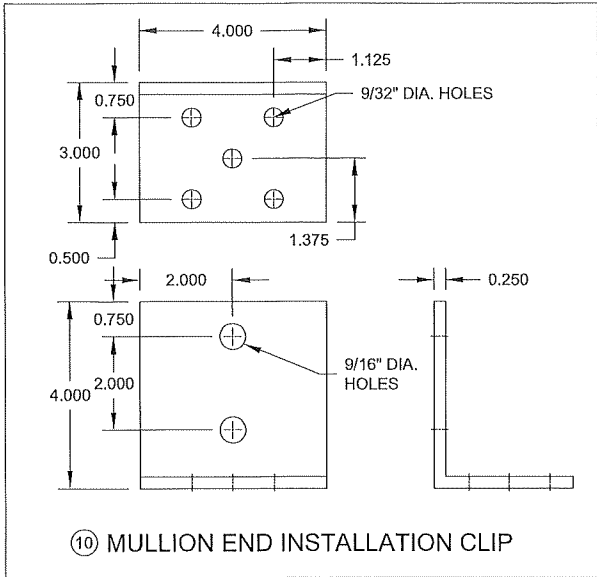

RICE
ENGINEERING
105 School Creek Trail
Luxemburg, WI 54217
Phone: (920) 617-1042
Fax: (920) 617-1100
www.rice-inc.com
Florida Firm No: F-01000005061
Certificate of Authorization: #9090
Wayne K. Helmila
Registration No: 59092

ITEM #		ITEM DESCRIPTION	MANUFACTURER/NOTES
PARTS			
1	HEAD		6061-T6 ALUMINUM
2	SILL		6061-T6 ALUMINUM
3	SILL PAN		5052-H32 ALUMINUM
4	JAMB		6061-T6 ALUMINUM
5	SLEEVE		5052-H32 ALUMINUM
6	BLADE		6061-T6 ALUMINUM
7	BLADE SUPPORT BRACKET		6061-T6 ALUMINUM
8A	TUBE MULLION (USED WITH NON-ARCHITECTURAL LOUVERS)		6063-T6 OR 6061-T6 ALUMINUM
8B	TUBE MULLION (USED WITH NON-ARCHITECTURAL LOUVERS)		6063-T6 OR 6061-T6 ALUMINUM
9	TUBE MULLION (USED WITH ARCHITECTURAL LOUVERS)		6063-T6 OR 6061-T6 ALUMINUM
10	MULLION END INSTALLATION CLIP		6061-T6 ALUMINUM
11	MULLION END INSTALLATION CLIP		6061-T6 ALUMINUM
12	MULLION END CLIP FOR SLEEVE MOUNT LOUVERS		6061-T6 ALUMINUM
13	MULLION END INSTALLATION CLIP		6061-T6 ALUMINUM
14	LOUVER JAMB TO SUBSTRATE CLIP		6063-T5 ALUMINUM
15	SLEEVE OR TUBE MULLION TO LOUVER JAMB CLIP		6063-T5 ALUMINUM (WITHIN 4" OF SLEEVE CORNERS OR TUBE MULLION ENDS AND MAX 8" O.C.)
16	TUBE MULLION TO LOUVER BLADE ANGLE (ARCHITECTURAL LOUVERS)		6063-T5 ALUMINUM
17	SLEEVE SUPPORT ANGLE		6063-T5 ALUMINUM
18	LOUVER JAMB TO SUBSTRATE CLIP		6063-T5 ALUMINUM
19	MULLION COVER		6063-T5 ALUMINUM
20	CONTINUOUS SUPPORT ANGLE		6063-T5 ALUMINUM
21	CONTINUOUS SUPPORT ANGLE		6063-T5 ALUMINUM
MISC. FASTENERS			
25	1/4-14 X 3/4" SELF TAP/DRILL SCREW		2 PER CLIP
26	1/4-14 X 3/4" SELF TAP/DRILL SCREW		WITHIN 4" OF CORNERS & SLEEVE SPLICES. MAX 8" O.C. (CLUSTERED AT MULLION ENDS PER DETAILS)
27	1/4-14 X 3/4" SELF TAP/DRILL SCREW		8" O.C. PER SECTIONS
28	1/4-14 X 3/4" SELF TAP/DRILL SCREW		4 AT HEAD & 2 PER BLADE
29	1/2" X 5" HEX HEAD STAINLESS STEEL NUT & BOLT		2 PER MULLION END
30	1/4-14 X 3/4" SELF TAP/DRILL SCREW		10 PER CLIP
31	1/4-14 X 3/4" SELF TAP/DRILL SCREW		1 PER CLIP
32	NO. 7 X 1/2" SMS SCREW		WITHIN 6" OF CORNERS & 24" MAX O.C.
33	1/4-14 X 3/4" SELF TAP/DRILL SCREW		SEE ANCHOR SPACING/PRESSURE TABLE FOR SPACING REQS.

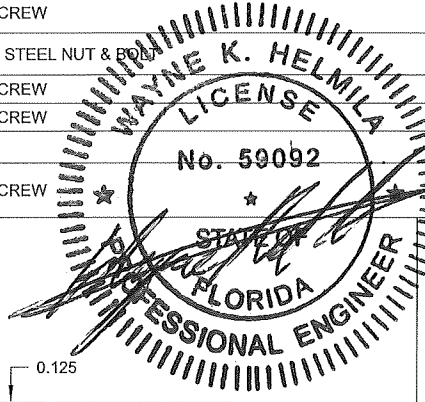

awv
www.awv.com
A MESTEK COMPANY
219 S. CHURCH STREET, SUITE 200
BOWLING GREEN, OHIO 43402
This drawing and the information contained therein is the property of MESTEK, Inc. and cannot be reproduced in whole or in part, nor delivered to others without the express written permission of MESTEK, Inc.

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 25-0106.04
Expiration Date 01/06/2026
By
Miami-Dade Product Control

LE-54 IMPACT
LOUVER SYSTEM

REVISIONS			
REV.	DATE	DESCRIPTION	BY

DATE: 19 DEC, 2024
DRAWN BY: MTC
CHECKED BY: JMC
34656-STD
SHEET No.: 10 of 10
SCALE: 3" = 1'-0"
REV. ----