



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION
NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/building

Amarr Garage Doors dba Entrematic
165 Carriage Court
Winston Salem, NC 27105

SCOPE: This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Model 950 Amarr Heritage 1000, 2000 (Dp:+42.0, -46.0 psf) Steel Sectional Garage Door up to 18'-0" Wide with Optional Impact Resistant Window

APPROVAL DOCUMENT: Drawing No. **IRC-9518-165-26-G**, titled "Model #950 Heritage 1000 & 2000", sheets 1 through 3 of 3, dated 03/16/2022, with revision A dated 01/27/2025, prepared by manufacturer, signed and sealed by Thomas L. Shelmerdine, P.E. on 04/10/2025, bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, manufacturing address, model number, the positive and negative design pressure rating, indicate impact rated if applicable, installation instruction drawing reference number, approval number (NOA), the applicable test standards, and the statement reading 'Miami-Dade County Product Control Approved' is to be located on the door's side track, bottom angle, or inner surface of a panel.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **renews and revises NOA No. 23-1114.10** and consists of this page 1 and evidence pages E-1, E-2 and E-3, as well as approval document mentioned above.

The submitted documentation was reviewed by **Carlos M. Utrera, P.E.**



06/10/25

NOA No. 25-0507.03
Expiration Date: March 24, 2031
Approval Date: June 20, 2025
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's

A. DRAWINGS “Submitted under NOA No. 16-0104.04”

1. Drawing No. **IRC-9518-165-26-G**, titled “Model #655 Oak Summit and Model #950 Heritage Series 1000 & 2000, Short, Long, Flush, and Oak Summit Panels” sheets 1 through 3 of 3, dated 08/09/10, with revision A dated 12/14/11, prepared by manufacturer, signed and sealed by Thomas L. Shelmerdine, P.E.

B. TESTS

1. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
4) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94
5) Tensile Test per ASTM E8

along with installation diagram on three Model 500 Classica Steel Sectional Garage Doors, prepared by American Test Lab, Inc, Test Report No. **ATLNC 0802.01-10R**, dated 11/03/10, signed and sealed by David W. Johnson, P.E.

“Submitted under NOA No. 10-1222.02”

2. Test report on Salt Spray per ASTM B117 of painted G40 galvanized coated panels, prepared by ETC Laboratories, Test Report No. **07-816-20337.0**, dated 03/24/2008, signed by Joseph L. Doldan, P.E.

“Submitted under NOA No. 08-0718.01”

C. CALCULATIONS “Submitted under NOA No. 12-0228.16”

1. Anchor calculations prepared by Structural Solutions, P.A., dated 02/09/2012, signed and sealed by Thomas L. Shelmerdine, P.E.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS

1. None.

F. STATEMENTS “Submitted under NOA No. 15-0505.09”

1. Statement letter of conformance, complying with **FBC 5th Edition (2014)** and of no financial interest, dated 04/08/15, issued by Structural Solutions, PA., signed and sealed by Tomas L. Shelmerdine, P.E.



Carlos M. Utrera, P.E.
Product Control Examiner
NOA No. 25-0507.03
Expiration Date: March 24, 2031
Approval Date: June 20, 2025

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's (CONTINUED)

G. OTHERS

1. Notice of Acceptance No. **16-0104.04**, issued to Amarr Garage Doors for their Model #950 Heritage and 655 Oak Summit 1000, 2000 Steel Sectional Garage Door up to 18'-0" Wide, approved on 05/26/16 and expiring on 03/24/21.

2. EVIDENCE SUBMITTED under previous NOAs

A. DRAWINGS

1. Drawing No. **IRC-9518-165-26-G**, titled "Model #950 Heritage Series 1000 & 2000," sheets 1 through 3 of 3, dated 03/15/22, prepared by manufacturer, signed and sealed by Thomas L. Shelmerdine, P.E.

B. TESTS

Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
4) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94
5) Tensile Test per ASTM E8

along with installation diagram of a door Model 950 Amarr, 18'x7', 24 ga. Steel Sectional Steel Garage Door, prepared by American Test Lab, Inc, Test Report No. **ATLNC 0314.01-22**, dated 03/30/22, signed and sealed by David W. Johnson, P.E.

C. CALCULATIONS

1. Anchor calculations prepared by Structural Solutions, P.A., dated 04/07/22, signed and sealed by Thomas L. Shelmerdine, P.E.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **21-0216.01** issued to **Eastman Chemical Company(MA)**, for their "**Saflex PVB Interlayers-Clear and Colored for Glass**", expiring on 05/21/26.

F. STATEMENTS

1. Statement letter of conformance, complying with **FBC 7th Edition (2020)** and of no financial interest, dated 04/04/22, issued by Structural Solutions, P.A., signed and sealed by Thomas L. Shelmerdine, P.E.



Carlos M. Utrera, P.E.
Product Control Examiner
NOA No. 25-0507.03
Expiration Date: March 24, 2031
Approval Date: June 20, 2025

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

3. EVIDENCE SUBMITTED UNDER NOA # 23-1114.10 AND NEW

A. DRAWINGS

1. Drawing No. **IRC-9518-165-26-G**, titled "Model #950 Heritage 1000 & 2000", sheets 1 through 3 of 3, dated 03/16/2022, with revision A dated 01/27/2025, prepared by manufacturer, signed and sealed by Thomas L. Shelmerdine, P.E. on 04/10/2025.

B. TESTS

1. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
4) Forced Entry Test, per TAS 202-94
5) Tensile Test per ASTM E8
along with marked-up drawings and installation diagram of Amarr 18' x 7' 24 ga steel garage door Model 950, prepared by American Test Lab, Inc, Test Report No. **ATLNC 0709.02-24**, dated 02/11/2025, signed and sealed by David W. Johnson, P.E.

C. CALCULATIONS

1. Anchor calculations prepared by Structural Solutions, P.A., dated 04/10/2025, signed and sealed by Thomas L. Shelmerdine, P.E.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS


1. None.

F. STATEMENTS

1. Statement letter of code conformance with the 8th edition (2023) of the FBC, and of no financial interest, dated 04/10/2025, issued by Structural Solutions, P.A., signed and sealed by Thomas L. Shelmerdine, P.E.
2. Statement letter of code conformance with the 8th edition (2023) of the FBC, and of no financial interest, dated 10/27/2023, issued by Structural Solutions, P.A., signed and sealed by Thomas L. Shelmerdine, P.E.



Carlos M. Utrera, P.E.
Product Control Examiner
NOA No. 25-0507.03
Expiration Date: March 24, 2031
Approval Date: June 20, 2025

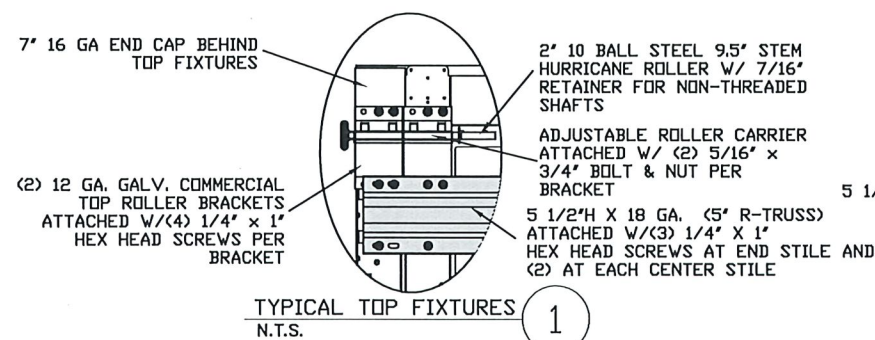

TYPICAL TOP FIXTURES 1
N.T.S.

TYPICAL CENTER HINGE 2
N.T.S.

TYPICAL END HINGE 3
N.T.S.

TYPICAL BOTTOM BRACKET 4
N.T.S.


OPTIONAL BOTTOM BRACKET 4B
N.T.S.

SECTION A-A (SIDE VIEW)
N.T.S.

LARGE MISSILE
IMPACT RESISTANT

TWO (2) ROWS OF THREE (3)
VENTS EQUALS 15 SQ. INCHES

OPTIONAL VENT DETAIL 5
N.T.S.

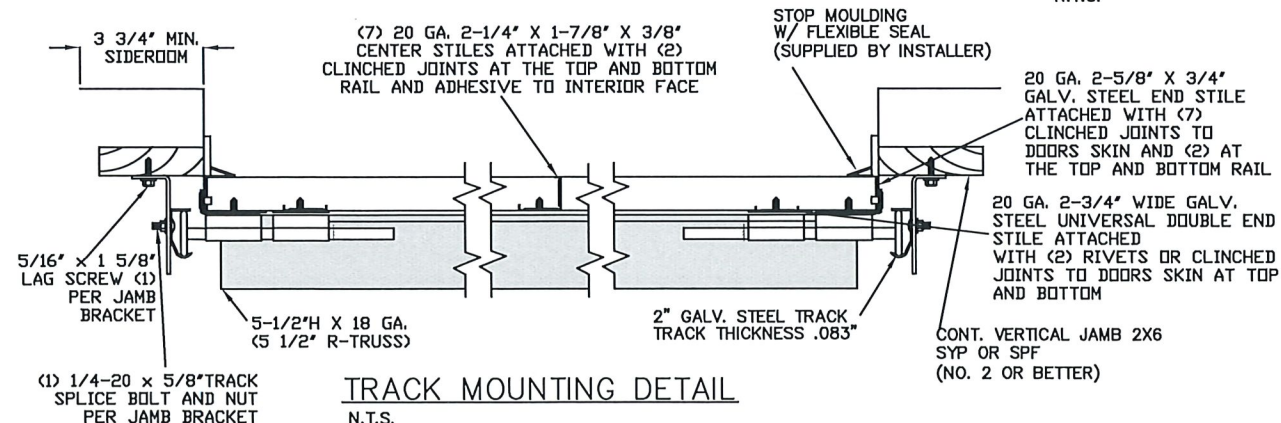

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 25-0507.03

Expiration Date 03/24/2031

By *[Signature]*
Miami-Dade Product Control


REV	DESCRIPTION OF REVISIONS	DATE	BY
A	ADDED ADDITIONAL GLAZING OPTIONS	1/27/25	RLR

MAX SIZE
18' x 14'

DESIGN LOADS
+42.0 PSF
-46.0 PSF

TEST LOADS
+63.0 PSF
-69.0 PSF

LARGE MISSILE
IMPACT
RESISTANCE

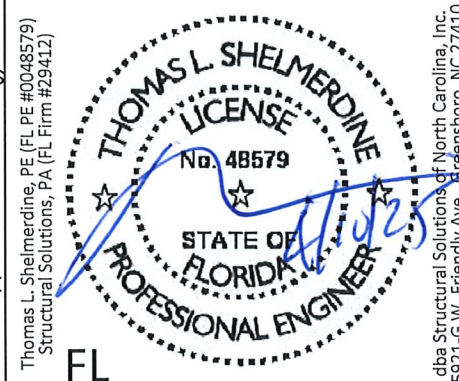



Amarr
ENTRE/MATIC

MODEL #950 AMARR HERITAGE 1000, 2000


SIZE	DRAWN BY	DRG	DATE	03/15/22	DRAWING NUMBER
B	CHECKED BY	RLR	DATE	03/16/22	IRC-9518-165-26-G
ENTRE/MATIC 165 CARRIAGE COURT WINSTON-SALEM, N.C. 27105					SHEET 1 OF 3

SPECIFICATIONS AND NOTES


1. ALL THE LOAD FROM THE DOOR IS TRANSFERRED TO THE VERTICAL TRACK, FROM THE TRACK THE LOAD IS TRANSFERRED TO THE VERTICAL JAMBS. THE HORIZONTAL JAMB OR HEADER RECEIVES NO PORTION OF THE LOAD TRANSFERRED FROM THE DOOR.
2. EACH VERTICAL JAMBS RECEIVES MAXIMUM DESIGN LOADS OF: +378.0 LBS/FT & -414.0 LBS/FT
3. DOOR AND HARDWARE WILL BE DESIGNED, MANUFACTURED AND INSTALLED WITH STANDARDS AS SET FORTH BY DASMA.
4. DOOR SECTIONS SHALL BE 24 GA. (.0216) MIN. EXTERIOR SKIN ROLLED FORMED, W/ BAKED ON POLYESTER FINISH
5. DOORS UP TO 7'0" HIGH CONSIST OF (4) SECTIONS AS SHOWN. USE (1) 5 1/2" R-TRUSS ON TOP SECTION, (1) 5 1/2" R-TRUSS PER INTERMEDIATE SECTION, & (1) 5 1/2" R-TRUSS AND (2) 3" STRUTS ON THE BOTTOM SECTION
6. DOORS OVER (4) SECTIONS REFER TO TABLES ON PAGE 3
7. SUPPORTING STRUCTURAL ELEMENTS SHALL BE DESIGNED BY A REGISTERED PROFESSIONAL ENGINEER FOR WIND LOADS INDICATED ON THIS DRAWING IN ADDITION TO OTHER LOADINGS.
8. THIS APPROVAL REQUIRES THE MANUFACTURER TO DO TESTING OF ALL COILS USED TO FABRICATE DOOR PANELS UNDER THIS NOTICE OF ACCEPTANCE. A MINIMUM OF 2 SPECIMENS SHALL BE CUT FROM EACH COIL AND TENSILE TESTED ACCORDING TO ASTM E-8 BY A DADE COUNTY APPROVED LAB SELECTED AND PAID BY THE MANUFACTURER. EVERY 3 MONTHS, 4 TIMES A YEAR, THE MANUFACTURER SHALL MAIL TO THIS OFFICE: A COPY OF THE TEST REPORTS WITH CONFIRMATION THAT THE SPECIMENS WERE SELECTED FROM COILS AT THE MANUFACTURER PRODUCTION FACILITIES. AND A NOTARIZED STATEMENT FROM THE MANUFACTURER THAT ONLY COILS WITH YIELD STRENGTH OF 45,000 PSI OR MORE SHALL BE USED TO MAKE DOOR PANELS FOR DADE COUNTY UNDER THIS NOTICE OF ACCEPTANCE.

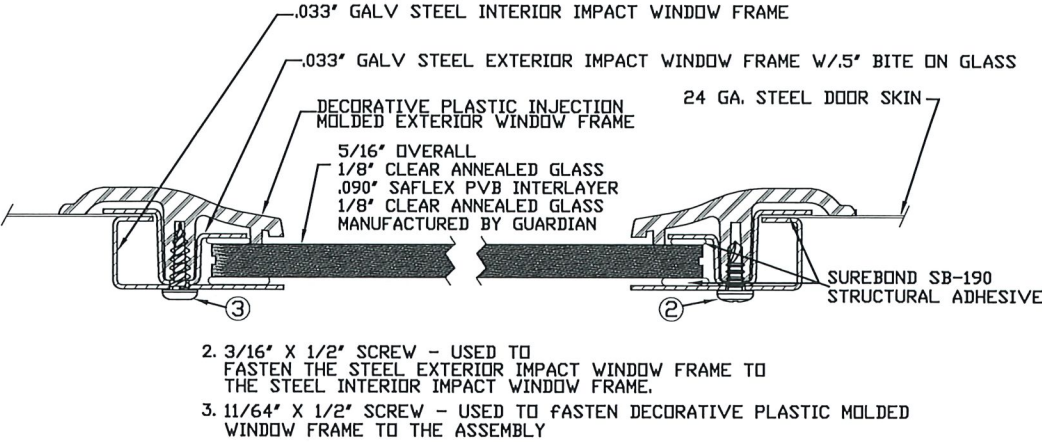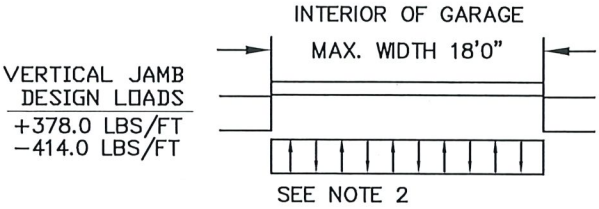


OPTIONAL SHORT PANEL GLAZED SECTION STRUT AND STILE LAYOUTS
N.T.S.

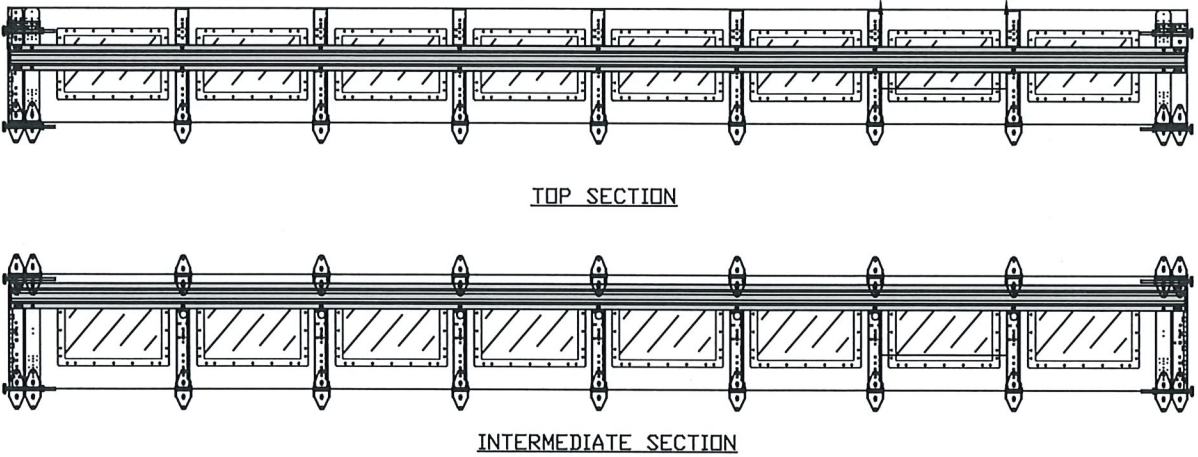


SECTION B-B IMPACT WINDOW DETAIL
N.T.S.

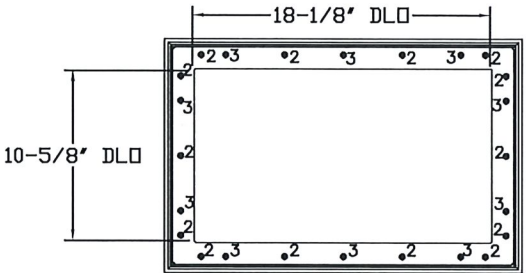

IMPACT GLAZING FASTENER DETAIL
N.T.S.
GLAZING MEETS ASTM E1300-04

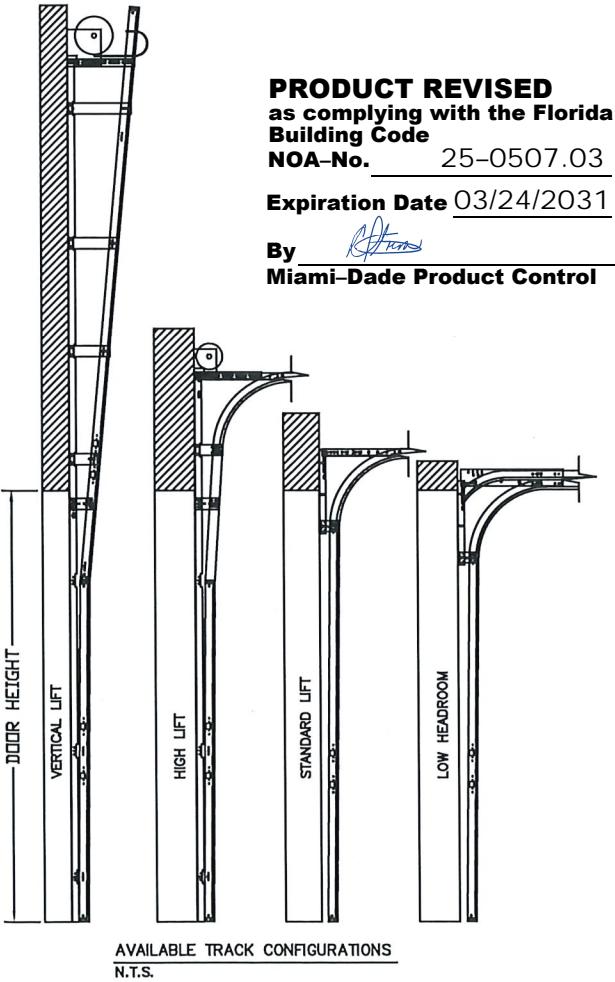

VERTICAL GLAZING OPTIONAL
DOWN EITHER/OR BOTH SIDES
N.T.S.

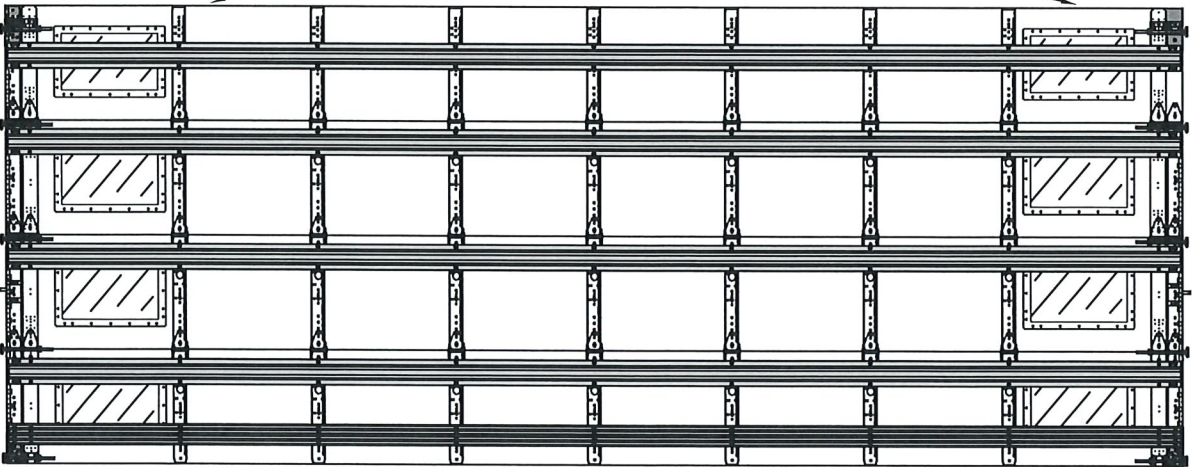

OPTIONAL SHORT PANEL VERTICAL GLAZING (STRUT AND STILE LAYOUT)

REV	DESCRIPTION OF REVISIONS	DATE	BY
A	ADDED ADDITIONAL GLAZING OPTIONS	1/27/25	RLR
<div><div><div>MAX SIZE 18' x 14'</div><div>DESIGN LOADS +42.0 PSF -46.0 PSF</div><div>TEST LOADS +63.0 PSF -69.0 PSF</div><div>LARGE MISSILE IMPACT RESISTANCE</div></div><div><div>Thomas L. Shelmerdine, PE (FL PE #0048579) Structural Solutions, PA (FL Firm #29412)</div><div><div><div>THOMAS L. SHELMERDINE LICENSE No. 48579 STATE OF FLORIDA PROFESSIONAL ENGINEER</div><div>FL</div></div><div>dba Structural Solutions of North Carolina, Inc. 5921-G W. Friendly Ave., Greensboro, NC 27410</div></div></div></div>			
<div><div><div>Amarr</div><div>ENTRE/MATIC</div></div><div>MODEL #950 AMARR HERITAGE 1000, 2000</div></div>			
SIZE	DRAWN BY	DRC	DATE
B	CHECKED BY	RLR	DATE
165 CARRIAGE COURT WINSTON-SALEM, N.C. 27105			
SHEET 2 OF 3			

TABLE 1

DOOR HEIGHT	TRACK ATTACHMENT															SPLICE
	A	B	C	D	E	F	G	H	I	J	K	L	M	N	S	
6' 6"	3"	14"	27"	38"	46"	56"	64"								70"	
7'	3"	14"	27"	38"	46"	56"	68"								76"	
7' 6"	3"	14"	27"	38"	46"	56"	68"	78"							82"	
8'	3"	14"	27"	38"	46"	56"	68"	78"							88"	
8' 6"	3"	14"	27"	38"	46"	56"	68"	78"	88"						94"	
9'	3"	14"	27"	38"	46"	56"	68"	78"	88"						100"	
9' 6"	3"	14"	27"	38"	46"	56"	68"	78"	88"	98"					106"	
10'	3"	14"	27"	38"	46"	56"	68"	78"	88"	100"					112"	
10' 6"	3"	14"	27"	38"	46"	56"	68"	78"	88"	100"	110"				118"	
11'	3"	14"	27"	38"	46"	56"	68"	78"	88"	100"	110"				124"	
11' 6"	3"	14"	27"	38"	46"	56"	68"	78"	88"	100"	110"	120"			130"	
12'	3"	14"	27"	38"	46"	56"	68"	78"	88"	100"	110"	122"			136"	
12' 6"	3"	14"	27"	38"	46"	56"	68"	78"	88"	100"	109"	122"	132"		142"	
13'	3"	14"	27"	38"	46"	56"	68"	78"	88"	100"	114"	122"	134"		148"	
13' 6"	3"	14"	27"	38"	46"	56"	68"	78"	88"	100"	109"	122"	134"	144"	154"	
14'	3"	14"	27"	38"	46"	56"	68"	78"	88"	100"	114"	122"	134"	146"	160"	

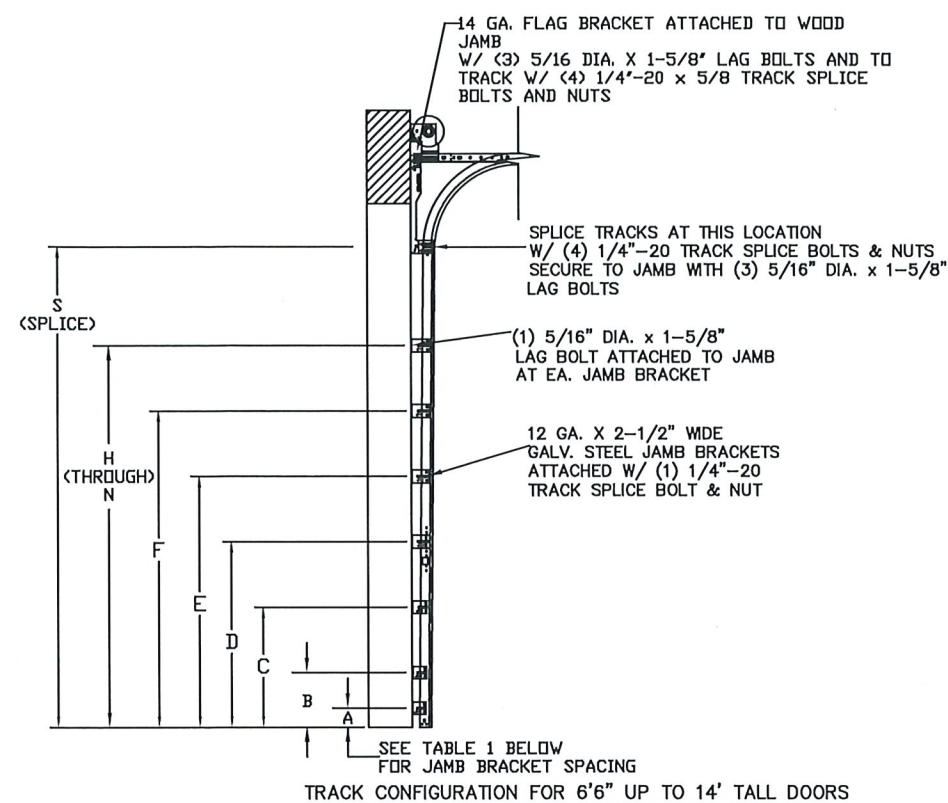
ALL TRACK ATTACHMENT SPACING $\pm 2"$ ALLOWED WITH SYP NO. 2 OR BETTER ONLY

TABLE 2

SECTION	STRUT SIZE
TOP	5.5"
7TH	5.5"
6TH	5.5"
5TH	5.5"
4TH	5.5"
3RD	5.5"
2ND	5.5"
BOTTOM	5.5" (2) 3"

WOOD JAMB ATTACHMENT TO STRUCTURE


2 X 6 VERTICAL JAMB ATTACHMENT TO WOOD FRAME STRUCTURE
5/16" X 3" LAG SCREWS STARTING 6" FROM ENDS THEN 12" O.C. (1 1/2" EMBEDMENT)

2 X 6 VERTICAL JAMB ATTACHMENT TO 2,000 PSI CONCRETE
HILTI KWIK BOLT 3/8" X 4" STARTING 6" FROM ENDS THEN 24" O.C. (2 1/2" EMBEDMENT)
HILTI SLEEVE ANCHOR 3/8" X 2-3/4" STARTING 6" FROM ENDS THEN 10" O.C. (1 1/4" EMBEDMENT)
ITW/RAMSET REDHEAD (TRU-BOLT) 3/8" X 4" STARTING 6" FROM ENDS THEN 22" O.C. (2 1/2" EMBEDMENT)

2 X 6 VERTICAL JAMB ATTACHMENT TO HOLLOW C-90 BLOCK
SIMPSON 1/4" X 3" TITEN SCREWS STARTING 6" FROM ENDS, USE PAIRS OF FASTENERS (3" APART) AT 8" O.C. (1 1/2" EMBEDMENT)
HILTI 1/4" X 2-3/4" KWIK-CON II+ SCREWS STARTING 6" FROM ENDS, USE PAIRS OF FASTENERS (3" APART) AT 8" O.C. (1 1/4" EMBEDMENT)

2 X 6 VERTICAL JAMB ATTACHMENT TO GROUTED C-90 BLOCK (2000 PSI GROUT)
HILTI SLEEVE ANCHOR 3/8" X 2-3/4" STARTING 6" FROM ENDS THEN 12" O.C. (1 1/4" EMBEDMENT)
(OR, USE FASTENERS FOR HOLLOW C-90 BLOCK)

*LAGS AND BOLTS CAN BE COUNTERSUNK TO PROVIDE A FLUSH MOUNTING SURFACE.
*PREPARATION OF WOOD JAMBS BY OTHERS

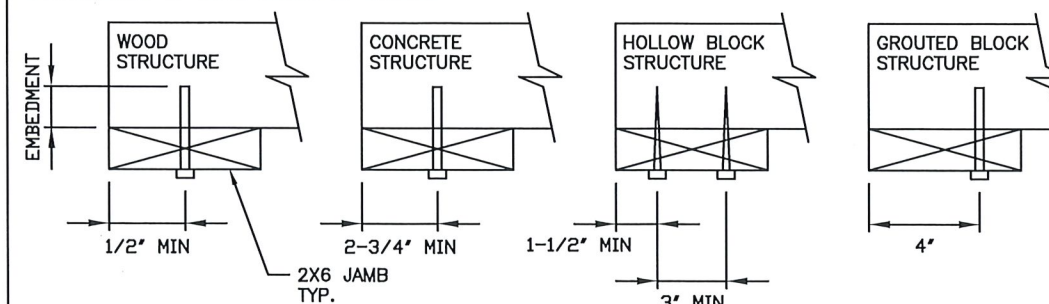

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 25-0507.03
Expiration Date 03/24/2031
By *[Signature]*
Miami-Dade Product Control

REV	DESCRIPTION OF REVISIONS	DATE	BY
A	ADDED ADDITIONAL GLAZING OPTIONS	1/27/25	RLR

MAX SIZE
18' x 14'

DESIGN LOADS
+42.0 PSF
-46.0 PSF

TEST LOADS
+63.0 PSF
-69.0 PSF

LARGE MISSILE
IMPACT
RESISTANCE

Thomas L. Shelmerdine, PE (FL PE #0048579)
Structural Solutions, PA (FL Firm #29412)

FL

Thomas L. Shelmerdine, PE (FL PE #0048579)
Structural Solutions, PA (FL Firm #29412)
dba Structural Solutions of North Carolina, Inc.
5921-G W. Friendly Ave., Greensboro, NC 27410

Amarr
ENTRE/MATIC

MODEL #950 AMARR HERITAGE 1000, 2000

SIZE B	DRAWN BY RLR	DRC RLR	DATE 03/15/22	DRAWING NUMBER IRC-9518-165-26-G
ENTRE/MATIC 165 CARRIAGE COURT WINSTON-SALEM, N.C. 27105				SHEET 3 OF 3