



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)  
BOARD AND CODE ADMINISTRATION DIVISION

## NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY  
PRODUCT CONTROL SECTION

11805 SW 26 Street, Room 208  
Miami, Florida 33175-2474  
T (786) 315-2590 F (786) 315-2599

[www.miamidade.gov/economy](http://www.miamidade.gov/economy)

**Kingspan Insulated Panels, Inc. (FL)**  
**726 Summerhill Drive**  
**Deland, FL 32724**

### SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

### DESCRIPTION: Designwall 4000, 2000, 2000R, and 2000R-459 Insulated Metal Wall Panels

**APPROVAL DOCUMENT:** Drawing titled "Designwall 4000, Designwall 2000, Designwall 2000R, and Designwall 2000R-459 Insulated Metal Wall Panels", sheets 1 through 5 of 5, prepared by Kingspan Insulated Panels, Inc., dated 06/02/2025, signed and sealed by Bala Sockalingam, PhD., P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and the expiration date by the Miami-Dade County Product Control Section.

### MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

**LABELING:** Each panel shall bear a permanent label with the manufacturer's name or logo, Deland, FL or Caledon, ON, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises** NOA # **24-0501.02** and consists of page 1 and evidence pages E-1, E-2, E-3 and E-4, as well as approval document mentioned above.

The submitted documentation was reviewed by **Carlos M. Utrera, P.E.**



11/18/25

NOA No. 25-0801.02  
Expiration Date: May 18, 2027  
Approval Date: November 26, 2025  
Page 1

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA # 16-0329.09**

**A. DRAWINGS**

1. Drawing No. C2070, titled "Designwall 2000 and Designwall 4000 Insulated Wall Metal Panels", sheets 1 through 4 of 4, prepared by Bala Sockalingam, P.E., dated May 04, 2017, signed and sealed by Bala Sockalingam, P.E., on May 04, 2017.

**B. TESTS**

1. Test report on Large Missile Impact Test per TAS 201, Cyclic Wind Pressure Test per TAS 203, and Uniform Static Air Pressure Test per TAS 202 on Designwall 2000 and Designwall 4000 Insulated Wall Metal Panels, prepared by Farabaugh Engineering and Testing, Report No. T298-15, dated November 19, 2015, signed and sealed by Daniel G. Farabaugh, P.E.

**C. CALCULATIONS**

1. Calculations titled "Designwall 2000 and Designwall 4000 Insulated Wall Metal Panels", dated February 10, 2016, 4 pages, prepared by Bala Sockalingam, P.E., signed and sealed by Bala Sockalingam, P.E., on February 10, 2016.

**D. QUALITY ASSURANCE**

1. Miami-Dade County Department of Regulatory and Economic Resources (RER).

**E. MATERIAL CERTIFICATIONS**

1. Tensile Test per ASTM A370-10, Report # T298-15, issued by Farabaugh Engineering and Testing, dated 11/19/15, signed & sealed by Daniel G. Farabaugh, P.E.

**2. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL #17-0921.12**

**A. DRAWINGS**

1. Drawing No. C2070, titled "Designwall 2000 and Designwall 4000 Insulated Wall Metal Panels", sheets 1 through 4 of 4, prepared by Bala Sockalingam, P.E., dated July 14, 2017, signed and sealed by Bala Sockalingam, P.E., on August 17, 2017.

**B. TESTS**

1. None.

**C. CALCULATIONS**

1. None.

**D. QUALITY ASSURANCE**

1. Miami-Dade County Department of Regulatory and Economic Resources (RER).

**E. MATERIAL CERTIFICATIONS**

1. None.



---

**Carlos M. Utrera, P.E.**  
**Product Control Examiner**  
**NOA No. 25-0801.02**  
**Expiration Date: May 18, 2027**  
**Approval Date: November 26, 2025**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**3. EVIDENCE SUBMITTED UNDER PREVIOUS NOA # 20-0625.06**

**A. DRAWINGS**

1. Drawing No. C2356, titled "Designwall 2000 and Designwall 4000 Insulated Wall Metal Panels", sheets 1 through 4 of 4, prepared by Bala Sockalingam, P.E., dated May 30, 2020, signed and sealed by Bala Sockalingam, P.E., on May 30, 2020.

**B. TESTS**

1. Test report on Transverse Load on Designwall 4000 Insulated Wall Metal Panels, prepared by Intertek, Report No. 103238238TOR-007, dated April 27, 2018, signed and sealed by Craig H. Wagner, P.E.
2. Flame Spread, Smoke Index Test by FM Approvals, dated 01/12/18.

**C. CALCULATIONS**

1. None.

**D. QUALITY ASSURANCE**

1. Miami-Dade County Department of Regulatory and Economic Resources (RER).

**E. MATERIAL CERTIFICATIONS**

1. None.

**F. STATEMENTS**

1. Compliance letter to the FBC, 2017 Edition, issued by Bala Sockalingam, P.E., dated 05/30/2020, signed and sealed by Bala Sockalingam, P.E., on 05/30/2020.

**4. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL #21-0419.01**

**A. DRAWINGS**

1. Drawing No. C2456, titled "Designwall 2000 and Designwall 4000 Insulated Wall Metal Panels", sheets 1 through 4 of 4, prepared by Bala Sockalingam, P.E., dated March 03, 2021, signed and sealed by Bala Sockalingam, P.E., on March 03, 2021.

**B. TESTS**

1. None.

**C. CALCULATIONS**

1. None.

**D. QUALITY ASSURANCE**

1. Miami-Dade County Department of Regulatory and Economic Resources (RER).

**E. MATERIAL CERTIFICATIONS**

1. None.

**F. STATEMENTS**

1. Compliance letter to the FBC, 2020 Edition, dated 03/03/2021, signed and sealed by Bala Sockalingam, P.E., on 05/30/2020.



---

**Carlos M. Utrera, P.E.**  
**Product Control Examiner**  
**NOA No. 25-0801.02**  
**Expiration Date: May 18, 2027**  
**Approval Date: November 26, 2025**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**5. EVIDENCE SUBMITTED UNDER PREVIOUS NOA # 22-0822.08**

**A. DRAWINGS**

1. None.

**B. TESTS**

1. None.

**C. CALCULATIONS**

1. None.

**D. QUALITY ASSURANCE**

1. Miami-Dade County Department of Regulatory and Economic Resources (RER).

**E. MATERIAL CERTIFICATIONS**

1. None.

**F. STATEMENTS**

1. Compliance letter to the FBC, 2020 Edition, dated 03/03/2021, signed and sealed by Bala Sockalingam, P.E., on 05/30/2020.

**6. EVIDENCE SUBMITTED UNDER PREVIOUS NOA # 23-0901.01**

**A. DRAWINGS**

1. Drawing No. C2720, titled "Designwall 2000 and Designwall 4000 Insulated Wall Metal Panels", sheets 1 through 4 of 4, prepared by Bala Sockalingam, P.E., dated August 28, 2023, signed and sealed by Bala Sockalingam, P.E., on August 28, 2023.

**B. TESTS**

1. Test report on Transverse Load per ASTM E72-15 on Designwall 2000 (Quadcore Foam) Insulated Wall Metal Panels, prepared by Farabaugh Engineering and Testing Inc., Report No. T235-22, dated July 20, 2022, signed and sealed by Daniel G. Farabaugh, P.E.

**C. CALCULATIONS**

1. None.

**D. QUALITY ASSURANCE**

1. Miami-Dade County Department of Regulatory and Economic Resources (RER).

**E. MATERIAL CERTIFICATIONS**

1. Spectrochemical Laboratories-Material Evaluation, Inc., Report of Tensile Testing, dated June 01, 2022, signed by Todd A. Ault.

**F. STATEMENTS**

1. Compliance letter to the FBC, 2023 Edition, dated 08/28/2023, signed and sealed by Bala Sockalingam, P.E., on 08/28/2023.



---

**Carlos M. Utrera, P.E.**  
**Product Control Examiner**  
**NOA No. 25-0801.02**  
**Expiration Date: May 18, 2027**  
**Approval Date: November 26, 2025**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**7. EVIDENCE SUBMITTED UNDER NOA # 24-0501.02 AND NEW**

**A. DRAWINGS**

1. Drawing titled “Designwall 4000, Designwall 2000, Designwall 2000R, and Designwall 2000R-459 Insulated Metal Wall Panels”, sheets 1 through 5 of 5, prepared by Kingspan Insulated Panels, Inc., dated 06/02/2025, signed and sealed by Bala Sockalingam, PhD., P.E.

**B. TESTS**

1. Test report on Transverse Load Strength per ASTM E72-15, of Designwall 2000R-459 Quadcore Foam Panels, prepared by Farabaugh Engineering and Testing Inc., Report No. **T199-25**, dated 04/14/2025, signed and sealed by Daniel G. Farabaugh, P.E.

**C. CALCULATIONS**

1. None.

**D. QUALITY ASSURANCE**

1. Miami-Dade County Department of Regulatory and Economic Resources (RER).

**E. MATERIAL CERTIFICATIONS**

1. None.

**F. STATEMENTS**

1. Statement letter of code conformance to the 8th edition (2023) of the FBC, issued by Encon Technology, Inc., dated 03/03/2021, signed and sealed by Bala Sockalingam, Ph.D., P.E.


**G. OTHERS**

1. Test proposal # 24-0001.



---

**Carlos M. Utrera, P.E.**  
**Product Control Examiner**  
**NOA No. 25-0801.02**  
**Expiration Date: May 18, 2027**  
**Approval Date: November 26, 2025**

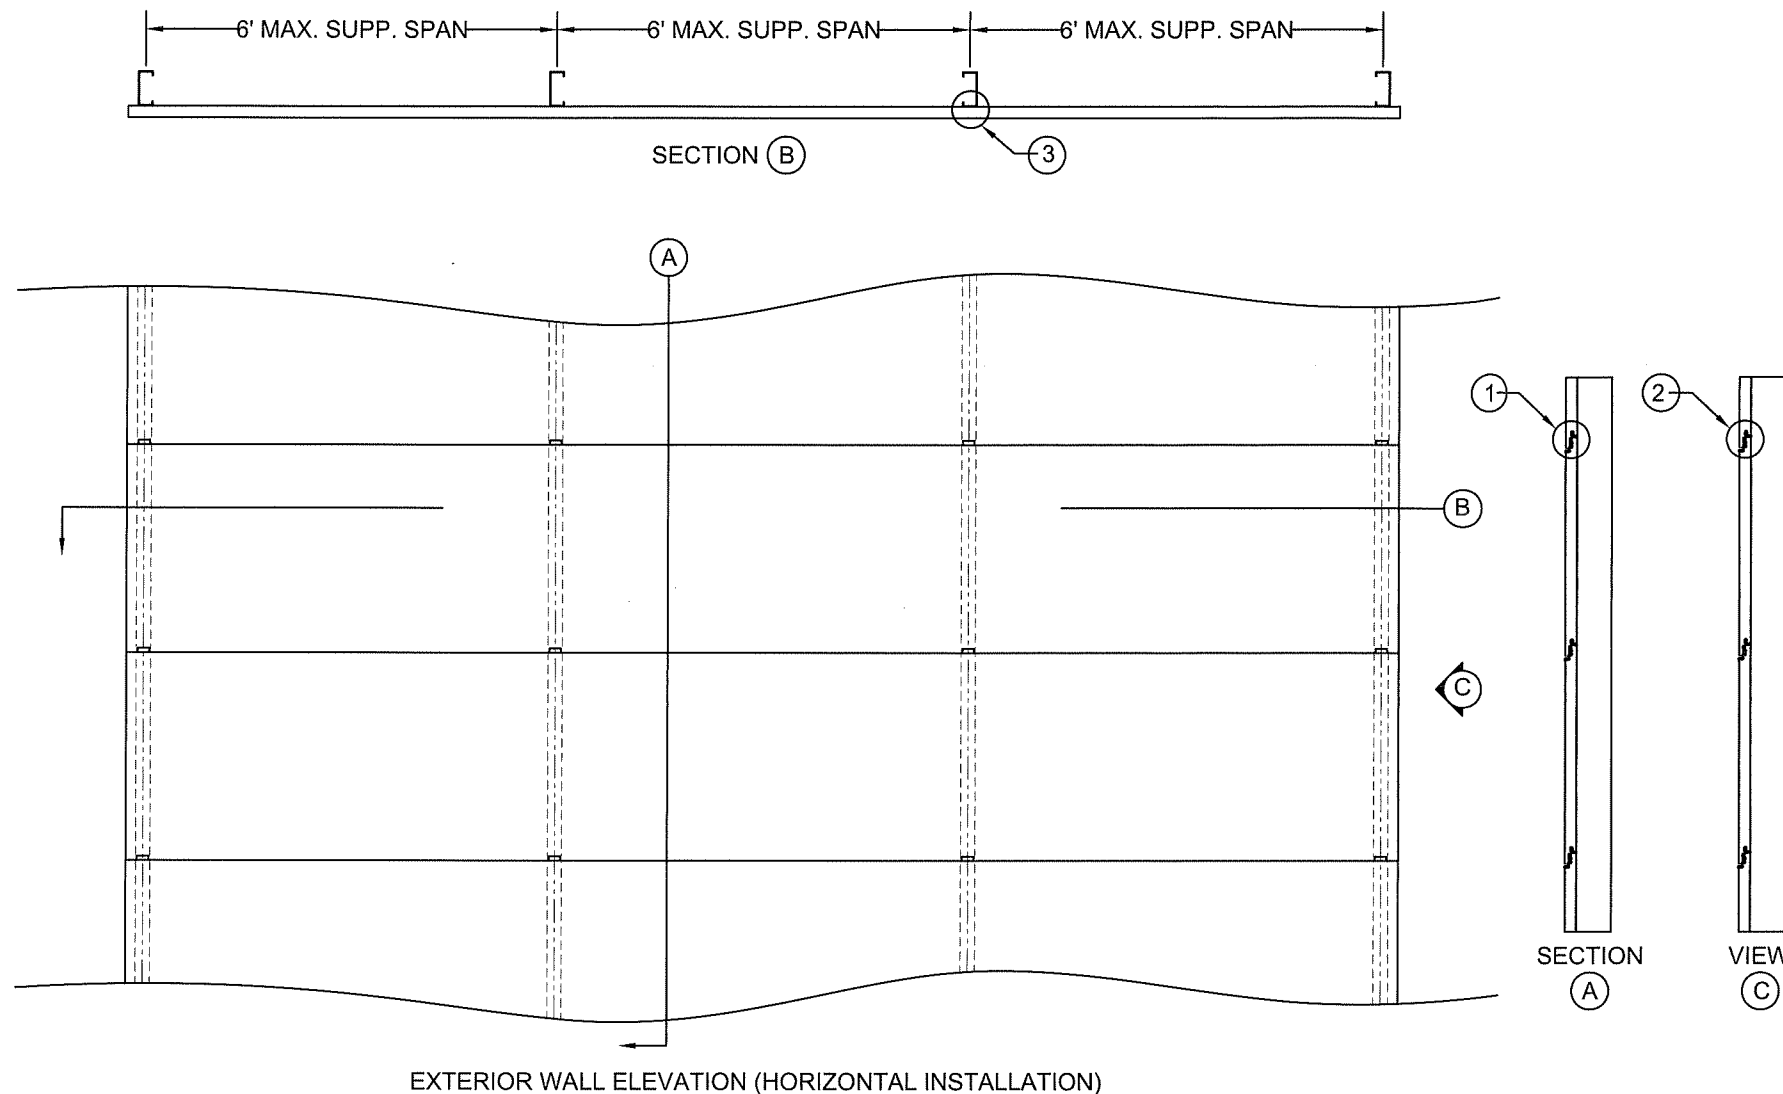

#### LIMITATIONS OF USE

1. Product approval is limited to panels and load bearing clips
2. Panels must be installed on structural framing complying with the 2023 Florida Building Code (FBC), High Velocity Hurricane Zone (HVHC) code section.
3. Panels shall not carry axial load, and are not intended/designed to act as a diaphragm.
4. The engineer of record or architect shall verify the supporting structure is capable of resisting the superimposed loads from the wall panel system, and that the supporting structure is capable of providing lateral stability to carry the wind loads to the building foundation

#### GENERAL NOTES ON DESIGNWALL (DW) 2000, 2000R, 2000R-459 AND 4000 PANELS

1. Kingspan's DW 2000, 2000R, 2000R-459 and 4000 panels are factory assembled Metal Insulated Panels (MIP), consisting of steel facings with a plastic foam core in between.
2. Panels are anchored to supports on one edge using bearing clips and screws and interlocking with the adjacent panel on the opposite.
3. Panels can be installed in vertical or horizontal installation.
4. Panel Width: 24" to 36" for DW 2000 and DW 4000; 12 to 24" for DW 2000R and DW 2000R-459.
5. Panel Thickness: 2.0", 2.5", 3.0", 4.0" for DW 2000 and DW 4000; 2.5", 3.0", 4.0" for DW 2000R and DW 2000R-459.
6. Panel Length: 1' to 30'

#### CODE COMPLIANCE

This structural wall panel has been designed in accordance with HVHZ 2023 Florida Building Code (FBC). The design pressures as determined from Section 1620 and ASCE 7-22 must be multiplied by 0.6

#### Installation

Each panel shall be fastened at one edge with two 1/4-14" self drilling steel fasteners and one load bearing clip as per details 1, 2, 3 of these drawings. Fasteners must be coated for corrosion resistance.

#### SUPPORTS & DESIGN LOAD

1. The support assembly must be designed and built by others
2. The support assembly will consist of horizontal or vertical studs for panels installed vertically or horizontally respectively.
3. The material of the studs shall be steel with a minimum Y.S. of 55 ksi
4. Thickness of the studs and spacing as dictated by the design loads in the span vs. load chart below.
5. Maximum support spacing and design load shall not be exceeded.
6. Support thickness in span vs. load chart shall be considered the minimum allowed.


Span (ft-in)	Max Design Load (+/- PSF)	Steel Supports Thickness
1' - 4"	80.0	16 Ga.
1' - 6"	80.0	12 Ga.
1' - 9"	80.0	12 Ga.
2' - 0"	80.0	12 Ga.
2' - 3"	80.0	12 Ga.
2' - 6"	80.0	12 Ga.
2' - 9"	80.0	12 Ga.
3' - 0"	80.0	12 Ga.
3' - 3"	80.0	12 Ga.
3' - 6"	80.0	12 Ga.
3' - 9"	80.0	12 Ga.
4' - 0"	79.5	12 Ga.
4' - 3"	74.8	12 Ga.
4' - 6"	70.7	12 Ga.
4' - 9"	66.9	12 Ga.
5' - 0"	63.6	12 Ga.
5' - 3"	60.6	12 Ga.
5' - 6"	57.8	12 Ga.
5' - 9"	55.3	12 Ga.
6' - 0"	53.0	12 Ga.

**PRODUCT REVISED**  
as complying with the Florida  
Building Code

NOA-No. 25-0801.02

Expiration Date 05/18/2027

By   
Miami-Dade Product Control

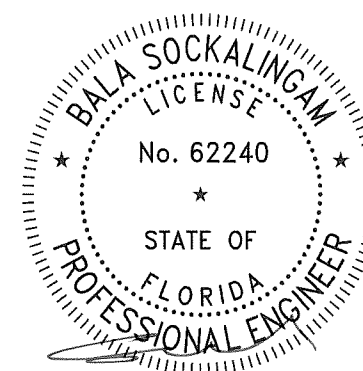

G.A. 2025

DESIGNWALL 4000, DESIGNWALL 2000,  
DESIGNWALL 2000R & 2000R-459  
INSULATED METAL WALL PANELS.

Page:  
1/5

DESIGN OVERVIEW

Scale:

Date:

6/2/2025

Drawn:  
B.S.






NO.	REVISION DESCRIPTION	BY	DATE
1	REVISE FBC 2014 TO FBC 2017	BS	7.14.17
2	DELETE FBC 2014	BS	5.30.20
3	REVISE FBC 2017 TO FBC 2020 & ASCE 7-10 TO 7-16	BS	3.3.21
4	REVISE FBC 2020 TO FBC 2023 & ASCE 7-16 TO 7-22	BS	7.22.23
5	ADD DW2000R	OL	12.20.23
6	ADD DW2000R-459	BS	5.13.25

NO.	REVISION DESCRIPTION	BY	DATE


Kingspan Insulated Panels, Inc.  
726 Summerhill Dr. Deland, FL 32724  
Phone: (386) 626 6789  
Kingspan Benchmark  
720 Marion Rd, Columbus, OH 43207  
Phone: (614) 444-0110  
www.kingspan.com/us/en

Consultant:


Bala Sockalingam, PhD., P.E.  
1216 N Lansing Ave., Suite C  
Tulsa, OK 74106  
Phone: 918 492 5992

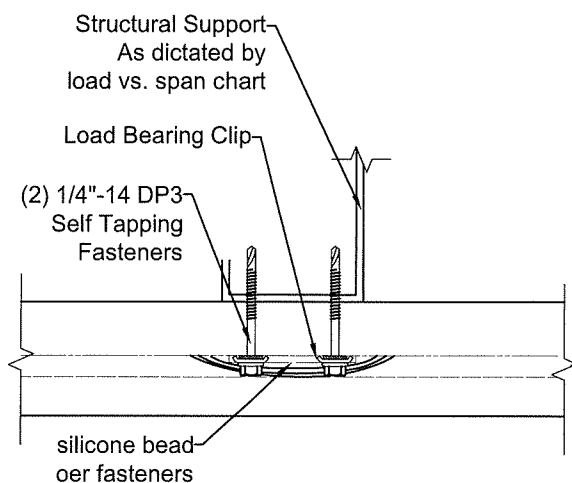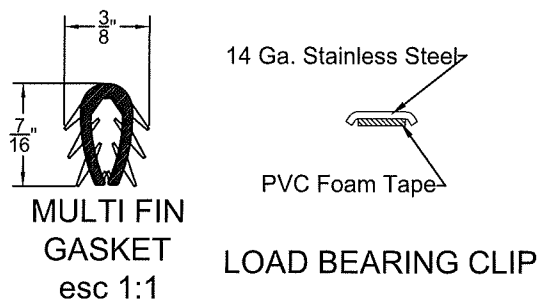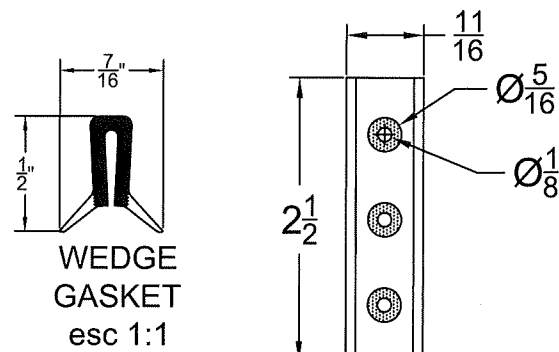


DW4000, DW2000 & DW2000R PANELS  
JOINT DETAIL AT SUPPORTS ③

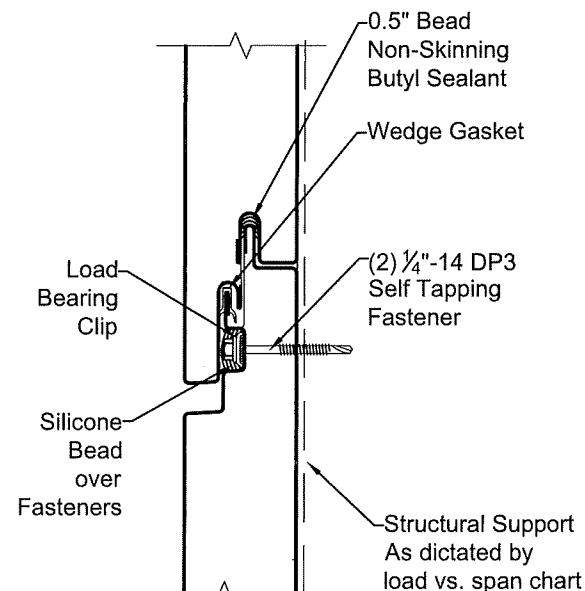


DW4000 PANEL  
JOINT DETAIL AT SUPPORTS ①

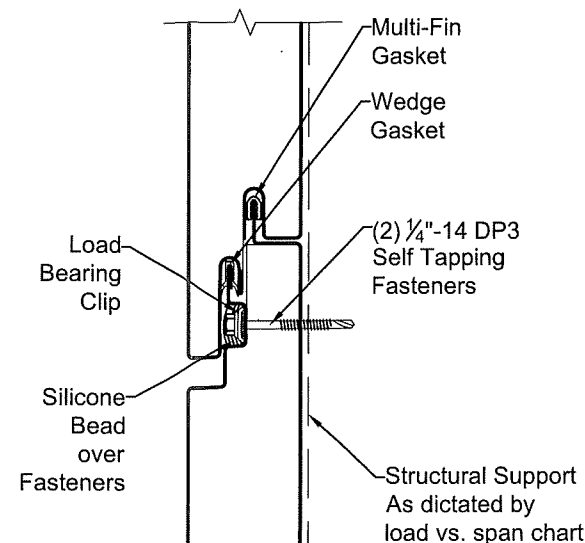


DW2000 PANEL  
JOINT DETAIL AT SUPPORTS ①

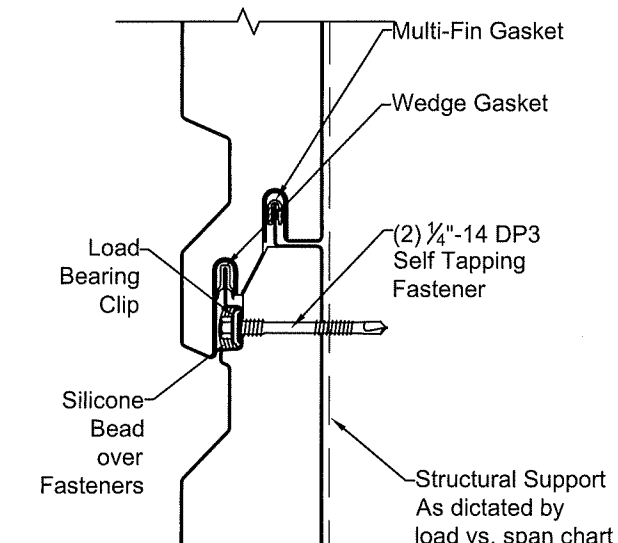


DW2000R & DW2000R-459 PANELS  
JOINT DETAIL AT SUPPORTS ①

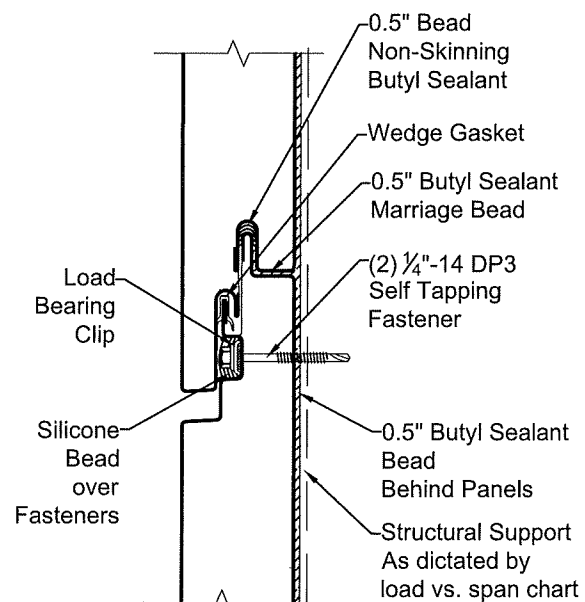

DW4000 PANEL  
JOINT DETAIL AT SUPPORTS AT END OF PANEL ②

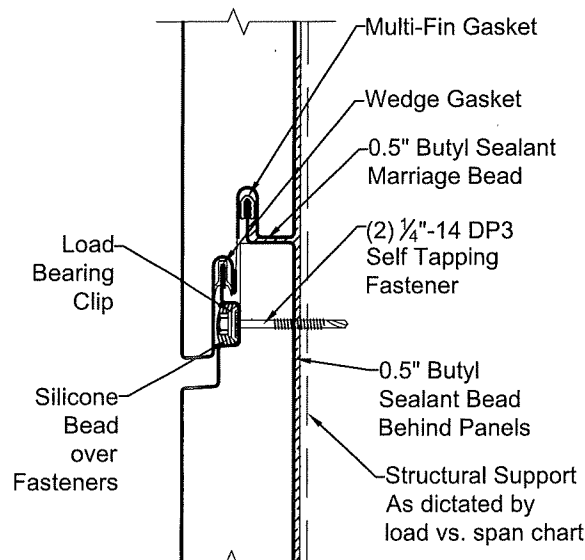


DW2000 PANEL  
JOINT DETAIL AT SUPPORTS AT END OF PANEL ②

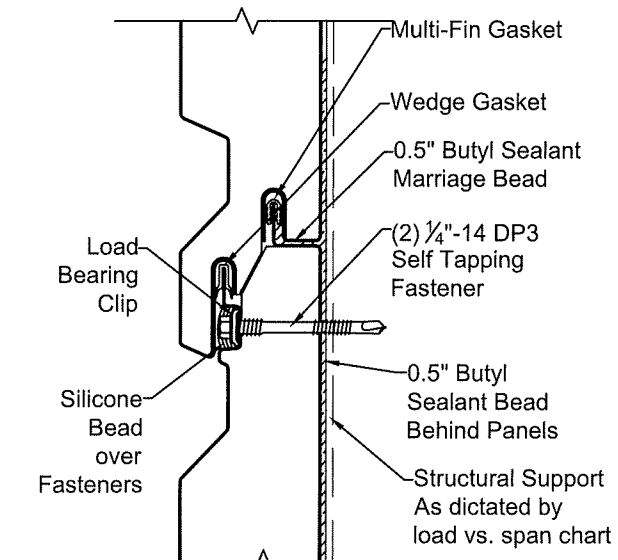

DW2000R & DW2000R-459 PANELS  
JOINT DETAIL AT SUPPORTS AT END OF PANEL ②

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
NOA-No. 25-0801.02  
Expiration Date 05/18/2027  
By *[Signature]*  
Miami-Dade Product Control

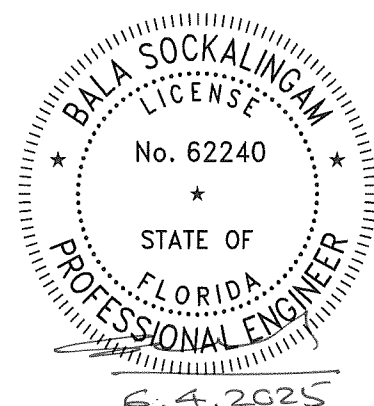

DESIGNWALL 4000, DESIGNWALL 2000,  
DESIGNWALL 2000R & 2000R-459  
INSULATED METAL WALL PANELS.

DETAILS Scale: Date: 5/13/2025 Page: 2/5 Drawn: B.S.




NO.	REVISION DESCRIPTION	BY	DATE
1	ADD DW2000R DETAILS	OL	12.20.23
2	CHANGE GASKET NAME FROM SINGLE-FIN TO WEDGE	OL	12.20.23
3	ADD DW2000R-459 TO DW2000R DETAILS	BS	5.13.25

NO.	REVISION DESCRIPTION	BY	DATE


Kingspan Insulated Panels, Inc.  
726 Summerhill Dr. Deland, FL 32724  
Phone: (386) 626 6789  
Kingspan Benchmark  
720 Marion Rd, Columbus, OH 43207  
Phone: (614) 444-0110  
www.kingspan.com/us/en


Consultant:  
Bala Sockalingam, PhD., P.E.  
1216 N Lansing Ave., Suite C  
Tulsa, OK 74106  
Phone: 918 492 5992

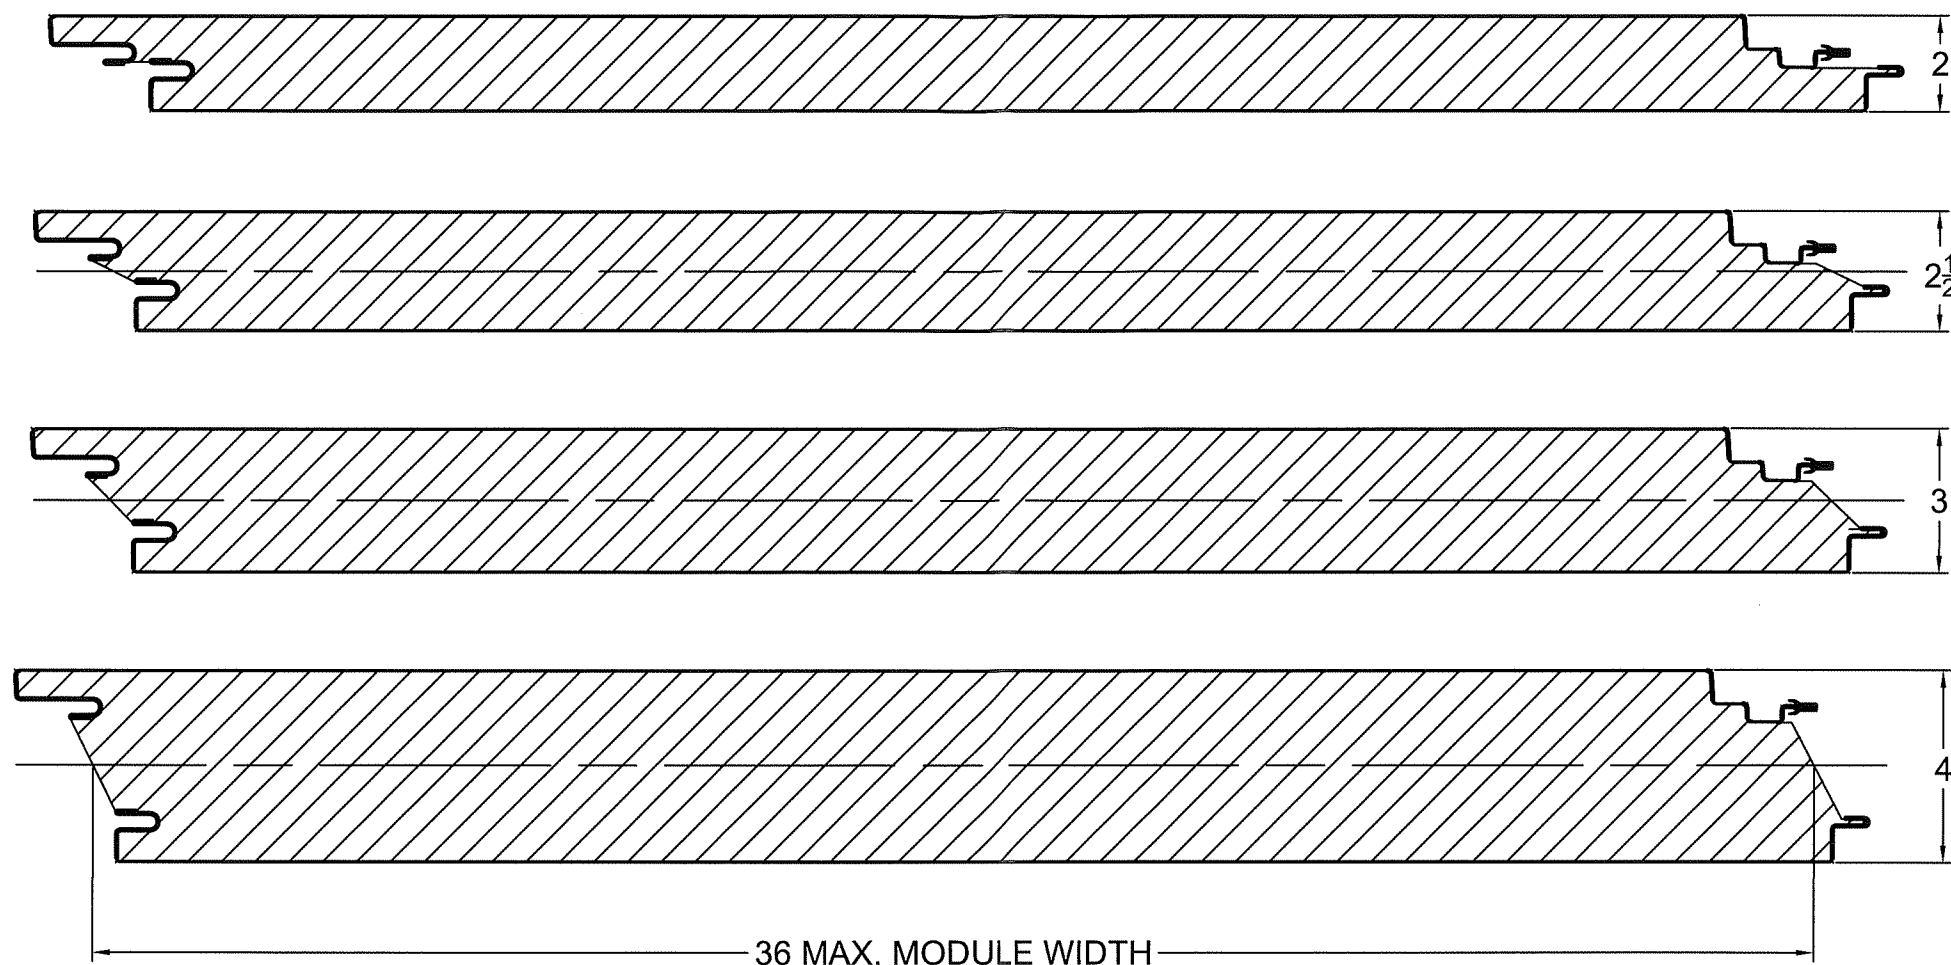

### DESIGNWALL 4000 INSULATED METAL PANEL

1. Exterior Facing: 22 Ga. Steel with a minimum 55 ksi yield strength, with G90 galvanized or AZ50 Galvalume ®/Zincalume ® coating protection in accordance with ASTM A653 or ASTM A792 respectively.
2. Interior Facing: 24 Ga. Steel with a minimum 55 ksi yield strength, with G90 galvanized or AZ50 Galvalume ®/Zincalume ® coating protection in accordance with ASTM A653 or ASTM A792 respectively.
3. Core: Continuously foamed in place rigid polyisocyanurate & Quadcore foams.

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
NOA-No. 25-0801.02  
Expiration Date 05/18/2027  
By   
Miami-Dade Product Control

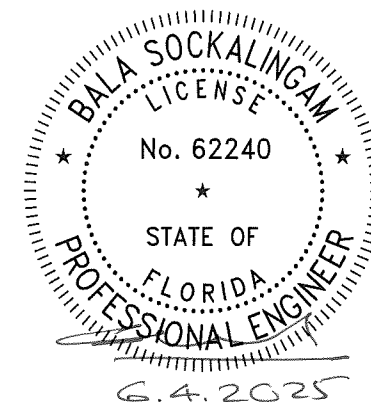

DESIGNWALL 4000, DESIGNWALL 2000,  
DESIGNWALL 2000R & 2000R-459  
INSULATED METAL WALL PANELS.

Page:  
3/5

DESIGNWALL 4000

Scale:

Date:

5/13/2025

Drawn:  
B.S.




NO.	REVISION DESCRIPTION	BY	DATE
1	ADDED QUADCORE FOAM IN NOTE 3	BS	5.30.20

NO.	REVISION DESCRIPTION	BY	DATE

Kingspan Insulated Panels, Inc.  
726 Summerhill Dr. Deland, FL 32724  
Phone: (386) 626 6789  
Kingspan Benchmark  
720 Marion Rd, Columbus, OH 43207  
Phone: (614) 444-0110  
www.kingspan.com/us/en

Consultant:

Bala Sockalingam, PhD., P.E.  
1216 N Lansing Ave., Suite C  
Tulsa, OK 74106  
Phone: 918 492 5992

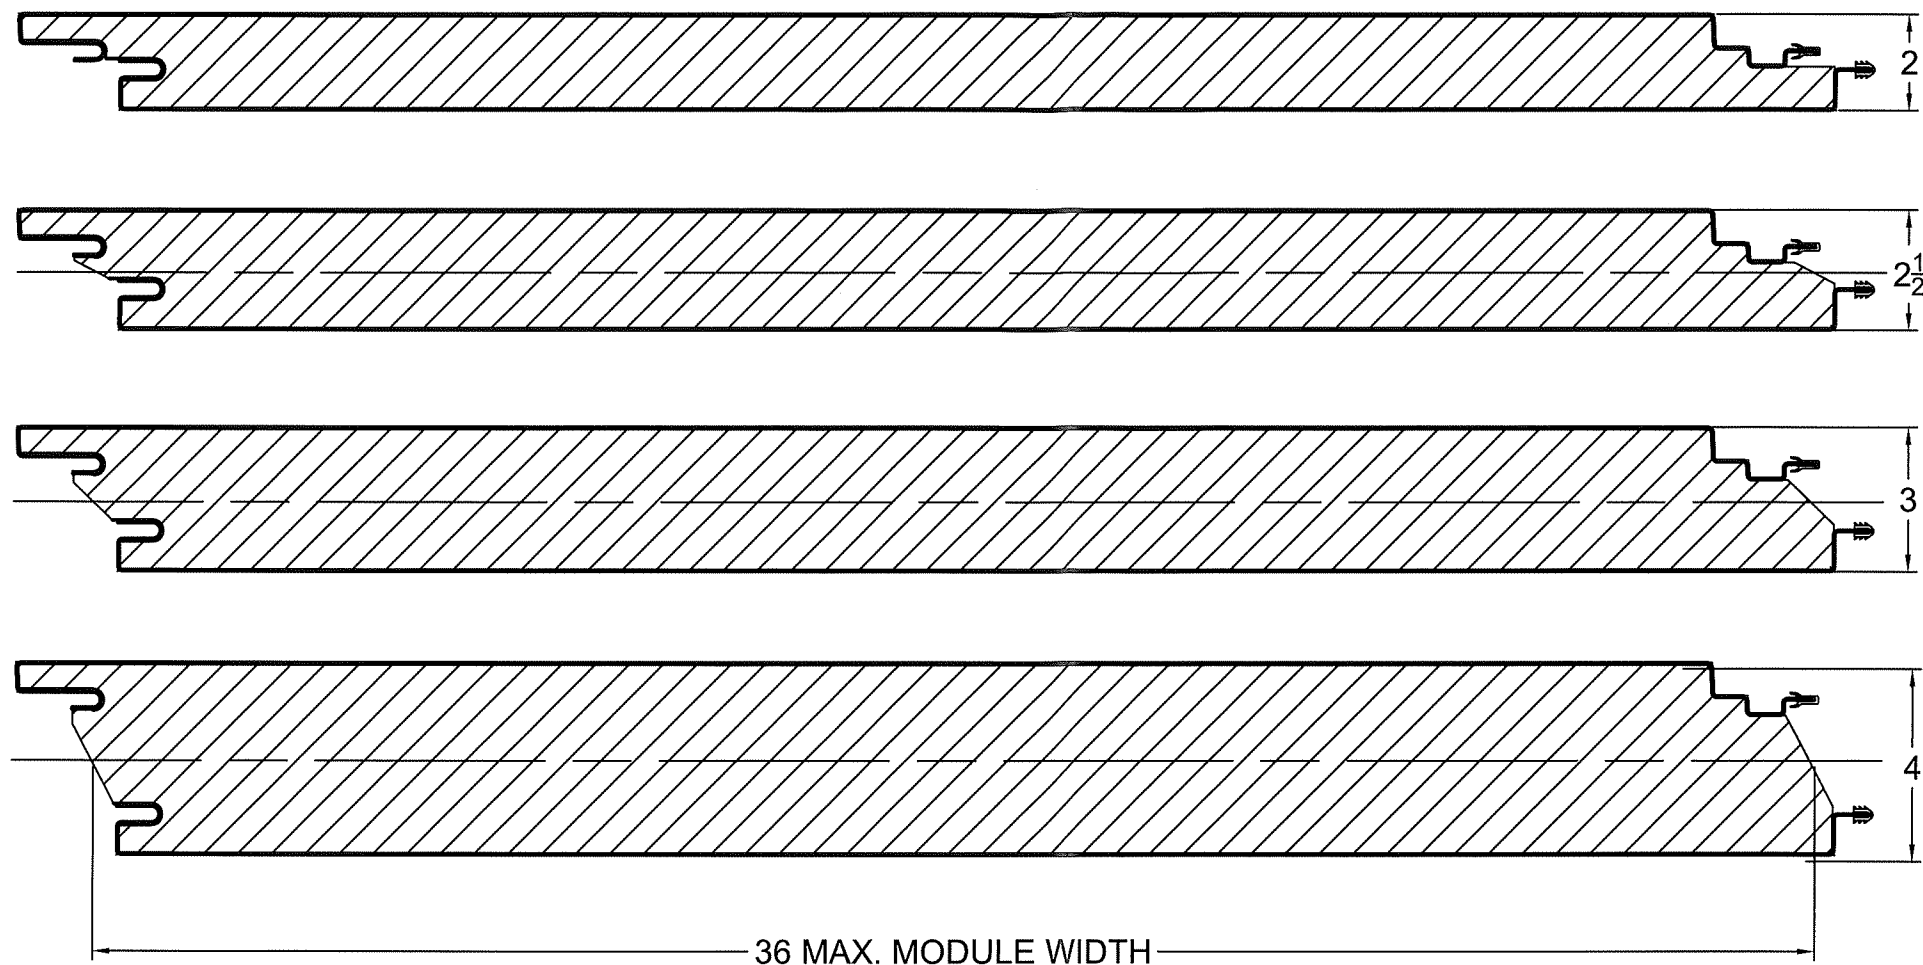

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
NOA-No. 25-0801.02  
Expiration Date 05/18/2027  
By *[Signature]*  
Miami-Dade Product Control


**DESIGNWALL 2000 INSULATED METAL PANEL**

- 1. Exterior Facing: 22 Ga. Steel with a minimum 55 ksi yield strength, with G90 galvanized or AZ50 Galvalume ®/Zincalume ® coating protection in accordance with ASTM A653 or ASTM A792 respectively.
- 2. Interior Facing: 24 Ga. Steel with a minimum 55 ksi yield strength, with G90 galvanized or AZ50 Galvalume ®/Zincalume ® coating protection in accordance with ASTM A653 or ASTM A792 respectively.
- 3. Core: Structurally laminated rigid polyisocyanurate & Quadcore-B foam.




NO.	REVISION DESCRIPTION	BY	DATE
1	ADDED QUADCORE-B FOAM IN NOTE 3	OL	12.20.23

NO.	REVISION DESCRIPTION	BY	DATE

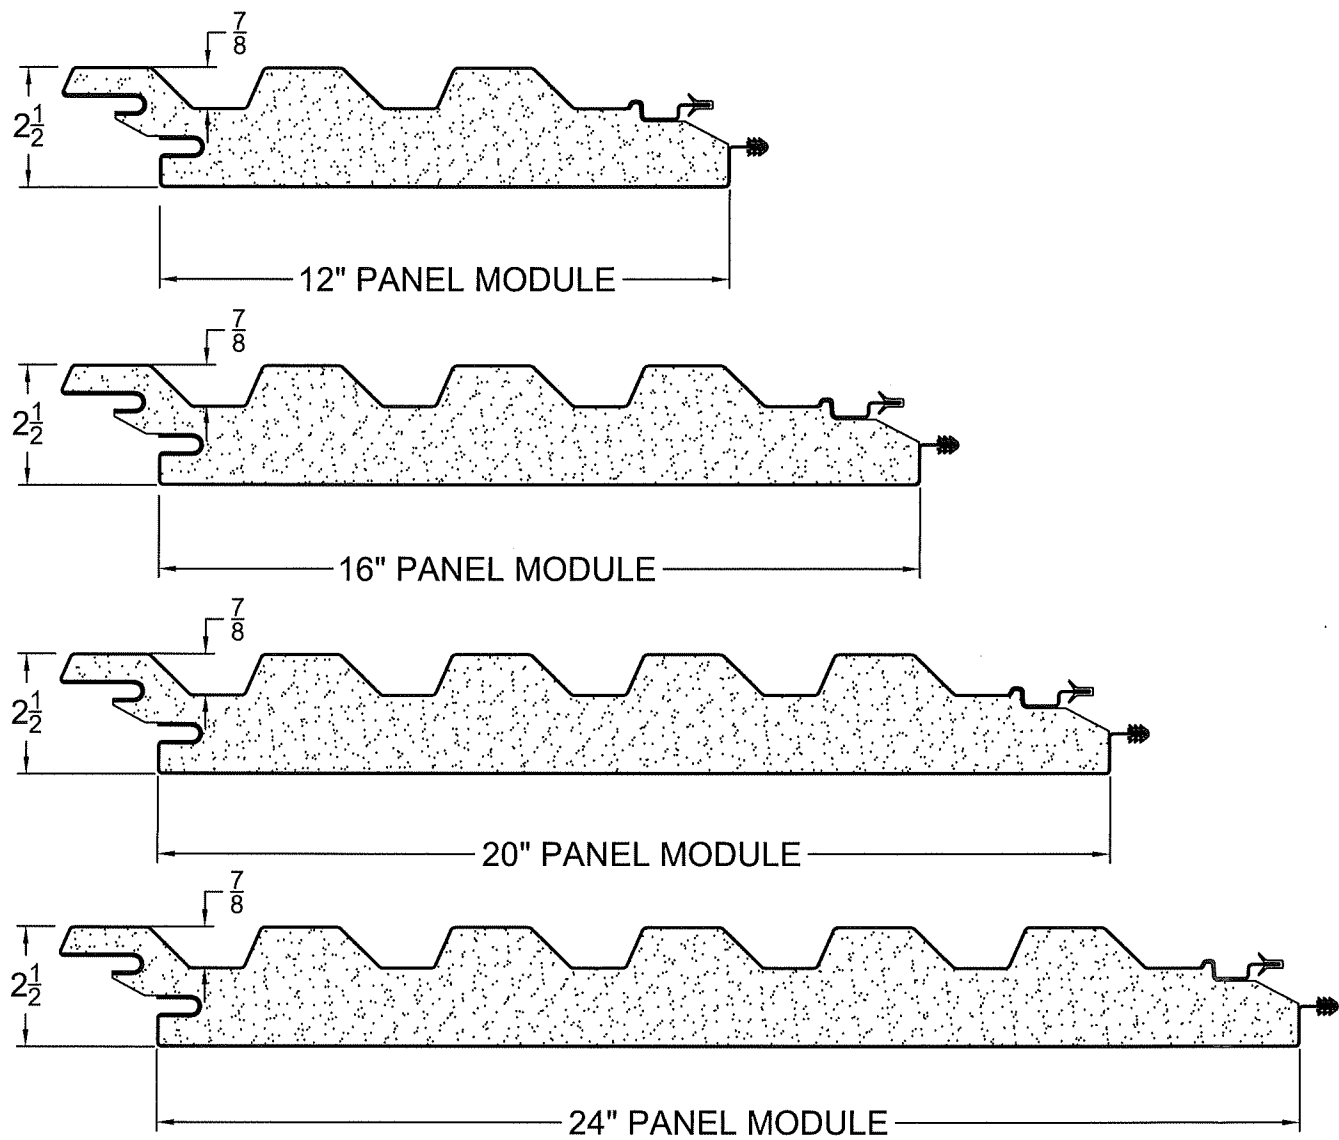


DESIGNWALL 2000R INSULATED METAL PANEL

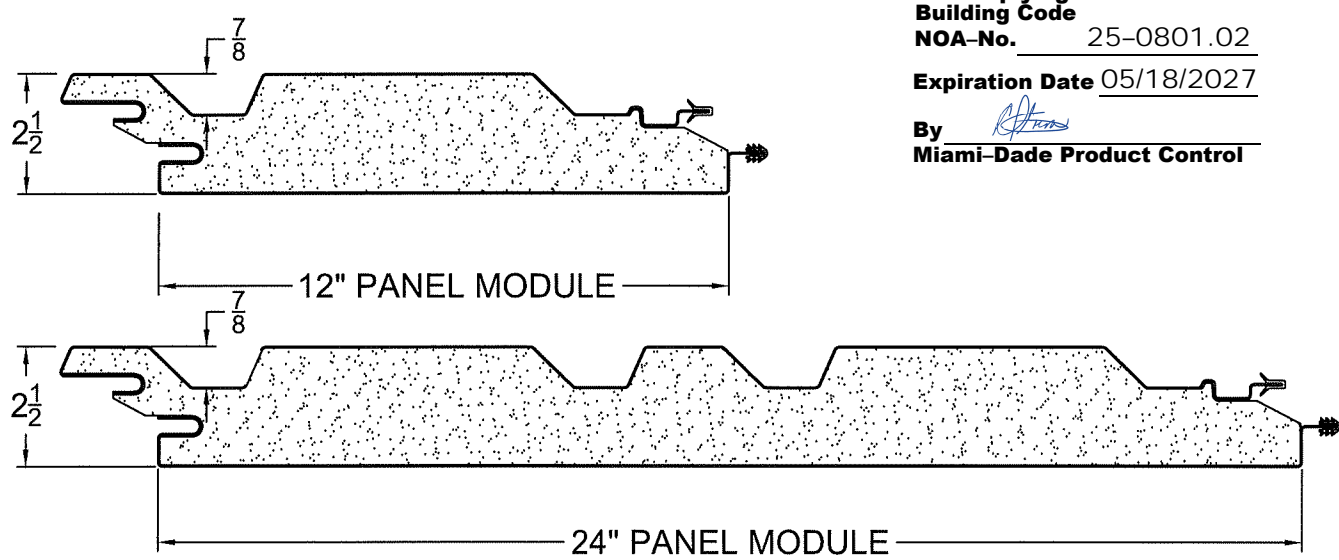

DESIGNWALL 2000R-459 INSULATED METAL PANEL

**PRODUCT REVISED**  
 as complying with the Florida  
 Building Code  
 NOA-No. 25-0801.02  
 Expiration Date 05/18/2027  
 By *[Signature]*  
 Miami-Dade Product Control

1. Exterior Facing: 22 Ga. Steel with a minimum 55 ksi yield strength, with G90 galvanized or AZ50 Galvalume ®/Zincalume ® coating protection in accordance with ASTM A653 or ASTM A792 respectively.
2. Interior Facing: 24 Ga. Steel with a minimum 55 ksi yield strength, with G90 galvanized or AZ50 Galvalume ®/Zincalume ® coating protection in accordance with ASTM A653 or ASTM A792 respectively.
3. Core: Quadcore-B foam.

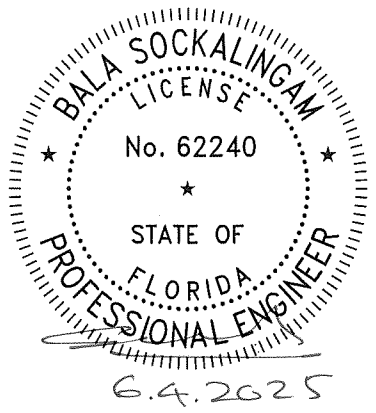

NO.	REVISION DESCRIPTION	BY	DATE
1	ADD DW2000R-459	BS	5.13.25

NO.	REVISION DESCRIPTION	BY	DATE

Kingspan Insulated Panels, Inc.  
 726 Summerhill Dr. Deland, FL 32724  
 Phone: (386) 626 6789  
 Kingspan Benchmark  
 720 Marion Rd, Columbus, OH 43207  
 Phone: (614) 444-0110  
 www.kingspan.com/us/en

Consultant:  
 Bala Sockalingam, PhD., P.E.  
 1216 N Lansing Ave., Suite C  
 Tulsa, OK 74106  
 Phone: 918 492 5992