



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY, FLORIDA
PRODUCT CONTROL SECTION

11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599

www.miamidade.gov/building

PGT Industries, LLC
3400 Precision Drive,
North Venice, FL 34275

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER - Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "PW-5440" PVC Fixed Window – N.I.

APPROVAL DOCUMENT: Drawing No. **MD-5440.0 Rev E** titled "Vinyl Fixed Casement Window NOA (NI)", sheets 1 through 11 of 11, dated 09/09/14 and last revised on 07/30/25, prepared by manufacturer, signed and sealed by Anthony Lynn Miller, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: None. Approved Hurricane Protection Devices complying FBC, HVHZ required

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises & renews NOA No. 23-0816.05** and consists of this page 1 and evidence pages E-1, E-2, E-3, E-4, E-5 and E-6, as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P.E.**



8/21/25

NOA No. 25-0801.06
Expiration Date: September 24, 2030
Approval Date: September 04, 2025
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's

A. DRAWINGS

1. Manufacturer's die drawings and sections.
(Submitted under NOA No. 15-0415.02)
2. Drawing No. **MD-5440.0** titled "Vinyl Fixed Casement Window NOA (NI)", sheets 1 through 11 of 11, dated 09/09/14, with revision **C** dated 03/19/20, prepared by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.
(Submitted under NOA No. 20-0401.08)

B. TESTS

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per ASTM F588 and TAS 202-94
along with marked-up drawings and installation diagram of all PGT Industries, Inc. representative units listed below and tested to qualify **Dowsil 791** and **Dowsil 983** silicones, prepared by Fenestration Testing Laboratory, Inc., Test Reports No.: **FTL-7897**, PGT PW5520 PVC Fixed Window (unit 6 in proposal), dated 09/03/14
FTL-20-2107.1, PGT SGD780 Aluminum Sliding Glass Door (unit 7 in proposal)
FTL-20-2107.2, PGT CA740 Alum. Outswing Casement Window (unit 8 in proposal)
FTL-20-2107.3, PGT PW7620A Aluminum Fixed Window (unit 9 in proposal) and
FTL-20-2107.4, PGT PW7620A Aluminum Fixed Window (unit 10 in proposal)
dated 07/13/20, all signed and sealed by Idalmis Ortega, P.E.
(Submitted under NOA No. 20-0401.08)
2. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of a PVC sliding glass door, a PVC fixed window and an aluminum sliding glass door, using: Kodispac 4SG TPS spacer system, Duraseal® spacer system, Super Spacer® NXT™ spacer system and XL Edge™ spacer system at insulated glass, prepared by Fenestration Testing Laboratory, Inc., Test Reports No. **FTL-8717**, **FTL-8968** and **FTL-8970**, dated 11/16/15, 06/07/16 and 06/02/16 respectively, all signed and sealed by Idalmis Ortega, P.E.
(Submitted under NOA No. 16-0714.20)



Ishaq I. Chanda, P.E.

Product Control Unit Supervisor

NOA No. 25-0801.06

Expiration Date: September 24, 2030

Approval Date: September 04, 2025

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED


1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's (CONTINUED)

B. TESTS (CONTINUED)

3. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per FBC 2411.3.2.1, and TAS 202-94
along with marked-up drawings and installation diagram of a PVC fixed window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-7897**, dated 08/01/14, signed and sealed by Idalmis Ortega, P.E.
(Submitted under NOA No. 15-0415.01)
4. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, per FBC 2411.3.2.1, and TAS 202-94
5) Large Missile Impact Test per FBC, TAS 201-94
6) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of a series 5540/5440 PVC casement picture windows, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-8128**, dated 02/10/15, signed and sealed by Idalmis Ortega, P.E.
(Submitted under NOA No. 15-0415.01)
5. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, per FBC 2411.3.2.1, and TAS 202-94
5) Large Missile Impact Test per FBC, TAS 201-94
6) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of a series 5540/5440 vinyl fixed windows w/tube mullion, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-8174**, dated 03/31/15, signed and sealed by Idalmis Ortega, P.E.
(Submitted under NOA No. 15-0415.01)
6. Additional, Reference test report **FTL-8183** per TAS 201, 202 & 203-94, issued by Fenestration Testing Laboratory, Inc.
(Submitted under NOA No. 15-0415.01)

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with **FBC 6th Edition (2017)** and **FBC 7th (2020)** dated 03/19/20, prepared by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.
(Submitted under NOA No. 20-0401.08)


Ishaq I. Chanda, P.E.
Product Control Unit Supervisor
NOA No. 25-0801.06
Expiration Date: September 24, 2030
Approval Date: September 04, 2025

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's (CONTINUED)

C. CALCULATIONS (CONTINUED)

2. Glazing complies with ASTM E1300-09

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS


1. Notice of Acceptance No. **18-0122.02**, issued to **ENERGI Fenestration Solutions USA, Inc.**, for their **White Rigid PVC Exterior Extrusions for Windows and Doors**, approved on 03/08/18, expiring on 02/28/23.
2. Notice of Acceptance No. **20-0203.03** issued to **ENERGI Fenestration Solutions USA, Inc.** for their **"Bronze and Lighter Shades of Cap Coated Rigid PVC Exterior Extrusions for Windows and Doors"** dated 02/27/20, expiring on 04/16/25.
3. Notice of Acceptance No. **20-0203.04** issued to **ENERGI Fenestration Solutions USA, Inc.** for their **"Performance Core Rigid PVC Exterior Extrusions for Windows and Doors"** dated 02/27/20, expiring on 04/16/25.

F. STATEMENTS

1. Statement letter of conformance, complying with **FBC 6th Edition (2017)** and the **FBC 7th Edition (2020)**, dated March 16, 2020, issued by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.
(Submitted under NOA No. 20-0401.08)
2. Statement letter of no financial interest, dated March 16, 2020, issued by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.
(Submitted under NOA No. 20-0401.08)
3. Proposal No. **19-1155TP** issued by the Product Control Section, dated January 10, 2020, signed by Ishaq Chanda, P.E.
(Submitted under NOA No. 20-0401.08)
4. Proposal No. **16-0125** issued by the Product Control Section, dated March 09, 2016, signed by Ishaq Chanda, P.E.
(Submitted under NOA No. 17-0614.07)
5. Proposal issued by Product Control Section, dated June 26, 2014, signed by Jaime Gascon, P.E. Supervisor, Product Control Section.
(Submitted under NOA No. 15-0415.02)

G. OTHERS

1. Notice of Acceptance No. **17-0614.07**, issued to **PGT Industries, Inc.** for their Series "PW-5440" PVC Fixed Window – N.I., approved on 10/12/17 and expiring on 09/24/20.


Ishaq I. Chanda, P.E.
Product Control Unit Supervisor
NOA No. 25-0801.06
Expiration Date: September 24, 2030
Approval Date: September 04, 2025

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

2. EVIDENCE SUBMITTED under previous approval

A. DRAWINGS

1. Drawing No. **MD-5440.0** titled “Vinyl Fixed Casement Window NOA (NI)”, sheets 1 through 11 of 11, dated 09/09/14, with revision **D** dated 07/31/23, prepared by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.

B. TESTS

1. None.

C. CALCULATIONS

1. None.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS


1. Notice of Acceptance No. **21-1109.04**, issued to **Vision Extrusions Group Limited**, for their **White Rigid PVC Exterior Extrusions for Windows and Doors**, approved on 03/31/22, expiring on 09/30/24.
2. Notice of Acceptance No. **22-0104.04**, issued to **Vision Extrusions Group Limited**, for their **Bronze and Lighter Shades of Cap Coated Rigid PVC Exterior Extrusions for Windows and Doors**, approved on 04/14/22, expiring on 12/29/26.
3. Notice of Acceptance No. **22-0621.01**, issued to **Vision Extrusions Group Limited**, for their **Black and Lighter Shades of Cap Coated Rigid PVC Exterior Extrusions for Windows and Doors**, approved on 07/28/22, expiring on 07/28/27.

F. STATEMENTS

1. Statement letter of conformance, complying with **FBC 7th Edition (2020)** and the **FBC 8th Edition (2023)**, dated July 31, 2023, issued by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.
2. Statement letter of no financial interest, dated July 31, 2023, issued by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.

G. OTHERS

1. Notice of Acceptance No. **20-0401.08**, issued to PGT Industries, Inc. for their Series “PW-5440” PVC Fixed Window – N.I., approved on 08/06/20 and expiring on 09/24/25.


Ishaq I. Chanda, P.E.
Product Control Unit Supervisor
NOA No. 25-0801.06
Expiration Date: September 24, 2030
Approval Date: September 04, 2025

PGT Industries, LLC

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

3. NEW EVIDENCE SUBMITTED

A. DRAWINGS

1. **APPROVAL DOCUMENT:** Drawing No. **MD-5440.0** Rev E titled "Vinyl Fixed Casement Window NOA (NI)", sheets 1 through 11 of 11, dated 09/09/14 and last revised on 07/30/25, prepared by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.

B. TESTS (submitted under previous approval)

1. None.

C. CALCULATIONS (submitted under previous approval)

1. None

D. QUALITY ASSURANCE


1. Miami-Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS

1. NOA No. **24-0618.01** issued to Vision Extrusions Group Limited, for their "**White Rigid PVC Exterior Extrusions for Windows and Doors**", expiring on 09/30/29.
2. Notice of Acceptance No. **25-0609.03**, issued to **Vision Extrusions Group Limited**, for their **Tan 3040 and Lighter Shades (Non-White) Rigid PVC Exterior Extrusions for Windows and Doors**, approved on 07/10/25, expiring on 02/04/31.
3. Notice of Acceptance No. **24-0401.07**, issued to **Vision Extrusions Group Limited**, for their **Black and Lighter Shades of Cap Coated Rigid PVC Exterior Extrusions for Windows and Doors**, approved on 05/09/24, expiring on 07/28/27.
4. Notice of Acceptance No. **23-0830.05**, issued to **Vision Extrusions Group Limited**, for their **VE 1000 Tan 202 and Lighter Shades (Non-White) Rigid PVC Exterior Extrusions for Windows and Doors**, approved on 10/26/23, expiring on 12/29/26.
5. Notice of Acceptance No. **24-0618.02**, issued to **Vision Extrusions Group Limited**, for their **Painted or Laminated White Rigid PVC Exterior Extrusions for Windows and Doors**, approved on 07/18/24, expiring on 09/30/29.

F. STATEMENTS

1. Statement letter of conformance, complying with **FBC 8th Edition (2023)** and no financial interest, dated 07-30-25, issued by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.
2. Statement letter dated 12/18/24 issued by manufacturer requesting renewal with company name change to PGT industries, LLC, signed and sealed by Anthony Lynn Miller, P.E.
3. e-mail dated 12/23/24 sent by Lynn Miller (PGT Code Compliance Manager), consists of PGT innovation form 8-k filed w/SEC, PGT innovation form 10-K filed w/SEC and Exhibit 21(Form 10-K); PGT innovation's list of subsidiaries



Ishaq I. Chanda, P.E.

Product Control Unit Supervisor

NOA No. 25-0801.06

Expiration Date: September 24, 2030

Approval Date: September 04, 2025


PGT Industries, LLC

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

3. NEW EVIDENCE SUBMITTED (continue)

G. OTHERS

1. This NOA **revises & renews** NOA# 23-0816.05, expiring on 09/24/30.
2. Article of conversion of PGT Industries, Inc to PGT industries, LLC pdf provided on 12/24/24 by Ms. April Lee, Assistant General Counsel.
3. Florida Department of State, Division of Corporation listing # L2400142070 of PGT Industries, LLC as active status since 12/17/24.
4. Florida Department of State, Division of Corporation listing # F03387 of PGT Industries, Inc as Inactive status.
5. PGT Name change organization chart layout prepared by RER (for file use only)



Ishaq I. Chanda, P.E.

Product Control Unit Supervisor


NOA No. 25-0801.06

Expiration Date: September 24, 2030

Approval Date: September 04, 2025


GENERAL NOTES: SERIES 5440
NON-IMPACT RESISTANT, VINYL FIXED CASEMENT WINDOW

- 1) THIS PRODUCT HAS BEEN DESIGNED & TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE, INCLUDING THE HIGH VELOCITY HURRICANE ZONE (HVHZ).
- 2) SHUTTERS ARE REQUIRED WHEN USED IN WIND-BORNE DEBRIS REGIONS.
- 3) FOR MASONRY APPLICATIONS IN MIAMI-DADE COUNTY, USE ONLY MIAMI-DADE COUNTY APPROVED MASONRY ANCHORS. MATERIALS USED FOR ANCHOR EVALUATIONS WERE SOUTHERN PINE, ASTM C90 CONCRETE MASONRY UNITS AND CONCRETE WITH MIN. KSI PER ANCHOR TYPE.
- 4) ALL WOOD BUCKS LESS THAN 1-1/2" THICK ARE TO BE CONSIDERED 1X INSTALLATIONS. 1X WOOD BUCKS ARE OPTIONAL IF UNIT IS INSTALLED DIRECTLY TO SUBSTRATE. WOOD BUCKS DEPICTED AS 2X ARE 1-1/2" THICK OR GREATER. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND SECURED TO PROPERLY TRANSFER LOADS TO THE STRUCTURE. WOOD BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER, (EOR) OR ARCHITECT OF RECORD, (AOR).
- 5) ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO. USE ANCHORS OF SUFFICIENT LENGTH TO ACHIEVE EMBEDMENT. OVERALL SEALING/FLASHING STRATEGY FOR WATER RESISTANCE OF INSTALLATION SHALL BE DONE BY OTHERS AND IS BEYOND THE SCOPE OF THESE INSTRUCTIONS.
- 6) MAX. 1/4" SHIMS ARE REQUIRED AT EACH ANCHOR LOCATION WHERE THE PRODUCT IS NOT FLUSH TO THE SUBSTRATE. USE SHIMS CAPABLE OF TRANSFERRING APPLIED LOADS. WOOD BUCKS, BY OTHERS, MUST BE SUFFICIENTLY ANCHORED TO RESIST LOADS IMPOSED ON THEM BY THE WINDOW.
- 7) DESIGN PRESSURES:
A. NEGATIVE DESIGN LOADS BASED ON STRUCTURAL TEST PRESSURE, FRAME ANALYSIS AND GLASS PER ASTM E1300.
B. POSITIVE DESIGN LOADS BASED ON WATER TEST PRESSURE, STRUCTURAL TEST PRESSURE, FRAME ANALYSIS AND GLASS PER ASTM E1300.
C. DESIGN LOADS ARE BASED ON ALLOWABLE STRESS DESIGN, ASD.
- 8) THE ANCHORAGE METHODS SHOWN HAVE BEEN DESIGNED AND SECURED TO RESIST THE WINDLOADS CORRESPONDING TO THE REQUIRED DESIGN PRESSURE. THE 33-1/3% STRESS INCREASE HAS NOT BEEN USED IN THE DESIGN OF THIS PRODUCT. THE 1.6 LOAD DURATION FACTOR WAS USED FOR THE EVALUATION OF ANCHORS INTO WOOD. ANCHORS THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE FLORIDA BUILDING CODE FOR CORROSION RESISTANCE.
- 9) METAL SUBSTRATE TO MEET MIN. STRENGTH AND THICKNESS REQUIREMENTS PER CURRENT FLORIDA BUILDING CODE AND TO BE REVIEWED BY THE AUTHORITY HAVING JURISDICTION.
- 10) REFERENCES: TEST REPORTS FTL-7897, 8128, 8174; DEWALT ULTRACON+ NOA; ELCO/DEWALT CRETEFLEX NOA; ELCO/DEWALT AGGRE-GATOR NOA; VISION EXTRUSION LTD., BLACK, WHITE BRONZE & LIGHTER SHADES OF CAP COATED PVC EXTRUSION NOA'S; NATIONAL DESIGN SPECIFICATION FOR WOOD CONSTRUCTION, ANSI/AF&PA NDS & ALUMINUM DESIGN MANUAL.
- 11) FRAME FLANGES OR INTEGRAL FINNS MAY BE TRIMMED IN-FIELD TO CREATE AN EQUAL-LEG FRAME.
- 12) MAXIMUM SHIM SPACING TO BE 18" WHEN INSTALLING THROUGH THE INTEGRAL FIN.

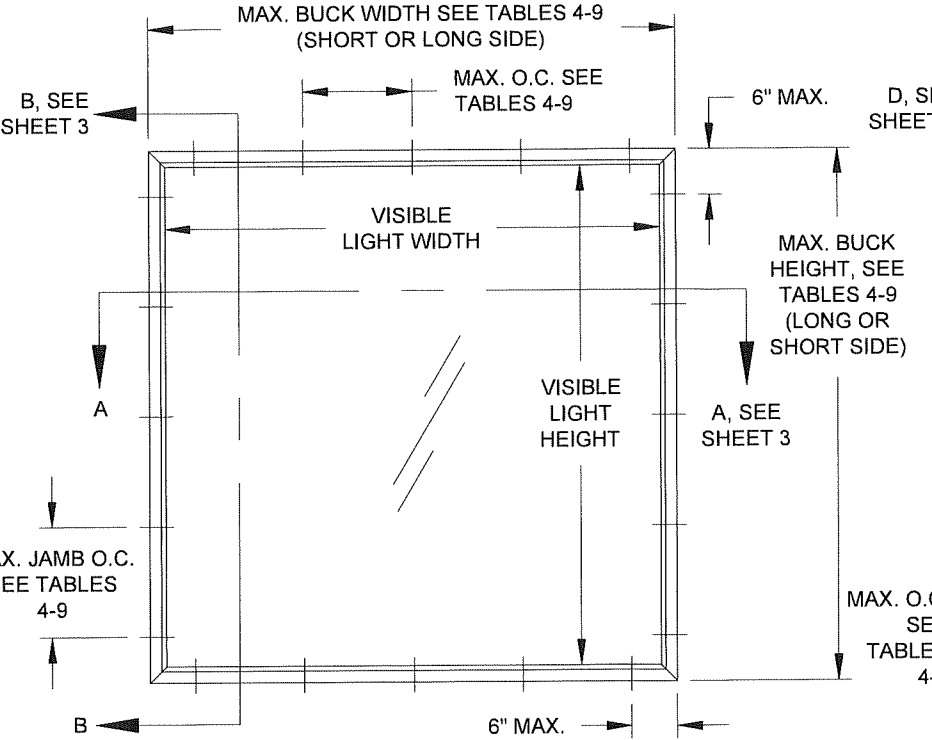


TYP. EQUAL-LEG/BOX & FLANGE FRAME (90° CORNERS)


IMPACT RATING	DESIGN PRESSURE RATING
NOT RATED FOR IMPACT RESISTANCE	VARIES PER OPTIONS, SEE TABLES 4-9, SHEETS 8-10

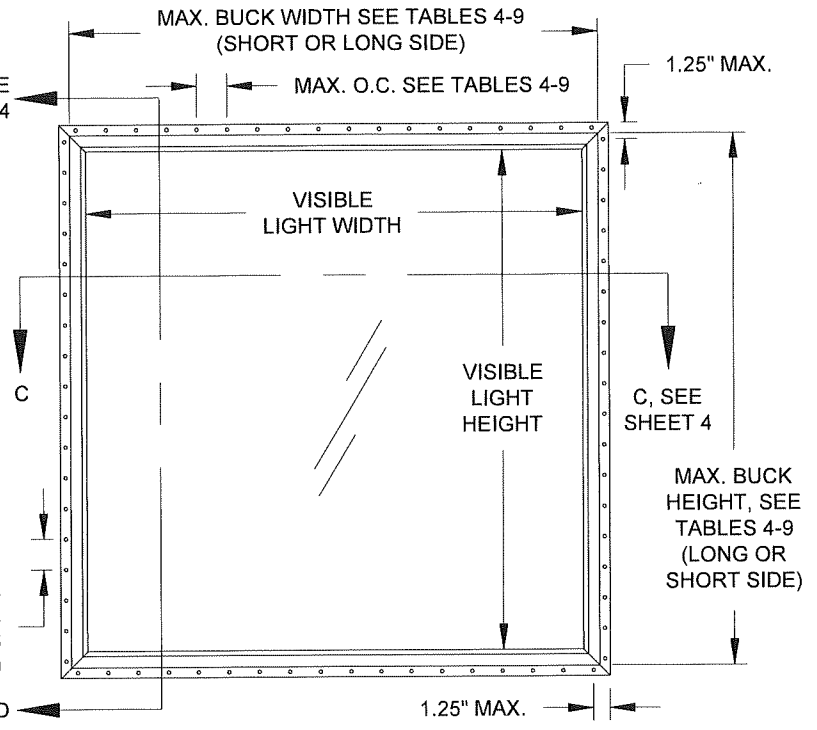

TYP. INTEGRAL FIN & J-CANNEL FRAME (90° CORNERS) (ANCHORED THROUGH NAIL FIN)

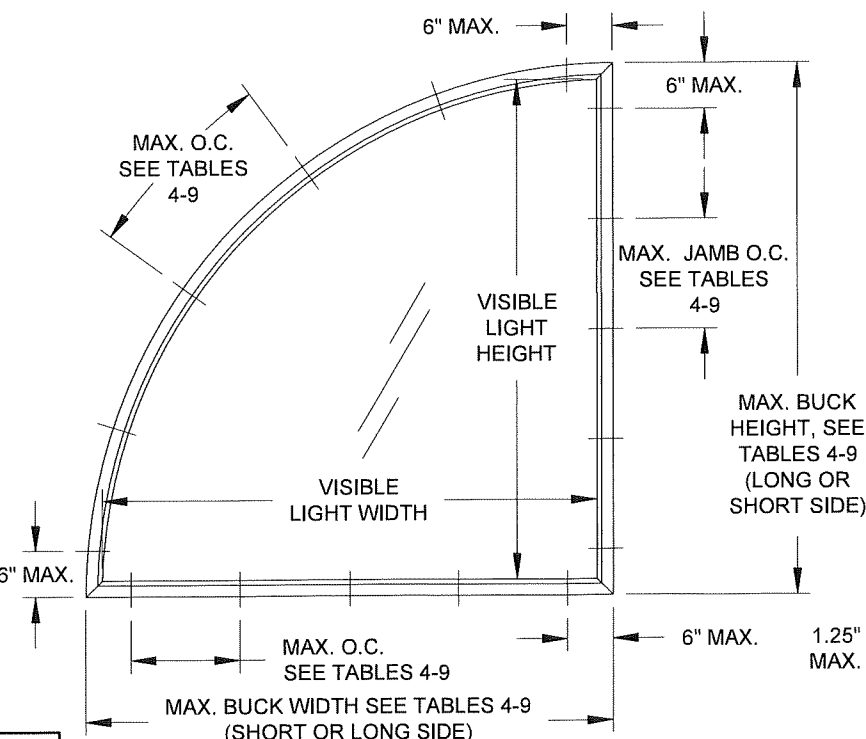

TYP. EQUAL-LEG/BOX & FLANGE FRAME (CURVED OR ANGLED CORNERS)

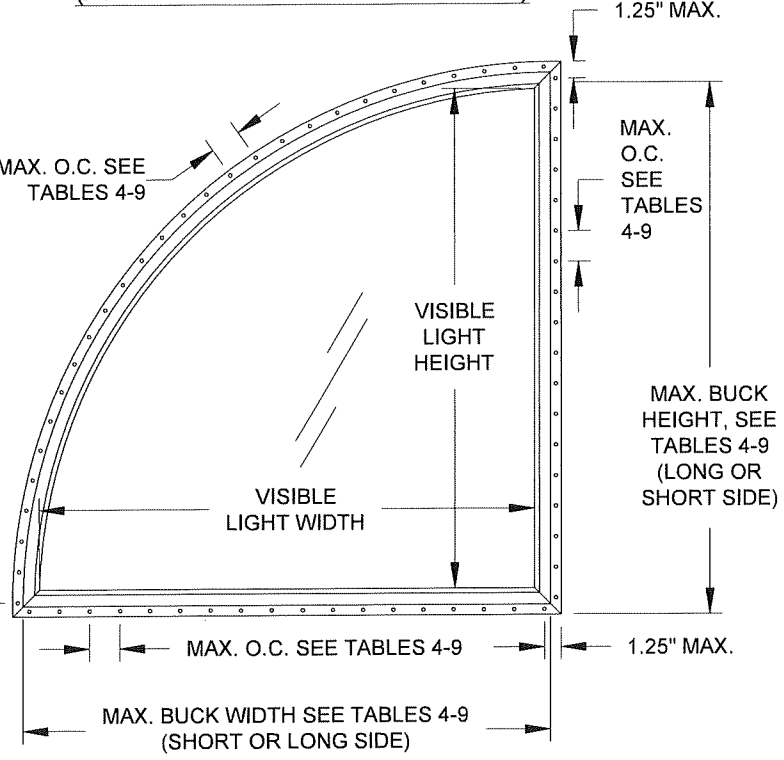

TYP. INTEGRAL FIN & J-CANNEL FRAME (CURVED OR ANGLED CORNERS) (ANCHORED THROUGH NAIL FIN)

GENERAL NOTES.....	1
ELEVATIONS.....	1
FRAME, GLASS & ANCHOR OPTIONS.....	2
INSTALLATION, FLANGE & EQUAL LEG.....	3
INSTALLATION, INTEGRAL FIN & J-CANNEL.....	4
FRAME ASSEMBLY TUBE.....	5-6
GLAZING DETAILS.....	7
DESIGN PRESSURES.....	8-10
BOM & ASSEMBLY.....	11

VISIBLE LIGHT FORMULAS
WIDTH: BUCK WIDTH - 6-3/4"
HEIGHT: BUCK HEIGHT - 6-3/4"

- CODES / STANDARDS USED:
- 2023 FLORIDA BUILDING CODE (FBC), 8TH EDITION
 - ASTM E1300-09
 - ANSI/AF&PA NDS-2018 FOR WOOD CONSTRUCTION
 - ALUMINUM DESIGN MANUAL, ADM-2020
 - AISI S100-16
 - AISC 360-16

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 25-0801.06
Expiration Date 9/24/2030
By *[Signature]*
Miami Dade Product Control

Revision:
ERASE 2020FBC, ADD NOTE 12-AM

PREPARED BY A. LYNN MILLER 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 (941) 480-1600	REGISTRATION #29296	Date	9/9/14	J. ROSOWSKI	Rev.	E						
		By										
		DWG	1 OF 11				MD-5440.0					
		Sheet										
PGT Custom Windows and Doors 3400 PRECISION DRIVE N. VENICE, FL 34275 (941) 480-1600	VINYL FIXED CASEMENT WINDOW NOA (NI)	ELEVATION & GENERAL NOTES	PW-5440	Series	Desc	Title						

ANTHONY LYNN MILLER
LICENSE
No. 58705
07/30/25
STATE OF
FLORIDA
PROFESSIONAL ENGINEER
A. LYNN MILLER, P.E.
P.E.# 58705

Glass Type	Description	Table #	Sheet #
1	7/8" I.G.: 1/8" A Exterior Cap + 5/8" Air Space + 1/8" A	4	8
2	7/8" I.G.: 1/8" T Exterior Cap + 5/8" Air Space + 1/8" T	5	8
3	7/8" I.G.: 3/16" A Exterior Cap + 1/2" Air Space + 3/16" A	6	9
4	7/8" I.G.: 3/16" T Exterior Cap + 1/2" Air Space + 3/16" T	7	9
5	1" I.G.: 1/4" A Exterior Cap + 1/2" Air Space + 1/4" A	8	10
6	1" I.G.: 1/4" T Exterior Cap + 1/2" Air Space + 1/4" T	9	10

"A" = ANNEALED
"T" = TEMPERED

TABLE 2: ANCHORS INSTALLED THROUGH FRAME

Group	Anchor	Substrate	Min. Edge Distance	Min. Embedment*
A	#10 SMS (steel, 18-8 S.S. or 410 S.S.)	Southern Pine (SG=0.55)	7/16"	1-3/8"
		Steel, A36*	3/8"	0.050"
		Steel Stud, A653 Gr. 33*	3/8"	0.0451" (18 Ga.)
		Aluminum, 6063-T5*	3/8"	0.050"
	3/16" steel Ultracon+	Southern Pine (SG=0.55)	7/16"	1-3/8"
		Concrete (min. 3 ksi)	1"	1-3/8"
B	#12 SMS (steel, 18-8 S.S. or 410 S.S.)	UngROUTED CMU, (ASTM C-90)	1"	1-1/4"
		Southern Pine (SG=0.55)	9/16"	1-3/8"
		Steel, A36*	3/8"	0.050"
		Steel Stud, A653 Gr. 33*	3/8"	0.0451" (18 Ga.)
	1/4" steel Ultracon+	Aluminum, 6063-T5*	3/8"	0.063"
		Southern Pine (SG=0.55)	1"	1-3/8"
C	1/4" steel Ultracon+	Concrete (min. 3 ksi)	1"	1-3/8"
		Southern Pine (SG=0.55)	1"	1-3/8"
	1/4" steel Creteflex	Southern Pine (SG=0.55)	1"	1-3/8"
		Southern Pine (SG=0.55)	1"	1-3/8"
D	1/4" steel Ultracon+	Southern Pine (SG=0.55)	1"	1-3/8"
		Concrete (min. 3 ksi)	1-3/16"	1-3/4"
	1/4" steel Creteflex	UngROUTED CMU, (ASTM C-90)	1"	1-1/4"
		Concrete (min. 3.35 ksi)	1"	1-3/4"
	1/4" steel Aggre-Gator	Concrete (min. 3 ksi)	2-1/2"	1-3/4"
		UngROUTED CMU, (ASTM C-90)	2-1/2"	1-1/4"

* MIN. OF 3 THREADS
BEYOND THE METAL
SUBSTRATE.

"UNGROUTED CMU"
VALUES MAY BE
USED FOR GROUTED
CMU APPLICATIONS.


ALL ANCHOR HEAD
TYPES ARE
ACCEPTABLE.

TABLE 3: ANCHORS INSTALLED THROUGH INTEGRAL FIN

Group	Anchor	Substrate	Min. Edge Distance	Min. Embedment*
E	2-1/2" x .131" Common Nail	Southern Pine (SG=.55)	3/8"	2-7/16"
F	2-1/2" Ring-shank Roofing Nail	Southern Pine (SG=.55)	3/8"	2-7/16"
		Southern Pine (SG=.55)	1/2"	1-3/8"
	#10 Trusshead SMS (steel, 18-8 S.S. or 410 S.S.)	Aluminum, 6063-T5*	3/8"	0.050"
		Steel Stud, Gr. 33*	3/8"	0.0451" (18 Ga.)
		Steel, A36*	3/8"	0.050"
		Southern Pine (SG=.55)	3/8"	0.050"
	#12 SMS (steel, 18-8 S.S. or 410 S.S.)	Aluminum, 6063-T5*	9/16"	1-3/8"
		Steel, A36*	3/8"	0.063"
		Steel Stud, Gr. 33*	3/8"	0.050"


* MIN. OF 3
THREADS
BEYOND
THE
METAL
SUBSTRATE.

WINDOW FRAMES MAY BE ANY OF THOSE SHOWN BELOW:

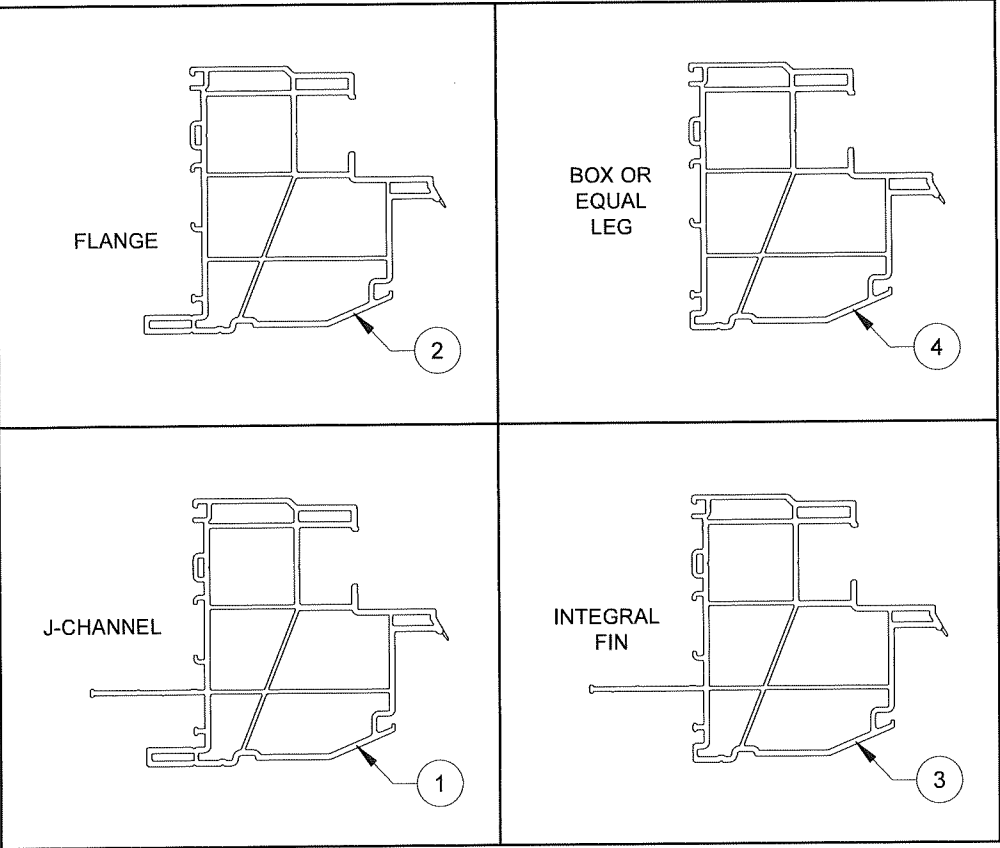

NOTE: SEE DETAILS AND DIMENSIONS ON SHEET 11

ALL ARCHITECTURAL WINDOW SHAPES QUALIFIED, COMMON EXAMPLES SHOWN. INSCRIBE THE SHAPE IN A BLOCK (SEE EXAMPLES BELOW), AND OBTAIN DESIGN PRESSURES FOR THAT BLOCK SIZE FROM DESIGN PRESSURE TABLES 4-9, SHEETS 8-10.

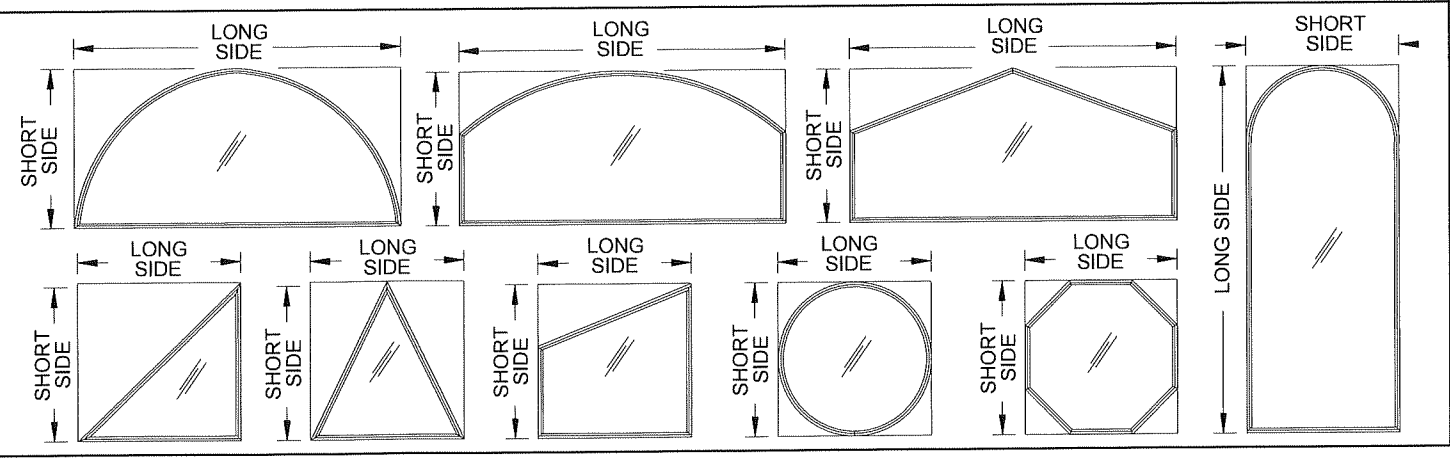


Material	Min. F _y	Min. F _u
Steel Screw	92 ksi	120 ksi
18-8 Screw	60 ksi	95 ksi
410 Screw	90 ksi	110 ksi
Elco/DeWalt Aggre-Gator®	57 ksi	96 ksi
3/16" DeWalt UltraCon+®	117 ksi	164 ksi
1/4" DeWalt UltraCon+®	148 ksi	164 ksi
410 SS Elco/Dewalt CreteFlex®	127.4 ksi	189.7 ksi
6063-T5 Aluminum	16 ksi	22 ksi
A36 Steel	36 ksi	58 ksi
Gr. 33 Steel Stud	33 ksi	45 ksi

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 25-0801.06
Expiration Date 9/24/2030
By [Signature]
Miami Dade Product Control

NO CHANGES THIS SHEET - AM


PREPARED BY A. LYNN MILLER 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 (941) 480-1600	REGISTRATION #29296	Date 9/9/14	By J. ROSOWSKI	Rev. E
PGT Custom Windows and Doors 3400 PRECISION DRIVE N. VENICE FL 34275 (941) 480-1600	VINYL FIXED CASEMENT WINDOW NOA (NI)	DWC No.	Sheet 2 OF 11	MD-5440.0
GLASS/ANCHORS/FRAME OPTIONS	PW-5440	Title	Series	Desc.

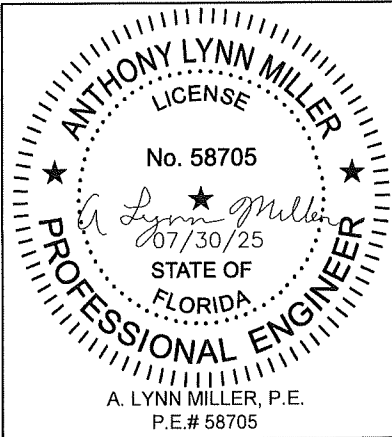

INSTALLATION DETAILS FOR FLANGE & EQUAL-LEG/BOX FRAMES

INSTALLATION
OPTION 1

ANCHORED THROUGH
FRAME INTO 2X WOOD
FRAME OR BUCKSTRIP.
SEE NOTE 2, THIS SHEET.

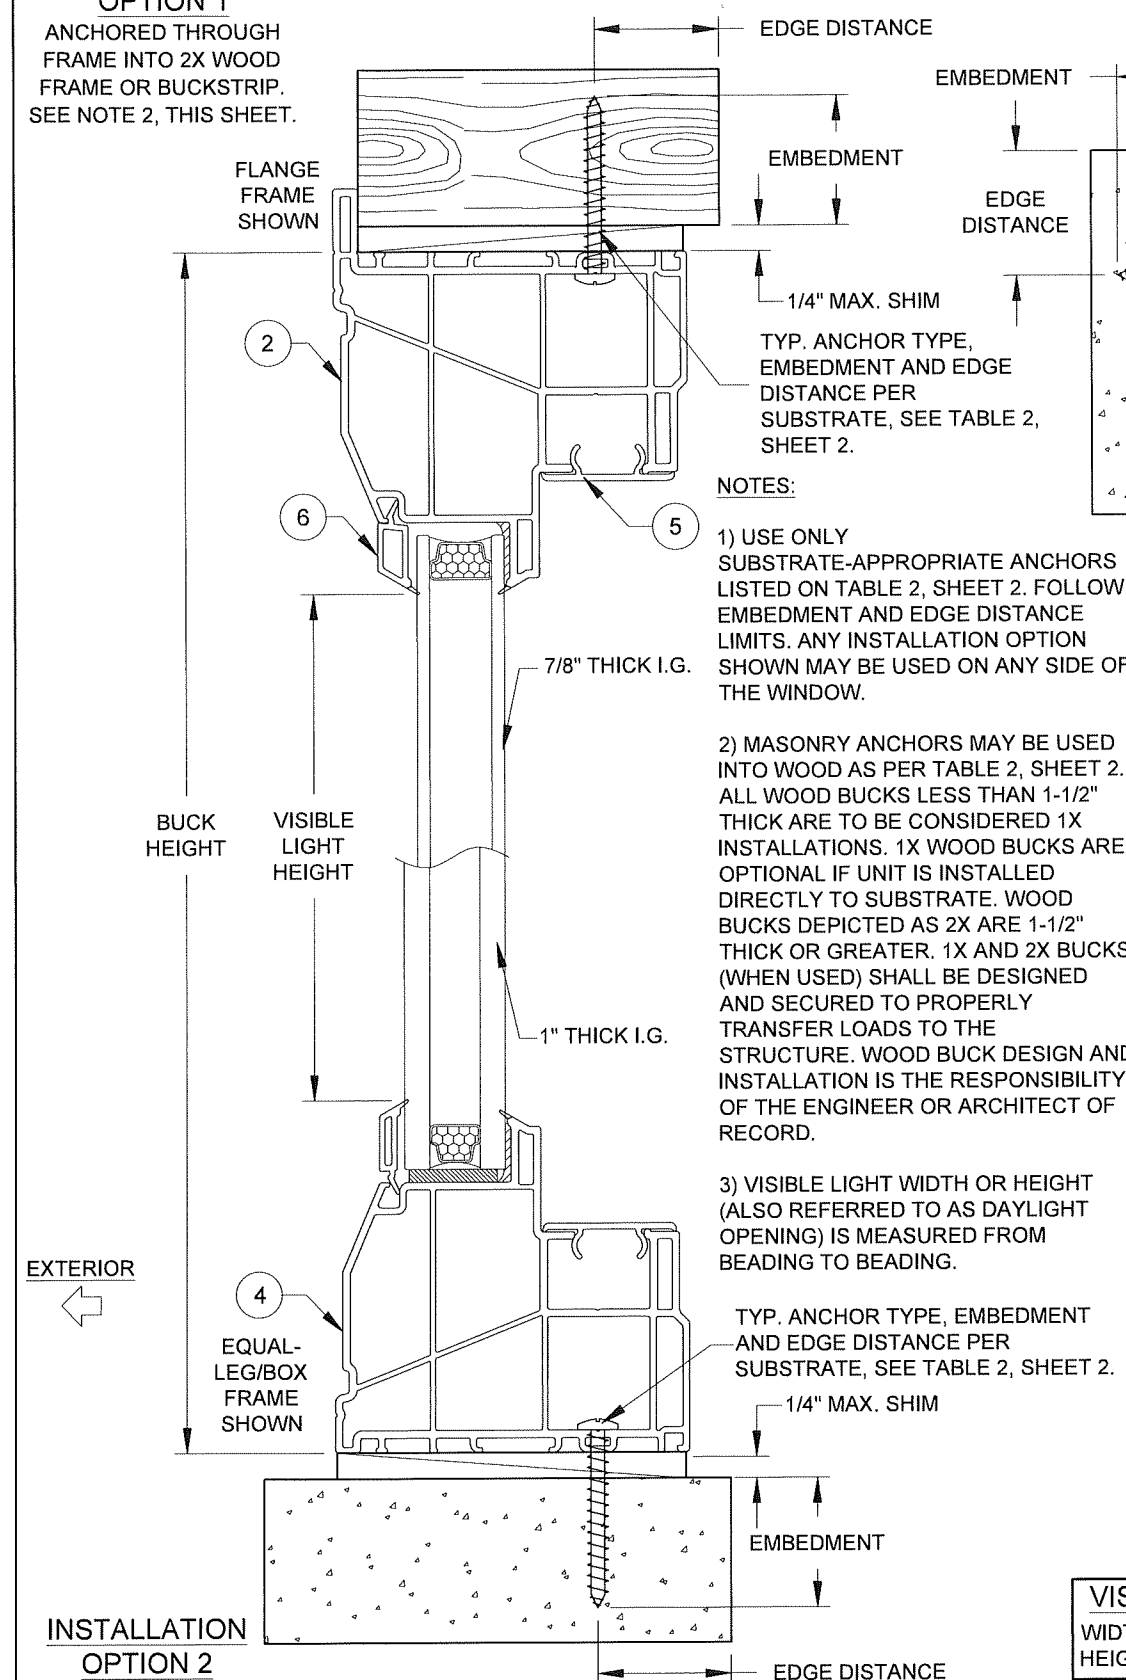


INSTALLATION
OPTION 2


ANCHORED THROUGH
FRAME DIRECTLY INTO
CONCRETE/CMU.

VERTICAL SECTION B-B


INSTALLATION OPTION 2
ANCHORED THROUGH FRAME
DIRECTLY INTO CONCRETE/CMU.

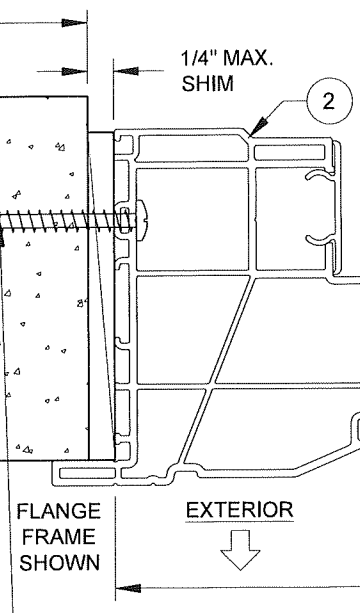

INSTALLATION OPTION 3
ANCHORED THROUGH FRAME AND 1X
BUCKSTRIP INTO CONCRETE/CMU.
SEE NOTE 2, THIS SHEET.

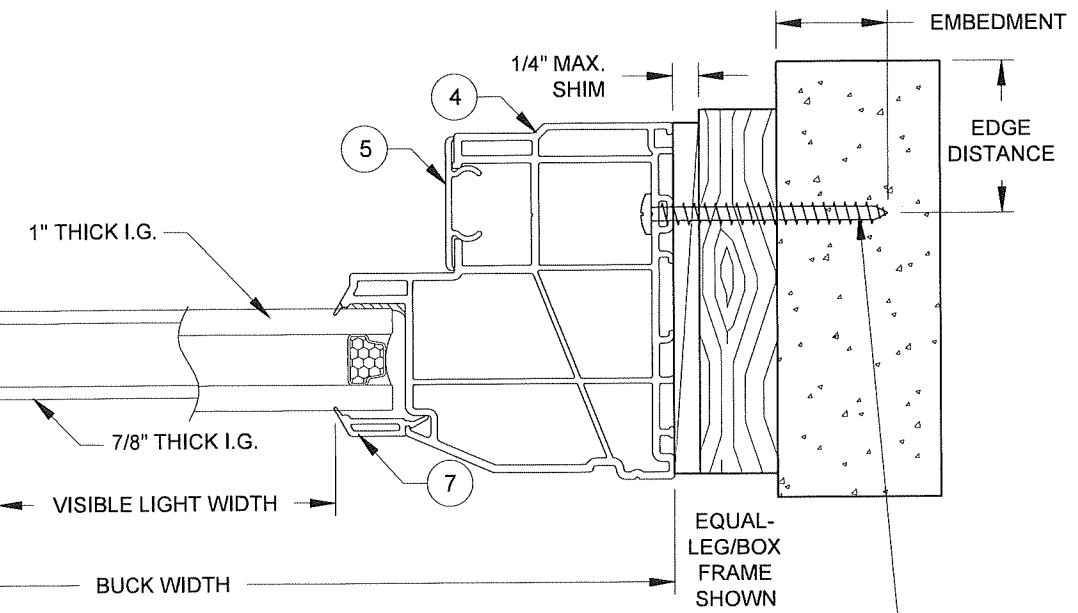

HORIZONTAL SECTION A-A

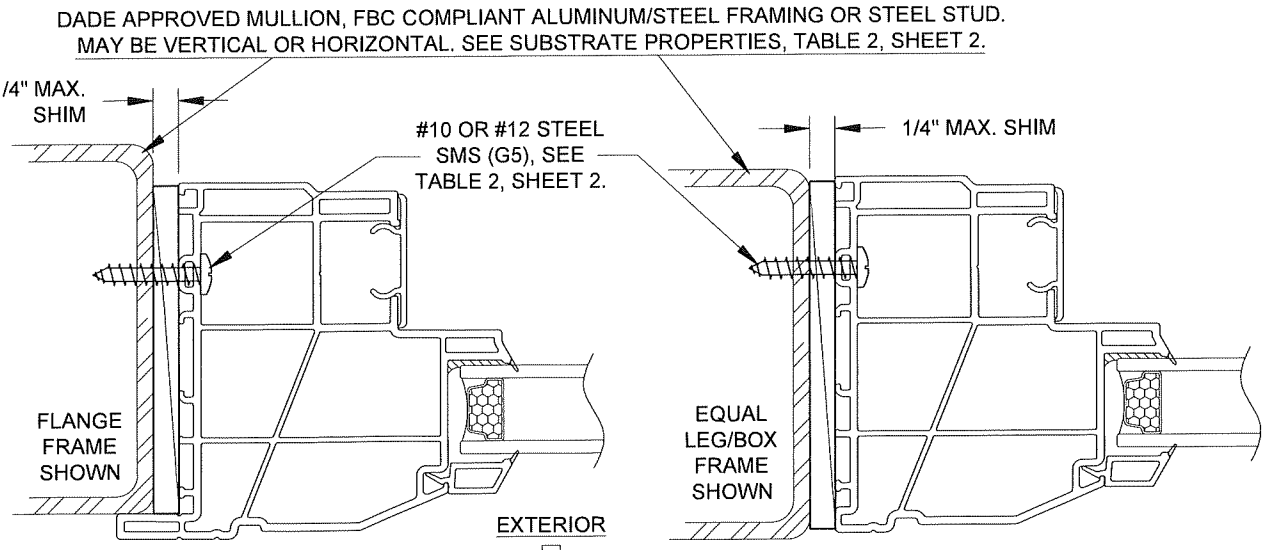

INSTALLATION
OPTION 4
ANCHORED THROUGH FRAME INTO METAL

INSTALLATION
OPTION 4
ANCHORED THROUGH FRAME INTO METAL


VISIBLE LIGHT FORMULAS
WIDTH: BUCK WIDTH - 6-3/4"
HEIGHT: BUCK HEIGHT - 6-3/4"

- NOTES:
- 1) USE ONLY SUBSTRATE-APPROPRIATE ANCHORS LISTED ON TABLE 2, SHEET 2. FOLLOW EMBEDMENT AND EDGE DISTANCE LIMITS. ANY INSTALLATION OPTION SHOWN MAY BE USED ON ANY SIDE OF THE WINDOW.
 - 2) MASONRY ANCHORS MAY BE USED INTO WOOD AS PER TABLE 2, SHEET 2. ALL WOOD BUCKS LESS THAN 1-1/2" THICK ARE TO BE CONSIDERED 1X INSTALLATIONS. 1X WOOD BUCKS ARE OPTIONAL IF UNIT IS INSTALLED DIRECTLY TO SUBSTRATE. WOOD BUCKS DEPICTED AS 2X ARE 1-1/2" THICK OR GREATER. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND SECURED TO PROPERLY TRANSFER LOADS TO THE STRUCTURE. WOOD BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD.
 - 3) VISIBLE LIGHT WIDTH OR HEIGHT (ALSO REFERRED TO AS DAYLIGHT OPENING) IS MEASURED FROM BEADING TO BEADING.

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 25-0801-06
Expiration Date 9/24/2030
By *[Signature]*
Miami Dade Product Control

Revision:
NO CHANGES THIS SHEET - AM


PREPARED BY A. LYNN MILLER 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 (941) 480-1600	REGISTRATION #29296	Date	9/9/14	Rev	E
		Drawn By	J. ROSOWSKI	No.	MD-5440.0
		Sheet	3 OF 11	DWG	
PGT Custom Windows and Doors 3400 PRECISION DRIVE N. VENICE FL 34275 (941) 480-1600	VINYL FIXED CASEMENT WINDOW NOA (NI)	FLANGE & EQUAL-LEG/BOX FRAMES			
		Series	PW-5440		

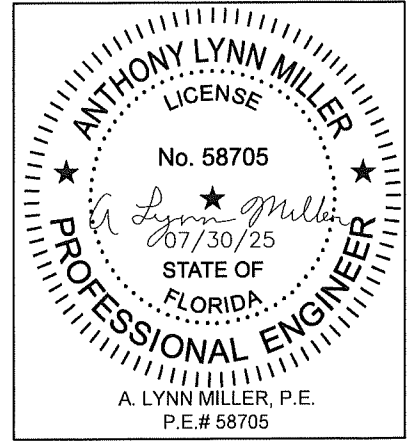

INSTALLATION DETAILS FOR INTEGRAL FIN & J-CHANNEL FRAMES

INSTALLATION OPTION 5

ANCHORED THROUGH INTEGRAL FIN INTO 2X WOOD FRAME OR BUCKSTRIP. SEE NOTE 2, THIS SHEET.

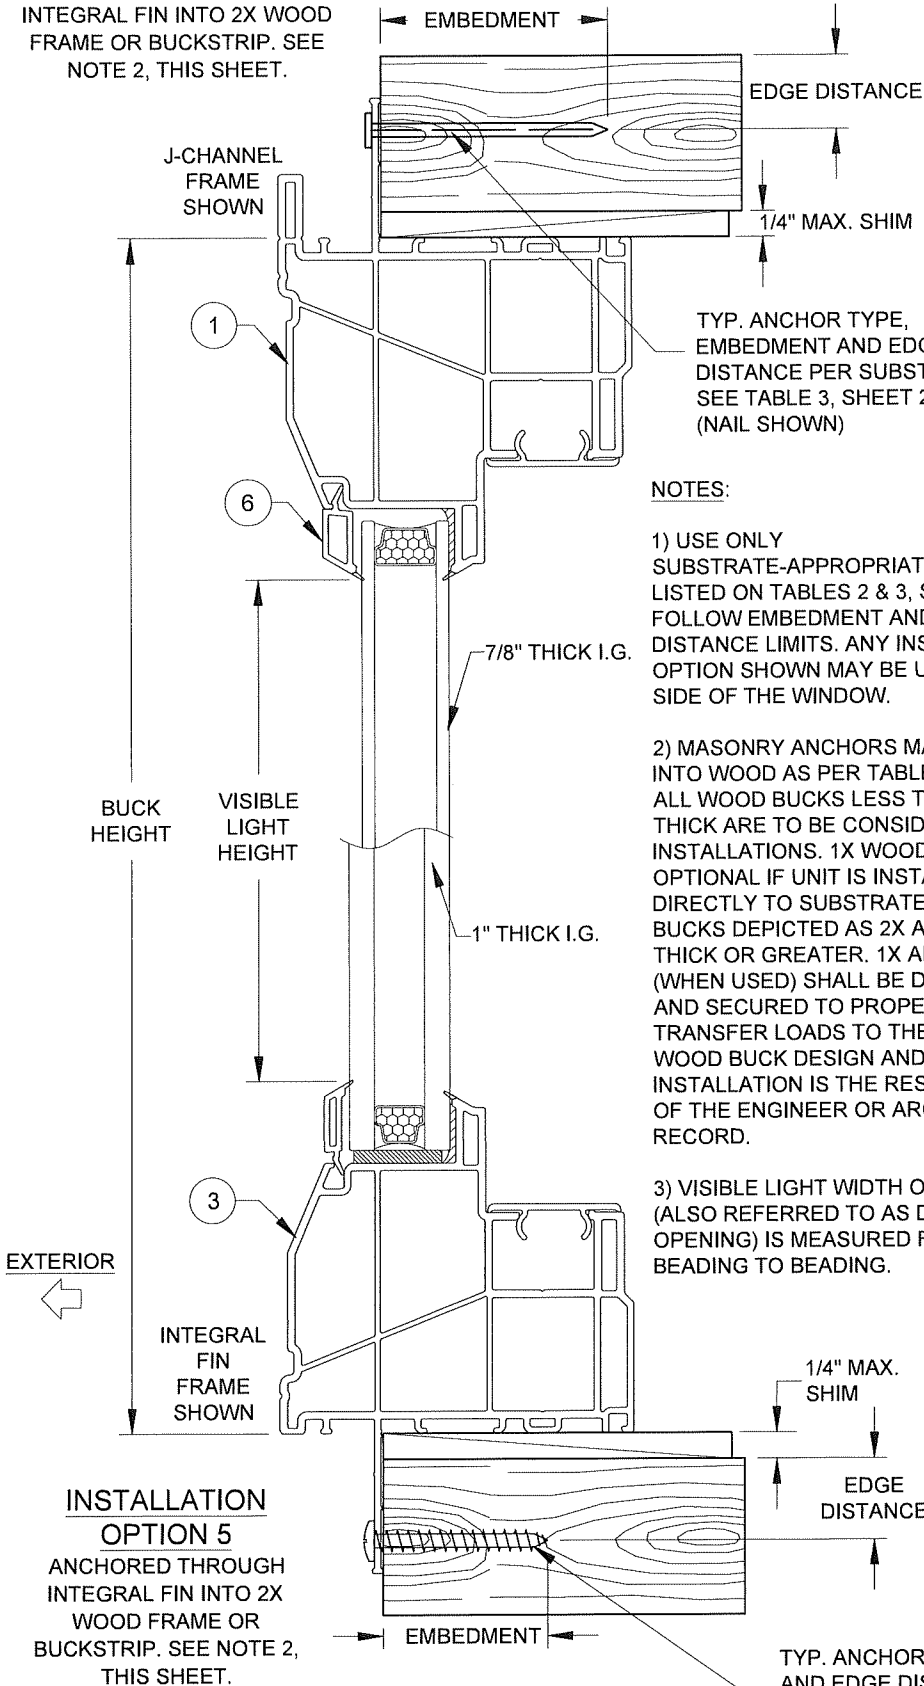

NOTES:

1) USE ONLY SUBSTRATE-APPROPRIATE ANCHORS LISTED ON TABLES 2 & 3, SHEET 2. FOLLOW EMBEDMENT AND EDGE DISTANCE LIMITS. ANY INSTALLATION OPTION SHOWN MAY BE USED ON ANY SIDE OF THE WINDOW.


2) MASONRY ANCHORS MAY BE USED INTO WOOD AS PER TABLE 2, SHEET 2. ALL WOOD BUCKS LESS THAN 1-1/2\"/>

3) VISIBLE LIGHT WIDTH OR HEIGHT (ALSO REFERRED TO AS DAYLIGHT OPENING) IS MEASURED FROM BEADING TO BEADING.

TYP. ANCHOR TYPE, EMBEDMENT AND EDGE DISTANCE PER SUBSTRATE, SEE TABLE 3, SHEET 2. (SCREW SHOWN)


INSTALLATION OPTION 6

ANCHORED THROUGH FRAME INTO 2X WOOD FRAME OR BUCKSTRIP. SEE NOTE 2, THIS SHEET. (MAY BE INSTALLED INTO CONCRETE, SIMILAR TO INSTALLATION OPTIONS 2 & 3)

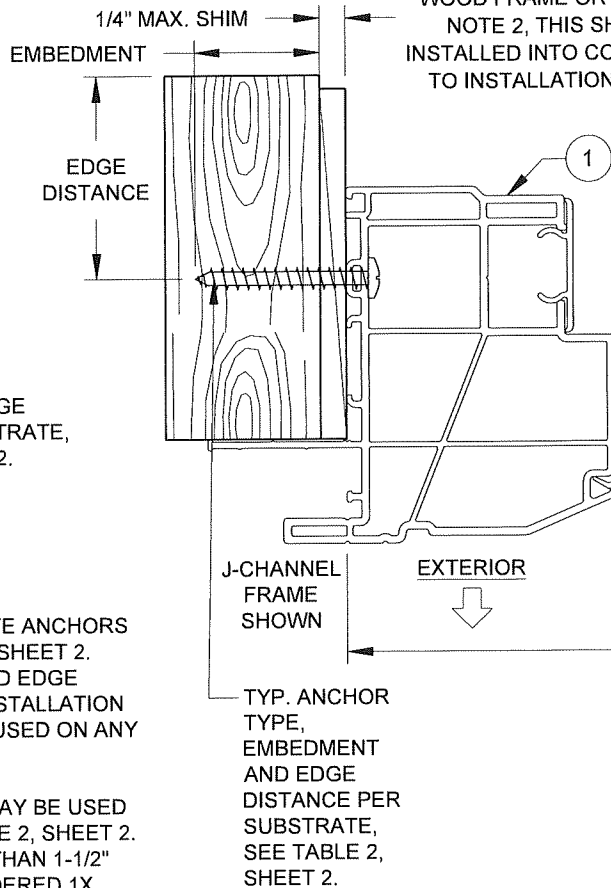


INSTALLATION OPTION 5

ANCHORED THROUGH INTEGRAL FIN INTO 2X WOOD FRAME OR BUCKSTRIP. SEE NOTE 2, THIS SHEET.

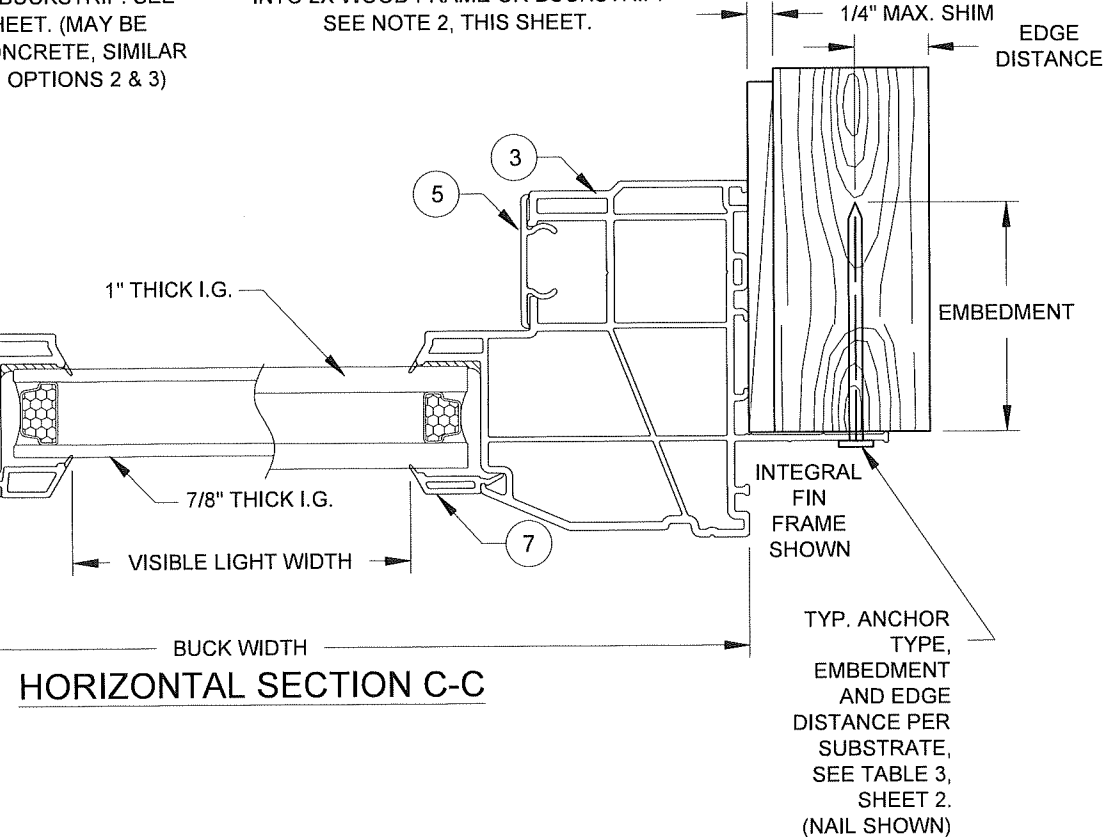

FBC COMPLIANT ALUMINUM/STEEL FRAMING OR STEEL STUD. MAY BE VERTICAL OR HORIZONTAL. SEE SUBSTRATE PROPERTIES, TABLES 2 & 3, SHEET 2.

ALSO FOR DADE-APPROVED MULLION

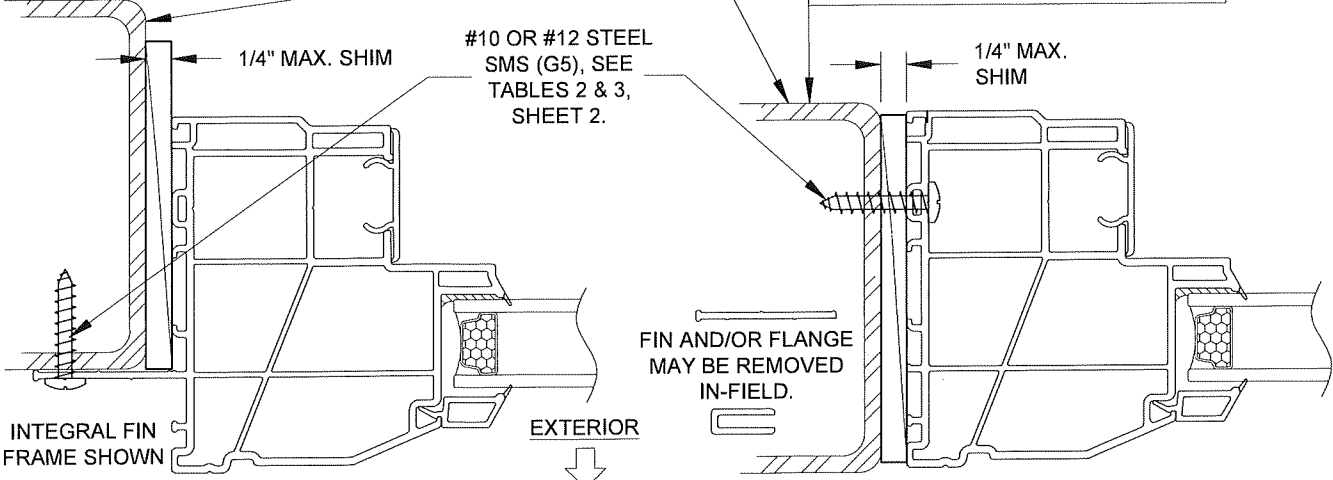

INSTALLATION OPTION 7
INSTALLATION THROUGH THE INTEGRAL FIN, INTO METAL, SEE TABLE 3, SHEET 2.

INSTALLATION OPTION 4 (FLANGE FRAME)
ALLOWED WITH MULLION INSTALLATION. SEE PAGE 3.

INSTALLATION OPTION 8
INSTALLATION THROUGH THE FRAME, INTO METAL, SEE TABLE 2, SHEET 2.

VISIBLE LIGHT FORMULAS

WIDTH: BUCK WIDTH - 6-3/4"
HEIGHT: BUCK HEIGHT - 6-3/4"

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 25-0801.06
Expiration Date 9/24/2030
By *Anthony Lynn Miller*
Miami Dade Product Control

NO CHANGES THIS SHEET - AM

PREPARED BY A. LYNN MILLER 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 (941) 480-1600	REGISTRATION #29296	Date 9/9/14	By J. ROSOWSKI	DWG No. MD-5440.0	Rev. E
PGT Custom Windows and Doors 3400 PRECISION DRIVE N. VENICE, FL 34275 (941) 480-1600	VINYL FIXED CASEMENT WINDOW NOA (NI)	ELEVATION & GENERAL NOTES	Sheet 4 OF 11	PW-5440	Series Title


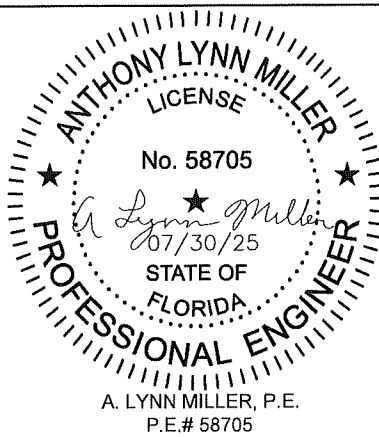


ILLUSTRATION OF FIXED CASEMENT-
TO-FIXED CASEMENT (OO)


(EQUAL LEG/BOX FRAME WITH IDENTICAL PRODUCTS COMBINED)

A) INDIVIDUAL
COMPONENTS:

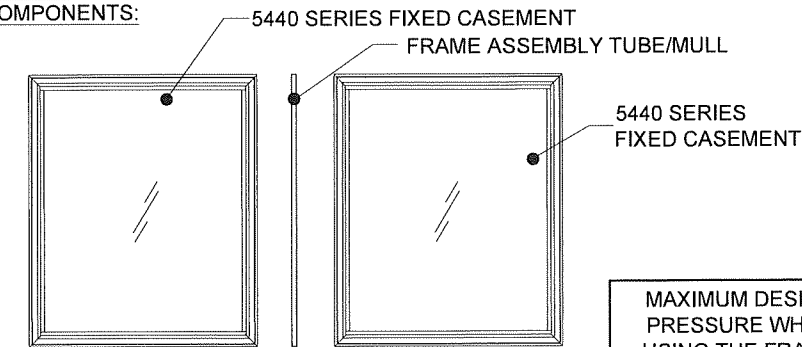

MAXIMUM DESIGN
PRESSURE WHEN
USING THE FRAME
ASSEMBLY TUBE/MULL,
SEE NOTE 2:
+/- 70.0 PSF

B) COMBINED
COMPONENTS:

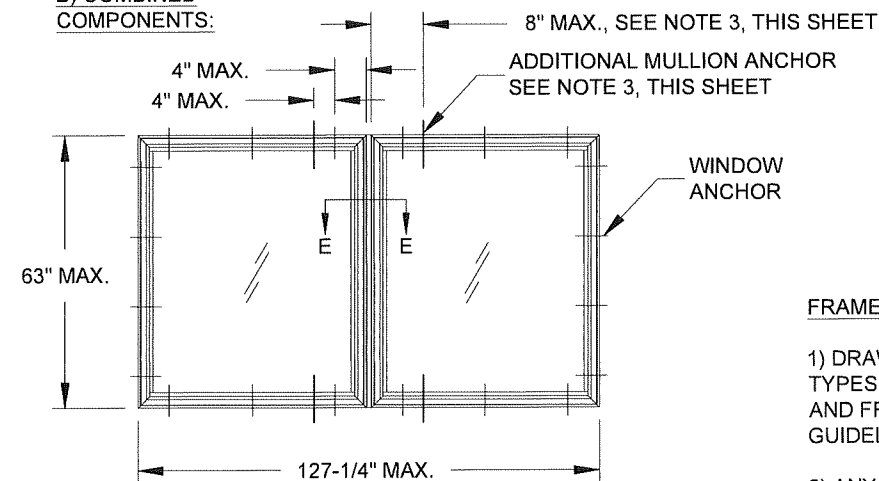

C) HORIZONTAL
SECTION E-E:

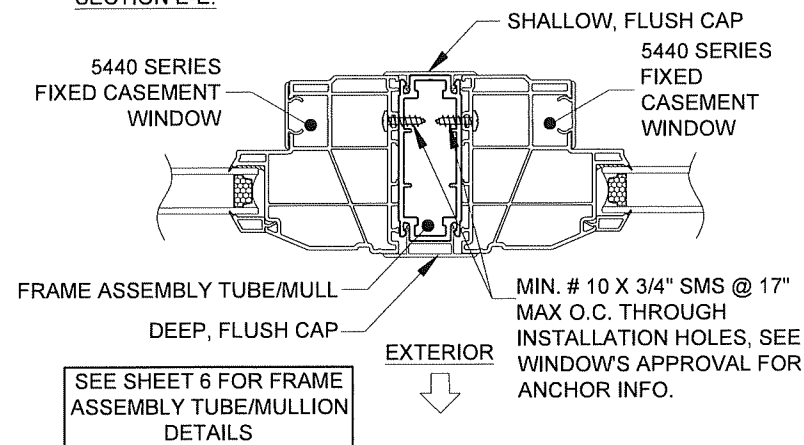


ILLUSTRATION OF AWNING-TO-CASEMENT-TO-FIXED CASEMENT (X/X/O)


(FLANGE FRAME WITH DIFFERENT 5440 SERIES PRODUCTS COMBINED)

A = 63" MAX. FOR FIXED CASEMENT

A = 40" MAX. FOR CASEMENT


A = 60" MAX. FOR AWNING

A) INDIVIDUAL
COMPONENTS:

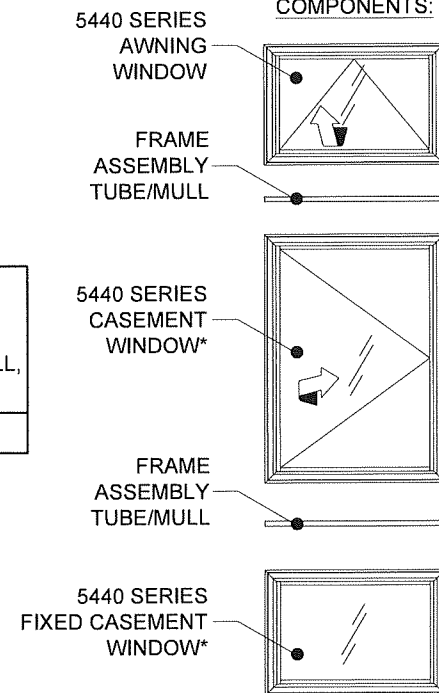

*UNDER SEPARATE APPROVAL

B) COMBINED
COMPONENTS:

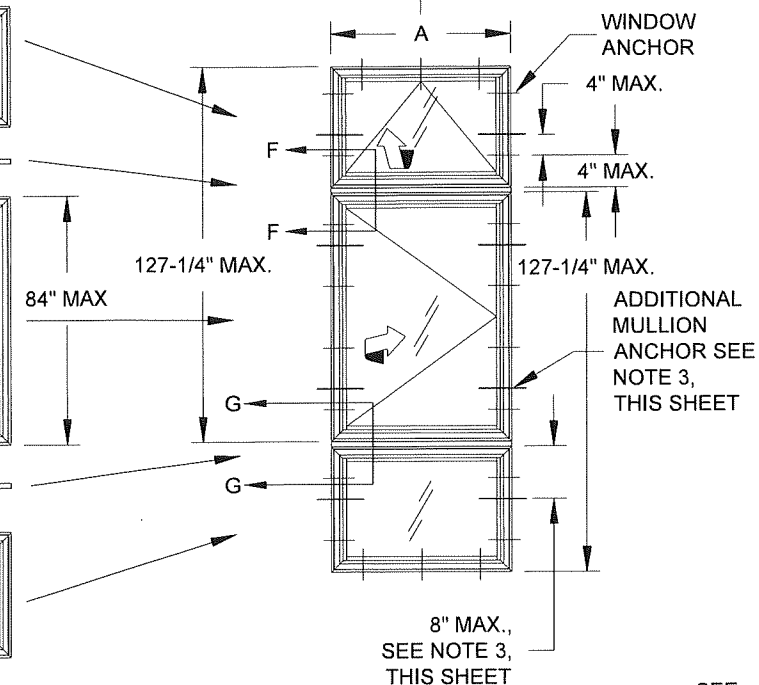


SEE
WINDOW'S
APPROVAL
FOR ANCHOR
INFO

VERTICAL
SECTION F-F

EXTERIOR

VERTICAL
SECTION G-G

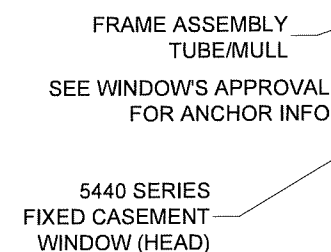

FRAME ASSEMBLY TUBE/MULL NOTES, ALSO SEE NEXT SHEET:

1) DRAWINGS SHOWN ON THIS SHEET ARE EXAMPLE CONFIGURATIONS FOR ALL FRAME TYPES. ADDITIONAL CONFIGURATIONS BASED ON WINDOW SIZE, TYPE, SHAPE, QUANTITY AND FRAME ASSEMBLY TUBE ORIENTATION ARE PERMISSIBLE FOLLOWING THE GUIDELINES OF THIS SHEET.

2) ANY 5440-SERIES CASEMENT (UNDER SEPARATE APPROVAL), AWNING (UNDER SEPARATE APPROVAL) OR FIXED CASEMENT WINDOW MAY BE ATTACHED TO THE FRAME ASSEMBLY TUBE/MULL, IN ANY COMBINATION TO THE SPAN AND WIDTH LIMIT SHOWN. FOR ALL WINDOWS IN THE ASSEMBLY, USE EACH WINDOW'S INDIVIDUAL APPROVAL FOR ANCHORAGE, SIZE AND DESIGN PRESSURE LIMITATIONS. THE LOWEST DESIGN PRESSURE OF THE WINDOWS OR FRAME ASSEMBLY TUBE/MULL APPLIES TO THE ENTIRE ASSEMBLY.

3) FOR ALL COMBINATION UNITS, ADDITIONAL INSTALLATION ANCHORS ARE REQUIRED TO BE INSTALLED THROUGH THE WINDOW FRAMES, AS SHOWN ON THIS SHEET, ON EACH SIDE OF THE FRAME ASSEMBLY TUBE/MULL WHEN USING FLANGE OR EQUAL-LEG/BOX FRAMES. FOR FIN OR J-CHANNEL FRAMES ADDITIONAL ANCHORS AND END CAPS ARE REQUIRED AS SHOWN ON SHEET 6.

4) FOR FLANGE OR EQUAL-LEG/BOX FRAMES, THE FRAME ASSEMBLY TUBE TO BE FASTENED TO WINDOW, AS SHOWN IN DETAILS, WITH MIN. #10 X 3/4" SHEET METAL SCREWS. USE THE SAME SPACING AND QUANTITY AS THE WINDOW INSTALLATION ANCHORS GIVEN IN THAT PRODUCT'S APPROVAL, UP TO 17" MAX. O.C., ADD ADDITIONAL ANCHORS AS NEEDED. THE FRAME ASSEMBLY TUBE IS NOT REQUIRED TO BE CLIPPED TO THE SUBSTRATE. ALL EXTERIOR JOINTS TO BE SEALED BY INSTALLER.

5) THE FRAME ASSEMBLY TUBE/MULL MAY NOT EXCEED 63" IN LENGTH OR BE USED IN TEE OR CROSS CONFIGURATIONS. TWO ADJACENT WINDOWS MAY NOT EXCEED A TOTAL OF 127-1/4" IN WIDTH OR HEIGHT, FROM WINDOW BUCK TO WINDOW BUCK, INCLUDING THE FRAME ASSEMBLY TUBE/MULL WIDTH.

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 25-0801.06
Expiration Date 9/24/2030
By *[Signature]*
Miami Dade Product Control

NO CHANGES THIS SHEET - AM

PREPARED BY A. LYNN MILLER 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 (941) 480-1600	REGISTRATION #29296	Date 9/9/14	By J. ROSOWSKI	DWC No.	Sheet 5 OF 11	Title PW-5440	Series Desc.	Rev.	E
PGT Custom Windows and Doors 3400 PRECISION DRIVE N. VENICE, FL 34275 (941) 480-1600	VINYL FIXED CASEMENT WINDOW NOA (NI)	FRAME ASSEMBLY TUBE DETAILS A	MD-5440.0	5440 SERIES AWNING WINDOW (SILL)	SHALLOW, FLUSH CAP FRAME ASSEMBLY TUBE/MULL	5440 SERIES CASEMENT WINDOW (HEAD)	5440 SERIES CASEMENT WINDOW (SILL)	5440 SERIES CASEMENT WINDOW (HEAD)	5440 SERIES CASEMENT WINDOW (SILL)



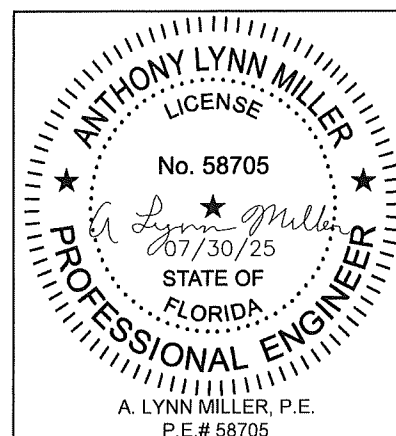


ILLUSTRATION OF END CAP USE WITH FIN AND J-CHANNEL FRAMES

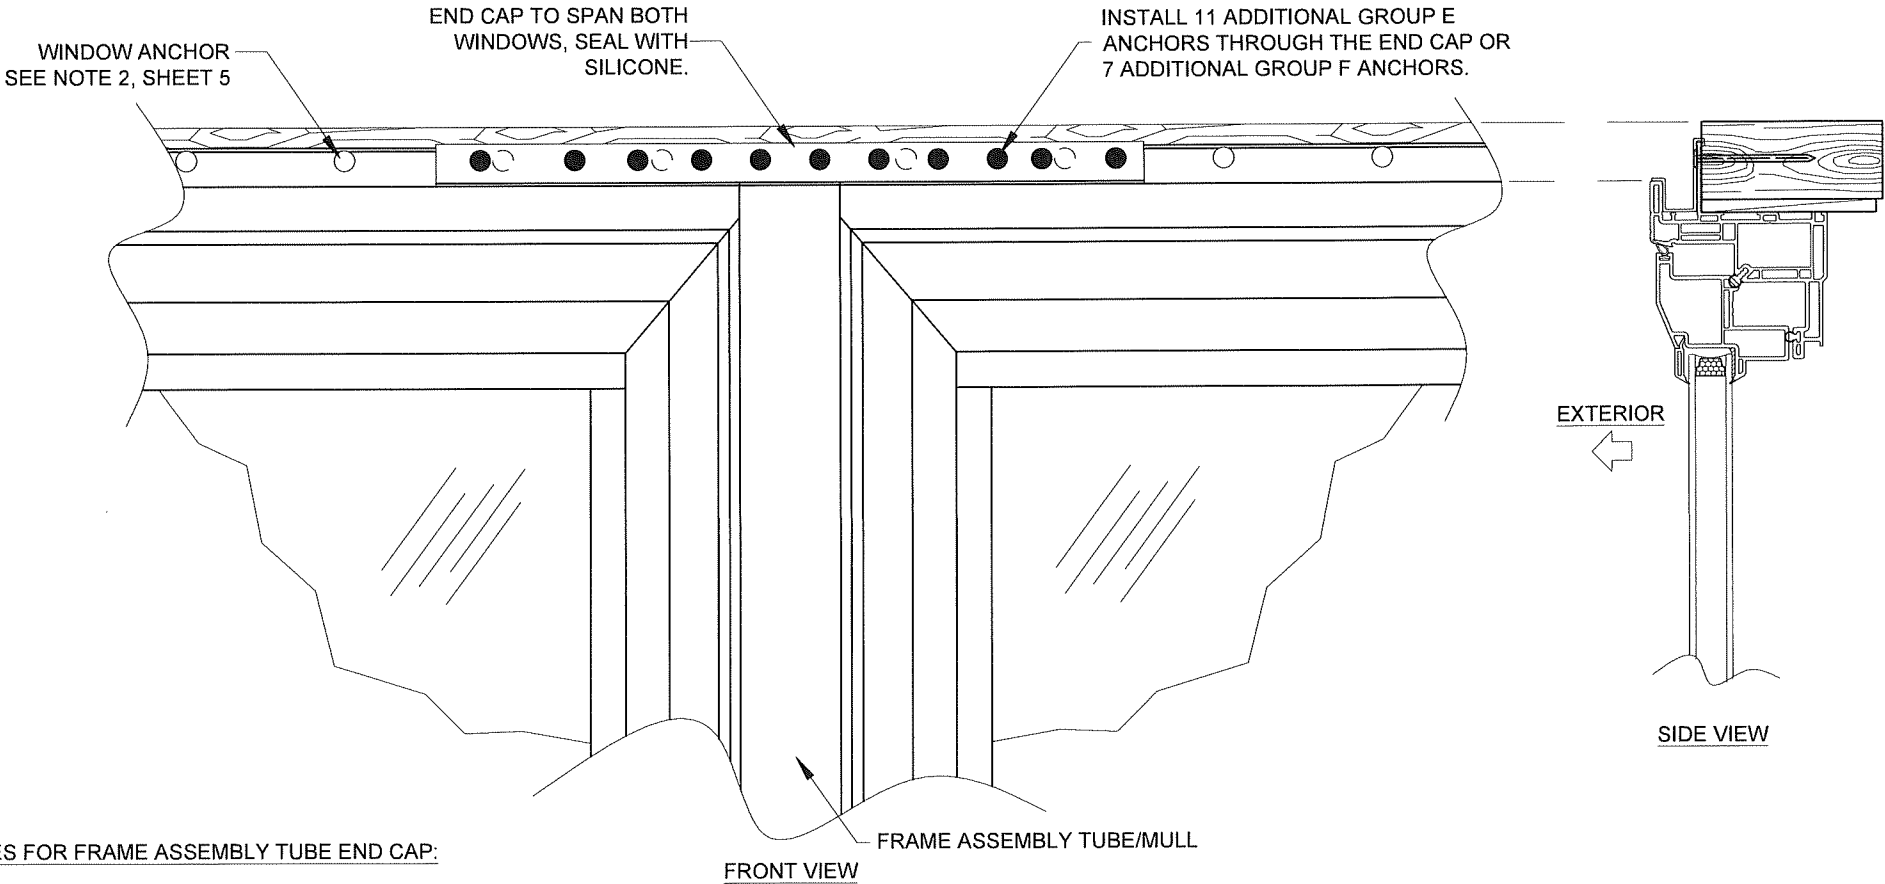


NOTES FOR FRAME ASSEMBLY TUBE END CAP:

- 1) APPLIES TO FIN OR J-CHANNEL FRAMES.
- 2) REQUIRED AT HEADER/SILL OR JAMBS TO SEAL THE END OF THE FRAME ASSEMBLY TUBE.
- 3) ALL WINDOW TYPES AND FRAME ASSEMBLY TUBE ORIENTATIONS APPLICABLE, SEE SHEET 5.
- 4) END CAP MAY REQUIRE IN-FIELD TRIMMING. STANDARD LENGTH IS 14".


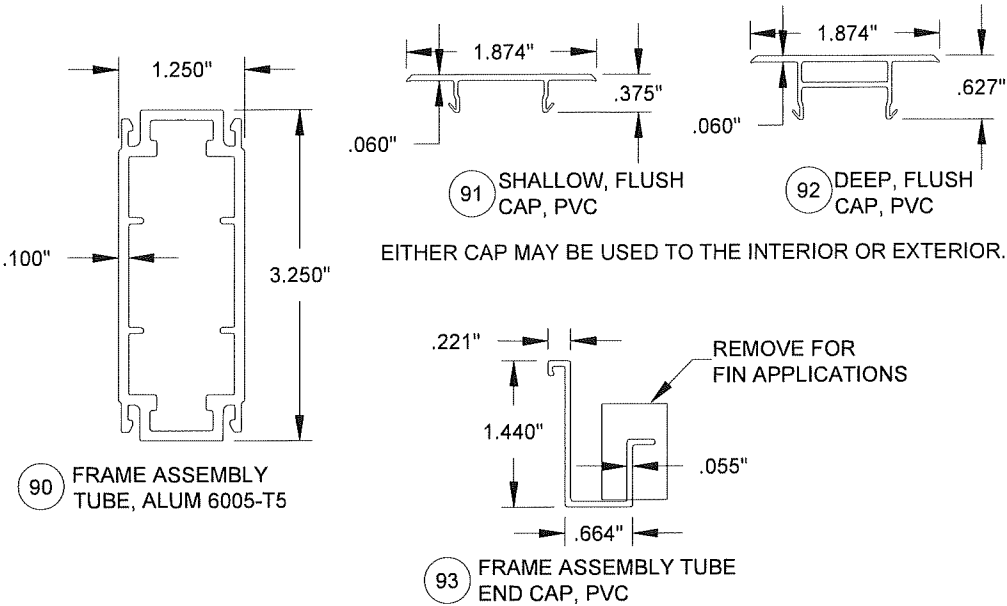


EXAMPLE CONFIGURATIONS WHEN USING THE FRAME ASSEMBLY TUBE/MULL. FOR TEES, CROSSES OR ASSEMBLIES WITH MORE THAN 4 UNITS USE CLIPPED, TUBE MULLION UNDER SEPARATE APPROVAL.

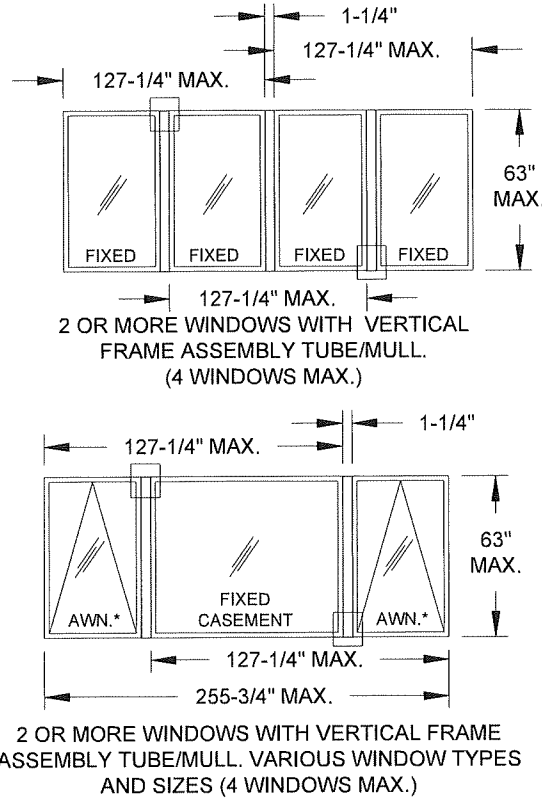

FRAME ASSEMBLY TUBE NOTE:

REFER TO SHEET 5 FOR THROUGH-FRAME ANCHORAGE AND THIS SHEET FOR NAIL FIN ANCHORAGE DETAILS TYP. AT ALL FRAME ASSEMBLY TUBE ENDS BOTH HORIZONTAL AND VERTICAL

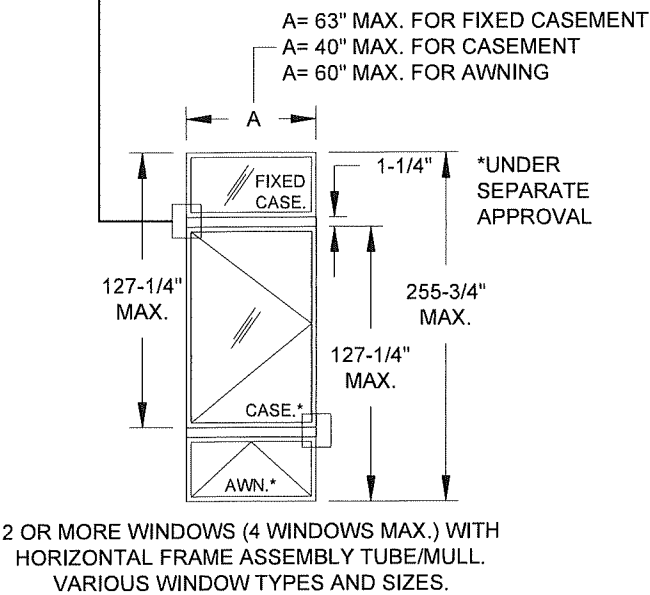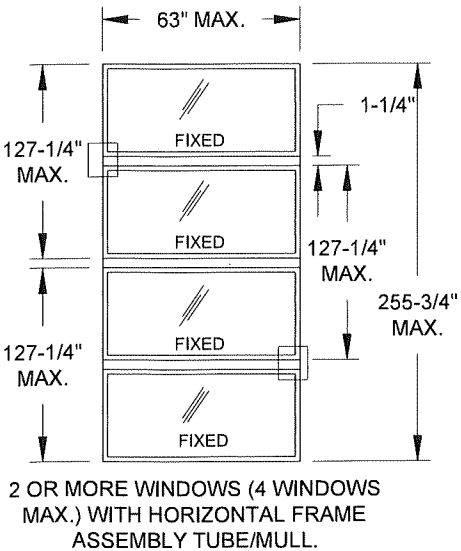



PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 25-089.06
Expiration Date 9/24/2030
By [Signature]
Miami Dade Product Control

NO CHANGES THIS SHEET - AM


Revision:

PREPARED BY A. LYNN MILLER 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 (941) 480-1600	REGISTRATION #29296	VINYL FIXED CASEMENT WINDOW NOA (NI)	9/9/14	J. ROSOWSKI	MD-5440.0	E
PGT Custom Windows and Doors 3400 PRECISION DRIVE N. VENICE, FL 34275 (941) 480-1600	FRAME ASSEMBLY TUBE DETAILS	PW-5440	6 OF 11	6 OF 11	6 OF 11	6 OF 11

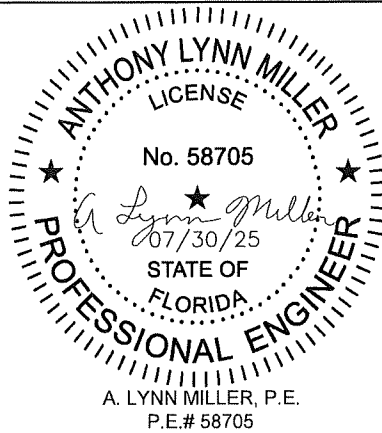


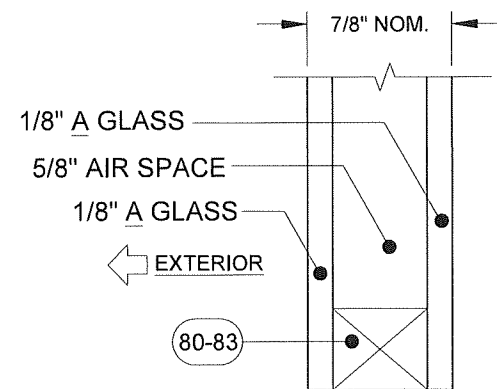


GLASS TYPE 1

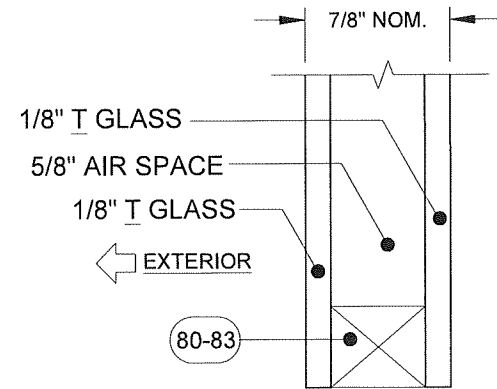


GLASS TYPE 2

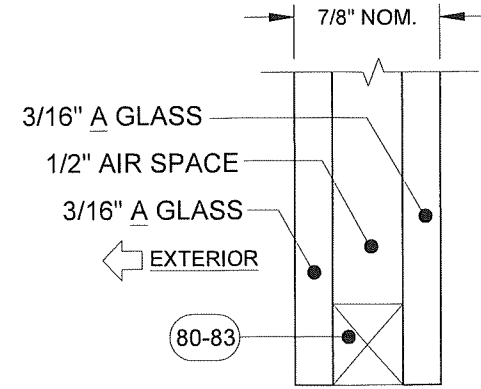


GLASS TYPE 3

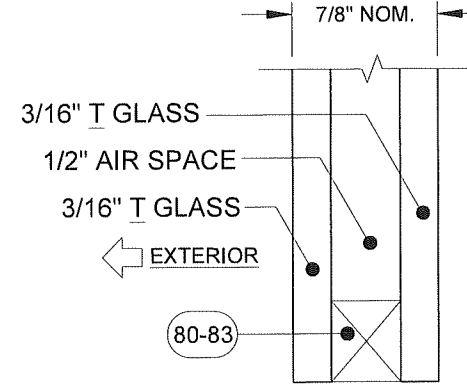


GLASS TYPE 4

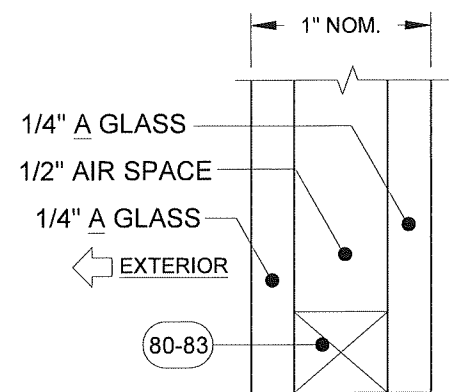

GLASS TYPE 5

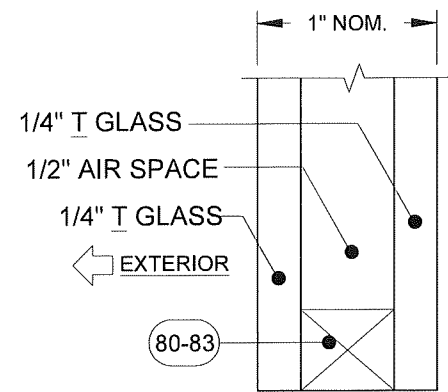

GLASS TYPE 6

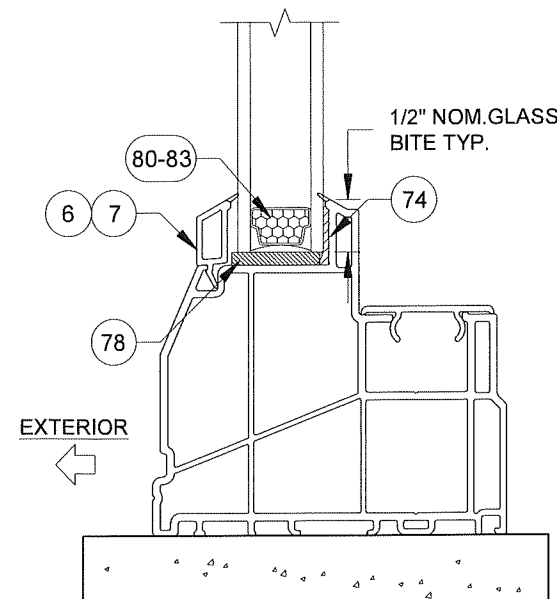

TYP. GLAZING DETAIL

GLAZING NOTES:
"A" = ANNEALED
"T" = TEMPERED

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 25-0801.06
Expiration Date 9/29/2030
By *[Signature]*
Miami Dade Product Control

Revision: NO CHANGES THIS SHEET - AM

PREPARED BY A. LYNN MILLER 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 (941) 480-1600	REGISTRATION #29296	Date	9/9/14	Rev.	E
		By	J. ROSOWSKI	No.	MD-5440.0
PGT Custom Windows and Doors 3400 PRECISION DRIVE N. VENICE, FL 34275 (941) 480-1600	VINYL FIXED CASEMENT WINDOW NOA (NI)	GLAZING DETAILS	Sheet	7 OF 11	DWG
			Series	PW-5440	

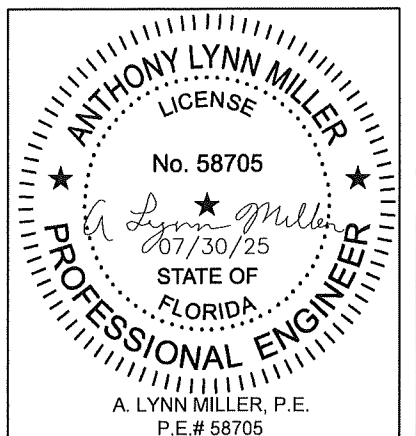


TABLE 4:

Window Design Pressure, (+/- psf)													Use this table for Glass Type:	1	
1/8" A Cap - Airspace - 1/8" A															
Window Dimensions		Long Side (in)													
		51.05	54	56	58	62	64	68	72	76	80	84	87		
Short Side (in)	18	+80/-93.7	+80/-92.6	+80/-91.9	+80/-91.3	+80/-90.3	+80/-89.8	+80/-88.9	+80/-88.2	+80/-87.5	+80/-86.9	+80/-86.4	+80/-86.1		
	20	+80/-86.4	+80/-85.2	+80/-84.5	+80/-83.5	+80/-80.6	+/-79.4	+/-77	+/-75.2	+/-74	+/-73.1	+/-72.2	+/-71.5		
	22	+80/-80.3	+/-75.2	+/-73.3	+/-71.5	+/-68.4	+/-67	+/-64.4	+/-62.5	+/-60.7	+/-59.2	+/-58	+/-57.1		
	24	+/-75.6	+/-71.3	+/-68.2	+/-65.7	+/-60.7	+/-58.5	+/-55.3	+/-53.1	+/-51.1	+/-49.7	+/-48.2	+/-47.3		
	26	+/-71.7	+/-70.2	+/-67	+/-63.5	+/-56.7	+/-54.7	+/-50.9	+/-47.7	+/-45.5	+/-43.7	+/-42.3	+/-41.2		
	28	+/-68.3	+/-67	+/-66.1	+/-63.5	+/-56.3	+/-54	+/-49.5	+/-45.5	+/-42.8	+/-40.3	+/-38	+/-37.1		
	30	+/-65.6	+/-64.1	+/-63.2	+/-62.4	+/-56.9	+/-54.4	+/-49.7	+/-45.4	+/-42.1	+/-38.9	+/-36.4			
	32	+/-63.2	+/-61.7	+/-60.8	+/-59.9	+/-57.8	+/-54.9	+/-50.2	+/-45.9	+/-42.5	+/-38.9				
	34	+/-61.2	+/-59.6	+/-58.6	+/-57.8	+/-56.3	+/-55.1	+/-50.8	+/-46.4	+/-43.2					
	36	+/-59.6	+/-57.9	+/-56.8	+/-55.9	+/-54.4	+/-53.7	+/-50.8	+/-46.6						
	38	+/-58.2	+/-56.4	+/-55.3	+/-54.3	+/-52.7	+/-52	+/-49.5							
	40	+/-57.1	+/-55.1	+/-54	+/-53	+/-51.3	+/-50.5	MAX. O.C. SPACING IF ANCHORING THROUGH THE FRAME PER SHEETS 3 & 4						MAX. O.C. SPACING IF ANCHORING THROUGH THE INTEGRAL FIN PER SHEET 4	
	42	+/-56.2	+/-54.1	+/-52.9	+/-51.8	+/-50									
	44	+/-55.5	+/-53.3	+/-52	+/-50.8			APPLIES TO A, B, C OR D ANCHORS (SEE TABLE 2)						APPLIES TO E OR F ANCHORS (SEE TABLE 3)	
	46	+/-54.9	+/-52.6	+/-51.1											
	48	+/-53.5	+/-50.8					15"						4"	
51.05	+/-50.6														

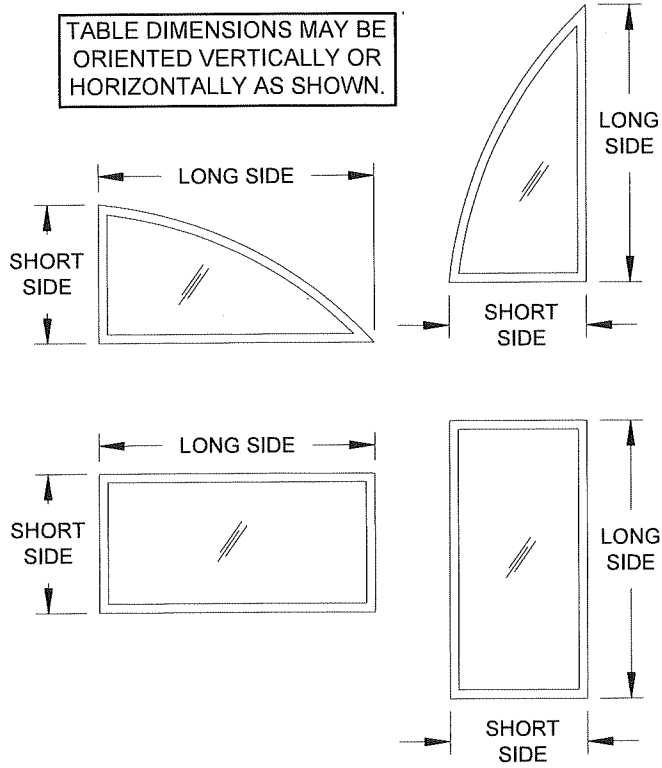


TABLE 5:

Window Design Pressure, (+/- psf)													Use this table for Glass Type:	2
1/8" T Cap - Airspace - 1/8" T														
Window Dimensions		Long Side (in)												
		60.926	64	66	68	70	74	77	80	84	87	92	97	99
Short Side (in)	32	+80/-98.2	+80/-96.6	+80/-95.6	+80/-94.7	+80/-93.9	+80/-92.4	+80/-91.4	+80/-90.5	+80/-89.5	+80/-88.7	+80/-87.7	+80/-86.7	+80/-86.4
	34	+80/-94.5	+80/-92.8	+80/-91.8	+80/-90.9	+80/-90	+80/-88.5	+80/-87.5	+80/-86.6	+80/-85.5	+80/-84.7	+80/-83.6	+80/-82.6	+80/-82.3
	36	+80/-91.4	+80/-89.6	+80/-88.5	+80/-87.6	+80/-86.7	+80/-85.1	+80/-84	+80/-83.1	+80/-81.9	+80/-81.2	+/-80	+/-79	+/-78.7
	38	+80/-88.6	+80/-86.7	+80/-85.6	+80/-84.6	+80/-83.7	+80/-82.1	+80/-81	+/-80	+/-78.8	+/-78	+/-76.9	+/-75.8	
	40	+80/-86.3	+80/-84.3	+80/-83.1	+80/-82.1	+80/-81.1	+/-79.4	+/-78.3	+/-77.3	+/-76	+/-75.2	+/-74		
	42	+80/-84.2	+80/-82.1	+80/-80.9	+/-79.8	+/-78.8	+/-77	+/-75.9	+/-74.8	+/-73.6	+/-72.7			
	44	+80/-82.4	+80/-80.3	+/-79	+/-77.9	+/-76.8	+/-75	+/-73.7	+/-72.7	+/-71.4				
	46	+80/-80.9	+/-78.6	+/-77.3	+/-76.1	+/-75	+/-73.1	+/-71.8	+/-70.7					
	48	+/-79.7	+/-77.3	+/-75.9	+/-74.6	+/-73.5	+/-71.5	+/-70.1						
	50	+/-78.6	+/-76.1	+/-74.6	+/-73.3	+/-72.1	+/-70		MAX. O.C. SPACING IF ANCHORING THROUGH THE FRAME PER SHEETS 3 & 4				MAX. O.C. SPACING IF ANCHORING THROUGH THE INTEGRAL FIN PER SHEET 4	
	52	+/-77.7	+/-75.1	+/-73.5	+/-72.2	+/-70.9								
	54	+/-77.1	+/-74.2	+/-72.6	+/-71.2				APPLIES TO B, C OR D ANCHORS (SEE TABLE 2)				APPLIES TO F ANCHORS (SEE TABLE 3)	
	56	+/-76.6	+/-73.6	+/-71.9										
	58	+/-76.3	+/-73.1						15.5"				4"	
60.926	+/-76.1													

- NOTES:
- 1) BUCK DIMENSIONS SHOWN.
- 2) FOR SIZES NOT SHOWN, ROUND UP TO THE NEXT AVAILABLE SHORT OR LONG DIMENSION.
- 3) FOR ARCHITECTURAL WINDOWS (SEE SHEET 2), FIND THE SMALLEST SQUARE WINDOW SIZE IN THE TABLE(S) ABOVE WHICH THE ARCHITECTURAL WINDOW WILL COMPLETELY FIT WITHIN.

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 25-P801-06
Expiration Date 9/29/2030
By Ishag L. Chah
Miami Dade Product Control

Revision:

NO CHANGES THIS SHEET - AM

PREPARED BY A. LYNN MILLER
1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275
(941) 480-1600

REGISTRATION #29296

VINYL FIXED CASEMENT WINDOW NOA (NI)

DESIGN PRESSURE TABLES A

DATE 9/9/14

BY J. ROSOWSKI

MD-5440.0

8 OF 11

PW-5440

Sheet

Series


PCT
Custom Windows and Doors
3400 PRECISION DRIVE
N. VENICE, FL 34275
(941) 480-1600

ANTHONY LYNN MILLER
LICENSE
No. 58705
07/30/25
STATE OF
FLORIDA
PROFESSIONAL ENGINEER
A. LYNN MILLER, P.E.
P.E.# 58705

TABLE 6:

Window Design Pressure, (+/- psf)													Use this table for Glass Type:	3
3/16" A Cap - Airspace - 3/16" A														
Window Dimensions		Long Side (in)												
		69.65	71	73	75	78	80	85	86	89	92	96	99	
Short Side (in)	32	+/-76.9	+/-76.4	+/-74.3	+/-72.5	+/-70.6	+/-69.3	+/-66.2	+/-65.7	+/-64.1	+/-62.6	+/-60.8	+/-59.8	
	34	+/-73.7	+/-73.3	+/-71.3	+/-69.7	+/-66.8	+/-65	+/-61	+/-60.3	+/-58.1	+/-56.3	+/-54.7	+/-53.8	
	36	+/-71	+/-70.5	+/-69.8	+/-67.9	+/-64.4	+/-62.5	+/-57.2	+/-56.3	+/-54.7	+/-52.9	+/-50.9	+/-49.7	
	38	+/-68.6	+/-68.1	+/-67.4	+/-66.8	+/-63.5	+/-61	+/-55.6	+/-54.9	+/-52.7	+/-50.6	+/-48.2	+/-46.4	
	40	+/-66.4	+/-65.9	+/-65.2	+/-64.6	+/-63.2	+/-60.7	+/-55.1	+/-54.2	+/-52	+/-49.7	+/-46.4	+/-45.2	
	42	+/-64.6	+/-64	+/-63.3	+/-62.6	+/-61.7	+/-60.5	+/-55.1	+/-54.2	+/-51.7	+/-49.1	+/-46.3	+/-44.5	
	44	+/-62.9	+/-62.4	+/-61.6	+/-60.9	+/-60	+/-59.4	+/-55.1	+/-54.2	+/-51.8	+/-49.1	+/-46.1	+/-44.5	
	46	+/-61.5	+/-60.9	+/-60.1	+/-59.4	+/-58.4	+/-57.8	+/-55.1	+/-54.2	+/-51.8	+/-49.3	+/-46.3	+/-44.5	
	48	+/-60.2	+/-59.6	+/-58.8	+/-58	+/-57	+/-56.4	+/-55	+/-54.2	+/-51.8	+/-49.5	+/-46.4	+/-44.6	
	50	+/-59.1	+/-58.5	+/-57.6	+/-56.8	+/-55.8	+/-55.1	+/-53.7	+/-53.4	+/-51.8	+/-49.5	+/-46.6		
	52	+/-58.1	+/-57.5	+/-56.6	+/-55.8	+/-54.6	+/-54	+/-52.5	+/-52.2	+/-51.5	+/-49.3			
	54	+/-57.3	+/-56.6	+/-55.7	+/-54.8	+/-53.7	+/-53	+/-51.4	+/-51.1	+/-50.4				
	56	+/-56.6	+/-55.9	+/-54.9	+/-54	+/-52.8	+/-52	+/-50.4	+/-50.2					
	57	+/-56.3	+/-55.5	+/-54.5	+/-53.6	+/-52.4	+/-51.6	+/-50						
	60	+/-55.5	+/-54.7	+/-53.6	+/-52.6	+/-51.3	+/-50.5							
	62	+/-55.1	+/-54.2	+/-53.1	+/-52.1	+/-50.7								
	64	+/-54.8	+/-53.9	+/-52.7	+/-51.6									
	66	+/-54.5	+/-53.6	+/-52.4										
	68	+/-53.6	+/-53.1											
	69.65	+/-52.6												
							MAX. O.C. SPACING IF ANCHORING THROUGH THE FRAME PER SHEETS 3 & 4			MAX. O.C. SPACING IF ANCHORING THROUGH THE INTEGRAL FIN PER SHEET 4				
							APPLIES TO A, B, C OR D ANCHORS (SEE TABLE 2)			APPLIES TO E OR F ANCHORS (SEE TABLE 3)				
							15"			3" FOR E ANCHORS, 4" FOR F ANCHORS				

TABLE DIMENSIONS MAY BE
ORIENTED VERTICALLY OR
HORIZONTALLY AS SHOWN.

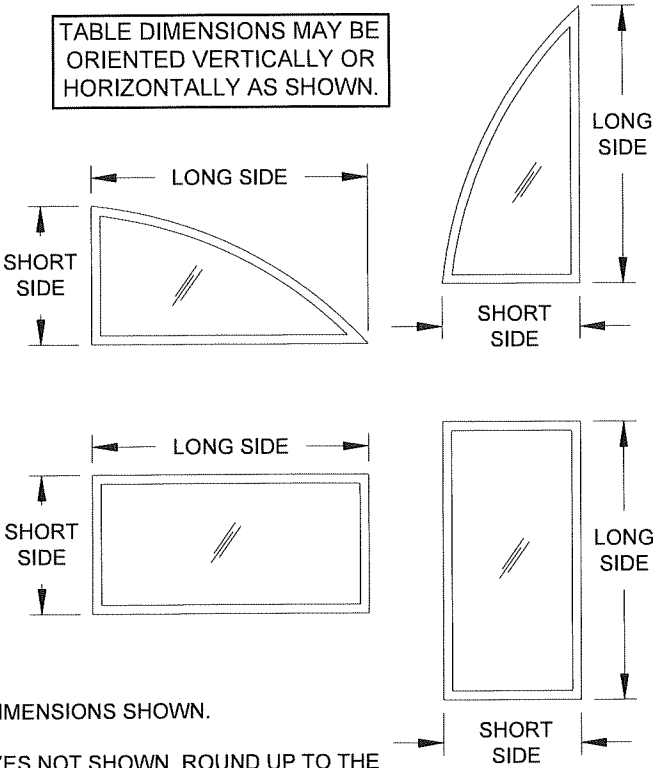

- NOTES:
1) BUCK DIMENSIONS SHOWN.
2) FOR SIZES NOT SHOWN, ROUND UP TO THE NEXT AVAILABLE SHORT OR LONG DIMENSION.
3) FOR ARCHITECTURAL WINDOWS (SEE SHEET 2), FIND THE SMALLEST SQUARE WINDOW SIZE IN THE TABLE(S) ABOVE WHICH THE ARCHITECTURAL WINDOW WILL COMPLETELY FIT WITHIN.

TABLE 7:

Window Design Pressure, (+/- psf)																			Use this table for Glass Type:	4
3/16" T Cap - Airspace - 3/16" T																				
Window Dimensions		Long Side (in)																		
		81.52	83	85	87	89	92	94	97	99	103	107	110	113	118	122	126	132	138	144
Short Side (in)	46	+80/-94	+80/-93.3	+80/-92.5	+80/-91.7	+80/-91	+80/-89.9	+80/-89.3	+80/-88.4	+80/-87.9	+80/-86.8	+80/-85.9	+80/-85.3	+80/-84.7	+80/-83.8	+80/-83.1	+80/-82.5	+80/-81.7	+80/-80.9	+80/-80.3
	48	+80/-91.6	+80/-90.9	+80/-90.1	+80/-89.3	+80/-88.5	+80/-87.5	+80/-86.8	+80/-85.9	+80/-85.3	+80/-84.3	+80/-83.3	+80/-82.7	+80/-82.1	+80/-81.2	+80/-80.5	+/-79.9	+/-79	+/-78.3	
	50	+80/-89.5	+80/-88.8	+80/-87.9	+80/-87.1	+80/-86.3	+80/-85.2	+80/-84.5	+80/-83.6	+80/-83	+80/-82	+80/-81	+80/-80.3	+/-79.7	+/-78.7	+/-78.1	+/-77.4	+/-76.6		
	52	+80/-87.6	+80/-86.9	+80/-86	+80/-85.1	+80/-84.3	+80/-83.2	+80/-82.5	+80/-81.5	+80/-80.9	+/-79.8	+/-78.8	+/-78.1	+/-77.5	+/-76.5	+/-75.8	+/-75.2			
	54	+80/-85.9	+80/-85.2	+80/-84.2	+80/-83.3	+80/-82.5	+80/-81.3	+80/-80.6	+/-79.6	+/-79	+/-77.9	+/-76.9	+/-76.2	+/-75.5	+/-74.5	+/-73.8				
	56	+80/-84.4	+80/-83.6	+80/-82.6	+80/-81.7	+80/-80.8	+/-79.7	+/-78.9	+/-77.9	+/-77.3	+/-76.1	+/-75	+/-74.3	+/-73.7	+/-72.6					
	58	+80/-83	+80/-82.2	+80/-81.2	+80/-80.2	+/-79.4	+/-78.1	+/-77.4	+/-76.3	+/-75.7	+/-74.5	+/-73.4	+/-72.7	+/-72						
	60	+80/-81.8	+80/-81	+/-79.9	+/-78.9	+/-78	+/-76.7	+/-76	+/-74.9	+/-74.2	+/-73	+/-71.9	+/-71.1							
	62	+80/-80.8	+/-79.9	+/-78.8	+/-77.8	+/-76.8	+/-75.5	+/-74.7	+/-73.6	+/-72.9	+/-71.6	+/-70.5								
	64	+/-79.8	+/-78.9	+/-77.8	+/-76.7	+/-75.7	+/-74.3	+/-73.5	+/-72.4	+/-71.6	+/-70.3									
	67	+/-78.6	+/-77.7	+/-76.4	+/-75.3	+/-74.3	+/-72.8	+/-72	+/-70.7	+/-70										
	68	+/-78.3	+/-77.3	+/-76.1	+/-74.9	+/-73.8	+/-72.4	+/-71.5	+/-70.3											
	70	+/-77.7	+/-76.7	+/-75.4	+/-74.2	+/-73.1	+/-71.5	+/-70.6												
	72	+/-77.2	+/-76.1	+/-74.8	+/-73.5	+/-72.4	+/-70.8													
	74	+/-76.8	+/-75.7	+/-74.3	+/-73	+/-71.8														
	76	+/-76.5	+/-75.3	+/-73.8	+/-72.5															
	78	+/-76.3	+/-75	+/-73.5																
	80	+/-76.2	+/-74.9																	
	81.52	+/-76.1																		
											MAX. O.C. SPACING IF ANCHORING THROUGH THE FRAME PER SHEETS 3 & 4			MAX. O.C. SPACING IF ANCHORING THROUGH THE INTEGRAL FIN PER SHEET 4						
											APPLIES TO B, C OR D ANCHORS (SEE TABLE 2)			APPLIES TO F ANCHORS (SEE TABLE 3)						
											15.5"			3.3"						

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 25-0801-06
Expiration Date 9/24/2030
By [Signature]
Miami Dade Product Control

Revision: NO CHANGES THIS SHEET - AM

PREPARED BY A. LYNN MILLER
1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275
(941) 480-1600

REGISTRATION #29296

VINYL FIXED CASEMENT WINDOW NOA (NI)
DATE 9/9/14
DRAWN BY J. ROSOWSKI

DESIGN PRESSURE TABLES B

MD-5440.0

9 OF 11

PW-5440

Sheet


Series Desc. Title

ANTHONY LYNN MILLER
LICENSE
No. 58705
07/30/25
STATE OF
FLORIDA
PROFESSIONAL ENGINEER
A. LYNN MILLER, P.E.
P.E.# 58705

TABLE 8:

Window Design Pressure, (+/- psf)														Use this table for Glass Type:	5
1/4" A Cap - Airspace - 1/4" A															
Window Dimensions		Long Side (in)													
		81.52	83	85	87	89	92	94	97	99	103	107	110	111	
Short Side (in)	46	+/-67.1	+/-66.7	+/-66.1	+/-65.3	+/-63.2	+/-60.1	+/-58	+/-55.1	+/-53.6	+/-51.3	+/-48.8	+/-46.8	+/-46.4	
	48	+/-65.4	+/-65	+/-64.3	+/-63.8	+/-62.8	+/-59.8	+/-57.6	+/-54.9	+/-53.5	+/-50.6	+/-47.9	+/-46.3	+/-45.7	
	50	+/-63.9	+/-63.4	+/-62.8	+/-62.2	+/-61.6	+/-59.4	+/-57.2	+/-54.9	+/-53.5	+/-50.6	+/-47.3	+/-45.9	+/-45.4	
	52	+/-62.6	+/-62.1	+/-61.4	+/-60.8	+/-60.2	+/-59.2	+/-57.1	+/-54.7	+/-53.5	+/-50.6	+/-47.5	+/-45.7	+/-45.4	
	54	+/-61.4	+/-60.8	+/-60.2	+/-59.5	+/-58.9	+/-58.1	+/-56.9	+/-54.7	+/-53.3	+/-50.6	+/-47.5	+/-45.9	+/-45.4	
	56	+/-60.3	+/-59.7	+/-59	+/-58.4	+/-57.7	+/-56.9	+/-56.4	+/-54.5	+/-53.3	+/-50.4	+/-47.5	+/-45.9	+/-45.5	
	58	+/-59.3	+/-58.7	+/-58	+/-57.3	+/-56.7	+/-55.8	+/-55.3	+/-54.4	+/-53.1	+/-50.4	+/-47.7	+/-45.9	+/-45.5	
	60	+/-58.5	+/-57.8	+/-57.1	+/-56.4	+/-55.7	+/-54.8	+/-54.3	+/-53.5	+/-52.7	+/-50.4	+/-47.7	+/-45.9		
	62	+/-57.7	+/-57.1	+/-56.3	+/-55.5	+/-54.9	+/-53.9	+/-53.3	+/-52.5	+/-52	+/-49.9	+/-47.7			
	64	+/-57	+/-56.4	+/-55.5	+/-54.8	+/-54.1	+/-53.1	+/-52.5	+/-51.7	+/-51.2	+/-49.3				
	67	+/-56.2	+/-55.5	+/-54.6	+/-53.8	+/-53	+/-52	+/-51.4	+/-50.5	+/-50					
	68	+/-55.9	+/-55.2	+/-54.3	+/-53.5	+/-52.7	+/-51.7	+/-51.1	+/-50.2						
	70	+/-55.5	+/-54.8	+/-53.8	+/-53	+/-52.2	+/-51.1	+/-50.4							
	72	+/-55.1	+/-54.4	+/-53.4	+/-52.5	+/-51.7	+/-50.6		<div>MAX. O.C. SPACING IF ANCHORING THROUGH THE FRAME PER SHEETS 3 & 4</div> <div>APPLIES TO A, B, C OR D ANCHORS (SEE TABLE 2)</div> <div>15"</div> <div>MAX. O.C. SPACING IF ANCHORING THROUGH THE INTEGRAL FIN PER SHEET 4</div> <div>APPLIES TO E OR F ANCHORS (SEE TABLE 3)</div> <div>2.6" FOR E ANCHORS, 4" FOR F ANCHORS</div>						
	74	+/-54.8	+/-54	+/-53	+/-52.1	+/-51.3									
	76	+/-54.6	+/-53.8	+/-52.7	+/-51.8										
	78	+/-53.6	+/-52.9	+/-51.8											
	80	+/-52.6	+/-51.8												
	81.52	+/-51.5													

TABLE DIMENSIONS MAY BE
ORIENTED VERTICALLY OR
HORIZONTALLY AS SHOWN.

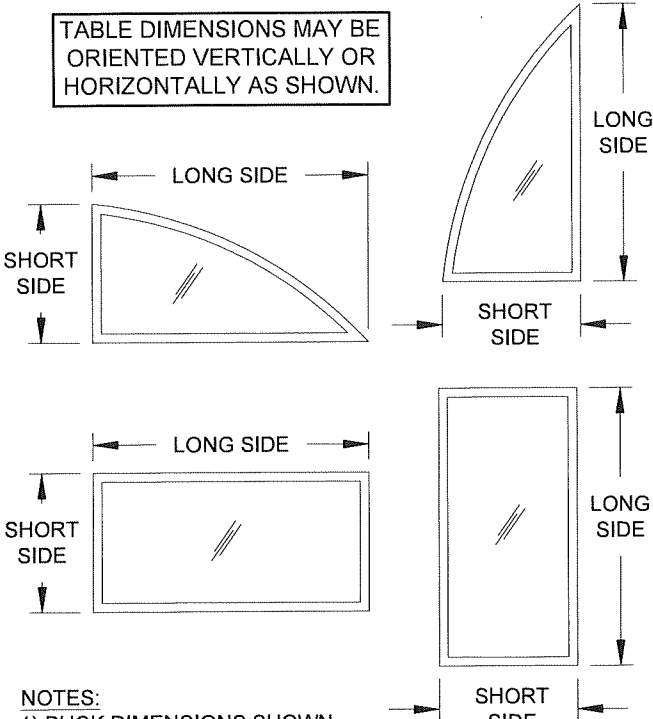

NOTES:
1) BUCK DIMENSIONS SHOWN.

2) FOR SIZES NOT SHOWN, ROUND UP TO THE
NEXT AVAILABLE SHORT OR LONG DIMENSION.

3) FOR ARCHITECTURAL WINDOWS (SEE SHEET 2),
FIND THE SMALLEST SQUARE WINDOW SIZE IN
THE TABLE(S) ABOVE WHICH THE ARCHITECTURAL
WINDOW WILL COMPLETELY FIT WITHIN.

TABLE 9:

Window Design Pressure, (+/- psf)																		Use this table for Glass Type:		6	
1/4" T Cap - Airspace - 1/4" T																					
Window Dimensions		Long Side (in)																			
		84.85	86	90	92	94	97	100	102	105	109	112	116	120	124	128	133	138	144		
Short Side (in)	46	+80/-96.2	+80/-95.7	+80/-94.2	+80/-93.5	+80/-92.8	+80/-91.9	+80/-91.1	+80/-90.5	+80/-89.8	+80/-88.9	+80/-88.2	+80/-87.5	+80/-86.7	+80/-86.1	+80/-85.5	+80/-84.8	+80/-84.1	+80/-83.5		
	48	+80/-93.7	+80/-93.2	+80/-91.6	+80/-90.9	+80/-90.2	+80/-89.3	+80/-88.4	+80/-87.9	+80/-87.1	+80/-86.2	+80/-85.5	+80/-84.7	+80/-84	+80/-83.3	+80/-82.7	+80/-82	+80/-81.3	+80/-80.6		
	50	+80/-91.5	+80/-91	+80/-89.3	+80/-88.6	+80/-87.9	+80/-86.9	+80/-86	+80/-85.5	+80/-84.7	+80/-83.7	+80/-83	+80/-82.2	+80/-81.5	+80/-80.8	+80/-80.2	+/-79.4	+/-78.8	+/-78.1		
	52	+80/-89.4	+80/-88.9	+80/-87.2	+80/-86.5	+80/-85.7	+80/-84.7	+80/-83.8	+80/-83.3	+80/-82.4	+80/-81.5	+80/-80.8	+/-80	+/-79.2	+/-78.5	+/-77.8	+/-77.1	+/-76.4			
	54	+80/-87.6	+80/-87.1	+80/-85.3	+80/-84.5	+80/-83.8	+80/-82.8	+80/-81.8	+80/-81.2	+80/-80.4	+/-79.4	+/-78.7	+/-77.9	+/-77.1	+/-76.4	+/-75.7	+/-74.9				
	56	+80/-86	+80/-85.4	+80/-83.6	+80/-82.8	+80/-82	+80/-81	+/-80	+/-79.4	+/-78.5	+/-77.5	+/-76.8	+/-75.9	+/-75.1	+/-74.4	+/-73.7					
	58	+80/-84.5	+80/-83.9	+80/-82.1	+80/-81.2	+80/-80.4	+/-79.3	+/-78.3	+/-77.7	+/-76.8	+/-75.8	+/-75	+/-74.2	+/-73.3	+/-72.6						
	60	+80/-83.2	+80/-82.6	+80/-80.6	+/-79.8	+/-79	+/-77.8	+/-76.8	+/-76.2	+/-75.3	+/-74.2	+/-73.4	+/-72.5	+/-71.7							
	62	+80/-82	+80/-81.3	+/-79.4	+/-78.5	+/-77.6	+/-76.5	+/-75.4	+/-74.7	+/-73.8	+/-72.7	+/-71.9	+/-71								
	64	+80/-80.9	+80/-80.3	+/-78.2	+/-77.3	+/-76.4	+/-75.2	+/-74.1	+/-73.4	+/-72.5	+/-71.3	+/-70.6									
	66	+/-80	+/-79.3	+/-77.2	+/-76.2	+/-75.3	+/-74.1	+/-72.9	+/-72.2	+/-71.3	+/-70.1										
	68	+/-79.2	+/-78.5	+/-76.2	+/-75.2	+/-74.3	+/-73	+/-71.9	+/-71.2	+/-70.2											
	70	+/-78.4	+/-77.7	+/-75.4	+/-74.4	+/-73.4	+/-72.1	+/-70.9	+/-70.2												
	72	+/-77.8	+/-77.1	+/-74.7	+/-73.6	+/-72.6	+/-71.2	+/-70													
	74	+/-77.3	+/-76.5	+/-74	+/-72.9	+/-71.9	+/-70.5							<div>MAX. O.C. SPACING IF ANCHORING THROUGH THE FRAME PER SHEETS 3 & 4</div> <div>MAX. O.C. SPACING IF ANCHORING THROUGH THE INTEGRAL FIN PER SHEET 4</div> <div>APPLIES TO B, C OR D ANCHORS (SEE TABLE 2)</div> <div>APPLIES TO F ANCHORS (SEE TABLE 3)</div> <div>15.5"</div> <div>3.2"</div>							
	76	+/-76.9	+/-76	+/-73.5	+/-72.3	+/-71.2															
	78	+/-76.5	+/-75.7	+/-73	+/-71.8																
	80	+/-76.3	+/-75.4	+/-72.6																	
	83	+/-76.1	+/-75.1																		
	84.85	+/-76																			

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 25-0801.06
Expiration Date 9/24/2030
By *[Signature]*
Miami Dade Product Control

Revision: NO CHANGES THIS SHEET - AM

PREPARED BY A. LYNN MILLER
1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275
(941) 480-1600

REGISTRATION #29296

9/9/14

9/9/14

J. ROSOWSKI

MD-5440.0

10 OF 11

PW-5440


PGT
Custom Windows and Doors
3400 PRECISION DRIVE
N. VENICE, FL 34275
(941) 480-1600

VINYL FIXED CASEMENT WINDOW NOA (NI)

DESIGN PRESSURE TABLES C

Series Desc. Title

ANTHONY LYNN MILLER
LICENSE
No. 58705
07/30/25
STATE OF
FLORIDA
PROFESSIONAL ENGINEER
A. LYNN MILLER, P.E.
P.E.# 58705

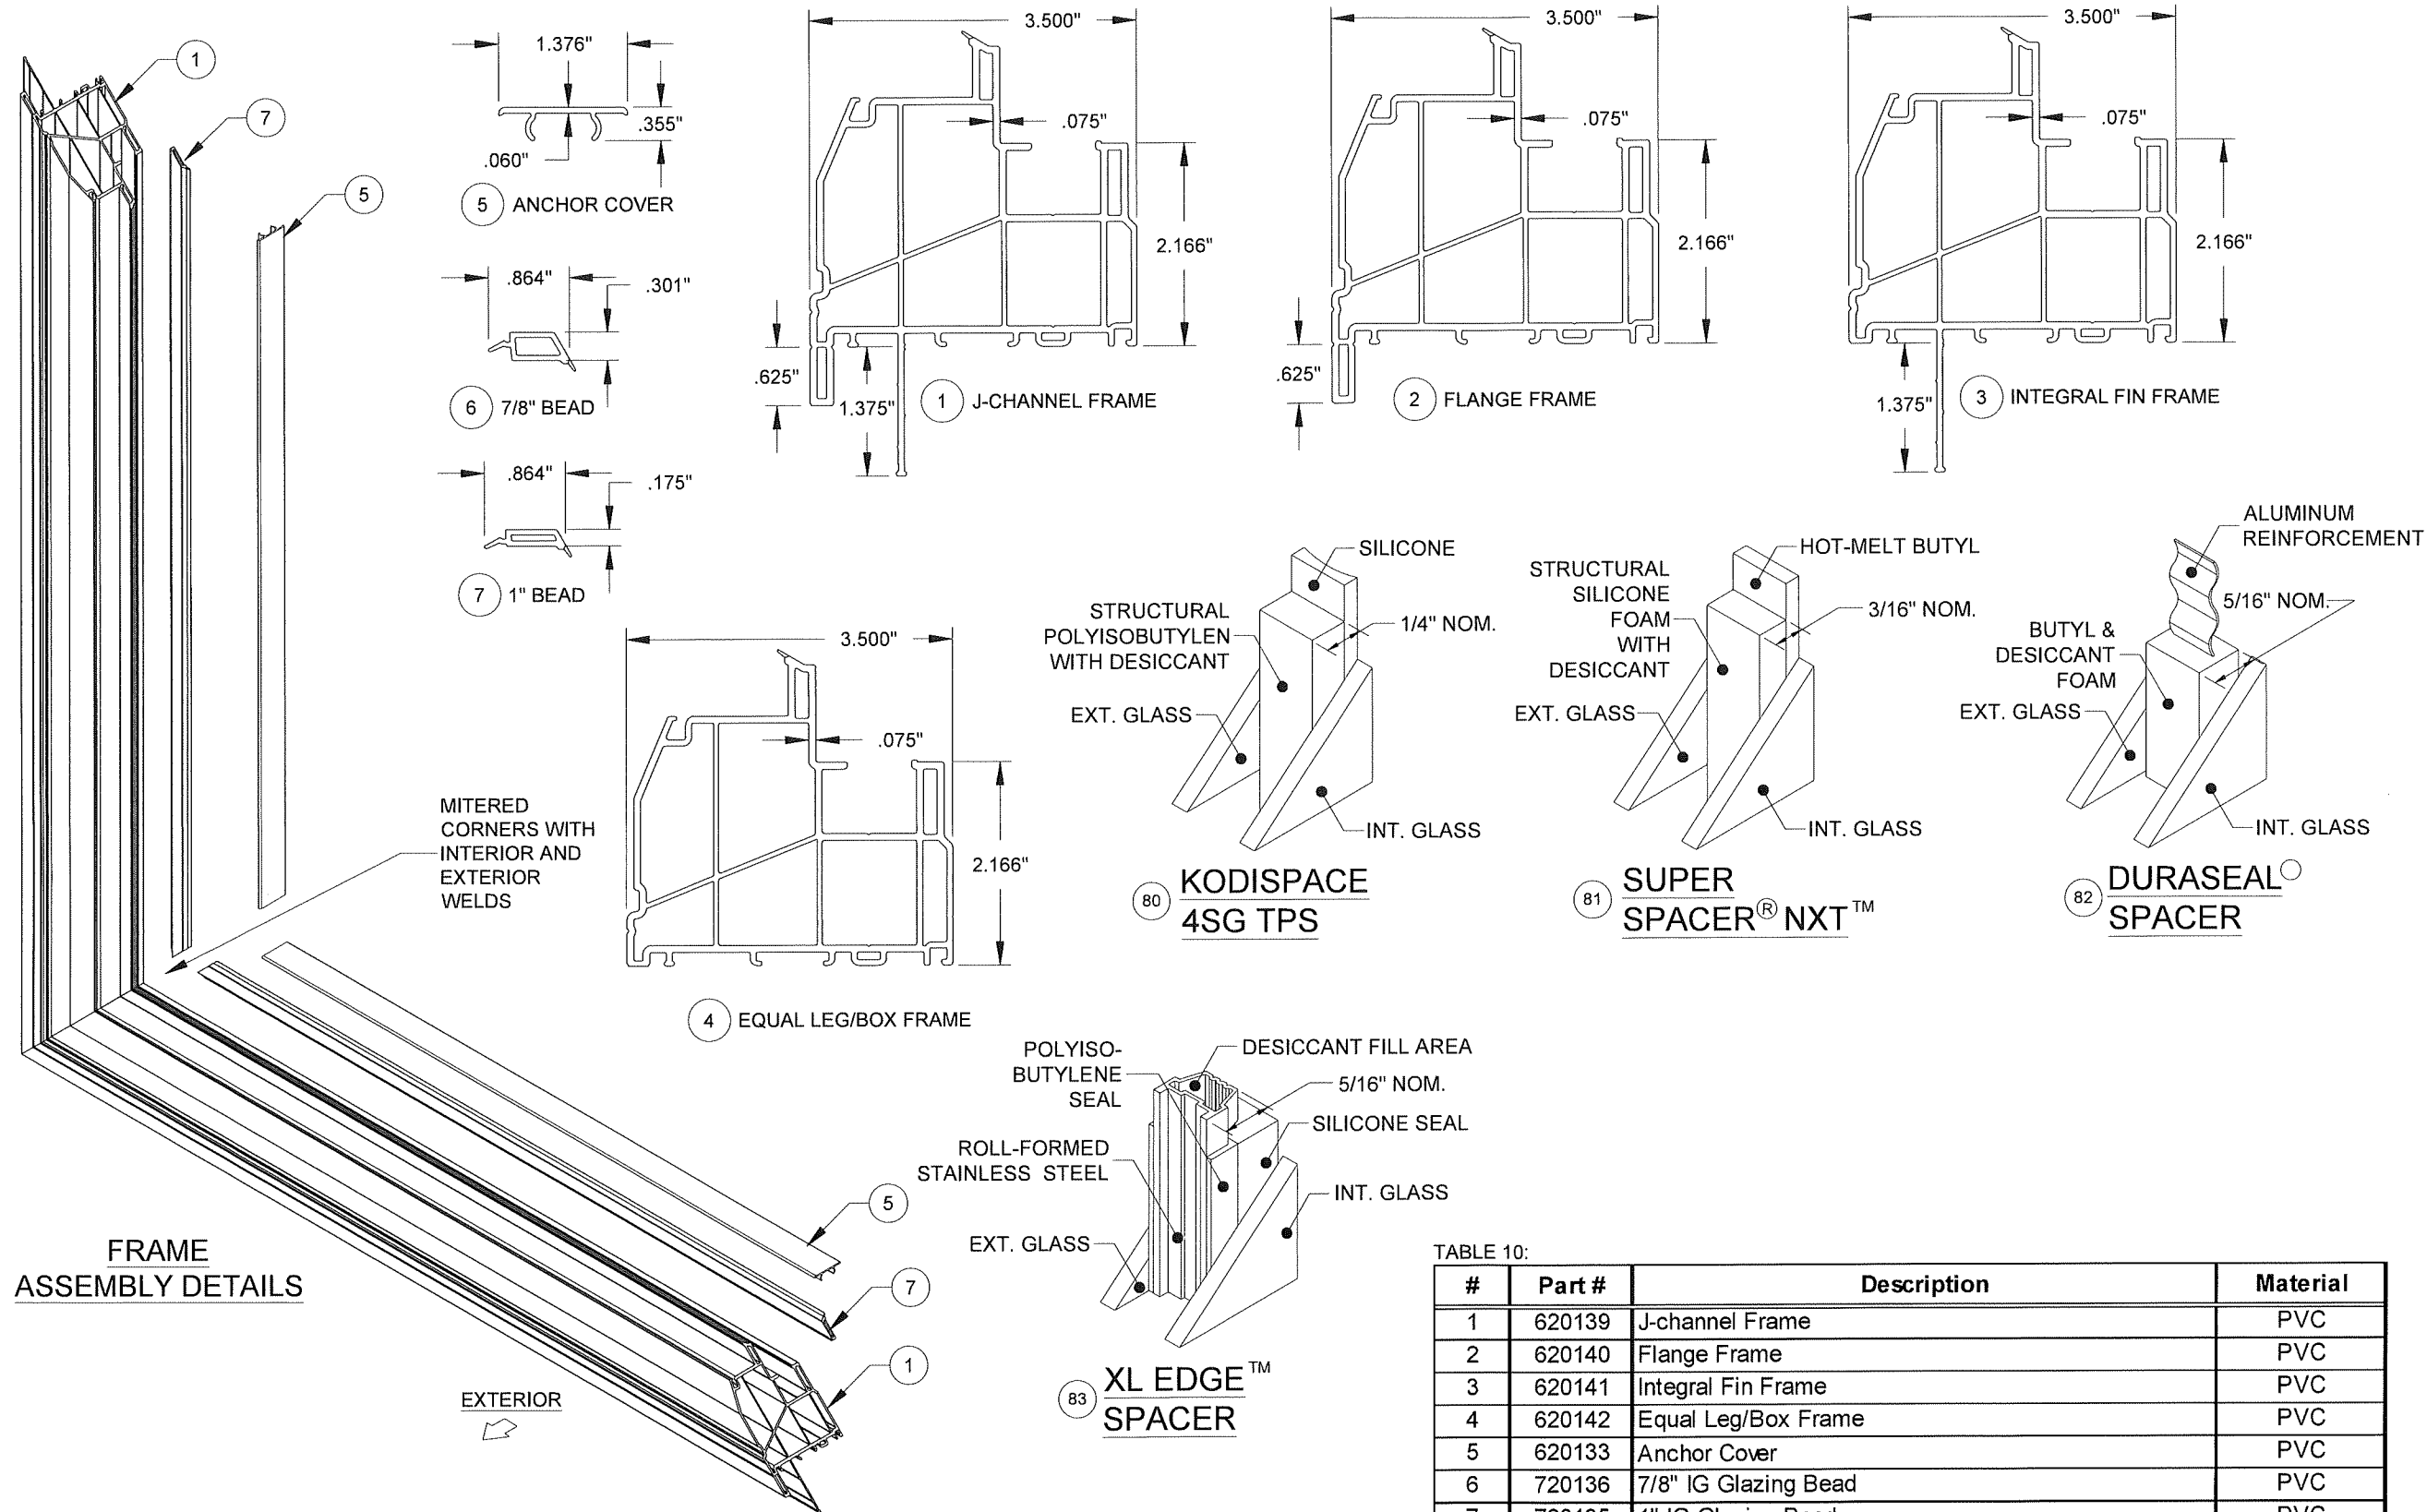

FRAME
ASSEMBLY DETAILS

Part #	Description	Material
80	Kommerling 4SG TPS Spacer System	See this Sheet for Materials
81	Quanex Super Spacer nXT with Hot Melt Butyl	
82	Quanex Duraseal Spacer	
83	Cardinal XL Edge Spacer	

NOTES:
 1) SOME PARTS/OPTIONS NOT SHOWN ON DRAWING FOR CLARITY.
 2) J-CHANNEL FRAME SHOWN, PART #1. OTHER FRAME TYPES, PARTS #2 - 4, APPLY.
 3) ITEMS # 8-73, 75-77, 79 & 84-89 ARE NOT USED AND ARE NOT PART OF THIS APPROVAL.
 4) VISION EXTRUSION, LTD. TO BE LABELED FOR AAMA EXTRUDER CODE.

TABLE 10:

#	Part #	Description	Material
1	620139	J-channel Frame	PVC
2	620140	Flange Frame	PVC
3	620141	Integral Fin Frame	PVC
4	620142	Equal Leg/Box Frame	PVC
5	620133	Anchor Cover	PVC
6	720136	7/8" IG Glazing Bead	PVC
7	720135	1" IG Glazing Bead	PVC
74		Backbedding, GE 7700 or Dow 791 or Dow 983	Silicone
78	71646N	Setting Block (7/8" x 1" x 1/8"), 85 +/- 5 duro.	PVC
90	20160A	Frame Assembly Tube	Alum. 6005-T5
91	20177	Shallow Flush Cap	PVC
92	20178	Deep Fush Cap	PVC
93	20132	Frame Assembly Tube End Cap	PVC

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 25-0801.06
 Expiration Date 9/24/2030
 By *[Signature]*
 Miami Dade Product Control

Revision: NO CHANGES THIS SHEET - AM

PREPARED BY A. LYNN MILLER
 1070 TECHNOLOGY DRIVE
 N. VENICE, FL 34275
 (941) 480-1600

REGISTRATION #29296

VINYL FIXED CASEMENT WINDOW NOA (NI)

DATE 9/9/14

BY J. ROSOWSKI

BOM & ASSEMBLY

11 OF 11

PW-5440

MD-5440.0

E

PGT Custom Windows and Doors

3400 PRECISION DRIVE
 N. VENICE, FL 34275
 (941) 480-1600

ANTHONY LYNN MILLER
 LICENSE
 No. 58705
 07/30/25
 STATE OF
 FLORIDA
 PROFESSIONAL ENGINEER
 A. LYNN MILLER, P.E.
 P.E.# 58705