


PLANS FOR PROPOSED

S.W. 80 ST. FROM
S.W. 149 AVE. TO S.W. 154 AVE

DRAINAGE IMPROVEMENT PROJECT
MIAMI-DADE COUNTY PROJECT NO. 20150122
FUNDING SOURCE: GENERAL OBLIGATION BOND

INDEX OF SHEETS

SHT. No.	SHEET DESCRIPTION
1	COVER SHEET
2	GENERAL NOTES
3	SURVEYOR'S NOTES, KEY SHEET, LEGEND AND ABBREVIATIONS
4,5,6,7,8,9	DRAINAGE PLANS
10,11	PROPOSED DRAINAGE STRUCTURE, CONFLICT AND SUMMARY OF QUANTITIES TABLE
12,13,14	STANDARD DETAILS
15	INLET PROTECTION SYSTEMS DETAILS
16	SEDIMENT BARRIERS DETAILS
17	STORMWATER POLLUTION PREVENTION PLAN

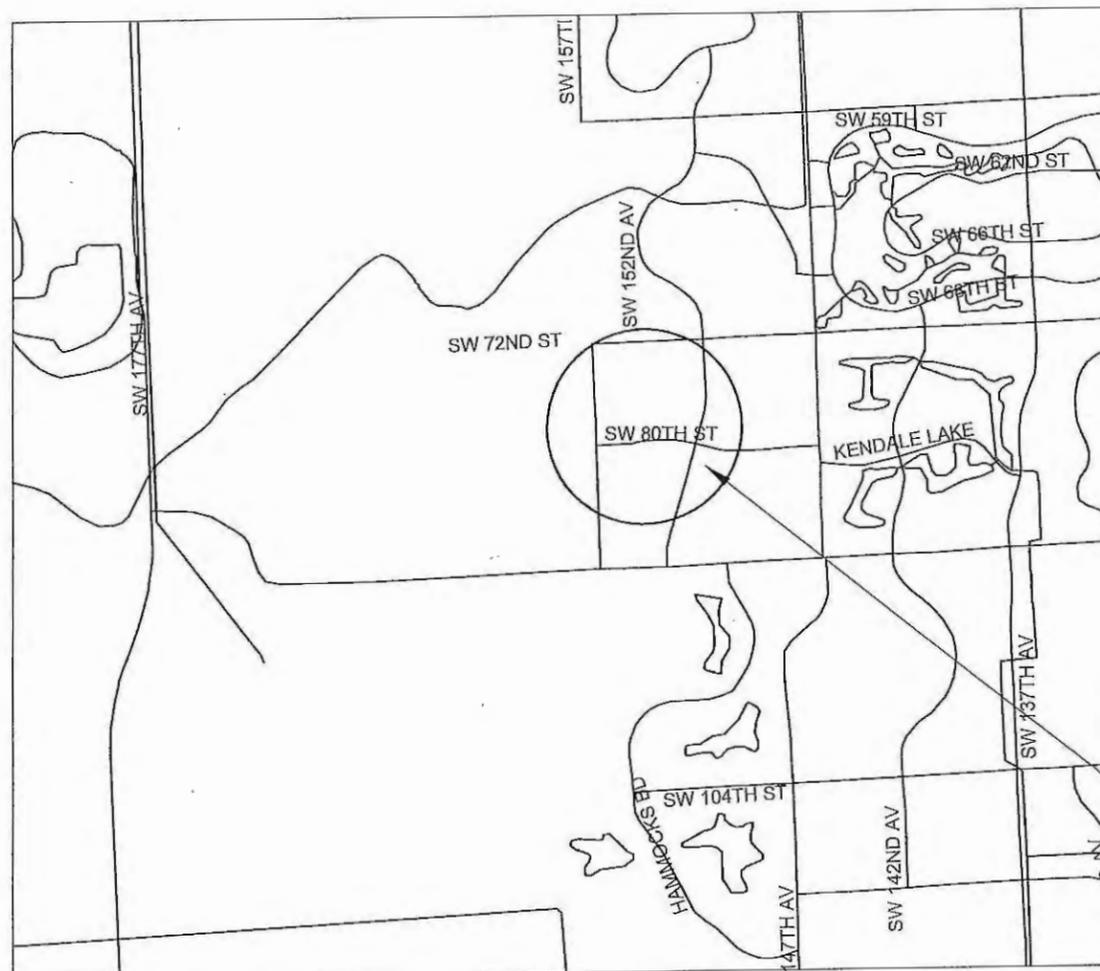


NOTE:

ATTENTION IS DIRECTED TO THE FACT THAT THESE PLANS MAY HAVE BEEN REDUCED IN SIZE BY REPRODUCTION. THIS MUST BE CONSIDERED WHEN OBTAINING SCALED DATA.

PROJECT LOCATION

PREPARED BY



DEPARTMENT OF TRANSPORTATION
AND PUBLIC WORKS
ROADWAY ENGINEERING AND
RIGHT OF WAY DIVISION

STEPHEN P. CLARK CENTER
111 NW 1 ST, SUITE 1510
MIAMI, FLORIDA 33128



DARYL K. HILDOER, P.E.
FLORIDA REGISTRATION P.E. No. 68633
CIVIL ENGINEER

THESE PLANS HAVE BEEN PREPARED IN ACCORDANCE WITH AND ARE GOVERNED BY THE MIAMI-DADE COUNTY PUBLIC WORKS DEPARTMENT STANDARDS AND SPECIFICATIONS PARTS 1, 2 AND 3. THE MANUAL OF UNIFORM MINIMUM STANDARDS FOR DESIGN, CONSTRUCTION AND MAINTENANCE FOR STREETS AND HIGHWAYS. THE FLORIDA DEPARTMENT OF TRANSPORTATION ROADWAY AND TRAFFIC DESIGN STANDARDS, AND THE FLORIDA DEPARTMENT OF TRANSPORTATION STANDARD SPECIFICATIONS, AS AMENDED BY CONTRACT DOCUMENTS.



DESIGN	I. NEWLAND	CHECK	F. GONZALEZ
		DRAWN	M. CEDRON/H.S.
DATE	04-19-16	SHEET	1 OF 17

GENERAL NOTES:


1. ALL ELEVATIONS REFER TO THE MSL, 1929 NATIONAL GEODETIC VERTICAL DATUM (NGVD).
2. ALL DRAINAGE CONSTRUCTION SHALL BE IN STRICT ACCORDANCE WITH THE REQUIREMENTS OF MIAMI-DADE COUNTY REGULATORY AND ECONOMIC RESOURCES AND THE MIAMI-DADE COUNTY DEPARTMENT OF TRANSPORTATION AND PUBLIC WORKS.
3. IT IS THE INTENT OF THESE PLANS TO BE IN ACCORDANCE WITH APPLICABLE CODES AND AUTHORITIES HAVING JURISDICTION. ANY DISCREPANCIES BETWEEN THESE PLANS AND APPLICABLE CODES SHALL BE IMMEDIATELY BROUGHT TO THE ATTENTION OF THE ENGINEER.
4. CATCH BASINS, SEEPAGE DRAINS, PAVEMENT RESTORATION AND PAVEMENT AROUND CATCH BASINS TO BE ACCORDING TO THE DETAILS AND APPLICABLE REQUIREMENTS OF THE MIAMI-DADE COUNTY DEPARTMENT OF TRANSPORTATION AND PUBLIC WORKS.
5. WHERE NEW PAVEMENT MEETS EXISTING, CONNECTION SHALL BE MADE IN A NEAT STRAIGHT LINE AND FLUSH WITH EXISTING PAVEMENT.
6. CONTRACTOR IS TO VERIFY THE EXACT LOCATION OF ALL EXISTING TREES, STRUCTURES, AND UTILITIES WHICH MAY NOT BE SHOWN ON PLANS. ANY EXISTING STRUCTURE, PAVEMENT, TREES OR OTHER EXISTING IMPROVEMENT NOT SPECIFIED FOR REMOVAL WHICH IS TEMPORARILY DAMAGED, EXPOSED OR IN ANY WAY DISTURBED BY CONSTRUCTION PERFORMED UNDER THIS CONTRACT, SHALL BE REPAIRED, PATCHED OR REPLACED AT NO ADDITIONAL COST TO THE OWNER.
7. THE LOCATION AND SIZE OF ALL EXISTING UTILITIES SHOWN ON THESE DRAWINGS ARE APPROXIMATE; ADDITIONAL UTILITIES MAY EXIST WHICH ARE NOT SHOWN ON THESE DRAWINGS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE LOCATION OF ALL EXISTING UTILITIES. THE CONTRACTOR SHALL VERIFY ALL UTILITIES BY ELECTRONIC METHODS AND BY HAND EXCAVATION IN COORDINATION WITH ALL UTILITY COMPANIES; PRIOR TO BEGINNING ANY CONSTRUCTION OPERATION, ANY AND ALL CONFLICTS OF EXISTING UTILITIES WITH PROPOSED IMPROVEMENTS MUST BE RESOLVED BY THE ENGINEER AND THE OWNER. THIS WORK BY THE CONTRACTOR SHALL BE CONSIDERED INCIDENTAL TO THE CONTRACT AND NO ADDITIONAL COMPENSATION SHALL BE ALLOWED.
8. CONTRACTOR SHALL CONTACT THE SUNSHINE STATE ONE CALL OF FLORIDA, INC. AT 1 (800) 432-4770 AT LEAST 48 HOURS PRIOR TO PERFORMING ANY DIGGING TO VERIFY THE EXACT LOCATION OF EXISTING UTILITIES.
9. EXISTING TREES SHALL BE REMOVED ONLY IF REQUIRED FOR CONSTRUCTION. THOSE TREES NOT INTERFERING WITH CONSTRUCTION SHALL BE PROTECTED IN PLACE. THE CONTRACTOR IS ADVISED THAT A TREE PERMIT MAY BE REQUIRED FOR TREE REMOVAL. CONTRACTOR SHALL NOTIFY REGULATORY AND ECONOMIC RESOURCES DEPARTEMENT AND MUNICIPALITIES WITH JURISDICTION PRIOR TO REMOVING ANY TREES.
10. EXISTING GRADES WERE TAKEN FROM THE BEST AVAILABLE DATA AND MAY NOT ACCURATELY REFLECT PRESENT CONDITIONS. CONTRACTOR SHALL BE RESPONSIBLE FOR FAMILIARIZING HIMSELF WITH CURRENT SITE CONDITIONS, AND SHALL REPORT ANY DISCREPANCIES TO THE ENGINEER PRIOR TO STARTING WORK.
11. THE CONTRACTOR SHALL PREPARE AND SUBMIT SHOP DRAWINGS FOR ALL ITEMS LISTED IN PROJECT SPECIFICATION.
12. UNDER NO CIRCUMSTANCES SHALL THE CONTRACTOR LEAVE EXCAVATED TRENCHES, OR PARTS OF, EXPOSED OR OPEN AT THE END OF THE WORKING DAY, WEEKENDS, HOLIDAYS OR OTHER TIMES. WHEN THE CONTRACTOR IS NOT WORKING, UNLESS OTHERWISE DETERMINED, ANY TRENCH SHALL BE COVERED, FIRMLY SECURED AND MARKED ACCORDINGLY FOR PEDESTRIAN TRAFFIC.
13. THE CONTRACTOR SHALL MAINTAIN ACCESS TO ALL ADJACENT PROPERTIES AT ALL TIMES.
14. ALL EXCAVATED MATERIAL REMOVED FROM THIS PROJECT SHALL BE DISPOSED OF PROPERLY BY THE CONTRACTOR AT THE CONTRACTOR'S EXPENSE.
15. CAST IRON PRODUCTS: HEAVY-DUTY CLASSIFICATION SUITABLE FOR HIGHWAY TRAFFIC LOADS, OR 16,000 LB. WHEEL LOADS.
16. STEEL GRATING AND COVERS: TRAFFIC CLASSIFICATION H-20 AASHTO H20: 16,000 LBS. OVER 8' X 20" AREA.
17. ALL STRUCTURES MUST BE CAPABLE OF SUSTAINING HEAVY TRAFFIC LOADS.
18. ALL GRASS AREAS AFFECTED BY CONSTRUCTION SHALL BE RE-SODDED.
19. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROVISION, INSTALLATION AND MAINTENANCE OF ALL TRAFFIC CONTROL AND SAFETY DEVICES, IN ACCORDANCE WITH SPECIFICATIONS OUTLINED IN SECTION C2 AND SECTION R19 OF THE PUBLIC WORKS DEPARTMENT MANUAL. IN ADDITION, THE CONTRACTOR IS RESPONSIBLE FOR THE RESETING OF ALL TRAFFIC CONTROL AND INFORMATION SIGNING REMOVED DURING CONSTRUCTION PERIOD.
20. EXCAVATED OR OTHER MATERIAL STORED ADJACENT TO OR PARTIALLY UPON A ROADWAY PAVEMENT SHALL BE ADEQUATELY MARKED FOR TRAFFIC SAFETY AT ALL TIMES.
21. TEMPORARY PATCH MATERIAL MUST BE ON THE JOB SITE WHENEVER PAVEMENT IS CUT, OR THE INSPECTOR WILL SHUT THE JOB DOWN.
22. CONTRACTOR SHALL MAINTAIN TRAFFIC ACCORDING TO CORRESPONDING TYPICAL CONTROL DETAIL AS OUTLINED IN MIAMI-DADE COUNTY PUBLIC WORKS MANUAL.
23. CONTRACTOR SHALL MAINTAIN AT LEAST THE FOLLOWING NUMBER OF TRAFFIC LANES FOR CORRESPONDING TIME PERIODS: MONDAY - FRIDAY 7-9 A.M. AND 4-8 P.M.; NO INTERRUPTION TO TRAFFIC IS PERMITTED.
ALL OTHER TIMES:
A) MAINTAIN ONE LANE FOR TWO-WAY OPERATION WITH FLAGMEN.
B) MAINTAIN ONE LANE IN EACH DIRECTION FOR TRAFFIC.
24. CONTRACTOR MUST PROVIDE FLASHER ARROW BOARD FOR ANY LANE THAT IS CLOSED OR DIVERTED.
25. CONTRACTOR SHALL NOTIFY LAW ENFORCEMENT AND FIRE PROTECTION SERVICES TWENTY-FOUR (24) HOURS IN ADVANCE OF THE DETOUR IN ACCORDANCE WITH SECTION 336.07 OF FLORIDA STATUTES.
26. COMPLETE AS-BUILT INFORMATION RELATIVE TO LOCATION AND DEPTH OF PIPES, MANHOLES, ETC. SHALL BE ACCURATELY RECORDED BY THE CONTRACTOR. THREE (3) SETS LABELED "AS-BUILT" MUST BE SUBMITTED, SIGNED AND SEALED BY A PROFESSIONAL ENGINEER REGISTERED IN THE STATE OF FLORIDA, TO THE ENGINEER OF RECORD PRIOR TO FINAL ACCEPTANCE OF THE WORK.
27. IT IS RESPONSIBILITY OF THE CONTRACTOR TO SELECT AND OBTAIN THE APPROPRIATE PERMISSION FROM MIAMI-DADE COUNTY OR APPLICABLE AGENCY THAT HAS JURISDICTION ON THE "PROPOSED" STAGING AREAS.
28. DRAINAGE/UTILITY TRENCHES SHALL NOT BE LEFT OPEN OVERNIGHT. A TEMPORARY COVER WITH A CAPACITY OF H-20 LOADING SHALL BE PLACED AS DIRECTED BY THE ENGINEER AT NO EXTRA COST TO MIAMI-DADE COUNTY.
29. PROVIDE FLOWABLE FILL OVER PIPE AS COVER WHERE MINIMUM PIPE COVER OF 2 FEET CANNOT BE ACCOMPLISHED UNDER PAVED AREAS. HOWEVER, THE COVER WITH FLOWABLE FILL SHALL BE NO LESS THAN 12 INCHES.
30. ALL STATIONS AND OFFSETS REFER TO [CENTERLINE]/[BASELINE] OF CONSTRUCTION, UNLESS OTHERWISE STATED.
31. CONTRACTOR SHALL COMPLY WITH THE REQUIREMENTS OF THE EPA AND THE NATIONAL POLLUTION DISCHARGE ELIMINATION SYSTEM (NPDES).
32. MIAMI-DADE WATER AND SEWER DEPARTMENT REQUIRES THAT ACCESS TO ALL WATER AND SEWER VALVES, SANITARY MANHOLES, AND OTHER CONTROL MECHANISMS BE MAINTAINED THROUGHOUT CONSTRUCTION IN THE EVENT OF AN EMERGENCY TO ENSURE THE PUBLIC HEALTH AND SAFETY. COVERING VALVE BOXES AND MANHOLES CAN BE CONSIDERED UNAUTHORIZED CONSTRUCTION OF AND TAMPERING WITH DEPARTMENT UTILITIES. ALL REQUESTS FOR UTILITY ADJUSTMENTS MUST BE MADE IN WRITING AT LEAST TWO (2) WEEKS IN ADVANCE. FOR MANHOLE AND VALVES, CONTACT UTILITY COORDINATOR PATRICK CHONG AT 786-268-5255. THE DEPARTMENT WILL MAKE ONE FINAL AND PERMANENT ADJUSTMENT AT NO COST TO THE REQUESTING AGENCY. FOR THE ADJUSTMENT OF WATER METERS, CONTACT THE CHIEF OF METER OPERATIONS AND MAINTENANCE: 786-268-5469. FOR ANY FIRE HYDRANTS THAT ARE DAMAGED OR BUMPED DURING CONSTRUCTION, CONTACT THE MDWASD HYDRANT SHOP AT 305-552-4926, BEFORE POURING CONCRETE FOR THE SIDEWALK. IN THE EVENT OF A WATER OR SEWER EMERGENCY, WASD EMERGENCY NUMBER 305-552-8901. THIS LINE IS OPEN 24 HOURS, 7 DAYS A WEEK.
33. THE CONTRACTOR IS ADVISED THAT PROPERTIES ADJACENT TO THE PROJECT HAVE ELECTRIC, TELEPHONE, GAS, WATER AND/OR SEWER SERVICE LATERALS WHICH MAY NOT BE SHOWN IN PLANS. THE CONTRACTOR MUST REQUEST THE LOCATION OF THESE LATERAL SERVICES FROM THE UTILITY COMPANIES. THE ADDITIONAL COST OF EXCAVATING, INSTALLING, BACKFILLING, AND COMPACTING AROUND THESE SERVICES MUST BE INCLUDED IN THE BID RELATED ITEM FOR THE WORK BEING DONE.
34. THE CONTRACTOR SHOULD TAKE SPECIAL NOTE OF SOIL CONDITIONS THROUGHOUT THIS PROJECT. ANY SPECIAL SHORING, SHEETING OR OTHER PROCEDURES NECESSARY TO PROTECT ADJACENT PROPERTY, PUBLIC OR PRIVATE, DURING THE EXCAVATION OF SUBSOIL MATERIAL AND EXFILTRATION TRENCH, OR FILLING OF ANY AREA, OR FOR ANY OPERATION DURING CONSTRUCTION, SHALL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR.
35. IF SHEETING, SHORING OR DEWATERING, INCLUDING WELL POINTS ARE NECESSARY, THE CONTRACTOR MUST MONITOR AND CONTROL ALL WORK THAT MAY CAUSE CRACKING TO ANY ADJACENT BUILDING, STRUCTURE, OR PROPERTY AREA. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ANY DAMAGES CAUSED BY THESE OPERATIONS. COST OF SHEETING, SHORING, OR DEWATERING, SHALL BE INCLUDED IN THE RELATED BID ITEM FOR THE WORK BEING DONE.
36. ALL DITCH EXCAVATIONS SHALL BE PERFORMED IN FULL COMPLIANCE WITH THE PROVISIONS OF THE TRENCH SAFETY ACT.
37. ANY KNOWN OR SUSPECTED HAZARDOUS MATERIAL FOUND ON THE PROJECT BY THE CONTRACTOR SHALL BE IMMEDIATELY REPORTED TO THE PROJECT ENGINEER, WHO SHALL DIRECT THE CONTRACTOR TO PROTECT THE AREA OF KNOWN OR SUSPECTED CONTAMINATION FROM FURTHER ACCESS. THE ENGINEER WILL ARRANGE FOR INVESTIGATION, IDENTIFICATION, AND REMEDIATION OF THE HAZARDOUS MATERIAL. THE CONTRACTOR SHALL NOT RETURN TO THE AREA OF CONTAMINATION UNTIL APPROVAL IS PROVIDED BY THE PROJECT ENGINEER.
38. THE CONTRACTOR SHALL USE A STREET SWEEPER (USING WATER) OR OTHER EQUIPMENT CAPABLE OF CONTROLLING AND REMOVING DUST. APPROVAL OF THE USE OF SUCH EQUIPMENT IS CONTINGENT UPON ITS DEMONSTRATED ABILITY TO DO THE WORK.
39. WHEN DISSIMILAR MATERIAL CONNECTIONS ARE MADE, SUCH AS CONCRETE TO METAL, THE DISSIMILAR MATERIAL SHALL BE SEPARATED BY COATING THE CONTACT SURFACE WITH BITUMASTIC MATERIAL.
40. PRIOR TO CONSTRUCTION THE CONTRACTOR WILL INSPECT ALL EXISTING STRUCTURES WHICH ARE TO REMAIN AND NOTIFY THE ENGINEER OF ANY OBVIOUS STRUCTURAL DEFICIENCIES.
41. WHERE CONNECTIONS TO EXISTING SIDEWALKS AND DRIVEWAYS ARE NOT INDICATED ON PLANS, PROPER CONNECTIONS ARE TO BE MADE AS DIRECTED BY THE ENGINEER. DROP CURB AND DRIVEWAY CONNECTIONS SHALL BE PROVIDED FOR ACCESS TO ALL PRIVATE PROPERTIES ADJACENT TO THE PROJECT. PAYMENT SHALL BE INCLUDED IN THE COST OF RELATED BID ITEMS.
42. CONTRACTOR TO INSTALL 1/2" PERFORMED EXPANSION JOINT WHEN PROPOSED SIDEWALK IMPROVEMENTS IS IMMEDIATELY ADJACENT TO EXISTING CONCRETE SLAB AND/OR BUILDING.
43. THE SIDEWALK AT DRIVEWAY TURNOUTS SHALL BE 6" CONCRETE.
44. ALL BUS STOP SIGNS TO BE FURNISHED BY MIAMI-DADE COUNTY DEPARTMENT OF TRANSPORTATION AND PUBLIC WORKS. ENGINEER TO CONTACT MIAMI-DADE COUNTY DEPARTMENT OF TRANSPORTATION AND PUBLIC WORKS AT (305) 637-3753 ONE (1) WEEK PRIOR TO POURING SIDEWALKS AND COORDINATE THE REMOVAL AND REPLACEMENT OF BUS STOP SIGNS AND BENCHES.
45. THE INFORMATION PROVIDED IN THESE DRAWINGS IS SOLELY TO ASSIST THE CONTRACTOR IN ASSESSING THE NATURE AND EXTENT OF CONDITIONS WHICH WILL BE ENCOUNTERED DURING THE COURSE OF WORK. THE CONTRACTORS ARE DIRECTED, PRIOR TO BIDDING, TO CONDUCT WHATEVER INVESTIGATIONS THEY DEEM NECESSARY TO ARRIVE AT THEIR OWN CONCLUSION REGARDING THE ACTUAL CONDITIONS THAT WILL BE ENCOUNTERED AND UPON WHICH BIDS WILL BE BASED.
46. ANY SURVEY MONUMENT, BENCH MARK, ETC., FOUND DURING CONSTRUCTION ACTIVITIES ARE TO BE RESTORED TO IT IS ORIGINAL LOCATION AND COORDINATES AS DEPICTED IN COUNTY RECORDS PLAT AND BOOK. RESTORATION WILL BE AT NO ADDITIONAL COST AND MUST BE SHOWN ON AS-BUILT PLANS.

REVISIONS


DATE	BY	DESCRIPTION	DATE	BY	DESCRIPTION

SW 80 ST FROM SW 149 AVE TO SW 154 AVE

NAME	DATE	NAME	DATE
DESIGNED BY: I. NEWLAND	03-25-16	DRAWN: M. CEDRONI/ALS	04-07-16
CHECKED BY: F. GONZALEZ		CHECKED BY:	
SUPERVISED BY:			



DEPARTMENT OF TRANSPORTATION AND PUBLIC WORKS
ROADWAY ENGINEERING AND RIGHT OF WAY DIVISION
111 NW 1 ST
MIAMI, FLORIDA 33128

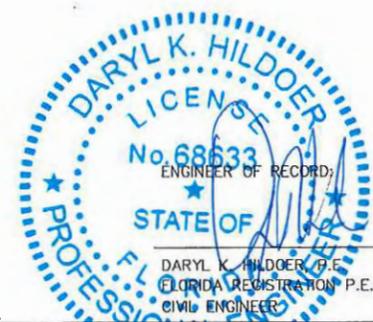

4/26/16

DARYL K. HILDOER, P.E.
FLORIDA REGISTRATION P.E. No. 68633
CIVIL ENGINEER

GENERAL NOTES


S:\Header\Verba\SW 80th St. from SW 149th Ave to SW 154th Ave\Plans\SH-02 GENERAL NOTES.dwg Apr 21, 2016 - 11:31pm SAUJCH

SURVEYOR'S NOTES


- Survey as performed by DTPW Survey Section as per: FB #2916, PG #38
- SW 80 ST FROM SW 149 AVE TO SW 152 AVE
- The elevations are based on N.G.V.D. MIAMI DADE COUNTY NAME=K-41; BM=ELEV=11.76'
SW 88 ST.=N of EDGE OF PAVEMENT;
SW 150 AVE=150'E of C/L
- *P.K. NAIL & ALUM WASHER IN CONC. CATCH BASIN

LEGEND AND ABBREVIATIONS:

- (M) = Measures
- (P) = By Plat
- F, Fd = Found
- CND = Concrete Nail & Disk
- PKF = PK Nail found
- CNDF = Concrete Nail & Disk found
- CNF = Concrete Nail & Disk found
- CNC = Concrete Nail Cut
- DHF = Drill Hole Found
- NF = Nail found
- PKDF = PK Nail & Disk Found
- R/W = Right-of-way
- RBAC = Rock base asphalt compound
- BL = Base Line
- CL = Center Line
- R = Radius
- L = Length of Curve
- C&G = Curb and Gutter
- E/P = Edge of Pavement
- T/B = Top of Bank
- E/W = Edge of Water
- E/W = Edge of Water
- PCP = Permanent Control Point
- RLS = Registered Land Surveyor
- PLS = Professional Land Surveyor
- PS = Street Sign
- FLS = Alum. Flashing School Light
- MB = Mailbox
- DL = Decorative Light Pole
- ML = Metal light pole
- MTLP = Metal Traffic light pole
- MP = Metal Power Pole
- CLP = Concrete Light Pole
- CP = Concrete Power Pole
- WLP = Wood Light Pole
- WPP = Wood Power Pole
- WTP = Wood Telephone Pole
- FLP = Fiberglass Light Pole
- WM = Water Manhole
- SM = Sanitary Manhole
- CTP = Cable Television Pedestal
- TCRB = TV cable Riser Box
- TCB = TV Control Box
- CB = Cable Box
- TH = Telephone Handhole
- TM = Telephone Manhole
- TUB = Telephone Utility Box
- TRB = Telephone Riser Box
- TRCB = Telephone Riser Control Box
- TCB = Telephone Control Box
- B = Box
- CS = Crossing Sign
- P = Post
- GV = Gas valve
- PVP = PVC Post
- WG = Wire guy
- SH = Sprinkle Head
- CA = Central angle of curve
- MW = Monitoring Well
- PP = Petroleum Pipeline
- EH = Electric Handhole
- EM = Electric Manhole
- FR = Firehydrant
- WV = Water Valve
- WM = Water Meter
- TSM = Traffic Sign Manhole
- TSH = Traffic Sign Handhole
- TTCB = Traffic Control Box
- TTSB = Traffic Signal Box
- SWM = Storm Water Manhole
- ECB = Electrical Control Box
- RR = Rail Road Crossing (Light)
- C = Concrete
- SSV = Sanitary Sewer Valve
- A = Asphalt
- UD = Unimproved Driveway
- G = Gravel
- B = Brick
- SC = Stamped Concrete
- CBF = Concrete Block Fence
- TD = Tree Diameter

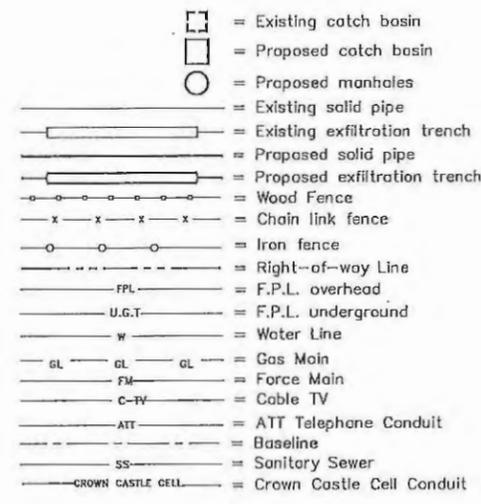

- AVOCADO TREE
- ARECA TREE
- AUST. PINE TREE
- ALMOND TREE
- BLACK OLIVE TREE
- BOTTLE BRUSH TREE
- BISMARCK PALM
- BUSH TREE
- BISCHOFIA TREE
- BANANA TREE
- BANYAN TREE
- BRASILIAN PEPPER
- CABBAGE TREE
- COCONUT TREE
- CLUSTER PALM
- CYPRESS TREE
- CANARY PALM
- COCOS PLUMOSA
- CACTUS
- DATE PALM
- FICUS TREE
- FLORIDA ORCHID TREE
- FOX TAIL TREE
- GUMBO LIMBO TREE
- HIBISCUS TREE
- IXORA TREE
- JUNIPER TREE
- JACARANDA TREE
- KAPOC TREE
- LIVE OAK TREE
- MAMEY TREE
- MULBERRY TREE
- MAHOGANY TREE
- MANGO TREE
- MANGROVE TREE
- NISPERO TREE
- NORFOLK TREE
- OAK TREE
- ORANGE GEIGER
- PINE TREE
- PALM TREE
- QUEEN PALM TREE
- RHOBOLENI TREE
- ROYAL POINCIANA TREE
- ROSEWOOD TREE
- ROYAL PALM
- PHILODENDRON/RUBBER TREE
- SOUR ORANGE TREE
- SEA GRAPE TREE
- SOLITARY PALM
- SILVER BUTTONWOOD TREE
- TABEBULA TREE
- TRAVELER CLUSTER
- TAMARIND TREE
- UNKNOWN TREE
- UMBRELLA TREE
- ZAPODILLA TREE
- WASHINGTON PALM

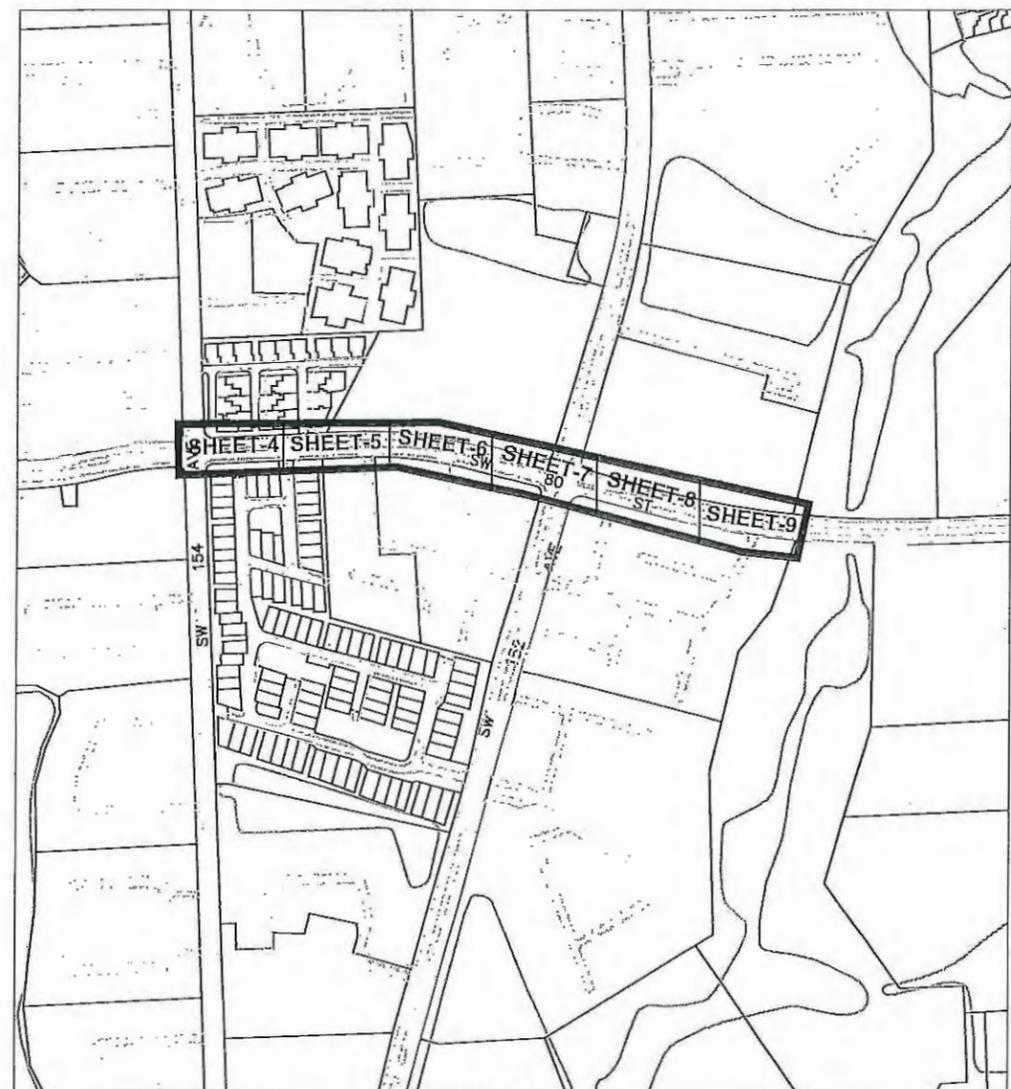

SCALE: N.T.S.


KEY SHEET
TRS 54-39-33

REVISIONS

DATE	BY	DESCRIPTION	DATE	BY	DESCRIPTION	DATE	BY	DESCRIPTION

SW 80 ST FROM
SW 149 AVE TO SW 154 AVE

DESIGNED BY	NAME	DATE	DRAWN BY	NAME	DATE
	L. HERLAND	03-25-16		M. CEDRONI/M.S.	03-25-16
CHECKED BY	F. GONZALEZ		CHECKED BY		
SUPERVISED BY					



DEPARTMENT OF TRANSPORTATION AND PUBLIC WORKS
ROADWAY ENGINEERING AND RIGHT OF WAY DIVISION
STEPHEN P. CLARK CENTER
111 NW 1 ST
MIAMI, FLORIDA 33128


DARYL K. HILDOER
LICENSED PROFESSIONAL ENGINEER
No. 68633
STATE ENGINEER OF RECORD
DARYL K. HILDOER, P.E.
FLORIDA REGISTRATION P.E. No. 68633
PROFESSIONAL ENGINEER

4/26/16

**SURVEYOR'S NOTES, KEY SHEET
LEGEND AND ABBREVIATIONS**

S:\Vector\veritas\SW 80th St. from SW 149th Ave to SW 154th Ave\Plans\SH-03 SURVEYOR'S NOTES.dwg Apr 21, 2016 - 1:31pm SANCHEZ

SCALE: 1"=30'

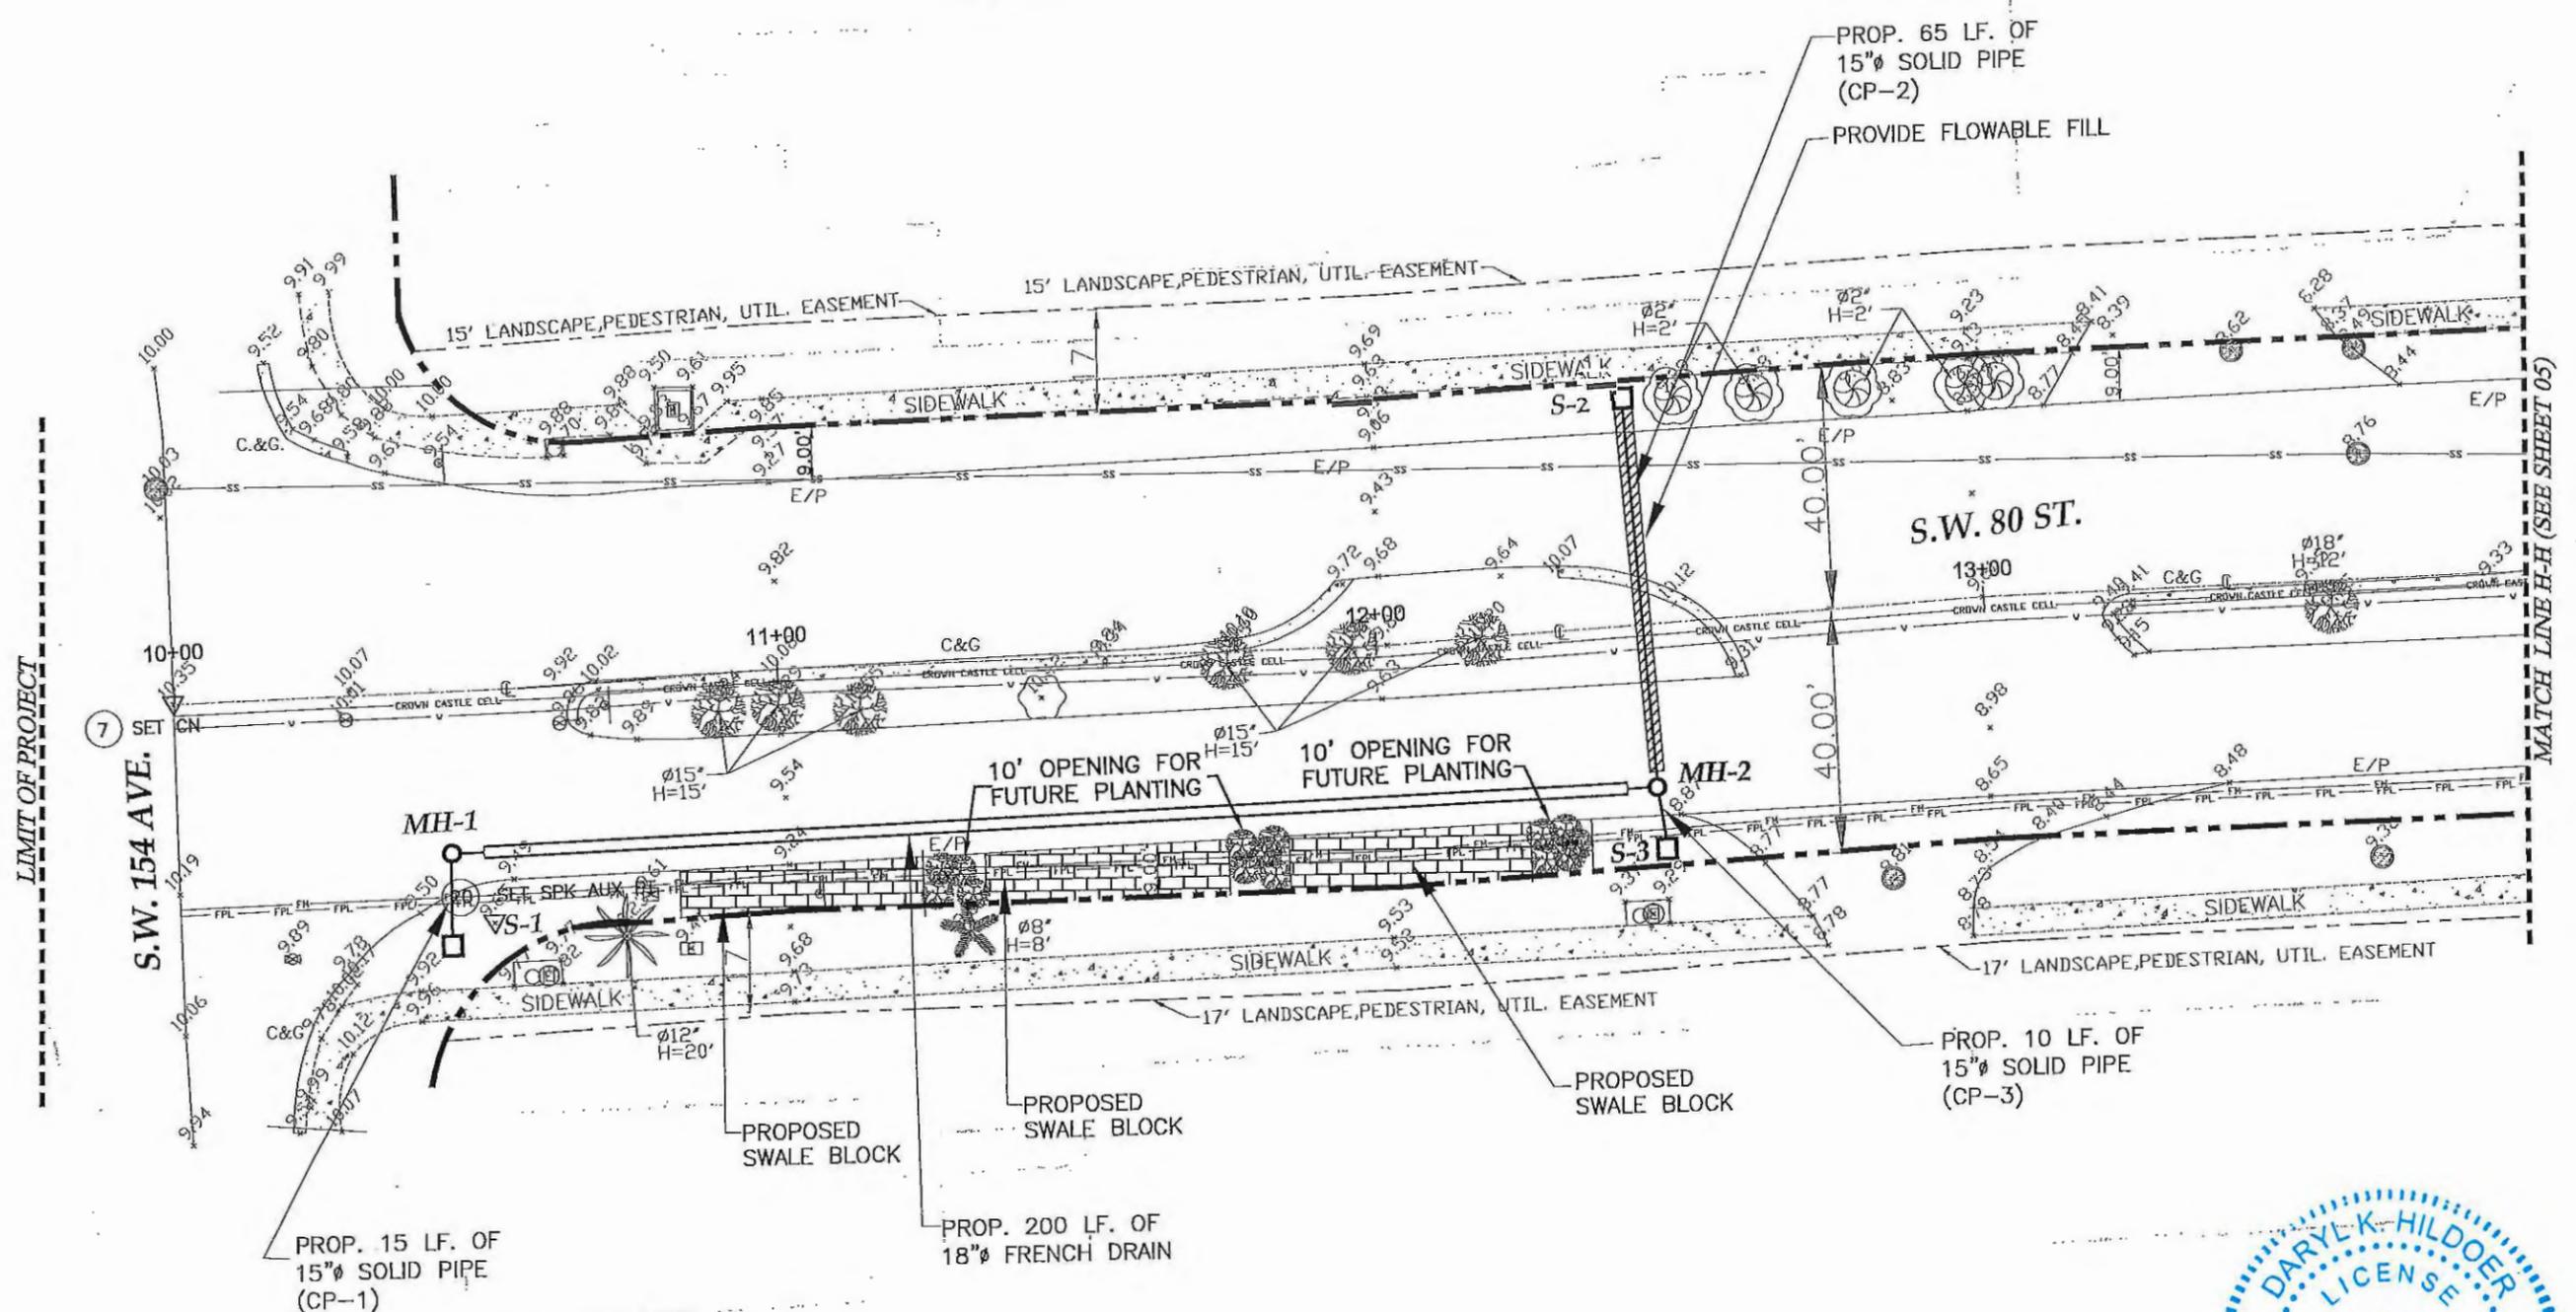

DARYL K. HILDOER
 LICENSE
 No. 68633
 STATE OF FLORIDA
 ENGINEER OF RECORD
 PROFESSIONAL ENGINEER
 DARYL K. HILDOER, P.E.
 FLORIDA REGISTRATION P.E. No. 68633
 CIVIL ENGINEER

S:\Project\Veritas\SW 80th St. from SW 149th Ave to SW 154th Ave\Plans\SH-04-TD SH-9 DRAINAGE PLAN.dwg Apr 21, 2016 - 1:32pm SMOHH

REVISIONS					
DATE	BY	DESCRIPTION	DATE	BY	DESCRIPTION


SW 80 ST FROM SW 149 AVE TO SW 154 AVE

NAME	DATE	NAME	DATE
DESIGNED BY: L.N.	10-18-15	DRAWN BY: M.CEDRONI/A.S.	4-12-16
CHECKED BY: L.N.		CHECKED BY: F.G.	
SUPERVISED BY:			

DEPARTMENT OF TRANSPORTATION AND PUBLIC WORKS
 ROADWAY ENGINEERING AND RIGHT-OF-WAY DIVISION
 STEPHEN P. CLARK CENTER
 311 NW 3 ST
 MIAMI, FLORIDA 33128

MIAMI-DADE COUNTY

DRAINAGE PLAN

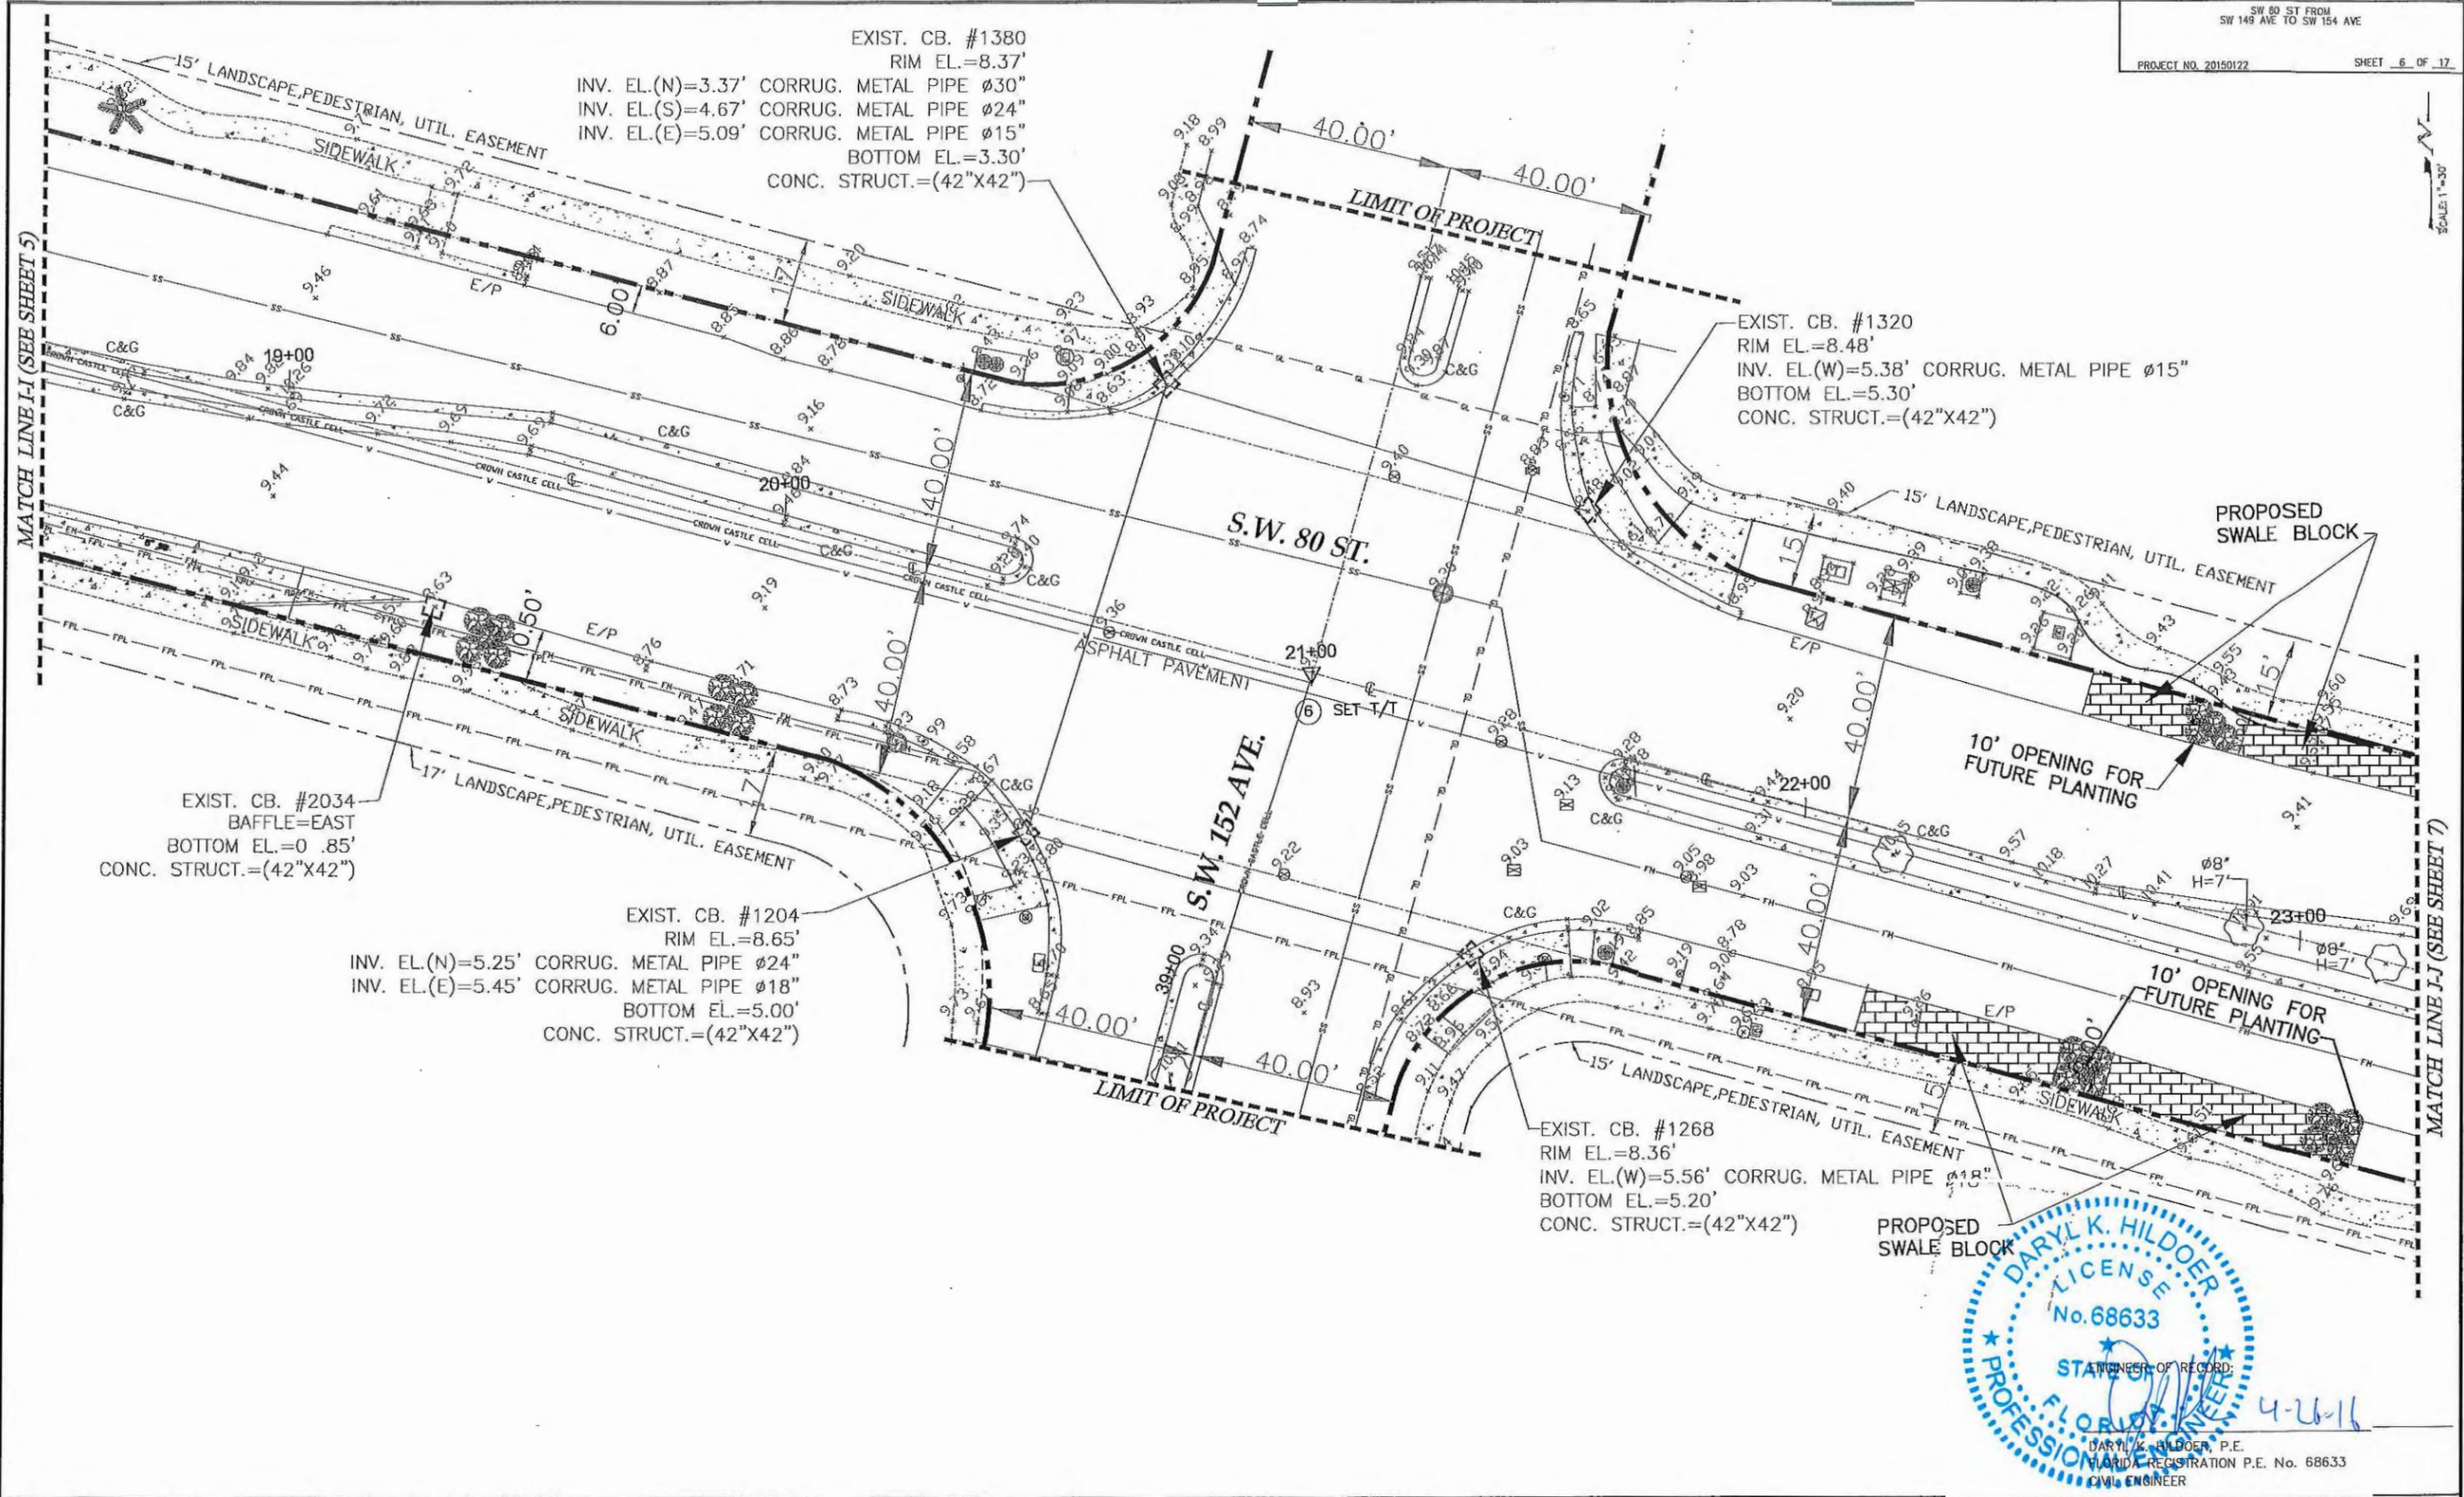

EXIST. CB. #1380
RIM EL.=8.37'
INV. EL.(N)=3.37' CORRUG. METAL PIPE Ø30"
INV. EL.(S)=4.67' CORRUG. METAL PIPE Ø24"
INV. EL.(E)=5.09' CORRUG. METAL PIPE Ø15"
BOTTOM EL.=3.30'
CONC. STRUCT.=(42"X42")

EXIST. CB. #1320
RIM EL.=8.48'
INV. EL.(W)=5.38' CORRUG. METAL PIPE Ø15"
BOTTOM EL.=5.30'
CONC. STRUCT.=(42"X42")

EXIST. CB. #2034
BAFFLE=EAST
BOTTOM EL.=0.85'
CONC. STRUCT.=(42"X42")

EXIST. CB. #1204
RIM EL.=8.65'
INV. EL.(N)=5.25' CORRUG. METAL PIPE Ø24"
INV. EL.(E)=5.45' CORRUG. METAL PIPE Ø18"
BOTTOM EL.=5.00'
CONC. STRUCT.=(42"X42")

EXIST. CB. #1268
RIM EL.=8.36'
INV. EL.(W)=5.56' CORRUG. METAL PIPE Ø18"
BOTTOM EL.=5.20'
CONC. STRUCT.=(42"X42")


DARYL K. HILDOER
LICENSE
No. 68633
STATE OF FLORIDA
PROFESSIONAL ENGINEER
DARYL K. HILDOER, P.E.
FLORIDA REGISTRATION P.E. No. 68633
CIVIL ENGINEER

S:\vector\verts\SW 80th St from sw 149th Ave to SW 154th Ave\Plane\SH-04-TD SH-9 DRAINAGE PLAN.dwg Apr 21, 2016 - 1:33pm SAKOHI

REVISIONS					
DATE	BY	DESCRIPTION	DATE	BY	DESCRIPTION

SW 80 ST FROM
SW 149 AVE TO SW 154 AVE

NAME	DATE	NAME	DATE
DESIGNED BY: I.N.	10-19-15	DRAWN BY: M.CEDRON/ALS.	4-12-16
CHECKED BY: I.N.		CHECKED BY: F.G.	
SUPERVISED BY:			



DEPARTMENT OF TRANSPORTATION AND PUBLIC WORKS
ROADWAY ENGINEERING AND RIGHT-OF-WAY DIVISION
STEPHEN P. CLARY CENTER
311 N.W. 131 ST
MIAMI, FLORIDA 33128


DRAINAGE PLAN

SCALE: 1"=30'

EXIST. CB. #2479
RIM EL.=8.07'
X-ING CORRUG. PIPE $\phi 84"=7'$
BOTTOM EL.=(-)0.20'
CORRUG. METAL PIPE STRUCT.= $\phi 18"=(1.3' \times 2.10')=H=0.75'$

PROP. 20LF. OF
15" ϕ SOLID PIPE

PROP. 190LF. OF
18" ϕ FRENCH DRAIN

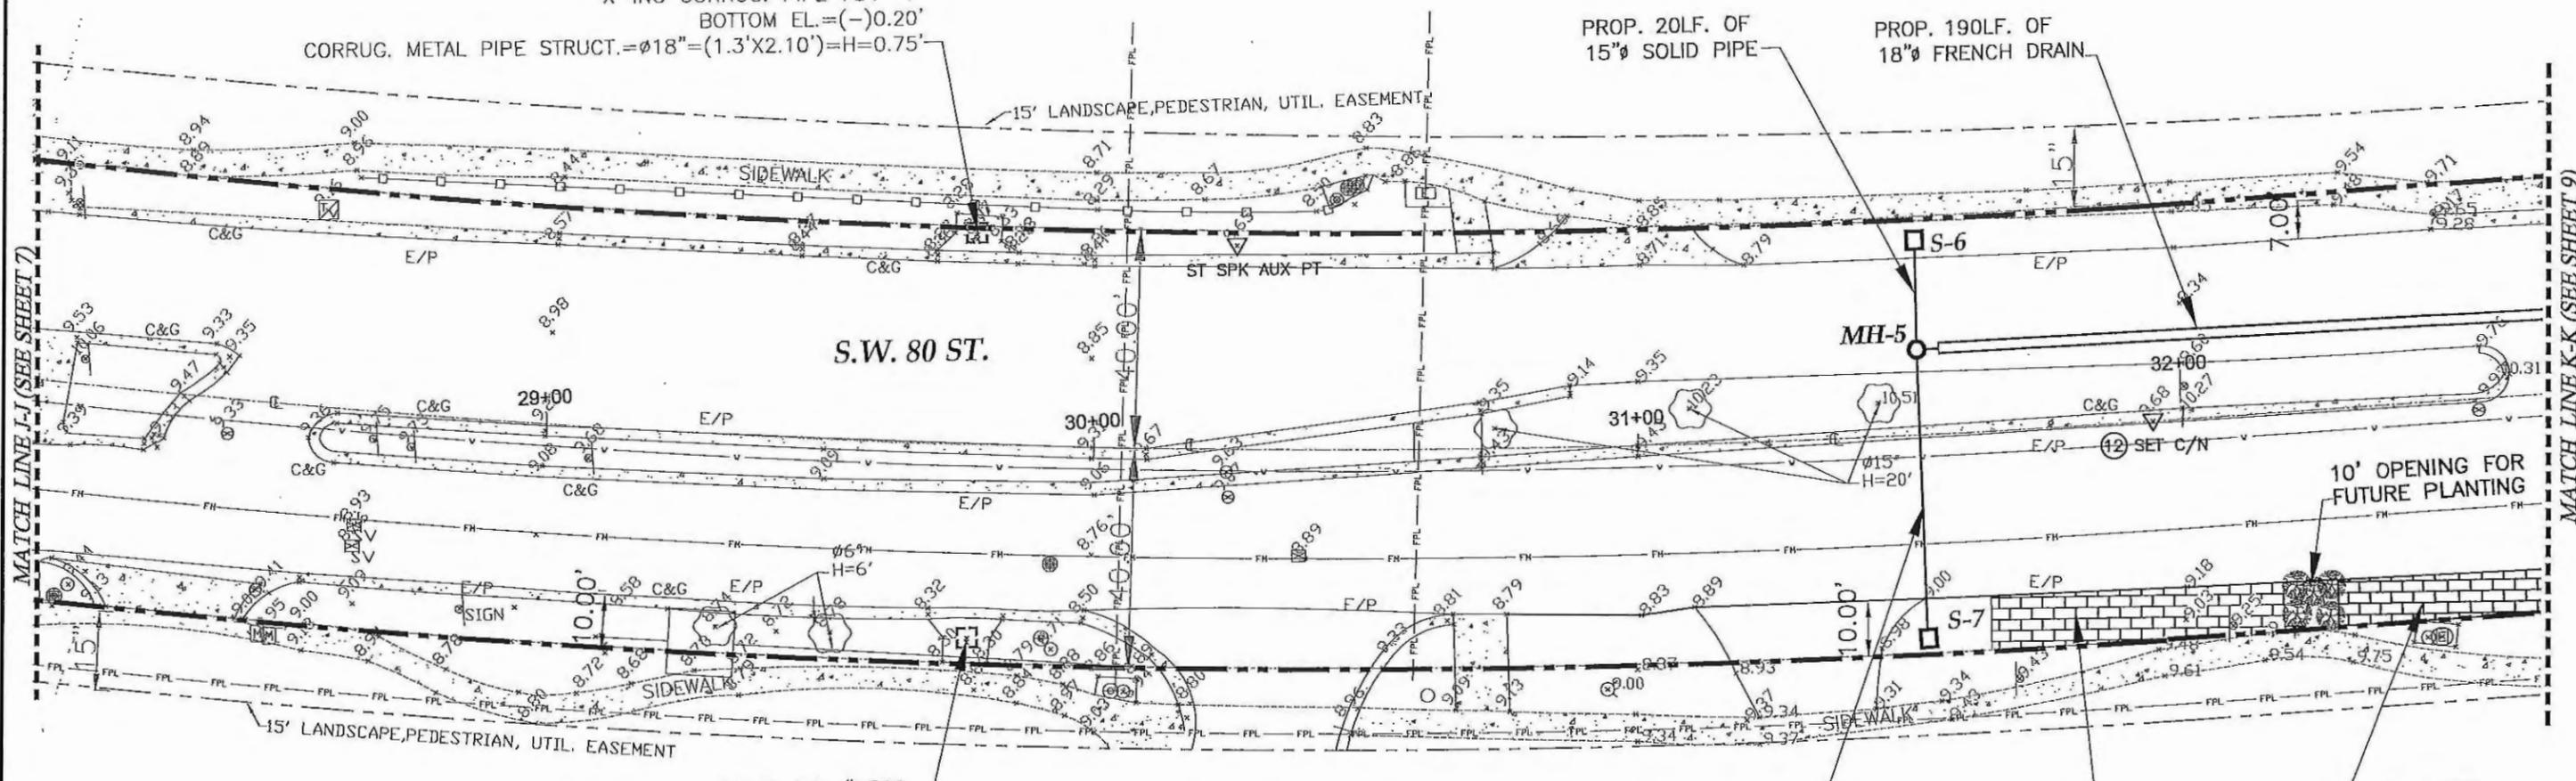


MATCH LINE J-J (SEE SHEET 7)

MATCH LINE K-K (SEE SHEET 9)

EXIST. CB. #2509
RIM EL.=8.08'
BOTTOM EL.=(-)0.25'
CORRUG. METAL PIPE= $\phi 18"=(1.3' \times 2.10')=H=0.75'$

PROP. 55LF. OF
15" ϕ SOLID PIPE
(CP-6)

10' OPENING FOR
FUTURE PLANTING

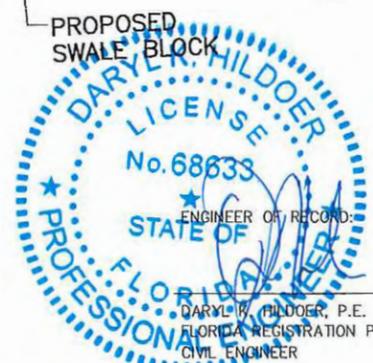

DARYL W. HILDER, P.E.
FLORIDA REGISTRATION P.E. No. 68633
CIVIL ENGINEER

S:\Vector\vertica\SW 80th St. from SW 148th Ave to SW 154th Ave\Plans\SH-04-TD SH-9 DRAINAGE PLAN.dwg Apr 21, 2016 1:54pm SANCHE

REVISIONS					
DATE	BY	DESCRIPTION	DATE	BY	DESCRIPTION


SW 80 ST FROM SW 149 AVE TO SW 154 AVE

DESIGNED BY	NAME	DATE	DRAWN BY	NAME	DATE
LNL	LNL	10-18-15	MCCORM/ALS	MCCORM/ALS	4-12-16
CHECKED BY	LNL		CHECKED BY	F.C.	
SUPERVISED BY:					

DEPARTMENT OF TRANSPORTATION AND PUBLIC WORKS
ROADWAY ENGINEERING AND RIGHT-OF-WAY DIVISION
STEPHEN R. CLARK CENTER
111 NW 1 ST
MIAMI, FLORIDA 33128

MIAMI-DADE COUNTY

DRAINAGE PLAN

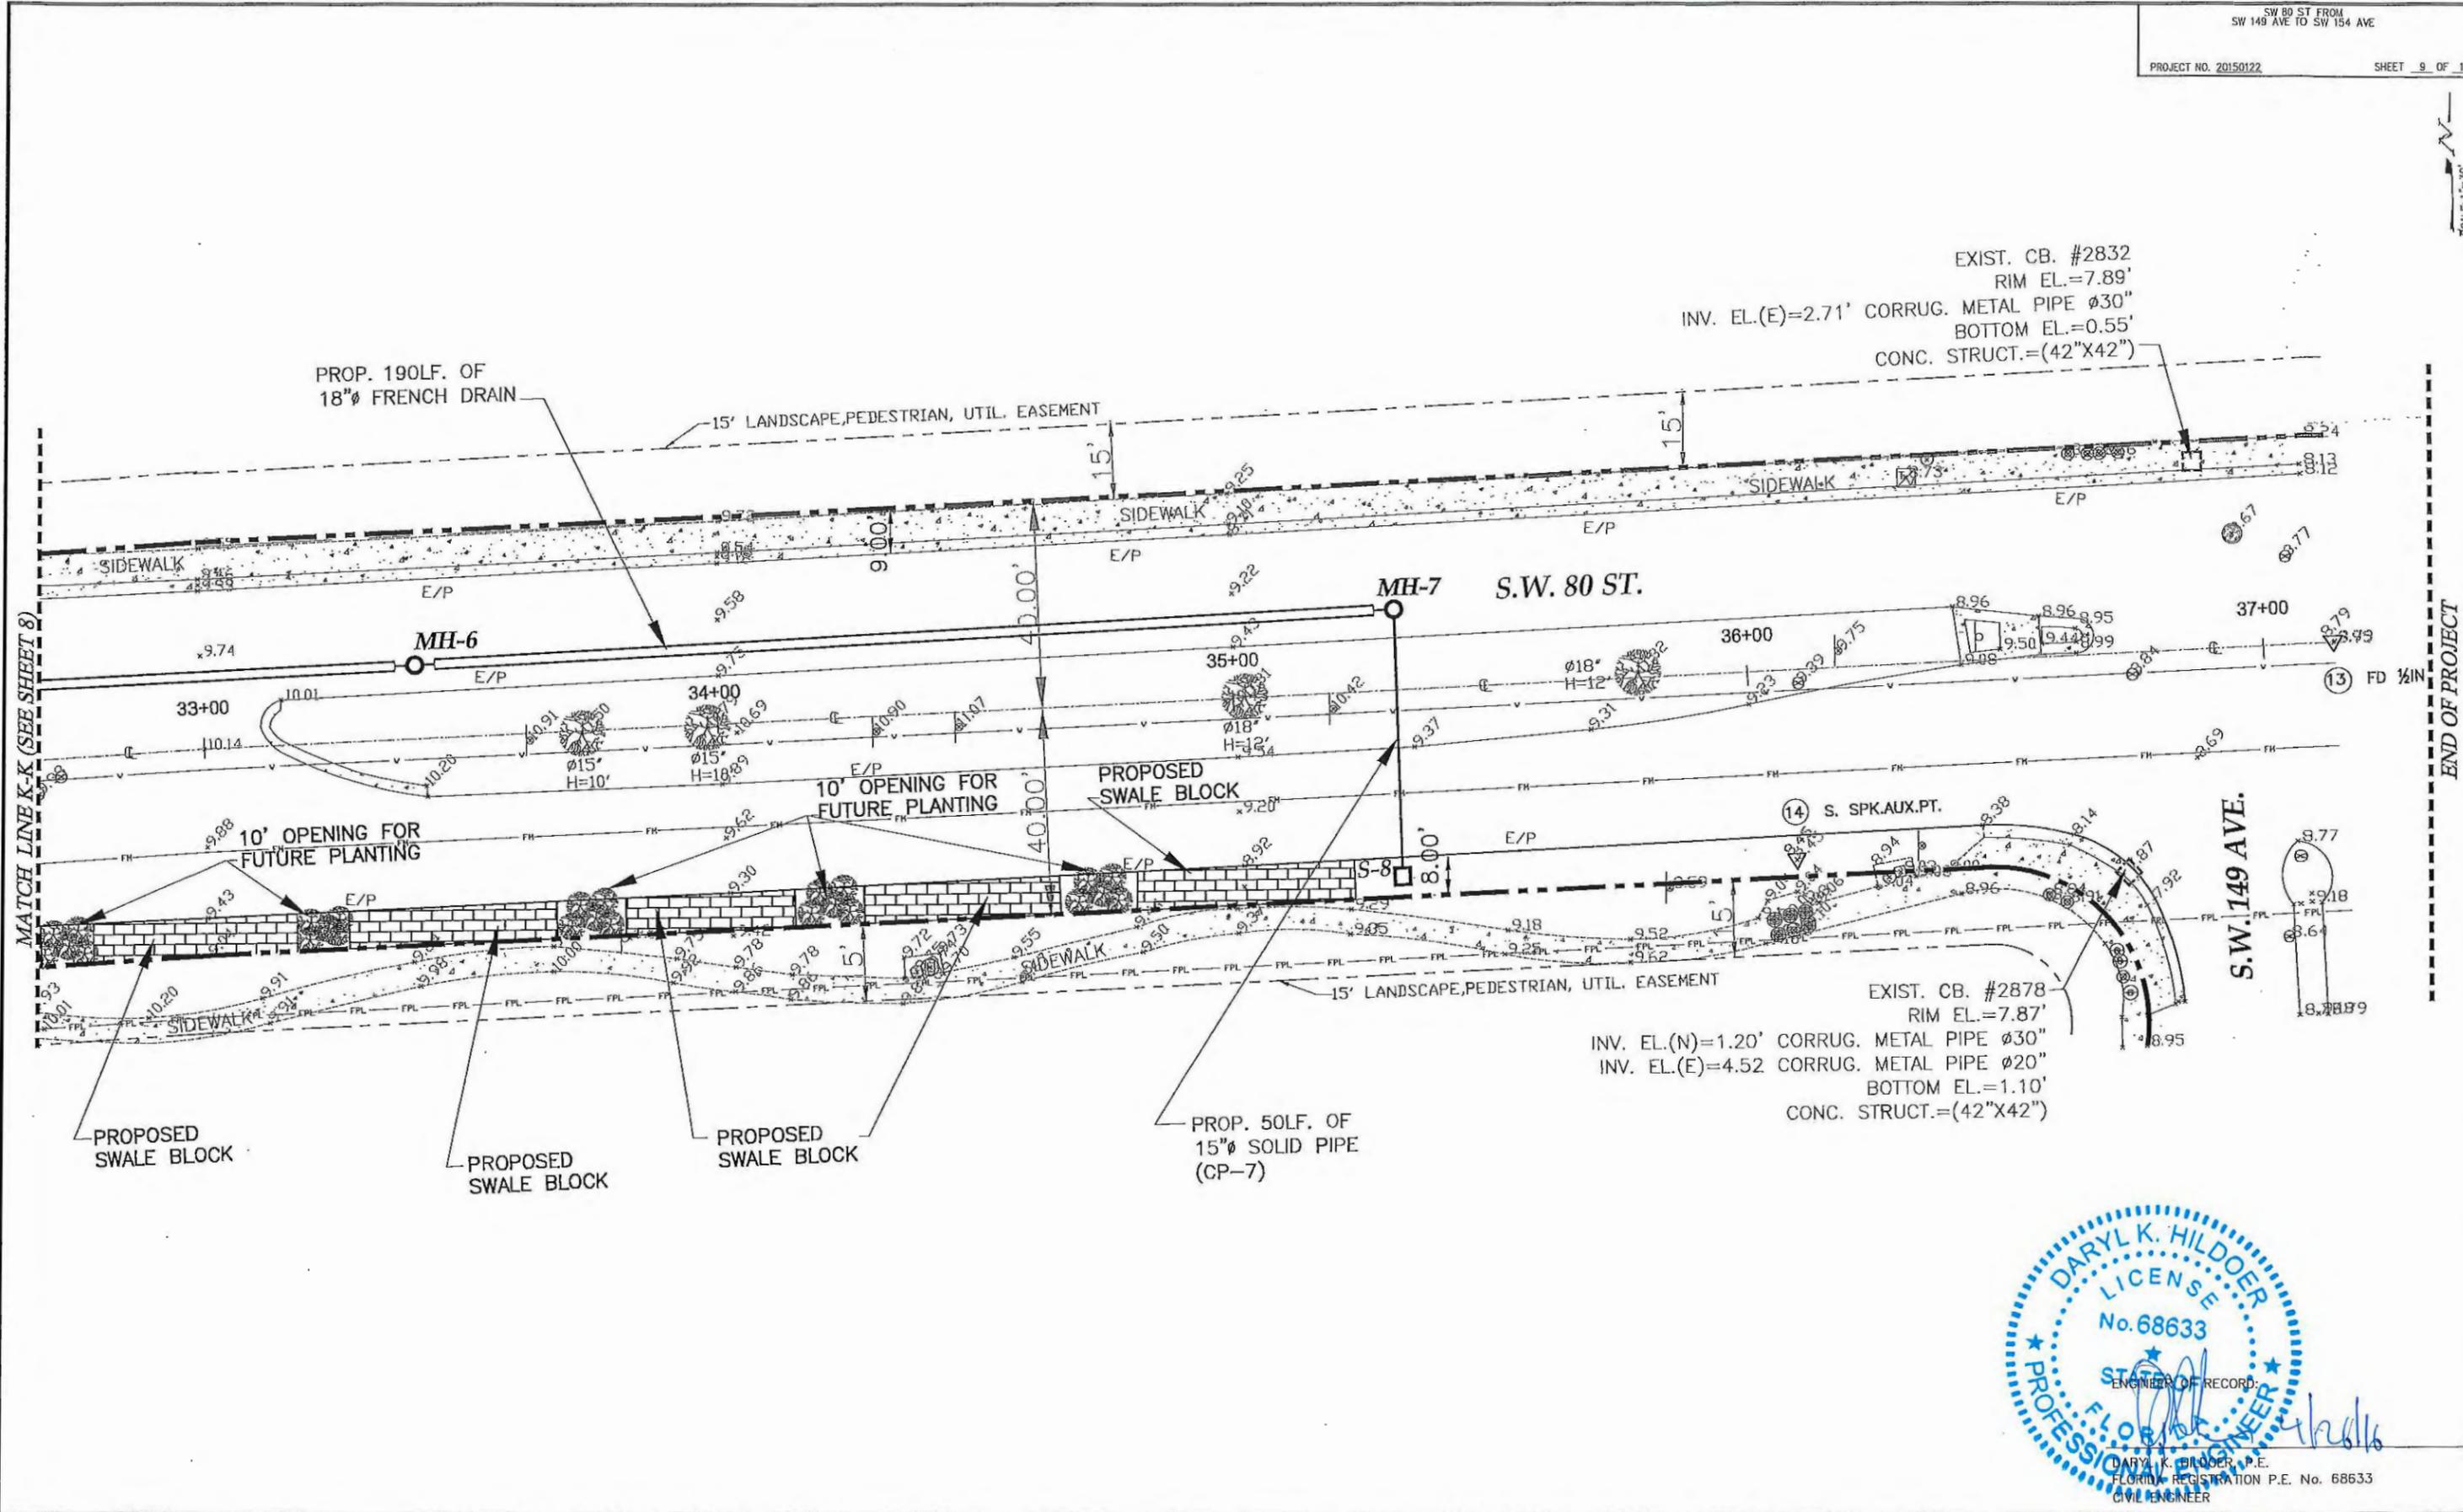

S:\vector\metra\SW 80th St from sw 149th Ave to SW154th Ave\Plans\SH-9 DRAINAGE PLAN.dwg Apr 21, 2016 - 1:54pm SANCOH

REVISIONS

DATE	BY	DESCRIPTION	DATE	BY	DESCRIPTION


SW 80 ST FROM SW 149 AVE TO SW 154 AVE

DESIGNED BY	NAME	DATE	DRAWN BY	NAME	DATE

DEPARTMENT OF TRANSPORTATION AND PUBLIC WORKS
ROADWAY ENGINEERING AND RIGHT-OF-WAY DIVISION
STEPHEN P. CLARK CENTER
111 NW 1 ST
MIAMI, FLORIDA 33128

MIAMI-DADE COUNTY

DRAINAGE PLAN

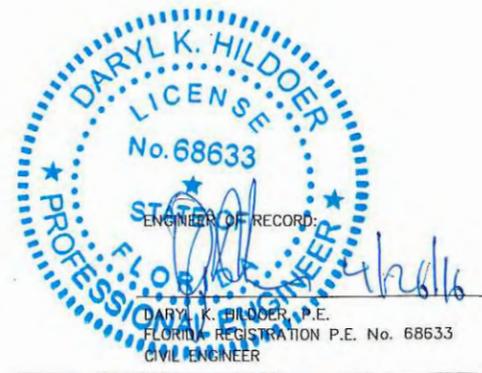

PROPOSED DRAINAGE STRUCTURE SCHEDULE

Structure	Station	Type of Structure	Inside Dimension	Rim Elevations	Bottom Elevations	Pipe Invert Elevation			
						N	S	E	W
MH-1	10+50 (25.0' RT)	P-7T	42"x 42"	9.75	3.10		6.00	5.70	
S-1	10+70 (40.0' RT)	D-3	36" φ	9.25	4.00	6.00			
MH-2	12+40 (25.0' LT)	P-7T	42"x 42"	9.10	1.55	3.55	5.40		5.70
S-2	12+45 (35.0' RT)	D-1	17" x 27"	8.65	1.55		3.55		
S-3	12+45 (45' RT)	D-1	17" x 27"	8.65	3.40	5.40			
MH-3	14+150 (25' RT)	P-7T	42"x 42"	8.35	2.55	4.55 Existing		4.75	
MH-4	16+80 (25' RT)	P-7T	42"x 42"	9.65	-1.05	0.95	4.25		4.75
S-4	12+35 (35' RT)	D-3	36" φ	9.05	-1.05		0.95		
S-5	16+80 (30' RT)	D-1	17" x 27"	8.85	2.25	4.25			
MH-5	31+55 (15' LT)	P-7T	42"x 42"	9.40	1.90	5.40	3.90	5.40	
S-6	31+55 (35' LT)	D-3	36" φ	8.65	3.40		5.40		
S-7	31+55 (35' RT)	D-3	36" φ	8.75	1.90	3.90			
MH-6	33+40 (15' LT)	P-7T	42"x 42"	9.80	3.20			5.20	5.40
MH-7	35+30 (15' LT)	P-7T	42"x 42"	9.20	1.25		3.25		5.20
S-8	35+30 (35' RT)	D-3	36" φ	8.55	1.25	3.25			

CONFLICT TABLE

Conflict Point	Drainage		Water		Sewer		Cell (Crown Castle)	
	Invert Elevation	Pipe Dia.	Top of Pipe	Pipe Dia.	Top of Pipe	Pipe Dia.	Top of Pipe	Pipe Dia.
CP-1	+6.00	15"			+3.41	8"		
CP-2	+3.55	15"	+6.33	12"	A'+5.95	8"	A'+6.85	6"
CP-3	5.40	15"			+3.40	8"		
CP-4	+0.95	15"	+5.15	12"	+3.35	8"	A'+7.20	6"
CP-5	+4.25	15"			A'+6.65	8"		
CP-6	+3.90	15"	+9.00	12"	A'+6.30	10"		
CP-7	+3.25	15"	A'+6.00	12"	A'+6.90	10"		

Elevations of pipes were not provided by the Utility Company, therefore, standard cover was assumed.

Assumed top and pipe diameter are preceded by an "A".

Elevations on table are in NGVD.



S:\ncor\weta\SW 80th St from sw 149th Ave to SW154th Ave\Plans\SH-10-SH-11 PROPOSED DRAINAGE STRUCTURES.dwg Apr 21, 2016 - 4:41pm SANGHI

REVISIONS					
DATE	BY	DESCRIPTION	DATE	BY	DESCRIPTION

S.W. 80 ST FROM
SW 149 AVE. TO SW154 AVE.

DESIGNED BY	NAME	DATE	DRAWN BY	NAME	DATE



DEPARTMENT OF TRANSPORTATION
AND PUBLIC WORKS
ROADWAY ENGINEERING AND
RIGHT OF WAY DIVISION
STEPHEN P. CLARK COVER
111 NW 1 ST
MIAMI, FLORIDA 33128

PROPOSED DRAINAGE STRUCTURE,
CONFLICT, AND SUMMARY OF QUANTITIES
TABLES


Summary of Quantities			
Item No.	Description	Unit	Total Quantity
102-71-12	Temporary Barrier Wall (Furnish & Install) (Water filled)	L.F.	50
102-74-1	Barricades (Temporary - Types I, II, VP and Drum)	E.A./DAY	7,200
102-74-2	Barricades (Temporary, Type III, 6')	E.A./DAY	4,800
102-76A	Advance Warning Arrow Panel	E.A./DAY	530
102-77	High intensity flashing (Temporary, Type "B")	E.A./DAY	240
102-91-1A	Pavement marking temporary (Solid) (Any width) (Yellow or White) (Paint)	L.F.	900
102-99	Variable message sign (temporary)	E.A./DAY	40
104-10-3	Sediment Barrier	L.F.	400
104-18	Inlet Protection System	E.A.	19
121-70-2	Flowable Fill	C.Y.	15
327-70-01	Milling Existing Asphalt Pavement (up to 5,000 square yards) (1" average depth)	S.Y.	545
331-72-10A-HMA	Roadway Pavement Restoration (Replace and match existing base thickness and asphalt course with 8" minimum, primed Limerock Base and 1" thick of HMA, Asphalt Work Category 3)	S.Y.	773
331-72-10B-HMA	Inlet Pavement (Includes 6" Limerock Base and 1" thick of HMA, Asphalt Work Category 2)	S.Y.	90
334-2-13-1	Hot Mix Asphalt, Traffic C, SP-9.5	TN.	150
400-1-15	Class I Concrete [(Miscellaneous) (Trench build-up, collars, pipe plugs, structure plugs etc.) (This item is contingent upon field conditions and may increased decreased or eliminated by the Engineer)]	C.Y.	3
425-1-1	Swale Inlet Type D-3 (36" Dia.) (Less than 10 feet deep)	E.A.	5
425-1-2B	Swale inlet Type D-1 (17"x27") (< 10' deep)	E.A.	3
425-2-41	Manhole Type P-7T (Any dimension) (Max. 15' Deep)	E.A.	7
425-82	Modify Structure-Cut to enlarge opening as needed in order to accommodate pipe due to utility conflict(s), brick and mortar as needed	E.A.	8
430-94-1-1	Desilting Pipe, 0 - 48"	L.F.	620
430-95-2	Desilting Drainage Structure	E.A.	11
430-171-115	Pipe Culvert - 15" Diameter	L.F.	365
443-70-3-3	French Drain (18" diameter pipe, trench depth 15 ft bls)	L.F.	830
520-1-10	Concrete Curb and Gutter (Type F) (6" Curb, 18" Gutter) (Includes cost of limerock base and subgrade)	L.F.	180
522-1(1)	Concrete Sidewalk (4" thick)(Class I concrete, 3000 P.S.I.)(Including pedestrian ramps and sidewalk curbs)	S.Y.	160
526-70-2C	Swale Blocks(Include excavation, saw cut edge of pavement, curb border, base & subbase preparation, and aggregates)	S.Y.	1,111
575-2A	Sodding	S.Y.	1,233
706-1-12	Reflective Pavement Markers (class B, mono or bi-directional , all colors)	E.A.	60
711-11-121	Thermoplastic (White) (Solid) (6")	L.F.	300
711-11-124	Thermoplastic (White) (Solid) (18")	L.F.	32
711-11-141	Thermoplastic (White) (Skip) (6")	L.F.	340
711-11-170	Thermoplastic (White) (Arrow)	E.A.	2
711-11-221	Thermoplastic (Yellow) (Solid) (6")	L.F.	180

S:\Sector\media\SW 80th St. from sw 149th Ave to SW152th Ave\Plan\SH-10-SH-11 PROPOSED DRAINAGE STRUCTURES.dwg, Apr 21, 2016 - 4:41pm SANCHH


REVISIONS					
DATE	BY	DESCRIPTION	DATE	BY	DESCRIPTION

SW 80 ST. FROM
SW 149 AVE. TO SW 152 AVE


DESIGNED BY	NAME	DATE	DRAWN BY	NAME	DATE
I. ROBERTO	I. ROBERTO	04-08-14	M. CEDRON	M. CEDRON	04-08-14
CHECKED BY	F. GONZALEZ	04-08-14	CHECKED BY	I. ROBERTO	04-08-14





PUBLIC WORKS AND WASTE MANAGEMENT DEPARTMENT
ROADWAY ENGINEERING AND RIGHT OF WAY DIVISION
111 NW 1 ST
MIAMI, FLORIDA 33128

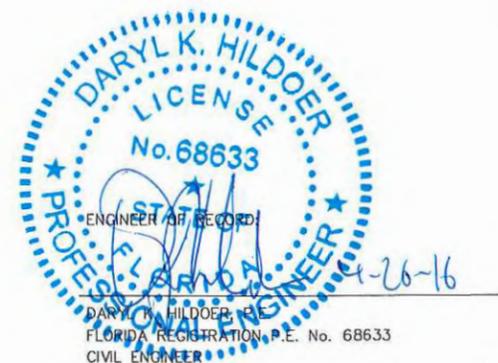

PROPOSED DRAINAGE STRUCTURE TABLE, CONFLICT TABLE AND SUMMARY OF QUANTITIES

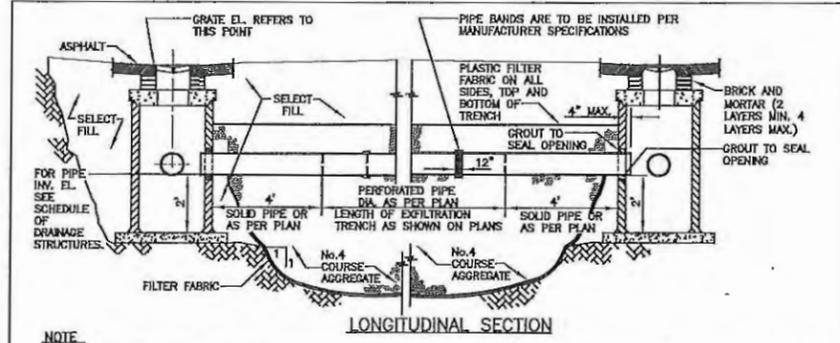

NOTE:
1-AFTER THE COURSE AGGREGATE HAS BEEN PLACED TO THE PROPER ELEVATION IT SHALL BE CAREFULLY WASHED DOWN WITH CLEAN WATER TO ALLOW FOR INITIAL SETTLEMENT THAT MAY OCCUR. IF SETTLEMENT DOES TAKE PLACE, ADDITIONAL No. 4 COURSE AGGREGATE WILL BE ADDED TO RESTORE THE PROPER ELEVATION SO THAT THE EXFILTRATION TRENCH IS COMPLETED IN ACCORDANCE WITH THE DETAILS.
2-REFER TO ROADWAY RESTORATION DETAIL FOR FRENCH DRAIN INSTALLATION UNDER PAVEMENT.

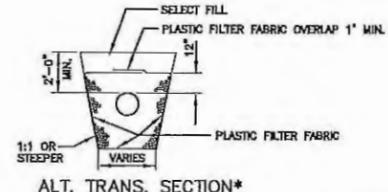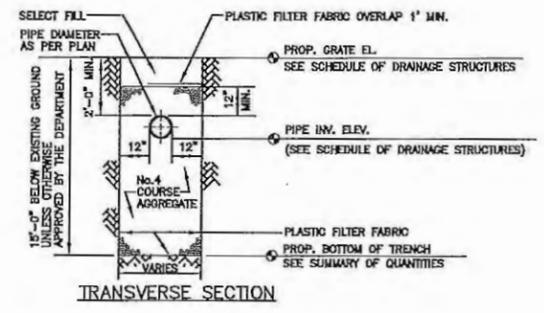

NOTE:
* MAY BE USED IN AREAS WHERE TRENCH WALLS WILL NOT STAND VERTICAL, OR WHERE CAVE-IN BELOW THE WATER TABLE IS LIKELY TO OCCUR. TO BE USED AT THE ENGINEER'S DISCRETION.

MIAMI-DADE COUNTY DEPARTMENT OF TRANSPORTATION AND PUBLIC WORKS ROADWAY ENGINEERING AND RIGHT OF WAY DIVISION	APPROVED	REVISED 2/8/2011	STANDARD STORM DRAINAGE DETAIL EXFILTRATION TRENCH (FRENCH DRAIN)	SD 1.1 SHEET 1 OF 2
---	----------	---------------------	--	---------------------------


GENERAL NOTES FOR PIPE CULVERTS

CONTRACTOR HAS THE OPTION OF INSTALLING ANY PIPE MEETING THE REQUIREMENTS OF SECTION 443-2 OF THE FDOT STANDARD SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION.

PIPE DIAMETER (Inches)	OUTER SHELL	LINER
	No. of 3/8" Dia. Holes (PER LIN. FT. OF PIPE)	No. of 5/8" Dia. Holes (PER LIN. FT. OF PIPE)
15	100	50
18	120	60
24	180	80
30	200	100
36	240	120
42	275	140
48	315	150
54	355	180
60	395	200
72	470	235
84	550	275

NOTE:
PERFORATIONS SHALL BE UNIFORMLY SPACED AROUND THE FULL PERIPHERY OF THE PIPE TO WITHIN 4" OF EACH END OF EACH LENGTH OF PIPE. THE NUMBER OF PERFORATIONS PER LINEAR FOOT OF PIPE AND THE DIAMETER OF THE PERFORATIONS SHALL BE AS SHOWN ON THE ABOVE TABLE.

MIAMI-DADE COUNTY DEPARTMENT OF TRANSPORTATION AND PUBLIC WORKS ROADWAY ENGINEERING AND RIGHT OF WAY DIVISION	APPROVED 5-2-81	REVISED 5-4-88 10-22-13	STANDARD STORM DRAINAGE DETAIL EXFILTRATION TRENCH (PIPE CULVERT NOTES)	SD 1.1 SHEET 2 OF 2
---	--------------------	-------------------------------	--	---------------------------

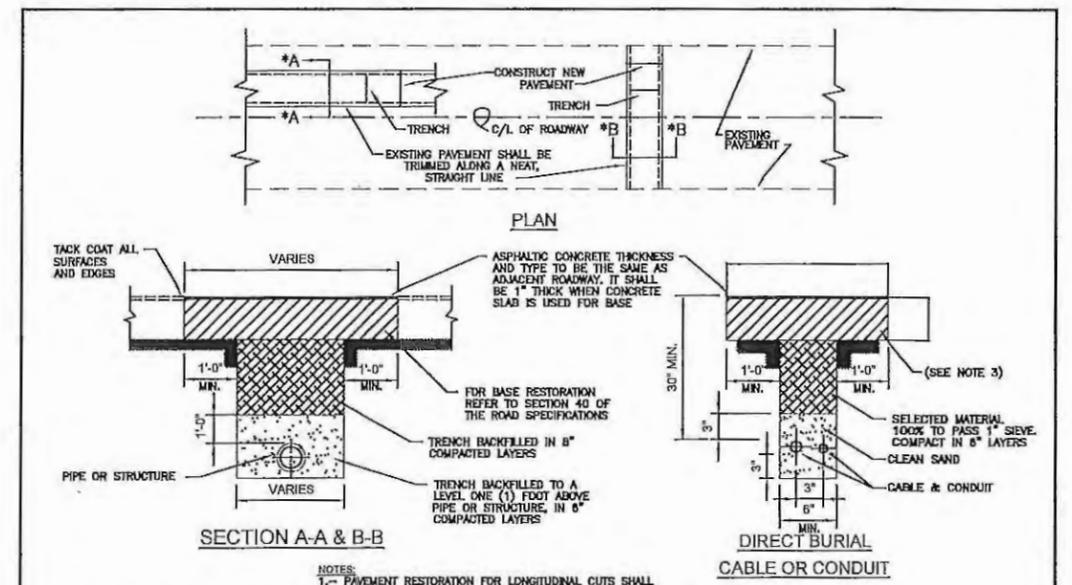

NOTES:
1.- PAVEMENT RESTORATION FOR LONGITUDINAL CUTS SHALL INCLUDE FULL LANE WIDTH RESURFACING FOR EACH LANE WITHIN WHICH THE CUT EXTENDS.
2.- IN SOME CASES IT WILL BE NECESSARY TO OVERLAY MORE THAN ONE (1) LANE WITH ASPHALTIC CONCRETE TO SATISFY PAVEMENT SLOPE.
3.- CONTRACTOR MAY ELECT TO BACKFILL WITH 1:10 SAND-CEMENT MIX.


MIAMI-DADE COUNTY DEPARTMENT OF TRANSPORTATION AND PUBLIC WORKS ROADWAY ENGINEERING AND RIGHT OF WAY DIVISION	APPROVED 8/5/81	REVISED 7/14/80 8/4/85 10/9/2012	STANDARD ROAD DETAIL PAVEMENT RESTORATION FOR TRENCHES CUT IN PUBLIC RIGHTS-OF-WAY	R 21.1 SHEET 1 OF 3
---	--------------------	---	---	---------------------------

S:\vector\wells\SW 80th St. from SW 149th Ave to SW 154th Ave\Plans\SH-12-13-14 STANDARD DETAILS.dwg Apr 21, 2016 1:37pm SANCHI


REVISIONS					
DATE	BY	DESCRIPTION	DATE	BY	DESCRIPTION

SW 80 ST. FROM
SW 149 AVE. TO SW 154 AVE.



DESIGNED BY L. NEVLAND 02-22-16	DATE 02-22-16	DRAWN BY M. CEDRONI/H.S. 03-25-16	DATE 03-25-16
CHECKED BY F. GONZALEZ	DATE 02-22-16	CHECKED BY	DATE
SUPERVISED BY:			



DEPARTMENT OF TRANSPORTATION AND PUBLIC WORKS
ROADWAY ENGINEERING AND RIGHT OF WAY DIVISION
STEPHEN P. CLARK CENTER
111 NW 1 ST
MIAMI, FLORIDA 33128

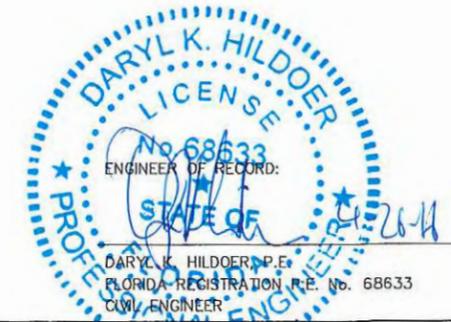

STANDARD DETAILS

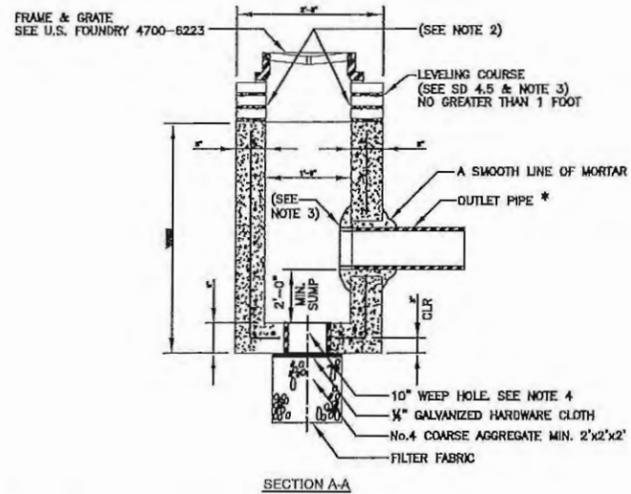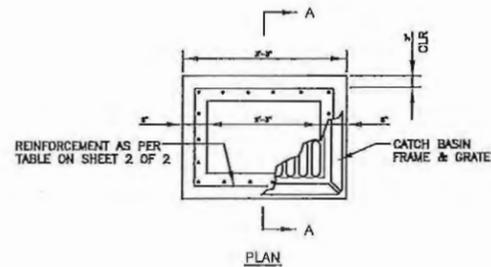


- NOTES:
- 1.-PIPES MAY EXTEND INTO CATCH BASIN A MAXIMUM OF 4".
 - 2.-USE 3,000 psi CONCRETE. (MINIMUM)
 - 3.-A SMOOTH LINE OF MORTAR 1/2" THICK INSIDE AND OUTSIDE.
 - 4.-WEEP HOLES ARE TO BE USED WHEN THE AVERAGE LOW WATER ELEVATION IS BELOW BOTTOM OF STRUCTURE
 - 5.-THIS STRUCTURE IS ONLY TO BE USED WHERE UTILITY CONFLICTS DO NOT ALLOW FOR INSTALLATION OF STANDARD STRUCTURES. THE INSTALLATION OF THIS STRUCTURE MUST BE APPROVED BY THE DEPARTMENT.

MIAMI-DADE COUNTY DEPARTMENT OF TRANSPORTATION AND PUBLIC WORKS ROADWAY ENGINEERING AND RIGHT OF WAY DIVISION	APPROVED	REVISED 9/27/12 5/7/12	STANDARD STORM DRAINAGE DETAIL SWALE INLET (TYPE D-1)	SD 3.1 SHEET 1 OF 1
---	----------	------------------------------	---	---------------------------

SQUARE BOX


Standard	Width (ft)	Length (ft)	Height (ft)	Wall Thickness (in)	Wall Steel	Top Slab Thickness (in)	Top Slab Steel	Bottom Slab Thickness (in)	Bottom Slab Steel	Bottom Slab Overhang
3.1	1.5	2.5	0-5.0	6"	#4010" H #4010" V	N/A	N/A	6"	#4012" EW	6"
3.1	1.5	2.5	5.1-10.0	6"	#4010" H #4010" V	N/A	N/A	6"	#4012" EW	N/A
3.1	1.5	2.5	10.1-15.0	6"	#406" H #4010" V		N/A	5"	#4012" EW	N/A

MIAMI-DADE COUNTY DEPARTMENT OF TRANSPORTATION AND PUBLIC WORKS ROADWAY ENGINEERING AND RIGHT OF WAY DIVISION	APPROVED	REVISED 10/11/2012 5/7/12	STANDARD STORM DRAINAGE DETAIL SWALE INLET (TYPE D-1)	SD 3.1 SHEET 2 OF 2
---	----------	---------------------------------	---	---------------------------

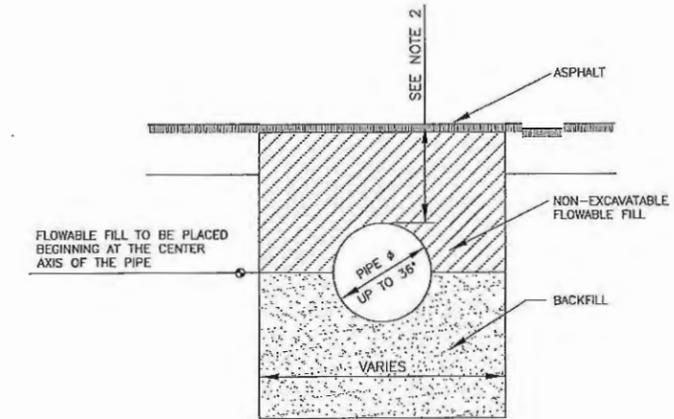

- NOTES:
- 1.-FOR USE IN AREAS, APPROVED BY THE ENGINEER, WHERE MINIMUM COVER OVER THE PIPE IS LESS THAN 2 FT. BUT NO LESS THAN 1 FT.
 - 2.-1 FT. MINIMUM COVER OVER THE PIPE INCLUDING UP TO 2" OF ASPHALT.
 - 3.-USE NON-EXCAVATABLE FLOWABLE FILL WITH A MINIMUM 28-DAYS COMPRESSIVE STRENGTH OF 3000 PSI PER SECTION 121-3 OF THE FDOT STANDARD SPECIFICATION FOR ROAD AND BRIDGE DESIGN.

MIAMI-DADE COUNTY DEPARTMENT OF TRANSPORTATION AND PUBLIC WORKS ROADWAY ENGINEERING AND RIGHT OF WAY DIVISION	APPROVED	REVISED 9-27-12	STANDARD STORM DRAINAGE DETAIL NON-EXCAVATABLE FLOWABLE FILL DETAIL	SD 0.0 SHEET 1 OF 1
---	----------	--------------------	--	---------------------------

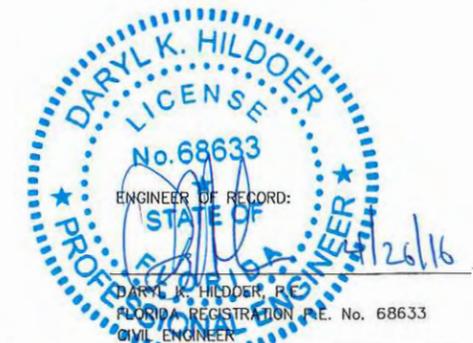

S:\Vector\herte\SW 80th St. from SW 149th Ave to SW 154th Ave\Plans\SH-12-13-14 STANDARD DETAILS.dwg Apr 21, 2016 1:36pm SANCHH

REVISIONS

DATE	BY	DESCRIPTION	DATE	BY	DESCRIPTION

SW 80 ST. FROM SW 149 AVE. TO SW. 154 AVE.


NAME	DATE	NAME	DATE
DESIGNED BY L. HEWLAND	03-25-16	DRAWN BY M. CEDRON/ALS	03-25-16
CHECKED BY F. GONZALEZ		CHECKED BY	
SUPERVISED BY			



DEPARTMENT OF TRANSPORTATION AND PUBLIC WORKS
ROADWAY ENGINEERING AND RIGHT OF WAY DIVISION
STEPHEN P. CLARK CENTER
111 NW 1 ST
MIAMI, FLORIDA 33128

STANDARD DETAILS

PAVE DRAIN CROSS SECTION

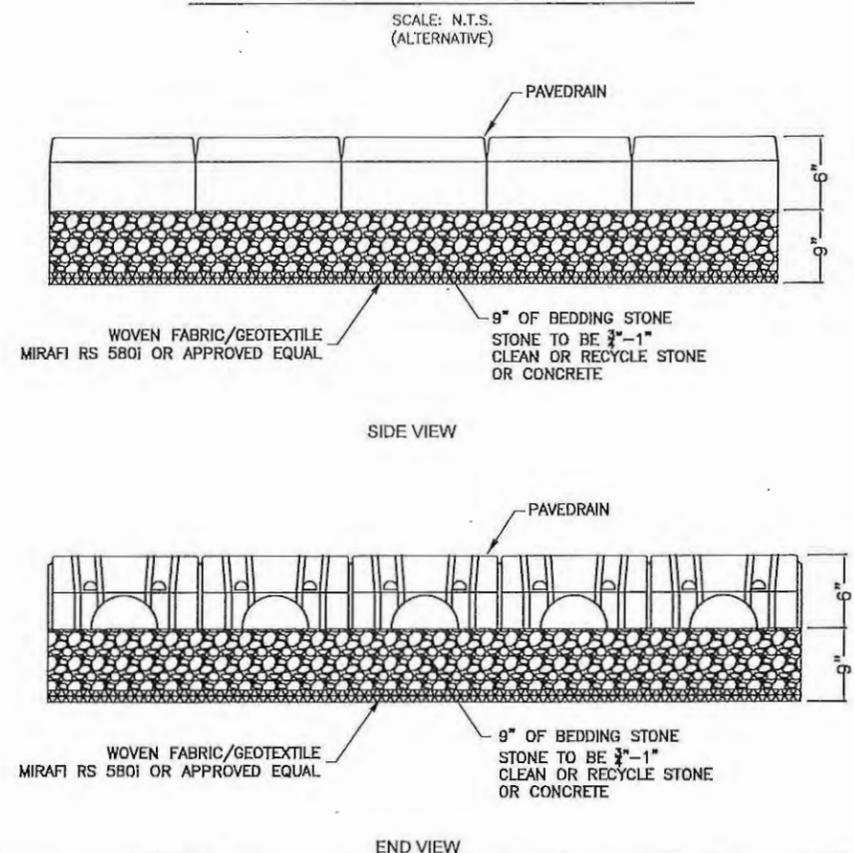

SWALE BLOCK

DESCRIPTION: Construction of Concrete Swale Block lattice type in swales and other locations as shown in the plans or as directed by the engineer.

MATERIALS.

- Concrete Block:** Use block approximately 3 1/8" in depth. The minimum required thickness of the web between the openings is 1". The percent of open area shall range between 30% and 50%. The block shall have an average compressive strength of 5,000psi and no individual unit compressive strength of less than 4,500psi.
- Block Opening Filler:** Swale block openings shall be filled with No. 8 coarse aggregate that meets the requirements of Section 901-1.4 of the Florida Department of Transportation Standard Specifications for Road and Bridge Construction 2004.
- Leveling Course:** Shall be No. 8 coarse aggregate. It shall meet the requirements of Section 901-1.4 of the Florida Department of Transportation Standard Specifications for Road and Bridge Construction 2004.
- Base Course:** Shall be No. 5 coarse aggregate. It shall meet the requirements of Section 901-1.4 of the Florida Department of Transportation Standard Specifications for Road and Bridge Construction 2004.
- Curb Border:** Use Class I concrete meeting the requirements of Section 347 of the Florida Department of Transportation Standard Specifications for Road and Bridge Construction 2004.

PLACEMENT.

- Base course:** Place a 9" layer of No. 5 coarse aggregate on firm and unyielding sub-grade and level surface layer to a uniform plane.
- Leveling Course:** Place a 3" layer of No. 8 coarse aggregate over the base course. Vibrate layer to a uniform plane surface with a low amplitude plate compactor.
- Block:** Hand place and interlock each concrete block in place to prevent excessive movement. Firmly seat each block on the leveling course so it is in contact over its entire area to prevent stress due to uneven placement. Vibrate blocks with a low amplitude plate compactor fitted with either a rubber or a neoprene mat.
- Block Opening Filler:** Fill swale concrete block openings with No. 8 coarse aggregate.
- Curb Border:** it shall comply with Section 520 of the Florida Department of Transportation Standard Specifications for Road and Bridge Construction 2004.


METHOD OF MEASUREMENT: This item will be paid for by area in square yard of swale block, completed and accepted.

BASIS OF PAYMENT: Prices and payments will be full compensation for all labor, materials and equipment necessary to install the swale blocks as specified in this Section, including excavation and disposal of excavated material.

Block: Price and payment will be full compensation for furnishing and installing the swale blocks and all labor, materials and equipment necessary for placement of the block including but not limited to excavation and disposal of excavated material, compacting the sub-grade to a firm unyielding surface, furnishing and installing the base course materials, furnishing and installing the leveling course and fill the fill block-fill cells with the leveling course material and all material, labor and equipment to saw cut the pavement, and all labor, materials and equipment necessary for construction and placement of the curb border block including but not limited to excavation and disposal of excavated.

Payment shall be made under:
Item No. 526-70-2C Swale Block – per square yard.

SWALE BLOCK DETAIL

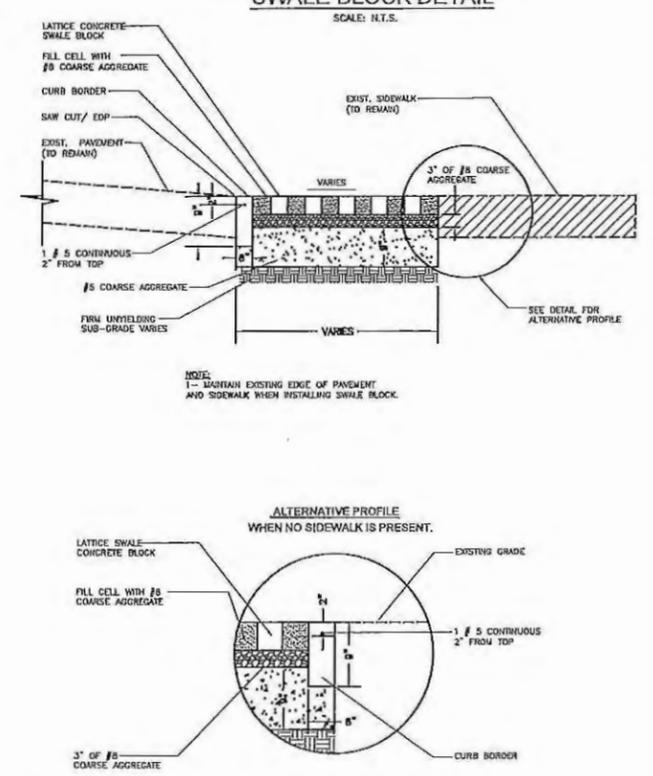


REVISIONS

DATE	BY	DESCRIPTION	DATE	BY	DESCRIPTION	DATE	BY	DESCRIPTION

SW 80 ST. FROM SW 149 AVE. TO SW 154 AVE.

NAME	DATE	NAME	DATE
DESIGNED BY: I. HEWLAND	03-25-16	DRAWN BY: M. CEDRON/ALS	03-25-16
CHECKED BY: F. GONZALEZ		CHECKED BY:	
SUPERVISED BY:			




DEPARTMENT OF TRANSPORTATION AND PUBLIC WORKS
ROADWAY CONSTRUCTION AND RIGHT OF WAY DIVISION
STEPHEN P. CLARK, CHIEF
101 001 ST
MIAMI, FLORIDA 33128


STANDARD DETAILS



S:\Hector\yvelte\SW 80th St from SW 149th Ave to SW 154th Ave\Plans\SH-12-13-14 STANDARD DETAILS.dwg Apr 21, 2016 - 1:39pm SANHH

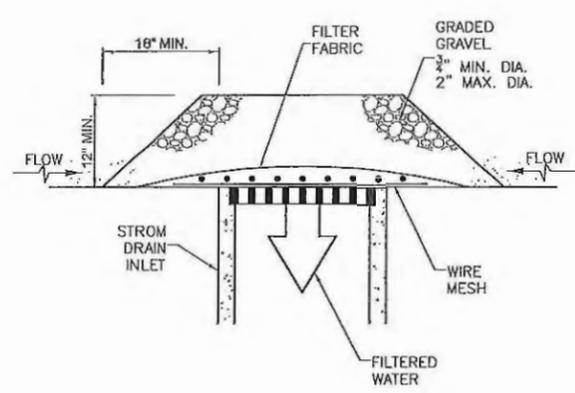

DROP INLET PROTECTION-GRAVEL

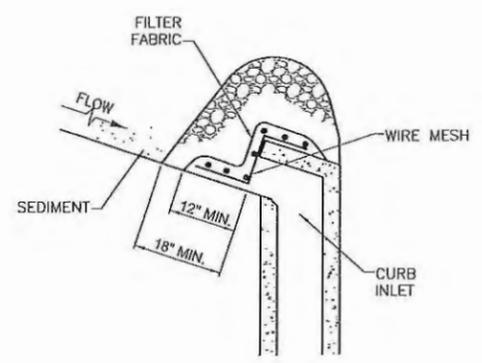

CURB INLET PROTECTION-GRAVEL

GRAVEL APPLICATIONS (TYP.) OR APPROVED ALTERNATIVE

NOTES FOR INLET PROTECTION GRAVEL:

1- INSTALLATION/APPLICATION CRITERIA:


- PLACE WIRE MESH (WITH 1/2 INCH OPENINGS) OVER THE INLET GRATE EXTENDING ONE FOOT PAST THE GRATE IN ALL DIRECTIONS.
- PLACE FILTER FABRIC OVER THE MESH. FILTER FABRIC SHOULD BE SELECTED BASED ON SOIL TYPE.
- PLACE GRADED GRAVEL, TO A MINIMUM DEPTH OF 12 INCHES, OVER THE FILTER FABRIC AND EXTENDING 18 INCHES PAST THE GRATE IN ALL DIRECTIONS.

2- MAINTENANCE:


- INSPECT INLET PROTECTION AFTER EVERY LARGE STORM EVENT AND AT A MINIMUM OF ONCE MONTHLY.
- REMOVE SEDIMENT ACCUMULATED WHEN IT REACHES 4 INCHES IN DEPTH.
- REPLACE FILTER FABRIC AND CLEAN OR REPLACE GRAVEL IF CLOGGING IS APPARENT.

3- LIMITATIONS:


- RECOMMENDED FOR MAXIMUM DRAINAGE AREA OF ONE ACRE.
- EXCESS FLOWS MAY BYPASS THE INLET REQUIRING DOWN GRADIENT CONTROLS.
- PONDING WILL OCCUR AT INLET.

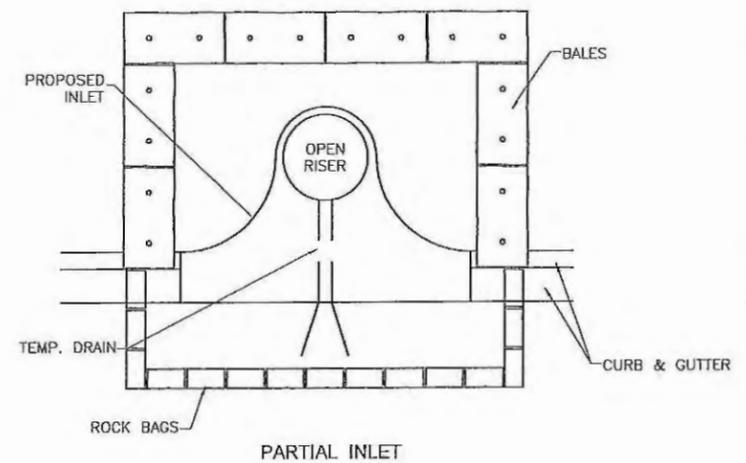


PARTIAL INLET

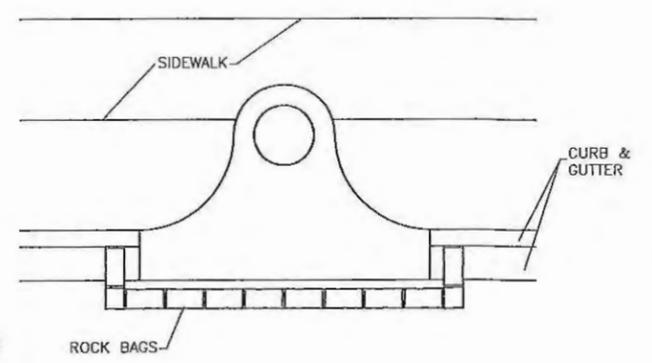

COMPLETED INLET

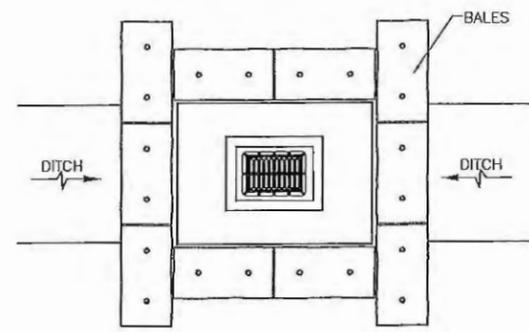

DITCH BOTTOM INLET




SWALE INLET

PROTECTION ALONG INLETS WITH ROCK BAGS BALES OR APPROVED ALTERNATIVES

NOTES FOR SYNTHETIC BALES OR BALE TYPE BARRIERS:

- 1- TYPE I AND II SYNTHETIC BARRIER SHOULD BE SPACED IN ACCORDANCE WITH CHART 1, SHEET 1 OF 2010 FDOT DESIGN STANDARDS INDEX 102.
- 2- BALES SHALL BE ANCHORED WITH TWO (2) 1"x2" (or 1" dia.) x 4' WOOD STAKES. STAKES OF OTHER MATERIAL OR SHAPE PROVIDING EQUIVALENT STRENGTH MAY BE USED IF APPROVED BY THE ENGINEER. STAKES OTHER THAN WOOD SHALL BE REMOVED UPON COMPLETION OF THE PROJECT.
- 3- RAILS AND POSTS SHALL BE 2"x4" WOOD. OTHER MATERIALS PROVIDING EQUIVALENT STRENGTH MAYBE USED IF APPROVED BY THE ENGINEER.
- 4- ADJACENT BALES SHALL BE BUTTED FIRMLY TOGETHER.
- 5- WHERE USED IN CONJUNCTION WITH SILT FENCE, BALES SHALL BE PLACED ON THE UPSTREAM SIDE OF THE FENCE.

INLET PROTECTION SYSTEM (TYP.) OR APPROVED ALTERNATIVE

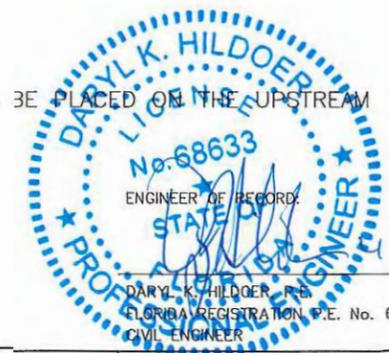

S:\Sector\media\SW 80th St. from SW 149th Ave to SW 154th Ave\Plans\SI-15 INLET PROTECTION.dwg Apr 21, 2016 - 1:40pm SANDHI

REVISIONS					
DATE	BY	DESCRIPTION	DATE	BY	DESCRIPTION

SW 80 ST. FROM SW 149 AVE. TO SW 154 AVE.

NAME	DATE	NAME	DATE
DESIGNED BY: I. NEWLAND	03-25-16	DRAWN BY: M. CEDRONI/S.S.	03-25-16
CHECKED BY: F. GONZALEZ		CHECKED BY:	
SUPERVISED BY:			



DEPARTMENT OF TRANSPORTATION AND PUBLIC WORKS
ROADWAY ENGINEERING AND RIGHT OF WAY DIVISION
STEPHEN R. CLARK CENTER
111 NW 1 ST.
MIAMI, FLORIDA 33128

INLET PROTECTION SYSTEMS DETAILS

STORMWATER POLLUTION PREVENTION PLAN

Narrative Description

The Stormwater Pollution Prevention Plan (SWPPP) Narrative Description contains references to the Contract Documents, the State of Florida Erosion and Sediment Control Designer and Reviewer Manual (E&S Manual), the FDOT Design Standards, and other sheets of these Construction Plans. The complete SWPPP is comprised of several items including: this narrative description, the documents referenced in this narrative, the Contractor's approved Erosion Control (ECP) prepared and submitted in accordance with the Contract Documents, and reports of inspections made during construction. All of which are complementary to the signed and certified SWPPP if one is provided by the Department. Contractor is required to maintain copies of the aforementioned items on site, including all applicable permits.

1. Site Description

- a. Nature of Construction Activities: The project consists of retrofitting of drainage infrastructure to residential area.
- b. Sequence of Major Soil Disturbing Activities: The Contractor shall provide in the ECP a detailed sequence of construction for all construction activities. Each construction phase requires the installation of perimeter control, after clearing and grubbing as necessary for the installation of the controls, prior to beginning any work. The Contractor shall follow the sequence of major activities below, unless the Contractor proposes a different sequence that is equal or better at controlling erosion and trapping sediment and is approved by the Engineer.
 - 1) Clearing and grubbing, earthwork, drainage improvements construction.
 - 2) Final grading and landscaping where necessary.
- c. Area Estimates (Acre)
 - 1) Total Site Area: 8.06 A.C.
 - 2) Total Area of the site that is expected to be disturbed: 0.53 A.C.
- d. Existing data describing the soil or the quality of any discharge from the site and an estimate of the size of the drainage area for each discharge point:
 - 1) Rational runoff coefficient
 - a) Before: 0.61
 - b) During: 0.64
 - c) After construction: 0.61
 - 2) Existing data describing the soil or the quality of discharge from the site: According to the United States Department of Agriculture Natural Resources Conservation Service Soil Survey Report of Dade County Area, Florida, the soil encountered on the project are Urban Land Udothents Association Soil, which are categorized as moderately well drained.
 - 3) The size of the drainage area for each outfall: N/A. This project has no outfall.
 - 4) The location of each outfall is provided in item 1.f. below. N/A. This project has no outfall.
- e. Site Map: The associated construction plan sheets will be used as the site map. Locations of the required information are described below. The sheet numbers for all items discussed are identified on the Cover Sheet of the construction plans.
 - 1) Drainage patterns and approximate slopes anticipated after major grading activities: The slopes of the site can be seen on the construction plan sheets.
 - 2) Areas of Soil Disturbance: The areas to be disturbed are indicated on the construction plan sheets. Any areas where permanent features are shown to be constructed above or below ground will be disturbed.
 - 3) An outline of areas which may not be disturbed: These areas of the Project outside the clearing and grubbing and construction activities which comprised of those that are not subject to any soil disturbing activities.
 - 4) The location of major structural and nonstructural controls identified in the plan: Temporary sediment control devices shall be installed all locations where disturbance of solids will occur. Additional measures may be required as necessary where stormwater runoff has the potential to reach surface waters or offsite stormwater collection facilities.
 - 5) The location of areas where stabilization practices are expected to occur, surface waters, wetlands and locations where stormwater is discharged to a surface water or MS4: Areas of permanent stabilization are shown on the Construction Plan Sheets.
- f. Discharge point(s): N/A. This project has no outfall.

2. Controls

- a. Erosion and Sediment Controls: The Contractor shall describe in the ECP the proposed stabilization and structural practices. The Contractor may choose to accept the following guidelines or modify them in the ECP, subject to approval by the Engineer. As work progresses, the Contractor shall modify the plan to adapt to seasonal variation, changes in construction activities, and the need for better management practices. For each construction phase install perimeter controls after clearing and grubbing necessary for installation of controls but before beginning other work for the construction phase. Remove perimeter controls only after all upstream areas are stabilized. In addition:
 - . Furnish and place inlet protection systems to control erosion and siltation.
 - . Install soil tracking prevention devices (STPDs) at all common areas where construction vehicles will be entering and exiting the construction site.
 - . Sediment barriers shall be installed and at the toe of slope of embankments and at locations as described in the Erosion and Sediment Control Details and the E&S Manual.
 - . Inlet protection systems shall be used for all existing and proposed inlets subject to sediment runoff.
 - . Clearing and grubbing operations will be controlled so as to minimize unprotected erodible areas exposed to weather. Areas outside the limits of construction shall not be disturbed.
 - . Excavated material shall not be deposited in locations where the material could be washed away by high water, rain or stormwater runoff. Stockpiles shall be covered or encircle with sediment barriers.

- 1) Stabilization Practices: In the ECP, the Contractor shall describe the stabilization practices proposed to control erosion. The Contractor shall initiate all stabilization measures as soon as practical, but in no case more than 7 days, in portions of the site where construction activities have temporarily or permanently ceased. The stabilization practices shall include at least the following, unless otherwise approved by the Engineer.
 - a) Temporary: Includes sod, mulch, and artificial coverings in accordance with the Contract Documents.
 - b) Permanent: Includes asphalt or concrete surface, sod, roadside swales, and endwalls in accordance with the Contract Documents.
- 2) Structural Practices: In the ECP, the Contractor shall describe the proposed structural practices to control trap sediment and otherwise prevent the discharge of pollutants from exposed areas of the site. Sediment controls shall be in place before disturbing soil upstream of the control. The structural practices shall include at least the following, unless otherwise approved by the Engineer.
 - a) Temporary: Includes inlet protection systems, sediment barriers, turbidity barriers and soil tracking prevention devices as per the E&S Manual and the Contract Documents. See Erosion and Sediment Control Details for more information. All sediment controls shall be in place prior to any soil disturbing activity.
 - b) Permanent: Includes roadside swales.
- b. Permanent Stormwater Management Controls: Stormwater runoff will be conveyed in a swale systems with inlets and French drains.
- c. Control for Other Potential Pollutants: The Contractor shall practice good housekeeping by instituting a clean, orderly construction site. The following controls shall be implemented to further reduce pollution at the project site:
 - 1) Waste Disposal: In the ECP, the Contractor shall describe the proposed methods to prevent the discharge of solid materials, including building materials, to waters of the United States. The proposed methods shall include at least the following, unless otherwise approved by the Engineer:
 - a) The Contractor shall demonstrate the proper disposal of all construction waste generated within the project limits. Waste may include, but not be limited to, vegetation from clearing and grubbing activities, packaging materials, scrap building materials, litter from traveling public, sewage from sanitary facilities, herbicides and pesticides and their containers, and hydrocarbon products. Contractor shall designate a waste collection area onsite and delineate the area on the SWPPP Site Map.
 - b) Sanitary/septic facilities shall be provided and maintained in a neat and sanitary condition, for the use of the Contractor's employees as necessary to comply with the requirements and regulations of the State and local boards of health. A licensed Sanitary Waste Management Contractor as required by State Regulations will collect all sanitary waste from portable units.
 - 2) Off-Site Vehicle Tracking & Generation of Dust: In the ECP, the Contractor shall describe the proposed methods for minimizing offsite vehicle tracking of sediments and generating dust. The proposed methods shall include at least the following, unless otherwise approved by the Engineer.
 - a) Stabilizing construction entrances as necessary according to the E&S Manual and the Contract Documents.
 - b) The Contractor shall take measures to insure the cleanup of sediments that have been tracked by vehicles or have been transported by wind or stormwater about the site or onto nearby roadways.
 - c) Removing excess dirt from roads daily.
 - d) Using roadway sweepers during dust generating activities such as excavation and milling operations.
 - e) Stabilized construction entrances and construction roads, if appropriate, shall be implemented in order to reduce off-site tracking.
 - f) Loaded haul trucks shall be covered with tarpaulin. Excess dirt on the road shall be removed daily.
- 3) State or Local Regulations: In the ECP, the Contractor shall describe the proposed procedures to comply with applicable State and local regulations for waste disposal, and sanitary sewer or septic systems.
- 4) Application of Fertilizer and Pesticides
 - a) The application and handling of herbicides and pesticides shall be in compliance with the manufacture recommended method and in accordance with FDOT Standard Specifications for Road and Bridge Construction as modified by the Contract Documents.
 - b) Herbicides and pesticides shall be stored onsite in their original containers with product label intact.
- 5) Toxic Substances and Materials
 - a) In the ECP, the contractor shall provide a list of toxic substances and materials that are likely to be used on the job and provide a plan addressing the generation, application, migration, storage, and disposal of these substances.
 - b) Contractor shall provide equipment necessary to contain and clean up spills of hazardous materials, including petroleum products. Spills shall be contained and cleaned up immediately after they occur. Spilled material and the equipment used to clean up the spill shall not come in contact with surface waters or be introduced into stormwater. Disposal of surplus product will be done according to manufacturer recommended method.
 - c) Contractor shall provide a project specific Hazardous Materials Spill Control Plan in order to address the handling of hydrocarbon and hazardous materials.


- d) Petroleum products shall be stored in covered areas with secondary containment surrounding container.
- e) Toxic/hazardous materials exposed during construction activities shall be handled per the FDOT Standard Specifications for Road and Bridge Construction as modified by the Contract Documents.
- d. Approved State and Local Plans and Permits
- 3. Maintenance: In the ECP, the Contractor shall provide a plan for maintaining all erosion and sediment controls throughout construction. The maintenance plan shall at a minimum, comply with the following:
 - a. Sediment Barriers: Twelve (12) months, or as required, replacement interval in accordance with Contract's Specifications.
 - b. Inlet Protection Systems at inlets-Check after rainfall events. Clean if clogging occurs.
 - c. The maintenance of these devices shall occur until the Engineer has deemed an area permanently stabilized. It will be the responsibility of the Contractor to remove erosion and sediment control devices once they have served their purpose.
- 4. Inspection
 - a. The Contractor shall be required to conduct daily visual inspections of all temporary and permanent erosion control measures along the project corridor. The Contractor shall maintain, repair and/or replace these items as necessary.
 - b. The Engineer shall have an Inspector review the project's temporary and permanent erosion control measures for the items listed below at least once every seven (7) calendar days and/or within 24 hours of the end of a storm that is 0.5 inches or greater. A written inspection report (form attached) is required every seven calendar days or within 24 hours of the end of a storm that deposits 0.5 inches of rain or greater.
 - 1) Outfalls into the waters of the United States
 - 2) Points of discharge to municipal separated storm sewer systems
 - 3) Disturbed areas of the site that have not been stabilized
 - 4) Areas used for storage of materials that are exposed to precipitation
 - 5) Structural controls
 - 6) Stormwater management systems
 - 7) Locations where vehicles enter or exit this site
 - 8) Check that the approved or revised Erosion Control Plan is followed
 - 9) Where sites have been stabilized, inspections shall be conducted at least once every month.
 - c. The Contractor shall initiate repairs within 24 hours of inspections that indicate items are not in good working order.
 - d. If inspections indicate that the installed stabilization and structural practices are not sufficient to minimize erosion, retain sediment, and prevent discharging pollutants, the Contractor shall provide additional measures, as approved by the Engineer.
- 5. Non-Stormwater Discharges
 - a. In the ECP, the Contractor shall identify all anticipated non-stormwater discharges (except flows from fire fighting activities). The Contractor shall describe the proposed measures to prevent pollution from these non-stormwater discharges.
 - b. If contaminated soil or groundwater is encountered during construction, the Contractor is to cease operations in that area. The Contractor shall contact the Miami-Dade County Regulatory and Economic Resources Compliance Desk, at (305) 372-6955.

REVISIONS


DATE	BY	DESCRIPTION	DATE	BY	DESCRIPTION

SW 80 ST. FROM
SW 149 AVE. TO SW 154 AVE.

DESIGNED BY	DATE	DRAWN BY	DATE
I. HENLAND	03-25-16	M. CEDRON/ALS	03-25-16
CHECKED BY	F. OROZALEZ	CHECKED BY	
SUPERVISED BY			



DEPARTMENT OF TRANSPORTATION AND PUBLIC WORKS
ROADWAY ENGINEERING AND RIGHT OF WAY DIVISION
STEPHEN P. CLARK CENTER
111 NW 2 ST
MIAMI, FLORIDA 33128

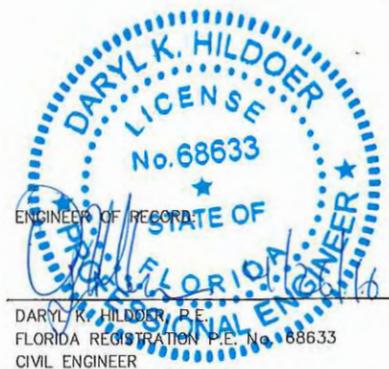

DARYL K. HILDOER, P.E.
FLORIDA REGISTRATION P.E. No. 68633
CIVIL ENGINEER

STORMWATER POLLUTION PREVENTION PLAN

S:\Factor\Projects\SW 80th St. from SW 149th Ave to SW 154th Ave\Plans\SW-17 STORMWATER POLLUTION.dwg Apr 21, 2016 - 1:41pm SANJH