



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION

11805 SW 26 Street, Room 208
T (786) 315-2590 F (786) 315-2599

www.miamidade.gov/economy

Gopi Glass Sales & Services Corp.

7450 NW 41st Street

Miami, FL 33166

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER - Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "4500 Flush Glazed" Aluminum Storefront System – N.I.

APPROVAL DOCUMENT: Drawing No. 97-38, titled "Series 4500 Alum. Flush Glazed System (N.I.)", sheets 1 through 7 of 7, dated 10/15/97, with revision G dated 01/25/18, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: None

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises and renews** NOA# 14-0728.08 and consists of this page 1 and evidence pages E-1, E-2 and E-3, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



Handwritten signature and date: 4/6/18

NOA No. 18-0226.01
Expiration Date: December 04, 2023
Approval Date: April 12, 2018
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's

A. DRAWINGS

1. Manufacturer's die drawings and sections.
(Submitted under NOA No. 08-1212.01)
2. Drawing No. **97-38**, titled "Series 4500 Alum. Flush Glazed System (N.I.)", sheets 1 through 7 of 7, dated 10/15/97, with revision **F** dated 06/11/14, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E.

B. TESTS

1. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
2) Water Resistance Test, per FBC, TAS 202-94
along with marked-up drawings and installation diagram of a series 4500 aluminum storefront system, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-5705**, dated 08/07/08, signed and sealed by Carlos S. Rionda, P.E.
(Submitted under NOA No. 08-1212.01)
2. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
2) Water Resistance Test, per FBC, TAS 202-94
along with marked-up drawings and installation diagram of a series 4500 aluminum storefront system, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-5751**, dated 10/17/08, signed and sealed by Carlos S. Rionda, P.E.
(Submitted under NOA No. 08-1212.01)
3. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
along with marked-up drawings and installation diagram of a series 4500 aluminum storefront system, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-5778**, dated 11/03/08, signed and sealed by Carlos S. Rionda, P.E.
(Submitted under NOA No. 08-1212.01)

C. CALCULATIONS


1. Anchor verification calculations and structural analysis, complying with **FBC 5th Edition (2014)**, dated June 12, 2014, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E.
2. Glazing complies with **ASTM E1300-09**.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS

1. None.


Manuel Perez, P.E.
Product Control Examiner
NOA No. 18-0226.01
Expiration Date: December 04, 2023
Approval Date: April 12, 2018

Gopi Glass Sales & Services Corp.


NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

F. STATEMENTS

1. Statement letter of conformance, complying with **FBC 5th Edition (2014)**, and of no financial interest, dated June 19, 2014, issued by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E.

G. OTHERS

1. Notice of Acceptance No. **13-0708.06**, issued to Gopi Glass Sales & Services Corp. for their Series “4500 Flush Glazed” Aluminum Storefront System – N.I., approved on 10/24/13 and expiring on 12/04/18.


Manuel Perez, P.E.
Product Control Examiner
NOA No. 18-0226.01
Expiration Date: December 04, 2023
Approval Date: April 12, 2018

Gopi Glass Sales & Services Corp.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

2. NEW EVIDENCE SUBMITTED

A. DRAWINGS

1. Drawing No. **97-38**, titled "Series 4500 Alum. Flush Glazed System (N.I.)", sheets 1 through 7 of 7, dated 10/15/97, with revision **G** dated 01/25/18, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E.

B. TESTS

1. None

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with **FBC 6th Edition (2017)**, dated 01/25/18, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS


1. None.


F. STATEMENTS

1. Statement letter of conformance, complying with **FBC 6th Edition (2017)**, and of no financial interest, dated January 12, 2018, issued by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E.


G. OTHERS

1. Notice of Acceptance No. **14-0728.08**, issued to Gopi Glass Sales & Services Corp. for their Series "4500 Flush Glazed" Aluminum Storefront System – N.I., approved on 10/16/14 and expiring on 12/04/18.


Manuel Perez, P.E.
Product Control Examiner
NOA No. 18-0226.01
Expiration Date: December 04, 2023
Approval Date: April 12, 2018

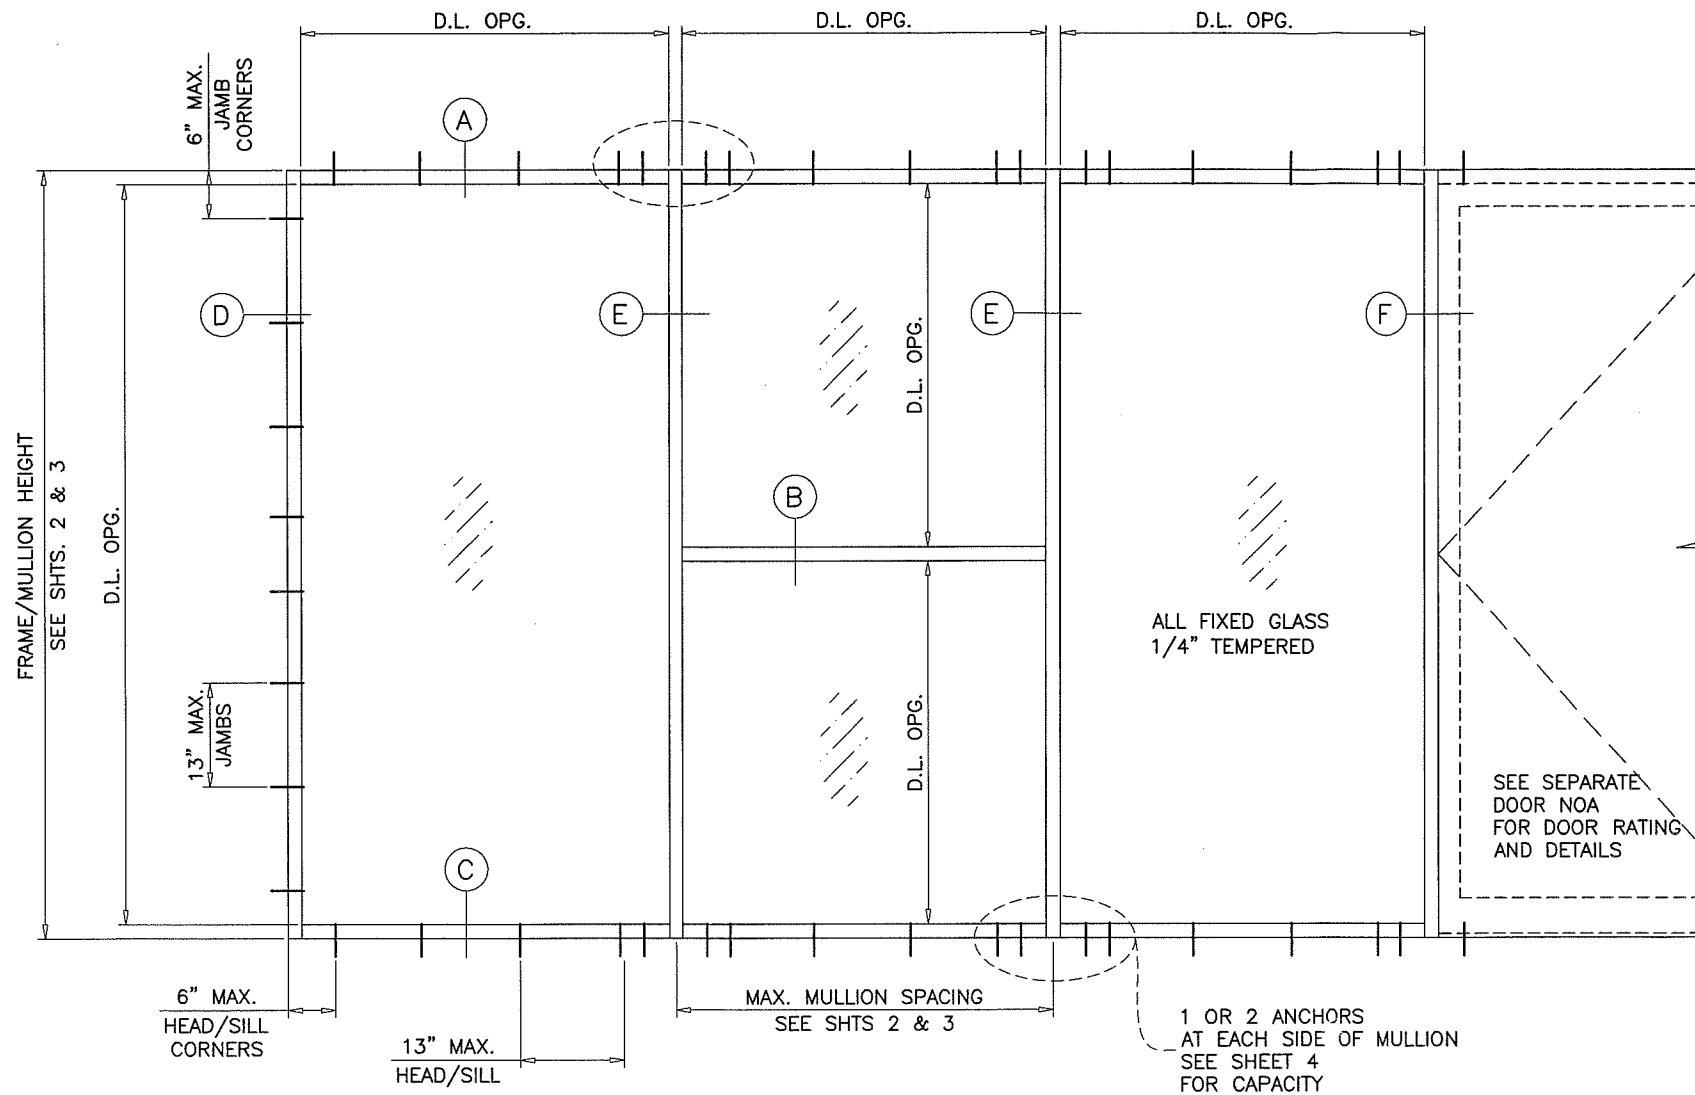

TYPICAL ELEVATION

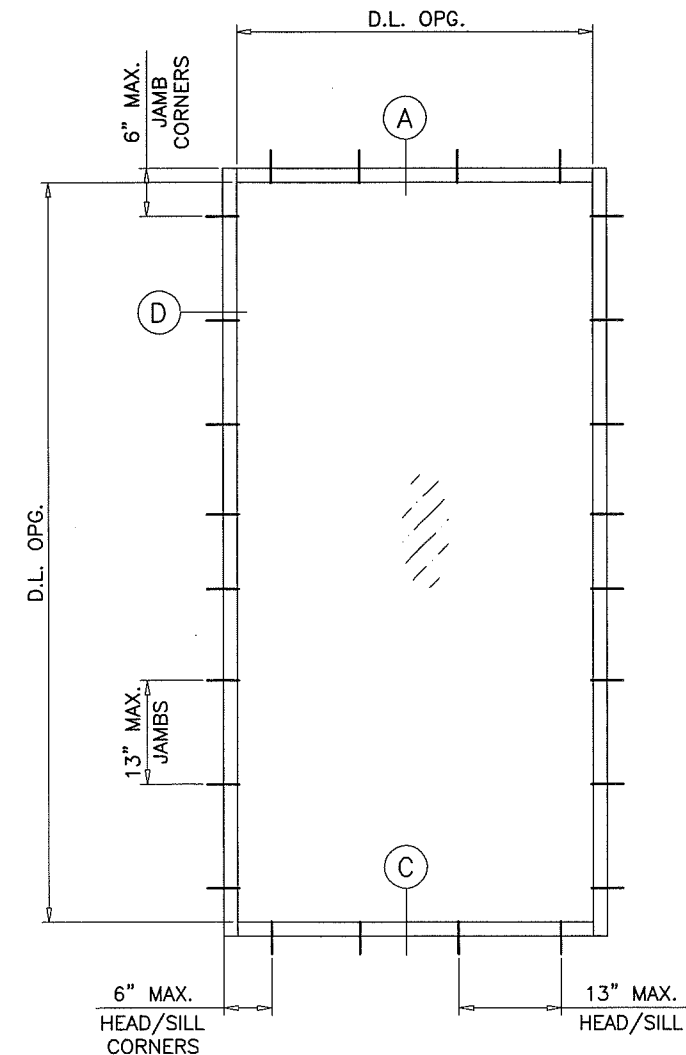

SERIES-4500

ALUMINUM FLUSH GLAZED STOREFRONT SYSTEM

THIS SYSTEM IS NOT RATED FOR IMPACT.

THIS SYSTEM MAY BE USED IN CONJUNCTION WITH MIAMI-DADE COUNTY APPROVED OUTSWING ENTRANCE DOORS.

CODE REQUIREMENTS FOR SAFEGUARDS MUST BE OBSERVED.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE 2017 (6TH EDITION) FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

1BY OR 2BY WOOD BUCKS & BUCK FASTENERS BY OTHERS, MUST BE DESIGNED AND INSTALLED ADEQUATELY TO TRANSFER APPLIED PRODUCT LOADS TO THE BUILDING STRUCTURE.

ANCHORS SHALL BE CORROSION RESISTANT, SPACED AS SHOWN ON DETAILS AND INSTALLED PER MANUF'S INSTRUCTIONS. SPECIFIED EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

ALL SHIMS TO BE HIGH IMPACT, NON-METALLIC AND NON-COMPRESSIBLE.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE 2017 FLORIDA BLDG. CODE & ADOPTED STANDARDS.

THIS PRODUCT APPROVAL IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT, i.e. LIFE SAFETY OF THIS PRODUCT, ADEQUACY OF STRUCTURE RECEIVING THIS PRODUCT AND SEALING AROUND OPENING FOR WATER INFILTRATION RESISTANCE ETC.

CONDITIONS NOT SHOWN IN THIS DRAWING ARE TO BE ANALYZED SEPARATELY, AND TO BE REVIEWED BY BUILDING OFFICIAL.

INSTRUCTIONS:

USE CHARTS AS FOLLOWS.


- STEP 1** DETERMINE DESIGN WIND LOAD REQUIREMENTS BASED ON WIND VELOCITY, BLDG. HEIGHT, WIND ZONE USING APPLICABLE ASCE 7 STANDARD.
- STEP 2** CHECK MULLION CAPACITY FOR A GIVEN SPACING AND HEIGHT USING CHARTS ON SHEETS 2 & 3 THE CAPACITY SHOULD EXCEED THE DESIGN LOAD.
- STEP 3** USING CHART ON SHEETS 4 SELECT ANCHOR OPTION WITH DESIGN RATING MORE THAN DESIGN LOAD SPECIFIED IN STEP 1 ABOVE.
- STEP 4** THE LOWEST VALUE RESULTING FROM STEPS 2 AND 3 SHALL APPLY TO ENTIRE SYSTEM.

INSTALLATION OF THIS PRODUCT IN THE HVHZ AREA REQUIRES THE USE OF APPROVED SHUTTERS OR EXTERNAL PROTECTION DEVICES COMPLYING WITH HVHZ REQUIREMENTS.

INSTALLATION OF THIS SYSTEM OUTSIDE THE HVHZ AREA SHALL MEET THE APPLICABLE REQUIREMENTS FOR WIND BORNE DEBRIS PROTECTION.

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 18-0326.01
Expiration Date Dec 4, 2023
By *Manuel Perez*
Miami Dade Product Control

FEB 12 2018

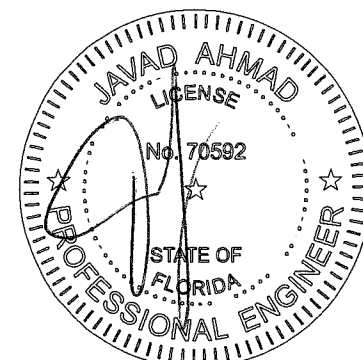

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

SERIES 4500 ALUM FLUSH GLAZED SYSTEM (N.I.)
Gopi Glass Sales & Services Corp.
7450 N.W. 41 STREET
MIAMI, FL. 33166
TEL. (305) 592-2089 FAX. (305) 477-0992


no	date	by	description
D	12.10.08		UPDATED FOR 2007 FBC
E	02.23.12		UPDATED TO 2010 FBC
F	06.11.14		UPDATED TO 2014 FBC
G	01.25.18		UPDATED TO 2017 FBC

date: 10-15-97
scale: 1/2"=1'-0"
dr. by: TARIQ
chk. by:
drawing no.
97-38
sheet 1 of 7


STORE\97-38GGC

MULLION LOAD CAPACITY - PSF WITHOUT INTERMEDIATE HORIZONTALS			
NOMINAL DIMS.		MULLION W/O REINF.	MULLION WITH REINF.
WIDTH (W)	FRAME HEIGHT	EXT. (+) INT. (-)	EXT. (+) INT. (-)
24"	72"	110.0	110.0
30"		110.0	110.0
36"		110.0	110.0
42"		105.6	110.0
48"		96.2	110.0
54"		89.7	110.0
60"		85.5	110.0
66"		83.0	110.0
72"		82.1	110.0
75"		82.2	110.0
24"	78"	110.0	110.0
30"		110.0	110.0
36"		100.2	110.0
42"		88.3	110.0
48"		79.9	110.0
54"		73.9	103.2
60"		69.7	97.3
66"		66.8	93.3
72"		65.2	91.0
75"		64.8	90.4
24"	84"	110.0	110.0
30"		100.7	110.0
36"		85.5	110.0
42"		75.0	104.8
48"		67.5	94.3
54"		62.1	86.7
60"		58.1	81.1
66"		55.2	77.1
72"		53.3	74.4
75"		52.6	73.5
24"	90"	107.6	110.0
30"		87.2	110.0
36"		73.9	103.2
42"		64.6	90.2
48"		57.9	80.9
54"		53.0	74.0
60"		49.3	68.8
66"		46.5	64.9
72"		44.5	62.2
75"		44.5	60.0
24"	96"	94.3	110.0
30"		76.3	106.6
36"		64.5	90.1
42"		56.3	78.6
48"		50.3	70.2
54"		45.8	63.9
60"		42.4	59.2
66"		39.8	55.6
72"		37.9	52.9
75"		37.1	51.8

MULLION LOAD CAPACITY - PSF WITHOUT INTERMEDIATE HORIZONTALS			
NOMINAL DIMS.		MULLION W/O REINF.	MULLION WITH REINF.
WIDTH (W)	FRAME HEIGHT	EXT. (+) INT. (-)	EXT. (+) INT. (-)
24"	102"	-	110.0
30"		-	94.1
36"		-	79.4
42"		-	69.1
48"		-	61.6
54"		-	55.9
60"		-	51.5
66"		-	48.2
72"		-	45.6
75"		-	44.5
24"	108"	-	103.6
30"		-	83.6
36"		-	70.5
42"		-	61.2
48"		-	54.4
54"		-	49.3
60"		-	45.3
66"		-	42.2
72"		-	39.8
75"		-	38.8
24"	114"	-	92.9
30"		-	74.9
36"		-	63.0
42"		-	54.7
48"		-	48.5
54"		-	43.8
60"		-	40.2
66"		-	37.4
72"		-	35.1
75"		-	34.1
24"	120"	-	83.7
30"		-	67.4
36"		-	56.7
42"		-	49.1
48"		-	43.5
54"		-	39.3
60"		-	35.9
66"		-	33.3
72"		-	31.2




MULLION
W/O REINF.




MULLION
WITH REINF.

Ix IN ⁴	Sx IN ³
3.2423	1.441


ALUMINUM	Ix IN ⁴	Sx IN ³
STEEL	1.317	.620
TOTAL	7.0623	
Ix ALUM + Ix STL X 2.9		

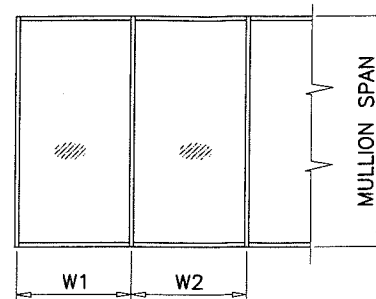



$$\text{WIDTH (W)} = \frac{W1 + W2}{2}$$

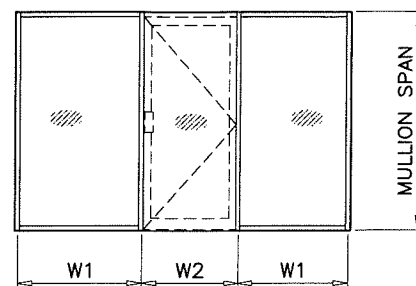

$$\text{WIDTH (W)} = \frac{W1 + W2}{2}$$

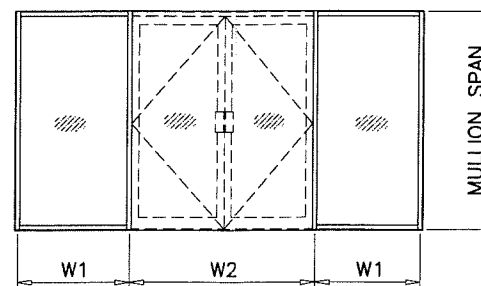


$$\text{WIDTH (W)} = \frac{W1}{2} + \frac{W2}{4}$$

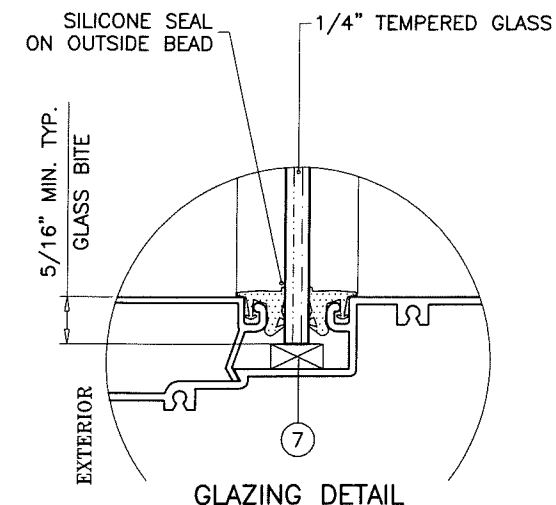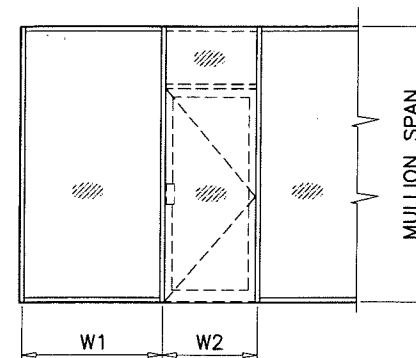

NOTE:
GLASS CAPACITIES ARE
BASED ON ASTM E1300-09 (3 SEC. GUSTS)

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 18-0226.01
Expiration Date Dec. 4, 2023
By *Manuel Jara*
Miami Dade Product Control

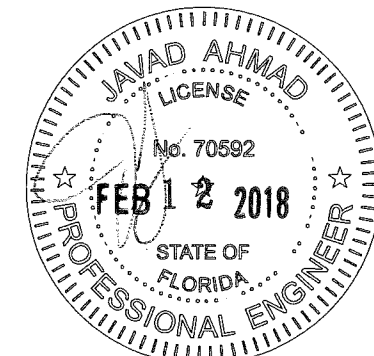


AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-8978
STORE \ 97-38GGC

SERIES 4500 ALUM FLUSH GLAZED SYSTEM (N.I.)
Gopi Glass Sales & Services Corp.
7450 N.W. 41 STREET
MIAMI, FL. 33166
TEL. (305) 592-2089 FAX. (305) 477-0992

revisions:	no.	date	by	description
	D	12.10.08		UPDATED FOR 2007 FBC
	E	02.23.12		UPDATED TO 2010 FBC
	F	06.11.14		NO CHANGE THIS SHEET
	G	01.25.18		UPDATED TO 2017 FBC
date:	10-15-97			
scale:	-			
dr. by:	TARIQ			
chk. by:				
drawing no.	97-38			
sheet	2 of 7			


MULLION LOAD CAPACITY - PSF WITH INTERMEDIATE HORIZONTALS			
NOMINAL DIMS.		MULLION W/O REINF.	MULLION WITH REINF.
WIDTH (W)	FRAME HEIGHT	EXT. (+) INT. (-)	EXT. (+) INT. (-)
24"	72"	110.0	110.0
30"		110.0	110.0
36"		109.5	110.0
42"		93.8	110.0
48"		82.1	110.0
54"		73.0	102.4
60"		65.7	92.1
66"		59.7	83.8
72"		54.7	76.8
75"		52.5	73.7
24"	78"	110.0	110.0
30"		110.0	110.0
36"		93.3	110.0
42"		80.0	110.0
48"		70.0	98.1
54"		62.2	87.2
60"		56.0	78.5
66"		50.9	71.4
72"		46.6	65.4
75"		44.8	62.8
24"	84"	110.0	110.0
30"		96.5	110.0
36"		80.4	110.0
42"		68.9	96.7
48"		60.3	84.6
54"		53.6	75.2
60"		48.3	67.7
66"		43.9	61.5
72"		40.2	56.4
75"		38.6	54.2
24"	90"	105.1	110.0
30"		84.1	110.0
36"		70.1	98.3
42"		60.1	84.2
48"		52.5	73.7
54"		46.7	65.5
60"		42.0	59.0
66"		38.2	53.6
72"		35.0	49.1
75"		35.0	49.1
24"	96"	92.4	110.0
30"		73.9	103.7
36"		61.6	86.4
42"		52.8	74.0
48"		46.2	64.8
54"		41.1	57.6
60"		36.9	51.8
66"		33.6	47.1
72"		30.8	43.2
75"		29.6	41.5

MULLION LOAD CAPACITY - PSF WITH INTERMEDIATE HORIZONTALS			
NOMINAL DIMS.		MULLION W/O REINF.	MULLION WITH REINF.
WIDTH (W)	FRAME HEIGHT	EXT. (+) INT. (-)	EXT. (+) INT. (-)
24"	102"	-	110.0
30"		-	91.8
36"		-	76.5
42"		-	65.6
48"		-	57.4
54"		-	51.0
60"		-	45.9
66"		-	41.7
72"		-	38.3
75"		-	36.7
24"	108"	-	102.4
30"		-	81.9
36"		-	68.2
42"		-	58.5
48"		-	51.2
54"		-	45.5
60"		-	40.9
66"		-	37.2
72"		-	34.1
75"		-	32.8
24"	114"	-	91.9
30"		-	73.5
36"		-	61.3
42"		-	52.5
48"		-	45.9
54"		-	40.8
60"		-	36.8
66"		-	33.4
72"		-	30.6
75"		-	29.4
24"	120"	-	82.9
30"		-	66.3
36"		-	55.3
42"		-	47.4
48"		-	41.5
54"		-	36.9
60"		-	33.2
66"		-	30.2
72"		-	27.6




MULLION
W/O REINF.

Ix IN ⁴	Sx IN ³
3.2423	1.441




MULLION
WITH REINF.


ALUMINUM	Ix IN ⁴	Sx IN ³
STEEL	1.317	.620
TOTAL		
Ix ALUM + Ix STL X 2.9	7.0623	

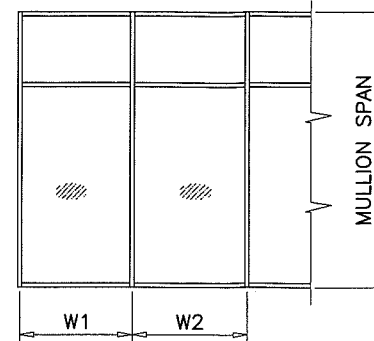


$$\text{WIDTH (W)} = \frac{W1 + W2}{2}$$

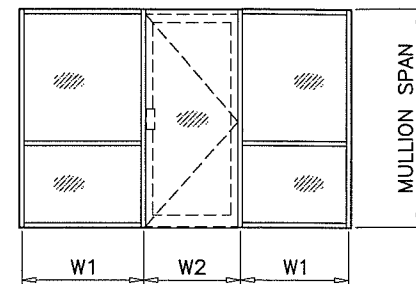


$$\text{WIDTH (W)} = \frac{W1 + W2}{2}$$

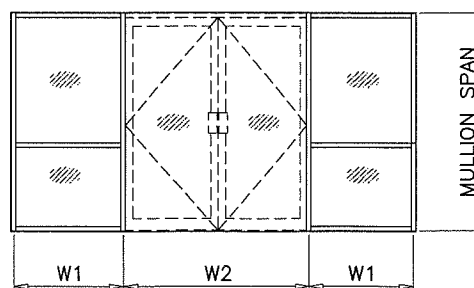

$$\text{WIDTH (W)} = \frac{W1}{2} + \frac{W2}{4}$$

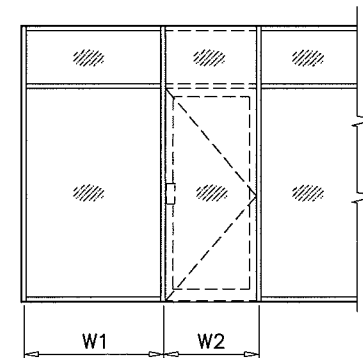


$$\text{WIDTH (W)} = \frac{W1 + W2}{2}$$

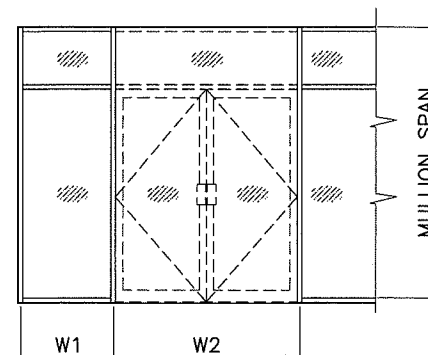

NOTE:
GLASS CAPACITIES ARE
BASED ON ASTM E1300-09 (3 SEC. GUSTS)

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 18-0226.01
Expiration Date Dec. 4, 2023
By *Manuel Jerez*
Miami Trade Product Control

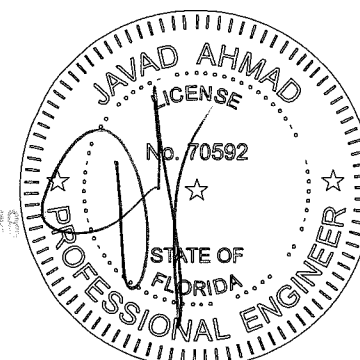

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

SERIES 4500 ALUM FLUSH GLAZED SYSTEM (N.I.)

Gopi Glass Sales & Services Corp.
7450 N.W. 41 STREET
MIAMI, FL. 33166
TEL. (305) 592-2089 FAX. (305) 477-0992

no	date	by	description
D	12.10.08		UPDATED FOR 2007 FBC
E	02.23.12		UPDATED TO 2010 FBC
F	06.11.14		NO CHANGE THIS SHEET
G	01.25.18		UPDATED TO 2017 FBC

date: 10-15-97

scale: -

dr. by: TARIQ

chk. by:


drawing no.
97-38

sheet 3 of 7


LOADS SHOWN IN CHARTS ARE FOR INSTALLATIONS WHERE
WATER INFILTRATION RESISTANCE IS NOT REQUIRED.
LIMIT EXTERIOR LOADS TO +72.0 PSF FOR INSTALLATIONS
WHERE WATER INFILTRATION RESISTANCE IS REQUIRED.

ANCHOR LOAD CAPACITY - PSF WITH OR WITHOUT INTERMEDIATE HORIZONTALS EXT.(+) & INT.(-)					
NOMINAL DIMS.		ANCHORS TYPE 'A'		ANCHORS TYPES 'B' & 'C'	
WIDTH (W)	FRAME HEIGHT	A1	A2	B1/C1	B2/C2
24"	72"	91.2	110.0	110.0	110.0
30"		76.8	110.0	110.0	110.0
36"		67.6	110.0	110.0	110.0
42"		61.3	110.0	103.0	110.0
48"		57.0	110.0	95.8	110.0
54"		54.0	108.1	90.8	110.0
60"		52.1	104.2	87.5	110.0
66"		51.0	102.0	85.7	110.0
72"		50.7	101.3	85.1	110.0
75"		50.7	101.3	85.1	110.0
24"	78"	82.9	110.0	110.0	110.0
30"		69.5	110.0	110.0	110.0
36"		60.8	110.0	102.1	110.0
42"		54.9	109.7	92.2	110.0
48"		50.7	101.3	85.1	110.0
54"		47.7	95.4	80.1	108.8
60"		45.6	91.2	76.6	104.0
66"		44.2	88.4	74.3	100.8
72"		43.4	86.9	73.0	99.0
75"		43.2	86.5	72.6	98.6
24"	84"	76.0	110.0	110.0	110.0
30"		63.4	110.0	106.6	110.0
36"		55.3	110.0	92.8	110.0
42"		49.6	99.3	83.4	110.0
48"		45.6	91.2	76.6	104.0
54"		42.7	85.3	71.7	97.3
60"		40.5	81.1	68.1	92.4
66"		39.0	78.0	65.5	89.0
72"		38.0	76.0	63.8	86.7
75"		37.7	75.3	63.3	85.9
24"	90"	70.2	110.0	110.0	110.0
30"		58.4	110.0	98.0	110.0
36"		50.7	101.3	85.1	110.0
42"		45.3	90.6	76.1	103.4
48"		41.5	82.9	69.6	94.5
54"		38.6	77.2	64.8	88.0
60"		36.5	73.0	61.3	83.2
66"		34.9	69.8	58.6	79.6
72"		33.8	67.6	56.7	77.0
75"		33.4	66.7	56.0	76.1
24"	96"	65.1	110.0	109.4	110.0
30"		54.0	108.1	90.8	110.0
36"		46.8	93.5	78.6	106.7
42"		41.7	83.4	70.0	95.1
48"		38.0	76.0	63.8	86.7
54"		35.2	70.5	59.2	80.4
60"		33.2	66.3	55.7	75.6
66"		31.6	63.2	53.1	72.0
72"		30.4	60.8	51.1	69.3
75"		29.9	59.9	50.3	68.3


ANCHOR LOAD CAPACITY - PSF WITH OR WITHOUT INTERMEDIATE HORIZONTALS EXT.(+) & INT.(-)					
NOMINAL DIMS.		ANCHORS TYPE 'A'		ANCHORS TYPES 'B' & 'C'	
WIDTH (W)	FRAME HEIGHT	A1	A2	B1/C1	B2/C2
24"	102"	60.8	110.0	102.1	110.0
30"		50.3	100.6	84.5	110.0
36"		43.4	86.9	73.0	99.0
42"		38.6	77.2	64.8	88.0
48"		35.1	70.2	58.9	80.0
54"		32.4	64.9	54.5	74.0
60"		30.4	60.8	51.1	69.3
66"		28.8	57.7	48.4	65.8
72"		27.6	55.3	46.4	63.0
75"		27.1	54.3	45.6	61.9
24"	108"	57.0	110.0	95.8	110.0
30"		47.1	94.1	79.1	107.4
36"		40.5	81.1	68.1	92.4
42"		35.9	71.9	60.4	82.0
48"		32.6	65.1	54.7	74.3
54"		30.0	60.0	50.4	68.5
60"		28.1	56.1	47.1	64.0
66"		26.5	53.1	44.6	60.5
72"		25.3	50.7	42.6	57.8
75"		24.8	49.7	41.7	56.6
24"	114"	53.6	107.3	90.1	110.0
30"		44.2	88.4	74.3	100.8
36"		38.0	76.0	63.8	86.7
42"		33.6	67.2	56.5	76.7
48"		30.4	60.8	51.1	69.3
54"		28.0	55.9	47.0	63.8
60"		26.1	52.1	43.8	59.4
66"		24.6	49.1	41.3	56.0
72"		23.4	46.8	39.3	53.3
75"		22.9	45.8	38.5	52.2
24"	120"	50.7	101.3	85.1	110.0
30"		41.7	83.4	70.0	95.1
36"		35.8	71.5	60.1	81.6
42"		31.6	63.2	53.1	72.0
48"		28.5	57.0	47.9	65.0
54"		26.2	52.3	43.9	59.6
60"		24.3	48.6	40.9	55.5
66"		22.9	45.7	38.4	52.2
72"		21.7	43.4	36.5	49.5

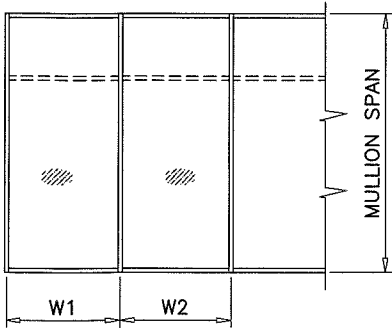

WIDTH (W) = $\frac{W1 + W2}{2}$



A1, B1, C1

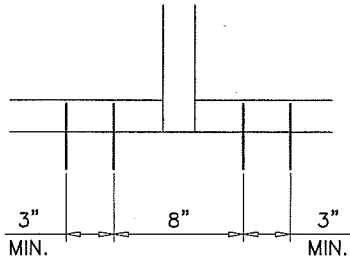


A2, B2, C2

ANCHORS TYPES: SEE SHEET 5 FOR DESCRIPTION

- A1 = (1) ANCHORS TYPE 'A' AT EACH SIDE OF MULLION
A2 = (2) ANCHORS TYPE 'A' AT EACH SIDE OF MULLION
B1 = (1) ANCHORS TYPE 'B' AT EACH SIDE OF MULLION
B2 = (2) ANCHORS TYPE 'B' AT EACH SIDE OF MULLION
C1 = (1) ANCHORS TYPE 'C' AT EACH SIDE OF MULLION
C2 = (2) ANCHORS TYPE 'C' AT EACH SIDE OF MULLION

ALL OTHER ANCHORS TO BE SPACED AS PER ELEVATION.

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 18-0226-01
Expiration Date Dec. 4, 2023
By *Manuel J. Lopez*
Miami Dade Product Control

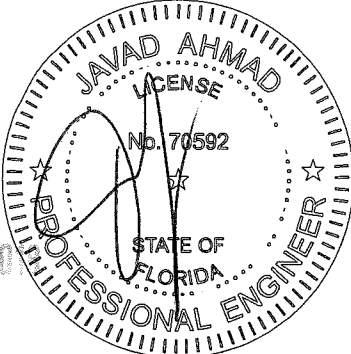




af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

SERIES 4500 ALUM FLUSH GLAZED SYSTEM (N.I.)
Gopi Glass Sales & Services Corp.
7450 N.W. 41 STREET
MIAMI, FL. 33166
TEL. (305) 592-2089 FAX. (305) 477-0992

revisions:

no	date	by	description
D	12.10.08		UPDATED FOR 2007 FBC
E	02.23.12		NO CHANGE THIS SHEET
F	06.11.14		NO CHANGE THIS SHEET
G	01.25.18		UPDATED TO 2017 FBC

date: 10-15-97	scale: -	dr. by: TARIQ	chk. by:
drawing no. 97-38			
sheet 4 of 7			

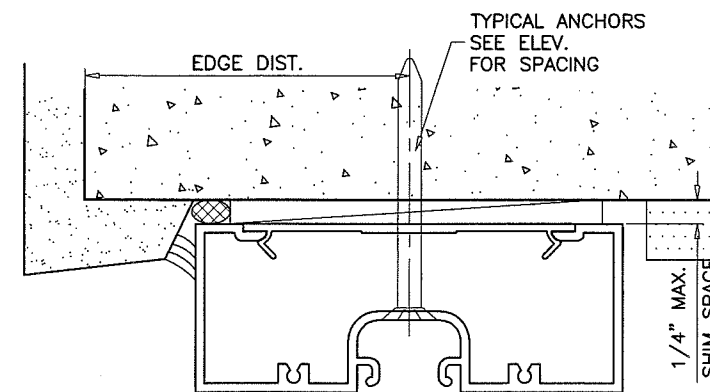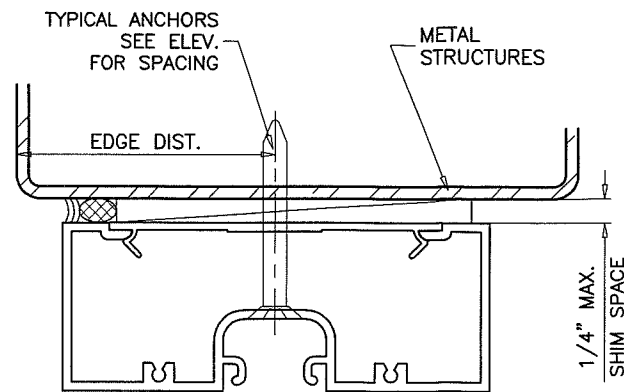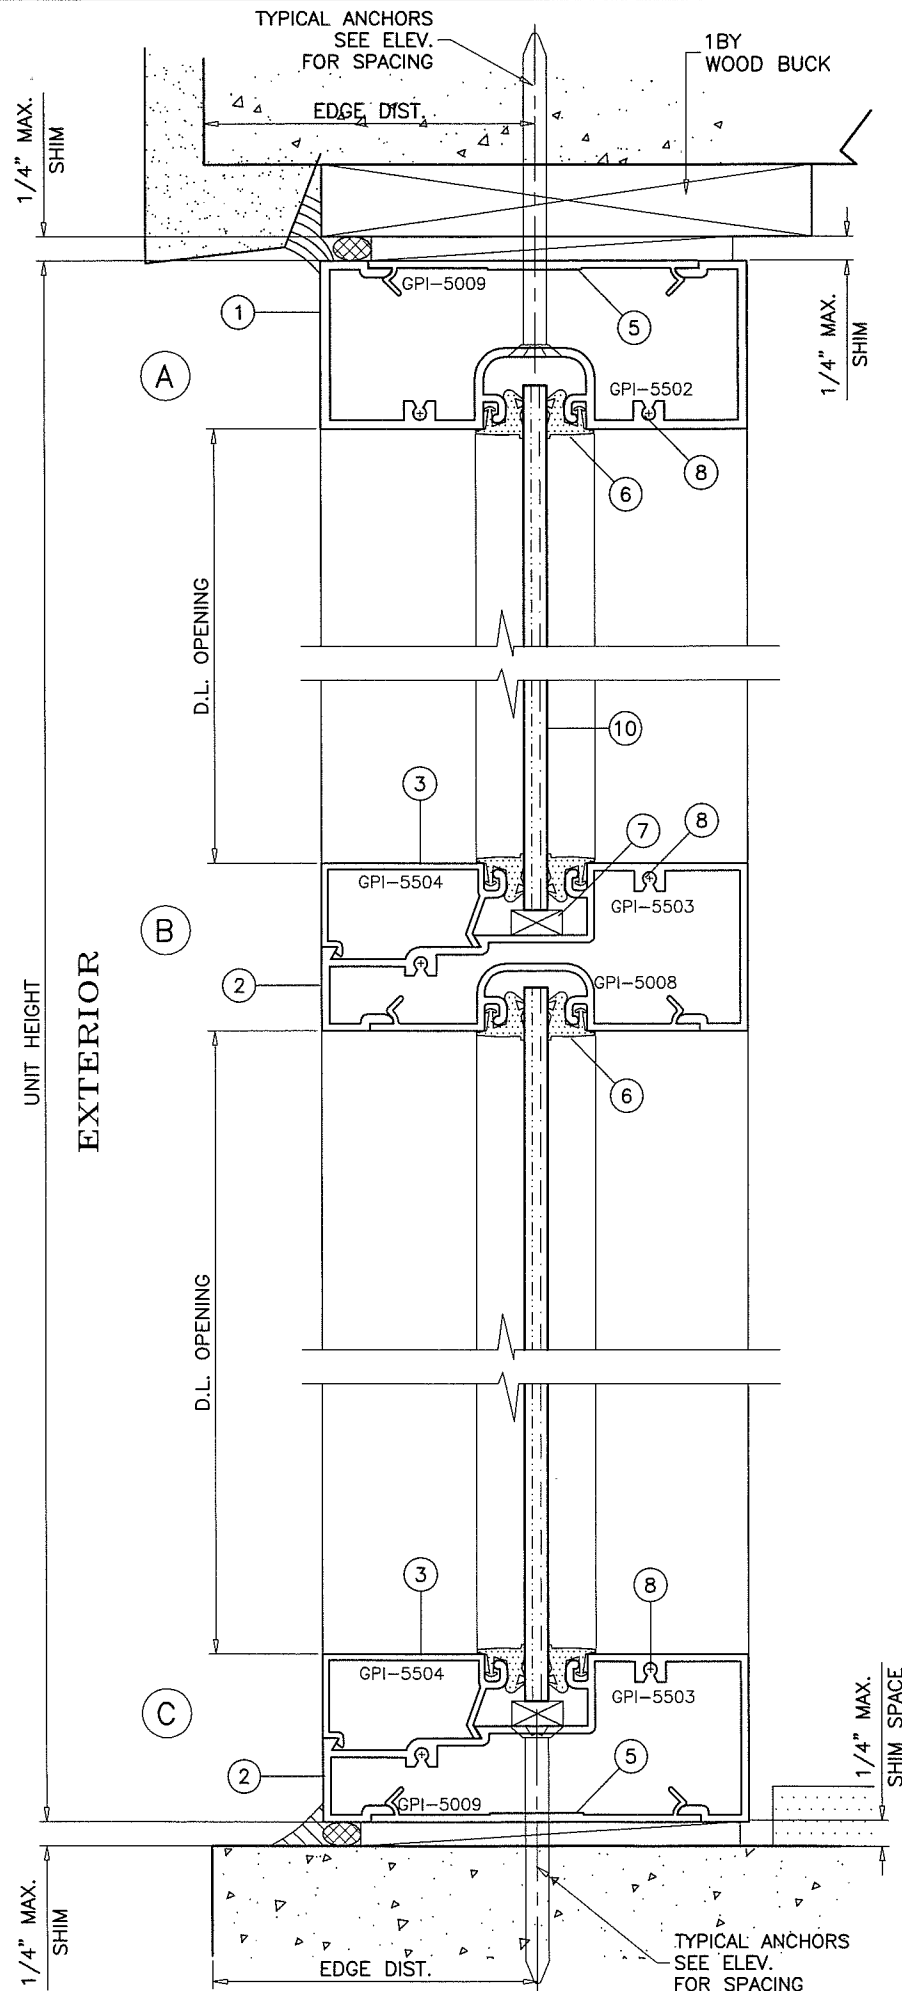

WOOD BUCKS AND METAL STRUCTURES NOT BY GOPI GLASS MUST SUPPORT LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

TYPE 'A' - **1/4" DIA. ULTRACON BY 'ELCO'** ($F_u=177$ KSI, $F_y=155$ KSI)
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 1-1/2" MIN. PENETRATION INTO WOOD (HEAD/SILL/JAMBS)
 THRU 1BY BUCKS INTO CONC. OR BLOCKS
 1-1/4" MIN. EMBED INTO CONCRETE (HEAD/SILL/JAMBS)
 1-1/4" MIN. EMBED INTO BLOCKS (JAMBS)

TYPE 'B' - **1/4" DIA. ULTRACON BY 'ELCO'** ($F_u=177$ KSI, $F_y=155$ KSI)
 DIRECTLY INTO CONCRETE OR BLOCKS
 1-3/4" MIN. EMBED INTO CONCRETE (HEAD/SILL/JAMBS)
 1-1/4" MIN. EMBED INTO BLOCKS (JAMBS)


TYPE 'C' - **#14 SMS OR SELF-DRILLING SCREWS** (GRADE 2 CRS)
 INTO METAL STRUCTURES (HEAD/SILL/JAMBS)
 (3) THREADS MIN. TO EXTEND BEYOND METAL THICKNESS
 ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)
 STEEL: 1/8" THK. MIN. ($F_y = 36$ KSI MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

CRITICAL EDGE DISTANCE

INTO CONCRETE AND BLOCKS = 2-1/2" MIN.
 INTO WOOD STRUCTURE = 1" MIN.
 INTO METAL STRUCTURE = 3/4" MIN.

WOOD AT HEAD, SILL OR JAMBS SG = 0.55 MIN.
 CONCRETE AT HEAD, SILL OR JAMBS $f'_c = 3000$ PSI MIN.
 C-90 HOLLOW/FILLED BLOCK AT JAMBS $f'_m = 2000$ PSI MIN.

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 18-0226.01
 Expiration Date Dec. 4, 2023
 By *Manuel Jara*
 Miami Dade Product Control

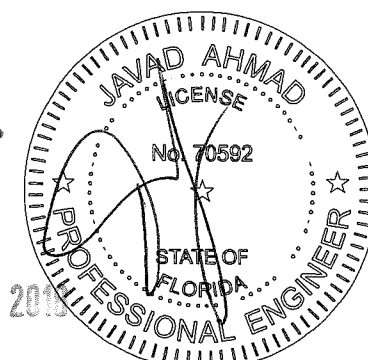

SEALANTS:

GLAZING BEAD TO FRAME, MULLION AND FRAME SEAMS AND ALL
 FRAME CORNERS SEALED WITH CLEAR/ALUM COLORED SILICONE
 'SCHNEE MOREHEAD 5504'.


AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173 (C.A.N. 3538)
 TEL. (305) 264-8100 FAX. (305) 262-6978
 STORE 97-38GGC

SERIES 4500 ALUM FLUSH GLAZED SYSTEM (N.I.)
Gopi Glass Sales & Services Corp.
 7450 N.W. 41 STREET
 MIAMI, FL. 33166
 TEL. (305) 592-2089 FAX. (305) 477-0992



no	date	by	description
D	12.10.08		UPDATED FOR 2007 FBC
E	02.23.12		ANCHORS REV.
F	06.11.14		NO CHANGE THIS SHEET
G	01.25.18		UPDATED TO 2017 FBC

date: 10-15-97
 scale: 1/2" = 1"
 dr. by: TARIQ
 chk. by:


drawing no.
97-38
 sheet 5 of 7

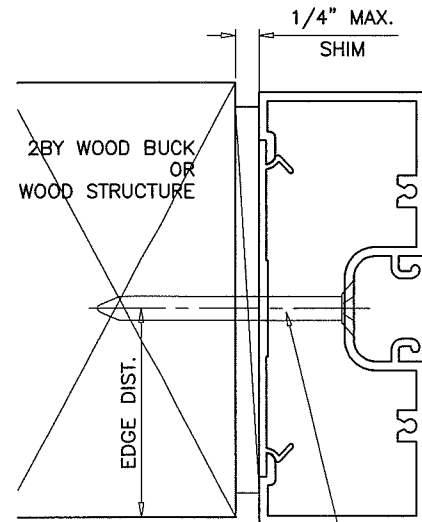

ITEM #	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	GPI-5502	AS REQD.	OPEN BACK HEAD/JAMB/MULL	6063-T6	—
2	GPI-5503	AS REQD.	FRAME SILL	6063-T6	—
3	GPI-5504	AS REQD.	GLASS STOP	6063-T5	—
4	GPI-5008	AS REQD.	POCKET FILLER	6063-T6	—
5	GPI-5009	AS REQD.	FLAT FILLER	6063-T6	—
6	—	AS REQD.	GLAZING GASKET	NEOPRENE	—
7		2/ LITE	SETTING BLOCK	EPDM	DUROMETER 87±5 SHORE A
8	#10 X 1" SMS	2/ CORNER	FRAME ASSEMBLY SCREWS	—	—
9	—	AS REQD.	REINFORCING CHANNEL	STEEL	5/8" X 4-1/4" X 5/8" X 1/8" TH.
10	—	—	1/4" TEMPERED GLASS	—	—

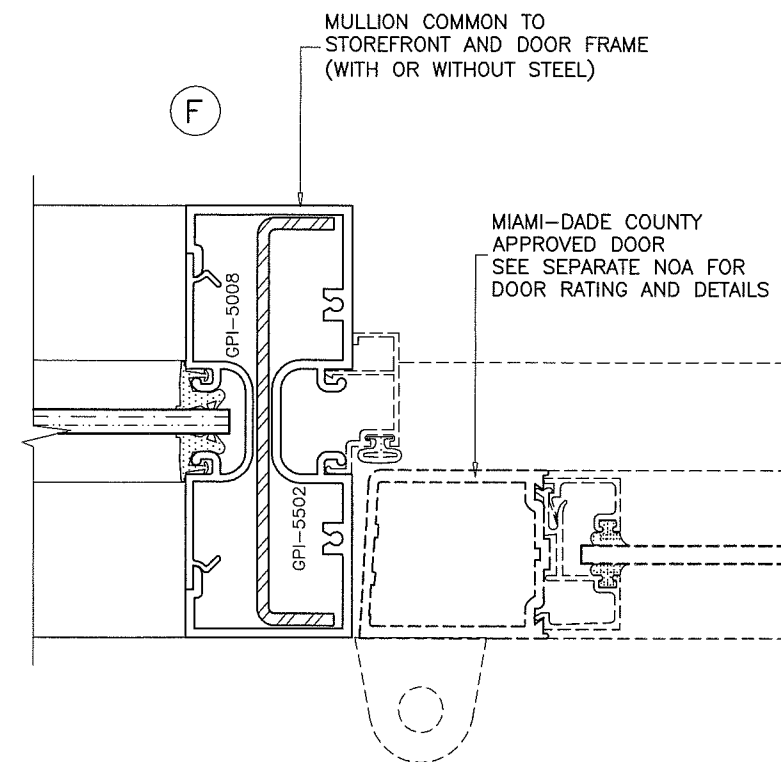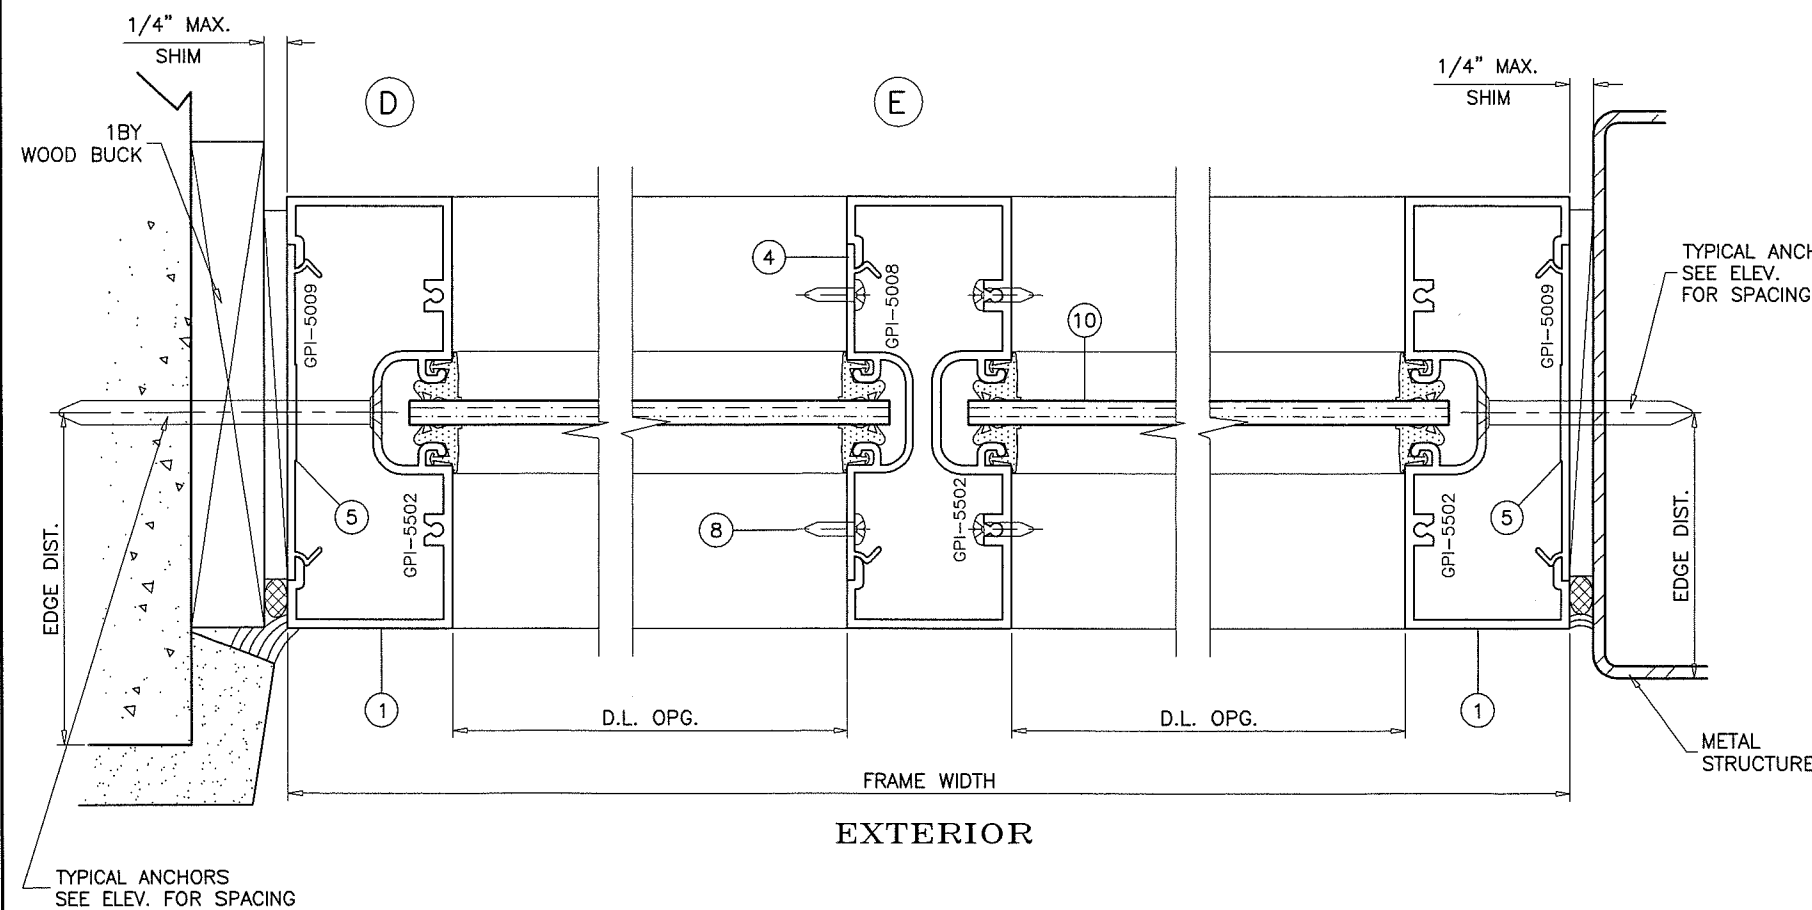

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 18-0226.01
Expiration Date Dec. 4, 2023
By Manuel Perez
Miami-Dade Product Control

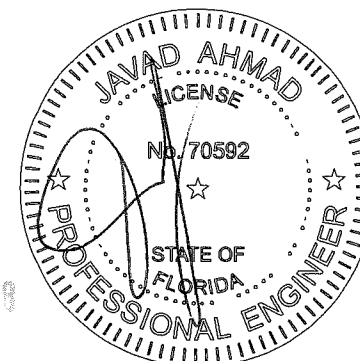

a f c

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978

SERIES 4500 ALUM FLUSH GLAZED SYSTEM (N.I.)

Gopi Glass Sales & Services Corp.
7450 N.W. 41 STREET
MIAMI, FL. 33166

TEL. (305) 592-2089 FAX. (305) 477-0992


revisions:		no	date	by	description
	D	12	10.08		UPDATED FOR 2007 FBC
	E	02.23.12			UPDATED TO 2010 FBC
	F	06.11.14			NO CHANGE THIS SHEET
	G	01.25.18			UPDATED TO 2017 FBC

date: 10-15-97
scale: 1/2" = 1"
dr. by: TARIQ
chk. by:


drawing no
97-38

sheet 6 of 7


STORE\97-38GGC

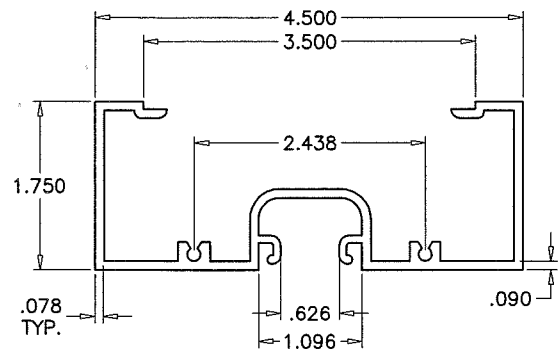


GPI-5502
6063-T6

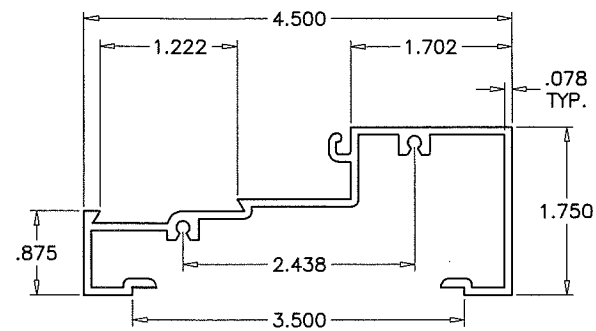


GPI-5503
6063-T6

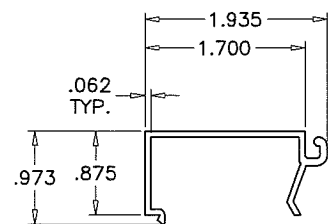


GPI-5504
6063-T5

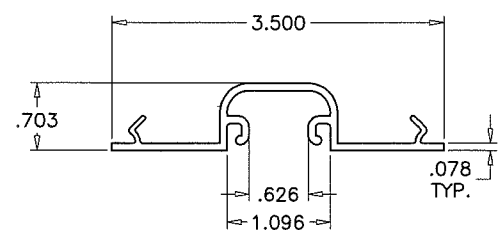

GPI-5008
6063-T6

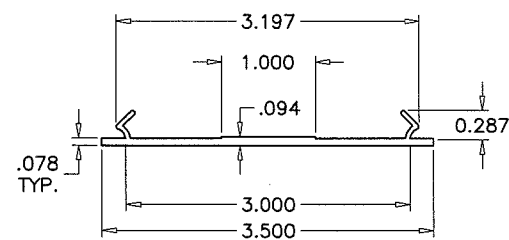


GPI-5009
6063-T6

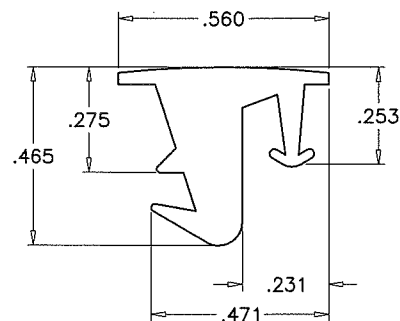


HARDNESS = 71±5 SHORE A
TENSILE STRENGTH = 1429 PSI
ELONGATION AT BREAK = 295%
TEAR STRENGTH = 221 PPI
SPECIFIC GRAVITY = 1.21


GLAZING GASKET
SCALE=2:1

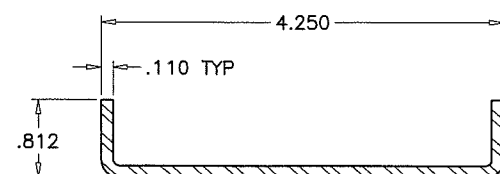


STEEL CHANNEL REINFORCEMENT

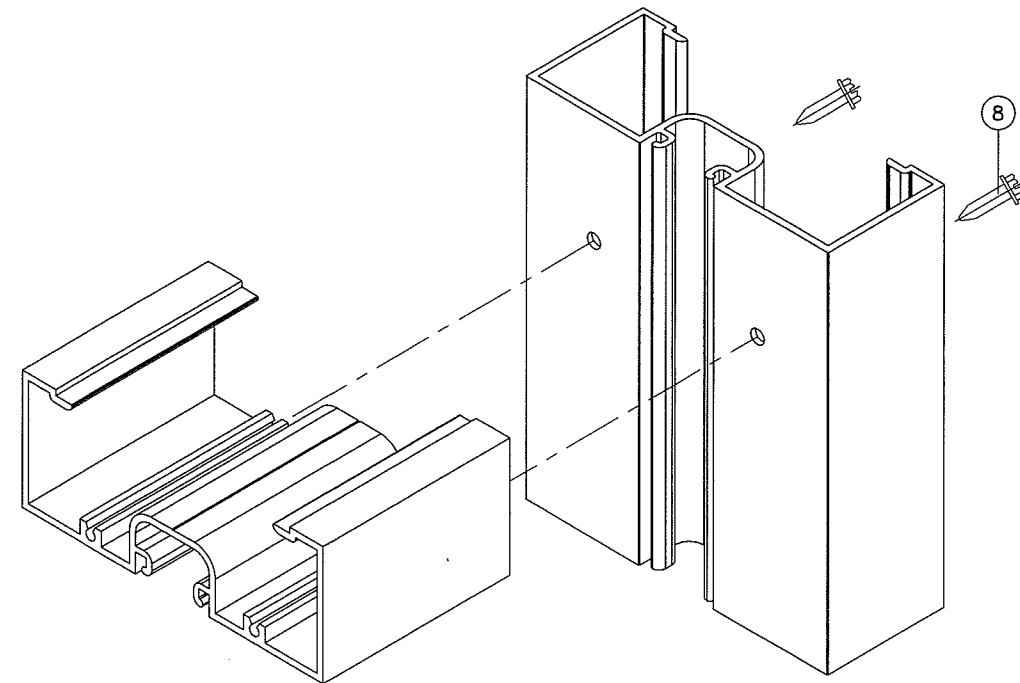

FRAME CORNERS

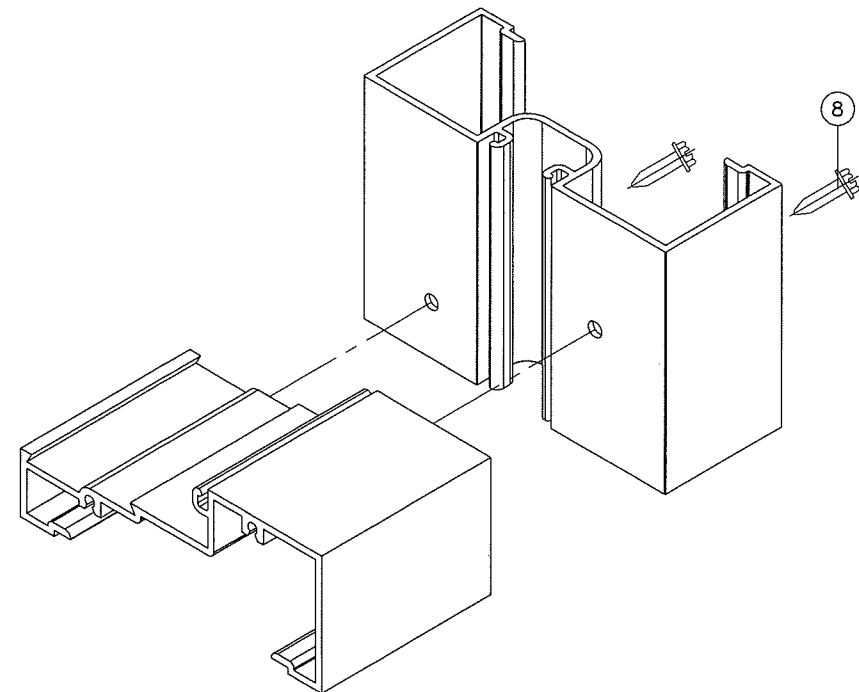

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 18-0726.01
Expiration Date Dec 4, 2023
By *Manuel Perez*
Miami Dade Product Control

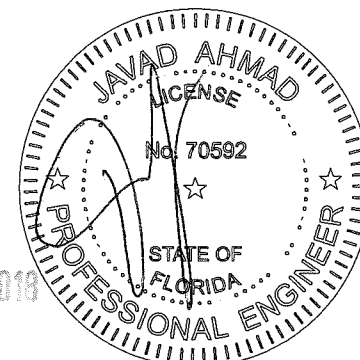

FEB 12 2019

afC
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978
STORE 97-38GGC

SERIES 4500 ALUM FLUSH GLAZED SYSTEM (N.I.)
Gopi Glass Sales & Services Corp.
7450 N.W. 41 STREET
MIAMI, FL. 33166
TEL. (305) 592-2089 FAX. (305) 477-0992

no	date	by	description
D	12.10.08		UPDATED FOR 2007 FBC
E	02.23.12		UPDATED TO 2010 FBC
F	06.11.14		NO CHANGE THIS SHEET
G	01.25.18		UPDATED TO 2017 FBC

date: 10-15-97
scale: 1/2" = 1"
dr. by: TARIQ
chk. by:

drawing no.
97-38
sheet 7 of 7