



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599

www.miamidade.gov/economy

NOTICE OF ACCEPTANCE (NOA)

Innova Eco Building System, LLC
3300 NW 110 Street
Miami, FL 33167

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER- Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Innova Panel HIP – 6” MgO High Impact Wall Panel

APPROVAL DOCUMENT: Drawing No. IEBS0003, titled “Innova Panel HIP – 6” MgO High Impact Wall Panel”, sheets 1 through 5 of 5, prepared by PTC, dated November 12, 2014, last revision #B dated April 30, 2015, signed and sealed by Robert James Amoroso, P.E., bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and the expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each panel shall bear a permanent label with the manufacturer's name or logo, city, state and the following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **renews NOA # 17-1207.03** and consists of this page 1, evidence submitted pages E-1 and E-2 as well as approval document mentioned above.

The submitted documentation was reviewed by **Helmy A. Makar, P.E., M.S.**



Helmy A. Makar
07/30/20

NOA No. 20-0619.01
Expiration Date: 05/21/2025
Approval Date: 07/30/2020
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL #14-1202.06

A. DRAWINGS

1. *Drawing No. 414-0116, titled "Innova Panel HIP – 6" MgO High Impact Wall Panel ", sheets 1 through 5 of 5, prepared by PTC, dated November 12, 2014, last revision #B dated April 30, 2015, signed and sealed by Robert James Amoruso, P.E.*

B. TEST

1. *Test report on Uniform Static Air Pressure test per TAS 202 on Wall Panels prepared by Fenestration Testing Laboratory, Inc., report No. 7848, dated October 14, 2014, signed and sealed by Idalmis Ortega, P.E. **No Air or Water Infiltration tests performed, this wall panel system is not approved for air nor water infiltration.***
2. *Test report on Large Missile Impact test and Cyclic Wind Pressure test per TAS 201 and TAS 203 on Wall Panels prepared by Fenestration Testing Laboratory, Inc., report No. 7848, dated October 14, 2014, signed and sealed by Idalmis Ortega, P.E.*
3. *Test report on Compression test only per ASTM E 72, on Wall Panels prepared by Fenestration Testing Laboratory, Inc., report No. 7870, dated November 06, 2014, signed and sealed by Idalmis Ortega, P.E.*

C. CALCULATIONS

1. *Panel allowable calculation and Fasteners verification prepared by Robert James Amoruso, P.E., 18 pages, dated November 10, 2014, signed and sealed by Robert James Amoruso, P.E.*

D. QUALITY ASSURANCE

1. *By Miami-Dade County Department of Regulatory and Economic Resources.*

E. MATERIAL CERTIFICATION

1. *None.*

F. OTHERS

1. *Florida Building Code, 2014 Edition, compliance letter issued by PTC, dated November 18, 2014, signed and sealed by Robert James Amoruso, P.E.*

2. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL #17-1207.03

A. DRAWINGS

1. *None.*

B. TEST

1. *None.*



Helmy A. Makar, P.E., M.S.
Product Control Section Supervisor
NOA No. 20-0619.01
Expiration Date: 05/21/2025
Approval Date: 07/30/2020

Innova Eco Building System, LLC

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

C. CALCULATIONS

1. *None.*

D. QUALITY ASSURANCE

1. *By Miami-Dade County Department of Regulatory and Economic Resources.*

E. MATERIAL CERTIFICATION

1. *None.*

F. OTHERS

1. *Florida Building Code, 2017 Edition, compliance letter issued by PTC, dated November 14, 2017, signed and sealed by Robert James Amoruso, P.E.*

3. NEW EVIDENCE SUBMITTED

A. DRAWINGS

1. *None.*

B. TEST

1. *None.*

C. CALCULATIONS

1. *None.*

D. QUALITY ASSURANCE

1. *By Miami-Dade County Department of Regulatory and Economic Resources.*

E. MATERIAL CERTIFICATION

1. *None.*

F. OTHERS

1. *Florida Building Code, 2017 Edition, compliance letter issued by PTC, dated November 14, 2017, signed and sealed by Robert James Amoruso, P.E.*



Helmy A. Makar, P.E., M.S.
Product Control Section Supervisor
NOA No. 20-0619.01
Expiration Date: 05/21/2025
Approval Date: 07/30/2020

INNOVA ECO BUILDING SYSTEM, LLC

INNOVA PANEL HIP - 6" MgO HIGH IMPACT WALL PANEL

INSTALLATION DETAILS

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 17-1207.03
Expiration Date 05/21/2020
By Healy A. M. Jr.
Miami Dade Product Control

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN HAS BEEN TESTED TO THE FOLLOWING PERFORMANCE TESTING STANDARDS IN ACCORDANCE WITH THE HIGH VELOCITY HURRICANE ZONE (HVHZ). OF THE LATEST EDITION OF THE FLORIDA BUILDING CODE.
- 1.1. TAS 201-94
1.2. TAS 202-94, STATIC LOADING ONLY
1.3. TAS 203-94
2. THE PRODUCT DETAILS CONTAINED HEREIN ARE BASED UPON SIGNED AND SEALED FENESTRATION TESTING LABORATORY TEST REPORT NO. LAB 7870/PROJECT NO. 14-5330, LAB NO. 7848/PROJECT NO. 14-5330 AND ASSOCIATED LABORATORY DRAWINGS TO TAS 201-94, TAS 202-94 AND TAS 203-94.
3. ADEQUACY OF THE EXISTING STRUCTURAL FRAMING SYSTEM AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT TRANSVERSE LOADS TO THE STRUCTURE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
4. THE DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, SITE SPECIFIC DOCUMENTS SHALL BE PREPARED FOR USE WITH THIS DOCUMENT AS ALLOWED BY THE AUTHORITY HAVING JURISDICTION.
5. SEE SIP PANEL SCHEDULE TABLE AND PANEL SECTION ON THIS SHEET FOR APPROVED PANEL COMPOSITION.
6. SEE PERFORMANCE RATINGS TABLE ON THIS SHEET FOR DESIGN PRESSURE LIMITATIONS BASED ON THE FOLLOWING PARAMETERS.
- 6.1. DP LIMITATION BASED ON DEFLECTION AT L/180.
6.1.1. DEFLECTIONS NOT EXCEEDING L/180 ALLOWS FOR FLEXIBLE FINISHES TO BE USED IN ACCORDANCE WITH DEFLECTION LIMITATIONS OF THE CURRENT EDITION OF THE FLORIDA BUILDING CODE.
6.2. DP LIMITATION BASED ON ULTIMATE DESIGN LOADING ACHIEVED IN TESTING TO TAS 202 DIVIDED BY A SAFETY FACTOR OF 1.5.
6.3. DP LIMITATION BASED ON IMPACT/CYCLIC LOADING TESTING TO TAS 201/203.
6.4. COMPRESSION LOAD LIMITATION BASED ON AVERAGE OF THREE TEST SPECIMENS DIVIDED BY ALLOWABLE STRESS DESIGN SAFETY FACTOR.
7. MAXIMUM PANEL SIZE
7.1. INDIVIDUAL AND OVERALL PANEL HEIGHT IS LIMITED TO 10' (120").
7.2. INDIVIDUAL PANEL WIDTH IS LIMITED TO 4' (48").
7.3. OVERALL PANEL WIDTH CAN BE CONNECTED USING SPLINE CONNECTION IN SECTION C-C SHOWN ON SHEET 3 OR PANEL-TO-PANEL CONNECTION SHOWN IN DETAIL C ON SHEET 4.
7.4. OPENINGS ARE LIMITED TO 3' X 6'-3 1/2" MAXIMUM.


INSTALLATION NOTES:

1. THE PRODUCT SHOWN SHALL BE INSTALLED IN A MANNER CONSISTANT WITH ITS TESTING AS DESCRIBED IN GENERAL NOTE 7 AND AS FOLLOWS.
2. SPLINE CONNECTIONS SHALL BE AS SHOWN IN SECTION C-C ON SHEET 2.
3. SIP END PLATES, BOTH HORIZONTAL AND VERTICAL, SHALL BE AS SHOWN IN DETAIL A ON SHEET 3.
4. SIP OPENING FACE PLATES, VERTICAL ONLY, SHALL BE AS SHOWN IN DETAIL B ON SHEET 3.
5. PANEL-TO-PANEL HEADER CONNECTIONS SHALL BE AS SHOWN IN DETAIL C ON SHEET 4.
6. SIP SUBSTRATE CONNECTIONS SHALL BE AS FOLLOWS (SEE NOTE 7 BELOW):
- 6.1. SILL
6.1.1. SEE DETAIL D ON SHEET 5 FOR INSTALLATION INTO CONCRETE SUBSTRATE.
6.1.2. SEE DETAIL E ON SHEET 5 FOR INSTALLATION INTO #2 SYP (OR WOOD WITH SG = 0.55 OR GREATER) SUBSTRATE.
- 6.2. HEAD
6.2.1. SEE DETAIL E ON SHEET 5 FOR INSTALLATION INTO #2 SYP (OR WOOD WITH SG = 0.55 OR GREATER) SUBSTRATE. INSTALLATION AT SILL SHOWN - REVERSE FOR HEAD INSTALLATION.
- 6.3. OTHER METHODS WILL REQUIRE PREPARATION OF SITE SPECIFIC DOCUMENTS PREPARED BY THE ENGINEER OF RECORD, DELEGATED ENGINEER OF ARCHITECT AS ALLOWED BY THE AUTHORITY HAVING JURISDICTION.
7. ANCHOR SCHEDULE
7.1. CONCRETE (2500 PSI MINIMUM STRENGTH)
7.1.1. 1/4" HILTI KWIK BOLT 3, 1-1/8" MINIMUM EMBEDMENT, 2 3/4" MINIMUM EDGE DISTANCE.
7.2. WOOD (SPECIFIC GRAVITY OF 0.55 OR GREATER)
7.2.1. 5/8" LAG SCREW, 3 3/8" MINIMUM EMBEDMENT (EXCLUDES SCREW TIP), 2 1/2" EDGE DISTANCE.

PERFORMANCE RATING	
BASED ON TAS 201, TAS 202, TAS 203	
TRANSVERSE LOADING DESIGN PRESSURE (PSF)	IMPACT RATING
+/-90	LARGE AND SMALL MISSILE IMPACT
THIS WALL PANEL SYSTEM IS NOT APPROVED FOR AIR INFILTRATION AND WATER PENETRATION. AIR INFILTRATION AND WATER PENETRATION TESTING TO TAS 202 WAS NOT PERFORMED.	
BASED ON ASTM E72-10, SECTION 9 COMPRESSION LOADING *	
CONCENTRATED LOADING (LBS)	DISTRIBUTED LOADING (LBS/FT)
28,563	7,141
TRANSVERSE DEFLECTION DID NOT EXCEED L/360. COMPRESSION LOAD BASED ON AVERAGE OF THREE TESTS DIVIDED BY ALLOWABLE STRESS DESIGN SAFETY FACTOR PER AISI.	
* THE ONLY LOADING PERFORMED PER ASTM E72-10 WAS THE COMPRESSION LOADING. THE TENSION OR RACKING LOADINGS WERE NOT PERFORMED. THEREFORE, NEITHER THE TENSION OR RACKING CAPACITIES ARE APPROVED.	

SIP PANEL SCHEDULE					
TOP (EXTERIOR) SKIN	BOTTOM (INTERIOR) SKIN	CORE	OVERALL PANEL THICKNESS	ADHESIVE	REINFORCEMENT
12 MM THICK MAGNESIUM OXIDE BOARD BY MGO CORP	12 MM THICK MAGNESIUM OXIDE BOARD BY MGO CORP	5 5/8" 1.0 PCF INSULFOAM EXPANDED POLYSTYRENE (EPS).	6 9/16"	DOW MOR-AD 654 LAMINATING ADHESIVE	24 OZ. PHENOLIC RESIN REINFORCEMENT ON ONE SIDE OF THE WALL BETWEEN THE FOAM AND THE MAGNESIUM OXIDE BOARD.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES, PERFORMANCE RATING & INSTALLATION NOTES
2	SIP ELEVATIONS AND SPLINE DETAILS
3	SIP END DETAILS
4	SIP END DETAILS
5	SUBSTRATE CONNECTION DETAILS

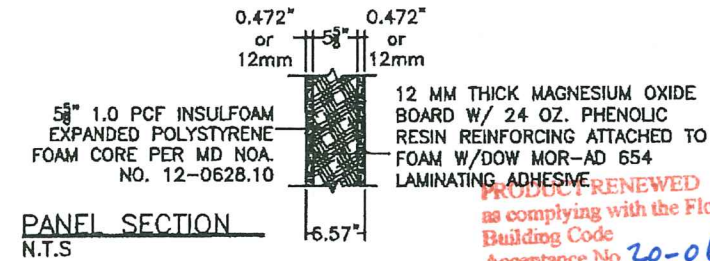

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No 20-0619.01
Expiration Date 05/21/2025
By Healy A. M. Jr.
Miami Dade Product Control

PROJECT NO. 414-0116

INNOVA ECO BUILDING SYSTEM, LLC

3300 NW 110 STREET
MIAMI, FL 33167

TITLE: INNOVA PANEL HIP - 6" MgO HIGH IMPACT WALL PANEL
GENERAL NOTES, PERFORMANCE RATING & PANEL SCHEDULE


PREPARED BY: PTC
DATE: 11/12/14
DRAWING NO: IEBS0003
SCALE: NONE
REV: B


PTC PRODUCT DESIGN GROUP, LLC
P.O. Box 520775
Longwood, FL 32752-0775
Phone: 321.580.1788
Fax: 321.580.1789
Email: info@ptc-corp.com

Approved as complying with the
Florida Building Code
Date 05/14/2015
NOA# 14-1202.06
Miami Dade Product Control


By Healy A. M. Jr.

Robert J. Amoroso, P.E.
Florida P.E. No. 49752

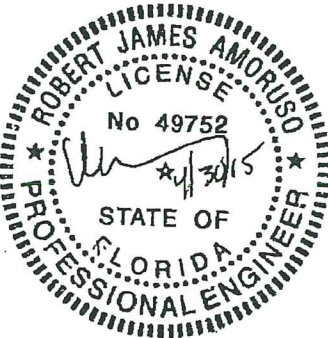

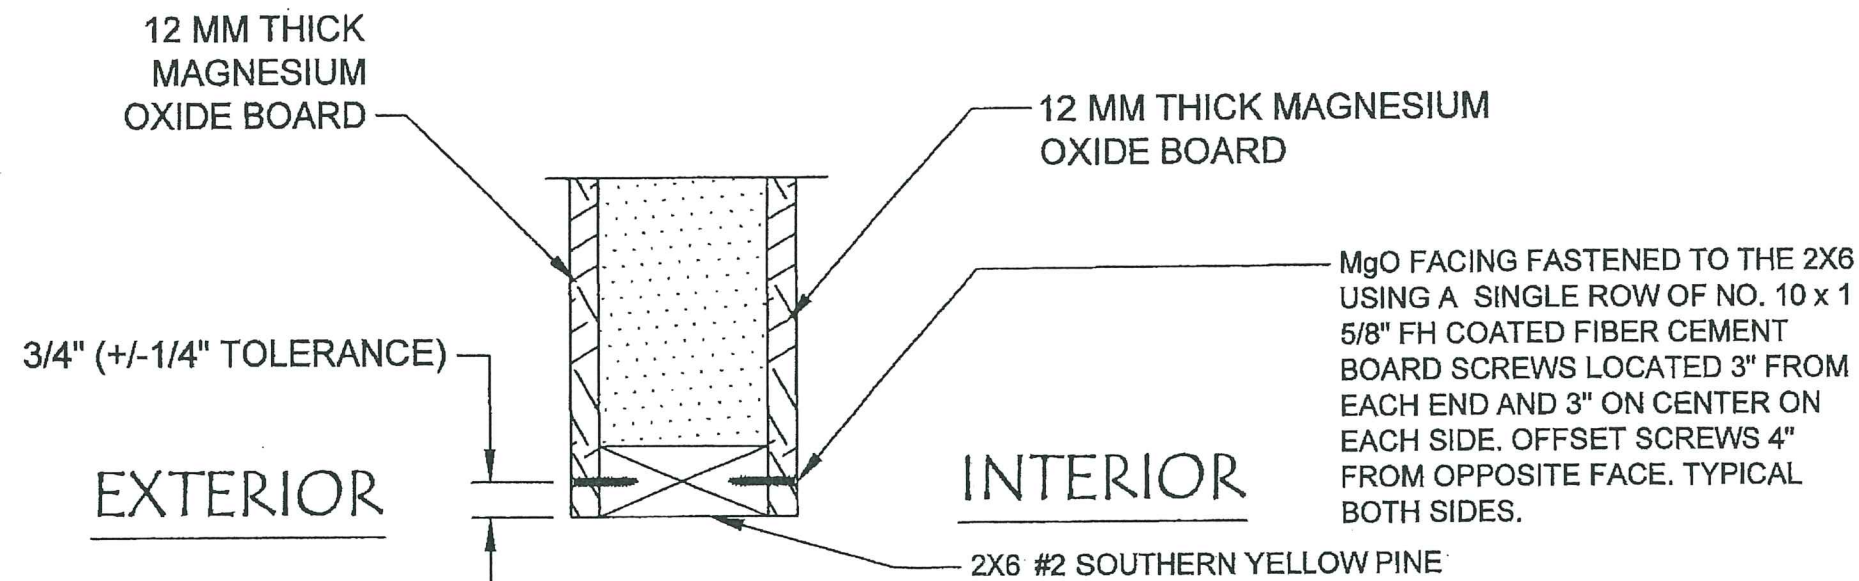

DETAIL A – MgO/MgO PANEL
SIDE/END PLATE CONNECTIONS
N.T.S

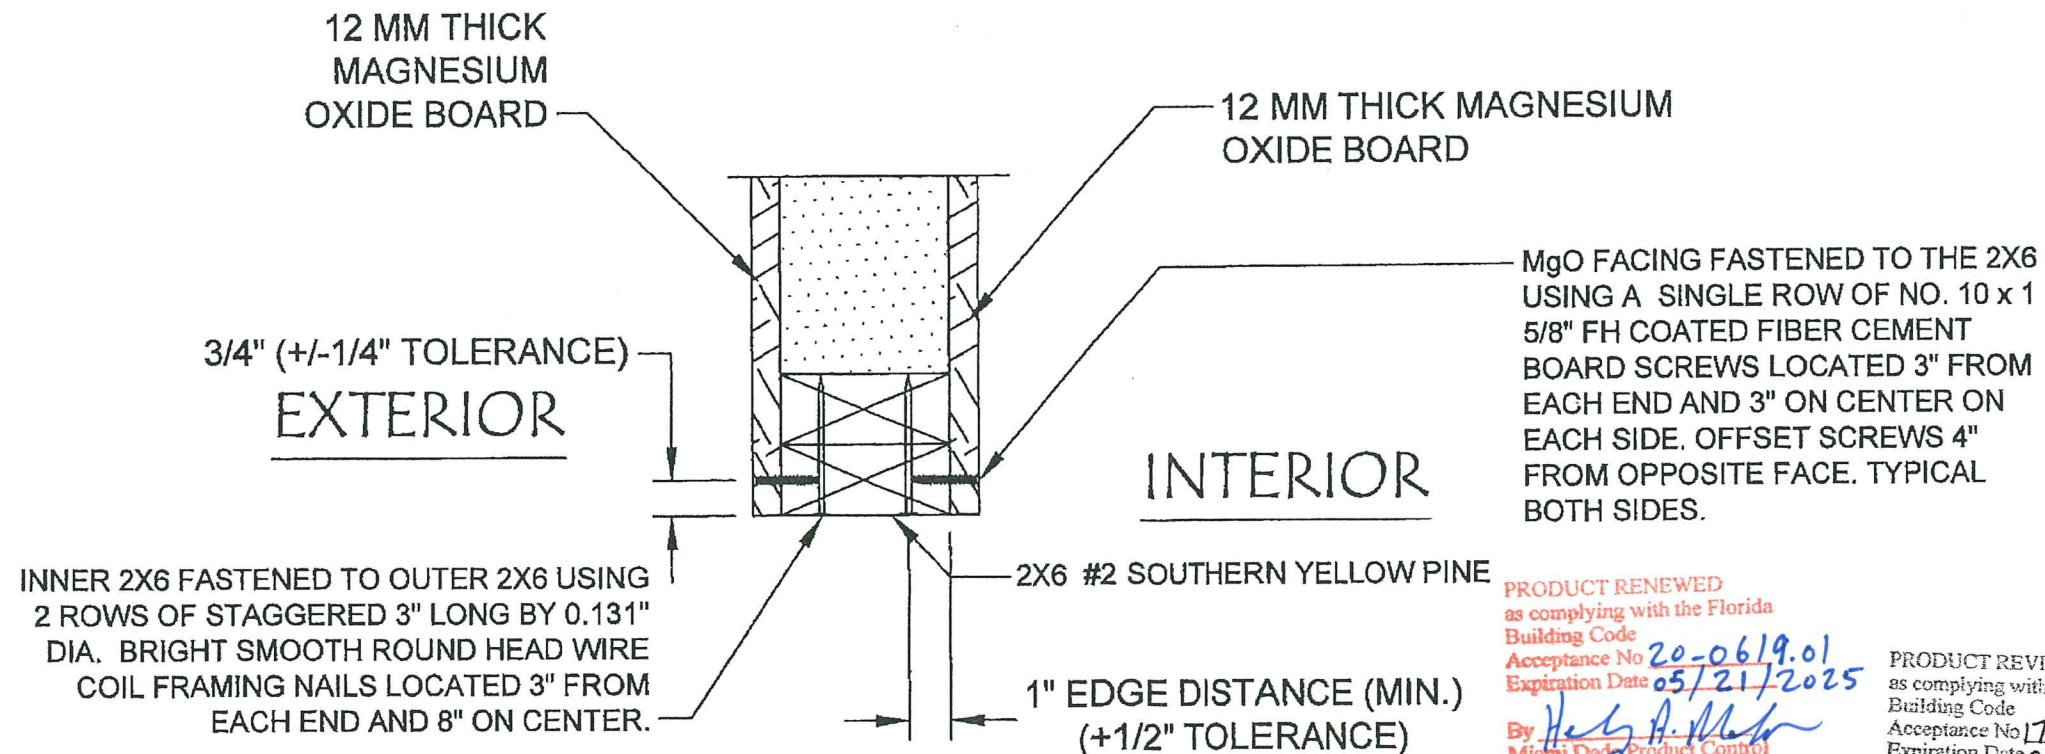


DETAIL B – OPENING SECTION
N.T.S

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No 20-0619.01
Expiration Date 05/21/2025
By *Healy A. Mohr*
Miami Dade Product Control


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 17-1207.03
Expiration Date 05/21/2020
By *Healy A. Mohr*
Miami Dade Product Control

Approved as complying with the
Florida Building Code
Date 05/14/2015
NOA# 14-1202.06
Miami Dade Product Control
By *Healy A. Mohr*


Robert J. Amoroso, P.E.
Florida P.E. No. 49752

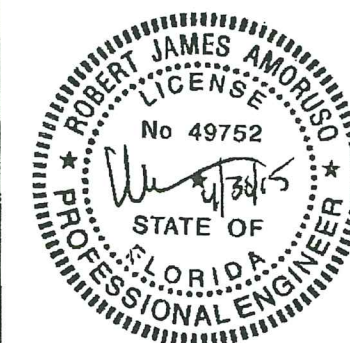

PROJECT NO. 414-0116					
INNOVA ECO BUILDING SYSTEM, LLC					
3300 NW 110 STREET					
MIAMI, FL 33167					
TITLE: INNOVA PANEL HIP - 6" MgO HIGH IMPACT WALL PANEL					
SIP END DETAILS					
DATE:	11/12/14				
DRAWN BY:	RJA				
SCALE:	NONE				
DRAWING NO:	IEBS0003				
REV:	B				
SHEET:	3 OF 5				
REVISION	DESCRIPTION				
REV	A				
REV	B				
REV	C				
REV	D				
REV	E				
REV	F				
REV	G				
REV	H				
REV	I				
REV	J				
REV	K				
REV	L				
REV	M				
REV	N				
REV	O				
REV	P				
REV	Q				
REV	R				
REV	S				
REV	T				
REV	U				
REV	V				
REV	W				
REV	X				
REV	Y				
REV	Z				

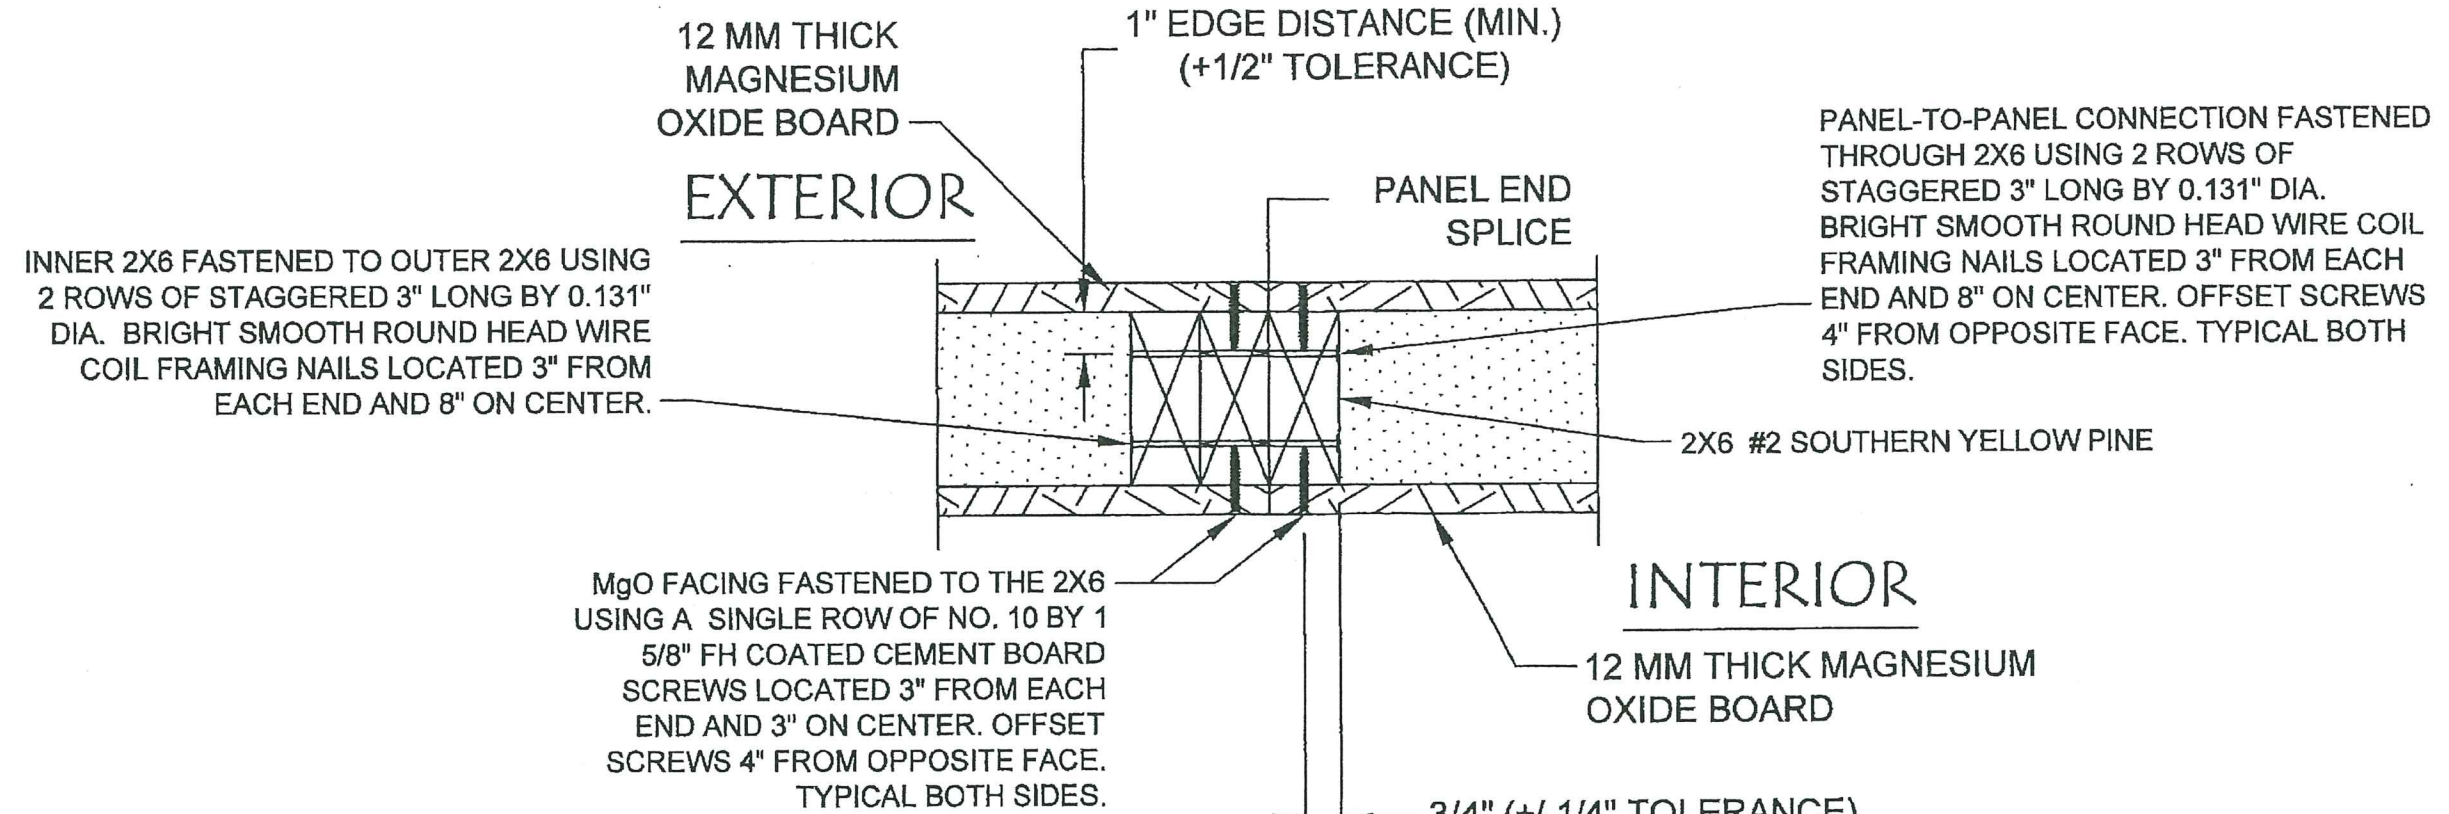

DETAIL C — MgO/MgO HEADER PANEL
 PANEL-TO-PANEL CONNECTIONS
 N.T.S

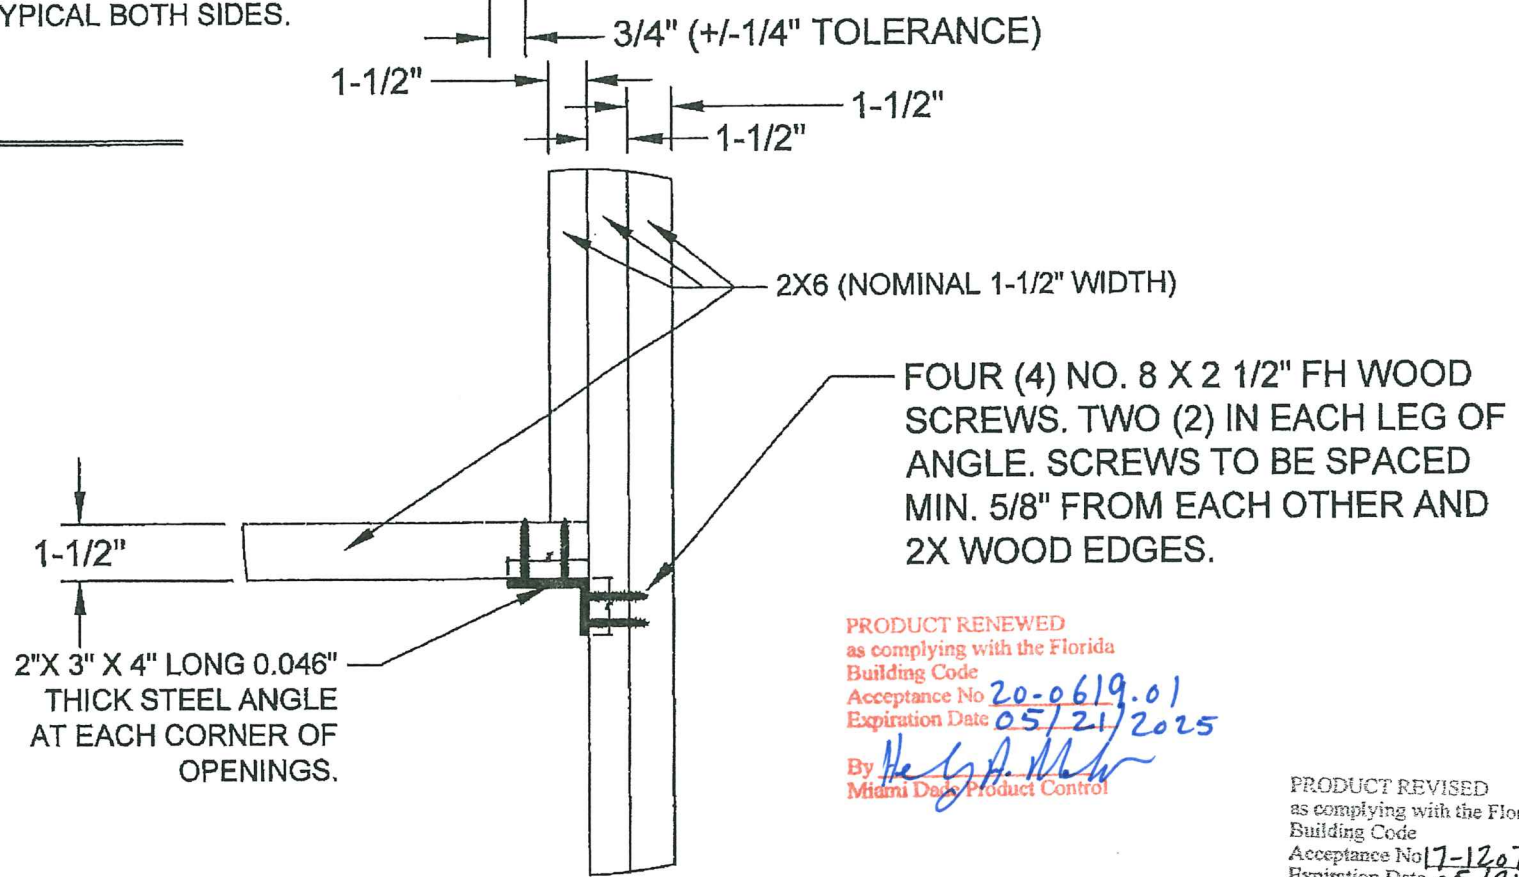


DETAIL D — OPENING PANEL CONNECTION ANGLE
 N.T.S


PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No 20-0619.01
 Expiration Date 05/21/2025
 By *Healy A. Mohr*
 Miami Dade Product Control

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No 17-1207.03
 Expiration Date 05/21/2020
 By *Healy A. Mohr*
 Miami Dade Product Control

Approved as complying with the
 Florida Building Code
 Date 05/14/2015
 NOA# 14-1202.06
 Miami Dade Product Control
 By *Healy A. Mohr*

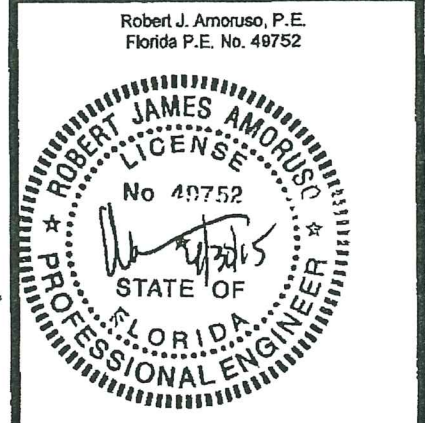


PROJECT NO. 414-0116		INNOVA ECO BUILDING SYSTEM, LLC		3300 NW 110 STREET MIAMI, FL 33167	
TITLE: INNOVA PANEL HIP - 6" MgO HIGH IMPACT WALL PANEL		DATE: 11/12/14		DRAWN BY: RJA	
REVISED PER MD REVIEW COMMENTS		DATE: 4/30/15		SCALE: NONE	
REVISED PER MD REVIEW COMMENTS		DATE: 4/21/15		DRAWING NO: IEBS0003	
DESCRIPTION		REV: B		SHEET: 4 OF 5	

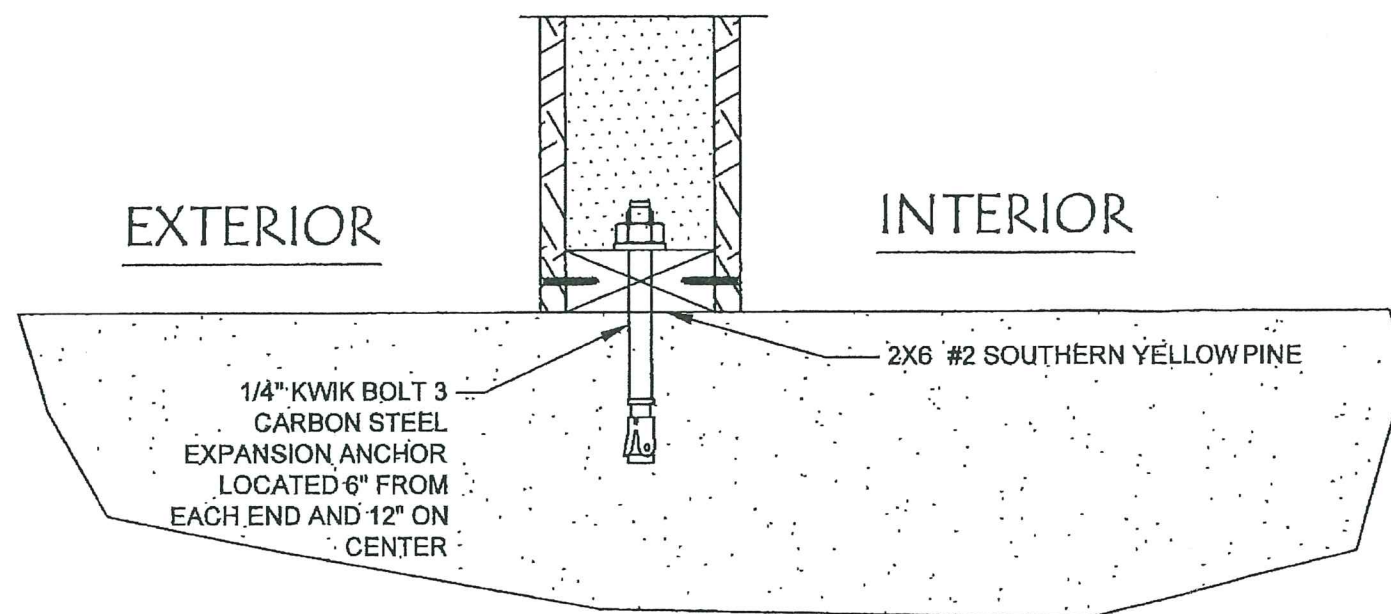

SECTION D - MgO/MgO PANEL SIDE/END PLATE CONNECTIONS CONCRETE SUBSTRATE INSTALLATIONS

N.T.S

SEE DETAIL A ON SHEET 3 FOR SIP PANEL COMPONENTS.
SEE ANCHOR SCHEDULE ON SHEET 1, INSTALLATION NOTE 6 FOR SUBSTRATE
FASTENING REQUIREMENTS.

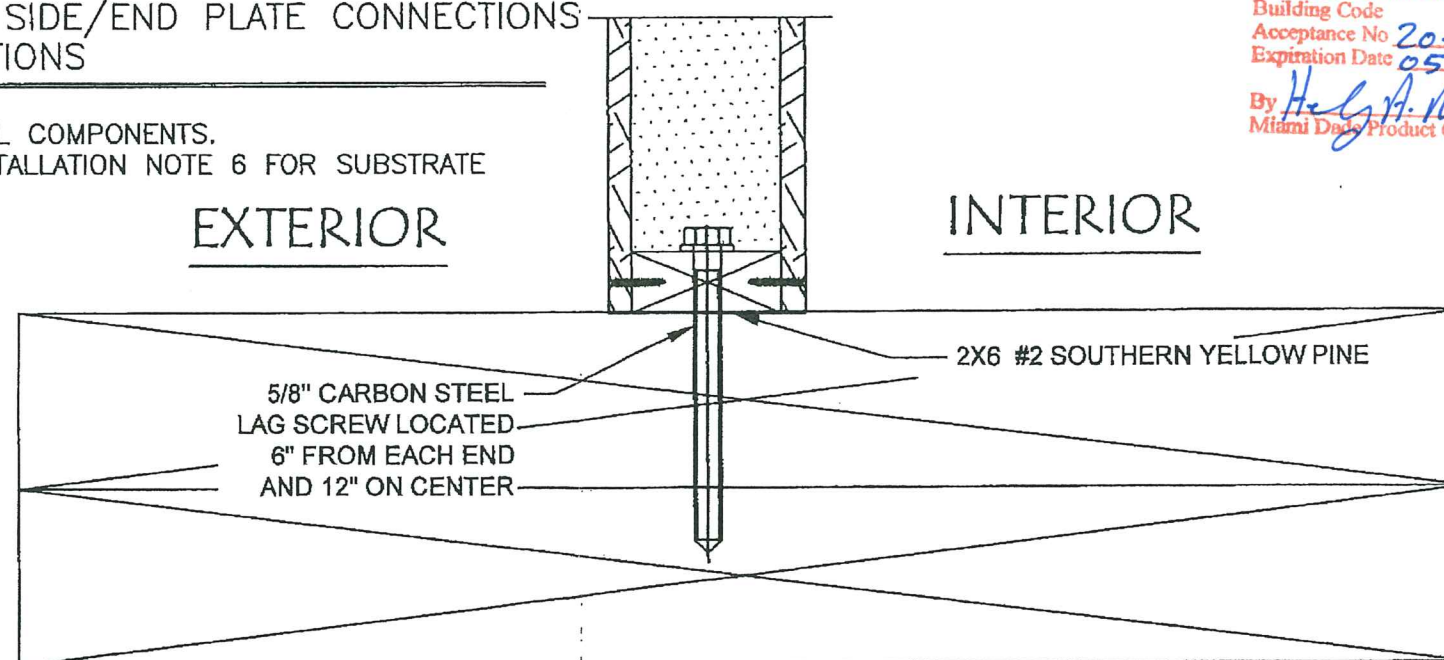

DETAIL E - MgO/MgO PANEL SIDE/END PLATE CONNECTIONS WOOD SUBSTRATE INSTALLATIONS

N.T.S

SEE DETAIL A ON SHEET 3 FOR SIP PANEL COMPONENTS.
SEE ANCHOR SCHEDULE ON SHEET 1, INSTALLATION NOTE 6 FOR SUBSTRATE
FASTENING REQUIREMENTS.

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 20-0619.01
Expiration Date 05/21/2025
By *H. A. Amoroso*
Miami Dade Product Control

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 17-1207.03
Expiration Date 05/21/2020
By *H. A. Amoroso*
Miami Dade Product Control

PROJECT NO. 414-0116

REV	DESCRIPTION	DATE	BY
B	REVISED PER MD REVIEW COMMENTS	4/30/15	RJA
A	REVISED PER MD REVIEW COMMENTS	4/21/15	RJA

INNOVA ECO BUILDING SYSTEM, LLC
3300 NW 110 STREET
MIAMI, FL 33167

TITLE: INNOVA PANEL HIP - 6" MgO HIGH IMPACT WALL PANEL
SUBSTRATE CONNECTION DETAILS

PREPARED BY:	DATE:	DRAWING NO:	SHEET:
RJA	11/12/14	IEBS0003	5 OF 5
SCALE:	NONE	REV:	B

Approved as complying with the
Florida Building Code
Date 05/14/2015
NOA# 14-1207.06
Miami Dade Product Control

By *H. A. Amoroso*

Robert J. Amoroso, P.E.
Florida P.E. No. 49752

