



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION

11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599

www.miamidade.gov/economy

TKO Doors, Div. of 4Front Engineered Solutions, Inc.
N56 W24701 N. Corporate Circle
Sussex, WI 53089

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Model TW WL Dock Plastic Sectional Garage Door up to 10'-0" Wide x 10'-0" High

APPROVAL DOCUMENT: Drawing No. **20-26587**, titled "Fiberglass Dock Doors TW WL Overhead Garage Door", sheet 1 through 7 of 7, dated 05/06/2013, with last revision dated 07/30/2020, prepared by Engineering Express, signed and sealed by Frank L. Bennardo, P.E., bearing the Miami-Dade County Product Control revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: A permanent label with the manufacturer's name or logo, manufacturing address, model number, the positive and negative design pressure rating, indicate impact rated if applicable, installation instruction drawing reference number, approval number (NOA), the applicable test standards, and the statement reading 'Miami-Dade County Product Control Approved' is to be located on the door's side track, bottom angle, or inner surface of a panel.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises NOA # 19-0522.02** and consists of this page 1 and evidence pages E-1, E-2 and E-3, as well as approval document mentioned above.

The submitted documentation was reviewed by **Carlos M. Utrera, P.E.**



NOA No 20-0901.16
Expiration Date: August 14, 2024
Approval Date: November 12, 2020
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. Submitted under previous NOA's

A. DRAWINGS “Submitted under NOA #15-0916.09”

1. Drawing No. **15-2399**, titled “Fiberglass Dock Doors TW WL Overhead Garage Door”, sheet 1 through 7 of 7, dated 05/06/2013, with last revision dated 05/06/2015, prepared by Engineering Express, signed and sealed by Frank L. Bennardo, P.E.

B. TESTS “Submitted under NOA # 13-0521.04”

1. Test reports on 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
4) Forced Entry Test, per FBC TAS 202-94
Along with marked-up drawings and installation diagram of Welter Weight Doors, prepared by Architectural Testing, Inc., Test Report No. **D5680.01-602-18**, dated 04/07/2014, signed and sealed by Shawn G. Collins, P.E.
2. Test reports on 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
4) Forced Entry Test, per FBC TAS 202-94
Along with marked-up drawings and installation diagram of Welter Weight Doors, prepared by Architectural Testing, Inc., Test Report No. **C3614.01-602-18**, dated 03/28/2013, signed and sealed by Shawn G. Collins, P.E.
3. Test report on Self-ignition Temperature per ASTM D1929, Smoke Density Rating per ASTM D2843 and Rate of Burn per ASTM D635 of various plastic door components, prepared by Architectural Testing, Inc., Test Report No. **C2850.01-106-18**, dated 11/21/2012, signed and sealed by Gary T. Hartman, P.E.

C. CALCULATIONS “Submitted under NOA #15-0916.09”

1. Jamb anchor calculations prepared by Engineering Express, dated 05/05/2015, signed and sealed by Frank L. Bennardo, P.E.

“Submitted under NOA # 13-0521.04”
2. Jamb anchor calculations prepared by Engineering Express, dated 05/14/2013 and 05/22/2014, signed and sealed by Frank L. Bennardo, P.E.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS “Submitted under NOA # 13-0521.04”

1. Test report on Flame Spread Index and Smoke Developed Index per UL-723 of XEPS foam insulation, Test Report No. **BRYX.R3573** dated 07/12/2010.



Carlos M. Utrera, P.E.
Product Control Examiner
NOA No 20-0901.16
Expiration Date: August 14, 2024
Approval Date: November 12, 2020

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

F. STATEMENTS “Submitted under NOA #15-0916.09”

1. Statement letter of code conformance with the 5th edition (2014) FBC, issued by Engineering Express, dated 05/04/2015, signed and sealed by Frank L. Bennardo, P.E.
2. Statement letter of no financial interest issued by Engineering Express, dated 05/04/2015, signed and sealed by Frank L. Bennardo, P.E.

2. Evidence submitted under NOA # 16-0725.04

A. DRAWINGS

1. Drawing No. **15-2399**, titled “Fiberglass Dock Doors TW WL Overhead Garage Door”, sheet 1 through 7 of 7, dated 05/06/2013, with last revision dated 06/21/2016, prepared by Engineering Express, signed and sealed by Frank L. Bennardo, P.E. on 03/27/2018.

B. TESTS

1. Test report on Airflow (Infiltration and Exfiltration) Rate, per ASTM E283-04 of a Thermal Weight (TW) WL dock door, prepared by Intertek/ATI, Test Report No. **E7174.01-602-18**, dated 07/21/2015, signed and sealed by Justin P. McDonald, P.E.

C. CALCULATIONS

1. None.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS

1. None.

F. STATEMENTS

1. Statement letter of code conformance with the 6th edition (2017) FBC issued by Engineering Express, dated 03/29/2018, signed and sealed by Frank L. Bennardo, P.E.
2. Statement letter of no financial interest issued by Engineering Express, dated 03/29/2018, signed and sealed by Frank L. Bennardo, P.E.



Carlos M. Utrera, P.E.
Product Control Examiner
NOA No 20-0901.16
Expiration Date: August 14, 2024
Approval Date: November 12, 2020

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

3. New evidence submitted

A. DRAWINGS

1. Drawing No. **20-26587**, titled “Fiberglass Dock Doors TW WL Overhead Garage Door”, sheet 1 through 7 of 7, dated 05/06/2013, with last revision dated 07/30/2020, prepared by Engineering Express, signed and sealed by Frank L. Bennardo, P.E.

B. TESTS

1. None.

C. CALCULATIONS

1. None.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS

1. None.

F. STATEMENTS

1. Statement letter of code conformance with the 7th edition (2020) FBC issued by Engineering Express, dated 08/05/2020, signed and sealed by Frank L. Bennardo, P.E.
2. Statement letter of no financial interest issued by Engineering Express, dated 08/05/2020, signed and sealed by Frank L. Bennardo, P.E.




Carlos M. Utrera, P.E.
Product Control Examiner
NOA No 20-0901.16
Expiration Date: August 14, 2024
Approval Date: November 12, 2020


C:\Users\eric\Engineering Express\Production - Documents\Projects\20-26587 - NOA - 19-0522.02 - Model TW WL Garage Door 10x10WLP2020 FBC6b 20-26587c Thermal Weight Sectional Door (NOA).dwg
08/11/2020 - 3:20pm eric

TW WL DOCK DOORS

LARGE MISSILE IMPACT RESISTANT

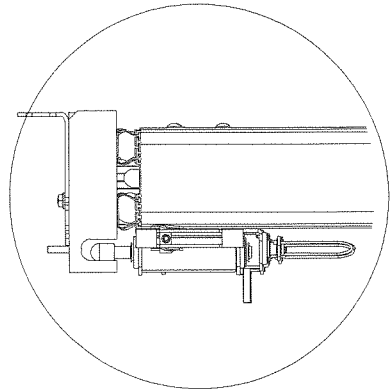

DETAIL B
SCALE 1 / 5

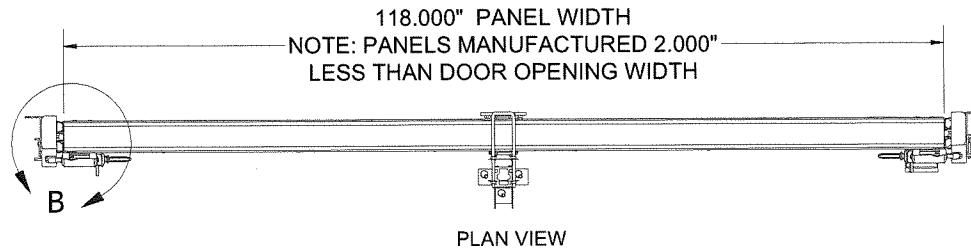


118.000" PANEL WIDTH
NOTE: PANELS MANUFACTURED 2.000"
LESS THAN DOOR OPENING WIDTH

PLAN VIEW

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 20-0901.16

Expiration Date 08/14/2024

By *[Signature]*
Miami-Dade Product Control

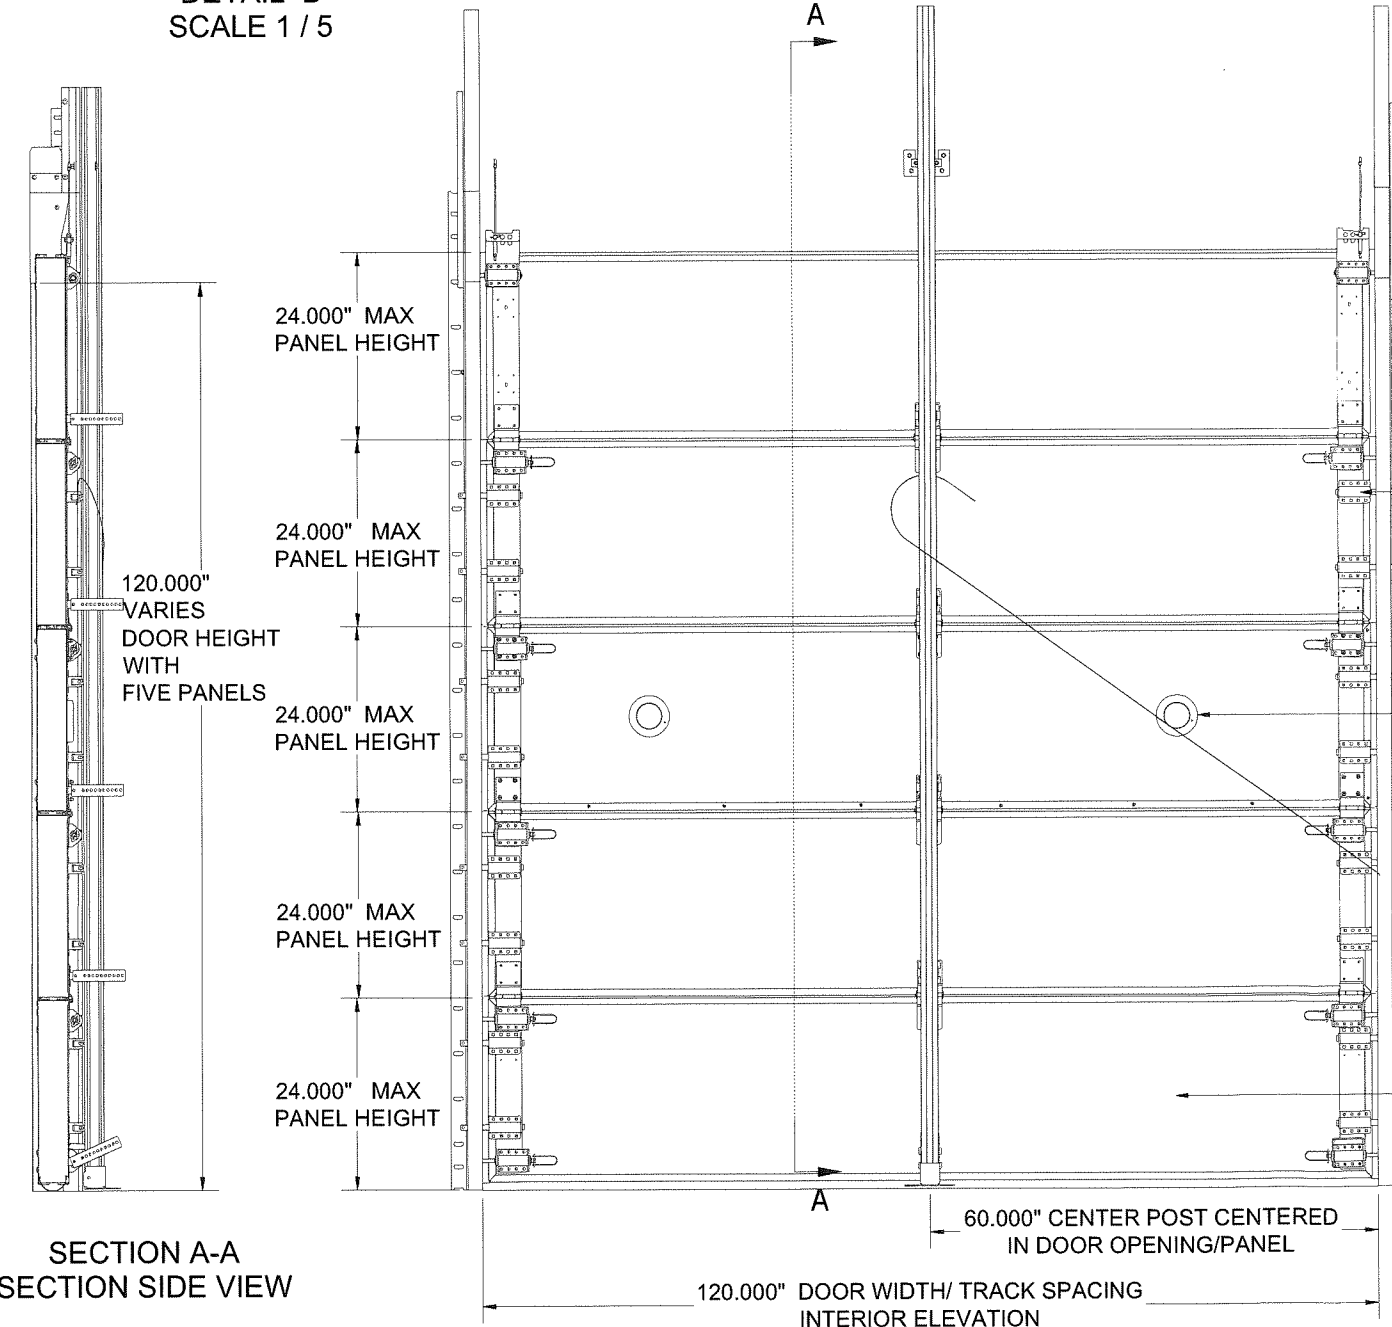

SECTION A-A
SECTION SIDE VIEW

24.000" MAX
PANEL HEIGHT

24.000" MAX
PANEL HEIGHT

24.000" MAX
PANEL HEIGHT

24.000" MAX
PANEL HEIGHT

24.000" MAX
PANEL HEIGHT

120.000"
VARIES
DOOR HEIGHT
WITH
FIVE PANELS

120.000" DOOR WIDTH/ TRACK SPACING
INTERIOR ELEVATION

60.000" CENTER POST CENTERED
IN DOOR OPENING/PANEL

SEE SHEETS 6 OF 7
AND 7 OF 7 FOR DETAIL
PANEL HARDWARE

SEE SHEET 4 OF 7 FOR DETAIL
LOWER TRACK ASSEMBLY

SEE SHEET 2 OF 7 FOR
PANEL ASSEMBLY

SEE SHEET 5 OF 7 FOR DETAIL
TRACK ANCHOR MOUNTING

SEE SHEET 3 OF 7 FOR
DETAIL PANEL COMPONENTS

GENERAL NOTES

1. THE SYSTEM DESCRIBED HEREIN HAS BEEN DESIGNED AND TESTED IN ACCORDANCE WITH THE FLORIDA BUILDING CODE SEVENTH EDITION (2020), FOR USE WITHIN AND OUTSIDE THE HIGH VELOCITY HURRICANE ZONE, PER TAS 201 / 202 / 203 STANDARDS.
2. NO 33-1/3% INCREASE IN ALLOWABLE STRESS HAS BEEN USED IN THE DESIGN OF THIS SYSTEM. WIND LOAD DURATION FACTOR Cd=1.6 HAS BEEN USED FOR WOOD ANCHOR DESIGN.
3. POSITIVE AND NEGATIVE DESIGN PRESSURES CALCULATED FOR USE WITH THIS SYSTEM SHALL BE DETERMINED PER SEPARATE ENGINEERING IN ACCORDANCE WITH THE GOVERNING CODE. PRESSURE REQUIREMENTS AS DETERMINED IN ACCORDANCE WITH ASCE 7 AND SECTION 1620 OF THE FLORIDA BUILDING CODE SHALL BE LESS THAN OR EQUAL TO THE POSITIVE OR NEGATIVE DESIGN PRESSURE CAPACITY VALUES LISTED HEREIN FOR ANY ASSEMBLY AS SHOWN.
4. DESIGN PRESSURES NOTED HEREIN ARE BASED ON MAXIMUM TESTED PRESSURES DIVIDED BY A 1.5 SAFETY FACTOR.
5. THE SYSTEM DETAILED HEREIN IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SPECIFIC SITE. FOR SITE CONDITIONS DIFFERENT FROM THE CONDITIONS DETAILED HEREIN, A LICENSED ENGINEER OR REGISTERED ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE IN CONJUNCTION WITH THIS DOCUMENT.
6. CONTRACTOR SHALL VERIFY THE ADEQUACY OF THE EXISTING STRUCTURE TO WITHSTAND SUPERIMPOSED LOADS. WOOD BUCKS (BY OTHERS) SHALL BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE EXISTING STRUCTURE.
7. ALL BOLTS & WASHERS SHALL BE ZINC COATED STEEL, GALVANIZED STEEL, OR STAINLESS STEEL WITH A MINIMUM TENSILE YIELD STRENGTH OF 60 KSI U.O.N.
8. ALL DISSIMILAR MATERIALS IN CONTACT SHALL BE PAINTED, PLATED OR OTHERWISE INSULATED.
9. DOOR HEIGHT MAY VARY UP TO A MAXIMUM HEIGHT OF 120", PROVIDED THAT INDIVIDUAL PANEL HEIGHTS DO NOT EXCEED 24".
10. ALL HARDWARE & FASTENERS SHALL BE IN ACCORDANCE WITH THESE DRAWINGS & MAY NOT VARY UNLESS SPECIFICALLY MENTIONED ON THE DRAWINGS.

ALLOWABLE
DESIGN PRESSURES
+52.0 PSF
-52.0 PSF

VISIT [ECALC.IO/26587](https://ecalculator.com/26587)

FOR SITE SPECIFIC DEVIATIONS
& MORE INFORMATION ABOUT THIS DOCUMENT
OR SCAN THIS QR CODE
VISIT [ENGINEERINGEXPRESS.COM/STORE](https://engineeringexpress.com/store)
FOR ADDITIONAL PLANS, REPORTS & RESOURCES



FRANK BENNARDO, PE
PE# 0046549 CA# 9885

08/11/2020

CORPORATE OFFICE:
160 SW 12th AVE, SUITE 106
DEERFIELD BEACH, FL 33442
(954) 354-0660 | (866) 396-9999
TEAM@ENGINEERINGEXPRESS.COM
ENGINEERINGEXPRESS.COM


TKO DOORS, DIVISION OF 4FRONT ENGINEERED SOLUTIONS, INC.
N56 W24701 NORTH CORPORATE CIRCLE, SUITE A
SUSSEX, WI 53089
PHONE: 1-800-575-3366 FAX: (262) 246-1301
FIBERGLASS DOCK DOORS
TW WL OVERHEAD GARAGE DOOR
MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DRWN	CHKD	DATE
INT ISSUE	KL	FLB	05/06/13
REV - PER COMMENTS	KL	FLB	05/16/14
REV (FBC UPDATE)	RWN	CSL	05/06/15
REV - NEW PARTS	AMD	RWN	06/21/16
REV (COMMENTS & 2017FBC)	AMD	RWN	06/21/16
REV (FBC UPDATE)	EPR	RWN	07/30/20

COPYRIGHT ENGINEERING EXPRESS


20-26587

SCALE:
PAGE DESCRIPTION:



By 
Miami-Dade Product Control

2



By


© 2006 The Authors
Journal compilation © 2006 Blackwell Publishing Ltd

C:\Users\eric\Engineering\Express\Production - Documents\Projects\20-26587 - NOA - 19-0522.02 - Model TW WL Garage Door 10x10WPL2020 FBC16b 20-26587c Thermal Weight Sectional Door (NOA).dwg


eric

08/11/2020 - 3:20pm


LEFT HAND SIDE TRACK

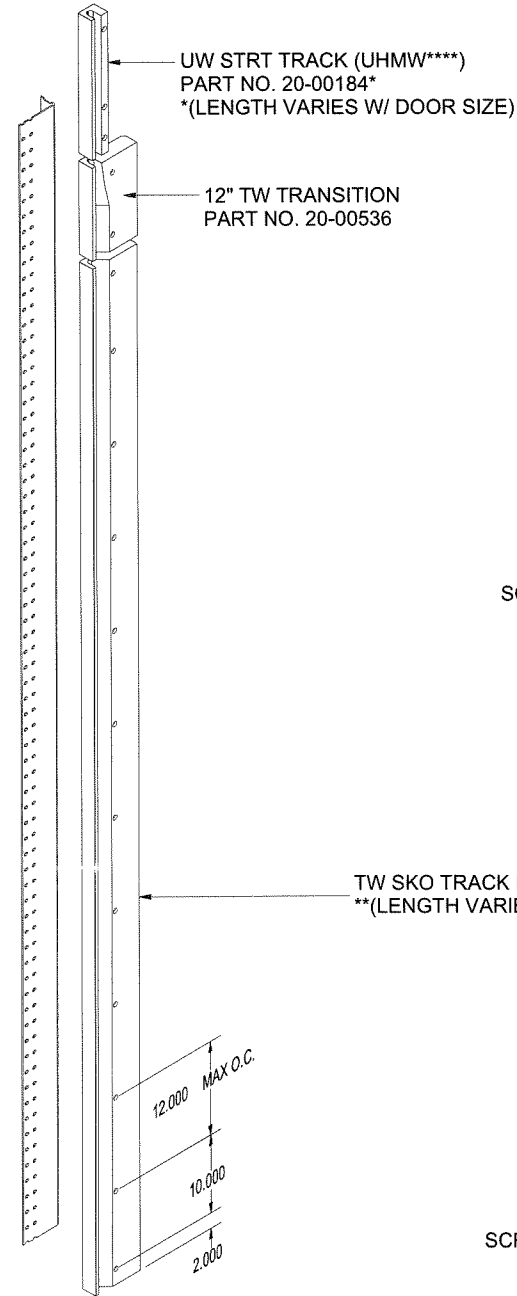

STANDARD MOUNT





REVERSE MOUNT




TW WL LOWER TRACK ASSEMBLY

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 20-0901.16
Expiration Date 08/14/2024
By *[Signature]*
Miami-Dade Product Control


RIGHT HAND SIDE TRACK

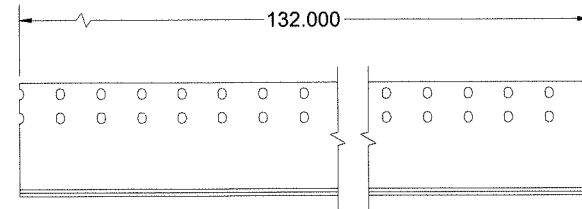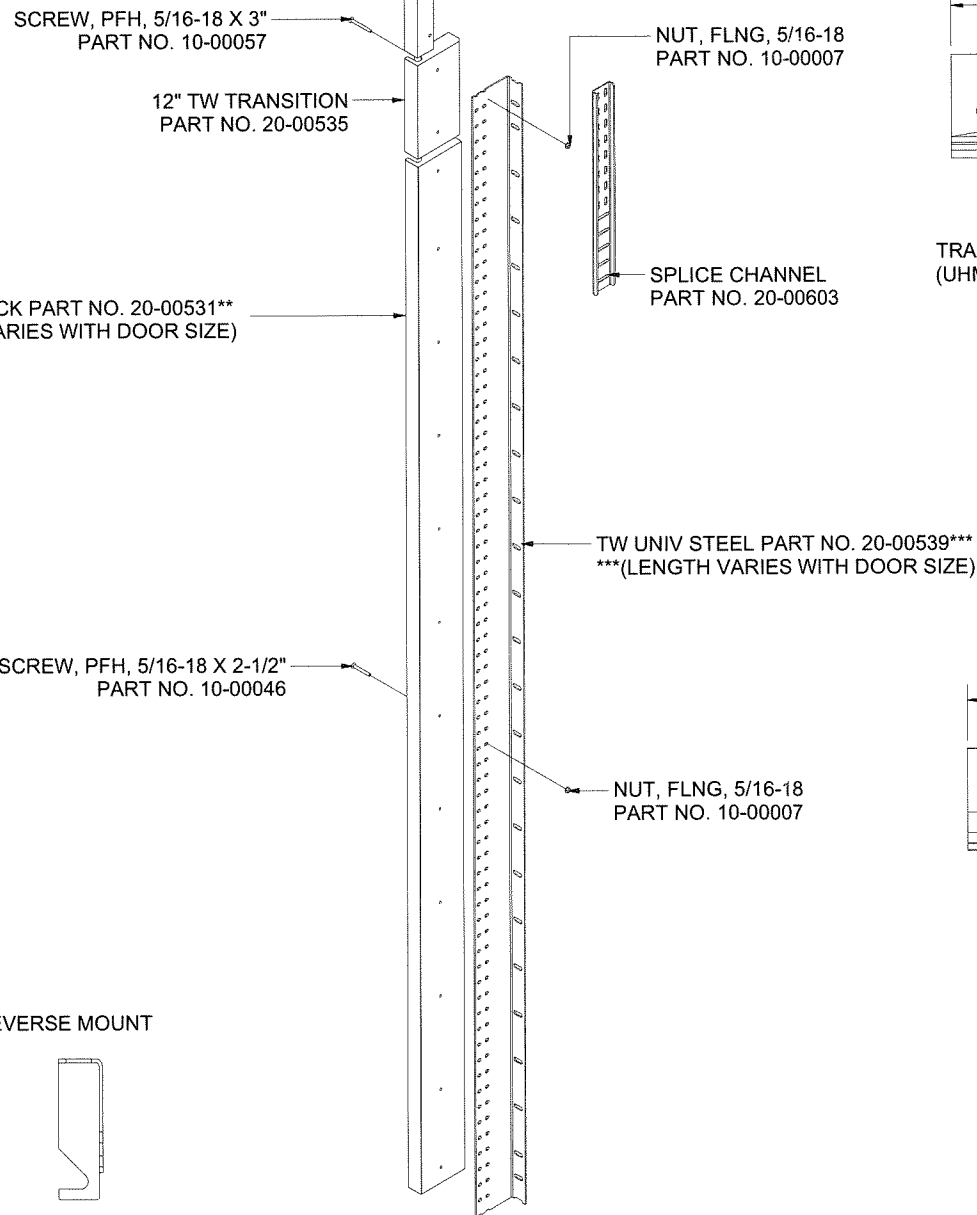


TRACK, TW UNIV STL 132" (8-GA ASTM A653 G90)(Fy=35 Ksi, MIN)
PART NO. 20-00539
TRACK, TW UNIV STL 132" S/S (8-GA TYPE 304 SS)(Fy=30 Ksi, MIN)
PART NO. 20-02249




UW STRT TRACK (UHMW****)
PART NO. 20-00184

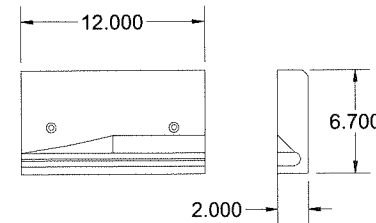


TRACK, TW, 12" TRN SKO>STRT LH
(UHMW****) PART NO. 20-00536

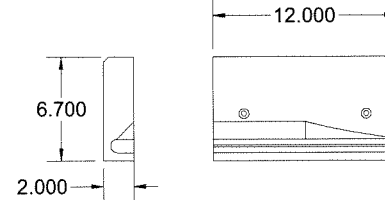

TRACK, TW, 12" TRN SKO>STRT RH
(UHMW****) PART NO. 20-00535



SPLICE CHANNEL (8-GA ASTM A653 G90; Fy = 35KSI MIN.)
PART NO. 20-00603
SPLICE CHANNEL S/S (8-GA TYPE 304 SS)(Fy=30 Ksi, MIN)
PART NO. 20-01083

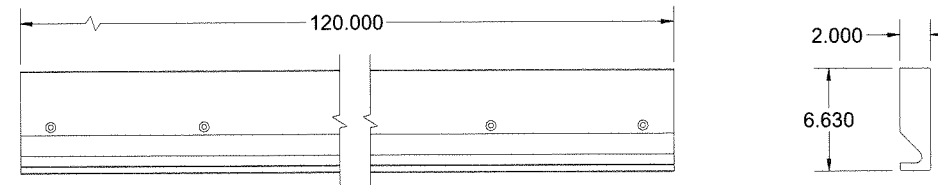

TRACK, TW, SKO 120" (UHMW****)
PART NO. 20-00531

****UHMW (ULTRA-HIGH-MOLECULAR-WEIGHT POLYETHYLENE)

FRANK BENNARDO, PE
PE# 0046549 CA# 9885
08/11/2020
No 46549
STATE OF FLORIDA
PROFESSIONAL ENGINEER
ENGINEERING EXPRESS
CORPORATE OFFICE:
160 SW 12th AVE, SUITE 106
DEERFIELD BEACH, FL 33442
(954) 354-0660 | (866) 396-9999
TEAM@ENGINEERINGEXPRESS.COM
ENGINEERINGEXPRESS.COM


TKO DOORS, DIVISION OF 4FRONT ENGINEERED SOLUTIONS, INC.
N56 W24701 NORTH CORPORATE CIRCLE, SUITE A
SUSSEX, WI 53089
PHONE: 1-800-575-3366 FAX: (262) 246-1301
FIBERGLASS DOCK DOORS
TW WL OVERHEAD GARAGE DOOR
MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DRWN	CHKD	DATE
INIT ISSUE	KL	FLB	05/06/13
REV. PER COMMENTS	KL	FLB	05/16/14
REV (FBC UPDATE)	RWN	CSL	05/06/15
REV - NEW PARTS	AMD	RWN	06/21/16
REV (COMMENTS & 2017FBC)	AMD	RWN	06/21/16
REV (FBC UPDATE)	EPR	RWN	07/30/20





COPYRIGHT ENGINEERING EXPRESS

20-26587



SCALE: -
PAGE DESCRIPTION:

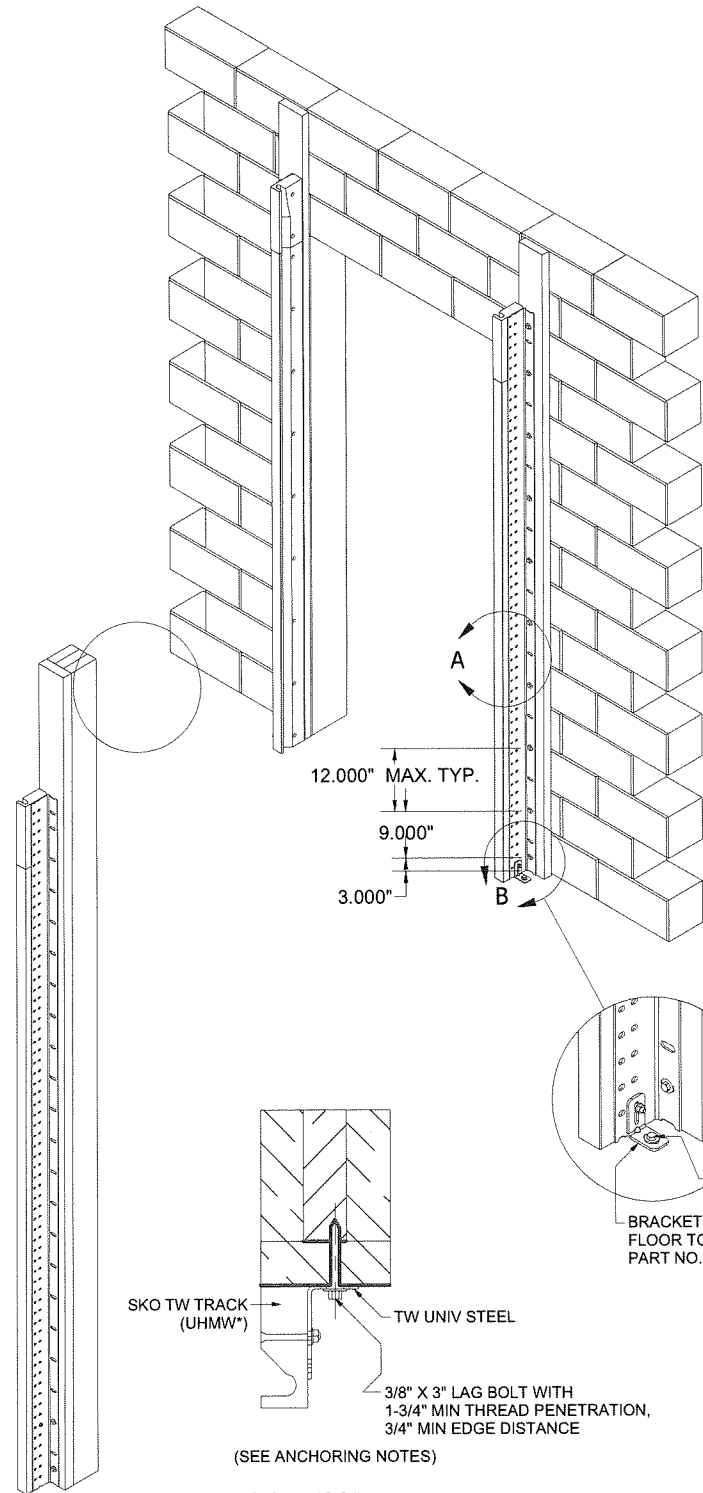

TW WL TRACK ANCHOR MOUNTING

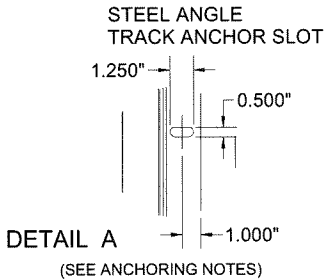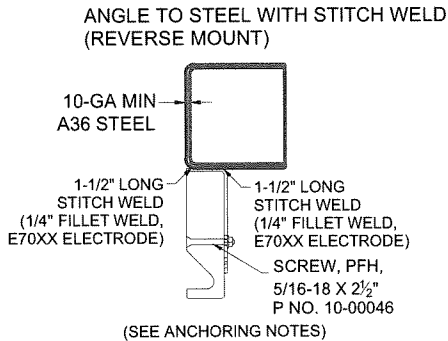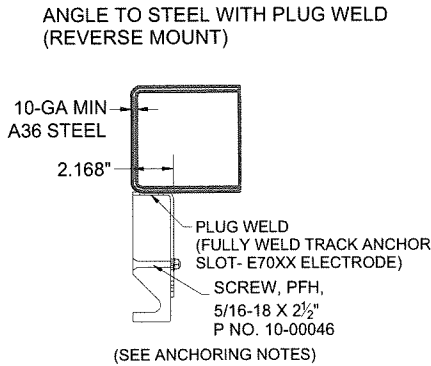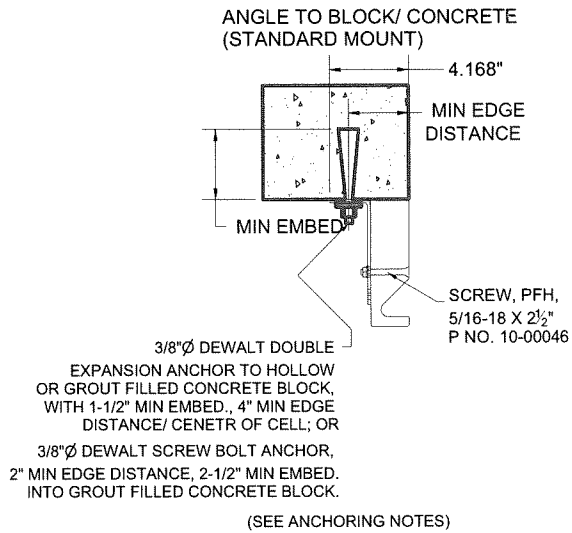

DETAIL B (SEE SHEET 4 OF 7 FOR DETAIL)

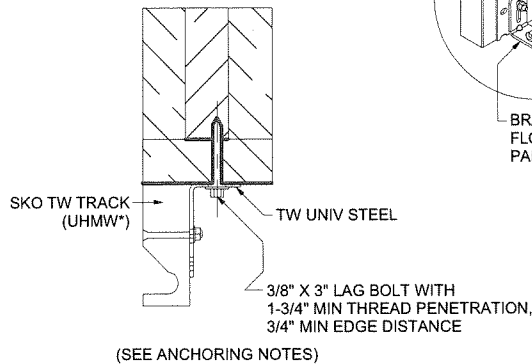


TEST MOUNTING ON WOOD

*UHMW (ULTRA-HIGH-MOLECULAR-WEIGHT POLYETHYLENE)

ANCHORING NOTES:

1. THIS SYSTEM SHALL BE ANCHORED WITH ANY OF THE ANCHORING METHODS SHOWN HEREIN, WITH A MINIMUM OF (2) ANCHORS LOCATED 3" AND 12" MAX. FROM THE BOTTOM OF THE TRACK AND 12" O.C. MAX THEREAFTER OR EVERY OTHER MOUNTING SLOT.
2. ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS' RECOMMENDATIONS.
3. WHERE ANCHORS FASTEN TO NARROW FACE OF STUD FRAMING, ANCHOR SHALL BE LOCATED IN CENTER OF NOMINAL 2x (MIN) WOOD STUD (i.e. 3/4" EDGE DISTANCE IS ACCEPTABLE FOR ANCHORS TO WOOD FRAMING).
4. WOOD HOST STRUCTURE SHALL BE "SOUTHERN PINE" G=0.55 OR GREATER DENSITY.
5. MINIMUM EMBEDMENT SHALL BE AS NOTED IN ANCHOR DETAIL. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDES STUCCO, FOAM, BRICK, AND OTHER WALL FINISHES.
6. WHERE EXISTING STRUCTURE IS WOOD FRAMING, EXISTING CONDITIONS MAY VARY. FIELD VERIFY THAT FASTENERS ARE INTO ADEQUATE WOOD FRAMING MEMBERS, NOT INTO PLYWOOD.
7. WOOD BUCKS (BY OTHERS) SHALL BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE EXISTING STRUCTURE.
8. MACHINE SCREWS SHALL HAVE MINIMUM OF 1/2" ENGAGEMENT OF THREADS IN BASE ANCHOR AND MAY HAVE EITHER A PAN HEAD, TRUSS HEAD, OR WAFER HEAD ("SIDEWALK BOLT") U.N.O.

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 20-0901.16
Expiration Date 08/14/2024
By 
Miami-Dade Product Control

FRANK BENNARDO, PE
PE# 0046549 CA# 9885

08/11/2020

CORPORATE OFFICE:
106
160 SW 12th AVE, SUITE 106
DEERFIELD BEACH, FL 33442
(954) 354-0660 | (866) 396-9999
TEAM@ENGINEERINGEXPRESS.COM
ENGINEERINGEXPRESS.COM

TKO DOORS, DIVISION OF 4FRONT ENGINEERED SOLUTIONS, INC.
N56 W24701 NORTH CORPORATE CIRCLE, SUITE A
SUSSEX, WI 53089
PHONE: 1-800-575-3366 FAX: (262) 246-1301
FIBERGLASS DOCK DOORS
TW WL OVERHEAD GARAGE DOOR
MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DRWN	CHKD	DATE
INIT ISSUE	KL	FLB	05/06/13
REV. PER COMMENTS	KL	FLB	05/16/14
REV (FBC UPDATE)	RWN	CSL	05/06/15
REV - NEW PARTS	AMD	RWN	06/21/16
REV (COMMENTS & 2017FBC)	AMD	RWN	06/21/16
REV (FBC UPDATE)	EPR	RWN	07/30/20

COPYRIGHT ENGINEERING EXPRESS

20-26587


SCALE: -
PAGE DESCRIPTION:

C:\Users\eric\Engineering Express\Production - Documents\Projects\20-26587 - NOA - 19-0522.02 - Model TW WL Garage Door 10x10WLP2020 FBC.6b 20-26587c Thermal Weight Sectional Door (NOA).dwg 08/11/2020 - 3:20pm eric

FASTENER NOTE:

1. FIXED PLUNGERS, SPRING PLUNGERS, HANDLES, AND TPU BRACKETS ARE MOUNTED TO THE PANEL USING:
(4) 1/4-20 X 3.00" CARRIAGE BOLTS AND (4) 1/4-20 FLANGE NUTS.
2. HINGE SETS ARE MOUNTED TO THE PANELS USING:
(4) 1/4-20 X 3.00" CARRIAGE BOLTS AND 1/4-20 FLANGE NUTS.
3. PANEL PLATES ARE MOUNTED TO THE PANELS USING:
(12) 1/4-20 X 3.00" CARRIAGE BOLTS AND 1/4-20 FLANGE NUTS.
4. SLIDE LOCKS ARE MOUNTED TO THE PANELS USING:
(4) #14 X 3/4" TEK SCREWS.


TW WL PANEL HARDWARE

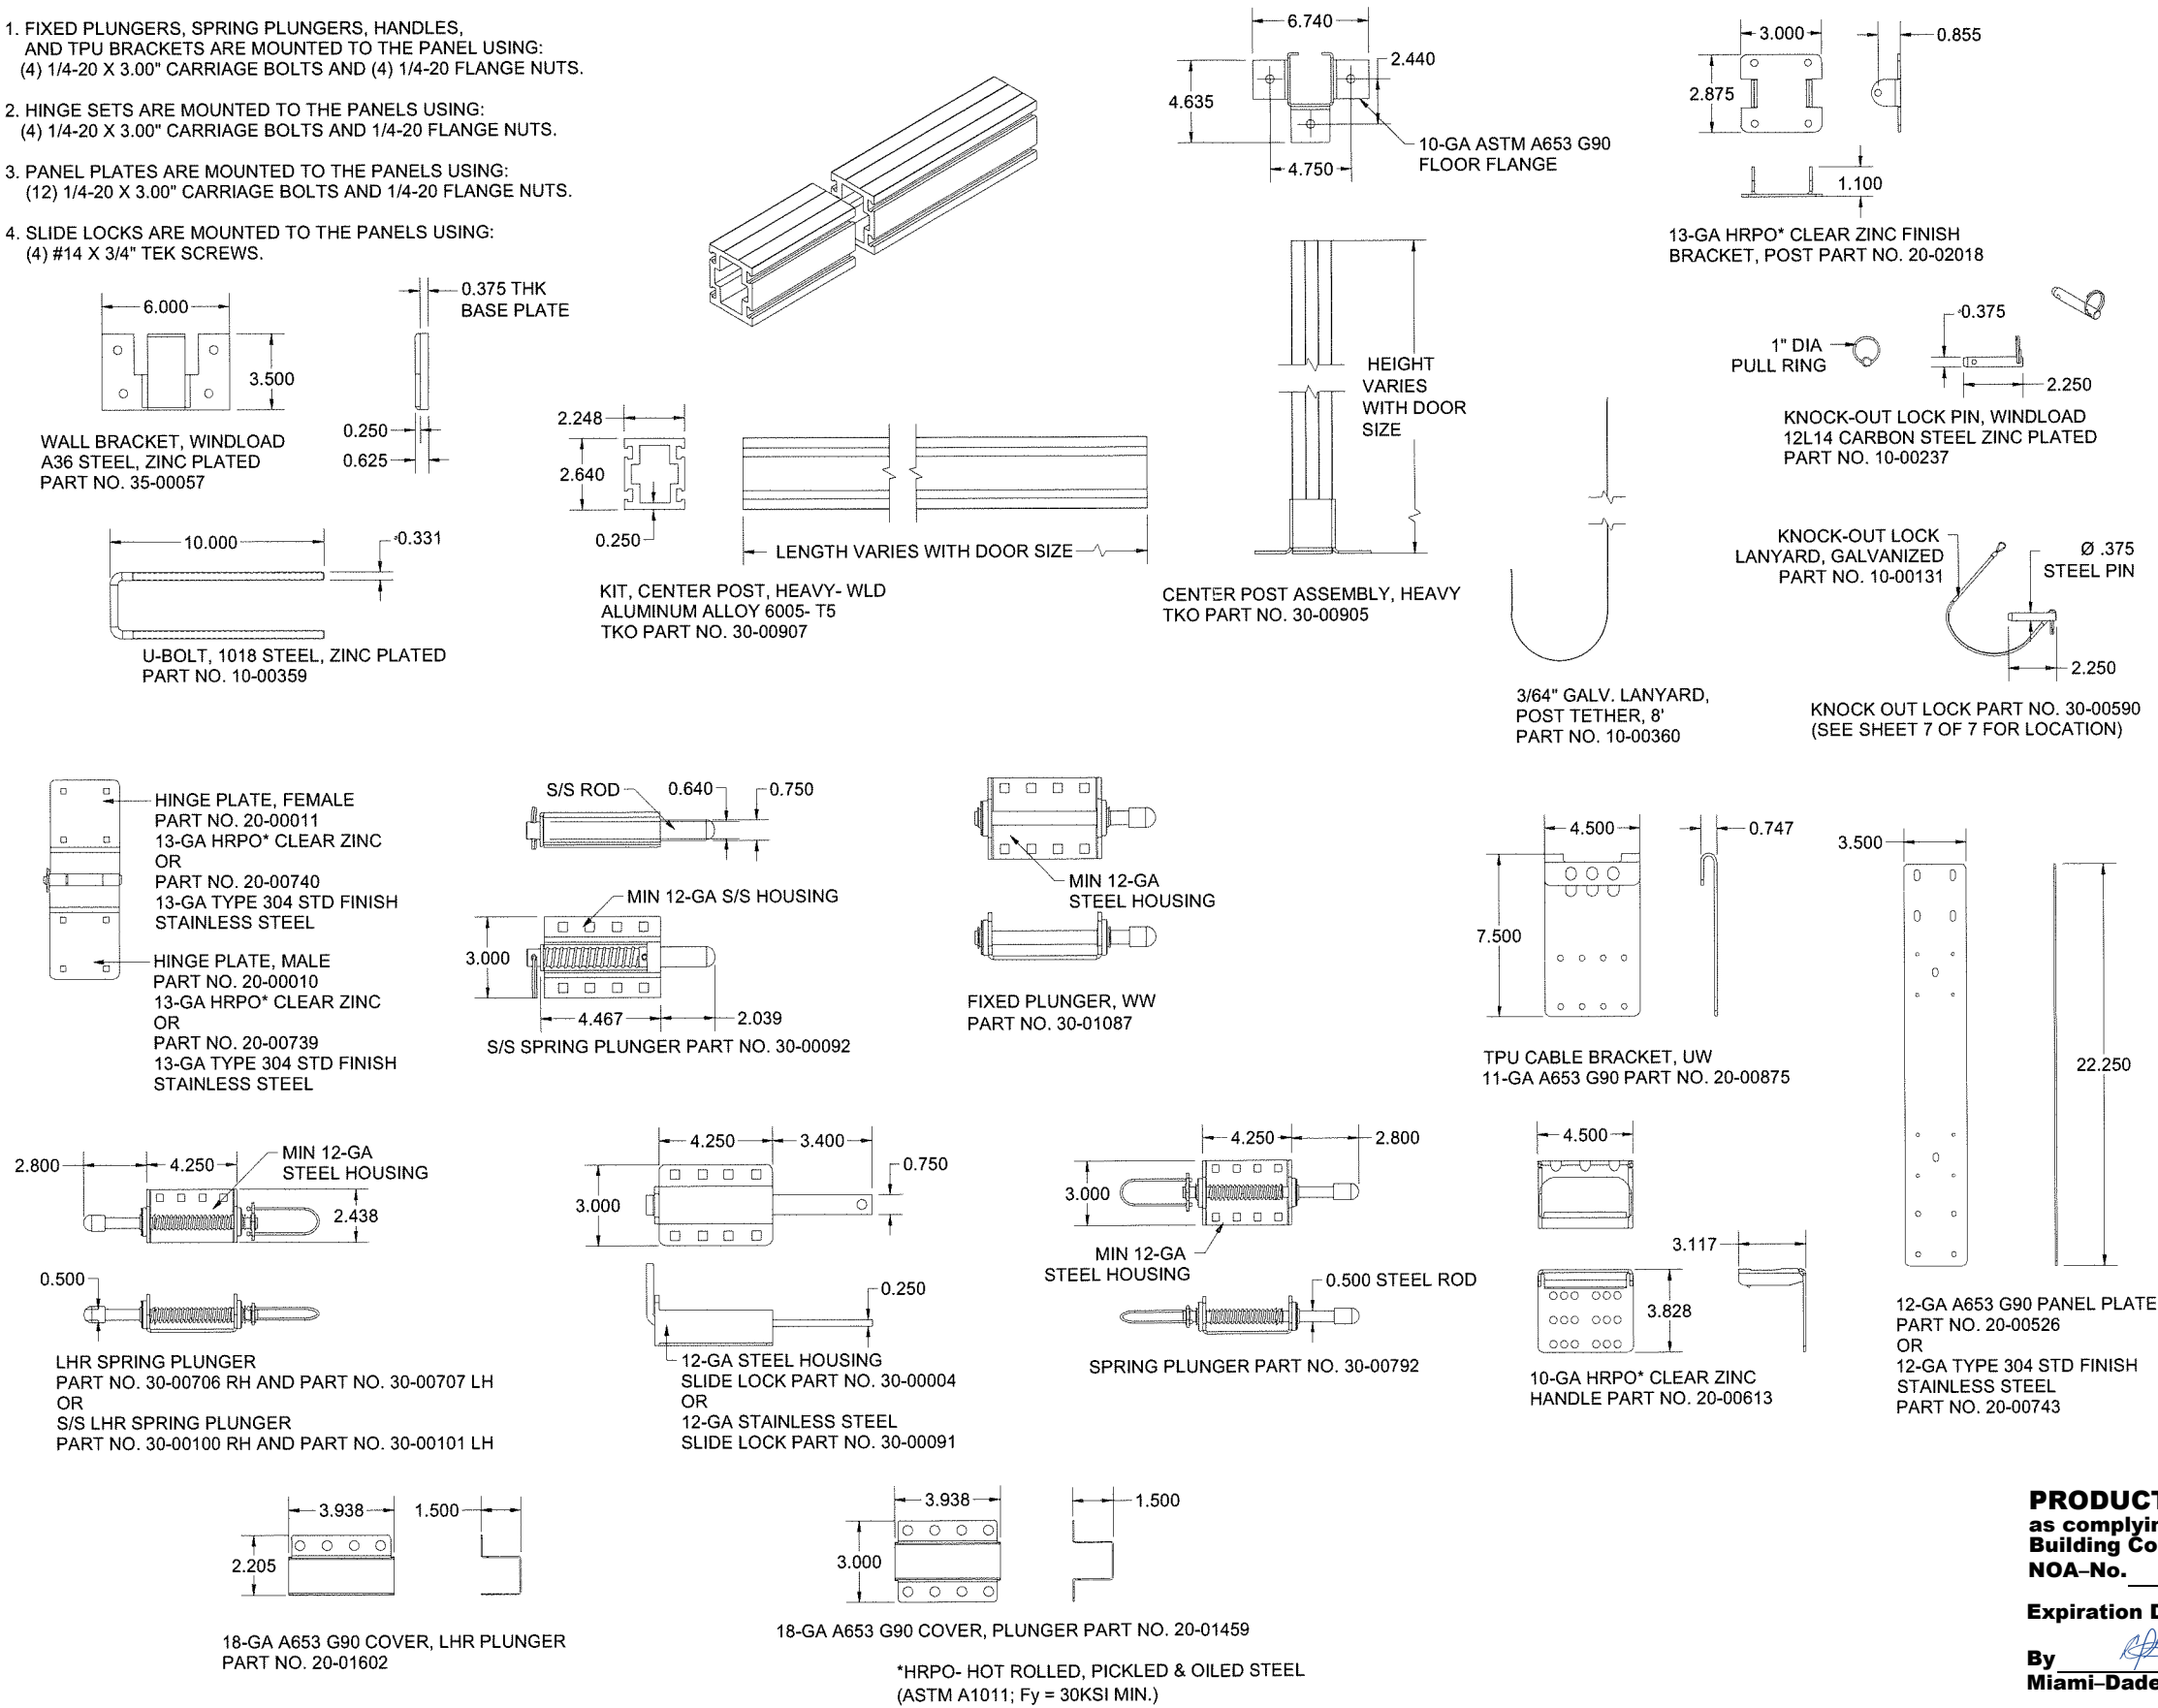

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 20-0901.16
Expiration Date 08/14/2024
By *[Signature]*
Miami-Dade Product Control

FRANK BENNARDO, PE
PE# 0046549 CA# 9885

08/11/2020

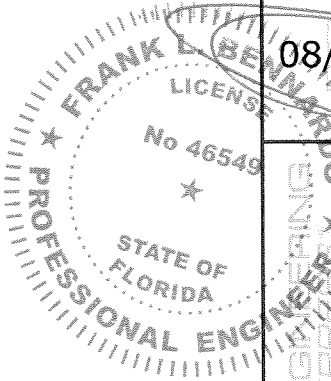

ENGINEERING EXPRESS
CORPORATE OFFICE:
160 SW 12th AVE, SUITE 106
DEERFIELD BEACH, FL 33442
(954) 354-0660 | (866) 396-9999
TEAM@ENGINEERINGEXPRESS.COM
ENGINEERINGEXPRESS.COM

TKO DOORS, DIVISION OF 4FRONT ENGINEERED SOLUTIONS, INC.
N56 W24701 NORTH CORPORATE CIRCLE, SUITE A
SUSSEX, WI 53089
PHONE: 1-800-575-3366 FAX: (262) 246-1301
FIBERGLASS DOCK DOORS
TW WL OVERHEAD GARAGE DOOR
MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DRWN	CHKD	DATE
INIT ISSUE	KL	FLB	05/06/13
REV PER COMMENTS	KL	FLB	05/16/14
REV (FBC UPDATE)	RWN	CSL	05/06/15
REV - NEW PARTS	AMD	RWN	06/21/16
REV (COMMENTS & 2017FBC)	AMD	RWN	06/21/16
REV (FBC UPDATE)	EPR	RWN	07/30/20

COPYRIGHT ENGINEERING EXPRESS

20-26587


SCALE: -

PAGE DESCRIPTION:

OF 7

6

TW WL PANEL HARDWARE (CONTINUED)

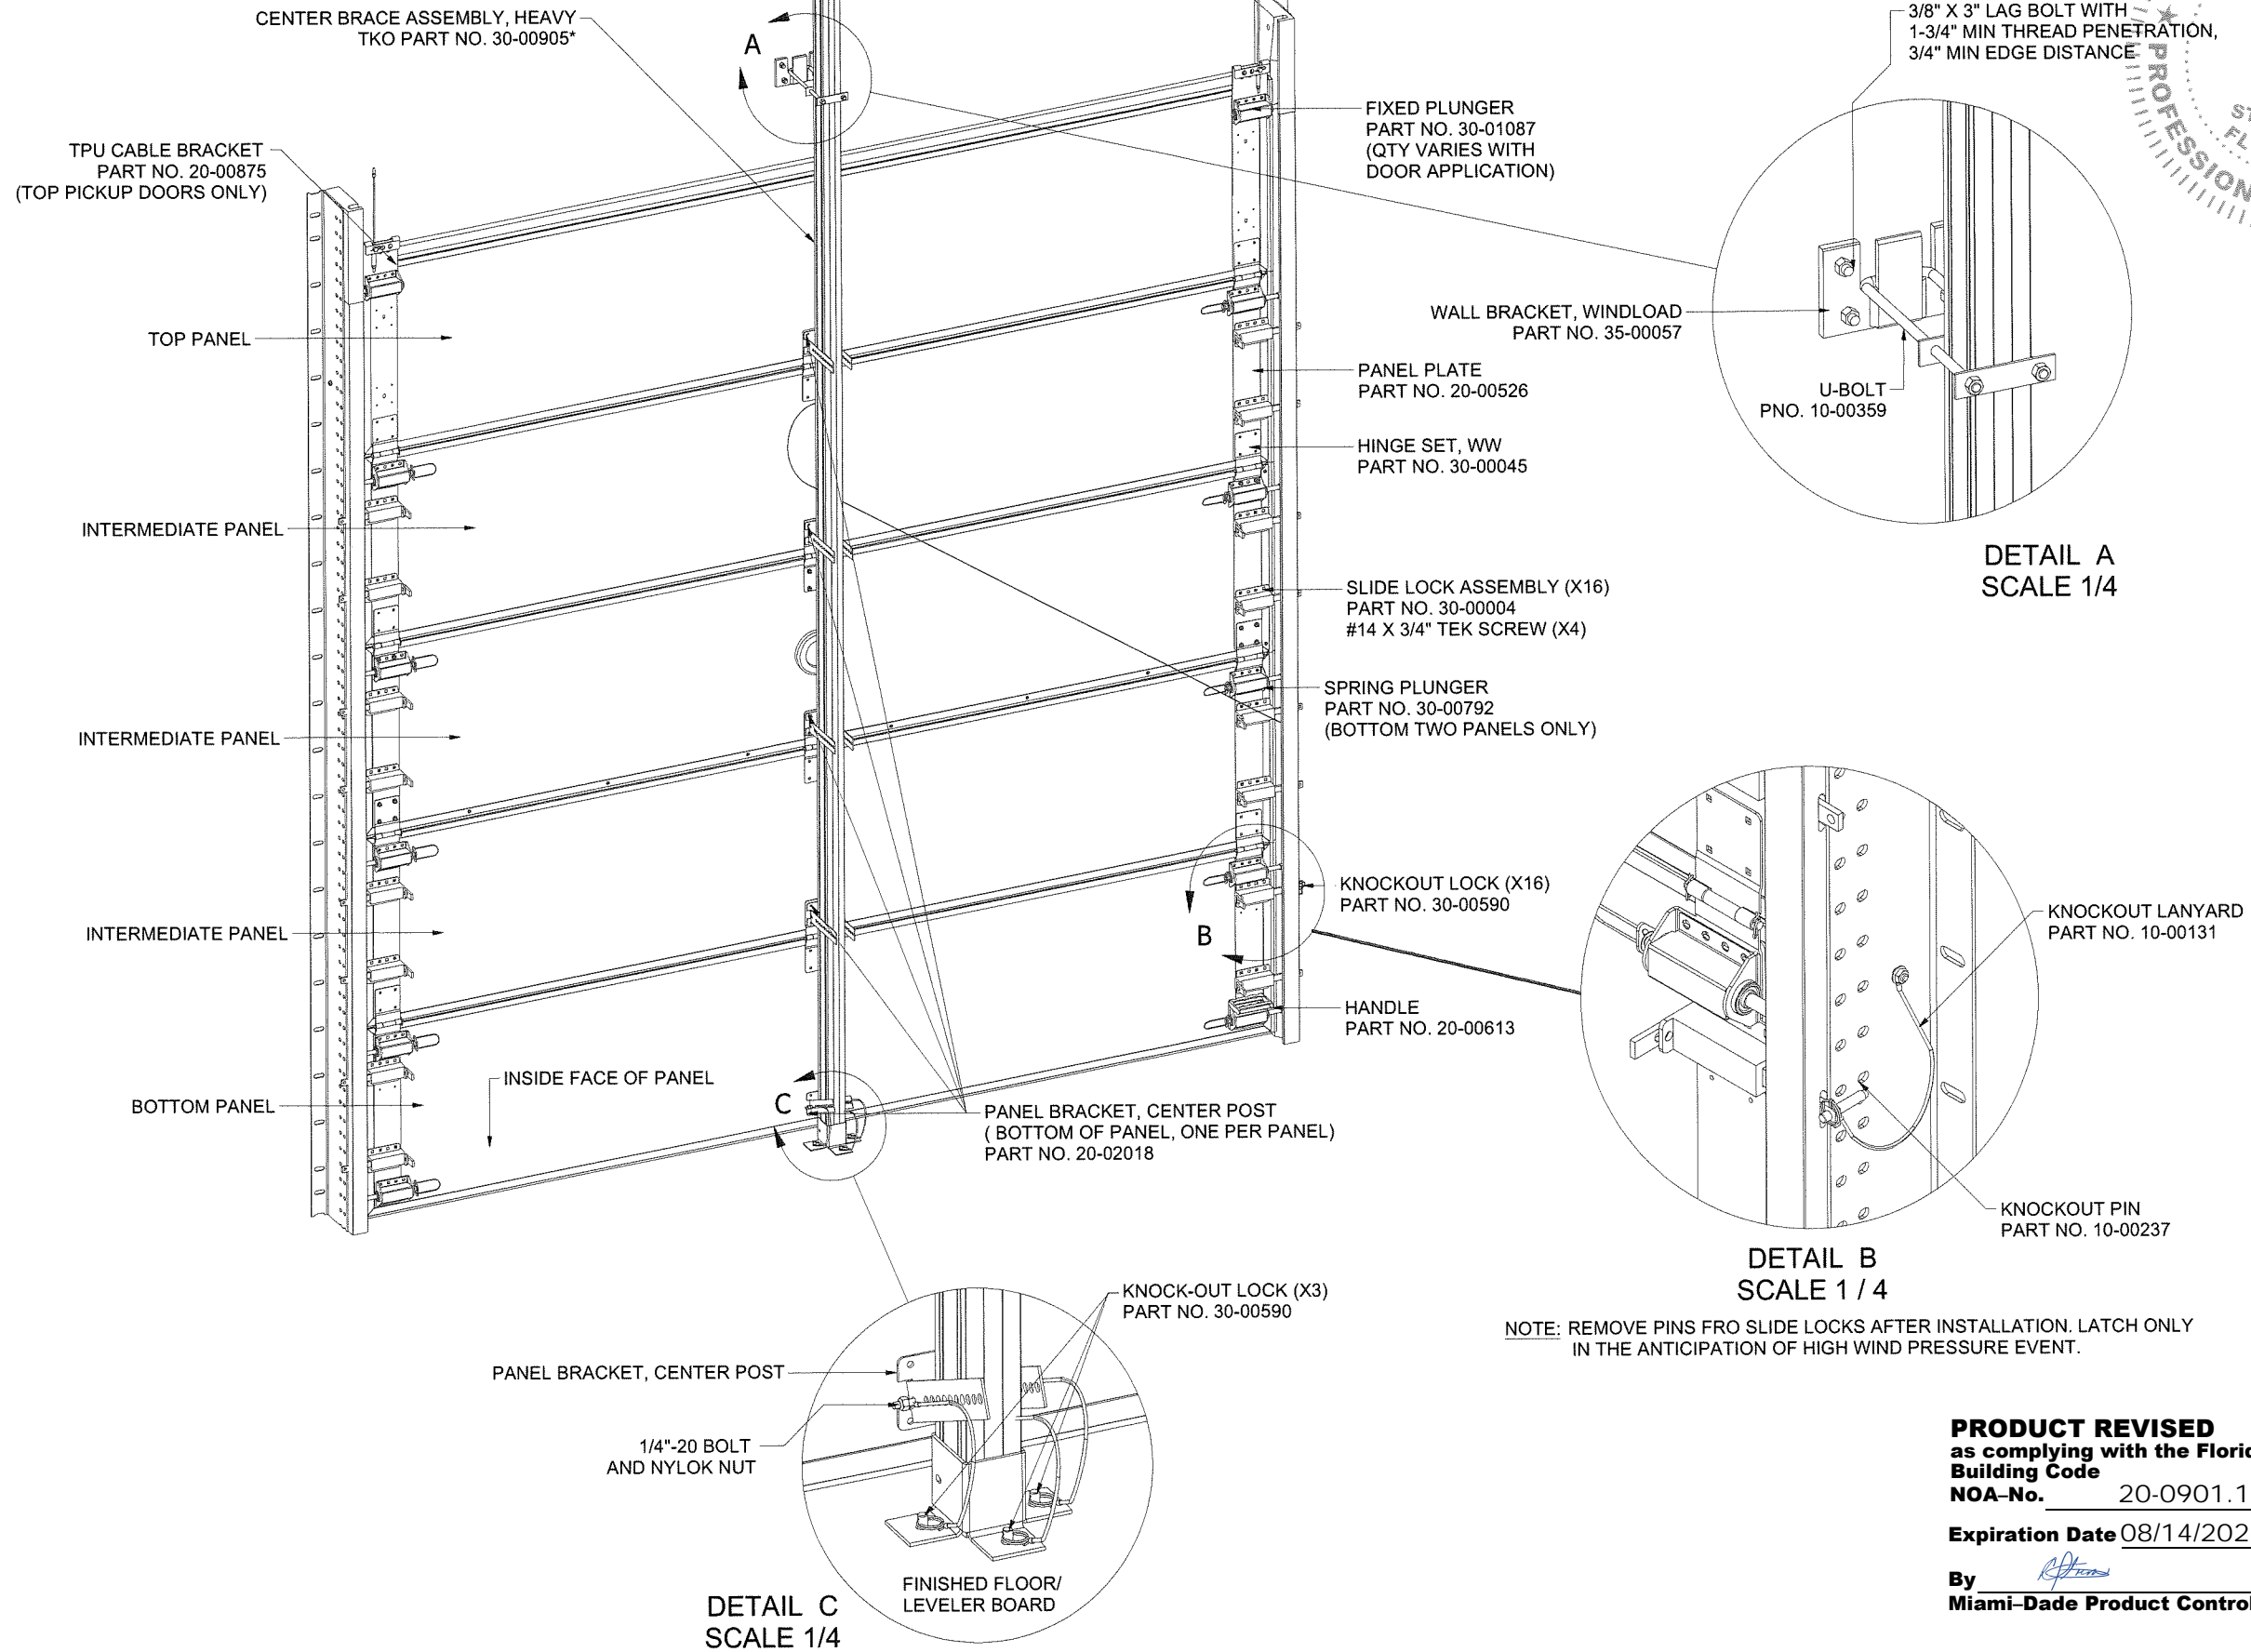

FRANK L BENNARDO, PE
PE# 0046549 CA# 9885

08/11/2020

FRANK L BENNARDO
LICENSE
No 46549
STATE OF
FLORIDA
PROFESSIONAL ENGINEER

ENGINEERING EXPRESS
CORPORATE OFFICE: 106
160 SW 12th AVE, SUITE 106
DEERFIELD BEACH, FL 33442
(954) 354-0660 | (866) 396-9999
TEAM@ENGINEERINGEXPRESS.COM
ENGINEERINGEXPRESS.COM

TKO DOORS, DIVISION OF 4FRONT ENGINEERED SOLUTIONS, INC.
N56 W24701 NORTH CORPORATE CIRCLE, SUITE A
SUSSEX, WI 53089
PHONE: 1-800-575-3366 FAX: (262) 246-1301

FIBERGLASS DOCK DOORS
TW WL OVERHEAD GARAGE DOOR
MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DRWN	CHKD	DATE
INIT ISSUE	KL	FLB	05/06/13
REV. PER COMMENTS	KL	FLB	05/16/14
REV. (FBC UPDATE)	RWN	CSL	05/06/15
REV. - NEW PARTS	AMD	RWN	06/21/16
REV. (COMMENTS & 2017FBC)	AMD	RWN	06/21/16
REV. (FBC UPDATE)	EPR	RWN	07/30/20

COPYRIGHT ENGINEERING EXPRESS

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 20-0901.16
Expiration Date 08/14/2024
By *[Signature]*
Miami-Dade Product Control

20-26587
SCALE: -
PAGE DESCRIPTION: