



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION

11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599

www.miamidade.gov/economy

E.S. Windows, LLC
10653 NE Quaybridge Ct.
Miami, FL 33138

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series ES-9100 Aluminum Outswing Door -S.M.I.

APPROVAL DOCUMENT: Drawing No. **W17-60 Rev B**, titled "Series ES-9100 Aluminum Outswing Door (S.M.I.)", sheets 1 through 7 of 7, dated OCT 03, 2017 and last revised on NOV 18, 2020, prepared by AL-Farooq Corporation, signed and sealed by Jalal Farooq, P.E., bearing the Miami-Dade County Product Control revision stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Small Missile Impact Resistant

Limitations:

1. See sheet 1 for Design Pressure ratings per glass types.
2. Only anchor type "B" is applicable at sill installation.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, Baranquilla, Columbia, S.A. and series and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises** NOA # **17-0802.15** consists of this page 1 and evidence pages E-1 & E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P.E.**



Ishaq I. Chanda

NOA No. 20-1118.07
Expiration Date: October 12, 2022
Approval Date: February 18, 2021
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. Evidence submitted under previous approvals

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No. **W17-60 rev A**, titled "Series ES-9100 Aluminum Outswing Door (S.M.I.)", sheets 1 through 7 of 7, dated OCT 03, 2017, prepared by AL-Farooq Corporation, signed and sealed by Javad Ahmad, P.E.

B. TESTS

1. Test reports on
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94(Not performed)
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
 - 6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94

Along with marked-up drawings and installation diagram of Alum Single Outswing Doors, prepared by Blackwater Testing, Inc., Test Report No. **BT-ESW-17-014**, dated 05/12/17, signed and sealed by Constantin Brotes, P.E.

Additional Test report along with marked-up Dwg. of single (X) aluminum outswing doors, issued by Fenestration Testing lab, Inc., Test Report No. **FTL-8605**, dtd 08/08/16 signed & sealed by Idalmis Ortega, P. E.

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC-2017 (6th Edition), prepared by Al-Farooq Corp., dated JUL 05, 2017 and last revised on 10/03/17, signed & sealed by Javad Ahmad, P.E.
2. Glazing complies w/ ASTM E-1300-02, -04 & -09.

D. QUALITY ASSURANCE

1. Miami Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **14-0916.11** issued to **Kuraray America, Inc.** (Former E.I. DuPont DeNemours & Co., Inc. for the "**Sentry Glass ® (Clear and White) Glass Interlayers**", expiring on 07/04/18.
2. Notice of Acceptance No. **16-1117.01** issued to Kuraray America, Inc. (former E.I. DuPont DeNemours & Co., Inc.) for "**Trosifol: Ultra clear, clear & color PVB glass interlayer**" (former "**Kuraray Butacite PVB Interlayer**"), expiring on 07/08/19.
3. Notice of Acceptance No. **15-1201.11** issued to Eastman Chemical Company (MA) former Solutia Inc. for their "**Saflex Clear or colored interlayer**", expiring on 05/21/21.

Ishaq I. Chanda

Ishaq I. Chanda, P.E.
Product Control Unit Supervisor
NOA No. 20-1118.07
Expiration Date: October 12, 2022
Approval Date: February 18, 2021

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

F. STATEMENTS

1. Statement letter of conformance to FBC 2017 (6th Edition) and letter of no financial interest, prepared by Al Farooq Corporation, dated 06/22/17, signed and sealed by Javad Ahmad, P.E.
2. Lab compliance as part of the above referenced test report.

G. OTHER

1. Test proposal dated 12/09/14, approved by Jaime D. Gascon, P.E.
2. Distribution agreement ES Windows-Energia Solar, S.A. and ES Windows, LLC, dated 10/20/10, signed by Ms. Carla G. Torrente and Andres Chamorro respectively (submitted under previous file).

2. New Evidence submitted

A. DRAWINGS

1. Drawing No. **W17-60 Rev B**, titled "Series ES-9100 Aluminum Outswing Door (S.M.I.)", sheets 1 through 7 of 7, dated OCT 03, 2017 and last revised on NOV 18, 2020, prepared by AL-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.

B. TESTS

1. None.

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with **FBC 7th Edition (2020)**, dated 11/18/20, prepared by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **19-0305.02** issued to **Kuraray America, Inc.** for their "**Trosifol® Ultraclear, Clear and Color PVB Glass Interlayers**" dated 05/09/19, expiring on 07/08/24.
2. Notice of Acceptance No. **15-1201.11** issued to Eastman Chemical Company (MA) former Solutia Inc. for their "**Saflex Clear or colored interlayer**", expiring on 05/21/21.
3. Notice of Acceptance No. **17-0808.02** issued to Kuraray America, Inc. (former E.I. DuPont DE Nemours & Co., Inc.) for the "**Sentry Glass® Interlayer**", expiring on 07/4/23.

D. STATEMENTS

1. Statement letter of conformance, complying with **FBC 7th Edition (2020)**, dated 11/06/20, issued by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.
2. Distribution agreement between Energia Solar, S.A.-ES Windows and ES Windows, LLC, dtd 08/03/15, signed by Ms. Carla Garcia (MGR) and Andres Chamorro (Gen. MGR) respectively (original copy in various ES approved NOA(s) files.

G. OTHER

1. This NOA revises **NOA No. 17-0802.15**, expiring 10/12/22.

Ishaq I. Chanda, P.E.
Product Control Unit Supervisor
NOA No. 20-1118.07
Expiration Date: October 12, 2022
Approval Date: February 18, 2021

GLASS D.L.O. FORMULAE:
D.L.O. WIDTH = FRAME WIDTH - 14.0" (STD. JAMBS)
D.L.O. WIDTH = FRAME WIDTH - 11.0" (NARROW JAMBS)
D.L.O. HEIGHT = FRAME HEIGHT - 15.750"

THESE DOORS ARE RATED FOR SMALL MISSILE IMPACT.
MIAMI-DADE COUNTY APPROVED IMPACT RESISTANT SHUTTERS REQUIRED
FOR INSTALLATIONS UP TO 30 FT. OF GRADE.
SHUTTERS NOT REQD. FOR INSTALLATIONS ABOVE 30 FT. OF GRADE.

ES-9100 ALUMINUM OUTSWING ENTRANCE DOOR

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE 2017 (6TH EDITION)/2020 (7TH EDITION) FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

1BY OR 2BY WOOD BUCKS & BUCK FASTENERS BY OTHERS, MUST BE DESIGNED AND INSTALLED ADEQUATELY TO TRANSFER APPLIED PRODUCT LOADS TO THE BUILDING STRUCTURE.

ANCHORS SHALL BE CORROSION RESISTANT, SPACED AS SHOWN ON DETAILS AND INSTALLED PER MANUF'S INSTRUCTIONS. SPECIFIED EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.


A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.
ALL SHIMS TO BE HIGH IMPACT, NON-METALLIC AND NON-COMPRESSIBLE.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE 2017/2020 FLORIDA BLDG. CODE & ADOPTED STANDARDS.

THIS PRODUCT APPROVAL IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT, I.E. LIFE SAFETY OF THIS PRODUCT, ADEQUACY OF STRUCTURE RECEIVING THIS PRODUCT AND SEALING AROUND OPENING FOR WATER INFILTRATION RESISTANCE ETC.
CONDITIONS NOT SHOWN IN THIS DRAWING ARE TO BE ANALYZED SEPARATELY, AND TO BE REVIEWED BY BUILDING OFFICIAL.

DESIGN LOADS SHOWN ARE BASED ON 'ALLOWABLE STRESS DESIGN (ASD)'.


DOORS APPROVED FOR INSTALLATIONS WHERE WATER INFILTRATION RESISTANCE IS REQUIRED.

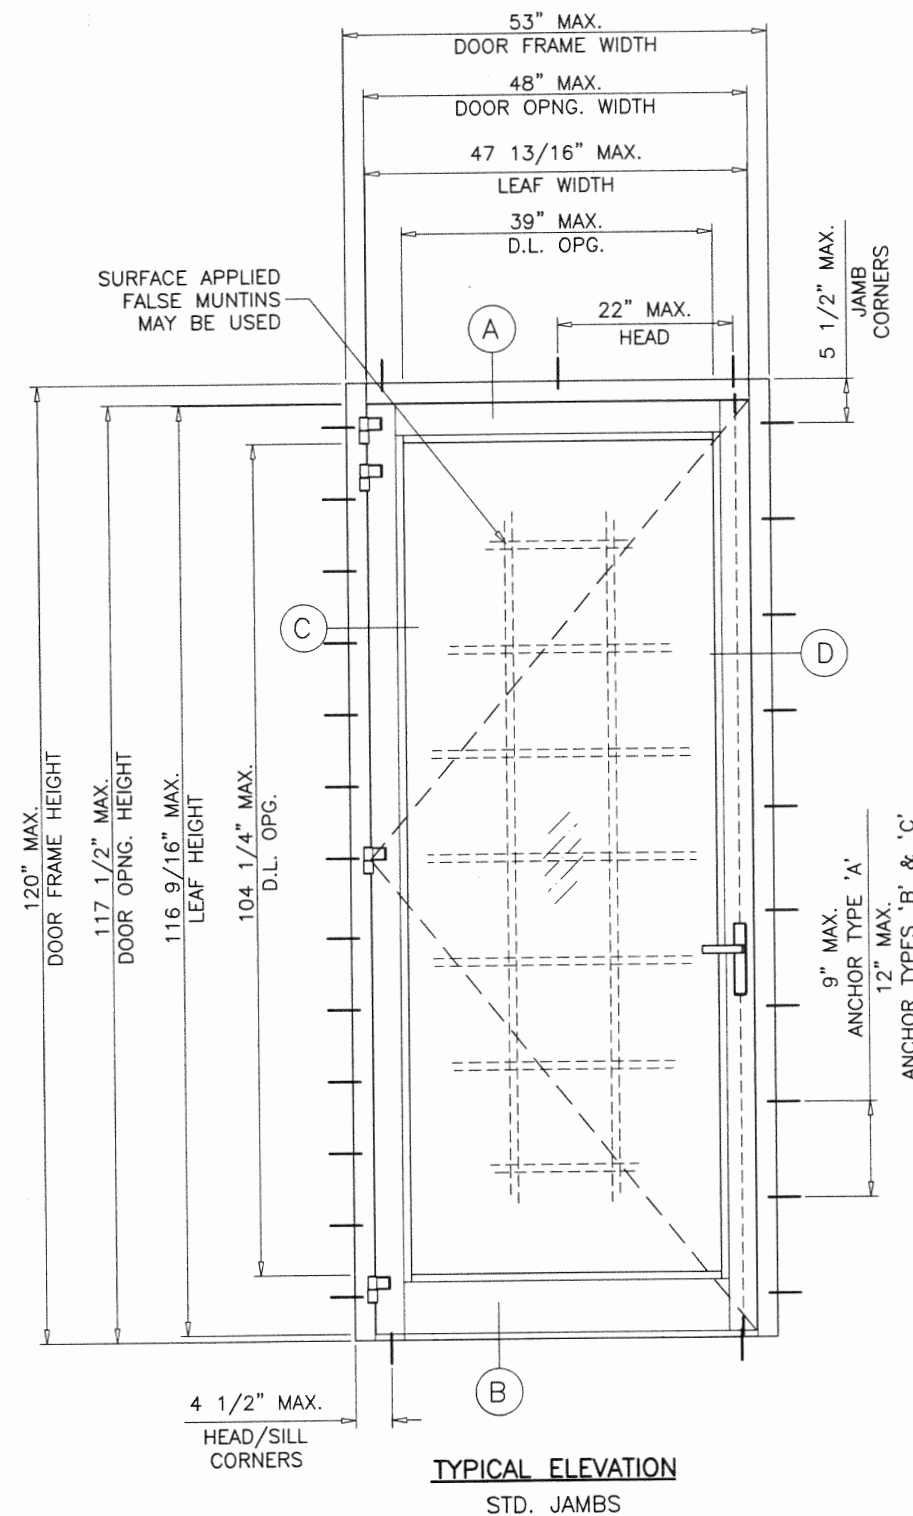

GLASS TYPES 'A', 'A2i' & 'A3i'
MAXIMUM DESIGN LOAD RATING = + 120.0 PSF
(FOR SIZES SHOWN ABOVE OR SMALLER) - 150.0 PSF
AS PERMITTED BY FBC

GLASS TYPE 'A1i'
MAXIMUM DESIGN LOAD RATING = + 120.0 PSF
(FOR SIZES SHOWN ABOVE OR SMALLER) - 144.0 PSF
AS PERMITTED BY FBC

DOOR HEIGHT AND WIDTH SIZE MUST COMPLY
EGRESS REQUIREMENTS PER FBC AS APPLICABLE.

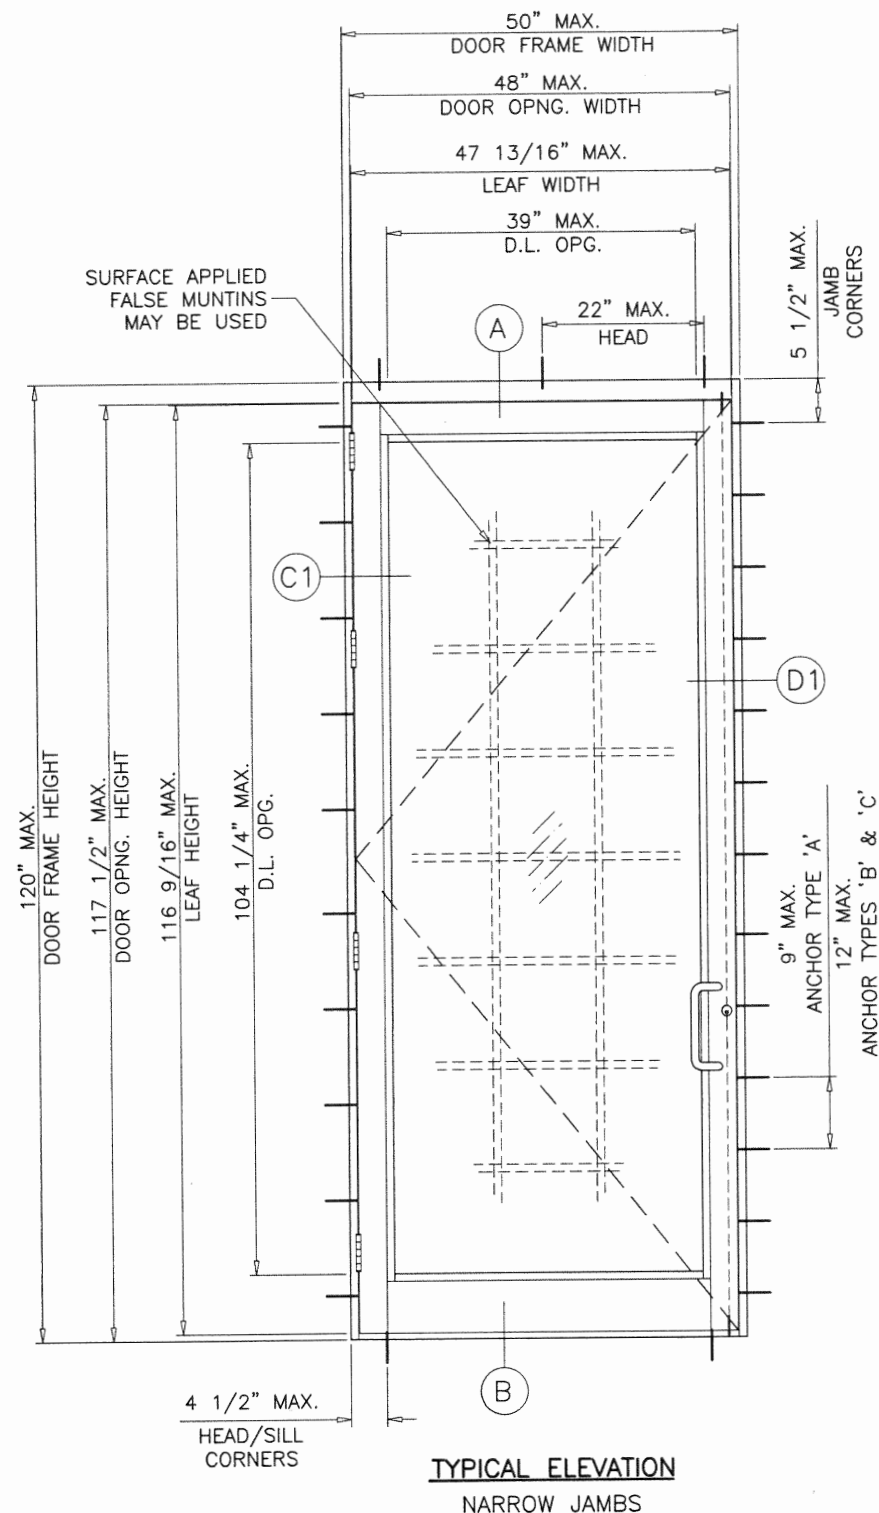


PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 20-1118.07

Expiration Date 10/12/2022

By *Ishag I. Chahin*
Miami-Dade Product Control

NOV 18 2020

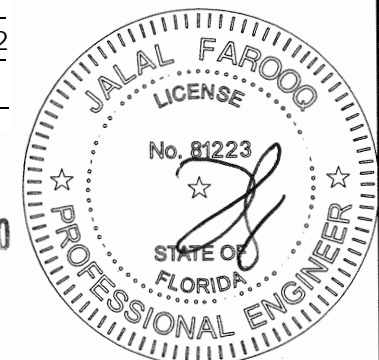

ES-9100 ALUMINUM OUTSWING DOOR (S.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151

revisions:	no	date	by	description
	A	10.03.17	REV. PER	COMMENTS
	B	11.12.20	UPDATED TO	2020 FBC


date:	0623-17
scale:	1/2"=1'-0"
dr. by:	TARIQ
chk. by:	

drawing no.
W17-60


sheet 1 of 7

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
(C.A.N. 3538)


COMP-ANL\W17-60ES

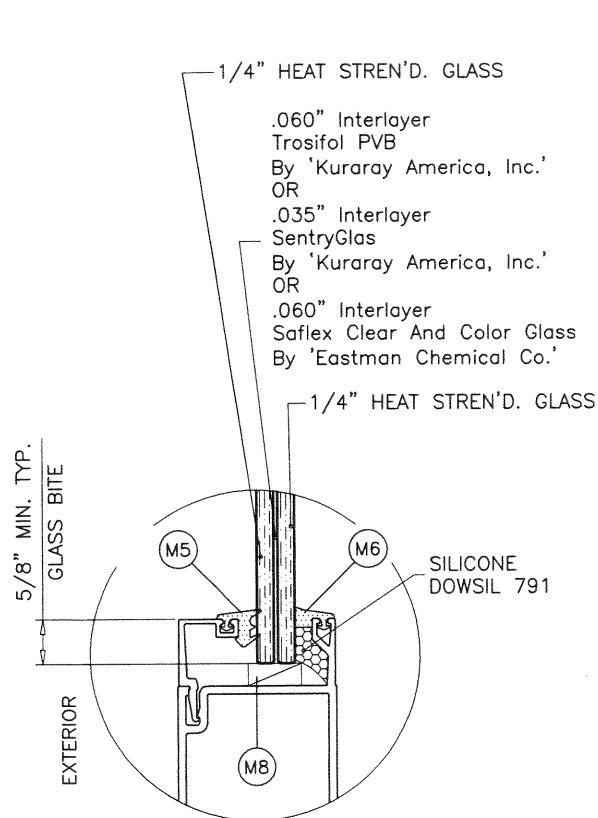


GLASS TYPE 'A'
9/16" OVERALL LAM. H.S. GLASS

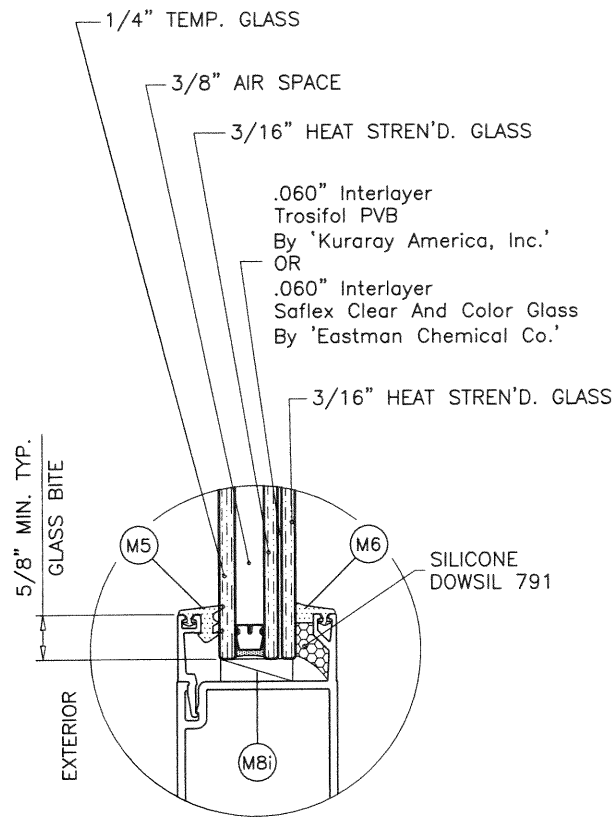

GLASS TYPE 'A1i'
1-1/16" OVERALL INSUL. LAM. H.S. GLASS

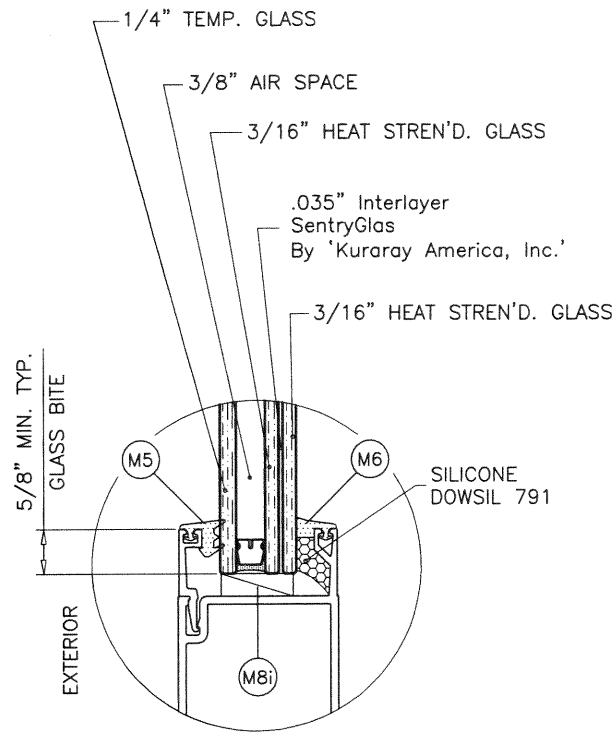

GLASS TYPE 'A2i'
1-1/16" OVERALL INSUL. LAM. H.S. GLASS

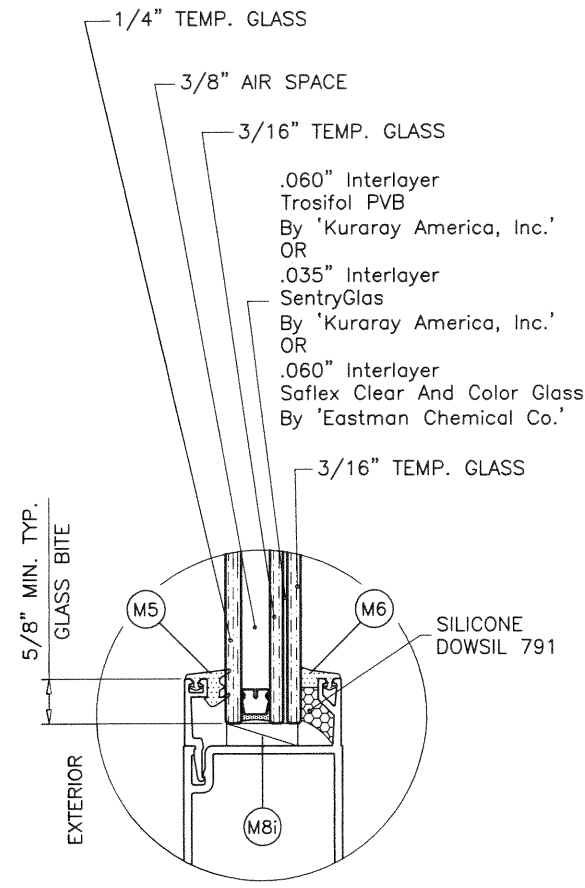

GLASS TYPE 'A3i'
1-1/16" OVERALL INSUL. LAM. TEMP. GLASS

GLAZING OPTIONS

3/8" AIR SPACE CONSISTING OF:


SPACER:
'HELIMA' LOW PROFILE ALUMINUM SPACER
BY 'LINGERMANN GMBH'
AROUND THE PERIMETER OF THE GLASS.
PERIMETER SEALANT:
SILICONE
DOWSIL 791

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 20-1118.07






Expiration Date 10/12/2022

By Ishag I. Chande
Miami-Dade Product Control

NOV 18 2020

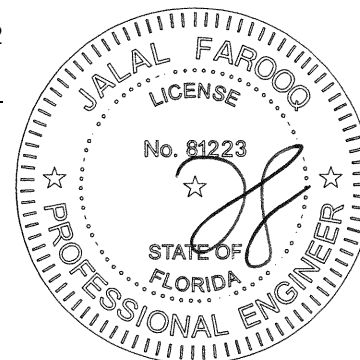

AL-FAROOQ CORPORATION ENGINEERS & PRODUCT DEVELOPMENT 9360 SUNSET DRIVE, SUITE 220 MIAMI, FLORIDA 33173 TEL. (305) 264-8100 FAX. (305) 262-6978 COMP-ANL\W17-60ES	
ES-9100 ALUMINUM OUTSWING DOOR (S.M.I.) E.S. WINDOWS, LLC 3550 N.W. 49 STREET MIAMI, FL. 33142 TEL. (305) 638-5151 FAX. (305) 638-5158	
revisions: no. date by description A 10.03.17 REV. PER RER COMMENTS B 11.12.20 UPDATED TO 2020 FBC	date: 0623-17 scale: 3/8" = 1" dr. by: TARIQ chk. by:
drawing no. W17-60 sheet 2 of 7	

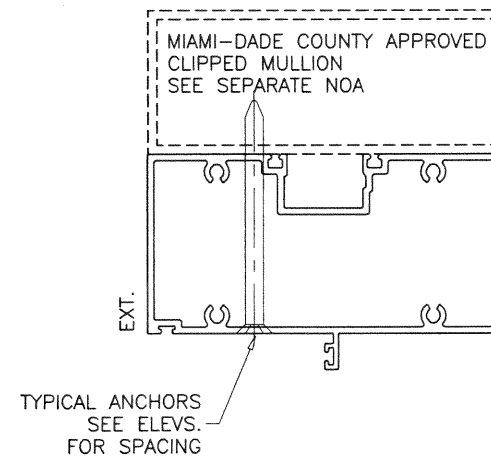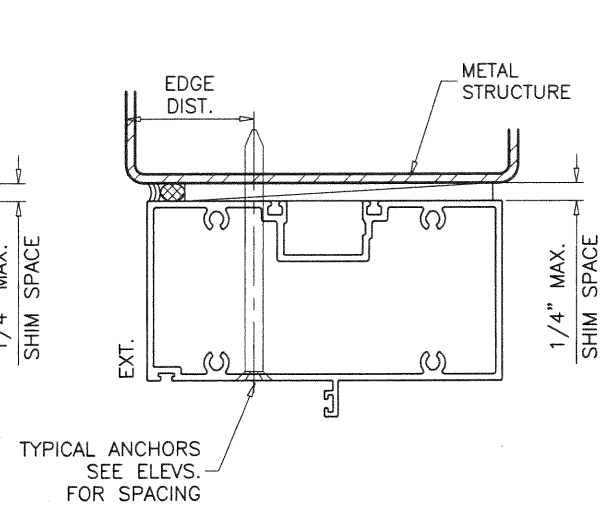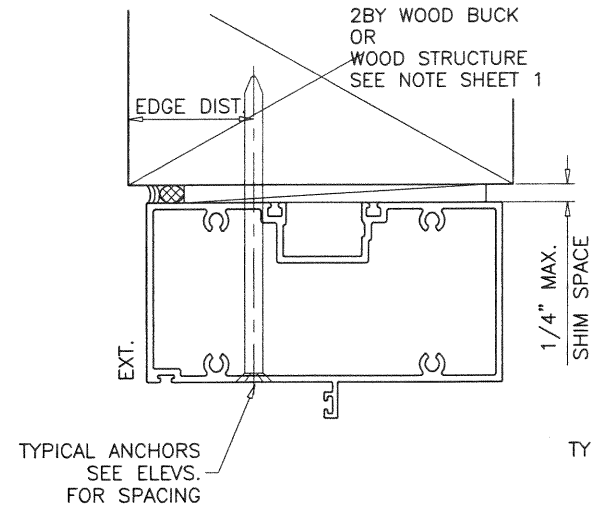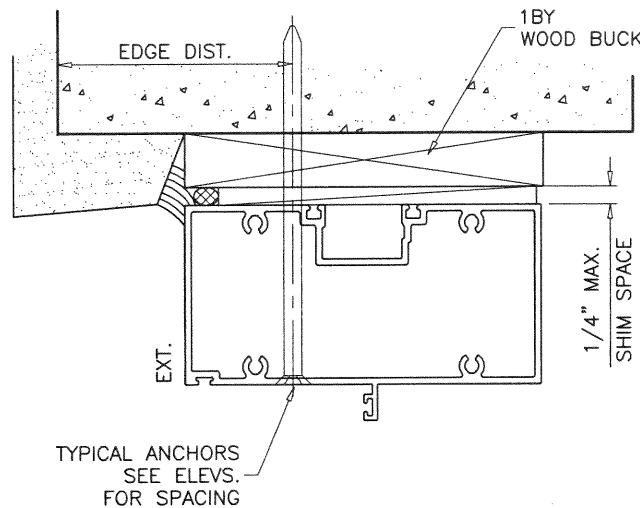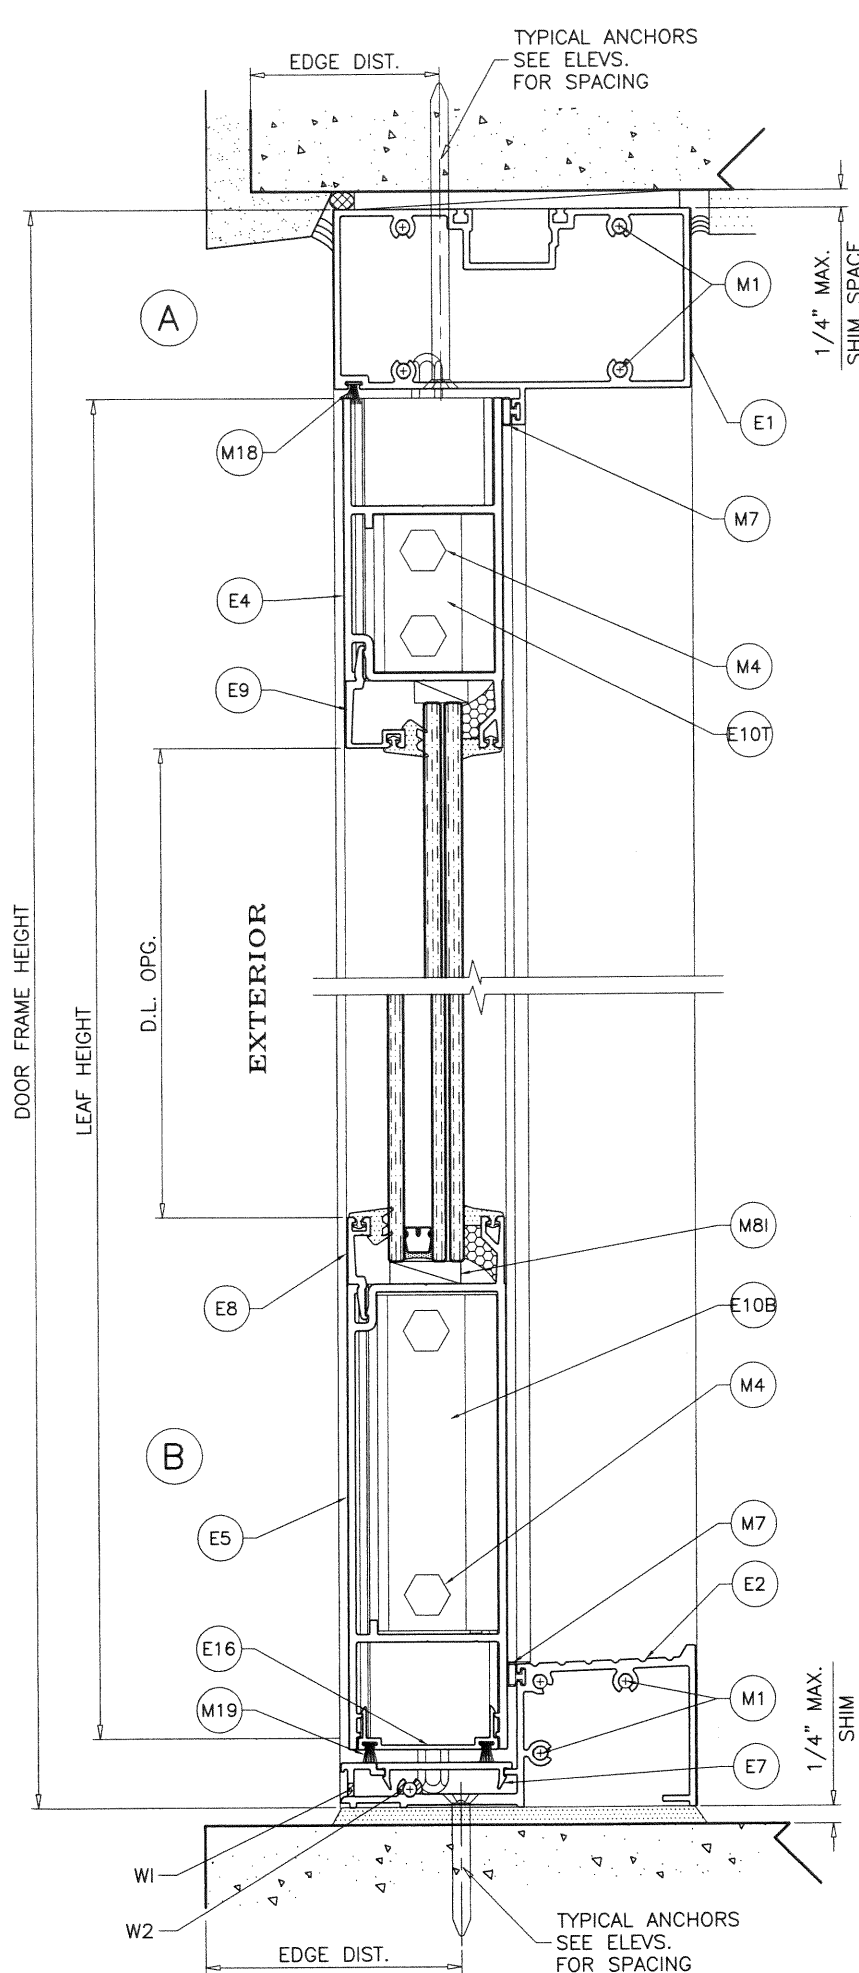

WOOD BUCKS AND METAL STRUCTURE NOT BY 'E.S. WINDOWS' MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

- TYPICAL ANCHORS:** SEE ELEV. FOR SPACING
- TYPE 'A' - 1/4" DIA. ULTRACON+ BY 'DEWALT'** (Fu=164 KSI, Fy=148 KSI)
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 1-1/2" MIN. PENETRATION INTO WOOD (HEAD/JAMBS)
 THRU 1BY BUCKS INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONCRETE (HEAD/JAMBS)
 1-1/4" MIN. EMBED INTO MASONRY (JAMBS)
 DIRECTLY INTO FILLED BLOCKS
 1-3/4" MIN. EMBED INTO FILLED BLOCKS (JAMBS)
- TYPE 'B' - 1/4" DIA. ULTRACON+ BY 'DEWALT'** (Fu=164 KSI, Fy=148 KSI)
 DIRECTLY INTO CONCRETE
 1-3/4" MIN. EMBED INTO CONCRETE (HEAD/SILL/JAMBS)
- TYPE 'C' - 1/4" DIA. TEKS OR SELF DRILLING SCREWS** (GRADE 5 CRS)
 INTO MIAMI-DADE COUNTY APPROVED MULLIONS
 OR
 INTO METAL STRUCTURES (HEAD/JAMBS)
 (3) THREADS MIN. PENETRATION BEYOND SUBSTRATE
 ALUMINUM: 3/16" THK. MIN. (6063-T5 MIN.)
 STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL EDGE DISTANCE

INTO CONCRETE AND MASONRY = 2-1/2" MIN.
 INTO WOOD STRUCTURE = 1" MIN.
 INTO METAL STRUCTURE = 3/4" MIN.

WOOD AT HEAD, SILL OR JAMBS SG = 0.55 MIN.
 CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.
 C-90 GROUT FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

WEEPHOLES:

W1 = 2" X 3/16" WEEP HOLES AT 1" FROM EACH END AND AT MIDSPAN


W2 = 3/4" WEEP NOTCH AT 3/4" FROM EACH END

PRODUCT REVISED
 as complying with the Florida
 Building Code
 NOA-No. 20-1118.07

Expiration Date 10/12/2022

By Ismael I. Chanda
 Miami-Dade Product Control

NOV 18 2022

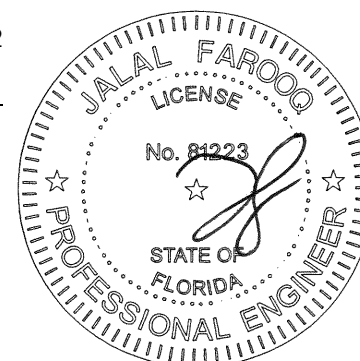

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173
 TEL. (305) 264-8100 FAX. (305) 262-6978

COMP-ANLW17-60ES

ES-9100 ALUMINUM OUTSWING DOOR (S.M.I.)



E.S. WINDOWS, LLC
 3550 N.W. 49 STREET
 MIAMI, FL. 33142
 TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:


no	date	by	description
A	10.03.17		NO CHANGE THIS SHEET
B	11.12.20		UPDATED TO 2020 FBC

date: 0623-17
 scale: 3/8" = 1"
 dr. by: TARIQ
 chk. by:

drawing no.
W17-60
 sheet 3 of 7

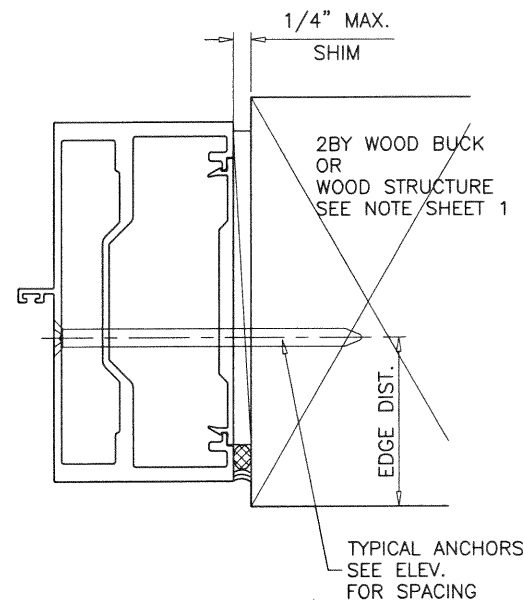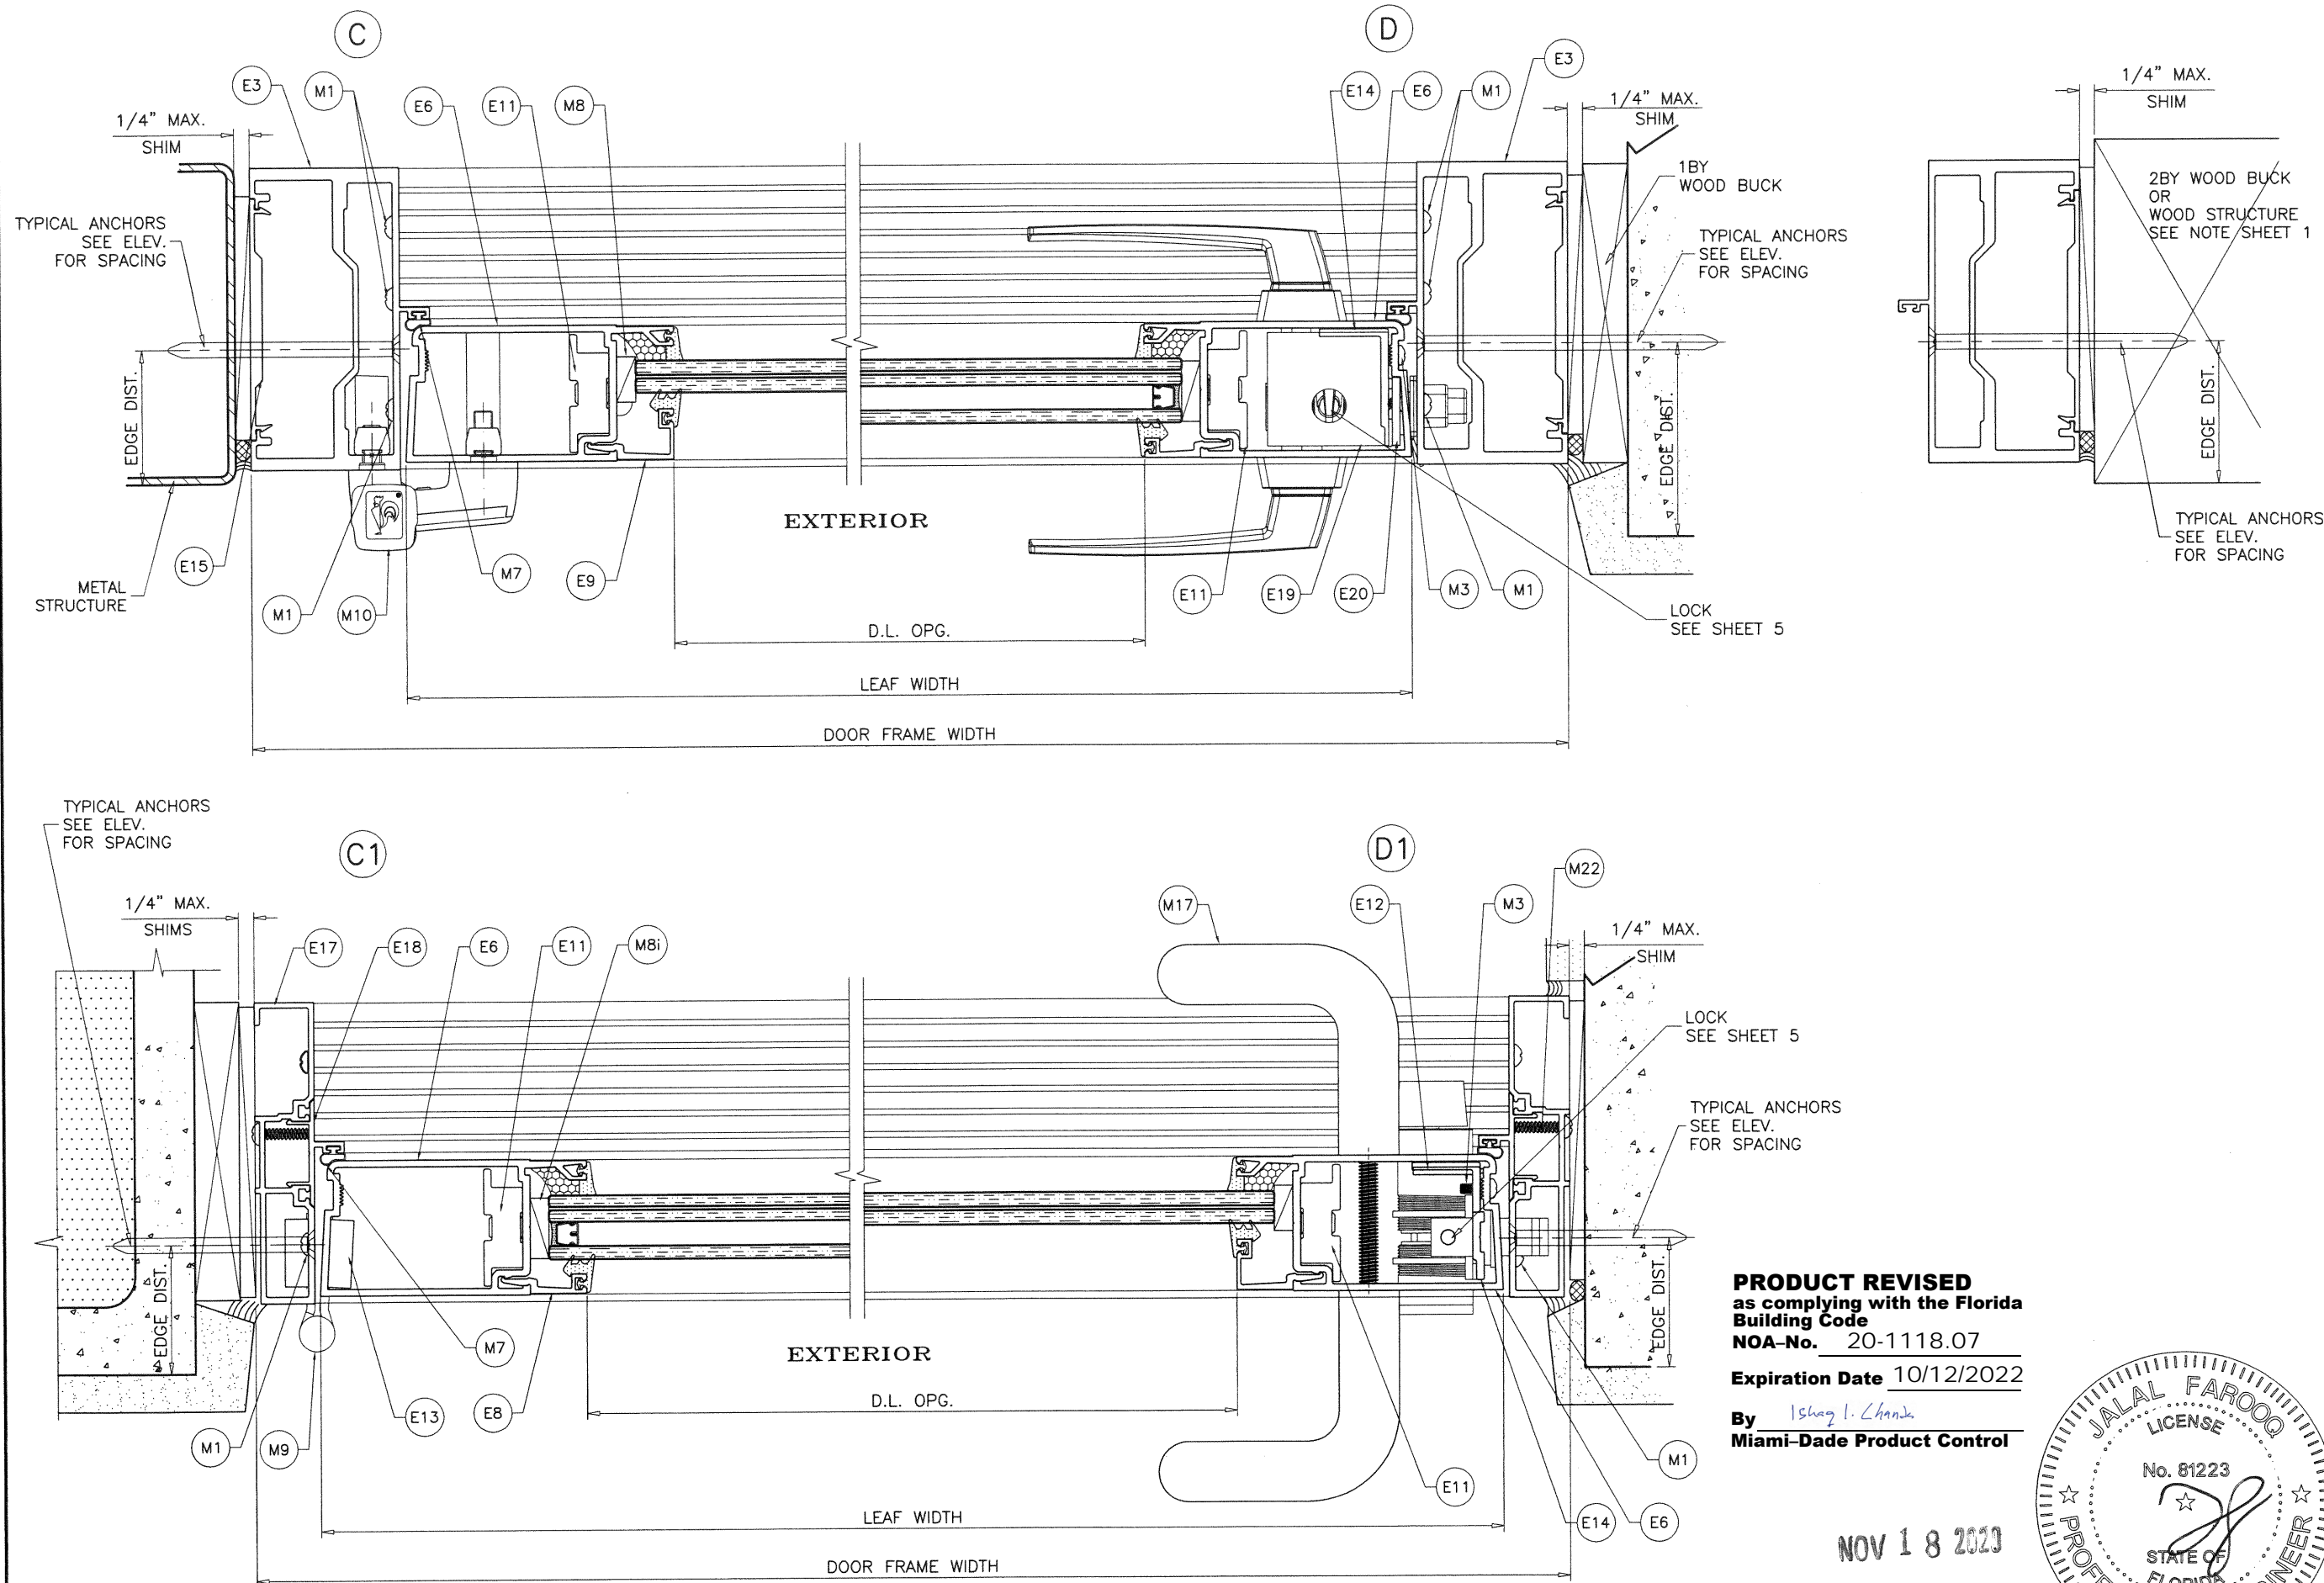

PRODUCT REVISED
 as complying with the Florida
 Building Code
 NOA-No. 20-1118.07
 Expiration Date 10/12/2022
 By Ishaq I. Chande
 Miami-Dade Product Control

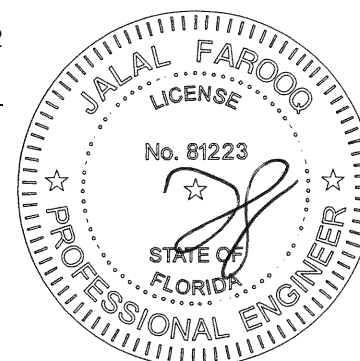

NOV 18 2023

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173 (C.A.N. 3538)
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W17-60ES

ES-9100 ALUMINUM OUTSWING DOOR (S.M.I.)

E.S. WINDOWS, LLC
 3550 N.W. 49 STREET
 MIAMI, FL. 33142
 TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:		date		description	
no	date	by	no	date	description
A	10.03.17				NO CHANGE THIS SHEET
B	11.12.20				UPDATED TO 2020 FBC

date: 0623-17

scale: 3/8" = 1"

dr. by: TARIQ

chk. by:

drawing no.
W17-60

sheet 4 of 7

ITEM #	PART #	REQD.	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
E1	ES-9012	1	DOOR FRAME HEAD	6063-T6	-
E2	ES-9026	1	FRAME SILL	6063-T6	-
E3	ES-9013	2	FRAME JAMB (STD.)	6063-T6	-
E4	ES-9001	1	TOP RAIL	6063-T5	-
E5	ES-9002	1	BOTTOM RAIL	6063-T5	-
E6	ES-9003	2	HINGE/LOCK STILE	6063-T5	-
E7	ES-9027	1	SILL COVER	6063-T5	-
E8	ES-9029	4/ LEAF	GLASS STOP (INSUL. LAM. GLASS)	6063-T5	-
E9	ES-9004	4/ LEAF	GLASS STOP (LAM. GLASS)	6063-T5	-
E10	ES-9008	AS REQD.	CORNER BLOCK	6063-T5	-
E11	ES-9009	AS REQD.	CORNER PLATE	6063-T5	-
E12	ES-9010	AS REQD.	SUPPORT ANGLE	6063-T5	-
E13	ES-9011	AS REQD.	HINGE BACKUP PLATE	6063-T5	-
E14	ES-9020	AS REQD.	LOCK BACKUP PLATE	6063-T5	-
E15	ES-9016	AS REQD.	SHEAR CLIP	6063-T5	-
E16	ES-9005	AS REQD.	W'STRIP ADAPTER	6063-T5	-
E17	ES-7530-213	2	FRAME JAMB (NARROW)	6063-T6	-
E18	ES-7530-214	2	DOOR STOP	6063-T6	-
E19	ALU-A-027	2	BOLT GUIDE ANGLE (2 X 2 X 1/8")	6063-T6	AT TOP & BOTTOM OF LOCK STILE
E20	ALU-P-030	-	LOCK SPACER PLATE (1-1/2" X 1/8")	6063-T6	-
M1	#12 X 1"	AS REQD.	FRAME/LEAF ASSEMBLY FASTENERS	ST/ST	PH SMS
M2	12-24 X 1/2"	AS REQD.	HINGE, INTER. PIVOT & SILL SLIP	ST/ST	FH MS
M3	8-32 X 1/2"	AS REQD.	BOLT GUIDE ANGLE & LOCK BACKUP PLATE FASTENERS	ST/ST	PH SMS
M4	3/8-16 X 1"	AS REQD.	LEAF ASSEMBLY FASTENERS	ST/ST	HEX BOLT
M5	ES-9000-G01	AS REQD.	EXTERIOR GLAZING GASKET	EPDM	DUROMETER 70±5 SHORE A
M6	ES-9000-G02	AS REQD.	INTERIOR GLAZING GASKET	EPDM	DUROMETER 70±5 SHORE A
M7	ES-9000-G03	AS REQD.	BULB W'STRIPPING	TPE/POLYPROPYLENE	-
M8	ES-9000-B01	2/ LITE	SETTING BLOCKS (LAM. GLASS) AT 1/4 POINTS	EPDM	DUROMETER 80±5 SHORE A
M8i	ES-9000-B02A	2/ LITE	SETTING BLOCKS (INSUL. LAM. GLASS) AT 1/4 POINTS	EPDM	DUROMETER 80±5 SHORE A
M9	-	AS REQD.	BUTT HINGES (4 X 4-1/2")	ST/ST	-
M10	60 AT	AS REQD.	RESIDENTIAL HINGES	-	DR. HAHN
M17	-	AS REQD.	DOOR PUSH/PULL	-	-
M18	W13272NK	AS REQD.	PILE W'STRIPPING AT HEAD	WOOL	-
M19	W13351NK	AS REQD.	PILE W'STRIPPING	WOOL	-
M21	#8 X 1"	AS REQD.	KEEPER FASTENERS	ST/ST	FH SMS
M22	#12 X 2"	AS REQD.	FRAME SILL ASSEMBLY FASTENERS (NARROW JAMB)	ST/ST	PH SMS

LOCK SINGLE DOOR:

OPTION #1:

SURFACE MOUNT 3 POINT LOCK SYSTEM (DL01-6063)
BY 'INTERLOCK USA'
KEY OPERATED ON EXTERIOR AND THUMB TURN ON INTERIOR
LEVER TYPE HANDLE AT 38" FROM BOTTOM ACTIVATES SHOOT BOLTS ENGAGING AT HEAD AND SILL
FASTENED WITH
(2) #10 X 3/4" FH SMS

OPTION #2:

SURFACE MOUNT 3 POINT LOCK SYSTEM (MS1953-350)
BY 'ADAMS RITE'
KEY OPERATED ON EXTERIOR AND THUMB TURN ON INTERIOR
FASTENED WITH (4) #8 X 1/2" FH SMS
LEVER TYPE HANDLE AT 38" FROM BOTTOM ACTIVATES SHOOT BOLTS ENGAGING AT HEAD AND SILL
FASTENED WITH
(2) 8-32 X 2-1/2" OH MACHINE SCREWS

HINGES:

OPTION #1:

4-1/2" LONG FLUSH MOUNT STEEL BUTT HINGES
BY 'INTERLOCK USA', (4) PER LEAF
TOP AND BOTTOM HINGES AT 9" FROM EACH END
INTERMEDIATE HINGES AT 34" O.C. MAX.
FASTENED WITH 12-24 X 1/2" FH MACHINE SCREWS
FOUR PER HASP(LEAF).

OPTION #2:

SERIES 60AT DIE CAST ALUMINUM HINGE
BY 'DR HAHN'
(2) AT 6" AND 12" FROM TOP
(1) AT 6" FROM BOTTOM
(1) AT MIDSPAN


SEALANTS:

ALL FRAME JOINTS AND SEAMS SEALED WITH
DOW CORNING 791 SILICONE.

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 20-1118.07

Expiration Date 10/12/2022

By Ismael I. Chanda
Miami-Dade Product Control

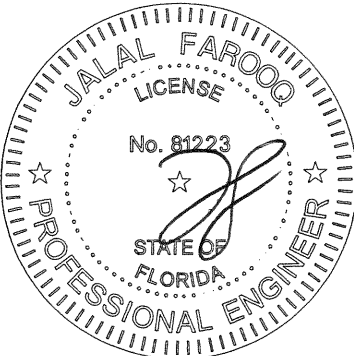

NOV 18 2021

afc





















AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 262-6978
FAX. (305) 262-6978
(C.A.N. 3538)

COMP-ANL\W17-60ES

ES-9100 ALUMINUM OUTSWING DOOR (S.M.I.)


E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151
FAX. (305) 638-5158

revisions:		no.		date		by		description	
A		10.03.17						REV. PER RER COMMENTS	
B		11.12.20						UPDATED TO 2020 FBC	
date:		0623-17							
scale:		3/8" = 1"							
dr. by:		TARIQ							
chk. by:									
drawing no.		W17-60							
sheet		5 of 7							

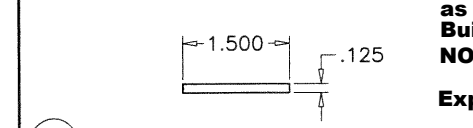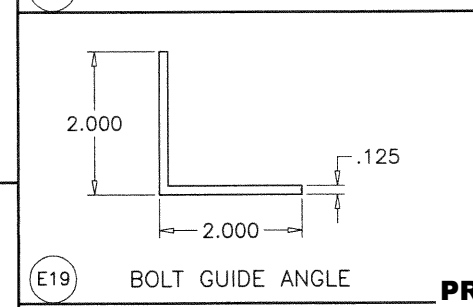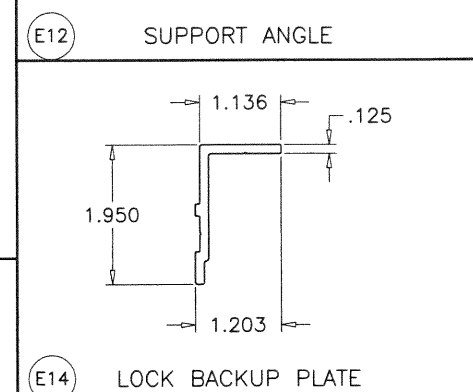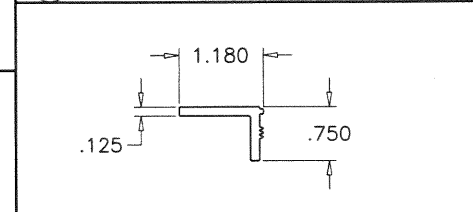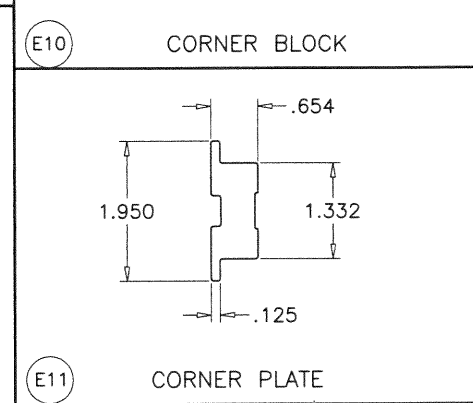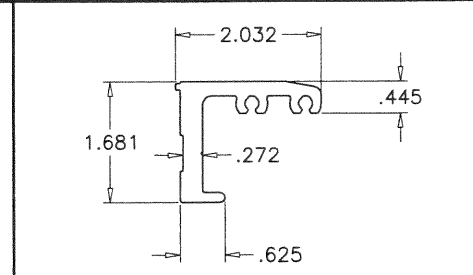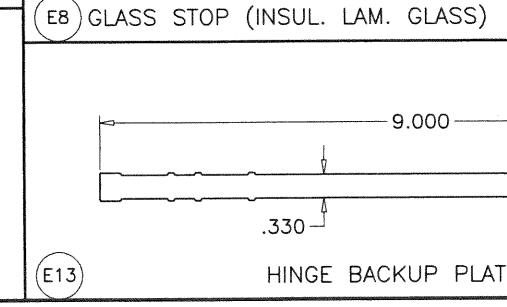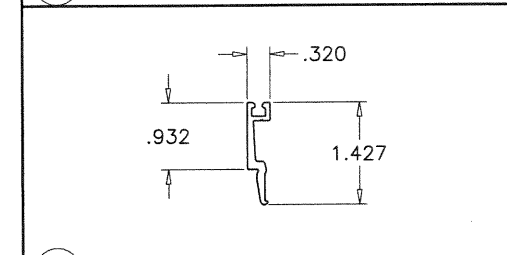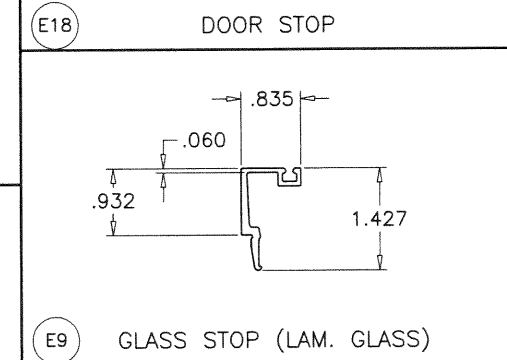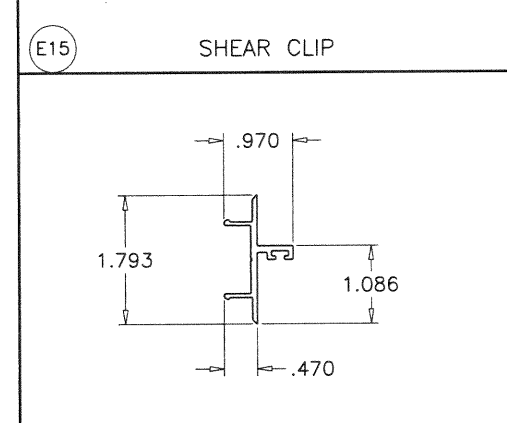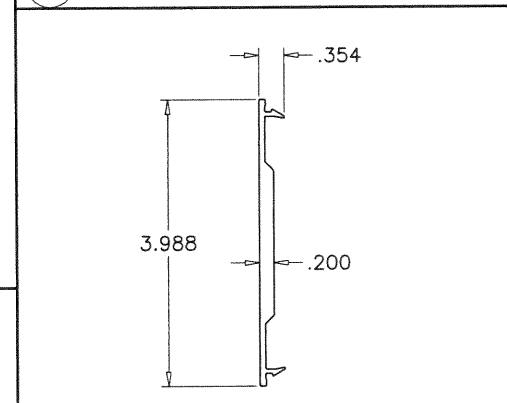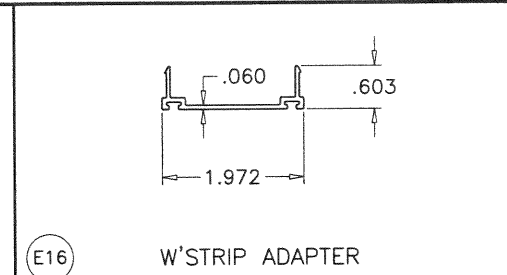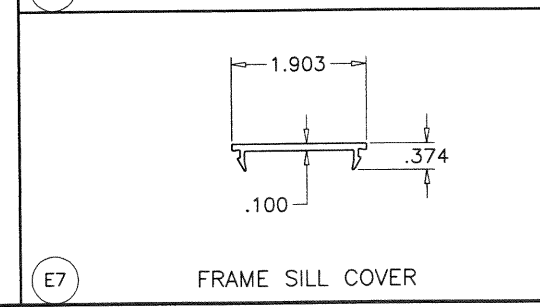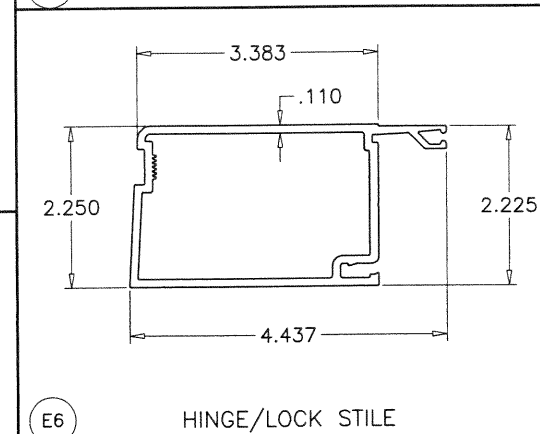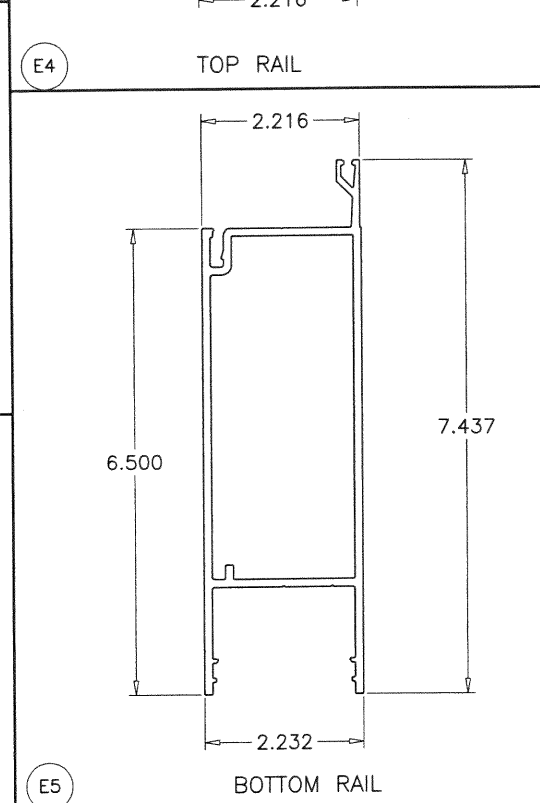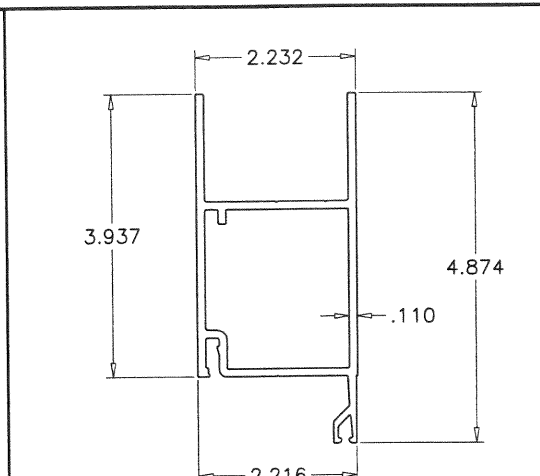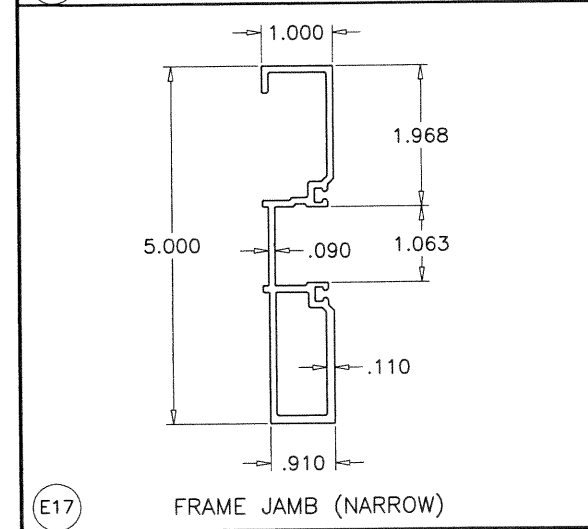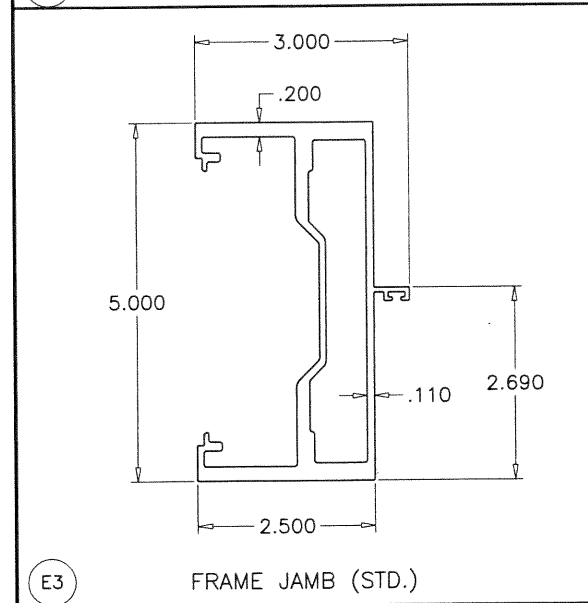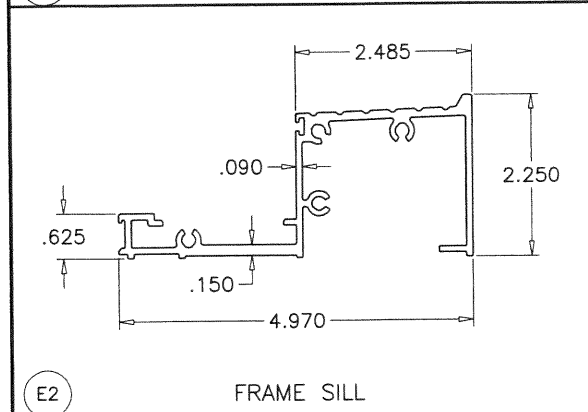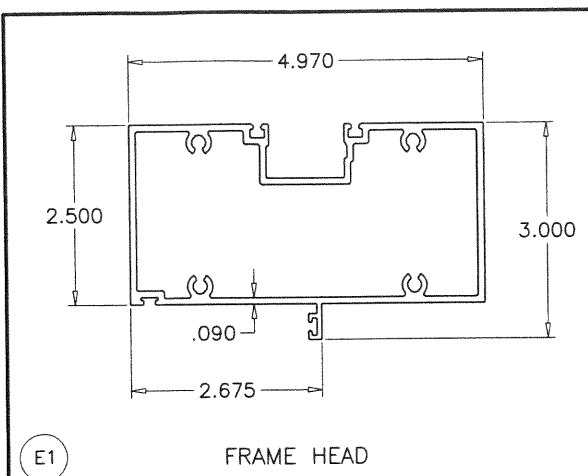

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 20-1118.07
Expiration Date 10/12/2022
By Ismael I. Chanda
Miami-Dade Product Control

NOV 18 2020

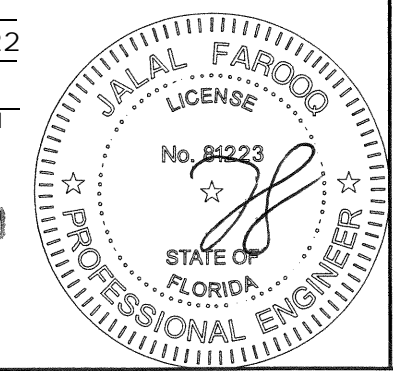

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

COMP-ANL\W17-60ES

ES-9100 ALUMINUM OUTSWING DOOR (S.M.I.)



E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:


no	date	description
A	10.03.17	NO CHANGE THIS SHEET
B	11.12.20	UPDATED TO 2020 FBC

date: 0623-17
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:



drawing no.
W17-60
sheet 6 of 7

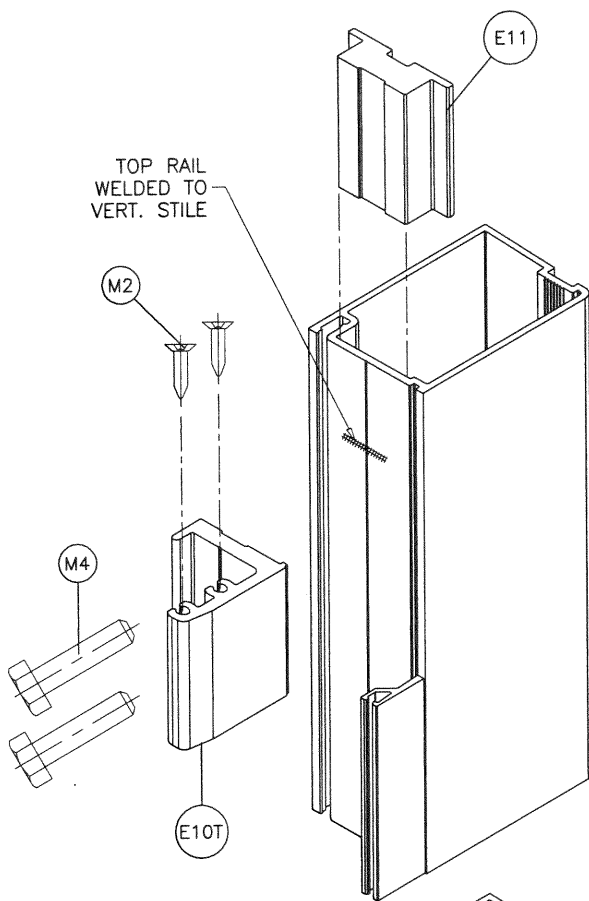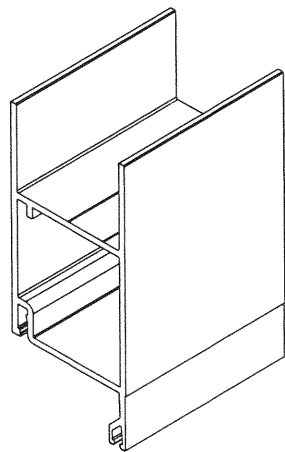


PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 20-1118.07
Expiration Date 10/12/2022
By Ishag I. Chande
Miami-Dade Product Control

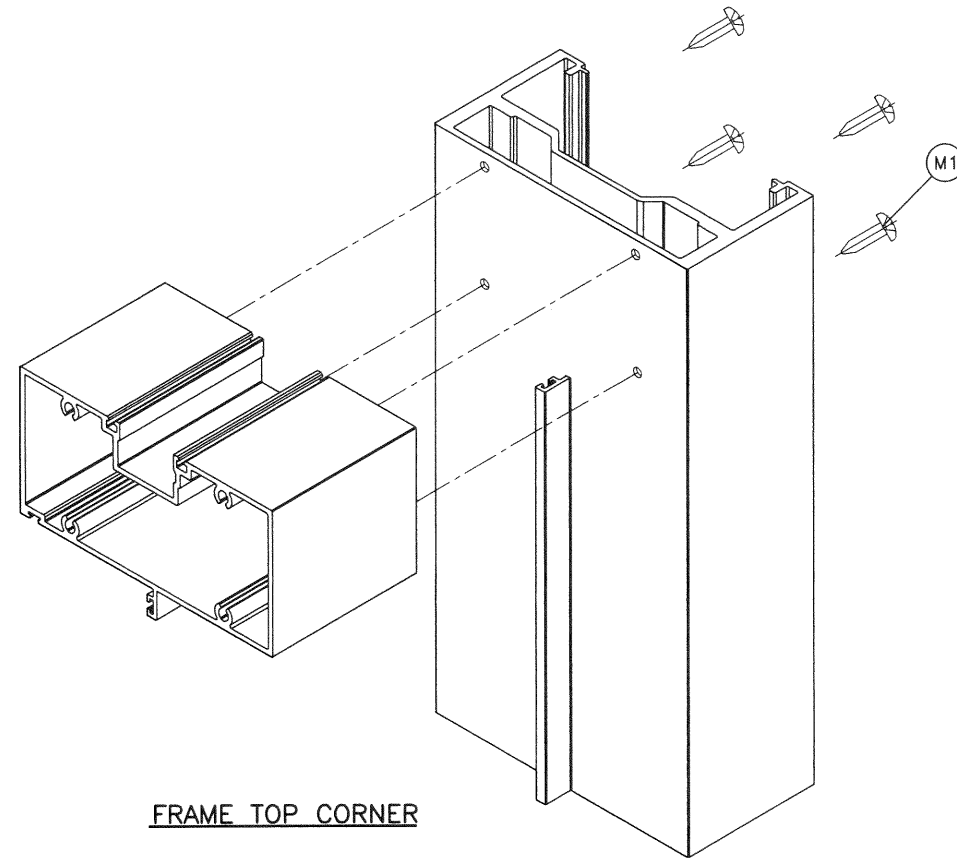

FRAME TOP CORNER

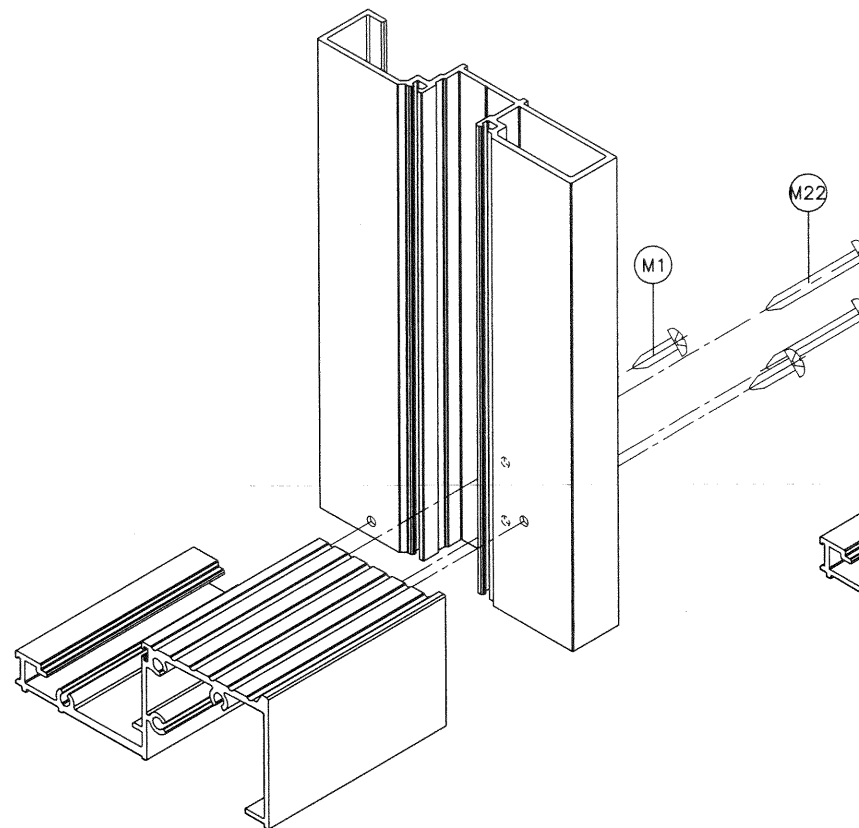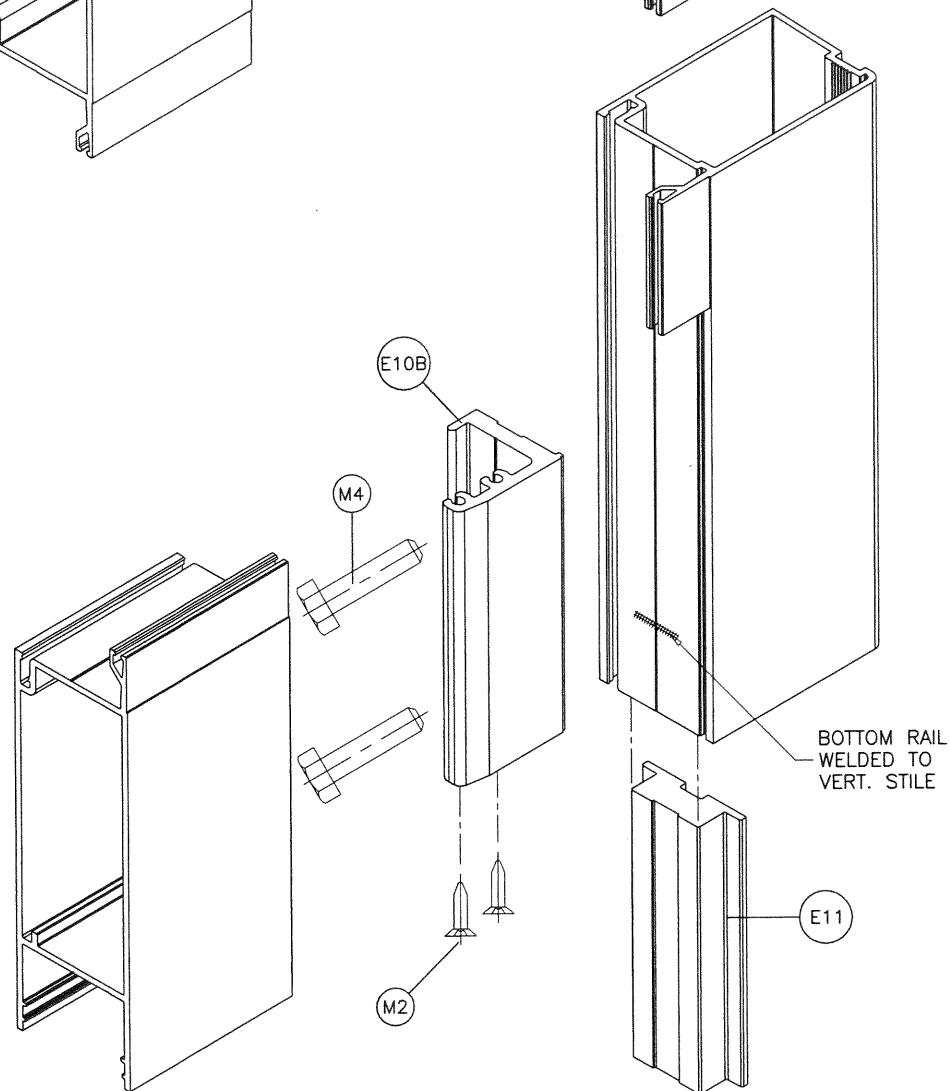


FRAME BOTTOM CORNER
NARROW JAMB

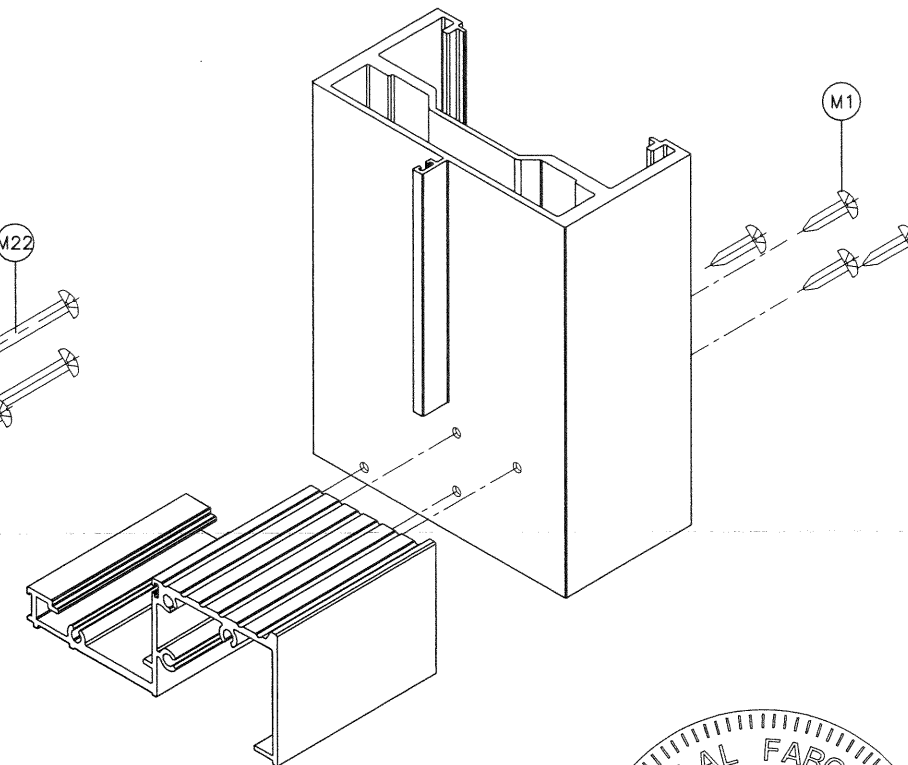

FRAME BOTTOM CORNER
STD. JAMB

NOV 18 2021

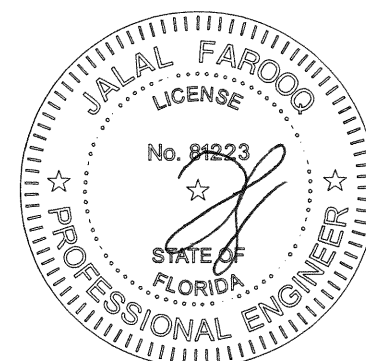

ES-9100 ALUMINUM OUTSWING DOOR (S.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:		no.	date	by	description
A	10.03.17				NO CHANGE THIS SHEET
B	11.12.20				UPDATED TO 2020 FBC
date:		0623-17			
scale:		3/8" = 1"			
dr. by:		TARIQ			
chk. by:					
drawing no.		W17-60			
sheet		7	of 7		

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
(C.A.N. 3538)

COMP-ANL\W17-60ES