



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599

www.miamidade.gov/economy

NOTICE OF ACCEPTANCE (NOA)

Briscoe Shutters, Inc. DBA BSI
2841 Shoreview Drive
Naples, Florida 34112

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER- Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Aluminum Colonial Shutter

APPROVAL DOCUMENT: Drawing No. 13-0579, titled "Colonial Shutter System and Bahama over Colonial Shutter System", sheets 1 through 10 of 10, prepared by Michael Trapasso, P.E., dated December 02, 2020, signed and sealed by Michael Trapasso, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and the expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, the following statement: "Miami-Dade County Product Control Approved", and NOA number, per TAS-201, TAS-202, and TAS-203, unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA # 17-0823.12 and consists of this page 1, evidence submitted pages E-1, E-2, E-3 & E-4 as well as approval document mentioned above.

The submitted documentation was reviewed by Helmy A. Makar, P.E., M.S.



Helmy A. Makar
01/21/2021

NOA No. 20-1215.08
Expiration Date: 11/28/2022
Approval Date: 01/21/2021
Page 1

Briscoe Shutters, Inc. DBA BSI

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 02-0722.04

A. DRAWINGS

1. *Drawing No. 13-0579 titled " Colonial Shutter Master Plan ", sheets 1 through 11 of 11, dated May 10, 2002, prepared by Arthur C. Quinnell, P.E, signed and sealed by Arthur C. Quinnell, P.E.*

B. TESTS

1. *Test report on Large Missile Impact Test, Cyclic Wind Pressure Test and Uniform Static Air Pressure Test of colonial shutters w/ four leaf assembly, prepared by Hurricane Test laboratory, Report No. 0288-0214.02, dated February 19-20, 2002, signed and sealed by Vinu J. Abraham, P.E.*
2. *Test report on Large Missile Impact Test, Cyclic Wind Pressure Test and Uniform Static Air Pressure Test of Double Bahama over Colonial Shutters w/ four leaf assembly, prepared by Hurricane Test laboratory, Report No. 0288-1218.01, dated December 13-14, 2001, signed and sealed by Vinu J. Abraham, P.E.*

C. CALCULATIONS

1. *Anchor analysis prepared by Briscoe shutter, Inc., signed and sealed by Arthur C. Quinnell, P.E.*

D. MATERIAL CERTIFICATIONS

1. *Mill Certified Inspection Report with chemical composition and mechanical properties for aluminum alloy 6063-T52.*

2. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL #07-0713.05

A. DRAWINGS

1. *None.*

B. TEST

1. *None.*

C. CALCULATIONS


1. *None.*

D. QUALITY ASSURANCE

1. *By Miami-Dade County Building Code Compliance Office.*

E. MATERIAL CERTIFICATION

1. *None.*



Helmy A. Makar, P.E., M.S.
Product Control Section Supervisor
NOA No. 20-1215.08
Expiration Date: 11/28/2022
Approval Date: 01/21/2021

Briscoe Shutters, Inc. DBA BSI

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

3. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 09-0122.08

A. DRAWINGS

1. *Drawing No. 13-0579, titled " Colonial Shutter System and Bahama over Colonial Shutter System ", sheets 1 through 11 of 11, prepared by Michael Trapasso, P.E., dated October 13, 2009, signed and sealed by Michael Trapasso, P.E.*

B. TESTS

1. *Test report on Large Missile Impact Test and Cyclic Wind Pressure Test of colonial shutters w/ four leaf assembly, prepared by Hurricane Test laboratory, Specimen #1B, Report No. 0288-0611.07, dated May 05, 2008, signed and sealed by Vinu J. Abraham, P.E.*
2. *Test report on Large Missile Impact Test and Cyclic Wind Pressure Test of colonial shutters w/ four leaf assembly, prepared by Hurricane Test laboratory, Specimen #4, Report No. 0288-0314.08, dated May 05, 2008, signed and sealed by Vinu J. Abraham, P.E.*
3. *Test report on Uniform Static Air Pressure Test of Bahama shutter System and Bahama over Colonial Shutter System, prepared by Hurricane Test laboratory, LLC Report No. 0288-0611-07, specimen #1, dated May 05, 2008, signed and sealed by Vinu J. Abraham, P.E.*

C. CALCULATIONS

1. *Anchor analysis prepared by Briscoe shutter, Inc., signed and sealed by Michael Trapasso, P.E.*

D. QUALITY ASSURANCE

1. *By Miami-Dade County Building Code Compliance Office.*


E. MATERIAL CERTIFICATIONS

1. *Mill Certified Inspection Report with chemical composition and mechanical properties for aluminum alloy 6063-T52.*

4. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 12-0927.01

A. DRAWINGS

1. *Drawing No. 13-0579, titled " Colonial Shutter System and Bahama over Colonial Shutter System ", sheets 1 through 10 of 10, prepared by Michael Trapasso, P.E., dated September 01, 2012, signed and sealed by Michael Trapasso, P.E.*



Helmy A. Makar, P.E., M.S.
Product Control Section Supervisor
NOA No. 20-1215.08
Expiration Date: 11/28/2022
Approval Date: 01/21/2021

Briscoe Shutters, Inc. DBA BSI

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

B. TESTS

1. *None.*

C. CALCULATIONS

1. *Revision analysis prepared by Briscoe shutter, Inc., dated September 20, 2012, signed and sealed by Michael Trapasso, P.E.*

D. QUALITY ASSURANCE

1. *By Miami-Dade County Department of Regulatory and Economic Resources.*

E. MATERIAL CERTIFICATIONS

1. *None.*

5. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 16-0201.21

A. DRAWINGS

1. *Drawing No. 13-0579, titled "Colonial Shutter System and Bahama over Colonial Shutter System", sheets 1 through 10 of 10, prepared by Michael Trapasso, P.E., dated January 18, 2016, signed and sealed by Michael Trapasso, P.E.*

B. TESTS

1. *None.*

C. CALCULATIONS

1. *None.*

D. QUALITY ASSURANCE


1. *By Miami-Dade County Department of Regulatory and Economic Resources.*

E. MATERIAL CERTIFICATIONS

1. *None.*

F. STATEMENTS

1. *Florida Building Code, 2014 Edition compliance letter, issued by Michael Trapasso, P.E., dated January 19, 2016, signed and sealed by Michael Trapasso, P.E.*



Helmy A. Makar, P.E., M.S.
Product Control Section Supervisor
NOA No. 20-1215.08
Expiration Date: 11/28/2022
Approval Date: 01/21/2021

Briscoe Shutters, Inc. DBA BSI

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

6. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 17-0823.12

A. DRAWINGS

1. *Drawing No. 13-0579, titled "Colonial Shutter System and Bahama over Colonial Shutter System", sheets 1 through 10 of 10, dated August 10, 2017, prepared, signed and sealed by Michael Trapasso, P.E.*

B. TESTS

1. *None.*

C. CALCULATIONS

1. *None.*

D. QUALITY ASSURANCE

1. *By Miami-Dade County Department of Regulatory and Economic Resources.*

E. MATERIAL CERTIFICATIONS

1. *None.*

F. STATEMENTS

1. *Florida Building Code, 2014 and 2017 Editions compliance letter, issued by Michael Trapasso, P.E., dated August 10, 2017, signed and sealed by Michael Trapasso, P.E.*

7. NEW EVIDENCE SUBMITTED

A. DRAWINGS

1. *Drawing No. 13-0579, titled "Colonial Shutter System and Bahama over Colonial Shutter System", sheets 1 through 10 of 10, prepared by Michael Trapasso, P.E., dated December 02, 2020, signed and sealed by Michael Trapasso, P.E.*

B. TESTS

1. *None.*

C. CALCULATIONS

1. *None.*

D. QUALITY ASSURANCE


1. *By Miami-Dade County Department of Regulatory and Economic Resources.*

E. MATERIAL CERTIFICATIONS

1. *None.*

F. STATEMENTS

1. *FBC, 2020 Edition compliance letter, issued by Michael Trapasso, P.E., on 12/02/20, signed and sealed by Michael Trapasso, P.E.*




Helmy A. Makar, P.E., M.S.
Product Control Section Supervisor
NOA No. 20-1215.08
Expiration Date: 11/28/2022
Approval Date: 01/21/2021

COLONIAL SHUTTER SYSTEM and
BAHAMA over COLONIAL SHUTTER SYSTEM

MICHAEL TRAPASSO
PROFESSIONAL ENGINEER #62482

Maximum Design Pressures
Bahama & Colonial Shutters
+ 84.7 psf & - 113.3 psf
Bahama Over Colonial Shutter
+ 77 psf & - 77 psf

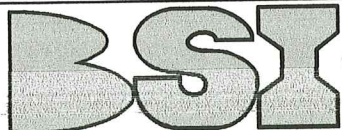

BRISCOE SHUTTERS INC.
2841 Shoreview Drive
Naples FL 34112
www.bsishutters.com
bsishutters@juno.com
Office: 259-774-2025

Glass Separation Sheet 9


Patent No: US 6,996,934 B2
US 7,131,480 B2



PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 20-145.08
Expiration Date 11/28/2022
By *Hugh A. Mohr*
Miami Trade Product Control

DRAWING NO. 13-0579 SHEET NO. 1 of 10

DATE: 12/02/20

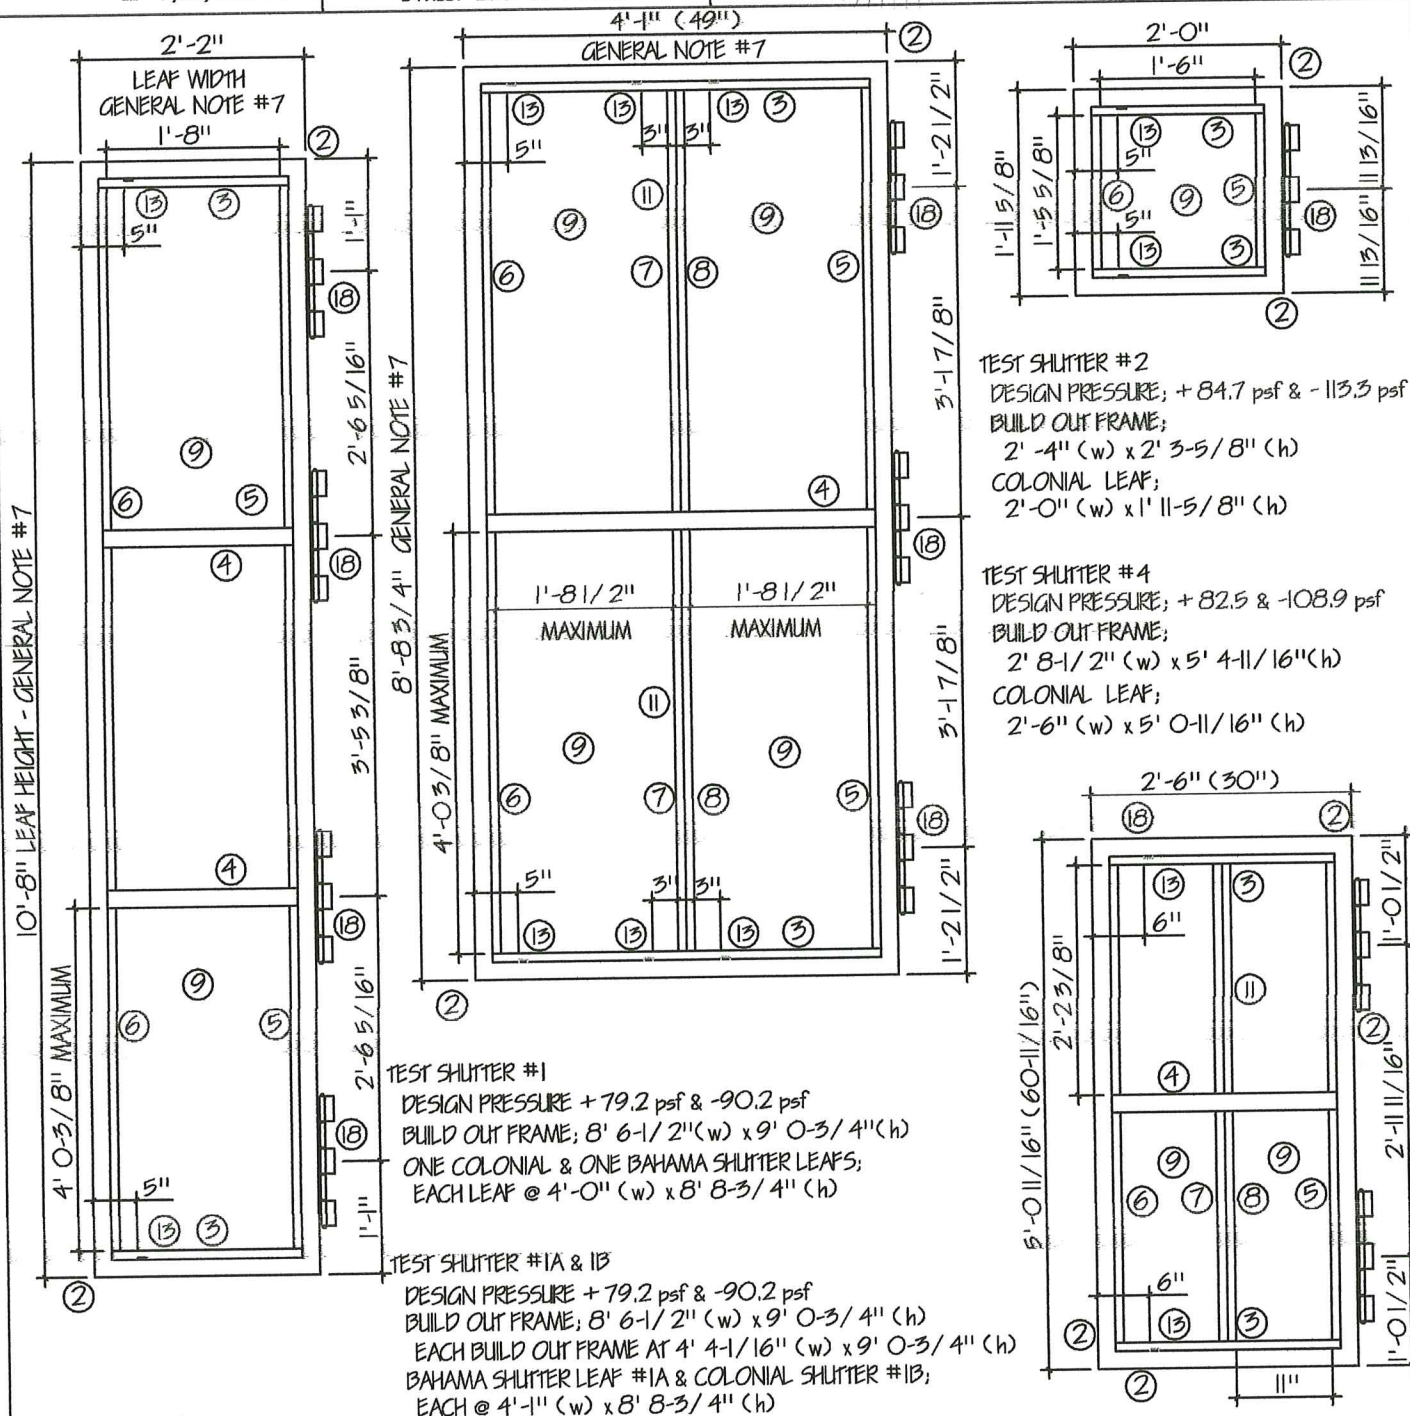

COLONIAL SHUTTER SYSTEM and
BAHAMA over COLONIAL SHUTTER SYSTEM


MICHAEL TRAPASSO
PROFESSIONAL ENGINEER #62482

Maximum Design Pressures
Bahama & Colonial Shutters
+ 84.7 psf & -113.3 psf

Bahama Over Colonial Shutter
+ 77 psf & -77 psf

Glass Separation Sheet 9

Patent No: US 6,996,934 B2
US 7,131,480 B2

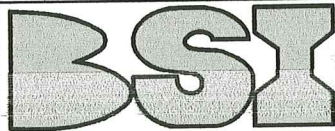

BRISCOE SHUTTERS INC.
2841 Shoreview Drive
Naples FL 34112
www.bsishutters.com
bsishutters@juno.com
Office: 239-774-2025




PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 20-1215-08
Expiration Date 11/28/2022
By Hely A. Melon
Miami Date Product Control

DRAWING NO.
13-0579

SHEET NO.
2 of 10

DATE: 12/02/20

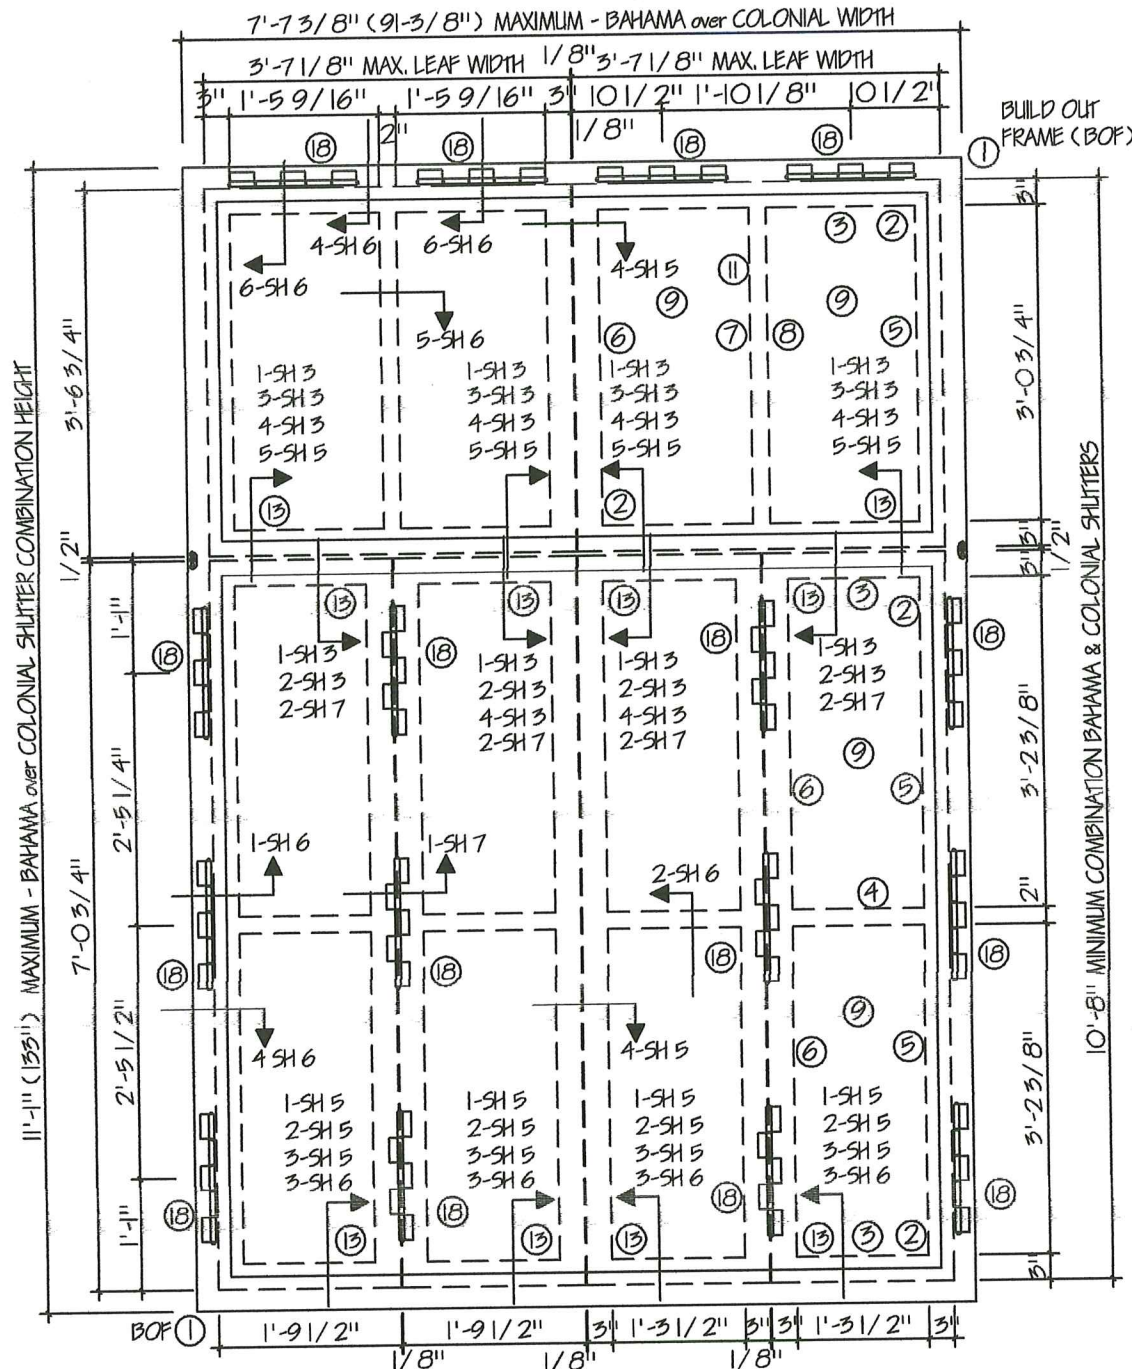

BAHAMA over COLONIAL SHUTTER SYSTEM - DESIGN PRESSURE: + 77 psf & -77 psf

GENERAL NOTES SHEET 10: TEST STANDARDS, WIND SPEED CONVERSIONS, WIND LOADS - COMPONENTS & CLADDING, ADJUSTMENT
FACTOR FOR BUILDINGS HEIGHT & EXPOSURE, SHUTTER LEAF SIZES, FASTENER CALCULATIONS & LOCATIONS

MICHAEL TRAPASSO
PROFESSIONAL ENGINEER #62482

BSI

MICHAEL TRAPASSO
PROFESSIONAL ENGINEER #62482



Michael Trapasso

12/2/20


3609 COTTON CLUB LANE
NAPLES, FLORIDA 34105

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 20-1215.08
Expiration Date 11/28/2022
By Hely A. Mohr
Miami-Dade Product Control


DRAWING NO. 13-0579	SHEET NO. 3 of 10
DATE: 12/02/20	

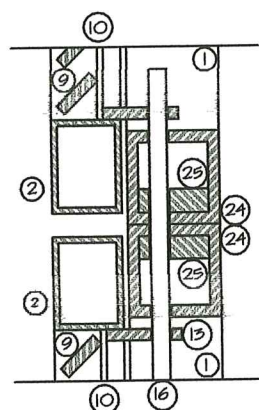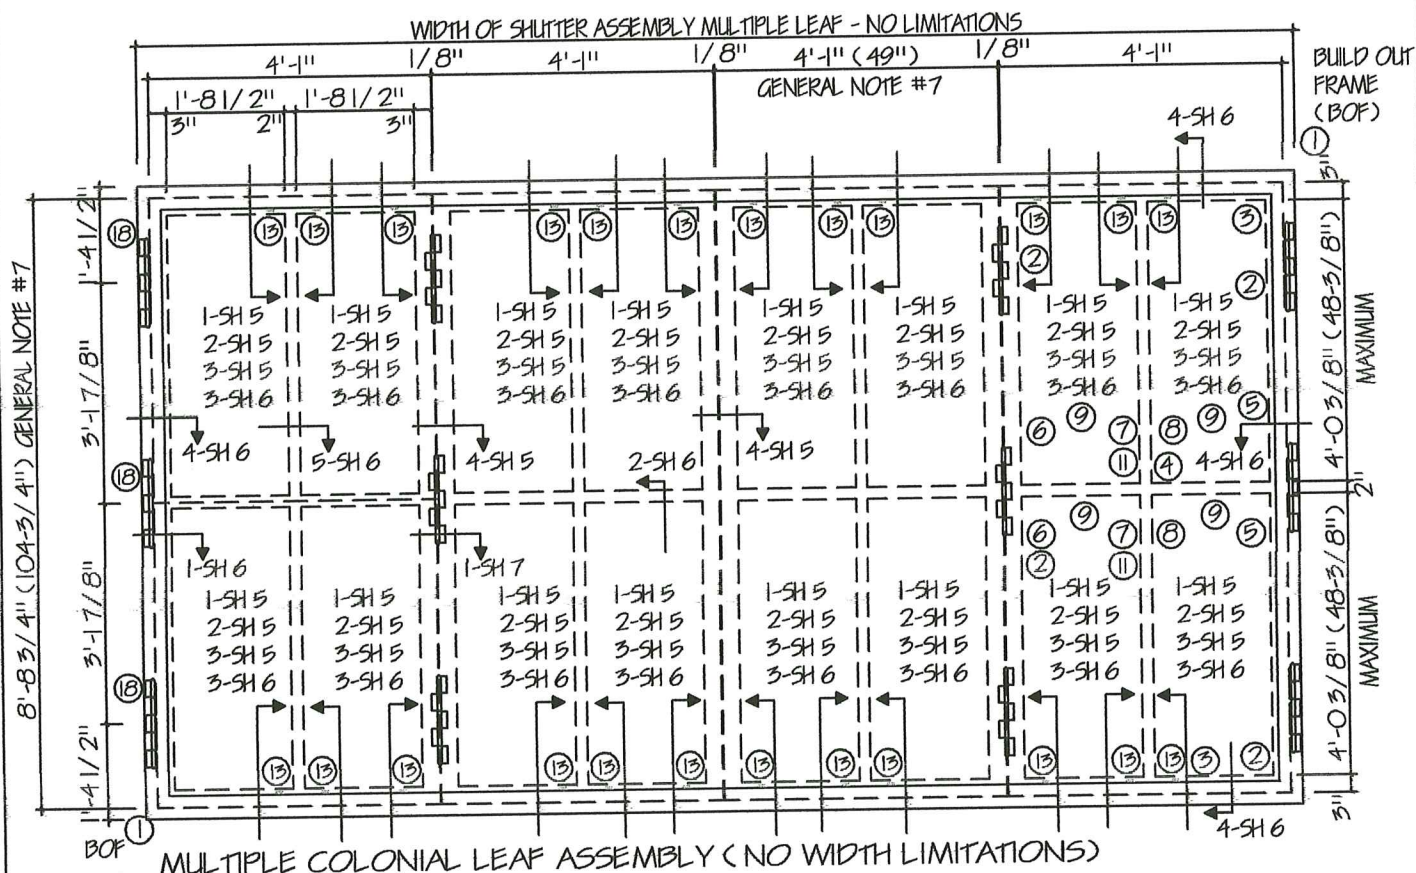


1 - SH 3
SECTION @ INSIDE CLOSURE
ROD @ HORIZONTAL MULLION
BAHAMA over COLONIAL

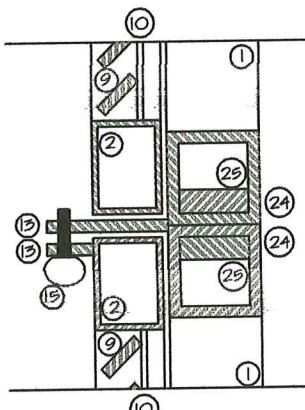

2 - SH 3
SECTION @ OUTSIDE CLOSURE
HORIZONTAL MULLION
BAHAMA over COLONIAL

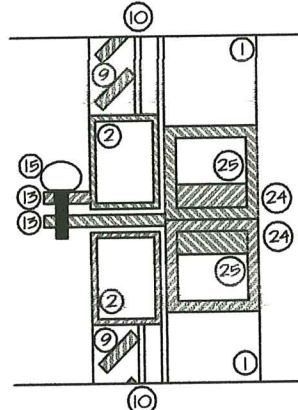

3- SH 3
SECTION @ OUTSIDE CLOSURE
HORIZONTAL MULLION
BAHAMA over COLONIAL

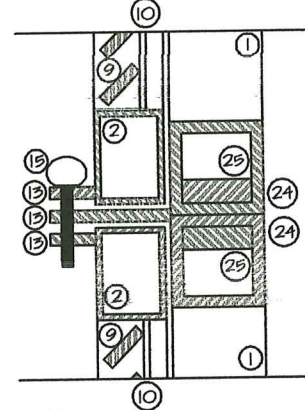

4-SH3
SECTION @ OUTSIDE CLOSURE
HORIZONTAL MULLION
BAHAMA over COLONIAL

GENERAL NOTES SHEET 10: TEST STANDARDS, WIND SPEED CONVERSIONS, WIND LOADS - COMPONENTS & CLADDING, ADJUSTMENT FACTOR FOR BUILDINGS HEIGHT & EXPOSURE, SHUTTER LEAF SIZES, FASTENER CALCULATIONS & LOCATIONS

MICHAEL TRAPASSO
PROFESSIONAL ENGINEER #62482


BSI

John A. Jones
12/2/20

3609 COTTAGE CLUB LANE
NAPLES, FLORIDA 34105

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 20-1215-08
Expiration Date 11/28/2022
By Heidi A. Miller
Miami-Dade Product Control

DRAWING NO. 13-0579	SHEET NO. 4 of 10
DATE: 12/02/20	

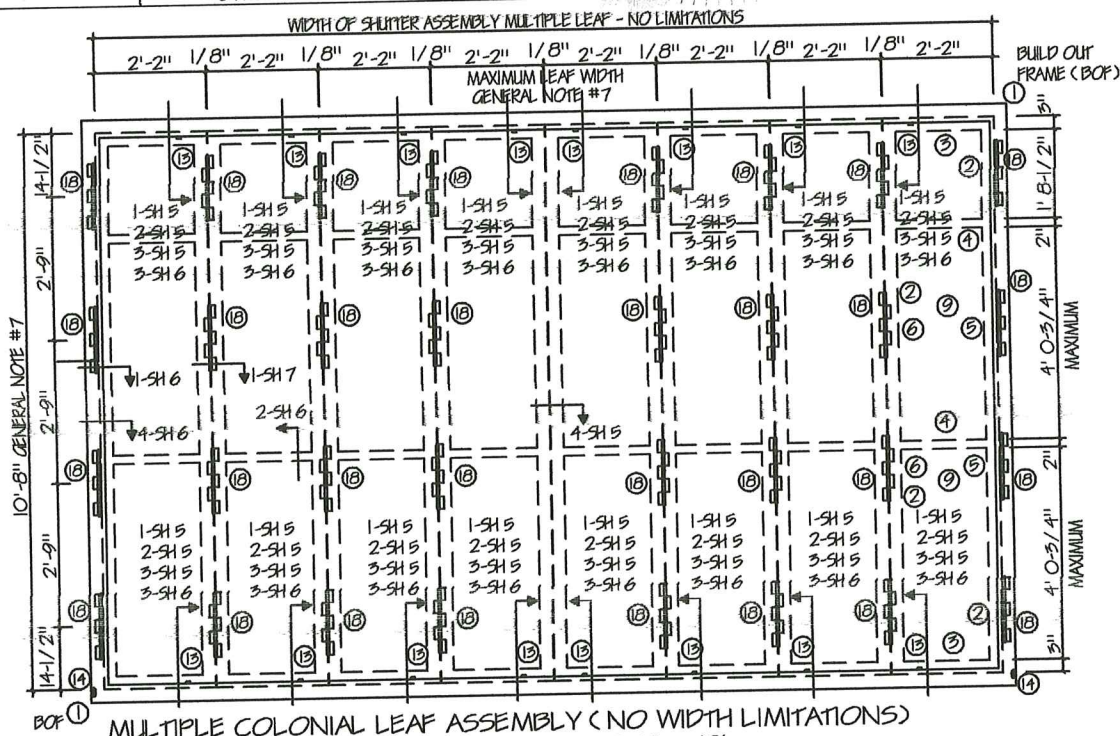

HINGE ASSEMBLY HINGE SPECIFICATIONS: REFER TO PAGE 10 GENERAL NOTE 10, 10a, & 10b

- 1 BAHAMA SHUTTER, 4'-1" (49") (w)
HINGES - 2 SETS OF 5 LEAF HINGES AT THE TOP PER SHUTTER, (3 LEAFS AT THE BUILD OUT FRAME & 2 LEAFS AT THE SHUTTER, WITH 3 SCREWS PER LEAF)
- 2 BAHAMA SHUTTER, 5'-7" (43") (w)
HINGES - 1 SET, 7 LEAF HINGE AT THE TOP PER SHUTTER, (4 LEAFS AT THE BUILD OUT FRAME & 3 LEAFS AT THE SHUTTER, WITH 3 SCREWS PER LEAF)
- 3 BAHAMA SHUTTER, 2'-6" (30") (w)
HINGES - 1 SET OF 5 LEAF HINGES AT THE TOP PER SHUTTER, (3 LEAFS AT THE BUILD OUT FRAME & 2 LEAFS AT THE SHUTTER, WITH 3 SCREWS PER LEAF)

OLD CLOSE TABS
1. BAHAMA SHUTTER, 4'-1" (w) x 8'-3/4" (h) - 4 TABS, 2 @ 5" IN FROM OUTSIDE EDGE JAMBS & 2 @ 3" EACH SIDE OF CENTER LINE
2. BAHAMA SHUTTER, 3'-7" (w) x 6'-0" (h) - 2 TABS, 5" TO 6" IN FROM OUTSIDE EDGE JAMBS

SHUTTER LEAF TOLERANCES: ANY COMBINATION OF WIDTH x HEIGHT NOT TO EXCEED 35.64 SQ FT PER LEAF IS ALLOWED WITHIN THE DESIGN PRESSURE

BAHAMA SHUTTER SYSTEM ASSEMBLY:
BAHAMA LEAF; WIDTH 4'-1" (49"), HEIGHT 8' 8-3/4" (103-3/4"), GENERAL NOTE #7

COMBINED BAHAMA & COLONIAL; BOF WIDTH 7' 7-3/8" (91-3/8"), HEIGHT 11'-1" (133") GENERAL NOTE #7
MAXIMUM BAHAMA LEAF; WIDTH 3' 7-1/8" (43-1/8"), MAXIMUM COMBINED HEIGHT - BAHAMA HEIGHT
PLUS COLONIAL HEIGHT NOT TO EXCEED 10'-8" (128"), GENERAL NOTE #7
MAXIMUM COLONIAL LEAF; WIDTH 1' 9-1/2" (21-1/2"), MAXIMUM COMBINED HEIGHT - BAHAMA HEIGHT
PLUS COLONIAL HEIGHT NOT TO EXCEED 10'-8" (128"), GENERAL NOTE #7

COLONIAL LEAF: WIDTH 2'-2" (26"), HEIGHT 10'-8" (128"), GENERAL NOTE #7

COLONIAL LEAF; WIDTH 4'-1" (49"), HEIGHT 8' 8-3/4" (103-3/4"), GENERAL NOTE #7

GENERAL NOTES SHEET 10: TEST STANDARDS, WIND SPEED CONVERSIONS, WIND LOADS - COMPONENTS & CLADDING, ADJUSTMENT FACTOR FOR BUILDINGS HEIGHT & EXPOSURE, SHUTTER LEAF SIZES, FASTENER CALCULATIONS & LOCATIONS


COLONIAL SHUTTER SYSTEM and
BAHAMA over COLONIAL SHUTTER SYSTEM

Maximum Design Pressures
Bahama & Colonial Shutters
+ 84.7 psf & - 113.3 psf

Bahama Over Colonial Shutter
+ 77 psf & - 77 psf

Glass Separation Sheet 9

Patent No: US 6,996,934 B2
US 7,131,480 B2

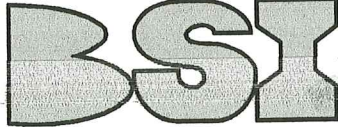

BRISCOE SHUTTERS INC.

2841 Shoreview Drive
Naples FL 34112

www.bsishutters.com

bsishutters@juno.com

Office: 239-774-2025

MICHAEL TRAPASSO
PROFESSIONAL ENGINEER #62482



PRODUCT REVISED

as complying with the Florida
Building Code

Acceptance No 20-1215-08


Expiration Date 11/28/2027

By *Heidi A. Mohr*
Miami Dade Product Control


DRAWING NO.
13-0579

SHEET NO.
5 of 10


DATE: 12/02/20

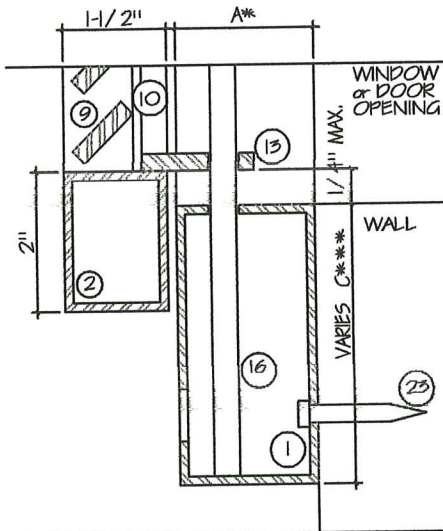


1-SH 5 SECTION: INSIDE CLOSURE
ROD @ SILL or HEAD

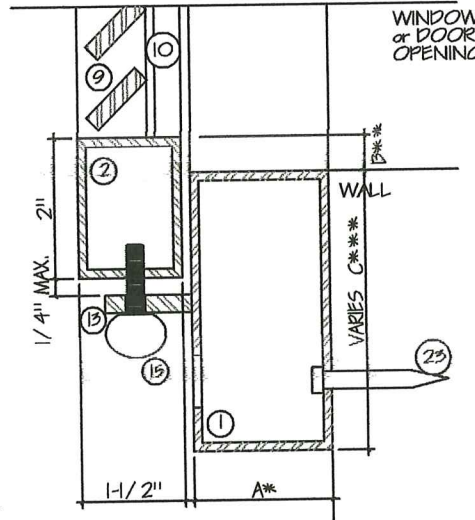


2-SH 5 SECTION: SILL or HEAD
CLOSURE - VERTICAL THUMBSCREW

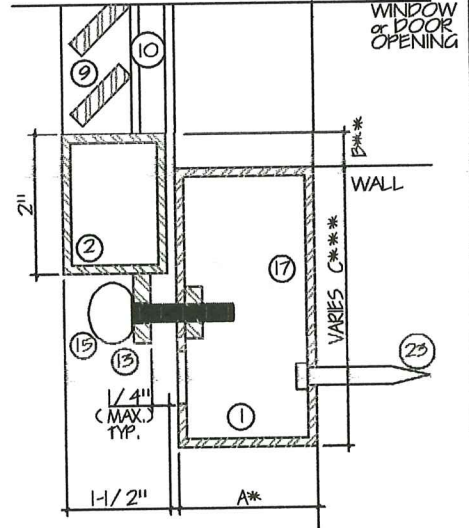


3-SH 5 SECTION: SILL or HEAD
OUTSIDE CLOSURE
HORIZONTAL - THUMBSCREW

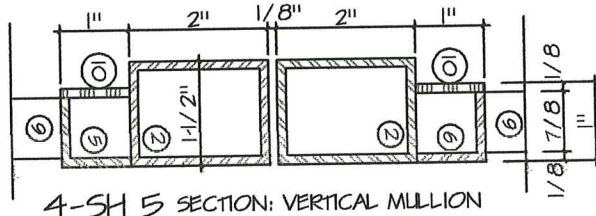


4-SH 5 SECTION: VERTICAL MULLION



13 HOLD CLOSE TAB




14 HOLD OPEN TAB
FRONT VIEW



GENERAL NOTE:
ADD 2-1/2" TO LENGTH
FOR EACH ADDITIONAL
SHUTTER LEAF / SIDE

14 HOLD OPEN TAB
SIDE VIEW

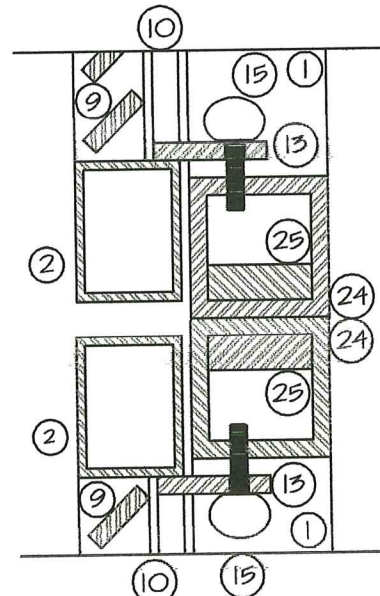

5-SH 5 SECTION: INSIDE CLOSURE
THUMBSCREWS @ HORIZONTAL
MULLION

NOTES:

- A * DEPTH OF BUILD OUT FRAME (1) - REFER TO SHEET 9 "MINIMUM GLASS SEPARATION"
- B * DIMENSION VARIES: SLAT SPACING TO ACCOMMODATE FULL SLAT (1/4" x 1" FLAT BAR @ 45 DEGREE) IN SLAT WELD GUIDES (5) & (6)
- C * * * WIDTH VARIES MINIMUM 3"

GENERAL NOTES SHEET 10: TEST STANDARDS, WIND LOADS CONVERSIONS, WIND LOADS - COMPONENTS & CLADDING, ADJUSTMENT
FACTOR FOR BUILDINGS HEIGHT & EXPOSURE, SHUTTER LEAF SIZES, FASTENER CALCULATIONS & LOCATIONS

COLONIAL SHUTTER SYSTEM and
BAHAMA over COLONIAL SHUTTER SYSTEM

Maximum Design Pressures
Bahama & Colonial Shutters
+ 84.7 psf & - 113.3 psf
Bahama Over Colonial Shutter
+ 77 psf & - 77 psf

Glass Separation Sheet 9

Patent No: US 6,996,934 B2
US 7,131,480 B2

BSI

BRISCOE SHUTTERS INC.

2841 Shoreview Drive
Naples FL 34112

www.bsishutters.com
bsishutters@juno.com
Office: 239-774-2025

MICHAEL TRAPASSO
PROFESSIONAL ENGINEER #62482

12/2/20
3609 COTTAGE CLUB LANE
NAPLES, FLORIDA 34105

PRODUCT REVISED
as complying with the Florida
Building Code


Acceptance No 20-1215.08
Expiration Date 11/28/2022

By *H. G. A. Miller*
Miami Data Product Control


DRAWING NO.
13-0579

SHEET NO.
6 of 10


DATE: 12/02/20

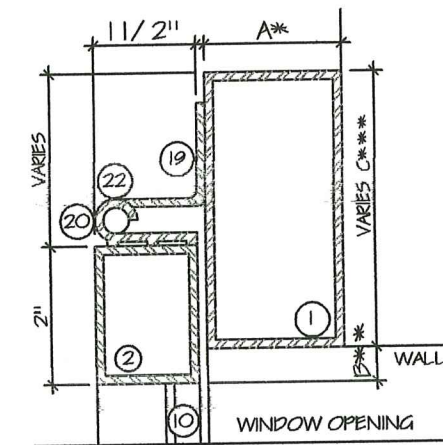


1-SH 6 SECTION @ HINGE
HEAD or JAMB

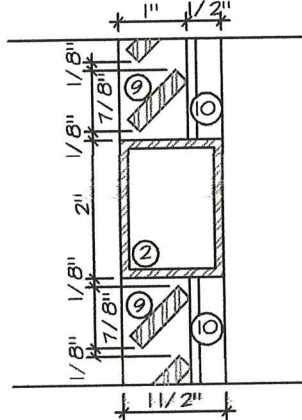


2-SH 6
SECTION @ HORIZONTAL
MULLION FRAME

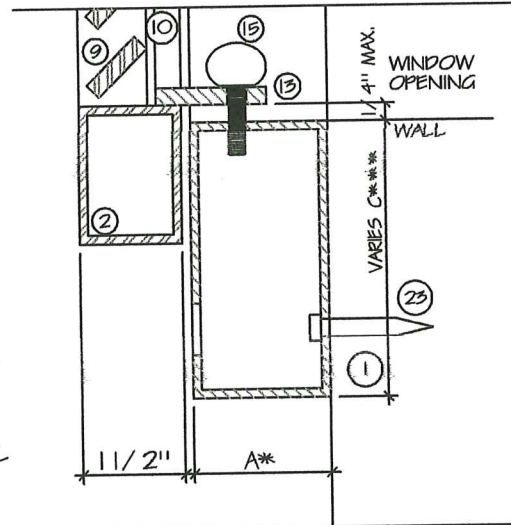


3-SH 6 SECTION @ SILL or HEAD INSIDE
CLOSURE THUMBSCREW

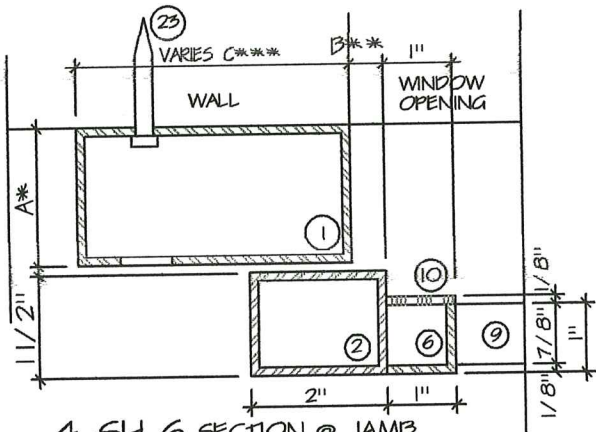

4-SH 6 SECTION @ JAMB

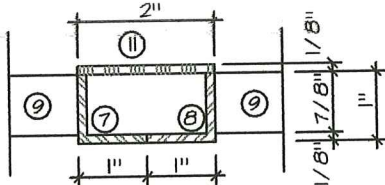

5-SH 6 SECTION @ VERTICAL
CENTER MULLION

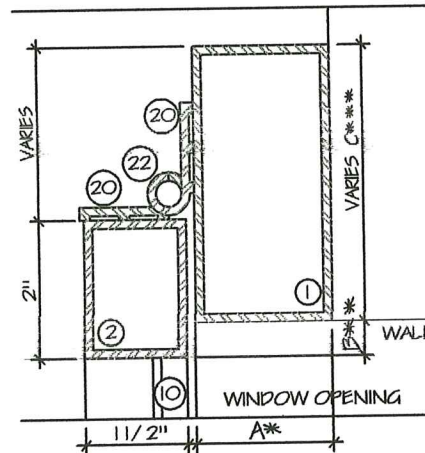

6-SH 6 SECTION @ HINGE
HEAD or JAMB

NOTES:

A* DEPTH OF BUILD OUT FRAME (1) = REFER TO SHEET 9 "MINIMUM GLASS SEPARATION"

B*** DIMENSION VARIES; SLAT SPACING TO ACCOMMODATE FULL SLAT (1/4 x 1 Flat Bar @ 45-Degree) IN SLAT WELD GUIDES (5) & (6)

C*** WIDTH VARIES MINIMUM 3"

GENERAL NOTES SHEET 10: TEST STANDARDS, WIND SPEED CONVERSIONS, WIND LOADS - COMPONENTS & CLADDING, ADJUSTMENT FACTOR FOR BUILDINGS HEIGHT & EXPOSURE, SHUTTER LEAF SIZES, FASTENER SCHEDULES & LOCATIONS


COLONIAL SHUTTER SYSTEM and
BAHAMA over COLONIAL SHUTTER SYSTEM

Maximum Design Pressures
Bahama & Colonial Shutters
+ 84.7 psf & - 113.3 psf

Bahama Over Colonial Shutter
+ 77 psf & - 77 psf

Glass Separation Sheet 9

Patent No: US 6,996,934 B2
US 7,131,480 B2

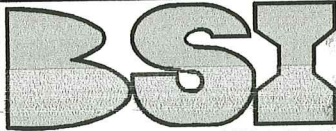

BRISCOE SHUTTERS INC.

2841 Shoreview Drive
Naples FL 34112

www.bsisshutters.com
bsishutters@juno.com
Office: 239-774-2025

MICHAEL TRAPASSO
PROFESSIONAL ENGINEER #62482

12/2/20
3609 COTTAGE CLUB LANE
NAPLES, FLORIDA 34105

PRODUCT REVISED
as complying with the Florida
Building Code

Acceptance No 20-1215-08
Expiration Date 11/28/2022



By *Heg A. Miller*
Miami Door Product Control

DRAWING NO.
13-0579



SHEET NO.
7 of 10

DATE: 12/02/20


HINGE SPECIFICATIONS: REFER TO PAGE 10 GENERAL NOTE 10, 10a, & 10b

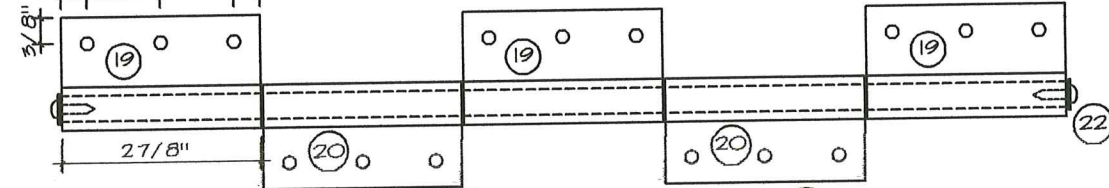

HINGE LAYOUT SHUTTER FRAME (2) TO SHUTTER FRAME (2). HINGE SPECIFICATIONS: REFER TO PAGE 10 GENERAL NOTE 10, 10a, & 10b

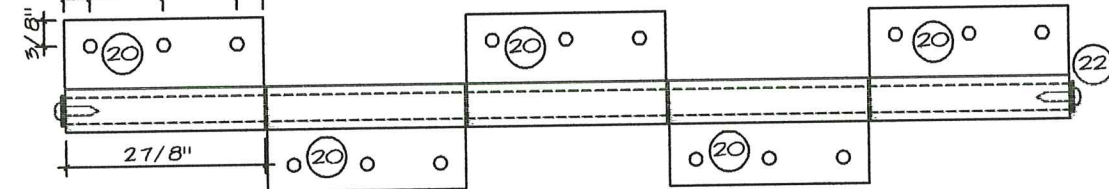


HINGE LAYOUT SHUTTER FRAME (2) TO SHUTTER FRAME (2)

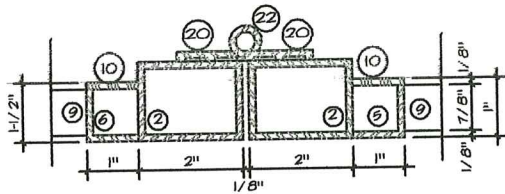


1-SH 7 SECTION: HINGE @ VERTICAL JAMBS

(20) FLAT HINGE


(19) SINGLE HINGE

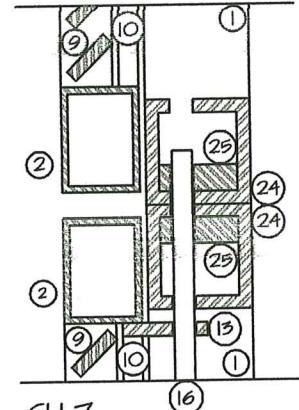


2-SH 7 SECTION @ INSIDE CLOSURE ROD @ HORIZONTAL MULLION BAHAMA over COLONIAL

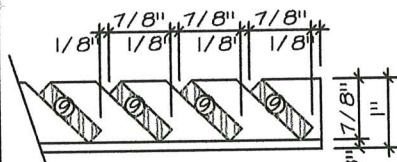

(6) SLAT WELD GUIDE LEFT

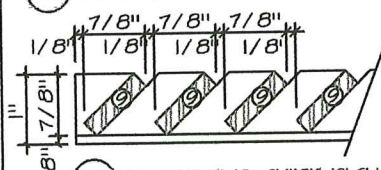


(5) SLAT WELD GUIDE RIGHT

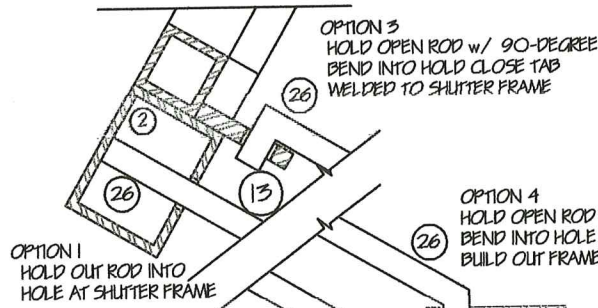

OPTION 1 HOLD OUT ROD INTO HOLE AT SHUTTER FRAME


OPTION 3 HOLD OPEN ROD w/ 90-DEGREE BEND INTO HOLD CLOSE TAB WELDED TO SHUTTER FRAME

OPTION 4 HOLD OPEN ROD w/ 45-DEGREE (+ -) BEND INTO HOLE @ TOP OF BUILD OUT FRAME



OPTION 1

OPTION 2


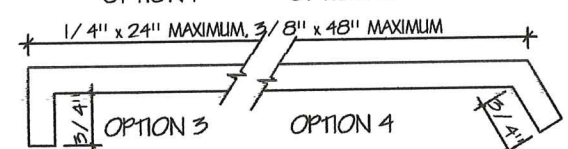


OPTION 3

OPTION 4

(26) BAHAMA HOLD OPEN ROD

OPTION 2 HOLD OUT ROD INTO HOLE AT BUILD OUT FRAME

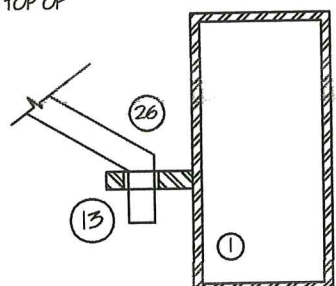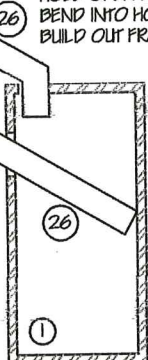

OPTION 4 HOLD OPEN ROD w/ 45-DEGREE (+ -) BEND INTO HOLE @ HOLD CLOSE TAB WELDED TO BUILD OUT FRAME


SECTION @ BAHAMA HOLD OPEN ROD LOCATIONS

COLONIAL SHUTTER SYSTEM and
BAHAMA over COLONIAL SHUTTER SYSTEM

Maximum Design Pressures
Bahama & Colonial Shutters
+ 84.7 psf & - 113.3 psf
Bahama Over Colonial Shutter
+ 77 psf & - 77 psf

Glass Separation Sheet 9

Patent No: US 6,996,934 B2
US 7,131,480 B2

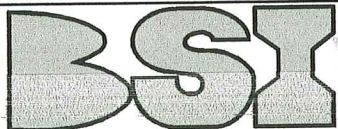

BRISCOE SHUTTERS INC.
2841 Shoreview Drive
Naples FL 34112
www.bsisshutters.com
bsishutters@juno.com
Office: 239-774-2025

MICHAEL TRAPASSO
PROFESSIONAL ENGINEER #62482



PRODUCT REVISED
as complying with the Florida
Building Code

Acceptance No 20-1215-08
Expiration Date 11/28/2022

By H. G. A. Miller
Miami Date Product Control

DRAWING NO.
13-0579

SHEET NO.
8 of 10

DATE: 12/02/20

DESCRIPTION OF MATERIAL

Item#	DESCRIPTION OF MATERIAL	SIZE	TYPE	MATERIAL GRADE
1	BUILD OUT FRAME	A * x C *** x 1/8"	TUBE	ALUMINUM 6063-T52
2	SHUTTER FRAME	1 1/2" x 2" x 1/8"	TUBE	ALUMINUM 6063-T52
3	SPACER	1" x 1" x 1/8"	TUBE	ALUMINUM 6063-T52
4	HORIZONTAL MULLION	1 1/2" x 2" x 1/8"	TUBE	ALUMINUM 6063-T52
5	SLAT WELD GUIDE RIGHT	1" x 1" x 1/8"	ANGLE	ALUMINUM 6063-T52
6	SLAT WELD GUIDE LEFT	1" x 1" x 1/8"	ANGLE	ALUMINUM 6063-T52
7	VERTICAL MULLION RIGHT	1" x 1" x 1/8"	ANGLE	ALUMINUM 6063-T52
8	VERTICAL MULLION LEFT	1" x 1" x 1/8"	ANGLE	ALUMINUM 6063-T52
9	SLATS	1/4" x 1"	FLAT BAR	ALUMINUM 6063-T52
10	JAMB WELD GUIDE COVER	1" x 1/8"	FLAT BAR	ALUMINUM 6063-T52
11	VERTICAL MULLION BACK COVER	1/8" x 2"	FLAT BAR	ALUMINUM 6063-T52
12				
13	HOLD CLOSE TAB	1/4" x 1" x Varies	FLAT BAR	ALUMINUM 6063-T52
14	HOLD OPEN TAB	1/4" x 1" x Varies	FLAT BAR	ALUMINUM 6063-T52
15-15*	SHUTTER CLOSURE THUMBSCREW	1/4" x 1" or *1 1/2"	THUMBSCREW	STAINLESS STEEL
16	INSIDE CLOSURE ROD	3/8" x VARIES PER SHUTTER	ROD	ALUMINUM 6063-T52
17				
18	HINGE ASSEMBLY			
19	SINGLE HINGE	3/16" x 2-7/8" x 1-5/8"		ALUMINUM 6061-T6
20	FLAT HINGE	3/16" x 2-7/8" x 1-5/8"		ALUMINUM 6061-T6
21	HINGE SCREWS	#10 x 1" 3 AT EACH HINGE LEAF		HEX SELF-DRILLING
22	HINGE PIN	3/8" DIAMETER	ROD	ALUMINUM 6063-T52
23	BUILD OUT FRAME FASTENERS			
	CONCRETE BLOCK HOLLOW	1/4 x MIN EMBED 1 1/4"	S.S. CONC. SCREW	ELCO IND. or EQUAL
	CONCRETE BLOCK; CONC. FILL	1/4 x MIN EMBED 1 1/4"	S.S. CONC. SCREW	ELCO IND. or EQUAL
	WOOD FRAMING	1/4" x MIN. EMBED 1 1/4"	LAG BOLT or SS CONC. SCREW	ELCO IND. or EQUAL
	WOOD FRAMING	5/16" x MIN. EMBED 1 1/4"	LAG BOLT or SS CONC. SCREW	ZINC, SS or EQUAL
	METAL FRAMING	12-24 x MIN. EMBED 1"	TEK SCREW	TEK SELF-DRILLING
24	HORIZONTAL MULLION	2" x 2" x 1/4"	TUBE	ALUMINUM 6061-T6
25	HORIZONTAL MULLION STIFFENER	1/2" x 1-1/2"	FLAT BAR	ALUMINUM 6061-T6
26	HOLD OUT ROD	1/4 x 24" MAXIMUM, 3/8" x 48" MAXIMUM	ROD	ALUMINUM 6063-T52

ASSEMBLY METHOD:

SHUTTER FRAME

- 1A SHUTTER FRAME CORNER CONSTRUCTION, AT EACH PANEL CORNER, THE ADJOINING STILE / RAIL ENDS ARE MITER CUT, BUTTED AND WELDED TOGETHER USING TWO (2) 1/4" x 2-13/16" FILET WELDS - ONE PER FACE, EACH FACE WELD IS GROUND DOWN SMOOTH
- 1B INTERMEDIATE RAIL END CONSTRUCTION, AT EACH INTERMEDIATE RAIL END, THE RAIL IS SQUARE CUT, BUTTED AND WELDED TO THE ADJACENT PANEL FRAME MEMBER USING TWO (2) 1/4" x 2" FILET WELDS - ONE PER FACE, EACH FACE WELD IS GROUND DOWN SMOOTH
- 1C SLAT WELD GUIDES WELDED TO THE SHUTTER FRAME JAMBS ON THE INSIDE AT 6" O/C, TOP AND BOTTOM
- 1D VERTICAL MULLION WELD GUIDE; ONE RIGHT WELD GUIDE AND ONE LEFT WELD GUIDE WELDED TOGETHER ON THE INSIDE AT 6" O/C, THIS MEMBER IS WELDED TO THE HEAD, MULLIONS, AND SILL
- 1E SLANTED SLAT CONSTRUCTION, ALL SLATS ARE SQUARE CUT AND WELDED AT EACH END TO THE ADJACENT PANEL STILE MEMBER USING ONE (1) 1/4" x 1" FILET WELD

BUILD OUT FRAME

- 2A BUILD OUT FRAME CONSTRUCTION, AT EACH CORNER THE ADJOINING STILE / RAIL ENDS ARE MITER CUT, BUTTED AND WELDED TOGETHER USING TWO (2) 1/4" x 4-1/4" (1 x 3) OR TWO (2) 1/4" x 5 11/16" (1 x 4) FILER WELDS - ONE PER FACE. EACH FACE WELD IS GROUND DOWN SMOOTH

COLONIAL SHUTTER SYSTEM and BAHAMA over COLONIAL SHUTTER SYSTEM

MICHAEL TRAPASSO
PROFESSIONAL ENGINEER #62482


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 20-1215.08
Expiration Date 11/29/2022
By H. A. M. M.
Miami Date Product Control

Maximum Design Pressures
Bahama & Colonial Shutters
+ 84.7 psf & -113.3 psf

Bahama Over Colonial Shutter
+ 77 psf & -77 psf

Glass Separation Sheet 9

Patent No: US 6,996,934 B2
US 7,131,480 B2

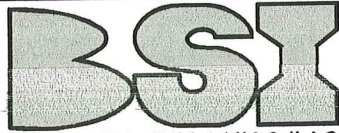


BRISCOE SHUTTERS INC.
2841 Shoreview Drive
Naples FL 34112
www.bsishutters.com
bsishutters@juno.com
Office: 239-774-2025




DRAWING NO.
13-0579

SHEET NO.
9 of 10

DATE: 12/02/20

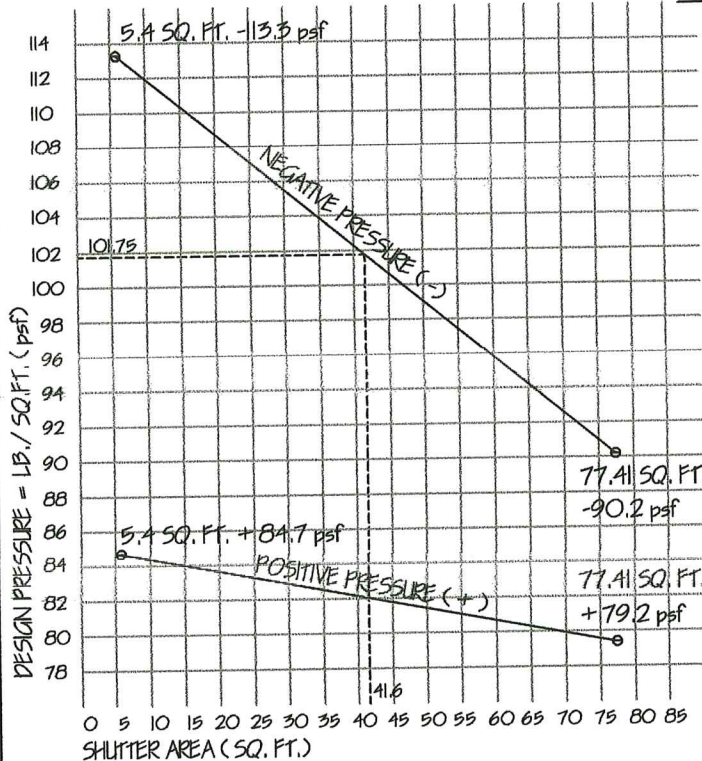

DESIGN PRESSURE CHART FOR FASTENER LOAD
CALCULATIONS BAHAMA & COLONIAL SHUTTER SYSTEMS

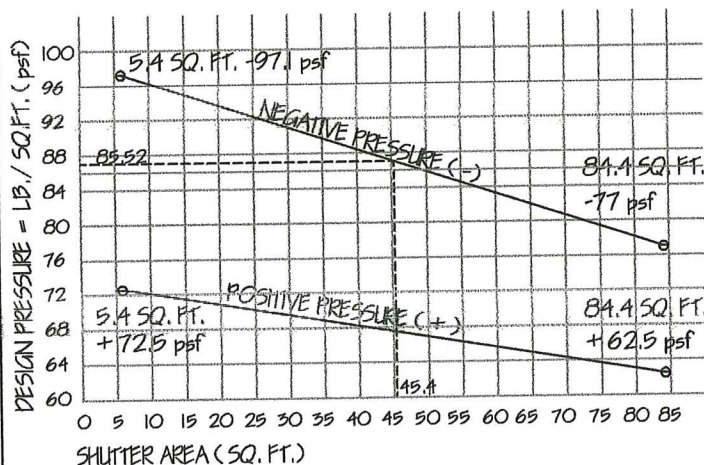

DESIGN PRESSURE CHART FOR FASTENER LOAD
CALCULATIONS BAHAMA over COLONIAL SHUTTER SYSTEM

EXAMPLE

A 41.6 sq. ft. shutter has a
negative 101.75 psf
design pressure.

41.6 sq. ft. x 101.75 psf
= 4,232.8 lb. design load.

BSI HURRICANE SHUTTER SYSTEMS HAS A BUILD OUT FRAME (BOF) ①
THAT ATTACHES TO THE BUILDING (INSIDE CLEAR OPENING IS 1/4"
LARGER THEN BUILDING OPENING), DEPTH OF BOF IS GOVERNED
BY THE GLASS SEPARATION, SHUTTERS ARE FACTORY ASSEMBLED
TO THE BOF THEN DISASSEMBLED FOR SHIPPING & INSTALLATION

BUILD OUT FRAME DEPTH IS GOVERNED BY THE GLASS SEPARATION
FURTHEST OUTWARD GLASS SURFACE TO BACK OF SHUTTER SLATS

DISTANCE FROM FACE OF BUILDING TO FURTHEST OUTWARD GLASS
SURFACE, MINUS (-) MINIMUM GLASS SEPARATION = DEPTH OF
BUILD OUT FRAME (MINIMUM DEPTH 1")

MINIMUM GLASS SEPARATION BACK OF SLATS TO GLASS

SHUTTER SIZE	MAX. SQ. FT.	TYPE OF SHUTTER	SEPARATION
24" x 23.625" to 30" x 60.6875"	3.94 sq ft to 12.64 sq ft	BAHAMA or COLONIAL	2-1/4"
30.01" x 60.7 to 49" x 104.75" & 26" x 128"	12.65 sq ft to 35.64 sq ft & 21.11 sq ft	BAHAMA or COLONIAL	2-3/4"
ALL SIZES	84.4 sq ft	BAHAMA over COLONIAL	3-1/4"


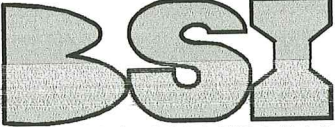
ANY COMBINATION OF WIDTH x HEIGHT NOT TO EXCEED 35.64 sq ft
PER LEAF IS ALLOWABLE WITHIN THE DESIGN PRESSURE, GENERAL
NOTE #7, SHEET 10

EXAMPLE

A 45.4 sq. ft. shutter has a
negative 85.2 psf
design pressure.

45.4 sq. ft. x 85.2 psf
= 3,868.08 lb. design load.

GENERAL NOTES SHEET 10: TEST STANDARDS, WIND SPEED CONVERSIONS, WIND LOADS - COMPONENTS & CLADDING,
ADJUSTMENT FACTOR FOR BUILDINGS HEIGHT & EXPOSURE, SHUTTER LEAF SIZES, FASTENER CALCULATIONS & LOCATIONS

COLONIAL SHUTTER SYSTEM and BAHAMA over COLONIAL SHUTTER SYSTEM		MICHAEL STRAPASSO PROFESSIONAL ENGINEER #62482 	PRODUCT REVISED as complying with the Florida Building Code Acceptance No. <u>20-1215.08</u> Expiration Date <u>11/28/2022</u> By <u>Helya M. M.</u> Miami Date Product Control				
Maximum Design Pressures Bahama & Colonial Shutter + 84.7 psf & - 113.3 psf Bahama Over Colonial Shutter + 77 psf & - 77 psf	 BRISCOE SHUTTERS INC. 2841 Shoreview Drive Naples FL 34112 www.bsishutters.com bsishutters@juno.com Office: 239-774-2025	<table border="1"> <tr> <td>DRAWING NO. 13-0579</td> <td>SHEET NO. 10 of 10</td> </tr> <tr> <td colspan="2">DATE: 12/02/20</td> </tr> </table>		DRAWING NO. 13-0579	SHEET NO. 10 of 10	DATE: 12/02/20	
DRAWING NO. 13-0579	SHEET NO. 10 of 10						
DATE: 12/02/20							
Glass Separation Sheet 9 Patent No: US 6,996,934 B2 US 7,131,480 B2							

GENERAL NOTES:

- 1 THIS PRODUCT IS DESIGNED & TESTED IN ACCORDANCE WITH THE 2020 FLORIDA BUILDING CODE 7th EDITION BUILDING & RESIDENTIAL; FOR USE WITHIN AND OUTSIDE THE HIGH VELOCITY HURRICANE ZONE, TEST STANDARDS: TAS 201, 202, 203
- 2 THIS PRODUCT IS DESIGNED & TESTED IN ACCORDANCE WITH THE 2020 FLORIDA BUILDING CODE 7th EDITION BUILDING CHAPTER 16 - STRUCTURAL DESIGN & CHAPTER 24 - GLASS & GLAZING
- 3 THIS PRODUCT IS DESIGNED & TESTED IN ACCORDANCE WITH THE 2020 FLORIDA BUILDING CODE 6th EDITION BUILDING CHAPTER 2413 HIGH-VELOCITY HURRICANE ZONES-STORM SHUTTERS/ EXTERIOR PROTECTIVE DEVICES
- 4 ASCE 7-10, CHAPTER 30 (pg. 346) WIND LOADS - COMPONENTS AND CLADDING - METHOD 1, NET DESIGN WIND PRESSURES, Pnet 30 (psf) (Exposure B at h = 30 ft.) NOTE: FOR EFFECTIVE AREAS BETWEEN THE THOSE GIVEN ABOVE THE LOAD MAY BE INTERPOLATED, OTHERWISE USE THE LOAD ASSOCIATED WITH THE LOWEST EFFECTIVE AREA
- 5 ASCE 7-10, CHAPTER 30 (pg. 347), MINIMUM DESIGN LOADS - COMPONENTS IN CLADDING METHOD 1, ADJUSTMENT FACTOR FOR BUILDING HEIGHT AND EXPOSURE B, C, & D
- 6 FASTENER CALCULATIONS & LOCATIONS:
 WIDTH x HEIGHT x DESIGN PRESSURE (6a) / FASTENER STRENGTH (6b) = TOTAL NUMBER OF FASTENERS REQUIRED PER OPENING (6c)
 - 6a DESIGN PRESSURE REQUIRED BUILDING DATA; WIND VELOCITY (MPH), IMPORTANCE FACTOR, EXPOSURE CATEGORY, INTERNAL PRESSURE COEFFICIENT +, -, MEAN ROOF HEIGHT, BUILDING WIDTH, BUILDING LENGTH, & ROOF SLOPE (x:12)
 - 6b FASTENER STRENGTH, ALLOWABLE LOADS EQUAL TO 25% OF THE AVERAGE ULTIMATE LABORATORY TEST VALUES, ELCO CONSTRUCTION PRODUCTS AGGRE-GATOR FASTENERS 300 SERIES STAINLESS STEEL (HEX HEAD - 1/4 x 4 MAX.), CRETE-FLEX 554 MASONRY SCREWS (HEX HEAD - 1/4 x 4 MAX.), ELCO ULTRA-CONCRETE & MASONRY ANCHORS (HEX HEAD - 1/4 x 6 MAX. OR HEX HEAD - 5/16 x 6 MAX.) OR FLORIDA FASTENERS DIRECT, LLC BLUE TAP SCREW ANCHORS - 1/4 DIAMETER HEX HEAD x 1-1/4" to 6" LONG OR EQUAL
 - 6c FASTENER SPACING AND LOCATIONS: MAJORITY OF FASTENERS AT PRESSURE POINTS (HINGES, HOLD CLOSE TABS OR BRACKETS) BALANCE ON SIDES (BAHAMA) OR TOP & BOTTOM (COLONIAL) OF THE BUILD OUT FRAME, IN ACCORDANCE WITH MANUFACTURES HURRICANE SHUTTER SHOP DRAWINGS FOR EACH SIZE AND/ OR OPENING

ANCHOR INSTALLATION SHALL BE MADE IN ACCORDANCE WITH ANCHOR MANUFACTURES PUBLISHED INSTALLATION INSTRUCTIONS AND THEIR APPROVED NOA
- 7 ANY COMBINATION OF WIDTH x HEIGHT NOT TO EXCEED 35.64 SQUARE FEET PER SHUTTER LEAF IS ALLOWABLE WITHIN THE DESIGN PRESSURE
- 8 BSI HURRICANE SHUTTER SYSTEMS HAS A BUILD OUT FRAME (BOF) ① THAT ATTACHES TO THE BUILDING (INSIDE CLEAR OPENING IS 1/4" LARGER THEN BUILDING OPENING), DEPTH OF THE BOF IS GOVERNED BY THE GLASS SEPARATION, SHUTTERS ARE FACTORY ASSEMBLED TO THE BOF THEN DISASSEMBLED FOR SHIPPING & INSTALLATION
- 9 FOR THE PURPOSE OF THE TESTING REQUIRED IN TAS 202 SECTION 5.2, DESIGN PRESSURE CALCULATED IN ACCORDANCE WITH ASCE 7-10 ARE PERMITTED TO BE MULTIPLIED BY 0.6
- 10 HINGE SPECIFICATIONS:
 - 10a DESIGN PRESSURES, WIND VELOCITY, AND REQUIREMENTS BY THE BUILDING DEPARTMENT GOVERNING YOUR AREA DETERMINE THE TYPE OF HINGE ASSEMBLY
 - 10b NUMBER OF HINGE LEAFS (3, 5, 7, 9, & 11-Leaf Assemblies) IS DETERMINED BY THE DESIGN PRESSURE & FASTENER CALCULATIONS REFER TO GENERAL NOTES: 6, 6a, 6b, & 6c