



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION
NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

Miami Wall Systems, Inc.,
701 W. 25th Street,
Hialeah, Florida 33010

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER -Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "113" Aluminum Sliding Glass Doors w/wo reinforcements -SMI

APPROVAL DOCUMENT: Drawing No. **113-SM Rev 2**, titled "Series 113 Alum Sliding Glass Door (S.M.I.)", sheets 1 through 11 of 11, dated 084-0-14 and last revised on MAR 23, 2021, prepared by manufacturer, signed and sealed by Jorge E. Valdes, P. E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Small Missile Impact

Limitations:

1. See Design Pressure (DP) charts: sizes Vs glass types (sheet 2), interlock/astragal reinforcing and Head receptor options, in sheet 3. See SGD door mullions (M1, M2 & M3) load capacity in sheet 4. See Head and Sill anchor capacity charts in sheet 5. Lower Design Pressure shall control from the charts, for entire assembly.
2. When SGD door jamb is mullied (mated) per sheet 4, the mating mullion is integral part of the capacity with min sectional properties, as listed. Additional mating per series 101 Window wall is under separate approval, to be reviewed by Building official.
3. See Head Receptor option and installation, in sheet 7. SGD units w/ Head receptor are limited to 122" span.
4. Min cluster of eight (8) anchors type A1, at sill end interlock/astragal at span > 120" & SGD w/Head receptor required.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and series and following statement: "Miami-Dade County Product Control Approved", noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises # 19-1029.04** and consists of this page 1 and evidence pages E-1, E-2 and E-3, as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P.E.**



Ishaq I. Chanda

NOA No. 21-0325.07
Expiration Date: May 21, 2025
Approval Date: May 20, 2021
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. Evidence submitted under previous file

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No. **113-SM**, titled "Series 113 Alum Sliding Glass Door (S.M.I.)", sheets 1 through 11 of 11, dated 084-0-14 and last revised on April 16, 2015, prepared by manufacturer, signed and sealed by Jorge E. Valdes, P.E.

B. TESTS

1. Test reports on:
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Small Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
 - 6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94

Along with installation diagram of sliding glass door w/wo head receptor and SGD muller to Window wall, prepared by Fenestration Testing Lab. Inc., Test reports # **FTL 7806** (mock-ups # **E-1, F-1** and **G-1**, dated June 07, 2014, signed and sealed by Idalmis Ortega, P.E.

Note: The test report #**FTL 7086** has been revised pages 2, 30 & 86, dated 02/11/15, issued by Fenestration Testing Lab. Inc., signed and sealed by Idalmis Ortega, P.E.

2. Additional Referenced test report **FTL 7806** (mock-up #**C-1**) per TAS 201, 202, 203-LMI.

C. CALCULATIONS

1. Anchor verification calculations and structural analysis dated AUG 04, 2014 and last revised on APR 16, 2015, prepared, signed and sealed by Jorge E. Valdes, P.E.
2. Glazing complies w/ ASTM E-1300-02 &-04

D. QUALITY ASSURANCE

1. Miami Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **11-0624.01** issued to E.I. DuPont DeNemours & Co., Inc. for their "**DuPont Butacite® PVB interlayer**", expiring on 12/11/16.
2. Notice of Acceptance No. **14-0423.17** issued to **Eastman Chemical Company (MA)** for their "**Saflex Clear and Color Glass Interlayers**" dated 06/19/14, expiring on 05/21/16.
3. Technical data sheet of strength properties of "THE 74 Natural" flexible PVC, per ASMC-826, manufactured by HI-TECH extrusions.

F. STATEMENTS

1. Statement letter of conformance to FBC 2010 and letter of no financial interest both dated May 12th, 2015, prepared, signed and sealed by Jorge E. Valdes, P.E.
2. Lab compliance as part of the above referenced test reports.

G. OTHER

1. Test proposal # **14-0261** dated April 18, 2014, approved by RER.
2. SGD mullion mating parts # 101-409, 101-411, Steel reinforcement's items #13, #14 and steel bar ½"x5-1/2".

Ishaq I. Chanda

Ishaq I. Chanda, P.E.
Product Control Unit Supervisor
NOA No. 21-0325.07
Expiration Date: May 21, 2025
Approval Date: May 20, 2021

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

2. Evidence submitted under previous approval

A. DRAWINGS

1. Drawing No. **113-SM Rev 1**, titled “Series 113 Alum Sliding Glass Door (S.M.I.)”, sheets 1 through 11 of 11, dated 084-0-14 and last revised on Oct 24, 2019, prepared by manufacturer, signed and sealed by Jorge E. Valdes, P. E.

Note: This revision consists of FBC code edition updated only.

B. TESTS (submitted under file #14-0515.10)

1. None.

C. CALCULATIONS (submitted under file #14-0515.10)

1. None.

D. QUALITY ASSURANCE

1. Miami Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **19-0305.02** issued to Kuraray America, Inc (former E.I. DuPont DE Nemours & Co., Inc.) for “**Trosifol**”: Ultra clear, clear & color PVB glass interlayer, expiring on 07/08/24.
2. Notice of Acceptance No. **18-0301.05** issued to **Eastman Chemical Company (MA)** for their “**Saflex Clear and Color Glass Interlayers**” dated 06/19/14, expiring on 05/21/21.
3. Technical data sheet of strength properties of “**THE 74 Natural**” flexible PVC, per ASMC-826, manufactured by HI-TECH extrusions.

F. STATEMENTS

1. Statement letter of conformance to FBC 2017 (6th Edition) and letter of no change from original approval, dated Oct 23, 2019, prepared, signed and sealed by Jorge E. Valdes, P.E.
2. Statement dated 11/25/19 via e-mail by Jorge Valdes, P.E. clarifying the only change in Dwg. set from previous approval NOA is general note updating FBC code edition, only.

G. OTHER

1. This NOA **revises & renews #14-0515.10**, expiring **05/21/2025**.

Ishaq I. Chanda

Ishaq I. Chanda, P.E.
Product Control Unit Supervisor
NOA No. 21-0325.07
Expiration Date: May 21, 2025
Approval Date: May 20, 2021

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

3. New Evidence submitted

A. DRAWINGS

1. Drawing No. **113-SM Rev 2**, titled “Series 113 Alum Sliding Glass Door (S.M.I.)”, sheets 1 through 11 of 11, dated 084-0-14 and last revised on MAR 23, 2021, prepared by manufacturer, signed and sealed by Jorge E. Valdes, P. E.

Note: This revision consists of FBC 2020 code edition updated only.

B. TESTS

1. None.

C. CALCULATIONS

1. None.

D. QUALITY ASSURANCE

1. Miami Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **19-0305.02** issued to Kuraray America, Inc (former E.I. DuPont DE Nemours & Co., Inc.) for “**Trosifol**”: Ultra clear, clear & color PVB glass interlayer, expiring on 07/08/24.
2. Notice of Acceptance No. **21-0210.01** issued to **Eastman Chemical Company (MA)** for their “**Saflex Clear and Color Glass Interlayers**”, expiring on 05/21/26.
3. Technical data sheet of strength properties of “**THE 74 Natural**” flexible PVC, per ASMC-826, manufactured by HI-TECH extrusions.

F. STATEMENTS








1. Statement letter of conformance to FBC 2020 (7th Edition), dated MAR 23, 2021, prepared, signed and sealed by Jorge E. Valdes, P.E.
2. Statement dated 03/25/21, clarifying the only change in Dwg. is general note updating FBC code edition, signed by Jorge Valdes, P.E.

G. OTHER

1. This NOA **revises #19-1029.04**, expiring **05/21/2025**.

Ishaq I. Chanda

Ishaq I. Chanda, P.E.
Product Control Unit Supervisor
NOA No. 21-0325.07
Expiration Date: May 21, 2025
Approval Date: May 20, 2021

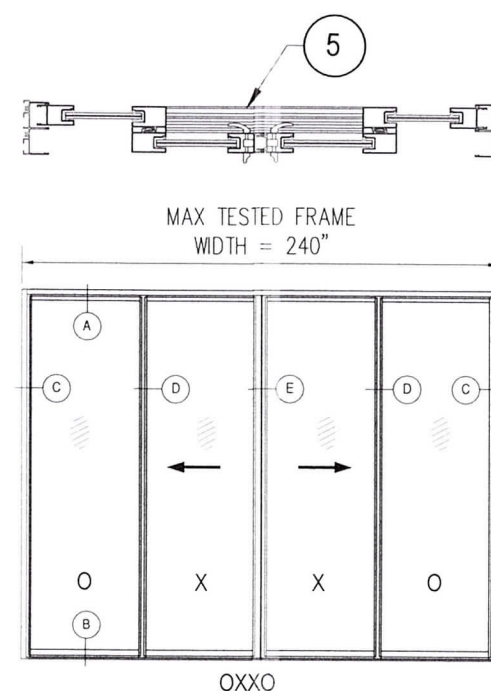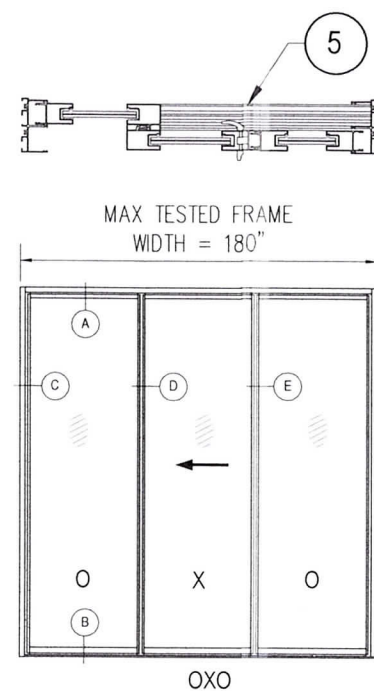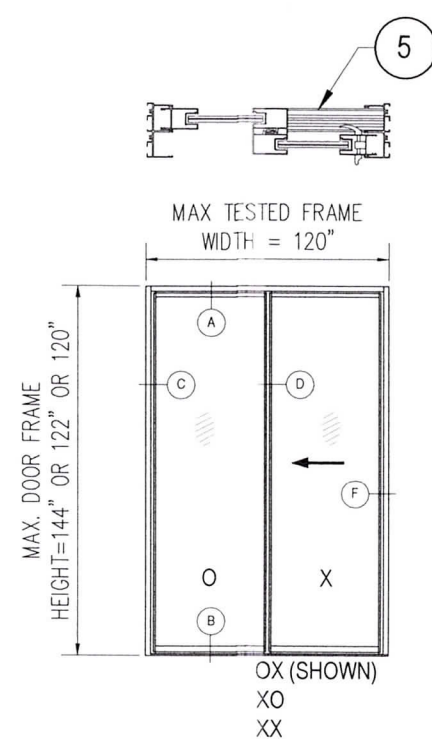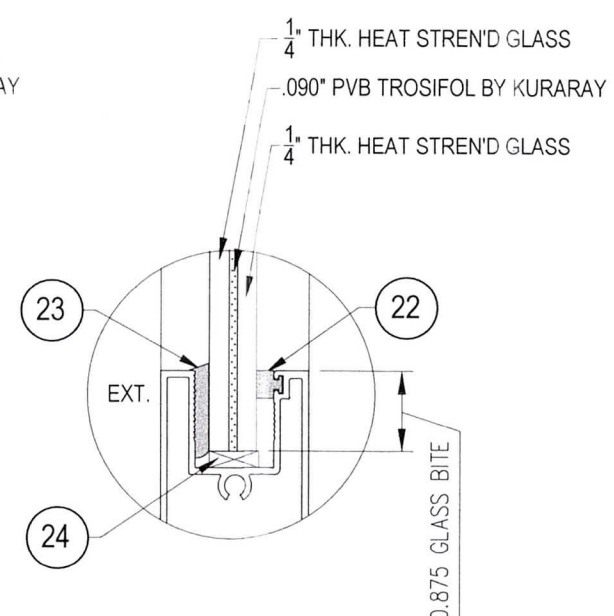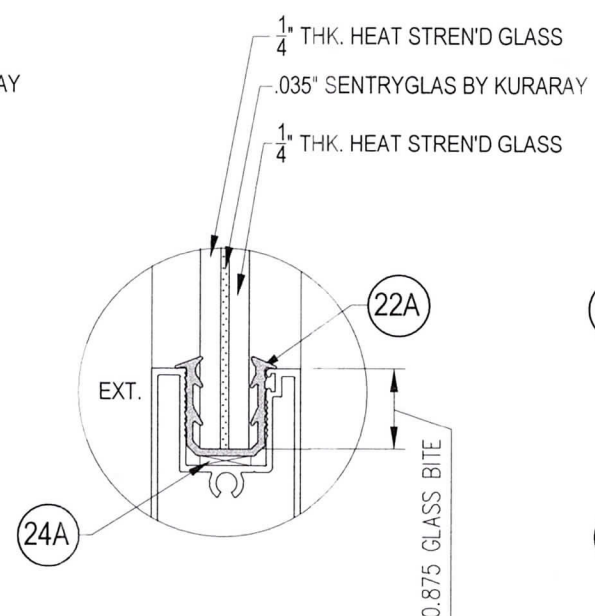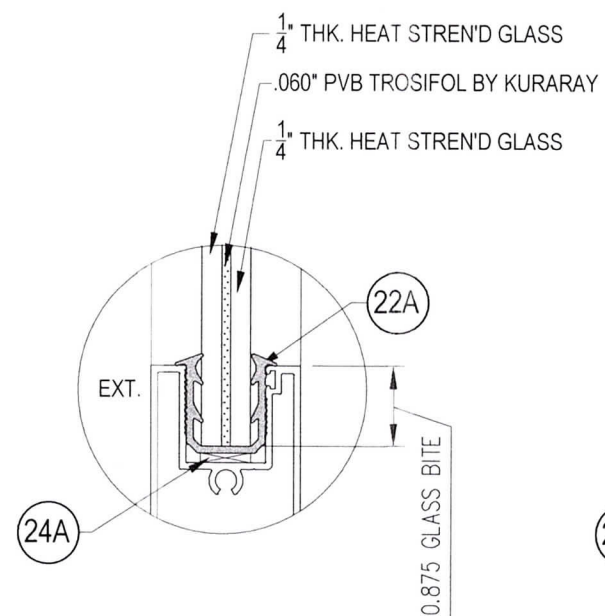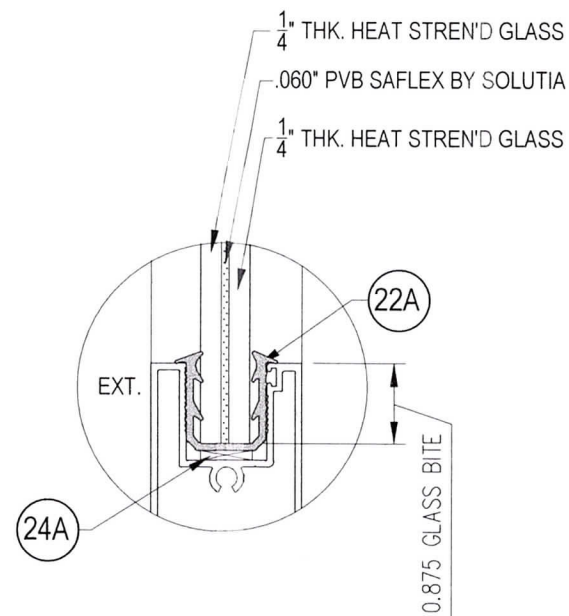


APPROVED CONFIGURATIONS (2 TRACKS, 4 PANEL OR LESS)

CONFIGURATIONS SHOWN FOR ILLUSTRATION PURPOSES ONLY
SEE SHEETS 6, 7 & 8 FOR FRAME ANCHOR INSTALLATIONS

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 21-0325.07

Expiration Date 05/21/2025


By Ishaq I. Chanda
Miami-Dade Product Control

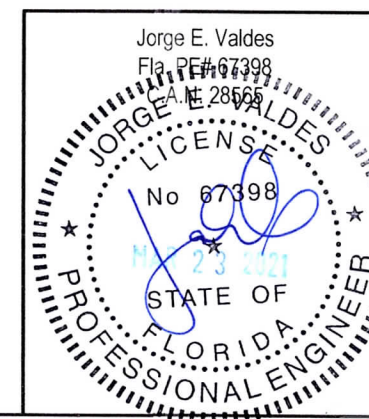

Miami Wall Systems, Inc.

701 West 25th Street
Hialeah, Florida. 33010

Phone:(305) 888-2300 Fax:(305) 888-3058



SERIES 113
ALUM. SLIDING GLASS DOOR
(S.M.I.)

NO.	DATE	REVISION
1	10/23/19	UPDATE TO 2017 FBC
2	03/16/21	UPDATE TO 2020 FBC

DATE: 7/30/2014

SCALE: AS NOTED

DWG. BY: O.J.L.

CHK. BY: JV

DWG NO.: 113-SM

SHEET 2 OF 11

CHART "A"

DESIGN LOAD CAPACITY - PSF DOORS WITH OR WITHOUT HEAD RECEPTOR STANDARD INTERLOCK AND ASTRAGAL					
PANEL WIDTH NOMINAL INCHES	DOOR FRAME HEIGHT INCHES	GLASS TYPE "GL-1"		GLASS TYPE "GL-2" & "GL-3"	
		EXT. (+)	INT. (-)	EXT. (+)	INT. (-)
30	84	80.0	80.0	80.0	95.0
36		80.0	80.0	80.0	95.0
42		80.0	80.0	80.0	95.0
48		80.0	80.0	80.0	95.0
54		75.5	75.5	80.0	92.0
60	90	68.0	68.0	80.0	83.0
30		80.0	80.0	80.0	95.0
36		80.0	80.0	80.0	95.0
42		80.0	80.0	80.0	95.0
48		80.0	80.0	80.0	95.0
54	96	75.5	75.5	80.0	92.0
60		68.0	68.0	80.0	83.0
30		80.0	80.0	80.0	95.0
36		80.0	80.0	80.0	95.0
42		80.0	80.0	80.0	95.0
48	102	80.0	80.0	80.0	95.0
54		80.0	80.0	80.0	95.0
60		75.5	75.5	80.0	92.0
30		80.0	80.0	80.0	95.0
36		80.0	80.0	80.0	95.0
42	108	80.0	80.0	80.0	95.0
48		80.0	80.0	80.0	95.0
54		75.5	75.5	80.0	92.0
60		68.0	68.0	80.0	83.0
30	114	80.0	80.0	80.0	95.0
36		80.0	80.0	80.0	95.0
42		80.0	80.0	80.0	95.0
48		80.0	80.0	80.0	95.0
54	120	75.5	75.5	80.0	92.0
60		68.0	68.0	80.0	83.0
30		80.0	80.0	80.0	95.0
36		80.0	80.0	80.0	95.0
42		80.0	80.0	80.0	95.0
48	120	80.0	80.0	80.0	95.0
51		80.0	80.0	80.0	95.0
54		75.5	75.5	80.0	92.0
60	120	68.0	68.0	80.0	83.0


NOTE:
GLASS CAPACITIES ON THIS SHEET ARE BASED ON ASTM E1300-12 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION DECLARATORY STATEMENT DCA05-DEC-219

CHART "B"


DESIGN LOAD CAPACITY - PSF DOORS WITH OR WITHOUT HEAD RECEPTOR HEAVY DUTY INTERIOR REINFORCED INTERLOCK AND ASTRAGAL			
PANEL WIDTH NOMINAL INCHES	DOOR FRAME HEIGHT INCHES	GLASS TYPE "GL-2" & "GL-3"	
		EXT. (+)	INT. (-)
30	84	130.0	130.0
36		130.0	130.0
42		130.0	130.0
48		130.0	130.0
54		122.7	122.7
60	90	110.5	110.5
30		130.0	130.0
36		130.0	130.0
42		130.0	130.0
48		130.0	130.0
54	96	122.7	122.7
60		110.5	110.5
30		130.0	130.0
36		130.0	130.0
42		130.0	130.0
48	102	130.0	130.0
54		122.7	122.7
60		110.5	110.5
30		130.0	130.0
36		130.0	130.0
42	108	130.0	130.0
48		130.0	130.0
54		122.7	122.7
60		110.5	110.5
30	114	130.0	130.0
36		130.0	130.0
42		130.0	130.0
48		130.0	130.0
54	122	122.7	122.7
60		110.5	110.5
30		130.0	130.0
36		130.0	130.0
42		130.0	130.0
48	122	130.0	130.0
51		130.0	130.0
54		122.7	122.7
60	122	110.5	110.5

CHART "C"

DESIGN LOAD CAPACITY - PSF HEAVY INTERLOCK AND ASTRAGAL W/REINFORCEMENTS			
PANEL WIDTH NOMINAL INCHES	DOOR FRAME HEIGHT INCHES	GLASS TYPE "GL-4"	
		EXT. (+)	INT. (-)
30	108	130.0	130.0
36		130.0	130.0
42		130.0	130.0
48		130.0	130.0
54		122.0	122.0
60	114	110.0	110.0
30		130.0	130.0
36		130.0	130.0
42		130.0	130.0
48		130.0	130.0
54	122	122.0	122.0
60		110.0	110.0
30		130.0	130.0
36		130.0	130.0
42		130.0	130.0
48	126	130.0	130.0
54		119.0	119.0
57		112.0	112.0
30		130.0	130.0
36		130.0	130.0
42	132	130.0	130.0
48		130.0	130.0
54		115.0	115.0
30		130.0	130.0
36		130.0	130.0
42	138	130.0	130.0
48		130.0	130.0
51		120.0	120.0
53-1/4		114.0	114.0
30		130.0	130.0
36	144	130.0	130.0
42		130.0	130.0
48		130.0	130.0
51		118.0	118.0

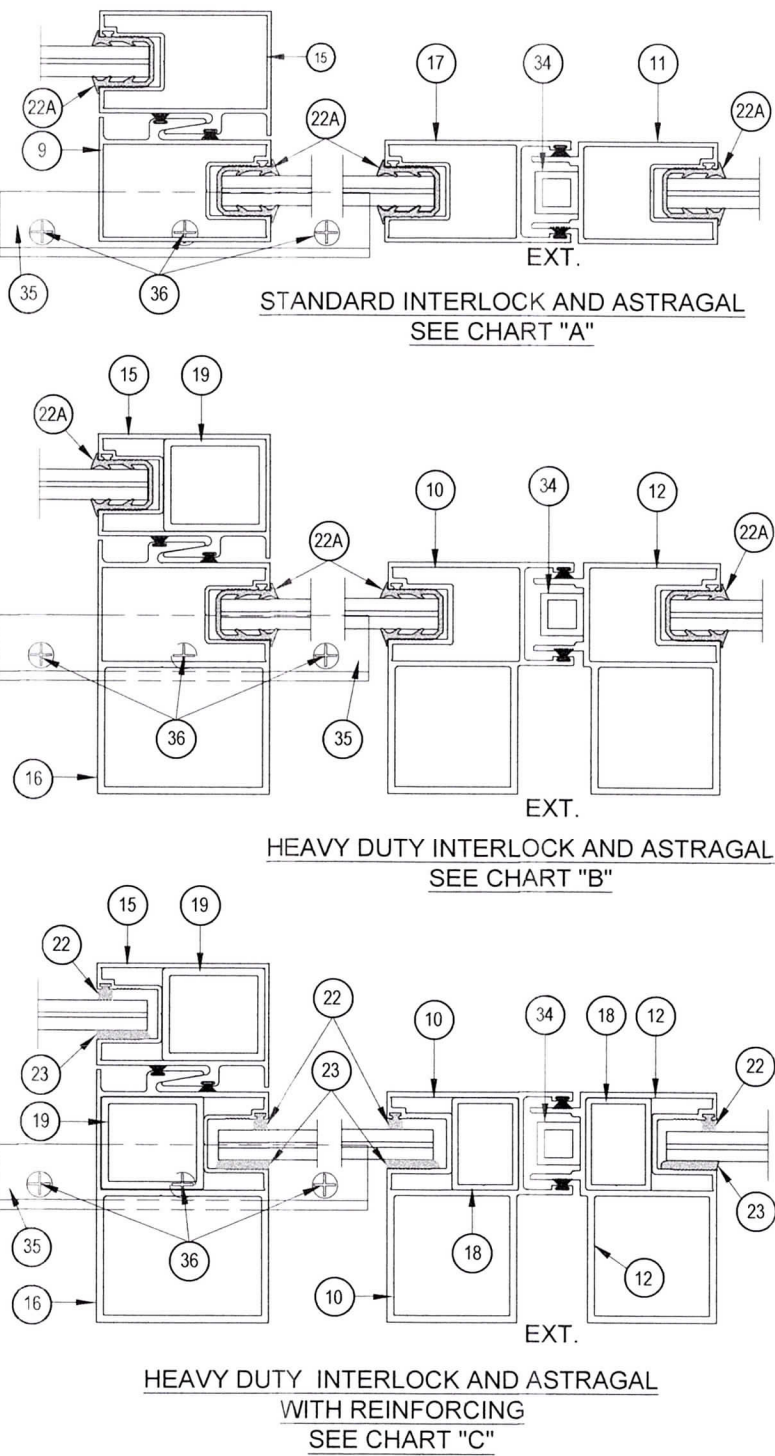

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 21-0325.07
Expiration Date 05/21/2025
By Ishag I. Chande
Miami-Dade Product Control

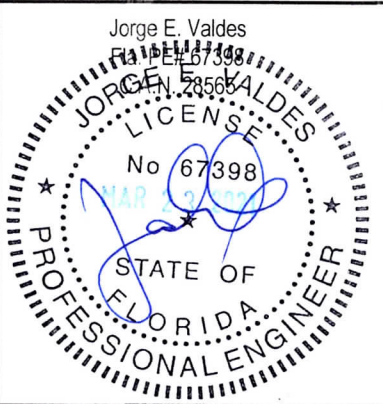

Miami Wall Systems, Inc.

701 West 25th Street
Hialeah, Florida. 33010


Phone: (305) 888-2300 Fax: (305) 888-3058

SERIES 113
ALUM. SLIDING GLASS DOOR
(S.M.I.)


NO.	DATE	REVISION
1	10/23/19	UPDATE TO 2017 FBC
2	03/16/21	UPDATE TO 2020 FBC
3		
4		
5		
6		
7		
8		
9		
10		
11		
12		
13		
14		
15		
16		
17		
18		
19		
20		
21		
22		
23		
24		
25		
26		
27		
28		
29		
30		
31		
32		
33		
34		
35		
36		
37		
38		
39		
40		
41		
42		
43		
44		
45		
46		
47		
48		
49		
50		
51		
52		
53		
54		
55		
56		
57		
58		
59		
60		
61		
62		
63		
64		
65		
66		
67		
68		
69		
70		
71		
72		
73		
74		
75		
76		
77		
78		
79		
80		
81		
82		
83		
84		
85		
86		
87		
88		
89		
90		
91		
92		
93		
94		
95		
96		
97		
98		
99		
100		
101		
102		
103		
104		
105		
106		
107		
108		
109		
110		
111		
112		
113		
114		
115		
116		
117		
118		
119		
120		
121		
122		
123		
124		
125		
126		
127		
128		
129		
130		
131		
132		
133		
134		
135		
136		
137		
138		
139		
140		
141		
142		
143		
144		
145		
146		
147		
148		
149		
150		
151		
152		
153		
154		
155		
156		
157		
158		
159		
160		
161		
162		
163		
164		
165		
166		
167		
168		
169		
170		
171		
172		
173		
174		
175		
176		
177		
178		
179		
180		
181		
182		
183		
184		
185		
186		
187		
188		
189		
190		
191		
192		
193		
194		
195		
196		
197		
198		
199		
200		
201		
202		
203		
204		
205		
206		
207		
208		
209		
210		
211		
212		
213		
214		
215		
216		
217		
218		
219		
220		
221		
222		
223		
224		
225		
226		
227		
228		
229		
230		
231		
232		
233		
234		
235		
236		
237		
238		
239		
240		
241		
242		
243		
244		
245		
246		
247		
248		
249		
250		
251		
252		
253		
254		
255		
256		
257		
258		
259		
260		
261		
262		
263		
264		
265		
266		
267		
268		
269		
270		
271		
272		
273		
274		
275		
276		
277		
278		
279		
280		
281		
282		
283		
284		
285		
286		
287		
288		
289		
290		
291		

HEAD ANCHOR LOAD CAPACITY - PSF							
PANEL WIDTH NOMINAL INCHES	DOOR HEIGHT INCHES	ANCHOR TYPE "A", "B" (Ø 1/4)			ANCHOR TYPE "A1", "B1" (Ø 5/16)		
		6 ANCHORS AT MTG. STILE ENDS	8 ANCHORS AT MTG. STILE ENDS	10 ANCHORS AT MTG. STILE ENDS	6 ANCHORS AT MTG. STILE ENDS	8 ANCHORS AT MTG. STILE ENDS	10 ANCHORS AT MTG. STILE ENDS
		EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)
30	96	95.0	130.0	130.0	95.0	130.0	130.0
36		95.0	130.0	130.0	95.0	130.0	130.0
42		95.0	130.0	130.0	95.0	130.0	130.0
48		95.0	129.3	130.0	95.0	130.0	130.0
54		90.0	120.0	130.0	95.0	130.0	130.0
60		84.7	112.9	130.0	95.0	130.0	130.0
30	102	95.0	130.0	130.0	95.0	130.0	130.0
36		95.0	130.0	130.0	95.0	130.0	130.0
42		95.0	130.0	130.0	95.0	130.0	130.0
48		89.5	119.4	130.0	95.0	130.0	130.0
54		82.8	110.4	130.0	95.0	130.0	130.0
60		77.6	103.5	129.3	95.0	130.0	130.0
30	108	95.0	130.0	130.0	95.0	130.0	130.0
36		95.0	130.0	130.0	95.0	130.0	130.0
42		91.7	122.3	130.0	95.0	130.0	130.0
48		83.1	110.9	130.0	95.0	130.0	130.0
54		76.6	102.2	127.7	95.0	130.0	130.0
60		71.6	95.5	119.4	95.0	130.0	130.0
30	114	95.0	130.0	130.0	95.0	130.0	130.0
36		95.0	129.3	130.0	95.0	130.0	130.0
42		85.8	114.4	130.0	95.0	130.0	130.0
48		77.6	103.5	129.3	95.0	130.0	130.0
54		71.4	95.1	118.9	95.0	130.0	130.0
60		66.5	88.7	110.9	95.0	130.0	130.0
30	120	95.0	130.0	130.0	95.0	130.0	130.0
36		91.3	121.7	130.0	95.0	130.0	130.0
42		80.6	107.5	130.0	95.0	130.0	130.0
48		72.8	97.0	121.3	95.0	130.0	130.0
54		66.8	89.0	111.3	95.0	130.0	130.0
60		62.1	82.8	103.5	95.0	130.0	130.0
30	126		130.0	130.0		130.0	130.0
36			115.0	130.0		130.0	130.0
42			101.4	126.7		130.0	130.0
48			91.3	114.1		130.0	130.0
54			83.6	104.5		130.0	130.0
60			77.6	97.0		130.0	130.0
30	132		127.3	130.0		130.0	130.0
36			108.9	130.0		130.0	130.0
42			95.9	119.8		130.0	130.0
48			86.2	107.8		130.0	130.0
54			78.8	98.5		130.0	130.0
60			73.0	91.3		130.0	130.0
30	138		121.1	130.0		130.0	130.0
36			103.5	129.3		130.0	130.0
42			91.0	113.7		130.0	130.0
48			81.7	102.1		130.0	130.0
54			74.6	93.2		130.0	130.0
60			69.0	86.2		130.0	130.0
30	144		115.5	130.0		130.0	130.0
36			98.5	123.2		130.0	130.0
42			86.5	108.2		130.0	130.0
48			77.6	97.0		130.0	130.0
54			70.7	88.4		130.0	130.0
60			65.3	81.7		126.4	130.0


SILL ANCHOR LOAD CAPACITY - PSF				
PANEL WIDTH NOMINAL INCHES	DOOR HEIGHT INCHES	ANCHOR TYPE "A1" (Ø5/16)		
		6 ANCHORS AT MTG. STILE ENDS	8 ANCHORS AT MTG. STILE ENDS	10 ANCHORS AT MTG. STILE ENDS
		EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)
30	96	95.0	130.0	130.0
36		95.0	130.0	130.0
42		95.0	130.0	130.0
48		95.0	130.0	130.0
54		95.0	130.0	130.0
60	102	95.0	130.0	130.0
30		95.0	130.0	130.0
36		95.0	130.0	130.0
42		95.0	130.0	130.0
48		95.0	130.0	130.0
54	108	95.0	130.0	130.0
60		95.0	130.0	130.0
30		95.0	130.0	130.0
36		95.0	130.0	130.0
42		95.0	130.0	130.0
48	114	95.0	130.0	130.0
54		95.0	130.0	130.0
60		95.0	130.0	130.0
30		95.0	130.0	130.0
36		95.0	130.0	130.0
42	120	95.0	130.0	130.0
48		95.0	130.0	130.0
54		95.0	130.0	130.0
60		95.0	130.0	130.0
30		95.0	130.0	130.0
36	126	130.0	130.0	130.0
42		130.0	130.0	130.0
48		130.0	130.0	130.0
54		130.0	130.0	130.0
60		130.0	130.0	130.0
30	132	130.0	130.0	130.0
36		130.0	130.0	130.0
42		130.0	130.0	130.0
48		130.0	130.0	130.0
54		130.0	130.0	130.0
60	138	130.0	130.0	130.0
30		130.0	130.0	130.0
36		130.0	130.0	130.0
42		130.0	130.0	130.0
48		130.0	130.0	130.0
54	144	130.0	130.0	130.0
60		130.0	130.0	130.0
30		130.0	130.0	130.0
36		130.0	130.0	130.0
42		130.0	130.0	130.0
48		130.0	130.0	130.0
54		130.0	130.0	130.0
60		126.4	130.0	

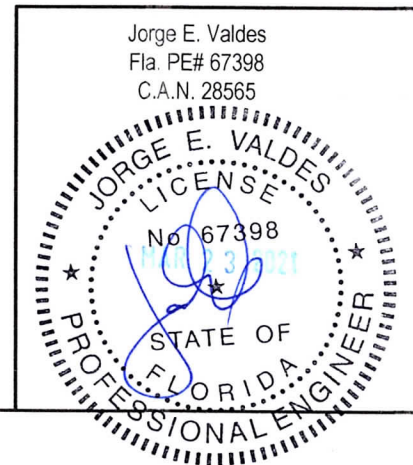

Phone:(305) 888-2300 Fax:(305) 888-3058

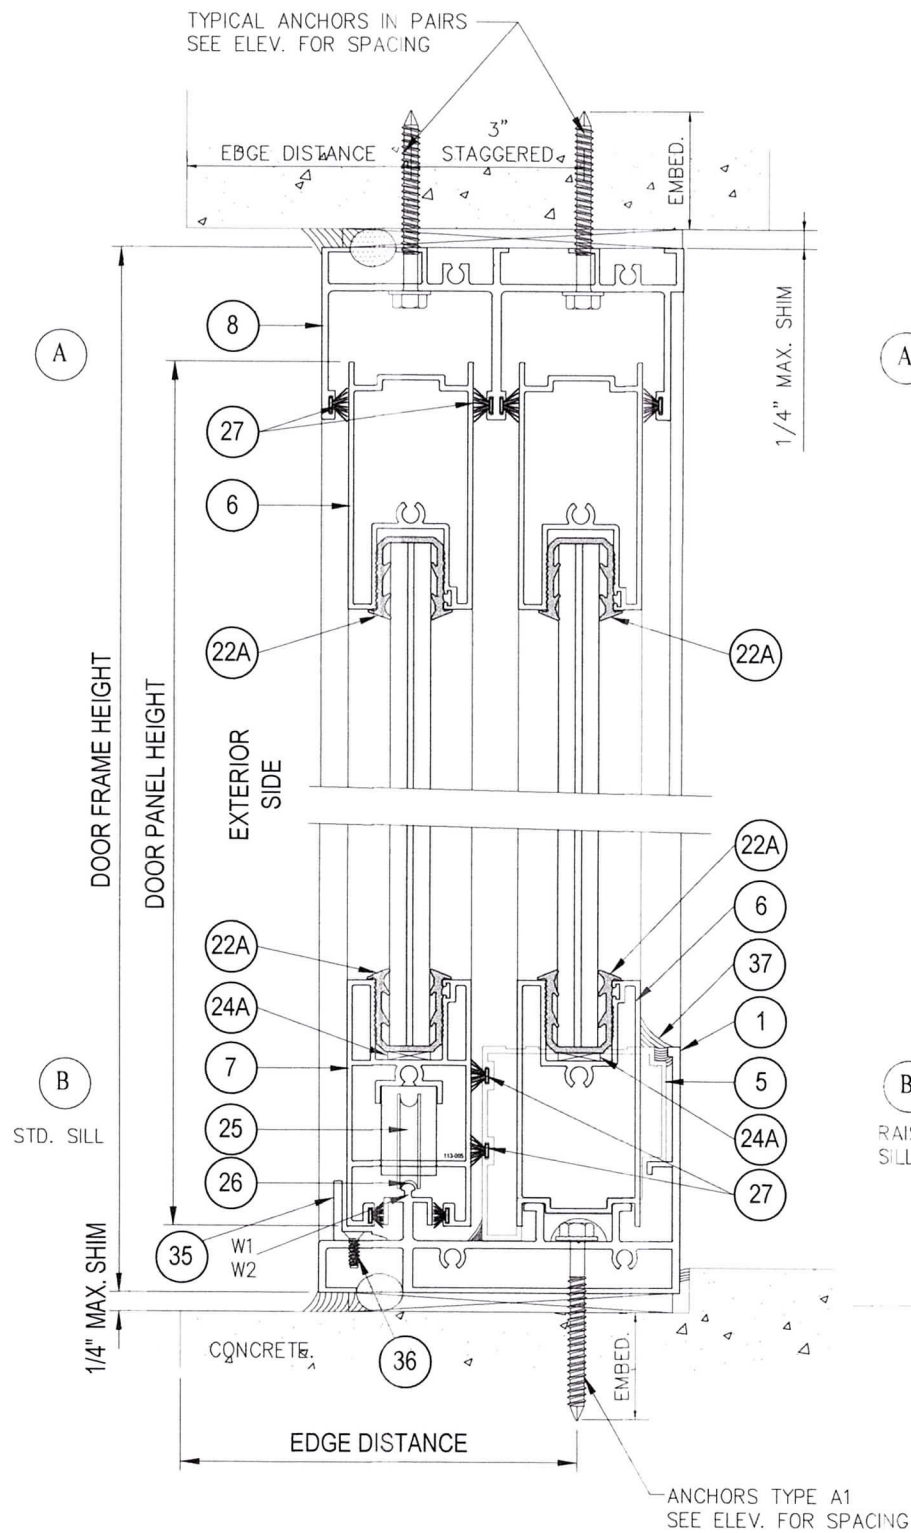

DOORS WITHOUT HEAD RECEPTOR

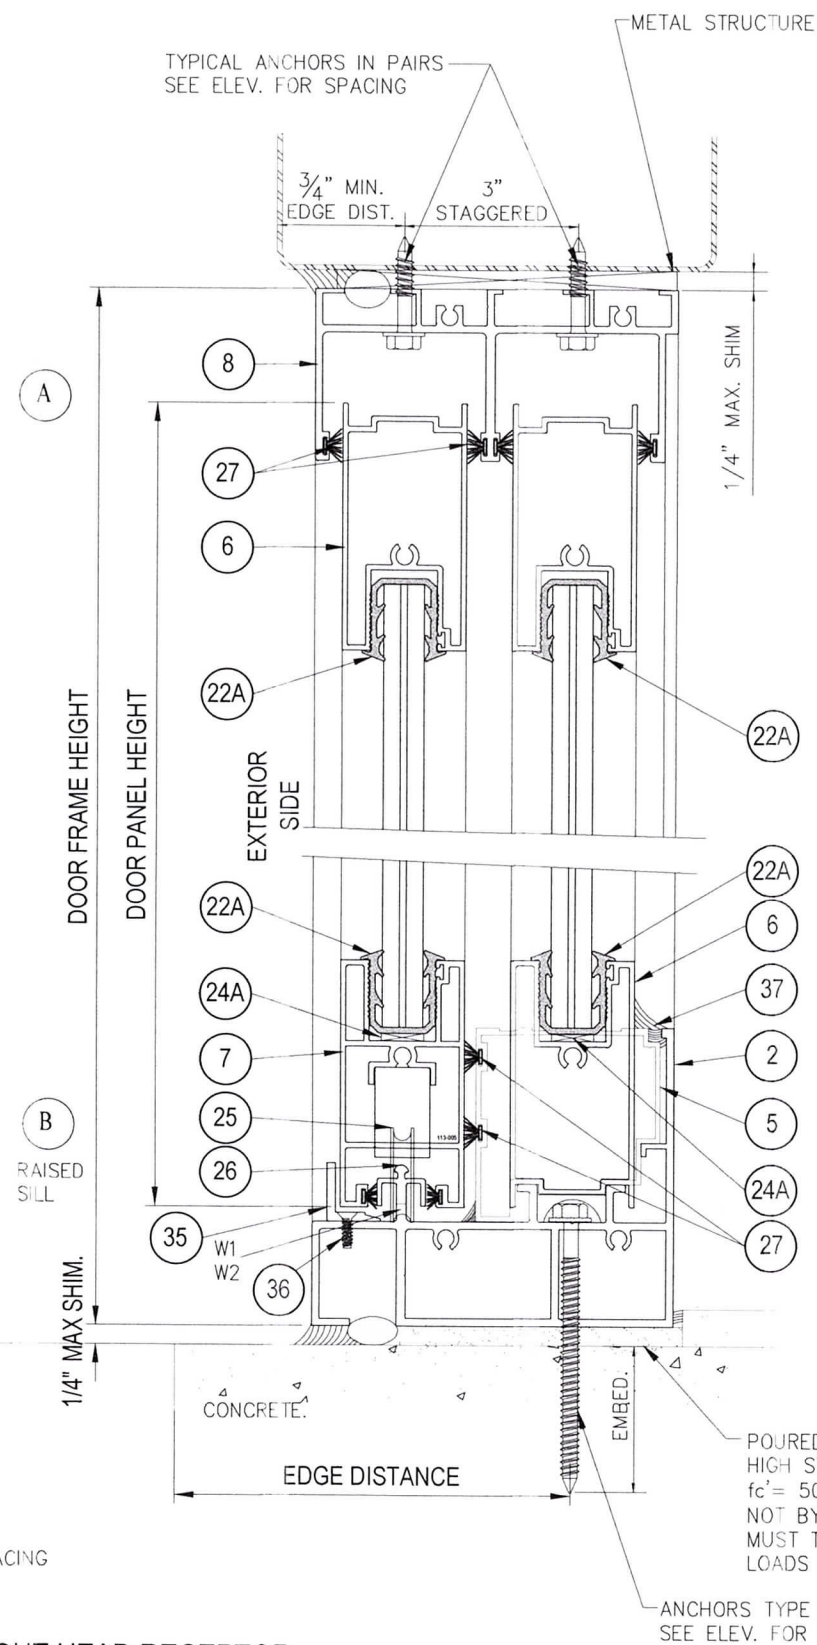

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

AT HEAD

TYPE. "A": 1/4" DIA. ULTRACON BY "ELCO" (Fu=177 KSI, Fy=155 KSI)
DIRECTLY INTO CONCRETE WITH 1-3/4" MIN. EMBED, fc'=3000 psi

TYPE. "A1": 5/16" DIA. ULTRACON BY "ELCO" (Fu=177 KSI, Fy=155 KSI)
DIRECTLY INTO CONCRETE WITH 2" MIN. EMBED, fc'=3515 psi

TYPE. "B": 1/4" DIA. DRILL FLEX OR SELF DRILLING SCREWS (Fu=92 KSI, Fy=120 KSI)
TYPE. "B1": 5/16" DIA. DRILL FLEX OR SELF DRILLING SCREWS (Fu=92 KSI, Fy=120 KSI)
INTO METAL STRUCTURES OR APPROVED MULLIONS
STEEL: 1/8" THICK MIN. (Fy = 36 KSI MIN.)
ALUMINUM: 1/8" THICK MIN. (6063-T5 MIN.)
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

SEE CHART ON SHEET 5 FOR CLUSTERS AT HEAD

AT SILL

TYPE. "A1": 5/16" DIA. ULTRACON BY "ELCO" (Fu=177 KSI, Fy=155 KSI)
DIRECTLY INTO CONCRETE WITH 2" MIN. EMBED, fc'=3515 psi

AT JAMBS

1/4" DIA. ULTRACON BY "ELCO" (Fu=177 KSI, Fy=155 KSI)
THRU 1BY BUCKS, 1-3/4" MIN. CONC. OR MASONRY EMBEDMENT
INTO 2BY WOOD BUCKS, 1-3/8" MIN. WOOD EMBEDMENT
DIRECTLY INTO CONCRETE OR MASONRY WITH 1-3/4" MIN. EMBED

1/4" DIA. DRILL FLEX OR SELF DRILLING SCREWS (Fu=92 KSI, Fy=120 KSI)
INTO METAL STRUCTURES OR APPROVED MULLIONS
STEEL: 1/8" THICK MIN. (Fy = 36 KSI MIN.)
ALUMINUM: 1/8" THICK MIN. (6063-T5 MIN.)
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL EDGE DISTANCE
INTO CONCRETE = 2-1/2" MIN. FOR 1/4" DIA. ANCHORS
= 3-1/8" MIN. FOR 5/16" DIA. ANCHORS
INTO WOOD STRUCTURE = 1-1/2" MIN.
INTO METAL STRUCTURE = 3/4" MIN.

CONCRETE AT HEAD, SILL OR JAMBS fc' = 3000 PSI MIN.
C-90 HOLLOW/FILLED BLOCK AT JAMBS fm' = 2000 PSI MIN.

SEALANTS:

ALL FRAME AND PANEL JOINT, INSTALLATION SCREWS AND HEADS OF ANCHOR
SCREWS AT SILL TO BE SEALED WITH BLACK/ALUM COLORED SILICONE.


WEEP HOLES:

W1=3/16" X 1" WEEP SLOTS AT 8" FROM ENDS
W2=1/4" X 2" WEEP SLOTS AT 8" FROM ENDS


PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 21-0325.07

Expiration Date 05/21/2025

By *Ishag I. Chande*
Miami-Dade Product Control

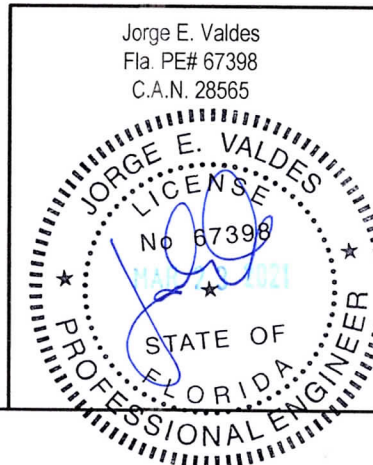

Miami Wall Systems, Inc.



SERIES 113
ALUM. SLIDING GLASS DOOR
(S.M.I.)

701 West 25th Street
Hialeah, Florida 33010

Phone: (305) 888-2300 Fax: (305) 888-3058

NO.	DATE	REVISION
1	10/23/19	UPDATE TO 2017 FBC
2	03/16/21	UPDATE TO 2020 FBC

DATE: 7/30/2014





SCALE: AS NOTED



DWG. BY: O.J.L.

CHK. BY: JV

DWG NO.: 113-SM

SHEET 6 OF 11

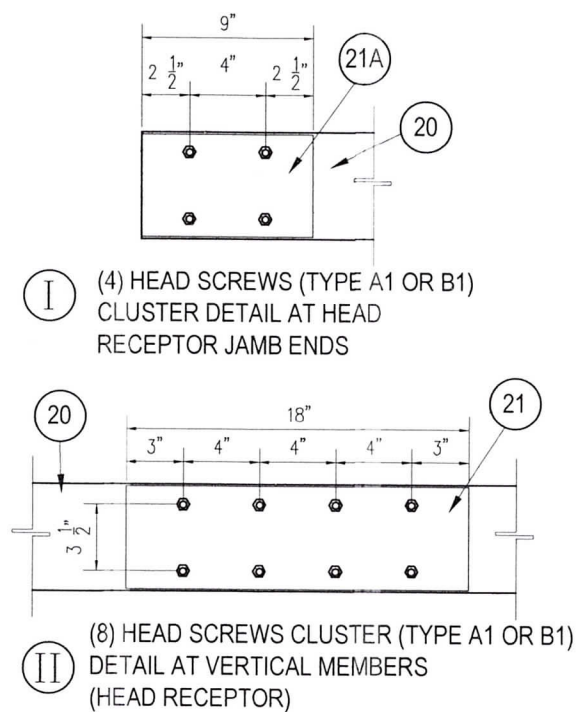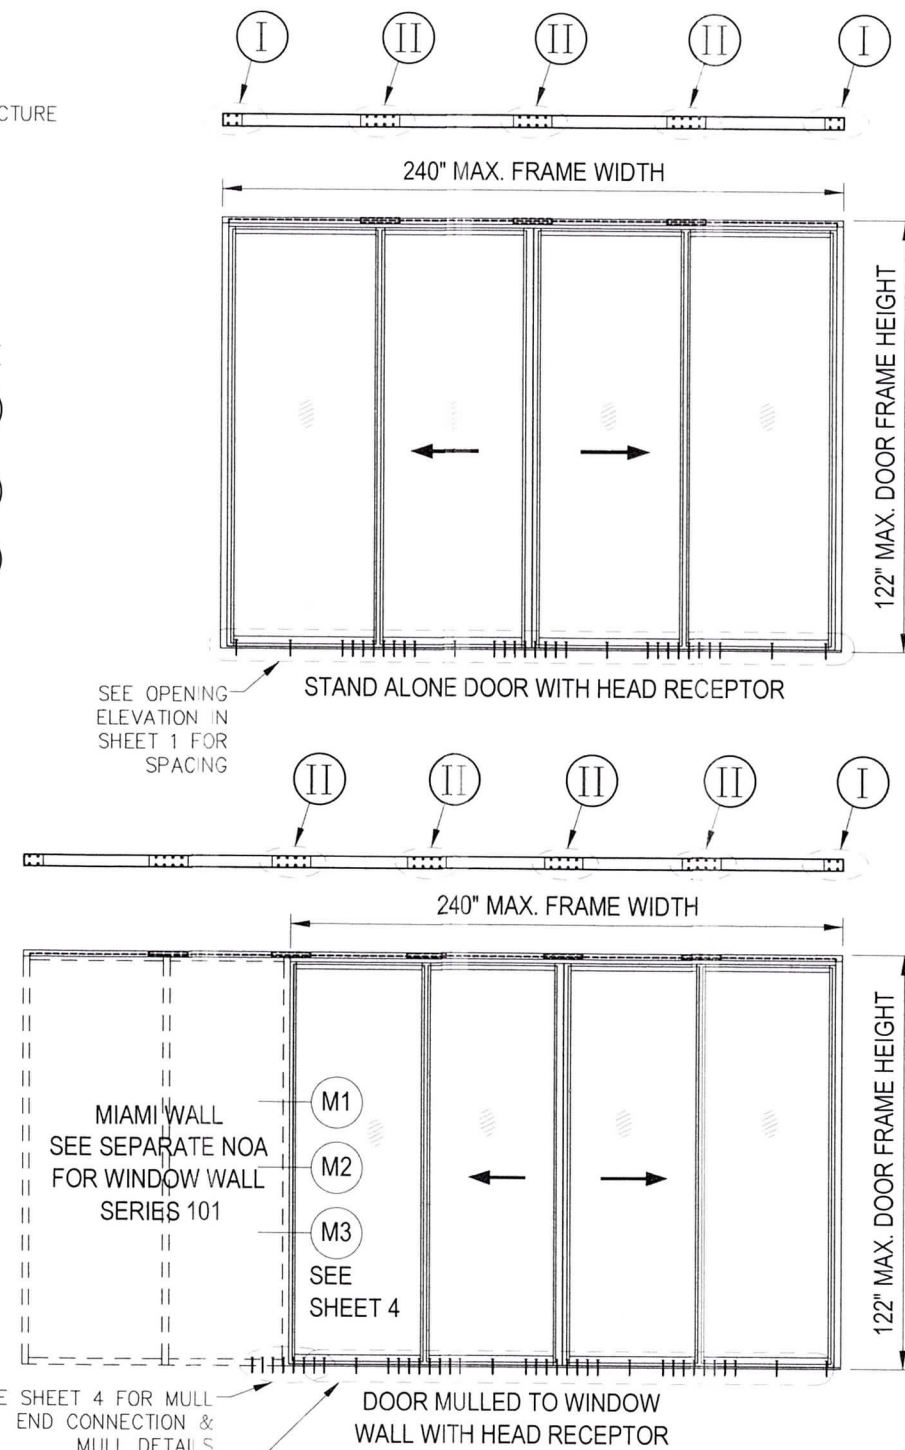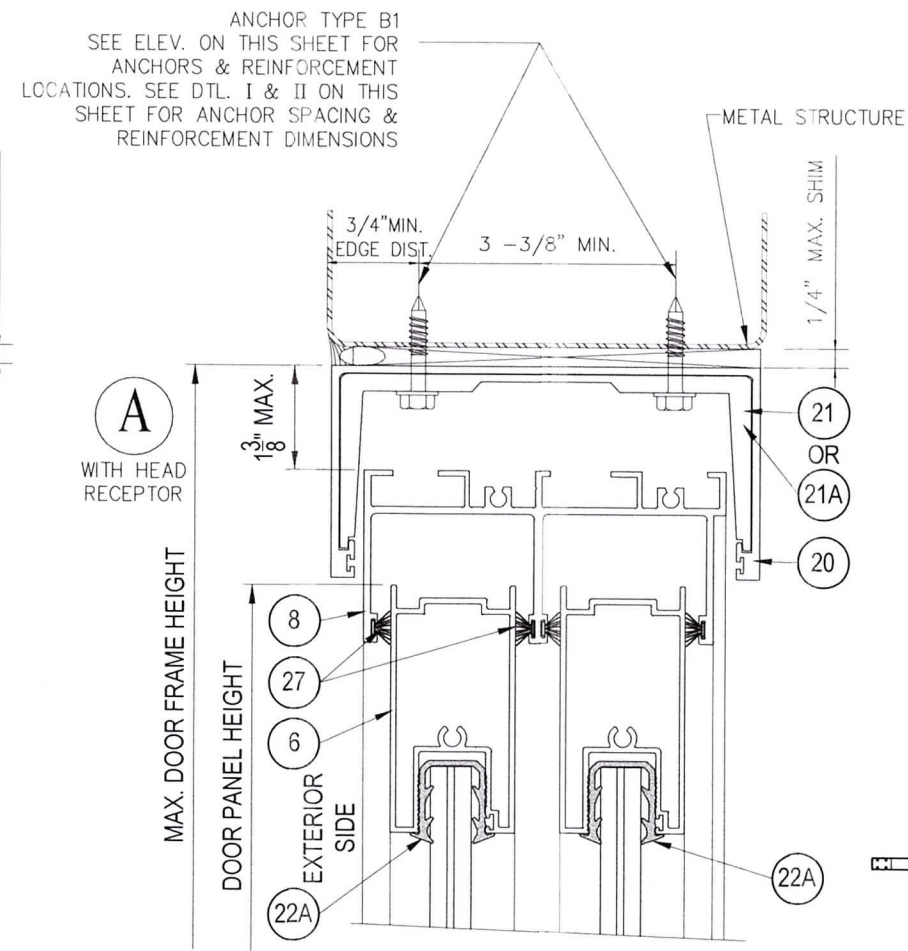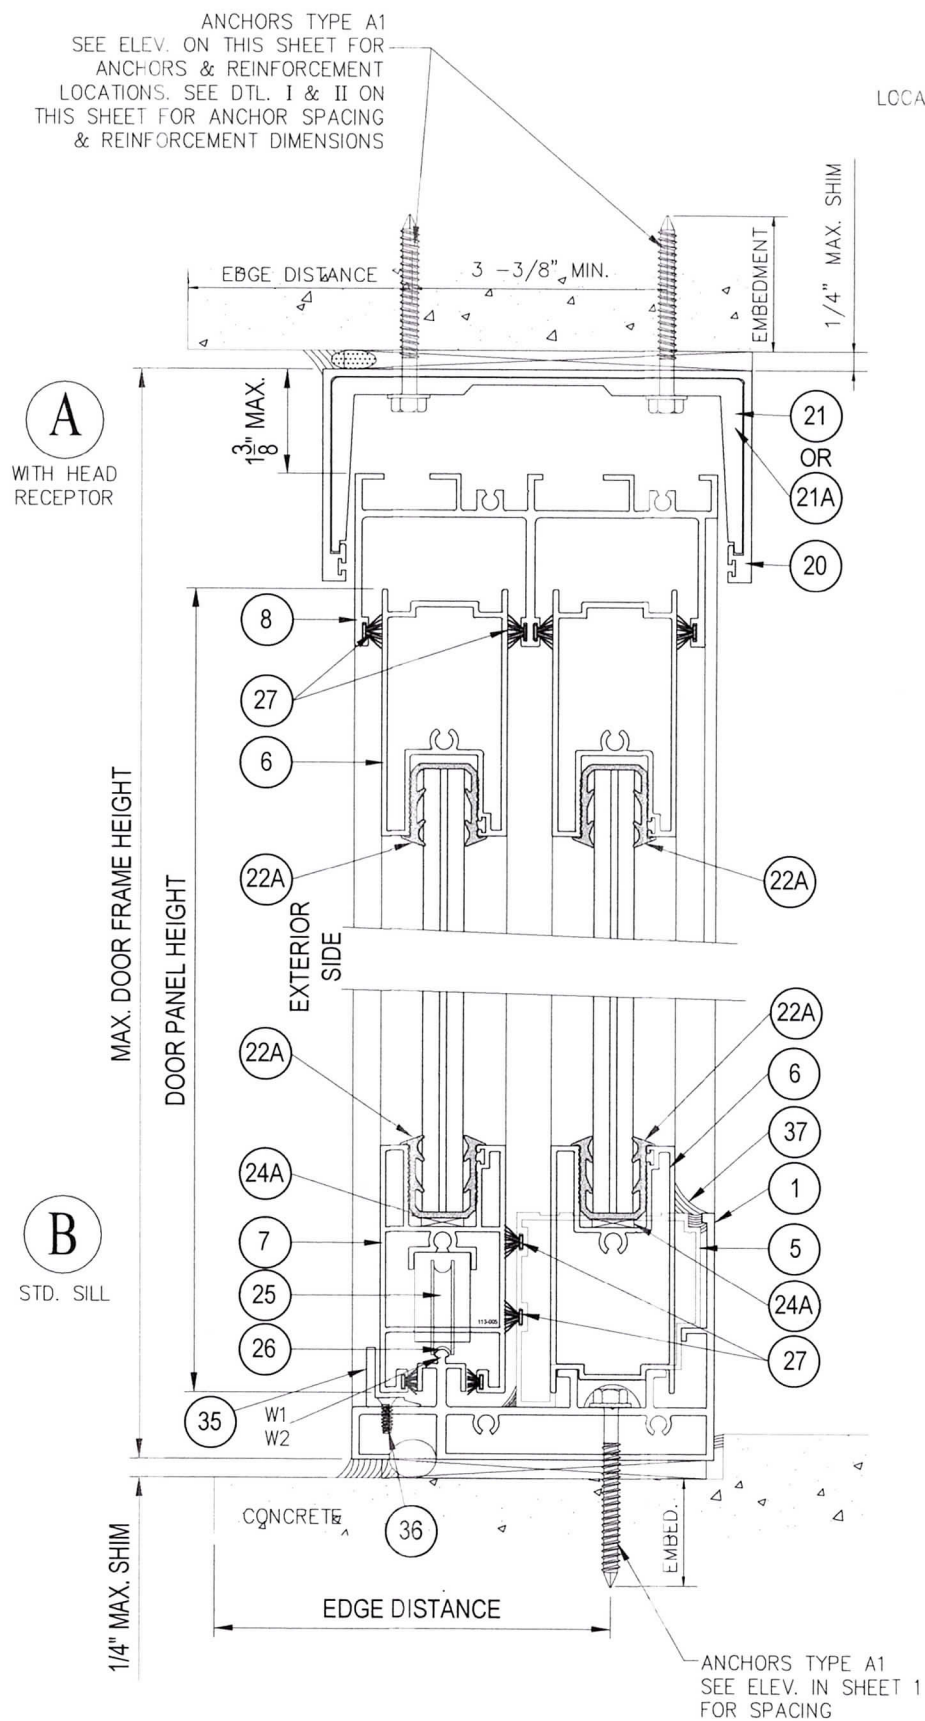

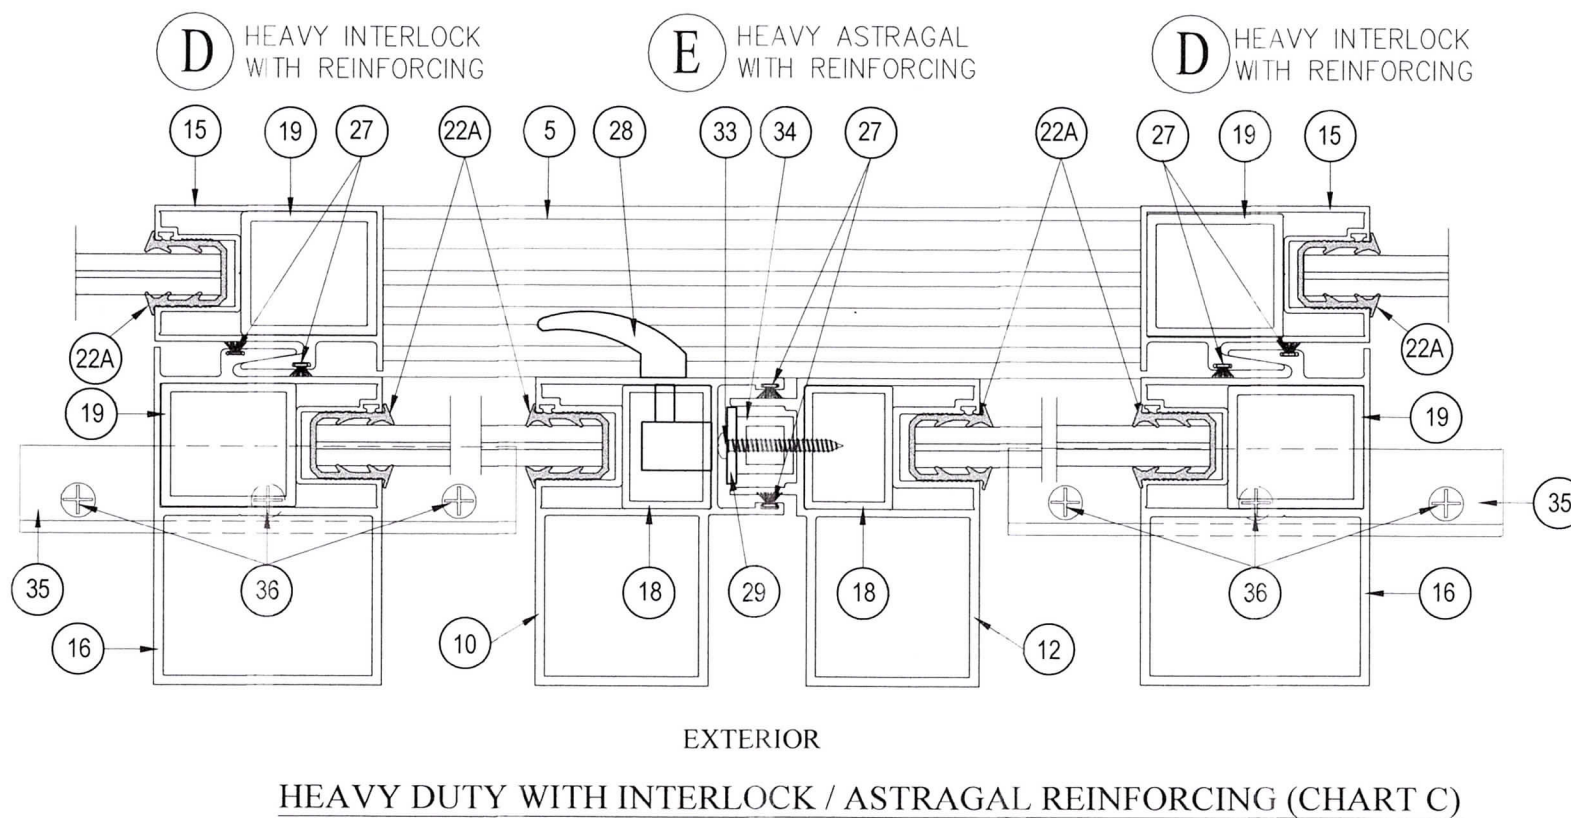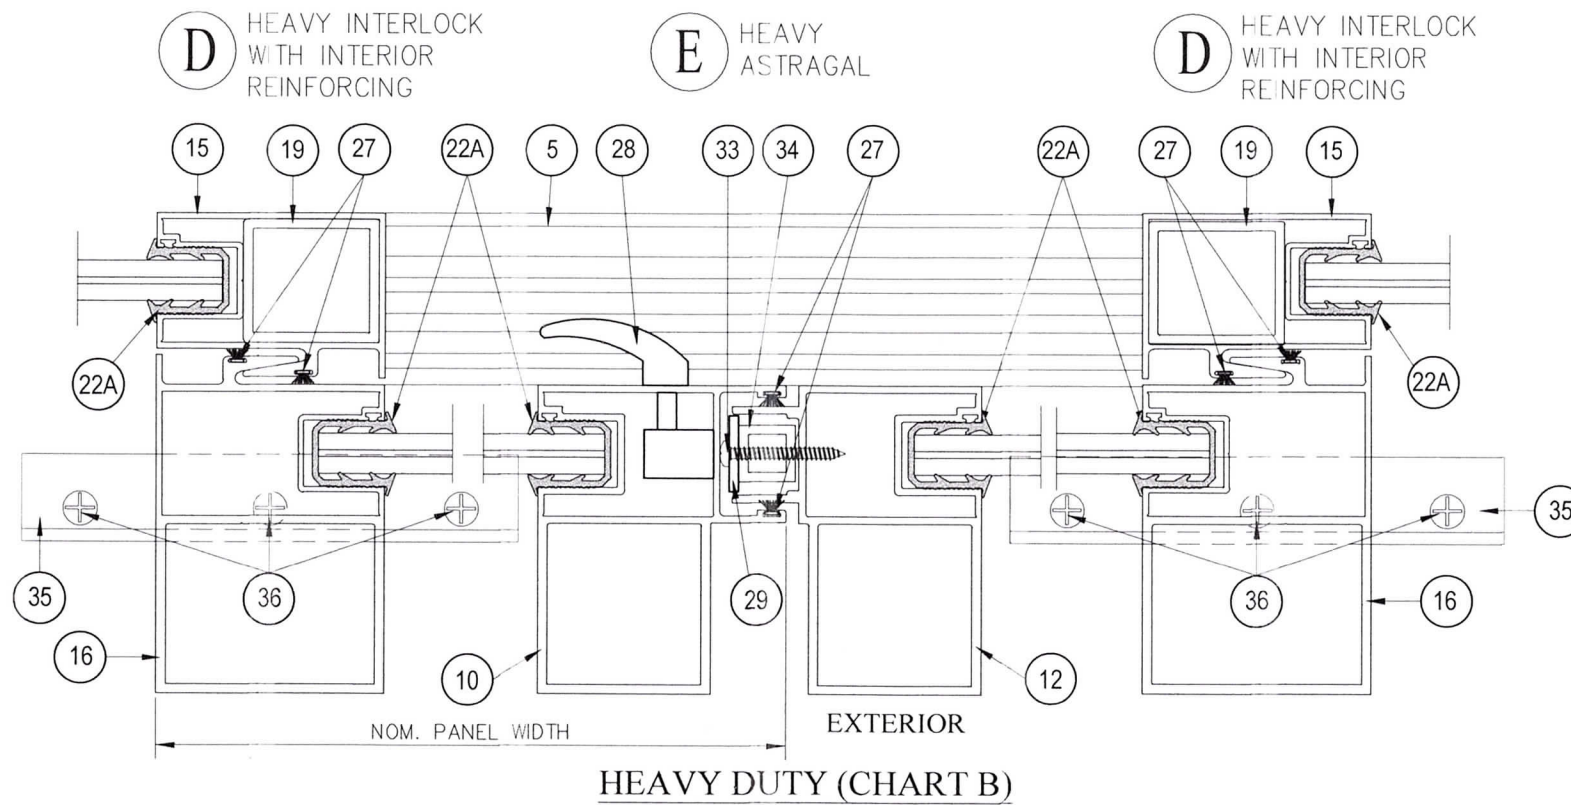


PRODUCT REVISED
 as complying with the Florida
 Building Code
 NOA-No. **21-0325.07**
 Expiration Date **05/21/2025**
 By Ishag I. Chande
 Miami-Dade Product Control


Miami Wall Systems, Inc.

701 West 25th Street
 Hialeah, Florida, 33010

Phone: (305) 888-2300 Fax: (305) 888-3058




SERIES 113
 ALUM. SLIDING GLASS DOOR
 (S.M.I.)

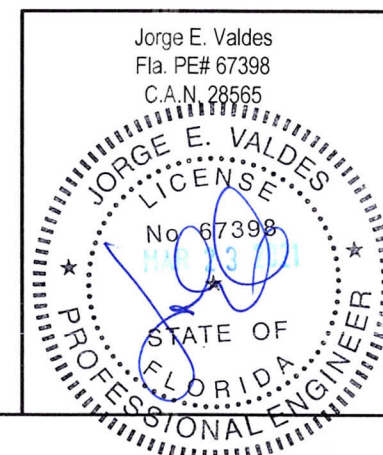


NO.	DATE	REVISION
1	10/23/19	UPDATE TO 2017 FBC
2	03/16/21	UPDATE TO 2020 FBC


DATE: 7/30/2014
 SCALE: AS NOTED
 DWG. BY: O.J.L.
 CHK. BY: JV
 DWG NO.: 113-SM
 SHEET 9 OF 11

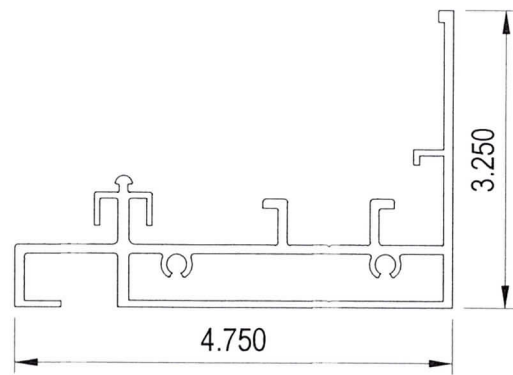


1 SILL
113-001
TYP. WALL THK = 0.100"
MAT: ALUM. ALLOY 6063-T5

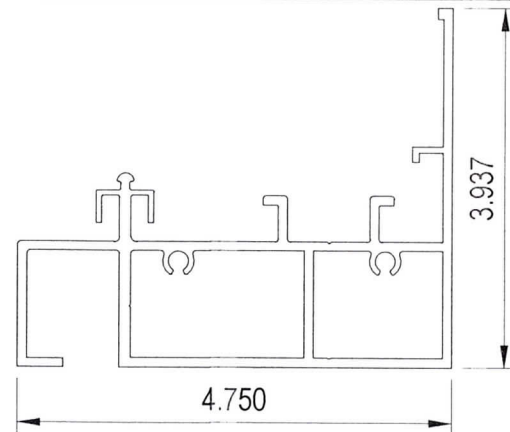


2 RAISED SILL
113-016
TYP. WALL THK = 0.100"
MAT: ALUM. ALLOY 6063-T6

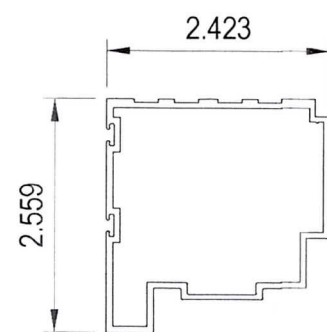


5 THRESHOLD (FIXED TRACK)
113-002
TYP. WALL THK = 0.070"
MAT: ALUM. ALLOY 6063-T5

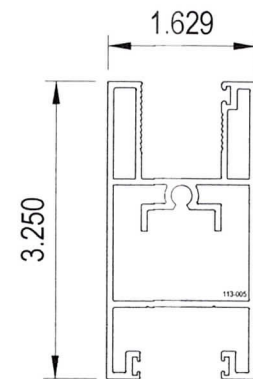


7 MOVING BOTTOM RAIL
113-005
TYP. WALL THK = 0.070"
MAT: ALUM. ALLOY 6063-T5

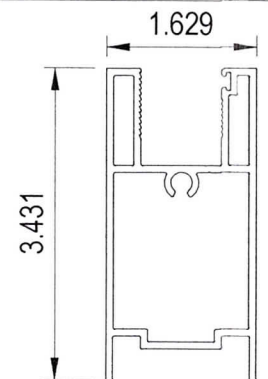


6 FIXED BOTTOM RAIL
113-004
TYP. WALL THK = 0.070"
MAT: ALUM. ALLOY 6063-T5

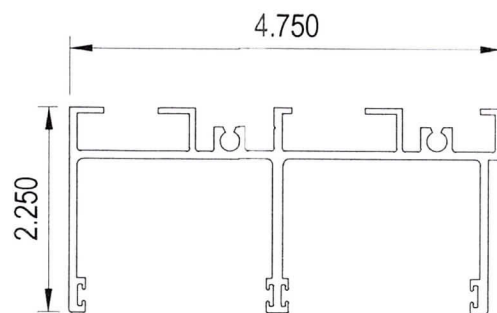


8 JAMB / HEAD
113-007
TYP. WALL THK = 0.090"
MAT: ALUM. ALLOY 6063-T5




13 REINF. BAR
MAT: STEEL A36




14 REINF. BAR
MAT: STEEL A36

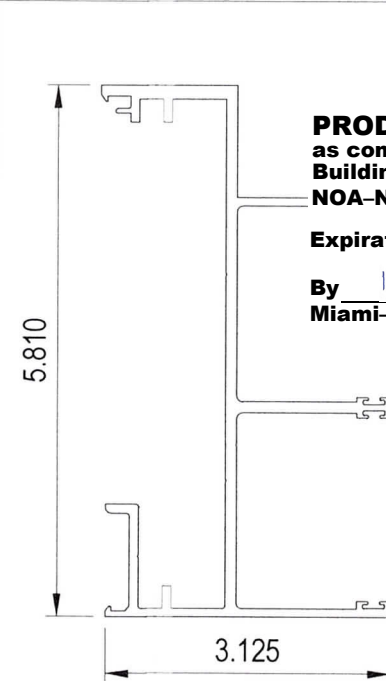

3 MEDIUM FEMALE SGD MULLION
113-018
TYP. WALL THK = 0.125"
MAT: ALUM. ALLOY 6063-T6

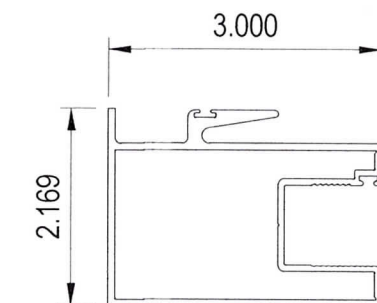

9 EXTERIOR STD. INTERLOCK STILE
113-010
TYP. WALL THK = 0.078"
MAT: ALUM. ALLOY 6063-T5

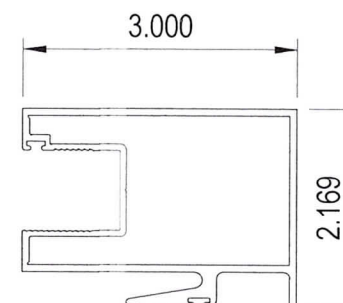


15 INTERIOR STD. INTERLOCK STILE
113-009
TYP. WALL THK = 0.078"
MAT: ALUM. ALLOY 6063-T5


PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. **21-0325.07**

Expiration Date **05/21/2025**


By Ishag I. Chande
Miami-Dade Product Control

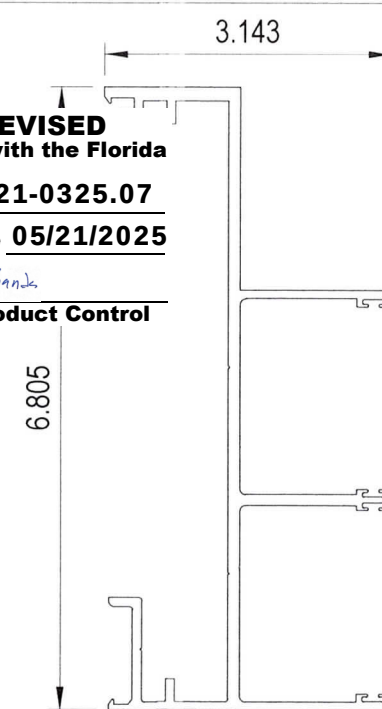


4 HEAVY FEMALE SGD MULLION
113-019
TYP. WALL THK = 0.125"
MAT: ALUM. ALLOY 6063-T6

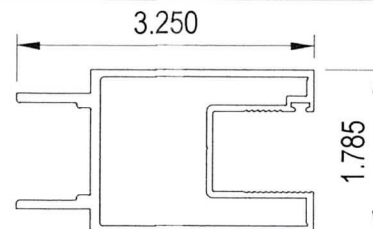


11 STANDARD ASTRAGAL
113-012
TYP. WALL THK = 0.090"
MAT: ALUM. ALLOY 6063-T6

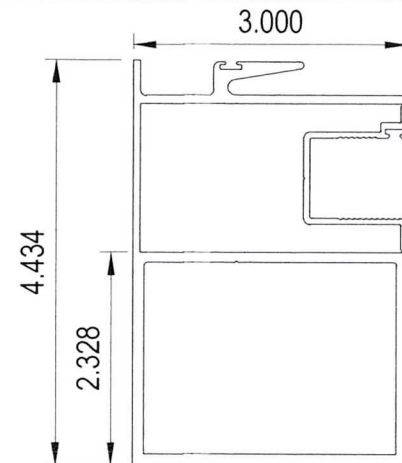


16 HEAVY EXTERIOR INTERLOCK STILE
113-029
TYP. WALL THK = 0.125"
MAT: ALUM. ALLOY 6063-T5

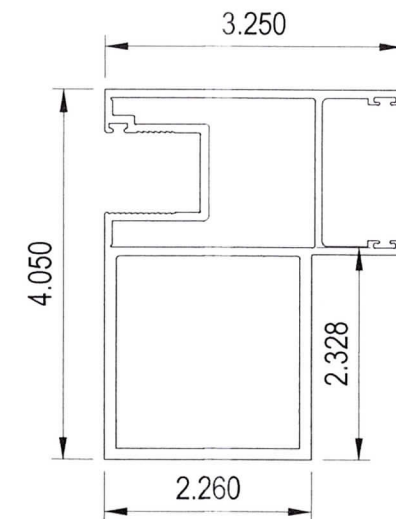

10 HEAVY LOCK STILE
113-017
TYP. WALL THK = 0.090"
MAT: ALUM. ALLOY 6063-T6

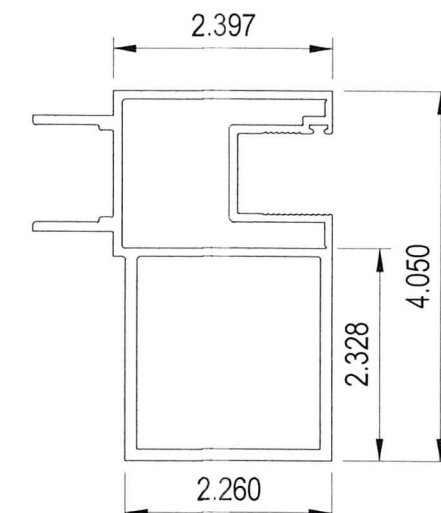

12 HEAVY ASTRAGAL
113-013
TYP. WALL THK = 0.090"
MAT: ALUM. ALLOY 6063-T5

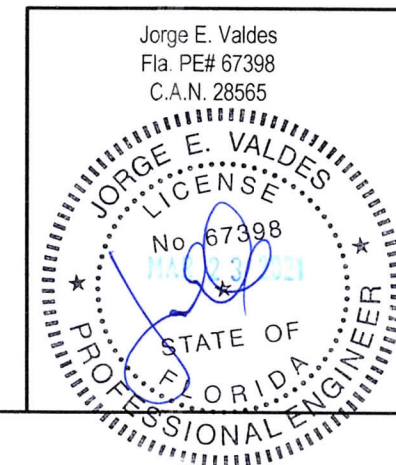

Miami Wall Systems, Inc.










701 West 25th Street
Hialeah, Florida, 33010

Phone: (305) 888-2300 Fax: (305) 888-3058

SERIES 113
ALUM. SLIDING GLASS DOOR
(S.M.I.)


NO.	DATE	REVISION
1	10/23/19	UPDATE TO 2017 FBC
2	03/16/21	UPDATE TO 2020 FBC
3		
4		
5		
6		
7		
8		
9		
10		
11		
12		
13		
14		
15		
16		

DATE: 7/30/2014
SCALE: AS NOTED
DWG. BY: O.J.L.
CHK. BY: JV
DWG NO.: 113-SM
SHEET 10 OF 11

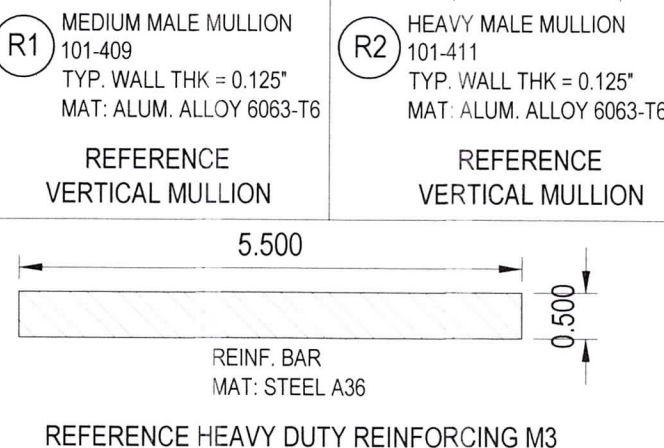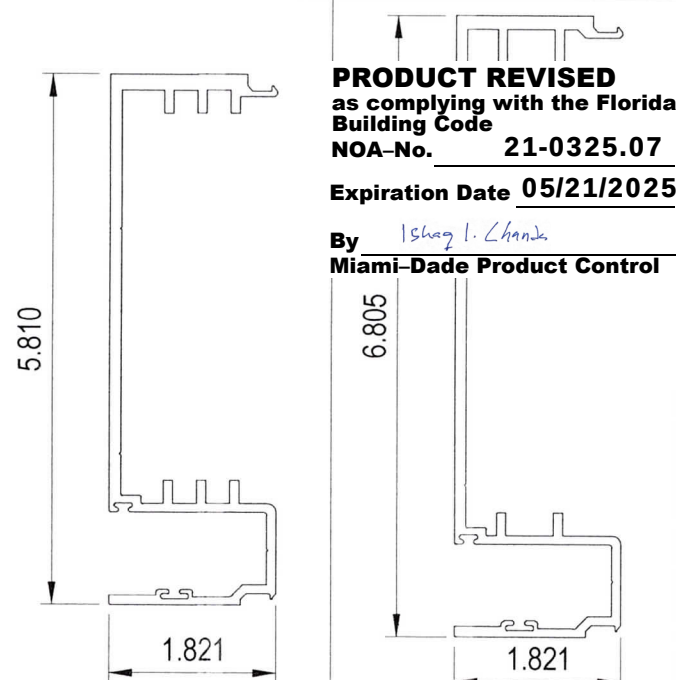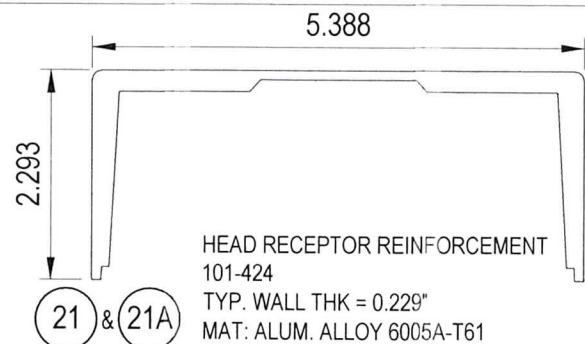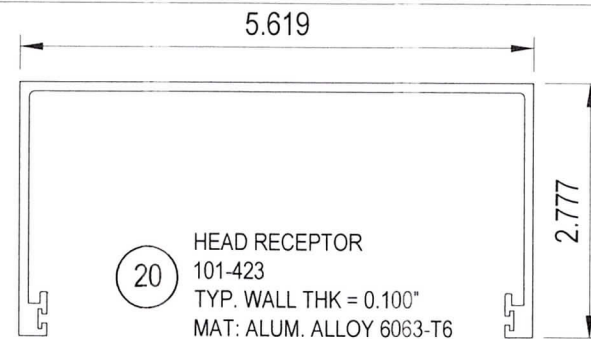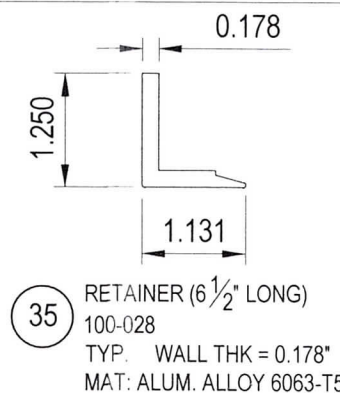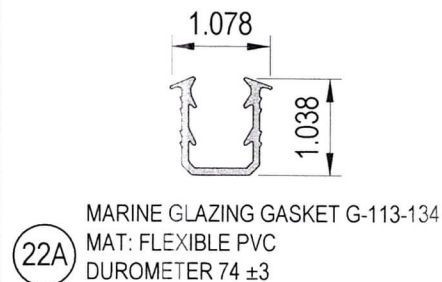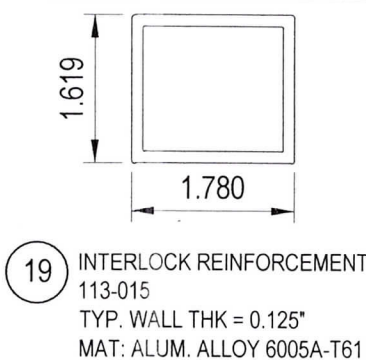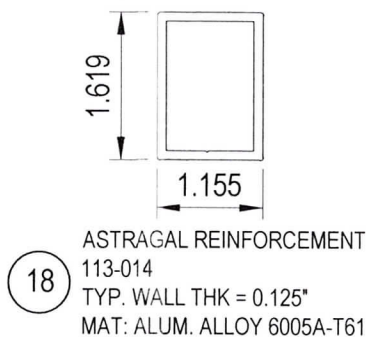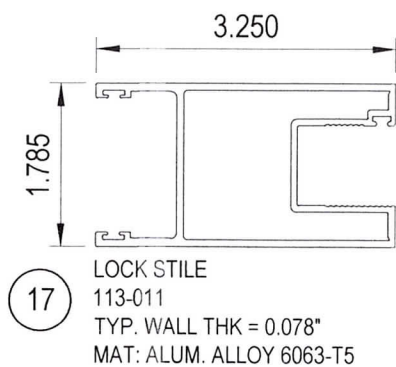


PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. **21-0325.07**
Expiration Date **05/21/2025**
By *Ismael I. Chan*
Miami-Dade Product Control


ITEM #	PART #	REQ'D	DESCRIPTION	REMARKS
1	113-001	1	SILL	SGD FRAME
2	113-016	1	RAISED SILL	SGD FRAME
3	113-018	1	MEDIUM FEMALE VERTICAL MULLION	SGD FRAME
4	113-019	1	HEAVY FEMALE VERTICAL MULLION	SGD FRAME
5	113-002	1	THRESHOLD	SGD FRAME
6	113-004	SEE REMARKS	FIXED BOTTOM RAIL, JAMB & SILL	(2) PER FIXED PANEL (1) PER MOV. PANEL
7	113-005	SEE REMARKS	MOVING BOTTOM RAIL	(1) PER MOV. PANEL
8	113-007	SEE REMARKS	JAMB/HEAD	SGD FRAME
9	113-010	SEE REMARKS	EXTERIOR STD. INTERLOCK STILE	(1) PER MOV. PANEL. SEE SHEET 3
10	113-017	SEE REMARKS	HEAVY LOCK STILE	(1) PER LOOKING MOV. PANEL. SEE SHEET 3
11	113-012	SEE REMARKS	STANDARD ASTRAGAL	(1) PER MOV. PANEL. SEE SHEET 3
12	113-013	SEE REMARKS	HEAVY ASTRAGAL	(1) PER MOV. PANEL. SEE SHEET 3
13		1	1/4" X 5 1/2" REINFORCEMENT STEEL BAR	SGD PANEL
14		1	1/4" X 6 1/2" REINFORCEMENT STEEL BAR	SGD PANEL
15	113-009	SEE REMARKS	INTERIOR INTERLOCK STILE	(1) PER FIXED PANEL
16	113-029	1	HEAVY EXTERIOR INTERLOCK STILE	(1) PER FIXED PANEL
17	113-011	SEE REMARKS	STD. LOCK STILE	(1) PER FIXED PANEL (1) PER LOCKING MOV. PANEL
18	113-014	AS REQ'D	ASTRAGAL REINFORCEMENT	SEE SHEET 3
19	113-015	AS REQ'D	INTERLOCK REINFORCEMENT	SEE SHEET 3
20	101-423	AS REQ'D	HEAD RECEPTOR	SGD FRAME. SEE SHEET 7
21	101-424	AS REQ'D	HEAD RECEPTOR REINFORCEMENT 18" LONG	AT VERTICAL STILES. SEE SHEET 7
21A	101-424	AS REQ'D	HEAD RECEPTOR REINFORCEMENT 9" LONG	AT JAMB ENDS OF STAND ALONE SGD. SEE SHEET 7
22	G-101-01	AS REQ'D	GLASS VINYL GASKET	DUROMETER 75 ±5 SHORE A
22A	G-113-134	AS REQ'D	MARINE GLAZING GASKET	DUROMETER 74 ±3 SHORE A BY HI-TECH EXTRUSIONS
23	SILICONE	AS REQ'D	TREMCO PROGLAZE	AT PANELS/9/16" GLASS
24		2 PER LITE	9/16" X 3/16" X 4" LG SETTING BLOCK	DUROMETER 75 ±5 SHORE A
24A		2 PER LITE	9/16" X 1/8" X 4" LG SETTING BLOCK	DUROMETER 75 ±5 SHORE A
25		SEE REMARKS	STAINLESS STEEL ROLLER	(2) PER MOV. PANEL
26		1	STAINLESS STEEL TRACK	AT SGD FRAME SILL
27		AS REQ'D	FIN SEAL	
28		-	S/S 3 PLY HOOK LOCK + ALUM. HANDLE	(1) PER LOCK STILE
29		-	S/S KEEPER	(1) PER LOCK STILE
30		8	#14" X 1" HEX HEAD SMS	FRAME ASSEMBLY SCREWS
31		-	1" X 1" X 1/8" X 4" LG. ALUM. TUBE	(1) PER KEEPER AT JAMB
32		-	1/16" X 4" PLASTIC SHIM	(1) PER KEEPER
33		-	#10 X 1 1/2" S/S PAN HEAD SCREW	(2) PER KEEPER
34		-	3/4" X 3/4" X 1/8" X 4" LG ALUM. TUBE	(1) PER KEEPER AT ASTRAGAL
35	100-028	AS REQ'D	RETAINER 6 1/2" LONG	(1) AT EACH INTERLOCK STILE
36		SEE REMARKS	#14" X 1" F.H. S/S SMS	(3) PER RETAINER ANGLE
37		AS REQ'D	SILICONE BEAD	CONTINUOUS ALONG SILL FRAME
38		AS REQ'D	SILICONE	14 1/2" FROM BOTTOM
39		4 PER PANEL	#14" X 1" P.H. SMS	PANEL ASSEMBLY SCREWS

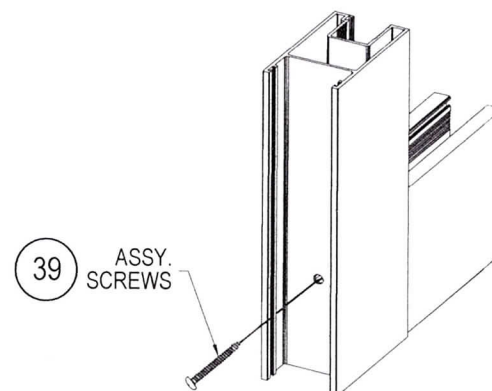

SERIES 113 SGD PANEL
CORNER ASSEMBLY DETAIL

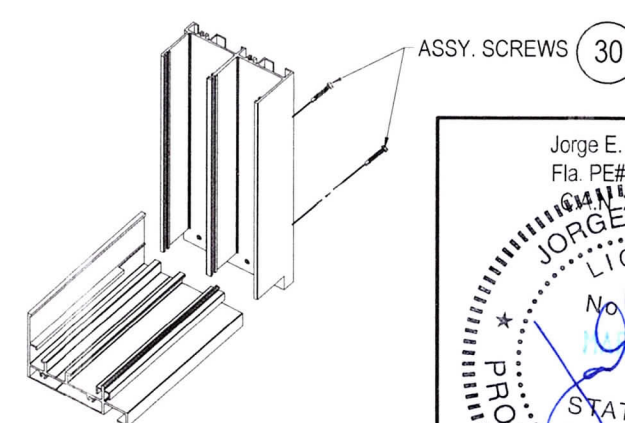

SERIES 113 SGD FRAME
CORNER ASSEMBLY DETAIL

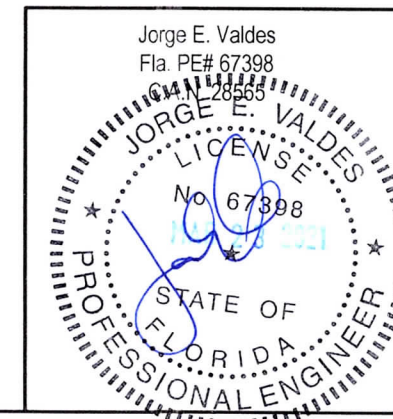

Miami Wall Systems, Inc.
701 West 25th Street
Hialeah, Florida 33010
Phone: (305) 888-2300 Fax: (305) 888-3058

SERIES 113
ALUM. SLIDING GLASS DOOR
(S.M.I.)

NO.	DATE	REVISION
1	10/23/19	UPDATE TO 2017 FBC
2	03/16/21	UPDATE TO 2020 FBC
DATE:	7/30/2014	
SCALE:	AS NOTED	
DWG. BY:	O.J.L.	
CHK. BY:	JV	
DWG NO.:	113-SM	
SHEET	11	OF 11