

MIAMI-DADE COUNTY PRODUCT CONTROL SECTION

11805 SW 26 Street, Room 208 Miami, Florida 33175-2474 T (786) 315-2590 F (786) 315-2599

www.miamidade.gov/economy

DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER) BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

PGT Industries, Inc. 1070 Technology Drive North Venice, FL 34275

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER -Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "FD-101" Outswing Aluminum French Door w/wo Sidelites - Non-Impact

APPROVAL DOCUMENT: Drawing No.11005-2 Rev G, titled "Alum French Door & Sidelites, NI", sheets 1 through 15 of 15, prepared by manufacturer, dated 04/04/12 and last revised on 04/20/20, signed and sealed by Lynn Miller, P.E., bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: None: Approved Hurricane Protection devices, complying w/ FBC, as applicable are required.

Limitations:

- 1. Use of Tables 1 or 2 (sheet 2) requires full length reinforcements (item # 22) for OX, XO, XXO, OXX, OXO and OXXO configurations. The lower design pressure from table 1 or table 2 shall control.
- 2. Standalone X, XX and O configuration unit do not require, reinforcement (item #22).
- 3. Applicable Egress operable doors must comply with min clear width & height per FBC, to be reviewed by AHJ.
- 4. 1x or 2x buck to be properly secured to sustain imposed load and to be reviewed by AHJ.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and series and following statement: "Miami-Dade County Product Control Approved", noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **renews NOA #20-0427.02** and consists of this page 1 and evidence pages E-1, E-2, E-3 & E-4, as well as approval document mentioned above.

The submitted documentation was reviewed by Ishaq I. Chanda, P.E.



Ishaq I. Chands

NOA No. 22-0608.04 Expiration Date: August 02, 2027 Approval Date: July 07, 2022

Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

DRAWINGS A.

- Manufacturer's die drawings and sections (Submitted under files # listed below)
- Drawing No.11005-2 Rev F, titled "Alum French Door & Sidelites, NI", sheets 1 through 15 of 15, prepared by manufacturer, dated 04/04/12 and last revised on 07/27/17, prepared by PGT Industries, signed and sealed by Anthony Lynn Miller, P.E.

TESTS B.

- 1. Reference Test report on 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, per FBC, TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94.
 - 4) Forced Entry Test, per FBC 2411 3.2.1 (b) and TAS 202-94.
 - 5) Large Missile Impact Test per FBC, TAS 201-94 (N/A)
 - 6) Cyclic Wind Pressure Loading per FBC, TAS 203-94 (N/A)

Along with marked-up drawings and installation diagram of aluminum double French door, prepared by Fenestration Testing Laboratory, Inc., Test Report No(s). FTL-2612, dated SEP 07, 2000, signed and sealed by Marlin D. Brinson, P.E.

Along with marked-up drawings and installation diagram of aluminum fixed door, prepared by Fenestration Testing Laboratory, Inc., Test Report No(s). FTL-6864, dated April 09, 2012, signed and sealed by Aldo P. Gonzalez, P.E.

- Reference Test report on 1) Uniform Static Air Pressure Test, per FBC, TAS 202-94
 - 2) Large Missile Impact Test per FBC, TAS 201-94(N/A)
 - 3) Cyclic Wind Pressure Loading per FBC, TAS 203-94(N/A)

Along with marked-up drawings and installation diagram of Aluminum Sliding Glass Doors (w/ PS, Super, Cardinal & Duraseal Spacers), prepared by Fenestration Testing Laboratory, Inc., Test Reports No(s) FTL-8717, FTL-8970 and FTL-8968, dated 02/15/16, 06/07/16 and 06/20/16, all signed & sealed by Idalmis Ortega, P.E. (Submitted under files #16-0629.18/#15-0528.25)

- Test report on
- 1) Air Infiltration Test, per FBC, TAS 202-94
- 2) Uniform Static Air Pressure Test, per FBC, TAS 202-94
- 3) Water Resistance Test, per FBC, TAS 202-94.
- 4) Forced Entry Test, per FBC 2411 3.2.1 (b) and TAS 202-94

Along with marked-up drawings and installation diagram of aluminum out swinging French door w/ sidelites, prepared by Fenestration Testing Laboratory, Inc., Test Report No(s). FTL-4964, dated September 09, 2006, signed and sealed by Edmundo Largaespada, P.E. (Submitted under files #15-0528.25/12-0516.03/#11-1013.21)

C. **CALCULATIONS**

- Anchor verification calculations and structural analysis dated 04/28/17 and last revised on 07/17/17, complying with FBC-217 (6th Edition), prepared by PGT, signed and sealed by Lynn Miller, P.E.
- Glazing complies w/ ASTME-1300-02, 04 & -09.

QUALITY ASSURANCE D.

Miami Dade Department of Regulatory and Economic Resources (RER).

Ishaq I. Chanda, P.E.
Product Control Unit Supervisor NOA No. 22-0608.04 Expiration Date: August 02, 2027

Approval Date: July 07, 2022

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

E. MATERIAL CERTIFICATIONS

1. None.

F. STATEMENTS

- 1. Statement letter of conformance to FBC 2017(6th edition) and letter of no financial interest, prepared by PGT, dated 07/17/17, signed and sealed by Lynn Miller, P.E.
- 2. Statement letter of conformance to FBC 2014(5th edition) and letter of no financial interest, prepared by PGT, dated 05/22/15, signed and sealed by Lynn Miller, P.E. (Submitted under files #15-0528.25)
- 3. Lab compliance as part of the above referenced test report.

G. OTHER

- 1. This NOA revises & renews NOA # 16-0629.18, expiring 08/02/22.
- 2. Test proposal # 16-0152 dated 03/09/16 approved by RER.
- 3. Test proposal dated Jan. 17, 2007 approved by BCCO.
- 4. RER e-mail correspondence dated 07-26-17.

2. Evidence submitted under previous approval

A. DRAWINGS

1. Drawing No.**11005-2 Rev G**, titled "Alum French Door & Sidelites, NI", sheets 1 through 15 of 15, prepared by manufacturer, dated 04/04/12 and last revised on 04/20/20, prepared by PGT Industries, signed and sealed by Anthony Lynn Miller, P.E.

B. TESTS

- 1. Test report on 1)
- 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Forced Entry Test, per ASTM F588 and TAS 202-94

along with marked-up drawings and installation diagram of all PGT Industries, Inc. representative units listed below and tested to qualify **Dowsil 791** and **Dowsil 983** silicones, prepared by Fenestration Testing Laboratory, Inc., Test Reports No.:

FTL-7897, PGT PW5520 PVC Fixed Window (unit 6 in proposal), dated 09/03/14 FTL-20-2107.1, PGT SGD780 Aluminum Sliding Glass Door (unit 7 in proposal) FTL-20-2107.2, PGT CA740 Alum. Outswing Casement Window (unit 8 in proposal) FTL-20-2107.3, PGT PW7620A Aluminum Fixed Window (unit 9 in proposal) and FTL-20-2107.4, PGT PW7620A Aluminum Fixed Window (unit 10 in proposal) dated 07/13/20, all signed and sealed by Idalmis Ortega, P.E

C. CALCULATIONS

- 1. Anchor verification calculations and structural analysis dated 04/20/20, complying with FBC-2020 (7th Edition), prepared by PGT, signed and sealed by Lynn Miller, P.E.
- 2. Glazing complies w/ ASTME-1300-02, -04 -09 & -16.

Ishaq 1. Chands

Ishaq I. Chanda, P.E.
Product Control Unit Supervisor
NOA No. 22-0608.04
Expiration Date: August 02, 2027
Approval Date: July 07, 2022

PGT Industries, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

D. QUALITY ASSURANCE

1. Miami Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS

1. None.

F. STATEMENTS

1. Statement letter of conformance to FBC 2020 (7th edition), and letter of no financial interest, prepared by PGT, dated 04/20/20, signed and sealed by Lynn Miller, P.E.

G. OTHER

- 1. This NOA revises NOA #20-0427.02 and updates to FBC 2020 (7th Edition) expiring 08/02/22.
- 2. RER Test proposals #19-1155 dated 01/10/20 approved by Ishaq I. Chanda, P.E.

Ishaq I. Chands

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

3. New Evidence submitted

A. DRAWINGS

1. Drawing No.**11005-2 Rev G**, titled "Alum French Door & Sidelites, NI", sheets 1 through 15 of 15, prepared by manufacturer, dated 04/04/12 and last revised on 04/20/20, prepared by PGT Industries, signed and sealed by Anthony Lynn Miller, P.E.

B. TESTS

1. None.

C. CALCULATIONS (submitted under previous approval)

- 1. Anchor verification calculations and structural analysis dated 04/20/20, complying with FBC-2020 (7th Edition), prepared by PGT, signed and sealed by Lynn Miller, P.E.
- 2. Glazing complies w/ ASTME-1300-02, -04 -09 & -16.

D. QUALITY ASSURANCE

1. Miami Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS

None.

F. STATEMENTS

- 1. Statement letter of conformance to FBC 2020 (7th edition), and letter of no financial interest, prepared by PGT, dated 05/26/22, signed and sealed by Lynn Miller, P.E.
- 2. Statement e-letter dated 05/26/22 issued by PGT Industries, Inc, requesting renewal with no change, signed and sealed by Lynn Miller, P.E.

G. OTHER

1. This NOA renews NOA #20-0427.02, expiring 08/02/27.

Ishaq I. Chands

SERIES 101 OUTSWING, NON-IMPACT RESISTANT FRENCH DOOR AND SIDE LITE

- GLAZING OPTIONS: SEE BELOW.
- 2) DESIGN PRESSURES: (SEE TABLES 1-4 ON SHEET 2.
 - A. NEGATIVE DESIGN LOADS BASED ON TESTED PRESSURE AND GLASS TABLES ASTM E 1300.
 - B. POSITIVE DESIGN LOADS BASED ON WATER TEST PRESSURE AND GLASS TABLES ASTM E 1300.
 - C. DESIGN LOADS ARE BASED ON ALLOWABLE STRESS DESIGN, ASD.
- 3) CONFIGURATIONS: X, O, XX, XO, OX, XXO, OXX, OXO, AND OXXO.
- ANCHORAGE: THE 33 1/3% STRESS INCREASE HAS NOT BEEN USED IN THE DESIGN OF THIS PRODUCT, FOR ANCHORAGE REQUIREMENTS SEE SHEETS 8-11. MATERIALS, INCLUDING BUT NOT LIMITED TO STEEL SCREWS. THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE FBC. CURRENT EDITION.
- 5) SHUTTERS ARE REQUIRED WHERE IMPACT RESISTANCE IS REQUIRED. SHUTTERS MUST BE MIAMI-DADE COUNTY APPROVED FOR INSTALLATION IN MIAMI-DADE COUNTY.
- 6) SEALANTS: INSTALLATION SCREWS, FRAME AND PANEL CORNERS SEALED WITH CLEAR COLORED SEALANT.
- 7) REFERENCES: TEST REPORT FTL-2612, 4964 & 6864; ELCO ULTRACON NOA, DEWALT ULTRACON+ NOA, ELCO/DEWALT CRETEFLEX NOA, ANSI/AF&PA NDS FOR WOOD CONSTRUCTION, ALUMINUM DESIGN MANUAL
- 8) THIS PRODUCT HAS BEEN DESIGNED & TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE, INCLUDING THE HIGH VELOCITY HURRICANE ZONE (HVHZ).
- 9) DOOR SIZES MUST BE VERIFIED FOR COMPLIANCE WITH EGRESS REQUIREMENTS PER CURRENT FLORIDA BUILDING CODE. APPLICABLE EGRESS REQUIREMENTS TO BE REVIEWED BY AUTHORITY HAVING JURISDICTION (AHJ).

TABLE A:

Anchor Group	Anchor Type	Frame Member	lember Substrate D		Min. Embedment or Metal Thickness
	1/4" Elco UltraCon®	All	Concrete (min. 2.85 ksi)	1-3/4"	1-3/8"
1 1	174 LICO OILIACONS	Jamb	Hollow Block (ASTM C90)	1-3/4"	1-1/4"
' [1/4" DeWalt UltraCon+®	All	Concrete (min. 3 ksi)	1-3/4"	1-3/8"
	1/4 Devvalt Oldacolli	Jamb	Hollow Block (ASTM C90)	1-3/4"	1-1/4"
	4/4" 440 CC Elas/DalA/alt	All	Concrete (min. 3.35 ksi)	1-3/4"	1-3/4"
2	1/4" 410 SS Elco/DeWalt CreteFlex®	Jamb	Hollow Block (ASTM C90)	1-3/4"	1-1/4"
	Creteriex®	All	Southern Pine (SG = 0.55)	1"	1-3/8"
		All	Southern Pine (SG = 0.55)	9/16"	1-3/8"
3	#12 SMS (steel, 18-8 S.S. or	All	6063-T5 Aluminum	3/8"	1/8"
٦	410 S.S.)	All	Steel, A36	3/8"	0.060"
		All	Steel Stud, A1003 Gr. 33	3/8"	0.0451" (18 Ga.)

DESIGN PRESSURE RATING

SEE TABLES 1 - 4

ON SHEET 2

- 1) ALL ANCHOR HEAD TYPES ARE APPLICABLE.
- 2) MIN. OF 3 THREADS BEYOND METAL SUBSTRATE.
- 3) METAL SUBSTRATE TO MEET MIN. STRENGTH AND THICKNESS REQUIREMENTS PER CURRENT FLORIDA BUILDING CODE AND TO BE REVIEWED BY THE AUTHORITY HAVING JURISDICTION
- 4) SEE ANCHOR/SUBSTRATE MATERIAL PROPERTIES ON SHEET 5 FOR Fv & Fu.

CODES / STANDARDS USED:

- 2020 FLORIDA BUILDING CODE (FBC), 7TH EDITION 2017 FLORIDA BUILDING CODE (FBC), 6TH EDITION
- ASTM E1300-09
- ANSI/AF&PA NDS-2018 FOR WOOD CONSTRUCTION
- ALUMINUM DESIGN MANUAL, ADM-2015
- AISI S100-16
- AISC 360-16

GENERAL NOTES1
GLAZING DETAILS1
DESIGN PRESSURES 2
VERT. SECTIONS3
HORIZ. SECTIONS 4
PARTS LIST 5
EXTRUSIONS 6
ANCHOR QUANTITY 7-13
INSTALLATION 14-15


IMPACT RATING

NOT RATED FOR IMPACT

RESISTANCE

INSTRUCTIONS:

- 1) DETERMINE THE DESIGN PRESSURE, DP REQUIREMENT (LBS/FT2) FOR THE OPENING USING THE ASCE-7 STANDARD.
- 2) ON SHEET 2, TABLES 1 & 2 REFER TO PRODUCTS THAT ARE REINFORCED. TABLES 3 & 4 REFER TO PRODUCTS THAT ARE UNREINFORCED. DETERMINE THE DESIGN PRESSURE OF YOUR PRODUCT USING THE APPROPRIATE SET OF TABLES. EXAMPLES ARE GIVEN ON SHEET 2. THIS DESIGN PRESSURE NEEDS TO BE HIGHER THAN THE OPENING'S REQUIRED DESIGN PRESSURE FROM STEP 1.
- 3) DETERMINE YOUR ANCHOR GROUP FROM TABLE A, THIS SHEET AND YOUR GLASS TYPES, A OR B, FROM THE GLAZING DETAILS ON THIS SHEET.
- 4) FROM SHEETS 7-13, FIND THE SHEET THAT PERTAINS TO YOUR PRODUCT'S CONFIGURATION AND DETERMINE THE ANCHOR QUANTITIES REQUIRED.
- 5) ANCHORS ARE TO BE INSTALLED USING THE LOCATION GUIDELINES GIVEN IN THE NOTES ON SHEETS 7-13. SHEET 14 & 15 SHOW INSTALLATION CROSS-SECTIONAL DETAILS.

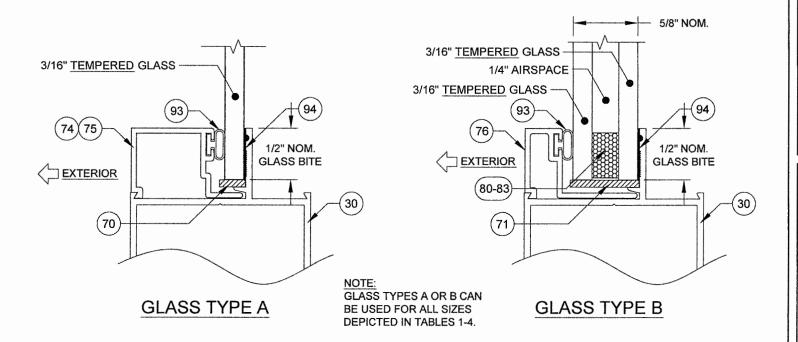

PRODUCT RENEWED as complying with the Florida Building Code 22-0608.04

Expiration Date 08/02/2027

Miami-Dade Product Control

PRODUCT REVISED as complying with the Florida Building Code

NOA-No.

20-0427.02 Expiration Date: 08/02/2022

Bv: Ishag 1. Chande

Miami-Dade Product Control

G) UPDATED TO FBC 2020, REVISED ANCHOR TYPE TABLE. AK - 04/15/20

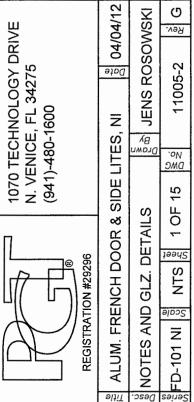




TABLE 1:	
1	DESIGN PRESSURES FOR DOORS ALL GLASS TYPE

REINFORCED (ITEM #22) DOOR TO SIDE LITE OR UNREINFORCED STAND-ALONE DOOR

CONFIG	500	D ED 484E		DOOR FRAME HEIGHT									
် ပိ		R FRAME /IDTH	6 ⁸ - 7	9 3/4"	7 ⁰ - 8	3 3/4"	87 3	3/4"	91 3	3/4"	8 ⁰ - 9	5 3/4"	
X	2 ⁰	25 1/2"	+75.0	-112.1	+75.0	-105.8	+75.0	-100.2	+75.0	-95.2	+75.0	-90.7	
Х		27 1/2"	+75.0	-105.0	+75.0	-99.0	+75.0	-93.7	+75.0	-89.0	+75.0	-84.7	
Х		29 1/2"	+75.0	-98.9	+75.0	-93.2	+75.0	-88.2	+75.0	-83.7	+75.0	-79.6	
X	2 ⁶	31 1/2"	+75.0	-93.7	+75.0	-88.3	+75.0	-83.4	+75.0	-79.1	+75.0	-75.2	
Х	2 ⁸	33 1/2"	+75.0	-82.3	+75.0	-82.3	+75.0	-79.3 ⁽	+75.0	-75.1	+71.3	-71.3	
Х		35 1/2"	+72.9	-72.9	+72.9	-72.9	+72.9	-72.9	+71.6	-71.6	+68.0	-68.0	
Х	3 ⁰	37 1/2"	+65.0	-65.0	+65.0	-65.0	+65.0	-65.0	+65.0	-65.0	+65.0	-65.0	
XX	4 ⁰	47 3/4"	+75.0	-112.1	+75.0	-105.8	+75.0	-100.2	+75.0	-95.2	+75.0	-90.7	
XX		51 3/4"	+75.0	-105.0	+75.0	-99.0	+75.0	-93.7	+75.0	-89.0	+75.0	-84.7	
XX		55 3/4"	+75.0	-98.9	+75.0	-93.2	+75.0	-88.2	+75.0	-83.7	+75.0	-79.6	
XX	5 ⁰	59 3/4"	+75.0	-93.7	+75.0	-88.3	+75.0	-83.4	+75.0	-79.1	+75.0	-75.2	
XX	5 ⁴	63 3/4"	+75.0	-82.3	+75.0	-82.3	+75.0	-79.3	+75.0	-75.1	+71.3	-71.3	
XX		67 3/4"	+72.9	-72.9	+72.9	-72.9	+72.9	-72.9	+71.6	-71.6	+68.0	-68.0	
XX	6 ⁰	71 3/4"	+65.0	-65.0	+65.0	-65.0	+65.0	-65.0	+65.0	-65.0	+65.0	-65.0	

DESIGN PRESSURES FOR DOORS. ALL GLASS TYPES UNREINFORCED DOOR TO SIDE LITE

٠.	UNREINFORCED DOOR TO SIDE LITE													
ב ב	_	DOOR	DOOR FRAME HEIGHT											
2	FRAME WIDTH		6 ⁸ - 7	9 3/4"	7 ⁰ - 8	7 ⁰ - 83 3/4"		87 3/4"		91 3/4"		8 ⁰ - 95 3/4"		
K	2 ⁰	25 1/2"	+60.0	-60.3	+57.0	-57.0	+54.0	-54.0	+51.3	-51.3	+48.8	-48.8		
K		27 1/2"	+56.5	-56.5	+53.3	-53.3	+50.5	-50.5	+47.9	-47.9	+45.6	-45.6		
X		29 1/2"	+53.3	-53.3	+50.2	-50.2	+47.5	-47.5	+45.0	-45.0	+42.8	-42.8		
X	2 ⁶	31 1/2"	+50.5	-50.5	+47.5	-47.5	+44.9	-44.9	+42.6	-42.6	+40.5	-40.5		
K	2 ⁸	33 1/2"	+44.3	-44.3	+44.3	-44.3	+42.7	-42.7	+40.4	-40.4	+38.4	-38.4		
X		35 1/2"	+39.3	-39.3	+39.3	-39.3	+39.3	-39.3	+38.6	-38.6	+36.6	-36.6		
X	3 ⁰	37 1/2"	+35.0	-35.0	+35.0	-35.0	+35.0	-35.0	+35.0	-35.0	+35.0	-35.0		

4^u 47 3/4" +60.0 -60.3

+57.0 -57.0 +54.0 -54.0 +51.3 -51.3 +48.8 -48.8 XX +56.5 -56.5 +53.3 -53.3 +50.5 -50.5 +47.9 -47.9 +45.6 -45.6 51 3/4" XX +53.3 -53.3 +50.2 -50.2 +47.5 -47.5 +45.0 -45.0 +42.8 -42.8 55 3/4" 5⁰ 59 3/4" XX +50.5 -50.5 +47.5 -47.5 +44.9 -44.9 +42.6 -42.6 +40.5 -40.5

63 3/4" +44.3 -44.3 +44.3 -44.3 +42.7 -42.7 +40.4 -40.4 +39.3 -39.3 +39.3 -39.3 +39.3 -39.3 +38.6 -38.6 XX 67 3/4" XX 6° 71 3/4" +35.0 -35.0 +35.0 -35.0 +35.0 -35.0 +35.0 -35.0 +35.0 -35.0

TABLE 2:

DESIGN PRESSURES FOR <u>SIDE LITES</u> , ALL GLASS TYPES
REINFORCED (ITEM #22) DOOR TO SIDE LITE OR UNREINFORCED STAND-ALONE SIDE LITE

KEINI OKCEL	REINFORCED (ITEM #22) DOOR TO SIDE EITE OR BIRCHINI ORGED STAND-REGNE BIDE EITE										
SIDE LITE		SIDE LITE FRAME HEIGHT									
FRAME WIDTH	6 ⁸ - 7	9 3/4"	7 ⁰ - 8	3 3/4"	87	3/4"	91	3/4"	8 ⁰ - 9	5 3/4"	
10 3/4"	+75.0	-150.0	+75.0	-150.0	+75.0	-150.0	+75.0	-150.0	+75.0	-150.0	
12 3/4"	+75.0	-150.0	+75.0	-150.0	+75.0	-150.0	+75.0	-150.0	+75.0	-150.0	
19"	+75.0	-138.5	+75.0	-131.0	+75.0	-124.3	+75.0	-118.3	+75.0	-112.8	
21 3/4"	+75.0	-123.4	+75.0	-116.6	+75.0	-110.5	+75.0	-105.1	+75.0	-100.1	
27 3/4"	+75.0	-101.1	+75.0	-95.3	+75.0	-90.2	+75.0	-85.5	+75.0	-81.3	
36 1/8"	+67.3	-67.3	+67.3	-67.3	+67.3	-67.3	+67.3	-67.3	+65.9	-65.9	
36 3/4"	+65.0	-65.0	+65.0	-65.0	+65.0	-65.0	+65.0	-65.0	+65.0	-65.0	

TABLE 4:

TABLE 3:

DESIGN PRESSURES FOR <u>SIDE LITES</u> , ALL GLASS TYPES	
UNREINFCTOOD TO SIDE LITE	

Shan I. Chanle											
SIDE LITE FRAME	SIDE LITE FRAME HEIGHT										
WIDTH	6 ⁸ - 7	9 3/4"	7 ⁰ - 8	3 3/4"	87 3	3/4"	91 :	3/4"	8 ⁰ - 9	5 3/4"	
10 3/4"	+60.0	-120.0	+60.0	-118.1	+60.0	-112.4	+60.0	-107.2	+60.0	-102.4	
12 3/4"	+60.0	-106.4	+60.0	-100.9	+60.0	-95.9	+60.0	-91.4	+60.0	-87.3	
19"	+60.0	-74.6	+60.0	-70.5	+60.0	-66.9	+60.0	-63.7	+60.0	-60.7	
21 3/4"	+60.0	-66.4	+60.0	-62.8	+59.5	-59.5	+56.6	-56.6	+53.9	-53.9	
27 3/4"	+54.4	-54.4	+51.3	-51.3	+48.5	-48.5	+46.1	-46.1	+43.8	-43.8	
36 1/8"	+36.2	-36.2	+36.2	-36.2	+36.2	-36.2	+36.2	-36.2	+35.5	-35.5	
36 3/4"	+35.0	-35.0	+35.0	-35.0	+35.0	-35.0	+35.0	-35.0	+35.0	-35.0	

FOR MAX. SIZES OF COMBINED UNITS, SEE SHEETS 10-13.

FOR MAX. SIZES OF COMBINED UNITS, SEE SHEETS 10-13.

EXAMPLE 1, (USING TABLE 1): X UNIT WITH GLASS TYPE A. 32" WIDE X 90" HIGH SINGLE DOOR (SEE NOTE 9)

DOOR DESIGN PRESSURE = +75 / -75.1 PSF

EXAMPLE 2, USING TABLES 3 & 4): XO UNIT WITH GLASS TYPE B. UNREINFORCED. 36" WIDE X 84" HIGH SINGLE DOOR WITH 12" X 84" SIDE LITE (SEE NOTE 9)

DOOR DESIGN PRESSURE = +35 / -35 PSF SIDE LITE DESIGN PRESSURE = +60 / -95.9 PSF OVERALL DESIGN PRESSURE = +35 / -35 PSF

EXAMPLE 3. (USING TABLE 1): XX UNIT WITH GLASS TYPE A, 63-3/4" WIDE X 91-3/4" HIGH DOUBLE DOOR

DOOR DESIGN PRESSURE = +75 / -75.1 PSF

EXAMPLE 4, (USING TABLES 1 & 2): OXX UNIT WITH GLASS TYPE B, REINFORCED, 60" WIDE X 90" HIGH DOUBLE DOOR WITH 29" X 90" SIDE LITE (SEE NOTE 9)

DOOR DESIGN PRESSURE = +75 / -75.1 PSF SIDE LITE DESIGN PRESSURE = +67.3 / -67.3 PSF OVERALL DESIGN PRESSURE = +67.3 / -67.3 PSF

EXAMPLE 5, (USING TABLE 2): O UNIT WITH GLASS TYPE A, 24" WIDE X 80" HIGH (SEE NOTE 9)

SIDE LITE DESIGN PRESSURE = +75 / -95.3 PSF

+38.4 -38.4

+36.6 -36.6

EXAMPLE 6, (USING TABLES 1 & 2): OXXO UNIT WITH GLASS TYPE B, REINFORCED, 71-3/4" WIDE X 95-3/4" HIGH DOUBLE DOOR WITH (2) 36-3/4" X 95-3/4" SIDE LITES

DOOR DESIGN PRESSURE = +65 / -65 PSF SIDE LITE DESIGN PRESSURE = +65 / -65 PSF OVERALL DESIGN PRESSURE = +65 / -65 PSF

DOOR SIZES MUST BE VERIFIED FOR COMPLIANCE WITH EGRESS REQUIREMENTS PER CURRENT FLORIDA BUILDING CODE. APPLICABLE EGRESS REQUIREMENTS TO BE REVIEWED BY AUTHORITY HAVING JURISDICTION (AHJ).

NOTES FOR ALL CONFIGURATIONS:

- 1) FOR CONFIGURATIONS WHICH CONTAIN A SIDE LITE TO DOOR CONNECTION, (XO, OX, XXO, OXX, OXO, OXXO), THE LOWEST DESIGN PRESSURE SHALL PREVAIL.
- 2) FULL LENGTH REINFORCEMENT (ITEM 22 SHOWN IN SECTION E-E, SHEET 4), IS REQUIRED AT DOOR TO SIDE LITE CONNECTIONS, WHEN USING **TABLES 1 & 2.**
- 3) DOOR AND SIDE LITE COMBINATIONS FROM TABLES 3 AND 4 DO NOT REQUIRE REINFORCEMENT ITEM 22.
- 4) DESIGN PRESSURES UNDER 40 PSF ARE NOT APPLICABLE IN MIAMI-DADE COUNTY.
- 5) POSITIVE DESIGN PRESSURE IS LIMITED TO 60 PSF (WATER RESISTANCE 9.0 PSF) FOR NON-REINFORCED DOORS AND SIDE LITES IN TABLES 3 AND 4.
- 6) FOR DOOR-ONLY CONFIGURATIONS (X, XX), ONLY TABLE 1 IS APPLICABLE. REINFORCEMENT, PART #22, IS NOT REQUIRED.
- 7) FOR SINGLE, STAND-ALONE SIDE LITES (O), ONLY TABLE 2 IS APPLICABLE, REINFORCEMENT, PART #22, IS NOT REQUIRED
- 8) CONFIGURATIONS WHERE THE DOOR LOCKSTILE ABUTS A SIDELITE ARE NOT AVAILABLE WITH REINFORCEMENT.
- 9) FOR SIZES NOT SHOWN, ROUND UP TO THE NEXT AVAILABLE SIZE. (E.G. FOR 32" "X" DOOR WIDTH IN TABLE 1, USE 33-1/2")

PRODUCT RENEWED as complying with the Florida Building Code 22-0608.04 NOA-No.

Expiration Date 08/02/2027

Ishaq I. Chanda

Miami-Dade Product Control


PRODUCT REVISED as complying with the Florida Building Code 20-0427.02 NOA-No.


Expiration Date: 08/02/2022

Bv: Ishag 1. Chande


Miami-Dade Product Control


G) ADDED DESCRIPTION TO TABLE HEADERS. - AK - 04/15/20

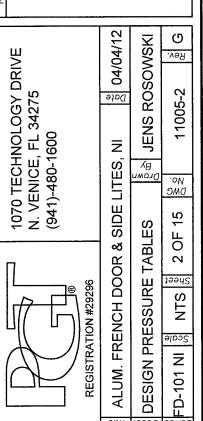






Series Desc. Title

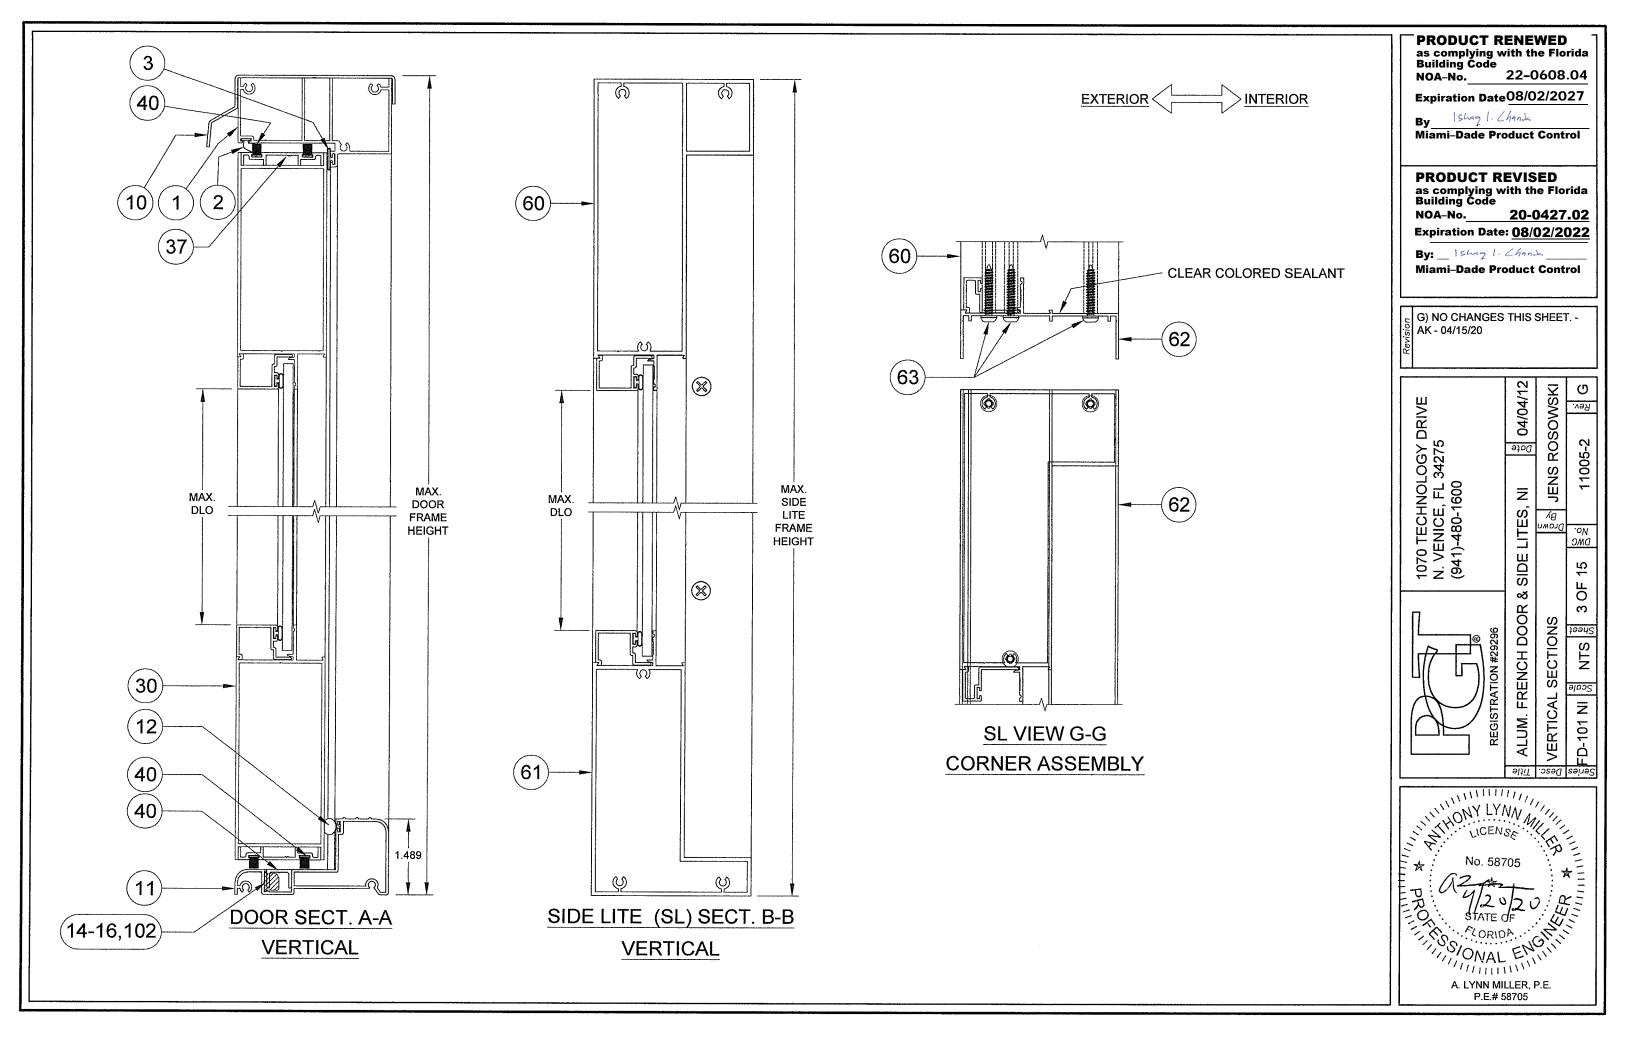

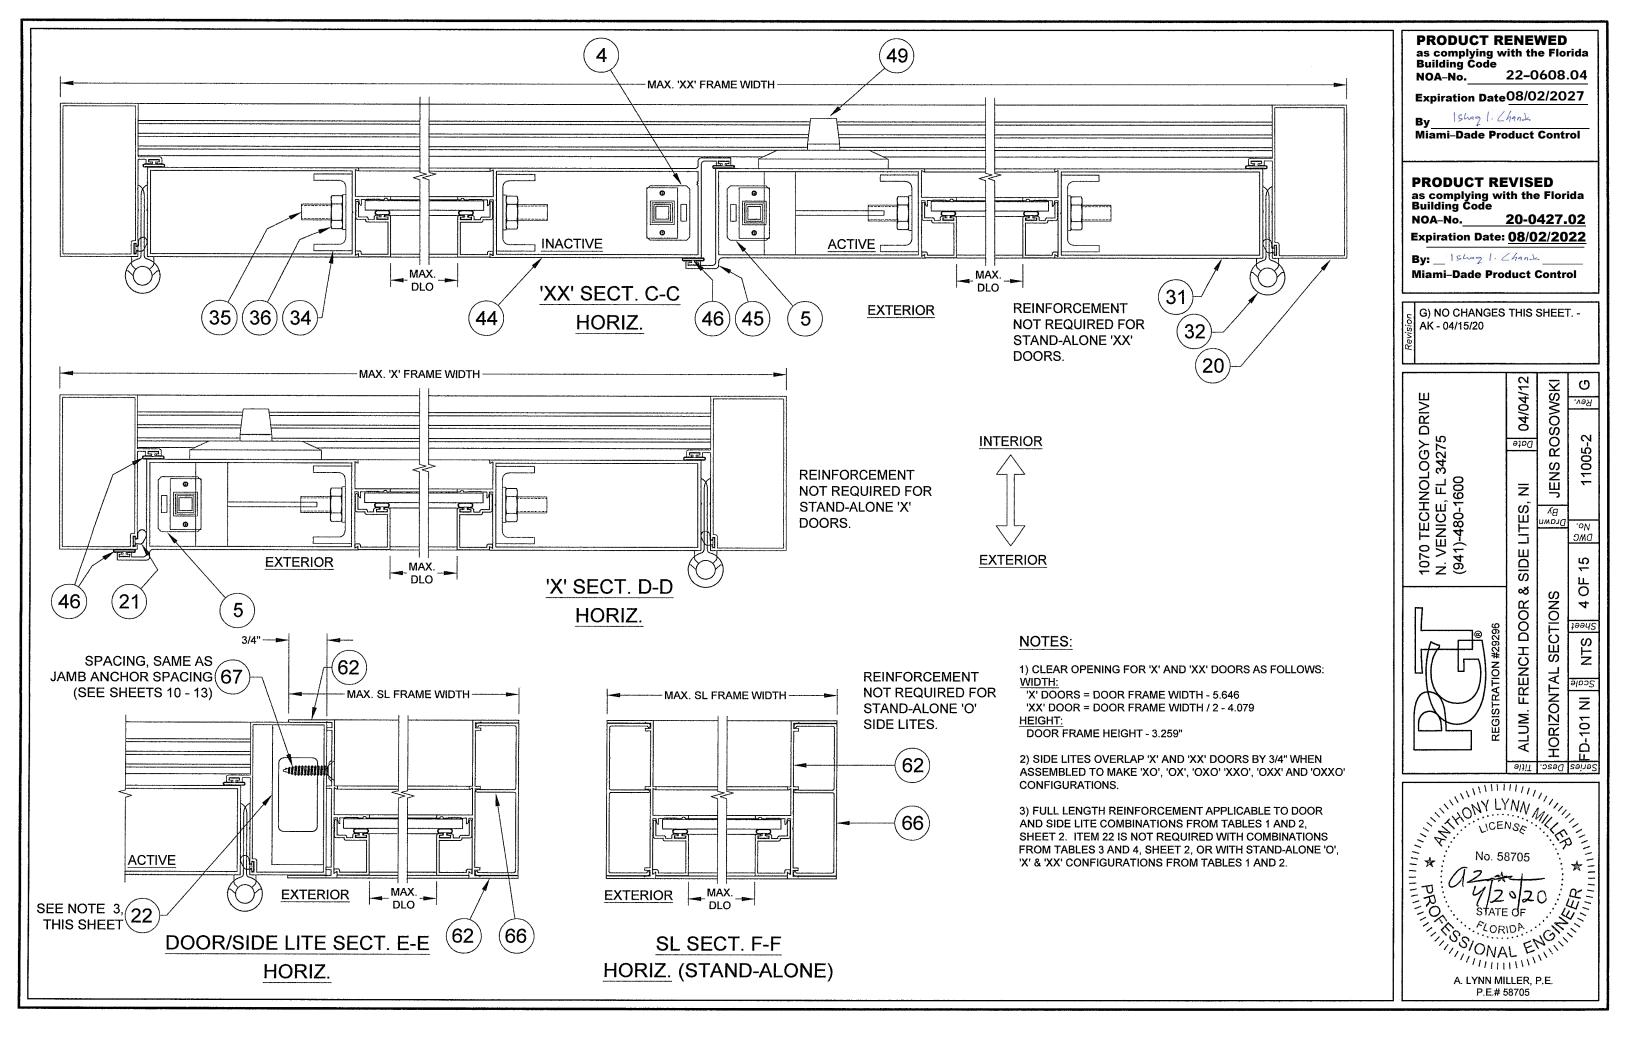

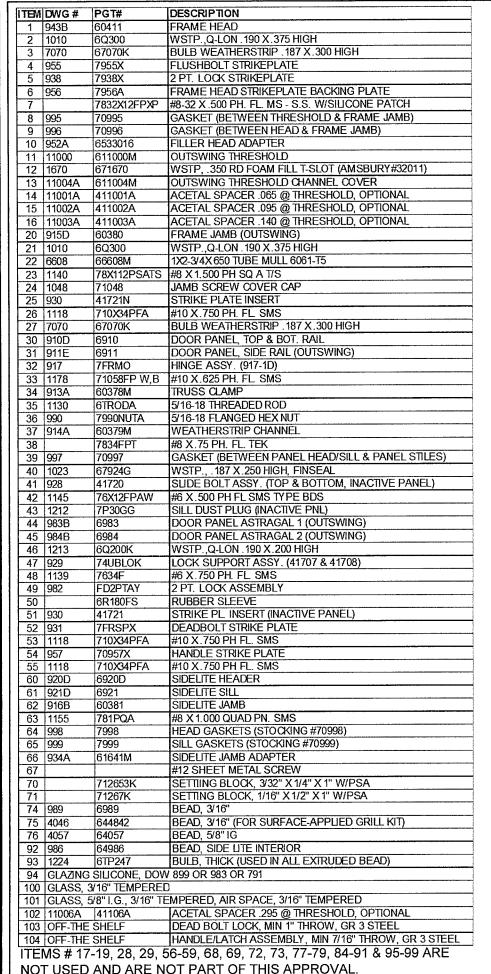

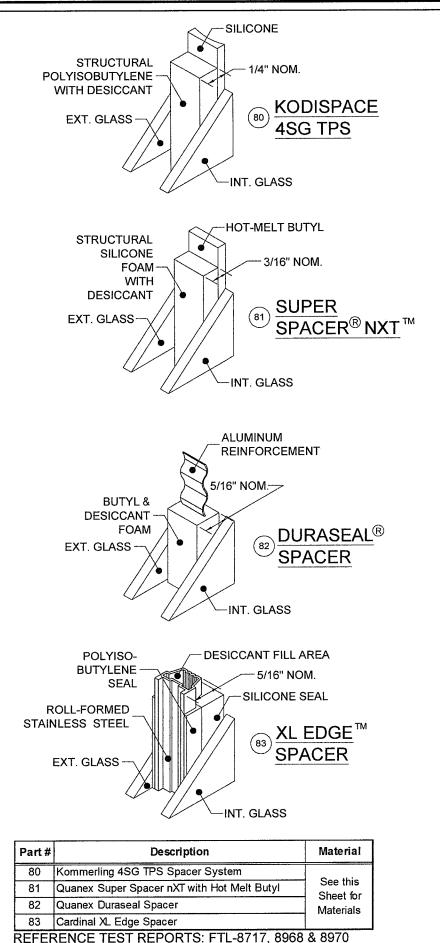

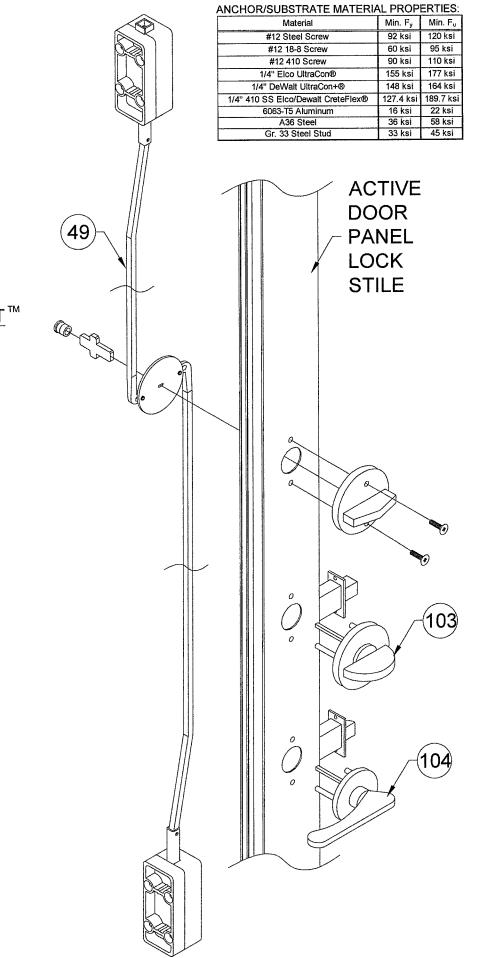

PRODUCT RENEWED as complying with the Florida Building Code 22-0608.04 NOA-No.

Expiration Date 08/02/2027

Ishaq 1. Chande

Miami-Dade Product Control

PRODUCT REVISED as complying with the Florida Building Code

NOA-No. 20-0427.02 Expiration Date: 08/02/2022

By: _ Ishaq 1. Chanda

Miami-Dade Product Control


G) ADDED BACKBEDDING. -AK - 04/15/20

04/04/12

Rev.

JENS ROSOWSKI 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 (941)-480-1600 11005-2 Z LITES, Drawn By SIDE BOM AND SPACER DETAILS P ∞ర ALUM. FRENCH DOOR S Zpeet NTS FD-101 NI

Date



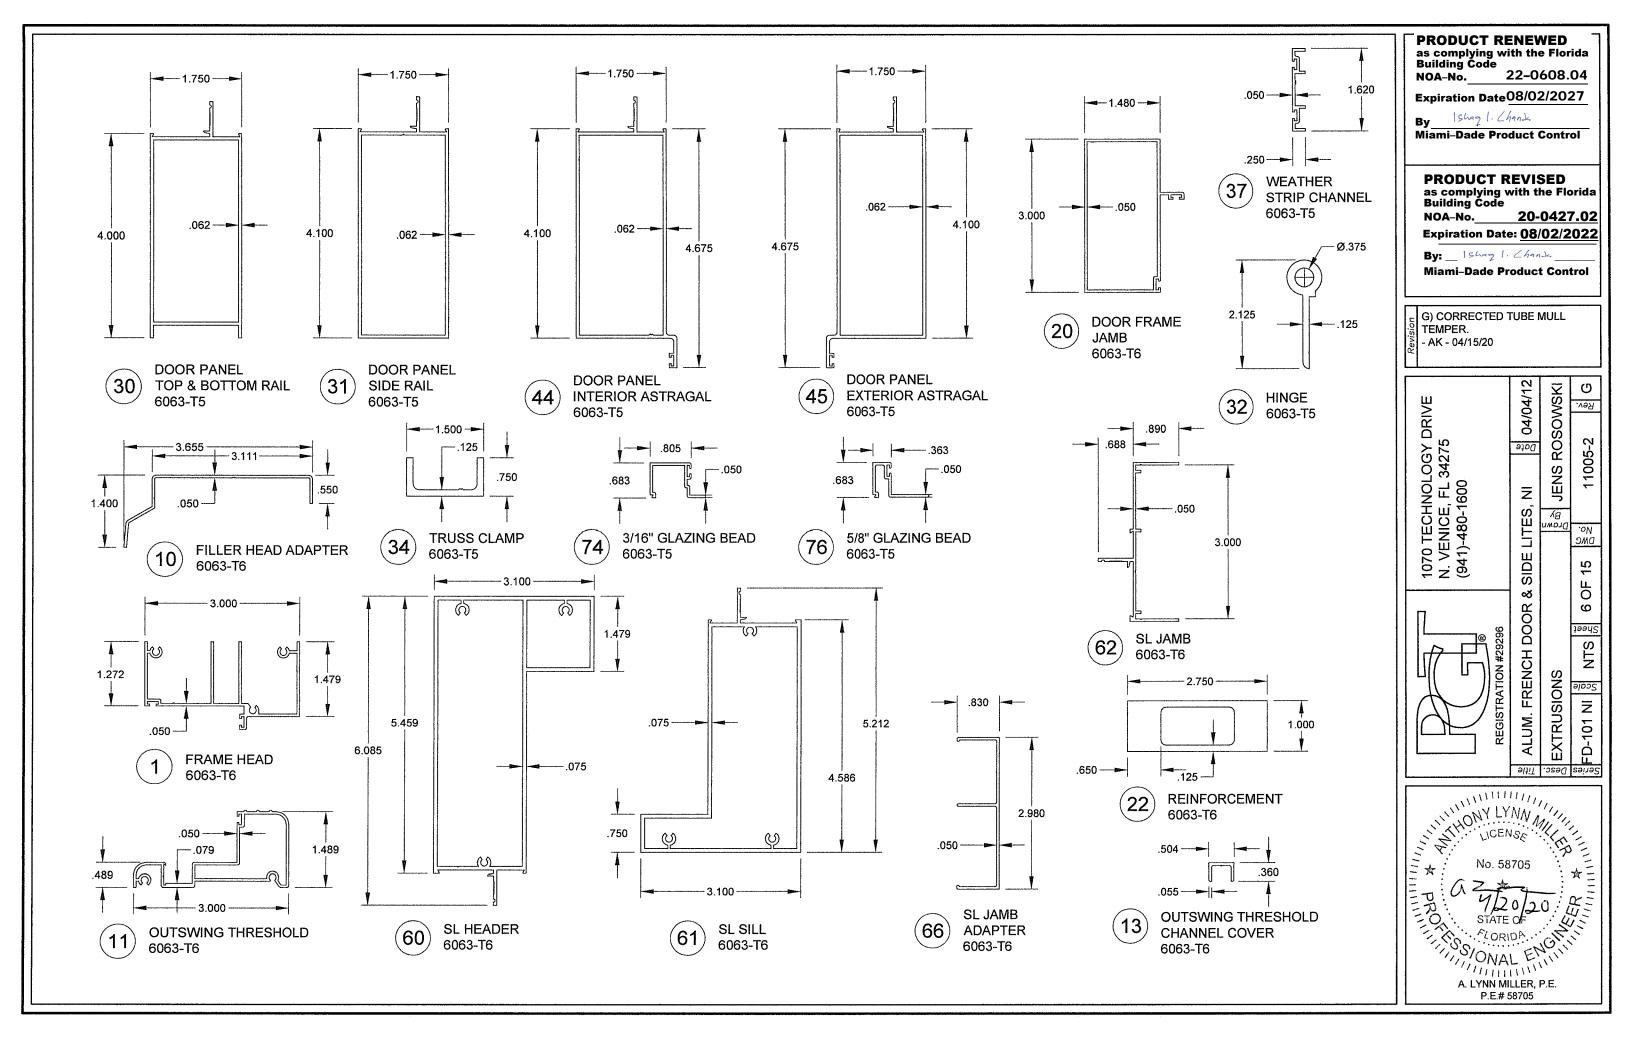


TABLE 5: X DOORS, GLASS TYPES A & B ANCHOR TYPE & 2,3, WOOD SUBSTRATE 3 ALUM CONCRETE LOAD ZONES SILL SILL MAX ⋖ర MAX. X - HEAD HEAD DOOR FRAME FRAME **HEIGHT WIDTH** 25.500 79.750 7 2 4 2 83.750 2 2 4 87.750 2 7 2 4 91.750 2 2 4 95.750 2 4 2 27.500 79.750 2 2 4 83.750 7 2 4 2 87.750 7 2 4 2 91.750 2 7 2 4 95.750 7 2 4 2 29.500 79.750 7 3 3 4 83.750 3 3 4 7 87.750 3 4 3 91.750 7 3 3 4 95.750 7 3 4 3

31.500

33.500

35.500

37.500

79.750

83,750

87.750

91.750

95.750

79.750

83.750

87.750

91.750

95.750

79.750

83.750

87.750

91.750

95.750

79.750

83.750

87.750

91.750

95.750

7

7

7

7

6

6

7

7

7

6

6

6

6

6

5

6

6

6

6

3

3

3

3

3

3

3

3

3

3

3

3

3

3

3

3

3

3

3

3

4

4

4

4

4

4

4

4

4

4

4

4

4

4

4

4

4

4

4

4

3

3

3

3

3

3

3

3

3

3

3

3

3

3

3

3


3

3

3

3

6" MAX.	20-7/8" MAX. O.C.			·····
D-D 4	84-3/8" MAX. DLO 24-9/16" MAX. DLO A-A 37-1/2" MAX. DOOR FRAME WIDTH	() () () () () () () () () ()	23-1/8" MAX. O.C. 40" (TYP.)	95-3/4" MAX. FRAME HEIGHT

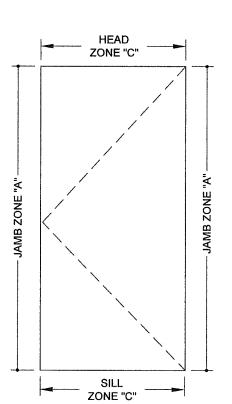

LOAD ZONES FOR SINGLE DOOR, X

NOTES:

1) SEE SHEET 1 FOR GLASS AND ANCHOR TYPE DESCRIPTIONS.

TYP. DIMENSIONS OF

SINGLE DOOR, X

- 2) DOORS MAY BE LEFT OR RIGHT-HANDED.
- 3) ANCHOR QUANTITIES ARE BASED ON SPACING AS FOLLOWS (4" MIN. O.C. FOR CONCRETE, 4" MIN. O.C. FOR CMU); JAMBS (ALL): 13-1/4" MAX. FROM CORNERS AND 23-1/8" MAX. O.C. HEAD & SILL OF DOORS: 6" MAX. FROM CORNERS, 9" MAX. FROM ASTRAGAL CENTERS AND 20-7/8" MAX. O.C.
- 4) FOR SIZES NOT SHOWN, ROUND UP TO THE NEXT AVAILABLE SIZE.
- 5) FOR ANCHORAGE INSTALLATION DETAILS SEE SHEET 14.

Design Pressure

See Sheet 2, Table 1

as complying with the Florida Building Code 22-0608.04 NOA-No.

PRODUCT RENEWED

Expiration Date 08/02/2027

Ishaq 1. Chank

Miami-Dade Product Control

PRODUCT REVISED as complying with the Florida Building Code

NOA-No. 20-0427.02

Expiration Date: 08/02/2022


By: _ Ishaq 1. Chande

Miami-Dade Product Control

G) NO CHANGES THIS SHEET. -AK - 04/15/20

04/04/12 Ö ROSOWSKI DRIVE Rev. 11005-2 Date JENS

Z

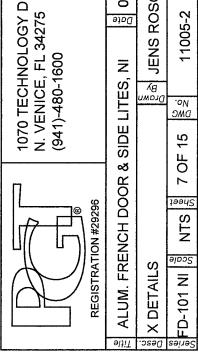






TABLE 6:		X DO	OPS							
	_			& R						
GLASS TYPES A & B ANCHOR TYPE & 2,3, WOOD 1,2,										
SL	CONC	CONCRETE								
LOAD ZONES										
MAX	MAX	/IB "A"	XX - HEAD & SILL "D"	//B "A"	XX - HEAD & SILL "D"					
DOOR FRAME WIDTH	FRAME HEIGHT	XX - JAMB "A"	XX - HE/	XX - JAMB "A"	XX - HE/					
47.750	79.750	6	5	4	3					
	83.750	6	4	4	3					
	87.750	6	4	4	3					
	91,750	6	4	4	3					
	95.750	6	4	4	3					
51.750	79.750	6	5	4	3					
	83.750	6	5	4	3					
	87.750	6	4	4	3					
	91.750	6	4	4	3					
	95.750	6	4	4	3					
55.750	79.750	6	5	4	3					
	83.750	6	5	4	3					
	87.750	6	5	4	3					
	91.750	6	5	4	3					
	95.750	6	4	4	3					
59.750	79.750	6	5	4	3					
	83.750	6	5	4	3					
	87.750	6	5	4	3					
	91.750	6	5	4	3					
	95.750	6	5	4	3					
63.750	79.750	6	5	4	3					
	83.750	6	5	4	3					
	87.750	6	5	4	3					
	91.750	(6)	(5)	4	3					
	95.750	6	5	4	3					
67.750	79.750	5	5	4	3					
	83.750	6	5	4	.3					
	87.750	6	5	4	3					
	91.750	6	5	4	3					
	95.750	6	5	4	3					
71.750	79.750	5	5	4	3					
	83.750	5	5	4	3					
	87.750	6	5	4	3					
	91.750	6	5	4	3					
l	95.750	6	5	4	3					

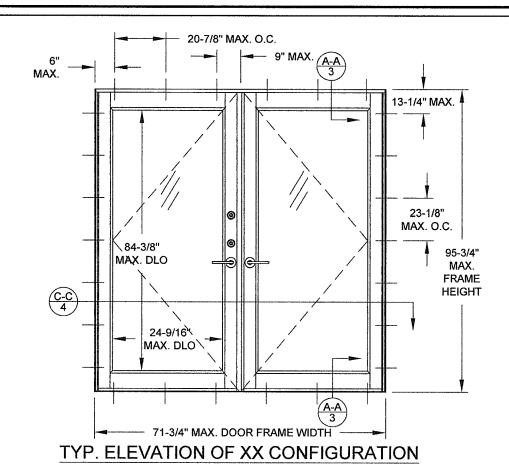

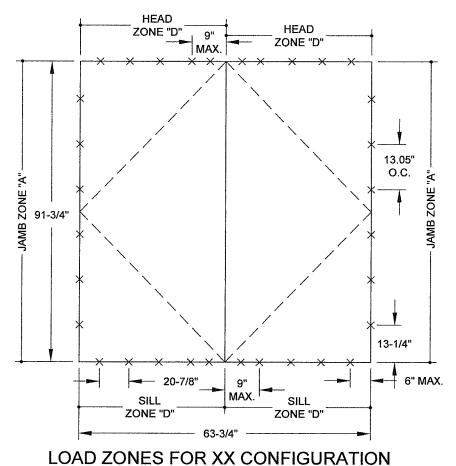

& ANCHORAGE LAYOUT USED IN EXAMPLE

Design Pressure

See Sheet 2, Table 1

NOTES:

- 1) SEE SHEET 1 FOR GLASS AND ANCHOR TYPE DESCRIPTIONS.
- 2) DOORS MAY BE LEFT OR RIGHT-HANDED
- 3) ANCHOR QUANTITIES ARE BASED ON SPACING AS FOLLOWS (4" MIN. O.C. FOR CONCRETE, 4" MIN. O.C. FOR CMU): JAMBS (ALL): 13-1/4" MAX. FROM CORNERS AND 23-1/8" MAX. O.C. HEAD & SILL OF DOORS: 6" MAX. FROM CORNERS, 9" MAX. FROM ASTRAGAL CENTERS AND 20-7/8" MAX. O.C.
- 4) FOR SIZES NOT SHOWN, ROUND UP TO THE NEXT AVAILABLE SIZE.
- 5) FOR ANCHORAGE DETAILS SEE SHEET 14.

EXAMPLE: XX WITH GLASS TYPE A, 63-3/4" WIDE X 91-3/4" HIGH DOUBLE DOOR. ANCHOR TYPE 3 INTO WOOD. DOOR DESIGN PRESSURE = +75 / -75.1 PSF. SEE EXAMPLE 3, SHEET 2 FOR DP EXAMPLE

DOOR ANCHOR REQUIREMENTS FROM TABLE 6: 6 ANCHORS @ EACH JAMB 5 ANCHORS EACH DOOR PANEL @ HEAD 5 ANCHORS EACH DOOR PANEL @ SILL

SEE CIRCLED VALUES ON TABLE 6.

 \times = DENOTES ANCHOR LOCATION.

PRODUCT RENEWED as complying with the Florida Building Code

22-0608.04 NOA-No.

Expiration Date 08/02/2027

Ishaq 1. Chands Miami-Dade Product Control

PRODUCT REVISED

as complying with the Florida Building Code 20-0427.02 NOA-No.


Expiration Date: <u>08/02/2022</u>

By: _ Ishaq 1. Chande

Miami-Dade Product Control

G) NO CHANGES THIS SHEET. -AK - 04/15/20

Ō

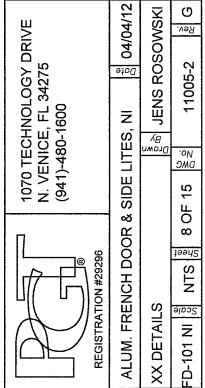






TABLE 7:

O SIDE LITE OLASS TYDES A 9

	HOR TYPE & SUBSTRATE		VOOD LUM	1, CONC	,2, RETE
				ZONES	
	:	3 "B"	S SILL "E"	3 "B"	S SILL "E"
MAX FRAME WIDTH	MAX FRAME HEIGHT	O - JAMB "B"	O - HEAD &	O - JAMB "B"	O - HEAD & SILL
10.750	79.750	4	2	4	2
10.,00	83.750	5	2	4	2
	87.750	5	2	4	2
	91.750	5	2	4	2
	95.750	5	2	4	2
12.750	79.750	5	2	4	2
	83.750	5	2	4	2
	87.750	5	2	4	2
	91.750	6	2	4	2
	95.750	6	2	4	2
19.000	79.750	6	2	4	2
	83.750	6	2	4	2
	87.750	6	2	4	2
	91.750	6	2	4	2
	95.750	6	2	4	2
21.750	79.750	6	2	4	2
	83.750	6	2	4	2
	87.750	6	2	4	2
	91.750	6	2	4	2
	95.750	6	2	4	2
27.750	79.750	6	2	4	2
	83.750	6	2	4	2
	87.750	6	2	4	2
	91.750	6	2	4	2
	95.750	6	2	4	2
36.125	79.750	5	3	4	3
	83.750	6	3	4	3
	87.750	6	3	4	3
	91.750	6	3	4	3
20.750	95.750	6	3	4	3
36.750	79.750	5	3	4	3
	83.750	5	3	4	3
	87.750	6	3	4	3
	91.750	6	3	4	3
	95.750	6	3	4	3

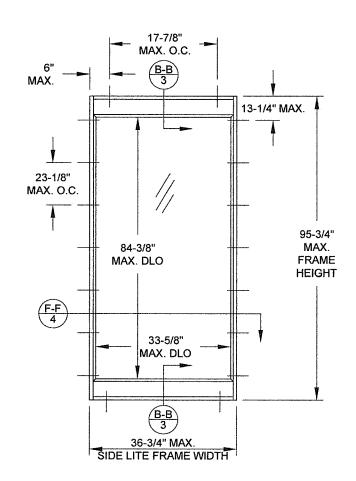

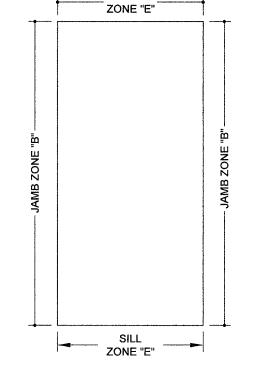

HEAD

TYP. ELEVATION OF SINGLE SIDELITE, O

LOAD ZONES FOR SINGLE SIDELITE, O

NOTES:

- 1) SEE SHEET 1 FOR GLASS AND ANCHOR TYPE DESCRIPTIONS.
- 2) ANCHOR QUANTITIES ARE BASED ON SPACING AS FOLLOWS (4" MIN. O.C. FOR CONCRETE, 4" MIN. O.C. FOR CMU): JAMBS (ALL): 13-1/4" MAX. FROM CORNERS AND 23-1/8" MAX. O.C. HEAD & SILL OF SIDE LITES: 6" MAX. FROM CORNERS AND 24-3/4" MAX. O.C.
- 3) FOR SIZES NOT SHOWN, ROUND UP TO THE NEXT AVAILABLE SIZE.
- 4) FOR ANCHORAGE INSTALLATION DETAILS SEE SHEET 15.

Design Pressure

See Sheet 2, Table 2

as complying with the Florida Building Code

22-0608.04 NOA-No. Expiration Date 08/02/2027

PRODUCT RENEWED

Ishaq I. Chands

Miami-Dade Product Control

PRODUCT REVISED as complying with the Florida Building Code


20-0427.02 NOA-No.


Expiration Date: <u>08/02/2022</u>


By: _ Ishaq 1. Chanda

Miami-Dade Product Control

G) NO CHANGES THIS SHEET. -AK - 04/15/20

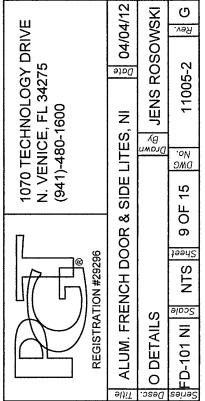



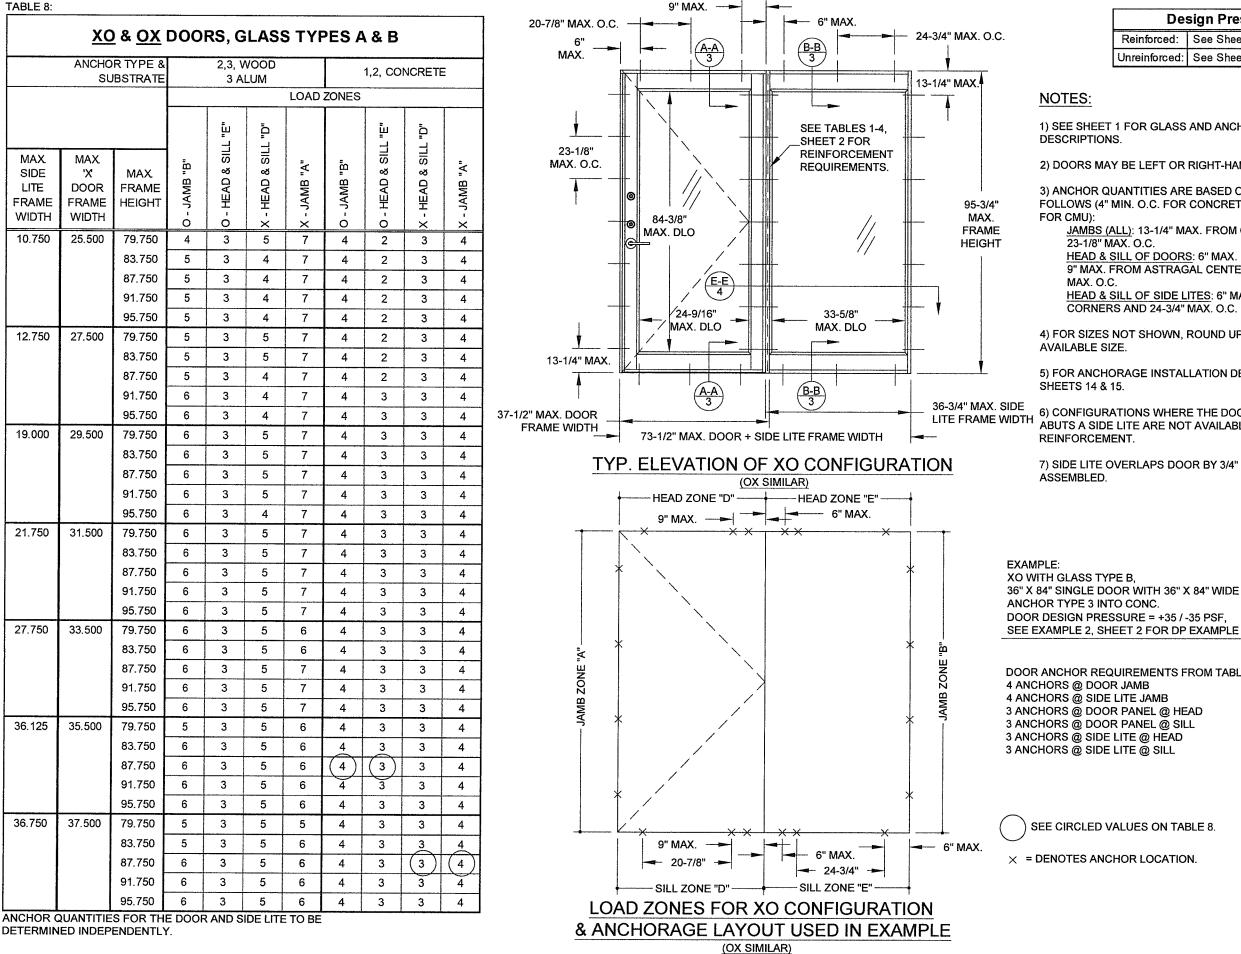

Design Pressure

See Sheet 2, Tables 1 & 2 Unreinforced: | See Sheet 2, Tables 3 & 4

- 1) SEE SHEET 1 FOR GLASS AND ANCHOR TYPE
- 2) DOORS MAY BE LEFT OR RIGHT-HANDED.
- 3) ANCHOR QUANTITIES ARE BASED ON SPACING AS FOLLOWS (4" MIN. O.C. FOR CONCRETE, 4" MIN. O.C.

JAMBS (ALL): 13-1/4" MAX. FROM CORNERS AND

HEAD & SILL OF DOORS: 6" MAX. FROM CORNERS, 9" MAX. FROM ASTRAGAL CENTERS AND 20-7/8"

HEAD & SILL OF SIDE LITES: 6" MAX. FROM CORNERS AND 24-3/4" MAX. O.C.

- 4) FOR SIZES NOT SHOWN, ROUND UP TO THE NEXT
- 5) FOR ANCHORAGE INSTALLATION DETAILS SEE
- 6) CONFIGURATIONS WHERE THE DOOR LOCKSTILE ABUTS A SIDE LITE ARE NOT AVAILABLE WITH
- 7) SIDE LITE OVERLAPS DOOR BY 3/4" ONCE

36" X 84" SINGLE DOOR WITH 36" X 84" WIDE SIDE LITE. DOOR DESIGN PRESSURE = +35 / -35 PSF,

DOOR ANCHOR REQUIREMENTS FROM TABLE 8:

- SEE CIRCLED VALUES ON TABLE 8.

PRODUCT RENEWED as complying with the Florida Building Code 22-0608.04 NOA-No.

Expiration Date 08/02/2027

Ishag 1. Chands

Miami-Dade Product Control


PRODUCT REVISED as complying with the Florida Building Code


NOA-No. 20-0427.02 **Expiration Date: 08/02/2022**


By: Ishaq 1. Chande


Miami-Dade Product Control

G) NO CHANGES THIS SHEET. AK - 04/15/20

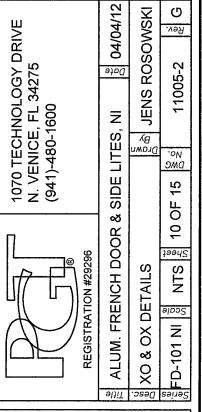



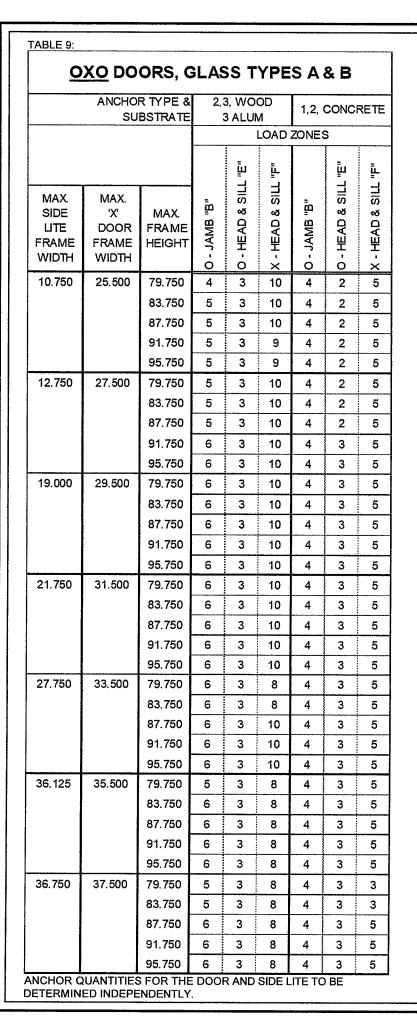

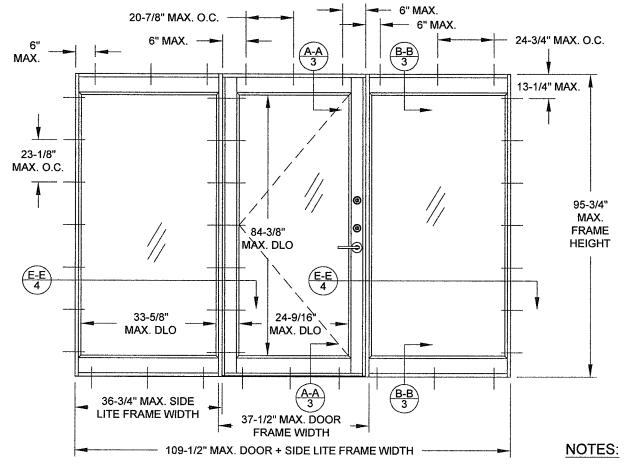

TYP. ELEVATION OF OXO CONFIGURATION

HEAD

ZONE "F"

SILL

ZONE "F"

LOAD ZONES FOR OXO CONFIGURATION

HEAD

ZONE "E"

SILL

ZONE "E"

(NOT AVAILABLE WITH REINFORCEMENT)

HEAD

ZONE "E"

SILL

ZONE "E"

Design Pressure Reinforced: N/A Unreinforced: See Sheet 2, Tables 3 & 4

- 1) SEE SHEET 1 FOR GLASS AND ANCHOR TYPE DESCRIPTIONS.
- 3) ANCHOR QUANTITIES ARE BASED ON SPACING AS FOLLOWS (4" MIN. O.C. FOR CONCRETE, 4" MIN. O.C. FOR CMU); JAMBS (ALL): 13-1/4" MAX. FROM CORNERS AND 23-1/8"

HEAD & SILL OF DOORS: 6" MAX. FROM CORNERS, 9" MAX. FROM ASTRAGAL CENTERS AND 20-7/8" MAX. O.C. HEAD & SILL OF SIDE LITES: 6" MAX. FROM CORNERS AND 24-3/4" MAX. O.C.

- SIDE LITE ARE NOT AVAILABLE WITH REINFORCEMENT.
- 7) SIDE LITE OVERLAPS DOOR BY 3/4" ONCE ASSEMBLED.

PRODUCT RENEWED as complying with the Florida Building Code 22-0608.04 NOA-No.

Expiration Date 08/02/2027

Ishaq I. Chands

Miami-Dade Product Control

PRODUCT REVISED as complying with the Florida Building Code


NOA-No. 20-0427.02 **Expiration Date: 08/02/2022**

By: _ Ishaq 1. Chande **Miami-Dade Product Control**

G) NO CHANGES THIS SHEET. -AK - 04/15/20

G

04/04/12 ROSOWSKI DRIVE Rev. 1070 TECHNOLOGY D N. VENICE, FL 34275 (941)-480-1600 11005-2 Date JENS Z LITES, VЯ MDJO .oN DMC SIDE 15 Р ૐ FRENCH DOOR Sheet NTS OXO DETAILS Z ALUM. FD-101



2) DOORS MAY BE LEFT OR RIGHT-HANDED


MAX, O.C.

4) FOR SIZES NOT SHOWN, ROUND UP TO THE NEXT AVAILABLE

- 5) FOR ANCHORAGE INSTALLATION DETAILS SEE SHEETS 14 & 15.
- 6) CONFIGURATIONS WHERE THE DOOR LOCKSTILE ABUTS A

ANCHOR	2,3, WOOD					1,2, CONCRETE						
				3 ALUM LOAD ZONES								
					SILL "E"	SILL "D"	ILL "F"				SILL "D"	SILL "F"
MAX SIDE LITE FRAME WIDTH	MAX 'XX' DOOR FRAME WIDTH	MAX FRAME HEIGHT	XX - JAMB "A"	O - JAMB "B"	O - HEAD & SII	XX - HEAD & S	XX - HEAD & SILL "F"	XX - JAMB "A"	O - JAMB "B"	O - HEAD & SILL "E"	XX - HEAD &	XX - HEAD &
10.750	47.750	79.750	6	4	3	5	8	4	4	2	3	5
		83,750	6	5	3	4	7	4	4	2	3	5
		87.750	6	5	3	4	7	4	4	2	3	5
		91.750	6	5	3	4	7	4	4	2	3	5
		95.750	6	5	3	4	7	4	4	2	3	5
19.000	51.750	79.750	6	5	3	5	8	4	4	2	3	5
		83.750	6	5	3	5	8	4	4	2	3	5
		87.750 91.750	6 6	5 6	3	4	7	4	4	3	3	5
		95.750	6	6	3	4	7	4	4	3	3	5
	55.750	79.750	6	6	3	5	8	4	4	3	3	5
	33.730	83.750	6	6	3	5	8	4	4	3	3	5
		87.750	6	6	3	5	8	4	4	3	3	5
		91.750	6	6	3	5	8	4	4	3	3	5
		95.750	6	6	3	4	7	4	4	3	3	5
21.750	59.750	79.750	6	6	3	5	8	4	4	3	3	5
		83.750	6	6	3	5	8	4	4	3	3	5
		87.750	6	6	3	5	8	4	4	3	3	5
		91.750	6	6	3	5	8	4	4	3	3	5
		95.750	6	6	3	5	8	4	4	3	3	5
27.750	63.750	79.750	6	6	3	5	8	4	4	3	3	5
		83.750	6	6	3	5	8	4	4	3	3	5
		87.750	6	6	3	5	8	4	4	3	3	5
		91.750	6	6	3	5	8	4	4	3	3	5
	67.750	95.750 79.750	6 5	6 5	3	5	8	4	4	3	3	3
36.125	67.750	83.750	6	6	3	5	8	4	4	3	3	5
		87.750	6	6	3	5	8	4	4	3	3	5
		91.750	6	6	3	5	8	4	4	3	3	5
		95.750	6	6	3	5	8	4	4	3	3	5
36.750	71.750	79.750	5	5	3	5	8	4	4	3	3	3
		83.750	5	5	3	5	8	4	4	3	3	3
		87.750	6	6	3	5	8	4	4	3	3	5
		91.750	6	6	3	5	8	4	4	3	3	5
		95.750	6	6	3	5	8	4	4	3	3	5

Design Pressure 9" MAX. Reinforced: See Sheet 2, Tables 1 & 2 7/8" MAX. O.C. 9" MAX. Unreinforced: See Sheet 2, Tables 3 & 4 9" MAX. 24-3/4" MAX. O.C. 6" MAX. $\frac{B-B}{3}$ (A-A)6" MAX. 23-1/8" 23-1/8" MAX. O.C. MAX. O.C. SEE TABLES 1-4, SHEET 2 FOR REINFORCEMENT 95-3/4" REQUIREMENTS. MAX. FRAME HEIGHT 84\3/8" MAX. DLO $\left(\begin{array}{c} E-E \\ 4 \end{array}\right)$ 24-9/16 33-5/8" MAX. DLO MAX. DLO $\begin{pmatrix} A-A \\ 3 \end{pmatrix}$ $\frac{B-B}{3}$ 36-3/4" MAX. 71-3/4" MAX. DOOR FRAME WIDTH -SIDE LITE FRAME WIDTH 107-3/4" MAX. DOOR + SIDE LITE FRAME WIDTH TYP. ELEVATION OF XXO CONFIGURATION NOTES: (OXX SIMILAR)

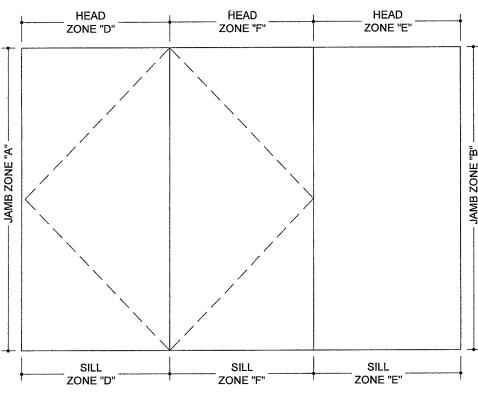

- 1) SEE SHEET 1 FOR GLASS AND ANCHOR TYPE DESCRIPTIONS.
- 2) DOORS MAY BE LEFT OR RIGHT-HANDED.
- 3) ANCHOR QUANTITIES ARE BASED ON SPACING AS FOLLOWS (4" MIN. O.C. FOR CONCRETE, 4" MIN. O.C. FOR CMU):

JAMBS (ALL): 13-1/4" MAX. FROM CORNERS AND 23-1/8" MAX. O.C. HEAD & SILL OF DOORS: 6" MAX. FROM CORNERS, 9" MAX. FROM ASTRAGAL CENTERS AND 20-7/8" MAX. O.C. HEAD & SILL OF SIDE LITES: 6" MAX. FROM CORNERS AND 24-3/4" MAX. O.C.

- 4) FOR SIZES NOT SHOWN, ROUND UP TO THE NEXT AVAILABLE SIZE.
- 5) FOR ANCHORAGE INSTALLATION DETAILS SEE SHEETS 14 & 15.
- 6) CONFIGURATIONS WHERE THE DOOR LOCKSTILE ABUTS A SIDE LITE ARE NOT AVAILABLE WITH REINFORCEMENT.
- 7) SIDE LITE OVERLAPS DOOR BY 3/4" ONCE ASSEMBLED.

PRODUCT RENEWED
as complying with the Florida
Building Code
NOA-No. 22-0608.04

Expiration Date 08/02/2027

by Ishaq I. Chands

Miami-Dade Product Control

PRODUCT REVISED

as complying with the Florida Building Code
NOA-No. 20-0427.02


Expiration Date: 08/02/2022

By: _ Ishaq 1. Chanda

Miami-Dade Product Control

G) CORRECTED JAMB A QUANTITIES IN TABLE 10. - AK - 04/15/20


04/04/12 ROSOWSKI G Rev. 1070 TECHNOLOGY D N. VENICE, FL 34275 (941)-480-1600 11005-2 Date JENSI Ī LITES, Drawn By No. SIDE OF ⋖ ALUM. FRENCH DOOR DETAILS XXO FD-101 NI ంర 0XX




eries Desc. Title

LOAD ZONES FOR XXO CONFIGURATION

(OXX SIMILAR)

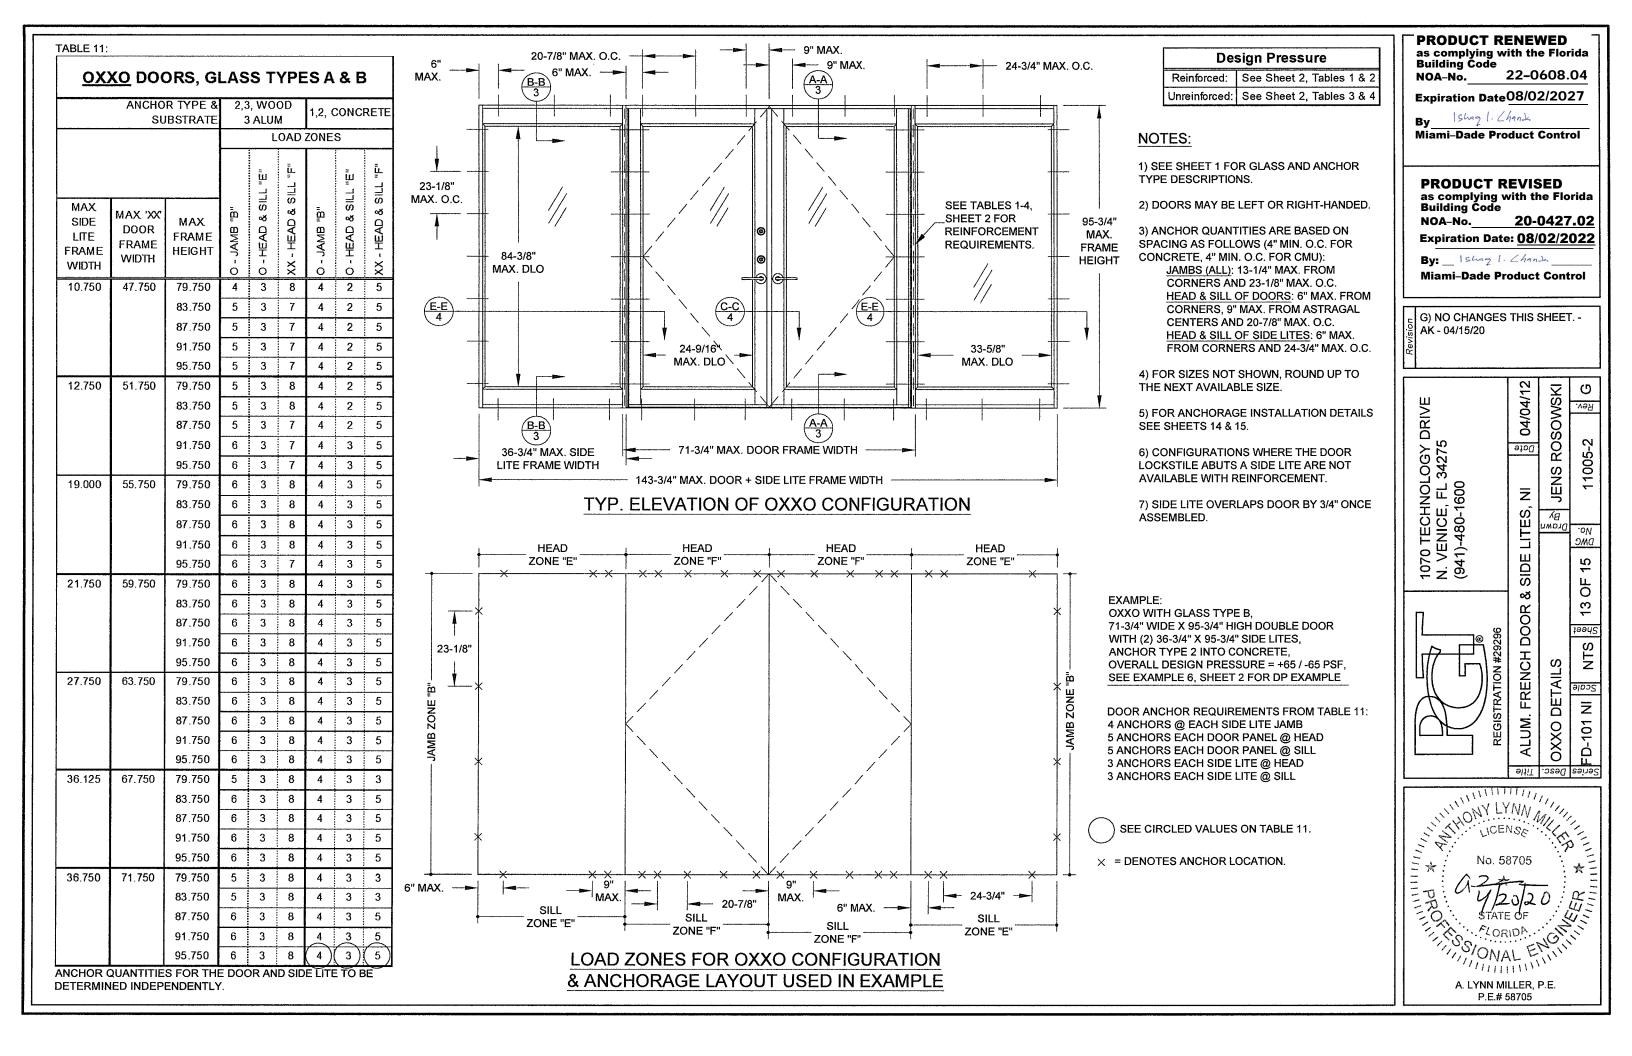

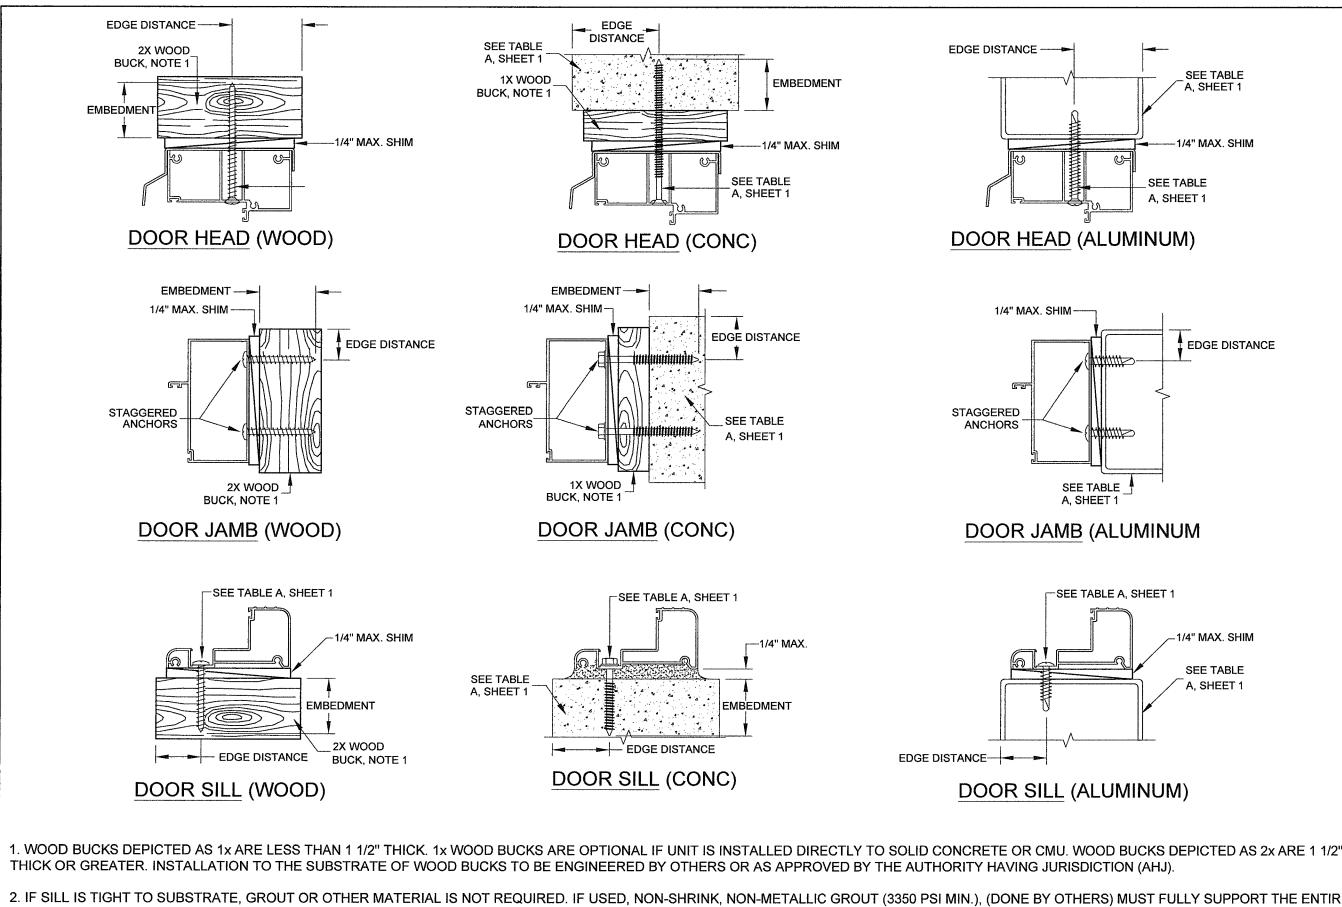

PRODUCT RENEWED as complying with the Florida Building Code 22-0608.04 NOA-No. Expiration Date 08/02/2027

Ishaq I. Chank Miami-Dade Product Control

PRODUCT REVISED as complying with the Florida Building Code

20-0427.02

Expiration Date: 08/02/2022

By: _ Ishaq 1. Chanda **Miami-Dade Product Control**


G) NO CHANGES THIS SHEET. -AK - 04/15/20

04/04/12

G

Rev.

JENS ROSOWSKI DRIVE 1070 TECHNOLOGY D N. VENICE, FL 34275 (941)-480-1600 11005-2 Date Ī SIDE LITES, סרמאר By DWG 14 OF 15 DETAILS ALUM. FRENCH DOOR Sheet NTS DOOR INSTALL Z FD-101




EXTERIOR INTERIOR

(ALL HEAD & SILL SECTIONS)


eries Desc. Title


2. IF SILL IS TIGHT TO SUBSTRATE, GROUT OR OTHER MATERIAL IS NOT REQUIRED. IF USED, NON-SHRINK, NON-METALLIC GROUT (3350 PSI MIN.), (DONE BY OTHERS) MUST FULLY SUPPORT THE ENTIRE LENGTH OF THE SILL THAT IS NOT TIGHT TO THE SUBSTRATE, AND TRANSFER SHEAR LOAD TO SUBSTRATE. IF SUBSTRATE IS WOOD, 30# FELT PAPER OR MASTIC IS REQUIRED BETWEEN THE GROUT AND WOOD SUBSTRATE, OR AS APPROVED BY THE AUTHORITY HAVING JURISDICTION.

3. TYP. ANCHOR TYPE, EMBEDMENT & EDGE DISTANCE PER SUBSTRATE, SEE TABLE A, SHEET 1...

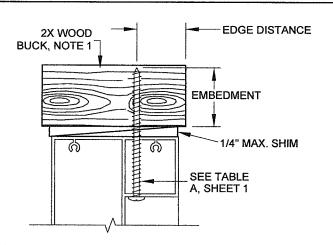


SIDE LITE HEAD (WOOD)

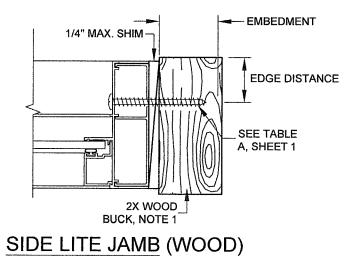

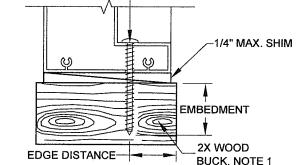


SEE TABLE A, SHEET 1


SIDE LITE SILL (WOOD)

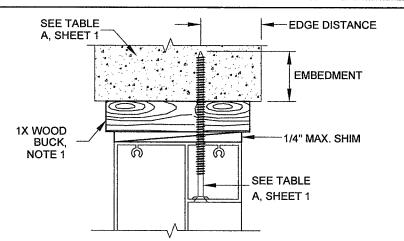


SIDE LITE HEAD (CONC)

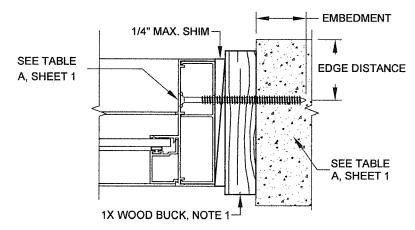


SIDE LITE JAMB (CONC)

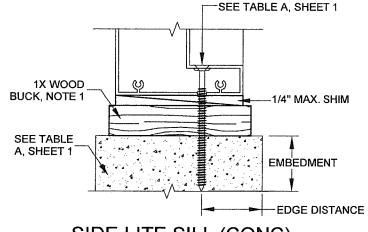


SIDE LITE SILL (CONC)

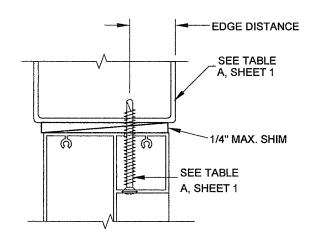

SIDE LITE HEAD (ALUMINUM)

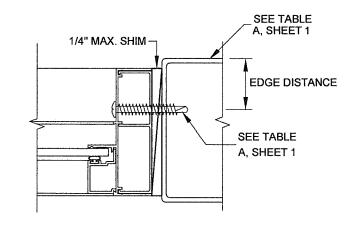

SIDE LITE JAMB (ALUMINUM)

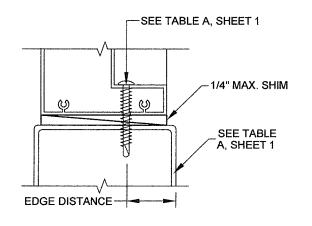

EXTERIOR INTERIOR

(ALL HEAD & SILL SECTIONS)

SIDE LITE SILL (ALUMINUM)

- 1. WOOD BUCKS DEPICTED AS 1x ARE LESS THAN 1 1/2" THICK. 1x WOOD BUCKS ARE OPTIONAL IF UNIT IS INSTALLED DIRECTLY TO SOLID CONCRETE OR CMU. WOOD BUCKS DEPICTED AS 2x ARE 1 1/2" THICK OR GREATER. INSTALLATION TO THE SUBSTRATE OF WOOD BUCKS TO BE ENGINEERED BY OTHERS OR AS APPROVED BY THE AUTHORITY HAVING JURISDICTION (AHJ).
- 2. IF SILL IS TIGHT TO SUBSTRATE, GROUT OR OTHER MATERIAL IS NOT REQUIRED. IF USED, NON-SHRINK, NON-METALLIC GROUT (3350 PSI MIN.), (DONE BY OTHERS) MUST FULLY SUPPORT THE ENTIRE LENGTH OF THE SILL THAT IS NOT TIGHT TO THE SUBSTRATE, AND TRANSFER SHEAR LOAD TO SUBSTRATE. IF SUBSTRATE IS WOOD, 30# FELT PAPER OR MASTIC IS REQUIRED BETWEEN THE GROUT AND WOOD SUBSTRATE, OR AS APPROVED BY THE AUTHORITY HAVING JURISDICTION.
- 3. TYP. ANCHOR TYPE, EMBEDMENT & EDGE DISTANCE PER SUBSTRATE, SEE TABLE A, SHEET 1..

PRODUCT RENEWED as complying with the Florida Building Code 22-0608.04 NOA-No.

Expiration Date 08/02/2027

Ishaq I. Chank Miami-Dade Product Control

PRODUCT REVISED as complying with the Florida Building Code

20-0427.02

Expiration Date: 08/02/2022

Miami-Dade Product Control

G) NO CHANGES THIS SHEET. -AK - 04/15/20

