



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

Clopay Corporation
8585 Duke Boulevard
Mason, OH 45040

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Custom Reserve EPS Insulated W8 DP47 Wood Sectional Garage Door up to 9’-0” Wide w/ Optional Impact Resistant Lites

APPROVAL DOCUMENT: Drawing No. **104939**, titled “Custom Reserve Wood Door up to 9’0” Wide”, sheet 1 thru 4 of 4, dated 10/10/2017, with revision 02 dated 07/13/2023, prepared by Clopay Corporation, signed and sealed by Mark Westerfield, P.E., bearing the Miami-Dade County Product Control revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: A permanent label with the manufacturer’s name or logo, manufacturing address, model number, the positive and negative design pressure rating, indicate impact rated if applicable, installation instruction drawing reference number, approval number (NOA), the applicable test standards, and the statement reading ‘Miami-Dade County Product Control Approved’ is to be located on the door’s side track, bottom angle, or inner surface of a panel.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **renews** and **revises** **NOA # 20-0922.22** and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Carlos M. Utrera, P.E.**



NOA-No. 23-0726.03
Expiration Date: August 23, 2028
Approval Date: September 14, 2023
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA # 17-1020.07

A. DRAWINGS

1. Drawing No. **104939**, titled “Custom Reserve Wood Door up to 9’0” Wide”, sheet 1 thru 4 of 4, dated 10/10/2017, with revision 01 dated 01/22/2018, prepared by Clopay Building Products Company, signed and sealed by Mark Westerfield, P.E. on 07/25/2018.

B. TESTS

1. Test reports on 1) Uniform Static Air Pressure Test, Loading per FBC, TAS 202
2) Large Missile Impact Test per FBC, TAS 201
3) Cyclic Wind Pressure Loading per FBC, TAS 203
4) Forced Entry Test per FBC, TAS 202-94
along with marked-up drawings and installation diagram of Clopay 9’ x 7’ Wood Garage Door, Model CRD1CC, prepared by American Testing Lab, Inc., Test Report No. **ATLNC 0123.01-14**, dated 09/03/2014, signed and sealed by David W. Johnson, P.E.

C. CALCULATIONS

1. Anchoring calculations prepared by Clopay Building Products Company, dated 10/10/2017, signed and sealed by Mark Westerfield, P.E.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS

1. Test report on Surface Burning Characteristics (Flame Spread and Smoke Developed indexes) per ASTM E84 of 2” thick C578 Type I Flint Hills Resources 5654 Resin EPS Foam samples, issued to Atlas Roofing Corp., prepared by UL LLC, Test Report No. **R6705/4788441837**, dated 06/06/2018, signed and sealed by Karen Foxx-Smith and James Smith.
2. Test report on Self-Ignition Temperature of Atlas EPS per ASTM D 1929-16, Test Report No. **102609488MID-002**, prepared by Intertek, dated 06/13/2016, signed and sealed by Frederick D. Curkeet, P.E.
3. Notice of acceptance issued to Eastman Chemical Company for its Saflex Clear and Color Glass Interlayer, NOA #17-0712.05 issued on 09/07/2017 and expires on 05/21/2021.

F. STATEMENTS

1. Statement letter of code conformance to the 6th edition (2017) FBC issued by Clopay Building Products Company, dated 10/10/2017, signed and sealed by Mark Westerfield, P.E.
2. Statement letter of no financial interest issued by Clopay Building Products Company, dated 10/10/2017, signed and sealed by Mark Westerfield, P.E.



Carlos M. Utrera, P.E.
Product Control Examiner
NOA-No. 23-0726.03
Expiration Date: August 23, 2028
Approval Date: September 14, 2023

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

2. EVIDENCE SUBMITTED UNDER NOA # 20-0922.22 AND NEW

A. DRAWINGS

1. Drawing No. **104939**, titled “Custom Reserve Wood Door up to 9’0” Wide”, sheet 1 thru 4 of 4, dated 10/10/2017, with revision 02 dated 07/13/2023, prepared by Clopay Corporation, signed and sealed by Mark Westerfield, P.E.

B. TESTS

1. None.

C. CALCULATIONS

1. None.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS

1. None.

F. STATEMENTS

1. Statement letter of code conformance to 8th Edition (2023) of the FBC, issued by Clopay Corporation, dated 07/14/2023, signed and sealed by Mark Westerfield, P.E.
2. Statement letter of no financial interest, issued by Clopay Corporation, dated 07/14/2023, signed and sealed by Mark Westerfield, P.E.
3. Statement letters of code conformance to 6th Edition (2017) and 7th Edition (2020) of the FBC, issued by Clopay Corporation, dated 09/10/2020, signed and sealed by Mark Westerfield, P.E.
4. Certificate of amendment changing the company name from Clopay Building Products Company, Inc. to Clopay Corporation, issued by the State of Delaware, dated 08/27/2019.




Carlos M. Utrera, P.E.
Product Control Examiner
NOA-No. 23-0726.03
Expiration Date: August 23, 2028
Approval Date: September 14, 2023

CUSTOM RESERVE COLLECTION
 CUSTOM MODELS CR800, MR800, CH900, CRDnnn.
 NOTE THAT "nnn" REPRESENTS THE ARRANGEMENT
 OF THE DECORATIVE CLADDING AND OVERLAYS.

SHEET:
 1 OF 4

REVISIONS					
REV. NO.	ZONE:	DATE:	ECN NO.	APPVD:	DESCRIPTION
00	-	10/10/17	-	MWW	INITIAL RELEASE
01		1/22/18		MWW	REVISIONS BASED ON MIAMI-DADE REVIEW
02		7/13/23		MWW	REVISED TO INDICATE COMPLIANCE WITH 8E FBC.

OPTIONAL IMPACT RESISTANT
 LITES. SEE SECTION B-B ON
 SHEET 2 FOR DETAILS.

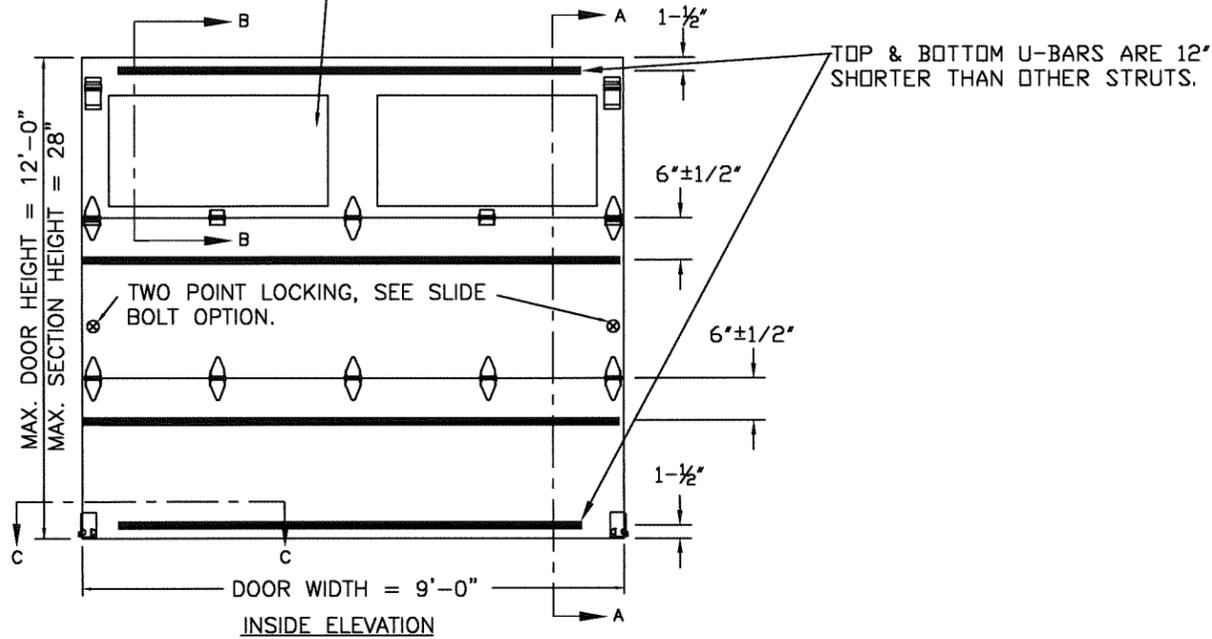



TOP & BOTTOM U-BARS ARE 12"
 SHORTER THAN OTHER STRUTS.

TWO POINT LOCKING, SEE SLIDE
 BOLT OPTION.

U-BAR NOTE: MOUNT (2) 1/4" x 1" LAG
 SCREWS AT EACH END AND CENTER HINGE
 LOCATIONS WHEN MOUNTING U-BARS. DRILL
 (2) 9/32" CLEARANCE HOLES IN U-BAR FOR
 MOUNTING IF HOLES DO NOT EXIST IN U-BAR.
 DRILL 3/16" PILOT HOLES IN WOOD FOR
 MOUNTING 1/4" LAG SCREWS.


NOTE: WHEN INSTALLING LAG SCREWS, DRILL
 3/16" PILOT HOLES IN ALL LOCATIONS THAT
 DO NOT CONTAIN PRE-DRILLED HOLES.

PRODUCT REVISED
 as complying with the Florida
 Building Code
 NOA-No. 23-0726.03
 Expiration Date 08/23/2028
 By *[Signature]*
 Miami-Dade Product Control

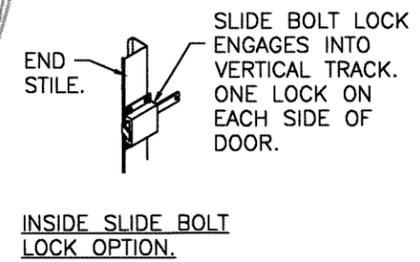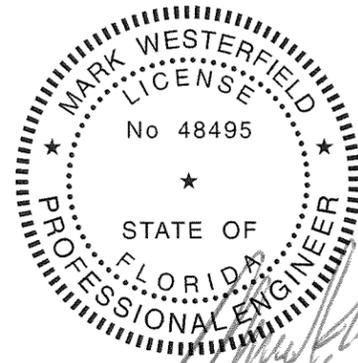


SLIDE BOLT LOCK
 ENGAGES INTO
 VERTICAL TRACK.
 ONE LOCK ON
 EACH SIDE OF
 DOOR.

INSIDE SLIDE BOLT
 LOCK OPTION.



14 GA. END HINGE
 (4) 1/4"x 1" LAG SCREWS
 PER END HINGE.



14 GA. CENTER HINGE
 (4) 1/4"x 1" LAG SCREWS



14 GA. WINDOW HALF HINGE
 (4) 1/4"x 1" LAG SCREWS

THIS PRODUCT CONFORMS
 TO THE REQUIREMENTS OF
 6TH 7TH AND 8TH EDITION
 OF THE FLORIDA BUILDING
 CODE.

DESIGN LOADS: +47.0 PSF & -55.0 PSF

Unless Stated Otherwise
 TOLERANCES are
 .0 = ±.031
 .00 = ±.015
 .000 = ±.005
 .0000 = ±.001
 Degrees = ±1/2'
 Unless Stated Otherwise
 DIMENSIONS ARE IN INCHES.

Clopay
 Building Products Company
 8585 Duke Boulevard
 Mason, OH 45040 USA
 Tel. No. 513-770-4800
 Fax No. 513-770-4853

MANUFACTURING PRODUCT CODE
 W-1G899

PART NO.: N/A

WINDLOAD RATING
 W8 DP47

DESCRIPTION: CUSTOM RESERVE WOOD DOOR UP TO 9'0" WIDE			
DRAWN BY: SH	DATE: 8/28/15	SCALE: NTS	DWG. SIZE B
CHECKED BY: MWW	DATE: 10/10/17	SHEET 1 OF 4	
DWG. NO.: 104939		VER: M-D	

DESIGN ENGINEER:
 MARK WESTERFIELD, P.E.
 FLORIDA LICENSE No. 48495


CUSTOM RESERVE COLLECTION
 CUSTOM MODELS CR800, MR800, CH900, CRDnnn.
 NOTE THAT "nnn" REPRESENTS THE ARRANGEMENT
 OF THE DECORATIVE CLADDING AND OVERLAYS.

SHEET:
 2 OF 4

REVISIONS					
REV. NO.	ZONE:	DATE:	ECN NO.	APPVD:	DESCRIPTION
--	-	-	-	-	SEE REVISION HISTORY ON SHEET ONE.


IMPACT-RESISTANT CONSTRUCTION:
 SOLID DOORS (NO GLAZING) OR DOORS WITH OPTIONAL IMPACT-RESISTANT GLAZING ARE IMPACT-RESISTANT. THE ENTIRE DOOR ASSEMBLY INSTALLED IN COMPLIANCE WITH THIS SECTION MEETS THE WIND LOAD REQUIREMENTS OF THE FLORIDA BUILDING CODE AND INTERNATIONAL BUILDING CODE AND IS LARGE- AND SMALL-MISSILE IMPACT RESISTANT.

SECTION B-B (IMPACT-RESISTANT GLAZING OPTION)

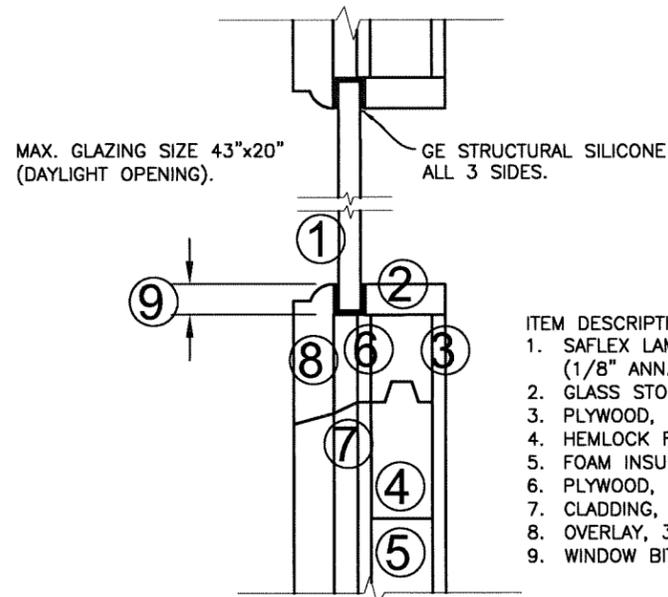

- ITEM DESCRIPTIONS AND NOMINAL DIMENSIONS
1. SAFLEX LAMINATED SAFETY GLASS, 3/8" (1/8" ANN. - 090" PVB - 1/8" ANN.)
 2. GLASS STOP, 16/32"
 3. PLYWOOD, 1/4"
 4. HEMLOCK FRAME, 1-1/8"
 5. FOAM INSULATION, 1-1/8"
 6. PLYWOOD, 1/4"
 7. CLADDING, 7/16"
 8. OVERLAY, 3/4"
 9. WINDOW BITE, 7/16"

PRODUCT REVISED
 as complying with the Florida Building Code
 NOA-No. 23-0726.03
 Expiration Date 08/23/2028
 By *[Signature]*
 Miami-Dade Product Control

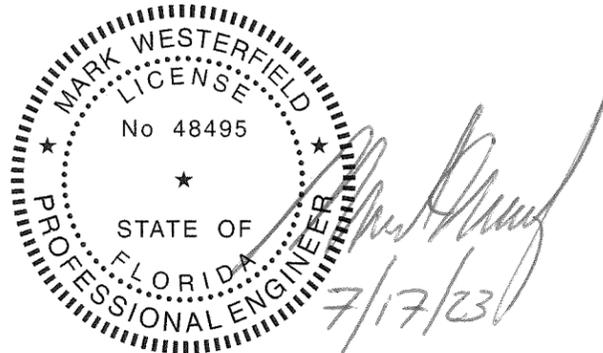

DESIGN ENGINEER:
 MARK WESTERFIELD, P.E.
 FLORIDA LICENSE No. 48495

DESIGN LOADS: +47.0 PSF & -55.0 PSF

Unless Stated Otherwise TOLERANCES are

.0	= ±.031
.00	= ±.015
.000	= ±.005
.0000	= ±.001
Degrees	= ±1/2'

Unless Stated Otherwise DIMENSIONS ARE IN INCHES.

Clopay Building Products Company	8585 Duke Boulevard Mason, OH 45040 USA Tel. No. 513-770-4800 Fax No. 513-770-4853		MANUFACTURING PRODUCT CODE W-1G899
	DESCRIPTION: CUSTOM RESERVE WOOD DOOR UP TO 9'0" WIDE		PART NO.: N/A
DRAWN BY: SH	DATE: 8/28/15	SCALE: NTS	WINDLOAD RATING W8 DP47
CHECKED BY: MWW	DATE: 10/10/17	SHEET 2 OF 4	DWG. B
DWG. NO.: 104939		VER: M-D	

CUSTOM RESERVE COLLECTION
 CUSTOM MODELS CR800, MR800, CH900, CRDnnn.
 NOTE THAT "nnn" REPRESENTS THE ARRANGEMENT
 OF THE DECORATIVE CLADDING AND OVERLAYS.


SHEET:
 3 OF 4

REVISIONS					
REV. NO.	ZONE	DATE	ECN NO.	APPVD	DESCRIPTION
--	-	-	-	-	SEE REVISION HISTORY ON SHEET ONE.

JAMB TO SUPPORTING STRUCTURE ATTACHMENT

- NOTES:
1. ALL THE LOAD FROM THE DOOR IS TRANSFERRED TO THE TRACK AND THEN FROM THE TRACK TO THE 2x6 VERTICAL SYP (GRADE #2 OR BETTER) JAMBS. NO LOAD FROM THE DOOR IS TRANSFERRED TO THE HORIZONTAL (TOP) JAMB.
 2. EACH VERTICAL JAMB SEES A MAXIMUM DESIGN LOAD OF +211.5 LB & -247.5 LB. PER LINEAR FOOT OF JAMB.
 3. ALL JAMB FASTENERS MAY BE (BUT ARE NOT REQUIRED TO BE) COUNTERSUNK TO PROVIDE A FLUSH MOUNTING SURFACE.
 4. A 1/3 STRESS INCREASE FOR WIND LOAD WAS NOT USED IN THE CALCULATION OF ALLOWABLE LOADS FOR ANCHORS AND FASTENERS FOR STEEL, CONCRETE AND MASONRY.

NOTE: 2x6 WOOD JAMBS ARE NOT REQUIRED WITH CONTINUOUS ANGLE MOUNT TRACK. HOWEVER, IF DESIRED ON STEEL JAMBS OR CONCRETE OR BLOCK WALLS, APPROVED FASTENERS AS DETAILED BELOW SHOULD BE INCREASED IN LENGTH BY 1-1/2" AND INSTALLED DIRECTLY THROUGH THE ANGLE AND 2x6 WOOD JAMBS INTO THE STEEL JAMBS OR CONCRETE OR BLOCK WALLS. ANCHORS CAN BE (BUT ARE NOT REQUIRED TO BE) COUNTERSUNK TO PROVIDE A FLUSH MOUNTING SURFACE. CONTINUOUS ANGLE TRACK CAN BE ANCHORED DIRECTLY TO GROUT REINFORCED BLOCK WALL OR 3,000 PSI MIN. CONCRETE COLUMN OR STEEL JAMBS.

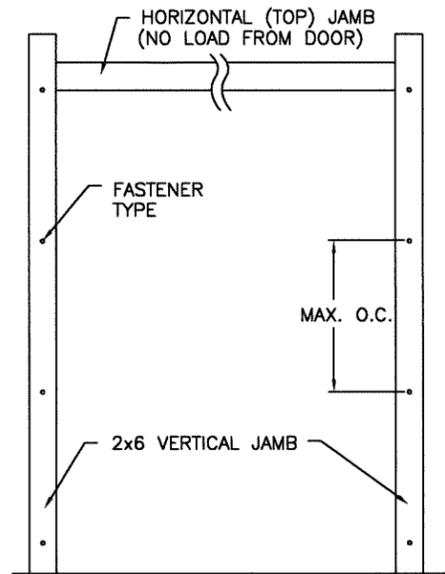


PRODUCT REVISED
 as complying with the Florida
 Building Code
 NOA-No. 23-0726.03
 Expiration Date 08/23/2028
 By *[Signature]*
 Miami-Dade Product Control



FASTENER ATTACHMENT TO SUPPORTING STRUCTURE SCHEDULES

BUILDING TYPE	FASTENER TYPE	MAXIMUM ON-CENTER DISTANCE BETWEEN FASTENERS*	STEEL WASHERS REQUIRED?
HOLLOW BLOCK WALL	1/4" x 1-1/4" MIN. EMBED ULTRACON CONCRETE ANCHOR	7-3/4"	1" O.D.
GROUT FILLED BLOCK WALL	1/4" x 1-3/4" MIN. EMBED ULTRACON CONCRETE ANCHOR	13"	1" O.D.
3000 PSI MIN. CONCRETE	1/4" x 1-3/4" MIN. EMBED ULTRACON CONCRETE ANCHOR	24"	1" O.D.
2000 PSI MIN. CONCRETE	1/4" x 1-3/4" MIN. EMBED TAPCON CONCRETE ANCHOR	24"	1" O.D.
2000 PSI MIN. CONCRETE	3/8" x 1-3/4" MIN. EMBED WEJ-IT ANKR TITE SLEEVE ANCHOR	23-3/4"	INCLUDED
4000 PSI MIN. CONCRETE	3/8" x 1-3/4" MIN. EMBED WEJ-IT ANKR TITE SLEEVE ANCHOR	24"	INCLUDED
WOOD FRAME (SYP 0.55 SG)	1/2" x 3" LAG SCREW (ASTM A307, GRADE A) 1-5/8" EMBED INTO STRUCTURE	24"	1" O.D.

* FIRST (BOTTOM) ANCHOR STARTING AT NO MORE THAN HALF OF THE MAXIMUM ON-CENTER DISTANCE. HIGHEST ANCHOR INSTALLED AT LEAST AS HIGH AS THE DOOR OPENING.
 CLOPAY DOES NOT SUPPLY JAMB ATTACHMENT FASTENERS.
 MINIMUM DISTANCE BETWEEN CENTER OF ANCHOR AND EDGE OF CONCRETE BLOCK: 2-1/2", EXCLUDING STUCCO THICKNESS.

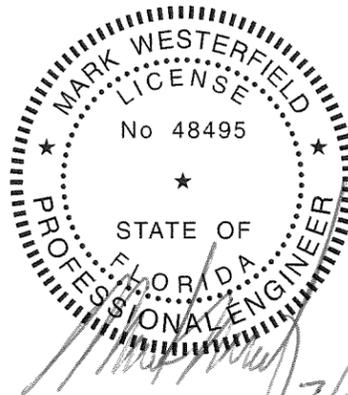

DESIGN ENGINEER:
 MARK WESTERFIELD, P.E.
 FLORIDA LICENSE No. 48495

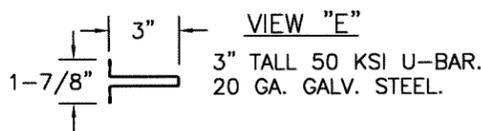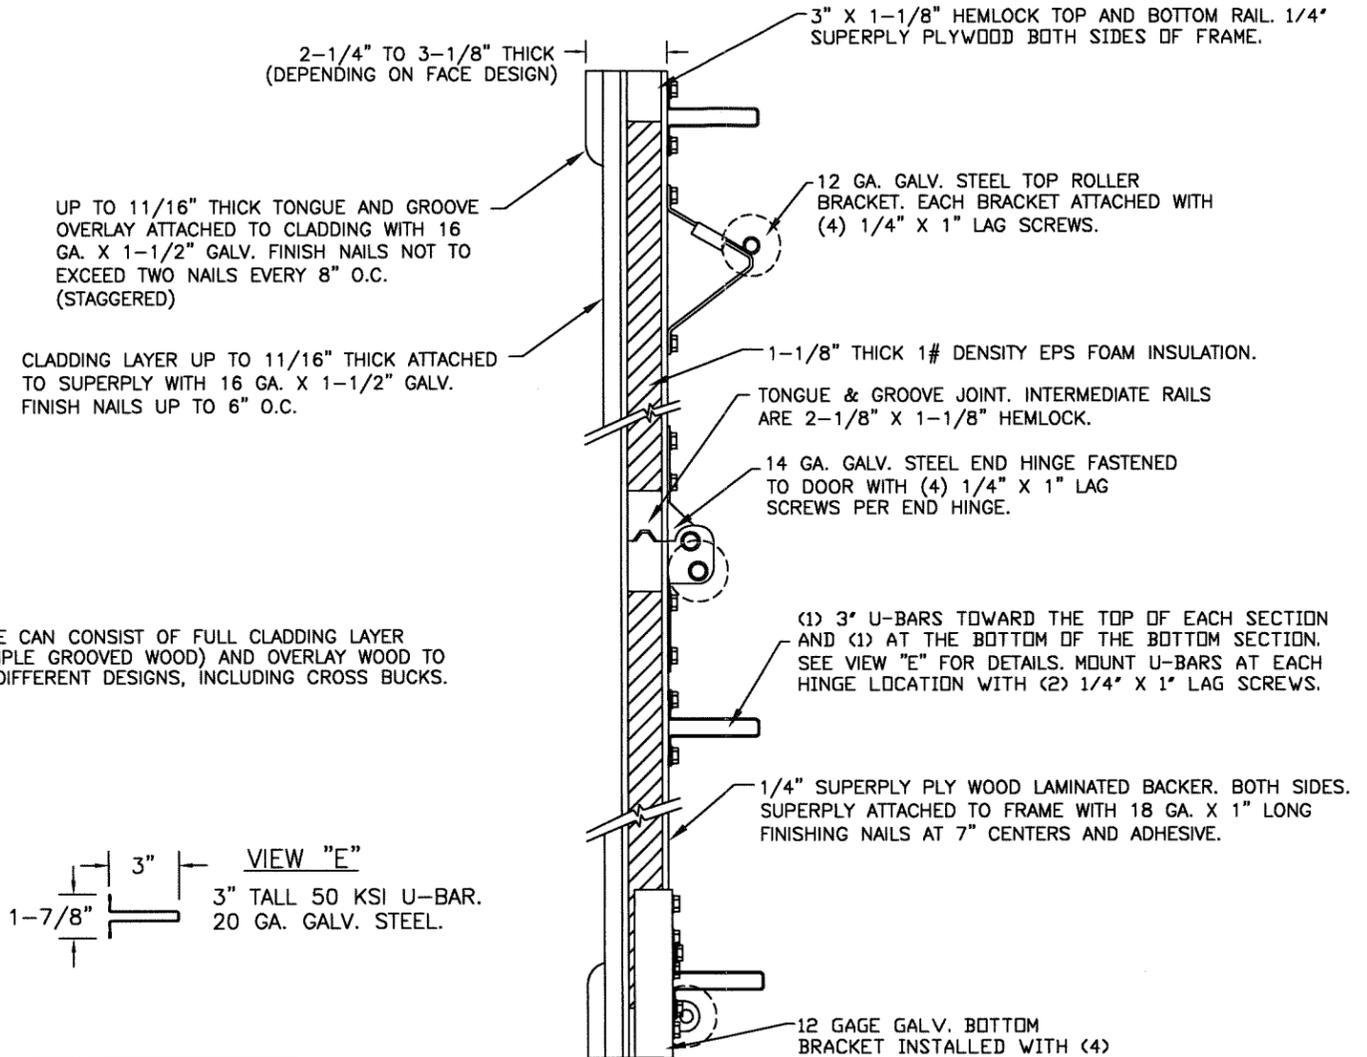

SECTION A-A (SIDE VIEW)

DESIGN LOADS: +47.0 PSF & -55.0 PSF

Unless Stated Otherwise
 TOLERANCES are
 .0 = ±.031
 .00 = ±.015
 .000 = ±.005
 .0000 = ±.001
 Degrees = ±1/2°
 Unless Stated Otherwise
 DIMENSIONS ARE IN INCHES.

Clopay
 Building Products Company
 8585 Duke Boulevard
 Mason, OH 45040 USA
 Tel. No. 513-770-4800
 Fax No. 513-770-4853

MANUFACTURING PRODUCT CODE
 W-1G899

PART NO.: N/A

WINDLOAD RATING
 W8 DP47

DESCRIPTION: CUSTOM RESERVE WOOD DOOR UP TO 9'0" WIDE			
DRAWN BY: SH	DATE: 8/28/15	SCALE: NTS	DWG. SIZE: B
CHECKED BY: MWW	DATE: 10/10/17	SHEET 3 OF 4	
DWG. NO.: 104939		VER: M-D	


CUSTOM RESERVE COLLECTION
 CUSTOM MODELS CR800, MR800, CH900, CRDnnn.
 NOTE THAT "nnn" REPRESENTS THE ARRANGEMENT
 OF THE DECORATIVE CLADDING AND OVERLAYS.

SHEET:
 4 OF 4

REVISIONS					DESCRIPTION
REV. NO.	ZONE:	DATE:	ECN NO.	APPVD:	
--	-	-	-	-	SEE REVISION HISTORY ON SHEET ONE.


2" TRACK CONFIGURATION.

NOTE DOUBLE TRACK HEADROOM, HI-LIFT TRACK, FOLLOW-THE-ROOF TRACK, AND VERTICAL LIFT TRACK ARE AVAILABLE OPTIONS. TRACK CONFIGURATION ABOVE THE DOOR OPENING DOES NOT AFFECT THE WIND LOAD RATING.

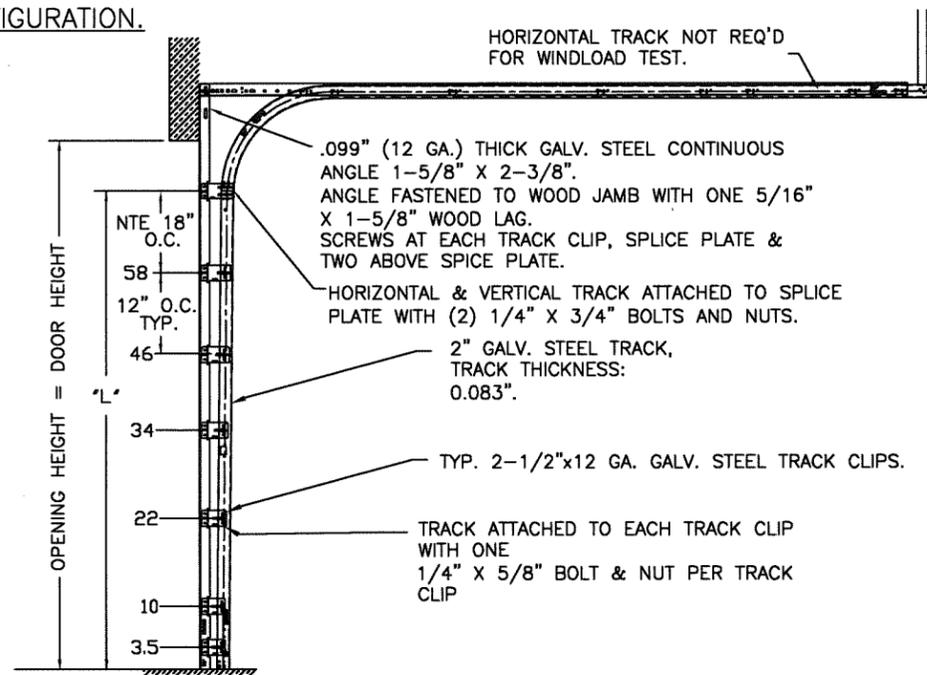

DOOR HEIGHT	"L"
6'-6"	70"
7'-0"	76"
7'-6"	82"
8'-0"	88"
8'-6"	94"
9'-0"	100"
9'-6"	106"
10'-0"	112"
10'-6"	118"
11'-0"	124"
11'-6"	130"
12'-0"	136"

JAMB CONFIGURATION FOR 2" TRACK.

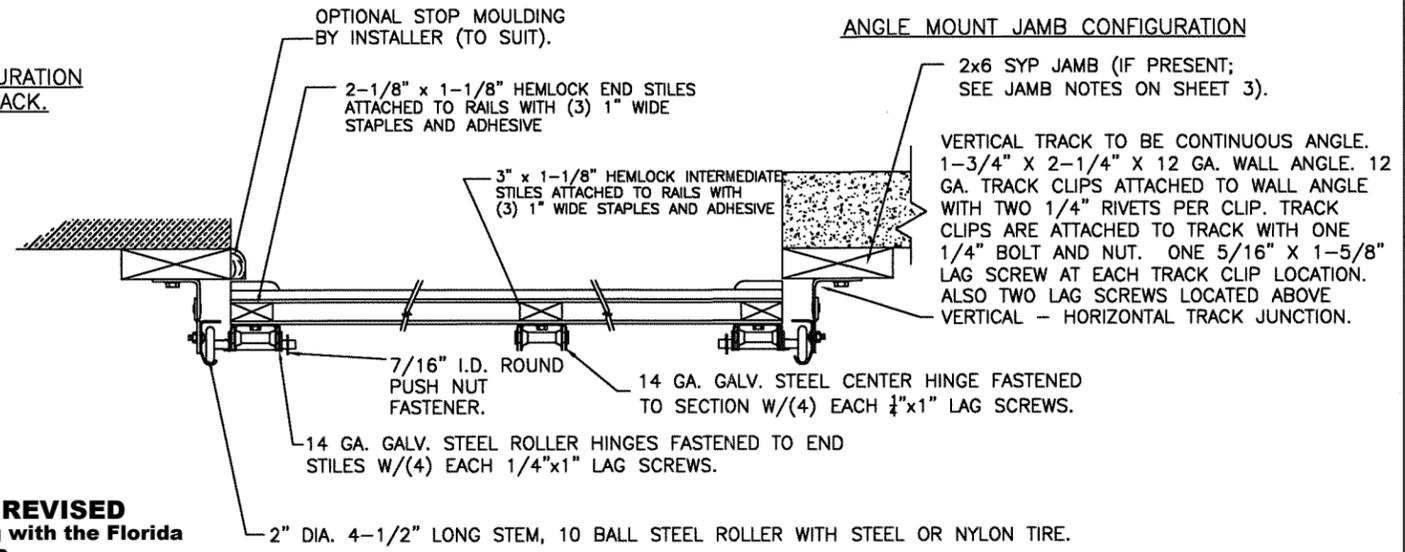

PRODUCT REVISED as complying with the Florida Building Code NOA-No. 23-0726.03


Expiration Date 08/23/2028

By Miami-Dade Product Control

JAMB CONFIGURATION FOR 3" TRACK.

3" TRACK CONFIGURATION.

NOTE DOUBLE TRACK HEADROOM, HI-LIFT TRACK, FOLLOW-THE-ROOF TRACK, AND VERTICAL LIFT TRACK ARE AVAILABLE OPTIONS. TRACK CONFIGURATION ABOVE THE DOOR OPENING DOES NOT AFFECT THE WIND LOAD RATING.

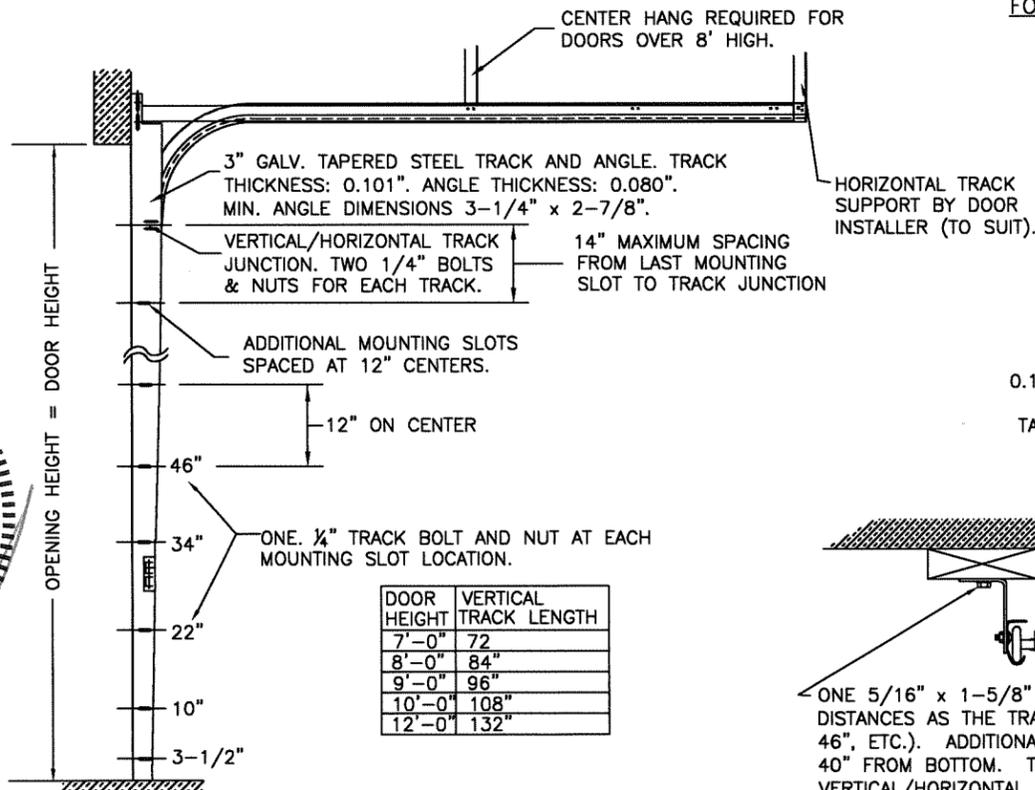


DOOR HEIGHT	VERTICAL TRACK LENGTH
7'-0"	72"
8'-0"	84"
9'-0"	96"
10'-0"	108"
12'-0"	132"

2x6 SYP JAMB (IF PRESENT; SEE JAMB NOTES ON SHEET 3).

3-1/4\" x 2-7/8\" MIN. x 0.080\" TAPERED ANGLE. SEE LAG BOLT MOUNTING AT TRACK CONFIGURATION BELOW.


0.101\" THICK 3\" GALV. STEEL TRACK FASTENED TO TAPERED ANGLE. TRACK ATTACHED TO TAPERED ANGLE WITH ONE 1/4\"x5/8\" BOLT & NUT AT EACH MOUNTING SLOT.

ONE 5/16\" x 1-5/8\" LAG SCREW SPACED AT THE SAME DISTANCES AS THE TRACK BOLTS (I.E. 3-1/2\", 10\", 22\", 34\", 46\", ETC.). ADDITIONAL LAG SCREWS LOCATED AT 16\", 28\", & 40\" FROM BOTTOM. TWO LAG SCREWS ALSO LOCATED ABOVE VERTICAL/HORIZONTAL TRACK JUNCTION.

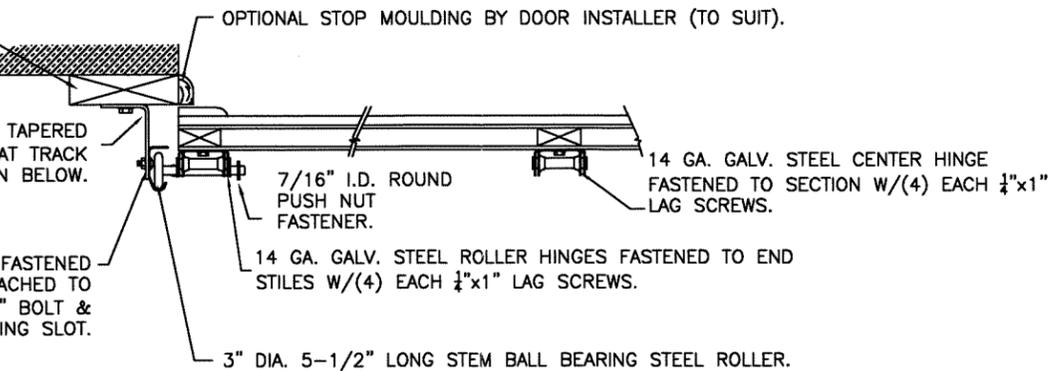

SECTION C-C
 PREPARATION OF JAMBS BY OTHERS.

LHR BRACKET (2-1/2\" x 5-3/4\" x 12GA) ATTACHED WITH (2) 1/4\" x 3/4\" SELF TAPPING SCREWS. NOTE THAT LHR BRACKETS ARE ALSO USED WITH "DOUBLE END STILE" AS SHOWN IN ZONE B-3 SHEET 1.

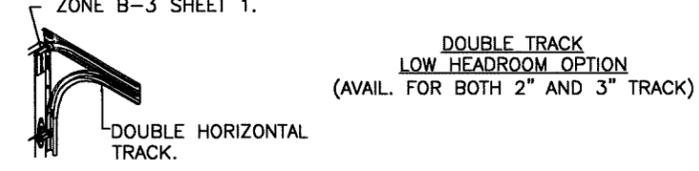

MARK WESTERFIELD
 LICENSE No 48495
 STATE OF FLORIDA
 PROFESSIONAL ENGINEER
 7/17/23
 DESIGN ENGINEER:
 MARK WESTERFIELD, P.E.
 FLORIDA LICENSE No. 48495

Unless Stated Otherwise TOLERANCES are
 .0 = ±.031
 .00 = ±.015
 .000 = ±.005
 .0000 = ±.001
 Degrees = ±1/2\"
 Unless Stated Otherwise DIMENSIONS ARE IN INCHES.

Clopay Building Products Company
 8585 Duke Boulevard
 Mason, OH 45040 USA
 Tel. No. 513-770-4800
 Fax No. 513-770-4853

MANUFACTURING PRODUCT CODE W-1G899
 PART NO.: N/A
 WINDLOAD RATING W8 DP47
 DESCRIPTION: CUSTOM RESERVE WOOD DOOR UP TO 9'0\" WIDE
 DRAWN BY: SH DATE: 8/28/15 SCALE: NTS DWG. SIZE B
 CHECKED BY: MWW DATE: 10/10/17 SHEET 4 OF 4
 DWG. NO.: 104939 VER: M-D

DESIGN LOADS: +47.0 PSF & -55.0 PSF