

MIAMI-DADE COUNTY PRODUCT CONTROL SECTION

11805 SW 26 Street, Room 208 Miami, Florida 33175-2474 T (786) 315-2590 F (786) 315-2599 www.miamidade.gov/economy

DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER) BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

Shanghai YY Windows CO. LTD. No. 9300 Hunan Highway, PuDong New Area, Shanghai, China, 201399

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER -Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "YY-86" Horizontal Sliding Window - L.M.I.

APPROVAL DOCUMENT: Drawing No. **AD 23-67**, titled "YY 86 Horizontal Sliding Window Systems (L.M.I.)", sheets 1 through 10 of 10, dated January 17, 2024, prepared by MCY Engineering, Inc., signed and sealed by Yiping Wang, P.E., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant Limitations:

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, **Shanghai, China**, series, and the following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of this page 1 and evidence pages E-1, as well as approval document mentioned above. The submitted documentation was reviewed by **Sifang Zhao**, **P.E.**



4,2. 11/07/2024

NOA No. 24-0205.03 Expiration Date: November 07, 2029 Approval Date: November 07, 2024

Page 1

Shanghai YY Windows CO. LTD.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

- **1.** Manufacturer's die drawings and sections.
- 2. Drawing No. **AD 23-67**, titled "YY 86 Horizontal Sliding Window Systems (L.M.I.)", sheets 1 through 10 of 10, dated January 17, 2024, prepared by MCY Engineering, Inc., signed and sealed by Yiping Wang, P.E.

B. TESTS

- 1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Forced Entry Test, per FBC, and TAS 202-94
 - 5) Large Missile Impact Test per FBC, TAS 201-94
 - 6) Cyclic Wind Pressure Loading per FBC, TAS 203-94

along with marked-up drawings and installation diagram of aluminum project out window, prepared by Intertek Testing, Shanghai, China., Test Report No. **230515009SHF-003**, dated 01/18/2024, signed and sealed by Vinu Abraham, P.E.

C. CALCULATIONS

- 1. Anchor verification calculations and structural analysis, complying with FBC-8th Edition dated 01/24/2024, prepared by MCY Engineering, Inc., signed and sealed by Yiping Wang, P.E.
- 2. Glazing complies with ASTM E1300-04 & -09.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. 23-0713.18 issued to Eastman Chemical Company (MA) for their "Saflex PVB Clear and Color Glass Interlayers" dated 08/17/2023, expiring on 05/21/2026.

F. STATEMENTS

- 1. Statement letter of conformance, complying with **FBC2023** (8th Edition) and "No financial interest" dated 01/24/2024, issued by MCY Engineering, Inc., signed and sealed by Yipping Wang, P.E.
- 2. Distributor Agreement, between manufacturer Shanghai YY Windows Co. LTD, China and DGC Development Corp., USA (Distributor) dated 05/31/2024, signed by Yvonne Yang, director and Daniel Jorge Oliveira, CEO on behalf of their respective companies.

G. OTHER


1. None.

0

Sifang Zhao, P.E. Product Control Examiner NOA No. 24-0205.03 on Date: November 07, 2029

Expiration Date: November 07, 2029 Approval Date: November 07, 2024

SHANGHAI YY WINDOWS CO., LTD. YY86 HORIZONTAL SLIDING WINDOW SYSTEM - LMI

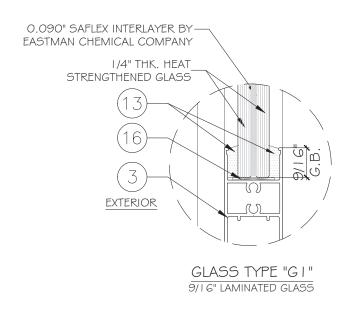

GENERAL NOTES:

- THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE 8TH EDITION OF FLORIDA BUILDING CODE 2023 INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).
- WINDOWS ARE RATED FOR LARGE MISSILE IMPACT. IMPACT SHUTTERS ARE NOT REQUIRED.
- THESE WINDOWS ARE APPROVED FOR AIR AND WATER INFILTRATION.
- ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS.

 ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
- ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.
- MATERIALS INCLUDING BUT NOT LIMITED TO STEEL / METAL SCREWS THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE 8TH EDITION OF FLORIDA BUILDING CODE 2023 SECTION AS APPLICABLE.
- METAL STRUCTURES BY OTHERS TO BE DESIGNED TO SUPPORT THE LOADS IMPOSED BY THIS GLAZING SYSTEM AND TO TRANSFER SUCH LOADS TO THE BUILDING MAIN STRUCTURE.
- ULTIMATE LOAD OBTAINED FROM ASCE 7-22, MULTIPLY BY 0.6 SHALL BE LESS THAN OR EQUAL TO MAX. DESIGN LOAD IN THIS DOCUMENT. THE DESIGN LOADS SHOWN IN THIS DOCUMENT ARE ALLOWABLE DESIGN LOADS.
- SEALANT:

ALL FRAME CORNERS, JOINTS, MULLION SEAMS AND PERIMETER GLAZING BEAD TO FRAME INSTALLATION FASTENERS SEALED WITH SILICONE SEALANT.

NOTE:

GLASS COMPLIES WITH ASTM E | 300-09 (3 SEC. GUSTS).

- MANUFACTURER'S LABEL SHALL BE LOCATED ON A READILY VISIBLE LOCATION IN ACCORDANCE WITH SECTION 1709.9.3 OF FLORIDA BUILDING CODE LABELING TO COMPLY WITH SECTION 1709.9.2.

USE CHARTS AS FOLLOWS.

STEP 1: DETERMINE DESIGN WIND LOAD REQUIREMENTS BASED ON WIND VELOCITY, BLDG. HEIGHT,

WIND ZONE USING APPLICABLE ASCE 7-22 STANDARD OR WIND TUNNEL REPORTS.

STEP 2: SEE SHEET 02 FOR APPROVED TYPICAL ELEVATION & CONFIGURATION.

STEP 3: ANCHOR OPTION SEE SHEET 07. ANCHOR LAYOUT SEE SHEET 02.

THE LOWEST VALUE RESULTING FROM STEPS 2 \$ 3 THAT EXCEED THE DESIGN WIND PRESSURES DETERMINED THRU STEP | SHALL APPLY TO ENTIRE SYSTEM.

ABBREVIATIONS AND SYMBOLS

G.B. - GLASS BITE

D.L.O. - DAYLITE OPENING


F.H. - FRAME HEIGHT

F.W. - FRAME WIDTH

W/ - WITH

W/O - WITHOUT

O.C. - ON CENTER




PRODUCT CONTROL

PRODUCT APPROVED as complying with the Florida Building Code

NOA-No. 24-0205.03

Approval Date 11/07/2024

By Miami-Dade Product Control



MCY ENGINEERING, INC. GLAZING CONSULTANTS

IZ781 M MIRAMAI

CO.,LTD
REA,SHANGHAI CHINA
D18

SHANGHAI YY WINDOWS CO.,LT O Hunan high way, PUDONG NEW AREA,SHAN TEL.+86 189 1616 7018


| Page |

Orawn Date Scale
01.17.2024 AS SHOWN
DRAWING NO.

AD23-67

COVER

1 OF 10

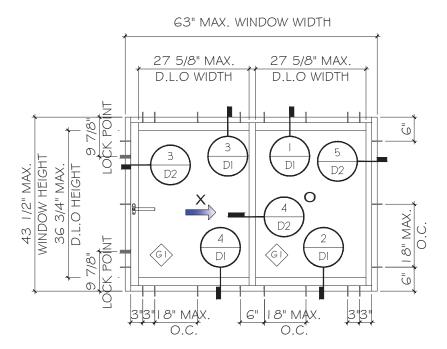


TYPICAL EXTERIOR ELEVATION XO(SHOWN) / OX

ALLOWABLE DESIGN LOAD

FOR SIZE SHOWN ABOVE OR SMALLER AS PERMITTED BY FBC

> +65 PSF - 65 PSF

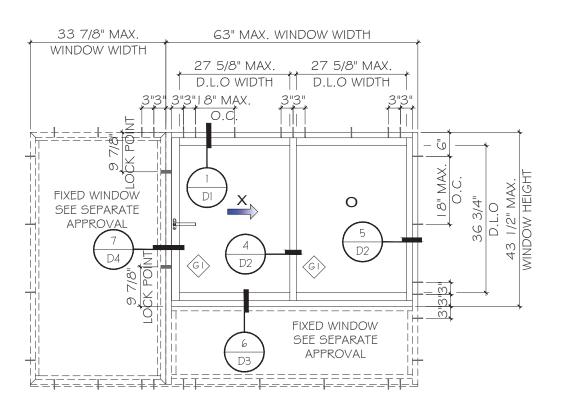

TYPICAL EXTERIOR ELEVATION

ALLOWABLE DESIGN LOAD

FOR SIZE SHOWN ABOVE OR SMALLER AS PERMITTED BY FBC

> +65 PSF - 65 PSF



SHANGHAI YY WINDOWS CO.,LTD NO.9300 Hunan high way, PUDONG NEW AREA,SHANGHAI CHINA

MCY ENGINEERING, INC. GLAZING CONSULTANTS


12781 MIRAMAR PKWY.STE.301 MIRAMAR, FL 33027 P


01.17.2024 AS SHOWN

AD23-67

E1 Sheet No.

2 OF 10

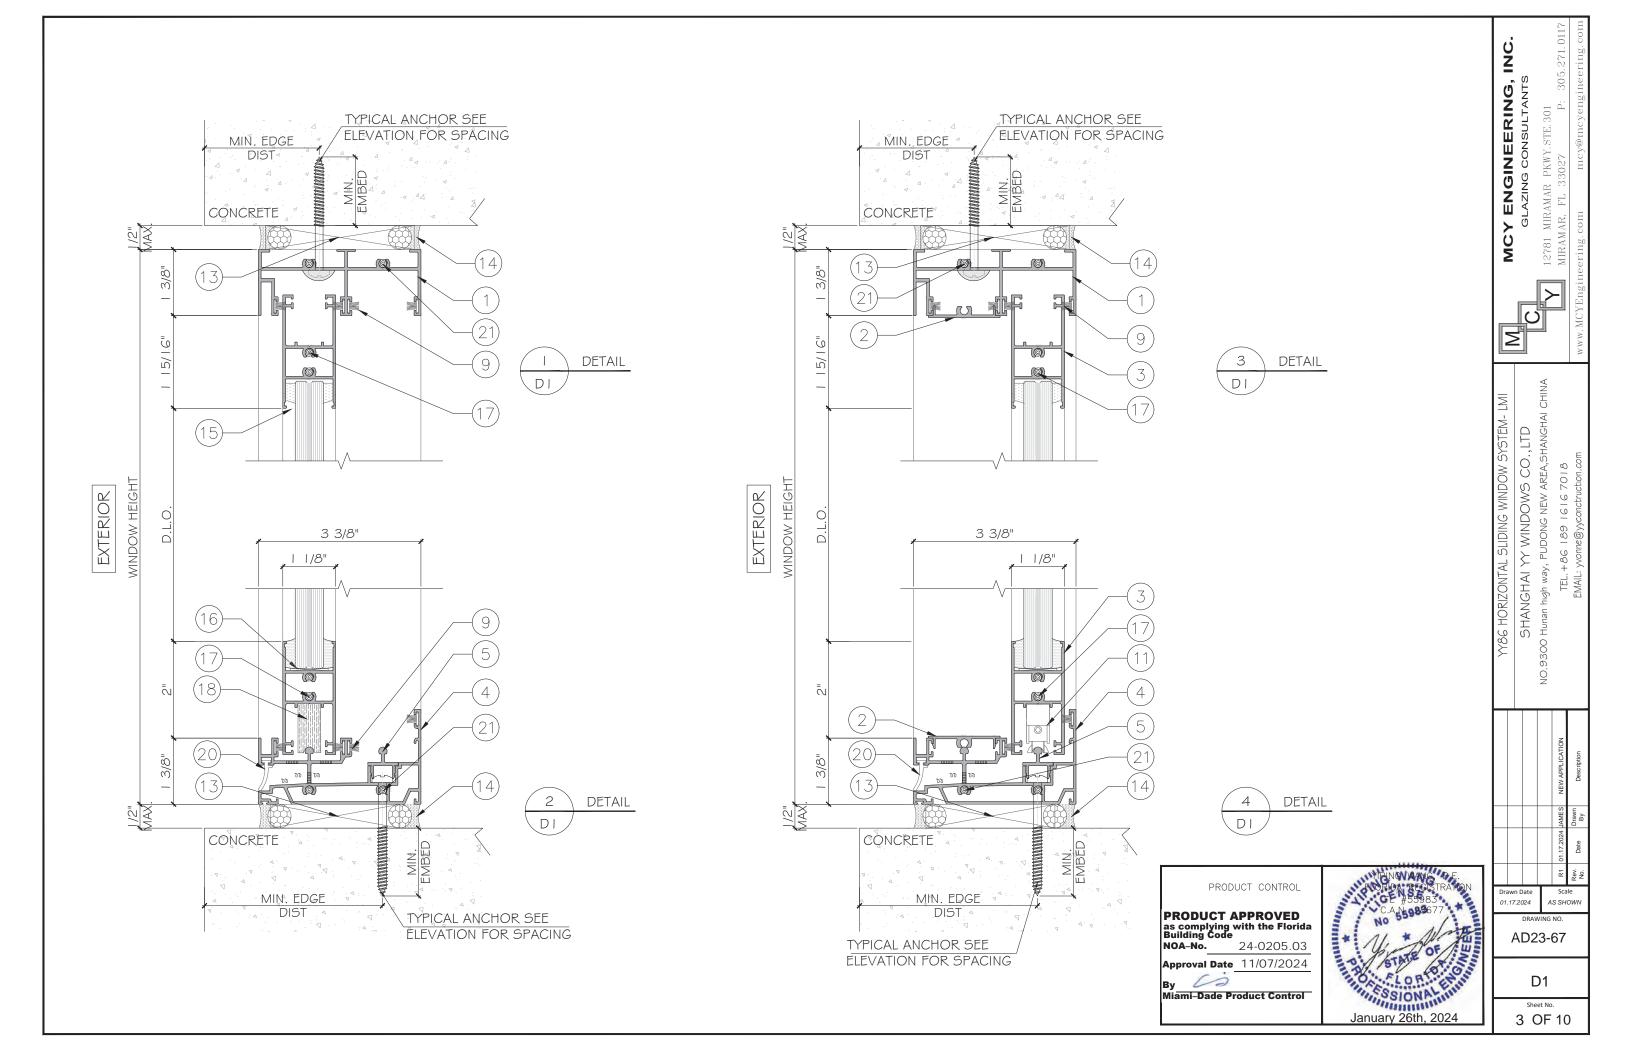

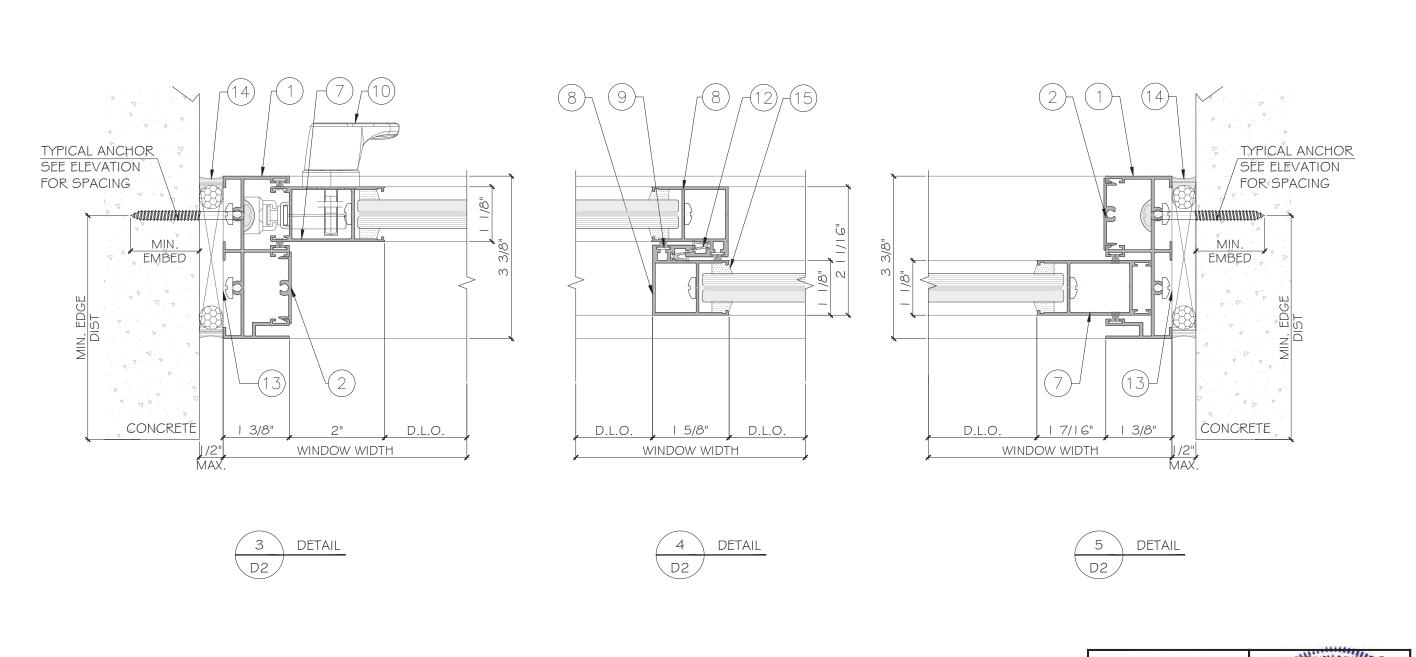

MCY ENGINEERING, INC. GLAZING CONSULTANTS

12781 MIRAMAR PKWY.STE.301 MIRAMAR, FL 33027

SHANGHAI YY WINDOWS CO., LTD NO.9300 Hunan high way, PUDONG NEW AREA, SHANGHAI CHINA TEL.+86 189 1616 7018

01.17.2024 AS SHOWN

AD23-67


PRODUCT CONTROL

PRODUCT APPROVED as complying with the Florida Building Code NOA-No. 24-0205.03

Approval Date 11/07/2024 By Miami-Dade Product Control

D2 Sheet No.

4 OF 10

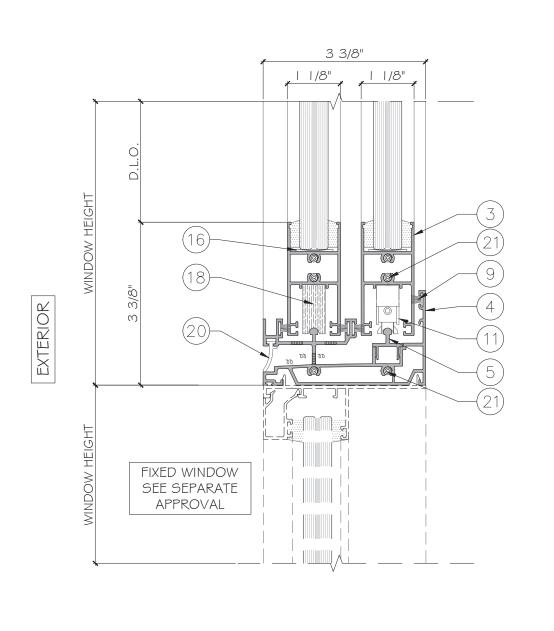

DETAIL 6 D3

SHANGHAI YY WINDOWS CO., LTD NO.9300 Hunan high way, PUDONG NEW AREA, SHANGHAI CHINA

MCY ENGINEERING, INC. GLAZING CONSULTANTS

12781 MIRAMAR PKWY.STE.301 MIRAMAR, FL 33027 P:

GE #55983 C.A.N. 023677

PRODUCT CONTROL


PRODUCT APPROVED as complying with the Florida Building Code
NOA-No. 24-0205.03

Approval Date 11/07/2024

By Miami-Dade Product Control

01.17.2024 AS SHOWN AD23-67

> D3 Sheet No. 5 OF 10

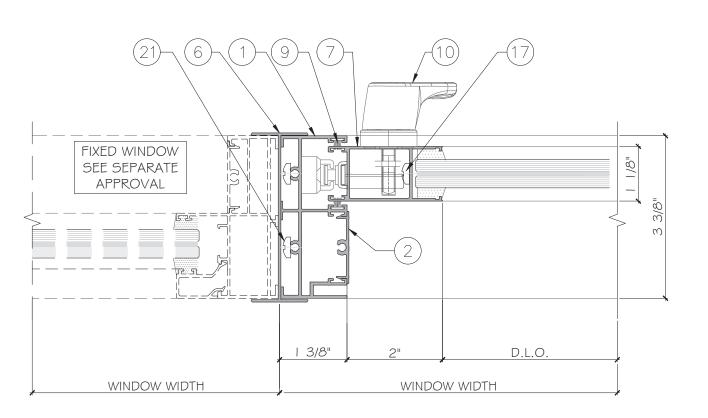

EXTERIOR

7 DETAIL D4



01.17.2024

AD23-67

D4
Sheet No.
6 OF 10

C.A.N. 23677

AS SHOWN

PRODUCT CONTROL

PRODUCT APPROVED
as complying with the Florida
Building Code
NOA-No. 24-0205.03

Approval Date 11/07/2024

By Miami-Dade Product Control

MCY ENGINEERING, INC.
GLAZING CONSULTANTS
12781 MIRAMAR PKWY.STE.301
MIRAMAR, FL 33027 P: 305.271.01

METAL STRUCTURES BY OTHERS TO BE DESIGNED TO SUPPORT THE LOADS IMPOSED BY THIS GLAZING SYSTEM AND TO TRANSFER SUCH LOADS TO THE BUILDING MAIN STRUCTURE.

TYPICAL ANCHOR TYPES: SEE ELEVATIONS FOR SPACING

TYPE "A": 1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)

1 3/4" MIN. EMBED INTO CONCRETE (HEAD/ JAMBS/ SILL)

1 3/4" MIN. EMBED INTO CONC. BLOCKS (JAMB ONLY)


TYPE "B": 1/4" TEKS/SELF DRILLING SCREW(GRADE 5) (Fu=120 KSI, Fy=92 KSI) INTO APPROVED MULLIONS (1/8" THK. MIN.) INTO METAL STRUCTURE


STEEL: 1/8" THK. MIN. (Fy=36 KSI MIN.) ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.) (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PANTED)


TYPICAL ANCHOR EDGE DISTANCE: INTO CONCRETE = 2 I/2" MIN. INTO METAL STRUCTURE = 3/4" MIN.


CONCRETE fc = 3000 psi MIN.C-90 HOLLOW/FILLED BLOCK fm = 2000 psi MIN.NORMAL STRENGTH CMU(AT JAMB ONLY)


GLAZING BEAD AT FRAME SILL SEALED TO GLASS WITH DOW CORNING 983. FRAME CORNERS SEALED WITH DOW CORNING 999 OR EQUAL COMPATIBLE




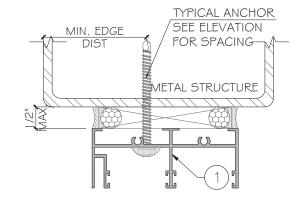



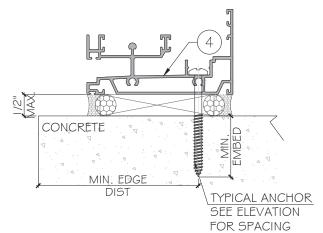

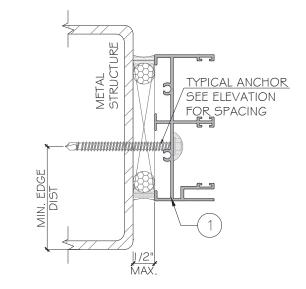

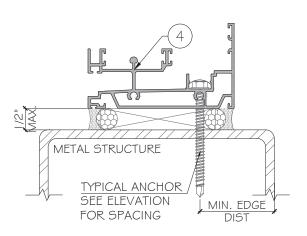



MCY ENGINEERING, INC.

12781 NIRAM/


January 26th, 2024

AD23-67

01.17.2024

A1
Sheet No.
7 OF 10


AS SHOWN

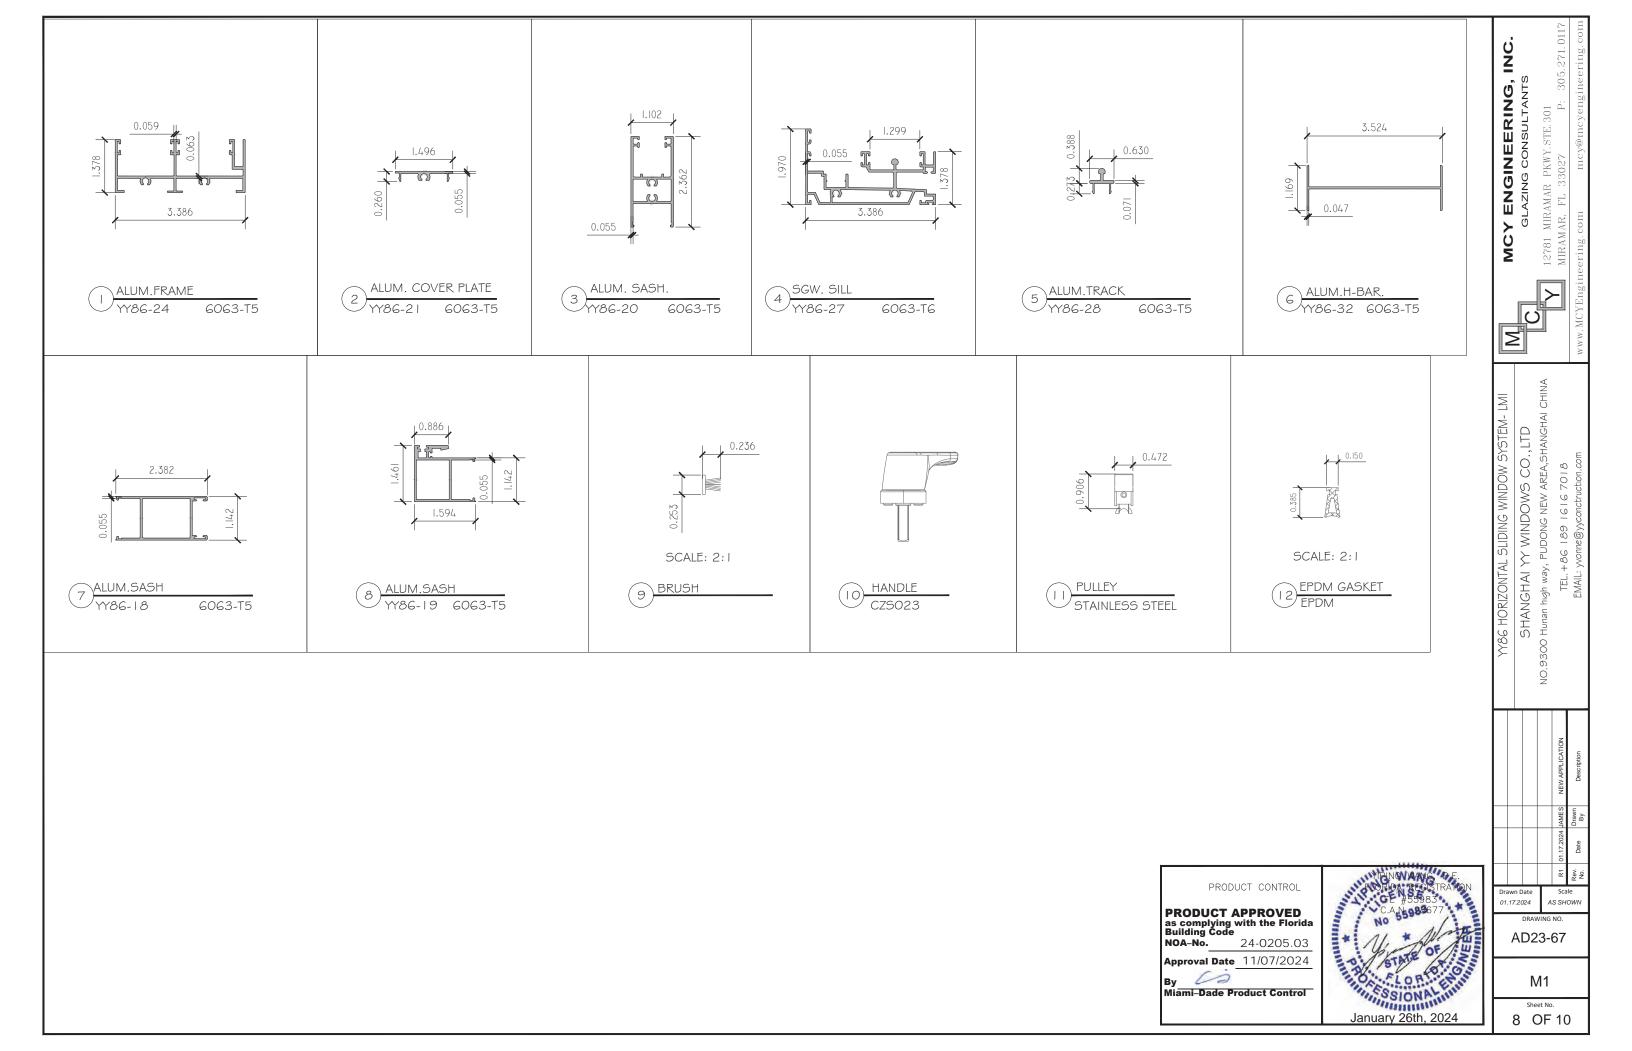

| MATERIAL LIST | | | | |
|----------------|----------------|-------------------------------------|-------------------|------------------------|
| ITEM NUMBER | PART NUMBER | PART NAME | MATERIAL | MANUF./REMARKS |
| | YY86-24 | FRAME | 6063-T5 | YY WINDOWS |
| 2 | YY86-21 | COVER PLATE | 6063-T5 | YY WINDOWS |
| 3 | YY86-20 | SASH | 6063-T5 | YY WINDOWS |
| 4 | YY86-27 | SILL | 6063-T6 | YY WINDOWS |
| 5 | YY86-28 | TRACK | 6063-T5 | YY WINDOWS |
| 6 | YY86-32 | H-BAR | 6063-T5 | YY WINDOWS |
| 7 | YY86-18 | SASH | 6063-T5 | YY WINDOWS |
| 8 | YY86-19 | SASH | 6063-T5 | YY WINDOWS |
| 9 | - | BRUSH | - | - |
| 10 | - | HANDLE | ALUMINUM ALLOY | НОРО |
| | - | PULLEY | STAINLESS STEEL | PAG |
| 12 | - | EPDM GASKET | EPDM | DUROMETER 50±5 SHORE A |
| 13 | - | WINDOW PACKER | PA66 | - |
| 14 | - | WEATHER SEALANT | DOWSIL 795 OR 790 | DOW CORNING |
| 15 | - | WEATHER SEALANT | DOWSIL 795 | DOW CORNING |
| 16 | - | SETTING BLOCK | TPE | SHORE HARDNESS 65-80 |
| 17 | - | DIA.3/16" X 1" SELF-DRILLING SCREW. | STAINLESS STEEL | - |
| 18 | - | FIXINGS | NYLON | - |
| 19 | SK02 | LOCKS | STAINLESS STEEL | KINLONG |
| 20 | | EPDM GASKET | EPDM | DUROMETER 50±5 SHORE A |
| 21 | - | DIA.3/16" X 2" SELF-DRILLING SCREW. | STAINLESS STEEL | - |
| | | | | |

PRODUCT CONTROL PRODUCT APPROVED as complying with the Florida Building Code
NOA-No. 24-0205.03
Approval Date 11/07/2024

By Miami-Dade Product Control



MCY ENGINEERING, INC.
GLAZING CONSULTANTS
12781 MIRAMAR PKWY.STE.301
MIRAMAR, FL 33027 P: 305.271.01


YY86 HORIZONTAL SLIDING WINDOW SYSTEM- LMI
SHANGHAI YY WINDOWS CO.,LTD
NO.9300 Hunan high way, PUDONG NEW AREA,SHANGHAI CHINA
TEL. +86 | 89 | 6 | 6 70 | 8
EMAIL: yvonne@yyconctruction.com

Drawn Date 01.17.2024 AS SHOWN

AD23-67

M2

Sheet No. 9 OF 10

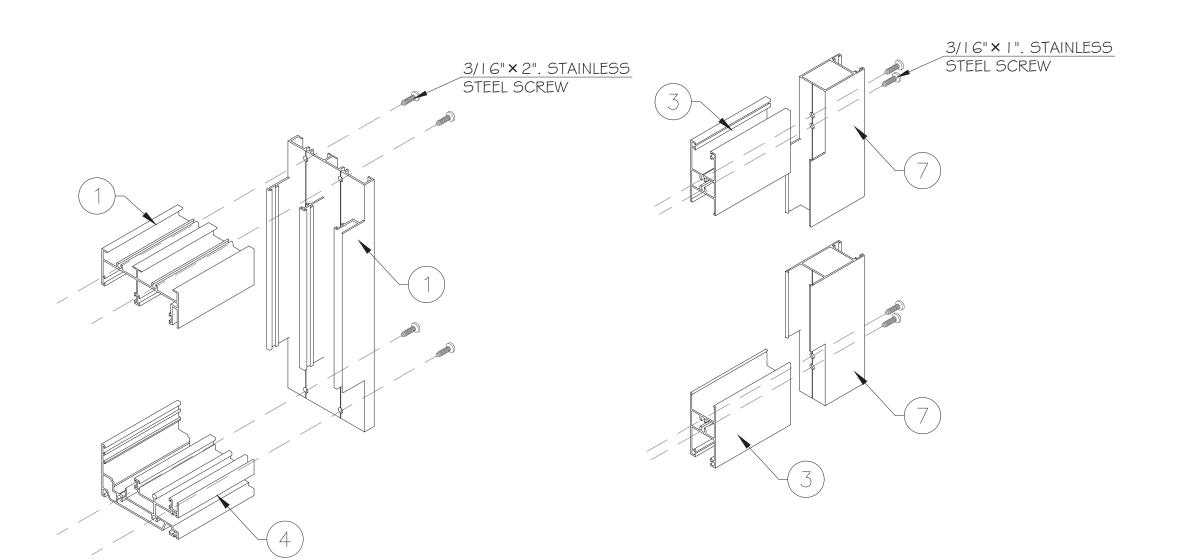

SHANGHAI YY WINDOWS CO.,LTD NO.9300 Hunan high way, PUDONG NEW AREA,SHANGHAI CHINA

MCY ENGINEERING, INC. GLAZING CONSULTANTS

PRODUCT CONTROL

PRODUCT APPROVED as complying with the Florida Building Code
NOA-No. 24-0205.03

Approval Date 1/07/2024

By Miami-Dade Product Control



AD23-67

3D Sheet No. 10 OF 10