



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION
NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

Master Builders Solutions US, LLC
23700 Chagrin Blvd.
Beachwood, OH 44122

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION:

Finestone Platinum CI Stucco Ultra Wall System over 5/8in. DensGlass Sheathing – S.M.I.

APPROVAL DOCUMENT: Drawing titled "Finestone Assembly Detail for Platinum CI Stucco Ultra Wall System over 5/8in. DensGlass Sheathing Substrate (Small Missile)", sheets 1 through 3 of 3, dated 01/17/2020, prepared by Master Builders Solutions US, LLC, signed and sealed by William O. Bishop, P.E. on 04/07/2020, bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, Acworth, GA, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein. Components of this product come in different size buckets or drums. Each container needs to be labeled. Unit is further defined as each individual board of insulation and roll of reinforcing mesh.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises # **21-0517.13** and consists of page 1 and evidence pages E-1, E-2 & E-3, as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P.E.**

Ishaq I. Chanda



NOA No. 24-1007.16
Expiration Date: October 08, 2025
Approval Date: November 14, 2024
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. Evidence submitted under previous approvals

A. DRAWINGS

1. Drawing titled “Finestone Platinum CI Stucco Ultra Wall System over 5/8in. DensGlass Sheathing Substrate (Small Missile)”, sheets 1 through 3 of 3, dated 01/17/2020, prepared by Master Builders Solutions US, LLC, signed and sealed by William O. Bishop, P.E. on 04/07/2020.

B. TESTS

1. Test reports on
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Small Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94along with marked-up drawings and installation diagram of Finestone Assembly Detail for Platinum CI Stucco Ultra Wall System over 5/8” DensGlass Sheathing and 16ga. Steel Frame, prepared by Intertek, Test Report No. **J3675.04-450-18 R0**, dated 01/08/2020, signed and sealed by Vinu J. Abraham, P.E.

C. CALCULATIONS

1. None.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS

1. Test report on Self-Ignition Temperature of the NEOPOR Rigid Insulation per ASTM D1929-16, prepared by QAI Laboratories, Test Report No. **RJ5863F-2**, dated 01/10/2018, signed by Brian Ortega.
2. UL evaluation report on Surface Burning Characteristics of the NEOPOR Rigid Insulation per UL 723, ASTM E84, prepared by UL LLC, Test Report No. **UL ER5817-02**, dated 10/02/2014, revised on 06/30/2019.

F. STATEMENTS

1. Statement letter of code conformance to the 7th edition (2020) FBC prepared by William O. Bishop, P.E., Jan 21, 2021, signed and sealed by William O. Bishop, P.E.

G. OTHER

1. This NOA revises # **20-0630.07**, expiring 10/15/25.

Ishaq I. Chanda

Ishaq I. Chanda, P.E.
Product Control Unit Supervisor
NOA No. 24-1007.16
Expiration Date: October 08, 2025
Approval Date: November 14, 2024

Master Builders Solutions US LLC

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

2. Evidence submitted under previous approvals

A. DRAWINGS

1. Drawing titled “Finestone Platinum CI Stucco Ultra Wall System over 5/8in. DensGlass Sheathing Substrate (Small Missile)”, sheets 1 through 3 of 3, dated 01/17/2020, prepared by Master Builders Solutions US, LLC, signed and sealed by William O. Bishop, P.E. on 04/07/2020.

B. TESTS

1. None.

C. CALCULATIONS

1. None.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS

1. Test report on Self-Ignition Temperature of the NEOPOR Rigid Insulation per ASTM D1929-16, prepared by QAI Laboratories, Test Report No. **RJ5863F-2**, dated 01/10/2018, signed by Brian Ortega.
2. UL evaluation report on Surface Burning Characteristics of the NEOPOR Rigid Insulation per UL 723, ASTM E84, prepared by UL LLC, Test Report No. **UL ER5817-02**, dated 10/02/2014, revised on 06/30/2019

F. STATEMENTS

1. Statement letter of code conformance to the 7th edition (2020) FBC prepared by William O. Bishop, P.E., Jan 21, 2021, signed and sealed by William O. Bishop, P.E.

G. OTHER

1. This NOA **revises # 20-0630.14**, expiring 10/08/25.

Ishaq I. Chanda

Ishaq I. Chanda, P.E.
Product Control Unit Supervisor
NOA No. 24-1007.16
Expiration Date: October 08, 2025
Approval Date: November 14, 2024

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

3. New Evidence submitted

A. DRAWINGS

1. Drawing titled “Finestone Platinum CI Stucco Ultra Wall System over 5/8in. Dens Glass Sheathing Substrate (Small Missile)”, sheets 1 through 3 of 3, dated 01/17/2020, prepared by Master Builders Solutions US, LLC, signed and sealed by William O. Bishop, P.E. on 04/07/2020.

B. TESTS

1. None.

C. CALCULATIONS

1. None.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS

1. None.

F. STATEMENTS

1. Statement letter of code conformance to the 8th edition (2023) FBC dated 09/30/23 prepared, signed and sealed by William O. Bishop, P.E.
2. Statement letter of code conformance to the 7th edition (2020) FBC prepared by William O. Bishop, P.E., Jan 21, 2021, signed and sealed by William O. Bishop, P.E.

G. OTHER

1. This NOA **revises # 21-0517.13**, expiring 10/08/25.

Ishaq I. Chanda


Ishaq I. Chanda, P.E.
Product Control Unit Supervisor
NOA No. 24-1007.16
Expiration Date: October 08, 2025
Approval Date: November 14, 2024

APPLICATION NOTES

- 1) SHEATHING FABRIC IS EMBEDDED IN FINESTOP RA AT SHEATHING JOINTS. SHEATHING FASTENERS ARE SPOTTED WITH FINESTOP RA.
- 2) APPLY FINESTOP RA TO SHEATHING SURFACE UNIFORMLY AT 10 MILS WET.
- 3) APPLY FINESTONE DRAINAGE MAT OVER FINESTOP RA WITH EDGES BUTTED. ATTACH TO SHEATHING WITH SUFFICIENT STAPLES TO STAY IN PLACE UNTIL INSULATION BOARD APPLICATION.
- 4) NEOPOR RIGID INSULATION BOARD HAS A NOMINAL DENSITY OF 1.35 PCF (ASTM C578 TYPE II) AND SHALL BE APPLIED HORIZONTALLY IN A RUNNING BOND PATTERN STAGGERING VERTICAL JOINTS AND CORNERS. 2 FASTENERS PER BOARD ARE USED TO HOLD IT IN PLACE UNTIL LATH INSTALLATION.
- 5) PERMALATH 1000 IS ATTACHED INTO THE FRAMING AT 6" OC WITH #8 X 2 5/8" SELF DRILLING SCREWS WITH WIND LOCK LATH PLATES (1 1/4" DIAMETER).
- 6) FINESTONE STUCCOBASE IS MIXED AT THE TIME OF USE PER FINESTONE INSTRUCTIONS
- 7) FINESTONE STUCCOBASE IS APPLIED AT MINIMUM 1/2" THICKNESS. A DARBY IS USED TO LEVEL THE STUCCOBASE TO A CONSISTENT THICKNESS
- 8) FINESTONE FINISH IS AN ACRYLIC BASED TEXTURED EXTERIOR COATING READY MIXED FROM THE FACTORY. IT IS APPLIED WITH A STAINLESS STEEL TROWEL AND FLOATED TO A DESIRED TEXTURE.

GENERAL NOTES

- 1) THIS SYSTEM HAS BEEN DESIGNED IN ACCORDANCE WITH THE LATEST FLORIDA BUILDING CODE AND ITS LATEST SUPPLEMENTS.
- 2) THIS SYSTEM HAS BEEN TESTED IN ACCORDANCE WITH MIAMI-DADE COUNTY PROTOCOL TAS-201, TAS-202 & TAS-203 FOR SMALL MISSILE IMPACT, STRUCTURAL AND CYCLIC TESTING.
- 3) THIS SYSTEM SHALL BE APPLIED BY A LICENSED PLASTERING CONTRACTOR FOLLOWING THIS NOTICE OF ACCEPTANCE, THE RECOMMENDATIONS OF FINESTONE AND THE APPLICABLE SECTION OF THE FLORIDA BUILDING CODE.
- 4) THE ENGINEER AND/OR ARCHITECT OF RECORD FOR EACH PROJECT USING THIS SYSTEM SHALL SIZE ALL STUD FRAMING TO ENSURE CONFORMANCE WITH STUD DEFLECTION AND STRESS LIMITATIONS AS REQUIRED BY GOVERNING CODE AND THIS DOCUMENT.
- 5) ALL STUDS USED WITH THIS SYSTEM SHALL BE COMPLETELY SHEATHED AT THE INTERIOR FLANGE OR BRIDGED AT MAXIMUM EVERY 5 FT. OF STUD LENGTH OR AS SPECIFIED BY THE STUD MANUFACTURER.
- 6) ALL STEEL STUDS SHALL BE STRUCTURAL WITH 1 5/8" MIN FLANGE WIDTH AND HAVE A MINIMUM YIELD STRENGTH OF 33000 PSI
- 7) DETAILS ON SHEET 2 & 3 OF 3 ARE TYPICAL AND SHOW INTENT TO PREVENT WATER INFILTRATION INTO AND BEHIND THE SYSTEM. ALTERNATE DETAILS AND SPECIFIC CONDITIONS NOT COVERED BY THE TYPICAL DETAILS ARE THE RESPONSIBILITY OF THE LICENSED DESIGN PROFESSIONAL IN CONSULTATION WITH FINESTONE.

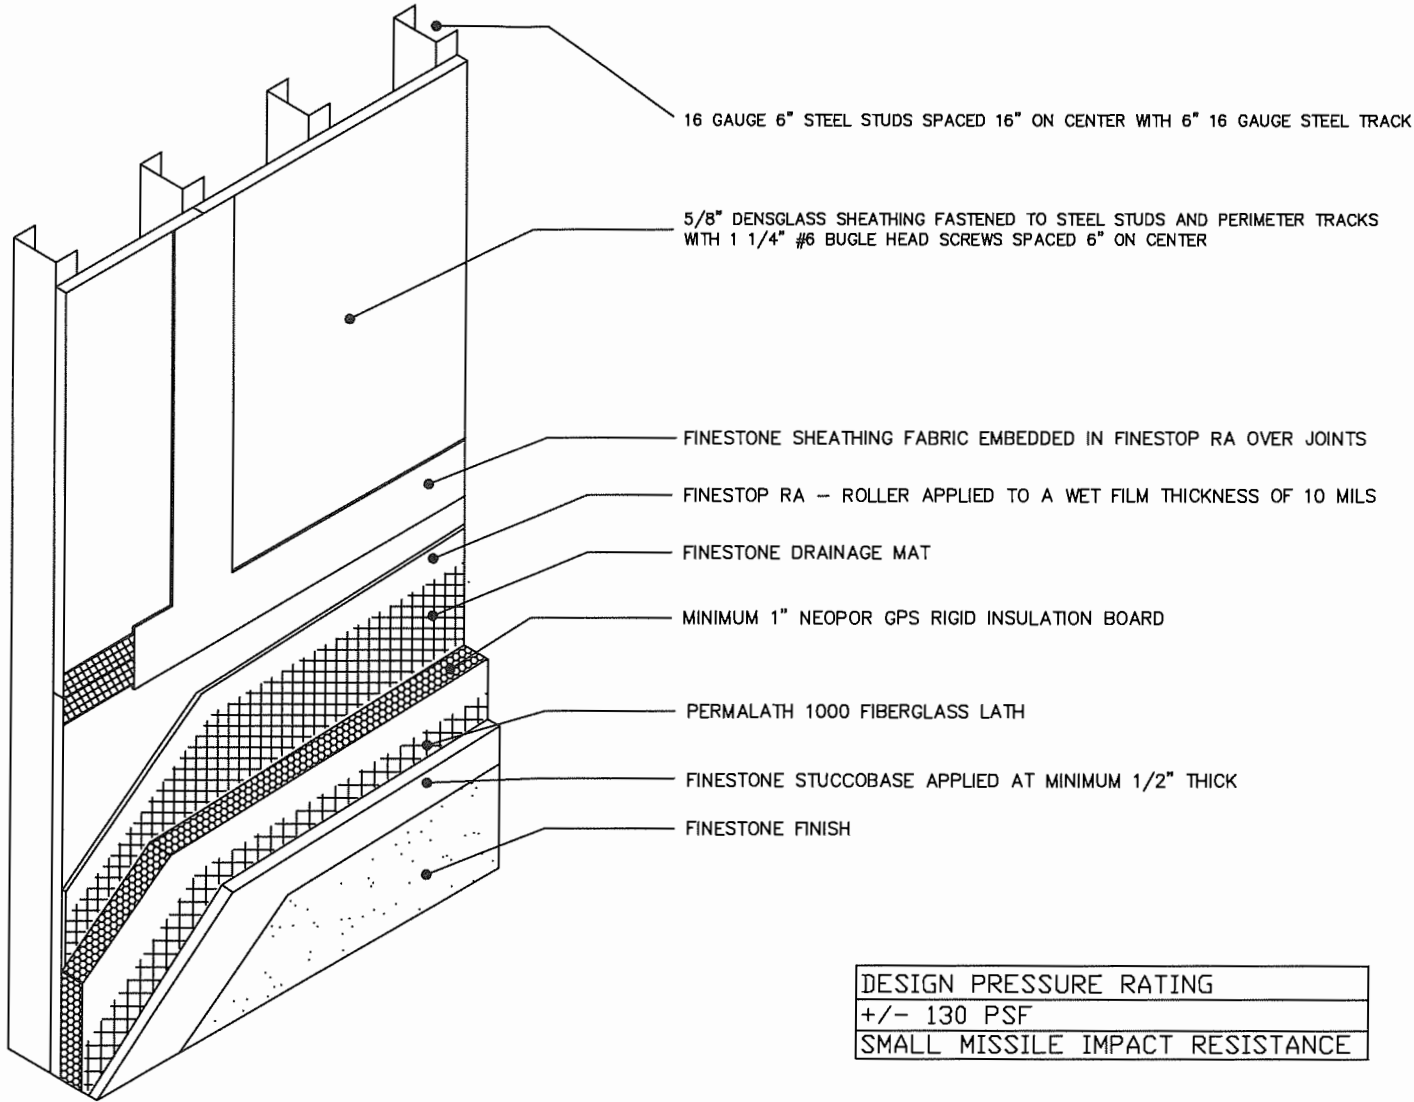

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 24-1007.16
Expiration Date 10/08/2025
By Ishag I. Chande
Miami-Dade Product Control

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 21-0517.13
Expiration Date 10/08/2025
By Ishag I. Chande
Miami-Dade Product Control


FINESTONE

DATE: 1/17/20 Page 1 of 3

Assembly Detail for Finestone
Platinum CI Stucco Ultra Wall
System with Finestop RA over
DensGlass Sheathing and 16ga
Steel Frame (Small Missile)

REVISIONS DATES

FLORIDA P.E.: William O. Bishop, P.E.
REGISTRATION NO.: 63305

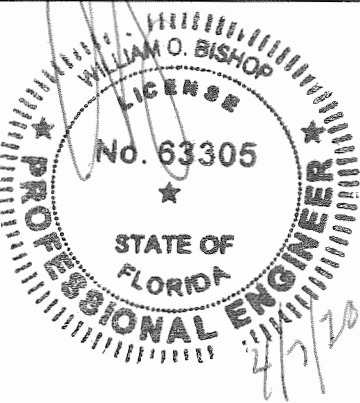

FOR OFFICE USE


PRODUCT APPROVED
as complying with the Florida
Building Code
NOA-No. 20-0630.14
Approval Date 10/08/2020
By [Signature]
Miami-Dade Product Control

Master Builders Solutions US, LLC
23700 Chagrin Blvd
Beachwood, OH 44122
800-589-1336

Typical Details for Finestone
 Platinum CI Stucco Ultra System
 (Small Missile)

REVISIONS
 DATES

FLORIDA P.E.: William O. Bishop, P.E.
 REGISTRATION NO.: 63305

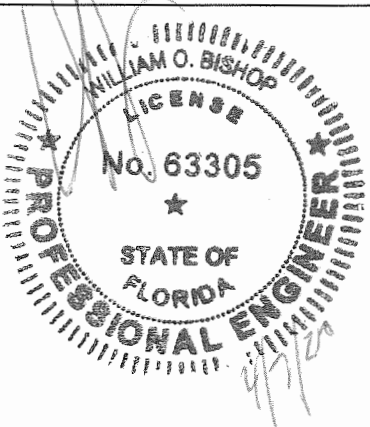


FOR OFFICE USE

PRODUCT APPROVED
 as complying with the Florida
 Building Code
 NOA-No. 20-0630.14


Approval Date 10/08/2020

By *[Signature]*
 Miami-Dade Product Control


Master Builders Solutions US, LLC
 23700 Chagrin Blvd
 Beachwood, OH 44122
 800-589-1336

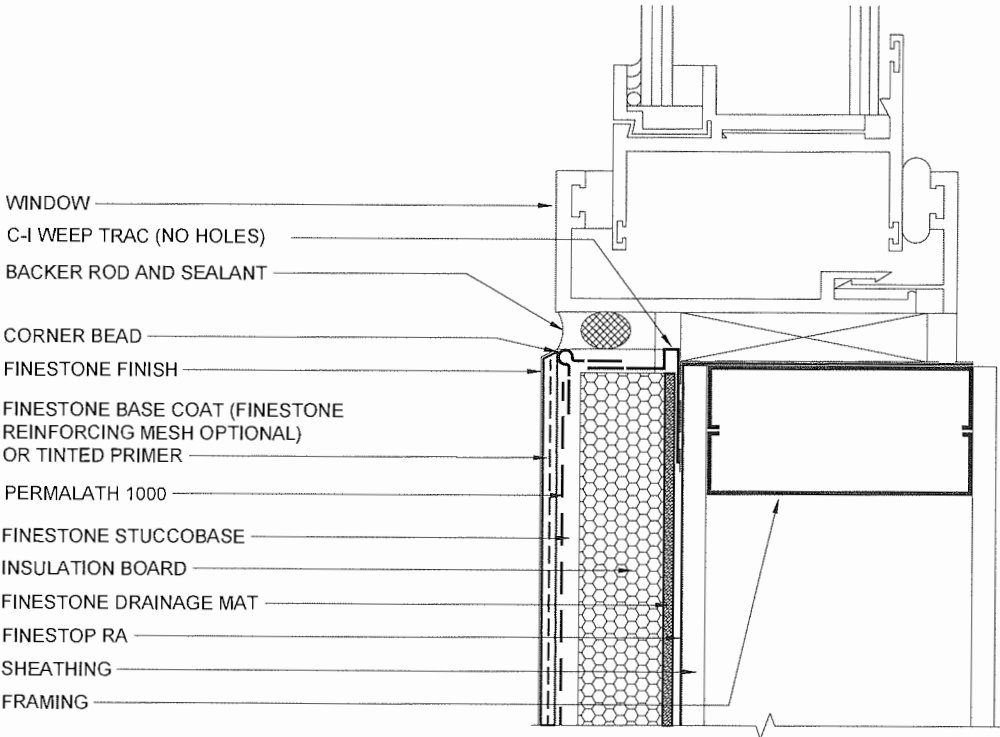

WINDOW JAMB DETAIL (FLUSH)

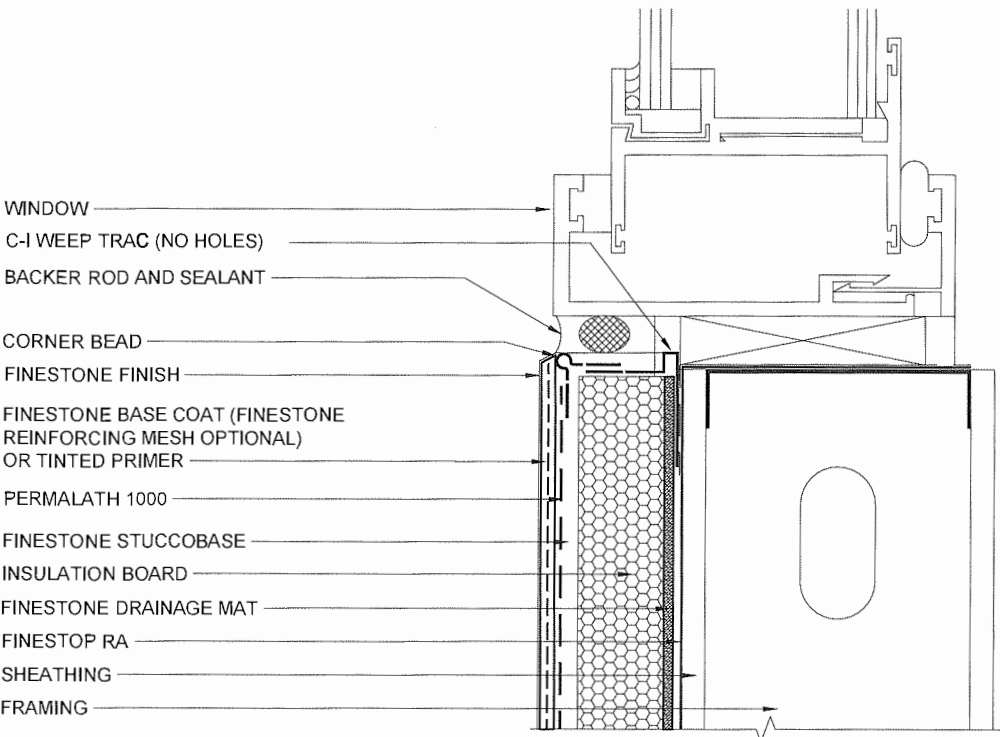


WINDOW SILL DETAIL (FLUSH)

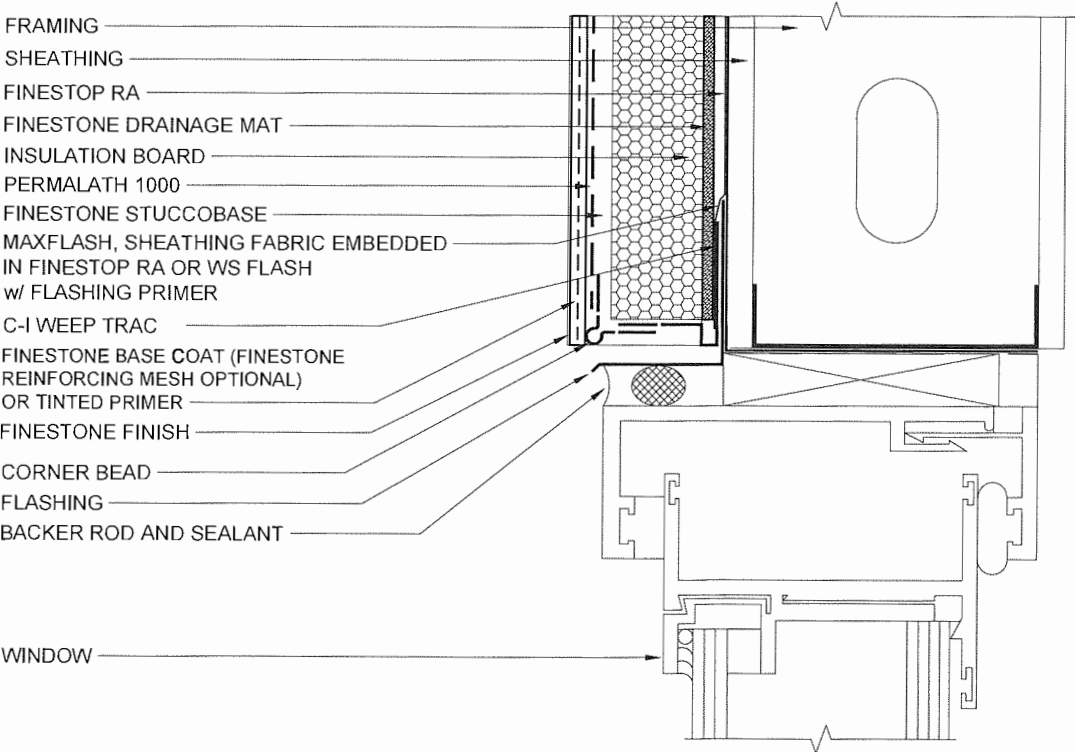


WINDOW HEAD (FLUSH)

PRODUCT REVISED
 as complying with the Florida
 Building Code
 NOA-No. 24-1007.16
 Expiration Date 10/08/2025
 By *Ishtaq I. Chande*
 Miami-Dade Product Control


PRODUCT REVISED
 as complying with the Florida
 Building Code
 NOA-No. 21-0517.13
 Expiration Date 10/08/2025
 By *Ishtaq I. Chande*
 Miami-Dade Product Control

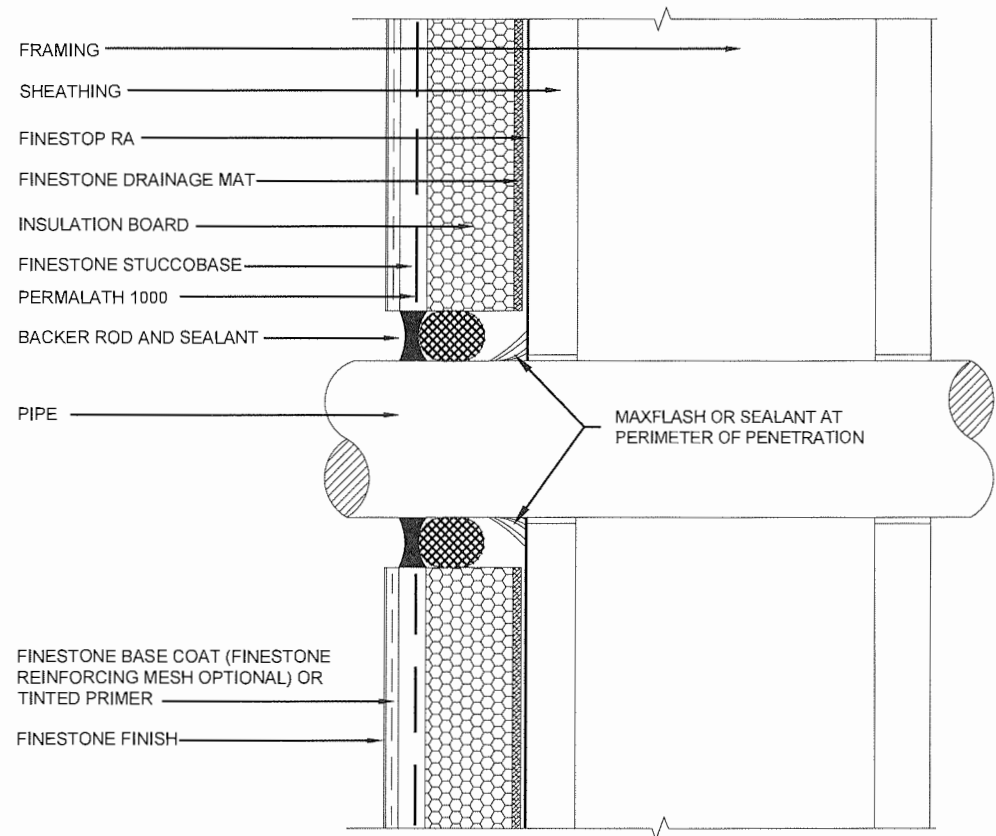

PIPE PENETRATION

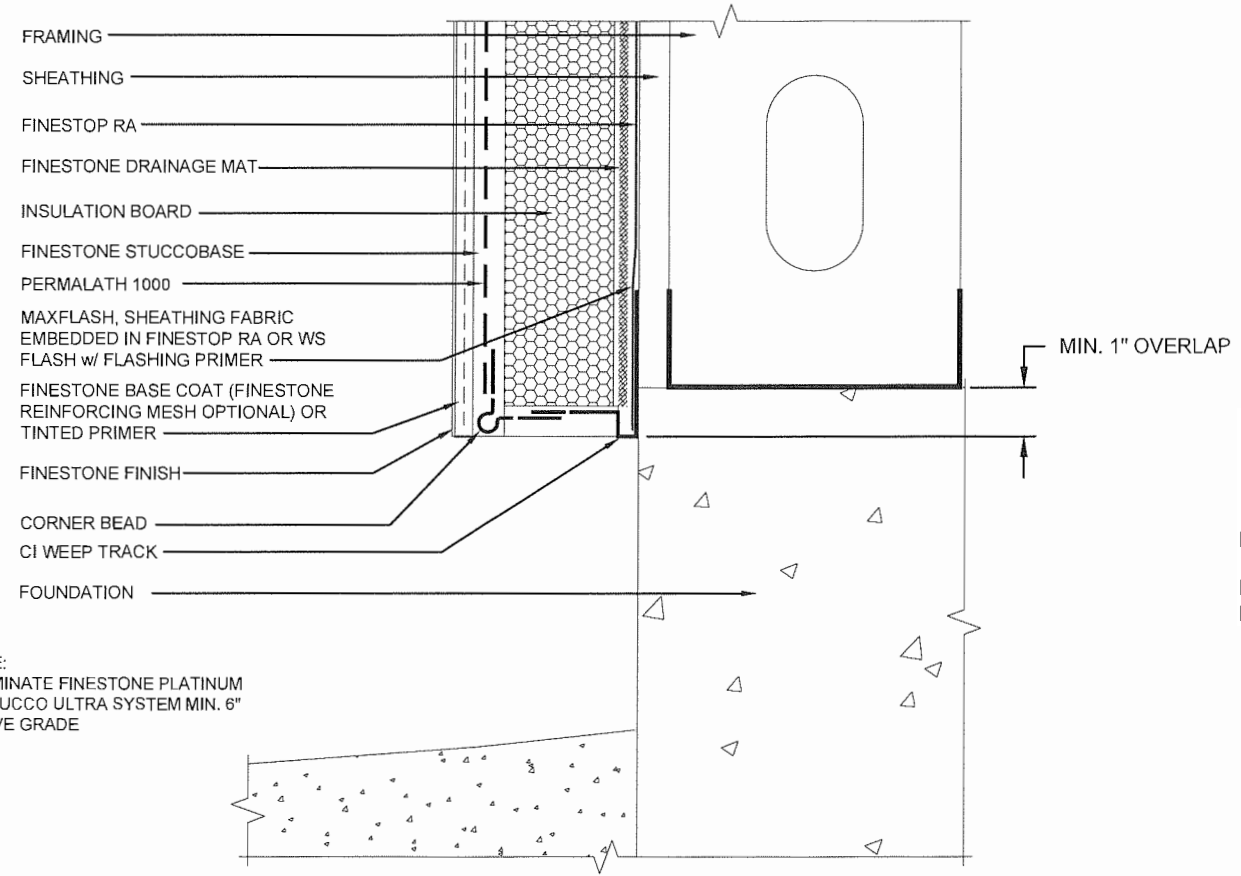

TERMINATION AT FOUNDATION

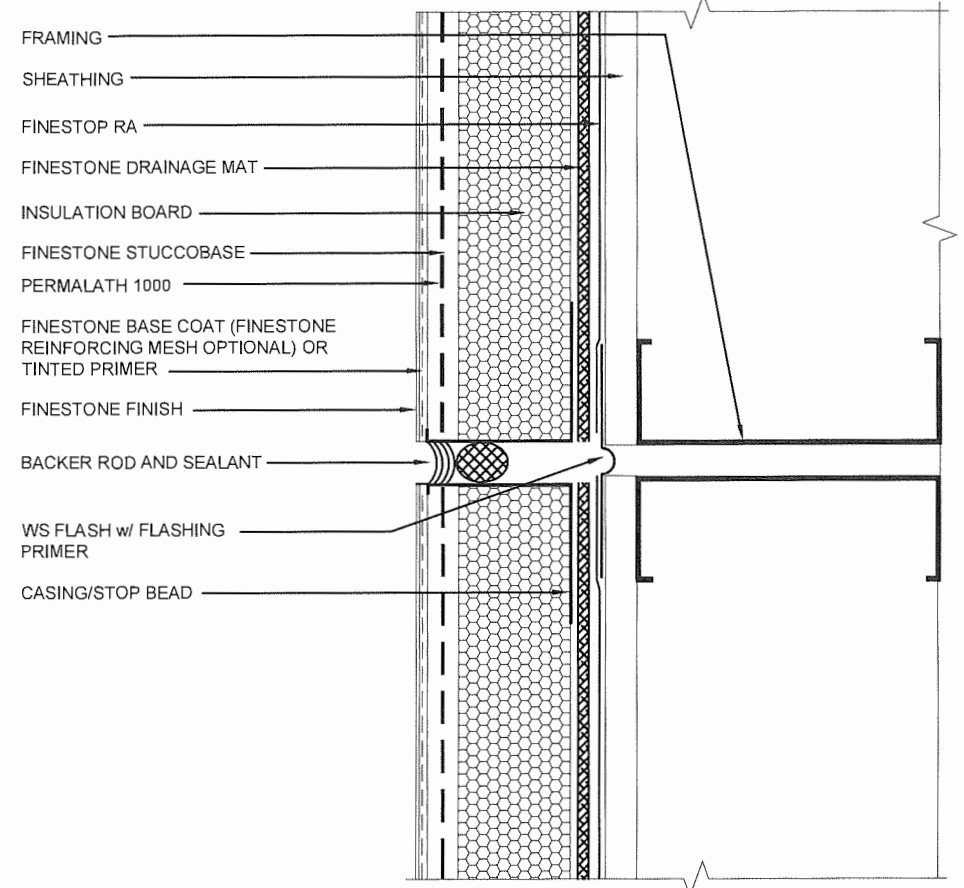

EXPANSION JOINT DETAIL (PLAN VIEW)

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 24-1007.16
Expiration Date 10/08/2025
By Ishaq I. Chanda
Miami-Dade Product Control

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 21-0517.13
Expiration Date 10/08/2025
By Ishaq I. Chanda
Miami-Dade Product Control


FINESTONE

DATE: 1/17/20 Page 3 of 3

Typical Details for Finestone
Platinum CI Stucco Ultra System
(Small Missile)

REVISIONS	DATES
-----------	-------

FLORIDA P.E.: William O. Bishop, P.E.
REGISTRATION NO.: 63305

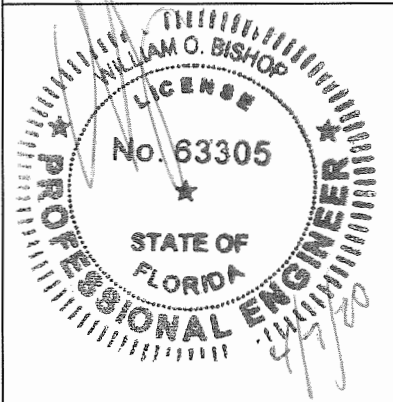

FOR OFFICE USE

PRODUCT APPROVED
as complying with the Florida
Building Code
NOA-No. 20-0630.14
Approval Date 10/08/2020
By [Signature]
Miami-Dade Product Control

Master Builders Solutions US, LLC
23700 Chagrin Blvd
Beachwood, OH 44122
800-589-1336