



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)  
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY  
PRODUCT CONTROL SECTION  
11805 SW 26 Street, Room 208  
Miami, Florida 33175-2474  
T (786) 315-2590 F (786) 315-2599  
[www.miamidade.gov/economy](http://www.miamidade.gov/economy)

## NOTICE OF ACCEPTANCE (NOA)

Westlake Royal Roofing, LLC  
7575 Irvine Center Drive, Suite 100  
Irvine, CA 92618

### SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER - Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (in Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code including the High Velocity Hurricane Zone of the Florida Building Code.

### DESCRIPTION: Saxony 900 Concrete Roof Tile

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA# 22-1118.07 and consists of pages 1 through 11.  
The submitted documentation was reviewed by Alex Tigera.

03/06/25



NOA No.: 24-1008.12  
Expiration Date: 04/26/27  
Approval Date: 02/06/25  
Page 1 of 11

## ROOFING ASSEMBLY APPROVAL

**Category:** Roofing  
**Sub-Category:** Roofing Tiles  
**Material:** Concrete  
**Deck Type:** Wood

### 1. SCOPE

This NOA approves a system using **Saxony 900 (Slate, Shake & Split Shake) Concrete Roof Tile**, as manufactured Westlake Royal Roofing LLC in Lake Wales, FL and described this Notice of Acceptance. For locations where the pressure requirements, as determined by applicable Building Code, do not exceed the design pressure values obtained by calculations in compliance with RAS 127 using the values listed in the installation section herein. The attachment calculations shall be done as a moment based system.

### 2. PRODUCT DESCRIPTION

<b><u>Manufactured by</u></b> <b><u>Applicant</u></b>	<b><u>Dimensions</u></b>	<b><u>Test</u></b> <b><u>Specifications</u></b>	<b><u>Product</u></b> <b><u>Description</u></b>
Saxony 900-Slate	Length = 17" Width = 13" thickness = 1-5/32"	TAS 112	Flat/Low profile, interlocking, high-pressure extruded concrete roof tile with two nail holes. For direct deck, batten, mortar set or adhesive set applications.
Saxony 900 - Split Shake	Length = 17" Width = 13" thickness = 1-9/32"	TAS 112	Flat/Low profile, interlocking, high-pressure extruded concrete roof tile with two nail holes. For direct deck, batten, mortar set or adhesive set applications. Top surface produced with 4 different configurations: <ol style="list-style-type: none"><li>1. Complete tile brushed</li><li>2. Right half brushed (shown in drawing)</li><li>3. Left half brushed</li><li>4. No brush</li></ol>
Saxony 900-Shake	Length = 17" Width = 13" thickness = 1-9/32"	TAS 112	Flat/Low profile, interlocking, high-pressure extruded concrete roof tile with two nail holes. For direct deck, batten, mortar set or adhesive set applications.
Trim Pieces	Length: varies Width: varies varying thickness	TAS-112	Accessory trim, boosted Barcelona, concrete roof pieces for use at hips, ridges and rakes.



NOA No.: 24-1008.12  
Expiration Date: 04/26/27  
Approval Date: 02/06/25  
Page 2 of 11

## 2.1 PRODUCTS MANUFACTURED BY OTHERS

<u>Product Name</u>	<u>Product Description</u>	<u>Manufacturer (With Current NOA)</u>
APOC® Polyset® RTA-1 (HFO)	Single component polyurethane foam roof tile adhesive.	ICP Construction Inc.
APOC® Polyset® AH-160 (HFC)	Two component polyurethane foam adhesive.	ICP Construction, Inc.
APOC® Polyset® AH-160 (HFO1)	Two component polyurethane foam adhesive.	ICP Construction, Inc.
APOC® Polyset® AH-160 (HFO2)	Two component polyurethane foam adhesive.	ICP Construction, Inc.
TILE BOND™ Roof Tile Adhesive	Single component polyurethane foam roof tile adhesive.	DuPont de Nemours, Inc.
“Tile Tite” Roof Tile Mortar	Premixed, pre-bagged roof tile mortar.	Bermuda Roof Co. Inc.
DAP StormBond® 2 Roof Tile Adhesive	Two component polyurethane foam adhesive.	DAP Global, Inc.
DAP StormBond® Roof Tile Adhesive	One component polyurethane foam adhesive.	DAP Global, Inc.

## 2.2 MANUFACTURING LOCATION

### 2.2.1. Lake Wales, FL

## 2.3 EVIDENCE SUBMITTED:

<u>Test Agency</u>	<u>Test Identifier</u>	<u>Test Name/Report</u>	<u>Date</u>
The Center for Applied Engineering, Inc.	94-084	Static Uplift Testing TAS 101 (Mortar Set)	May 1994
	94-060A	Static Uplift Testing TAS 101 (Adhesive Set)	March, 1994
	25-7183-6	Static Uplift Testing TAS 102 (2 Quik-Drive Screws, Direct Deck)	Feb. 1995
	25-7183-5	Static Uplift Testing TAS 102 (2 Quik-Drive Screws, Battens)	Feb. 1995
	25-7214-1	Static Uplift Testing TAS 102 (1 Quik-Drive Screw, Direct Deck)	March, 1995
	25-7214-5	Static Uplift Testing TAS 102 (1 Quik-Drive Screw, Battens)	March, 1995
	Project No. 307025	Wind Driven Rain	Oct. 1994



NOA No.: 24-1008.12  
 Expiration Date: 04/26/27  
 Approval Date: 02/06/25  
 Page 3 of 11

	Test #MDC-77	TAS 100	
Redland Technologies	7161-03 Appendix II & III Letter Dated Aug. 1, 1994	Wind Tunnel Testing TAS 108 (Nail-On) Wind Tunnel Testing TAS 108 (Nail-On) Wind Tunnel Testing TAS 108 (Mortar Set) Withdrawal Resistance Testing of screw vs. smooth shank nails	Dec. 1991  Aug. 1994  July 1994  Sept. 1993
	P0631-01		
	P0402		
Atlanta Testing & Engineering, Inc.	R1.894/R2.894/R3.894	Physical Properties TAS 112	Aug. 1994
Celotex Corporation Testing Service	520109-1 520111-4 520191-1	Static Uplift Testing TAS 101 Static Uplift Testing TAS 101	Dec. 1998  March 1999
Walker Engineering, Inc.	Evaluation Calculations Evaluation Calculations Evaluation Calculations  Evaluation Calculations Evaluation Calculations Calculations Evaluation Calculations	25-7094 25-7496 25-7584/25-7804b-8/25-7804-4 & 5 25-7848-6 25-7183 Aerodynamic Multipliers Two Patty Adhesive Set System Restoring Moments Due to Gravity	February 1996 April 1996 December 1996  March 1995 09/01/16 April 1999 09/01/16
American Test Lab of South Florida	RT0617.04-16 RT0209.01-22 RT0209.04-22	TAS 112 TAS 112 TAS 112	06/29/16 02/01/22 02/17/22
PRI Construction Material Technologies	COPO-002-02-12 COPO-002-02-06 COPO-002-02-05 BORR-022-02-01 BORR-022-02-02 BORR-022-02-03 BORR-022-02-04 2002T0003.03	TAS 101 TAS 101 TAS 101 TAS 101 TAS 101 TAS 101 TAS 101 TAS 101	10/12/2016 10/12/2016 10/12/2016 02/25/2019 02/25/2019 02/25/2019 02/28/2019 11/06/20
NEMO ETC, LLC	4p-ICP-20-SSLAP-01.A 4c-DPBS-20-LSOTM-01.C.R1 4c-ICP-21-LSOTM-01.A 4p-ICP-22-SSLAP-06.A 4c-ICP-23-LSOTM-02.A 4c-ICP-23-LSOTM-01.A	ASTM D1623 TAS 101 TAS 101 ASTM D1623 TAS 101 TAS 101	12/15/20 12/17/20 01/26/22 08/29/23 11/12/24 11/13/24

### 3. LIMITATIONS:

- 3.1 Fire classification is not part of this acceptance.
- 3.2 For mortar or adhesive set tile applications, a static field uplift test shall be performed in accordance with TAS 106.
- 3.3 Applicant shall retain the services of a Miami-Dade County Certified Laboratory to perform quarterly test in accordance with TAS 112, appendix 'A'. Such testing shall be submitted to the Building Code Compliance Office for review.
- 3.4 Minimum underlayment shall be in compliance with the applicable Roofing Applications Standards listed section 4.1 herein.
- 3.5 30/90 hot mopped underlayment applications may be installed perpendicular to the roof slope unless stated otherwise by the underlayment material manufacturers published literature.
- 3.6 This acceptance is for wood deck applications. Minimum deck requirements shall be in compliance with applicable building code.

### 4. INSTALLATION

- 4.1 Saxony 900 (Slate, Shake & Split Shake) Concrete Roof Tile and its components shall be installed in strict compliance with Roofing Application Standard RAS 118, RAS 119, and RAS 120.
- 4.2 Data For Attachment Calculations

**Table 1: Average Weight (W) and Dimensions (l x w )**

Tile Profile	Weight-W (lbf)	Length-l (ft)	Width-w (ft)
Saxony 900 Slate, Shake & Split Shake	10.9	1.417	1.08

**Table 2: Aerodynamic Multipliers -  $\lambda$  (ft<sup>3</sup>)**

Tile Profile	$\lambda$ (ft <sup>3</sup> ) Batten Application	$\lambda$ (ft <sup>3</sup> ) Direct Deck Application
Saxony 900 Slate, Shake & Split Shake	0.291	0.315

**Table 3: Restoring Moments due to Gravity -  $M_g$  (ft-lbf)**

Tile Profile	2":12"	3":12"	4":12"		5":12"		6":12"		7":12" or greater	
Saxony 900 Slate &, Shake & Split Shake	Direct Deck	Direct Deck	Battens	Direct Deck	Battens	Direct Deck	Battens	Direct Deck	Battens	Direct Deck
	7.70	7.62	6.61	7.50	6.48	7.34	6.31	7.16	6.13	6.95



**Table 4: Attachment Resistance Expressed as a Moment -  $M_r$  (ft.-lbf)  
for Mechanically Fastened Systems**

Tile Profile	Fastener Type	Direct Deck (min 15/32" plywood)	Direct Deck (min. 19/32" plywood)	Battens
Saxony 900 Slate, Shake & Split Shake	2-10d Ring Shank Nails	30.9	38.1	17.2
	1-10d Smooth or Screw Shank Nail	7.3	9.8	4.9
	2-10d Smooth or Screw Shank Nails	14.0	18.8	7.4
	1 #8 Screw	30.8	30.8	18.2
	2 #8 Screw	51.7	51.7	24.4
	1-10d Smooth or Screw Shank Nail (Field Clip)	24.3	24.3	24.2
	1-10d Smooth or Screw Shank Nail (Eave Clip)	19.0	19.0	22.1
	2-10d Smooth or Screw Shank Nails (Field Clip)	35.5	35.5	34.8
	2-10d Smooth or Screw Shank Nails (Eave Clip)	31.9	31.9	32.2

**Table 5: Attachment Resistance Expressed as a Moment  $M_r$  (ft.-lbf)  
for Two Patty Adhesive<sup>1</sup> Set Systems**

<b>Tile Profile:</b> Saxony 900, Slate, Shake & Split Shake			
Tile Application	Paddy weight	Adhesive Contact Area	Minimum Attachment Resistance
TILE BOND™ Roof Tile Adhesive – (Interdependent)	12.5 grams each	16 in <sup>2</sup> per paddy	63
TILE BOND™ Roof Tile Adhesive – (Independent)	25 grams each	8 in <sup>2</sup>	65
APOC® Polyset® AH-160 (HFC & HFO1)	8 grams each	-	31
APOC® Polyset® AH-160 (HFO2)	12 grams to underlayment	(4" x 4") 16 in <sup>2</sup>	55
	14 grams at headlap	(4" x 2") 8 in <sup>2</sup>	
APOC® Polyset® RTA-1 (HFO)	12 grams to underlayment	(4" x 3") 12 in <sup>2</sup>	41
	10 grams at headlap	(1" x 10") 10 in <sup>2</sup>	
DAP StormBond® Roof Tile Adhesive	8 grams each		59
DAP StormBond® 2 Roof Tile Adhesive	8 grams each	-	109
1. See manufacturer component approval for installation requirements.			



**Table 6: Attachment Resistance Expressed as a Moment -  $M_r$  (ft.-lbf)  
for Single Patty Adhesive<sup>2</sup> Set Systems**

**Tile Profile:** Saxony 900, Slate, Shake & Split Shake

Tile Application	Paddy weight	Adhesive Contact Area	Minimum Attachment Resistance
APOC® Polyset® AH-160 (HFC & HFO1)	45 grams each	-	119
APOC® Polyset® AH-160 (HFC & HFO1)	34 grams each	-	115
APOC® Polyset® AH-160 (HFC & HFO1)	24 grams each	-	83
APOC® Polyset® AH-160 (HFC & HFO1)	18 grams each	-	60
DAP StormBond® 2 Roof Tile Adhesive	45 grams each	-	93
DAP StormBond® 2 Roof Tile Adhesive	24 grams each	-	62

2. See manufacturer component approval for installation requirements.

**Table 7: Attachment Resistance Expressed as a Moment -  $M_r$  (ft.-lbf)  
for Mortar Set Systems**

Tile Profile	Tile Application	Attachment Resistance
Saxony 900 Slate &, Shake & Split Shake	Mortar Set <sup>3</sup>	44

3. Bermuda Roof Co. Inc. Tile-Tite Roof Tile Mortar.

**Table 8: Attachment Resistance Expressed as a Moment  $M_f$  (ft.-lbf)  
for Hybrid Attachment (Adhesive<sup>4</sup> and Mechanical)**

**Tile Profile:** Saxony 900, Slate, Shake & Split Shake

Tile Application	Paddy weight	Adhesive Contact Area	Minimum Attachment Resistance
Two (2) #8 Screws and APOC® Polyset® RTA-1 (HFO)	11 grams at headlap	-	39

4 See manufacturer component approval for installation requirements.




## 5. LABELING

- 5.1 All tiles shall bear the imprint or identifiable marking of the manufacturer's name or logo as detailed below, or following statement: "Miami-Dade County Product Control Approved".



OR



**LABEL FOR SAXONY 900 TILES (LAKE WALES FL PLANT)  
LOCATED UNDERNEATH TILE**

## 6. BUILDING PERMIT REQUIREMENTS


- 6.1 Application for building permit shall be accompanied by copies of the following:
- 6.1.1 This Notice of Acceptance.
  - 6.1.2 Any other documents required by the Building Official or applicable building code in order to properly evaluate the installation of this system.



NOA No.: 24-1008.12  
Expiration Date: 04/26/27  
Approval Date: 02/06/25  
Page 8 of 11




## PROFILE DRAWINGS

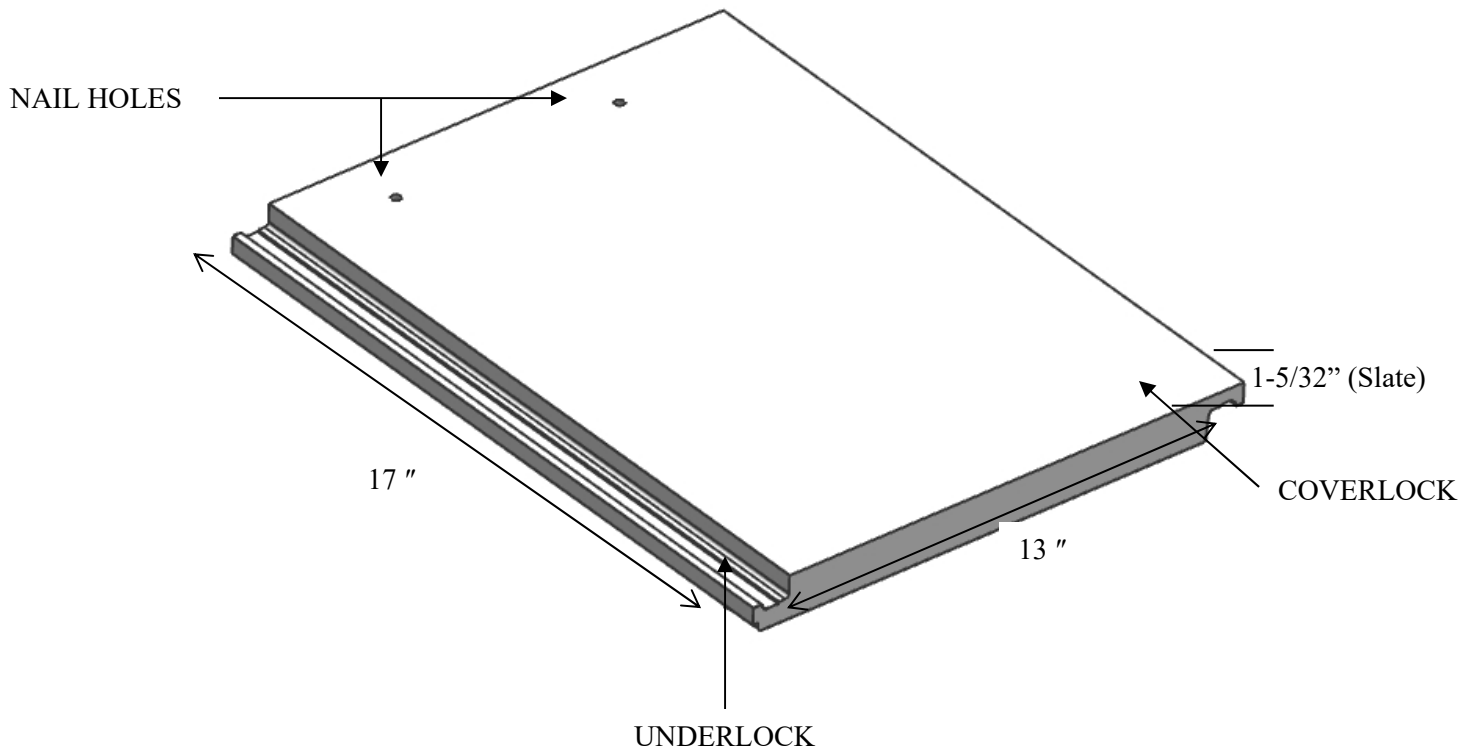

## SAXONY 900 - SLATE



## PROFILE DRAWINGS

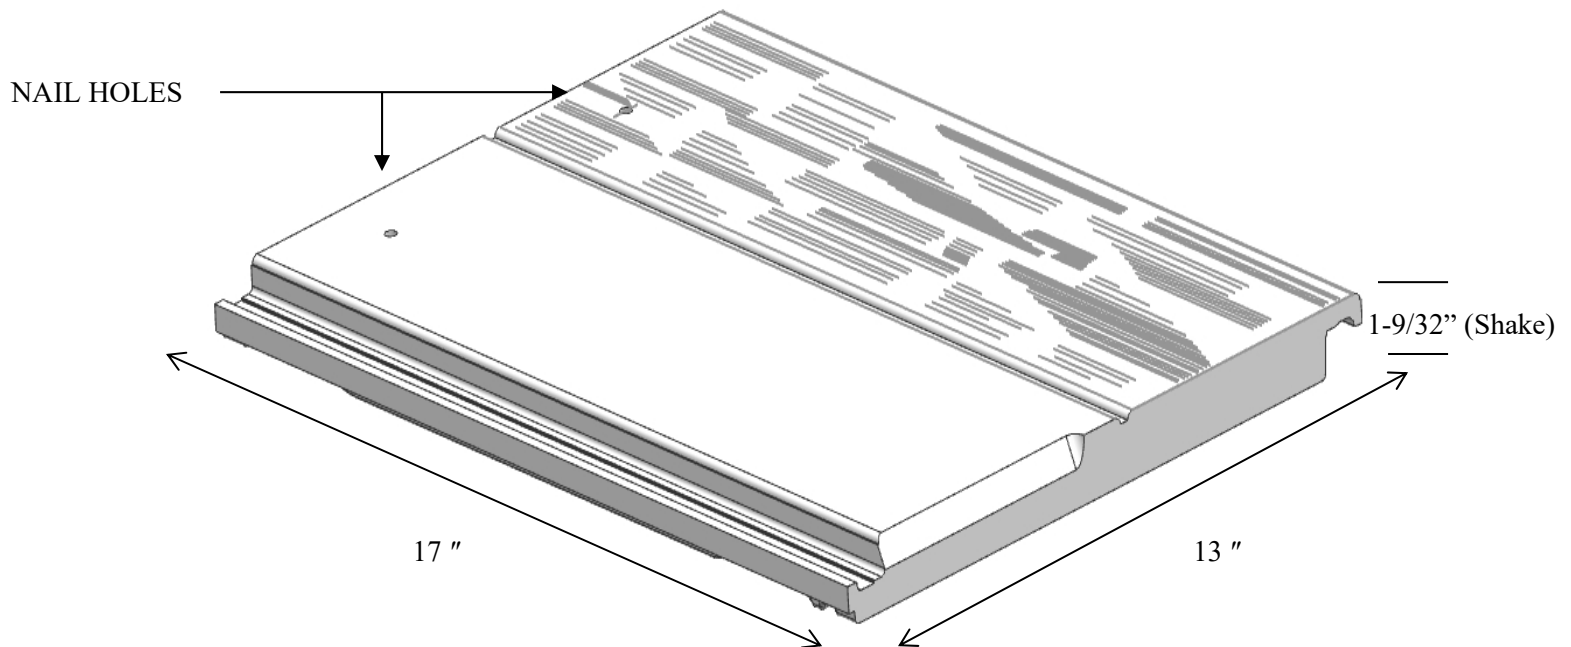


### Note: Available Top Surface Finishes

1. Complete tile brushed
2. Right half brushed (shown in drawing)
3. Left half brushed
4. No brush

## SAXONY 900 - SPLIT SHAKE



## PROFILE DRAWINGS

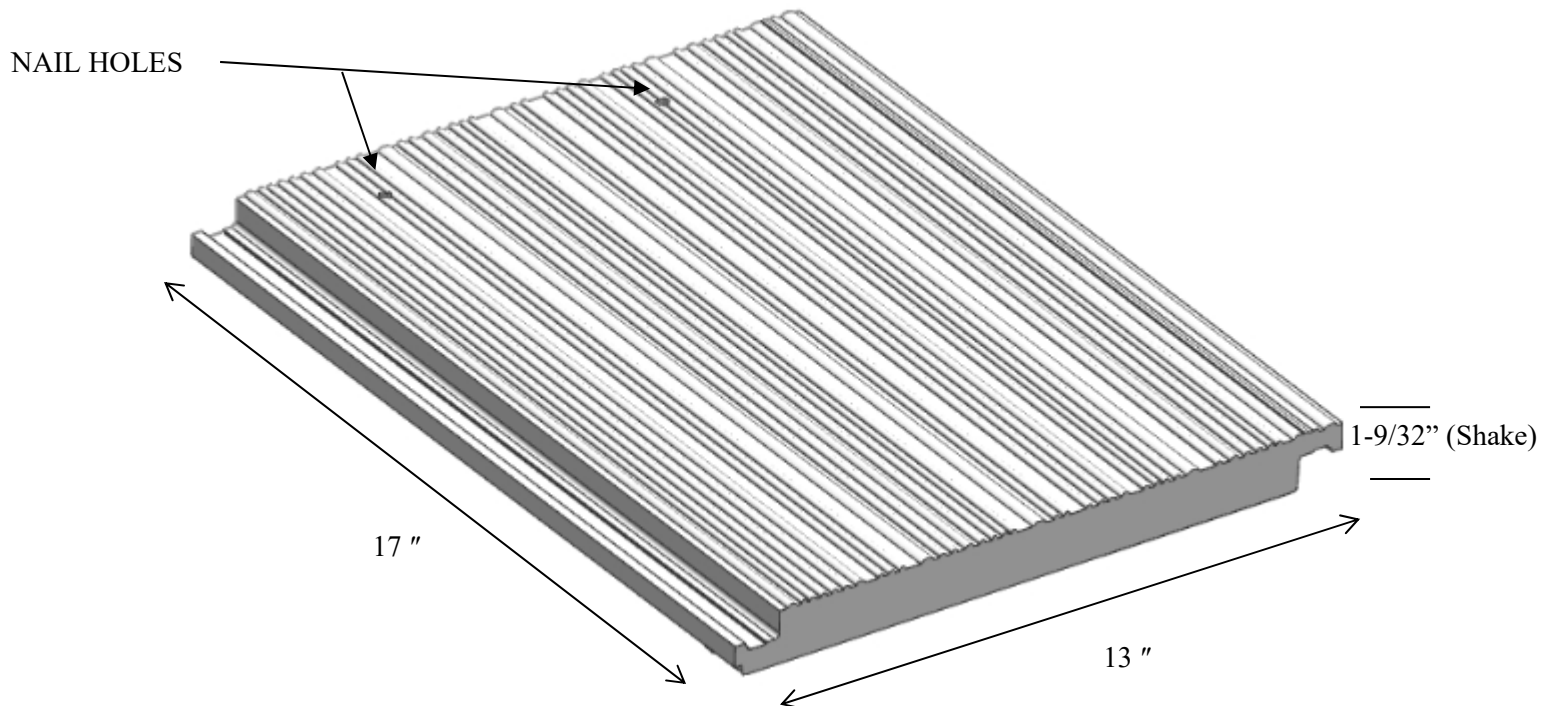

## SAXONY 900- SHAKE

**END OF THIS ACCEPTANCE**



NOA No.: 24-1008.12  
Expiration Date: 04/26/27  
Approval Date: 02/06/25  
Page 11 of 11