



MIAMI-DADE COUNTY  
PRODUCT CONTROL SECTION  
11805 SW 26 Street, Room 208  
Miami, Florida 33175-2474  
T (786) 315-2590 F (786) 315-2599  
[www.miamidade.gov/building](http://www.miamidade.gov/building)

DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)  
BOARD AND CODE ADMINISTRATION DIVISION  
**NOTICE OF ACCEPTANCE (NOA)**

**Tecnoglass, LLC**  
**3550 NW 49 Street**  
**Miami, FL 33142**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION: Series "500Y" Aluminum Single Hung Window – S.M.I.**

**APPROVAL DOCUMENT:** Drawing No. **W03-111**, titled "Series 500Y Alum Single Hung Window (S.M.I.)", sheets 1 through 3, 3.1, 4, 4.1, 5 and 6 through 10 of 10, dated 12/11/03, with revision **L** dated 02/17/25, prepared by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

**MISSILE IMPACT RATING: Small Missile Impact Resistant.**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, **Barranquilla, Colombia S.A.**, series and following statement: "Miami-Dade County Product Control Approved" unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/ or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.


**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises and renews NOA No. 23-0928.11** and consists of this page 1, evidence pages E-1, E-2, E-3 and E-4, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



  
4/10/25

**NOA No. 25-0312.06**  
**Expiration Date: June 23, 2030**  
**Approval Date: April 17, 2025**  
**Page 1**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**


**1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's**

**A. DRAWINGS**

1. Manufacturer's die drawings and sections.  
*(Submitted under NOA's No. 07-0706.07 and 05-0519.01)*
2. Drawing No. **W03-111**, titled "Series 500Y Alum Single Hung Window (S.M.I.)", sheets 1 through 10 of 10, dated 12/11/03, with revision **K** dated 09/14/23, prepared by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.  
*(Submitted under NOA No. 23-0928.11)*

**B. TESTS**

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Small Missile Impact Test per FBC, TAS 201-94  
5) Large Missile Impact Test per FBC, TAS 201-94  
6) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
along with marked-up drawings and installation diagram of an aluminum single hung window, prepared by Fenestration Testing Laboratories, Inc., Test Report No. **FTL-5988**, dated 08/31/09, signed and sealed by Julio E. Gonzalez, P.E.  
*(Submitted under NOA No. 07-0706.07)*
2. Test report on: 1) Pendulum Impact Test, per CPSC 16 CFR 1201 Category II, along with marked-up drawings and installation diagram of an aluminum fixed window, prepared by Fenestration Testing Laboratories, Inc., Test Report No. **FTL-5321**, dated 07/05/07, signed and sealed by Carlos S. Rionda, P.E.  
*(Submitted under NOA No. 07-0706.07)*
3. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Small Missile Impact Test, per FBC, TAS 201-94  
5) Cyclic Wind Pressure Loading, per FBC, TAS 203-94  
6) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94  
along with marked-up drawings and installation diagram of an aluminum single hung window, prepared by Fenestration Testing Laboratories, Inc., Test Reports No. **FTL-4526** and **FTL-4352**, dated 02/18/05 and 01/10/05 respectively, both signed and sealed by Edmundo Largaespada, P.E.  
*(Submitted under NOA No. 05-0519.01)*

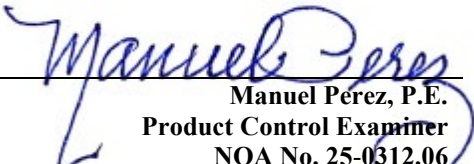  
Manuel Perez, P.E.  
Product Control Examiner  
NOA No. 25-0312.06  
Expiration Date: June 23, 2030  
Approval Date: April 17, 2025

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's (CONTINUED)**

**B. TESTS (CONTINUED)**

4. Test reports on: 1) Large Missile Impact Test per FBC, TAS 201-94  
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
along with marked-up drawings and installation diagram of an aluminum single hung window, prepared by Fenestration Testing Laboratories, Inc., Test Report No. **FTL-4268**, dated 01/10/05, signed and sealed by Edmundo Largaespada, P.E.  
*(Submitted under NOA No. 05-0519.01)*

**C. CALCULATIONS**

1. Anchor verification calculations and structural analysis, dated 04/07/15 and updated on 02/16/18, to comply with FBC 6<sup>th</sup> Edition (2017), and updated on 11/20/20 to comply with FBC 7<sup>th</sup> Edition (2020), prepared by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.  
*(Submitted under NOA No. 20-1202.09)*
2. Glazing complies with **ASTM E 1300-09**

**D. QUALITY ASSURANCE**


1. Miami-Dade Department of Regulatory and Economic Resources (RER)

**E. MATERIAL CERTIFICATIONS**

1. Notice of Acceptance No. **22-1116.01** issued to **Kuraray America, Inc.** for their "**SentryGlas® (Clear and White) Glass Interlayers**" dated 12/15/22, expiring on 07/04/28.
2. Notice of Acceptance No. **20-0915.22** issued to **Kuraray America, Inc.** for their "**Trosifol® Ultraclear, Clear and Color PVB Glass Interlayers**" dated 11/19/20, expiring on 07/08/24.
3. Notice of Acceptance No. **21-0216.01** issued to **Eastman Chemical Company (MA)** for their "**Saflex PVB Interlayers - Clear and Colored for Glass**" dated 04/29/21, expiring on 05/21/26.

**F. STATEMENTS**

1. Statement letter of conformance, complying with **FBC 7<sup>th</sup> Edition (2020)**, with **FBC 8<sup>th</sup> Edition (2023)** and of no financial interest, dated September 25, 2023, issued by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.  
*(Submitted under NOA No. 23-0928.11)*
2. Asset purchase agreement dated 06/19/14, signed by Mr. Raul Casares, for and on behalf of R.C. Aluminum Industries, Inc. and Mr. José M. Daes, for and on behalf of Tecnoglass, LLC.  
*(Submitted under NOA No. 14-0923.06)*

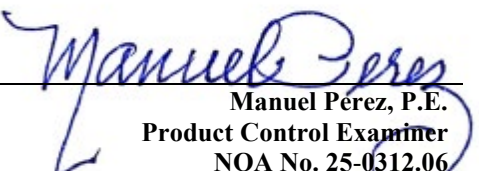  
Manuel Perez, P.E.  
Product Control Examiner  
NOA No. 25-0312.06  
Expiration Date: June 23, 2030  
Approval Date: April 17, 2025

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's (CONTINUED)**

**F. STATEMENTS (CONTINUED)**

3. Statement letter dated 07/15/14, issued by R.C. Aluminum Industries, Inc. of sales of asset and relinquishing of all rights of NOA No. **12-0330.07**, signed by Raul Casares, for and on behalf of R.C. Aluminum Industries, Inc.  
*(Submitted under NOA No. 14-0923.06)*
4. Department of State Certification of **TECNOGLASS, LLC** as a limited liability company, active and organized under the laws of the State of Florida, dated 03/03/14 and signed by Ken Detzner, Secretary of State.  
*(Submitted under NOA No. 14-0923.06)*
5. Laboratory compliance letters for Test Reports No.'s **FTL-4521**, dated 01/18/05 and **FTL-4353**, dated 02/18/05, both issued by Fenestration Testing Laboratories, Inc., signed and sealed by Edmundo J. Largaespada, P.E.  
*(Submitted under NOA No. 05-0519.02)*

**G. OTHERS**

1. Notice of Acceptance No. **20-1202.09**, issued to Tecnoglass, LLC, for their Series "500-Y" Aluminum Single Hung Window – S.M.I., approved on 02/25/21 and expiring on 06/23/25.


**2. NEW EVIDENCE SUBMITTED**

**A. DRAWINGS**

1. Drawing No. **W03-111**, titled "Series 500Y Alum Single Hung Window (S.M.I.)", sheets 1 through 3, 3.1, 4, 4.1, 5 and 6 through 10 of 10, dated 12/11/03, with revision **L** dated 02/17/25, prepared by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.

**B. TESTS**

1. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94  
2) Small Missile Impact Test, per FBC, TAS 201-94  
3) Cyclic Wind Pressure Loading, per FBC, TAS 203-94  
along with marked-up drawings and installation diagram of a series 500Y aluminum single hung window, prepared by Blackwater Technical Services, Inc., Test Report No. **BT-ESW-23-023**, dated 02/13/24, signed and sealed by Michael D. Caldwell, P.E.

  
Manuel Perez, P.E.  
Product Control Examiner  
NOA No. 25-0312.06  
Expiration Date: June 23, 2030  
Approval Date: April 17, 2025

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**2. NEW EVIDENCE SUBMITTED (CONTINUED)**

**C. CALCULATIONS**

1. Anchor verification calculations and structural analysis, to comply with FBC 8<sup>th</sup> Edition (2023), dated 03/10/25, prepared by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.

**D. QUALITY ASSURANCE**

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

**E. MATERIAL CERTIFICATIONS**


1. Notice of Acceptance No. **23-0717.30** issued to **Kuraray America, Inc.** for their “SentryGlas® (Clear and White) Glass Interlayers” dated 08/31/23, expiring on 07/04/28.
2. Notice of Acceptance No. **24-0205.08** issued to **Kuraray America, Inc.** for their “Trosifol® Ultraclear, Clear and Color PVB Glass Interlayers” dated 03/21/24, expiring on 07/08/29.
3. Notice of Acceptance No. **23-0713.18** issued to **Eastman Chemical Company (MA)** for their “Saflex® PVB Clear and Colored Interlayers for Laminated Glass” dated 08/17/23, expiring on 05/21/26.

**F. STATEMENTS**

1. Statement letter of conformance, complying with **FBC 8<sup>th</sup> Edition (2023)** and of no financial interest, dated March 10, 2025, issued by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.

**G. OTHERS**

1. Notice of Acceptance No. **23-0928.11**, issued to Tecnoglass, LLC, for their Series “500Y” Aluminum Single Hung Window – S.M.I., approved on 10/26/23 and expiring on 06/23/25.

  
Manuel Perez, P.E.  
Product Control Examiner  
NOA No. 25-0312.06  
Expiration Date: June 23, 2030  
Approval Date: April 17, 2025



THESE WINDOWS ARE RATED FOR SMALL MISSILE IMPACT.  
MIAMI-DADE COUNTY APPROVED IMPACT RESISTANT SHUTTERS  
ARE REQUIRED FOR INSTALLATIONS UPTO 30 FT. OF GRADE.  
SHUTTERS NOT REQUIRED FOR INSTALLATIONS ABOVE  
30 FT. OF GRADE.

## SERIES 500Y

### ALUMINUM SINGLE HUNG WINDOW

NOA APPLIES TO SINGLE UNITS OR SIDE BY SIDE COMBINATIONS  
OF S.H. TO S.H. OR S.H./FIX. TO S.H./FIX. IN MODULES OF TWO OR  
MORE WINDOWS USING MIAMI-DADE COUNTY APPROVED MULLIONS IN  
BETWEEN.

FOR S.H. WINDOW CAPACITY SEE CHARTS ON SHEETS 3 THRU 4.1.  
FOR WINDOWALL BOTTOM LITE CAPACITY SEE CHART ON SHEET 7.  
FOR WINDOW MULLION CAPACITY SEE CHART ON SHEET 7.  
LOWER DESIGN PRESSURES FROM CHARTS ABOVE WILL APPLY  
TO ENTIRE SYSTEM.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE  
REQUIREMENTS OF THE 2023 (8TH EDITION) FLORIDA BUILDING CODE  
INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

1BY OR 2BY WOOD BUCKS & BUCK FASTENERS BY OTHERS, MUST BE  
DESIGNED AND INSTALLED ADEQUATELY TO TRANSFER APPLIED PRODUCT  
LOADS TO THE BUILDING STRUCTURE.

ANCHORS SHALL BE CORROSION RESISTANT, SPACED AS SHOWN ON DETAILS  
AND INSTALLED PER MANUF'S INSTRUCTIONS. SPECIFIED EMBEDMENT TO BASE  
MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.


A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

ALL SHIMS TO BE HIGH IMPACT, NON-METALLIC AND NON-COMPRESSIBLE.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT  
COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE  
REQUIREMENTS OF THE 2023 FLORIDA BLDG. CODE & ADOPTED STANDARDS.

THIS PRODUCT NOA IS GENERIC AND DOES NOT PROVIDE INFORMATION  
FOR A SITE SPECIFIC PROJECT, i.e. LIFE SAFETY OF THIS PRODUCT, ADEQUACY  
OF STRUCTURE RECEIVING THIS PRODUCT AND SEALING AROUND OPENING FOR  
WATER INFILTRATION RESISTANCE ETC.  
CONDITIONS NOT SHOWN IN THIS DRAWING ARE TO BE ANALYZED SEPARATELY,  
AND TO BE REVIEWED BY BUILDING OFFICIAL.

DESIGN LOADS SHOWN ARE BASED ON 'ALLOWABLE STRESS DESIGN (ASD)'.

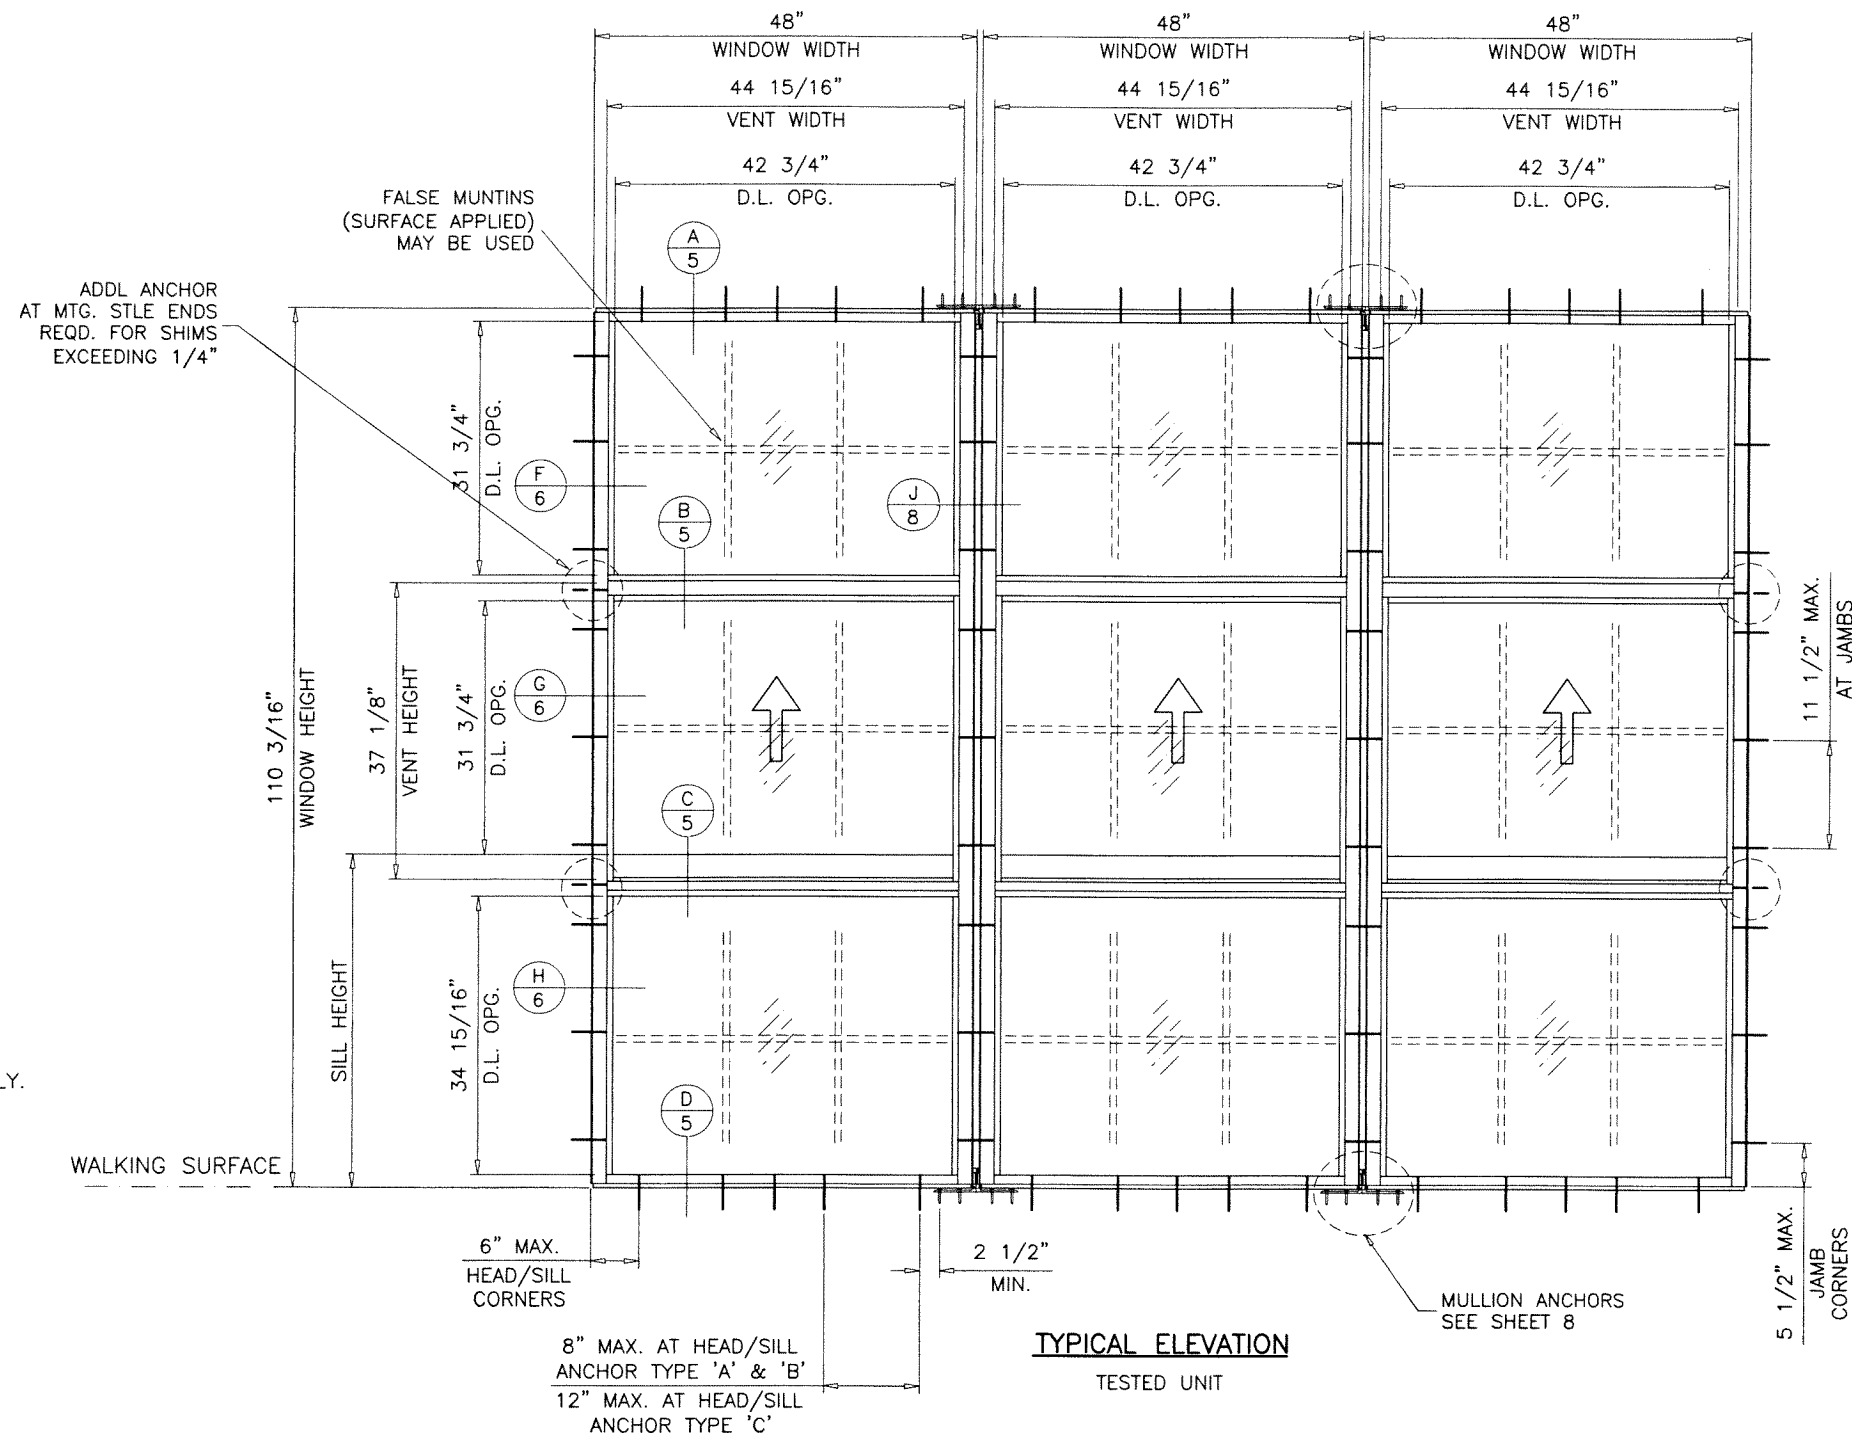


PRODUCT COMPLY WITH REQUIREMENTS OF ANSI Z97.1.  
WITH MINIMUM SILL HEIGHT OF 36 IN. ABOVE WALKING SURFACE.

LAMINATED GLASS  
SMALL MISSILE IMPACT


**PRODUCT REVISED**  
As complying with the Florida  
Building Code  
NOA-No. **25-0312.06**  
Expiration Date: **06/23/2030**  
By: *Manuel Perez*  
Miami-Dade Product Control

MAR 1 1 2025

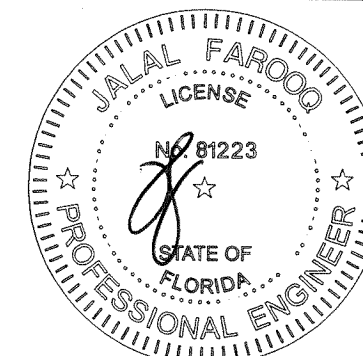

### APPROVED CONFIGURATIONS

NOA APPLIES TO INDIVIDUAL UNITS OF SINGLE HUNG WINDOWS OR SINGLE HUNG OVER FIXED WINDOWS.  
ALSO SIDE BY SIDE COMBINATIONS OF S.H. TO S.H. OR S.H./FIX. TO S.H./FIX. IN MODULES OF TWO OR  
MORE UNITS USING MULLIONS.

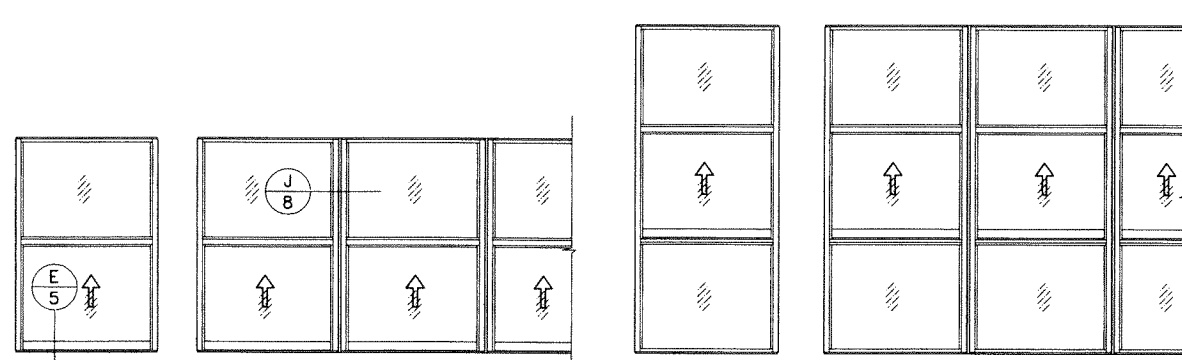


**af c**  
**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
9360 SUNSET DRIVE, SUITE 220  
MIAMI, FLORIDA 33173  
TEL. (305) 262-8100 FAX. (305) 262-6978  
COMP-ANL\W03-111RC

SERIES 500Y ALUM SINGLE HUNG WINDOW (S.M.I.)  
**TECNOGLASS, LLC**  
3550 N.W. 49 STREET  
MIAMI, FL. 33142  
TEL. (305) 638-5151 FAX. (305) 638-5158



no	date	description	by
H	04.08.15	UPDATED TO 2014 FBC	
I	02.22.18	UPDATED TO 2017 FBC	
J	11.20.20	UPDATED TO 2020 FBC	
K	09.14.23	UPDATED TO 2023 FBC	
L	02.17.25	GENERAL REVISION	

date: 12-11-03  
scale: 1/2"=1'-0"  
dr. by: TARIQ  
chk. by:



drawing no.  
**W03-111**  
sheet 1 of 10

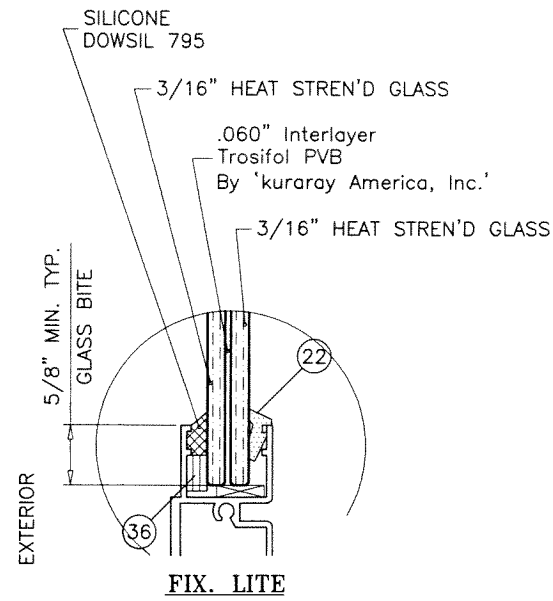



GLASS TYPE 'A'

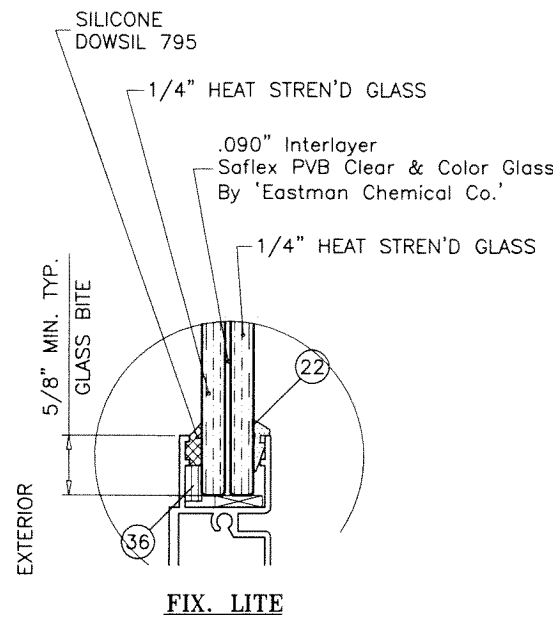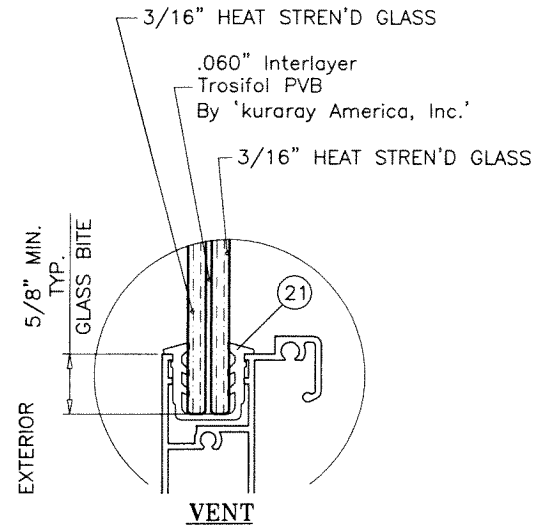


GLASS TYPE 'C'

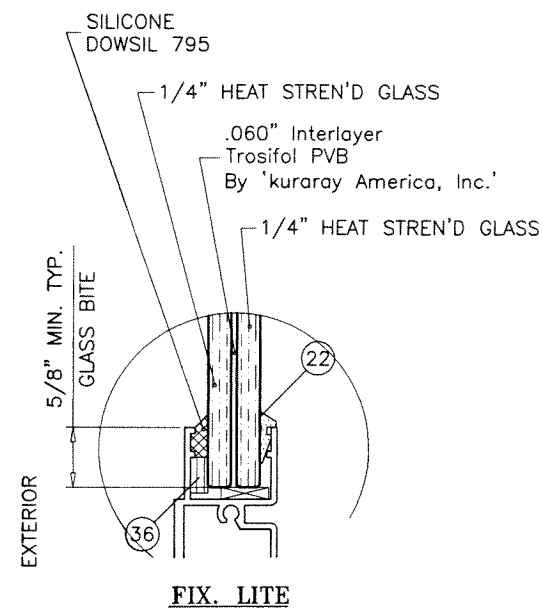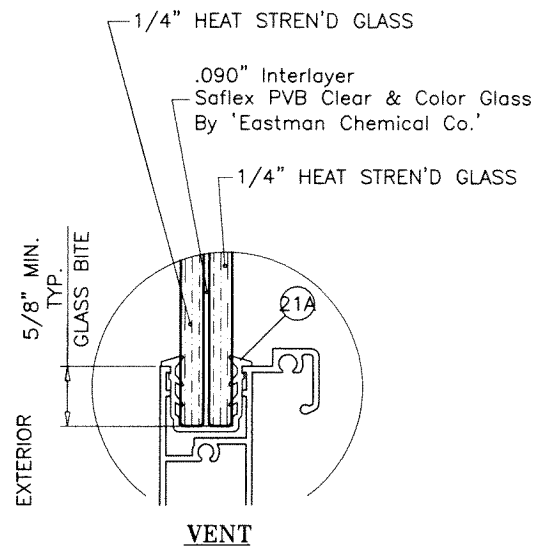

GLASS TYPE 'B'

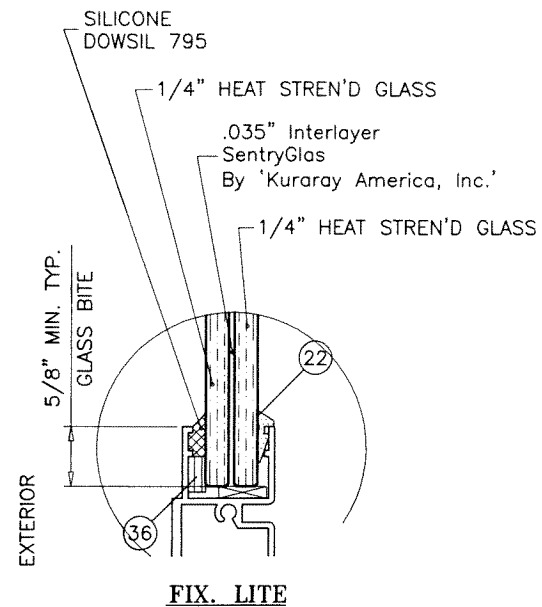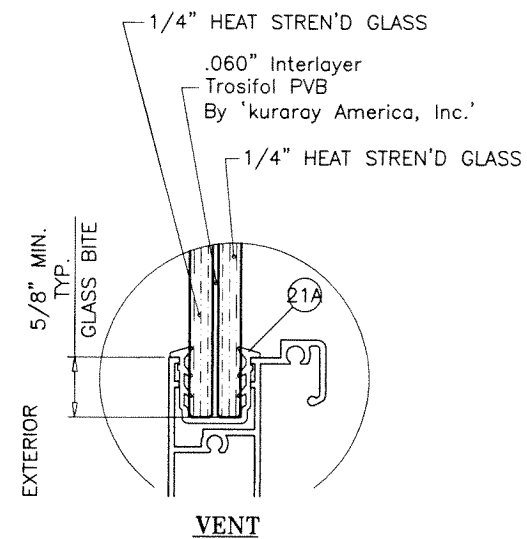


GLASS TYPE 'D'

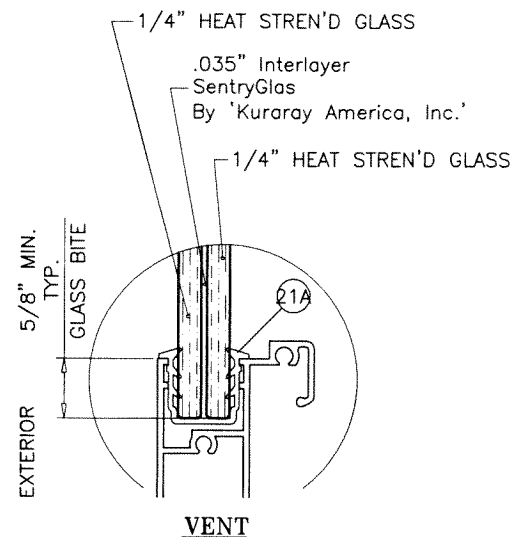

GLAZING OPTIONS

**PRODUCT REVISED**  
 As complying with the Florida  
 Building Code  
 NOA-No. **25-0312.06**  
 Expiration Date: **06/23/2030**  
 By: *Manuel Perez*  
 Miami-Dade Product Control

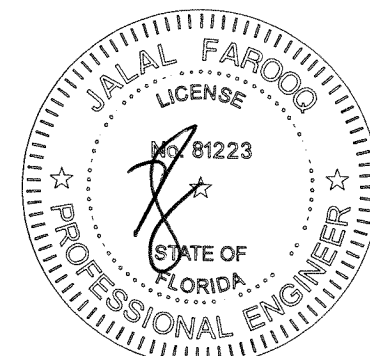

MAR 11 2025

**AL-FAROOQ CORPORATION**  
 ENGINEERS & PRODUCT DEVELOPMENT  
 9360 SUNSET DRIVE, SUITE 220  
 MIAMI, FLORIDA 33173  
 TEL. (305) 264-8100 FAX. (305) 262-6978

**TECNOGLASS, LLC**  
 3550 N.W. 49 STREET  
 MIAMI, FL. 33142  
 TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:	
no	description
H	04.08.15 UPDATED TO 2014 FBC
I	02.22.18 UPDATED TO 2017 FBC
J	11.20.20 UPDATED TO 2020 FBC
K	09.14.23 NO CHANGE THIS SHEET
L	02.17.25 GENERAL REVISION

date: 12-11-03

scale: 1/2"=1'-0"

dr. by: TARIQ

chk. by:

drawing no.


**W03-111**

sheet 2 of 10



EQUAL LITES SINGLE HUNG WINDOWS DESIGN LOAD CAPACITY - PSF									
WINDOW DIMS.		3/8" MAX. SHIMS							
		GLASS TYPE 'A'		GLASS TYPE 'B'		GLASS TYPE 'C'		GLASS TYPE 'D'	
WIDTH	HEIGHT	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
36"	36"	100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
42"		100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
43-1/4"		100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
48"		100.0	130.0	100.0	130.0	100.0	140.0	100.0	130.0
54"		100.0	130.0	100.0	130.0	100.0	140.0	100.0	130.0
60"		89.7	116.6	89.7	116.6	89.7	116.6	83.3	108.3
66"		67.0	87.1	67.0	87.1	67.0	87.1	62.2	80.9
72"		51.3	66.7	51.3	66.7	51.3	66.7	47.7	62.0
36"	42"	100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
42"		100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
43-1/4"		100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
48"		100.0	130.0	100.0	130.0	100.0	140.0	100.0	130.0
54"		100.0	130.0	100.0	130.0	100.0	140.0	100.0	130.0
60"		77.9	101.3	77.9	101.3	77.9	101.3	72.4	94.1
66"		58.0	75.4	58.0	75.4	58.0	75.4	53.9	70.1
72"		44.4	57.7	44.4	57.7	44.4	57.7	41.2	53.6
36"	48"	100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
42"		100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
43-1/4"		100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
48"		100.0	130.0	100.0	130.0	100.0	140.0	100.0	130.0
54"		96.5	125.5	96.5	125.5	96.5	125.5	89.6	116.5
60"		69.2	90.0	69.2	90.0	69.2	90.0	64.3	83.6
66"		51.4	66.9	51.4	66.9	51.4	66.9	47.8	62.1
72"		39.3	51.1	39.3	51.1	39.3	51.1	36.5	47.4
36"	54"	100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
42"		100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
43-1/4"		100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
48"		100.0	130.0	100.0	130.0	100.0	140.0	100.0	130.0
54"		87.7	114.0	87.7	114.0	87.7	114.0	81.5	105.9
60"		62.7	81.5	62.7	81.5	62.7	81.5	58.2	75.7
66"		46.4	60.3	46.4	60.3	46.4	60.3	-	-
72"		35.3	45.9	35.3	45.9	-	-	-	-
36"	60"	100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
42"		100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
43-1/4"		100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
48"		100.0	130.0	100.0	130.0	100.0	140.0	100.0	130.0
54"		81.0	105.3	81.0	105.3	81.0	105.3	75.2	97.8
60"		57.6	74.8	57.6	74.8	57.6	74.8	-	-
66"		42.4	55.2	42.4	55.2	-	-	-	-
36"	66"	100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
42"		100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
43-1/4"		100.0	130.0	100.0	148.3	100.0	148.3	100.0	130.0
48"		100.0	130.0	100.0	130.0	100.0	133.7	100.0	130.0
54"		75.8	98.5	75.8	98.5	75.8	98.5	-	-
60"		53.5	69.6	53.5	69.6	-	-	-	-
72"		100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
36"	72"	100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
42"		100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
43-1/4"		100.0	130.0	100.0	144.0	100.0	144.0	100.0	130.0
48"		100.0	130.0	100.0	130.0	100.0	129.4	100.0	130.0
54"		71.7	93.2	71.7	93.2	-	-	-	-
60"		100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
72"		100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0


EQUAL LITES SINGLE HUNG WINDOWS DESIGN LOAD CAPACITY - PSF									
WINDOW DIMS.		3/8" MAX. SHIMS							
		GLASS TYPE 'A'		GLASS TYPE 'B'		GLASS TYPE 'C'		GLASS TYPE 'D'	
WIDTH	HEIGHT	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
36"	78"	100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
42"		100.0	130.0	100.0	149.2	100.0	149.2	100.0	130.0
43-1/4"		100.0	130.0	100.0	141.4	100.0	141.4	100.0	130.0
48"		100.0	130.0	100.0	130.0	-	-	100.0	129.4
54"		68.5	89.1	68.5	89.1	-	-	-	-
36"	84"	100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
42"		100.0	130.0	100.0	148.5	100.0	148.5	100.0	130.0
43-1/4"		100.0	125.1	100.0	140.1	100.0	140.1	-	-
48"		100.0	125.1	100.0	125.1	-	-	-	-
36"	86"	100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
42"		100.0	130.0	100.0	148.5	100.0	148.5	100.0	130.0
43-1/4"		100.0	124.7	100.0	140.0	100.0	140.0	-	-
36"	89-1/4"	100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
42"		100.0	130.0	100.0	130.0	-	-	100.0	130.0
48"		100.0	124.7	100.0	124.7	-	-	-	-
36"	90"	100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
42"		100.0	130.0	100.0	130.0	-	-	100.0	130.0
36"	96"	100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
42"		100.0	130.0	100.0	130.0	-	-	100.0	130.0

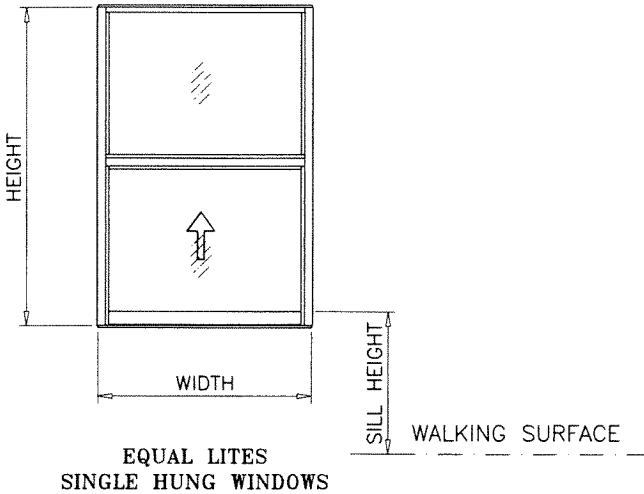

NOTE:  
GLASS CAPACITIES ON THIS SHEET ARE  
BASED ON ASTM E1300-09 (3 SEC. GUSTS)  
AND FLORIDA BUILDING COMMISSION  
DECLARATORY STATEMENT DCA05-DEC-219

MAR 11 2025

**PRODUCT REVISED**  
As complying with the Florida  
Building Code  
NOA-No. **25-0312.06**  
Expiration Date: **06/23/2030**  
By: *Manuel Perez*  
Miami-Dade Product Control

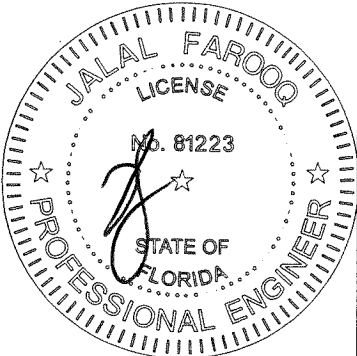

**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
9360 SUNSET DRIVE, SUITE 220  
MIAMI, FLORIDA 33173  
TEL. (305) 264-8100 FAX. (305) 262-6978  
C.A.N. 3538


SERIES 500Y ALUM SINGLE HUNG WINDOW (S.M.I.)  
**TECNOGLASS, LLC**  
3550 N.W. 49 STREET  
MIAMI, FL. 33142  
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:		no	date	by	description
12-11-03	scale: 1/2"=1'-0"	H	04.08.15		UPDATED TO 2014 FBC
		I	02.22.18		UPDATED TO 2017 FBC
		J	11.20.20		UPDATED TO 2020 FBC
		K	09.14.23		NO CHANGE THIS SHEET
		L	02.17.25		GENERAL REVISION
drawing no.		W03-111			
sheet		3 of 10			



EQUAL LITES SINGLE HUNG WINDOWS DESIGN LOAD CAPACITY - PSF									
WINDOW DIMS.		1/2" MAX. SHIMS							
		GLASS TYPE 'A'		GLASS TYPE 'B'		GLASS TYPE 'C'		GLASS TYPE 'D'	
WIDTH	HEIGHT	EXT.(+)	1NT.(-)	EXT.(+)	1NT.(-)	EXT.(+)	1NT.(-)	EXT.(+)	1NT.(-)
36"	36"	100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
42"		100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
43-1/4"		100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
48"		100.0	130.0	100.0	130.0	100.0	140.0	100.0	130.0
54"		100.0	130.0	100.0	130.0	100.0	140.0	100.0	130.0
60"		89.7	116.6	89.7	116.6	89.7	116.6	83.3	108.3
66"		67.0	87.1	67.0	87.1	67.0	87.1	62.2	80.9
72"		51.3	66.7	51.3	66.7	51.3	66.7	47.7	62.0
36"	42"	100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
42"		100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
43-1/4"		100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
48"		100.0	130.0	100.0	130.0	100.0	140.0	100.0	130.0
54"		100.0	130.0	100.0	130.0	100.0	140.0	100.0	130.0
60"		77.9	101.3	77.9	101.3	77.9	101.3	72.4	94.1
66"		58.0	75.4	58.0	75.4	58.0	75.4	53.9	70.1
72"		44.4	57.7	44.4	57.7	44.4	57.7	41.2	53.6
36"	48"	100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
42"		100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
43-1/4"		100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
48"		100.0	130.0	100.0	130.0	100.0	140.0	100.0	130.0
54"		96.5	125.5	96.5	125.5	96.5	125.5	89.6	116.5
60"		69.2	90.0	69.2	90.0	69.2	90.0	64.3	83.6
66"		51.4	66.9	51.4	66.9	51.4	66.9	47.8	62.1
72"		39.3	51.1	39.3	51.1	39.3	51.1	36.5	47.4
36"	54"	100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
42"		100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
43-1/4"		100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
48"		100.0	130.0	100.0	130.0	100.0	140.0	100.0	130.0
54"		87.7	114.0	87.7	114.0	87.7	114.0	81.5	105.9
60"		62.7	81.5	62.7	81.5	62.7	81.5	58.2	75.7
66"		46.4	60.3	46.4	60.3	46.4	60.3	-	-
36"	60"	100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
42"		100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
43-1/4"		100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
48"		100.0	130.0	100.0	130.0	100.0	140.0	100.0	130.0
54"		81.0	105.3	81.0	105.3	81.0	105.3	75.2	97.8
60"		57.6	74.8	57.6	74.8	57.6	74.8	38.2	49.7
36"	66"	100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
42"		100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
43-1/4"		100.0	130.0	100.0	148.3	100.0	148.3	100.0	130.0
48"		100.0	130.0	100.0	130.0	100.0	133.7	100.0	130.0
54"		75.8	98.5	75.8	98.5	75.8	98.5	50.3	65.4
36"	72"	100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
42"		100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
43-1/4"		100.0	130.0	100.0	144.0	100.0	144.0	100.0	130.0
48"		100.0	118.5	100.0	118.5	100.0	118.5	100.0	118.5

EQUAL LITES SINGLE HUNG WINDOWS DESIGN LOAD CAPACITY - PSF									
WINDOW DIMS.		1/2" MAX. SHIMS							
		GLASS TYPE 'A'		GLASS TYPE 'B'		GLASS TYPE 'C'		GLASS TYPE 'D'	
WIDTH	HEIGHT	EXT.(+)	1NT.(-)	EXT.(+)	1NT.(-)	EXT.(+)	1NT.(-)	EXT.(+)	1NT.(-)
36"	78"	100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
42"		100.0	130.0	100.0	141.4	100.0	141.4	100.0	130.0
43-1/4"		100.0	130.0	100.0	138.5	100.0	138.5	100.0	130.0
36"	84"	100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
42"		100.0	130.0	100.0	142.4	100.0	142.4	100.0	130.0
43-1/4"		100.0	130.0	100.0	139.6	100.0	139.6	100.0	130.0
36"	86"	100.0	130.0	100.0	150.0	100.0	150.0	100.0	130.0
42"		100.0	130.0	100.0	138.0	100.0	138.0	100.0	130.0
43-1/4"		100.0	130.0	100.0	135.3	100.0	135.3	100.0	130.0
36"	89-1/4"	100.0	130.0	100.0	147.0	100.0	147.0	100.0	130.0
36"	90"	100.0	130.0	100.0	145.3	100.0	145.3	100.0	130.0
36"	96"	100.0	130.0	100.0	147.6	100.0	147.6	100.0	130.0

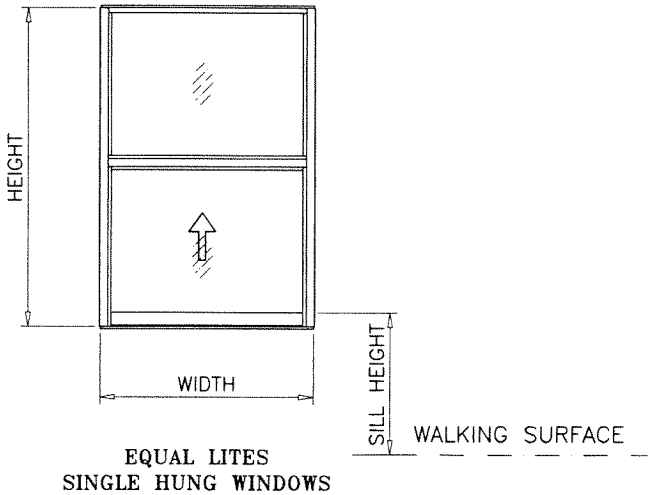


EQUAL LITES  
SINGLE HUNG WINDOWS

NOTE:  
GLASS CAPACITIES ON THIS SHEET ARE  
BASED ON ASTM E1300-09 (3 SEC. GUSTS)  
AND FLORIDA BUILDING COMMISSION  
DECLARATORY STATEMENT DCA05-DEC-219

MAR 1 1 2025

PRODUCT REVISED  
As complying with the Florida  
Building Code  
NOA-No. 25-0312.06  
Expiration Date: 06/23/2030  
By: Manuel Perez  
Miami-Dade Product Control

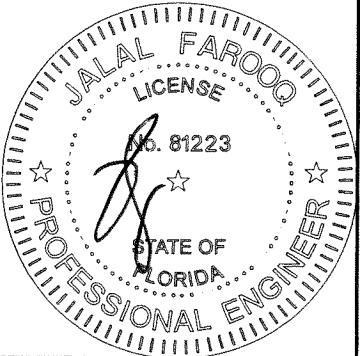

afcc

AL-FAROOQ CORPORATION  
ENGINEERS & PRODUCT DEVELOPMENT  
9360 SUNSET DRIVE, SUITE 220  
MIAMI, FLORIDA 33173  
TEL. (305) 264-8100 FAX. (305) 262-6978

SERIES 500Y ALUM SINGLE HUNG WINDOW (S.M.I.)

TECNOGLASS, LLC  
3550 N.W. 49 STREET  
MIAMI, FL. 33142  
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:

no	date	by	description

date: 12-11-03  
scale: 1/2"=1'-0"  
dr. by: TARIQ  
chk. by:

drawing no.  
W03-111  
sheet 3.1 of 10

COMP-ANL\W03-111RC

UNEQUAL LITES SINGLE HUNG WINDOWS DESIGN LOAD CAPACITY – PSF																	
WINDOW DIMS.		3/8" MAX. SHIMS								1/4" MAX. SHIMS							
		GLASS TYPE 'A'		GLASS TYPE 'B'		GLASS TYPE 'C'		GLASS TYPE 'D'		GLASS TYPE 'A'		GLASS TYPE 'B'		GLASS TYPE 'C'		GLASS TYPE 'D'	
WIDTH	HEIGHT	EXT.(+)	INT.(–)	EXT.(+)	INT.(–)	EXT.(+)	INT.(–)	EXT.(+)	INT.(–)	EXT.(+)	INT.(–)	EXT.(+)	INT.(–)	EXT.(+)	INT.(–)	EXT.(+)	INT.(–)
36" 42" 43–1/4" 48" 54" 60" 66" 72"	48"	100.0	130.0	100.0	150.0	106.7	150.0	100.0	130.0	100.0	130.0	100.0	150.0	106.7	150.0	100.0	130.0
		100.0	130.0	100.0	150.0	106.7	150.0	100.0	130.0	100.0	130.0	100.0	150.0	106.7	150.0	100.0	130.0
		100.0	130.0	100.0	150.0	106.7	150.0	100.0	130.0	100.0	130.0	100.0	150.0	106.7	150.0	100.0	130.0
		100.0	130.0	100.0	130.6	106.7	140.0	100.0	130.0	100.0	130.0	100.0	130.6	106.7	140.0	100.0	130.0
		81.9	110.5	81.9	110.5	81.9	110.5	93.7	121.8	81.9	110.5	81.9	110.5	81.9	110.5	93.7	121.8
		58.7	79.3	58.7	79.3	58.7	79.3	66.7	86.7	58.7	79.3	58.7	79.3	58.7	79.3	66.7	86.7
		43.6	58.9	43.6	58.9	43.6	58.9	49.2	64.0	43.6	58.9	43.6	58.9	43.6	58.9	49.2	64.0
		33.3	45.0	33.3	45.0	33.3	45.0	37.4	48.6	33.3	45.0	33.3	45.0	33.3	45.0	37.4	48.6
36" 42" 43–1/4" 48" 54" 60" 66" 72"	54"	100.0	130.0	100.0	150.0	106.7	150.0	100.0	130.0	100.0	130.0	100.0	150.0	106.7	150.0	100.0	130.0
		100.0	130.0	100.0	150.0	106.7	150.0	100.0	130.0	100.0	130.0	100.0	150.0	106.7	150.0	100.0	130.0
		100.0	130.0	100.0	150.0	106.7	150.0	100.0	130.0	100.0	130.0	100.0	150.0	106.7	150.0	100.0	130.0
		100.0	130.0	100.0	130.0	106.7	140.0	100.0	130.0	100.0	130.0	100.0	130.0	106.7	140.0	100.0	130.0
		74.9	101.1	74.9	101.1	74.9	101.1	87.9	114.3	74.9	101.1	74.9	101.1	74.9	101.1	87.9	114.3
		53.4	72.1	53.4	72.1	53.4	72.1	61.9	80.4	53.4	72.1	53.4	72.1	53.4	72.1	61.9	80.4
		39.5	53.3	39.5	53.3	39.5	53.3	–	–	39.5	53.3	39.5	53.3	39.5	53.3	–	–
		30.1	40.6	30.1	40.6	–	–	–	–	30.1	40.6	30.1	40.6	–	–	–	–
36" 42" 43–1/4" 48" 54" 60" 66" 72"	60"	100.0	130.0	100.0	150.0	106.7	150.0	100.0	130.0	100.0	130.0	100.0	150.0	106.7	150.0	100.0	130.0
		100.0	130.0	100.0	150.0	106.7	150.0	100.0	130.0	100.0	130.0	100.0	150.0	106.7	150.0	100.0	130.0
		100.0	130.0	100.0	150.0	103.1	150.0	100.0	130.0	100.0	130.0	100.0	150.0	103.1	150.0	100.0	130.0
		100.0	130.0	100.0	130.0	103.1	139.2	100.0	130.0	100.0	130.0	100.0	130.0	103.1	139.2	100.0	130.0
		70.1	94.7	70.1	94.7	70.1	94.7	84.4	109.7	70.1	94.7	70.1	94.7	70.1	94.7	84.4	109.7
		49.6	67.0	49.6	67.0	49.6	67.0	–	–	49.6	67.0	49.6	67.0	49.6	67.0	–	–
		36.5	49.3	36.5	49.3	–	–	–	–	36.5	49.3	36.5	49.3	–	–	–	–
		27.7	37.3	27.7	37.3	–	–	–	–	27.7	37.3	27.7	37.3	–	–	–	–
36" 42" 43–1/4" 48" 54" 60" 66" 72"	66"	100.0	130.0	100.0	150.0	106.7	150.0	100.0	130.0	100.0	130.0	100.0	150.0	106.7	150.0	100.0	130.0
		100.0	130.0	100.0	150.0	106.7	150.0	100.0	130.0	100.0	130.0	100.0	150.0	106.7	150.0	100.0	130.0
		100.0	130.0	100.0	150.0	100.6	150.0	100.0	130.0	100.0	130.0	100.0	150.0	100.6	150.0	100.0	130.0
		100.0	130.0	100.0	130.0	100.6	135.9	100.0	130.0	100.0	130.0	100.0	130.0	100.6	135.9	100.0	130.0
		67.1	90.5	67.1	90.5	67.1	90.5	–	–	67.1	90.5	67.1	90.5	67.1	90.5	–	–
		47.0	63.5	47.0	63.5	–	–	–	–	47.0	63.5	47.0	63.5	–	–	–	–
		34.3	46.3	34.3	46.3	–	–	–	–	34.3	46.3	34.3	46.3	–	–	–	–
		25.9	34.9	25.9	34.9	–	–	–	–	25.9	34.9	25.9	34.9	–	–	–	–
36" 42" 48" 54" 60" 66"	72"	100.0	130.0	100.0	150.0	106.7	150.0	100.0	130.0	100.0	130.0	100.0	150.0	106.7	150.0	100.0	130.0
		100.0	130.0	100.0	130.0	106.7	140.0	100.0	130.0	100.0	130.0	100.0	130.0	106.7	140.0	100.0	130.0
		100.0	130.0	100.0	130.0	100.0	135.0	100.0	130.0	100.0	130.0	100.0	130.0	100.0	135.0	100.0	130.0
		65.4	88.2	65.4	88.2	–	–	–	–	65.4	88.2	65.4	88.2	–	–	–	–
		45.3	61.1	45.3	61.1	–	–	–	–	45.3	61.1	45.3	61.1	–	–	–	–
		32.8	44.2	32.8	44.2	–	–	–	–	32.8	44.2	32.8	44.2	–	–	–	–
36" 42" 48" 54" 60"	78"	100.0	130.0	100.0	130.0	106.7	140.0	100.0	130.0	100.0	130.0	100.0	130.0	106.7	140.0	100.0	130.0
		100.0	130.0	100.0	130.0	106.7	140.0	100.0	130.0	100.0	130.0	100.0	130.0	106.7	140.0	100.0	130.0
		100.0	128.4	100.0	128.4	100.0	128.4	–	–	100.0	130.0	100.0	130.0	100.0	135.0	–	–
		64.9	87.6	64.9	87.6	–	–	–	–	64.9	87.6	64.9	87.6	–	–	–	–
		44.3	59.8	44.3	59.8	–	–	–	–	44.3	59.8	44.3	59.8	–	–	–	–
36" 42" 48" 54"	84"	100.0	130.0	100.0	130.0	106.7	140.0	100.0	130.0	100.0	130.0	100.0	130.0	106.7	140.0	100.0	130.0
		100.0	130.0	100.0	130.0	106.7	140.0	100.0	130.0	100.0	130.0	100.0	130.0	106.7	140.0	100.0	130.0
		100.0	130.0	100.0	130.0	–	–	–	–	100.0	130.0	100.0	130.0	–	–	–	–
		64.9	87.6	64.9	87.6	–	–	–	–	64.9	87.6	64.9	87.6	–	–	–	–
36" 42" 48"	89–1/4"	100.0	130.0	100.0	130.0	106.7	140.0	100.0	130.0	100.0	130.0	100.0	130.0	106.7	140.0	100.0	130.0
		100.0	130.0	100.0	130.0	–	–	100.0	129.1	100.0	130.0	100.0	130.0	–	–	100.0	130.0
		100.0	120.8	100.0	120.8	–	–	–	–	100.0	130.0	100.0	130.0	–	–	–	–
36" 42" 48"	90"	100.0	130.0	100.0	130.0	106.7	140.0	100.0	130.0	100.0	130.0	100.0	130.0	106.7	140.0	100.0	130.0
		100.0	130.0	100.0	130.0	–	–	100.0	127.8	100.0	130.0	100.0	130.0	–	–	100.0	130.0
		100.0	119.5	100.0	119.5	–	–	–	–	100.0	130.0	100.0	130.0	–	–	–	–
36" 42" 48"	96"	100.0	130.0	100.0	130.0	106.7	140.0	100.0	130.0	100.0	130.0	100.0	130.0	106.7	140.0	100.0	130.0
		100.0	130.0	100.0	130.0	–	–	100.0	130.0	100.0	130.0	100.0	130.0	–	–	100.0	130.0
		100.0	130.0	100.0	130.0	–	–	–	–	100.0	130.0	100.0	130.0	–	–	–	–

UNEQUAL LITES (ORIEL)  
SINGLE HUNG WINDOWS  
(GLASS TYPES A, B & C)

UNEQUAL LITES (ORIEL)  
SINGLE HUNG WINDOWS  
(GLASS TYPE D)

MAR 11 2025

date: 12-11-03

scale: 1/2"=1'-0"

dr. by: TARIQ

chk. by:

drawing no.

**W03-111**

sheet 4 of 10

revisions:		
no	date	description
H	04.08.15	UPDATED TO 2014 FBC
I	02.22.18	UPDATED TO 2017 FBC
J	11.20.20	UPDATED TO 2020 FBC
K	09.14.23	NO CHANGE THIS SHEET
L	02.17.25	GENERAL REVISION

SERIES 500Y ALUM SINGLE HUNG WINDOW (S.M.I.)

**TECNOGLASS, LLC**

3550 N.W. 49 STREET

MIAMI, FL. 33142

TEL. (305) 638-5151 FAX. (305) 638-5158

AL-FAROOQ CORPORATION

ENGINEERS & PRODUCT DEVELOPMENT

9360 SUNSET DRIVE, SUITE 220




MIAMI, FLORIDA 33173 (C.A.N. 3538)

TEL. (305) 264-8100 FAX. (305) 262-6978

COMP-ANL\W03-111RC





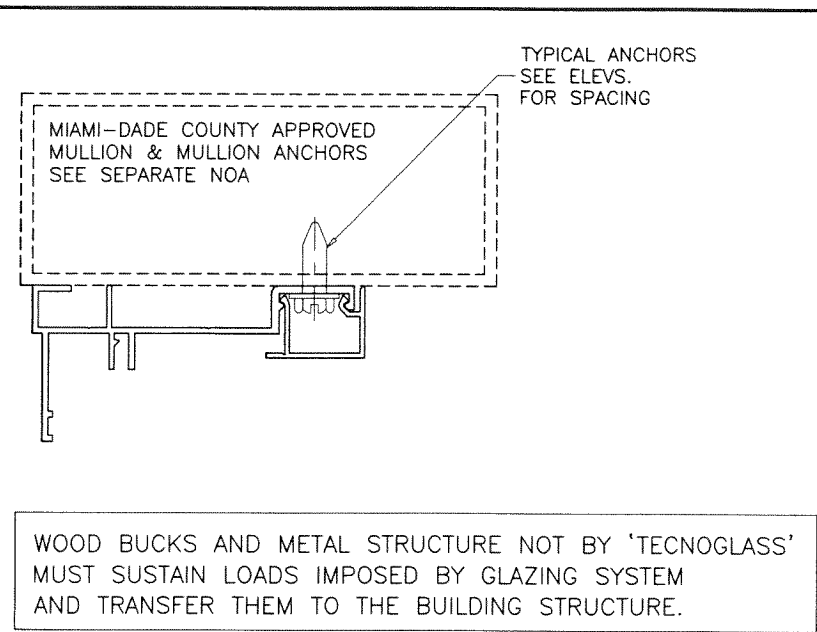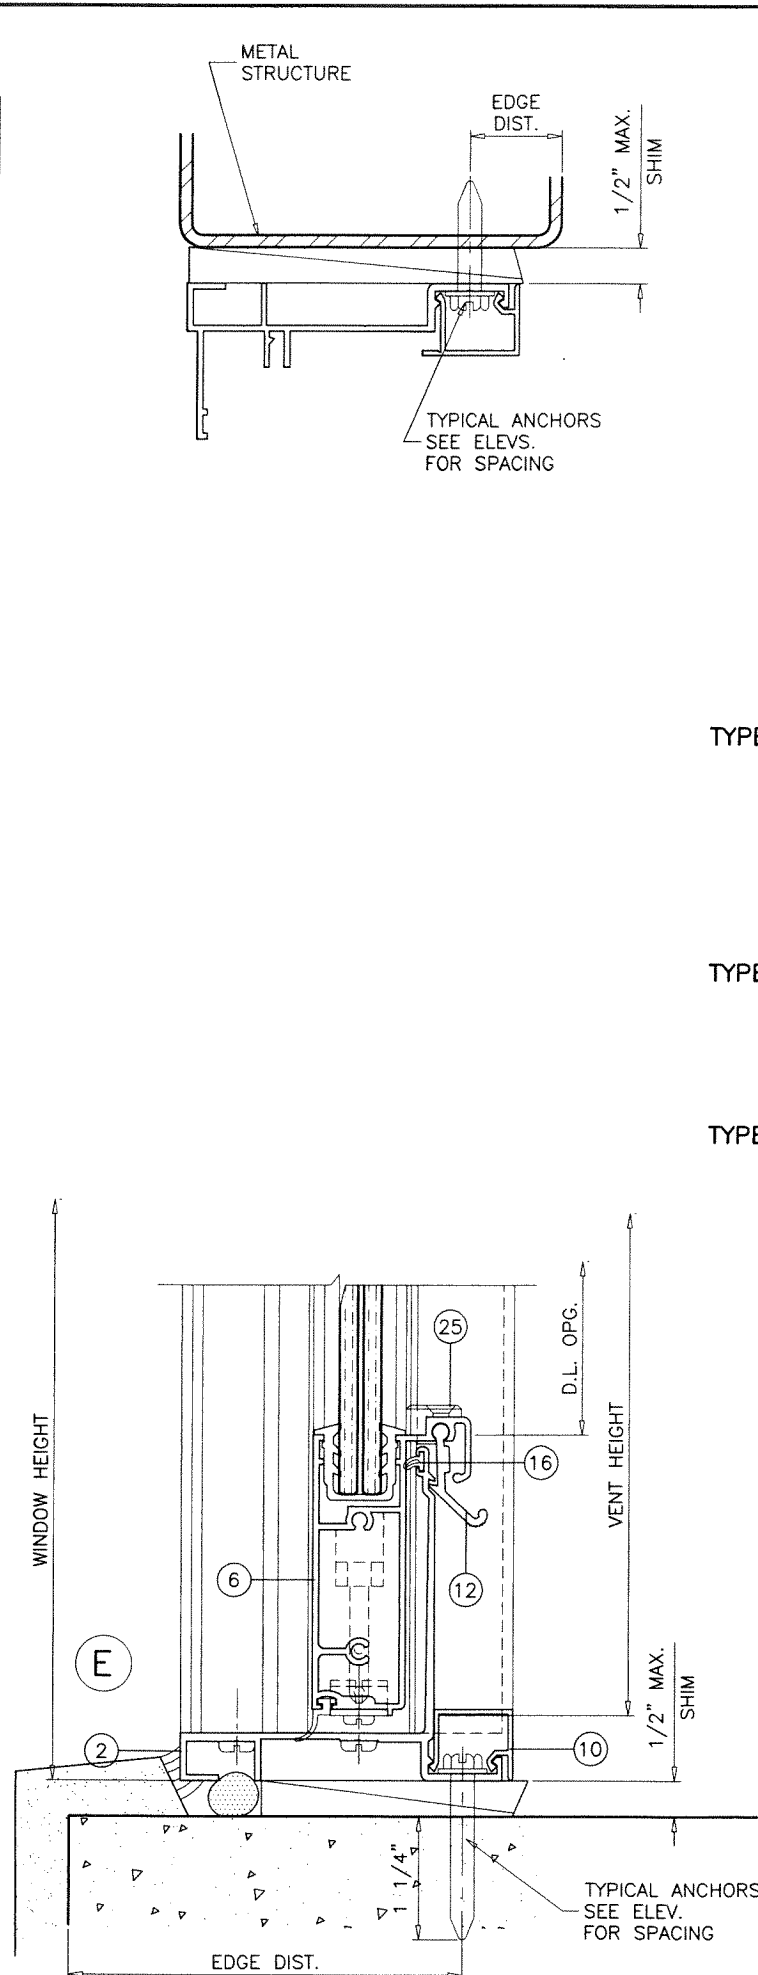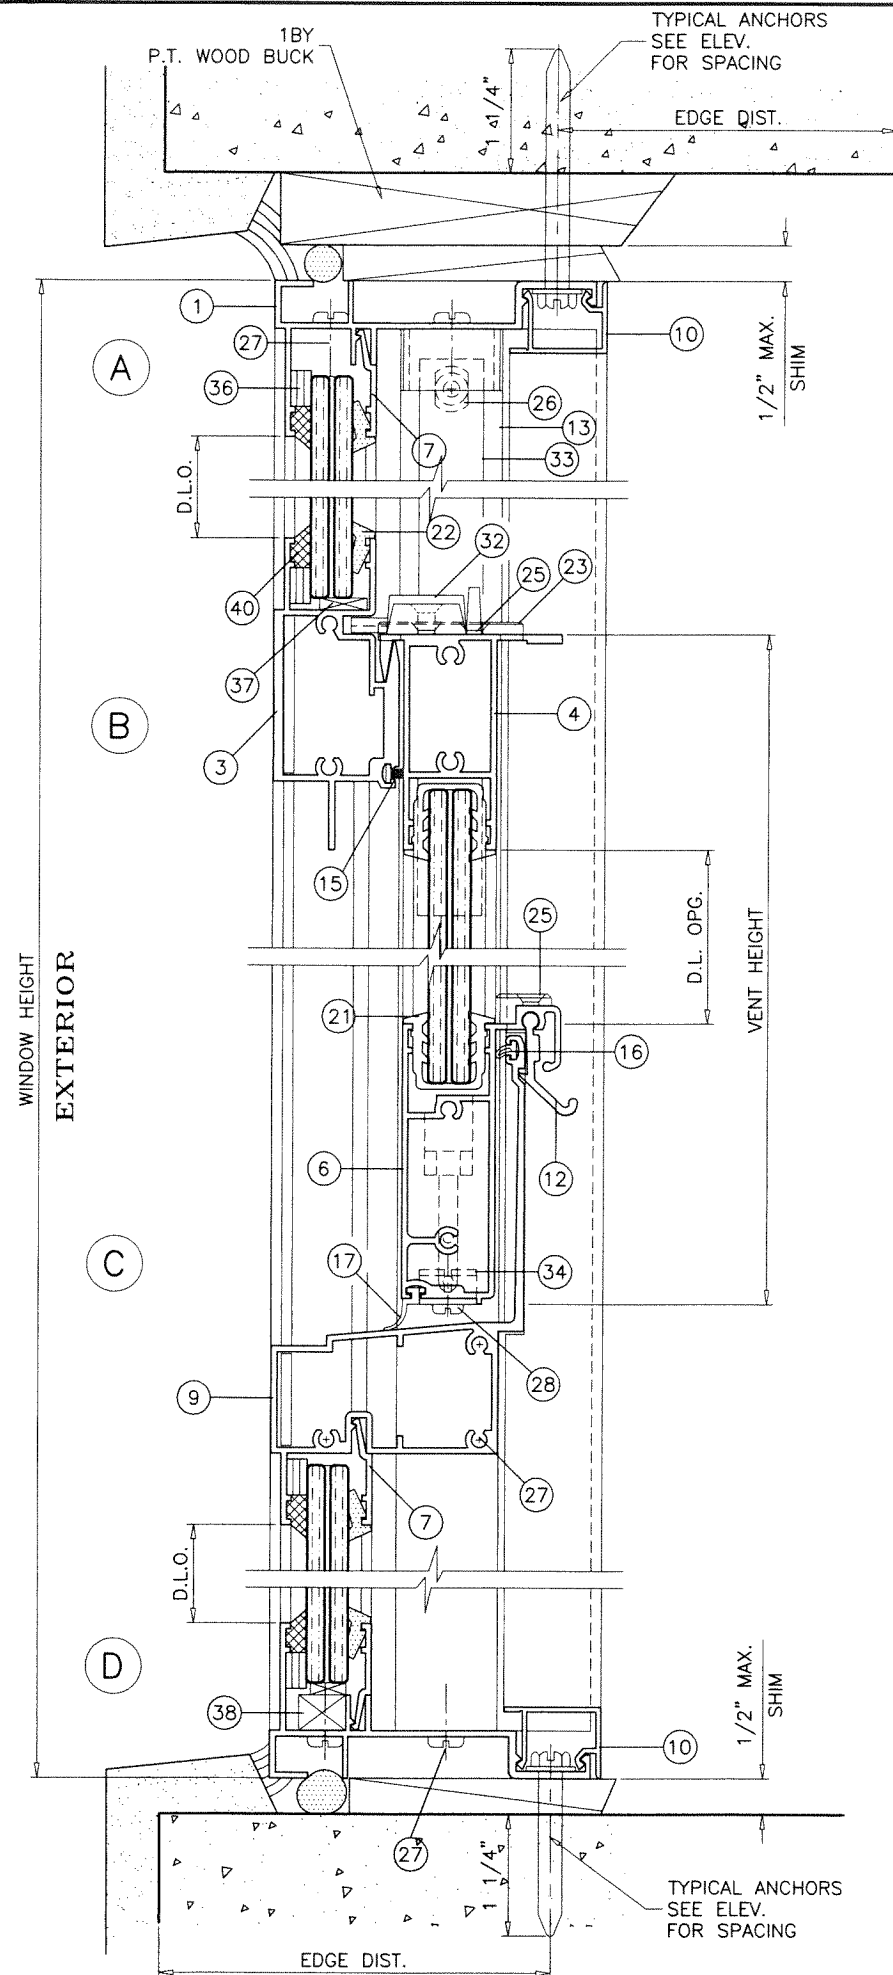

**TYPICAL ANCHORS:** SEE ELEV. FOR SPACING

**TYPE 'A'—** 1/4" DIA. KWIK-CON II+ BY 'HILTI' (Fu=138 KSI, Fy=137 KSI)  
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES  
 1-1/2" MIN. PENETRATION INTO WOOD (HEAD/SILL/JAMBS)  
 THRU 1BY BUCKS INTO CONC. OR BLOCKS  
 1-1/4" MIN. EMBED INTO CONCRETE (HEAD/SILL/JAMBS)  
 1-1/4" MIN. EMBED INTO BLOCKS (JAMBS)


**TYPE 'B'—** 1/4" DIA. KWIK-CON II+ BY 'HILTI' (Fu=138 KSI, Fy=137 KSI)  
 DIRECTLY INTO CONCRETE OR BLOCKS  
 1-1/4" MIN. EMBED INTO CONCRETE (HEAD/SILL/JAMBS)  
 1-3/4" MIN. EMBED INTO GROUT-FILLED BLOCKS (JAMBS)

**TYPE 'C'—** 1/4" DIA. KWIK-FLEX SELF DRILLING SCREWS BY 'HILTI' (Fu=120 KSI, Fy=92 KSI)  
 INTO MIAMI-DADE COUNTY APPROVED MULLIONS  
 OR  
 INTO METAL STRUCTURES (HEAD/SILL/JAMBS)  
 (3) THREADS MIN. TO EXTEND BEYOND METAL THICKNESS  
 ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)  
 STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.)  
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

**CRITICAL EDGE DISTANCE**

INTO CONCRETE AND BLOCKS = 2-1/2" MIN.  
 INTO WOOD STRUCTURE = 1" MIN.  
 INTO METAL STRUCTURE = 3/4" MIN.  
 WOOD AT HEAD, SILL OR JAMBS SG = 0.55 MIN.  
 CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.  
 C-90 HOLLOW/FILLED BLOCK AT JAMBS f'm = 1500 PSI MIN.

**PRODUCT REVISED**  
 As complying with the Florida  
 Building Code  
**NOA-No. 25-0312.06**  
**Expiration Date: 06/23/2030** **MAR 11 2025**  
 By: *Manuel Ferrer*  
**Miami-Dade Product Control**

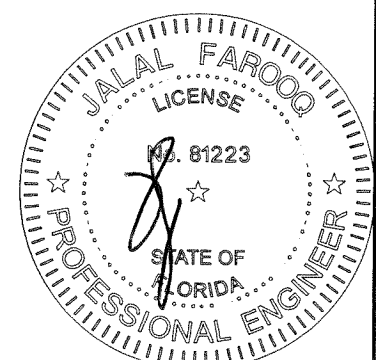

**AL-FAROOQ CORPORATION**  
 ENGINEERS & PRODUCT DEVELOPMENT  
 9360 SUNSET DRIVE, SUITE 220  
 MIAMI, FLORIDA 33173  
 TEL. (305) 264-8100 FAX. (305) 262-6978

**af c**  
 (C.A.N. 3538)  
 COMP-ANL\W03-111RC

---

SERIES 500Y ALUM SINGLE HUNG WINDOW (S.M.I.)  
**TECNOGLASS, LLC**  
 3550 N.W. 49 STREET  
 MIAMI, FL. 33142  
 TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:




no	date	by	description
H	04.08.15		UPDATED TO 2014 FBC
I	02.22.18		UPDATED TO 2017 FBC
J	11.20.20		UPDATED TO 2020 FBC
K	09.14.23		NO CHANGE THIS SHEET
L	02.17.25		GENERAL REVISION

---


date: 12-11-03  
 scale: 1/2" = 1"  
 dr. by: TARIQ  
 chk. by:

drawing no.  
**W03-111**  
 sheet 5 of 10



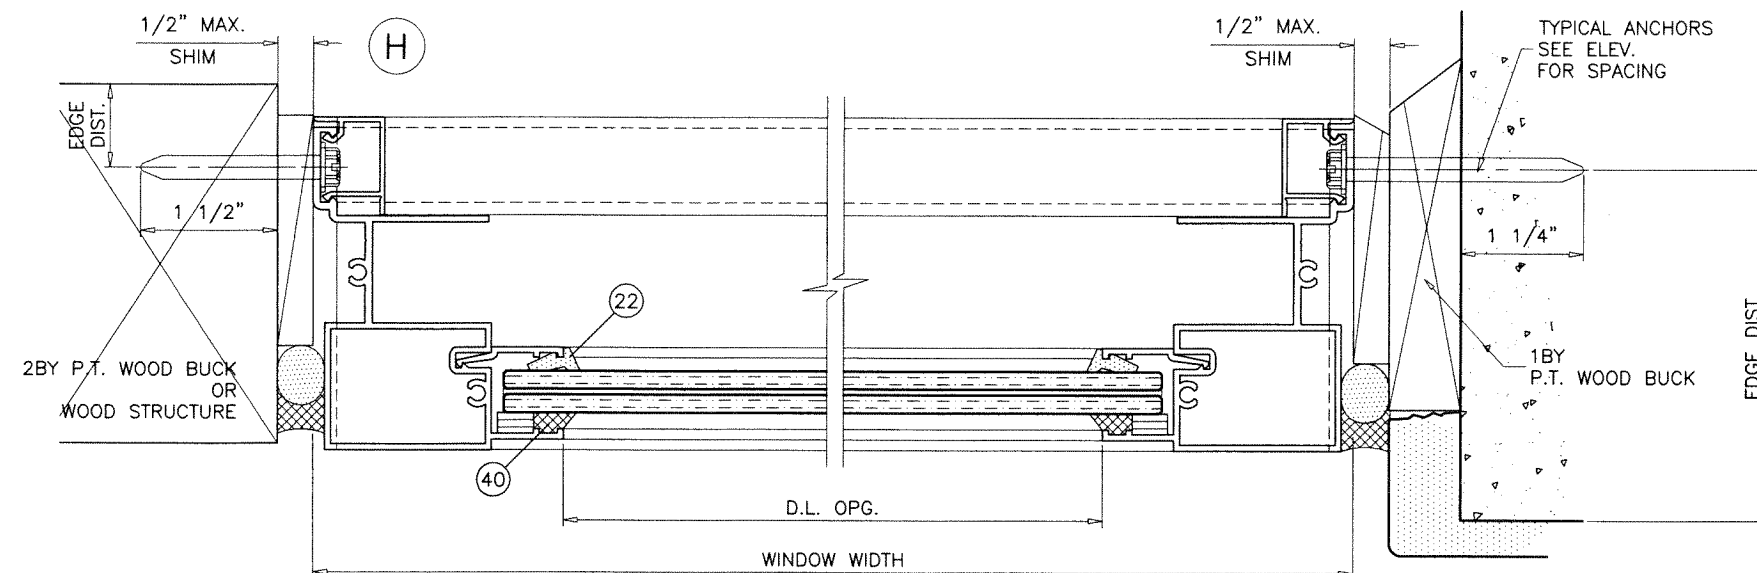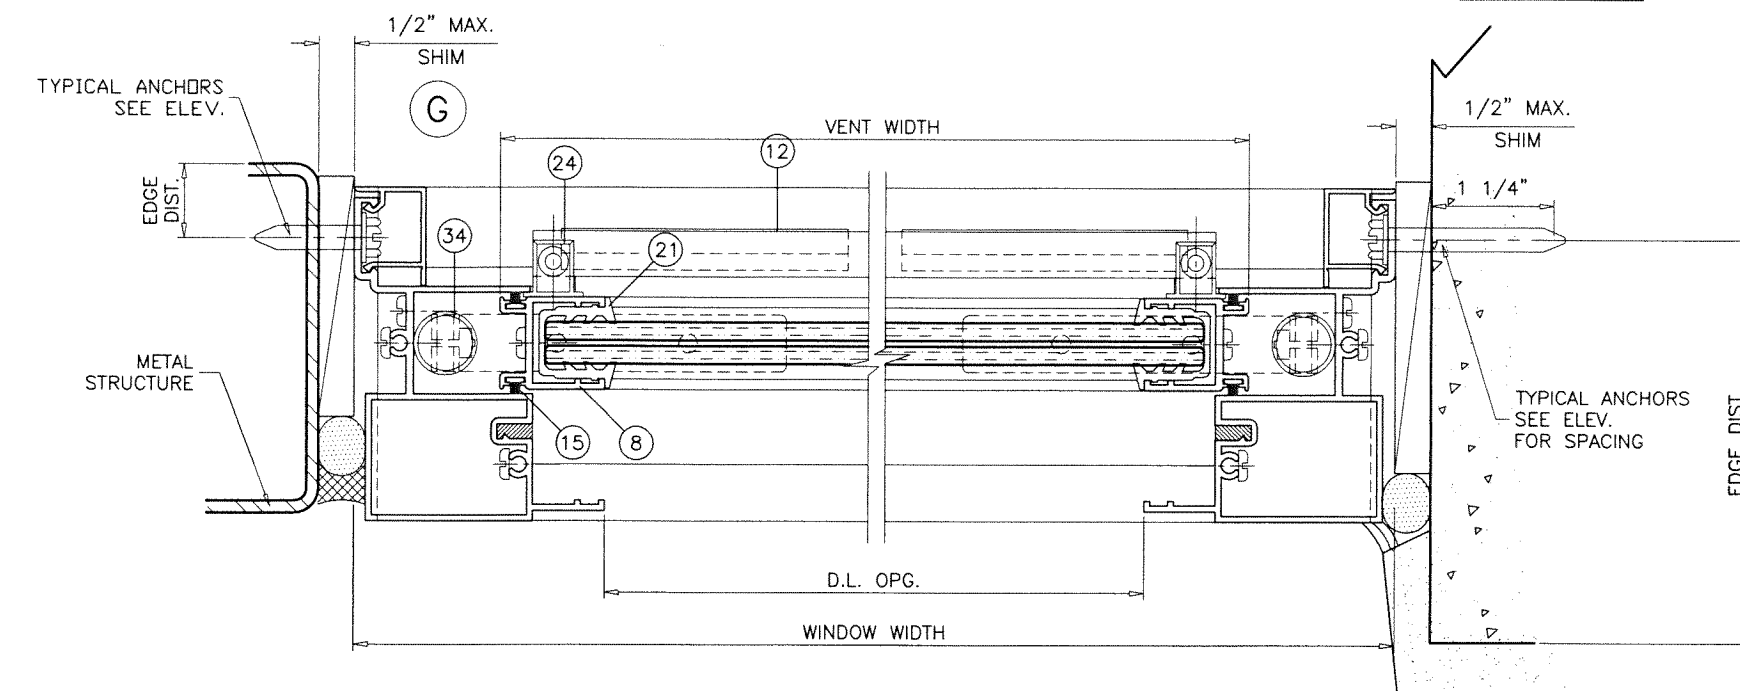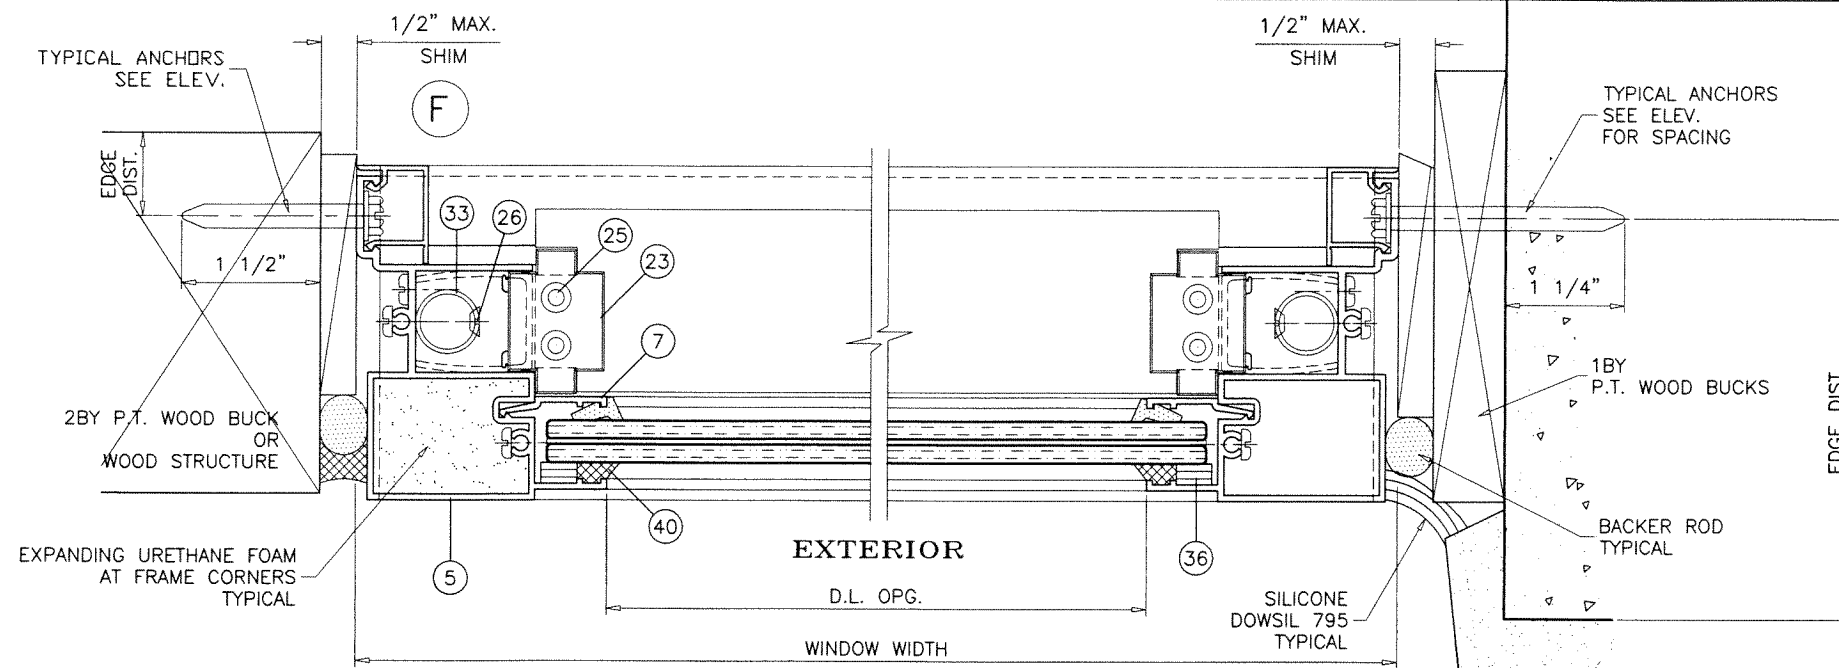

**PRODUCT REVISED**  
 As complying with the Florida  
 Building Code  
 NOA-No. **25-0312.06**  
 Expiration Date: **06/23/2030**  
 By: *Manuel Perez*  
 Miami-Dade Product Control

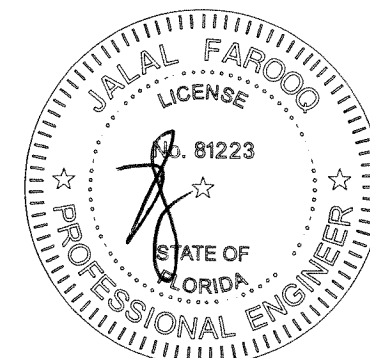

MAR 1 1 2025

**af c**  
**AL-FAROOQ CORPORATION**  
 ENGINEERS & PRODUCT DEVELOPMENT  
 9360 SUNSET DRIVE, SUITE 220  
 MIAMI, FLORIDA 33173 (C.A.N. 3538)  
 TEL. (305) 264-8100 FAX. (305) 262-6978  
 COMP-ANL\W03-111RC

SERIES 500Y ALUM SINGLE HUNG WINDOW (S.M.I.)  
**TECNOGLASS, LLC**  
 3550 N.W. 49 STREET  
 MIAMI, FL. 33142  
 TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:		no	date	by	description
		H	04.08.15		UPDATED TO 2014 FBC
		I	02.22.18		UPDATED TO 2017 FBC
		J	11.20.20		UPDATED TO 2020 FBC
		K	09.14.23		NO CHANGE THIS SHEET
		L	02.17.25		GENERAL REVISION



  

date:	12-11-03
scale:	1/2" = 1"
dr. by:	TARIQ
chk. by:	


  

drawing no.	W03-111
sheet	6 of 10

WINDOWALL BOTTOM LITE CAPACITY			
DESIGN LOAD CAPACITY - PSF			
WINDOW DIMS.		GLASS TYPE 'A' 'B' 'C' & 'D'	
WIDTH	HEIGHT	EXT.(+)	INT.(-)
24"	38-3/8"	100.0	130.0
30"		100.0	130.0
36"		100.0	130.0
42"		100.0	130.0
48"		100.0	130.0
24"	42"	100.0	130.0
30"		100.0	130.0
36"		100.0	130.0
42"		91.5	119.0
24"	48"	100.0	130.0
30"		100.0	130.0
36"		100.0	130.0
36"		100.0	130.0

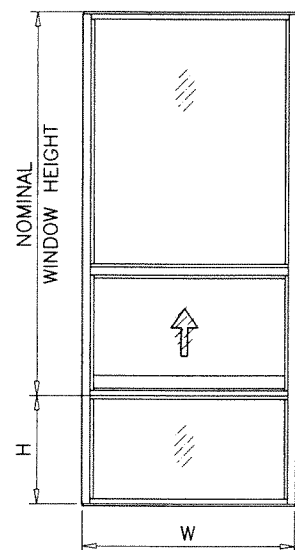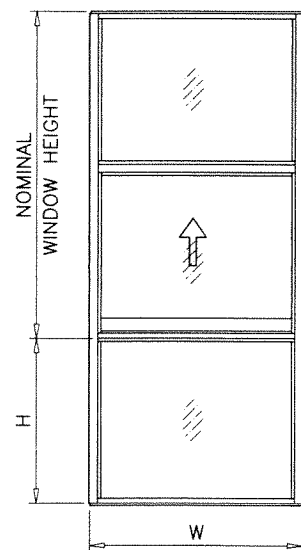

SINGLE HUNG OVER  
FIXED WINDOWS

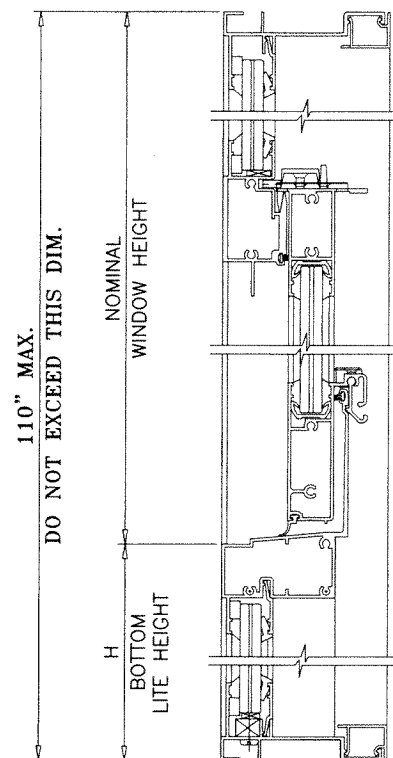



REFER TO SHEETS 3 THRU 4.1 TO OBTAIN CAPACITY OF  
WINDOW PORTION FOR CONFIGURATION/GLASS USED.

REFER TO CHART ABOVE TO OBTAIN CAPACITY OF  
BOTTOM LITE OF WINDOWALL.

REFER TO CHARTS AT RIGHT OF THIS PAGE TO OBTAIN  
MULLION CAPACITY.

USE LOWEST VALUES OF OPTIONS CONSULTED.

MULLION CAPACITY CHART - PSF			
WINDOW DIMS.		STD. MULLION UNREINFORCED	
WIDTH (W)	MULL SPAN	EXT.(+)	INT.(-)
36"	48"	100.0	130.0
42"		100.0	130.0
48"		100.0	130.0
54"		100.0	130.0
60"		100.0	130.0
66"		100.0	130.0
72"		100.0	130.0
36"	54"	100.0	130.0
42"		100.0	130.0
48"		100.0	130.0
54"		100.0	130.0
60"		100.0	130.0
36"	60"	100.0	130.0
42"		100.0	130.0
48"		100.0	130.0
54"		100.0	130.0
36"	66"	100.0	130.0
42"		100.0	130.0
48"		100.0	130.0
36"	72"	100.0	130.0
42"		100.0	130.0
48"		100.0	130.0

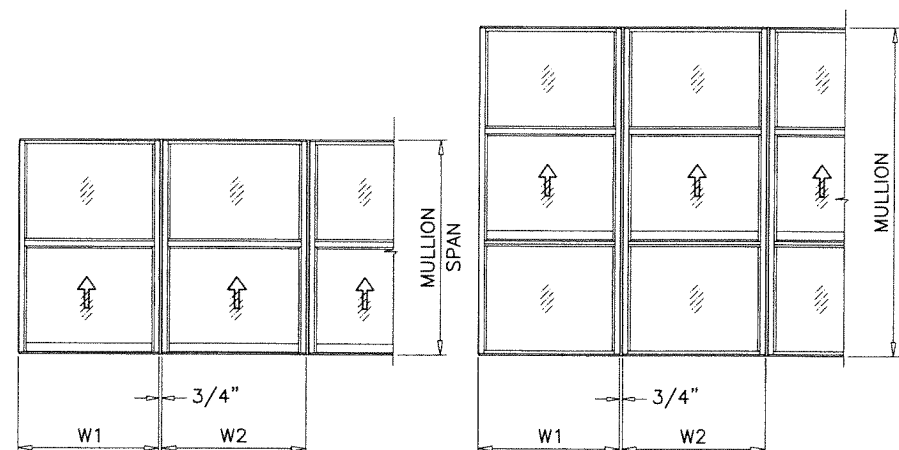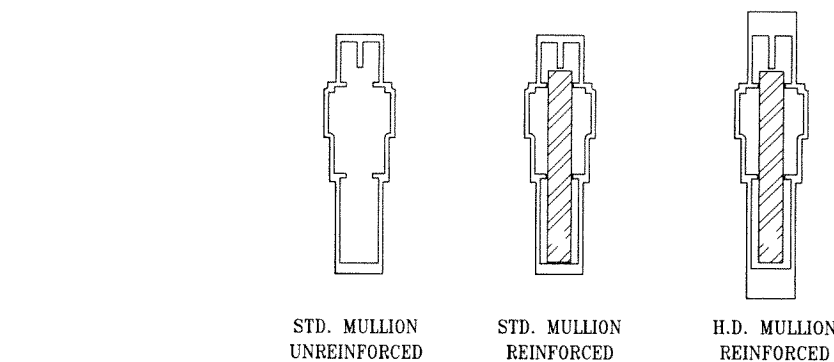


$$\text{WIDTH (W)} = \frac{W1 + W2}{2} + 3/4"$$

MULLION CAPACITY CHART - PSF					
WINDOW DIMS.		STD. MULLION REINFORCED		H.D. MULLION REINFORCED	
WIDTH (W)	MULL SPAN	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
36"	66"	100.0	130.0	100.0	130.0
42"		100.0	130.0	100.0	130.0
48"		100.0	130.0	100.0	130.0
54"		100.0	130.0	100.0	130.0
60"		100.0	130.0	100.0	130.0
66"		100.0	130.0	100.0	130.0
72"		100.0	130.0	100.0	130.0
36"	72"	100.0	130.0	100.0	130.0
42"		100.0	130.0	100.0	130.0
48"		100.0	130.0	100.0	130.0
54"		100.0	130.0	100.0	130.0
60"		100.0	130.0	100.0	130.0
66"		100.0	130.0	100.0	130.0
72"		100.0	130.0	100.0	130.0
36"	78"	100.0	130.0	100.0	130.0
42"		100.0	130.0	100.0	130.0
48"		100.0	130.0	100.0	130.0
54"		100.0	130.0	100.0	130.0
60"		100.0	130.0	100.0	130.0
66"		100.0	130.0	100.0	130.0
36"	84"	100.0	130.0	100.0	130.0
42"		100.0	130.0	100.0	130.0
48"		100.0	130.0	100.0	130.0
54"		100.0	130.0	100.0	130.0
60"		100.0	130.0	100.0	130.0
66"		100.0	130.0	100.0	130.0
36"	90"	100.0	130.0	100.0	130.0
42"		100.0	130.0	100.0	130.0
48"		100.0	130.0	100.0	130.0
54"		100.0	130.0	100.0	130.0
60"		100.0	130.0	100.0	130.0
66"		100.0	130.0	100.0	130.0
36"	96"	100.0	130.0	100.0	130.0
42"		100.0	130.0	100.0	130.0
48"		100.0	130.0	100.0	130.0
54"		100.0	116.6	100.0	130.0
60"		100.0	130.0	100.0	130.0
66"		100.0	130.0	100.0	130.0
36"	108"	100.0	130.0	100.0	130.0
42"		100.0	118.4	100.0	130.0
48"		100.0	103.6	100.0	130.0
54"		100.0	130.0	100.0	130.0
60"		100.0	130.0	100.0	130.0
66"		100.0	130.0	100.0	130.0
36"	110"	100.0	130.0	100.0	130.0
42"		100.0	114.1	100.0	130.0
48"		99.9	99.9	100.0	130.0
54"		99.9	99.9	100.0	130.0
60"		99.9	99.9	100.0	130.0
66"		99.9	99.9	100.0	130.0

**PRODUCT REVISED**  
As complying with the Florida  
Building Code  
NOA-No. **25-0312.06**  
Expiration Date: **06/23/2030**

By: *Manuel Perez*  
Miami-Dade Product Control

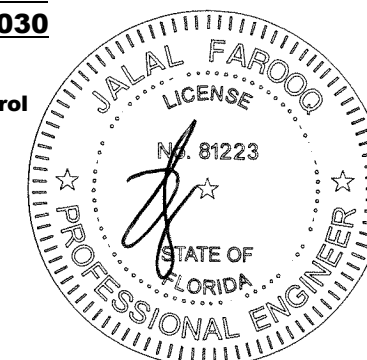

MAR 11 2025

**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
9360 SUNSET DRIVE, SUITE 220  
MIAMI, FLORIDA 33173  
TEL. (305) 262-6978 FAX. (305) 262-6978  
(C.A.N. 3538)

COMP-ANL\W03-111RC


revisions:

no	date	by	description
H	04.08.15		UPDATED TO 2014 FBC
I	02.22.18		UPDATED TO 2017 FBC
J	11.20.20		UPDATED TO 2020 FBC
K	09.14.23		NO CHANGE THIS SHEET
L	02.17.25		GENERAL REVISION


date: 12-11-03  
scale: 1/2" = 1"  
dr. by: TARIQ  
chk. by:

drawing no.  
**W03-111**  
sheet 7 of 10





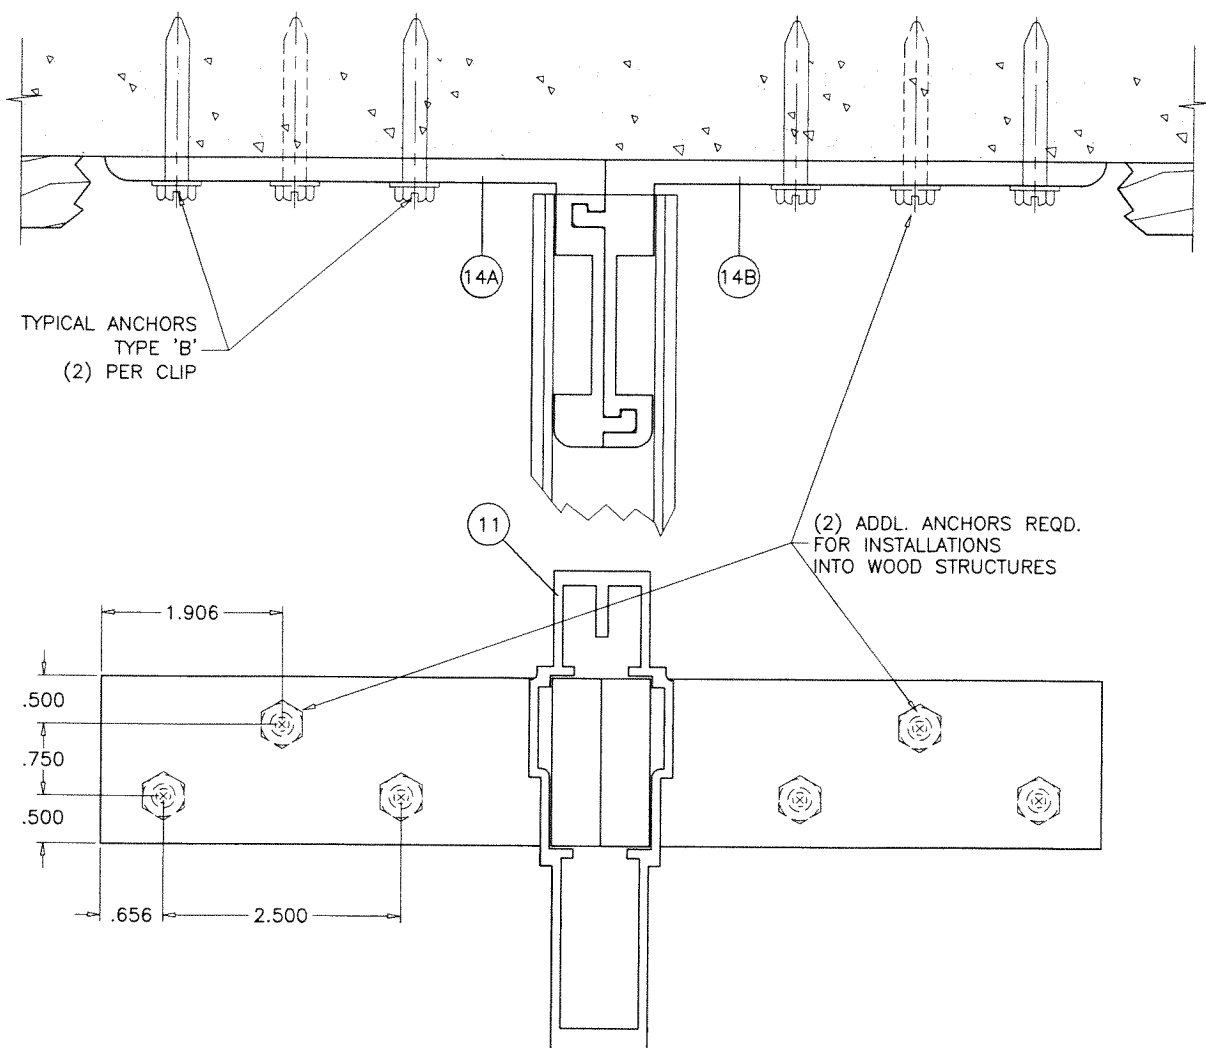

MULLION CONNECTION AT HEAD & SILL  
OPTION 1

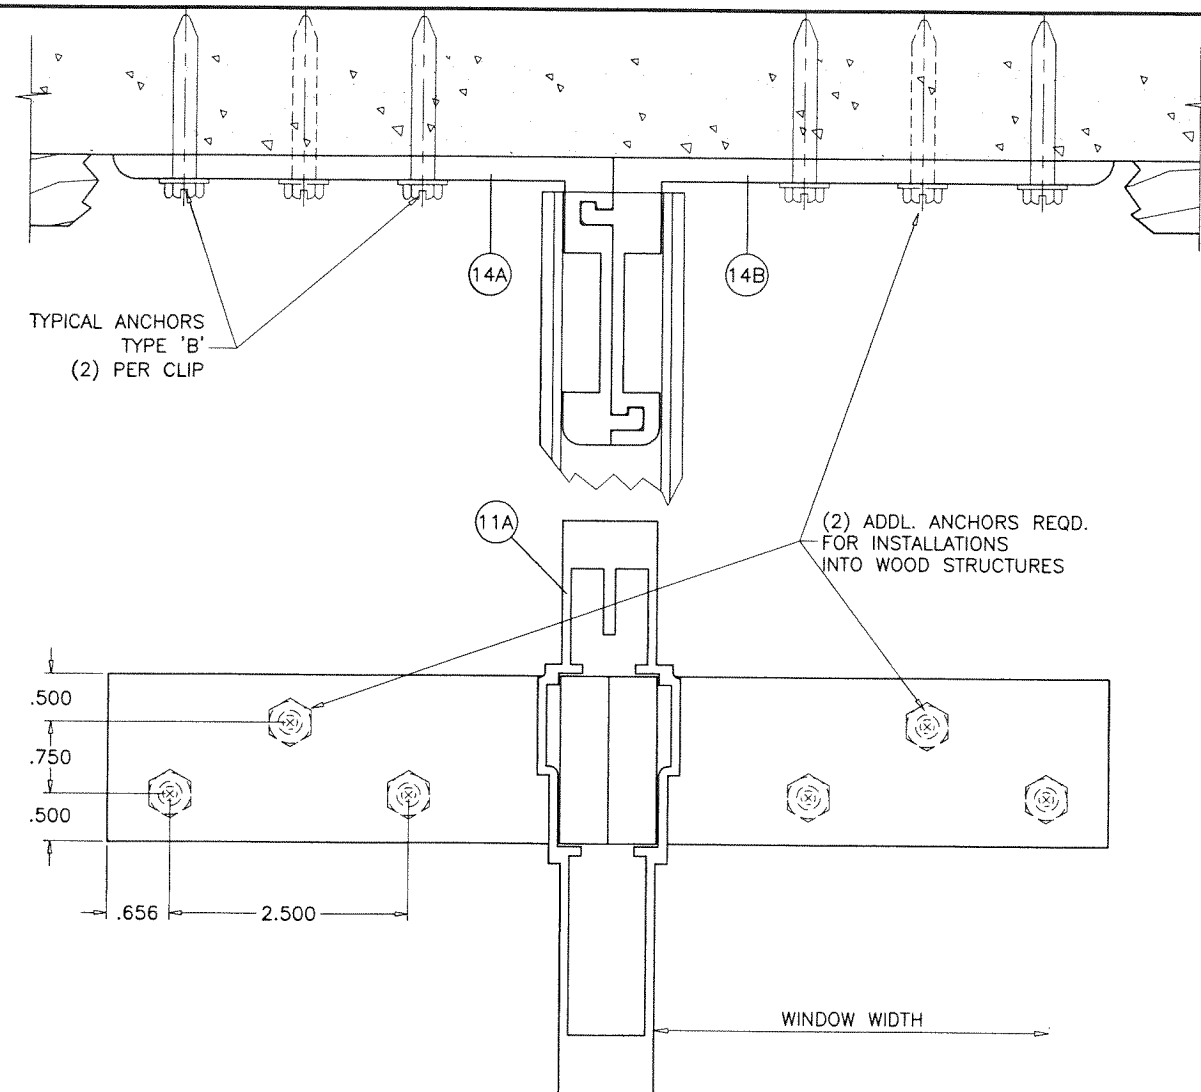


MULLION CONNECTION AT HEAD & SILL  
OPTION 2

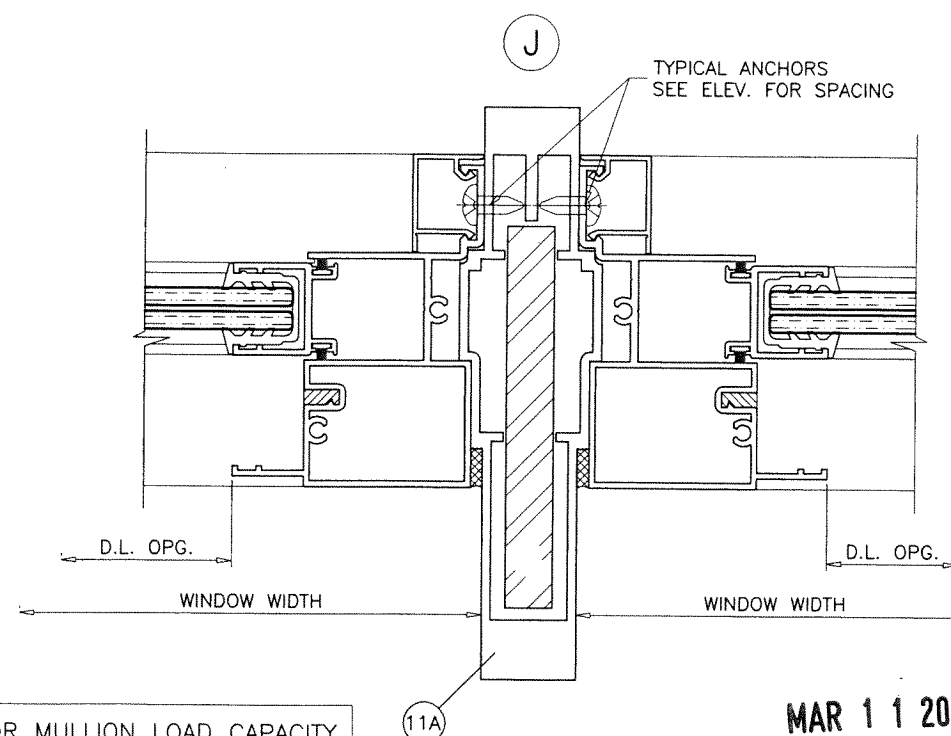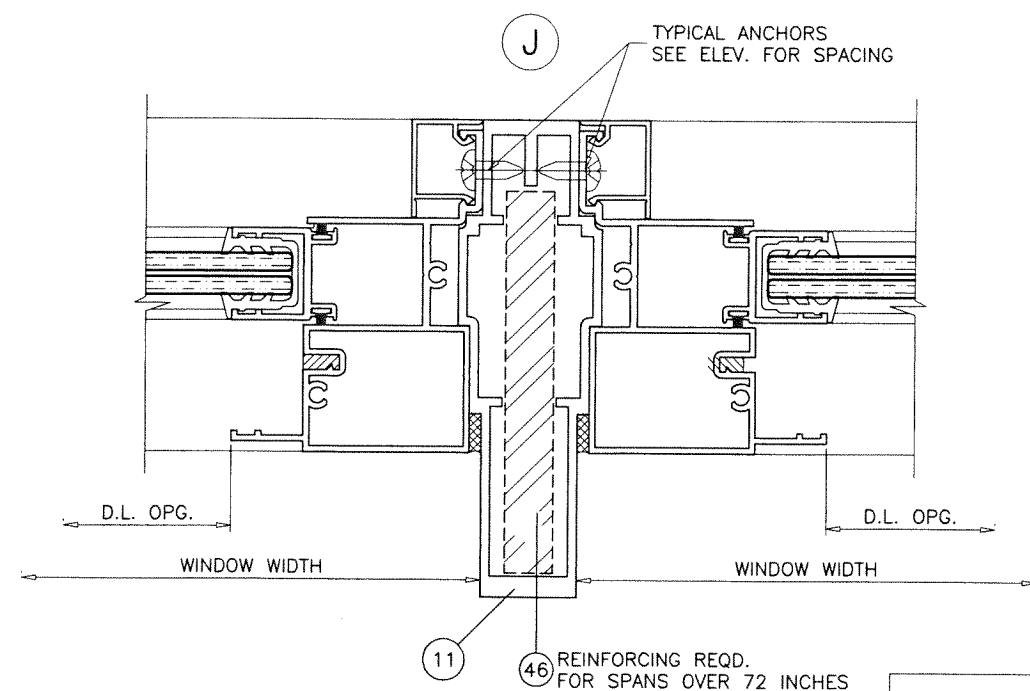

SEE CHARTS ON SHEET 7 FOR MULLION LOAD CAPACITY

MAR 11 2025

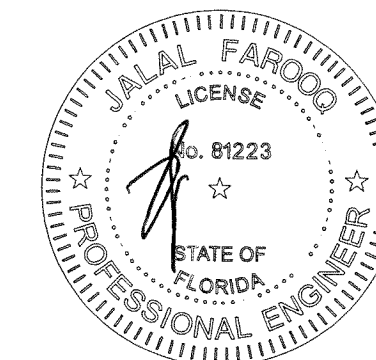

**PRODUCT REVISED**  
As complying with the Florida  
Building Code  
NOA-No. 25-0312.06  
Expiration Date: 06/23/2030  
By: Manuel Perez  
Miami-Dade Product Control

revisions:	no	date	by	description
	H	04.08.15		UPDATED TO 2014 FBC
	I	02.22.18		UPDATED TO 2017 FBC
	J	11.20.20		UPDATED TO 2020 FBC
	K	09.14.23		NO CHANGE THIS SHEET
		02.17.25		GENERAL REVISION

date: 12-11-03  
scale: 1/2" = 1"  
dr. by: TARIQ  
chk. by:

drawing no.  
W03-111  
sheet 8 of 10

SERIES 500Y ALUM SINGLE HUNG WINDOW (S.M.I.)

TECNOGLASS, LLC

TECNOGLASS, LLC  
3550 N.W. 49 STREET

MIAMI, FL. 33142

MIAMI, FL. 33142  
TEL. (305) 638-5151

**AL-FAROOQ CORPORATION**

**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT

9360 SUNSET DRIVE, SUITE 220  
MIAMI, FLORIDA 33173 (C


9360 SUNSET DRIVE, SU  
MIAMI, FLORIDA 33173

MIAMI, FLORIDA 33173  
TEL: (305) 264-8100


TE 220  
(C.A.N. 3538)

303/ 202-0378  
COMP-ANL\W03-111RC

afu

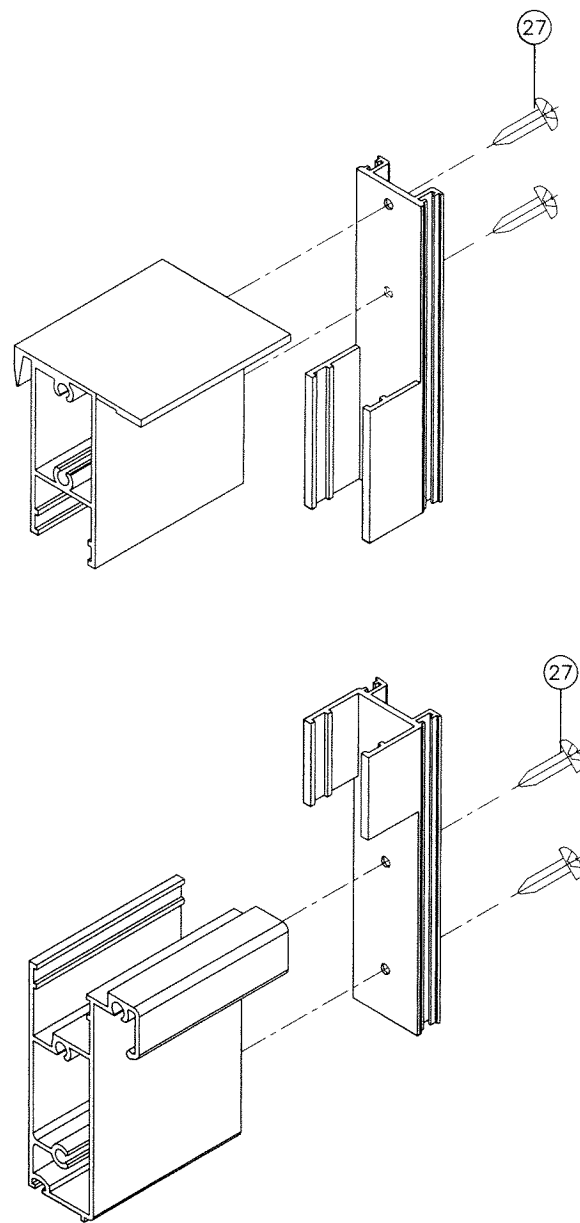

VENT CORNER DETAIL

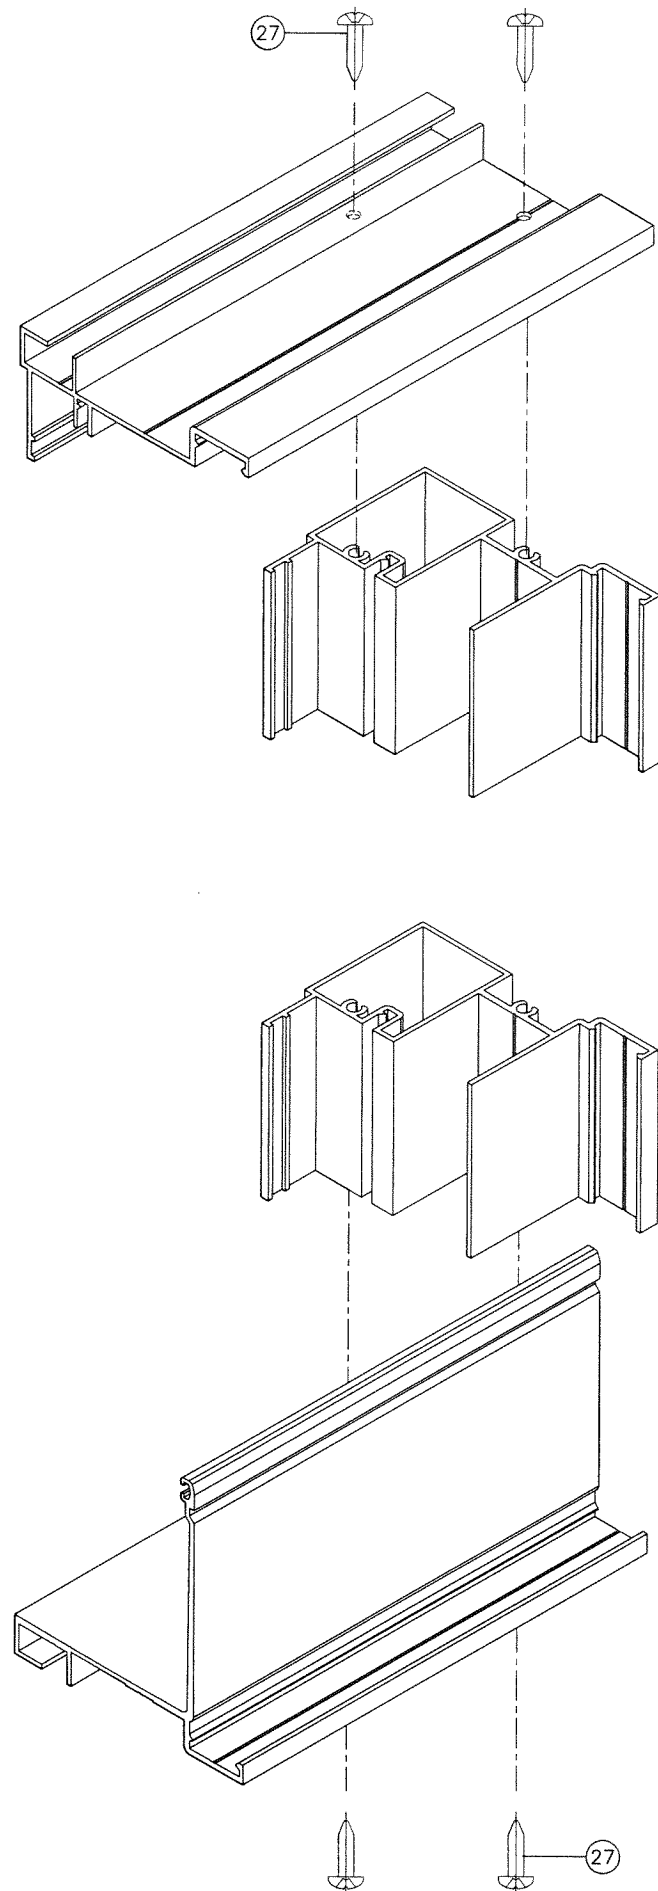

FRAME CORNERS DETAIL


ITEM #	PART #	REQD.	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	500Y-001	AS REQD.	HEAD & FIXED SILL	6063-T6	AT FRAME
2	500Y-002A	AS REQD.	FRAME SILL	-	AT FRAME
3	500Y-003	1	MEETING RAIL	6005-T5	AT FRAME
4	500Y-004	1	VENT TOP	6005-T5	SASH VENT
5	500Y-005	2	JAMB	6063-T6	AT FRAME
6	500Y-006A	1	VENT BOTTOM	6063-T6	SASH VENT
7	500Y-007	AS REQD.	GLAZING BEAD	6063-T6	AT FIXED GLASS
8	500Y-008	2	VENT SIDE	6063-T6	SASH VENT
9	500Y-009	AS REQD.	SILL MEETING RAIL	6005-T5	AT FRAME
10	500Y-010	AS REQD.	TRACK COVER (OPTIONAL)	6063-T6	AT FRAME
11	500Y-023	AS REQD.	STD. MULLION	6063-T6	AT FRAME
11A	500Y-029	AS REQD.	H.D. MULLION	6063-T6	AT FRAME
12	LL-300	2/VENT	HANDICAP FINGER LOCK	6063-T6	SASH VENT
13	500Y-013	1	VENT STOP	6063-T6	AT TOP OF FRAME
14A	500Y-024	AS REQD.	FEMALE ANCHOR CLIP	6063-T6	TOP & BOTTOM OF MULL
14B	500Y-025	AS REQD.	MALE ANCHOR CLIP	6063-T6	TOP & BOTTOM OF MULL
15	W33261NK	AS REQD.	WEATHERSTRIPPING PILE	-	AT VENT SIDE MEETING RAIL
16	WV-3189	AS REQD.	W'STIPPING GASKET (DUROMETER 65 SHORE A)	VINYL	SILL & SILL MEETING RAIL
17	V-048	AS REQD.	W'STRIPPING GASKET (DUROMETER 60±5 SHORE A)	NEOPRENE	BOTTOM OF SASH VENT
21	V-052	-	GLAZING GASKET (DUROMETER 75 SHORE A)	VINYL	-
21A	V-049	-	GLAZING GASKET (DUROMETER 75 SHORE A)	VINYL	-
22	V-053	-	GLAZING WEDGE (DUROMETER 70±5 SHORE A)	VINYL	-
23	P-012	2/ VENT	VENT TOP GUIDE PLASTIC M&M (ROCKWELL R 110)	NYLON	TOP OF SASH VENT
24	P-013	2/ VENT	VENT BOTTOM GUIDE PLASTIC M&M (ROCKWELL R 110)	NYLON	BOTTOM OF SASH VENT
25	-	AS REQD.	#8 X 3/8" LG. FH. SMS. ST/ST PHILLIPS	-	AT P-012, P-013 & PD-203
26	-	2	#8 X 1" LG. FH. SMS. ST/ST PHILLIPS	-	AT TOP OF BALANCE
27	-	AS REQD.	#10 X 1" LG. PH. SMS. ST/ST PHILLIPS	-	ASSEMBLY SCREWS
28	-	6	#10 X 3/4" LG. PH. SMS. ST/ST PHILLIPS	-	AT BALANCE CLIP
32	PD-203	2/ WDW	SASH LOCK	-	AT TOP OF SASH
33	-	2/ WDW	ULTRA-LIFT BALANCE #30	-	AT FRAME
34	-	2/ WDW	ULTRA-LIFT NON TILT BRACKET	-	-
36	-	-	1/4" X 1/2" FOAM TAPE SINGLE FACE	-	-
37	-	-	1/8" X 1/2" X 4" LG. SETTING BLOCK	NEOPRENE	DUROMETER 85±5 SHORE A
38	-	-	3/8" X 1/2" X 4" LG. SETTING BLOCK	NEOPRENE	DUROMETER 85±5 SHORE A
40	DOWSIL 795	-	GLAZING COMPOUND	SILICONE	-
46	-	AS REQD.	1/2" X 4" X 104" LG. STEEL.	-	AT MULLION

**SEALANT:**

ALL JOINTS AND FRAME CONNECTIONS SEALED WITH DOWSIL 795 SEALANT.

**PRODUCT REVISED**  
As complying with the Florida Building Code  
NOA-No. **25-0312.06**  
Expiration Date: **06/23/2030**  
By: *Manuel Perez*  
Miami-Dade Product Control

MAR 11 2025

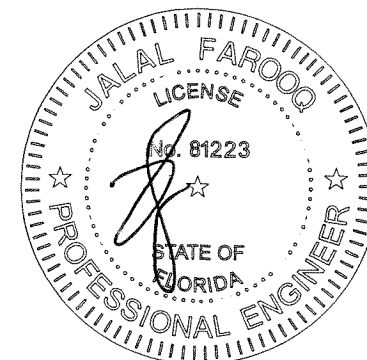


**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
9360 SUNSET DRIVE, SUITE 220  
MIAMI, FLORIDA 33173  
TEL. (305) 264-8100 FAX. (305) 262-6978  
(C.A.N. 3538)


SERIES 500Y ALUM SINGLE HUNG WINDOW (S.M.I.)  
**TECNOGLASS, LLC**  
3550 N.W. 49 STREET  
MIAMI, FL. 33142  
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:	no	date	by	description
	H	04.08.15		description
	I	02.22.18		UPDATED TO 2017 FBC
	J	11.20.20		UPDATED TO 2020 FBC
	K	09.14.23		NO CHANGE THIS SHEET
	L	02.17.25		GENERAL REVISION
date:	12-11-03			
scale:	1/2" = 1"			
dr. by:	TARIQ			
chk. by:				
drawing no.	W03-111			
sheet	9 of 10			




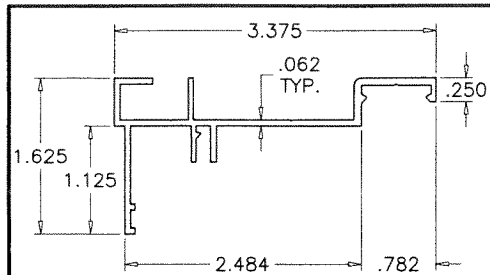


① FRAME HEAD/SILL

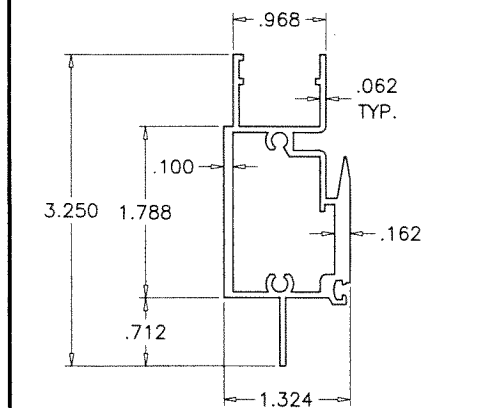


③ MEETING RAIL

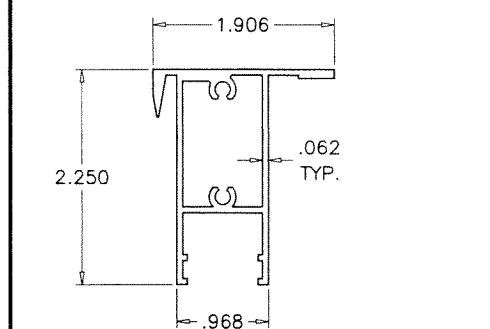


④ VENT TOP RAIL

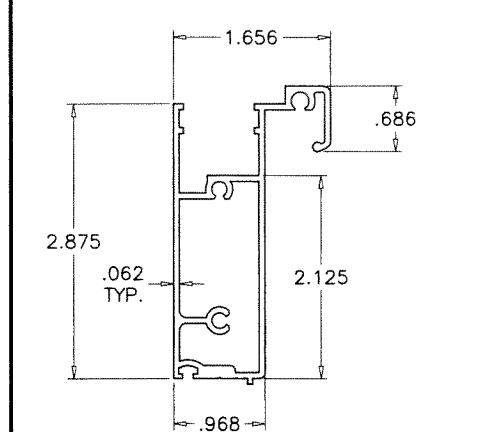


⑥ VENT BOTTOM RAIL

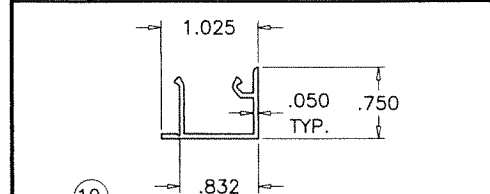


⑩ INSTALLATION TRACK COVER

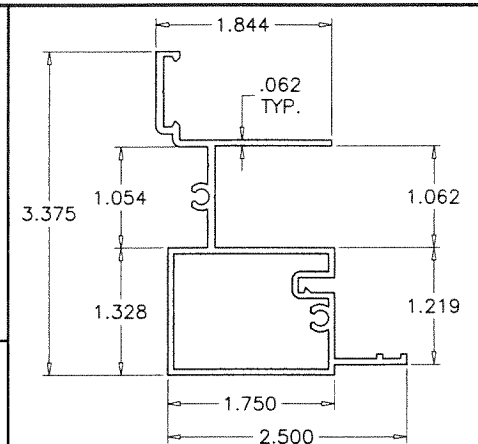


⑤ FRAME JAMB

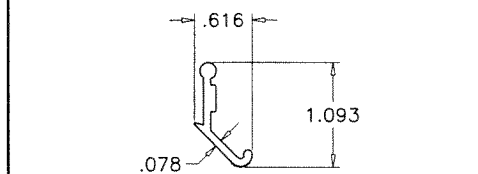


⑫ VENT LATCH

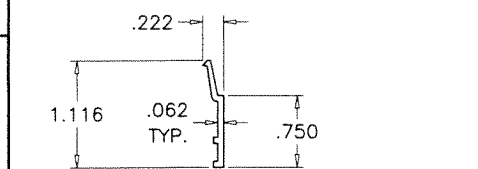


⑦ GLAZING BEAD

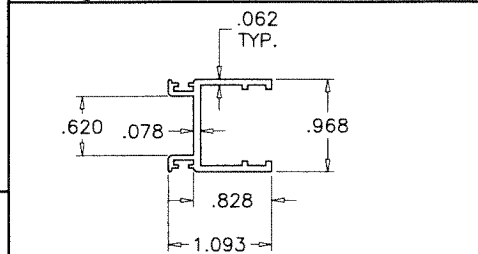


⑧ VENT SIDE RAIL

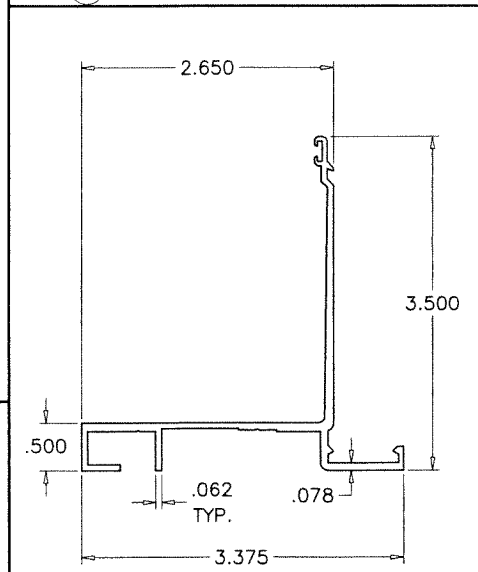


② FRAME SILL

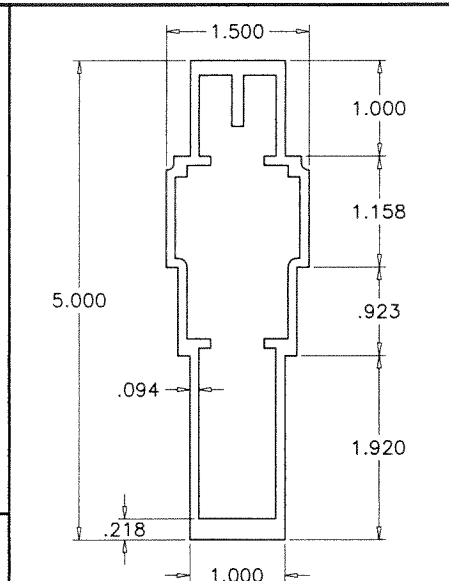


⑪ STD. MULLION

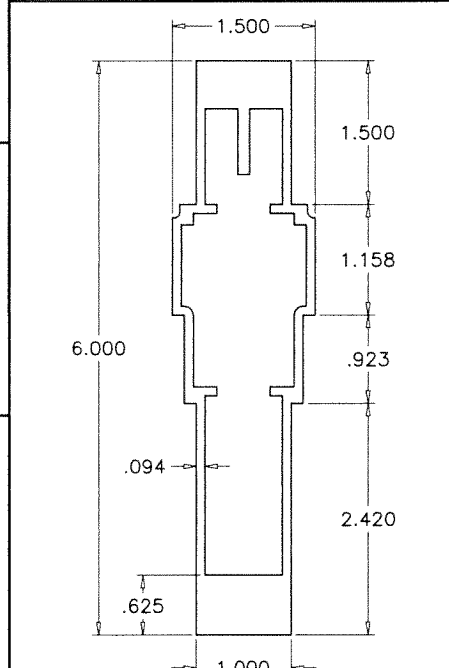


⑪A H.D. MULLION

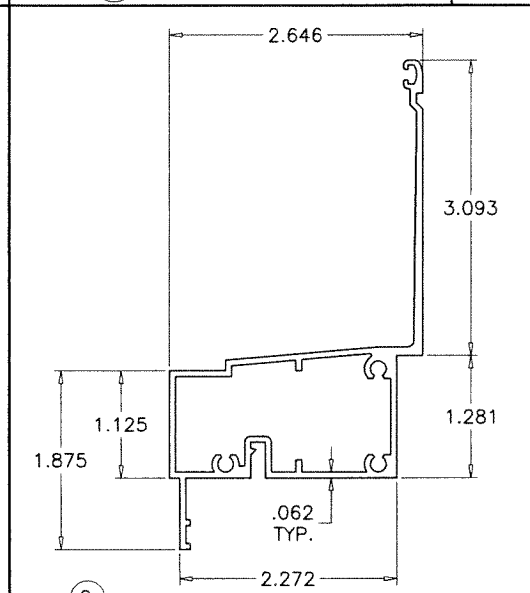

⑨ SILL MTG. RAIL W/ FIXED BOTTOM

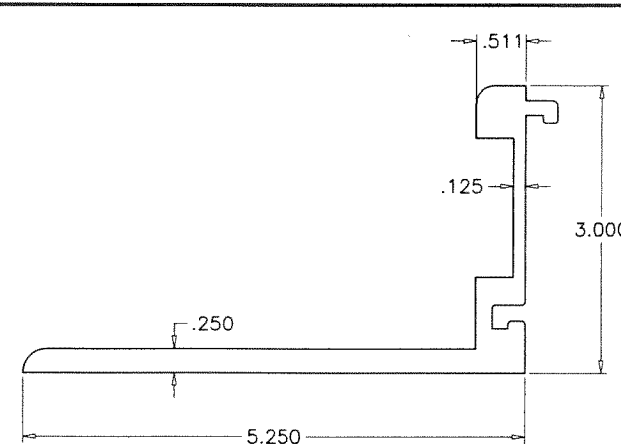


⑭A FEMALE ANCHOR CLIP

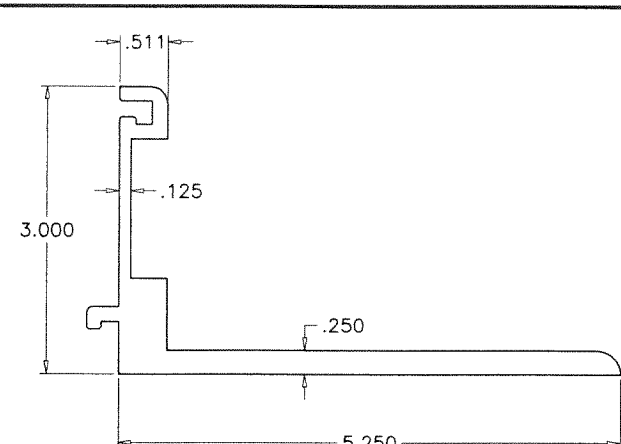

⑭B MALE ANCHOR CLIP

**PRODUCT REVISED**  
As complying with the Florida Building Code  
NOA-No. **25-0312.06**  
Expiration Date: **06/23/2030**  
By: *Manuel Perez*  
Miami-Dade Product Control

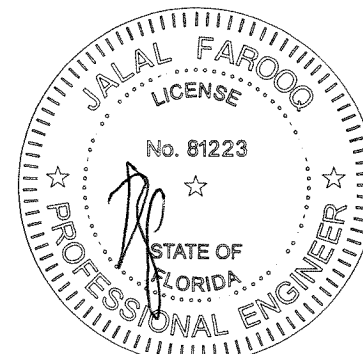

MAR 11 2025

**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
9360 SUNSET DRIVE, SUITE 220  
MIAMI, FLORIDA 33173  
TEL. (305) 264-8100 FAX. (305) 262-6978  
C.A.N. 3538

SERIES 500Y ALUM SINGLE HUNG WINDOW (S.M.I.)  
**TECNOGLASS, LLC**  
3550 N.W. 49 STREET  
MIAMI, FL. 33142  
TEL. (305) 638-5151 FAX. (305) 638-5158

no	date	by	description
H	04.08.15		UPDATED TO 2014 FBC
I	02.22.18		UPDATED TO 2017 FBC
J	11.20.20		UPDATED TO 2020 FBC
K	09.14.23		NO CHANGE THIS SHEET
L	02.17.25		GENERAL REVISION

date: 12-11-03  
scale: 1/2" = 1"  
dr. by: TARIQ  
chk. by:  
drawing no. **W03-111**  
sheet 10 of 10

COMP-ANL\W03-111RC