



**MIAMI-DADE COUNTY, FLORIDA  
PRODUCT CONTROL SECTION**

11805 SW 26 Street, Room 208

Miami, Florida 33175-2474

T (786) 315-2590 F (786) 315-2599

**DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)  
BOARD AND CODE ADMINISTRATION DIVISION**

**NOTICE OF ACCEPTANCE (NOA)**

[www.miamidade.gov/economy](http://www.miamidade.gov/economy)

**PGT Industries, LLC  
3400 Precision Drive  
North Venice, FL 34275**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER - Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION: Series "SH-5500" PVC Single Hung Window – L.M.I.**

**APPROVAL DOCUMENT:** Drawing No. **SH5500-NOA** titled "Vinyl Single Hung Window (LM)", sheets 1 through 14 of 14, dated 05/15/15, with revision E dated 05/12/25, prepared by manufacturer, signed and sealed by Anthony Lynn Miller, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

**MISSILE IMPACT RATING: Large and Small Missile Impact Resistant**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.


**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises and renews** NOA No. **23-0707.12** and consists of this page 1 and evidence pages E-1, E-2, E-3, E-4 and E-5, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



  
6/3/25

**NOA No. 25-0520.01**  
**Expiration Date: July 30, 2030**  
**Approval Date: June 12, 2025**  
**Page 1**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**


**1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's**

**A. DRAWINGS**

1. Manufacturer's die drawings and sections.  
*(Submitted under NOA No. 15-0519.05)*
2. Drawing No. **SH5500-NOA** titled "Vinyl Single Hung Window (LM)", sheets 1 through 13 of 13, dated 05/15/15, with revision **D** dated 07/05/23, prepared by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.  
*(Submitted under NOA No. 23-0707.12)*

**B. TESTS**

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Large Missile Impact Test per FBC, TAS 201-94  
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
6) Forced Entry Test, per ASTM F588 and TAS 202-94  
along with marked-up drawings and installation diagram of all PGT Industries, Inc. representative units listed below and tested to qualify **Dowsil 791** and **Dowsil 983** silicones, prepared by Fenestration Testing Laboratory, Inc., Test Reports No.: **FTL-7897**, PGT PW5520 PVC Fixed Window (unit 6 in proposal), dated 09/03/14  
**FTL-20-2107.1**, PGT SGD780 Aluminum Sliding Glass Door (unit 7 in proposal)  
**FTL-20-2107.2**, PGT CA740 Alum. Outswing Casement Window (unit 8 in proposal)  
**FTL-20-2107.3**, PGT PW7620A Aluminum Fixed Window (unit 9 in proposal) and  
**FTL-20-2107.4**, PGT PW7620A Aluminum Fixed Window (unit 10 in proposal)  
dated 07/13/20, all signed and sealed by Idalmis Ortega, P.E.  
*(Submitted under NOA No. 20-0401.03)*
2. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94  
2) Large Missile Impact Test per FBC, TAS 201-94  
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
along with marked-up drawings and installation diagram of a PVC sliding glass door, a PVC fixed window and an aluminum sliding glass door, using: Kodispace 4SG TPS spacer system, Duraseal® spacer system, Super Spacer® NXT™ spacer system and XL Edge™ spacer system at insulated glass, prepared by Fenestration Testing Laboratory, Inc., Test Reports No. **FTL-8717**, **FTL-8968** and **FTL-8970**, dated 11/16/15, 06/07/16 and 06/02/16 respectively, all signed and sealed by Idalmis Ortega, P.E.  
*(Submitted under NOA No. 16-0714.03)*

  
Manuel Pérez, P.E.  
Product Control Examiner  
NOA No. 25-0520.01  
Expiration Date: July 30, 2030  
Approval Date: June 12, 2025

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's (CONTINUED)**

**B. TESTS (CONTINUED)**

3. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94  
4) Forced Entry Test, per FBC 2411.3.2.1, and TAS 202-94  
5) Large Missile Impact Test per FBC, TAS 201-94  
6) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
along with marked-up drawings and installation diagram of a series 5500 PVC single hung window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-7964**, dated 11/15/14, signed and sealed by Idalmis Ortega, P.E.  
**(Submitted under NOA No. 15-0519.05)**
4. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94  
2) Large Missile Impact Test per FBC, TAS 201-94  
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
along with marked-up drawings and installation diagram of a series 5500 PVC single hung window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-7966**, dated 08/21/14, signed and sealed by Idalmis Ortega, P.E.  
**(Submitted under NOA No. 15-0519.05)**

**C. CALCULATIONS**


1. Anchor verification calculations and structural analysis, complying with FBC 5<sup>th</sup> Edition (2014), dated 05/15/15, 08/29/17 and updated on 03/10/20 to the FBC 7<sup>th</sup> Edition (2020), prepared by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.  
**(Submitted under NOA No. 20-0401.03)**
2. Glazing complies with **ASTM E1300-09**

**D. QUALITY ASSURANCE**

1. Miami-Dade Department of Regulatory and Economic Resources (RER).

**E. MATERIAL CERTIFICATIONS**

1. Notice of Acceptance No. **19-0305.02** issued to **Kuraray America, Inc.** for their "Trosifol® Ultraclear, Clear and Color PVB Glass Interlayers" dated 05/09/19, expiring on 07/08/24.
2. Notice of Acceptance No. **18-0725.11** issued to **Kuraray America, Inc.** for their "SentryGlas® Xtra™ (SGX™) (Clear and White) Glass Interlayers" dated 05/23/19, expiring on 05/23/24.

  
Manuel Pérez, P.E.  
Product Control Examiner  
NOA No. 25-0520.01  
Expiration Date: July 30, 2030  
Approval Date: June 12, 2025

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's (CONTINUED)**

**E. MATERIAL CERTIFICATIONS (CONTINUED)**


3. Notice of Acceptance No. **21-1109.04** issued to Vision Extrusions Group Limited, for their **"White Rigid PVC Exterior Extrusions for Windows and Doors"** dated 03/31/22, expiring on 09/30/24.
4. Notice of Acceptance No. **22-0104.04** issued to Vision Extrusions Group limited for their **"Bronze and Lighter Shades of Cap Coated Rigid PVC Exterior Extrusions for Windows and Doors"** dated 04/14/22, expiring on 12/29/26.
5. Notice of Acceptance No. **20-0203.04** issued to ENERGI Fenestration Solutions USA, Inc. for their **"Performance Core Rigid PVC Exterior Extrusions for Windows and Doors"** dated 02/27/20, expiring on 04/16/25.

**F. STATEMENTS**

1. Statement letter of conformance, complying with **FBC 7<sup>th</sup> Edition (2020)** and **FBC 8<sup>th</sup> Edition (2023)**, dated July 05, 2023, issued by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.  
*(Submitted under NOA No. 23-0707.12)*
2. Statement letter of no financial interest, dated March 10, 2020, issued by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.  
*(Submitted under NOA No. 20-0401.03)*
3. Proposal No. **19-1155 TP** issued by the Product Control Section, dated January 10, 2020, signed by Ishaq Chanda, P.E.  
*(Submitted under NOA No. 16-0714.03)*
4. Proposal No. **16-0125** issued by the Product Control Section, dated March 09, 2016, signed by Ishaq Chanda, P.E.  
*(Submitted under NOA No. 16-0714.03)*
5. Proposal issued by Product Control, dated 06/26/14 and revised on 08/19/14, signed by Jaime Gascon, P.E., Supervisor, Product Control Section.  
*(Submitted under NOA No. 15-0519.05)*

**G. OTHERS**

1. Notice of Acceptance No. **20-0401.03**, issued to PGT Industries, Inc. for their Series "SH-5500" PVC Single Hung Window - L.M.I. approved on 07/23/20 and expiring on 07/30/25.

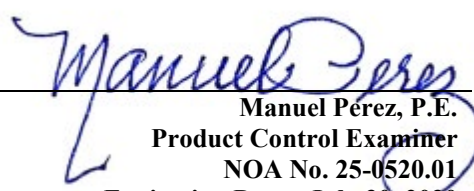  
Manuel Pérez, P.E.  
Product Control Examiner  
NOA No. 25-0520.01  
Expiration Date: July 30, 2030  
Approval Date: June 12, 2025

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**2. NEW EVIDENCE SUBMITTED**

**A. DRAWINGS**

1. Drawing No. **SH5500-NOA** titled “Vinyl Single Hung Window (LM)”, sheets 1 through 14 of 14, dated 05/15/15, with revision **E** dated 05/12/25, prepared by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.

**B. TESTS**

1. None.

**C. CALCULATIONS**


1. Anchor verification calculations and structural analysis, complying with FBC 8<sup>th</sup> Edition (2023), dated 05/12/25, prepared by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.

**D. QUALITY ASSURANCE**

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

**E. MATERIAL CERTIFICATIONS**

1. Notice of Acceptance No. **24-0205.08** issued to **Kuraray America, Inc.** for their “**Trosifol® Ultraclear, Clear and Color PVB Glass Interlayers**” dated 03/21/24, expiring on 07/08/29.
2. Notice of Acceptance No. **23-0717.30** issued to **Kuraray America, Inc.** for their “**SentryGlas® (Clear and White) Glass Interlayers**” dated 08/31/23, expiring on 07/04/28.
3. Notice of Acceptance No. **24-0618.01**, issued to **Vision Extrusions Group Limited**, for their **White Rigid PVC Exterior Extrusions for Windows and Doors**, approved on 07/18/24, expiring on 09/30/29.
4. Notice of Acceptance No. **24-0401.07**, issued to **Vision Extrusions Group Limited**, for their **Black and Lighter Shades of Cap Coated Rigid PVC Exterior Extrusions for Windows and Doors**, approved on 05/09/24, expiring on 07/28/27.
5. Notice of Acceptance No. **23-0821.09**, issued to **Vision Extrusions Group Limited**, for their **Tan 3040 and Lighter Shades (Non White) Rigid PVC Exterior Extrusions for Windows and Doors**, approved on 02/04/23, expiring on 02/04/26.
6. Notice of Acceptance No. **23-0830.05**, issued to **Vision Extrusions Group Limited**, for their **VE 1000 Tan 202 and Lighter Shades (Non-White) Rigid PVC Exterior Extrusions for Windows and Doors**, approved on 10/26/23, expiring on 12/29/26.
7. Notice of Acceptance No. **24-0618.02**, issued to **Vision Extrusions Group Limited**, for their **Painted or Laminated White Rigid PVC Exterior Extrusions for Windows and Doors**, approved on 07/18/24, expiring on 09/30/29

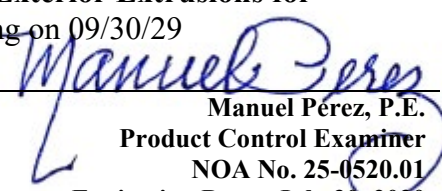  
Manuel Pérez, P.E.  
Product Control Examiner  
NOA No. 25-0520.01  
Expiration Date: July 30, 2030  
Approval Date: June 12, 2025

**PGT Industries, LLC**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**


**2. NEW EVIDENCE SUBMITTED (CONTINUED)**


**F. STATEMENTS**

1. Statement letter of conformance, complying with **FBC 8<sup>th</sup> Edition (2023)**, dated May 12, 2025, issued by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.
2. Statement letter of no financial interest, dated May 12, 2025, issued by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.
3. Article of conversion of PGT Industries, Inc to PGT industries, LLC pdf provided on 12/24/24 by Ms. April Lee, Assistant General Counsel.
4. Florida Department of State, Division of Corporation listing # L2400142070 of PGT Industries LLC as active status since 12/17/24.
5. Florida Department of State, Division of Corporation listing # F03387 of PGT Industries, Inc as Inactive status.
6. PGT Name change organization chart layout prepared by RER (for file use only).


**G. OTHERS**

1. Notice of Acceptance No. **23-0707.12**, issued to PGT Industries, Inc. for their Series "SH-5500" PVC Single Hung Window - L.M.I. approved on 07/27/23 and expiring on 07/30/25.


  
Manuel Perez, P.E.  
Product Control Examiner  
NOA No. 25-0520.01  
Expiration Date: July 30, 2030  
Approval Date: June 12, 2025

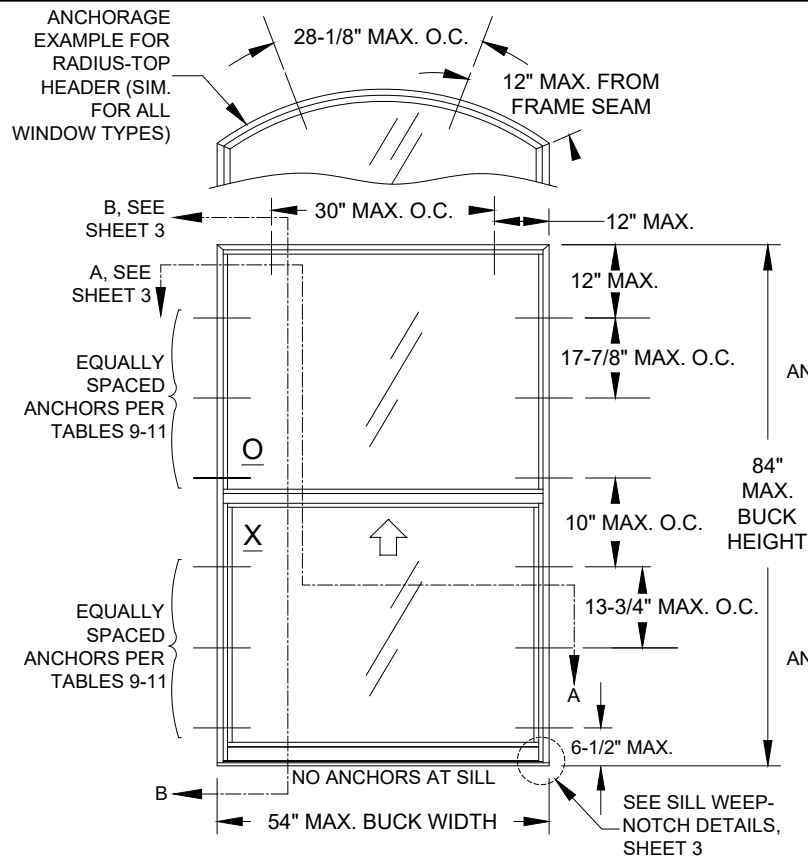


ELEVATION FOR TYP. EQUAL LEG FRAME  
SHOWN WITH EQUAL-LITE CONFIGURATION

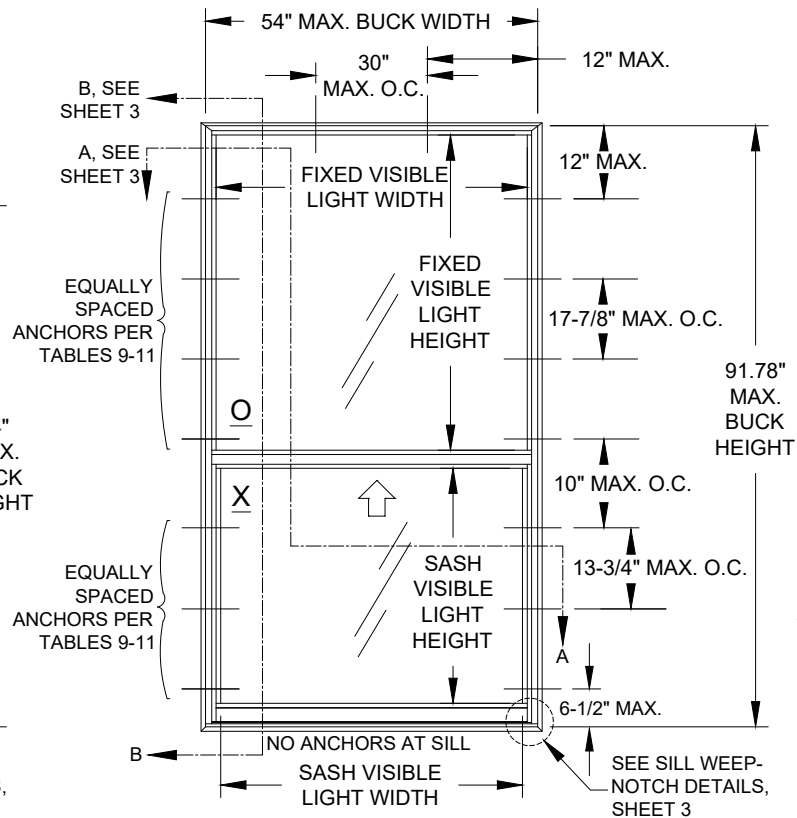

ELEVATION FOR TYP. FLANGE FRAME  
SHOWN WITH ORIEL/PROVIEW CONFIGURATION

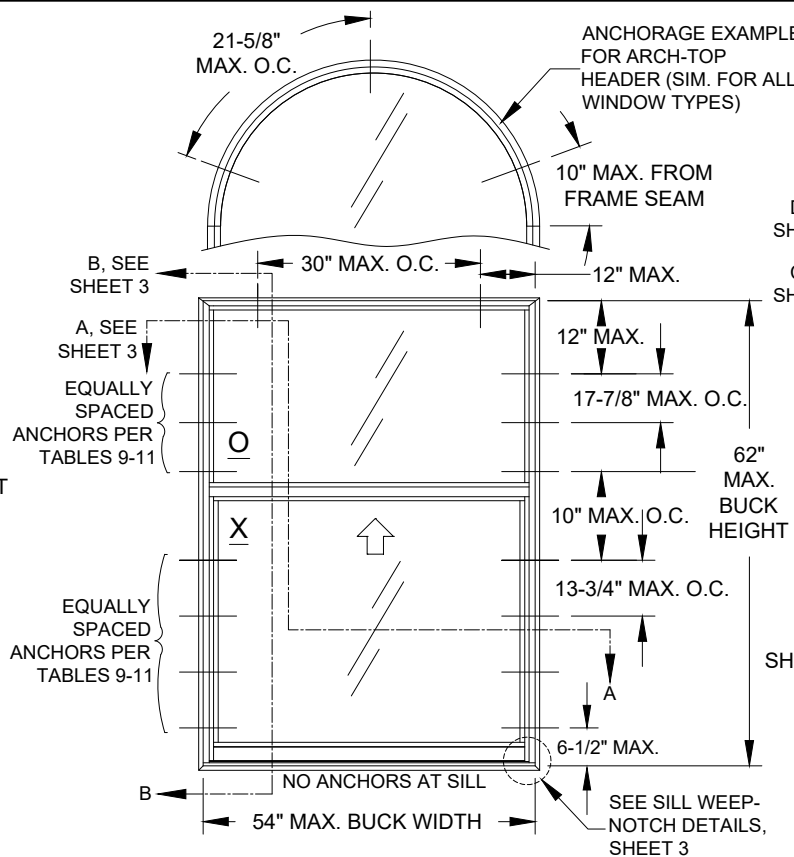

ELEVATION FOR TYP. FLANGE FRAME  
SHOWN WITH STANDARD COTTAGE CONFIGURATION  
FOR CUSTOM COTTAGE CONFIGURATION UP TO  
75" HEIGHT SEE TABLES 4-11

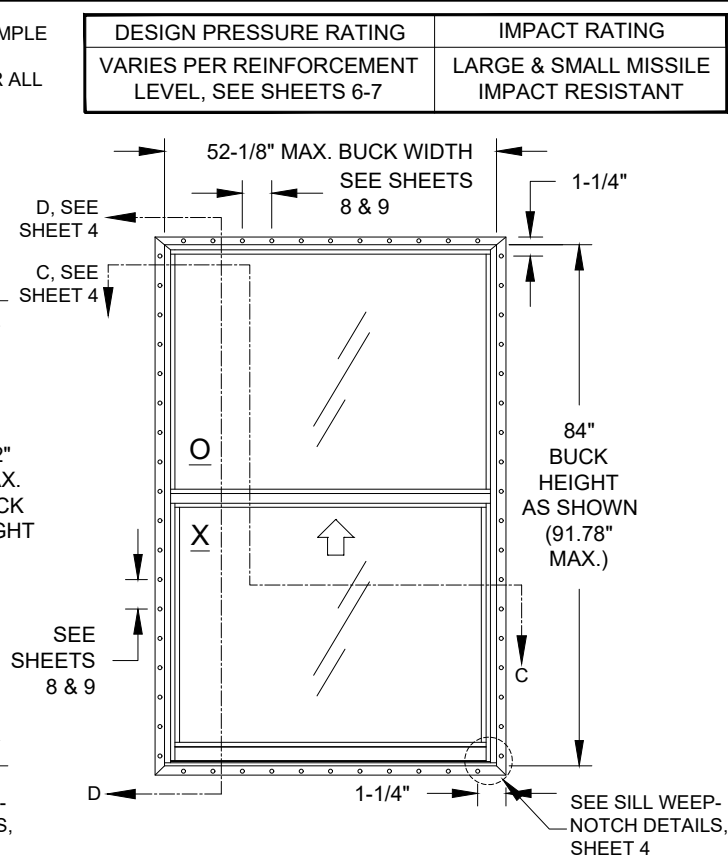

ELEVATION FOR TYP. FIN OR J-CHANNEL FRAME  
SHOWN WITH EQUAL-LITE CONFIGURATION  
ANCHORED THROUGH THE NAIL-FIN  
(SIMILAR ANCHOR DIMENSIONS FOR OTHER CONFIGURATIONS)

GENERAL NOTES: SERIES 5500 IMPACT RESISTANT SINGLE HUNG WINDOW

- 1) THIS PRODUCT HAS BEEN DESIGNED & TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE, INCLUDING THE HIGH VELOCITY HURRICANE ZONE (HVHZ).
- 2) SHUTTERS ARE NOT REQUIRED WHEN USED IN WIND-BORNE DEBRIS REGIONS. FOR INSULATED GLASS INSTALLATIONS ABOVE 30' IN THE HVHZ, THE OUTBOARD LITE (CAP) MUST TEMPERED.
- 3) FOR MASONRY APPLICATIONS IN MIAMI-DADE COUNTY, USE ONLY MIAMI-DADE COUNTY APPROVED MASONRY ANCHORS. MATERIALS USED FOR ANCHOR EVALUATIONS WERE SOUTHERN PINE, ASTM C90 CONCRETE MASONRY UNITS AND CONCRETE WITH MIN. KSI PER ANCHOR TYPE.
- 4) ALL WOOD BUCKS LESS THAN 1-1/2" THICK ARE TO BE CONSIDERED 1X INSTALLATIONS. 1X WOOD BUCKS ARE OPTIONAL IF UNIT IS INSTALLED DIRECTLY TO SUBSTRATE. WOOD BUCKS DEPICTED AS 2X ARE 1-1/2" THICK OR GREATER. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND SECURED TO PROPERLY TRANSFER LOADS TO THE STRUCTURE. WOOD BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER, (EOR) OR ARCHITECT OF RECORD, (AOR).
- 5) ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO. USE ANCHORS OF SUFFICIENT LENGTH TO ACHIEVE REQUIRED MIN. EMBEDMENT. INST. ANCHORS SHOULD BE SEALED. OVERALL SEALING/FLASHING STRATEGY FOR WATER RESISTANCE OF INSTALLATION SHALL BE DONE BY OTHERS AND IS BEYOND THE SCOPE OF THESE INSTRUCTIONS.
- 6) 1/4" MAX. SHIMS ARE REQUIRED AT EACH ANCHOR LOCATION WHERE THE PRODUCT IS NOT FLUSH TO THE SUBSTRATE. USE SHIMS CAPABLE OF TRANSFERRING APPLIED LOADS.
- 7) DESIGN PRESSURES:
  - A. NEGATIVE DESIGN LOADS BASED ON STRUCTURAL & CYCLE TESTING AND GLASS PER ASTM E1300.
  - B. POSITIVE DESIGN LOADS BASED ON WATER TEST PRESSURE, STRUCTURAL & CYCLE TESTING AND GLASS PER ASTM E1300.
  - C. DESIGN LOADS ARE BASED ON ALLOWABLE STRESS DESIGN, ASD.
- 8) THE ANCHORAGE METHODS SHOWN HAVE BEEN DESIGNED TO RESIST THE WINDLOADS CORRESPONDING TO THE REQUIRED DESIGN PRESSURE. THE 33-1/3% STRESS INCREASE HAS NOT BEEN USED IN THE DESIGN OF THIS PRODUCT. THE 1.6 LOAD DURATION FACTOR WAS USED FOR THE EVALUATION OF ANCHORS INTO WOOD. ANCHORS THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE FLORIDA BUILDING CODE FOR CORROSION RESISTANCE.
- 9) METAL SUBSTRATE TO MEET MIN. STRENGTH AND THICKNESS REQUIREMENTS PER CURRENT FLORIDA BUILDING CODE AND TO BE REVIEWED BY THE AUTHORITY HAVING JURISDICTION.
- 10) REFERENCES: TEST REPORTS FTL-7964 & 7966; ELCO ULTRACON NOA; DEWALT ULTRACON+ NOA; ELCO/DEWALT CRETEFLEX NOA; ELCO/DEWALT AGGRE-GATOR NOA; VISION EXTRUSION, LTD WHITE & BRONZE/LIGHTER SHADES OF CAP COATED PVC EXTRUSION NOA'S; NATIONAL DESIGN SPECIFICATION FOR WOOD CONSTRUCTION, ANSI/AF&PA NDS & ALUMINUM DESIGN MANUAL
- 11) APPLICABLE EGRESS REQUIREMENTS TO BE REVIEWED BY BUILDING OFFICIAL.
- 12) FRAME FLANGES OR INTEGRAL FINS MAY BE TRIMMED IN-FIELD TO CREATE AN EQUAL-LEG FRAME.

USER INSTRUCTIONS:

- 1) DETERMINE THE SITE SPECIFIC, WINDOW OPENING'S DESIGN PRESSURE REQUIREMENT FROM ASCE 7.
- 2) DETERMINE THE MOST SUITABLE ANCHOR GROUP FROM TABLES 2 OR 3 ACCORDING TO THE INSTALLATION CONDITIONS.
- 3) KNOWING YOUR GLAZING OPTION (TABLE 1), WINDOW CONFIGURATION AND SIZE, DETERMINE YOUR WINDOW'S DESIGN PRESSURE FROM TABLES 4-8. IT MUST EQUAL OR EXCEED THE DESIGN PRESSURE REQUIREMENT FOR THE WINDOW OPENING OBTAINED IN STEP 1.
- 4) DETERMINE THE ANCHOR QUANTITY FROM TABLES 9-12. VERIFY THE ANCHOR/SUBSTRATE WILL MEET REQUIREMENTS FOR YOUR OPENING'S CONDITION FROM TABLES 2 OR 3, AND THAT ALL MIN. REQUIREMENTS FROM THIS SHEET-SET ARE MET.
- 5) INSTALL AS PER SHEET 3 FOR THRU-FRAME INSTALLATION OR SHEET 4 FOR INTEGRAL FIN INSTALLATION.

NOTE: DESIGN PRESSURE RATING DETERMINATION IS THE SAME PROCESS FOR ALL FRAME TYPES (J-CHANNEL, FLANGE, INTEGRAL FIN OR EQUAL LEG/BOX).


CODES / STANDARDS USED:

- 2023 FLORIDA BUILDING CODE (FBC), 8TH EDITION
- ASTM E1300-09
- ANSI/AF&PA NDS-2018 FOR WOOD CONSTRUCTION
- ALUMINUM DESIGN MANUAL, ADM-2020
- AISI S100-16
- AISC 360-16

GENERAL NOTES.....	1
ELEVATIONS.....	1
FRAME, GLASS & ANCHOR OPTIONS.....	2
INSTALLATION, FLANGE & EQUAL LEG/BOX.....	3
INSTALLATION, INTEGRAL FIN & J-CHANNEL.....	4
GLAZING DETAILS.....	5
DESIGN PRESSURES.....	6-7
ANCHOR QUANTITIES.....	8-11
EXTRUSION PROFILES.....	12
ASSEMBLY & PARTS LIST.....	13-14

**PRODUCT REVISED**  
As complying with the Florida  
Building Code  
NOA-No. **25-0520.01**  
Expiration Date: **07/30/2030**  
By: *Manuel Perez*  
**Miami-Dade Product Control**

<b>PGT</b> Custom Windows and Doors		PREPARED BY A. LYNN MILLER 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 (941) 480-1600	
3400 PRECISION DRIVE N. VENICE, FL 34275 (941) 480-1600		REGISTRATION #29296	
Series	Rev	Title	Date
		VINYL SINGLE HUNG WINDOW (LM)	05/15/15
		GENERAL NOTES & ELEVATION	05/12/25
		ERASE 2020 FBC REFERENCE, UPDATE COMPANY ADDRESS - AM	05/12/25
SH5500	1 OF 14	SH5500-NOA	E

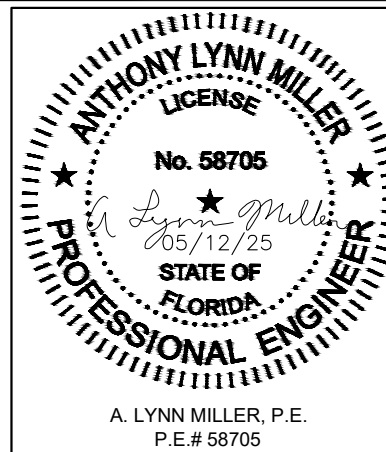

Glass Type	Description (Listed from Exterior to Interior)	Design Pressure	
		Table #	Sheet #
5	7/8" Laminated I.G.: 1/8" A Exterior Cap + 7/16" Air Space + 5/16" Laminated; (2) Lites of 1/8" A Glass with .090" PVB Interlayer	4, 5	6
6	7/8" Laminated I.G.: 1/8" T Exterior Cap + 7/16" Air Space + 5/16" Laminated; (2) Lites of 1/8" A Glass with .090" PVB Interlayer	4, 6	6
7	7/8" Laminated I.G.: 3/16" A Exterior Cap + 3/8" Air Space + 5/16" Laminated; (2) Lites of 1/8" A Glass with .090" PVB Interlayer	4, 6	6
8	7/8" Laminated I.G.: 3/16" T Exterior Cap + 3/8" Air Space + 5/16" Laminated; (2) Lites of 1/8" A Glass with .090" PVB Interlayer	4, 6	6
9	7/8" Laminated I.G.: 1/8" A Exterior Cap + 7/16" Air Space + 5/16" Laminated; (2) Lites of 1/8" H Glass with .090" SG Interlayer	7	7
10	7/8" Laminated I.G.: 1/8" T Exterior Cap + 7/16" Air Space + 5/16" Laminated; (2) Lites of 1/8" H Glass with .090" SG Interlayer	7	7
11	7/8" Laminated I.G.: 3/16" A Exterior Cap + 3/8" Air Space + 5/16" Laminated; (2) Lites of 1/8" H Glass with .090" SG Interlayer	7	7
12	7/8" Laminated I.G.: 3/16" T Exterior Cap + 3/8" Air Space + 5/16" Laminated; (2) Lites of 1/8" H Glass with .090" SG Interlayer	7	7
13	7/8" Laminated I.G.: 1/8" A Exterior Cap + 5/16" Air Space + 7/16" Laminated; (2) Lites of 3/16" A Glass with .090" SG Interlayer	8	7
14	7/8" Laminated I.G.: 1/8" T Exterior Cap + 5/16" Air Space + 7/16" Laminated; (2) Lites of 3/16" A Glass with .090" SG Interlayer	8	7
15	7/8" Laminated I.G.: 3/16" A Exterior Cap + 1/4" Air Space + 7/16" Laminated; (2) Lites of 3/16" A Glass with .090" SG Interlayer	7	7
16	7/8" Laminated I.G.: 3/16" T Exterior Cap + 1/4" Air Space + 7/16" Laminated; (2) Lites of 3/16" A Glass with .090" SG Interlayer	7	7

Group	Anchor	Substrate	Min. Edge Distance	Min. Embedment*
A	#10 SMS (steel, 18-8 S.S. or 410 S.S.)	P.T. Southern Pine (SG=0.55)	7/16"	1-3/8"
		Steel, A36*	3/8"	0.050"
		Steel Stud, A653 Gr. 33*	3/8"	0.0451" (18 Ga.)
		Aluminum, 6063-T5*	3/8"	0.050"
	3/16" steel Ultracon+	P.T. Southern Pine (SG=0.55)	7/16"	1-3/8"
		Concrete (min. 3 ksi)	1"	1-3/8"
		Ungrouted CMU, (ASTM C-90)	1"	1-1/4"
B	#12 SMS (steel, 18-8 S.S. or 410 S.S.)	P.T. Southern Pine (SG=0.55)	9/16"	1-3/8"
		Steel, A36*	3/8"	0.050"
		Steel Stud, A653 Gr. 33*	3/8"	0.0451" (18 Ga.)
		Aluminum, 6063-T5*	3/8"	0.063"
	1/4" steel Ultracon+	P.T. Southern Pine (SG=0.55)	1"	1-3/8"
	1/4" steel Creteflex	P.T. Southern Pine (SG=0.55)	1"	1-3/8"
	1/4" steel Aggre-Gator	P.T. Southern Pine (SG=0.55)	1"	1-3/8"
C	1/4" steel Ultracon+	Concrete (min. 3 ksi)	1-3/16"	1-3/4"
		Ungrouted CMU, (ASTM C-90)	1"	1-1/4"
	1/4" steel Creteflex	Concrete (min. 3.35 ksi)	1"	1-3/4"
D	1/4" steel Ultracon+	Concrete (min. 3 ksi)	2-1/2"	1-3/4"
		Ungrouted CMU, (ASTM C-90)	2-1/2"	1-1/4"
	1/4" steel Creteflex	Concrete (min. 3.35 ksi)	2-1/2"	1-3/4"
		Ungrouted CMU, (ASTM C-90)	2-1/2"	1-1/4"
	1/4" steel Aggre-Gator	Concrete (min. 3.275 ksi)	1-1/2"	1-3/8"
		Grouted CMU, (ASTM C-90)	2"	2"

**! GLASS TYPES 5, 7, 9, 11, 13 & 15 MAY NOT BE USED IN THE HVHZ ABOVE 30'.**





Group	Anchor	Substrate	Min. Edge Distance	Min. Embedment*
E	2-1/2" x .131" Common Nail	P.T. Southern Pine (SG=.55)	3/8"	2-7/16"
F	2-1/2" Ring-shank Roofing Nail	P.T. Southern Pine (SG=.55)	3/8"	2-7/16"
	#10 Trusshead SMS (steel, 18-8 S.S. or 410 S.S.)	P.T. Southern Pine (SG=.55)	1/2"	1-3/8"
		Aluminum, 6063-T5*	3/8"	0.050"
		Steel Stud, Gr. 33*	3/8"	0.0451" (18 Ga.)
		Steel, A36*	3/8"	0.050"
	#12 SMS (steel, 18-8 S.S. or 410 S.S.)	P.T. Southern Pine (SG=.55)	9/16"	1-3/8"
		Aluminum, 6063-T5*	3/8"	0.063"
		Steel Stud, Gr. 33*	3/8"	0.050"
Steel, A36*		3/8"	0.050"	

Diagram illustrating three types of window frames: Rectangular, Radius-Top, and Arch-Top. Each frame is shown within a 'BUCK' (a rectangular frame). The Rectangular frame is a simple rectangle. The Radius-Top frame has a curved top section. The Arch-Top frame has a full arch top section. Dimensions are labeled: 'BUCK WIDTH' and 'BUCK HEIGHT' for the outer frame, and 'LEG HEIGHT' for the vertical section of the Radius-Top and Arch-Top frames.

Frame Types (see Fig B)	Glass Options (see Table 1)	Frame Configs. (see Fig A)	Frame Shapes (see Fig C)	Installation Options that may be used	
Flange (#2)	5 - 16	Equal-Lite, Oriel/Proview & Cottage	Square/Rect., Arch-Top & Radius-Top	Through the frame of the window.....	....into 2X Wood Frame/Buckstrip - sheet 3, option 1
					....into Concrete/CMU - sheet 3, option 2
					....through 1X Buckstrip into Concrete/CMU - sheet 3, option 3
					....into Metal - sheet 3, option 4
Box / Equal-Leg (#4)	5 - 16	Equal-Lite, Oriel/Proview & Cottage	Square/Rect., Arch-Top & Radius-Top	Through the frame of the window.....	....into 2X Wood Frame/Buckstrip - sheet 3, option 1
					....into Concrete/CMU - sheet 3, option 2
					....through 1X Buckstrip into Concrete/CMU - sheet 3, option 3
					....into Metal - sheet 3, option 4
J-Channel (#1)	5 - 8	Equal-Lite, Oriel/Proview & Cottage	Square/Rect., Arch-Top & Radius-Top	Through the integral fin.....	....into 2X Wood Frame/Buckstrip - sheet 4, option 5
					....into Metal - sheet 4, option 7
				Through the frame of the window.....	....into 2X Wood Frame/Buckstrip - sheet 4, option 6
					....into Metal - sheet 4, option 8
Integral Fin (#3)	5 - 8	Equal-Lite, Oriel/Proview & Cottage	Square/Rect., Arch-Top & Radius-Top	Through the integral fin.....	....into 2X Wood Frame/Buckstrip - sheet 4, option 5
					....into Metal - sheet 4, option 7
				Through the frame of the window.....	....into 2X Wood Frame/Buckstrip - sheet 4, option 6
					....into Metal - sheet 4, option 8


The diagrams show three window styles:


- EQUAL-LITE:** A rectangular window divided into two equal horizontal panes. Each pane contains two parallel diagonal lines sloping from the top-left to the bottom-right.
- ORIEL:** A rectangular window with a single large upper pane and a smaller rectangular pane at the bottom. Both panes contain two parallel diagonal lines sloping from the top-left to the bottom-right.
- COTTAGE:** A rectangular window with a smaller rectangular pane at the top and a larger single pane below it. Both panes contain two parallel diagonal lines sloping from the top-left to the bottom-right.

<p>1</p>  <p>J-CHANNEL</p>	<p>3</p>  <p>INTEGRAL FIN</p>
<p>2</p>  <p>FLANGE</p>	<p>4</p>  <p>BOX OR EQUAL-LEG</p>


Material	Min. F <sub>y</sub>	Min. F <sub>u</sub>
Steel Screw	92 ksi	120 ksi
18-8 Screw	60 ksi	95 ksi
410 Screw	90 ksi	110 ksi
Elco/DeWalt Aggre-Gator®	57 ksi	96 ksi
3/16" DeWalt UltraCon+®	117 ksi	164 ksi
1/4" DeWalt UltraCon+®	148 ksi	164 ksi
410 SS Elco/Dewalt CreteFlex®	127.4 ksi	189.7 ksi
6063-T5 Aluminum	16 ksi	22 ksi
A36 Steel	36 ksi	58 ksi
Gr. 33 Steel Stud	33 ksi	45 ksi

**PRODUCT REVISED**  
As complying with the Florida  
Building Code  
NOA-No. 25-0520.01  
Expiration Date: 07/30/2030  
By: Manuel Perez  
Miami-Dade Product Control

 <b>Custom Windows and Doors</b>		PREPARED BY A. LYNN MILLER 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275					
		(941) 480-1600					
3400 PRECISION DRIVE N. VENICE, FL 34275 (941) 480-1600		REGISTRATION #29296					
Title	VINYL SINGLE HUNG WINDOW (LM)				Date	05/15/15	
Desc.	GLASS/ANCHOR/FRAME OPTIONS		Drawn By	JENS ROSOWSKI			
Rev	NO CHANGES THIS SHEET - AM				Rev Date	05/12/25	
Series	SH5500	Sheet	2 OF 14	DWG No.	SH5500-NOA	Rev.	E




A. LYNN MILLER, P.E.  
 P.E.# 58705

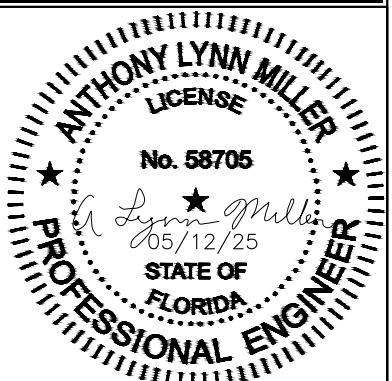

INSTALLATION DETAILS FOR FLANGE & EQUAL-LEG/BOX FRAMES

INSTALLATION  
OPTION 1


ANCHORED THROUGH  
FRAME INTO 2X WOOD  
FRAME OR BUCKSTRIP.  
SEE NOTE 2, THIS SHEET.

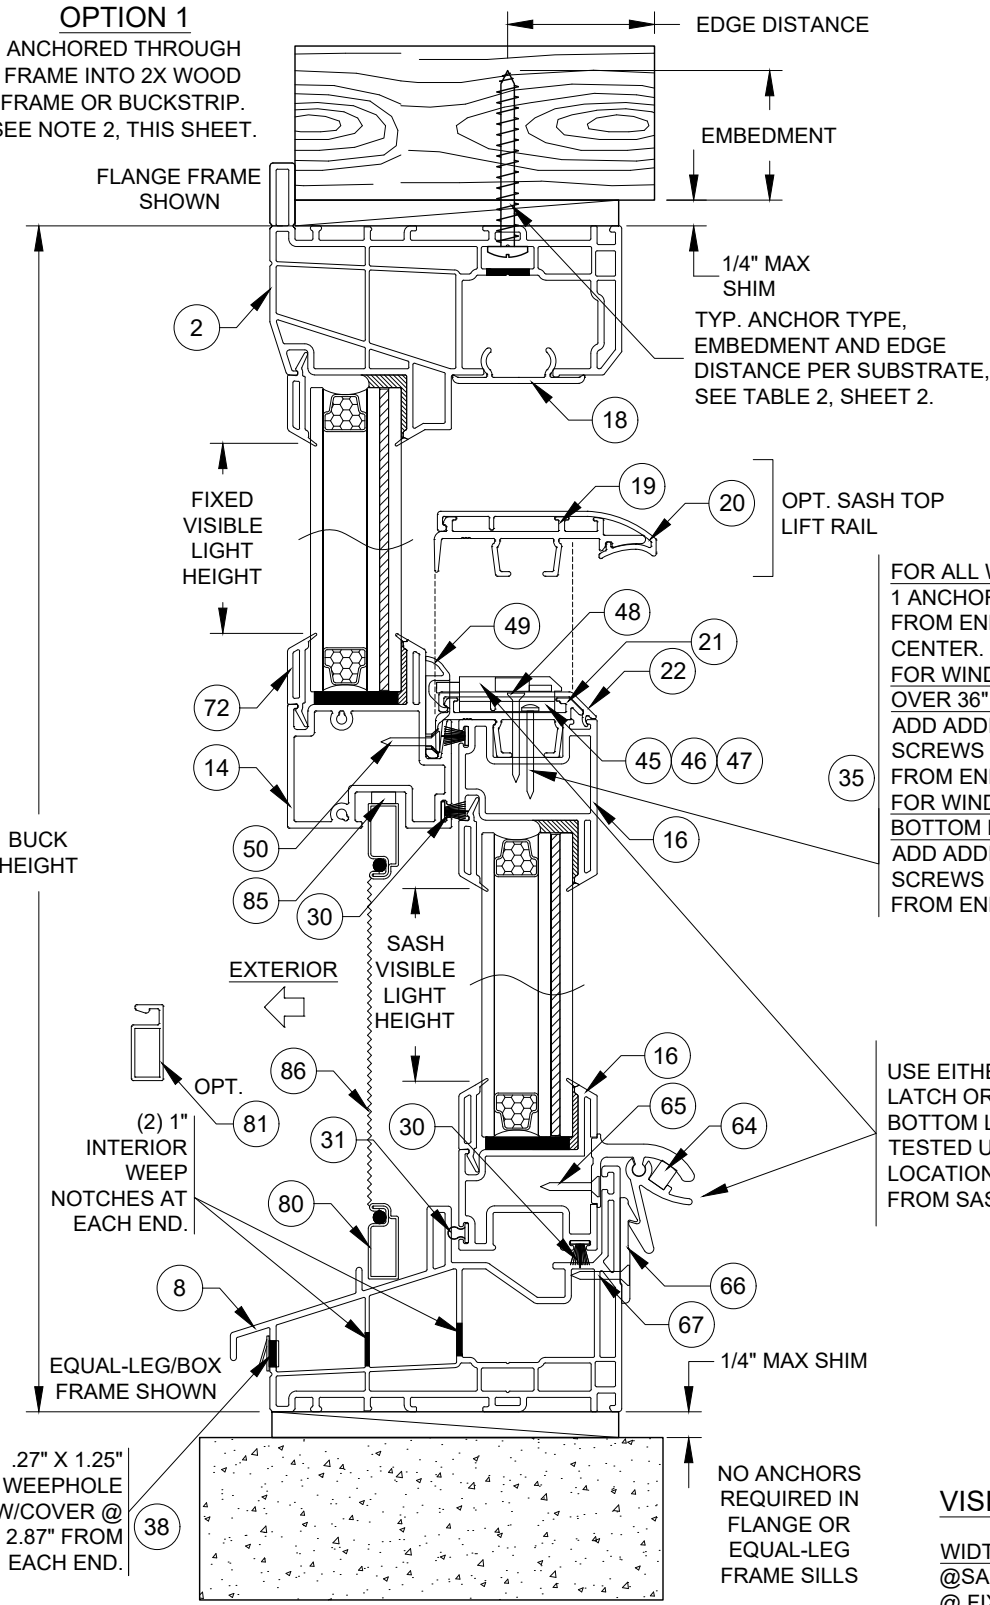

VERTICAL SECTION B-B


INSTALLATION OPTION 2

ANCHORED THROUGH FRAME  
DIRECTLY INTO CONCRETE/CMU.

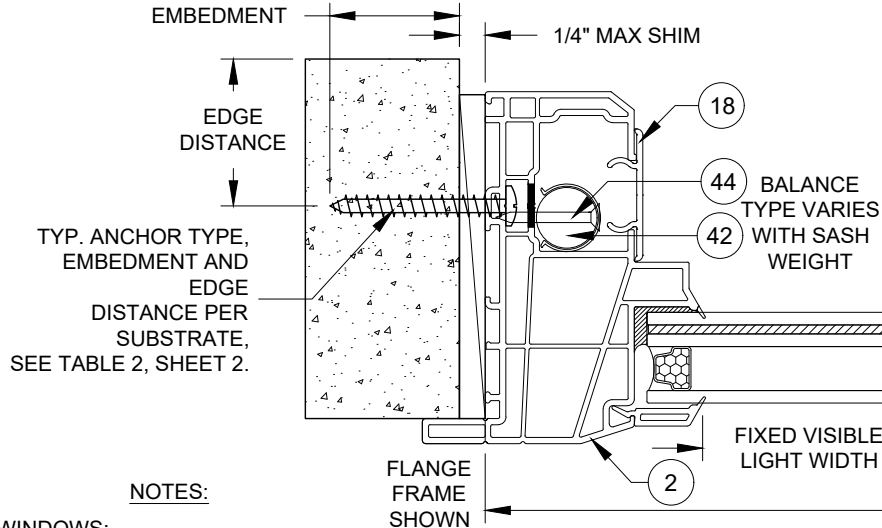


INSTALLATION OPTION 3

ANCHORED THROUGH FRAME AND 1X  
BUCKSTRIP INTO CONCRETE/CMU.  
SEE NOTE 2, THIS SHEET.

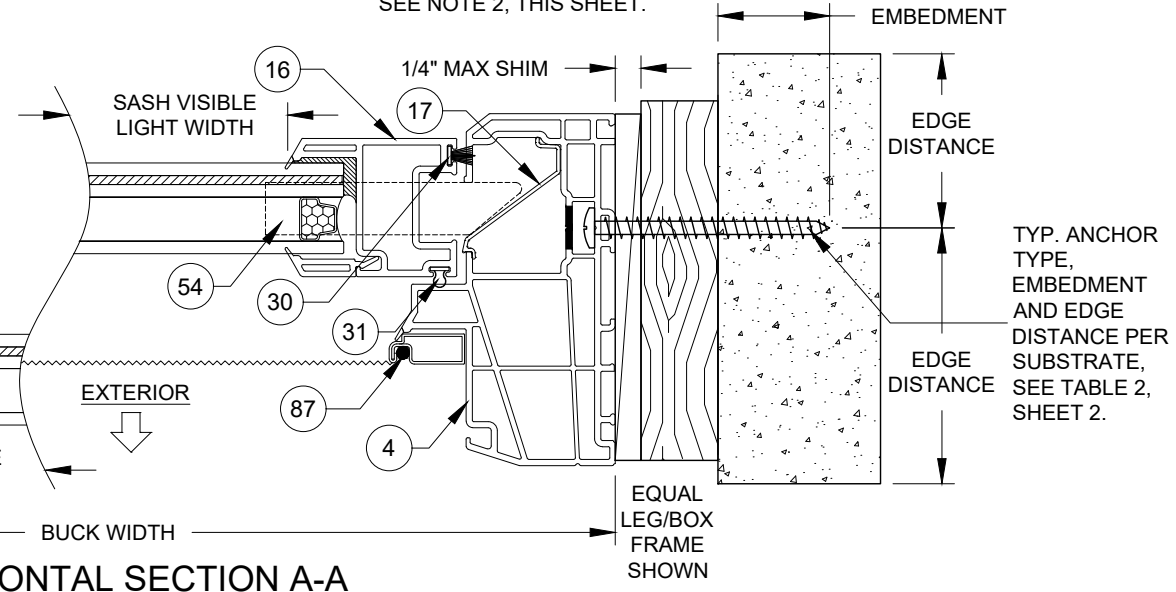

HORIZONTAL SECTION A-A

DADE APPROVED MULLION, FBC COMPLIANT ALUMINUM/STEEL FRAMING OR STEEL STUD.  
MAY BE VERTICAL OR HORIZONTAL. SEE SUBSTRATE PROPERTIES, TABLE 2, SHEET 2.

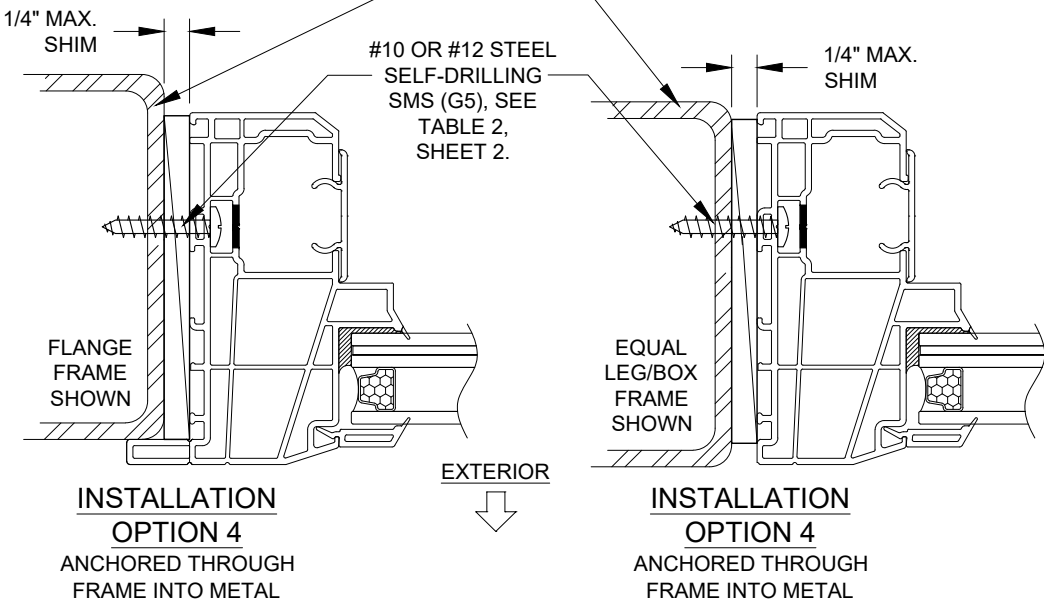

NOTES:

- 1) USE ONLY SUBSTRATE-APPROPRIATE ANCHORS LISTED ON TABLE 2, SHEET 2. FOLLOW EMBEDMENT AND EDGE DISTANCE LIMITS. ANY INSTALLATION OPTION SHOWN MAY BE USED ON ANY SIDE OF THE WINDOW.
- 2) MASONRY ANCHORS MAY BE USED INTO WOOD AS PER TABLE 2, SHEET 2. ALL WOOD BUCKS LESS THAN 1-1/2" THICK ARE TO BE CONSIDERED 1X INSTALLATIONS. 1X WOOD BUCKS ARE OPTIONAL IF UNIT IS INSTALLED DIRECTLY TO SUBSTRATE. WOOD BUCKS DEPICTED AS 2X ARE 1-1/2" THICK OR GREATER. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED TO PROPERLY TRANSFER LOADS TO THE STRUCTURE. WOOD BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD.
- 3) VISIBLE LIGHT WIDTH OR HEIGHT (ALSO REFERRED TO AS DAYLIGHT OPENING) IS MEASURED FROM BEADING TO BEADING.
- 4) ALL ANCHOR HEAD TYPES ARE ACCEPTABLE.

VISIBLE LIGHT FORMULAS

WIDTH  
@SASH: BUCK WIDTH - 6-1/2"  
@ FIXED LITE: BUCK WIDTH - 4-3/8"

HEIGHT (EQUAL-LITE)  
BUCK HEIGHT/2 - 3-15/16"



3400 PRECISION DRIVE  
N. VENICE, FL 34275  
(941) 480-1600


PREPARED BY A. LYNN MILLER  
1070 TECHNOLOGY DRIVE  
N. VENICE, FL 34275

(941) 480-1600

REGISTRATION #29296

Series	Rev	Desc	Title	Date
			VINYL SINGLE HUNG WINDOW (LM)	05/15/15
			FLANGE & EQUAL-LEG FRAMES	05/12/25
			NO CHANGES THIS SHEET - AM	05/12/25
SH5500	3 OF 14	DWG No.	SH5500-NOA	Rev. E


**PRODUCT REVISED**  
As complying with the Florida  
Building Code  
NOA-No. **25-0520.01**  
Expiration Date: **07/30/2030**  
By: *Manuel Perez*  
Miami-Dade Product Control

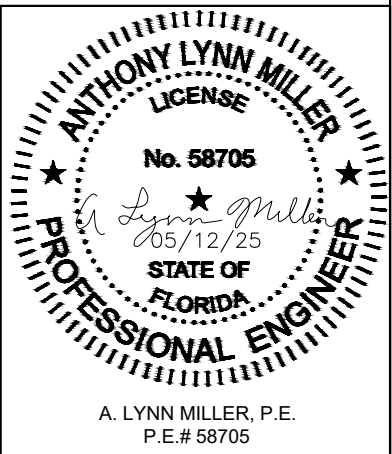

INSTALLATION DETAILS FOR INTEGRAL FIN & J-CHANNEL FRAMES

INSTALLATION OPTION 5

ANCHORED THROUGH INTEGRAL FIN INTO 2X WOOD FRAME OR BUCK-STRIP. SEE NOTE 2, THIS SHEET.

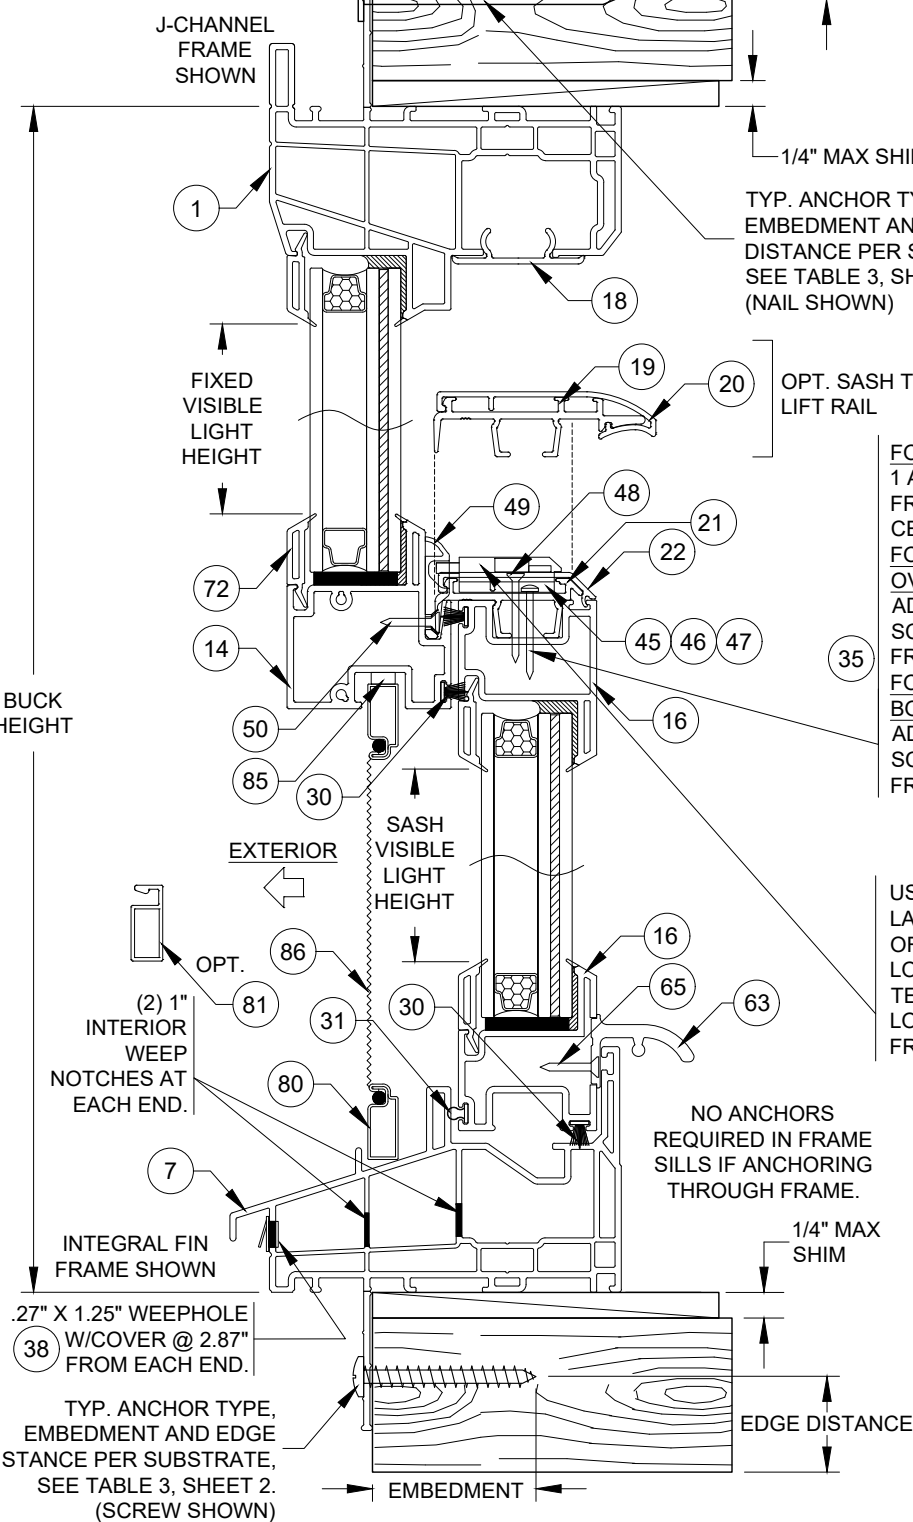

INSTALLATION OPTION 5  
ANCHORED THROUGH INTEGRAL FIN INTO 2X WOOD FRAME OR BUCK-STRIP. SEE NOTE 2, THIS SHEET.


VERTICAL SECTION D-D

VISIBLE LIGHT FORMULAS

WIDTH  
@SASH: BUCK WIDTH - 6-1/2"  
@ FIXED LITE: BUCK WIDTH - 4-3/8"

HEIGHT (EQUAL-LITE)  
BUCK HEIGHT/2 - 3-15/16"


INSTALLATION OPTION 6  
ANCHORED THROUGH FRAME INTO 2X WOOD FRAME OR BUCKSTRIP. SEE NOTE 2, THIS SHEET.

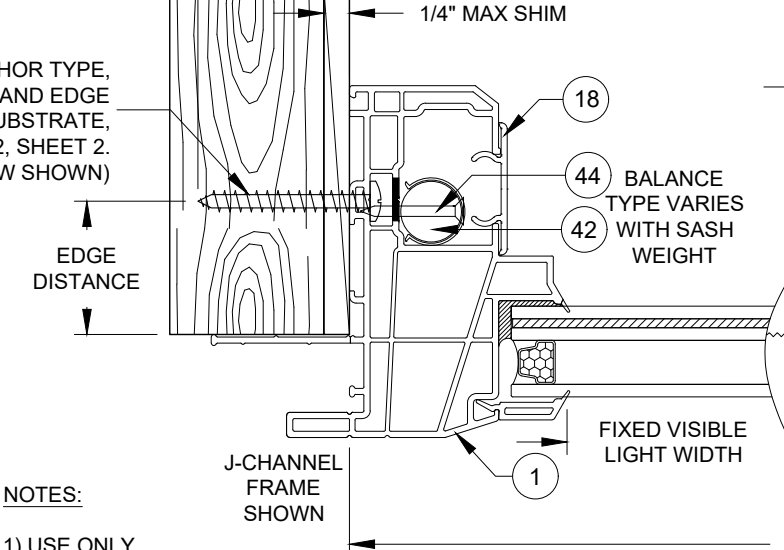


NOTES:

- 1) USE ONLY SUBSTRATE-APPROPRIATE ANCHORS LISTED ON TABLES 2 & 3 OF SHEET 2. FOLLOW EMBEDMENT AND EDGE DISTANCE LIMITS. ANY INSTALLATION OPTION SHOWN MAY BE USED ON ANY SIDE OF THE WINDOW.
- 2) MASONRY ANCHORS MAY BE USED INTO WOOD AS PER TABLE 2, SHEET 2. ALL WOOD BUCKS LESS THAN 1-1/2" THICK ARE TO BE CONSIDERED 1X INSTALLATIONS. 1X WOOD BUCKS ARE OPTIONAL IF UNIT IS INSTALLED DIRECTLY TO SUBSTRATE. WOOD BUCKS DEPICTED AS 2X ARE 1-1/2" THICK OR GREATER. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED TO PROPERLY TRANSFER LOADS TO THE STRUCTURE. WOOD BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD.
- 3) VISIBLE LIGHT WIDTH OR HEIGHT (ALSO REFERRED TO AS DAYLIGHT OPENING) IS MEASURED FROM BEADING TO BEADING.
- 4) ALL ANCHOR HEAD TYPES ARE ACCEPTABLE.

INSTALLATION OPTION 5  
ANCHORED THROUGH INTEGRAL FIN INTO 2X WOOD FRAME OR BUCKSTRIP. SEE NOTE 2, THIS SHEET.

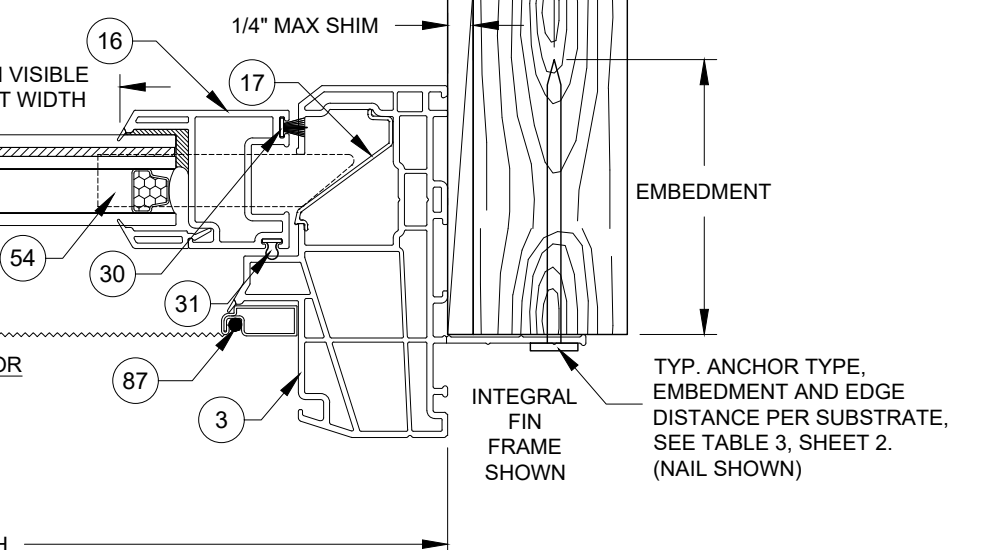

HORIZONTAL SECTION C-C

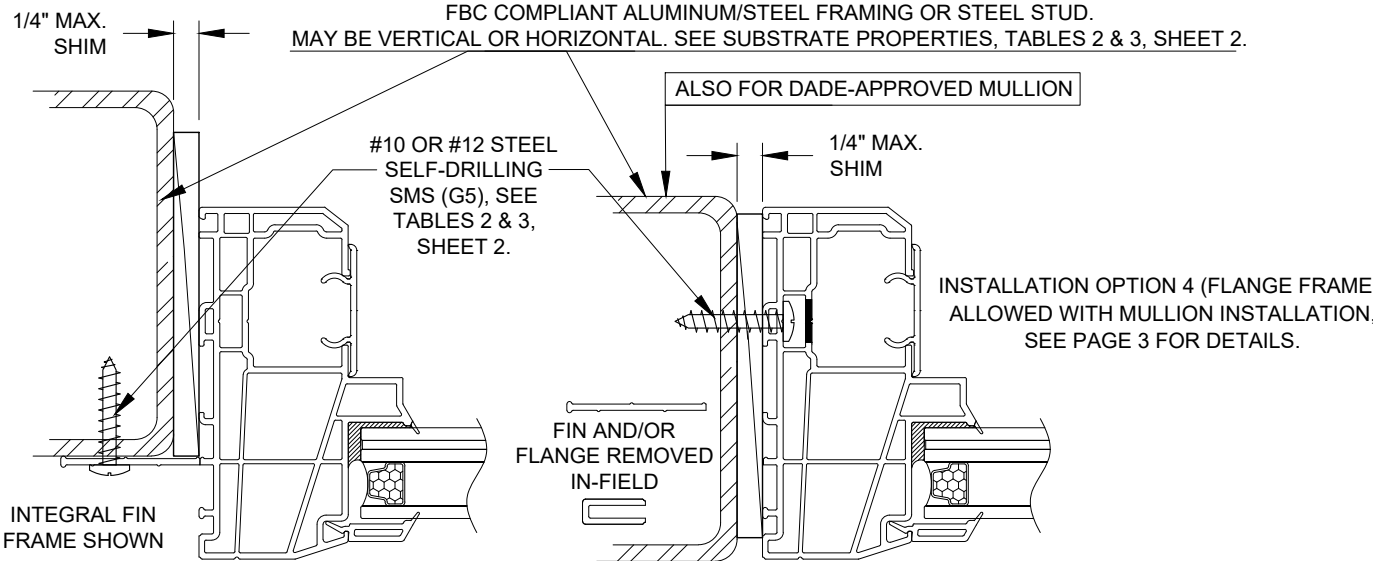



INSTALLATION  
OPTION 7  
ANCHORED THROUGH  
INTEGRAL FIN INTO METAL

INSTALLATION  
OPTION 8  
ANCHORED THROUGH FRAME INTO METAL  
(INTEGRAL FIN/FLANGE REMOVED)


**PRODUCT REVISED**  
As complying with the Florida Building Code  
NOA-No. **25-0520.01**  
Expiration Date: **07/30/2030**  
By: *Manuel Perez*  
Miami-Dade Product Control

<b>PGT</b> Custom Windows and Doors 3400 PRECISION DRIVE N. VENICE, FL 34275 (941) 480-1600		PREPARED BY A. LYNN MILLER 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 (941) 480-1600 REGISTRATION #29296	
Rev	Desc.	Date	
	VINYL SINGLE HUNG WINDOW (LM)	05/15/15	
	J-CHANNEL AND INT. FIN FRAMES	Drawn By JENS ROSOWSKI	
	NO CHANGES THIS SHEET - AM		Rev Date 05/12/25
Series	SH5500	Sheet 4 OF 14	DWG No. SH5500-NOA Rev E

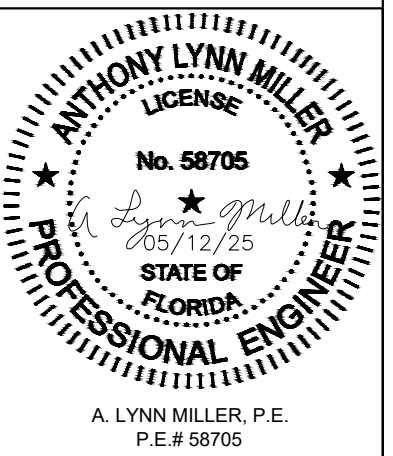


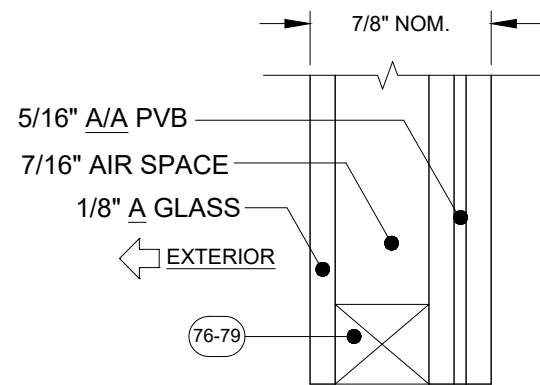


GLASS TYPE 5

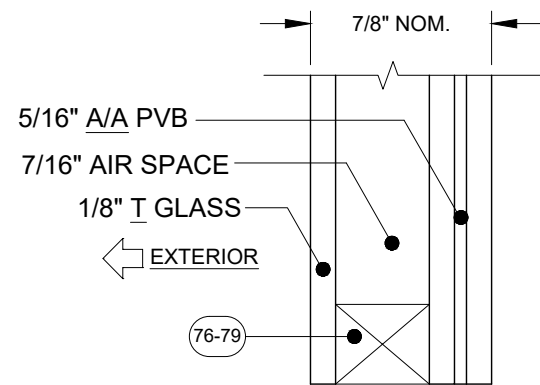


GLASS TYPE 6

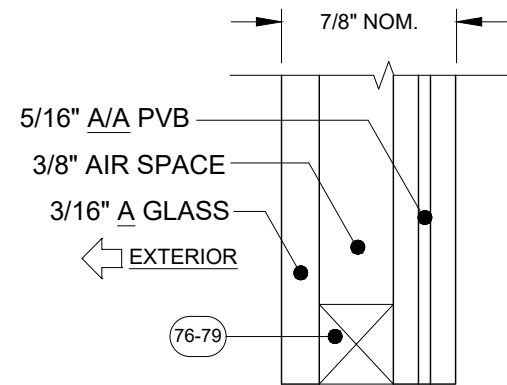


GLASS TYPE 7

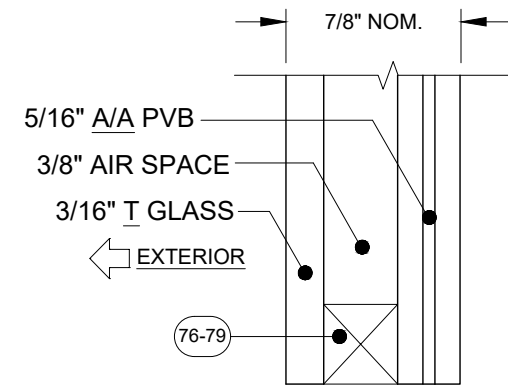


GLASS TYPE 8

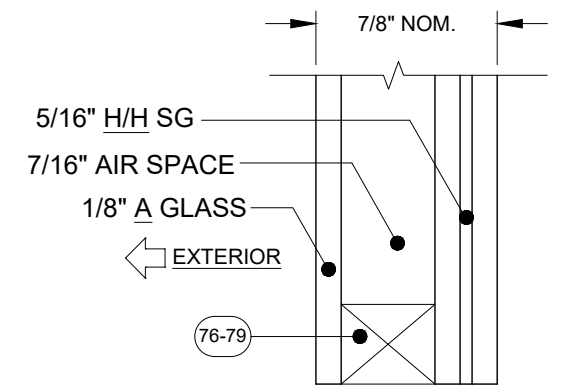


GLASS TYPE 9

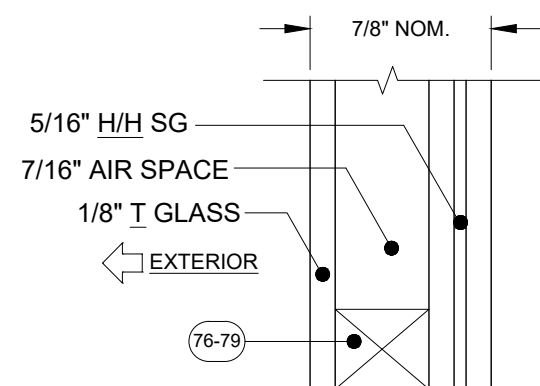


GLASS TYPE 10

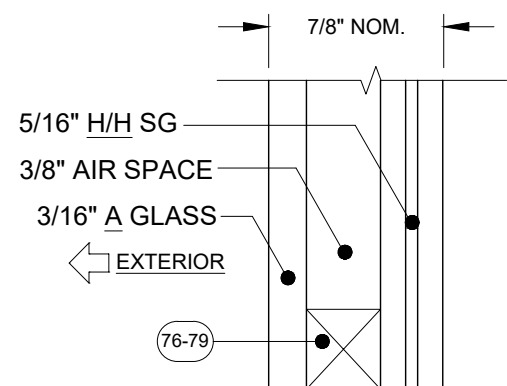


GLASS TYPE 11

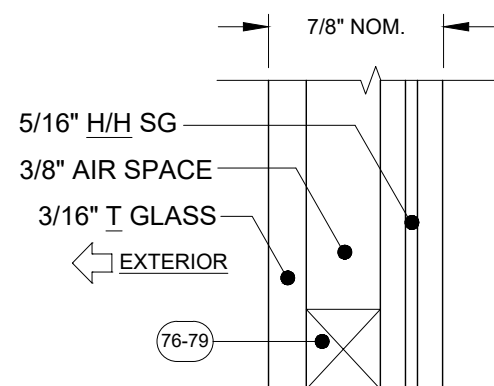


GLASS TYPE 12

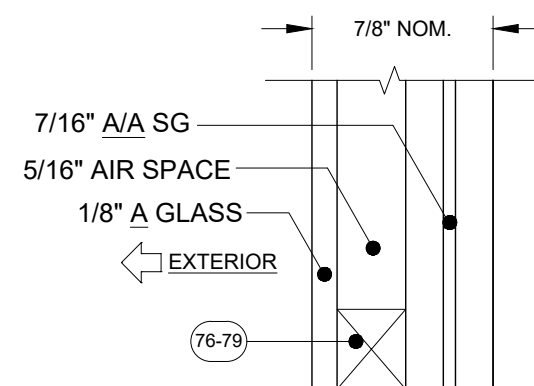


GLASS TYPE 13

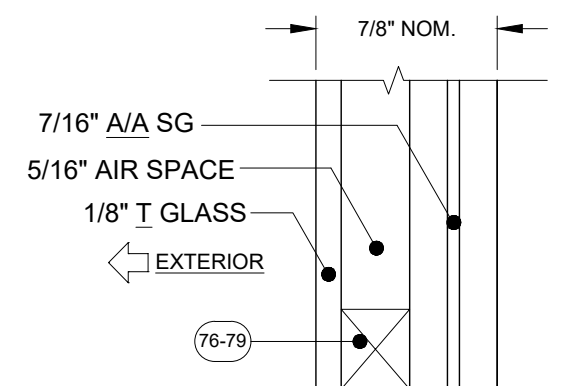


GLASS TYPE 14

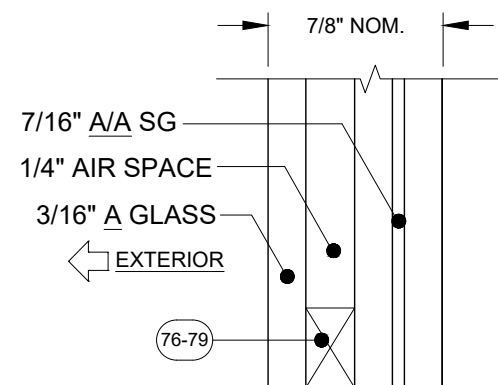

GLASS TYPE 15

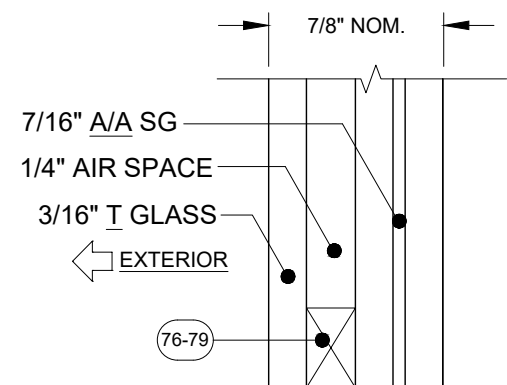

GLASS TYPE 16

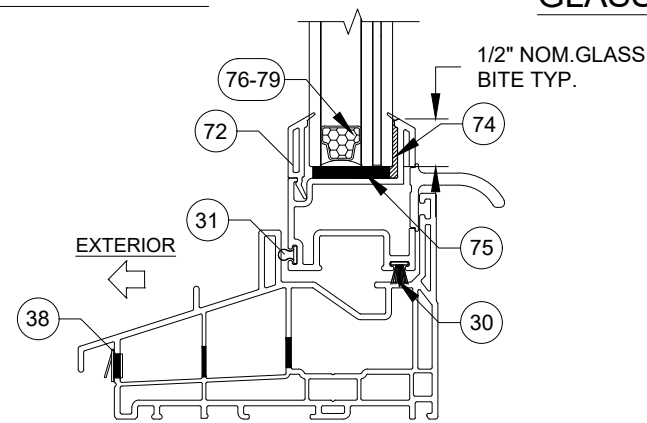

TYP. GLAZING DETAIL

GLAZING NOTES:  
 "A" = ANNEALED  
 "H" = HEAT STRENGTHENED  
 "T" = TEMPERED  
 "PVB" = .090" TROSIFOL® PVB BY KURARAY AMERICA, INC.  
 "SG" = .090" SENTRYGLAS® BY KURARAY AMERICA, INC.

FOR LAMINATED GLAZING COMPONENTS, SEE TABLE 1, SHEET 2.

GLASS TYPES 9 THROUGH 16 MAY NOT BE USED WITH J-CHANNEL OR INTEGRAL FIN FRAMES

GLASS TYPES 5, 7, 9, 11, 13 & 15 MAY NOT BE USED IN THE HVHZ ABOVE 30'.

**PRODUCT REVISED**  
 As complying with the Florida Building Code  
 NOA-No. **25-0520.01**  
 Expiration Date: **07/30/2030**  
 By: *Manuel Perez*  
 Miami-Dade Product Control

**PGT**  
 Custom Windows and Doors  
 3400 PRECISION DRIVE  
 N. VENICE, FL 34275  
 (941) 480-1600

PREPARED BY A. LYNN MILLER  
 1070 TECHNOLOGY DRIVE  
 N. VENICE, FL 34275

(941) 480-1600

REGISTRATION #29296

Series	VINYL SINGLE HUNG WINDOW (LM)					Date	05/15/15
	GLAZING DETAILS				Drawn By	JENS ROSOWSKI	
	NO CHANGES THIS SHEET - AM					Rev Date	05/12/25
	SH5500	Sheet	5 OF 14	DWG No.	SH5500-NOA		Rev.


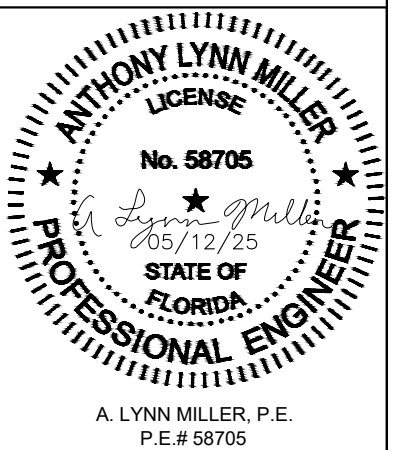


TABLE 4:

Glass Types 5, 6, 7 & 8	Design Pressure, lbs/ft <sup>2</sup>
	+/- 50.0
Reinf. Level R1	For all window & sash sizes

SEE TABLE 9, SHEET 8 FOR  
ANCHOR GROUP AND QUANTITY.

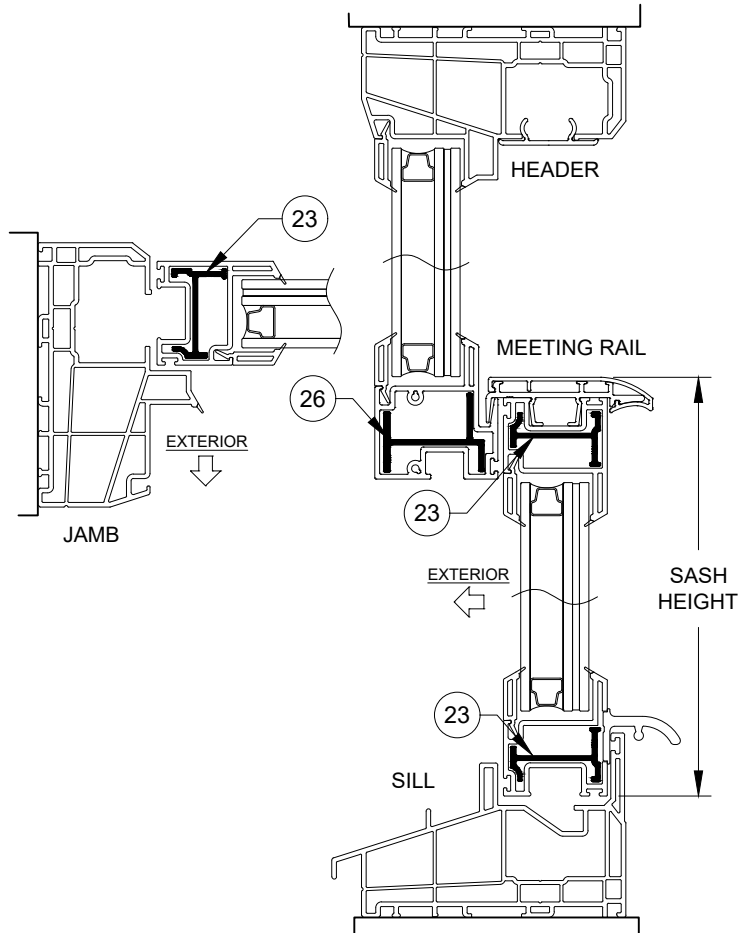

SECTION DETAIL FOR WINDOWS WITH  
LEVEL R1 REINFORCEMENT & GLASS TYPES 5, 6, 7 & 8  
(REINFORCEMENTS SHOWN IN FIGURES ABOVE  
APPLY TO ALL FRAME TYPES &  
CONFIGURATIONS)

TABLE 5:


Glass Type 5	Bottom Sash Description for given Range @ Window Height Shown	Sash Height Range (in)	Design Pressure, lbs/ft <sup>2</sup>			
			Window Buck Width (in)			
			up to 48		52.125	
Reinf. Level R2						
23.5	Equal-lite	11.394	+65.0	-70.0	+65.0	-70.0
28	Standard Cottage	14.517 - 15.870	+65.0	-70.0	+65.0	-70.0
	Equal-lite	11.583 - 14.516	+65.0	-70.0	+65.0	-70.0
	Standard Proview	11.377 - 11.582	+65.0	-70.0	+65.0	-70.0
37.375	Tallest	23.517 - 25.286	+65.0	-70.0	+65.0	-70.0
	Standard Cottage	20.958 - 23.516	+65.0	-70.0	+65.0	-70.0
	Equal-lite	17.517 - 20.957	+65.0	-70.0	+65.0	-70.0
	Standard Proview	14.517 - 17.516	+65.0	-70.0	+65.0	-70.0
	Shortest	11.377 - 14.516	+65.0	-70.0	+65.0	-70.0
44	Tallest	27.583 - 31.911	+65.0	-70.0	+65.0	-70.0
	Custom Size	26.517 - 27.582	+65.0	-70.0	+65.0	-70.0
	Standard Cottage	23.517 - 26.516	+65.0	-70.0	+65.0	-70.0
	Equal-lite	20.517 - 23.516	+65.0	-70.0	+65.0	-70.0
	Standard Proview	17.517 - 20.516	+65.0	-70.0	+65.0	-70.0
	Custom Size	14.517 - 17.516	+65.0	-70.0	+65.0	-70.0
	Shortest	11.377 - 14.516	+65.0	-70.0	+65.0	-70.0
48	Tallest	31.583 - 35.911	+65.0	-70.0	+65.0	-70.0
	Standard Cottage	26.517 - 31.582	+65.0	-70.0	+65.0	-70.0
	Equal-lite	20.517 - 26.516	+65.0	-70.0	+65.0	-70.0
	Standard Proview	17.517 - 20.516	+65.0	-70.0	+65.0	-70.0
	Custom Size	14.517 - 17.516	+65.0	-70.0	+65.0	-70.0
	Custom Size	12.517 - 14.516	+65.0	-70.0	+65.0	-70.0
	Shortest	11.377 - 12.516	+65.0	-70.0	+65.0	-70.0
49.625	Tallest	33.208 - 37.536	+65.0	-70.0	+65.0	-70.0
	Standard Cottage	26.517 - 33.207	+65.0	-70.0	+65.0	-70.0
	Equal-lite	23.517 - 26.516	+65.0	-70.0	+65.0	-70.0
	Custom Size	20.517 - 23.516	+65.0	-70.0	+65.0	-70.0
	Standard Proview	17.517 - 20.516	+65.0	-70.0	+65.0	-70.0
	Custom Size	14.517 - 17.516	+65.0	-70.0	+65.0	-70.0
	Custom Size	12.517 - 14.516	+65.0	-70.0	+65.0	-70.0
62	Shortest	11.377 - 12.516	+65.0	-70.0	+65.0	-70.0
	Tallest	36.517 - 41.644	+65.0	-70.0	+65.0	-70.0
	Standard Cottage	31.517 - 36.516	+65.0	-70.0	+65.0	-70.0
	Equal-lite	26.517 - 31.516	+65.0	-70.0	+65.0	-70.0
	Standard Proview	23.517 - 26.516	+65.0	-70.0	+65.0	-70.0
	Custom Size	20.517 - 23.516	+65.0	-70.0	+65.0	-70.0
	Custom Size	17.517 - 20.516	+65.0	-70.0	+65.0	-70.0
75	Custom Size	14.517 - 17.516	+65.0	-70.0	+65.0	-68.1
	Custom Size	13.017 - 14.516	+65.0	-70.0	+65.0	-67.3
	Shortest	11.864 - 13.016	+65.0	-70.0	+65.0	-66.5
	Tallest	39.517 - 41.644	+65.0	-70.0	+65.0	-70.0
	Custom Size	38.517 - 39.516	+65.0	-70.0	+65.0	-70.0
	Equal-lite	35.517 - 38.516	+65.0	-70.0	+65.0	-70.0
	Custom Size	32.517 - 35.516	+65.0	-70.0	+65.0	-70.0
84	Standard Proview	29.517 - 32.516	+65.0	-70.0	+65.0	-70.0
	Custom Size	26.517 - 29.516	+65.0	-70.0	+65.0	-67.3
	Shortest	24.864 - 26.516	+65.0	-70.0	+65.0	-66.5
	Equal-lite	38.517 - 41.644	+65.0	-70.0	+65.0	-70.0
91.78	Custom Size	35.517 - 38.516	+65.0	-70.0	+65.0	-67.3
	Standard Proview	33.864 - 35.516	+65.0	-70.0	+65.0	-66.5
	Tallest	** - 41.644	+65.0	-70.0	+65.0	-66.5

SEE TABLE 10, SHEET 9  
FOR ANCHOR GROUP  
AND QUANTITY.  
\*\* MIN. SASH HEIGHT =  
WINDOW BUCK HEIGHT -  
50.136  
(APPLIES TO ANY  
HEIGHT 91.78" OR LESS)

TABLE 6:

Glass Types 6, 7 & 8	Design Pressure, lbs/ft <sup>2</sup>
	+65.0 / -70.0
Reinf. Level R2	For all window and sash sizes

SEE TABLE 10, SHEET 9 FOR  
ANCHOR GROUP AND QUANTITY.

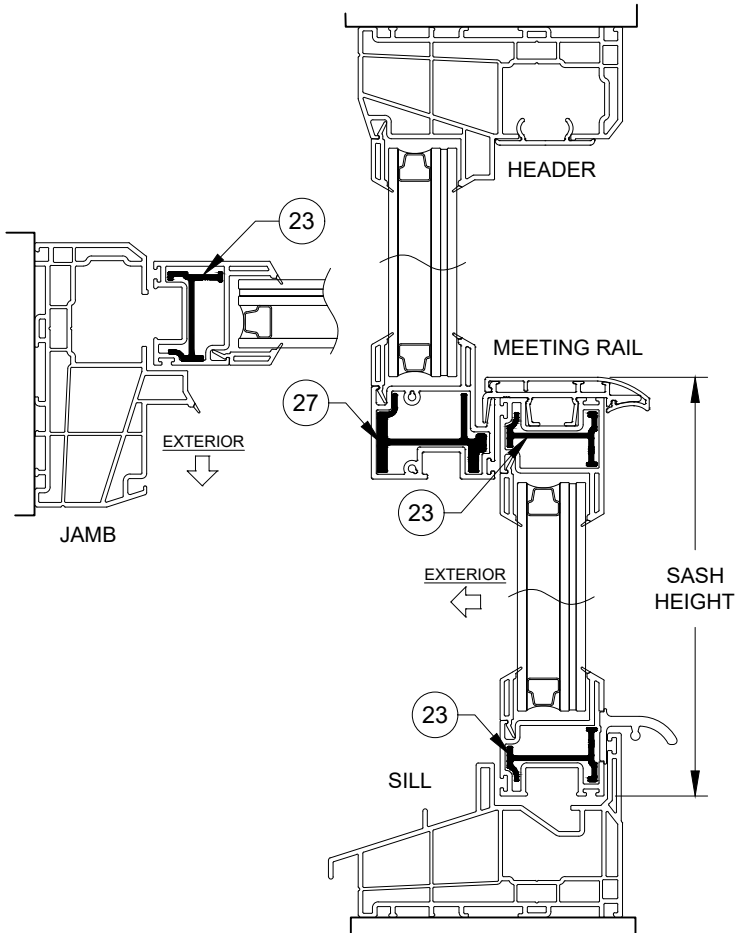

SECTION DETAIL FOR WINDOWS WITH  
LEVEL R2 REINFORCEMENT & GLASS TYPES 5, 6, 7 & 8  
(REINFORCEMENTS SHOWN IN FIGURES ABOVE  
APPLY TO ALL FRAME TYPES &  
CONFIGURATIONS)

## NOTES:

- 1) USE THESE TABLES FOR ALL WINDOWS INSTALLED THROUGH THE FRAME OR INTEGRAL FIN.
- 2) FRAME DIMENSIONS ARE BUCK. SASH HEIGHT IS AS PER THE FIGURE.
- 3) FOR SIZES NOT SHOWN, ROUND UP TO THE NEXT AVAILABLE WIDTH OR HEIGHT DIMENSION SHOWN ON THE TABLE.

**PRODUCT REVISED**  
As complying with the Florida  
Building Code  
NOA-No. **25-0520.01**  
Expiration Date: **07/30/2030**  
By: *Manuel Perez*  
Miami-Dade Product Control

**PGT**  
Custom Windows and Doors


3400 PRECISION DRIVE  
N. VENICE, FL 34275  
(941) 480-1600

PREPARED BY A. LYNN MILLER  
1070 TECHNOLOGY DRIVE  
N. VENICE, FL 34275

(941) 480-1600

REGISTRATION #29296

Title	VINYL SINGLE HUNG WINDOW (LM)					Date	05/15/15		
Desc.	DESIGN PRESSURE TABLE				Drawn By	JENS ROSOWSKI			
Rev	NO CHANGES THIS SHEET - AM					Rev Date	05/12/25		
Series	SH5500	Sheet	6 OF 14	DWG No.	SH5500-NOA			Rev.	E

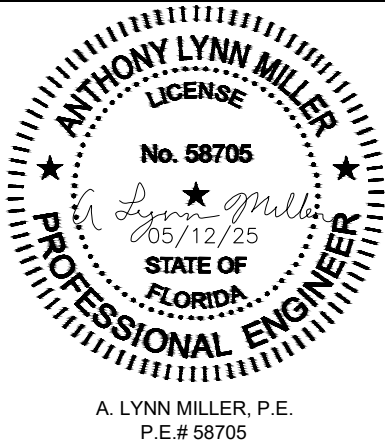

A. LYNN MILLER, P.E.  
P.E.# 58705

TABLE 7:


Glass Type 9-12, 15 & 16 Reinf. Level 3	Bottom Sash Description for given Range @ Window Height Shown	Sash Height Range (in)	Design Pressure, lbs/ft <sup>2</sup>							
			Window Buck Width (in)							
			up to 40	48	52.125	54				
23.5	Equal-lite	11.394	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0
28	Standard Cottage	14.517 - 15.870	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0
	Equal-lite	11.583 - 14.516	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0
	Standard Proview	11.377 - 11.582	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0
37.375	Tallest	23.517 - 25.286	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0
	Standard Cottage	20.958 - 23.516	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0
	Equal-lite	17.517 - 20.957	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-109.0
44	Standard Proview	14.517 - 17.516	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0
	Shortest	11.377 - 14.516	+70.0	-110.0	+70.0	-110.0	+70.0	-107.0	+70.0	-103.0
	Tallest	27.583 - 31.911	+70.0	-110.0	+70.0	-99.0	+70.0	-93.0	+70.0	-90.0
48	Custom Size	26.517 - 27.582	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0
	Standard Cottage	23.517 - 26.516	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0
	Equal-lite	20.517 - 23.516	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0
49.625	Standard Proview	17.517 - 20.516	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0
	Custom Size	14.517 - 17.516	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0
	Shortest	11.377 - 14.516	+70.0	-110.0	+70.0	-110.0	+70.0	-107.0	+70.0	-103.0
62	Tallest	31.583 - 35.911	+70.0	-110.0	+70.0	-99.0	+70.0	-93.0	+70.0	-90.0
	Standard Cottage	28.517 - 31.582	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0
	Equal-lite	20.517 - 26.516	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0
75	Standard Proview	17.517 - 20.516	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0
	Custom Size	14.517 - 17.516	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0
	Shortest	11.377 - 12.516	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0
84	Tallest	33.208 - 37.536	+70.0	-110.0	+70.0	-99.0	+70.0	-93.0	+70.0	-90.0
	Standard Cottage	26.517 - 33.207	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0
	Equal-lite	23.517 - 26.516	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0
91.78	Standard Proview	20.517 - 23.516	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0
	Custom Size	17.517 - 20.516	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0
	Shortest	12.517 - 14.516	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0

SEE TABLE 11, SHEET 10 FOR ANCHOR GROUP AND QUANTITY.  
\*\* MIN. SASH HEIGHT = WINDOW BUCK HEIGHT - 50.136  
(APPLIES TO ANY HEIGHT 91.78" OR LESS)

TABLE 8:

Glass Type 13 & 14 Reinf. Level 3	Bottom Sash Description for given Range @ Window Height Shown	Sash Height Range (in)	Design Pressure lbs/ft <sup>2</sup>													
			Window Buck Width (in)													
			18	24	32	36	40	48	52.125	54						
23.5	Equal-lite	11.394	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0
28	Standard Cottage	14.517 - 15.870	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0
	Equal-lite	11.583 - 14.516	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0
	Standard Proview	11.377 - 11.582	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0
37.375	Tallest	23.517 - 25.286	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0
	Standard Cottage	20.958 - 23.516	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0
	Equal-lite	17.517 - 20.957	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-109.0
44	Standard Proview	14.517 - 17.516	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0
	Shortest	11.377 - 14.516	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-107.0	+70.0	-103.0
	Tallest	27.583 - 31.911	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-99.0	+70.0	-93.0	+70.0	-90.0
48	Custom Size	26.517 - 27.582	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0
	Standard Cottage	23.517 - 26.516	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0
	Equal-lite	20.517 - 23.516	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0
49.625	Standard Proview	17.517 - 20.516	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0
	Custom Size	14.517 - 17.516	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0
	Shortest	11.377 - 14.516	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-107.0	+70.0	-103.0
62	Tallest	31.583 - 35.911	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-99.0	+70.0	-93.0	+70.0	-90.0
	Standard Cottage	28.517 - 31.582	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0
	Equal-lite	20.517 - 26.516	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0
75	Standard Proview	17.517 - 20.516	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0
	Custom Size	14.517 - 17.516	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0
	Shortest	11.377 - 12.516	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0
84	Tallest	33.208 - 37.536	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-99.0	+70.0	-93.0	+70.0	-90.0
	Standard Cottage	26.517 - 33.207	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0
	Equal-lite	23.517 - 26.516	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0
91.78	Standard Proview	20.517 - 23.516	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0
	Custom Size	17.517 - 20.516	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0
	Shortest	12.517 - 14.516	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0	+70.0	-110.0

SEE TABLE 12, SHEET 11 FOR ANCHOR GROUP AND QUANTITY.  
\*\* MIN. SASH HEIGHT = WINDOW BUCK HEIGHT - 50.136  
(APPLIES TO ANY HEIGHT 91.78" OR LESS)

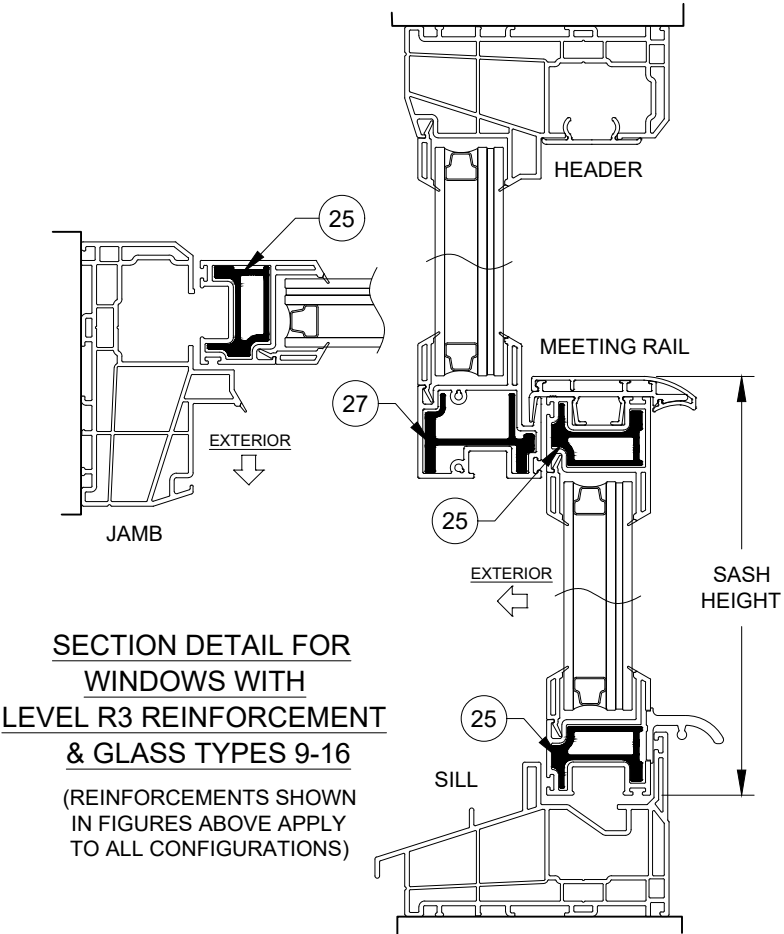

NOTES:

- 1) USE THESE TABLES FOR ALL WINDOWS INSTALLED THROUGH THE FRAME.
- 2) FRAME DIMENSIONS ARE BUCK. SASH HEIGHT IS AS PER THE FIGURE.
- 3) FOR SIZES NOT SHOWN, ROUND UP TO THE NEXT AVAILABLE WIDTH OR HEIGHT DIMENSION SHOWN ON THE TABLE.

**PRODUCT REVISED**  
As complying with the Florida Building Code  
NOA-No. **25-0520.01**  
Expiration Date: **07/30/2030**  
By: *Manuel Perez*  
Miami-Dade Product Control



PREPARED BY A. LYNN MILLER  
1070 TECHNOLOGY DRIVE  
N. VENICE, FL 34275

(941) 480-1600

REGISTRATION #29296

Series	Desc. Title	Date	Rev	Date	Rev
SH5500	VINYL SINGLE HUNG WINDOW (LM)	05/15/15	7 OF 14	05/12/25	E
	DESIGN PRESSURE TABLE	JENS ROSOWSKI			
DWG No.	NO CHANGES THIS SHEET - AM	05/12/25	SH5500-NOA	E	



TABLE 9:

Anchor Quantities Required for "Through-Frame" Installation			Anchor Group A															Anchor Group B															Anchor Group C																				
			18" Wide			24" Wide			32" Wide			36" Wide			40" Wide			48" Wide			52-1/8" Wide			18" Wide			24" Wide			32" Wide			36" Wide			40" Wide			48" Wide			52-1/8" Wide											
			Jamb	Below M/R	Header	Jamb	Below M/R	Header	Jamb	Below M/R	Header	Jamb	Below M/R	Header	Jamb	Below M/R	Header	Jamb	Below M/R	Header	Jamb	Below M/R	Header	Jamb	Below M/R	Header	Jamb	Below M/R	Header	Jamb	Below M/R	Header	Jamb	Below M/R	Header	Jamb	Below M/R	Header	Jamb	Below M/R	Header	Jamb	Below M/R	Header	Jamb	Below M/R	Header						
Glass Types 5, 6, 7 & 8 Reinf. Level R1	Bottom Sash Description for given Range @ Window Height Shown	Sash Height Range (in)	Above M/R	Below M/R	Header	Above M/R	Below M/R	Header	Above M/R	Below M/R	Header	Above M/R	Below M/R	Header	Above M/R	Below M/R	Header	Above M/R	Below M/R	Header	Above M/R	Below M/R	Header	Above M/R	Below M/R	Header	Above M/R	Below M/R	Header	Above M/R	Below M/R	Header	Above M/R	Below M/R	Header	Above M/R	Below M/R	Header	Above M/R	Below M/R	Header	Above M/R	Below M/R	Header	Above M/R	Below M/R	Header						
			23.5	Equal-Lite	11.394	1	2	1	1	2	1	1	2	1	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2
28	Standard Cottage	14.517 - 15.870	1	2	1	1	2	1	1	2	1	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2			
	Equal-Lite	11.583 - 14.516	1	2	1	1	2	1	1	2	1	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2			
	Standard Proview	11.377 - 11.582	2	2	1	2	2	1	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2		
37.375	Tallest	23.517 - 25.286	1	2	1	1	2	1	1	2	1	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2			
	Standard Cottage	20.958 - 23.516	1	2	1	1	2	1	1	2	1	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2			
	Equal-Lite	17.517 - 20.957	2	2	1	2	2	1	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2		
	Standard Proview	14.517 - 17.516	2	2	1	2	2	1	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2		
	Shortest	11.377 - 14.516	2	2	1	2	2	1	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2		
44	Tallest	27.583 - 31.911	1	3	1	1	3	1	1	3	2	1	3	2	1	3	2	1	3	2	1	3	2	1	3	2	1	3	2	1	3	2	1	3	2	1	3	2	1	3	2	1	3	2	1	3	2	1	3	2	1	3	2
	Custom Size	26.517 - 27.582	2	3	1	2	3	1	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2
	Standard Cottage	23.517 - 26.516	2	3	1	2	3	1	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2
	Equal-Lite	20.517 - 23.516	2	2	1	2	2	1	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	
	Standard Proview	17.517 - 20.516	2	2	1	2	2	1	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2		
	Custom Size	14.517 - 17.516	3	2	1	3	2	1	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	
	Shortest	11.377 - 14.516	3	2	1	3	2	1	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	
48	Tallest	31.583 - 35.911	1	3	1	1	3	1	1	3	2	1	3	2	1	3	2	1	3	2	1	3	2	1	3	2	1	3	2	1	3	2	1	3	2	1	3	2	1	3	2	1	3	2	1	3	2	1	3	2	1	3	2
	Standard Cottage	26.517 - 31.582	2	3	1	2	3	1	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2
	Equal-Lite	20.517 - 26.516	2	3	1	2	3	1	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2
	Standard Proview	17.517 - 20.516	3	2	1	3	2	1	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	
	Custom Size	14.517 - 17.516	3	2	1	3	2	1	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	
	Custom Size	12.517 - 14.516	3	2	1	3	2	1	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	
	Shortest	11.377 - 12.516	3	2	1	3	2	1	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	
49.625	Tallest	33.208 - 37.536	1	3	1	1	3	1	1	3	2	1	3	2	1	3	2	1	3	2	1	3	2	1	3	2	1	3	2	1	3	2	1	3	2	1	3	2	1	3	2	1	3	2	1	3	2	1	3	2	1	3	2
	Standard Cottage	26.517 - 33.207	2	3	1	2	3	1	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2
	Equal-Lite	23.517 - 26.516	2	3	1	2	3	1	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2
	Custom Size	20.517 - 23.516	3	2	1	3	2	1	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	
	Standard Proview	17.517 - 20.516	3	2	1	3	2	1	3	2	2	3	2	2	3	2	2	3	2	2	3	2																															

TABLE 10:

[illegible]

### Max. Anchor O.C. Spacing for "Integral-Fin" Installation

Anchor Group F	4"
-------------------	----

SEE TABLES 5 & 6, SHEET 6 FOR DESIGN PRESSURES WHEN USING THIS TABLE.


**\*\* MIN. SASH HEIGHT = WINDOW BUCK HEIGHT - 50.136**


(APPLIES TO ANY HEIGHT 91.78" OR LESS)

NOTES:

- 1) USE THE ABOVE "ANCHOR QUANTITIES REQUIRED....." TABLE FOR ANCHORS INSTALLED THROUGH THE FRAME.
- 2) USE THE ABOVE "MAX. ANCHOR O.C. SPACING....." TABLE FOR ANCHORS INSTALLED THROUGH THE INTEGRAL FIN.
- 3) FRAME DIMENSIONS ARE BUCK. "MR" = MEETING RAIL.
- 4) FOR SIZES NOT SHOWN, ROUND UP TO THE NEXT AVAILABLE WIDTH OR HEIGHT DIMENSION SHOWN ON THE TABLE.
- 5) REFER TO TABLES 2 & 3, SHEET 2 FOR ANCHOR GROUP DESCRIPTIONS.

**PRODUCT REVISED**  
As complying with the Florida  
Building Code  
NOA-No. **25-0520.01**  
Expiration Date: **07/30/2030**  
By: *Manuel Perez*  
**Miami-Dade Product Control**


 <p><b>PGT</b> Custom Windows and Doors</p>			PREPARED BY A. LYNN MILLER 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275			
3400 PRECISION DRIVE N. VENICE, FL 34275 (941) 480-1600			(941) 480-1600			
			REGISTRATION #29296			
Title	VINYL SINGLE HUNG WINDOW (LM)				Date	05/15/15
Desc.	ANCHOR QUANTITY TABLE			Drawn By	JENS ROSOWSKI	
Rev	NO CHANGES THIS SHEET - AM				Rev Date	05/12/25
Series	SH5500	Sheet	9 OF 14	DWG No.	SH5500-NOA	Rev. E

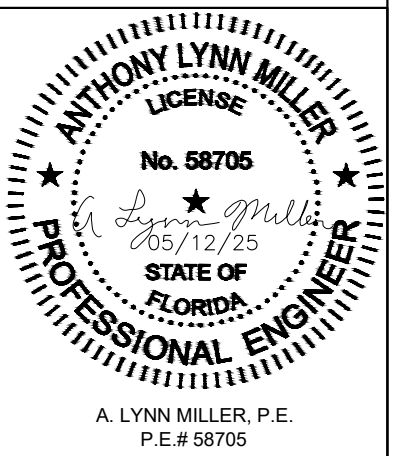

[illegible]

SEE TABLE 7, SHEET 7 FOR DESIGN PRESSURES WHEN USING THIS TABLE.  
 \*\* MIN. SASH HEIGHT = WINDOW BUCK HEIGHT - 50.136  
 (APPLIES TO ANY HEIGHT 91.78" OR LESS)

3) REFER TO TABLES 2, SHEET 2 FOR ANCHOR GROUP DESCRIPTIONS.

		PREPARED BY A. LYNN MILLER 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275					
		(941) 480-1600					
3400 PRECISION DRIVE N. VENICE, FL 34275 (941) 480-1600		REGISTRATION #29296					
Title	VINYL SINGLE HUNG WINDOW (LM)					Date	05/15/15
Desc.	ANCHOR QUANTITY TABLE				Drawn By	JENS ROSOWSKI	
Rev.	ADD TABLE 11 AND PAGE - AM					Rev Date	05/12/25
Series	SH5500	Sheet	10 OF 14	DWG No.	SH5500-NOA		Rev. E

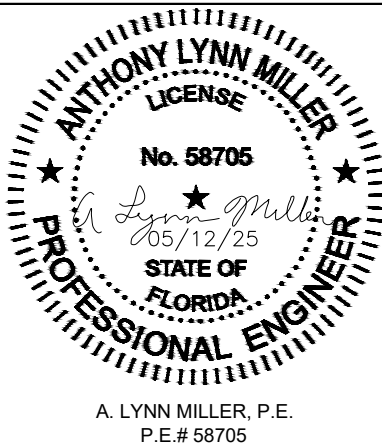


TABLE 12:

[illegible]

**GLASS TYPES 9 THROUGH 16 MAY NOT BE USED WITH J-CHANNEL OR INTEGRAL FIN FRAMES**

SEE TABLE 8, SHEET 7 FOR DESIGN PRESSURES WHEN USING THIS TABLE.


\*\* MIN. SASH HEIGHT = WINDOW BUCK HEIGHT - 50.136


(APPLIES TO ANY HEIGHT 91.78" OR LESS)
























NOTES:

- 1) FRAME DIMENSIONS ARE BUCK. "MR" = MEETING RAIL.
- 2) FOR SIZES NOT SHOWN, ROUND UP TO THE NEXT AVAILABLE WIDTH OR HEIGHT DIMENSION SHOWN ON THE TABLE.
- 3) REFER TO TABLES 2, SHEET 2 FOR ANCHOR GROUP DESCRIPTIONS.

**PRODUCT REVISED**  
As complying with the Florida  
Building Code  
NOA-No. **25-0520.01**  
Expiration Date: **07/30/2030**  
By: *Manuel Perez*  
**Miami-Dade Product Control**

		PREPARED BY A. LYNN MILLER 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275					
		(941) 480-1600					
3400 PRECISION DRIVE N. VENICE, FL 34275 (941) 480-1600		REGISTRATION #29296					
Title	VINYL SINGLE HUNG WINDOW (LM)				Date	05/15/15	
Desc.	ANCHOR QUANTITY TABLE			Drawn By	JENS ROSOWSKI		
Rev	UPDATE SHEET # - AM				Rev Date	05/12/25	
Series	SH5500	Sheet	11 OF 14	DWG No.	SH5500-NOA	Rev.	E

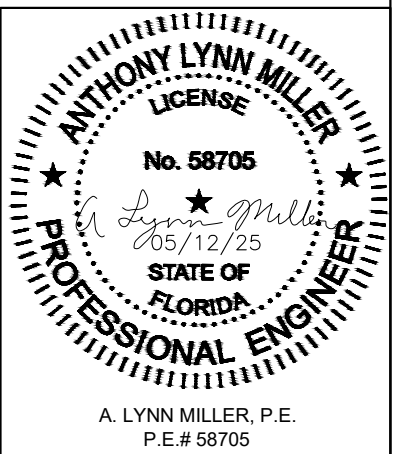

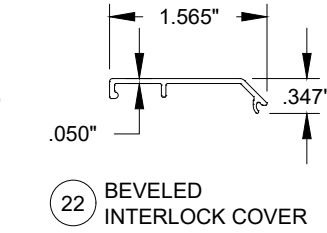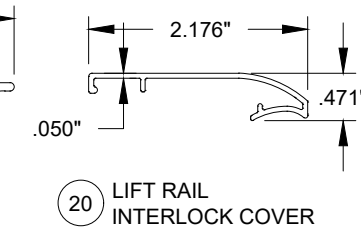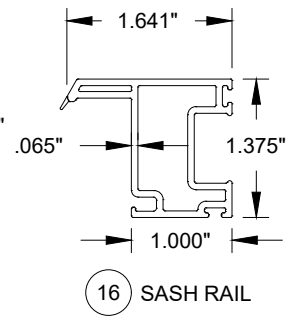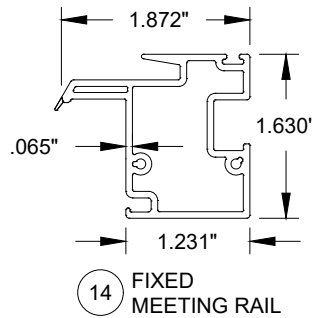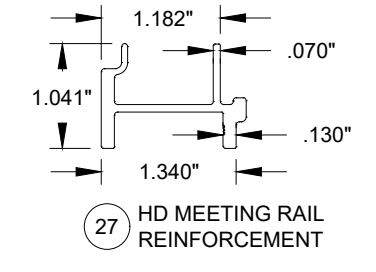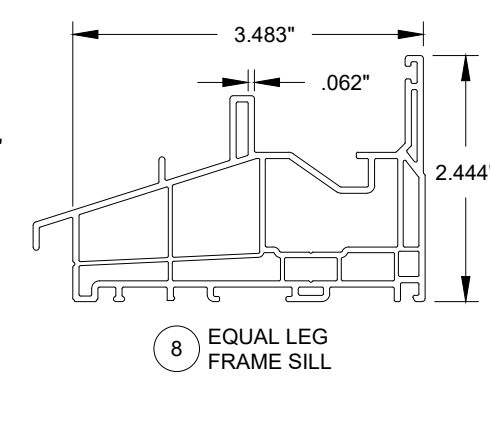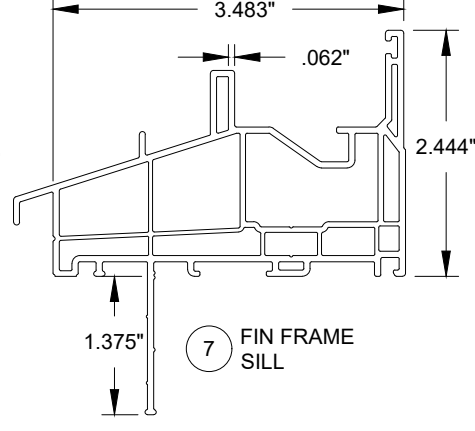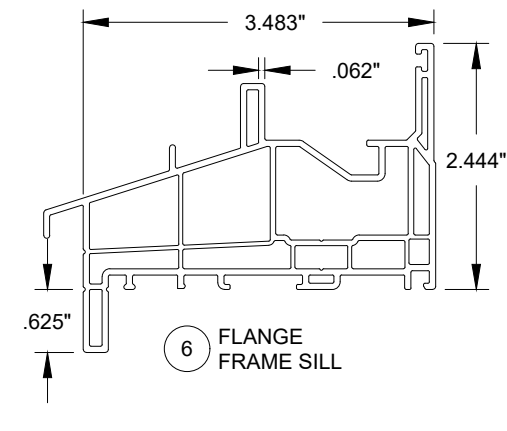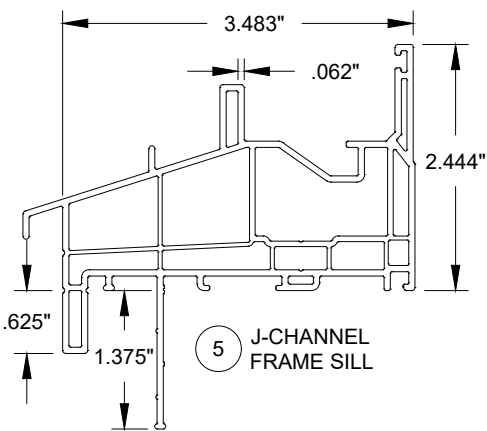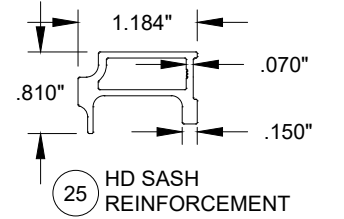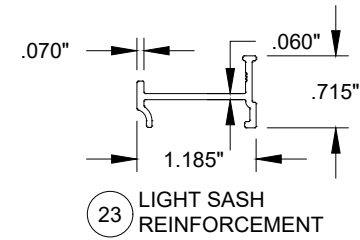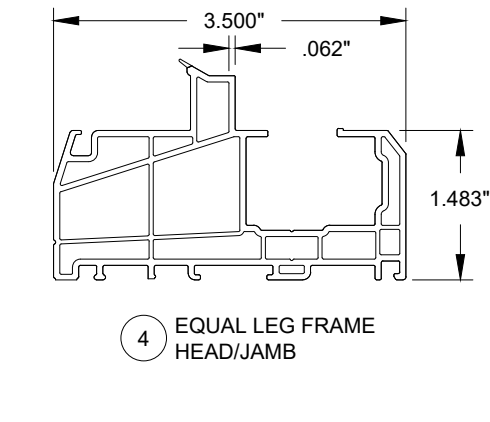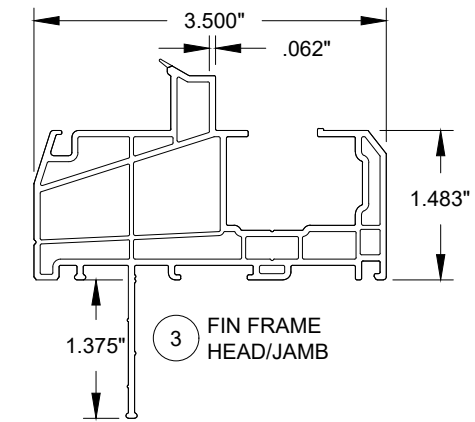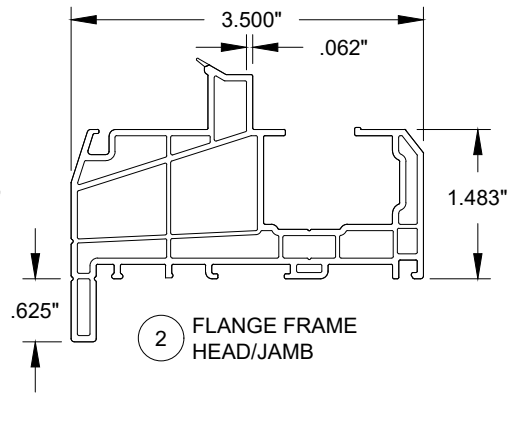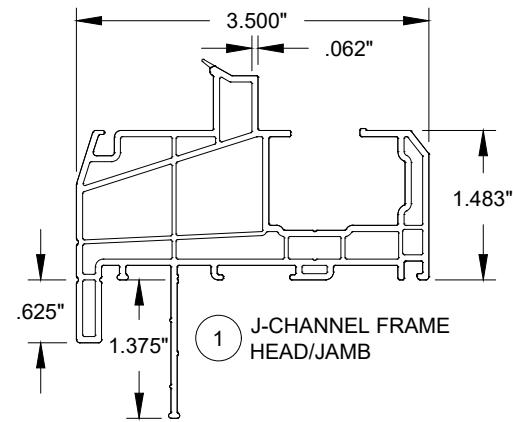

**PRODUCT REVISED**  
As complying with the Florida Building Code  
NOA-No. **25-0520.01**  
Expiration Date: **07/30/2030**  
By: *Manuel Perez*  
Miami-Dade Product Control

<b>PGT</b> Custom Windows and Doors		PREPARED BY A. LYNN MILLER 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 (941) 480-1600	
3400 PRECISION DRIVE N. VENICE, FL 34275 (941) 480-1600		REGISTRATION #29296	
Series	Desc.	Date	
	VINYL SINGLE HUNG WINDOW (LM)	05/15/15	
Rev	Desc.	Drawn By	
	WINDOW EXTRUSIONS	JENS ROSOWSKI	
Rev	Desc.	Rev Date	
	NO CHANGES THIS SHEET - AM	05/12/25	
Sheet	12 OF 14	DWG No.	SH5500-NOA
Rev.	E		


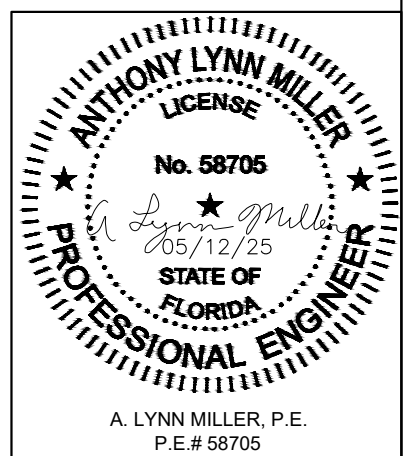


TABLE 12:

Bill of Material			
#	Part #	Description	Material
1	620101	Single Hung Frame Head & Jambs - J-Channel	PVC
2	620102	Single Hung Frame Head & Jambs - Flange	PVC
3	620103	Single Hung Frame Head & Jambs - Fin	PVC
4	620104	Single Hung Frame Head & Jambs - Equal Leg/Box	PVC
5	620105	SH/DH Frame Sill - J-Channel	PVC
6	620106	SH/DH Frame Sill - Flange	PVC
7	620107	SH/DH Frame Sill - Fin	PVC
8	620108	SH/DH Frame Sill - Equal Leg/Box	PVC
14	620131	Fixed Meeting Rail	PVC
16	620129	Sash Rail (Sides, Top & Bottom)	PVC
17	620134	Balance Cover	PVC
18	620133	Sash Stop/Screw Cover	PVC
19	620156	Pull Rail Interlock	6005 T5 Al
20	620144	Pull Rail Interlock Cover	PVC
21	620157	Beveled Interlock	6005 T5 Al
22	620145	Beveled Interlock Cover	PVC
23	620150	Light Sash Reinforcement	6063 T6 Al
25	620152	HD Sash Reinforcement	6063 T6 Al
26	620153	Standard Meeting Rail Reinforcement	6005 T5 Al
27	620154	HD Meeting Rail Reinforcement	6005 T5 Al
30	61644	Weatherstrip, .187" x .270" Fin Pile	
31	6Q300	Weatherstrip, .190" x .300" Foam Bulb	Flex PVC
32	61719	Weatherstrip, .187" x .220" PolyPile	
33	61825	Weatherstrip Plug, .220" Finseal	
35	78X1MTTT	#8 x 1" Ph. PH SDS (Interlock Mounting Screw)	
36	78X3THPX	#8 x 3" Ph. PH SMS (Meeting Rail Screw)	410 SS
37	71669SP	Meeting Rail Screw Support Plate	6063 T6 Al
38	720210	Weep Hole Cover	PVC
40	720XXXX	Constant Force Balance	
41		#8 x 3/4" Ph. FH SMS (Con. Force Balance Screw)	SS
42		Spiral Balance	
43	720205	Spiral Balance Shoe	Nylon
44	78X114FPAX	#8 x 1-1/4" Ph. FH SMS (Spiral Balance Screw)	410 SS

TABLE 12, CONT.:

Bill of Material, cont.			
#	Part #	Description	Material
45	720197	Auto Lock Mechanism	C Steel
46	720198&9	Sweep Lock	Cast Zinc
47	720195&6	Auto Lock Cover Assembly	Cast Zinc
48	76X1180PTX	#6 x 1-1/8" Ph. FH SDS (Auto and Sweep Lock Screw)	SS
49	720200	Auto and Sweep Lock Keeper	Cast Zinc
50	76X34PPA	#6 x 3/4" PH. PH SDS (Keeper Screw)	SS
51	420181 L/R	Beveled Tilt Latch Corner Key	PVC
52	420182 L/R	Pull Rail Tilt Latch Corner Key	PVC
53	7634PHFL	#6 x 3/4" Ph. FH SDS (Corner Key Screw)	SS
54	420183	Tilt Latch	PVC
55	420184	Tilt Latch Retainer	PVC
56	720207	1" Tilt Latch Spring	SS
57	420186	Plastic Tilt Latch Finger Pull	PVC
58	720192	Metal Tilt Latch Finger Pull	Cast Zinc
59	420180	Pivot Bar Corner Key	PVC
60	720206	Pivot Bar	SS
63	720191	Sash Pull Handle	Cast Zinc
64	720194	Sash Pull Handle With Latch Assembly	Cast Zinc
65	7834FPT	#8 x 3/4" Ph. FH SDS (Pull Handle Screw )	SS
66	420188	Bottom Latch Strike Plate	Cast Zinc
67	77858B	#8 x 5/8" Ph. FH SMS (Strike Plate Screw)	SS
72	720135	Lami I.G. Bead	PVC
74		Backbedding, GE 7700 or Dow 791 or Dow 983	Silicone
75	71646N	Setting Block (7/8" x 1" x 1/8"), 85 +/- 5 duro.	EPDM
80	61012	Extruded Screen Frame	Alum
81	61011	Roll-Formed Screen Frame	Alum
82	7CKGLB21	Screen Corner Key for Extruded Frame X 4	PVC
83	47042	Screen Corner Key with Pull Ring X 2	PVC
84	47041	Screen Corner Key without Pull Ring X 2	PVC
85	7CASPM	Tension Spring	SS
86	61816C48	Screen Cloth	Fiberglass
87	61635/61614	.140" Screen Spline (Machine/Hand Rolled)	Vinyl

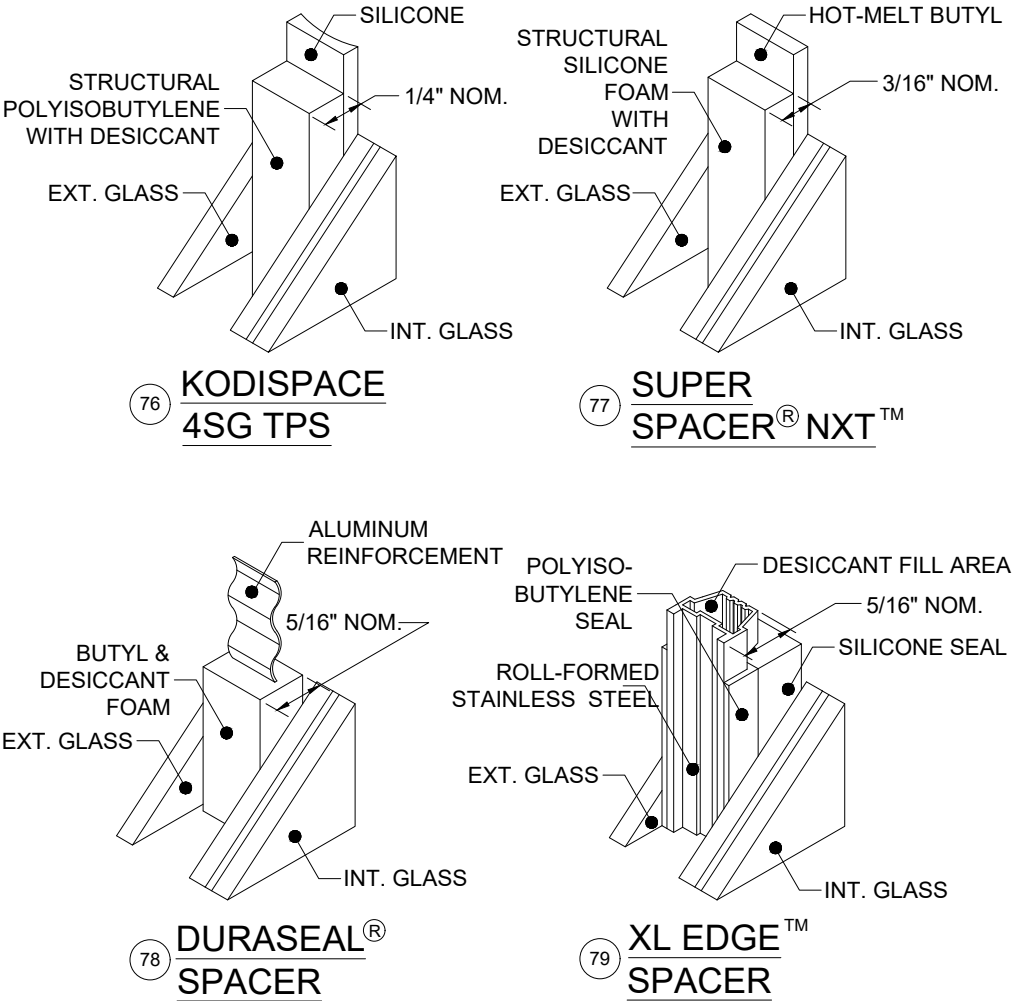

Part #	Description	Material
76	Kommerling 4SG TPS Spacer System	See this Sheet for Materials
77	Quanex Super Spacer nXT with Hot Melt Butyl	
78	Quanex Duraseal Spacer	
79	Cardinal XL Edge Spacer	

REFERENCE TEST REPORTS: FTL-8717, 8968 & 8970

NOTES:

- 1) PVC BY VISION EXTRUSION, LTD., TO BE LABELED FOR AAMA EXTRUDER CODE.  
2) ITEMS # 9-13, 15, 24, 28, 29, 34, 39, 61, 62, 68-71, & 73 ARE NOT USED AND ARE NOT PART OF THIS APPROVAL.

**PRODUCT REVISED**  
As complying with the Florida Building Code  
NOA-No. **25-0520.01**  
Expiration Date: **07/30/2030**  
By: *Manuel Perez*  
**Miami-Dade Product Control**

**PGT**  
Custom Windows and Doors

3400 PRECISION DRIVE  
N. VENICE, FL 34275  
(941) 480-1600


PREPARED BY A. LYNN MILLER  
1070 TECHNOLOGY DRIVE  
N. VENICE, FL 34275  
(941) 480-1600

REGISTRATION #29296

Series	Desc.	Title	Date
		VINYL SINGLE HUNG WINDOW (LM)	05/15/15
Rev	Drawn By	JENS ROSOWSKI	
		BILL OF MATERIALS	
		NO CHANGES THIS SHEET - AM	05/12/25
Sheet	13 OF 14	DWG No.	SH5500-NOA
Rev.	E		

ANTHONY LYNN MILLER  
LICENSE  
No. 58705  
05/12/25  
STATE OF FLORIDA  
PROFESSIONAL ENGINEER

A. LYNN MILLER, P.E.  
P.E.# 58705

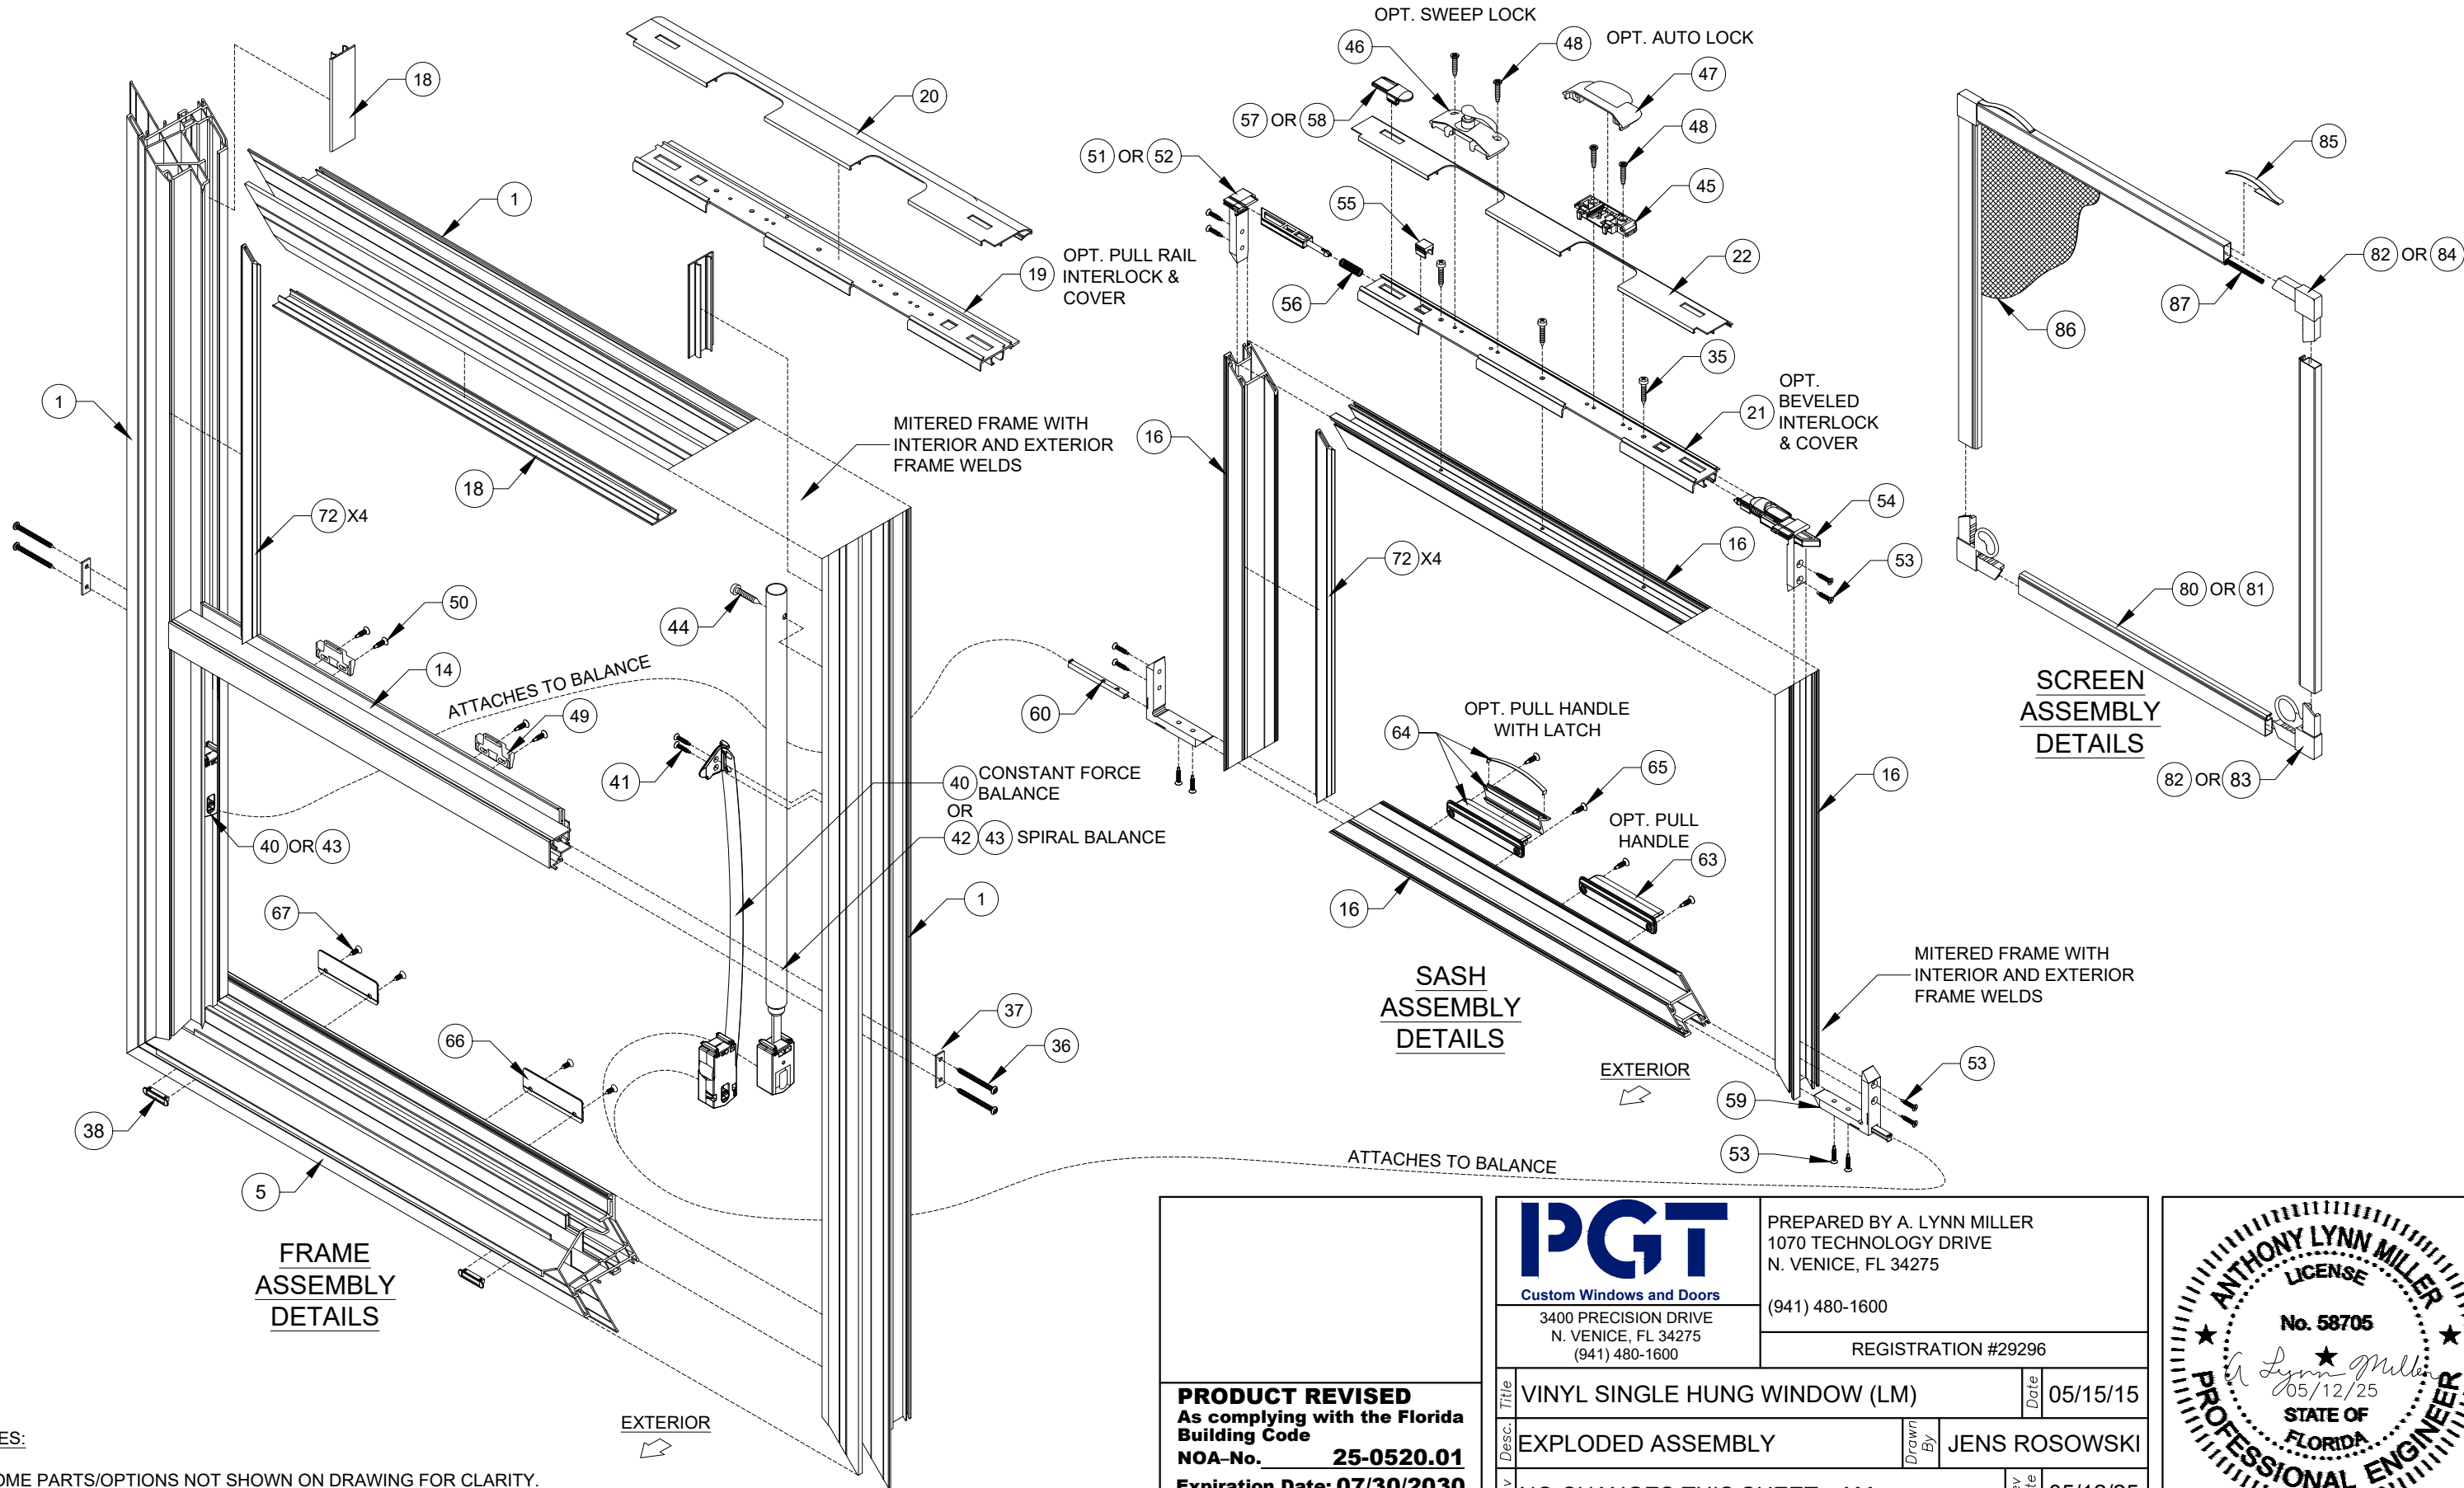

NOTES:

- 1) SOME PARTS/OPTIONS NOT SHOWN ON DRAWING FOR CLARITY.
- 2) J-CHANNEL FRAME SHOWN, PARTS # 1 & 5. OTHER FRAME TYPES APPLY.
- 3) FOR REINFORCEMENT TYPES, SEE DETAILS ON SHEETS 6 & 7.
- 4) USE EITHER SASH TOP LOCKS OR SASH BOTTOM LOCKS.

**PRODUCT REVISED**  
As complying with the Florida  
Building Code  
NOA-No. **25-0520.01**  
Expiration Date: **07/30/2030**  
By: *Manuel Perez*  
Miami-Dade Product Control

<b>PGT</b> Custom Windows and Doors		PREPARED BY A. LYNN MILLER 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 (941) 480-1600	
3400 PRECISION DRIVE N. VENICE, FL 34275 (941) 480-1600		REGISTRATION #29296	
Series	Rev	Desc. Title	Date
SH5500		VINYL SINGLE HUNG WINDOW (LM)	05/15/15
EXPLODED ASSEMBLY		Drawn By	JENS ROSOWSKI
NO CHANGES THIS SHEET - AM		Rev Date	05/12/25
Sheet	14 OF 14	DWG No.	SH5500-NOA
		Rev.	E

