



MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
 11805 SW 26 Street, Room 208
 Miami, Florida 33175-2474
 T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
 BOARD AND CODE ADMINISTRATION DIVISION
NOTICE OF ACCEPTANCE (NOA)

Custom Window Systems, Inc.
 1900 SW 44th Avenue
 Ocala, FL 34474

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER - Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/ or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "310 (Fin Frame)" Aluminum Single Hung Window - N.I.

APPROVAL DOCUMENT: Drawing No. **CWS-1255**, titled "CWS 310 Single Hung Aluminum Fin Frame Non-Impact Window", sheets 1 through 5 of 5, dated 11/17/23, with revision **A** dated 05/15/25, prepared by the manufacturer, signed and sealed by Thomas J. Sotos, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: None

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, Medley, Florida, series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/ or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises and renews** NOA No. **23-1017.07** and consists of this page 1 and evidence pages E-1, E-2, E-3 and E-4, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**




 6/27/25

NOA No. 25-0612.01
 Expiration Date: July 07, 2030
 Approval Date: July 03, 2025
 Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's

A. DRAWINGS

1. Manufacturer's die drawings and sections.
(Submitted under NOA No. 05-0324.06)
2. Drawing No. **L7600-0402**, titled "SH-7600 Single Hung Fin Window", sheets 1 through 5 of 5, dated 09/20/04, with revision **H** dated 10/11/23, prepared by manufacturer, signed and sealed by Thomas J. Sotos, P.E.
(Submitted under NOA No. 23-1017.07)

B. TESTS

1. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of a series SH-7700 aluminum single hung window, prepared by Hurricane Engineering & Testing, Inc., Test Reports No. **HETI-23-8048** and **HETI-23-8049**, dated 07/24/23, signed and sealed by Ram N. Tewari, P.E.
(Submitted under NOA No. 23-1017.07)
2. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, per FBC 2411.3.2.1, and TAS 202-94
along with marked-up drawings and installation diagram of an aluminum single hung window-fin mounted, prepared by Fenestration Testing Laboratories, Inc., Test Report No. **FTL-5284**, dated on 09/14/07, and addendum letter dated 07/21/08, all signed and sealed by Michael R. Wenzel, P.E.
(Submitted under NOA No.07-1029.05)
3. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, per FBC 2411.3.2.1, and TAS 202-94
along with marked-up drawings and installation diagram of aluminum single hung windows - (fin/flange mounted), prepared by Fenestration Testing Laboratory, Inc., Test Reports No. **FTL-4324**, **FTL-4350**, **FTL-4351**, **FTL-4346**, **FTL-4363**, **FTL-4323**, **FTL-4406** and **FTL-4405**, all dated 11/08/04 and 11/12/04, signed and sealed by Edmundo J. Largaespada, P.E.
(Submitted under NOA No.05-0324.06)



Manuel Perez, P.E.
Product Control Examiner
NOA No. 25-0612.01

Expiration Date: July 07, 2030
Approval Date: July 03, 2025

Custom Window Systems, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's (CONTINUED)

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC, dated 08/04/09, prepared by manufacturer, signed and sealed by Thomas J. Sotos, P.E.
(Submitted under NOA No. 09-0720.06)
2. Glazing complies with ASTM E1300-04/09

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS

1. None.

F. STATEMENTS

1. Statement letter of conformance, complying with **FBC 8th Edition (2023)**, dated October 11, 2023, issued by the manufacturer, signed and sealed by Thomas J. Sotos, P.E.
(Submitted under NOA No. 23-1017.07)
2. Statement letter of no financial interest, dated October 11, 2023, issued by the manufacturer, signed and sealed by Thomas J. Sotos, P.E.
(Submitted under NOA No. 23-1017.07)
3. Proposal No. **23-0461R** issued by Product Control Section, dated June 13, 2023, and revised on June 16, 2023, signed by Manuel Perez, P.E.
(Submitted under NOA No. 23-1017.07)
4. Laboratory compliance letter for Test Report No. **FTL-5284**, issued by Fenestration Testing Laboratory, Inc., dated 09/14/07, signed and sealed by Michael R. Wenzel, P.E.
(Submitted under NOA No. 07-1029.05)
5. Laboratory compliance letter for Test Reports No. **FTL-4324, FTL-4350, FTL-4346, FTL-4363, FTL-4323, FTL-4406** and **FTL-4405**, issued by Fenestration Testing Laboratory, Inc., all dated 11/08/04 and 11/12/04, all signed and sealed by Edmundo J. Largaespada, P.E.
(Submitted under NOA No.05-0928.02)

G. OTHERS

1. Notice of Acceptance No. **20-0814.06**, issued to Lawson Industries, Inc. for their Series "SH-7600 (Fin Frame)" Aluminum Single Hung Window – N.I., approved on 10/15/20 and expiring on 07/07/25.


Manuel Perez, P.E.
Product Control Examiner
NOA No. 25-0612.01
Expiration Date: July 07, 2030
Approval Date: July 03, 2025

Custom Window Systems, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

2. NEW EVIDENCE SUBMITTED

A. DRAWINGS

1. Drawing No. **CWS-1255**, titled “CWS 310 Single Hung Aluminum Fin Frame Non-Impact Window”, sheets 1 through 5 of 5, dated 11/17/23, with revision **A** dated 05/15/25, prepared by manufacturer, signed and sealed by Thomas J. Sotos, P.E.

B. TESTS

1. None.

C. CALCULATIONS

1. None.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS

1. None.

F. STATEMENTS

1. Statement letter of conformance, complying with **FBC 8th Edition (2023)**, dated June 9, 2025, issued by the manufacturer, signed and sealed by Thomas J. Sotos, P.E.
2. Statement letter of no financial interest, dated June 9, 2025, issued by the manufacturer, signed and sealed by Thomas J. Sotos, P.E.
3. Bill of Sales between CWS-SF, LLC (Buyer) and Lawson Industries, Inc. (Seller), dated Nov. 28, 2023, signed by Nicholas Cross (President, CWS) and Harold Bailey (President, Lawson Industries).
4. Statement letter dated June 5, 2025, confirming that Custom Window System, Inc. is a wholly owned subsidiary of Pella Corporation, signed by Chantel Kramme, Secretary Pella Corp.
5. Letter from owners of existing NOA, stating that they have sold all assets to the applicant, that they no longer manufacture the product, relinquish their rights to the current NOA and request that it be rescinded, dated June 10, 2025, signed by Mr. Harold Bailey, President, Lawson Industries, Inc.
6. Statement letter dated June 25, 2025, issued by Custom Window Systems, Inc. (CWS) stating that they have legally purchased all assets of (18) listed NOA’s from Lawson Industries, Inc. and requesting that new corresponding NOA’s be issued to CWS name; also, that (18) listed Private Label Agreement NOA’s between Lawson Industries, Inc. and CWS be rescinded, signed by Kevin Pine, Vice President.



Manuel Perez, P.E.
Product Control Examiner
NOA No. 25-0612.01

Expiration Date: July 07, 2030
Approval Date: July 03, 2025

Custom Window Systems, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

2. NEW EVIDENCE SUBMITTED (CONTINUED)

G. OTHERS

1. Notice of Acceptance No. **23-1017.07**, issued to Lawson Industries, Inc. for their Series “SH-7600 (Fin Frame)” Aluminum Single Hung Window – N.I., approved on 10/16/23 and expiring on 07/07/25. **(Previous NOA to be rescinded)**
2. Notice of Acceptance No. **24-0116.15**, issued to Custom Window Systems, Inc. for their Series “CWS-310 (Fin Frame)” Aluminum Single Hung Window – N.I., approved on 02/01/24 and expiring on 07/07/25. **(Private Label NOA to be rescinded)**




Manuel Perez, P.E.

Product Control Examiner

NOA No. 25-0612.01


Expiration Date: July 07, 2030

Approval Date: July 03, 2025

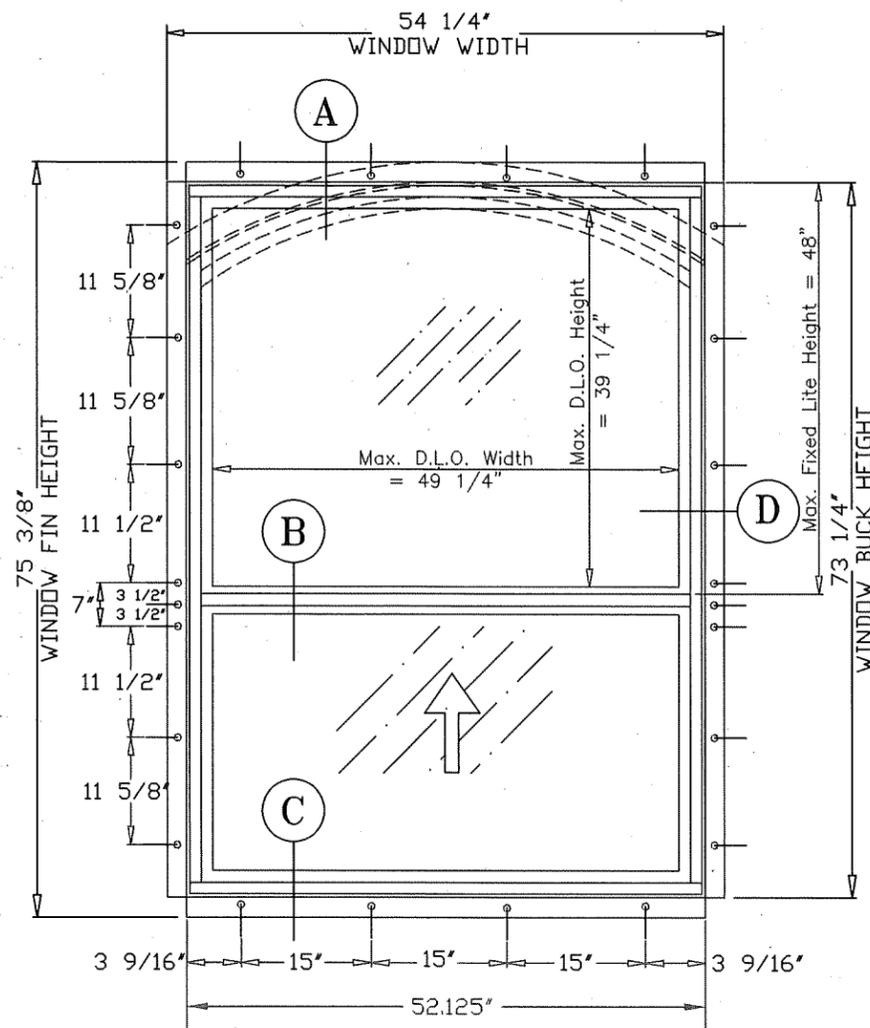


UNEQUAL LITE VIEW WINDOW ELEVATION

(SEE TABLE V-1 & V-2 FOR DESIGN PRESSURE)

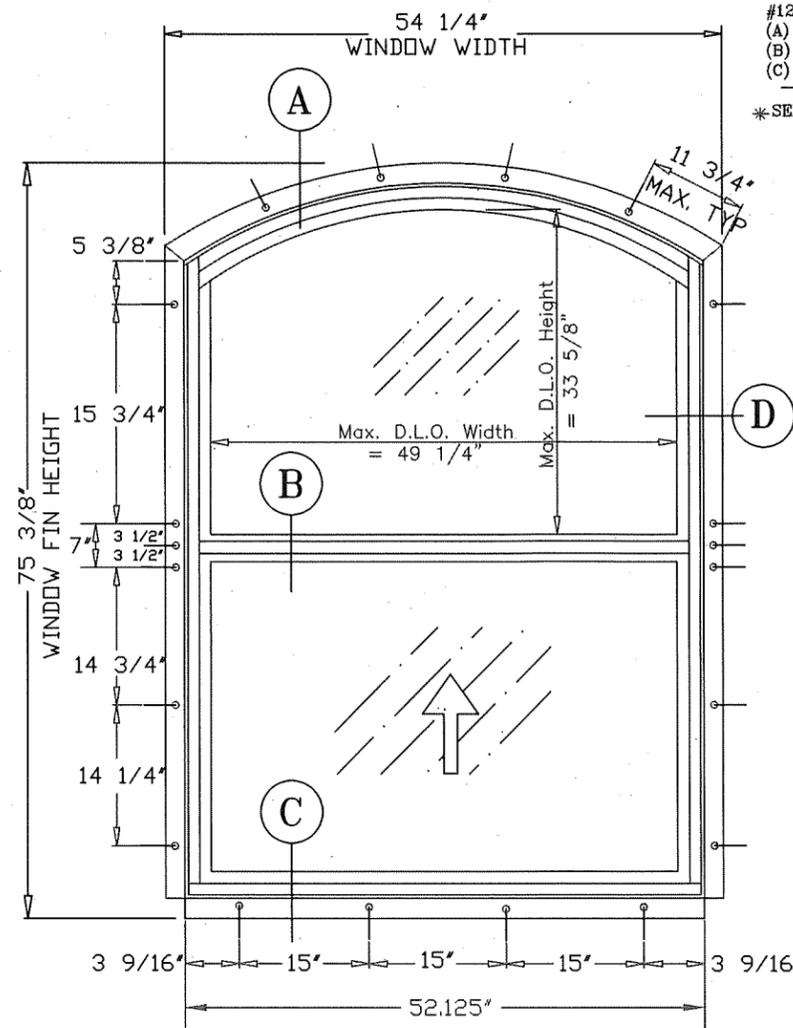

RADIUS HEAD EQUAL LITE WINDOW ELEVATION

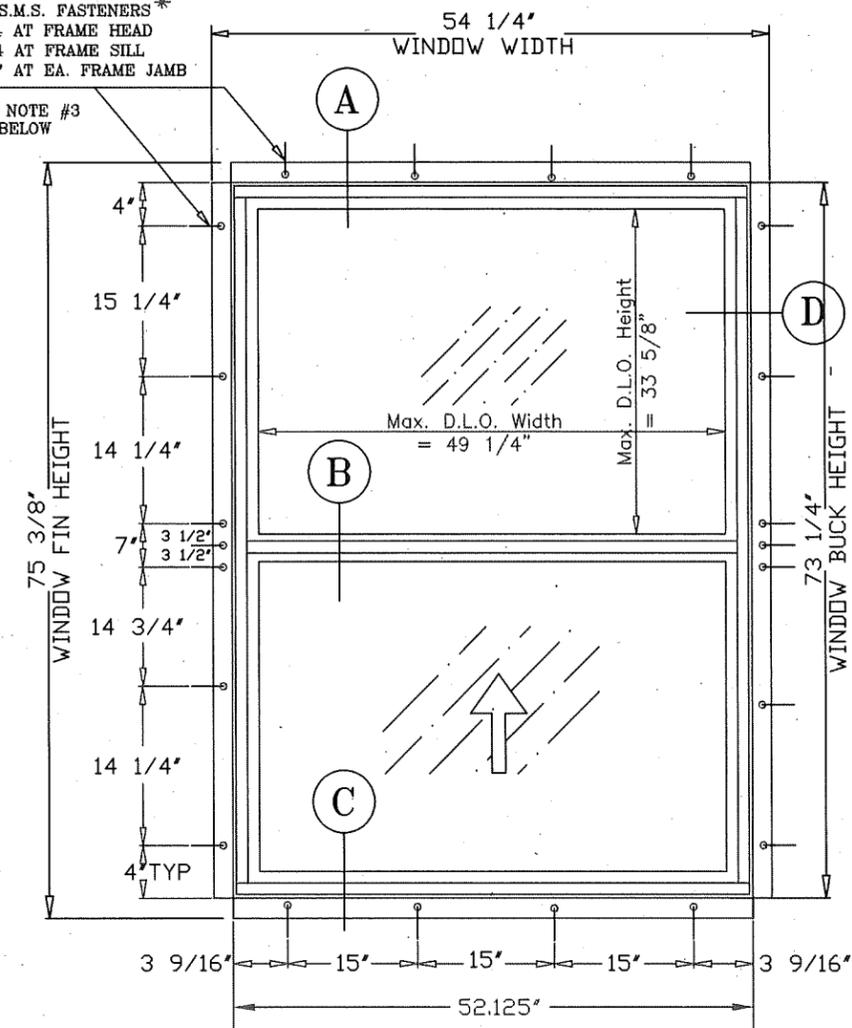

EQUAL LITE WINDOW ELEVATION

#12 S.M.S. FASTENERS*
 (A) 4 AT FRAME HEAD
 (B) 4 AT FRAME SILL
 (C) 7 AT EA. FRAME JAMB
 *SEE NOTE #3 BELOW




1900 SW 44TH AVE.
 OCALA, FLORIDA 34474
 WWW.CWS.CC

CWS 310 SINGLE HUNG ALUMINUM FIN FRAME NON-IMPACT WINDOW

NO.	DESCRIPTION	BY	DATE
A	Revises NDA # 23-1017.07	N.E.	05/15/25

THOMAS J. SOTOS
 PROFESSIONAL ENGINEER
 FL LIC. # 55225

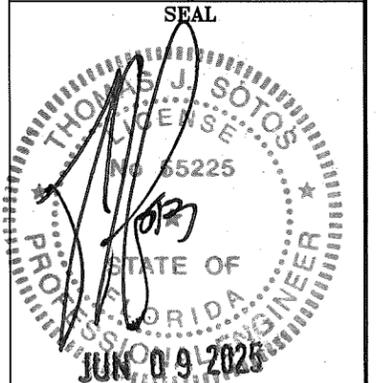

DATE: _____
 SHEET DESCRIPTION:
 APPROVED ELEVATIONS, CONFIGURATIONS AND NOTES

DRAWN BY:	DATE:
NELSON ERAZO	11/17/2023
REV. BY:	DATE:
N.E.	05/15/2025
DWG #:	REV #:
CWS-1255	A
SCALE:	SHEET
AS NOTED	1 OF 5

NOTES:

- THIS WINDOW SYSTEM IS DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE (2020-7th Edition & 2023-8th Edition) AND ASTM 1300-09. THIS PRODUCT IS NOT IMPACT RESISTANT. WINDOWS ARE TO BE PROTECTED WITH A MIAMI-DADE COUNTY APPROVED IMPACT RESISTANT SHUTTER.
- 1 X OR 2 X WOOD BUCKS SHALL BE INSTALLED AND ANCHORED SO THAT THE BUILDING RESISTS THE SUPERIMPOSED LOADS IN ACCORDANCE WITH REQUIREMENTS OF F.B.C. & TO BE REVIEWED BY BUILDING OFFICIAL.
- ANCHORS SHOWN ABOVE ARE AS PER TEST UNITS. EXTERIOR ANCHOR SPACINGS WILL VARY WITH UNIT DIMENSIONS, AND THE NUMBER OF ANCHORS REQUIRED, AS SPECIFIED ON THE LOAD TABLES AT SHEET 3 & 4.
- ANCHOR CONDITIONS NOT DESCRIBED IN THESE DRAWING'S ARE TO BE ENGINEERED ON A SITE SPECIFIC BASIS, UNDER SEPARATE APPROVAL AND TO BE REVIEWED BY BUILDING OFFICIAL.
- RADIUS HEAD WINDOWS ARE QUALIFIED FOR USE WITH ALL GLASS TYPES TABULATED HEREIN. HEREIN.
- VIEW WINDOWS ARE QUALIFIED FOR USE WITH 3/16" ANNEALED & 3/16" TEMPERED GLASS USING THE HEAVY DUTY MEETING RAIL ONLY.
- SEE SHEET #5 FOR SASH LOCK OPTIONS & NOTES.
- SEE SHEET #4 FOR GLAZING DETAILS & OPTIONS. (REFER TO SHEETS 3, & 4 FOR DESIGN PRESSURES.
- WOOD OPENING SHALL BE PROTECTED WITH AN APPROVED MOISTURE RESISTANT BARRIER (BY OTHERS), PRIOR TO WINDOW INSTALLATION. (SEE SHEET #2 FOR DETAIL & NOTES.
- APPROVAL APPLIES TO SINGLE UNITS, OR MULTIPLE UNITS AND MAY BE MULLED VERTICALLY OR HORIZONTALLY.
- MULLING SINGLE HUNG WINDOWS WITH OTHER TYPES OF MIAMI-DADE COUNTY APPROVED WINDOWS USING A MIAMI-DADE COUNTY APPROVED MULLION IN BETWEEN ARE ACCEPTABLE BUT THE LOWER PRESSURE FROM THE WINDOWS OR MULLION APPROVAL WILL APPLY TO THE ENTIRE MULLED SYSTEM.
- SEE SHEET # 5 FOR MULLION/METAL ATTACHMENT DETAILS & NOTES.

WINDOWS ARE TO BE PROTECTED WITH MIAMI DADE COUNTY APPROVED IMPACT RESISTANT SHUTTERS

PRODUCT RENEWED
 as complying with the Florida Building Code
 NOA-No. **25-0613.03**
 Expiration Date: **06/30/2026**
 By: *Manuel Perez*
 Miami-Dade Product Control




1900 SW 44TH AVE.
OCALA, FLORIDA 34474
WWW.CWS.CC

**CWS 310 SINGLE HUNG
ALUMINUM FIN FRAME
NON-IMPACT WINDOW**


NO.	DESCRIPTION	BY	DATE
A	Revises NDA # 23-1017.07	N.E.	05/15/25

THOMAS J. SOTOS
PROFESSIONAL ENGINEER
FL LIC. # 55225

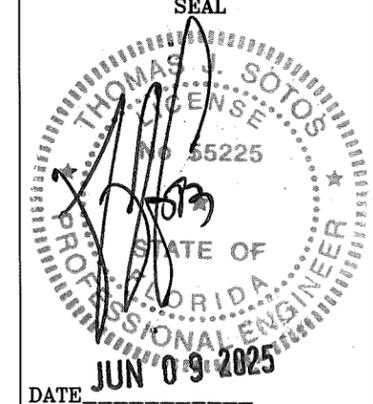

DATE: JUN 09 2025
SHEET DESCRIPTION:
**CROSS SECTIONAL DETAILS
FOR STANDARD AND HEAVY
DUTY MEETING RAILS**

DRAWN BY:	DATE:
NELSON ERAZO	11/17/2023
REV. BY:	DATE:
N.E.	05/15/2025
DWG #:	REV #:
CWS-1255	A
SCALE:	SHEET
AS NOTED	2 OF 5

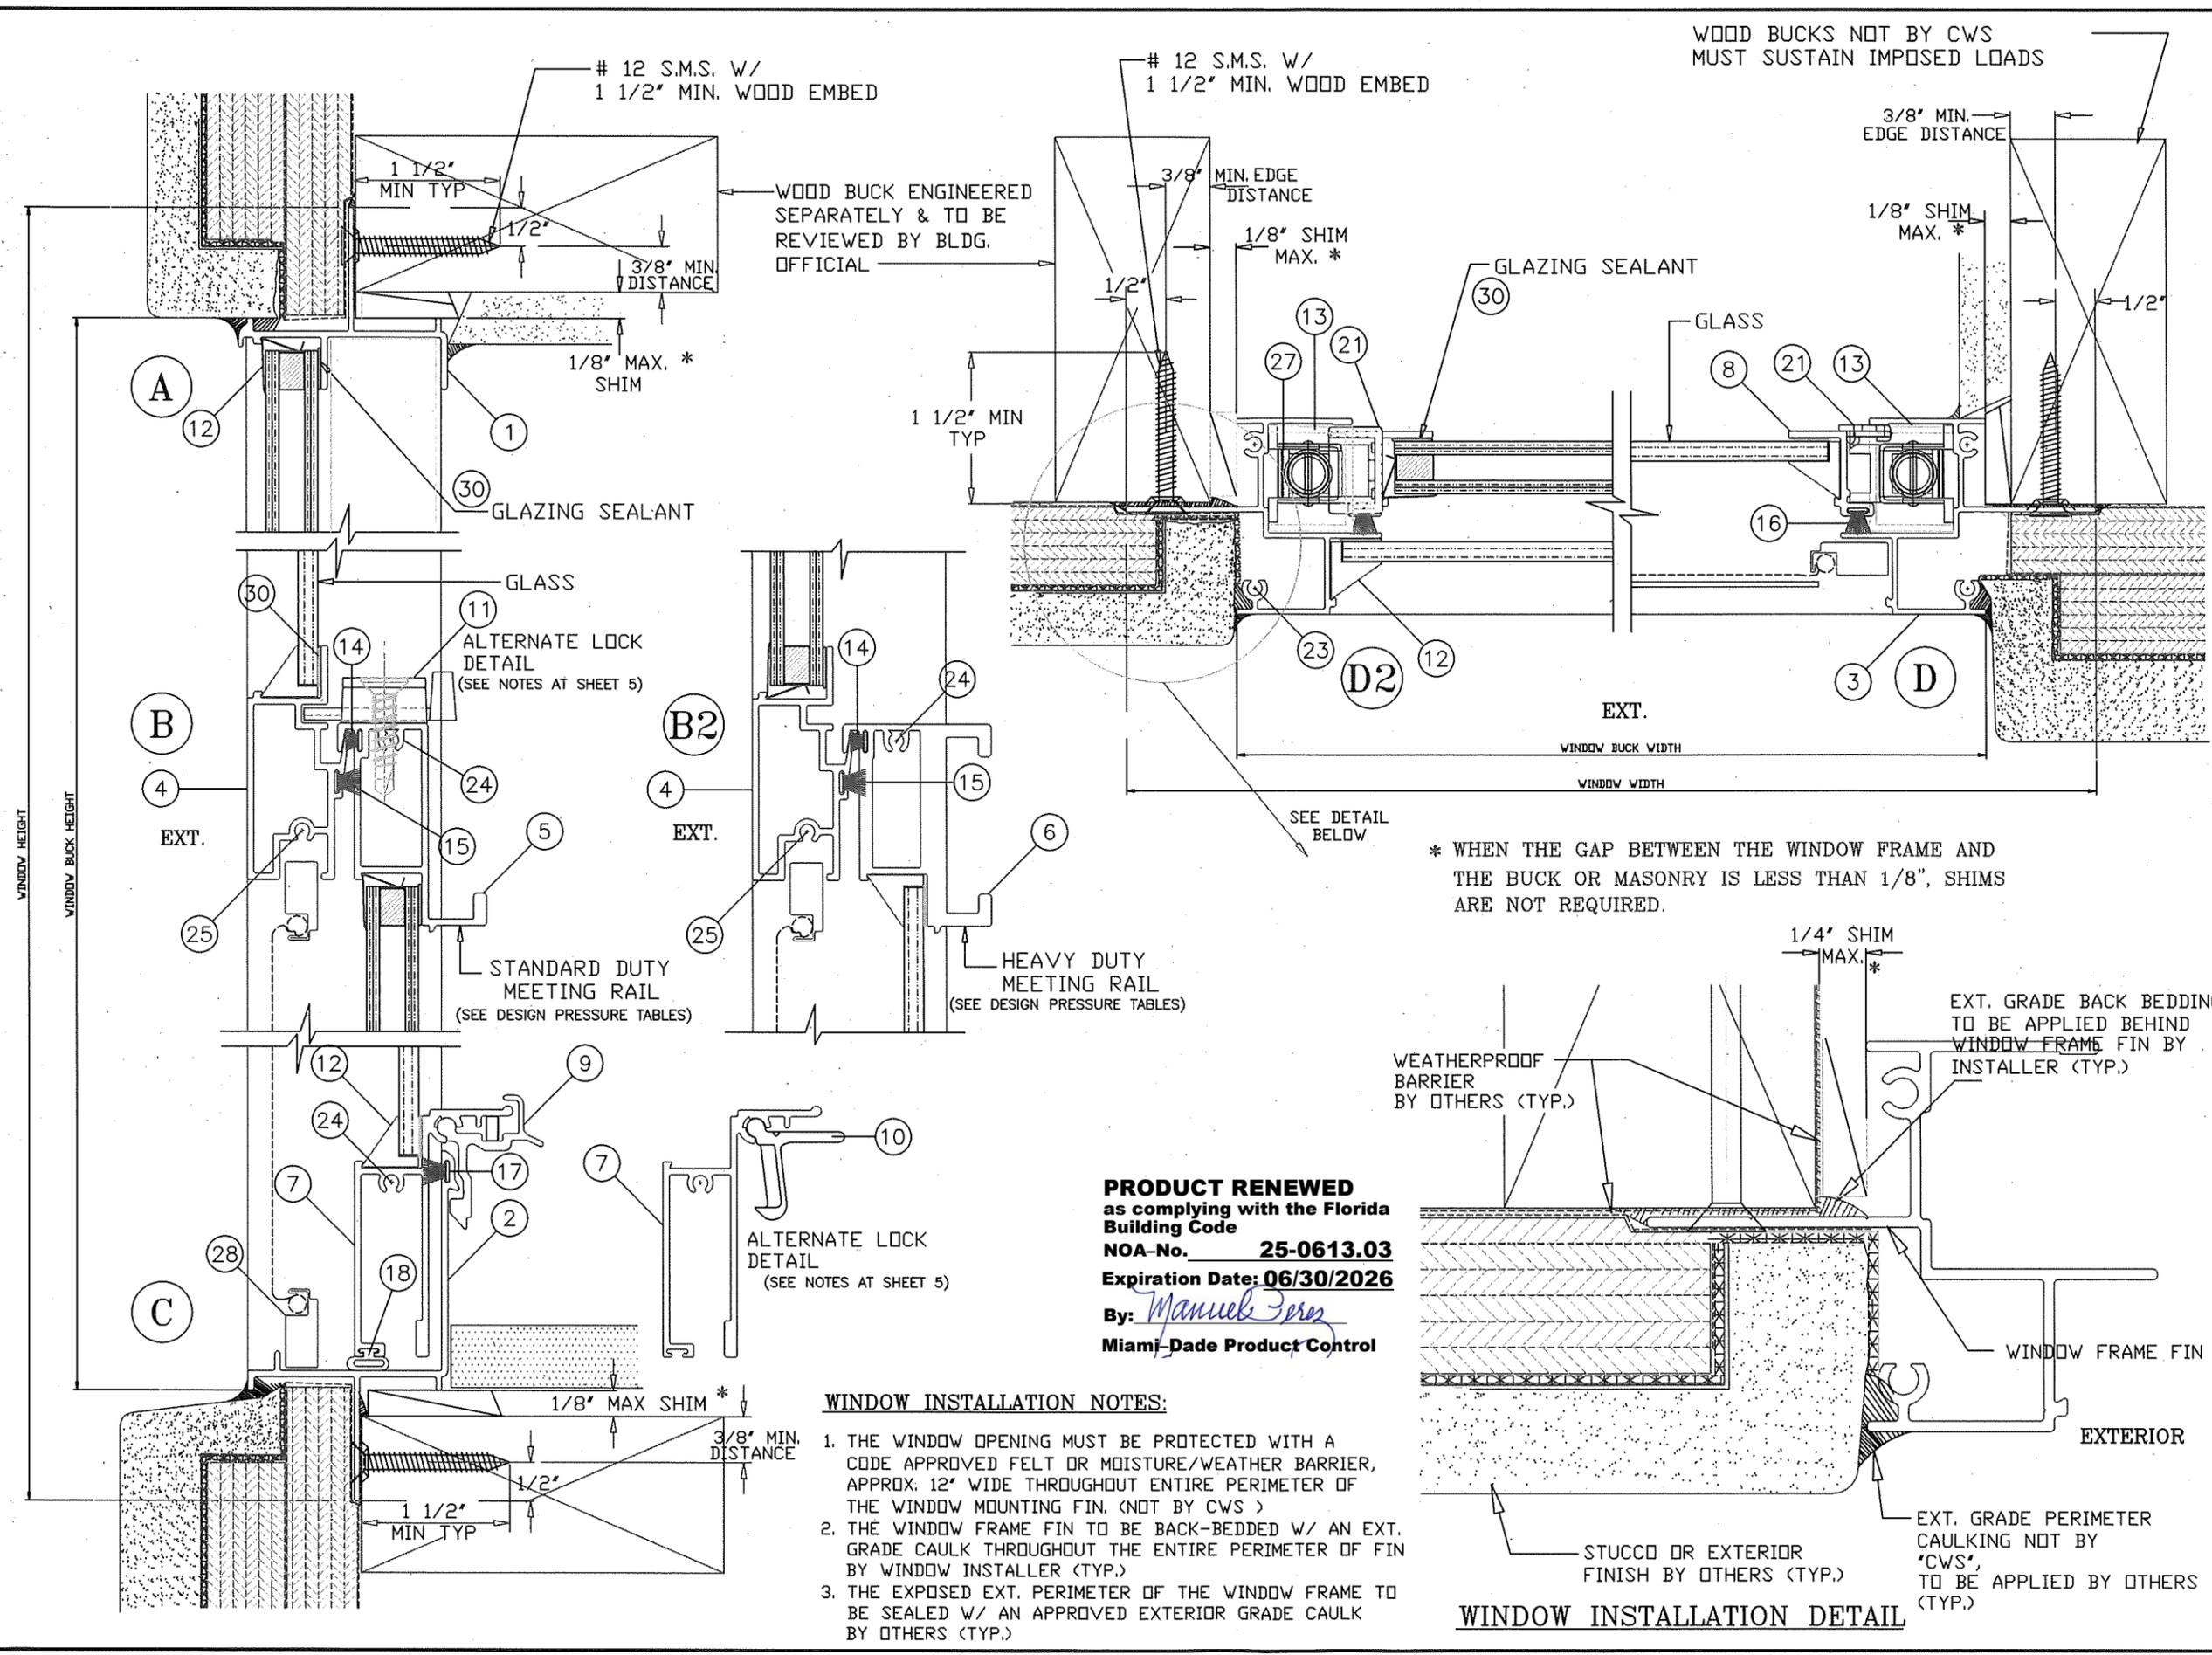

7600 Non Impact Single Hung Window Test # FTL 5284 A-1 - 1/4" Annealed Pressure Limited to Negative 100psf. Fin Frame w/ Standard Meeting Rail					
Buck Width	Buck Height	P(+) psf	P(-) psf	Each Jamb Anchors	Head & Sill Anchors
18.125	25	70.00	100.00	3	2
18.125	37.375	70.00	100.00	4	2
18.125	49.625	70.00	100.00	6	2
18.125	57	70.00	100.00	7	2
18.125	62	70.00	100.00	7	2
18.125	73.25	70.00	100.00	9	2
25.5	25	70.00	100.00	4	2
25.5	37.375	70.00	100.00	5	3
25.5	49.625	70.00	100.00	7	3
25.5	57	70.00	100.00	8	3
25.5	62	70.00	100.00	9	3
25.5	73.25	70.00	100.00	11	3
36	25	70.00	100.00	4	3
36	37.375	70.00	100.00	6	4
36	49.625	70.00	95.62	8	4
36	57	70.00	90.30	9	4
36	62	70.00	87.97	10	4
36	73.25	70.00	85.76	12	4
52.125	25	70.00	96.80	6	4
52.125	37.375	70.00	71.11	6	4
52.125	49.625	58.30	58.30	7	4
52.125	57	53.41	53.41	7	4
52.125	62	50.86	50.86	8	4
52.125	73.25	46.70	46.70	9	4

7600 Non Impact Single Hung Window Test # FTL 4344 - 1/4" Annealed Pressure Limited to Negative 100psf. Fin Frame w/ Heavy Duty Rail					
Buck Width	Buck Height	P(+) psf	P(-) psf	Each Jamb Anchors	Head & Sill Anchors
18.125	25	70.00	100.00	4	2
18.125	37.375	70.00	100.00	4	3
18.125	49.625	70.00	100.00	7	2
18.125	57	70.00	100.00	7	2
18.125	62	70.00	100.00	8	2
18.125	73.25	70.00	100.00	10	2
25.5	25	70.00	100.00	4	3
25.5	37.375	70.00	100.00	6	3
25.5	49.625	70.00	100.00	8	3
25.5	57	70.00	100.00	8	3
25.5	62	70.00	100.00	10	3
25.5	73.25	70.00	100.00	12	3
36	25	70.00	100.00	4	4
36	37.375	70.00	100.00	7	4
36	49.625	70.00	100.00	10	6
36	57	70.00	100.00	11	6
36	62	70.00	100.00	12	6
36	73.25	70.00	86.00	12	4
52.125	25	70.00	100.00	6	6
52.125	37.375	70.00	100.00	8	7
52.125	49.625	70.00	93.00	11	7
52.125	57	70.00	74.90	10	7
52.125	62	66.10	66.10	11	6
52.125	73.25	57.70	57.70	11	6

7600 Non Impact Single Hung Window Test # FTL 4406 - 3/16" Annealed Pressure Limited to Negative 100psf. Fin Frame w/ Standard Duty Rail					
Buck Width	Buck Height	P(+) psf	P(-) psf	Each Jamb Anchors	Head & Sill Anchors
18.125	25	70.00	100.00	4	2
18.125	37.375	70.00	100.00	4	3
18.125	49.625	70.00	100.00	7	2
18.125	57	70.00	100.00	7	2
18.125	62	70.00	100.00	8	2
18.125	73.25	70.00	100.00	10	2
25.5	25	70.00	100.00	4	3
25.5	37.375	70.00	100.00	6	3
25.5	49.625	70.00	100.00	8	3
25.5	57	70.00	100.00	8	3
25.5	62	70.00	100.00	10	3
25.5	73.25	70.00	89.80	11	3
36	25	70.00	100.00	4	4
36	37.375	70.00	100.00	7	4
36	49.625	70.00	93.30	8	4
36	57	70.00	82.00	8	4
36	62	70.00	77.20	10	4
36	73.25	66.80	66.80	10	4
52.125	25	70.00	100.00	6	6
52.125	37.375	70.00	76.13	7	6
52.125	49.625	62.42	62.42	8	6
52.125	57	52.70	52.70	8	4
52.125	62	49.90	49.90	8	4
52.125	73.25	45.80	45.80	10	4

7600 Non Impact Single Hung Window Test # FTL 4324 - 3/16" Tempered Pressure Limited to Negative 100psf. Fin Frame w/ Heavy Duty Rail					
Buck Width	Buck Height	P(+) psf	P(-) psf	Each Jamb Anchors	Head & Sill Anchors
18.125	25	70	100.00	4	2
18.125	37.375	70.00	100.00	4	3
18.125	49.625	70.00	100.00	7	2
18.125	57	70.00	100.00	7	2
18.125	62	70.00	100.00	8	2
18.125	73.25	70.00	100.00	10	2
25.5	25	70.00	100.00	4	3
25.5	37.375	70.00	100.00	6	3
25.5	49.625	70.00	100.00	8	3
25.5	57	70.00	100.00	8	3
25.5	62	70.00	100.00	10	3
25.5	73.25	70.00	100.00	12	3
36	25	70.00	100.00	4	4
36	37.375	70.00	100.00	7	4
36	49.625	70.00	100.00	10	6
36	57	70.00	100.00	11	6
36	62	70.00	100.00	12	6
36	73.25	70.00	100.00	15	6
52.125	25	70.00	100.00	6	6
52.125	37.375	70.00	100.00	8	7
52.125	49.625	70.00	99.87	12	7
52.125	57	70.00	91.49	12	7
52.125	62	70.00	87.12	14	7
52.125	73.25	70.00	80.00	15	7

7600 Non Impact Single Hung View Window Test # FTL 4363 - 3/16" Annealed View Fin Frame w/ Heavy Duty Rail TABLE V-1						
CODE SIZE	Buck Width	Buck Height	P(+) psf	P(-) psf	Each Jamb Anchors	Head & Sill Anchors
14 - 2	18.125	49.625	70.0	100.0	8	3
14 - 3	18.125	49.625	70.0	100.0	10	3
15 - 3	18.125	62	70.0	100.0	10	3
15 - 4	18.125	62	70.0	100.0	11	3
16 - 4	18.125	73.25	70.0	100.0	11	3
16 - 45	18.125	73.25	70.0	100.0	11	3
16 - 5	18.125	73.25	70.0	100.0	12	3
H34 - 2	25.5	49.625	70.0	84.5	7	3
H34 - 3	25.5	49.625	70.0	104.0	8	3
H35 - 3	25.5	62	70.0	72.4	7	3
H35 - 4	25.5	62	70.0	84.5	8	3
H36 - 4	25.5	73.25	64.4	64.4	8	3
H36 - 45	25.5	73.25	70.0	70.2	8	3
H36 - 5	25.5	73.25	70.0	74.2	10	3
24 - 2	36	49.625	63.8	63.8	7	3
24 - 3	36	49.625	70.0	75.2	7	3
25 - 3	36	62	55.2	55.2	7	3
25 - 4	36	62	63.8	63.8	8	3
26 - 4	36	73.25	49.1	49.1	7	3
26 - 45	36	73.25	53.3	53.3	8	3
26 - 5	36	73.25	56.6	56.6	8	3
34 - 2	52.125	49.625	44.6	44.6	6	3
34 - 3	52.125	49.625	49.0	49.0	7	3
35 - 3	52.125	62	41.5	41.5	7	3
35 - 4	52.125	62	44.6	44.6	7	4
36 - 4	52.125	73.25	39.0	39.0	8	3
36 - 45	52.125	73.25	40.8	40.8	8	4
36 - 5	52.125	73.25	42.2	42.2	8	4

7600 Non Impact Single Hung View Window Test # FTL 4345 - 3/16" Tempered View Pressure Limited to Negative 100psf. Fin Frame w/ Heavy Duty Rail - TABLE V-2						
Buck Width	Buck Height	P(+) psf	P(-) psf	Each Jamb Anchors	Head & Sill Anchors	
14 - 3	18.125	49.625	70.0	100.0	7	2
15 - 3	18.125	62	70.0	100.0	8	2
15 - 4	18.125	62	70.0	100.0	8	2
16 - 4	18.125	73.25	70.0	100.0	10	2
16 - 45	18.125	73.25	70.0	100.0	10	2
16 - 5	18.125	73.25	70.0	100.0	10	2
H34 - 2	25.5	49.625	70.0	100.0	8	3
H34 - 3	25.5	49.625	70.0	100.0	8	3
H35 - 3	25.5	62	70.0	100.0	10	3
H35 - 4	25.5	62	70.0	100.0	10	3
H36 - 4	25.5	73.25	70.0	100.0	12	3
H36 - 45	25.5	73.25	70.0	100.0	12	3
H36 - 5	25.5	73.25	70.0	100.0	12	3
24 - 2	36	49.625	70.0	100.0	10	3
24 - 3	36	49.625	70.0	100.0	10	4
25 - 3	36	62	70.0	100.0	12	4
25 - 4	36	62	70.0	100.0	12	6
26 - 4	36	73.25	70.0	100.0	15	4
26 - 45	36	73.25	70.0	100.0	15	6
26 - 5	36	73.25	70.0	100.0	15	6
34 - 2	52.125	49.625	70.0	100.0	12	4
34 - 3	52.125	49.625	70.0	100.0	12	6
35 - 3	52.125	62	70.0	92.9	15	6
35 - 4	52.125	62	70.0	87.6	14	7
36 - 4	52.125	73.25	70.0	84.1	16	7
36 - 45	52.125	73.25	70.0	81.3	15	7
36 - 5	52.125	73.25	70.0	80.0	15	7

PRODUCT RENEWED

as complying with the Florida Building Code

NOA-No. **25-0613.03**

Expiration Date: **06/30/2026**

By: *Manuel Perez*

Miami-Dade Product Control




1900 SW 44TH AVE.
OCALA, FLORIDA 34474
WWW.CWS.CC

**CWS 310 SINGLE HUNG
ALUMINUM FIN FRAME
NON-IMPACT WINDOW**
















NO.	DESCRIPTION	BY	DATE
A	Revises NOA # 23-1017.07	N.E.	05/15/25

**THOMAS J. SOTOS
PROFESSIONAL ENGINEER
FL LIC. # 55225**

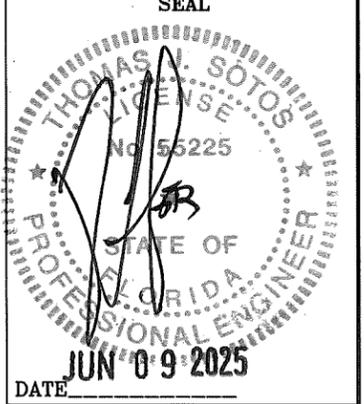



DATE: JUN 09 2025
SHEET DESCRIPTION:
**DESIGN LOAD CHARTS W/
MONOLITHIC GLASS**

DRAWN BY:	DATE:
NELSON ERAZO	11/17/2023
REV. BY:	DATE:
N.E.	05/15/2025
DWG #:	REV #:
CWS-1255	A
SCALE:	SHEET
AS NOTED	3 OF 5

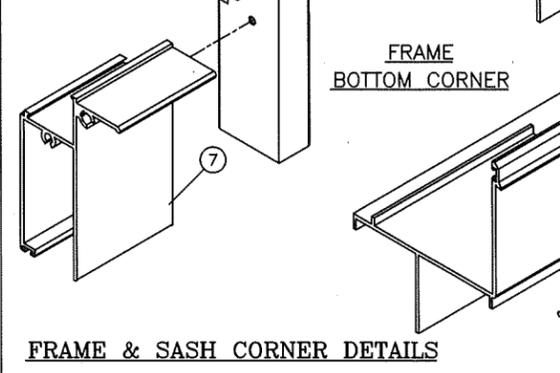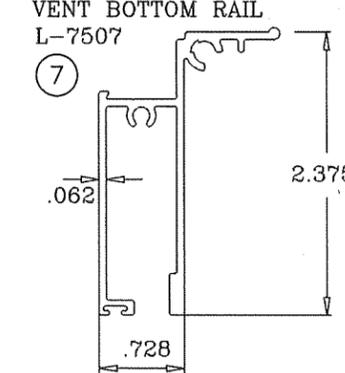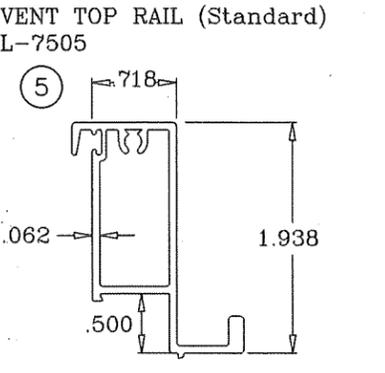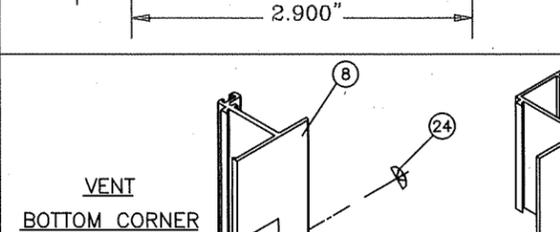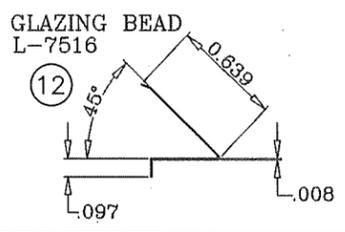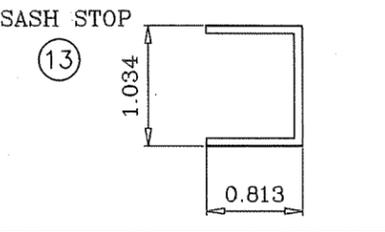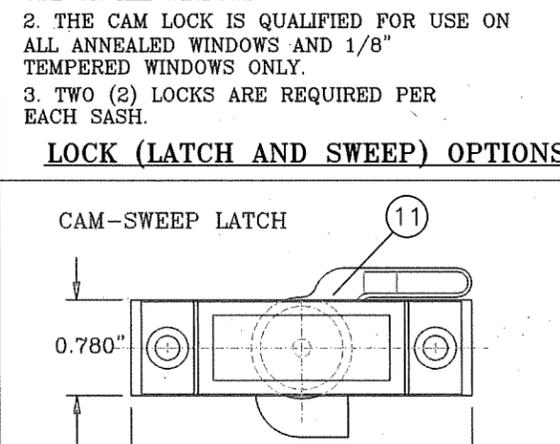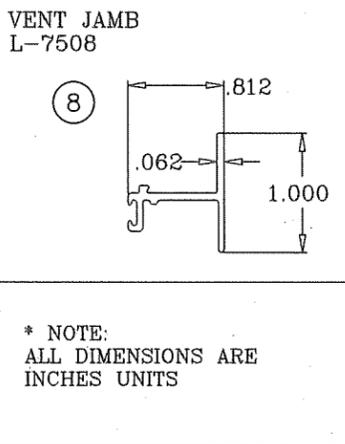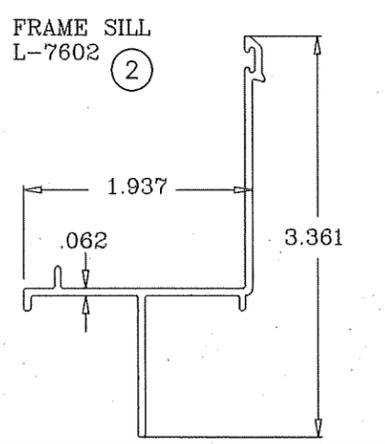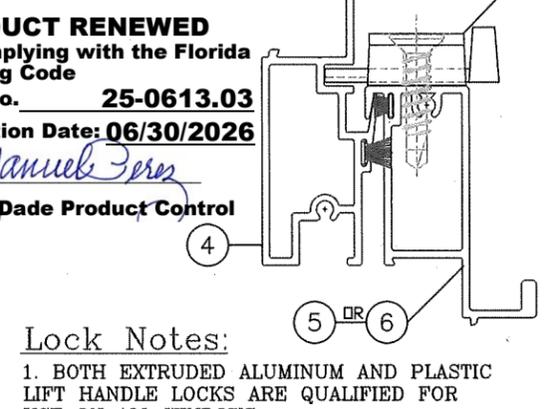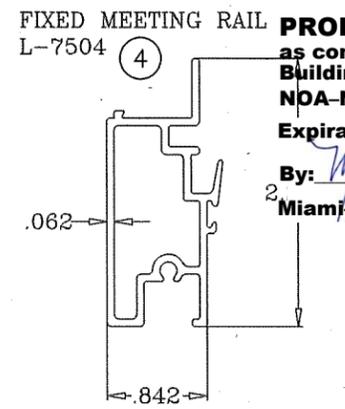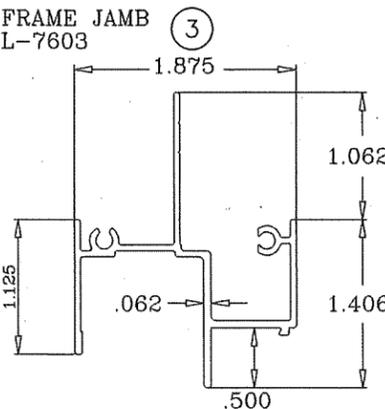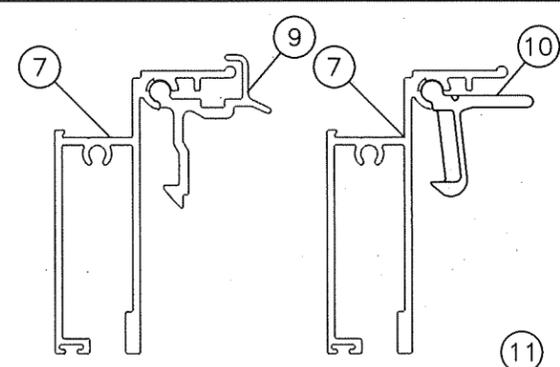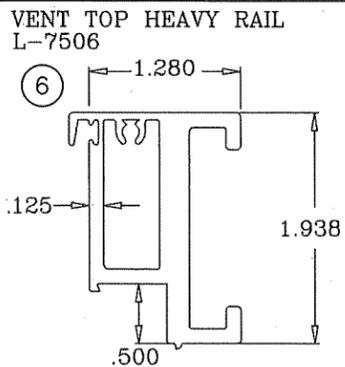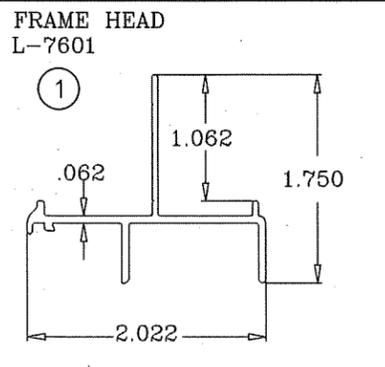



PRODUCT RENEWED
 as complying with the Florida Building Code
 NOA-No. **25-0613.03**
 Expiration Date: **06/30/2026**
 By: *Manuel Fern*
 Miami-Dade Product Control

Lock Notes:
 1. BOTH EXTRUDED ALUMINUM AND PLASTIC LIFT HANDLE LOCKS ARE QUALIFIED FOR USE ON ALL WINDOWS.
 2. THE CAM LOCK IS QUALIFIED FOR USE ON ALL ANNEALED WINDOWS AND 1/8" TEMPERED WINDOWS ONLY.
 3. TWO (2) LOCKS ARE REQUIRED PER EACH SASH.

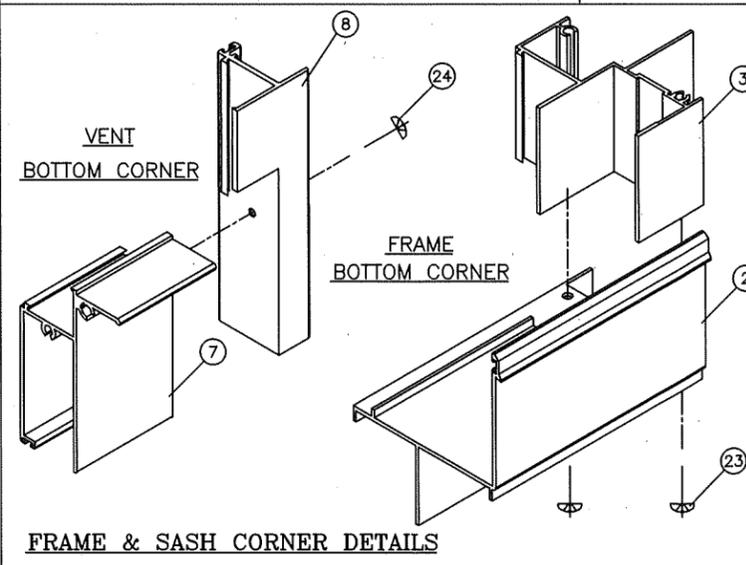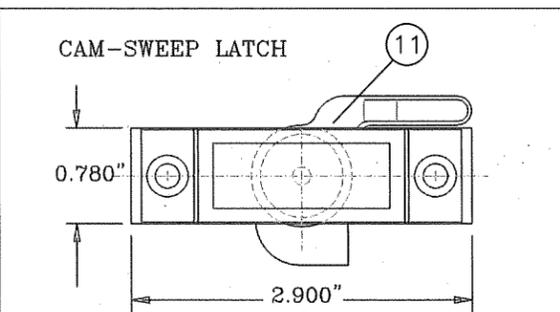

CWS 310 FIN WINDOW BILL OF MATERIALS

ITEM #	PART #	DRWG. #	REQD.	DESCRIPTION	REMARKS
1	L-7601	LII-123	1	FRAME HEAD	6063-T6 ALUMINUM
2	L-7602	LII-122	1	FRAME SILL	6063-T6 ALUMINUM
3	L-7603	LII-128	2	FRAME JAMB	6063-T6 ALUMINUM
4	L-7504	LII-129	1	FIXED MEETING RAIL	6005-T5 ALUMINUM
5	L-7505	LII-125	1	VENT TOP RAIL STD. DUTY	6005-T5 ALUMINUM
6	L-7506	LII-126	1	VENT TOP RAIL HVY DUTY	6005-T5 ALUMINUM
7	L-7507	LII-136	1	VENT BOTTOM RAIL	6005-T5 ALUMINUM
8	L-7508	LII-124	1	VENT JAMB	6063-T5 ALUMINUM
9	*	*	2	VENT LATCH / LIFT LOCK	6063-T6 ALUMINUM
10	*	*	2	VENT LATCH / LIFT LOCK	INJECTED MOLDED
11	*	*	2	VENT LATCH / SWEEP	DIE CAST
12	*	*	AS REQD.	GLAZING BEAD	ROLL FORMED ALUMINUM
13	*	*	2	VENT/SASH STOP	Rigid Vinyl PVC
14	*	SCHLEGEL	AS REQD.	TOP RAIL WEATHERSTRIP	.187" X 150' PILE
15	*	ULTRAFAB	AS REQD.	FXD. RAIL WEATHERSTRIP	.187" X 250' FIN SEAL
16	*	ULTRAFAB	AS REQD.	VENT JAMB WEATHERSTRIP	.187" X .280' FIN SEAL
17	*	ULTRAFAB	AS REQD.	FRAME SILL WEATHERSTRIP	.187" X .250' FIN SEAL
18	*	*	AS REQ'D.	BOTT. RAIL WEATHERSTRIP	3/8" DIA. BULB
19	*	*	2	VENT/SILL OPEN CELL PAD	1"x1"x1/2" FOAM PAD
20	*	*	2	SILL/JAMB JOINT GASKET	1/16" CLOSED CELL FOAM
21	L-7523	*	2	VENT TOP GUIDE / CAM	1 AT EACH END OF RAIL
22	L-7524	HC-033	4	VENT JAMB FACE GUIDE	2 PER VENT JAMB
23	*	*	8	FRAME ASSEMBLY SCREWS	# 8 X 1" P.H. SQ. RECESS
24	*	*	4	VENT ASSEMBLY SCREWS	# 8 X 1" P.H. SQ. RECESS
25	*	*	2	FXD. MTG. RAIL SCREW	# 8 X 1" P.H. SQ. RECESS
26	*	*	14	FRAME INSTALL'N SCREW	#10 X 1 1/4" F.H. / PHI.
27	L-7527	*	2	BLOCK & TACKLE BALANCE	1 PER JAMB
28	*	*	1	INSECT. SCREEN	OPTIONAL
29	*	*	2	GLASS @ TOP & BOTTOM	See Detail @ Sheet 2 of 5
30	*	*	AS REQ'D	GLAZING SILICONE	See Detail @ Sheet 2 of 5
31 a	Truseal	774-25B-767	AS REQ'D	Insulated Swiggle Spacer	Black -1/4" air space
31 b	Quanex	*	AS REQ'D	Insulated SuperSpacer	Black -1/4" air space
31 c	Quanex	*	AS REQ'D	Insulated Duraseal Spacer	Black -1/4" air space

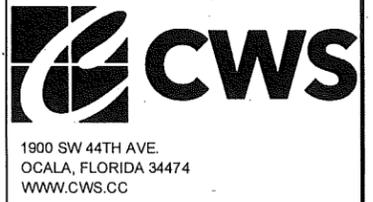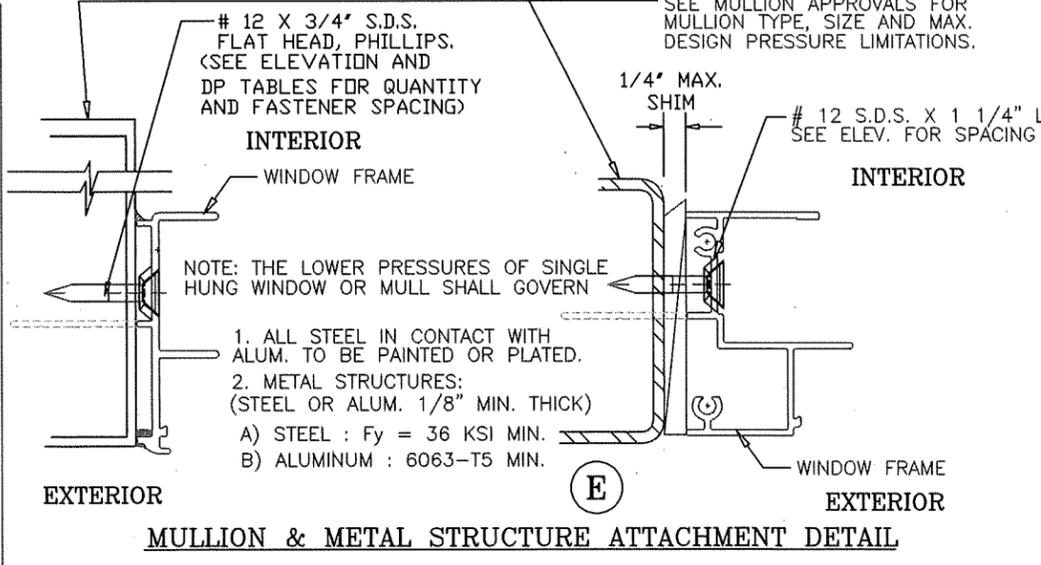

CWS 310 SINGLE HUNG ALUMINUM FIN FRAME NON-IMPACT WINDOW

NO.	DESCRIPTION	BY	DATE
A	Revises NOA # 23-1017.07	N.E.	05/15/25

THOMAS J. SOTOS
 PROFESSIONAL ENGINEER
 FL LIC. # 55225

SEAL

DATE **JUN 09 2025**

SHEET DESCRIPTION:
BILL OF MATERIALS, EXTRUSION DETAILS, ASSEMBLY DETAILS, AND GLAZING DETAILS

DRAWN BY:	DATE:
NELSON ERAZO	11/17/2023
REV. BY:	DATE:
N.E.	05/15/2025
DWG #:	REV #:
CWS-1255	A
SCALE:	SHEET
AS NOTED	5 OF 5