



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599

www.miamidade.gov/economy

NOTICE OF ACCEPTANCE (NOA)

American Panel Corporation
5800 S.E. 78th Street
Ocala, Florida 34472

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Walk-In Cooler / Freezer

APPROVAL DOCUMENT: Drawing No. KC25-0122, titled "Walk-In Cooler / Freezer", sheets 1 through 5 of 5, prepared by Knezevich Consulting, LLC, dated July 02, 2025, last revision #0 dated July 02, 2025, signed and sealed by J. W. Knezevich, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and the expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and the following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA #23-1107.06 and consists of this page 1, evidence submitted pages E-1, E-2, E-3, E-4 & E-5 as well as approval document mentioned above.

The submitted documentation was reviewed by **Helmy A. Makar, P.E., M.S.**



Helmy A. Makar
08/14/25

NOA No. 25-0708.01
Expiration Date: 08/30/2027
Approval Date: 08/14/2025
Page 1

American Panel Corporation

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 07-0301.04

A. DRAWINGS

1. *Drawing No. 06-541, titled "Walk-In Cooler / Freezer", sheets 1 through 5 of 5, prepared by Thornton Tomasetti, dated February 15, 2007, last revision #1 dated July 17, 2007, signed and sealed by J. W. Knezevich, P.E.*

B. TESTS

1. *Test report on Uniform Static air Pressure Test, Large Missile Impact Test, Cyclic Load Test, and Racking Load Test on Galvanized Steel Sheathed Polyurethane Foam Filled Modular Panel Walk-in Coolers / Freezers, prepared by Construction Testing Corporation, Report No. 06-018, dated 01/15/2007, signed and sealed by Yamil Kuri, P.E.*

C. CALCULATIONS

1. *Calculation titled "Walk-In Cooler/Freezer Calculations", dated February 15, 2007, sheets 1 through 22 of 22, prepared by Thornton Tomasetti, signed and sealed by J. W. Knezevich, P.E.*

D. QUALITY ASSURANCE

1. *By Miami-Dade County Building Code Compliance Office.*

E. MATERIAL CERTIFICATIONS

1. *Tensile Test by Certified Testing Laboratories, Report # 198, dated 01/05/07, signed and sealed by Ramesh Patel, P.E.*

2. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 12-0516.18

A. DRAWINGS

1. *Drawing No. 12-APC-01, titled "Walk-In Cooler / Freezer", sheets 1 through 5 of 5, prepared by Knezevich Consulting, LLC, dated May 14, 2012, signed and sealed by J. W. Knezevich, P.E., on May 14, 2012.*

B. TESTS

1. *None.*

C. CALCULATIONS

1. *None.*

D. QUALITY ASSURANCE

1. *By Miami-Dade County Department of Regulatory and Economic Resources.*

E. MATERIAL CERTIFICATIONS

1. *None.*



Helmy A. Makar, P.E., M.S.
Product Control Section Supervisor
NOA No. 25-0708.01
Expiration Date: 08/30/2027
Approval Date: 08/14/2025

American Panel Corporation

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

3. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 15-0629.08

A. DRAWINGS

1. *Drawing No. KC15-0405, titled "Walk-In Cooler / Freezer", sheets 1 through 5 of 5, prepared by Knezevich Consulting, LLC, dated June 24, 2015, signed and sealed by J. W. Knezevich, P.E., on June 24, 2015.*

B. TESTS

1. *None.*

C. CALCULATIONS

1. *None.*

D. QUALITY ASSURANCE

1. *By Miami-Dade County Department of Regulatory and Economic Resources.*

E. MATERIAL CERTIFICATIONS

1. *None.*

4. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 17-0413.05

A. DRAWINGS

1. *Drawing No. KC15-0405, titled "Walk-In Cooler / Freezer", sheets 1 through 5 of 5, prepared by Knezevich Consulting, LLC, dated 06/24/2015, revision #1 dated 04/07/2017, signed and sealed by J. W. Knezevich, P.E., on 04/10/2017.*

B. TESTS

1. *None.*

C. CALCULATIONS

1. *None.*

D. QUALITY ASSURANCE

1. *By Miami-Dade County Department of Regulatory and Economic Resources.*

E. MATERIAL CERTIFICATIONS

1. *None.*


5. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 17-0724.08

A. DRAWINGS

1. *Drawing No. KC17-0714, titled "Walk-In Cooler / Freezer", sheets 1 through 5 of 5, prepared by Knezevich Consulting, LLC, dated July 17, 2017, signed and sealed by J. W. Knezevich, P.E., on July 17, 2017.*

B. TESTS

1. *None.*



Helmy A. Makar, P.E., M.S.
Product Control Section Supervisor
NOA No. 25-0708.01
Expiration Date: 08/30/2027
Approval Date: 08/14/2025

American Panel Corporation

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

C. CALCULATIONS

1. *None.*

D. QUALITY ASSURANCE

1. *By Miami-Dade County Department of Regulatory and Economic Resources.*

E. MATERIAL CERTIFICATIONS

1. *None.*

F. STATEMENTS

1. *Florida Building Code, 2017 Edition compliance letter issued by Knezevich Consulting, LLC, dated July 17, 2017, signed and sealed by J. W. Knezevich, P.E.*

6. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 20-0811.20

A. DRAWINGS

1. *Drawing No. KC20-0722, titled "Walk-In Cooler / Freezer", sheets 1 through 5 of 5, prepared by Knezevich Consulting, LLC, dated July 21, 2020, last revision #1 dated August 27, 2020, signed and sealed by J. W. Knezevich, P.E.*

B. TESTS

1. *None.*

C. CALCULATIONS

1. *None.*

D. QUALITY ASSURANCE

1. *By Miami-Dade County Department of Regulatory and Economic Resources.*

E. MATERIAL CERTIFICATIONS

1. *None.*

F. STATEMENTS

1. *FBC, 2017 & 2020 Editions compliance letter issued by Knezevich Consulting, LLC, dated August 27, 2020, signed and sealed by J. W. Knezevich, P.E.*

7. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 22-0602.03

A. DRAWINGS

1. *None.*

B. TESTS

1. *None.*

C. CALCULATIONS

1. *None.*



Helmy A. Makar, P.E., M.S.
Product Control Section Supervisor
NOA No. 25-0708.01
Expiration Date: 08/30/2027
Approval Date: 08/14/2025

American Panel Corporation

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

D. QUALITY ASSURANCE

1. *By Miami-Dade County Department of Regulatory and Economic Resources.*

E. MATERIAL CERTIFICATIONS

1. *None.*

F. STATEMENTS

1. *FBC, 2017 & 2020 Editions compliance letter issued by Knezevich Consulting, LLC, dated August 27, 2020, signed and sealed by J. W. Knezevich, P.E.*

8. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 23-1107.06

A. DRAWINGS

1. *Drawing No. KC23-0912, titled "Walk-In Cooler / Freezer", sheets 1 through 5 of 5, prepared by Knezevich Consulting, LLC, dated October 31, 2023, last revision #0 dated October 31, 2023, signed and sealed by J. W. Knezevich, P.E.*

B. TESTS

1. *None.*

C. CALCULATIONS

1. *None.*

D. QUALITY ASSURANCE

1. *By Miami-Dade County Department of Regulatory and Economic Resources.*

E. MATERIAL CERTIFICATIONS

1. *None.*

F. STATEMENTS

1. *FBC 2023, 8th Edition Compliance letter issued by Knezevich Consulting, LLC, dated October 31, 2023, signed and sealed by J. W. Knezevich, P.E.*

9. NEW EVIDENCE SUBMITTED

A. DRAWINGS

1. *Drawing No. KC25-0122, titled "Walk-In Cooler / Freezer", sheets 1 through 5 of 5, prepared by Knezevich Consulting, LLC, dated July 02, 2025, last revision #0 dated July 02, 2025, signed and sealed by J. W. Knezevich, P.E.*

B. TESTS

1. *Test report on TAS 202 Uniform Static air Pressure Test, Negative structural load only on Wall Panel Ceiling Stub Floor Screed, prepared by ATL, Report No. 0328.01-24, dated 10/17/2024, signed and sealed by Stephen Warter, P.E.*



Helmy A. Makar, P.E., M.S.
Product Control Section Supervisor
NOA No. 25-0708.01
Expiration Date: 08/30/2027
Approval Date: 08/14/2025

American Panel Corporation

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

2. *Test report on Uniform Static air Pressure Test, Large Missile Impact Test, Cyclic Load Test, and Racking Load Test on Galvanized Steel Sheathed Polyurethane Foam Filled Modular Panel Walk-in Coolers / Freezers, prepared by Construction Testing Corporation, Report No. 7593-24, dated 03/02/2025, signed and sealed by Yamil Kuri, P.E., on 07/04/25.*

C. CALCULATIONS

1. *Calculation titled "Walk-In Cooler/Freezer Calculations", dated July 02, 2025, sheets 1 through 29 of 29, prepared by Knezevich Consulting, LLC, signed and sealed by J. W. Knezevich, P.E.*

D. QUALITY ASSURANCE


1. *By Miami-Dade County Department of Regulatory and Economic Resources.*

E. MATERIAL CERTIFICATIONS

1. *None.*

F. STATEMENTS

1. *FBC 2023, 8th Edition Compliance letter issued by Knezevich Consulting, LLC, dated July 02, 2025, signed and sealed by J. W. Knezevich, P.E.*




Helmy A. Makar, P.E., M.S.
Product Control Section Supervisor
NOA No. 25-0708.01
Expiration Date: 08/30/2027
Approval Date: 08/14/2025

General Notes:


1. This Product Evaluation Document (PED) represents a Walk-In Cooler/Freezer system analyzed with the provisions set for the issuance of a Notice of Acceptance (NOA) by the Miami-Dade Department of Regulatory and Economic Resources, Product Control Section. This document complies with the 8th Edition (2023) Florida Building Code, Building (FBC), High Velocity Hurricane Zone (HVHZ) provisions.
2. For areas outside of the HVHZ, site specific engineering is required to verify the site specific design wind loads and panel testing comply with the testing requirement of FBC Section 1709.3
3. This PED addresses the structural requirements for compliance with the structural portions of the noted codes. Architectural, fire protection, mechanical, electrical and waterproofing requirements are not part of the evaluation. Specific use of this PED requires the Architect or Engineer of Record to address the architectural, fire protection, mechanical, electrical, and waterproofing requirements for the installation.
4. Design Loads:
- A. Roof:
- A.1. Dead Load: Roof Panel RP1: 6.5 psf; RP3: 8.5 psf
- A.2. Live Load: 30 psf
- A.3. Mechanical Equipment: 330 lbs Maximum per condensing unit.
Space units at least 4'-0" o.c.
- B. Walls:
- B.1. Dead Load: Wall Panel 2.6 psf
- C. Floors:
- C.1. Dead Load: Floor Panel 4 psf
- C.2. Live Load: Insulated Floor 250 psf
- D. Wind loads shall be determined in accordance with the code provisions at the time of permit based on the site specific conditions. See Tables 2 & 3 on Sheet 2 for ASD wind load and force limitations to be used in the design of a specific cooler layout. These ASD loads and forces are based on wind load resistance testing. Wind loads determined in accordance with FBC Section 1620 and ASCE 7-22 shall be multiplied by the ASD load factor of 0.6 for comparison with the allowable loads on these documents.
5. This PED is generic and does not include information prepared for a specific site. Neither Knezevich Consulting, LLC nor John W. Knezevich, PE are, in any way, the Designer of Record for any project on which this PED is used for permitting or design guidance unless retained specifically for that purpose.
6. This PED represents the structural and material properties of the Walk-In Cooler/Freezer components. This PED shall not be applied by the Contractor on a specific site without the involvement of an Architect or Engineer of Record (A/E of Record). The A/E of Record shall be responsible for compliance with the code requirements of a specific installation including but not limited to the following:
- A. Verify the site specific wind load requirements are within the criteria used to develop this PED and the unit is configured in compliance with the limitations herein.
- B. Verify the foundation design is adequate to resist the foundation loads identified in Table 1.
- C. Verify the existing building is adequate to resist the superimposed loads identified in Table 1.
- D. Weather protection, architectural, fire protection, mechanical, and electrical requirements are outside the scope of these documents. Determine and/or provide for compliance with the requirements of the Authority Having Jurisdiction.
7. Any modifications or additions to this PED will void the PED.
8. When the site conditions deviate from this PED, the Building Official shall require that a one-time site specific approval be applied for and secured from the Miami-Dade County Department of Regulatory and Ecomimic Resources, Product Control Section.
9. All bolts and screws shall be 2024-T4 aluminum alloy, electro-galvanized steel, hot dipped galvanized steel or 300 series stainless steel with a min. tensile strength of 60 ksi.
10. Concrete anchors shall be as specified on the drawings and are for use in uncracked concrete only with a min f'c = 3.5 ksi and a min. 3" edge distance, u.o.n. Embedment lengths noted on the drawings shall not include finish material. Install in accordance with anchor manufacturer's instructions.
11. An allowable stress increase is not used in the design of the cooler/freezer components nor its attachments.
12. Dissimilar metals in contact with aluminum shall be protected in accordance with the Aluminum Design Manual, 2020, Chapter M.7.

Rigid Urethane Foam Sandwich Panel Specifications:

1. Wall & roof composite sandwich panels are comprised of aluminum or steel facings with urethane foam cores. Thickness and material of facings shall be as shown on the drawings.
2. Aluminum facings on wall and roof panels shall be 3105-H254 alloy (min. Fy=26.7 ksi) for interior and exterior use.
3. Aluminum facings on floor panels shall be 5052-H34 alloy with a minimum Fy=30.8 ksi for interior use.
4. Steel facings used on roof panels shall comply with one of the following:
- A. ASTM A653 CS, Type B with a min. Fy = 48 ksi, a G90 coating, and a min. total thickness of 0.035".
- B. ASTM A653 SS, Grade 50, Class 1, with a G90 coating and a min total thickness of 0.035".
5. Steel facings used on floor panels shall be ASTM A653 SS, Grade 33 with a G90 coating and a minimum total thickness of 0.019" for exterior use.
6. Steel inserts and accessories shall be ASTM A653 CS, Type B with a min. Fy = 33 kis and a min thickness as specified herein. Steel that is exposed or not embedded within foam shall have a G90 coating.
7. Polyurethane foam core shall be BASF Elastopor P 52490R resin / Elastopor P 1001U isocyanate rigid urethane foam system with an average in-place density of 2.3 pcf with a range of any given measurement of $\pm 10\%$.
8. Polyurethane foam core shall be as approved by UL (R-5692) with a flame spread rating of not more than 25 and a smoke developed rating of not more than 450.
9. For specific requirements of foam plastics in coolers and walk-in coolers, see FBC Section 2603.4.1.2 and 2603.4.1.3.
10. Camlock assemblies and metal facings shall be adhered to foam with an air spray coating of UPACO #1882 (3001881h) adhesive at a rate of 0.147 fluid ounces per square foot.

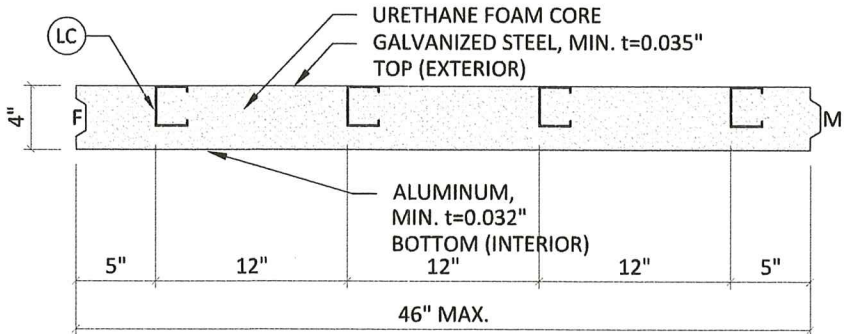


RP1 ROOF PANEL - MAX. LENGTH 11'- 7"
SCALE: 1" = 1'-0"

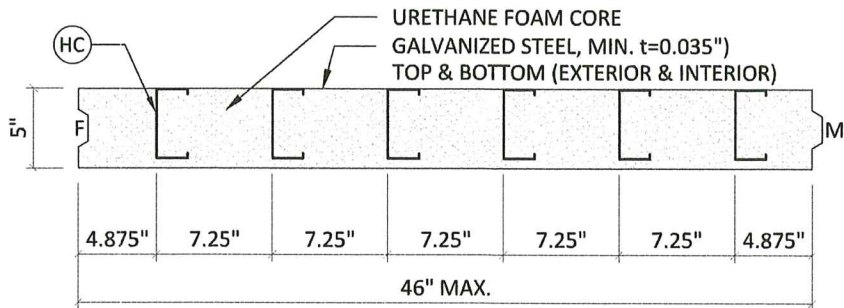


RP3 ROOF PANEL - MAX. LENGTH 15'- 5"
SCALE: 1" = 1'-0"


PRODUCT REVISED
as complying with the Florida:
Building Code
Acceptance No. 25-0708.01
Expiration Date 08/30/2027
By: [Signature]
Miami Dade Product Control

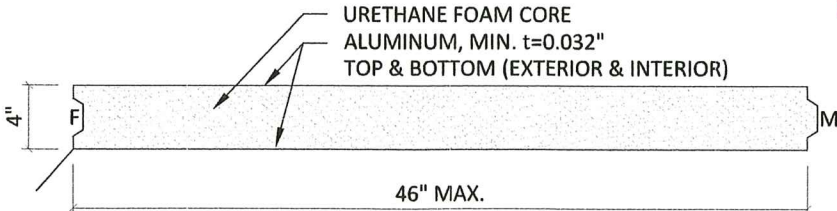


WP WALL PANEL - MAX. LENGTH 9'- 8.25"
SCALE: 1" = 1'-0" (MAX. LENGTH 10'- 0.25" W/OUT FLOOR OR SCREED)

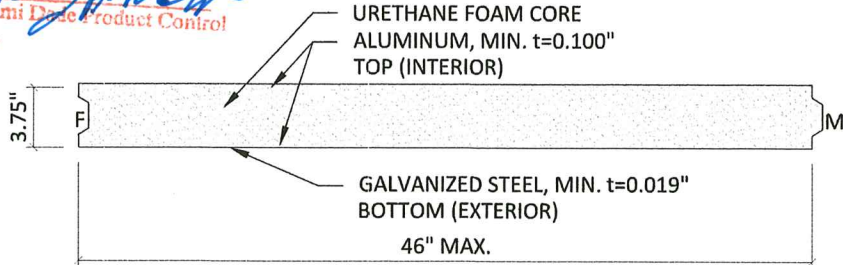


FP FLOOR PANEL - MAX. LENGTH 15'- 5"
SCALE: 1" = 1'-0"

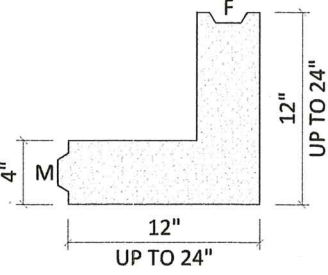

WC WALL PANEL (CORNER SECTION)
SCALE: 1" = 1'-0"

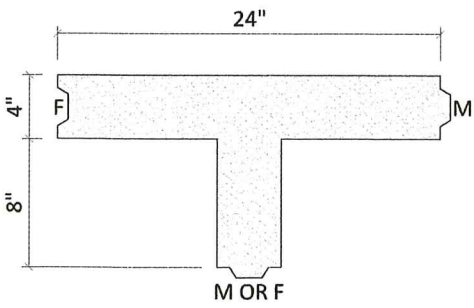

WT WALL PANEL (TEE SECTION)
SCALE: 1" = 1'-0"



FS FLOOR SCREED
SCALE: 1" = 1'-0"

KNEZEVICH CONSULTING
KNEZEVICH CONSULTING, LLC
1600 S. Federal Hwy., Suite 961
Pompano Beach, FL 33062
T 954-772-6224 * COA 27988
www.knezevich.com
Copyright © 2025 Knezevich Consulting, LLC

WALK-IN COOLER / FREEZER
American Panel Corporation
5800 S.E. 78th Street
Ocala, FL 34472
Tel: (352) 245-7055
Fax: (352) 245-0726
American Panel

Revisions		description	
no	date	by	description
1	07/02/2025	JWK	Formerly KC23-0912

Scale: AS NOTED
Drawn by: JWK
Date: 07/02/2025
J.W. Knezevich
Professional Engineer
FL License No.: PE 41961



Drawing No. **KC25-0122**
sheet 1 of 5

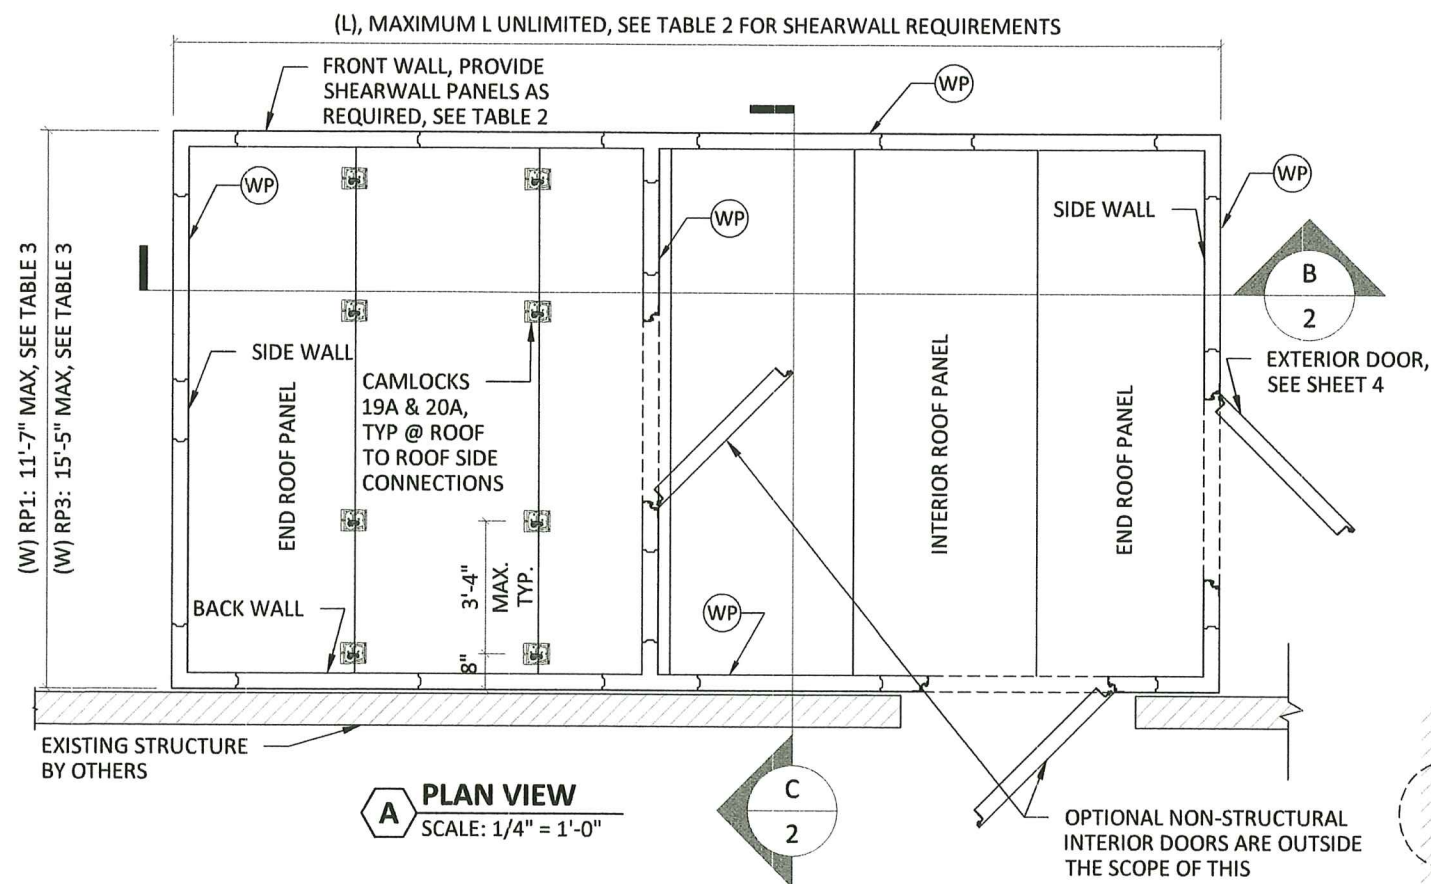


TABLE 1 NOTES:

1. Net wind forces represent the reactions from allowable stress (ASD) wind load combinations assuming maximum roof panel spans and maximum wall panel heights.
2. P_V represents the vertical wind reaction.
3. P_H represents the horizontal wind reaction.
4. P_W represents the shearwall base shear for each required panel.
5. M_W represents the shearwall base moment for each required panel.

TABLE 2 NOTES:

1. A sufficient number of 46" roof panels shall be provided to maintain the roof diaphragm moment and shear in each panel below the maximum ASD values shown here.
2. A sufficient number of 46" wall panels shall be provided on the front wall to maintain the shearwall moment and shear in each panel below the maximum ASD values shown here.

TABLE 1	
LOADS FOR FOUNDATION DESIGN	
LOAD	NET WIND FORCES (ASD)
P_V	± 425 LB/FT (RP1); ± 565 LB/FT (RP3)
P_H	± 280 LB/FT
P_W	± 215 LB/PANEL (w/ Detail 4 or 5)
P_W	± 430 LB/PANEL (w/ Detail 5A)
M_W	$\pm 2,150$ FT-LB/PANEL (w/ Detail 4 or 5)
M_W	$\pm 4,300$ FT-LB/PANEL (w/ Detail 5A)

TABLE 3 NOTES:

1. Allowable wind loads shown represent the maximum ASD component uniform wind loads for each panel span.
2. To determine compliance, USD site specific wind loads shall be multiplied by the load factor 0.6 when comparing to these ASD values. Reference General Notes 4D and 6A.
3. For non-uniform loads, moments and shears from site specific wind loads shall be less than those resulting from the loads and spans shown here.
4. Allowable wind loads are based on a factor of safety of 1.5 for wall panels and 2.0 for roof panels with a minimum recovery of 80% in accordance with TAS 202 and the HVHZ provisions of the FBC.

TABLE 2			
MAX. ALLOWABLE (ASD) ROOF PANEL DIAPHRAGM FORCES			
PANEL TYPE		MOMENT (FT-LBS/PANEL)	SHEAR (LBS/PANEL)
RP1	4" ROOF PANEL	5,600	1,000
RP3	5" ROOF PANEL	11,300	1,500
MAX. ALLOWABLE (ASD) FRONT WALL PANEL SHEARWALL FORCES			
PANEL TYPE		MOMENT (FT-LBS/PANEL)	SHEAR (LBS/PANEL)
WP	4" WALL PANEL (w/ Detail 5)	2,150	215
WP	4" WALL PANEL (w/ Detail 5A)	4,250	425



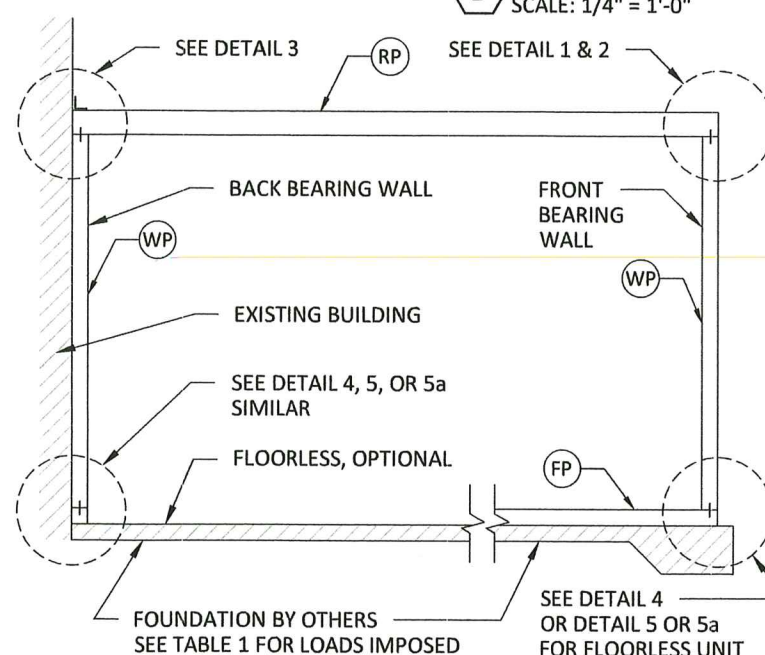


TABLE 3


PANEL TYPE			MAX. ALLOWABLE (ASD) WIND LOAD	
ROOF PANELS	RP1	4" END ROOF PANEL (3-SIDED SUPPORT)	11'-7"	+ 34.0 - 73.1
	RP1	4" INTERIOR ROOF PANEL (2-SIDED SUPPORT)	11'-7"	+ 34.0 - 48.4
	RP3	5" ROOF PANEL (ALL CONDITIONS)	15'-5"	+ 34.0 - 72.8
	WP	4" WALL PANEL (PANELS W/OUT SCREED OR FLOOR PANEL PER DETAIL 5A MAY BE 4" LONGER THAN TABLE VALUE)	9'-2.25" 9'-8.25"	+ 56.9 - 57.6 + 54.0 - 54.7

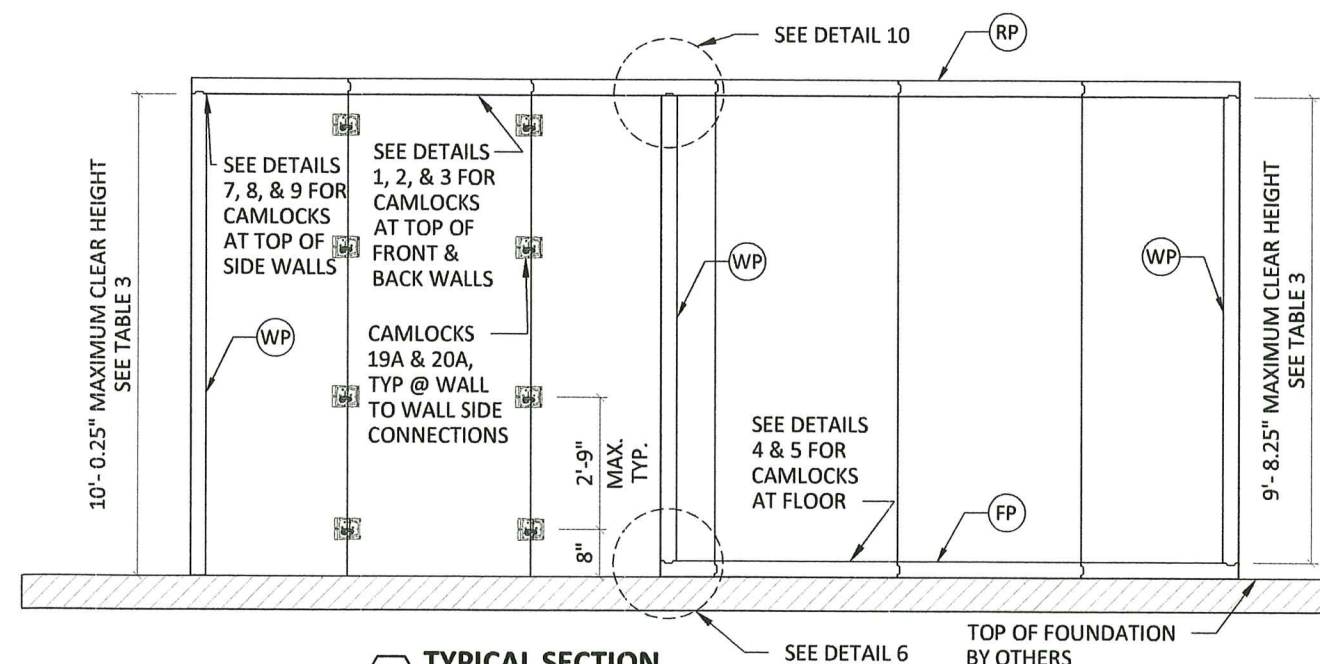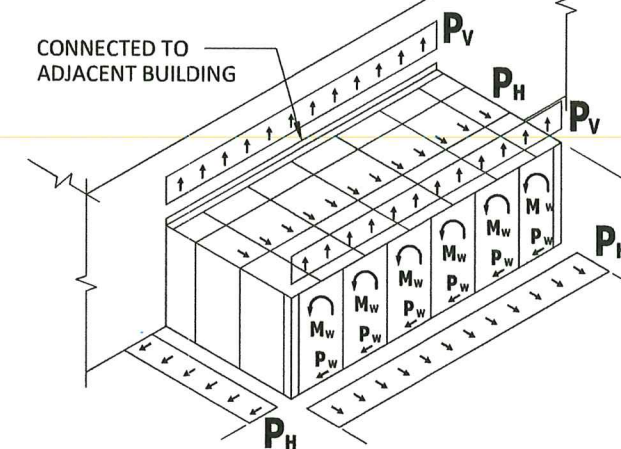

ISOMETRIC WITH FOUNDATION WIND LOADS

SEE TABLE 2 FOR SHEARWALL & DIAPHRAGM LIMITATIONS

PRODUCT REVISED as complying with the Florida Building Code
Acceptance No. 25-0708.01
Expiration Date 08/30/2027
By: *Helga A. Mahr*
Miami Date Product Control

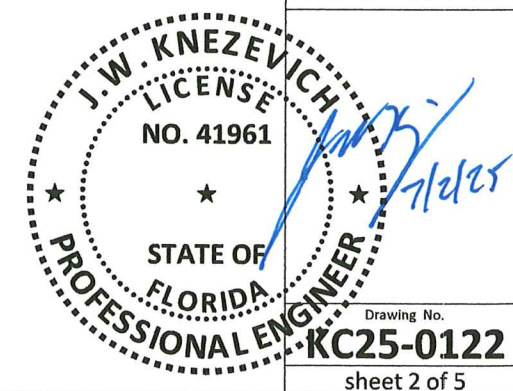


KNEZEVICH CONSULTING
KNEZEVICH CONSULTING, LLC
1600 S. Federal Hwy., Suite 961
Pompano Beach, FL 33062
T 954.772.6224 * COA 27988
www.knezevich.com
Copyright © 2025 Knezevich Consulting, LLC


WALK-IN COOLER / FREEZER
American Panel Corporation
5800 S.E. 78th Street
Ocala, FL 34472
Tel: (352) 245-7055
Fax: (352) 245-0726

Revisions		description	
no	date	by	description
1	07/02/2025	JWK	Formerly KC25-0912


Scale: AS NOTED
Drawn by: JWK
Date: 07/02/2025
J.W. Knezevich
Professional Engineer
FL License No.: PE 41961

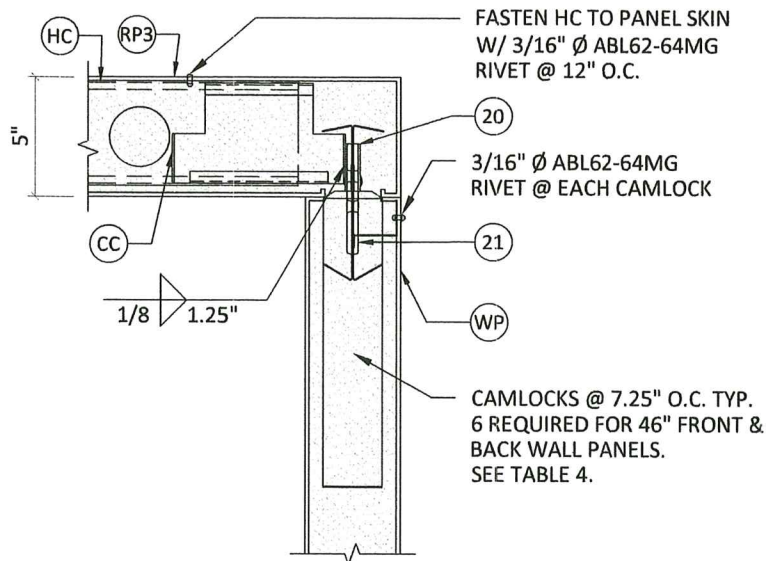


1 RP3 ROOF TO BEARING WALL
SCALE: 1.5" = 1'-0"

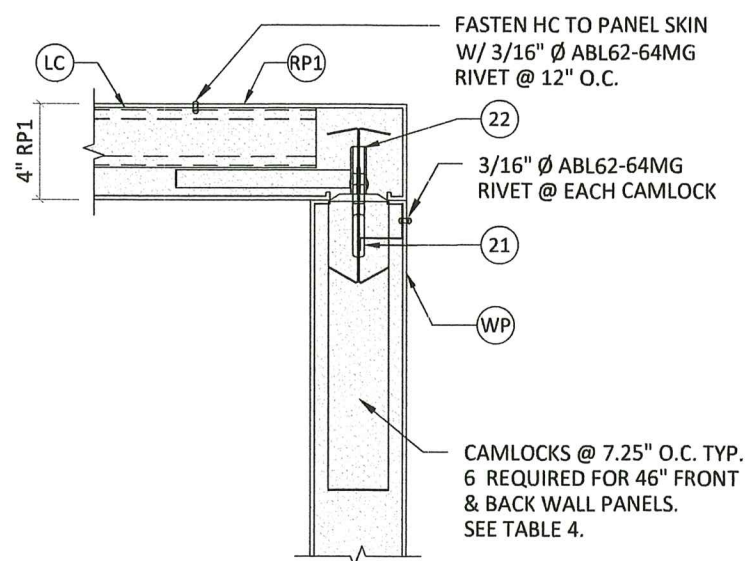


2 RP1 ROOF TO BEARING WALL
SCALE: 1.5" = 1'-0"

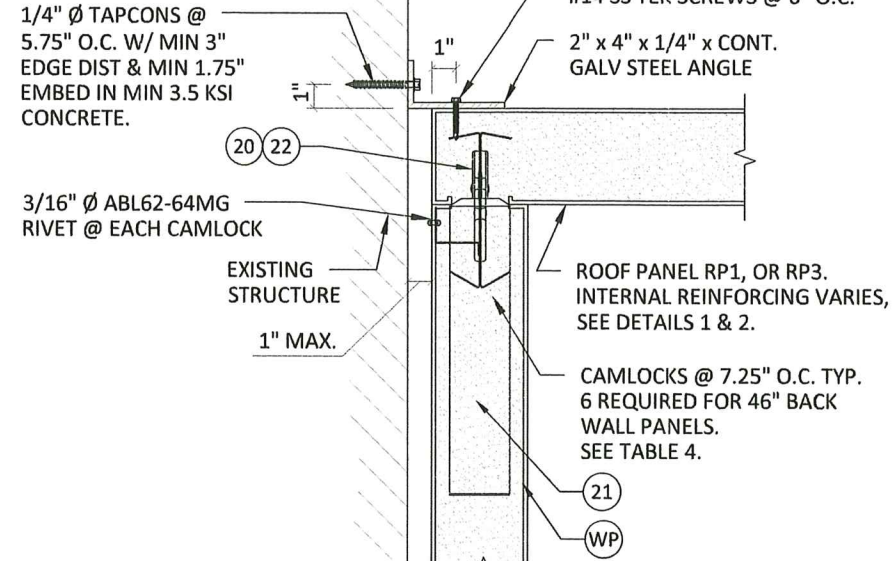


3 TYP. ROOF PANEL TO EXISTING BLDG
SCALE: 1.5" = 1'-0"

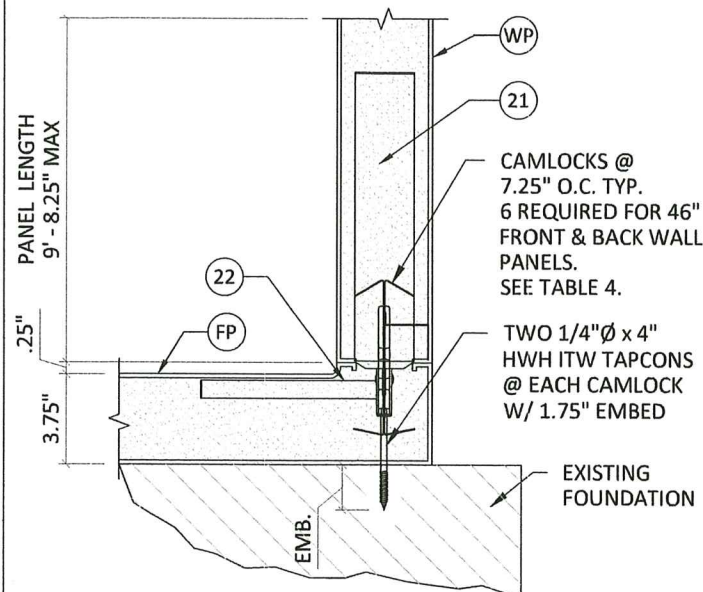


4 WALL TO FLOOR PANEL
SCALE: 1.5" = 1'-0"

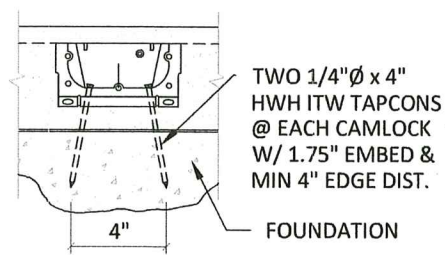


**4A FLOOR OR SCREED
CAMLOCK TO CONCRETE**
SCALE: 1.5" = 1'-0"

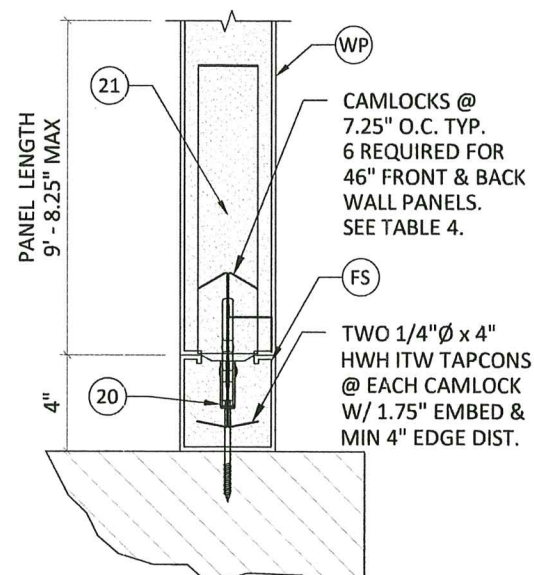


**5 WALL TO FLOOR
WITH SCREED**
SCALE: 1.5" = 1'-0"

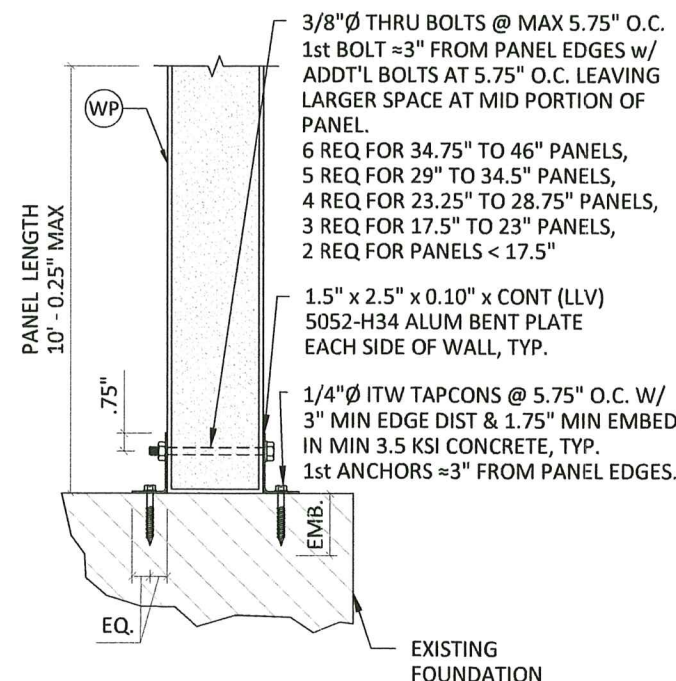

5A WALL TO FLOOR
SCALE: 1.5" = 1'-0"

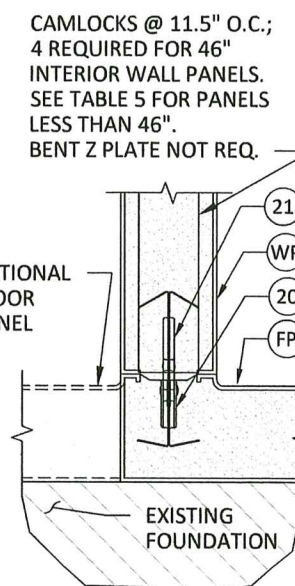


**6 INTERIOR WALL
TO FLOOR PANEL**
SCALE: 1.5" = 1'-0"

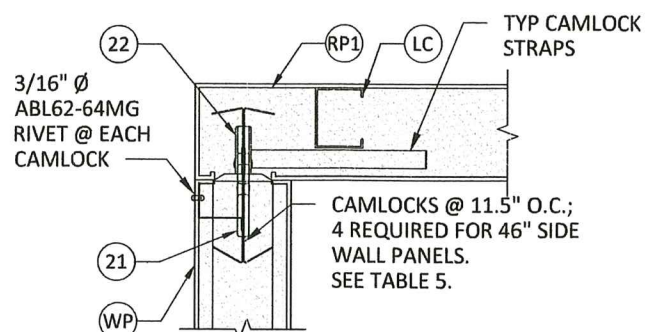


7 RP1 ROOF TO SIDE WALL
SCALE: 1.5" = 1'-0"

8 RESERVED
SCALE: 1.5" = 1'-0"

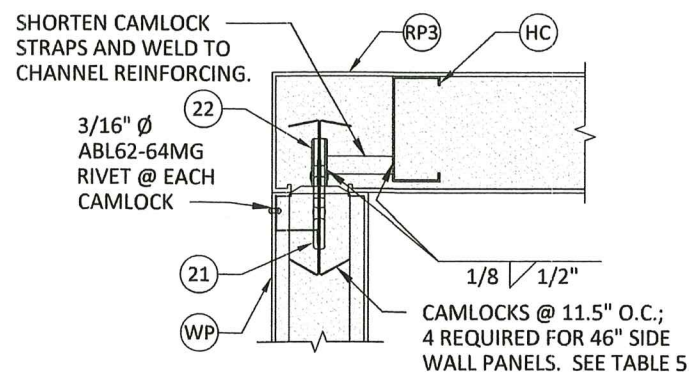

9 RP3 ROOF TO SIDE WALL
SCALE: 1.5" = 1'-0"

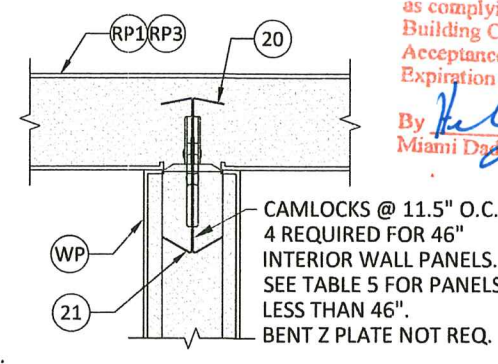

10 ROOF TO INTERIOR WALL
SCALE: 1.5" = 1'-0"

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 25-0708.01
Expiration Date 08/30/2027
By J.W. Knezevich
Miami Data Product Control




**KNEZEVICH
CONSULTING**
KNEZEVICH CONSULTING, LLC
1600 S. Federal Hwy., Suite 961
Pompano Beach, FL 33062
T 954.772.6224 * COA 27988
www.knezevich.com
Copyright © 2025 Knezevich Consulting, LLC

WALK-IN COOLER / FREEZER
American Panel Corporation
5800 S.E. 78th Street
Ocala, FL 34472
Tel: (352) 245-7055
Fax: (352) 245-0726
American Panel


Revisions		description
no	date	by
0	07/02/2025	JWK

Scale: AS NOTED
Drawn by: JWK
Date: 07/02/2025
J.W. Knezevich
Professional Engineer
FL License No.: PE 41961


Drawing No.
KC25-0122
sheet 3 of 5

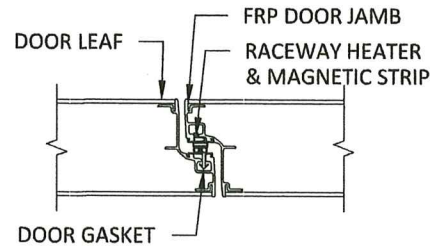


11 DOOR SEAL
SCALE: 1.5" = 1'-0"

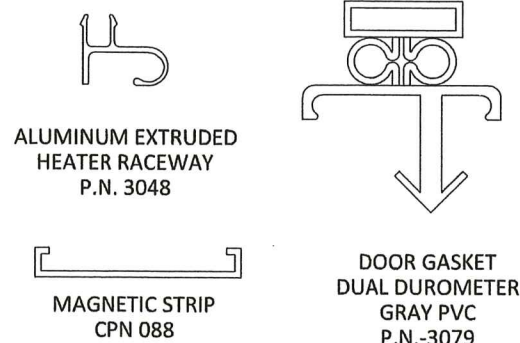


12 DOOR SEAL PARTS
FULL SCALE

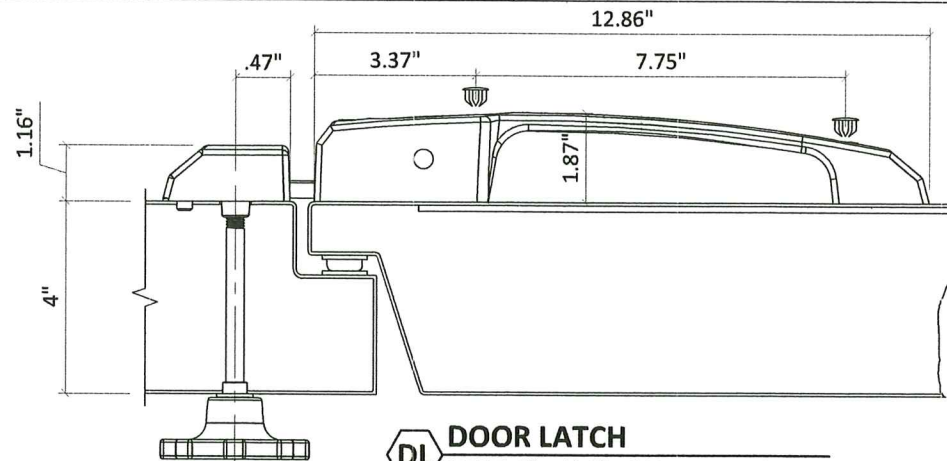

DL DOOR LATCH
SCALE: 3" = 1'-0" KASON MODEL #27C

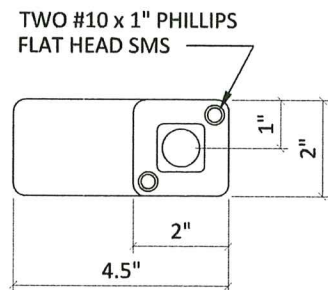


FRONT VIEW

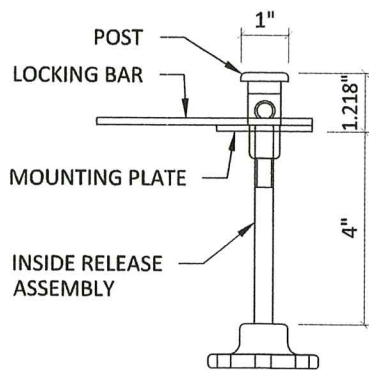


SECTION VIEW


PL PAD LOCK
SCALE: 3" = 1'-0" KASON #0036

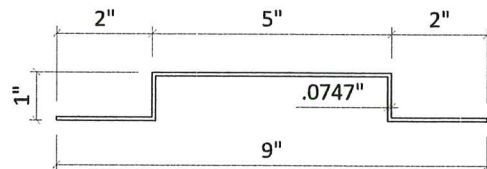


RC DOOR PANEL REINF. CHANNEL
SCALE: 3" = 1'-0" GALV STEEL




DC DOOR CHANNEL
SCALE: 3" = 1'-0" GALV STEEL

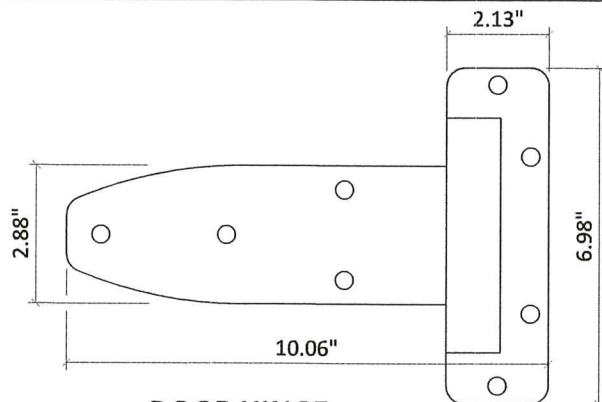


DH DOOR HINGE
SCALE: 3" = 1'-0" DENT MODEL #D69B

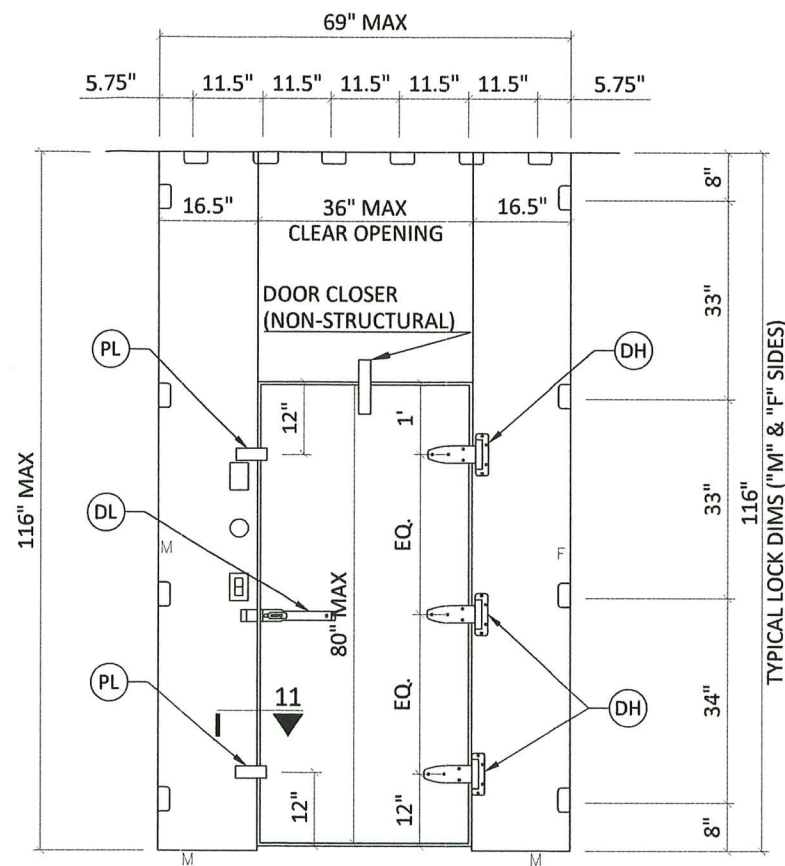


13 DOOR ELEVATION (EXTERIOR)
SCALE: 3/8" = 1'-0"

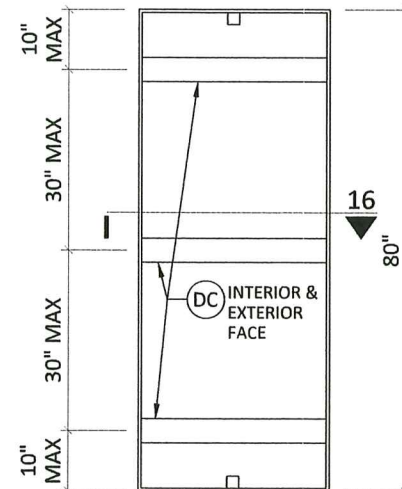


15 DOOR LEAF SHOWING CHANNEL REINFORCEMENT
SCALE: 3/8" = 1'-0"

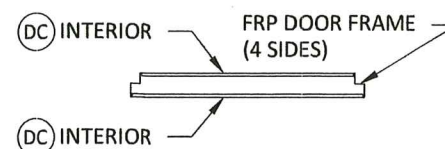

16 SECTION THRU DOOR LEAF
SCALE: 3/8" = 1'-0"

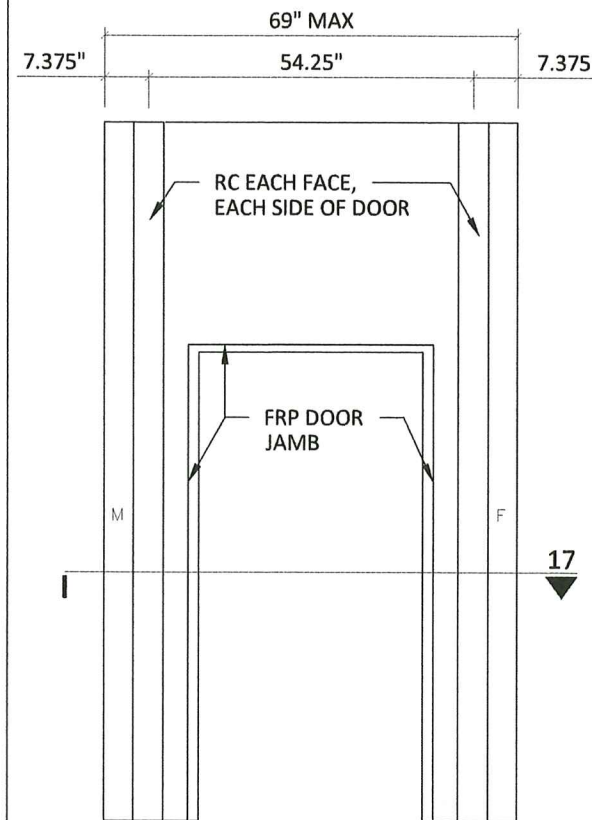


14 DOOR PANEL W/ REINFORCEMENT
SCALE: 3/8" = 1'-0"

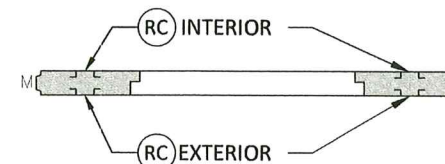

17 SECTION THRU DOOR PANEL
SCALE: 3/8" = 1'-0"

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 25-0708.01
Expiration Date 08/30/2027
By: [Signature]
Miami Data Product Control

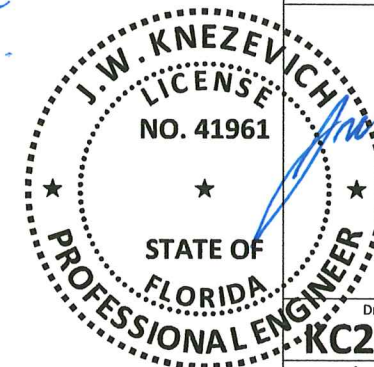

KNEZEVICH CONSULTING
KNEZEVICH CONSULTING, LLC
1600 S. Federal Hwy., Suite 961
Pompano Beach, FL 33062
T 954-772-6224 * COA 27988
www.knezevich.com
Copyright © 2025 Knezevich Consulting, LLC

WALK-IN COOLER / FREEZER

American Panel Corporation
5800 S.E. 78th Street
Ocala, FL 34472
Tel: (352) 245-7055
Fax: (352) 245-0726
American Panel

Revisions

no	date	by	description
0	07/02/2025	JWK	Formerly KC25-0912

Scale: AS NOTED
Drawn by: JWK
Date: 07/02/2025

J.W. Knezevich
Professional Engineer
FL License No.: PE 41961

Drawing No. **KC25-0122**
sheet 4 of 5

