



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599

www.miamidade.gov/economy

S&P Air Control, LLC
3005 South Hickory Street
Chattanooga, TN 37407

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Model WDV-75 Vertical Aluminum Louver System (80 fps Impact)

APPROVAL DOCUMENT: Drawing No. **25-061**, titled "Model WDV-75 Vertical Aluminum Louver System", sheets 1 through 8 of 8, dated 07/07/2025, prepared by Tiltco, Inc., signed and sealed by Walter A. Tillit Jr., P.E., bearing the Miami-Dade County Product Control revision stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant.

LABELING: A permanent label with the manufacturer's name or logo, Chattanooga, TN or Hartford, AL, model/series, and following statement: "Miami-Dade County Product Control Approved", is to be located on each unit.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises NOA # 23-0726.12** consists of this page 1 and evidence page E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by **Carlos M. Utrera, P.E.**



09/09/25

NOA No. 25-0805.07
Expiration Date: September 29, 2027
Approval Date: September 18, 2025
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

- 1. Evidence submitted under NOA # 22-0729.05, 23-0726.12, and new**
- A. DRAWINGS**
 1. Drawing No. **25-061**, titled “Model WDV-75 Vertical Aluminum Louver System”, sheets 1 through 8 of 8, dated 07/07/2025, prepared by Tilteco, Inc., signed and sealed by Walter A. Tillit Jr., P.E.
- B. TESTS**
 1. Test reports on 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94 (Level “E”, 80 fps)
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of Model WDV-75 Vertical Aluminum Louver Systems, prepared by PRI Construction Materials Technologies LLC, Test Report No. **1697T0003**, dated 06/27/2022, signed and sealed by Zachary Priest, P.E.
 2. Test Report on High Velocity Wind Driven Rain Resistance Test per ANSI/AMCA 550-15 of a Model WDV-75 Vertical Aluminum Louver System, prepared by PRI Construction Materials Technologies LLC, Report No. **1697T0002**, dated 05/19/2022, signed and sealed by Zachary Priest, P.E.
 3. Test Report on Large Missile Impact Test per ANSI/AMCA 540-13 and Cyclic Wind Pressure Loading per FBC, TAS 203-94 of Model WDV-75 Vertical Aluminum Louver Systems, prepared by PRI Construction Materials Technologies LLC, Report No. **1697T0004**, dated 06/27/2022, signed and sealed by Zachary Priest, P.E.
- C. CALCULATIONS**
 1. Structural analysis and anchor calculations, prepared by Tilteco Inc, dated 07/15/2022, signed and sealed by Walter A. Tillit Jr., P.E.
- D. QUALITY ASSURANCE**
 1. Miami-Dade Department of Regulatory and Economic Resources (RER).
- E. MATERIAL CERTIFICATIONS**
 - 1.
- F. STATEMENTS**
 1. Amended Sales Agreement made on April 8th, 2024 by S&P Air Control, LLC.
 2. Statement letter of code conformance to the 8th edition (2023) of the FBC, issued by Tilteco, Inc. on 07/07/2023, signed and sealed by Walter A. Tillit Jr., P.E.
 3. Statement letter of no financial interest, issued by Tilteco, Inc., dated 07/15/2022, signed and sealed by Walter A. Tillit Jr., P.E.



Carlos M. Utrera, P.E.
Product Control Examiner
NOA No. 25-0805.07
Expiration Date: September 29, 2027
Approval Date: September 18, 2025

GENERAL NOTES

1. MODEL WDV-75 VERTICAL ALUMINUM LOUVER SYSTEM SHOWN ON THIS PRODUCT APPROVAL DOCUMENT (P.A.D.) HAS BEEN VERIFIED FOR COMPLIANCE IN ACCORDANCE WITH THE **2023 (8th EDITION) AND 2020 (7th EDITION)** OF THE FLORIDA BUILDING CODE. THIS ALUMINUM LOUVER SYSTEM MAY BE INSTALLED AT HIGH VELOCITY HURRICANE ZONES (H.V.H.Z).

DESIGN WIND LOADS SHALL BE DETERMINED AS PER SECTION 1620 OF THE ABOVE MENTIONED CODE, USING **ASCE 7-22 (FBC 2023) & ASCE 7-16 (FBC 2020)** AND SHALL NOT EXCEED THE MAXIMUM (A.S.D.) DESIGN PRESSURE RATINGS INDICATED ON THIS SHEET.

IN ORDER TO VERIFY THE ABOVE CONDITION, ULTIMATE DESIGN WIND LOADS DETERMINED PER ASCE 7-22 OR ASCE 7-16 SHALL BE FIRST REDUCED TO A.S.D. DESIGN WIND LOADS BY MULTIPLYING THEM BY 0.6 IN ORDER TO COMPARE THESE W/ MAX. (A.S.D.) DESIGN PRESSURE RATINGS INDICATED ON THIS SHEET.

ALUMINUM LOUVER SYSTEM ADEQUACY FOR IMPACT AND FATIGUE RESISTANCE HAS BEEN VERIFIED IN ACCORDANCE WITH SECTION 1626 OF THE ABOVE MENTIONED CODE AS PER PRI CONSTRUCTION MATERIALS TECHNOLOGIES, LLC. TESTING LAB REPORT # 1697T0003, AS PER TAS-201, TAS-202, TAS-203, AS WELL AS PER AMCA IMPACT STANDARD 540, PER TESTING REPORT # 1697T0004, AND AS PER AMCA STANDARD 550-15 HIGH VELOCITY WIND DRIVEN RAIN AND TAS 100(A)-95, PER TEST REPORT # 1697T0002.

- 2. ALL ALUMINUM EXTRUSIONS SHALL BE 6063-T5 ALLOY AS PER BILL OF MATERIALS ON SHEET 2.
- 3. ALL SCREWS TO BE STAINLESS STEEL 304 OR 316 SERIES WITH 50 ksi YIELD POINT AND 90 ksi TENSILE STRENGTH OR CORROSION RESISTANT CARBON STEEL AS PER DIN 50018 AND SHALL COMPLY W/ FLORIDA BUILDING CODE SECTION 2411.3.3.4.
- 4. ALL WELDING OF ALUMINUM FRAMING SHALL BE IN ACCORDANCE WITH THE AMERICAN WELDING SOCIETY A.W.S. D.1.2 REGULATIONS. USE CERTIFIED WELDERS. USE ER-5356 ELECTRODES.
- 5. ANCHOR (13) TO EXISTING STRUCTURE SHALL BE AS FOLLOWS (SEE SHEETS 5 , 6).

(A). ANCHORS SHALL BE INSTALLED FOLLOWING ALL THE RECOMMENDATIONS AND SPECIFICATIONS OF THE ANCHORS MANUFACTURER. E.D. IS BEYOND ANY WALL FINISH.

ANCHOR TYPE	MANUFACTURER	DIAMETER OR GAGE	MIN. EMBEDMENT				MIN. EDGE DISTANCE (E.D)		
			TO CONCRETE (f'c=3,000 psi) MIN.	TO CONCRETE BLOCK ASTM (C-90 UNIT) (f'c=1.5 ksi) GROUTED	1/8" MIN. ALUMINUM (Fy=25ksi) or 14 GA GALV. STEEL (Fy=33 ksi)	TO WOOD (G ≥ 0.55)	CONCRETE OR CONCRETE BLOCK	STEEL OR ALUM.	WOOD
SCREW-BOLT+	DEWALT	3/8"	3 1/4"	3 1/4"	N/A	N/A	1 1/2"	N/A	N/A
LAG SCREW	-	3/8"	N/A	N/A	N/A	1 1/2"	N/A	N/A	1 1/2"
TAP-FLEX	ELCO CONST.	3/8"	N/A	N/A	FULLY EMB. PLUS 3 THREADS BEYOND.	N/A	N/A	3/4"	N/A


- 6. MODEL WDV-75 ALUMINUM LOUVER SYSTEM MAY BE INSTALLED IN LOCATIONS WHERE THE ROOM BEHIND IS NOT DESIGNED TO DRAIN WATER PENETRATING INTO THE ROOM, OR THE ROOM WILL HOUSE NON-WATER RESISTANT EQUIPMENT. COMPONENTS OR SUPPLIES INSTALLATION ON LOUVER IS LIMITED TO 40 FT. IN HEIGHT ACCORDING TO TABLE 3 OF TAS 100(A)-95.
- 7. ALUMINUM MEMBERS IN CONTACT WITH DISSIMILAR MATERIALS SHALL COMPLY WITH SECTION III-6 OF THE 2020 & 2015 ALUMINUM DESIGN MANUAL.

- 8. IT SHALL BE RESPONSIBILITY OF THE CONTRACTOR TO VERIFY THE SOUNDNESS OF THE STRUCTURE WHERE LOUVER SYSTEM IS TO BE ATTACHED TO INSURE PROPER ANCHORAGE.
- 9. (A). THIS PRODUCT APPROVAL DOCUMENT (P.A.D.) PREPARED BY THIS ENGINEER IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SPECIFIC PROJECT; I.E. WHERE THE SITE CONDITIONS DEVIATE FROM THE P.A.D.
(B). CONTRACTOR TO BE RESPONSIBLE FOR THE SELECTION, PURCHASE AND INSTALLATION INCLUDING LIFE SAFETY OF THIS PRODUCT, BASED ON THIS P.A.D., PROVIDED HE/SHE DOES NOT DEVIATE FROM THE CONDITIONS DETAILED ON THIS DOCUMENT.
(C). THIS PRODUCT APPROVAL DOCUMENT WILL BE CONSIDERED INVALID IF MODIFIED.
(D). SITE SPECIFIC PROJECTS SHALL BE PREPARED BY A FLORIDA REGISTERED ENGINEER OR ARCHITECT WHICH WILL BECOME THE ENGINEER OF RECORD (E.O.R.) FOR THE PROJECT AND WHO WILL BE RESPONSIBLE FOR THE PROPER USE OF THE P.A.D.
(E). ORIGINAL P.A.D. SHALL BEAR THE DATE AND ORIGINAL SEAL AND SIGNATURE OF THE PROFESSIONAL ENGINEER THAT PREPARED IT.
- 10. PRODUCT MANUFACTURER'S LABEL SHALL BE LOCATED ON A READILY VISIBLE LOCATION AT PRODUCT IN ACCORDANCE WITH SECTION 1703.5 OF THE FLORIDA BUILDING CODE AND MIAMI- DADE COUNTY GUIDELINES.

**A.S.D. DESIGN PRESSURE RATING:
+100, -100 psf.**

**THIS DRAWING SHALL ONLY BE USED TO
OBTAIN PERMITS IN THE STATE OF FLORIDA**

PRODUCT REVISED
as complying with the Florida Building Code
NOA-No. 25-0805.07
Expiration Date 09/29/2027
By *[Signature]*
Miami-Dade Product Control

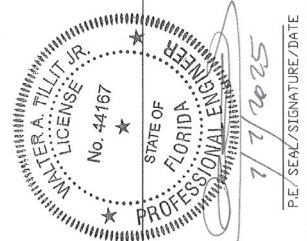

FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)

MODEL WDV-75 VERTICAL ALUMINUM LOUVER SYSTEM

W.H. DRAWN BY: 7/7/2025 DATE

25-061 DRAWING No.

S&P AIR CONTROL, LLC.
155 GENCO DRIVE
3005 SOUTH HICKORY ST.
MIAMI, FL 33133
PHONE: (423)898-7715 FAX: (423)898-6639

REV. NO	DESCRIPTION	DATE	REV. NO	DESCRIPTION	DATE
1	0.0.25-073	7/7/25	4		

©2025 TILTECO, INC.

TILTECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6335 N.W. 38th St., Ste. 305, WILMINGTON, FL 33166
Phone: (305)976-0067
WALTER A. TILLIT JR., P.E.
FLORIDA Lic. # 44167

BILL OF MATERIALS:

COMPONENT #	DESCRIPTION	MATERIAL	NOTES
①	HEAD	6063-T5 ALUMINUM ALLOY/TEMPER	CONTINUOUS
②	SILL	6063-T5 ALUMINUM ALLOY/TEMPER	CONTINUOUS
③	SIDE JAMB/MULLION	6063-T5 ALUMINUM ALLOY/TEMPER	CONTINUOUS
③A	LAST BLADE BLANK-OFF ANGLE	6063-T6 ALUMINUM ALLOY/TEMPER	CONTINUOUS
⑤	BLADE	6063-T5 ALUMINUM ALLOY/TEMPER	WDV-75 MODEL
⑥	BLADE BRACE	6063-T5 ALUMINUM ALLOY/TEMPER	USE (1) EVERY (3) ⑤ 2" HIGH
⑥A	BLADE BRACE STRIP	6063-T5 ALUMINUM ALLOY/TEMPER	CONTINUOUS
⑦	OPTIONAL BIRD SCREEN	3/4" x 0.051" FLATTENED ALUMINUM	OPTIONAL
⑨	HEAD/SILL MOUNTING ANGLE	6061-T6 ALUMINUM ALLOY/TEMPER	CONTINUOUS
⑩	#10 x 1-1/2" HEX HEAD, TEK SCREW	Fy=134 Ksi Fu=152Ksi CLIMASEAL COATED	USE (2) FOR BLADE ATTACHMENT EA. END
⑪	1/4 -14 x 1-1/2" HEX HEAD, TEK SCREW	Fy=134 Ksi Fu=152Ksi CLIMASEAL COATED	ANGLE CLIP ⑨ ATTACHMENT TO HEAD & SILL
⑫	#10 x 3/4" HEX HEAD, TEK SCREW	Fy=134 Ksi Fu=152Ksi CLIMASEAL COATED	BLADE BRACE ⑥, ⑥A ATTACHMENT & ③A ATTACHMENT
⑬	ANCHOR	SEE GENERAL NOTE 5A/1	SEE DETAILS FOR SPACING ON SHEETS 5 & 6
⑭	FLANGE	6063-T5 ALUMINUM ALLOY/TEMPER	OPTIONAL


PRODUCT REVISED
 as complying with the Florida
 Building Code
NOA-No. 25-0805.07
Expiration Date 09/29/2027
 By *[Signature]*
Miami-Dade Product Control

MODEL WDV-75 VERTICAL ALUMINUM LOUVER SYSTEM		W.H. DRAWN BY: 7/7/2025
S&P AIR CONTROL, LLC. 150 GUNCO DRIVE HARTFORD, AL 36344 PHONE: (423)898-7715 FAX:(423)958-8629		DATE: 25-061
REV. NO	DESCRIPTION	DATE
1	O.D. 23-073	7/7/23
2		
3		
4		


©2025 TILTECO, INC.
TILECO INC.
 TILIT TESTING & ENGINEERING COMPANY
 6335 N.W. 35th Ave., Virginia, FL 33186
 Phone: (305)979-3333 (305)979-1433
 CA-0068719 (05/20/14-15)
 WALTER A. TILIT JR., P.E.
 FLORIDA Lic. # 44167

STATE OF FLORIDA
 PROFESSIONAL ENGINEER
 WALTER A. TILIT JR.
 LICENSE No. 44167
 P.E. SEAL/SIGNATURE/DATE


MIAMI-DADE COUNTY
 SHEET 2 OF 8

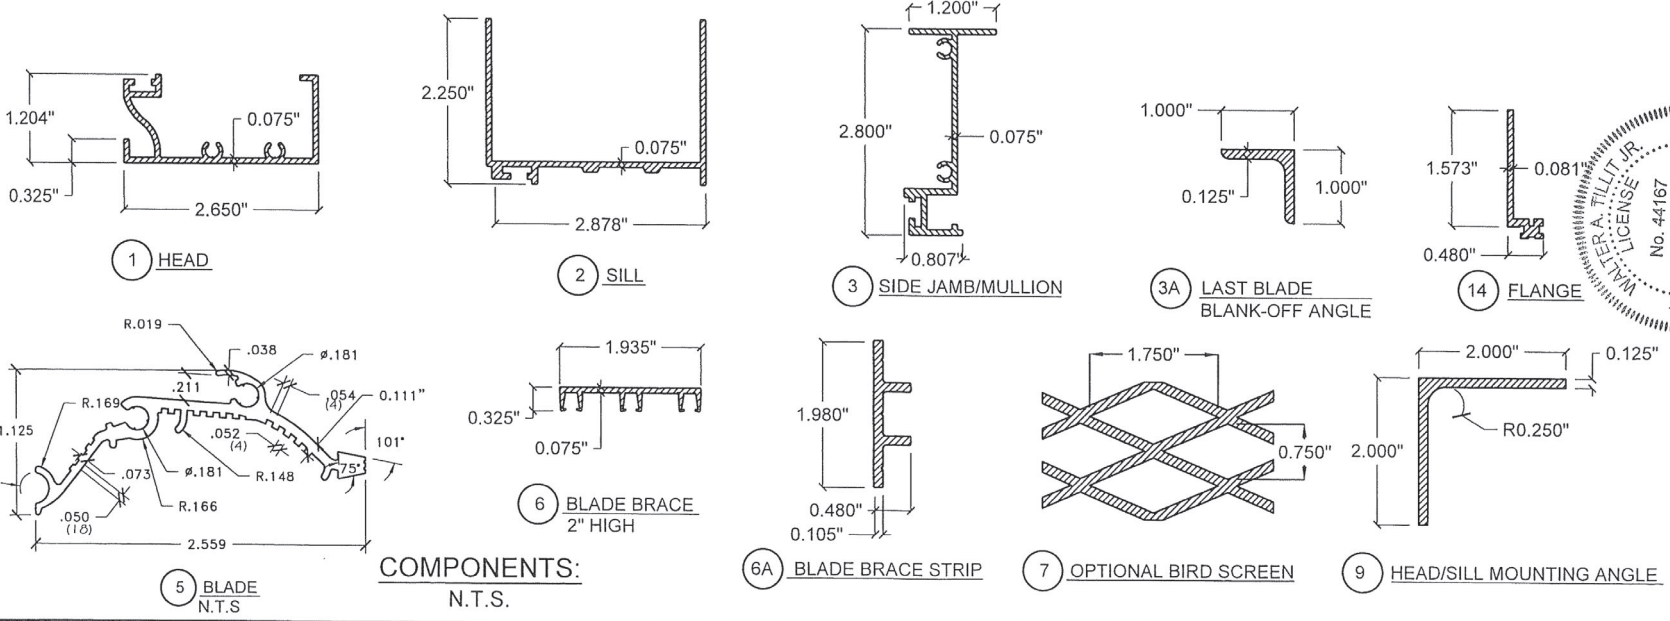


COMPONENTS:
 N.T.S.

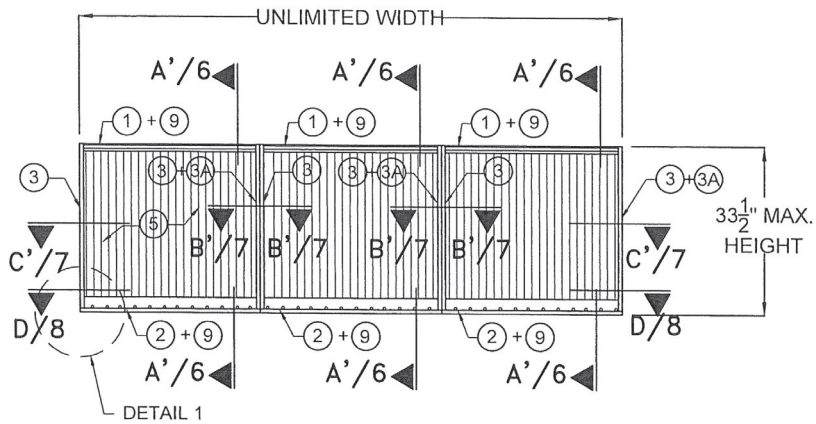


EXTERIOR ELEVATION
 MAX. HEIGHT FOR MULTIPLE UNITS
 W/O (6) + (6A)

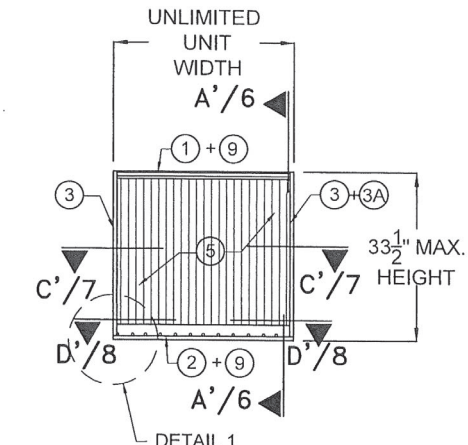


EXTERIOR ELEVATION
 MAX. HEIGHT FOR SINGLE UNIT
 W/O (6) + (6A)

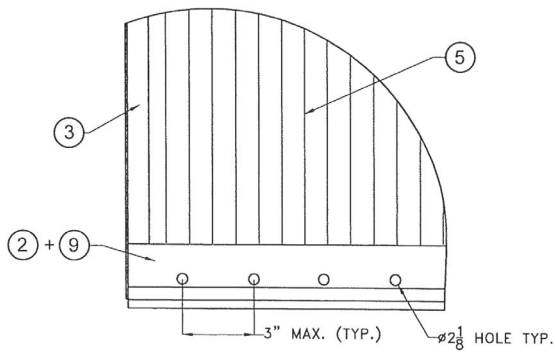

DETAIL 1
 WEEP HOLES/SILL BAFFLE @ (2)
 SCALE: N.T.S.

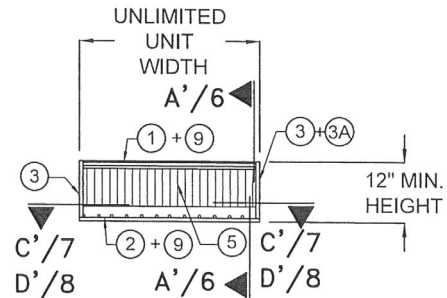


EXTERIOR ELEVATION
 MIN. HEIGHT FOR SINGLE UNIT
 W/O (6) + (6A)



PRODUCT REVISED
 as complying with the Florida
 Building Code
 NOA-No. 25-0805.07
 Expiration Date 09/29/2027
 By *[Signature]*
 Miami-Dade Product Control

FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)

MODEL WDV-75 VERTICAL ALUMINUM LOUVER SYSTEM		W.H. DRAWN BY: 7/7/2025	DATE: 7/7/2025
S&P AIR CONTROL, LLC. 159 GEMCO DRIVE 3005 SOUTH HICKORY ST. HARTFORD, AL 35344 PHONE: (423)698-7715 FAX: (423)698-6629		25-061 DRAWING NO.	
REV. NO.	DESCRIPTION	DATE	REV. NO.
1	OLD 23-073	7/7/25	3
2			4
3			5
02025 TILTECO, INC.		MIAMI-DADE COUNTY	
TILECO INC. TILIT TESTING & ENGINEERING COMPANY 6337 Phoenicia Blvd., Suite 1305, Phoenix, AZ 85018 WALTER A. TILLIT JR., P.E. FLORIDA Lic. # 44167		P.E. SEAL/SIGNATURE/DATE <i>[Signature]</i> 7/7/2025	

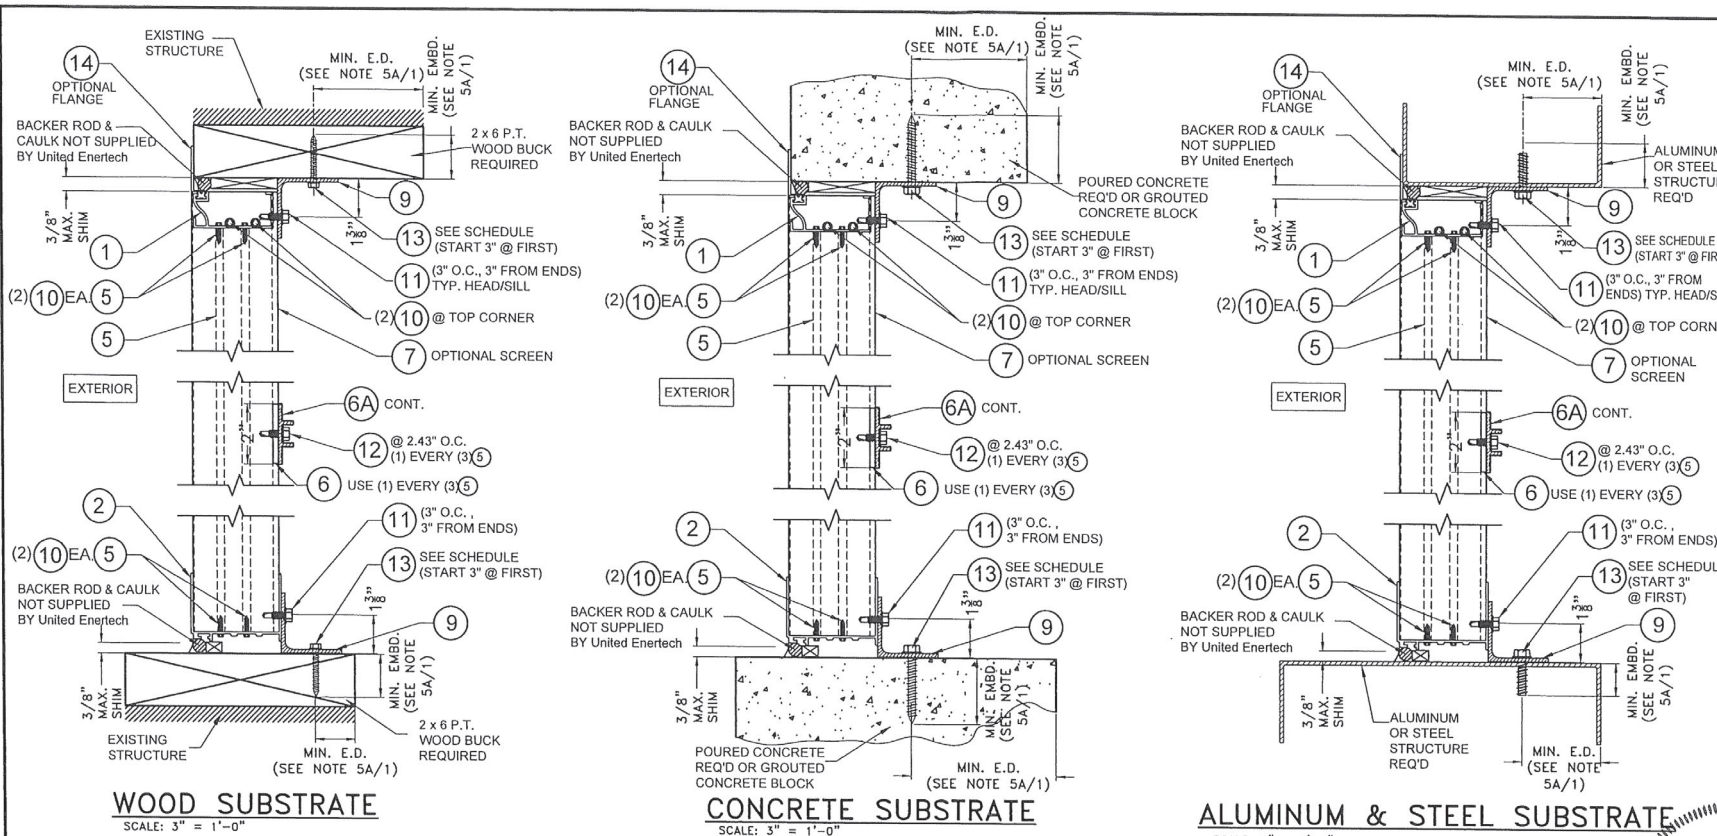

SECTIONS A-A W/6A

MAX. ANCHOR 13 SPACING SCHEDULE AS PER NOTE 5A/1 AT ANGLE 9 TOP & BOTTOM

A.S.D. DESIGN LOAD (p.s.f.)	MAX. UNIT HEIGHT (FT)	SUBSTRATE			
		CONCRETE	GROUTED CONCRETE BLOCK	WOOD	STEEL OR ALUMINUM
≤ 75.0	≤ 5'-0"	6" O.C.	6" O.C.	6" O.C.	6" O.C.
	> 5'-0" TO 8'-0"	6" O.C.	6" O.C.	4" O.C.	6" O.C.
>75-100	≤ 5'-0"	6" O.C.	6" O.C.	3" O.C.	6" O.C.
	> 5'-0" TO 8'-0"	6" O.C.	6" O.C.	3" O.C.	6" O.C.

STATE OF FLORIDA
 PROFESSIONAL ENGINEER
 WALTER A. TILLIT JR.
 LICENSE No. 44167
 7/7/2025

PRODUCT REVISED
 as complying with the Florida Building Code
NOA-No. 25-0805.07
Expiration Date 09/29/2027
 By *[Signature]*
Miami-Dade Product Control

FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)

MODEL WDVY-75
 VERTICAL ALUMINUM LOWER SYSTEM


W.H. DRAWN BY: 7/7/2025
 DATE: 7/7/2025
 25-061 DRAWING No.
 SHEET 5 OF 8

S&P AIR CONTROL, LLC.
 3005 SOUTH HICKORY ST. 159 GRENCO DRIVE
 CHATTAHOOCHEE, TN 37407 HARTFORD, AL 36344
 PHONE: (423)986-7715 FAX: (423)698-6629

TILECO INC.
 TILIT TESTING & ENGINEERING COMPANY
 6555 Pharr Ln. #300, Ft. Lauderdale, FL 33309
 CA-0006719
 WALTER A. TILLIT JR. P.E.
 FLORIDA Lic. # 44167

©2025 TILECO, INC.

P.E. SEAL/SIGNATURE/DATE

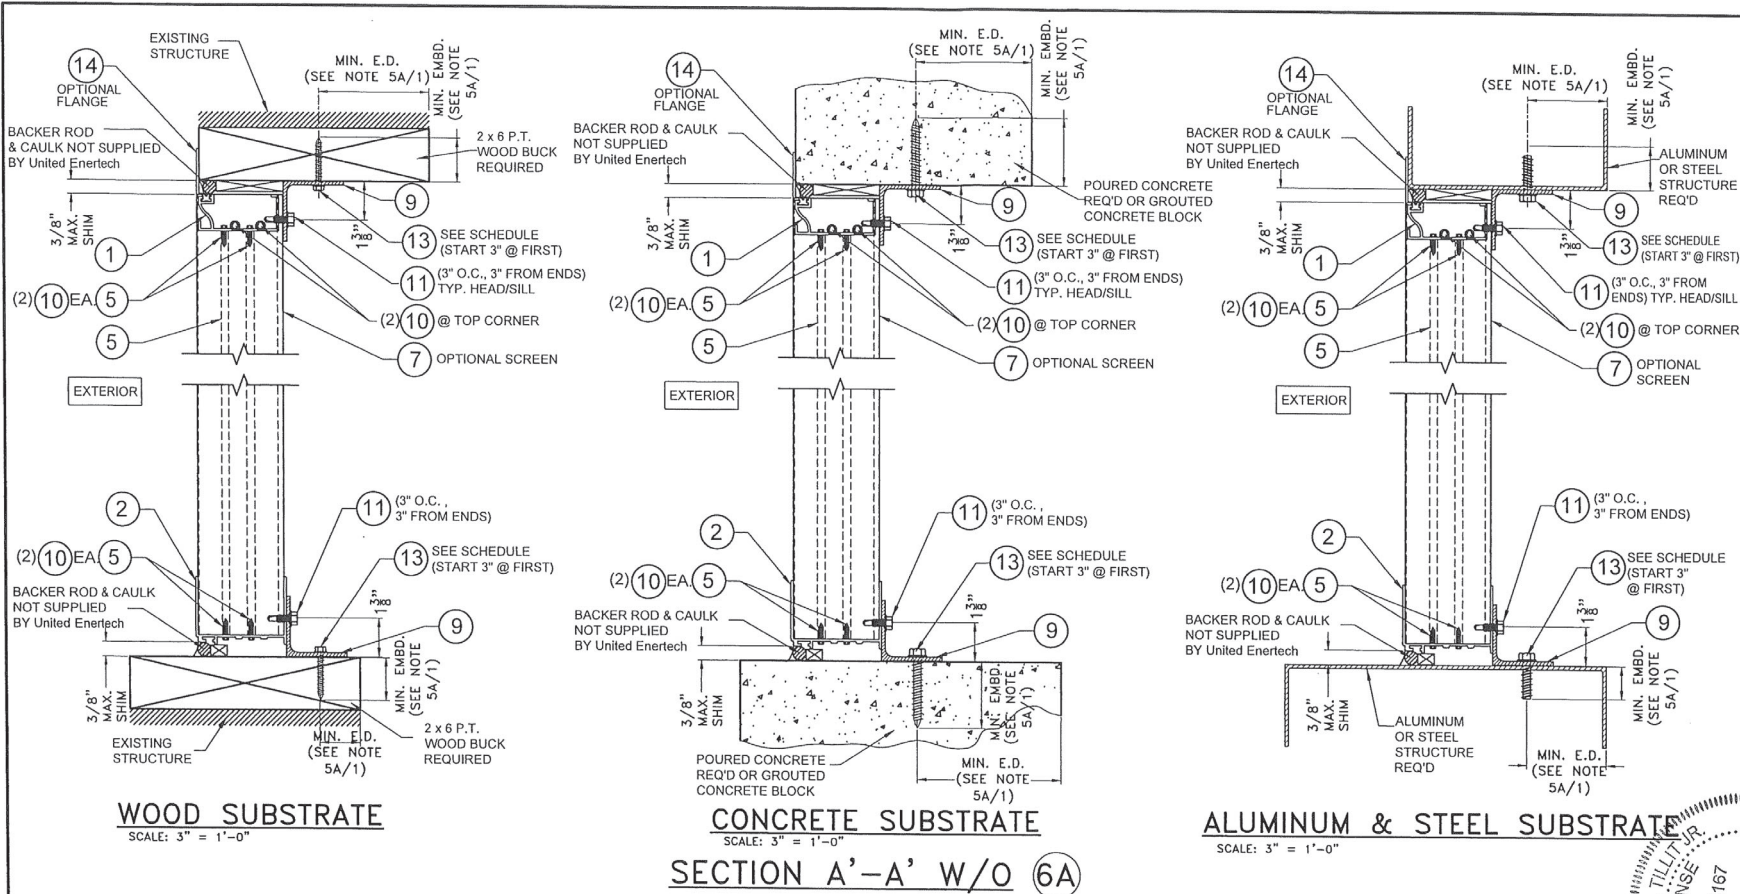

SECTION A'-A' W/O 6A

MAX. ANCHOR 13 SPACING SCHEDULE AS PER NOTE 5A/1 AT ANGLE 9 TOP & BOTTOM

A.S.D. DESIGN LOAD (p.s.f.)	MAX. UNIT HEIGHT (FT)	SUBSTRATE			
		CONCRETE	GROUTED CONCRETE BLOCK	WOOD	STEEL OR ALUMINUM
≤ 75.0	≤ 33½"	6" O.C.	6" O.C.	6" O.C.	6" O.C.
>75-100	≤ 33½"	6" O.C.	6" O.C.	3" O.C.	6" O.C.

FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)

MODEL WDV-75
VERTICAL ALUMINUM LOUVER SYSTEM

S&P AIR CONTROL, LLC.
3005 SOUTH HICKORY ST. 150 GEMCO DRIVE
CHATTANOOGA, TN 37407 HARTFORD, AL 36344
PHONE: (423) 868-7715 FAX: (423) 868-6629

TILECO INC.
TILIT TESTING & ENGINEERING COMPANY
6336 W. WILSON BLVD. SUITE 116
PHOENIX, AZ 85032 Phone: (602) 971-4330 Fax: (602) 971-4331
CA-00062719
WALTER A. TILIT, P.E.
FLORIDA Lic. # 44167


WALTER A. TILIT, P.E.
LICENSE No. 44167
STATE OF FLORIDA
PROFESSIONAL ENGINEER
7/7/2025

P.E. SEAL/SIGNATURE/DATE


MIAMI-DADE COUNTY

W.H. DRAWN BY: 7/7/2025 DATE: 25-081 DRAWING No. SHEET 6 OF 8


PRODUCT REVISED as complying with the Florida Building Code
NOA-No. 25-0805.07
Expiration Date 09/29/2027
By *[Signature]*
Miami-Dade Product Control

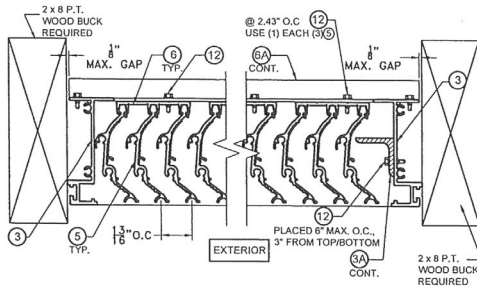


WOOD SUBSTRATE

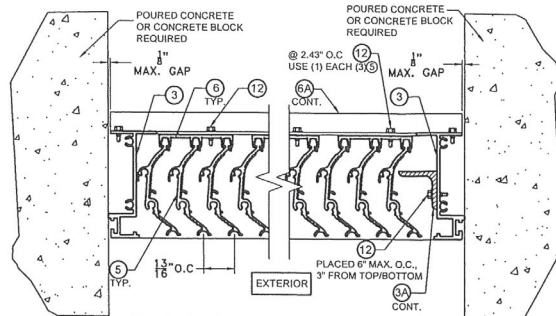


**POURED CONCRETE OR
CONCRETE BLOCK SUBSTRATE**
SECTION C-C W/ (6) & (6A)
© SINGLE & MULTIPLE UNITS
N.T.S.

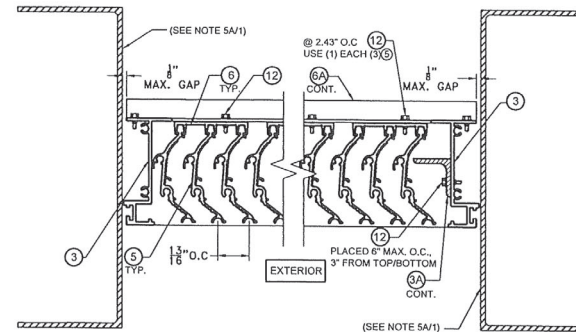


ALUMINUM & STEEL SUBSTRATE

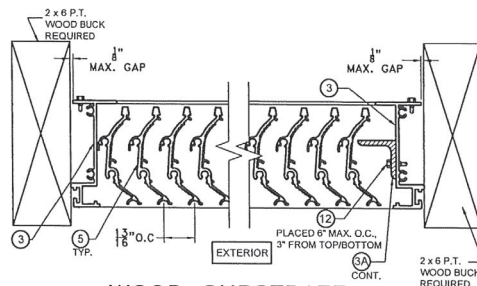


WOOD SUBSTRATE

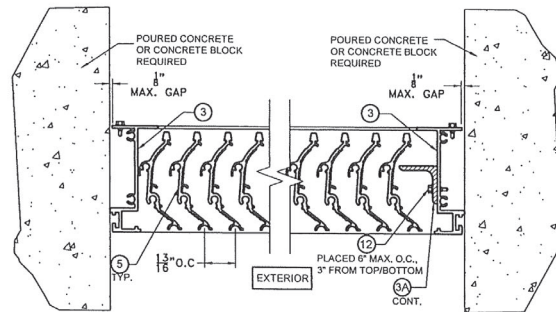


**POURED CONCRETE OR
CONCRETE BLOCK SUBSTRATE**
SECTION C'-C' W/O (6) & (6A)
© SINGLE & MULTIPLE UNITS
N.T.S.

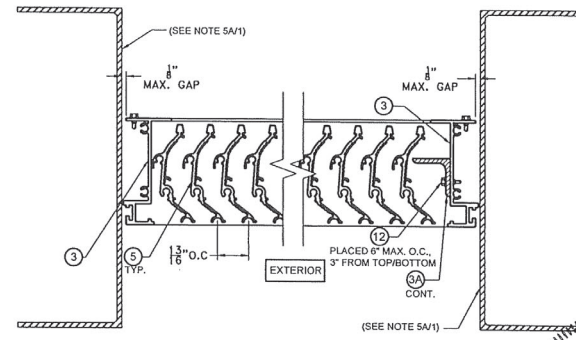

ALUMINUM & STEEL SUBSTRATE

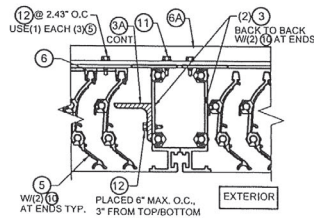

BACK TO BACK MULLION
MULTIPLE UNITS W/ (6) & (6A)
SECTION B-B
N.T.S.

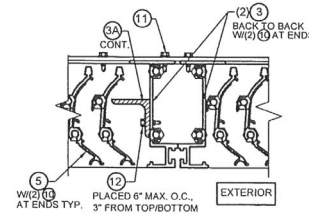

BACK TO BACK MULLION
MULTIPLE UNITS W/O (6) & (6A)
SECTION B'-B'
N.T.S.


FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)

MODEL WDV-75		W.H. DRAWN BY:	7/7/2025
VERTICAL ALUMINUM LOUVER SYSTEM		DATE:	
S&P AIR CONTROL, LLC.		25-061	
HICKORY DRIVE 3001 WOODBINE ST. SUITE 100 PHOENIX, AZ 85027 PHONE: (480) 998-7715 FAX: (480) 998-6629		REV. NO.	DATE
REV. NO.	DESCRIPTION	DATE	DESCRIPTION
1	OLD 25-073	7/7/25	
2			
3			
4			

92025 TILTECO, INC.


TILECO INC.

TILIT TESTING & ENGINEERING COMPANY
6332 NW 36th St., Ste. 300, Virginia Gardens, FL 33146
Phone: (305) 991-0311 FAX: (305) 991-0311
WALTER A. TILIT JR., P.E.
FLORIDA, LIC. # 44167




PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 25-0805.07
Expiration Date 09/29/2027
By *[Signature]*
Miami-Dade Product Control

MIAMI-DADE COUNTY

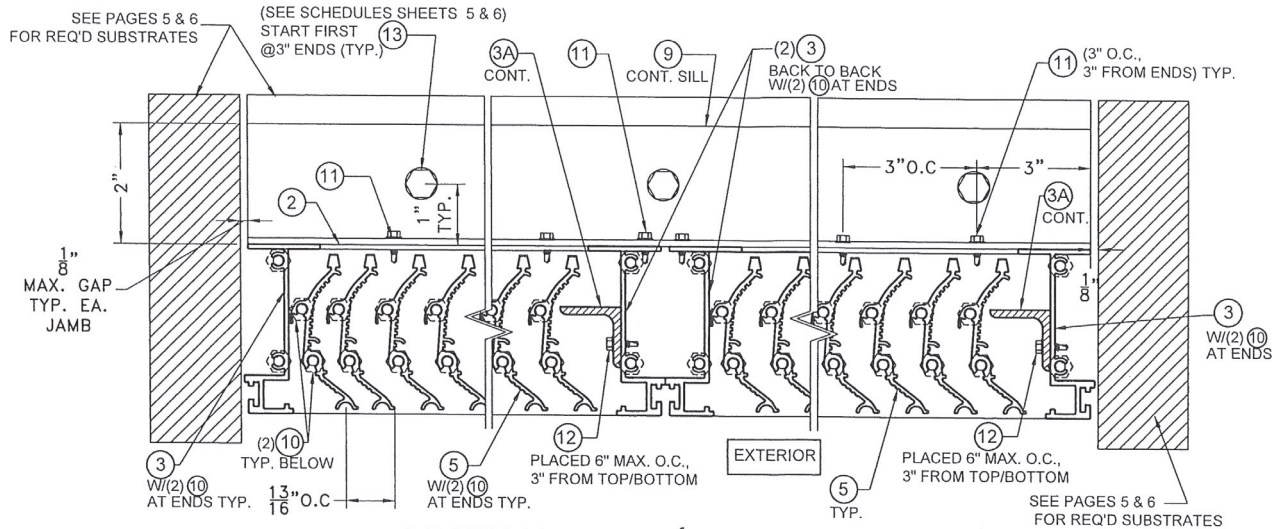

SECTION D-D (MULTIPLE UNITS)

SCALE: 6" = 1'-0"

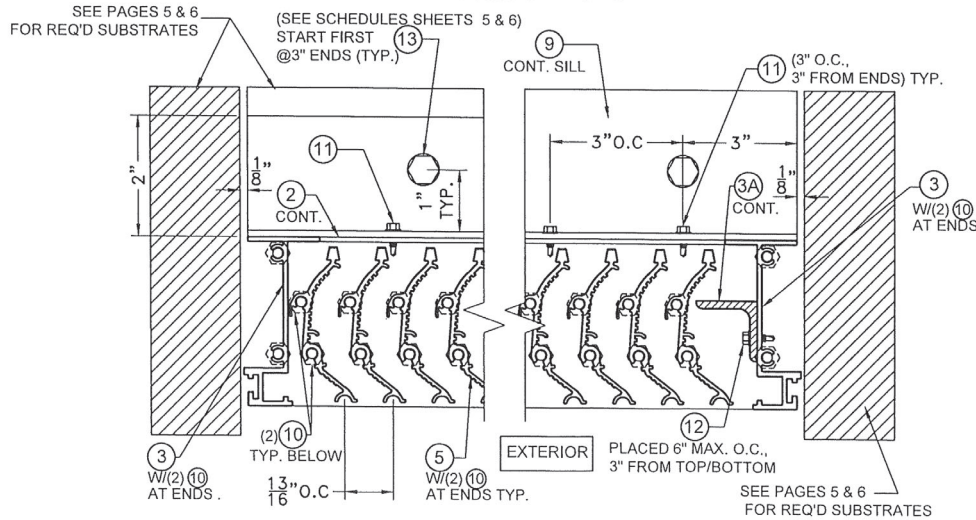

SECTION D'-D' (SINGLE UNITS)


SCALE: 6" = 1'-0"

FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)

W.H. DRAWN BY: 7/7/2025 DATE: 25-061 DRAWING NO. SHEET 8 OF 8

VERTICAL ALUMINUM LOUVER SYSTEM
S&P AIR CONTROL, LLC.
 158 GENCO DRIVE
 HICKORY ST.
 GAITHERSBURG, MD 20878
 PHONE: (423)898-7715 FAX: (423)698-8629

TILECO INC.
 TILIT TESTING & ENGINEERING COMPANY
 6332 N.W. 36th St., 3rd. Fl., Victoria Gardens, Ft. Lauderdale, FL 33316
 Phone: (305)971-1311
 FAX: (305)971-1311
 WALTER A. TILIT JR., P.E.
 FLORIDA Lic. # 44167

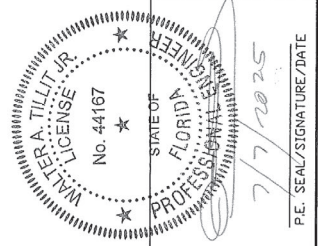

PRODUCT REVISED
 as complying with the Florida Building Code
 NOA-No. 25-0805.07
 Expiration Date 09/29/2027
 By *[Signature]*
 Miami-Dade Product Control

MIAMI-DADE COUNTY