



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

NOTICE OF ACCEPTANCE (NOA)

GAF
1 Campus Drive
Parsippany, NJ 07054

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER - Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (in Miami-Dade County) and/ or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code including the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: GAF Master Flow™ Pivot™ Pipe Boot Flashing

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/ or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of pages 1 through 6.
The submitted documentation was reviewed by Rafael Macedo.

09/25/25



NOA No.:25-0827.02
Expiration Date:09/25/30
Approval Date:09/25/25
Page 1 of 6

ROOFING COMPONENT APPROVAL

Category: Roofing
Sub-Category: Flashing
Material: Galvanized Steel
Minimum Slope: 2:12

TRADE NAMES OF PRODUCTS MANUFACTURED OR LABELED BY APPLICANT

<u>Product</u>	<u>Dimensions</u>	<u>Test Specification</u>	<u>Product Description</u>
Master Flow™ Pivot™ Pipe Boot Flashing, Small Combo (PPBGSC)	Overall Height = 15.00" Length = 12.94" Width = 12.57" 0.020" Thick Galvanized Steel	TAS 100(A)	Pipe boot flashing with base flashing and adjustable height cap assembly
Master Flow™ Pivot™ Pipe Boot Flashing, Large Combo (PPBGLC)	Overall Height = 15.00" Length = 15.0" Width = 17.20" 0.020" Thick Galvanized Steel	TAS 100(A)	Pipe boot flashing with base flashing and adjustable height cap assembly

MANUFACTURING LOCATION

1. Burgaw, NC

EVIDENCE SUBMITTED

<u>Test Agency</u>	<u>Name</u>	<u>Test Report</u>	<u>Date</u>
PRI Construction Materials Technologies	TAS 100 (A)	376T0351	02/07/23



APPROVED APPLICATIONS

Tradename: Master Flow™ Pivot™ Pipe Boot Flashing, Small Combo (PPBGSC)
Master Flow™ Pivot™ Pipe Boot Flashing, Large Combo (PPBGLC)

System Type: Mechanical attachment of flashing for asphalt shingle roof systems.

Installation: Cut a minimum 24" x 24" square piece of self-adhering leak barrier (ASTM D1970) and center the square over the top of the plumbing pipe. Cut an "X" in the leak barrier square from one outside edge of the plumbing pipe to the other, ensuring the "X" is slightly smaller than the pipe's overall width to allow the leak barrier to fit tightly around the pipe. Remove the release liner on the leak barrier and lower the leak barrier down around the plumbing pipe, firmly pressing it in place to the roof deck, roof deck protection, and up the side of the plumbing pipe itself. Proceed with shingling up to the bottom of the pipe following shingle manufacturer's installation instructions.

Separate the Pivot™ cap assembly from its base flashing assembly. Using the base flashing's built-in ball/socket pitch adjustment feature, adjust the Pivot™ so that it is oriented vertically toward the sky. With the "UP" arrow inscribed in the base flashing pointing towards the roof peak, center and slide the base flashing down over the plumbing pipe. The bottom portion of the base flashing must always sit on TOP of the shingle course below the plumbing pipe. Vertically orient the Pivot™ toward the sky using the rooftop pitch adjustment feature, centering the plumbing pipe in the base flashing.

A bead of polyurethane sealant (ASTM C920) is recommended to be applied in a 'U' shape pattern underneath the bottom and sides of the base flashing. Nail the base flashing in-place through the pre-punched fastening guides. Shingle around the Pivot using the pre-formed shingle termination guides.




GENERAL LIMITATIONS

1. Refer to applicable Building Code required ventilation.
2. For all vents listed herein, thermostat and wiring shall be installed in compliance with GAF's published instructions, and in accordance with applicable Building Codes.
3. This acceptance is for installations under asphaltic shingle roof systems only.
4. All vents listed herein shall not be installed on roof mean heights greater than 33 feet.
5. All products listed herein shall have a quality assurance audit in accordance with the Florida Building Code and Rule 61G20-3 of the Florida Administrative Code.
6. All approved products listed herein shall be labeled and shall bear the imprint or identifiable marking of the manufacturer's name or logo and following statement: "Miami-Dade County Product Control Approved" or the Miami-Dade County Product Control Seal as shown below.




DETAIL DRAWINGS
(All dimensions in inches)

MASTER FLOW™ PIVOT™ PIPE BOOT FLASHING, SMALL COMBO (PPBGSC)

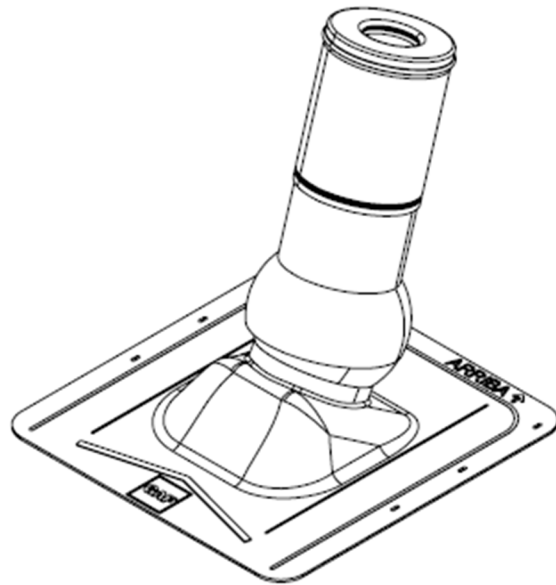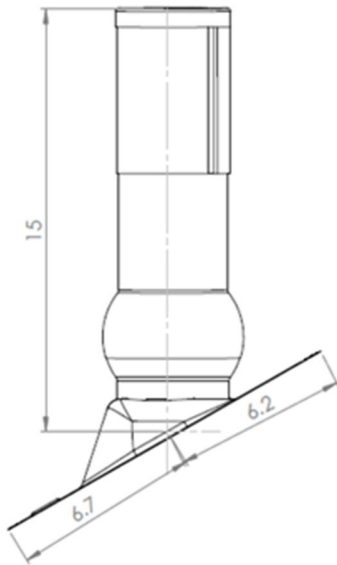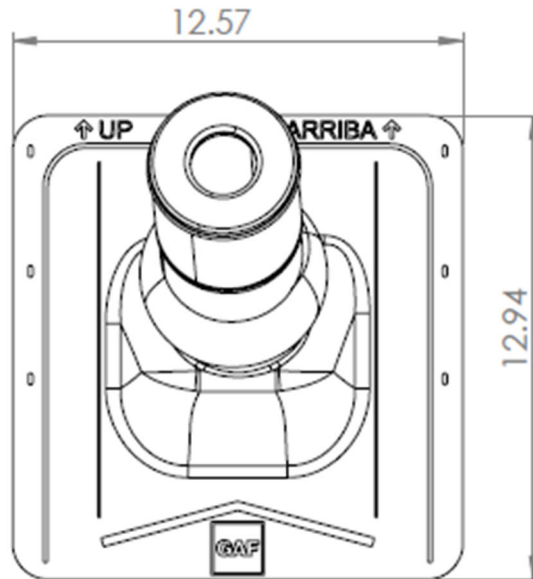

MASTER FLOW™ PIVOT™ PIPE BOOT FLASHING , LARGE COMBO (PPBGLC)

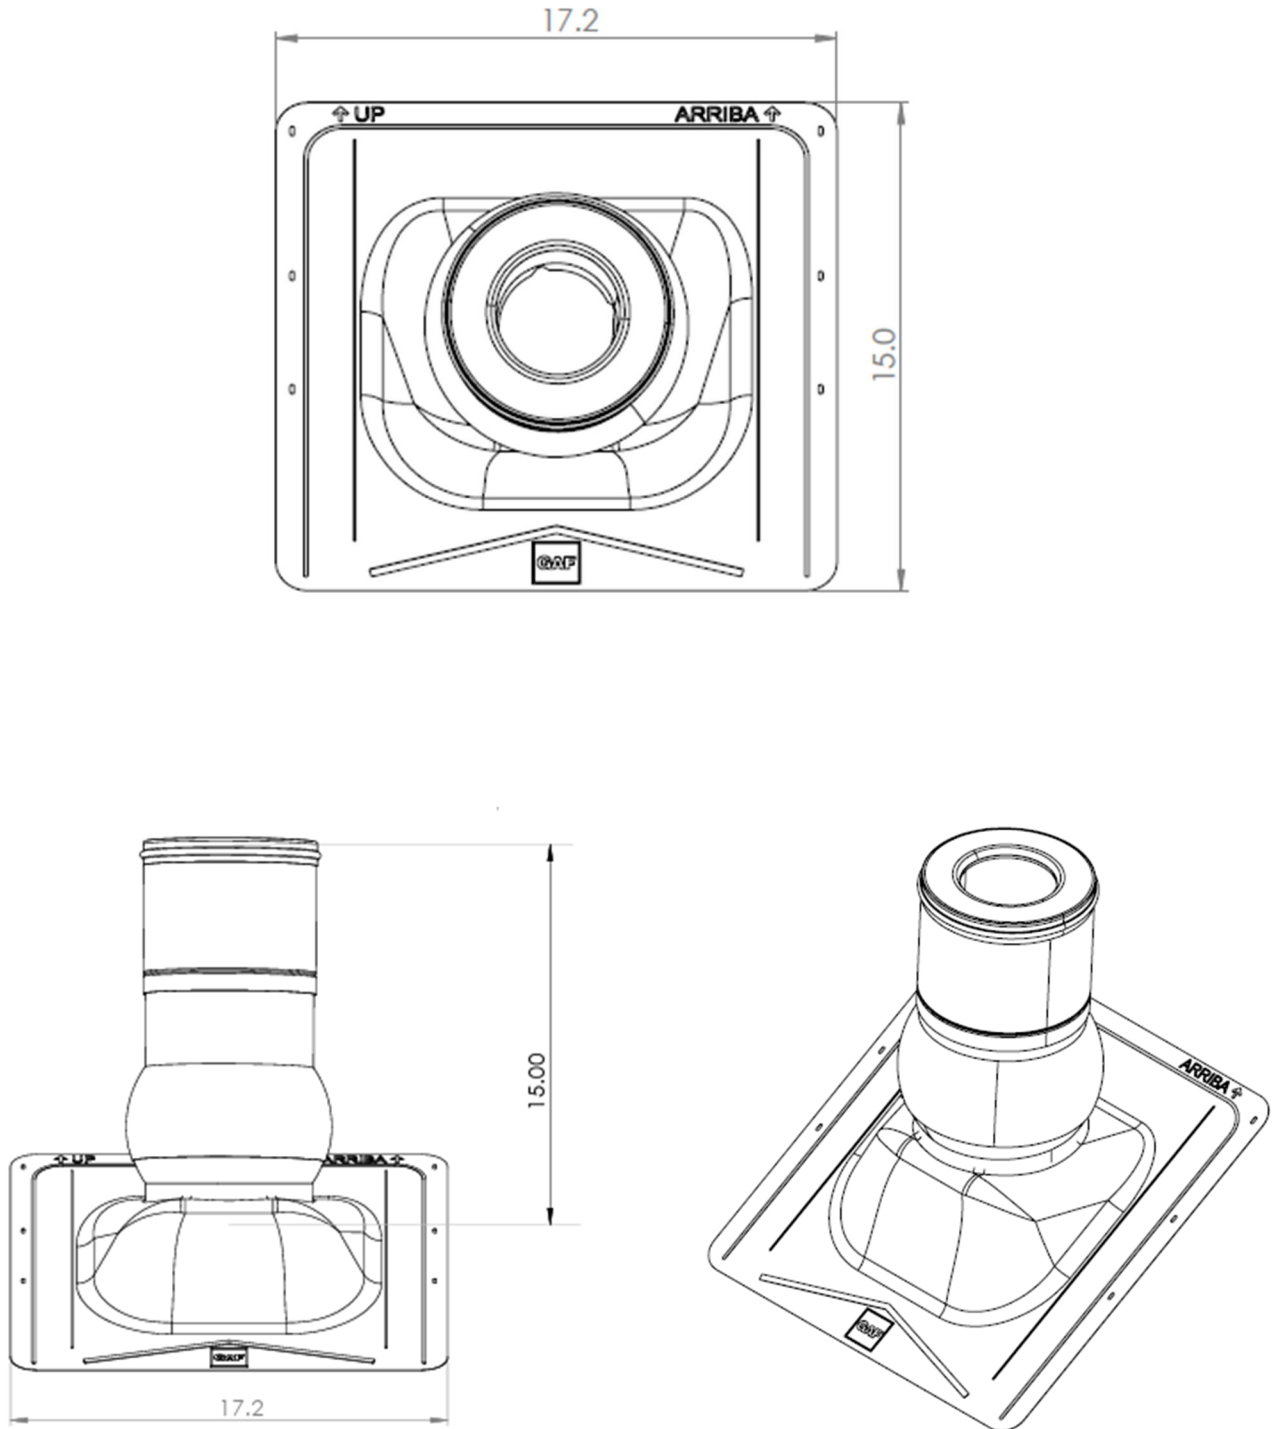

END OF THIS ACCEPTANCE