



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION
NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

Tremco CPG, Inc. (Dryvit EIFS Products)
3735 Green Road
Beachwood, OH 44122

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/ or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Dryvit Fedderlite EIF Panel System over 5/8" Gypsum Sheathing or Concrete Wall

APPROVAL DOCUMENT: Drawing No. **FS58EXP6INSTUDS**, titled "Dryvit Fedderlite System with Panzer 20 over 6" Studs with 5/8" E²XP", sheets 1 through 3 of 3, and **FSCONCBLK**, titled "Dryvit Fedderlite System over Concrete or Concrete Block, both prepared by the manufacturer, dated 08/13/2025, signed and sealed by Scott Wolters, P.E., bearing the Miami-Dade County Product Control approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, Columbus, GA and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein. Each container (bucket or drum) needs to be labeled. Unit is further defined as each roll of reinforcing mesh.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/ or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of page 1 and evidence page E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by **Carlos M. Utrera, P.E.**



12/04/25

NOA No. 25-0828.03
Expiration Date: December 11, 2030
Approval Date: December 11, 2025

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Drawing No. **FS58EXP6INSTUDS**, titled “Dryvit Fedderlite System with Panzer 20 over 6” Studs with 5/8” E²XP”, sheets 1 through 3 of 3, and **FSCONCBLK**, titled “Dryvit Fedderlite System over Concrete or Concrete Block, both prepared by the manufacturer, dated 08/13/2025, signed and sealed by Scott Wolters, P.E.

B. TESTS

1. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Tensile Strength per ASTM E8

along with marked-up drawings and installation diagram of Fedderlite Prefabricated Dryvit Outsulation EIFS Panel System, prepared by Intertek, Report No. **Q8796.01-109-18**, dated 04/24/2025, signed and sealed by Tanya A. Dolby, P.E.

C. CALCULATIONS

1. None.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS



1. None.

F. STATEMENTS

1. Statement letter of code conformance to the 8th edition (2023) of the FBC, issued by Wolters Engineering, Inc, dated 09/15/2025, signed and sealed by Scott Wolters, P.E.
2. Statement letter of no financial interest, issued by Wolters Engineering, Inc, dated 04/25/2023, signed and sealed by Scott Wolters, P.E.



Carlos M. Utrera, P.E.
Product Control Examiner
NOA No. 25-0828.03
Expiration Date: December 11, 2030
Approval Date: December 11, 2025

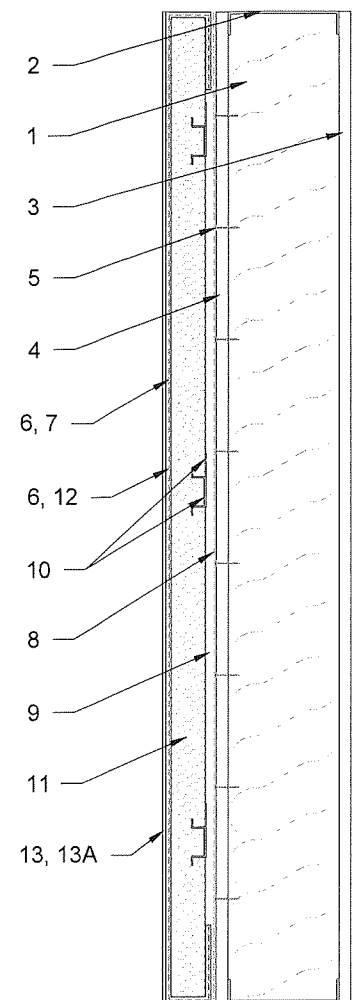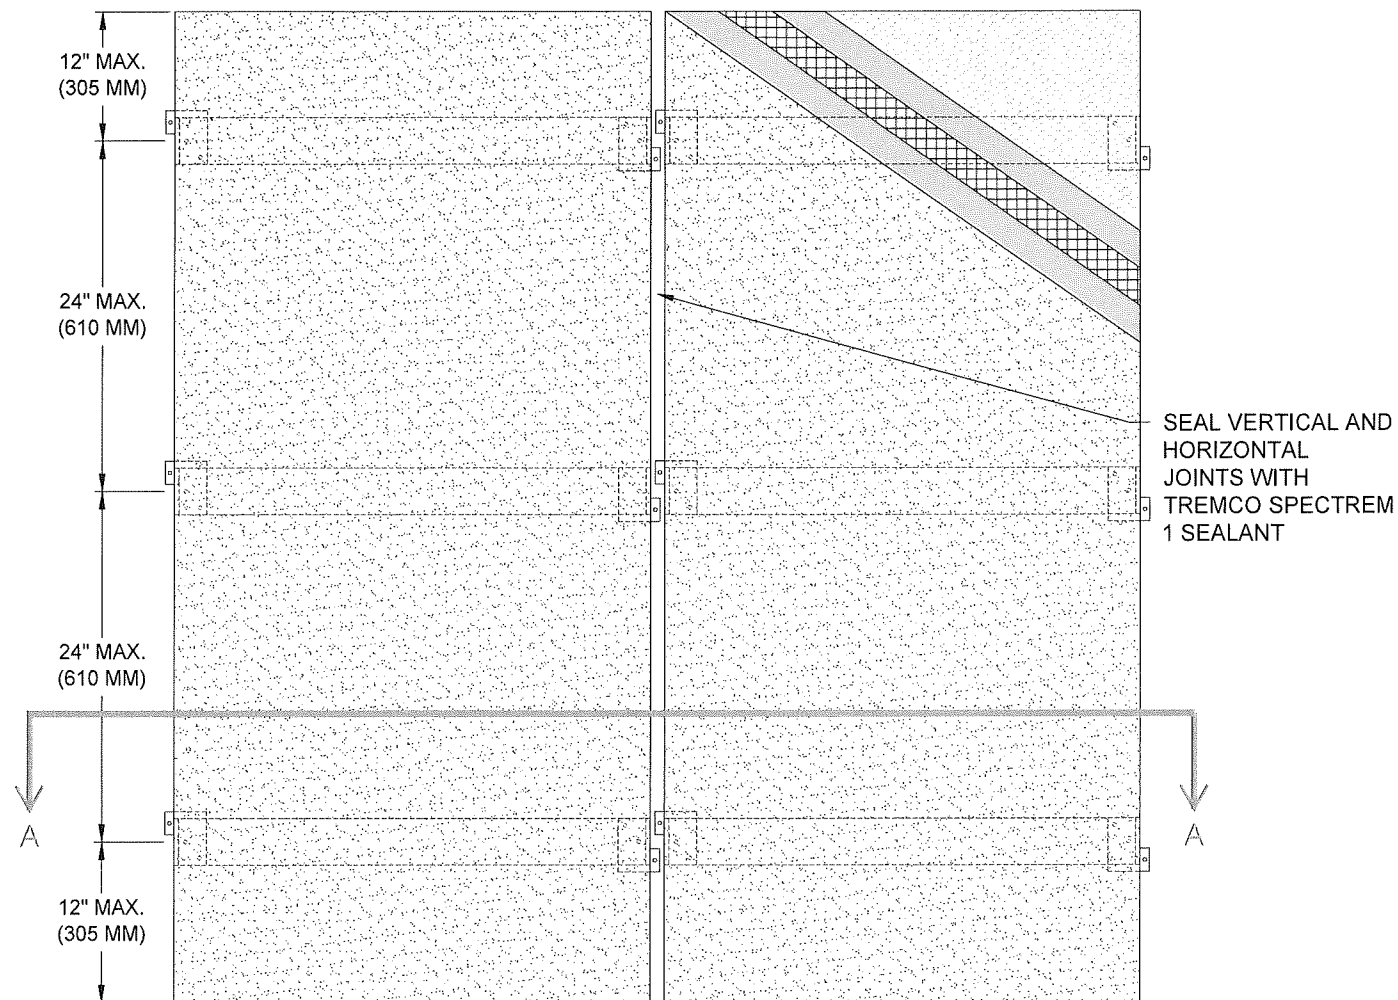


MATERIAL LIST

1. MINIMUM 6" X 16 GAUGE STEEL STUDS AT 16" O.C.
2. MINIMUM 6" X 16 GAUGE STEEL TRACK
3. MINIMUM 1/2" GYPSUM WALL BOARD
4. MINIMUM 5/8" NATIONAL GYPSUM E²XP
5. MINIMUM NO. 8 X 1 1/4" SELF DRILLING SCREWS SPACED AT 6" O.C.
6. DRYVIT BASE COAT: PRIMUS[®], GENESIS[®], OR GENESIS[®] DM; PRIMUS OR GENESIS IS MIXED 1:1 BY WEIGHT WITH PORTLAND CEMENT AND WATER. PRIMUS AND GENESIS ARE 100 PERCENT POLYMER-BASED PRODUCTS. GENESIS DM IS A DRY MIX THAT IS MIXED WITH WATER.
7. DRYVIT PANZER[®] 20 REINFORCING MESH 20.5 OZ/YD² FIBERGLASS REINFORCING MESH EMBEDDED IN THE DRYVIT BASE COAT. PANZER 20 MESH EDGES SHALL ME ABUTTED TIGHTLY. DO NOT OVERLAP.
8. DRYVIT BACKSTOP[®] NTX AIR BARRIER REQUIRED FOR FEDDERLITE SYSTEM.
9. ADHERE THE FEDDERLITE PANELS WITH DRYVIT PRIMUS, GENESIS OR GENESIS DM MIXTURE. THE ADHESIVE IS APPLIED WITH A 3/8" X 1/2" NOTCHED TROWEL WITH NOTCHES SPACED A MAXIMUM OF 1 1/2" O.C. THE ADHESIVE SHALL BE SPACED A MAXIMUM OF 1/2" APPLIED TO THE BACKSIDE OF THE EPS IN A VERTICAL ORIENTATION.
10. ALUMINUM FEDDERLITE CHANNEL AND MOUNTING PLATES. MOUNTING PLATES SHALL BE USED TO TEMPORARILY SECURE THE PANELS TO THE WALL WHILE THE ADHESIVE CURES BY USE OF MINIMUM #8 X 1 1/4" FASTENERS. FASTENERS SHALL ENGAGE STUD FRAMING OR ADDITIONAL STRAPPING THAT SPANS BETWEEN STUDS AS REQUIRED. MOUNTING PLATES SHALL BE INSTALLED IN ALL LOCATIONS AS INDICATED IN THE APPROVED FEDDERLITE PANEL SHOP DRAWINGS FOR THE PROJECT.
11. MINIMUM 2" THICK EPS INSULATION BOARD MEETING THE FBC SECTION 2612. INSULATION BOARD SUPPLIER SHALL POSSESS A CURRENT NOA WITH MIAMI DADE COUNTY.
12. DRYVIT'S STANDARD REINFORCING MESH: 4.3 OZ/SQ. YD FIBERGLASS REINFORCING MESH EMBEDDED IN THE DRYVIT BASE COAT. THE STANDARD REINFORCING MESH SHALL BE LAPPED A MINIMUM OF 2 1/2" AT ALL EDGES.
13. DRYVIT FINISH: A 100 PERCENT ACRYLIC BASED MATERIAL AVAILABLE IN VARIOUS TEXTURES; OR
- 13A. DRYVIT NEWBRICK ADHERED TO BASE COAT WITH DRYVIT PRIMUS, GENESIS, GENESIS DM MIXTURE, OR TREMCO TREMPRO[®] CHEM-X PRO.

GENERAL NOTES


1. THE SYSTEM HAS BEEN DESIGNED IN ACCORDANCE WITH THE LATEST EDITION OF THE FLORIDA BUILDING CODE INCLUDING THE LATEST SUPPLEMENTS.
2. THIS SYSTEM HAS BEEN TESTED IN ACCORDANCE WITH MIAMI DADE COUNTY PROTOCOLS TAS 201, TAS 202 AND TAS 203; IMPACT, STRUCTURAL AND CYCLIC TESTING
3. THIS SYSTEM SHALL BE APPLIED BY A LICENSED PLASTERING CONTRACTOR FOLLOWING THIS NOTICE OF ACCEPTANCE THE RECOMMENDATION OF DRYVIT SYSTEMS, INC. AND THE APPLICABLE SECTIONS OF THE FLORIDA BUILDING CODE.
4. THE ENGINEER AND/OR ARCHITECT OF RECORD FOR EACH PROJECT USING THIS SYSTEM SHALL SIZE ALL STUD FRAMING TO ENSURE CONFORMANCE WITH STUD DEFLECTION AND STRESS LIMITATIONS AS REQUIRED BY ALL GOVERNING CODES AND THIS DOCUMENT.
5. ALL STUDS USED WITH THIS SYSTEM SHALL BE COMPLETELY SHEATHED AT THE INTERIOR FLANGE OR BRIDGED AT A MAXIMUM OF EVERY 5' OF STUD LENGTH OR AS SPECIFIED BY THE STUD MANUFACTURER.
6. ALL STEEL STUDS SHALL BE STRUCTURAL WITH 1 5/8" MINIMUM FLANGE WIDTH AND HAVE A MINIMUM YIELD STRENGTH OF 50,000 PSI.
7. DETAILS ON SHEETS 2 AND 3 OF 3 ARE TYPICAL AND SHOW INTENT TO PREVENT WATER INFILTRATION INTO AND BEHIND THIS SYSTEM. ALTERNATE DETAILS AND SPECIFIC CONDITIONS NOT COVERED BY THE TYPICAL DETAILS ARE THE RESPONSIBILITY OF THE LICENSED DESIGN PROFESSIONALS.

NOTE: THE DRYVIT FEDDERLITE PANEL SYSTEM SHALL BE FABRICATED OFFSITE UTILIZING MATERIALS 6, 10, 11, 12, 13 AND 13A, IF APPLICABLE, FROM THE MATERIALS LIST PROVIDED WITHIN THIS DOCUMENT. ALL OTHER MATERIALS, SUCH AS THE AIR/WATER-RESISTIVE BARRIER SYSTEM AND ADHESIVE, SHALL BE APPLIED IN-FIELD, WITH EXCEPTION TO MATERIAL 6, WHICH IS REQUIRED FOR INSTALLATION OF THE PANZER MESH 20 OVER THE SUBSTRATE.

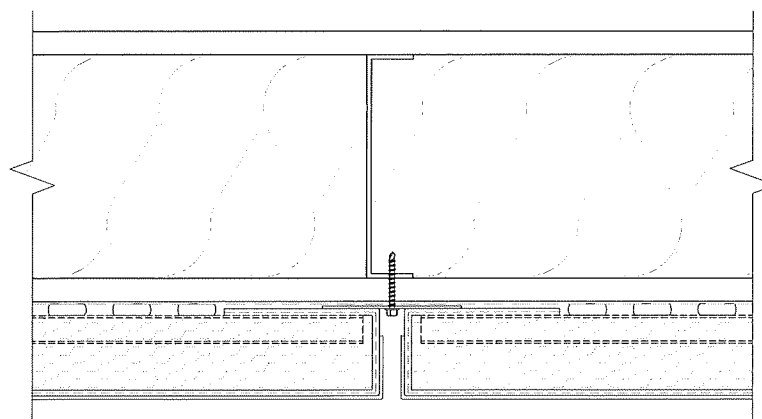


SECTION B-B

FEDDERLITE CHANNEL ISOMETRIC VIEW

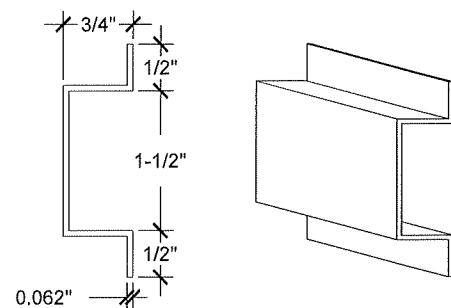

ALUMINUM FEDDERLITE CHANNEL SECTION VIEW

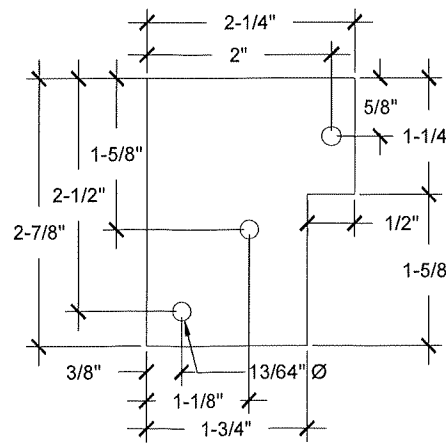

MOUNTING PLATE

PRODUCT APPROVED
 as complying with the Florida Building Code
 NOA-No. 25-0828.03
 Approval Date 12/11/2025
 By *[Signature]*
 Miami-Dade Product Control

DESIGN PRESSURE : ± 110PSF

TREMCO Construction Products Group
 Tremco CPG Inc.
 3735 Green Road
 Beachwood, Ohio 44122

DWG. NO.: FS58EXP6INSTUDS

SHEET NO: 1 OF 3	ISSUE DATE: 8/13/2025	REV DATE: -
---------------------	--------------------------	----------------

DRYVIT FEDDERLITE SYSTEM WITH PANZER 20 OVER 6" STUDS WITH 5/8" E²XP

SCOTT WOLTERS
 FL PE# 62354

WOLTERS ENGINEERING
 (COA# 27194)
 15211 97TH ROAD N
 WEST PALM BEACH, FL. 33412
 PH: (561) 225-1982

SCOTT WOLTERS
 SEAL
 No 62354
 STATE OF FLORIDA
 PROFESSIONAL ENGINEER
 NOV 25 2025



Detail: Dryvit Fedderlite System with Panzer 20 over 6" Studs with 5/8" E²XP




Drawn by: KAB	Checked by: CW	Scale: NTS
Revision #: 00	Revised by: -	Date: 10/6/2025

This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

File Name:

FL-MD-01



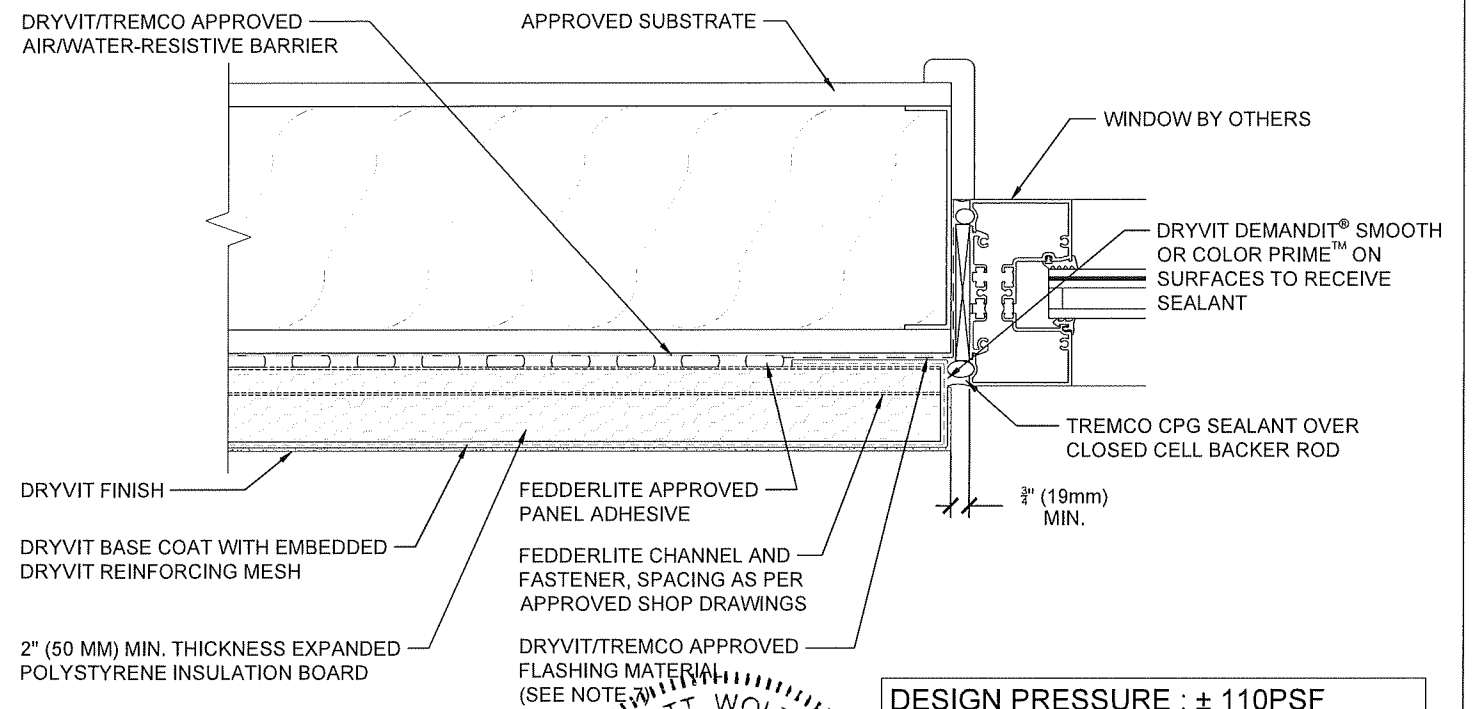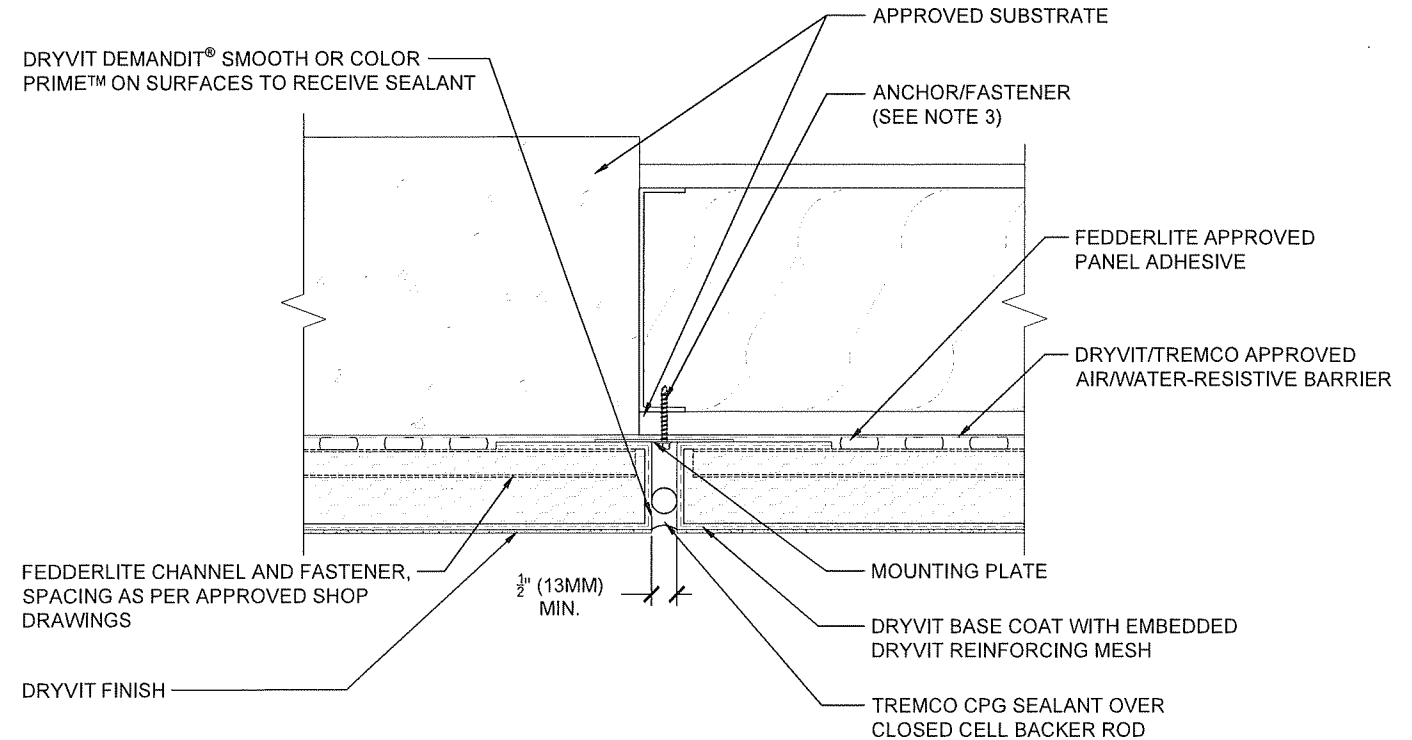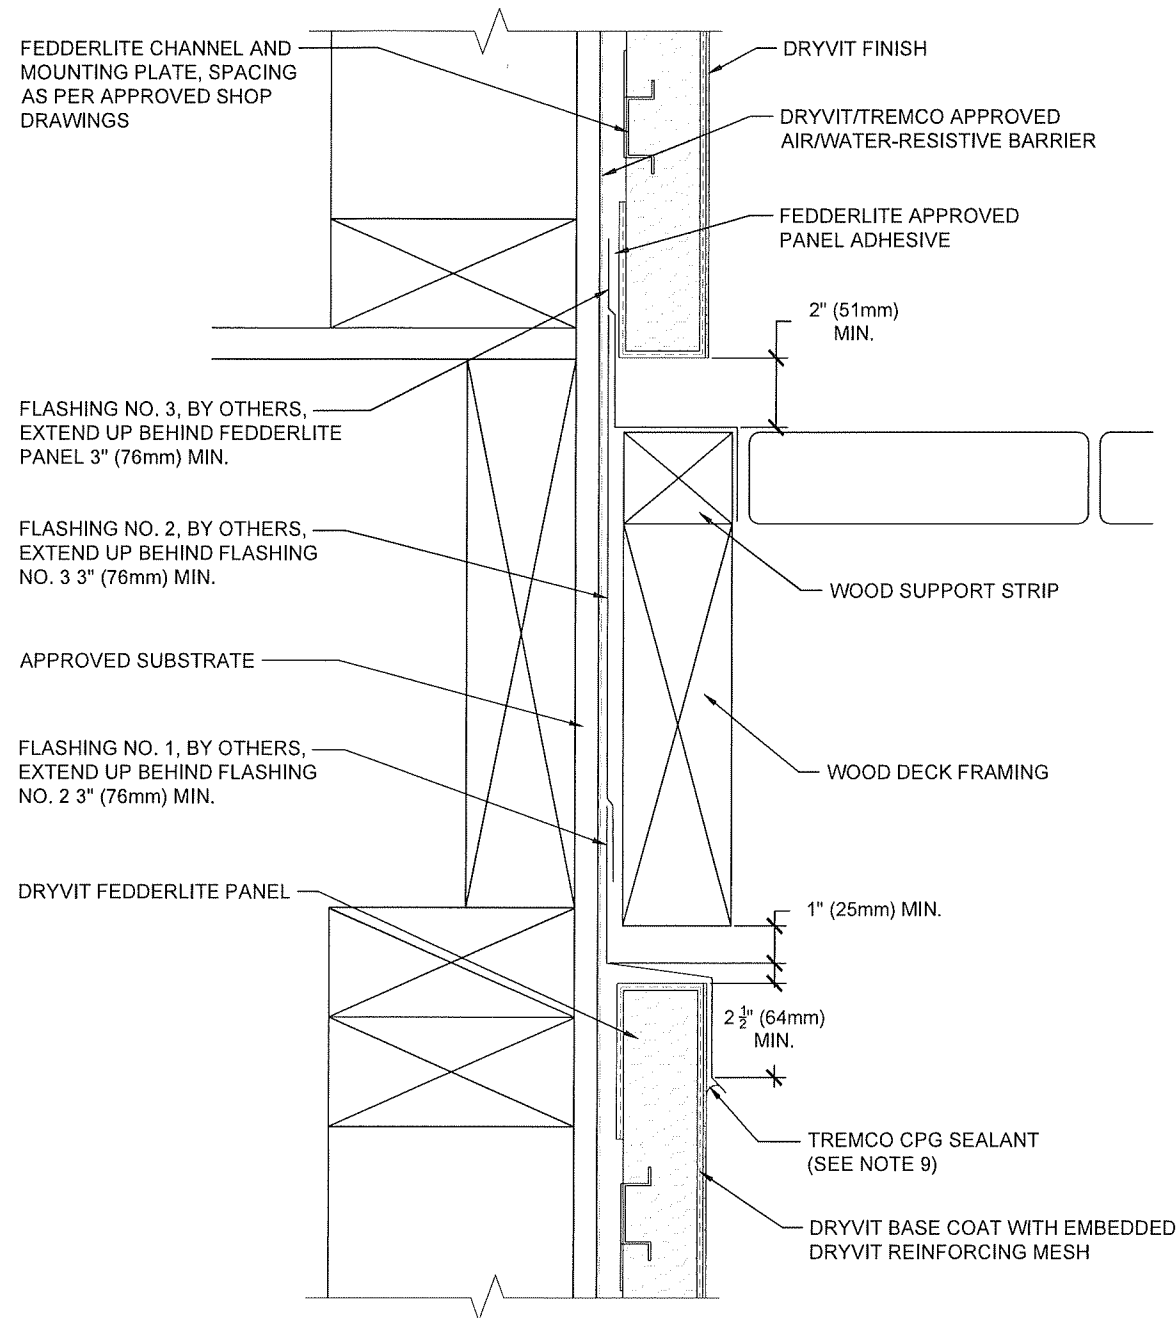


NOTES:

- MECHANICAL ATTACHMENTS ARE NECESSARY TO SUPPORT THE PANEL UNTIL THE ADHESIVE CURES. REFER TO DRYVIT PUBLICATIONS DS217 & DS113.
- GAP WOOD SHEATHING EDGE AND END JOINTS IN ACCORDANCE WITH APA (AMERICAN PLYWOOD ASSOCIATION) RECOMMENDATIONS.
- SEAL PENETRATIONS THROUGH FLASHING WHERE ATTACHED TO FRAMING
- DISTANCE OF EIFS TO DECK VARIES WITH CLIMATE. ALLOW SUFFICIENT DISTANCE TO PREVENT SNOW/ICE AND PUDDLING WATER AGAINST SYSTEM.
- PROVIDE END DAMS WHERE FLASHINGS TERMINATE AT ENDS OF DECK.
- PRESSURE TREATED WOOD (SPACE FROM FLASHING OR ROUT BACKSIDE TO PROVIDE DRAINAGE
- FLASHING MEMBRANE FOR ROUGH OPENINGS SHALL BE DRYVIT AQUAFLASH® SYSTEM, TREMCO DYMONIC® 100, TREMCO EXOAIR DUALFLASH® OR TREMCO EXOAIR® 230 WITH TREMCO 2011 MESH.
- DRYVIT AQUAFLASH® SYSTEM, TREMCO DYMONIC® 100 OR TREMCO EXOAIR® 110AT. DYMONIC® 100 MUST BE INSTALLED OVER FACE OF EXOAIR 110AT FOR COMPATIBILITY WITH DRYVIT CEMENTITIOUS ADHESIVES. DRYVIT/TREMCO FLASHING MATERIAL SHALL EXTEND 3" MIN. ONTO SHEATHING SUBSTRATE.
- REFER TO DRYVIT DS153 FOR ADDITIONAL INFORMATION REGARDING SEALANTS FOR USE WITH EIFS.

PRODUCT APPROVED
 as complying with the Florida
 Building Code
 NOA-No. 25-0828.03
 Approval Date 12/11/2025
 By *[Signature]*
 Miami-Dade Product Control

SCOTT WOLTERS
 FL PE# 62354
 WOLTERS ENGINEERING
 (COA# 27194)
 15211 97TH ROAD N
 WEST PALM BEACH, FL. 33412
 PH: (561) 225-1982

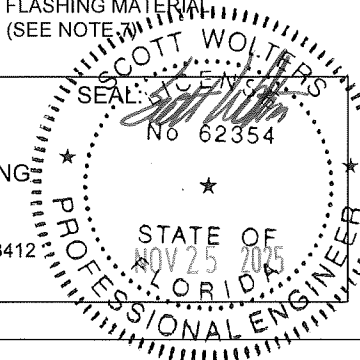

DESIGN PRESSURE : ± 110PSF		
TREMCO Construction Products Group		Tremco CPG Inc. 3735 Green Road Beachwood, Ohio 44122
DWG. NO.: FS58EXP6INSTUDS		
SHEET NO: 2 OF 3	ISSUE DATE: 8/13/2025	REV DATE: -
DRYVIT FEDDERLITE SYSTEM WITH PANZER 20 OVER 6" STUDS WITH E ² XP		

Fedderlite®







Detail: Dryvit Fedderlite System with Panzer 20 over 6" Studs with 5/8" E²XP
 Drawn by: KAB
 Checked by: CW
 Scale: NTS
 Revision #: 00
 Revised by: -
 Date: 10/6/2025

This detail is for general informational purpose only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

File Name:


FL-MD-02



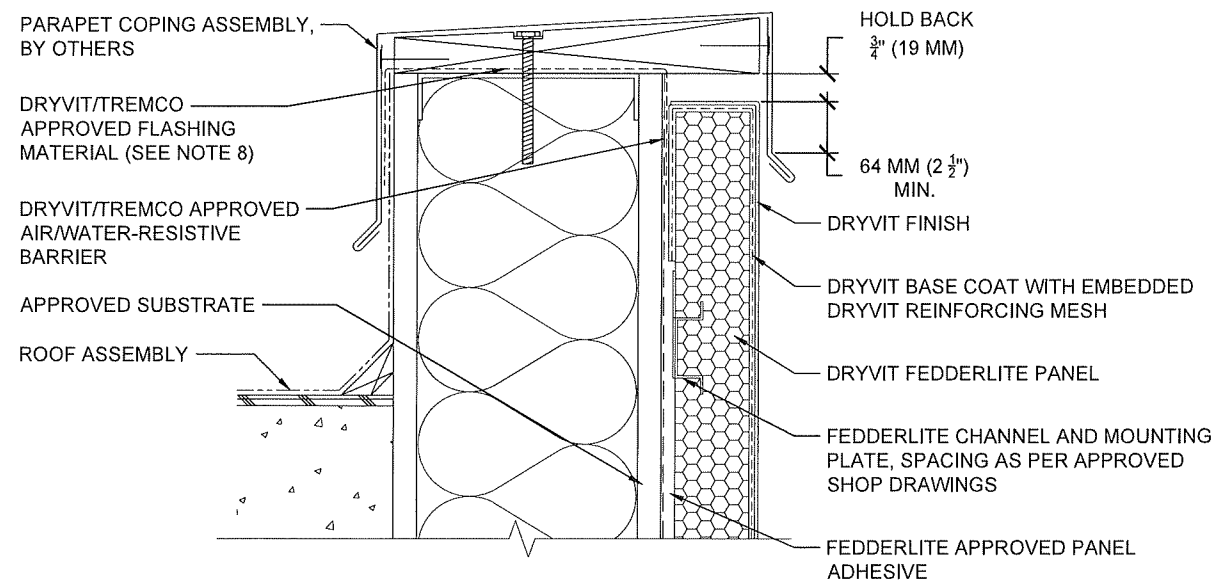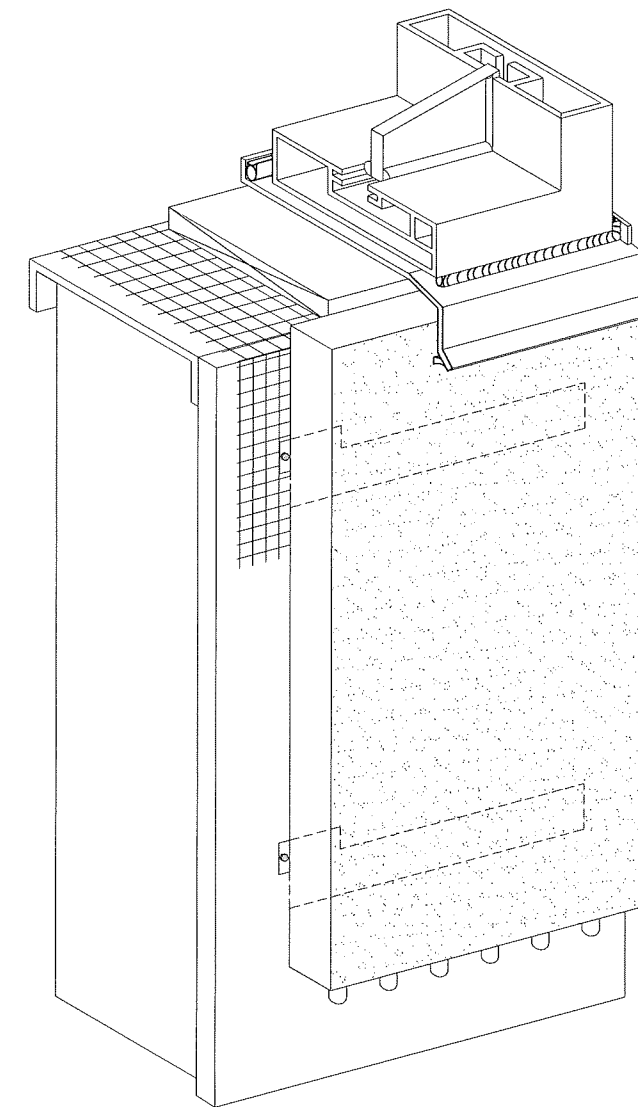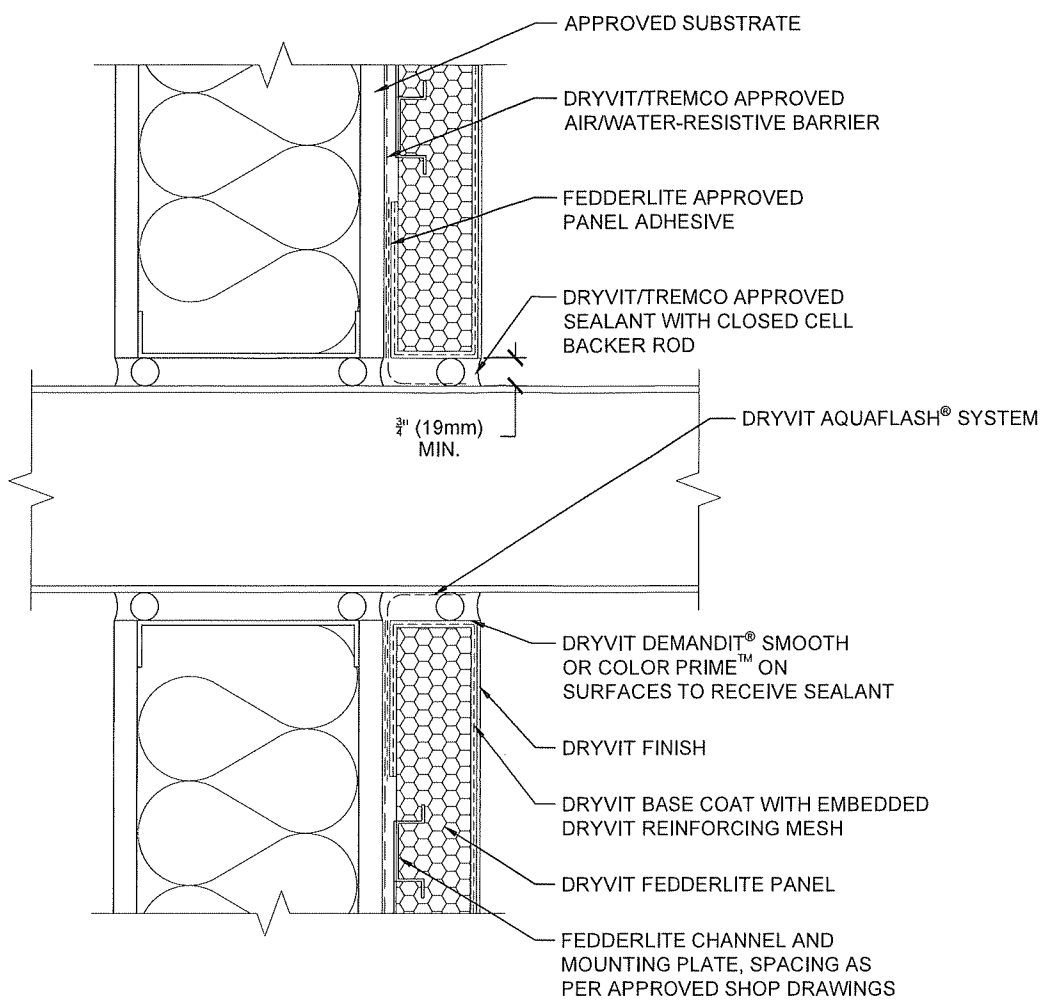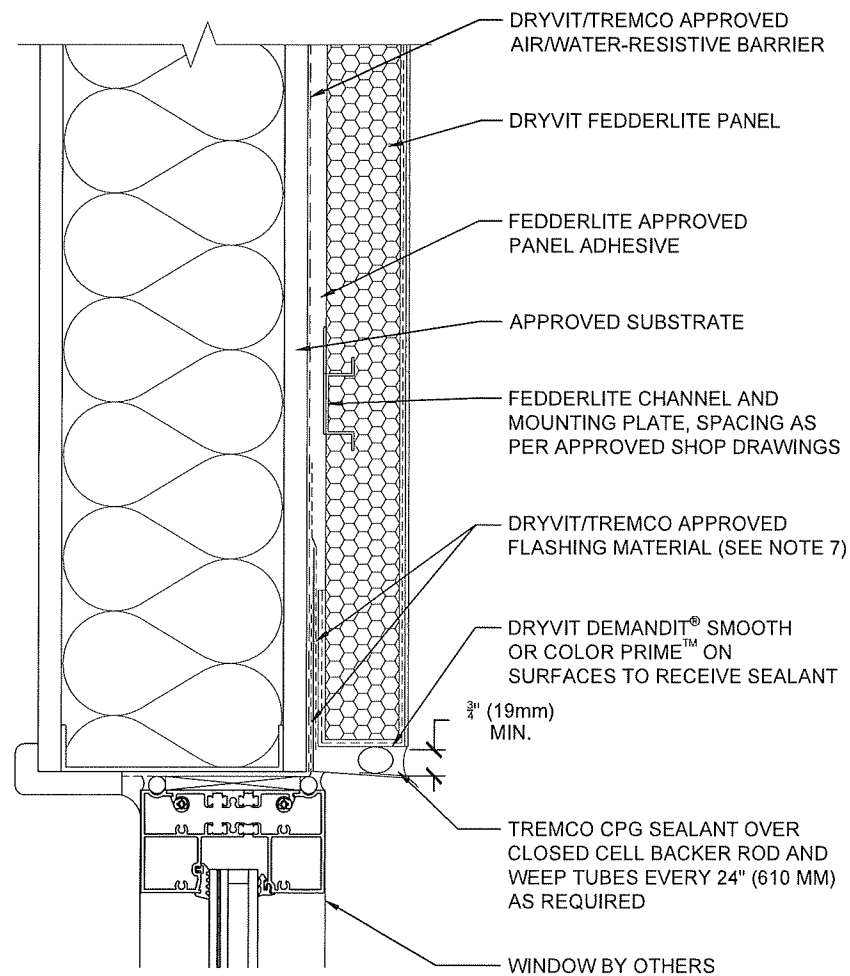

PRODUCT APPROVED
 as complying with the Florida
 Building Code
NOA-No. 25-0828.03
Approval Date 12/11/2025
 By *[Signature]*
Miami-Dade Product Control

SCOTT WOLTERS
 FL PE# 62354
 WOLTERS ENGINEERING
 (COA# 27194)
 15211 97TH ROAD N
 WEST PALM BEACH, FL. 33412
 PH: (561) 225-1982

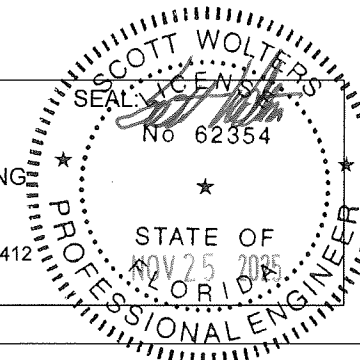

DESIGN PRESSURE : ± 110PSF		
TREMCO Construction Products Group		Tremco CPG Inc. 3735 Green Road Beachwood, Ohio 44122
DWG. NO.: FS58EXP6INSTUDS		
SHEET NO: 3 OF 3	ISSUE DATE: 8/13/2025	REV DATE: -
DRYVIT FEDDERLITE SYSTEM WITH PANZER 20 OVER 6" STUDS WITH E ² XP		

Fedderlite®





Detail: Dryvit Fedderlite System with Panzer 20 over 6" Studs with E ² XP		
Drawn by: KAB	Checked by: CW	Scale: NTS
Revision #: 00	Revised by: -	Date: 10/6/2025

This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

File Name:	FL-MD-03
------------	----------



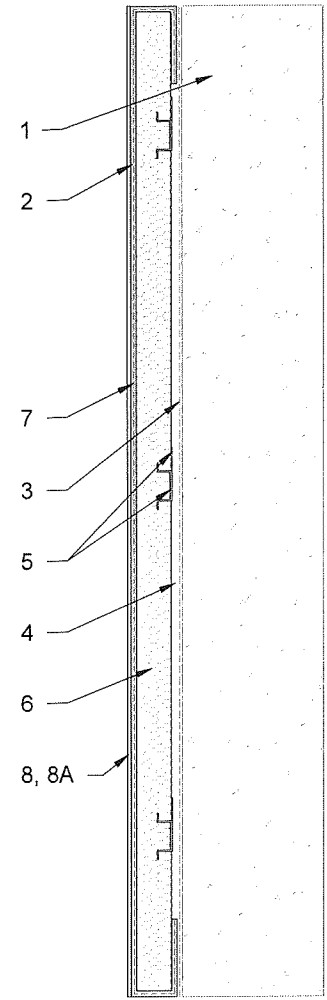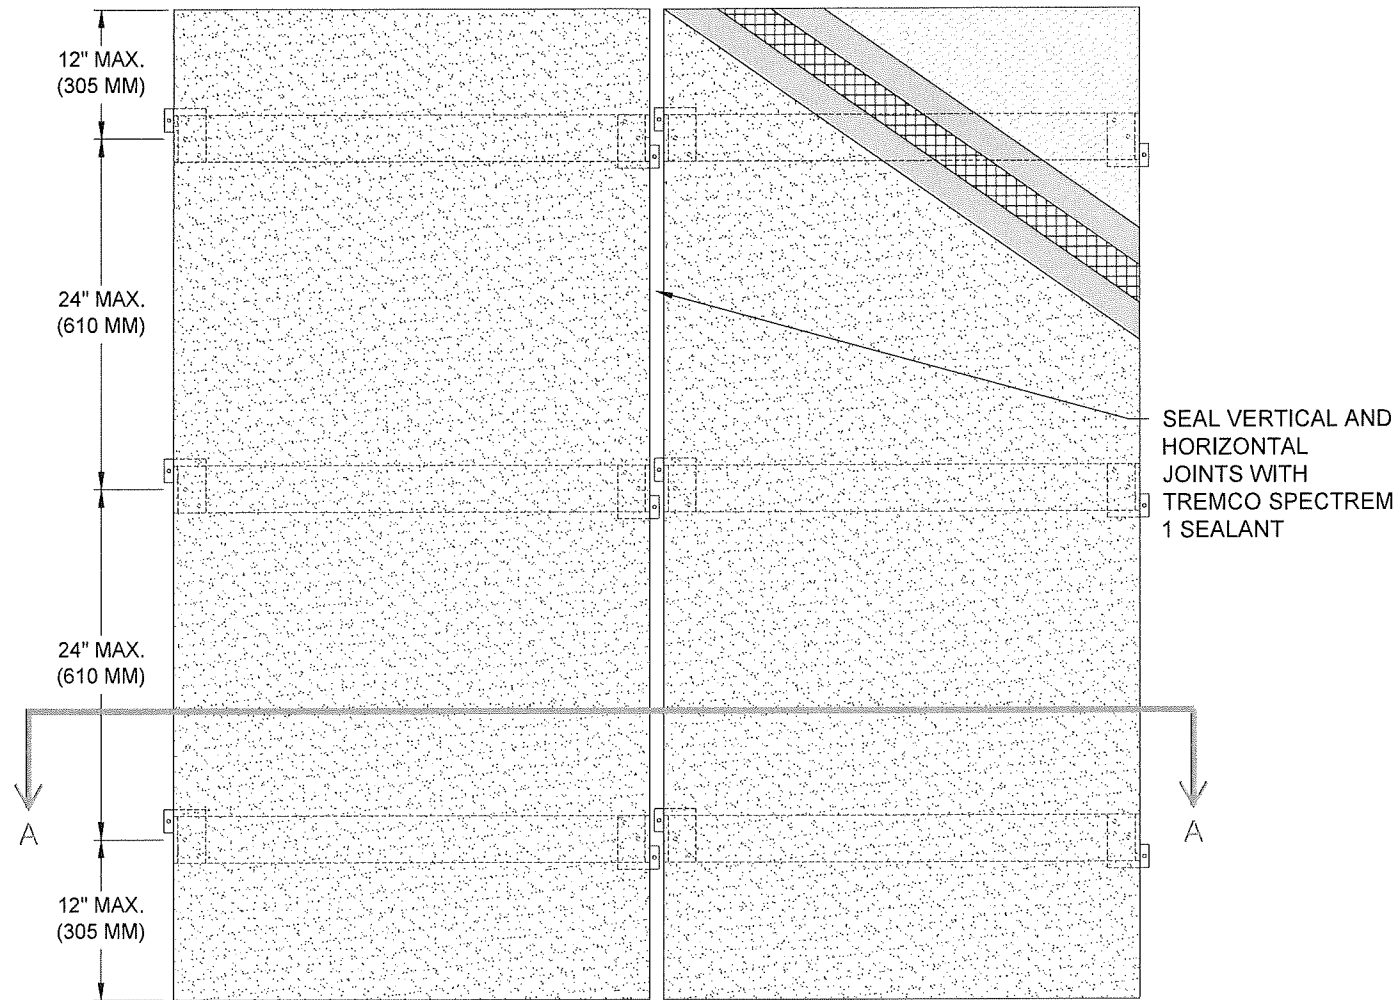


MATERIAL LIST

1. CONCRETE WALL (ACI 318) OR CONCRETE MASONRY STRUCTURE (ASTM C90) WITH TYPE S MORTAR (ASTM C270) COMPLYING WITH F.B.C.
2. DRYVIT BASE COAT: PRIMUS®, GENESIS®, OR GENESIS® DM; PRIMUS OR GENESIS IS MIXED 1:1 BY WEIGHT WITH PORTLAND CEMENT AND WATER. PRIMUS AND GENESIS ARE 100 PERCENT POLYMER-BASED PRODUCTS. GENESIS DM IS A DRY MIX THAT IS MIXED WITH WATER.
3. DRYVIT BACKSTOP® NTX AIR BARRIER REQUIRED FOR FEDDERLITE SYSTEM.
4. ADHERE THE FEDDERLITE PANELS WITH DRYVIT PRIMUS, GENESIS OR GENESIS DM MIXTURE. THE ADHESIVE IS APPLIED WITH A 3/8" X 1/2" NOTCHED TROWEL WITH NOTCHES SPACED A MAXIMUM OF 1 1/2" O.C. THE ADHESIVE SHALL BE SPACED A MAXIMUM OF 1/2" APPLIED TO THE BACKSIDE OF THE EPS IN A VERTICAL ORIENTATION.
5. ALUMINUM FEDDERLITE CHANNEL AND MOUNTING PLATES. MOUNTING PLATES SHALL BE USED TO TEMPORARILY SECURE THE PANELS TO THE WALL WHILE THE ADHESIVE CURES BY USE OF MINIMUM 3/16" X 1 1/4" CONCRETE/MASONRY ANCHORS. FASTENERS SHALL ENGAGE STUD FRAMING OR ADDITIONAL STRAPPING THAT SPANS BETWEEN STUDS AS REQUIRED. MOUNTING PLATES SHALL BE INSTALLED IN ALL LOCATIONS AS INDICATED IN THE APPROVED FEDDERLITE PANEL SHOP DRAWINGS FOR THE PROJECT.
6. MINIMUM 2" THICK EPS INSULATION BOARD MEETING THE FBC SECTION 2612. INSULATION BOARD SUPPLIER SHALL POSSES A CURRENT NOA WITH MIAMI DADE COUNTY.
7. DRYVIT'S STANDARD REINFORCING MESH: 4.3 OZ/SQ. YD FIBERGLASS REINFORCING MESH EMBEDDED IN THE DRYVIT BASE COAT. THE STANDARD REINFORCING MESH SHALL BE LAPPED A MINIMUM OF 2 1/2" AT ALL EDGES.
8. DRYVIT FINISH: A 100 PERCENT ACRYLIC BASED MATERIAL AVAILABLE IN VARIOUS TEXTURES; OR
- 8A. DRYVIT NEWBRICK ADHERED TO BASE COAT WITH DRYVIT PRIMUS, GENESIS, GENESIS DM MIXTURE OR TREMCO TREMPRO® CHEM-X PRO.

GENERAL NOTES


1. THE SYSTEM HAS BEEN DESIGNED IN ACCORDANCE WITH THE LATEST EDITION OF THE FLORIDA BUILDING CODE INCLUDING THE LATEST SUPPLEMENTS.
2. THIS SYSTEM HAS BEEN TESTED IN ACCORDANCE WITH MIAMI DADE COUNTY PROTOCOLS TAS 201, TAS 202 AND TAS 203; IMPACT, STRUCTURAL AND CYCLIC TESTING
3. THIS SYSTEM SHALL BE APPLIED BY A LICENSED PLASTERING CONTRACTOR FOLLOWING THIS NOTICE OF ACCEPTANCE THE RECOMMENDATION OF DRYVIT SYSTEMS, INC. AND THE APPLICABLE SECTIONS OF THE FLORIDA BUILDING CODE.
4. THE ENGINEER AND/OR ARCHITECT OF RECORD FOR EACH PROJECT USING THIS SYSTEM SHALL DESIGN THE CONCRETE OR BLOCK WALL TO ENSURE CONFORMANCE WITH ALL GOVERNING CODES AND THIS DOCUMENT.
5. THE CONCRETE OR BLOCK WALL SURFACE SHALL BE DRY, CLEAN, AND FREE OF ALL LOOSE DEBRIS PRIOR TO PLACING THE SYSTEM. DRYVIT GENESIS MAY BE USED AS A LEVELING COAT TO REMOVE PLANAR IRREGULARITIES IN THE SUBSTRATE, IF REQUIRED.
6. DETAILS ON SHEETS 2 AND 3 OF 3 ARE TYPICAL AND SHOW INTENT TO PREVENT WATER INFILTRATION INTO AND BEHIND THIS SYSTEM. ALTERNATE DETAILS AND SPECIFIC CONDITIONS NOT COVERED BY THE TYPICAL DETAILS ARE THE RESPONSIBILITY OF THE LICENSED DESIGN PROFESSIONALS.

NOTE: THE DRYVIT FEDDERLITE PANEL SYSTEM SHALL BE FABRICATED OFFSITE UTILIZING MATERIALS 2, 5, 6, 7, 8, AND 8A, IF APPLICABLE, FROM THE MATERIALS LIST PROVIDED WITHIN THIS DOCUMENT. ALL OTHER MATERIALS, SUCH AS THE AIR/WATER-RESISTIVE BARRIER SYSTEM AND ADHESIVE, SHALL BE APPLIED IN-FIELD.

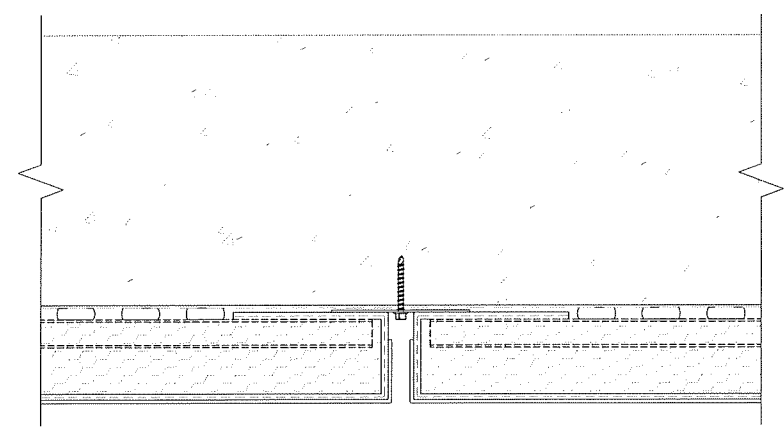


SECTION B-B

FEDDERLITE CHANNEL ISOMETRIC VIEW

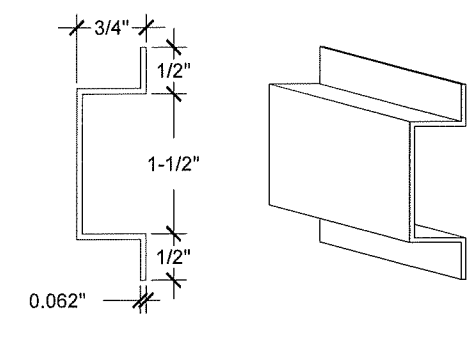

ALUMINUM FEDDERLITE CHANNEL SECTION VIEW

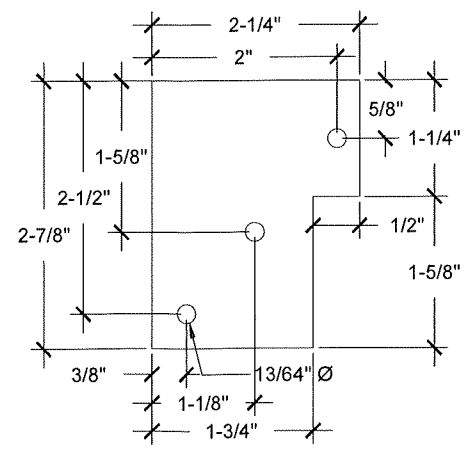


MOUNTING PLATE

PRODUCT APPROVED
 as complying with the Florida Building Code
 NOA-No. 25-0828.03
 Approval Date 12/11/2025
 By *[Signature]*
 Miami-Dade Product Control

DESIGN PRESSURE : ± 110PSF

SCOTT WOLTERS
 FL PE# 62354
 WOLTERS ENGINEERING
 (COA# 27194)
 15211 97TH ROAD N
 WEST PALM BEACH, FL. 33412
 PH: (561) 225-1982

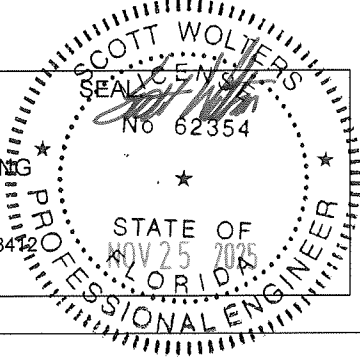

Tremco CPG Inc. 3735 Green Road Beachwood, Ohio 44122		
DWG. NO.: FSCONCBLK		
SHEET NO: 1 OF 3	ISSUE DATE: 8/13/2025	REV DATE: -
DRYVIT FEDDERLITE SYSTEM OVER CONCRETE OR CONCRETE BLOCK		





Detail: Dryvit Fedderlite System over Concrete of Concrete Block		
Drawn by: KAB	Checked by: CW	Scale: NTS
Revision #: 00	Revised by: -	Date: 11/3/2025

This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

File Name:
 FL-MD-C-01



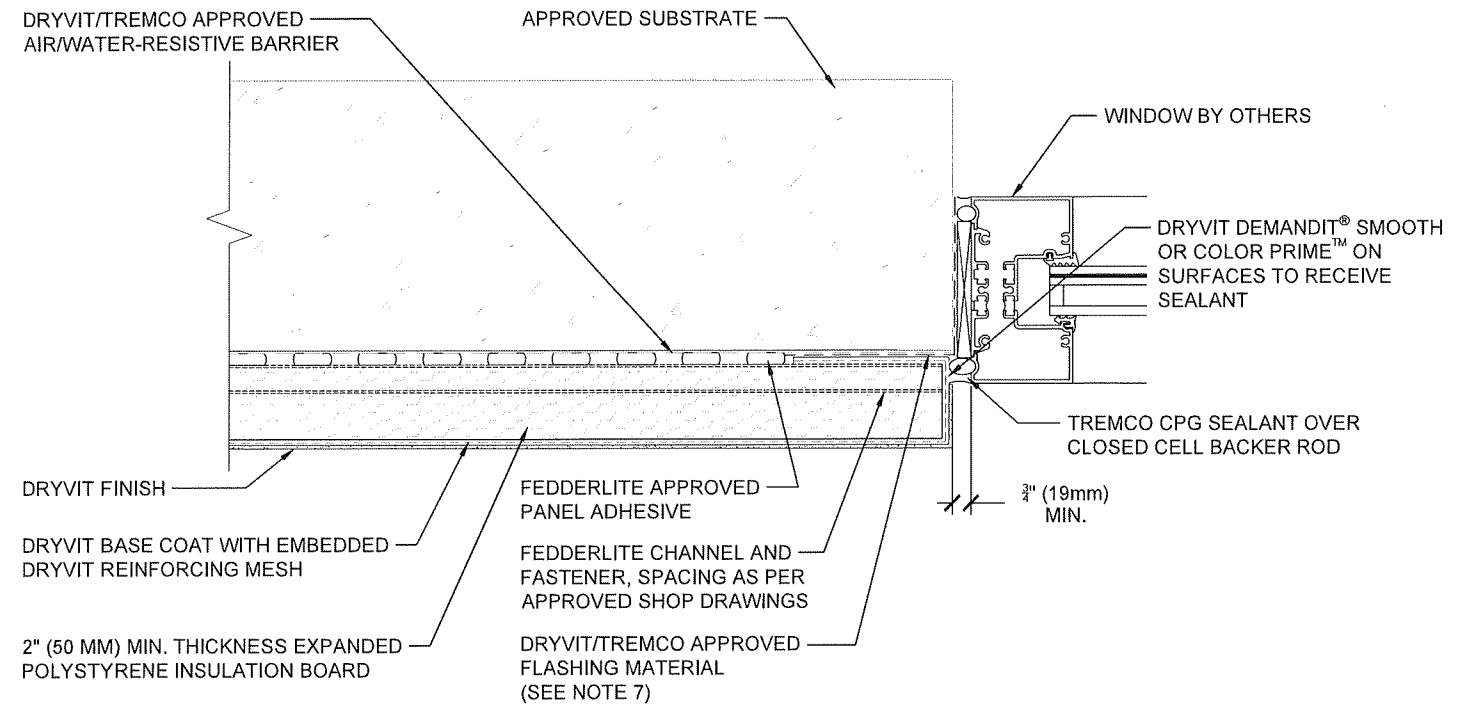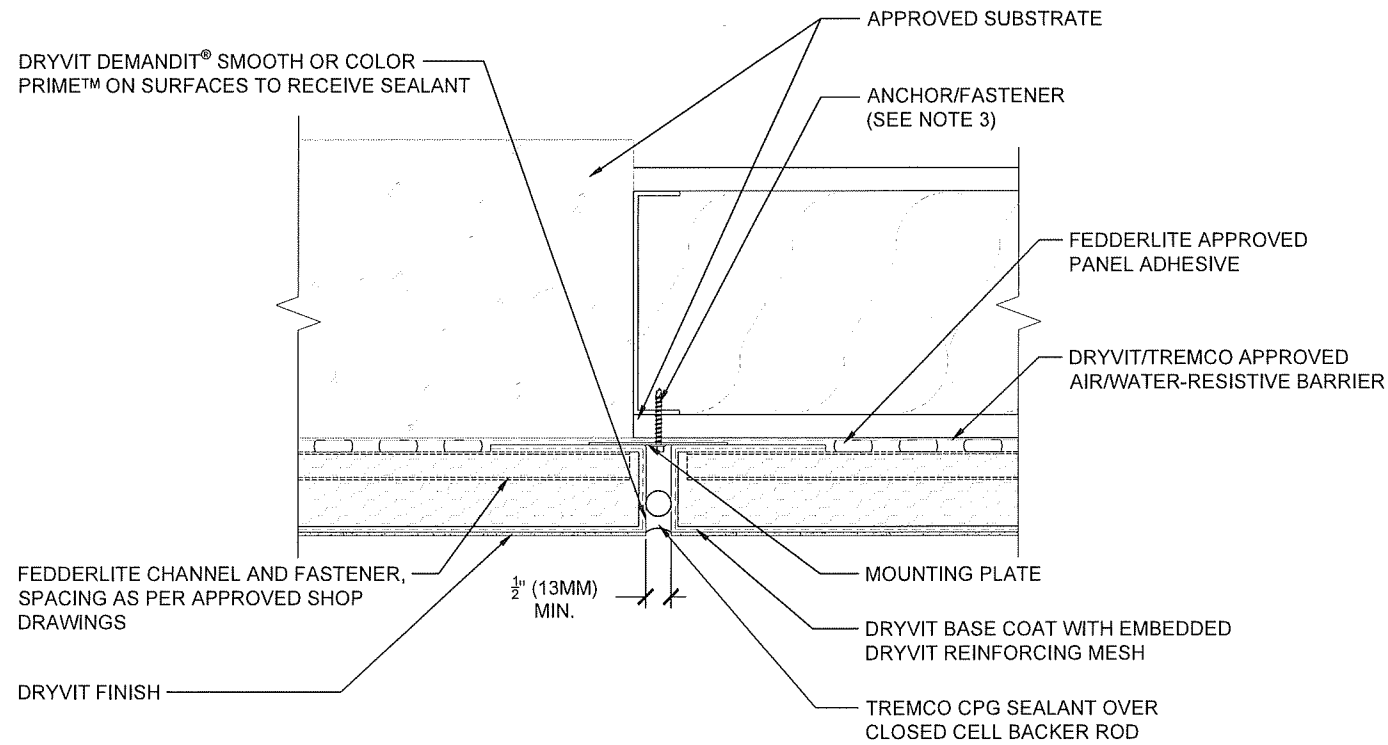

NOTES:

- MECHANICAL ATTACHMENTS ARE NECESSARY TO SUPPORT THE PANEL UNTIL THE ADHESIVE CURES. REFER TO DRYVIT PUBLICATIONS DS217 & DS113.
- SEAL PENETRATIONS THROUGH FLASHING WHERE ATTACHED TO SUBSTRATE
- FLASHING MEMBRANE FOR ROUGH OPENINGS SHALL BE DRYVIT AQUAFLASH® SYSTEM, TREMCO DYMONIC® 100, TREMCO EXOAIR DUALFLASH® OR TREMCO EXOAIR® 230 WITH TREMCO 2011 MESH.
- DRYVIT AQUAFLASH® SYSTEM, TREMCO DYMONIC® 100 OR TREMCO EXOAIR® 110AT. DYMONIC® 100 MUST BE INSTALLED OVER FACE OF EXOAIR 110AT FOR COMPATIBILITY WITH DRYVIT CEMENTITIOUS ADHESIVES. DRYVIT/TREMCO FLASHING MATERIAL SHALL EXTEND 3" MIN. ONTO CONCRETE/CMU SUBSTRATE.
- REFER TO DRYVIT DS153 FOR ADDITIONAL INFORMATION REGARDING SEALANTS FOR USE WITH EIFS.

PRODUCT APPROVED
as complying with the Florida
Building Code


NOA-No. 25-0828.03

Approval Date 12/11/2025

By *[Signature]*
Miami-Dade Product Control

SCOTT WOLTERS
FL PE# 62354

WOLTERS ENGINEERING
(COA# 27194)
15211 97TH ROAD N
WEST PALM BEACH, FL. 33412
PH: (561) 225-1982

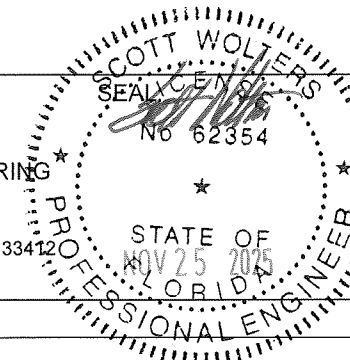

DESIGN PRESSURE : ± 110PSF

TREMCO Construction Products Group		Tremco CPG Inc. 3735 Green Road Beachwood, Ohio 44122
DWG. NO.: FSCONCBLK		
SHEET NO: 2 OF 3	ISSUE DATE: 8/13/2025	REV DATE: -
DRYVIT FEDDERLITE SYSTEM OVER CONCRETE OR CONCRETE BLOCK		

Fedderlite®



Detail: Dryvit Fedderlite System over Concrete of Concrete Block





Drawn by: KAB	Checked by: CW	Scale: NTS
Revision #: 00	Revised by: -	Date: 11/3/2025

This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

File Name:


FL-MD-C-02



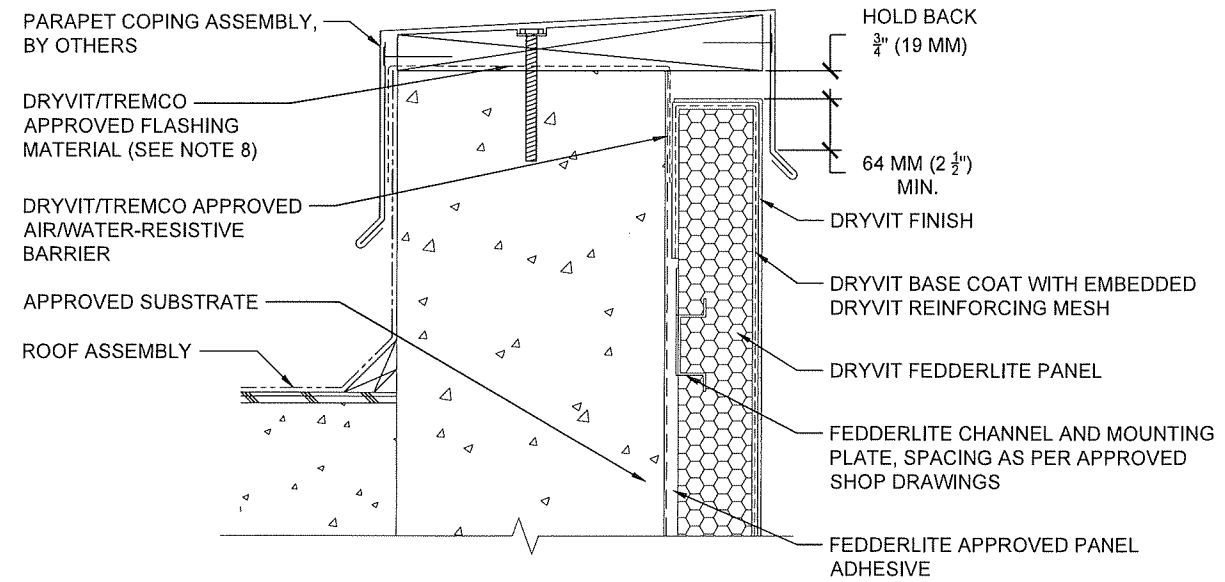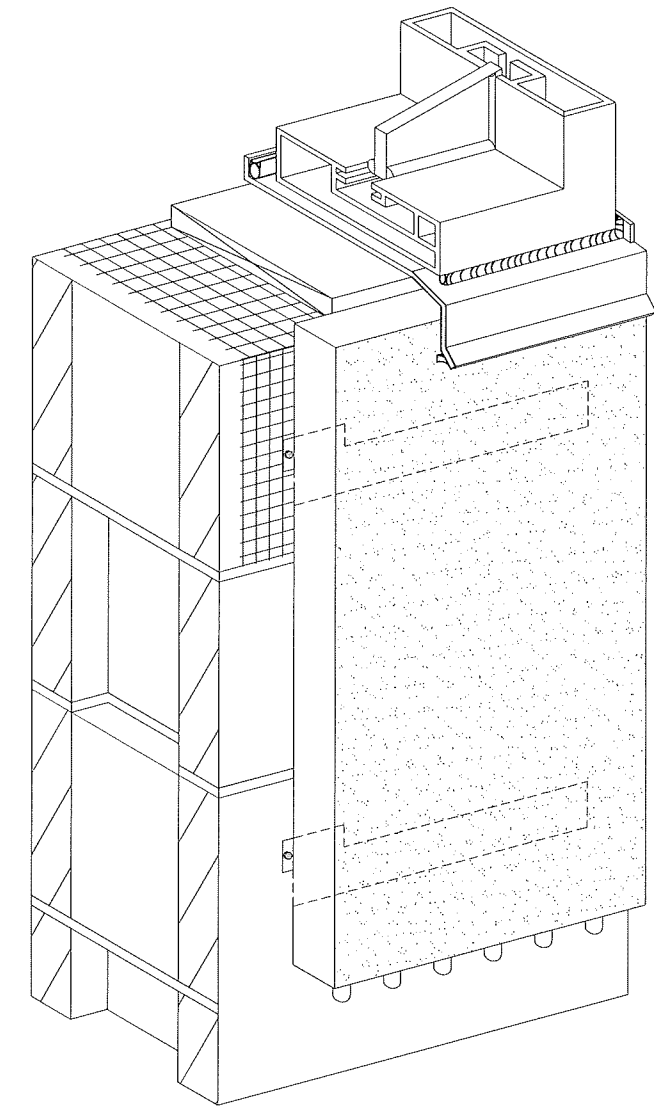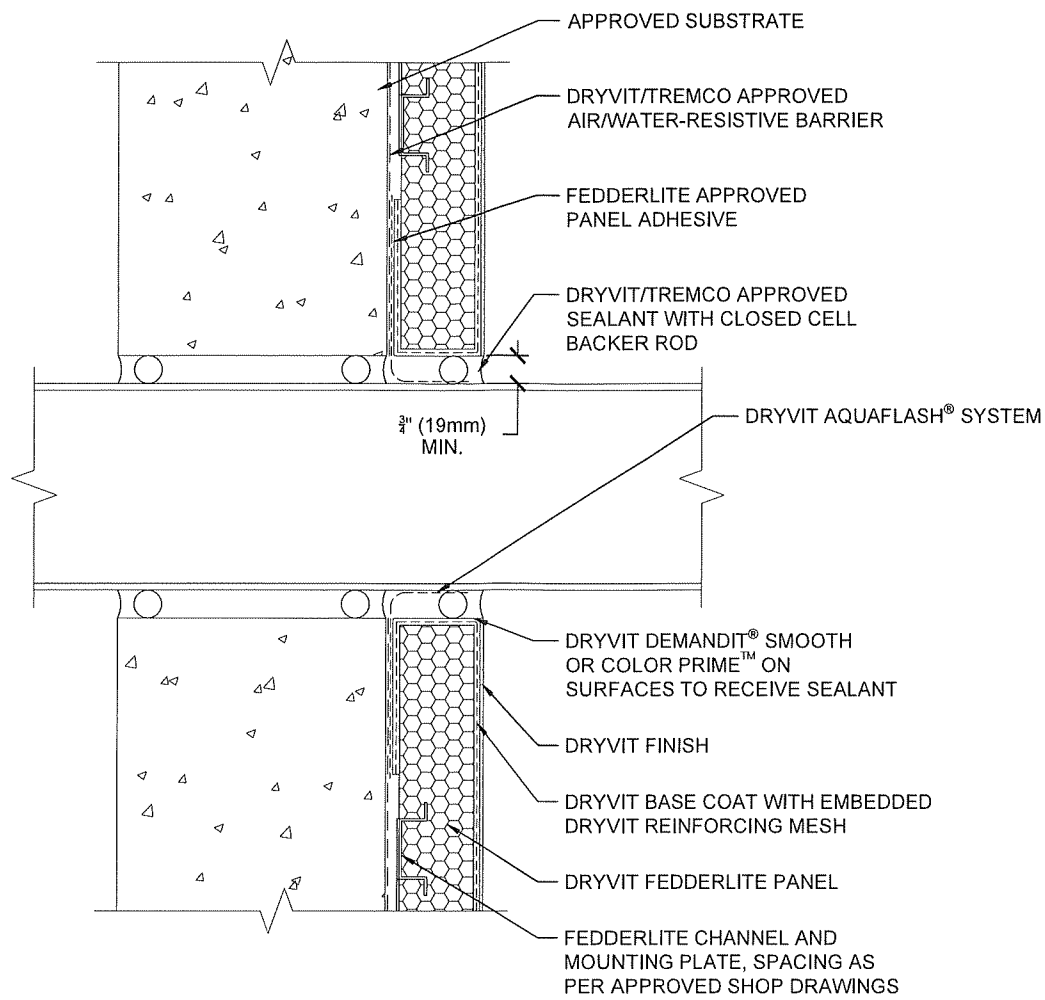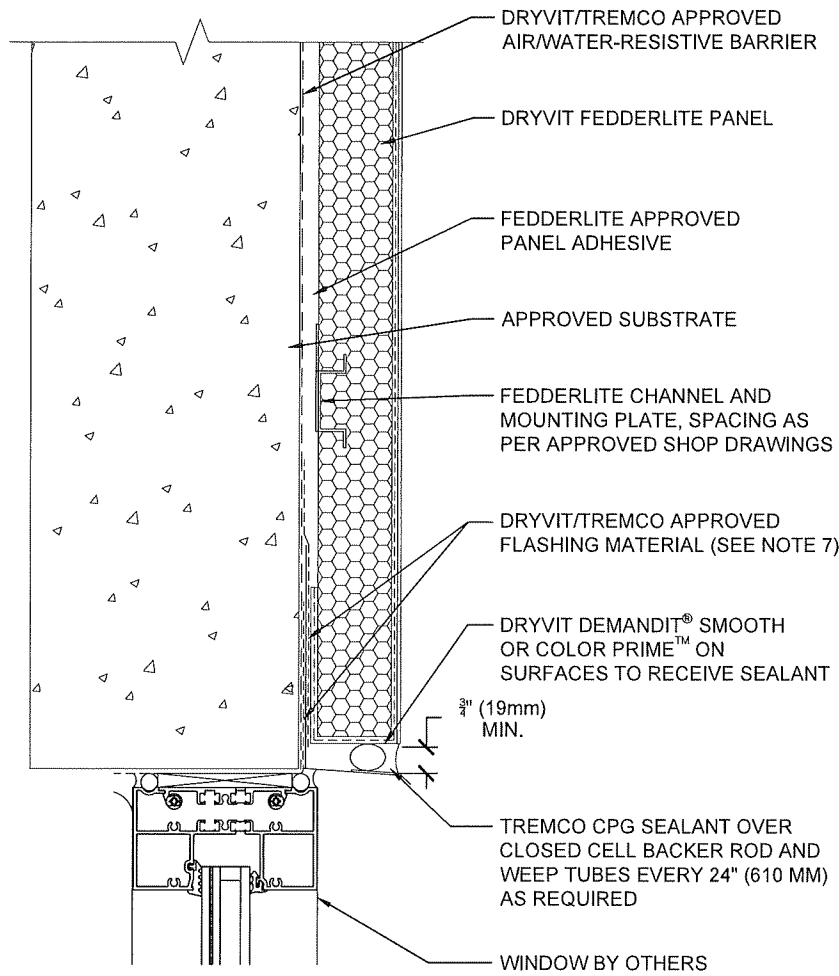

PRODUCT APPROVED
 as complying with the Florida
 Building Code
 NOA-No. 25-0828.03
 Approval Date 12/11/2025
 By *[Signature]*
 Miami-Dade Product Control

SCOTT WOLTERS
 FL PE# 62354
 WOLTERS ENGINEERING
 (COA# 27194)
 15211 97TH ROAD N
 WEST PALM BEACH, FL 33412
 PH: (561) 225-1982

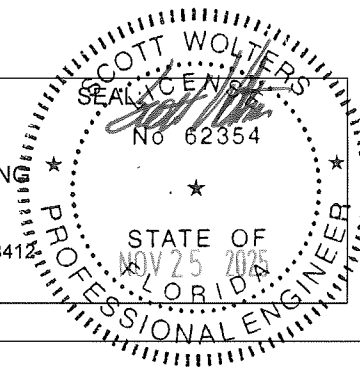

DESIGN PRESSURE : ± 110PSF		
TREMCO Construction Products Group		Tremco CPG Inc. 3735 Green Road Beachwood, Ohio 44122
DWG. NO.: FSCONCBLK		
SHEET NO: 3 OF 3	ISSUE DATE: 8/13/2025	REV DATE: -
DRYVIT FEDDERLITE SYSTEM OVER CONCRETE OR CONCRETE BLOCK		

Fedderlite®



Detail: Dryvit Fedderlite System over Concrete or Concrete Block		
Drawn by: KAB	Checked by: CW	Scale: NTS
Revision #: 00	Revised by: -	Date: 11/3/2025

This detail is for general informational purposes only. The project design professional determines, in its sole discretion, whether this detail or a functionally equivalent detail is best suited for the project with respect to any architecture, engineering, and design requirements, including any local building code requirements. If this document is not reviewed and the product is not approved for use by a licensed design professional, the customer agrees that the detail may contain substantive flaws requiring correction, and hereby releases Tremco CPG Inc. from any and all liability related to the design and installation of the product. This detail is subject to change without notice. Contact Tremco to ensure you have the most recent version.

File Name:	FL-MD-C-03
------------	------------

