



MIAMI-DADE COUNTY, FLORIDA
PRODUCT CONTROL SECTION

11805 SW 26 Street, Room 208

Miami, Florida 33175-2474

T (786) 315-2590 F (786) 315-2599

DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

www.miamidade.gov/economy

Harmon, Inc.

1209 Edgewater Drive, Suite 200

Orlando, FL 32804

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER - Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "HI 7000" Pressure Plate Glazed, Aluminum Curtain Wall System – L.M.I.

APPROVAL DOCUMENT: Drawing No. **HI7000LM**, titled "Harmon HI 7000 Large Missile – Preglazed & Unitized Pressure Plate Glazing, Aluminum Curtainwall System", sheets 01 through 41 of 41, dated 06/28/04, with revision #9 dated 08/12/25, prepared by manufacturer, signed and sealed by Ethan A. Charpentier, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LIMITATIONS: Insulated glass options 12 and 19 may not be used in installations above 30 feet above grade (Small Missile Impact area).

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, 4290 Port Union Road, West Chester, OH 45011, model/series, and the following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises and renews NOA No. 19-0409.06** and consists of this page 1 and evidence pages E-1, E-2, E-3 and E-4, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**




9/18/25

NOA No. 25-0902.03

Expiration Date: September 02, 2029

Approval Date: September 25, 2025

Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED


1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's

A. DRAWINGS

1. Manufacturer's die drawings and sections.
(Submitted under NOA No. 04-0217.11)
2. Drawing No. **HI7000LM**, titled "Harmon HI 7000 Large Missile Preglazed & Unitized Pressure Plate Glazing, Aluminum Curtainwall System", sheets 01 through 41 of 41, dated 06/28/04, with revision #7 dated 03/05/19, prepared by manufacturer, signed and sealed by Ethan A. Charpentier, P.E.
(Submitted under NOA No. 19-0409.06)

B. TESTS

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Small Missile Impact Test per FBC, TAS 201-94
6) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of an aluminum unitized window wall system, prepared by Hurricane Test Laboratory, Inc., Test Report No. **HTL-0319-0509-06**, dated 08/15/08, signed and sealed by Vinu J. Abraham, P.E.
(Submitted under NOA No. 08-1015.03)
2. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Small Missile Impact Test per FBC, TAS 201-94
5) Large Missile Impact Test per FBC, TAS 201-94
6) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of an aluminum window wall system (specimens 10, 11, 12 & 13), prepared by Hurricane Test Laboratory, Inc., Test Report No. **HTL-0319-0107-03**, various dates, signed and sealed by Vinu J. Abraham, P.E.
(Submitted under NOA No. 04-0217.11)
3. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
2) Small Missile Impact Test per FBC, TAS 201-94
3) Large Missile Impact Test per FBC, TAS 201-94
4) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of an aluminum window wall system (specimen 1), prepared by Hurricane Test Laboratory, Inc., Test Report No. **HTL-0319-0511-03**, dated 5/06-08/03, signed and sealed by Vinu J. Abraham, P.E.
(Submitted under NOA No. 04-0217.11)

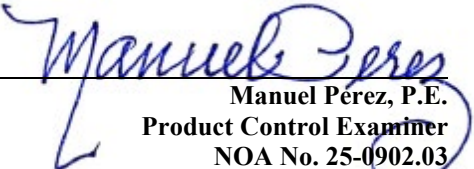

Manuel Perez, P.E.
Product Control Examiner
NOA No. 25-0902.03
Expiration Date: September 02, 2029
Approval Date: September 25, 2025

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's (CONTINUED)

B. TESTS (CONTINUED)

4. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Small Missile Impact Test per FBC, TAS 201-94
5) Large Missile Impact Test per FBC, TAS 201-94
6) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of an aluminum window wall system (specimen 1), prepared by Hurricane Test Laboratory, Inc., Test Report No. **HTL-0319-0711-03**, dated 7/7-16/03, signed and sealed by Vinu J. Abraham, P.E.
(Submitted under NOA No. 04-0217.11)
5. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of an aluminum window wall system (specimen W1), prepared by Hurricane Test Laboratory, Inc., Test Report No. **HTL-0319-0627-03**, dated 06/23/03, signed and sealed by Vinu J. Abraham, P.E.
(Submitted under NOA No. 04-0217.11)
6. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
2) Small Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of an aluminum window wall system (specimens 2, 3 and 4), prepared by Hurricane Test Laboratory, Inc., Test Report No. **HTL-0319-1122-02**, dated 11/15-18/02, signed and sealed by Vinu J. Abraham, P.E.
(Submitted under NOA No. 04-0217.11)
7. Test reports on: 1) Large Missile Impact Test per FBC, TAS 201-94
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of an aluminum window wall system (specimens 1 & 2), prepared by Hurricane Test Laboratory, Inc., Test Report No. **HTL-0319-1125-03**, dated 11/24-26/03, signed and sealed by Vinu J. Abraham, P.E.
(Submitted under NOA No. 04-0217.11)

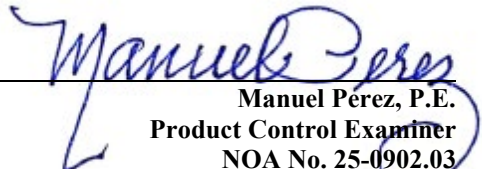
Manuel Perez, P.E.
Product Control Examiner
NOA No. 25-0902.03
Expiration Date: September 02, 2029
Approval Date: September 25, 2025

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's (CONTINUED)

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC 5th Edition (2014), prepared by Larson Engineering, Inc., dated 06/25/08, 11/20/08, and revised and updated on 07/16/16, signed and sealed by Ethan A. Charpentier, P.E.
(Submitted partly under NOA No. 08-1015.03)
2. Glazing complies with **ASTM E1300-04**

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS


1. Notice of Acceptance No. **17-0808.02** issued to **Kuraray America, Inc.** for their "**SentryGlas® (Clear and White) Glass Interlayers**" dated 12/28/17, expiring on 07/04/23.
2. Notice of Acceptance No. **18-0301.05** issued to **Eastman Chemical Company (MA)** for their "**Saflex HP Clear or Color Glass Interlayers**" dated 05/10/18, expiring on 04/14/23.
3. Notice of Acceptance No. **17-0712.05** issued to **Eastman Chemical Company (MA)** for their "**Saflex Clear and Color Glass Interlayers**" dated 09/07/17, expiring on 05/21/21.

F. STATEMENTS

1. Statement letter of conformance, complying with **FBC 6th Edition (2017)**, dated March 25, 2019, signed and sealed by Ethan A. Charpentier, P.E.
(Submitted under NOA No. 19-0409.06)
2. Statement letter of no financial interest, dated July 18, 2016, signed and sealed by Ethan A. Charpentier, P.E.
(Submitted under NOA No. 16-0726.06)
3. Laboratory compliance letter for Test Report No. **HTL-0319-0509-06**, issued by Hurricane Test Laboratory, Inc., dated 08/09/06, signed and sealed by Vinu J. Abraham, P.E.
(Submitted under NOA No. 08-1015.03)

G. OTHER

1. Notice of Acceptance No. **16-0726.06**, issued to Harmon, Inc. for their Series "HI 7000" Pressure Plate Glazed, Aluminum Curtain Wall System – L.M.I., approved on 02/23/17 and expiring on 09/02/19.

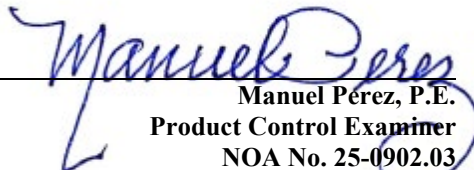
Manuel Pérez, P.E.
Product Control Examiner
NOA No. 25-0902.03
Expiration Date: September 02, 2029
Approval Date: September 25, 2025

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

2. NEW EVIDENCE SUBMITTED

A. DRAWINGS

1. Drawing No. **HI7000LM**, titled “Harmon HI 7000 Large Missile Preglazed & Unitized Pressure Plate Glazing, Aluminum Curtainwall System”, sheets 01 through 41 of 41, dated 06/28/04, with revision #9 dated 08/12/25, prepared by manufacturer, signed and sealed by Ethan A. Charpentier, P.E.

B. TESTS

1. None

C. CALCULATIONS

1. None

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS


1. Notice of Acceptance No. **23-0717.30** issued to **Kuraray America, Inc.** for their “**SentryGlas® (Clear and White) Glass Interlayers**” dated 08/31/23, expiring on 07/04/28.
2. Notice of Acceptance No. **23-0713.20** issued to **Eastman Chemical Company (MA)** for their “**Saflex® HP Clear and Colored Interlayers for Laminated Glass**” dated 08/17/23, expiring on 04/14/28.
3. Notice of Acceptance No. **23-0713.18** issued to **Eastman Chemical Company (MA)** for their “**Saflex® PVB Clear and Colored Interlayers for Laminated Glass**” dated 08/17/23, expiring on 05/21/26.

F. STATEMENTS

1. Statement letter of conformance, complying with **FBC 8th Edition (2023)**, dated August 19, 2025, signed and sealed by Ethan A. Charpentier, P.E.
2. Statement letter of no financial interest, dated August 19, 2025, signed and sealed by Ethan A. Charpentier, P.E.

G. OTHERS

1. Notice of Acceptance No. **19-0409.06**, issued to Harmon, Inc. for their Series “HI 7000” Pressure Plate Glazed, Aluminum Curtain Wall System – L.M.I., approved on 06/06/19 and expiring on 09/02/24.

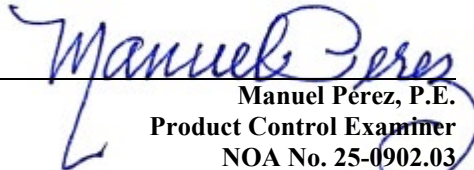
Manuel Pérez, P.E.
Product Control Examiner
NOA No. 25-0902.03
Expiration Date: September 02, 2029
Approval Date: September 25, 2025

HARMON HI 7000 LARGE MISSILE PREGLAZED & UNITIZED PRESSURE PLATE GLAZING, ALUMINUM CURTAINWALL SYSTEM

THIS NOA INCLUDES WINDOW WALL, STOREFRONT & PUNCH OPENING SINGLE LITE APPLICATIONS
AS WELL AS OPTION 2-SIDED STRUCTURAL SILICONE GLAZING DESIGN

DESIGN PARAMETERS

THIS PRODUCT HAS BEEN DESIGNED & TESTED IN ACCORDANCE WITH THE CURRENT FLORIDA 2023
BUILDING CODE 8th EDITION REQUIREMENTS INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ) 

TAS-201 - LARGE & SMALL MISSILE IMPACT

TAS-202 - AIR LEAKAGE, WATER PENETRATION & STRUCTURAL PERFORMANCE
(WATER @ 20 psf, STRUCTURAL @ +110/-130 psf & +79.2/-148.9 psf)

TAS-203 - CYCLING

ASTM STANDARDS (MIAMI)

E283 - AIR LEAKAGE

E330 - STRUCTURAL PERFORMANCE

E331 - WATER PENETRATION

E1886 LEVEL "D" - IMPACT BY "MISSILE" & CYCLIC PRESSURES

E1996 - IMPACT BY WINDBORNE DEBRIS

 AAMA - TIR - A9-14

SYSTEM DIMENSIONS

2 1/2" X 8" (MONOLITHIC GLASS)

2 1/2" X 8 3/4" (INSULATED GLASS)

FINISH

ON A PER JOB BASIS (EXPOSED AREAS)

CLEAR ANODIZED (NON-EXPOSED AREAS)

MILL FINISH (NON-EXPOSED AREAS) SETTING CHAIRS, ANCHORS, ETC.

ALUMINUM IN CONTACT WITH DISSIMILAR MATERIALS SHALL BE PROTECTED
AS SPECIFIED IN SECTION 2003.8.4 OF THE FLORIDA BUILDING CODE

ALUMINUM ALLOY

6063-T5 6063-T6 6005-T5 6105-T5

SEE ALSO ALUMINUM MATERIAL LIST ON SHT 2

STEEL

ALL CLIP ANGLES OR REINFORCING STEEL SHALL BE PER ASTM-36 OR 50 KSI WHERE NOTED (PRIME PAINTED) 

WELDING

CURRENT ASTM STANDARDS E70 - XX ELECTRODES UNLESS OTHERWISE NOTED

GLASS

SEE SHEET 7.

GASKETS

SILICONE OR EPDM --- SEE GASKET CHART ON SHEET 2

SEALANTS

STRUCTURAL SILICONE - DOW CORNING 983 (TWO PART) / RE-GLAZING - DOW CORNING 995

FRAME ASSEMBLY SEALS - DOW CORNING 795 OR DOW CORNING 791

PERIMETER WEATHER SEAL, BACKER ROD AND DOW CORNING 795

ANCHORAGE

FASTENERS TO BE CORROSION RESISTANT AS DETAILED HEREIN AND CONFORM TO F.B.C.

SEE ASSEMBLY SCREW CHART ON SHEET 2

SYSTEM SELECTION

CURTAINWALL

TWIN SPAN - SHEET 5

STACK C.W. - SHEET 6 & 24

CORNERS - SHEET 24

WINDOW WALL / STOREFRONT / PUNCH OPENING

SINGLE SPAN - SHEET 4

CORNERS - SHEET 24

2-SIDED SILICONE OPTIONS SEE PAGE 15

INDEX OF DRAWINGS

PAGE	DESCRIPTION
1	COVER SHEET - DESIGN PARAMETERS
2	MATERIAL LISTS
3	GLAZING DETAILS & RE-GLAZING DETAILS
4	ELEVATION - SINGLE SPAN WINDOW WALL / STOREFRONT
5	ELEVATION - TWIN SPAN CURTAINWALL
6	ELEVATION - TWIN SPAN w/ STACK HORIZONTAL CURTAINWALL
7	GLASS SCHEDULE - LARGE MISSILE
8	PART DRAWINGS
9	PART DRAWINGS
10	MULLION APPLICATION CHARTS SINGLE SPAN WINDOW WALL/STOREFRONT
11	MULLION APPLICATION CHARTS TWIN SPAN CURTAINWALL
12	MULLION APPLICATION CHARTS TWIN SPAN WITH STACK RAIL CURTAINWALL
13	ANCHOR APPLICATIONS
14	DETAILS OF TYPICAL HEADS, SILLS, & INTERMEDIATE HORIZONTALS
15	DETAILS OF TYPICAL VERTICALS
16	DETAIL OF DOOR, HEAD & JAMB AND SEGMENTED VERTICAL
17	DETAIL OF 90 DEGREE OUTSIDE CORNER (BOX)
18	DETAIL OF 5" STACK HORIZONTAL W/ SPLICE SLEEVE
19	STRAP ANCHOR & THRU-FRAME ANCHOR
20	ANGLES IN VERTICAL ANCHOR & ALUMINUM LUG IN VERTICAL ANCHOR
21	MID-SPAN ANCHOR & STACK WALL ANCHOR
22	JAMB ANCHORS / STACK WALL ANCHOR - EXPLODED ISOMETRIC VIEW
23	JAMB WINDLOAD CHARTS
24	ELEVATION - TWIN SPAN W/ STACK HORIZ. & 90° CORNER MULL.
25	HORIZONTAL DETAILS WITH MONOLITHIC ADAPTORS AND INS. SILL
26	HORIZONTAL DETAILS WITH BACK PANS
27	3 3/8" STACK HORIZONTAL DETAIL WITH SECTION CUT
28	3 3/8" STACK HORIZONTAL DETAIL WITH SECTION CUT
29	3 3/8" STACK HORIZ. DETAIL WITH SECTION CUT AT BACK PAN DETAILS
30	VERTICAL DETAILS BACK PAN AND MONOLITHIC ADAPTORS
31	VERTICAL DETAILS BACK PAN
32	90° CORNER MULLION DETAILS (DART)
33	VERTICAL JAMB DETAILS
34	DEADLOAD ANCHOR DETAIL WITH SECTION CUT
35	WINDLOAD ANCHOR DETAIL WITH SECTION CUT
36	OUTSIDE 90° CORNER DEADLOAD ANCHOR DETAIL
37	OUTSIDE 90° CORNER WINDLOAD ANCHOR DETAIL
38	OUTSIDE 90° CORNER @ SILL DETAIL
39	OUTSIDE 90° CORNER @ STACK DETAIL WITH SECTION CUT
40	VERTICAL JAMB AT SILL ANCHOR DETAIL
41	VERTICAL SILL ANCHOR AT MULLION, STIFFENER & REINFORCEMENT



Larson Engineering, Inc.

3524 Labore Road
White Bear Lake, MN 55110
(P) 651.481.9120 (F) 651.481.9200

DADE CO. STAMP

PRODUCT REVISED

As complying with the Florida
Building Code

NOA-No. 25-0902.03

Expiration Date: 09/02/2029

By: *Manuel Perez*

Miami-Dade Product Control

Florida Firm No. F-02000005175
Certificate of Authorization #9803
Ethan A. Charpentier
Registration No. 65106



Harmon

HI 7000 LARGE MISSILE

COVER SHEET

DATE: 06/28/04  6/17/16

 11/18/08  03/05/19

 3/10/09  02/25/21

 3/16/09  08/12/25

 5/22/12

 10/03/14

DWG. NO. HI7000LM

SHEET 01 OF 41

FRAME ASSEMBLY FASTENER LIST					GASKET CHART					ALUMINUM MATERIAL LIST					
										DESCRIPTION	PART #	ALLOY	TYP. THK.	REMARKS	REV
(A)	PRESSURE PLATE BOLT FOR INSULATED GLASS SYSTEM	#14 X 1" HWH S.S. "A" POINT XLYAN COATED	2 1/2" FROM END AND 9" ON CENTER		A		PART # 770301	85 DUR. SILICONE	INTERIOR FIXED GASKET FOR 5/8" & 1 3/8" THICK GLASS (1/4" THICK SEAL)	1	FEMALE VERTICAL MULLION	306001	6063-T6	.110	
(B)	TYPICAL HORIZONTAL FRAME ASSEMBLY SCREW	#12 X 1 1/2" HWH "A" POINT GRADE 5 XLYAN COATED	(4) REQUIRED PER JOINT		B		PART # 750301	70 DUR. SILICONE	VERTICAL WHISKER GASKET	2	MALE VERTICAL MULLION	306002	6063-T6	.110	
(C)	NON-TYPICAL HORIZONTAL ASSEMBLY SCREW TO BYPASS STEEL	#12 X 1 1/2" PFH "A" POINT GRADE 5 XLYAN COATED	(4) REQUIRED PER JOINT		C		PART # 720301	70 DUR. EPDM	EXTERIOR SLIDE IN VERTICAL PRESSURE PLATE	3	INTERMEDIATE HORIZONTAL	306101	6063-T5	.100	
(D)	ANCHOR STEEL FIXING PLATE INTO HORIZONTAL	#17-14 X 1" TYPE AB 304 STAINLESS	(1) REQUIRED PER PLATE		D		PART # 730301	70 DUR. EPDM	EXTERIOR WEDGE	4	JAMB - MONOLITHIC GLASS	306004	6063-T6	.110	
(E)	TEMPORARY ANCHOR FOR CORNER END CAPS	#10 X 1 1/4" TEK SCREW	(1) REQUIRED PER END CAP		E		PART # 790301	70 DUR. EPDM	THERMAL BREAK FOR PRESSURE PLATE	5	HEAD & SILL - MONOLITHIC GLASS	306103	6063-T5	.110	
(F)	PRESSURE PLATE BOLT FOR MONOLITHIC GLASS SYSTEM	#14 X 3/4" HWH S.S. "A" POINT XLYAN COATED	2 1/2" FROM END AND 9" ON CENTER		F		PART # 770302	85 DUR. SILICONE	INTERIOR FIXED GASKET FOR 9/16" & 1 5/16" THICK GLASS (5/16" THICK SEAL)	6	JAMB - INSULATED GLASS	306003	6063-T6	.110	
(G)	ALLEN HEAD SCREW FOR ANCHOR USED w/ STACK HORIZONTAL	1/4-20 ALLEN HEAD BOLT GRADE 5	LOCATED AT TOP & BOTTOM OF ANCHOR		G		PART # 790303	90 DUR. EPDM	ALL PERIMETERS	7	HEAD & SILL - INSULATED GLASS	306102	6063-T5	.110	
(H)	GLASS ADAPTOR FOR MONOLITHIC GLASS SYSTEM	#12 X 1 1/4" PFH DRIL-FLEX	9" ON CENTER		H		PART # 790302	90 DUR. EPDM	PERIMETER THERMAL BREAK	8	JAMB COVER	300203	6063-T5	.100	
(J)	ANCHOR FOR SILL	1/2" X 3 1/2" HWH GRADE 5 BOLT WITH WASHER AND NUT	(1) REQUIRED PER MULLION		J		PART # 780301	70 DUR. SILICONE	ZONE DAM FOR MONOLITHIC GLASS 2 1/2" LONG	9	HEAD & SILL EXTERIOR COVER	300202	6063-T5	.100	
(K)	ANCHOR FOR ANCHOR STRAP	3/8" X 3 3/4" PFH POWER BOLT WITH 3 1/2" MIN. EMBEDMENT	(2) REQUIRED PER MULLION		K		PART # 780302	70 DUR. SILICONE	ZONE DAM FOR INSULATED GLASS 2 1/2" LONG	10	HEAD & SILL INTERIOR FILLER	306401	6063-T5	.080	
(L)	POCKET FILLER FOR STEEL BACK PAN	#12 X 2 1/2" PFH DRIL-FLEX	9" ON CENTER		L		PART # 700303	90 DUR. SILICONE	5" LONG SETTING BLOCK. (TEAR IN HALF FOR MONOLITHIC GLASS)	11	HORIZONTAL COVER	300201	6063-T5	.100	
(M)	STEEL REINFORCEMENT TO MULLION	3/8"-16 X 1" HWH GRADE 5 BOLT XLYAN COATED	(2) REQUIRED PER MULLION		M		PART # 740301	70 DUR. EPDM	AT BUTT JOINT FOR MONOLITHIC GLASS	12	VERTICAL COVER	300236	6063-T5	.060	
(N)	STEEL CHANNEL STIFFENER ATTACHED TO STEEL BACK PAN	#12 X 1 1/2" HWH SELF TAPPING XLYAN COATED	9" ON CENTER		N		PART # 740302	70 DUR. EPDM	AT BUTT JOINT FOR INSULATED GLASS	13	VERTICAL PRESSURE PLATE	300701	6105-T5	.100	
(P)	STEEL REINFORCING INTO CORNET MULLION	3/8"-16 RIVIT NUT	(2) REQUIRED PER MULLION		P		PART # 780307	70 DUR. SILICONE	ZONE DAM FOR INSULATED GLASS 4 3/4" LONG	14	PERIMETER ADAPTOR - MONOLITHIC GLASS	300305	6105-T5	.080	
(Q)	STEEL ANGLE ATTACHED TO FRAME AND TO STEEL BACK PAN	1/4" STEEL POP RIVET	9" ON CENTER		Q		PART # 78030X	70 DUR. SILICONE	ZONE DAM FOR INSULATED GLASS 4 3/4" LONG	15	PERIMETER ADAPTOR - INSULATED GLASS	300304	6105-T5	.080	
(R)	STEEL BACK PAN INTO STEEL ANGLE	#12 X 3/4" HWH SELF TAPPING	9" ON CENTER		R		PART # 780303	70 DUR. SILICONE	END PLUG BOTTOM OF FEMALE MULL. AT STACK 2 1/2" LONG	16	HORIZONTAL ADAPTOR - MONOLITHIC GLASS	300303	6105-T5	.080	
(S)	ANCHOR FOR STEEL ANGLES	3/8" X 3 3/4" HWH POWER BOLT WITH 3 1/2" MIN. EMBEDMENT	(2) REQUIRED PER CLIP		S		PART # 740601	60 DUR. EPDM	AT STACK HORIZONTAL EXTERIOR BULB GASKET	17	HORIZONTAL ADAPTOR - INSULATED GLASS	300302	6105-T5	.080	
(T)	FOR INTERMEDIATE ANCHOR TO MULLION	3/8" X 1 1/4" HWH GRADE 5 BOLT WITH WASHER AND NUT	(4) REQUIRED PER CLIP		T		PART # 780304	70 DUR. SILICONE	END PLUG BOTTOM OF MALE MULL. AT STACK 2 1/2" LONG	18	VERTICAL ADAPTOR - MONOLITHIC GLASS	300308	6105-T5	.093	
(U)	JACK BOLT FOR HOOK ANCHOR	3/8" X 2 1/2" HWH GRADE 5 BOLT WITH NUT	(1) REQUIRED PER CLIP		U		PART # 780305	70 DUR. SILICONE	END PLUG BOTTOM OF JAMB MULL. AT STACK 2 1/2" LONG	19	VERTICAL ADAPTOR - INSULATED GLASS	300301	6105-T5	.093	
(X)					X					20	ANTI-BUCKLING CLIP (EXTERIOR SIDE)	300306	6105-T5	.060	4" LONG 30" O.C. MAX.
										21	ANTI-BUCKLING CLIP (INTERIOR SIDE)	300310	6105-T5	.060	4" LONG 30" O.C. MAX.
										22	STRAP ANCHOR FEMALE	930102	6105-T5	.177	SEE DET. 1-4 SHT. 19
										23	STRAP ANCHOR MALE	930106	6105-T5	.187	SEE DET. 1-4 SHT. 19
										24	SLIDING ANCHOR FEMALE	930105	6105-T5	.250	SEE DET. 5-8 SHT. 20
										25	SLIDING ANCHOR MALE	930104	6105-T5	.435	SEE DET. 5-8 SHT. 20
										26	"STACK" SPLICE PLATE	930107	6005-T5	.187	SEE DET. 1 SHT. 18
										27	SERRATED PLATE	930110	6005-T5	.191	SEE DET. 3 & 4 SHT. 21
										28	"KNUCKLE" ANCHOR	930109	6005-T5	.250	SEE DET. 3 & 4 SHT. 21
										29	HOOK ANCHOR	930108	6005-T5	.250	SEE DET. 3 & 4 SHT. 21
										30	FLOOR EDGE PLATE	930111	6005-T5	.685	SEE DET. 3 & 4 SHT. 21
										31	ANTI-WALK ANGLE		6105-T5	.125	SEE DET. 3 & 4 SHT. 21
										32	MONOLITHIC ADAPTOR	300312	6063-T5	.060	SEE DET. 1,2&4 SHT. 25
										33	VERTICAL COVER	300216	6063-T5	.060	SEE DET. 12&13 SHT. 30
										34	90° CORNER COVER	300218	6063-T5	.055	SEE DET. 16&17 SHT. 32
										35	90° CORNER PRESSURE PLATE	300702	6063-T6	.100	SEE DET. 16&17 SHT. 32
										36	90° CORNER FEMALE MULLION	306005	6063-T6	.125	SEE DET. 16&17 SHT. 32
										37	90° CORNER MALE MULLION	306006	6063-T6	.125	SEE DET. 16&17 SHT. 32
										38	STACK HORIZONTAL SILL	306181	6063-T6	.125	SEE DET. 8 SHT. 27
										39	STACK HORIZONTAL HEAD	306191	6063-T6	.110	SEE DET. 8 SHT. 27
										40	STACK COVER	300217	6063-T5	.100	SEE DET. 8 SHT. 27
										41	STACK SPLICE SLEEVE	306801	6063-T6	.125	SEE DET. 8 SHT. 27
										42	MULLION SPLICE SLEEVE	306802	6063-T6	.100	SEE DET. 8 SHT. 27
										43	POCKET FILLER	300313	6063-T5	.060	SEE DET. 5-7 SHT. 26
										44	OPTIONAL CORNER COVER	300321	6063-T5	.100	SEE DET. 22A SHT. 36



Larson Engineering, Inc. 8.19.25
3524 Labore Road
White Bear Lake, MN 55110
(P) 651.481.9120 (F) 651.481.9201

DADE CO. STAMP

PRODUCT REVISED
As complying with the Florida Building Code
NOA-No. **25-0902.03**
Expiration Date: **09/02/2029**

By: *Manuel Perez*
Miami-Dade Product Control

ENGINEER'S CHARTER
No. 65106
STATE OF FLORIDA
Ethan A. Charpentier
Registration No. 65106



Harmon

HI 7000 LARGE MISSILE MATERIAL LIST


DATE: 06/28/04	6/17/16
11/18/08	03/05/19
3/10/09	02/25/21
3/16/09	08/12/25
5/22/12	
10/03/14	

DWG. NO. H17000LM


GLAZING DETAILS

LAMINATED GLASS DETAILS

INSULATED LAMINATED GLASS DETAILS

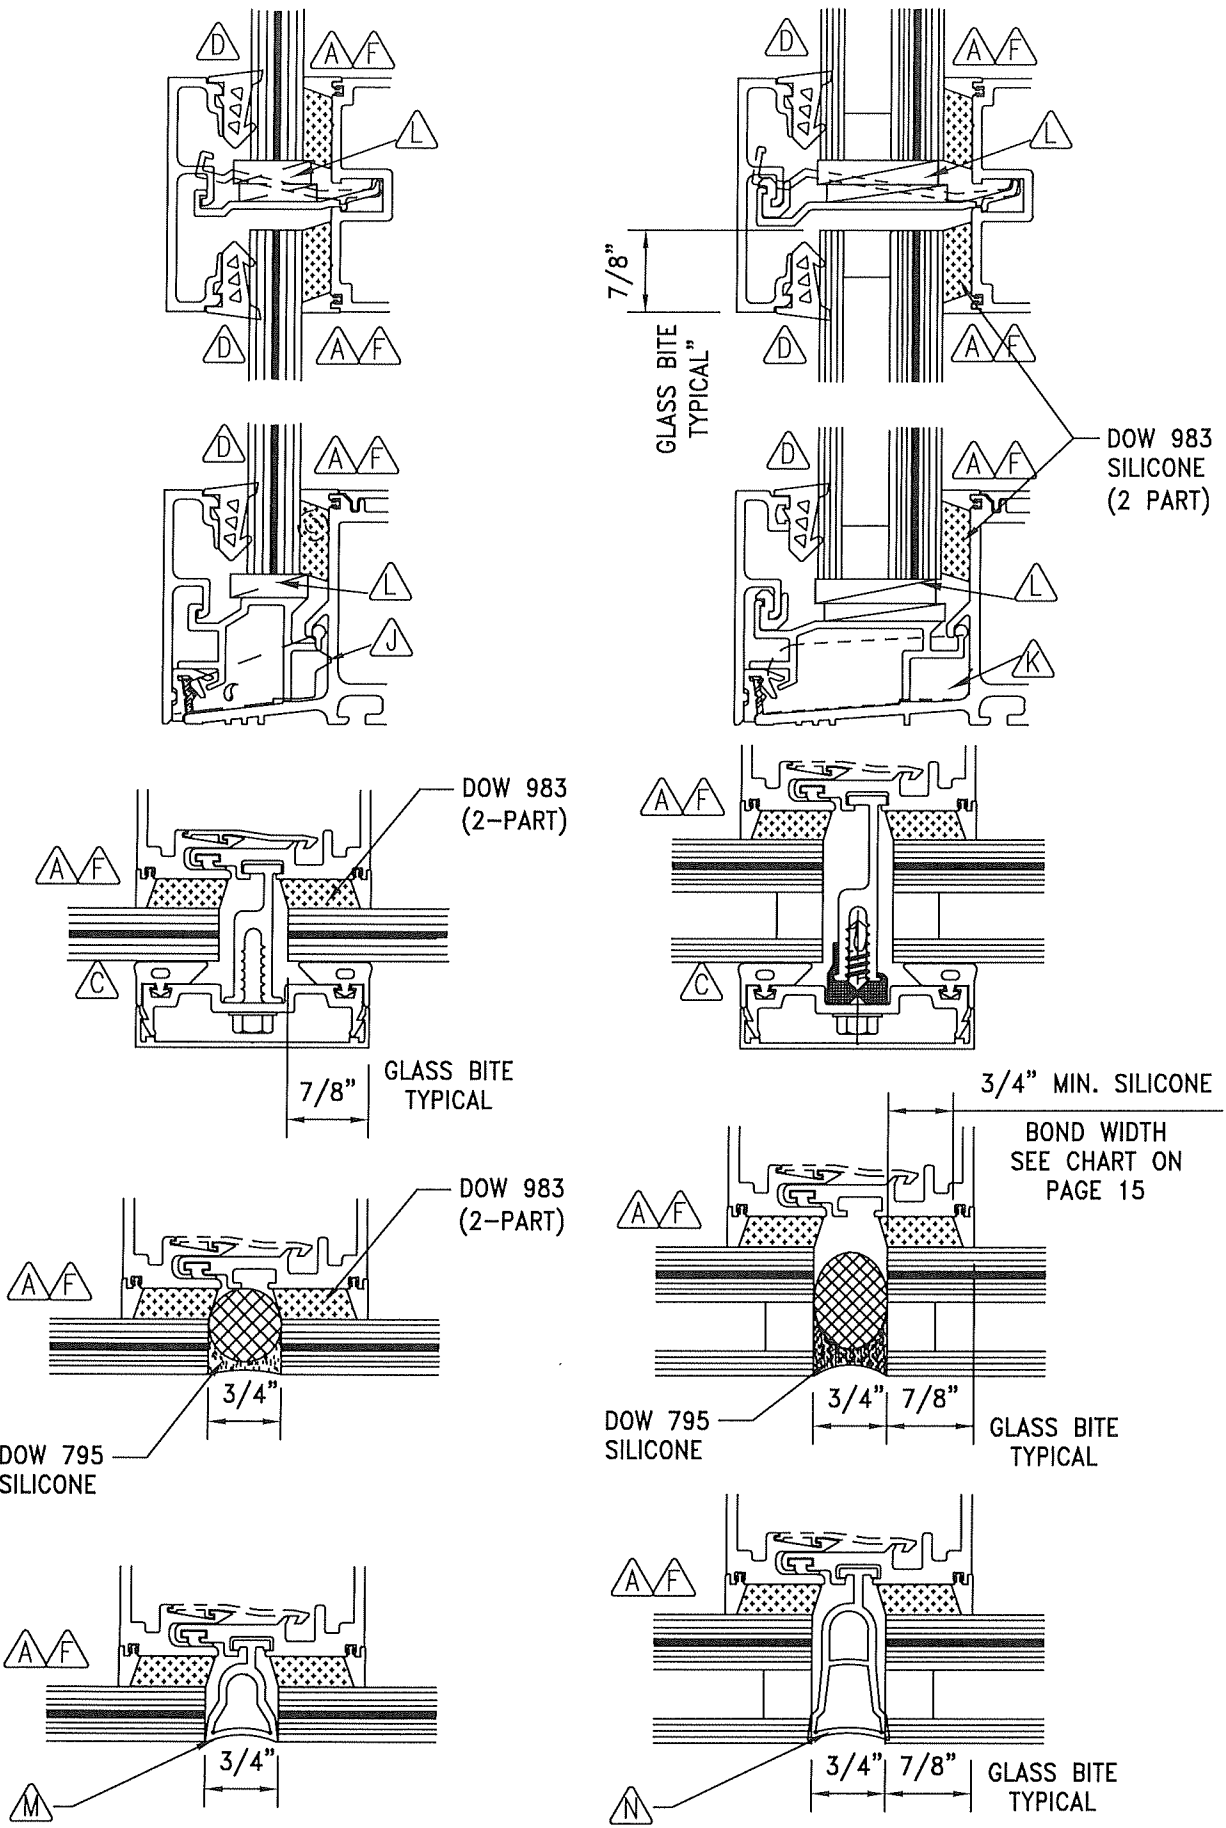

RE-GLAZING DETAILS

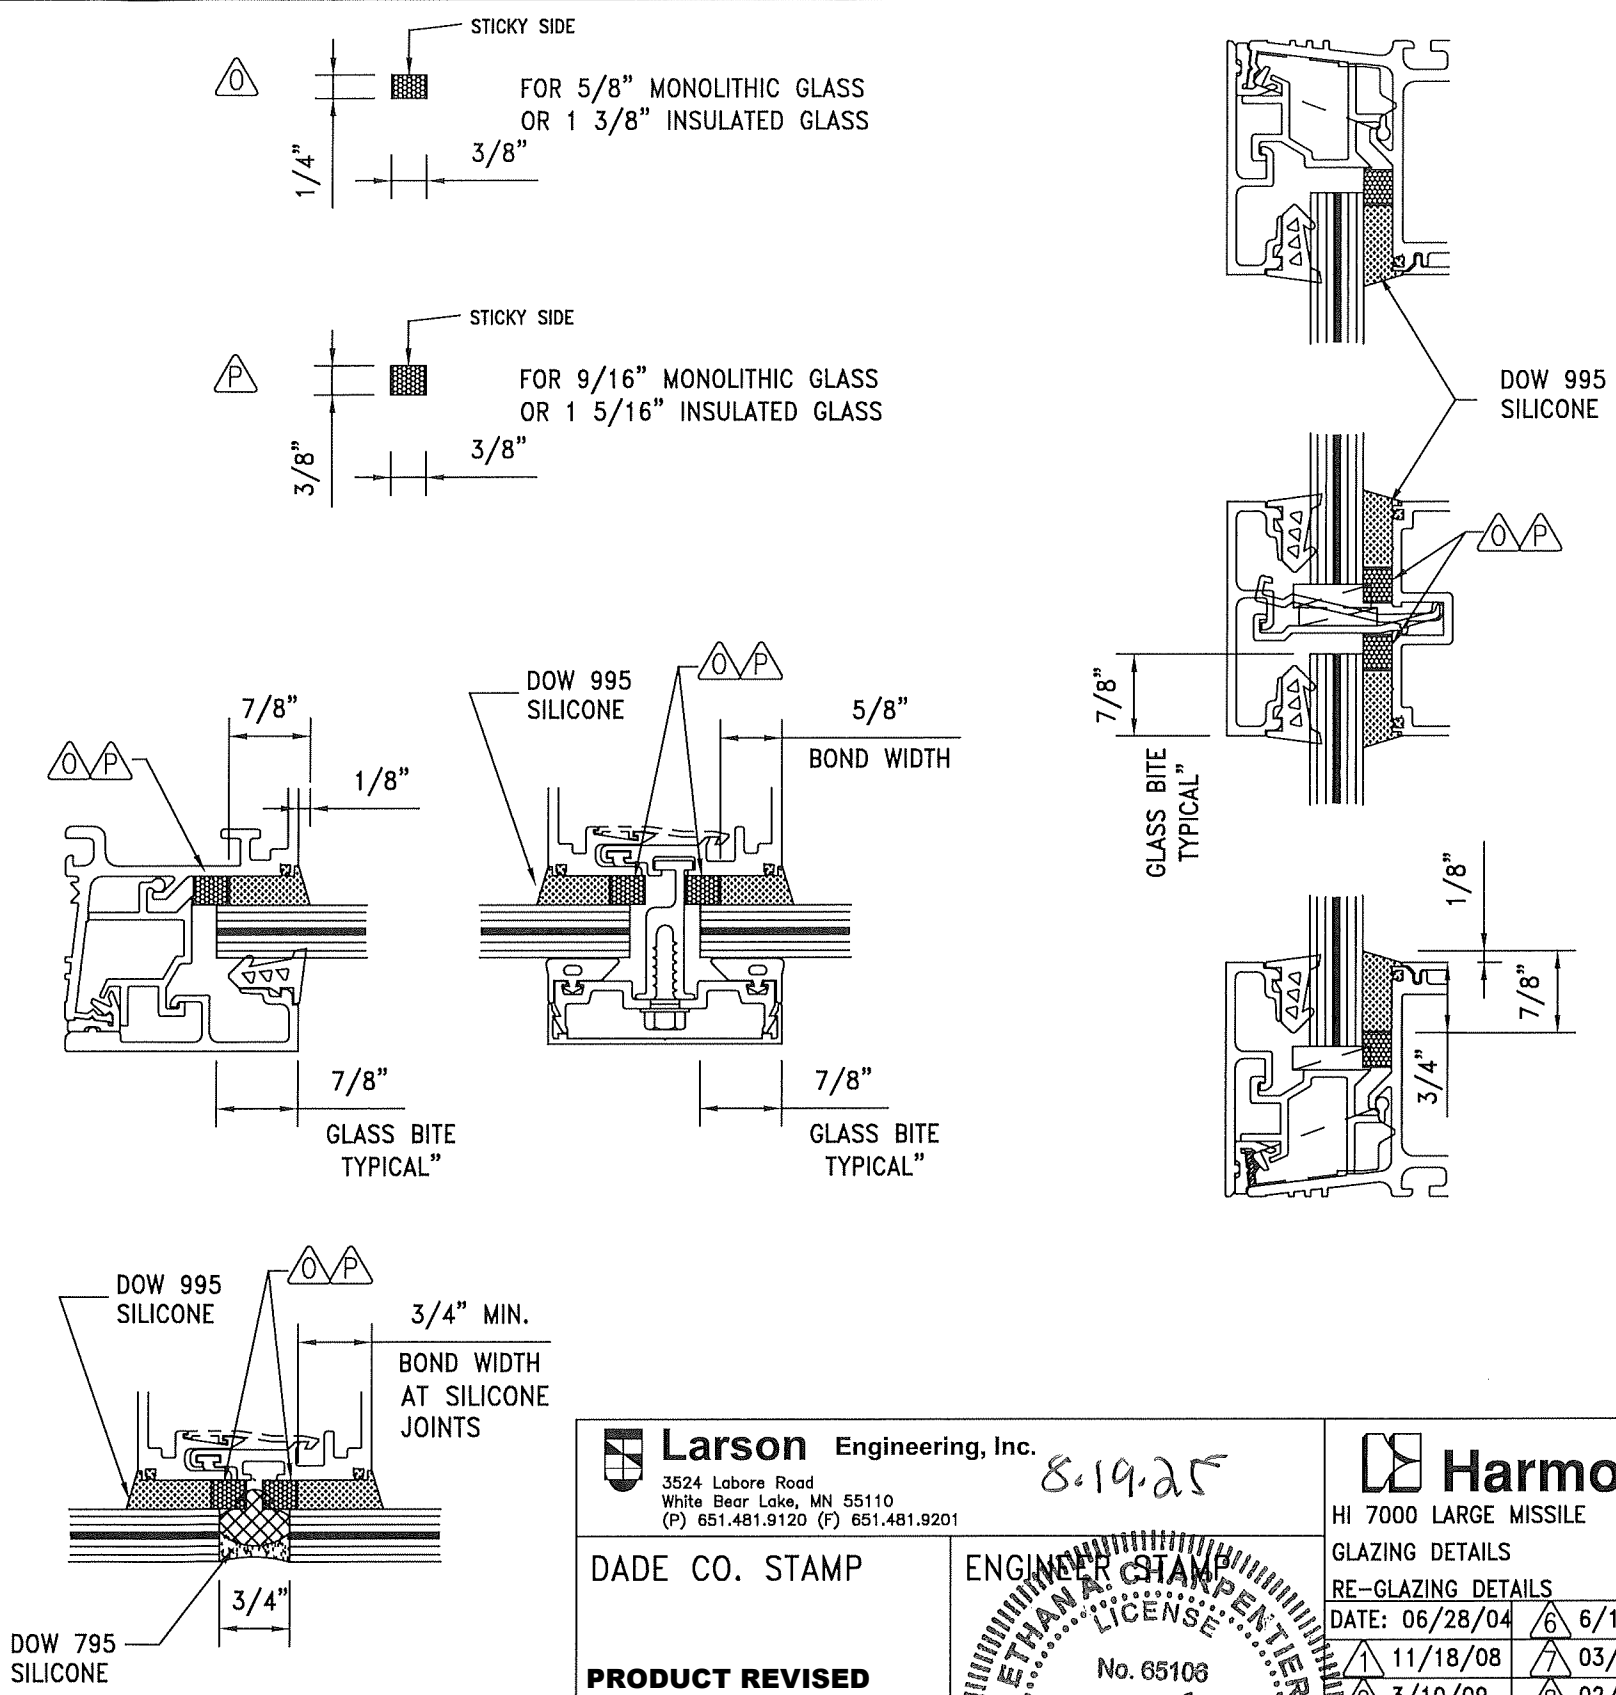

Larson Engineering, Inc.
3524 Labore Road
White Bear Lake, MN 55110
(P) 651.481.9120 (F) 651.481.9201

DADE CO. STAMP

PRODUCT REVISED
As complying with the Florida Building Code
NOA-No. **25-0902.03**
Expiration Date: **09/02/2029**
By: *Manuel Perez*
Miami-Dade Product Control



ENGINEER STAMP

ETHAN A. CHAMBERLAIN
LICENSED PROFESSIONAL ENGINEER
No. 65108
STATE OF FLORIDA
Professional Seal
Registration No. 65108

Harmon

HI 7000 LARGE MISSILE
GLAZING DETAILS
RE-GLAZING DETAILS
DATE: 06/28/04
6/17/16
11/18/08
03/05/19
3/10/09
02/25/21
3/16/09
08/12/25
5/22/12
10/03/14
DWG. NO. HI7000LM
SHEET 03 OF 41

STOREFRONT, WINDOW WALL & PUNCHED OPENING

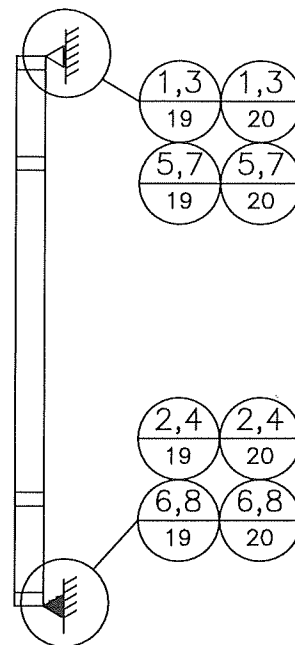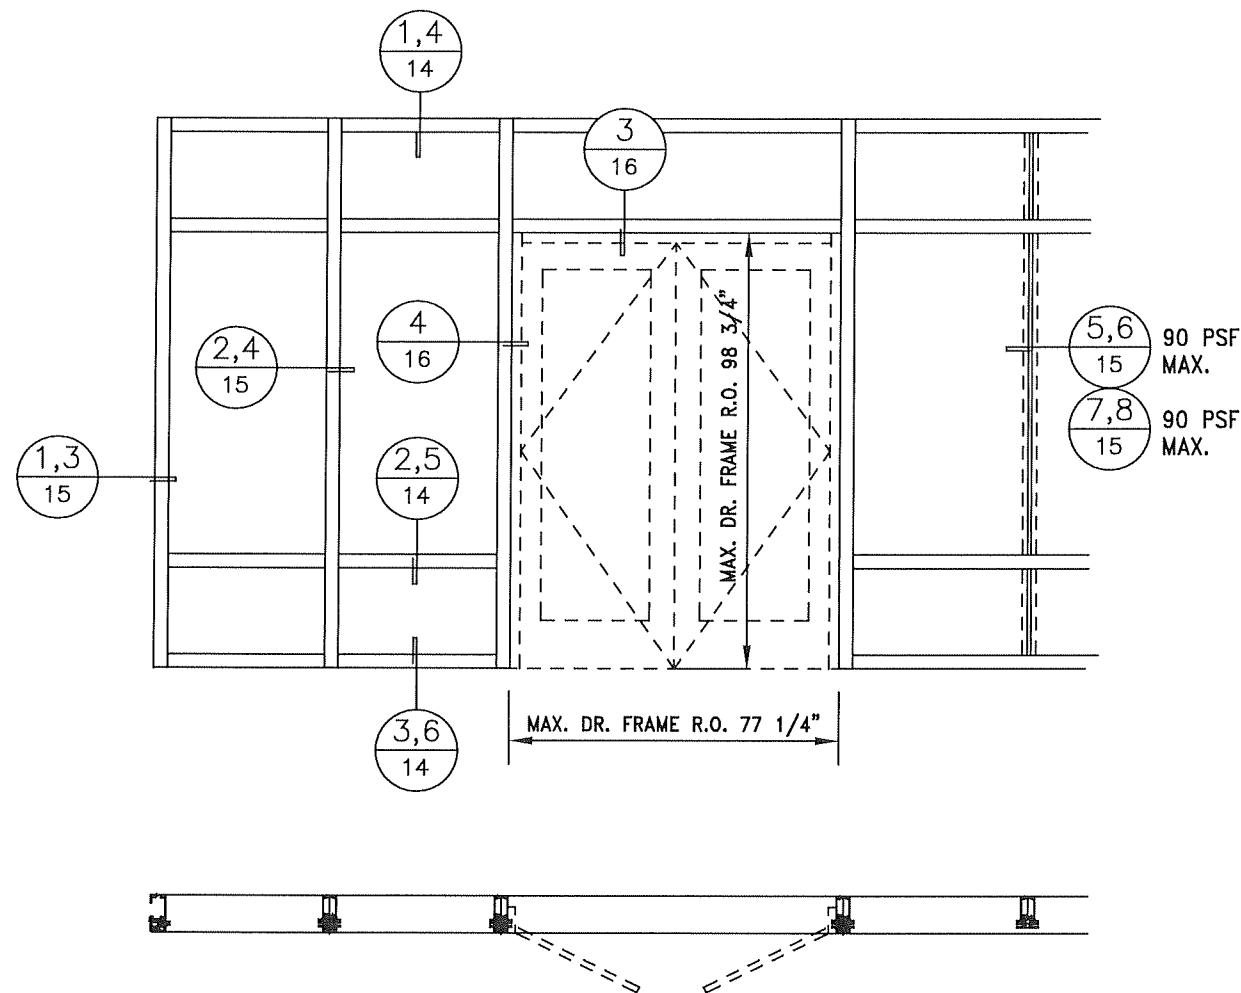

SYSTEM APPLICATION GUIDELINES:

- 1 SELECT GLASS FROM CHARTS ON SHEET 7. NOTE THE GLASS THICKNESS AND 4-SIDE CAPTURED VERSUS CAPTURED/SSG OPTIONS.
- 2 SELECT MULLION & REINFORCING AS REQUIRED FROM CHARTS ON SHEET 10 FOR SINGLE SPAN APPLICATION. APPLICATION BASED ON WIND LOAD, MODULE "B", AND SPAN "L". REFER TO GENERAL NOTES AND GUIDELINES REGARDING SPAN LIMITATIONS AND COMBINATIONS.
- 3 SELECT ANCHOR APPLICATIONS FROM SHEET 13. MAKE SELECTION BASED ON PERIMETER CONDITION AND END REACTIONS. NOTE MAXIMUM TESTED END REACTIONS FOR PROPER APPLICATION.
- 4 SELECT APPROPRIATE DETAILS FROM ELEVATION AT LEFT, BASED ON GLASS APPLICATION AND MULLION REINFORCING REQUIREMENTS. FOR SPECIFIC ANCHOR DETAILS, SEE DETAILS REFERENCED ON ANCHOR APPLICATION SHEET 13.
- 5 SELECT JAMB MULLION & REINFORCING AS REQUIRED FROM CHARTS ON SHEET 23.
6. LOWEST VALUE OF ALL TABLES SHALL APPLY FOR THE ENTIRE ASSEMBLY.

GENERAL NOTES:

- DOOR AREA TESTED IS 90 PSF.
- SILICONE VERTICAL JOINTS AND GASKET JOINTS ARE TESTED TO 90 PSF
- DOORS AND DOOR FRAMES ARE NOT PART OF THIS SUBMISSION. ANY DOOR USED MUST MEET DADE COUNTY NOA.

Larson Engineering, Inc.
3524 Labore Road
White Bear Lake, MN 55110
(P) 651.481.9120 (F) 651.481.9201

8.19.25

Harmon

HI 7000 LARGE MISSILE

SINGLE SPAN APPLICATION

JAMBS	
DATE: 06/28/04	6 6/17/16
1 11/18/08	7 03/05/19
2 3/10/09	8 02/25/21
3 3/16/09	9 08/12/25
4 5/22/12	
5 10/03/14	

DWG. NO. HI7000LM

SHEET 04 OF 41


DADE CO. STAMP

PRODUCT REVISED
As complying with the Florida Building Code
NOA-No. **25-0902.03**
Expiration Date: **09/02/2029**
By: *Manuel Perez*
Miami-Dade Product Control

ENGINEER STAMP

ETHAN A. CHARPENTIER
LICENSE
No. 65106
STATE OF
FLORIDA
Professional Engineer
Registration No. 65106

TWIN SPAN CURTAINWALL

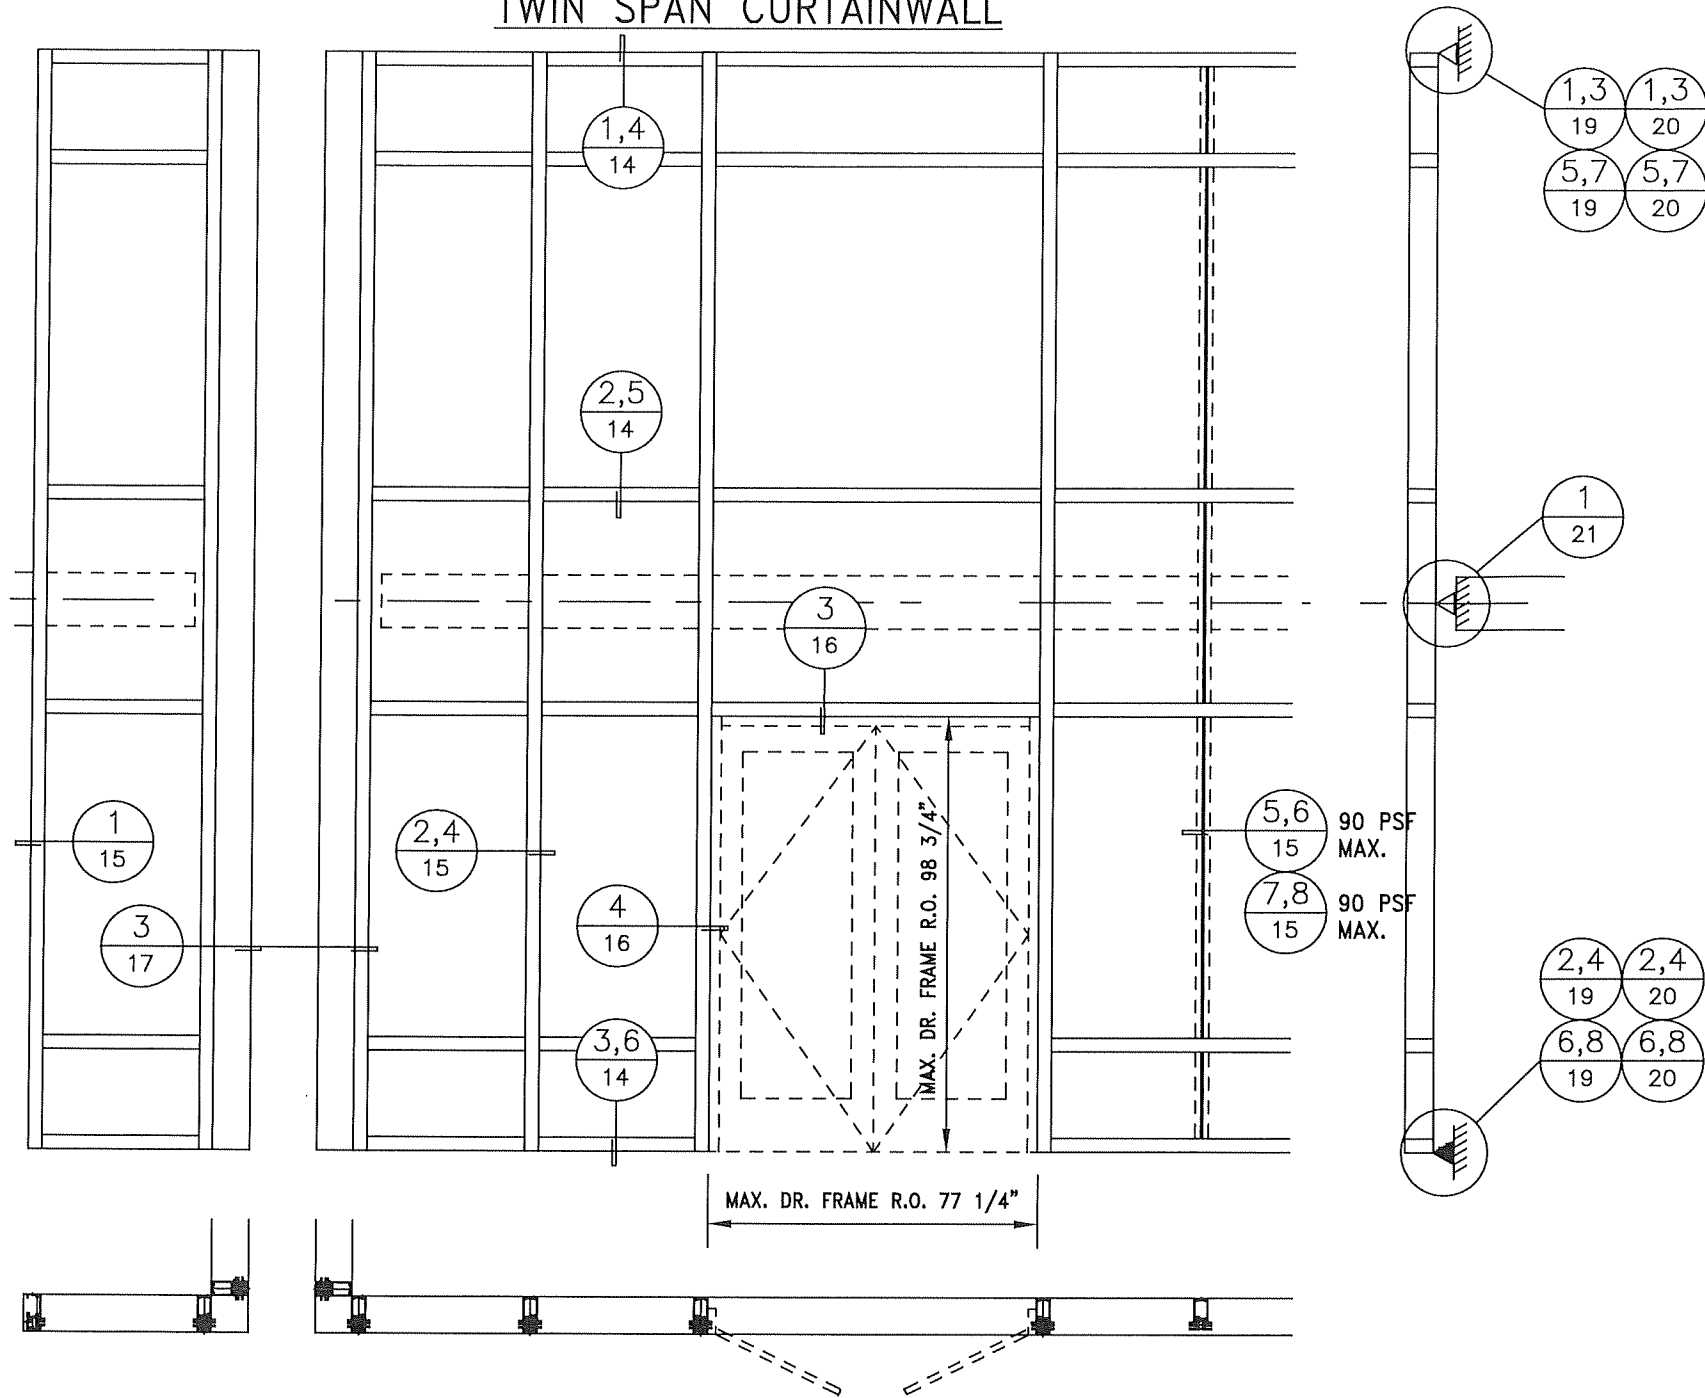

SYSTEM APPLICATION GUIDELINES:

- 1 SELECT GLASS FROM CHARTS ON SHEET 7. NOTE THE GLASS THICKNESS AND 4-SIDE CAPTURED VERSES CAPTURED/SSG OPTIONS.
- 2 SELECT MULLION & REINFORCING AS REQUIRED FROM CHARTS ON SHEET 11 FOR TWIN SPAN APPLICATION. APPLICATION BASED ON WIND LOAD, MODULE "B", AND SPAN "L". REFER TO GENERAL NOTES AND GUIDELINES REGARDING SPAN LIMITATIONS AND COMBINATIONS.
- 3 SELECT ANCHOR APPLICATIONS FROM SHEET 13. MAKE SELECTION BASED ON PERIMETER CONDITION AND END REACTIONS. NOTE MAXIMUM TESTED END REACTIONS FOR PROPER APPLICATION.
- 4 SELECT APPROPRIATE DETAILS FROM ELEVATION AT LEFT, BASED ON GLASS APPLICATION AND MULLION REINFORCING REQUIREMENTS. FOR SPECIFIC ANCHOR DETAILS, SEE DETAILS REFERENCED ON ANCHOR APPLICATION SHEET 13.
- 5 SELECT JAMB MULLION & REINFORCING AS REQUIRED FROM CHARTS ON SHEET 23.
6. LOWEST VALUE OF ALL TABLES SHALL APPLY FOR THE ENTIRE ASSEMBLY.

GENERAL NOTES:

- DOOR AREA TESTED IS 90 PSF.
- SILICONE VERTICAL JOINTS AND GASKET JOINTS ARE TESTED TO 90 PSF
- DOORS AND DOOR FRAMES ARE NOT PART OF THIS SUBMISSION. ANY DOOR USED MUST MEET DADE COUNTY NOA.

Larson Engineering, Inc.
3524 Labore Road
White Bear Lake, MN 55110
(P) 651.481.9120 (F) 651.481.9201

DADE CO. STAMP

PRODUCT REVISED
As complying with the Florida Building Code
NOA-No. **25-0902.03**
Expiration Date: **09/02/2029**
By: *Manuel Perez*
Miami-Dade Product Control

ENGINEER STAMP

ETHAN A. CHAPMAN
LICENSE
No. 65106
STATE OF FLORIDA
Professional Engineer
Ethan A. Chapman
Registration No. 65106

Harmon


HI 7000 LARGE MISSILE
TWIN SPAN APPLICATION

DATE: 06/28/04	6	6/17/16	
1	11/18/08	7	03/05/19
2	3/10/09	8	02/25/21
3	3/16/09	9	08/12/25
4	5/22/12		
5	10/03/14		

DWG. NO. HI7000LM

SHEET 05 OF 41

STACK CURTAINWALL

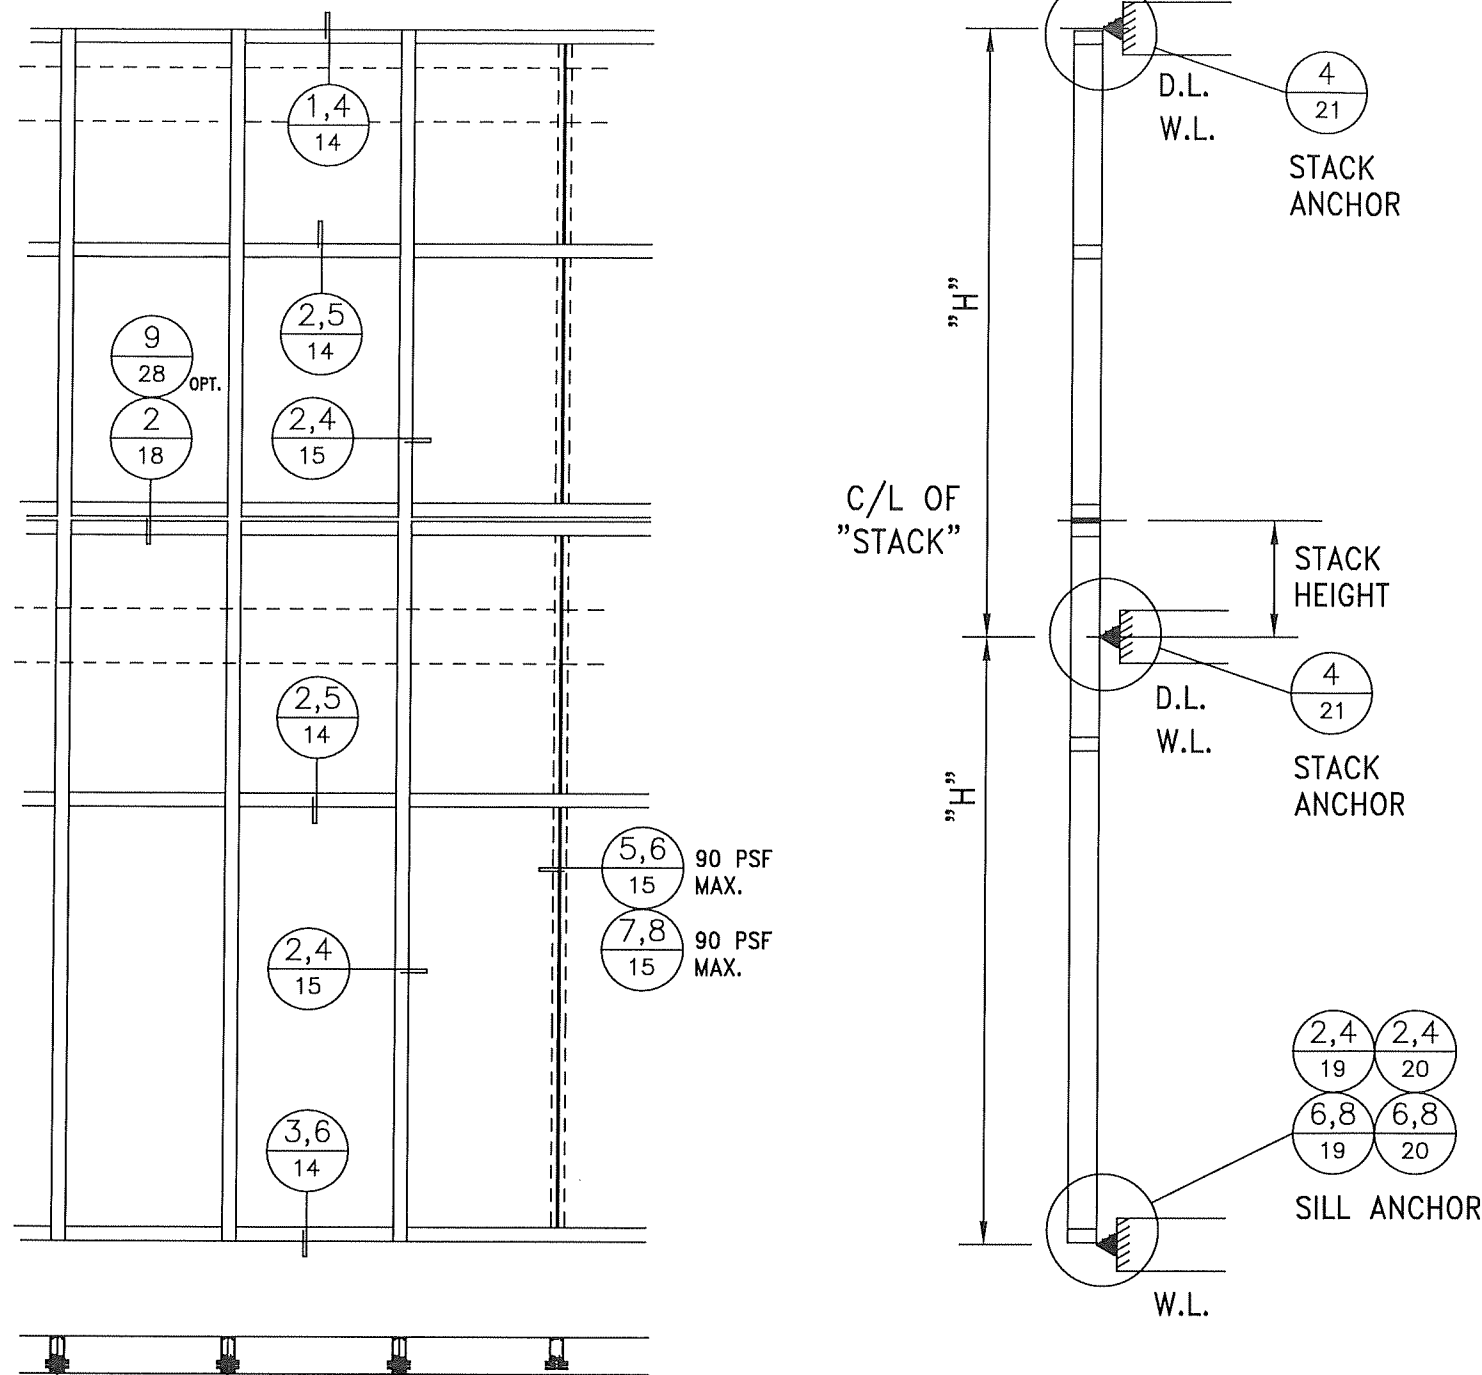

SYSTEM APPLICATION GUIDELINES:

- 1 SELECT GLASS FROM CHARTS ON SHEET 7. NOTE THE GLASS THICKNESS AND 4-SIDE CAPTURED VERSES CAPTURED/SSG OPTIONS.
- 2 SELECT MULLION & REINFORCING AS REQUIRED FROM CHARTS ON SHEET 12 FOR TWIN SPAN w/ STACK HORIZONTAL APPLICATION. APPLICATION BASED ON WIND LOAD, MODULE "B", AND SPAN "L". REFER TO GENERAL NOTES AND GUIDELINES REGARDING SPAN LIMITATIONS AND COMBINATIONS.
- 3 SELECT ANCHOR APPLICATIONS FROM SHEET 13. MAKE SELECTION BASED ON PERIMETER CONDITION AND END REACTIONS. NOTE MAXIMUM TESTED END REACTIONS FOR PROPER APPLICATION.
- 4 SELECT APPROPRIATE DETAILS FROM ELEVATION AT LEFT, BASED ON GLASS APPLICATION AND MULLION REINFORCING REQUIREMENTS. FOR SPECIFIC ANCHOR DETAILS, SEE DETAILS REFERENCED ON ANCHOR APPLICATION SHEET 13.
- 5 SELECT JAMB MULLION & REINFORCING AS REQUIRED FROM CHARTS ON SHEET 23.
6. LOWEST VALUE OF ALL TABLES SHALL APPLY FOR THE ENTIRE ASSEMBLY.

GENERAL NOTES:

- SILICONE VERTICAL JOINTS AND GASKET JOINTS ARE TESTED TO 90 PSF
- SEE SHEET 24 FOR OPTIONAL STACK AND CORNER APPLICATION GUIDELINES

Larson Engineering, Inc.
3524 Labore Road
White Bear Lake, MN 55110
(P) 651.481.9120 (F) 651.481.9201

8.19.25

Harmon

HI 7000 LARGE MISSILE	
TWIN SPAN APPLICATION	
w/ STACK HORIZONTAL	
DATE: 06/28/04	6/17/16
1 11/18/08	7 03/05/19
2 3/10/09	8 02/25/21
3 3/16/09	9 08/12/25
4 5/22/12	
5 10/03/14	
DWG. NO. HI7000LM	
SHEET 06 OF 41	

DADE CO. STAMP

PRODUCT REVISED
As complying with the Florida Building Code
NOA-No. **25-0902.03**
Expiration Date: **09/02/2029**
By: *Manuel Perez*
Miami-Dade Product Control

ENGINEER'S STAMP
No. 65106
STATE OF FLORIDA
Professional Engineer
Ethan A. Carpenter
Registration No. 65106


HI 7000 Glass Load Capacity			Monolithic Glass Types				Insulated Glass Types	
DLO "B"	DLO "H"	SF	Type 4	Type 3	Type 18	Type 13	Type 12	Type 19
30"	54"	11.25 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	+110/-130 PSF	+110/-148 PSF	+110/-130 PSF
36"	54"	13.5 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	+110/-130 PSF	+110/-148 PSF	+110/-130 PSF
42"	54"	15.75 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	+110/-130 PSF	+110/-148 PSF	+110/-130 PSF
48"	54"	18 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	+110/-130 PSF	+110/-148 PSF	+110/-130 PSF
54"	54"	20.25 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	+110/-130 PSF	+110/-148 PSF	+110/-130 PSF
60"	54"	22.5 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
66"	54"	24.75 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
72"	54"	27 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
36"	60"	15 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	+110/-130 PSF	+110/-148 PSF	+110/-130 PSF
42"	60"	17.5 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	+110/-130 PSF	+110/-148 PSF	+110/-130 PSF
48"	60"	20 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	+110/-130 PSF	+110/-148 PSF	+110/-130 PSF
54"	60"	22.5 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
60"	60"	25 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
66"	60"	27.5 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
72"	60"	30 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
36"	66"	16.5 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	+110/-130 PSF	+110/-148 PSF	+110/-130 PSF
42"	66"	19.25 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	+110/-130 PSF	+110/-148 PSF	+110/-130 PSF
48"	66"	22 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	+110/-130 PSF	+110/-148 PSF	+110/-130 PSF
54"	66"	24.75 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
60"	66"	27.5 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
66"	66"	30.25 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
72"	66"	33 SF	+/-60 PSF	N/A	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
36"	72"	18 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	+110/-130 PSF	+110/-148 PSF	+110/-130 PSF
42"	72"	21 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	+110/-130 PSF	+110/-148 PSF	+110/-130 PSF
48"	72"	24 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
54"	72"	27 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
60"	72"	30 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
66"	72"	33 SF	+/-60 PSF	N/A	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
72"	72"	36 SF	+/-60 PSF	N/A	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
36"	78"	19.5 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	+110/-130 PSF	+110/-148 PSF	+110/-130 PSF
42"	78"	22.75 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
48"	78"	26 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
54"	78"	29.25 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
60"	78"	32.5 SF	+/-60 PSF	N/A	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
66"	78"	35.75 SF	+/-60 PSF	N/A	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
36"	84"	21 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	+110/-130 PSF	+110/-148 PSF	+110/-130 PSF
42"	84"	24.5 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
48"	84"	28 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
54"	84"	31.5 SF	+/-60 PSF	N/A	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
60"	84"	35 SF	+/-60 PSF	N/A	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
36"	90"	22.5 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
42"	90"	26.25 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
48"	90"	30 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
54"	90"	33.75 SF	+/-60 PSF	N/A	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
60"	90"	37.5 SF	+/-60 PSF	N/A	+110/-130 PSF	N/A	+110/-148 PSF	+110/-126 PSF
36"	96"	24 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
42"	96"	28 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
48"	96"	32 SF	+/-60 PSF	N/A	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
54"	96"	36 SF	+/-60 PSF	N/A	+110/-124 PSF	N/A	+110/-148 PSF	+110/-127 PSF
36"	102"	25.5 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
42"	102"	29.75 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
48"	102"	34 SF	+/-60 PSF	N/A	+110/-130 PSF	N/A	+110/-148 PSF	+110/-129 PSF
36"	108"	27 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
42"	108"	31.5 SF	+/-60 PSF	N/A	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
48"	108"	36 SF	+/-60 PSF	N/A	+110/-130 PSF	N/A	+110/-148 PSF	+110/-125 PSF
30"	114"	23.75 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
36"	114"	28.5 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
42"	114"	33.25 SF	+/-60 PSF	N/A	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
48"	114"	38 SF	+/-60 PSF	N/A	+110/-119 PSF	N/A	+110/-148 PSF	+110/-120 PSF
24"	120"	20 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	+110/-130 PSF	+110/-148 PSF	+110/-130 PSF
30"	120"	25 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
36"	120"	30 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
42"	120"	35 SF	+/-60 PSF	N/A	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
24"	132"	22 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	+110/-130 PSF	+110/-148 PSF	+110/-130 PSF
30"	132"	27.5 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
36"	132"	33 SF	+/-60 PSF	N/A	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
24"	143"	23.83 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
30"	143"	29.79 SF	+/-60 PSF	+/- 90 PSF	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF
36"	143"	35.75 SF	+/-60 PSF	N/A	+110/-130 PSF	N/A	+110/-148 PSF	+110/-130 PSF

MONOLITHIC GLASS – LARGE MISSILE			
4	9/16" (.090) SAFLEX HP HS / HS	TEST PRESSURE: +/-60 PSF DLO SF <= 38.03 SF	1/4" HS 1/4" HS .090 EASTMAN CHEMICAL COMPANY SAFLEX HP
3	9/16" (.100) SG H.S. / H.S.	TEST PRESSURE: +/-90 PSF DLO SF <=30.71 SF	1/4" HS 1/4" HS .100 SENTRYGLAS BY KURARAY AMERICA INC.
18	9/16" (.075) SAFLEX CP H.S. / H.S.	TEST PRESSURE: +110 PSF/-130 PSF DLO SF <= 38.03 SF	1/4" HS 1/4" HS .075 EASTMAN CHEMICAL COMPANY SAFLEX STORM
13	9/16" (.100) SG W/FRIT H.S. / H.S.	TEST PRESSURE: +110 PSF/-130 PSF DLO SF <=22.44 SF	1/4" HS 1/4" HS .100 SENTRYGLAS BY KURARY AMERICA INC.
INSULATED GLASS – LARGE MISSILE			
12	1 5/16" (.100) SG IG HS / HS – HS	TEST PRESSURE: +110 PSF/-148 PSF DLO SF <= 38.03 SF	1/4" HS 1/4" HS AIR SPACE 1/4" HS .100 SENTRYGLAS BY KURARY AMERICA INC.
19	1 5/16" (.075) SAFLEX CP HS / HS – HS	TEST PRESSURE +110 PSF/-130 PSF DLO SF <= 38.03 SF	1/4" HS 1/4" HS AIR SPACE 1/4" HS .075 EASTMAN CHEMICAL COMPANY SAFLEX STORM

NOTES:

ALL GLASS SIZES MUST MEET ASTM E1300-16 WITH THE SQUARE FOOT LESS THAN OR EQUAL TO THE TESTED SQUARE FOOT SIZES AT THE TESTED PRESSURES.

GLASS FORMULA FOR ALL GLASS = DLO+1 3/4" HORIZONTALLY AND VERTICALLY

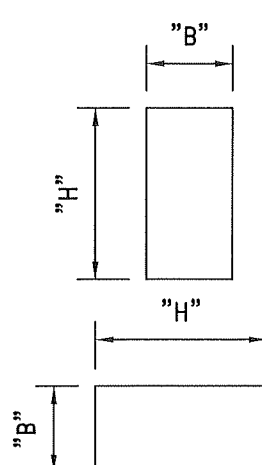

DIM. "B" AND "H" REFER TO DLO ON SHOP DRAWINGS

NOTE:
ALL GLASS TYPES HAVE BEEN TESTED FOR 4-SIDE CAPTURED APPLICATION.

ONLY GLASS TYPES 18 & 19 HAVE BEEN TESTED FOR VERTICAL SSG APPLICATION FOR MAXIMUM 90 PSF.


 **Larson Engineering, Inc.**
3524 Labore Road
White Bear Lake, MN 55110
(P) 651.481.9120 (F) 651.481.9201

8.19.25


DADE CO. STAMP

PRODUCT REVISED
As complying with the Florida Building Code
NOA-No. **25-0902.03**
Expiration Date: **09/02/2029**
By: *Manuel Perez*
Miami-Dade Product Control

ENGINEER STAMP

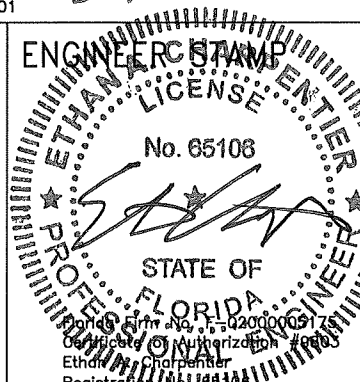

 **Harmon**
HI 7000 LARGE MISSILE
GLASS APPLICATIONS
LARGE MISSILE
DATE: 06/28/04 6 6/17/16
1 11/18/08 7 03/05/19
2 3/10/09 8 02/25/21
3 3/16/09 9 08/12/25
4 5/22/12
5 10/03/14
DWG. NO. HI7000LM
SHEET 07 OF 41

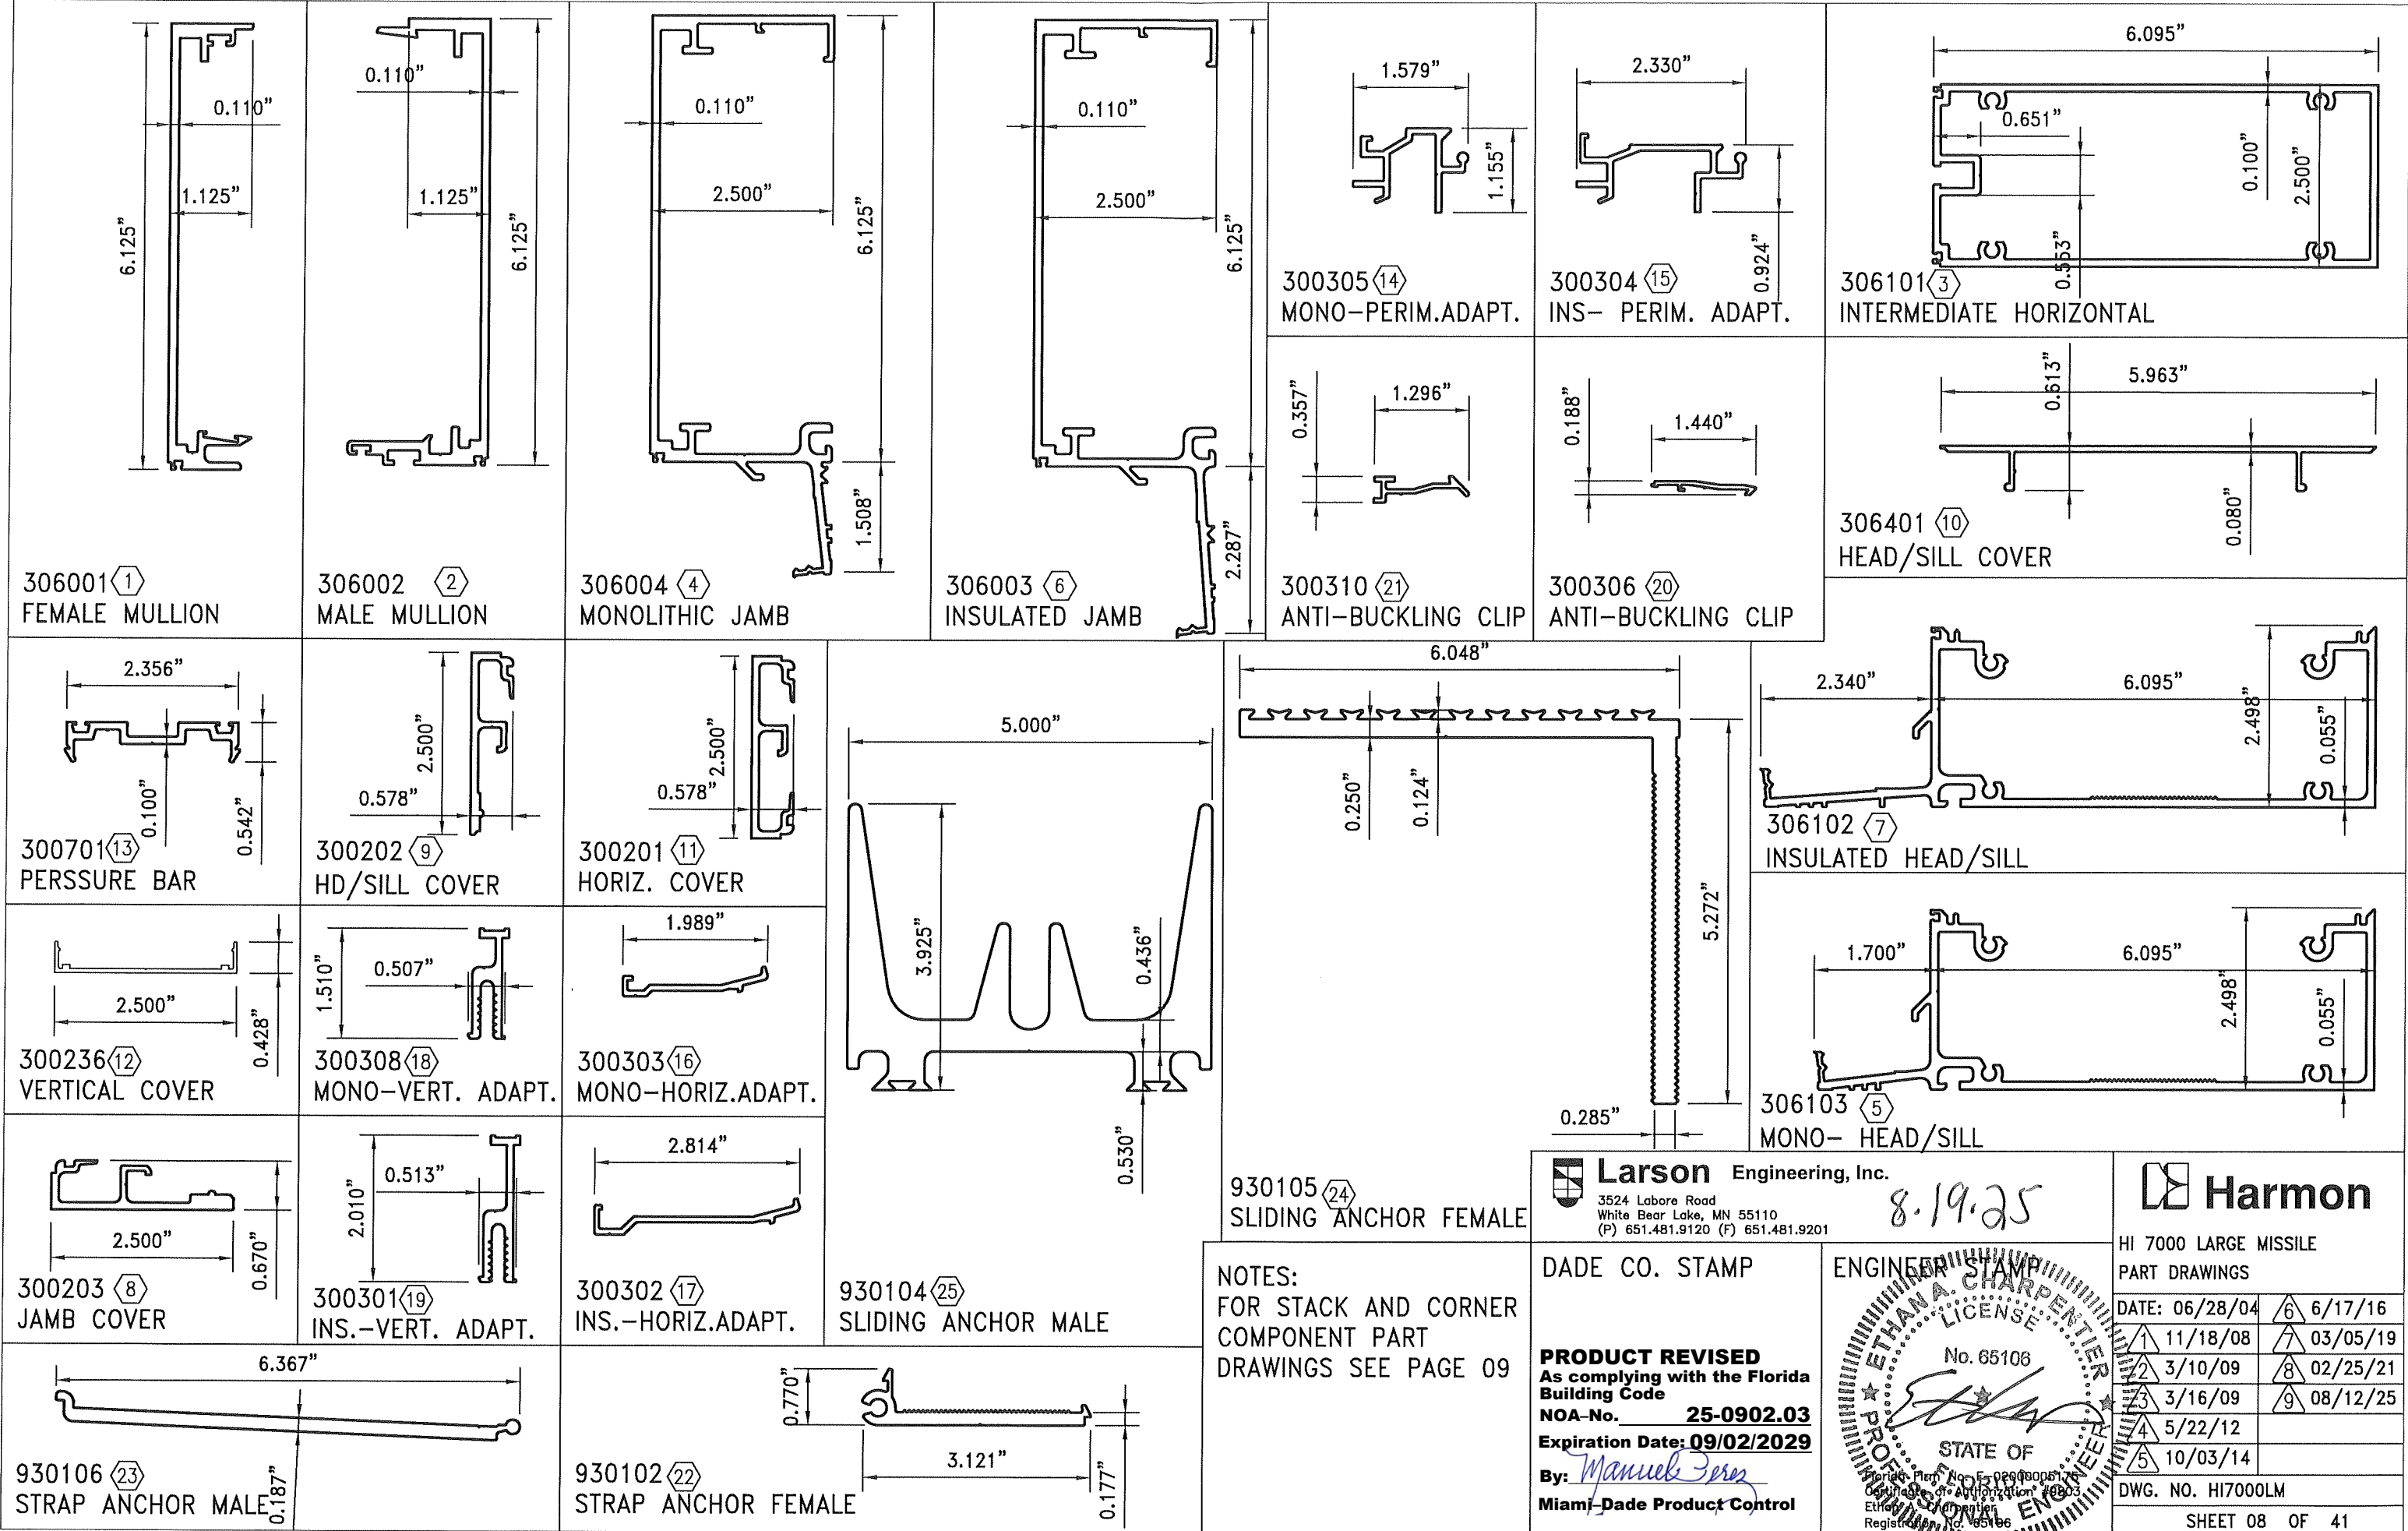

NOTES:
FOR STACK AND CORNER
COMPONENT PART
DRAWINGS SEE PAGE 09



Larson Engineering, Inc.
3524 Labore Road
White Bear Lake, MN 55110
(P) 651.481.9120 (F) 651.481.9201

8.19.25

DADE CO. STAMP

PRODUCT REVISED
As complying with the Florida
Building Code
NOA-No. **25-0902.03**
Expiration Date: **09/02/2029**
By: *Manuel Perez*
Miami-Dade Product Control

ENGINEER STAMP

ETHANA SHARPE
No. 65106
STATE OF
FLORIDA
Professional Engineer
Registration No. 65106




Harmon


HI 7000 LARGE MISSILE
PART DRAWINGS

DATE: 06/28/04	⑥ 6/17/16
① 11/18/08	⑦ 03/05/19
② 3/10/09	⑧ 02/25/21
③ 3/16/09	⑨ 08/12/25
④ 5/22/12	
⑤ 10/03/14	


DWG. NO. HI7000LM
SHEET 08 OF 41

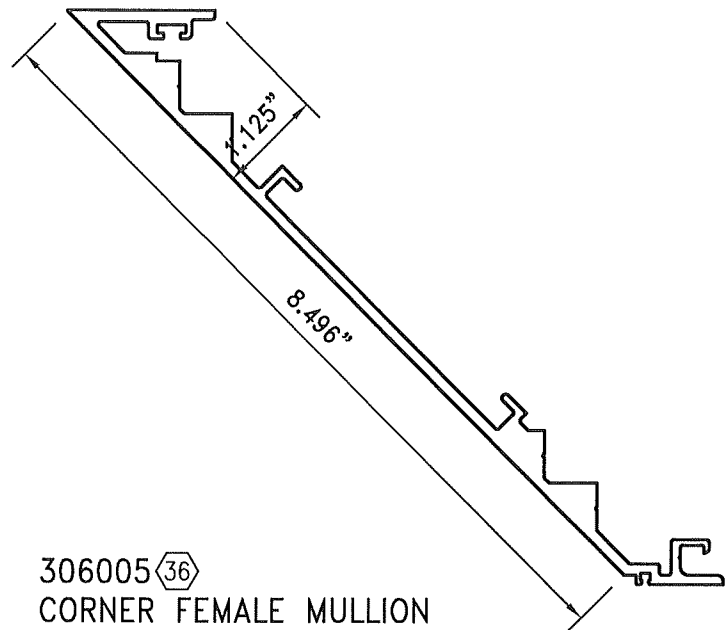


306005 ³⁶
CORNER FEMALE MULLION

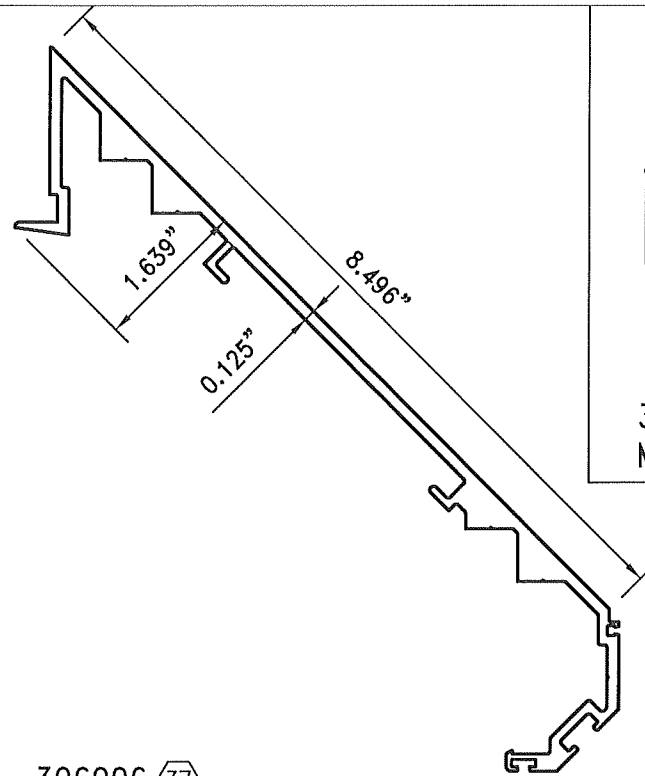


306006 ³⁷
CORNER MALE MULLION

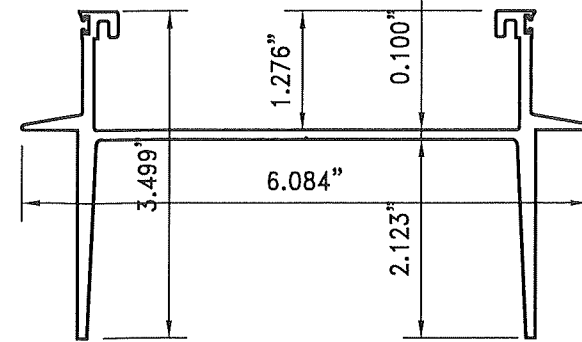


306802 ⁴²
MULLION SPLICE SLEEVE

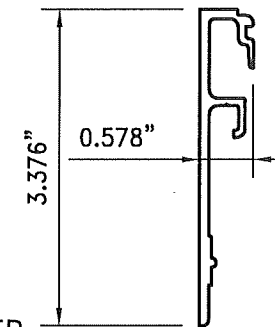


300217 ⁴⁰
STACK COVER

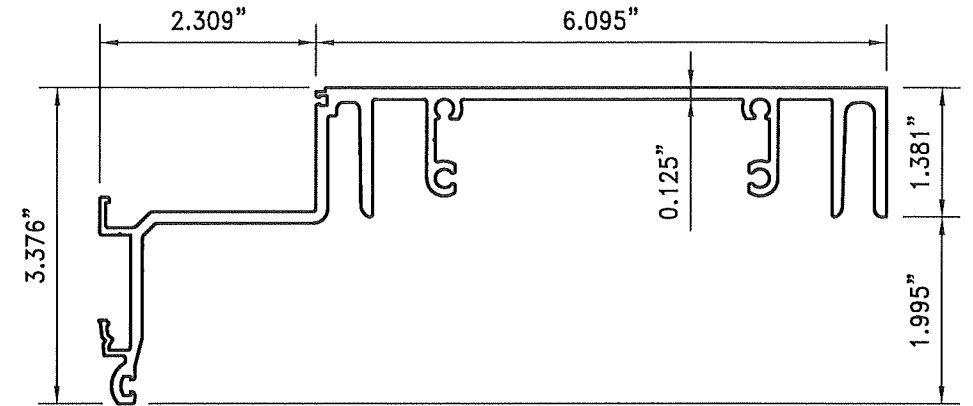


306181 ³⁸
STACK SILL

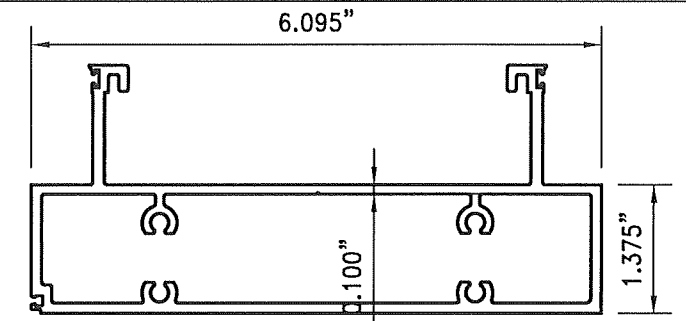


306191 ³⁹
STACK HEAD

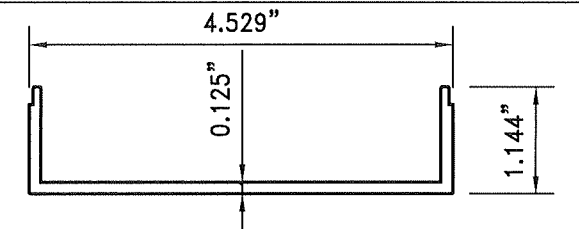


306801 ⁴¹
STACK SPLICE SLEEVE

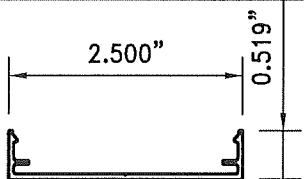


300216 ³³
OPTIONAL VERT. COVER

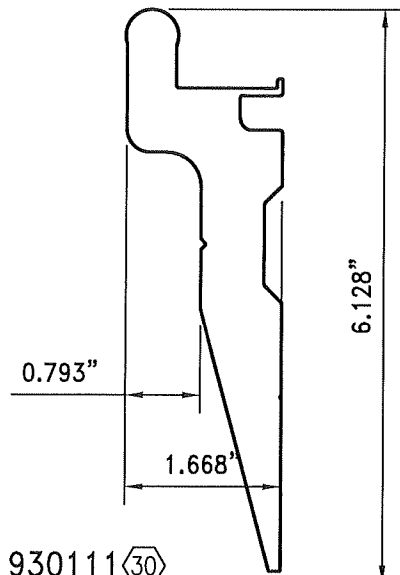


930111 ³⁰
FLOOR EDGE PLATE

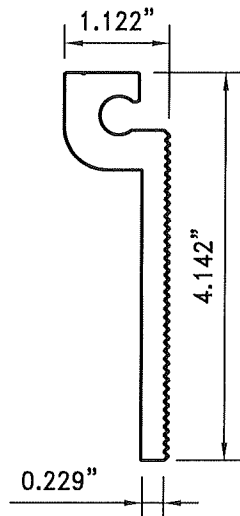


930109 ²⁸
KNUCKLE ANCHOR

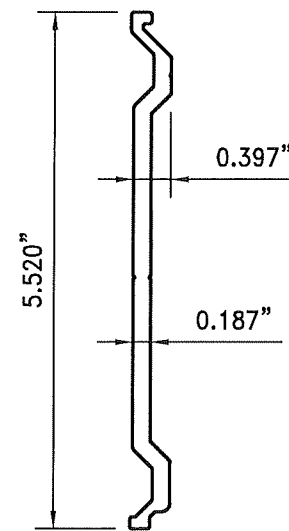


930107 ²⁶
STACK SPLICE PLATE

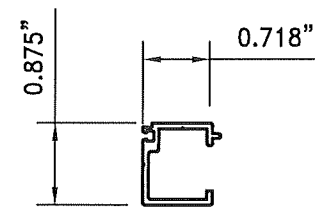


300312 ³²
MONOLITHIC ADAPTER

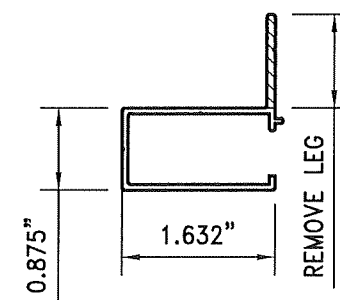


300313 ⁴³
POCKET FILLER

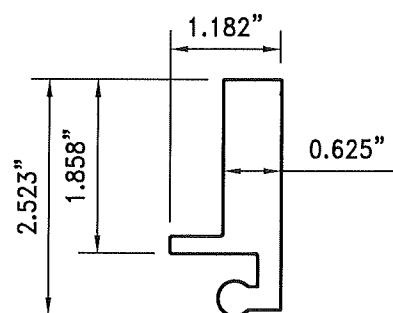


930108 ²⁹
HOOK ANCHOR

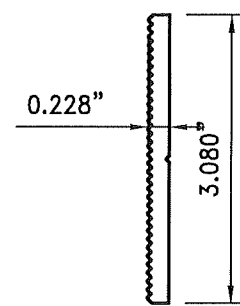


930110 ²⁷
SERRATED PLATE



300702 ³⁵
CORNER PRES. PLATE

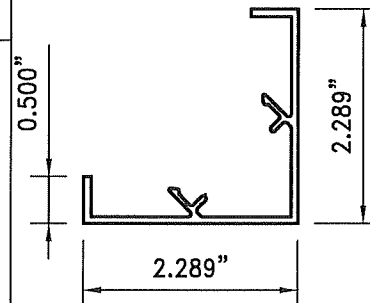

300218 ³⁴
CORNER COVER

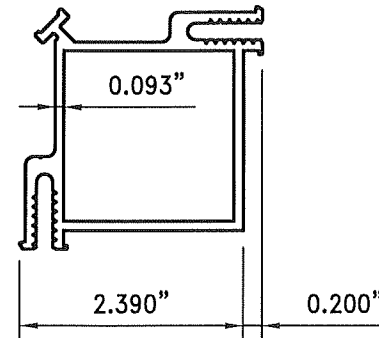

300321 ⁴⁴
CORNER ADAPTOR



Larson Engineering, Inc.

3524 Labore Road
White Bear Lake, MN 55110
(P) 651.481.9120 (F) 651.481.9201

DADE CO. STAMP

PRODUCT REVISED
As complying with the Florida
Building Code
NOA-No. **25-0902.03**
Expiration Date: **09/02/2029**
By: *Manuel Perez*
Miami-Dade Product Control

ENGINEER'S STAMP

ETHAN A. CHARPENTIER
LICENSED PROFESSIONAL ENGINEER
No. 85108
STATE OF FLORIDA
Professional Seal No. 85108
Expiration Date 09/02/2029
Ethan A. Charpentier
Registration No. 85108



Harmon

HI 7000 LARGE MISSILE
PART DRAWINGS

DATE: 06/28/04	6	6/17/16	
1	11/18/08	7	03/05/19
2	3/10/09	8	02/25/21
3	3/16/09	9	08/12/25
4	5/22/12		
5	10/03/14		

DWG. NO. HI7000LM

SHEET 09 OF 41

SINGLE SPAN APPLICATION


REINFORCING
OPTIONS

		Case 1	Case 2	Case 3	Case 4	Case 5	Case 6	Case 7
	"B"	"L"/"R"	"L"/"R"	"L"/"R"	"L"/"R"	"L"/"R"	"L"/"R"	"L"/"R"
UP TO MAXIMUM 60 PSF POS. OR NEG. LOAD	3'-0"	10'-4" 933	13'-9" 1243	16'-6" 1490	17'-7" 1587	18'-3" 1645	19'-6" 1758	20'-8" 1862
	4'-0"	8'-11" 1077	11'-11" 1435	14'-4" 1721	15'-6" 1863	16'-8" 2002	18'-2" 2181	19'-2" 2310
	5'-0"	8'-0" 1204	10'-8" 1605	12'-9" 1924	13'-10" 2083	14'-10" 2238	17'-0" 2554	18'-2" 2731
	6'-0"	7'-3" 1319	9'-9" 1758	11'-8" 2107	12'-8" 2282	13'-7" 2451	15'-6" 2798	17'-4" 3131
UP TO MAXIMUM 70 PSF POS. OR NEG. LOAD	3'-0"	9'-7" 1007	12'-9" 1343	15'-3" 1610	16'-7" 1743	17'-6" 1847	18'-9" 1973	19'-10" 2090
	4'-0"	8'-3" 1163	11'-0" 1550	13'-3" 1859	14'-4" 2013	15'-5" 2162	17'-5" 2448	18'-6" 2593
	5'-0"	7'-5" 1301	9'-10" 1733	11'-10" 2078	12'-10" 2250	13'-9" 2417	15'-9" 2759	17'-6" 3065
	6'-0"	6'-9" 1425	9'-0" 1899	10'-10" 2276	11'-8" 2465	12'-7" 2648	14'-4" 3022	16'-1" 3391
UP TO MAXIMUM 80 PSF POS. OR NEG. LOAD	3'-0"	8'-11" 1077	11'-11" 1435	14'-4" 1721	15'-6" 1863	16'-8" 2002	18'-2" 2181	19'-2" 2310
	4'-0"	7'-9" 1244	10'-4" 1657	12'-4" 1987	13'-5" 2152	14'-5" 2311	16'-5" 2638	17'-10" 2866
	5'-0"	6'-11" 1390	9'-3" 1853	11'-1" 2221	12'-0" 2405	12'-10" 2584	14'-8" 2949	16'-6" 3309
	6'-0"	6'-4" 1523	8'-5" 2030	10'-1" 2433	10'-11" 2635	11'-9" 2830	13'-5" 3231	15'-1" 3625
UP TO MAXIMUM 90 PSF POS. OR NEG. LOAD	3'-0"	8'-5" 1142	11'-3" 1522	13'-6" 1825	14'-7" 1976	15'-8" 2123	17'-7" 2382	18'-8" 2523
	4'-0"	7'-3" 1319	9'-9" 1758	11'-8" 2107	12'-8" 2282	13'-7" 2451	15'-6" 2798	17'-4" 3131
	5'-0"	6'-6" 1475	8'-8" 1965	10'-5" 2356	11'-4" 2551	12'-2" 2741	13'-10" 3128	15'-7" 3510
	6'-0"	5'-11" 1615	7'-11" 2153	9'-6" 2581	10'-4" 2795	11'-1" 3002	12'-8" 3426	14'-2" 3845


REINFORCING
OPTIONS

		Case 1	Case 2	Case 3	Case 4	Case 5	Case 6	Case 7
	"B"	"L"/"R"	"L"/"R"	"L"/"R"	"L"/"R"	"L"/"R"	"L"/"R"	"L"/"R"
UP TO MAXIMUM 100 PSF POS. OR NEG. LOAD	3'-0"	8'-0" 1204	10'-8" 1605	12'-9" 1924	13'-10" 2083	14'-10" 2238	17'-0" 2554	18'-2" 2731
	4'-0"	6'-11" 1390	9'-3" 1853	11'-1" 2221	12'-0" 2405	12'-10" 2584	14'-8" 2949	16'-6" 3309
	5'-0"	6'-2" 1554	8'-3" 2072	9'-11" 2483	10'-9" 2689	11'-6" 2889	13'-2" 3297	14'-9" 3700
	6'-0"	5'-8" 1703	7'-6" 2269	9'-0" 2720	9'-9" 2946	10'-6" 3164	12'-0" 3612	13'-6" 4053
UP TO MAXIMUM 110 PSF POS. OR NEG. LOAD	3'-0"	7'-7" 1263	10'-2" 1683	12'-2" 2018	13'-2" 2185	14'-2" 2347	16'-2" 2679	17'-9" 2933
	4'-0"	6'-7" 1458	8'-9" 1943	10'-7" 2330	11'-5" 2523	12'-3" 2710	14'-0" 3093	15'-9" 3471
	5'-0"	5'-11" 1630	7'-10" 2173	9'-5" 2605	10'-3" 2821	11'-0" 3030	12'-6" 3458	14'-1" 3881
	6'-0"	5'-4" 1786	7'-2" 2380	8'-7" 2853	9'-4" 3090	10'-0" 3319	11'-5" 3788	12'-10" 4251
UP TO MAXIMUM 110 PSF POS. OR 120 PSF NEG. LOAD	3'-0"	7'-3" 1319	9'-9" 1758	11'-8" 2107	12'-8" 2282	13'-7" 2451	15'-6" 2798	17'-4" 3131
	4'-0"	6'-4" 1523	8'-5" 2030	10'-1" 2433	10'-11" 2635	11'-9" 2830	13'-5" 3231	15'-1" 3625
	5'-0"	5'-8" 1703	7'-6" 2269	9'-0" 2720	9'-9" 2946	10'-6" 3164	12'-0" 3612	13'-6" 4053
	6'-0"	5'-2" 1865	6'-10" 2486	8'-3" 2980	8'-11" 3227	9'-7" 3466	10'-11" 3956	12'-3" 4440
UP TO MAXIMUM 110 PSF POS. OR 130 PSF NEG. LOAD	3'-0"	7'-0" 1373	9'-4" 1830	11'-2" 2193	12'-2" 2375	13'-0" 2551	14'-11" 2912	16'-9" 3268
	4'-0"	6'-1" 1585	8'-1" 2113	9'-8" 2533	10'-6" 2743	11'-3" 2946	12'-11" 3362	14'-6" 3773
	5'-0"	5'-5" 1772	7'-3" 2362	8'-8" 2831	9'-5" 3066	10'-1" 3294	11'-6" 3759	12'-11" 4219
	6'-0"	4'-11" 1941	6'-7" 2587	7'-11" 3102	8'-7" 3359	9'-2" 3608	10'-6" 4118	11'-6" 4515

GENERAL NOTES:

- "L" = MAXIMUM MULLION SPAN
- "B" = C/L TO C/L SPACING
- $"B" = \frac{W1 + W2}{2}$ 
- FOR SINGLE SPAN MAXIMUM DEFL. = L/180 or 1"
- (WHEN STEEL RIENF. IS USED, LENGTH OF STEEL IS LENGTH OF MULLION MINUS 12")
- SPANS ARE LIMITED BY MAXIMUM TESTED END REACTIONS
- R= REACTION (REFER TO PAGE 13 FOR BUILDING CONDITION TYPES AND PAGES 19, 20, 21, 23 FOR REACTION DETAIL OPTIONS)

SINGLE SPAN

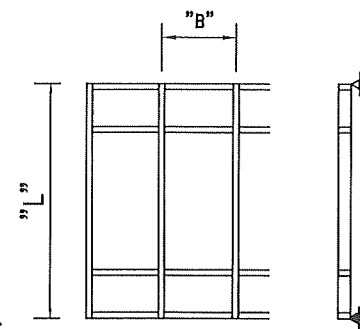


REINFORCING OPTIONS


1

COMBINED Ix =
12.941 in⁴


NO REINFORCING



2

COMBINED Ix =
22.993 in⁴1/4" x 5 1/2"
STL BAR


3

COMBINED Ix =
33.045 in⁴(2) 1/4" x 5 1/2"
STL BARS


4

COMBINED Ix =
38.751 in⁴


C5x9




5

COMBINED Ix =
44.714 in⁴C5x6.7 w/
1/4" x 5 1/2"
STL BAR

6

COMBINED Ix =
58.254 in⁴1 1/2" x 5"
STL BAR

7

COMBINED Ix =
73.538 in⁴2" x 5"
STL BAR

Larson Engineering, Inc.

3524 Labore Road
White Bear Lake, MN 55110
(P) 651.481.9120 (F) 651.481.9201

DADE CO. STAMP

PRODUCT REVISED
As complying with the Florida
Building Code
NOA-No. **25-0902.03**
Expiration Date: **09/02/2029**
By: *Manuel Perez*
Miami-Dade Product Control

ENGINEER'S STAMP

ETHAN A. STAMPER
LICENSE
No. 65106
STATE OF
FLORIDA
Professional Engineer
Registration

Harmon

HI 7000 LARGE MISSILE

MULLION APPLICATIONS

LOAD TABLES SINGLE SPAN

DATE: 06/28/04	6	6/17/16	
1	11/18/08	7	03/05/19
2	3/10/09	8	02/25/21
3	3/16/09	9	08/12/25
4	5/22/12		
5	10/03/14		

DWG. NO. HI7000LM

SHEET 10 OF 41

TWIN SPAN APPLICATION


REINFORCING
OPTIONS

		Case 1	Case 2	Case 3	Case 4	Case 5	Case 6	Case 7
	"B"	"L"/"R"	"L"/"R"	"L"/"R"	"L"/"R"	"L"/"R"	"L"/"R"	"L"/"R"
UP TO MAXIMUM 60 PSF POS. OR NEG. LOAD	3' 0"	12'-8"	14'-7"	14'-7"	14'-7"	14'-7"	14'-7"	14'-7"
	RE	872	1006	1006	1006	1006	1006	1006
	RM	2781	3209	3209	3209	3209	3209	3209
	4' 0"	10'-11"	13'-6"	14'-7"	14'-7"	14'-7"	14'-7"	14'-7"
	RE	1007	1238	1342	1342	1342	1342	1342
	RM	3211	3946	4278	4278	4278	4278	4278
	5' 0"	9'-10"	12'-1"	14'-5"	14'-7"	14'-7"	14'-7"	14'-7"
	RE	1126	1384	1658	1677	1677	1677	1677
	RM	3590	4411	5288	5348	5348	5348	5348
	6' 0"	8'-11"	11'-0"	13'-2"	14'-7"	14'-7"	14'-7"	14'-7"
	RE	1233	1516	1817	2012	2012	2012	2012
	RM	3932	4832	5793	6417	6417	6417	6417
UP TO MAXIMUM 70 PSF POS. OR NEG. LOAD	3' 0"	11'-9"	14'-5"	14'-7"	14'-7"	14'-7"	14'-7"	14'-7"
	RE	942	1158	1174	1174	1174	1174	1174
	RM	3003	3691	3744	3744	3744	3744	3744
	4' 0"	10'-2"	12'-6"	14'-7"	14'-7"	14'-7"	14'-7"	14'-7"
	RE	1088	1337	1565	1565	1565	1565	1565
	RM	3468	4262	4991	4991	4991	4991	4991
	5' 0"	9'-1"	11'-2"	13'-4"	14'-7"	14'-7"	14'-7"	14'-7"
	RE	1216	1494	1791	1957	1957	1957	1957
	RM	3877	4765	5712	6239	6239	6239	6239
	6' 0"	8'-3"	10'-2"	12'-2"	13'-10"	14'-2"	14'-7"	14'-7"
	RE	1332	1637	1962	2229	2283	2348	2348
	RM	4247	5219	6257	7106	7278	7487	7487
UP TO MAXIMUM 80 PSF POS. OR NEG. LOAD	3' 0"	10'-11"	13'-6"	14'-7"	14'-7"	14'-7"	14'-7"	14'-7"
	RE	1007	1238	1342	1342	1342	1342	1342
	RM	3211	3946	4278	4278	4278	4278	4278
	4' 0"	9'-6"	11'-8"	14'-0"	14'-7"	14'-7"	14'-7"	14'-7"
	RE	1163	1429	1713	1789	1789	1789	1789
	RM	3707	4556	5462	5704	5704	5704	5704
	5' 0"	8'-6"	10'-5"	12'-6"	14'-3"	14'-7"	14'-7"	14'-7"
	RE	1300	1597	1915	2175	2228	2236	2236
	RM	4145	5094	6106	6935	7103	7130	7130
	6' 0"	7'-9"	9'-6"	11'-5"	13'-0"	14'-7"	14'-7"	14'-7"
	RE	1424	1750	2098	2382	2440	2683	2683
	RM	4540	5580	6689	7597	7781	8556	8556
UP TO MAXIMUM 90 PSF POS. OR NEG. LOAD	3' 0"	10'-4"	12'-8"	14'-7"	14'-7"	14'-7"	14'-7"	14'-7"
	RE	1068	1313	1509	1509	1509	1509	1509
	RM	3405	4185	4813	4813	4813	4813	4813
	4' 0"	8'-11"	11'-0"	13'-2"	14'-7"	14'-7"	14'-7"	14'-7"
	RE	1233	1516	1817	2012	2012	2012	2012
	RM	3932	4832	5793	6417	6417	6417	6417
	5' 0"	8'-0"	9'-10"	11'-9"	13'-5"	13'-9"	14'-7"	14'-7"
	RE	1379	1694	2031	2307	2363	2515	2515
	RM	4396	5402	6477	7356	7534	8021	8021
	6' 0"	7'-3"	9'-0"	10'-9"	12'-3"	12'-6"	14'-7"	14'-7"
	RE	1510	1856	2225	2527	2588	3018	3018
	RM	4816	5918	7095	8058	8253	9625	9625







REINFORCING
OPTIONS

		Case 1	Case 2	Case 3	Case 4	Case 5	Case 6	Case 7
	"B"	"L"/"R"	"L"/"R"	"L"/"R"	"L"/"R"	"L"/"R"	"L"/"R"	"L"/"R"
UP TO MAXIMUM 100 PSF POS. OR NEG. LOAD	3' 0"	9'-10"	12'-1"	14'-5"	14'-7"	14'-7"	14'-7"	14'-7"
	RE	1126	1384	1658	1677	1677	1677	1677
	RM	3590	4411	5288	5348	5348	5348	5348
	4' 0"	8'-6"	10'-5"	12'-6"	14'-3"	14'-7"	14'-7"	14'-7"
	RE	1300	1597	1915	2175	2228	2236	2236
	RM	4145	5094	6106	6935	7103	7130	7130
	5' 0"	7'-7"	9'-4"	11'-2"	12'-8"	13'-0"	14'-7"	14'-7"
	RE	1453	1786	2141	2432	2490	2795	2795
	RM	4634	5695	6827	7754	7941	8912	8912
	6' 0"	6'-11"	8'-6"	10'-2"	11'-7"	11'-11"	14'-3"	14'-7"
	RE	1592	1956	2345	2664	2728	3266	3354
	RM	5076	6238	7478	8494	8699	10414	10695
UP TO MAXIMUM 110 PSF POS. OR NEG. LOAD	3' 0"	9'-4"	11'-6"	13'-9"	14'-7"	14'-7"	14'-7"	14'-7"
	RE	1181	1451	1739	1845	1845	1845	1845
	RM	3765	4626	5546	5882	5882	5882	5882
	4' 0"	8'-1"	9'-11"	11'-11"	13'-7"	13'-11"	14'-7"	14'-7"
	RE	1363	1675	2008	2281	2336	2460	2460
	RM	4347	5342	6404	7274	7449	7843	7843
	5' 0"	7'-3"	8'-11"	10'-8"	12'-1"	12'-5"	14'-7"	14'-7"
	RE	1524	1873	2245	2550	2612	3074	3074
	RM	4860	5973	7160	8132	8329	9804	9804
	6' 0"	6'-7"	8'-1"	9'-9"	11'-1"	11'-4"	13'-7"	14'-5"
	RE	1670	2052	2460	2794	2861	3425	3634
	RM	5324	6543	7843	8908	9124	10922	11587
UP TO MAXIMUM 110 PSF POS. OR 120 PSF NEG. LOAD	3' 0"	8'-11"	11'-0"	13'-2"	14'-7"	14'-7"	14'-7"	14'-7"
	RE	1233	1516	1817	2012	2012	2012	2012
	RM	3932	4832	5793	6417	6417	6417	6417
	4' 0"	7'-9"	9'-6"	11'-5"	13'-0"	13'-3"	14'-7"	14'-7"
	RE	1424	1750	2098	2382	2440	2683	2683
	RM	4540	5580	6689	7597	7781	8556	8556
	5' 0"	6'-11"	8'-6"	10'-2"	11'-7"	11'-11"	14'-3"	14'-7"
	RE	1592	1956	2345	2664	2728	3266	3354
	RM	5076	6238	7478	8494	8699	10414	10695
	6' 0"	6'-4"	7'-9"	9'-4"	10'-7"	10'-10"	13'-0"	13'-2"
	RE	1744	2143	2569	2918	2988	3577	3634
	RM	5561	6834	8192	9304	9529	11408	11587
UP TO MAXIMUM 110 PSF POS. OR 130 PSF NEG. LOAD	3' 0"	8'-7"	10'-7"	12'-8"	14'-5"	14'-7"	14'-7"	14'-7"
	RE	1284	1577	1891	2148	2180	2180	2180
	RM	4093	5029	6029	6848	6952	6952	6952
	4' 0"	7'-5"	9'-2"	11'-0"	12'-6"	12'-9"	14'-7"	14'-7"
	RE	1482	1821	2183	2480	2540	2907	2907
	RM	4726	5807	6962	7907	8098	9269	9269
	5' 0"	6'-8"	8'-2"	9'-10"	11'-2"	11'-5"	13'-8"	14'-7"
	RE	1657	2036	2441	2772	2839	3399	3633
	RM	5283	6493	7784	8840	9054	10839	11586
	6' 0"	6'-1"	7'-5"	8'-11"	10'-2"	10'-5"	12'-2"	12'-2"
	RE	1815	2231	2674	3037	3110	3634	3634
	RM	5788	7113	8527	9684	9918	11587	11587

GENERAL NOTES:

- "H" = MULLION LENGTH
- "L" = SPAN BETWEEN ANCHORS
- "B" = C/L TO C/L SPACING
- $$B = \frac{W1 + W2}{2}$$

- FOR TWIN SPAN MAXIMUM DEFL. = L/180 OR 1"
- (WHEN STEEL REINF. IS USED, LENGTH OF STEEL IS LENGTH OF MULLION MINUS 12")
- SPANS ARE LIMITED BY MAXIMUM TESTED END REACTIONS
- RE= REACTION AT HEAD AND SILL (SEE PAGE 13)
- RM= REACTION AT MIDPOINT ANCHOR (SEE PAGE 13)


REINFORCING OPTIONS

1 COMBINED $I_x = 12.941 \text{ in}^4$ NO REINFORCING 	2 COMBINED $I_x = 22.993 \text{ in}^4$ $1/4" \times 5 \frac{1}{2}"$ STL BAR 	3 COMBINED $I_x = 33.045 \text{ in}^4$ (2) $1/4" \times 5 \frac{1}{2}"$ STL BARS 	TWIN-SPACER LENGTH RATIO CENTER ANGLE IS PERMITTED BE LOCATED $H/2 \pm 2"$
4 COMBINED $I_x = 38.751 \text{ in}^4$ C5x9 	5 COMBINED $I_x = 44.714 \text{ in}^4$ C5x6.7 w/ $1/4" \times 5 \frac{1}{2}"$ STL BAR 	6 COMBINED $I_x = 58.254 \text{ in}^4$ $1 \frac{1}{2}" \times 5"$ STL BAR 	7 COMBINED $I_x = 73.538 \text{ in}^4$ $2" \times 5"$ STL BAR 

TWIN SPAN

NO "TOTAL SPAN" SHALL BE
GREATER THAN 28'-4 3/4" (TESTED)TESTED LENGTHS ARE 165 3/4" (LOWER)
AND 175" (UPPER).
TOTAL LENGTH OF MULLION = (H)

$$(H) = \left(\frac{\text{CHART "L" }}{1.028} \right)^2$$

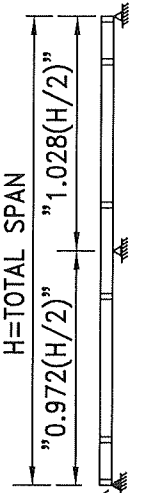THESE LENGTHS
ARE BASED ON
THE TESTED
"TWIN-SPAN"
LENGTH RATIOS.CENTER ANCHOR
IS PERMITTED TO
BE LOCATED @
H/2 +/- 2.8% (H/2)

Larson Engineering, Inc.

3524 Labore Road
White Bear Lake, MN 55110
(P) 651.481.9120 (F) 651.481.9201

DADE CO. STAMP

PRODUCT REVISED
As complying with the Florida
Building Code
NOA-No. **25-0902.03**
Expiration Date: **09/02/2029**
By: *Manuel Perez*
Miami-Dade Product Control

ENGINEER'S STAMP

ETHAN A. SCARF
No. 65106
STATE OF
FLORIDA
PROFESSIONAL ENGINEER
Registration No. 65106



Harmon

HI 7000 LARGE MISSILE

MULLION APPLICATIONS

LOAD TABLES

DATE: 06/28/04	6/17/16
11/18/08	03/05/19
3/10/09	02/25/21
3/16/09	08/12/25
5/22/12	
10/03/14	

DWG. NO. HI7000LM

SHEET 11 OF 41

TWIN SPAN w/ STACK RAIL APPLICATION

REINFORCING
OPTIONS



		Case 1	Case 2	Case 3	Case 4	Case 5	Case 6	Case 7
	"B"	"L"/"R"	"L"/"R"	"L"/"R"	"L"/"R"	"L"/"R"	"L"/"R"	"L"/"R"
UP TO MAXIMUM 60 PSF POS. OR NEG. LOAD	3' 0"	12'-5"	16'-5"	17'-11"	18'-8"	19'-4"	20'-8"	21'-11"
	RE	931	1224	1340	1394	1445	1544	1636
	RM	2635	3464	3793	3947	4090	4370	4629
	D	497	653	715	744	771	823	872
	4' 0"	10'-9"	14'-4"	16'-8"	17'-3"	17'-3"	17'-3"	17'-3"
	RE	1075	1433	1663	1716	1716	1716	1716
	RM	3043	4056	4706	4857	4857	4857	4857
	D	573	764	887	915	915	915	915
	5' 0"	9'-8"	12'-10"	13'-9"	13'-9"	13'-9"	13'-9"	13'-9"
	RE	1202	1602	1716	1716	1716	1716	1716
	RM	3402	4534	4857	4857	4857	4857	4857
	D	641	854	915	915	915	915	915
UP TO MAXIMUM 70 PSF POS. OR NEG. LOAD	6' 0"	8'-9"	11'-6"	11'-6"	11'-6"	11'-6"	11'-6"	11'-6"
	RE	1317	1716	1716	1716	1716	1716	1716
	RM	3726	4857	4857	4857	4857	4857	4857
	D	702	915	915	915	915	915	915
	3' 0"	11'-6"	15'-4"	17'-3"	17'-11"	18'-7"	19'-11"	21'-1"
	RE	1006	1340	1504	1565	1622	1733	1836
	RM	2846	3794	4257	4430	4592	4906	5197
	D	460	613	688	716	742	792	839
	4' 0"	10'-0"	13'-4"	16'-0"	16'-8"	17'-3"	17'-3"	17'-3"
	RE	1161	1548	1855	1942	2002	2002	2002
	RM	3286	4380	5251	5497	5666	5666	5666
	D	531	708	848	888	915	915	915
UP TO MAXIMUM 80 PSF POS. OR NEG. LOAD	5' 0"	8'-11"	11'-11"	13'-9"	13'-9"	13'-9"	13'-9"	13'-9"
	RE	1298	1730	2002	2002	2002	2002	2002
	RM	3674	4897	5666	5666	5666	5666	5666
	D	594	791	915	915	915	915	915
	6' 0"	8'-2"	10'-10"	11'-6"	11'-6"	11'-6"	11'-6"	11'-6"
	RE	1422	1895	2002	2002	2002	2002	2002
	RM	4025	5365	5666	5666	5666	5666	5666
	D	650	866	915	915	915	915	915
	3' 0"	10'-9"	14'-4"	16'-8"	17'-4"	18'-0"	19'-3"	20'-5"
	RE	1075	1433	1663	1730	1793	1916	2029
	RM	3043	4056	4706	4897	5075	5422	5744
	D	430	573	665	692	717	766	812
UP TO MAXIMUM 90 PSF POS. OR NEG. LOAD	4' 0"	9'-4"	12'-5"	14'-11"	16'-2"	16'-9"	17'-3"	17'-3"
	RE	1241	1655	1983	2147	2225	2288	2288
	RM	3513	4683	5614	6076	6297	6475	6475
	D	497	662	793	859	890	915	915
	5' 0"	8'-4"	11'-2"	13'-4"	13'-9"	13'-9"	13'-9"	13'-9"
	RE	1388	1850	2217	2288	2288	2288	2288
	RM	3928	5236	6276	6475	6475	6475	6475
	D	555	740	887	915	915	915	915
	6' 0"	7'-7"	10'-2"	11'-6"	11'-6"	11'-6"	11'-6"	11'-6"
	RE	1520	2026	2288	2288	2288	2288	2288
	RM	4303	5735	6475	6475	6475	6475	6475
	D	608	811	915	915	915	915	915
UP TO MAXIMUM 110 PSF POS. OR NEG. LOAD	3' 0"	10'-2"	13'-7"	16'-2"	16'-10"	17'-6"	18'-8"	19'-9"
	RE	1140	1520	1816	1890	1959	2093	2217
	RM	3227	4302	5140	5349	5544	5923	6274
	D	406	541	646	672	697	744	788
	4' 0"	8'-9"	11'-9"	14'-1"	15'-3"	16'-3"	17'-3"	17'-3"
	RE	1317	1755	2104	2278	2430	2574	2574
	RM	3726	4967	5954	6448	6879	7285	7285
	D	468	624	748	810	864	915	915
	5' 0"	7'-10"	10'-6"	12'-7"	13'-8"	13'-9"	13'-9"	13'-9"
	RE	1472	1962	2352	2547	2574	2574	2574
	RM	4166	5553	6657	7209	7285	7285	7285
	D	524	698	836	906	915	915	915
UP TO MAXIMUM 130 PSF POS. OR NEG. LOAD	6' 0"	7'-2"	9'-7"	11'-6"	11'-6"	11'-6"	11'-6"	11'-6"
	RE	1612	2149	2574	2574	2574	2574	2574
	RM	4564	6083	7285	7285	7285	7285	7285
	D	573	764	915	915	915	915	915

REINFORCING
OPTIONS




		Case 1	Case 2	Case 3	Case 4	Case 5	Case 6	Case 7
	"B"	"L"/"R"	"L"/"R"	"L"/"R"	"L"/"R"	"L"/"R"	"L"/"R"	"L"/"R"
UP TO MAXIMUM 100 PSF POS. OR NEG. LOAD	3' 0"	9'-8"	12'-10"	15'-5"	16'-5"	17'-0"	18'-2"	19'-3"
	RE	1202	1602	1920	2045	2120	2265	2399
	RM	3402	4534	5436	5789	6000	6410	6790
	D	385	513	615	655	678	725	768
	4' 0"	8'-4"	11'-2"	13'-4"	14'-5"	15'-6"	16'-11"	17'-3"
	RE	1388	1850	2217	2401	2579	2810	2860
	RM	3928	5236	6276	6797	7301	7953	8094
	D	444	592	710	768	825	899	915
	5' 0"	7'-5"	9'-11"	11'-11"	12'-11"	13'-9"	13'-9"	13'-9"
	RE	1552	2068	2479	2685	2860	2860	2860
	RM	4391	5853	7017	7599	8094	8094	8094
	D	497	662	793	859	915	915	915
UP TO MAXIMUM 110 PSF POS. OR NEG. LOAD	6' 0"	6'-10"	9'-1"	10'-11"	11'-6"	11'-6"	11'-6"	11'-6"
	RE	1700	2265	2716	2860	2860	2860	2860
	RM	4811	6412	7687	8094	8094	8094	8094
	D	544	725	869	915	915	915	915
	3' 0"	9'-2"	12'-3"	14'-8"	15'-11"	16'-7"	17'-9"	18'-10"
	RE	1261	1680	2014	2181	2277	2432	2577
	RM	3568	4755	5701	6173	6444	6885	7293
	D	367	489	586	635	662	708	750
	4' 0"	7'-11"	10'-7"	12'-9"	13'-9"	14'-10"	16'-6"	17'-3"
	RE	1456	1940	2326	2518	2705	3018	3145
	RM	4120	5491	6583	7128	7657	8543	8904
	D	424	565	677	733	787	878	915
UP TO MAXIMUM 120 PSF POS. OR NEG. LOAD	5' 0"	7'-1"	9'-6"	11'-4"	12'-4"	13'-3"	13'-9"	13'-9"
	RE	1627	2169	2600	2816	3024	3145	3145
	RM	4606	6139	7360	7970	8561	8904	8904
	D	474	631	756	819	880	915	915
	6' 0"	6'-6"	8'-8"	10'-5"	11'-3"	11'-6"	11'-6"	11'-6"
	RE	1783	2376	2848	3084	3145	3145	3145
	RM	5045	6725	8062	8730	8904	8904	8904
	D	519	691	829	897	915	915	915
	3' 0"	8'-9"	11'-9"	14'-1"	15'-3"	16'-3"	17'-5"	18'-5"
	RE	1317	1755	2104	2278	2430	2596	2750
	RM	3726	4967	5954	6448	6879	7349	7785
	D	351	468	561	608	648	692	734
UP TO MAXIMUM 110 PSF POS. OR NEG. LOAD	4' 0"	7'-7"	10'-2"	12'-2"	13'-2"	14'-2"	16'-2"	17'-2"
	RE	1520	2026	2429	2630	2825	3221	3413
	RM	4303	5735	6875	7445	7998	9119	9660
	D	406	541	648	702	754	859	910
	5' 0"	6'-10"	9'-1"	10'-11"	11'-10"	12'-8"	13'-9"	13'-9"
	RE	1700	2265	2716	2941	3159	3431	3431
	RM	4811	6412	7687	8324	8942	9713	9713
	D	453	604	724	784	842	915	915
	6' 0"	6'-2"	8'-3"	9'-11"	10'-9"	11'-6"	11'-6"	11'-6"
	RE	1862	2482	2975	3221	3431	3431	3431
	RM	5270	7024	8420	9119	9713	9713	9713
	D	497	662	793	859	915	915	915
UP TO MAXIMUM 110 PSF POS. OR NEG. LOAD	3' 0"	8'-5"	11'-3"	13'-6"	14'-8"	15'-9"	17'-0"	18'-1"
	RE	1370	1826	2190	2371	2547	2757	2920
	RM	3879	5170	6197	6711	7209	7804	8267
	D	338	450	539	584	627	679	719
	4' 0"	7'-4"	9'-9"	11'-8"	12'-8"	13'-7"	15'-7"	16'-9"
	RE	1582	2109	2528	2738	2941	3357	3624
	RM	4478	5969	7156	7749	8324	9501	10257
	D	390	519	622	674	724	826	892
	5' 0"	6'-6"	8'-9"	10'-6"	11'-4"	12'-2"	13'-9"	13'-9"
	RE	1769	2358	2827	3061	3288	3717	3717
	RM	5007	6674	8001	8664	9307	10522	10522
	D	436	581	696	754	809	915	915
UP TO MAXIMUM 130 PSF POS. OR NEG. LOAD	6' 0"	5'-11"	7'-11"	9'-7"	10'-4"	11'-1"	11'-6"	11'-6"
	RE	1938	2583	3096	3353	3602	3717	3717
	RM	5485	7311	8764	9491	10195	10522	10522
	D	477	636	762	825	887	915	915

GENERAL NOTES:


- "L" = DISTANCE BETWEEN ANCHORS
- "B" = C/L TO C/L SPACING
- $B = \frac{W1 + W2}{2}$
- FOR TWIN SPAN MAXIMUM DEFL. = $L/180$ OR 1"
- (WHEN STEEL RIENF. IS USED, LENGTH OF STEEL IS LENGTH OF MULLION MINUS 12")
- SPANS ARE LIMITED BY MAXIMUM TESTED END REACTIONS
- RE= REACTION AT HEAD AND SILL (SEE PAGE 13)
- RM= REACTION AT MIDPOINT ANCHOR (SEE PAGE 13)
- D= DEADLOAD REACTION (SEE PAGE 13)

REINFORCING OPTIONS


1
COMBINED I_x =
12.941 in^4




2
COMBINED I_x =
22.993 in^4
1/4" x 5 1/2"
STL BAR




3
COMBINED I_x =
33.045 in^4
(2) 1/4" x 5 1/2"
STL BARS




4
COMBINED I_x =
38.751 in^4
C5x9




5
COMBINED I_x =
44.714 in^4
C5x6.7 w/
1/4" x 5 1/2"
STL BAR





6
COMBINED I_x =
58.254 in^4
1 1/2" x 5"
STL BAR



7
COMBINED I_x =
73.538 in^4
2" x 5"
STL BAR



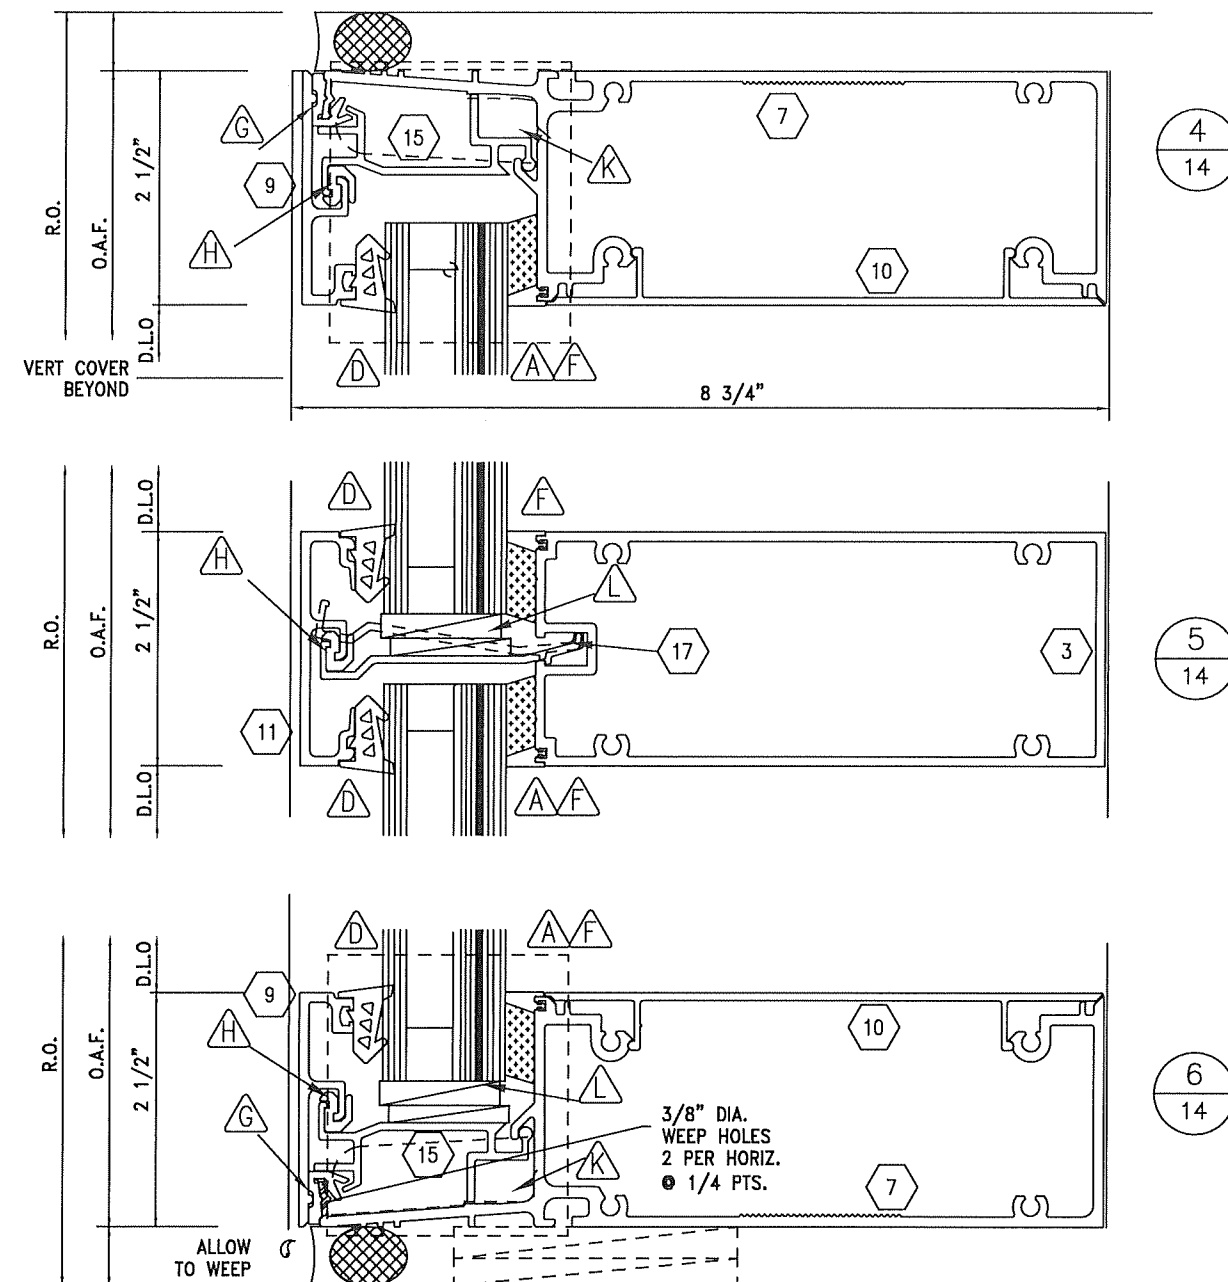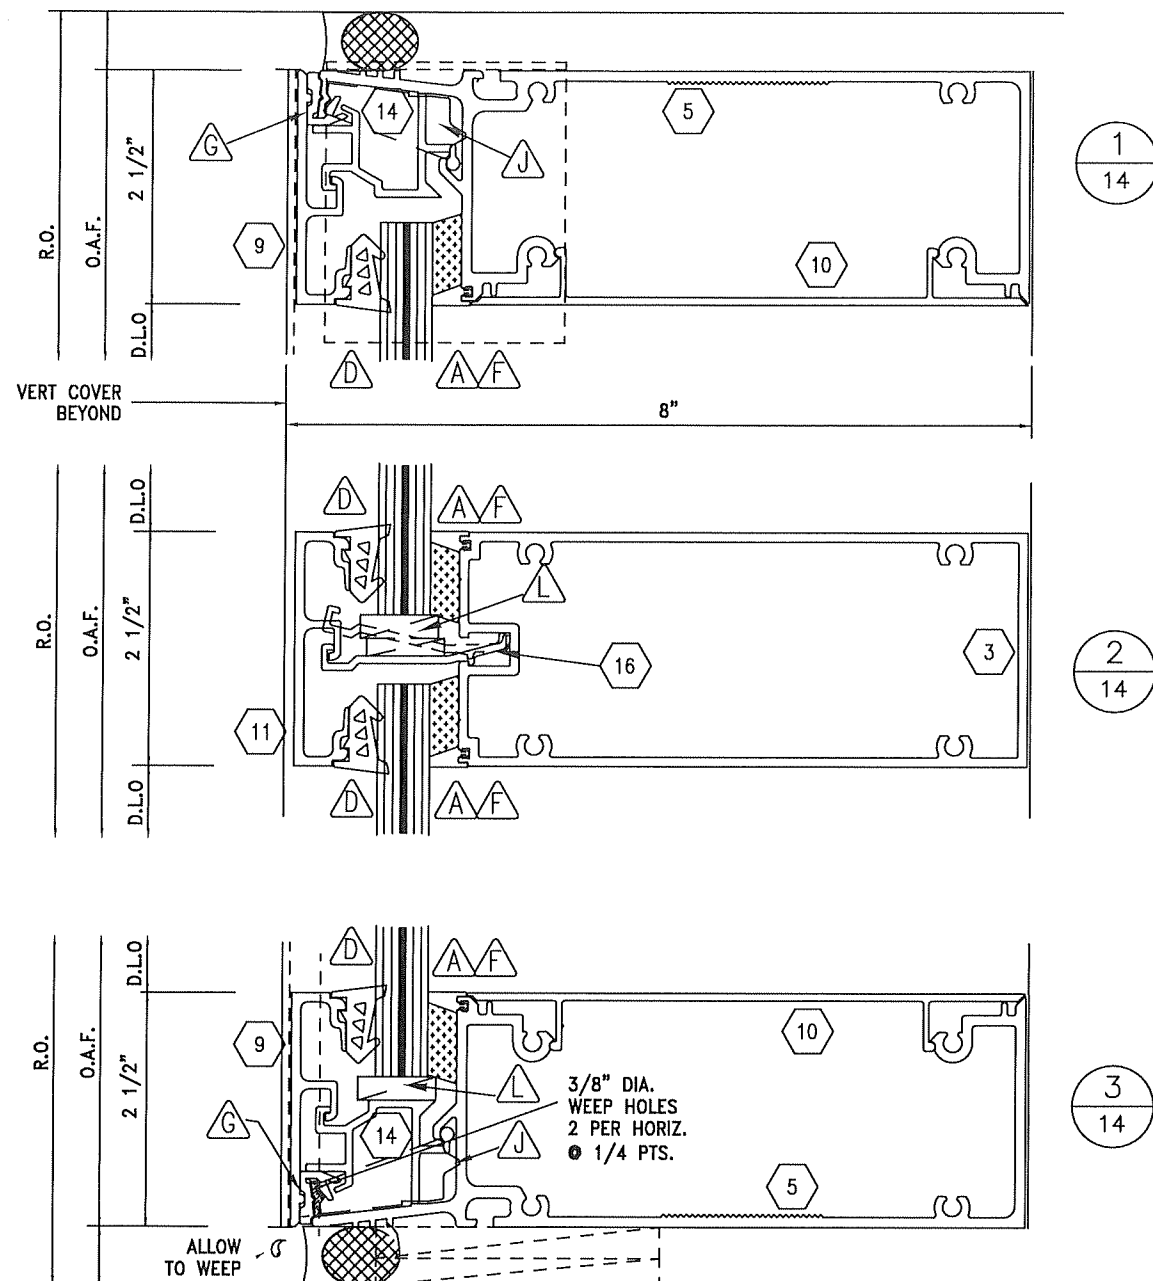

GENERAL NOTES:

- FOR ANCHOR DETAILS REFER TO SHEET 13
- FOR PART IDENTIFICATION REFER TO SHEET 2

- FASTENERS
- △ GASKETS
- ⬡ ALUMINUM EXTRUSIONS

- FOR GLAZING DETAILS, GLASS BITE & GASKET CONFIGURATIONS SEE SHEET 3.

Larson Engineering, Inc.
3524 Labore Road
White Bear Lake, MN 55110
(P) 651.481.9120 (F) 651.481.9201

DADE CO. STAMP

PRODUCT REVISED
As complying with the Florida Building Code
NOA-No. **25-0902.03**
Expiration Date: **09/02/2029**
By: *Manuel Perez*
Miami-Dade Product Control

ENGINEER STAMP

ETHAN PERCIVALLI
No. 65108
STATE OF FLORIDA
Professional Engineer
Florida Firm No. F-02000061
Certificate of Authorization #9808
Ethan Percivalli
Registration No. 166106







Harmon

HI 7000 LARGE MISSILE
HORIZONTAL DETAILS

DATE: 06/28/04	6/17/16
1 11/18/08	7 03/05/19
2 3/10/09	8 02/25/21
3 3/16/09	9 08/12/25
4 5/22/12	
5 10/03/14	

DWG. NO. HI7000LM

SHEET 14 OF 41

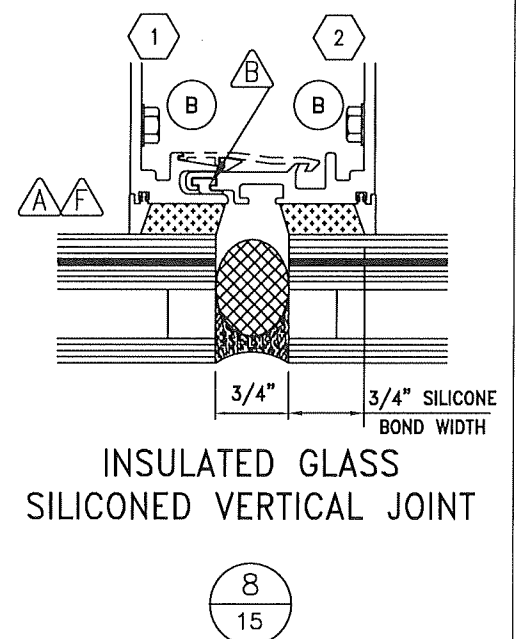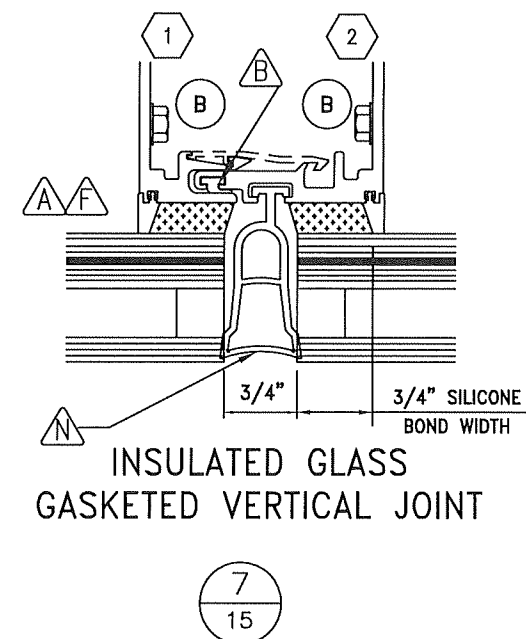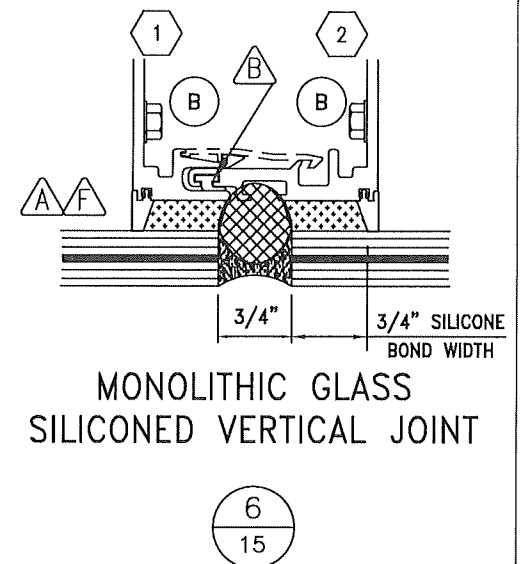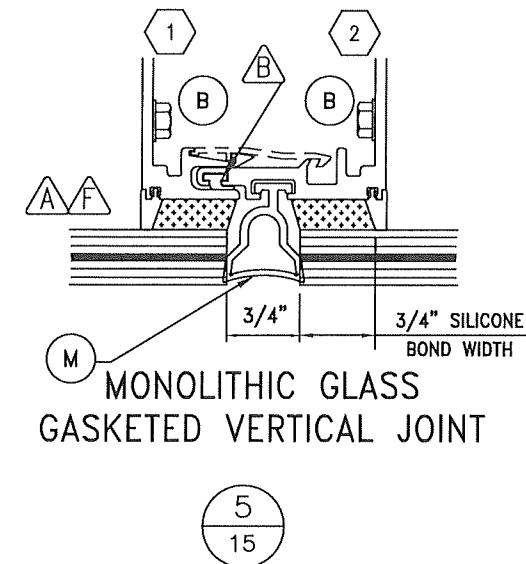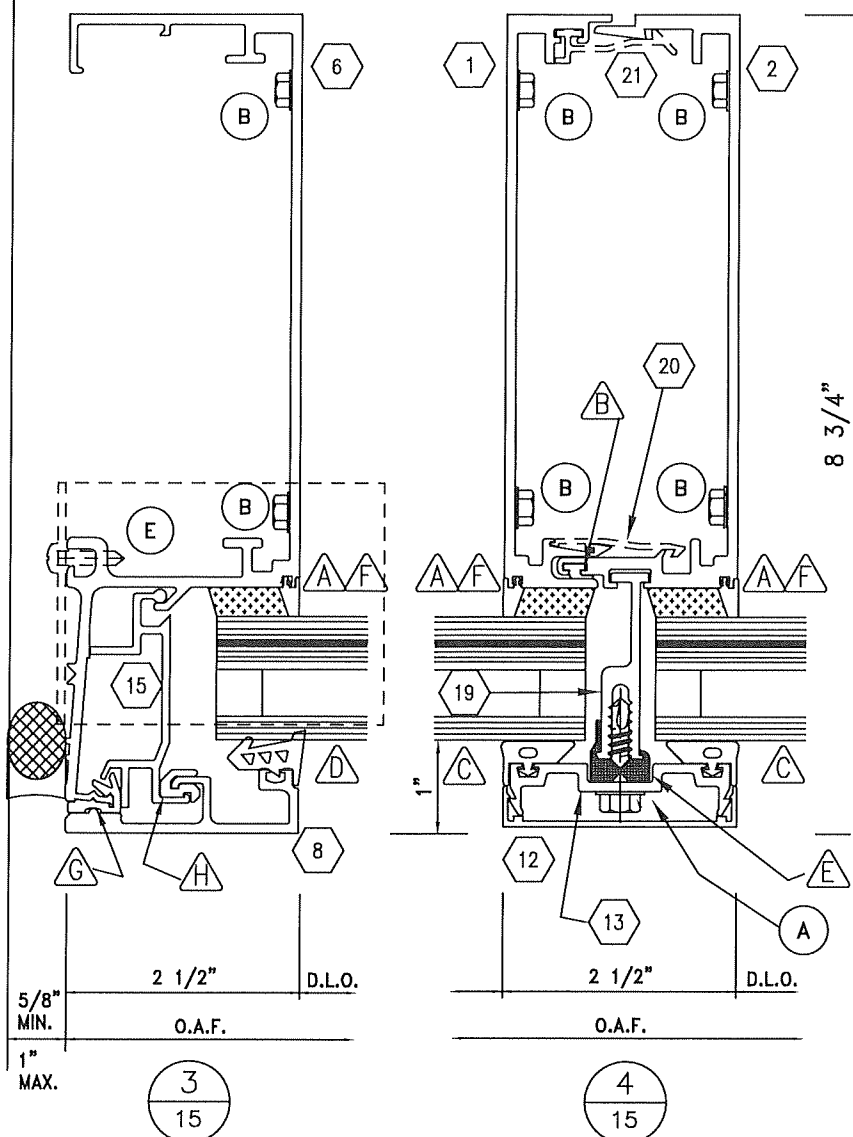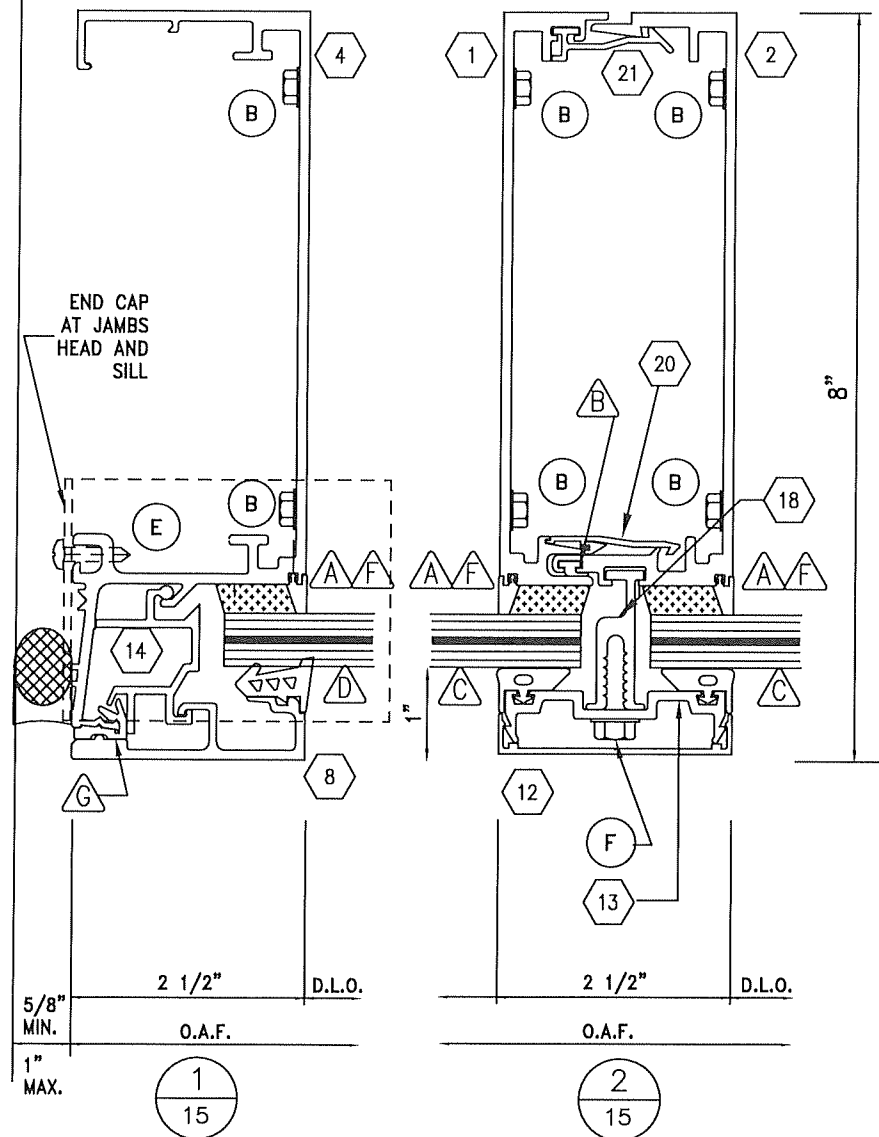

SILICONE OR GASKET GLASS JOINT DESIGN:

SILICONE OF GASKET GLASS JOINT DESIGN TESTED TO 90 PSF.

DETERMINE THE DESIGNED WINDLOAD AND THE SMALLEST LEG OF THE LARGEST LITE OF GLASS FOR THE PROJECT.

FOLLOW THE CHART FOR THE 3/4" SILICONE BOND WIDTH TO DETERMINE IF YOUR GLASS SIZE IS ACCEPTABLE FOR THE PROJECT.

IF YOUR SIZE AND WINDLOAD ARE NOT APPROVED, CONSULT THE ARCHITECT OR ENGINEER OF OPTIONS.

3/4" Silicone Bond Width Chart

Smallest leg of largest lite of glass

Windload	24"	30"	36"	42"	48"	54"	60"	66"	72"
20 PSF	3/4" OK	3/4" OK	3/4" OK	3/4" OK	3/4" OK	3/4" OK	3/4" OK	3/4" OK	3/4" OK
30 PSF	3/4" OK	3/4" OK	3/4" OK	3/4" OK	3/4" OK	3/4" OK	3/4" OK	3/4" OK	3/4" OK
40 PSF	3/4" OK	3/4" OK	3/4" OK	3/4" OK	3/4" OK	3/4" OK	3/4" OK	3/4" OK	3/4" OK
50 PSF	3/4" OK	3/4" OK	3/4" OK	3/4" OK	3/4" OK	3/4" OK	3/4" OK	3/4" OK	3/4" OK
60 PSF	3/4" OK	3/4" OK	3/4" OK	3/4" OK	3/4" OK	3/4" OK	3/4" OK	3/4" OK	3/4" OK
70 PSF	3/4" OK	3/4" OK	3/4" OK	3/4" OK	3/4" OK	3/4" OK	3/4" OK	Not Apvd	Not Apvd
80 PSF	3/4" OK	3/4" OK	3/4" OK	3/4" OK	3/4" OK	3/4" OK	Not Apvd	Not Apvd	Not Apvd
90 PSF	3/4" OK	3/4" OK	3/4" OK	3/4" OK	3/4" OK	3/4" OK	Not Apvd	Not Apvd	Not Apvd

GENERAL NOTES:

- FOR ANCHOR DETAILS REFER TO SHEET 13
- FOR PART IDENTIFICATION REFER TO SHEET 2

FASTENERS

GASKETS

ALUMINUM EXTRUSIONS

- FOR GLAZING DETAILS, GLASS BITE & GASKET CONFIGURATIONS SEE SHEET 3.

Larson Engineering, Inc.
3524 Labore Road
White Bear Lake, MN 55110
(P) 651.481.9120 (F) 651.481.9201

DADE CO. STAMP

PRODUCT REVISED
As complying with the Florida Building Code
NOA-No. **25-0902.03**
Expiration Date: **09/02/2029**
By: *Manuel Perez*
Miami-Dade Product Control

ENGINEER STAMP

STATE OF FLORIDA
Professional Engineer
No. 65106
Ethan A. Sharp
Registration No. 65106

Harmon

HI 7000 LARGE MISSILE
VERTICAL DETAILS


DATE: 06/28/04	6	6/17/16	
1	11/18/08	7	03/05/19
2	3/10/09	8	02/25/21
3	3/16/09	9	08/12/25
4	5/22/12		
5	10/03/14		

DWG. NO. HI7000LM


SHEET 15 OF 41

NOTE: SHALLOW HORIZONTALS MAY BE DESIRED TO AVOID EXPOSED EDGES AT VERTICALS DUE TO MITRE.


MAX. 90 P S F WITH THE SHORT HORIZ.

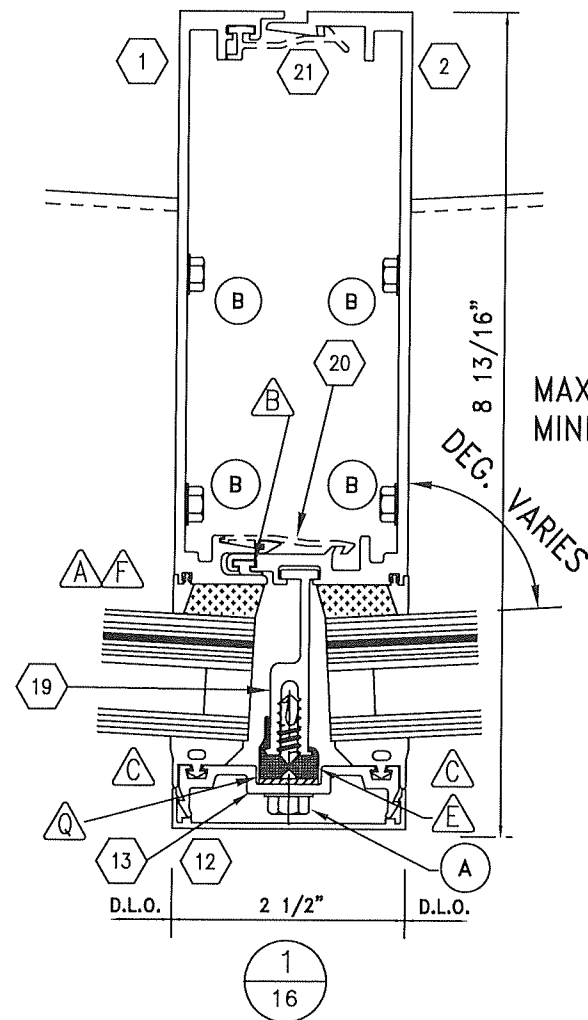


SEGMENTED MULLION
INSULATED GLASS

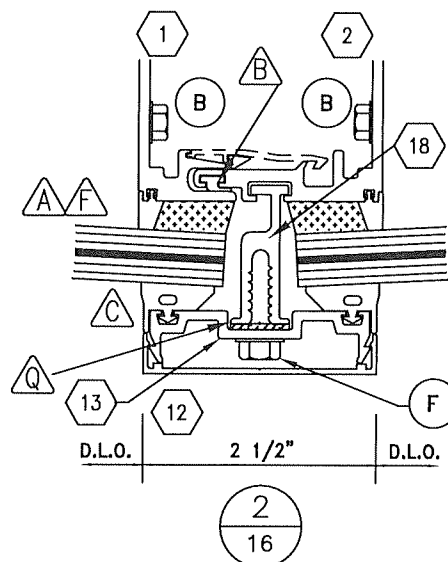

SEGMENTED MULLION
MONOLITHIC GLASS

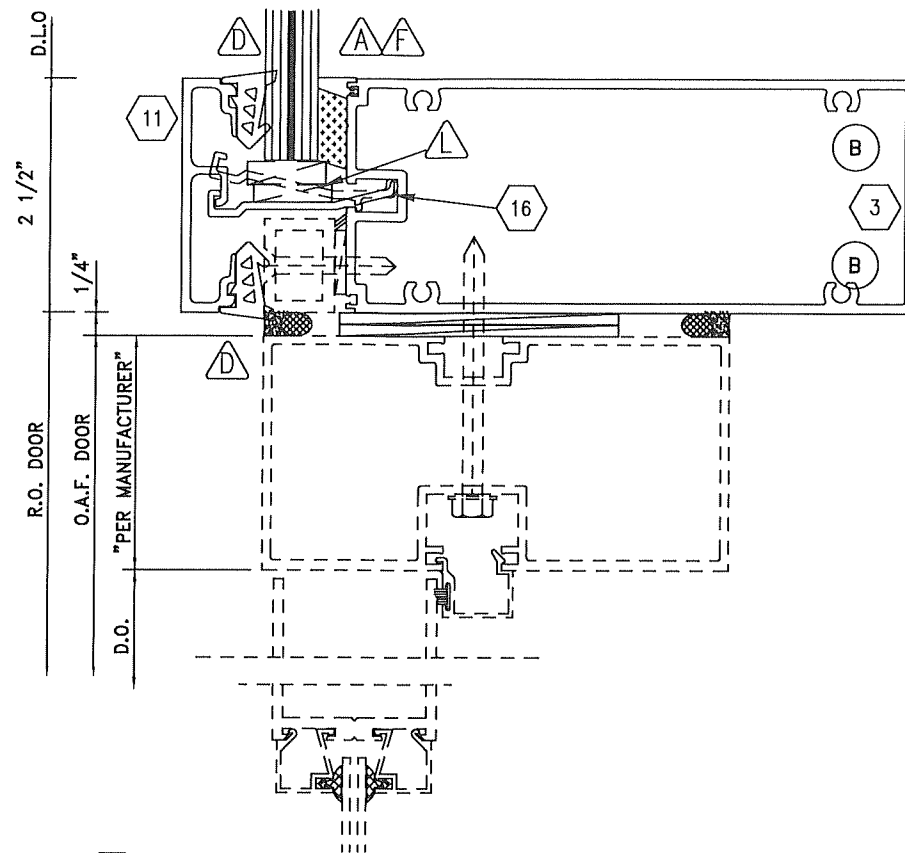

3
16

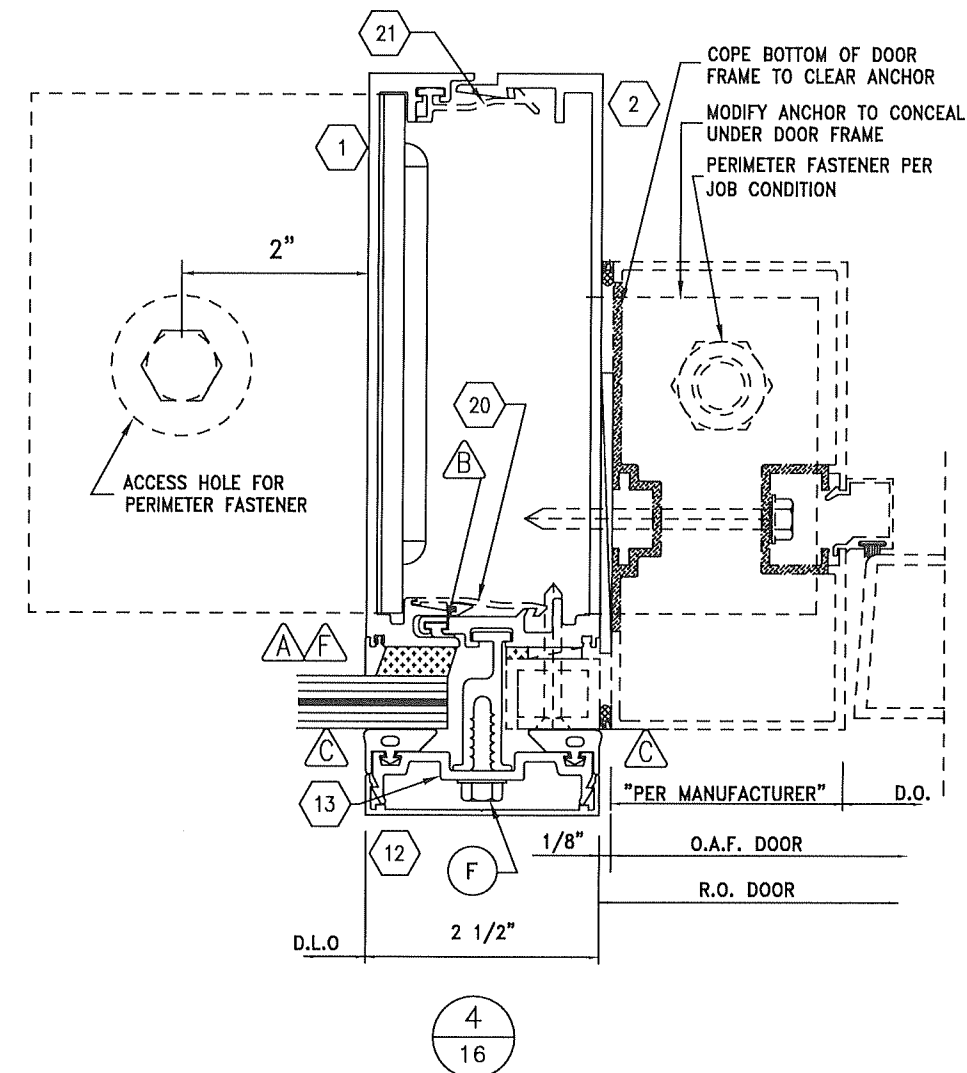

4
16

GENERAL NOTES:

- FOR ANCHOR DETAILS REFER TO SHEET 13
- FOR PART IDENTIFICATION REFER TO SHEET 2

○ FASTENERS

△ GASKETS

⬡ ALUMINUM EXTRUSIONS

- FOR GLAZING DETAILS, GLASS BITE & GASKET CONFIGURATIONS SEE SHEET 3.

Larson Engineering, Inc.
3524 Labore Road
White Bear Lake, MN 55110
(P) 651.481.9120 (F) 651.481.9201

DADE CO. STAMP

PRODUCT REVISED
As complying with the Florida
Building Code
NOA-No. **25-0902.03**
Expiration Date: **09/02/2029**
By: *Manuel Perez*
Miami-Dade Product Control

ENGINEER STAMP

8.19.25
No. 65106
STATE OF
FLORIDA
Professional Engineer
Ethan A. Argente
Registration No. 65106

Harmon


HI 7000 LARGE MISSILE

SEGMENTED MULLION &
DOOR DETAILS

DATE: 06/28/04	6	6/17/16
1 11/18/08	7	03/05/19
2 3/10/09	8	02/25/21
3 3/16/09	9	08/12/25
4 5/22/12		
5 10/03/14		

DWG. NO. HI7000LM

SHEET 16 OF 41

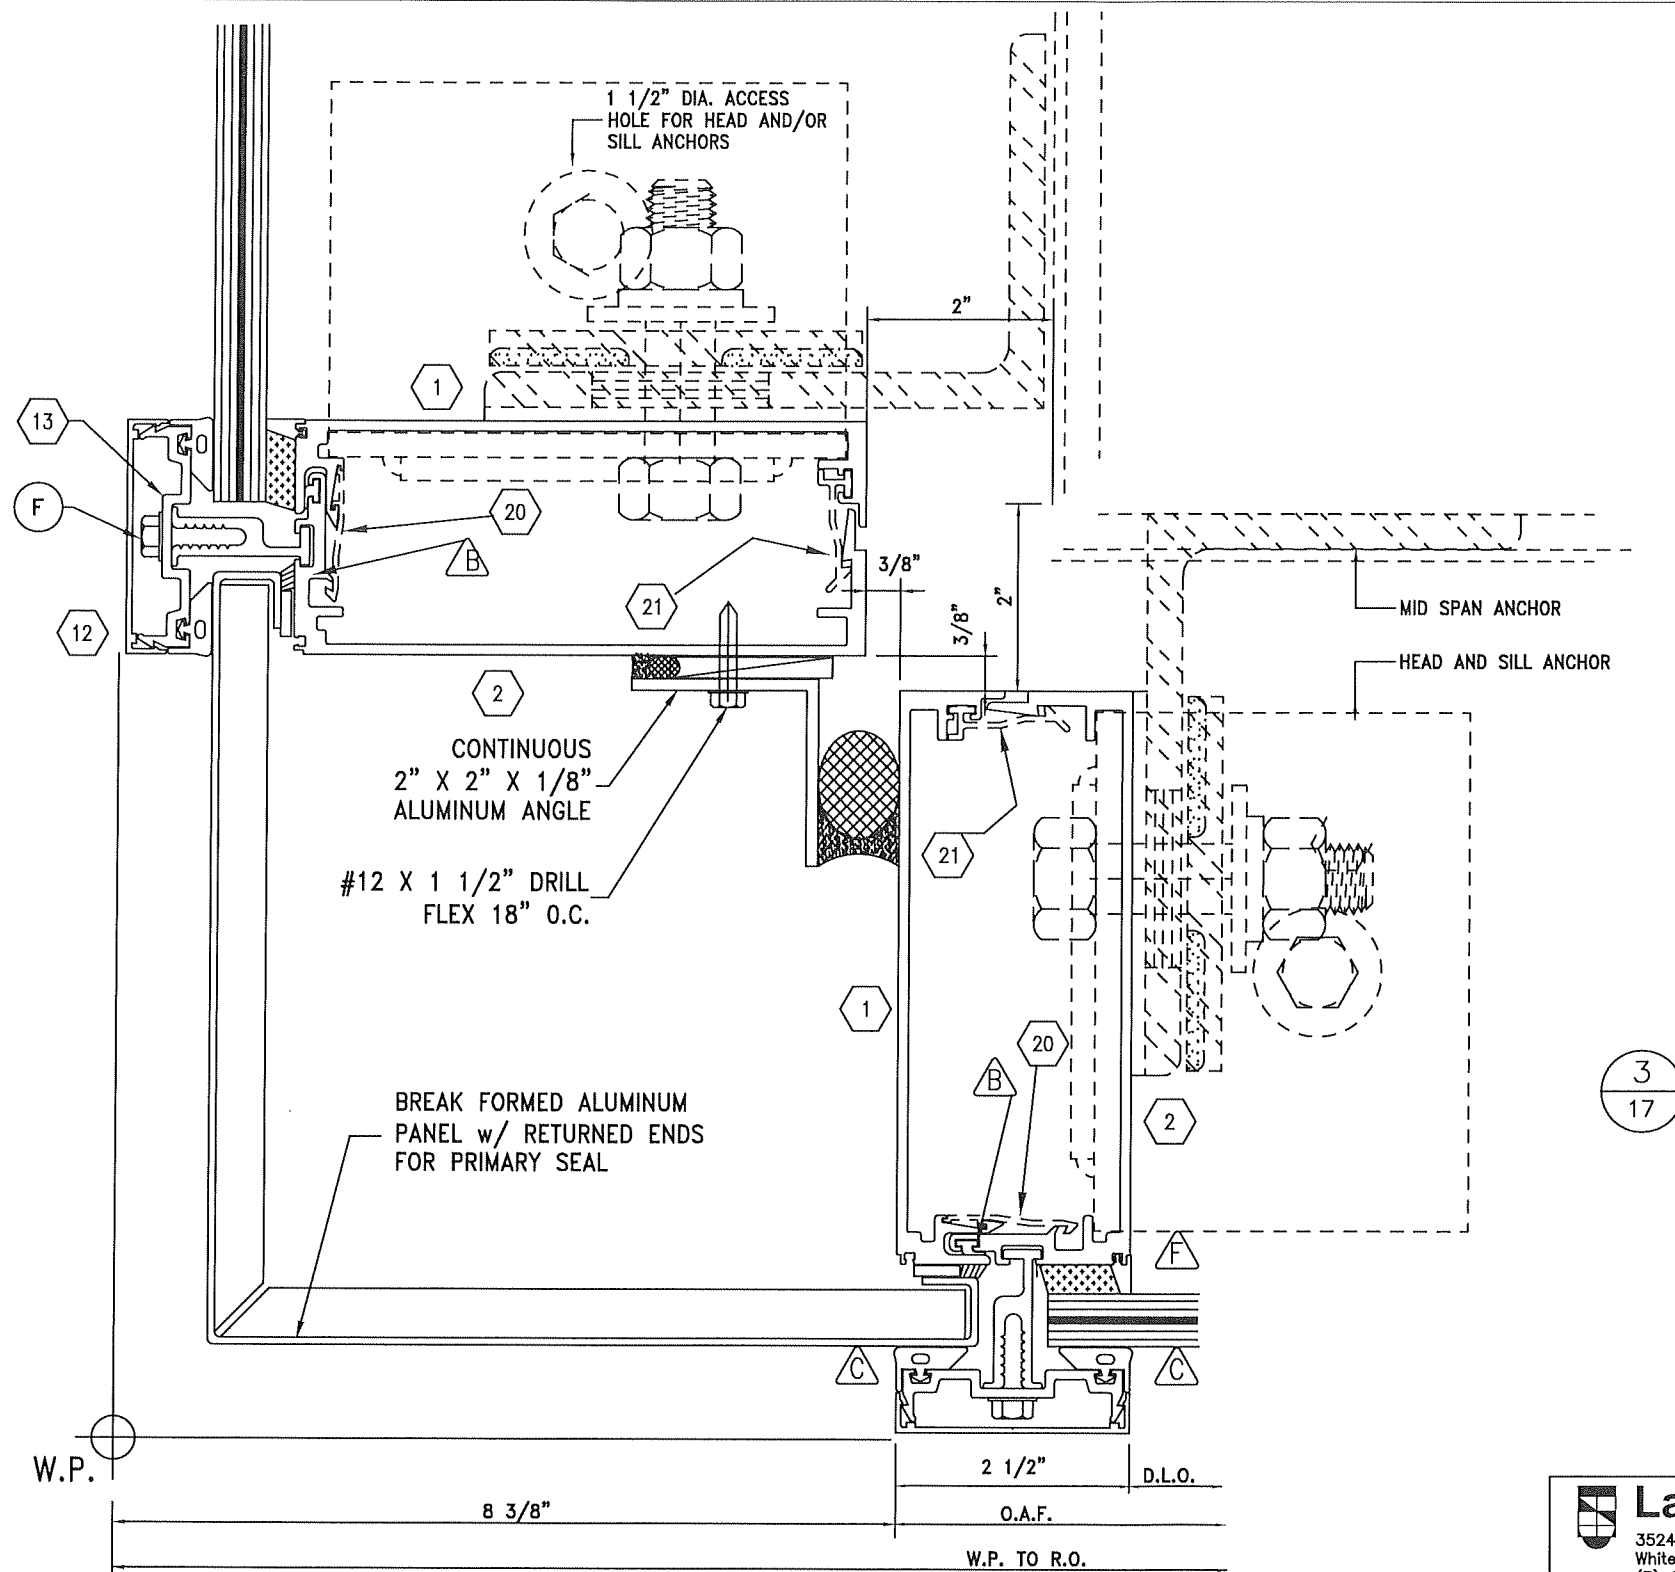

GENERAL NOTES:

- FOR PART IDENTIFICATION REFER TO SHEET 2

- FOR GLAZING DETAILS, GLASS BITE & GASKET CONFIGURATIONS SEE SHEET 3.

- FASTENERS
- △ GASKETS
- ⬡ ALUMINUM EXTRUSIONS

Larson Engineering, Inc.
3524 Labore Road
White Bear Lake, MN 55110
(P) 651.481.9120 (F) 651.481.9201

DADE CO. STAMP

PRODUCT REVISED
As complying with the Florida
Building Code
NOA-No. **25-0902.03**
Expiration Date: **09/02/2029**
By: *Manuel Perez*
Miami-Dade Product Control

ENGINEER STAMP

ETHANA A. STAMP
LICENSE
No. 65108
STATE OF
FLORIDA
Professional Engineer
Registration No. 65108




Harmon

HI 7000 LARGE MISSILE
90° OUTSIDE CORNER DETAIL

DATE: 06/28/04	6	6/17/16
1 11/18/08	7	03/05/19
2 3/10/09	8	02/25/21
3 3/16/09	9	08/12/25
4 5/22/12		
5 10/03/14		

DWG. NO. HI7000LM

SHEET 17 OF 41

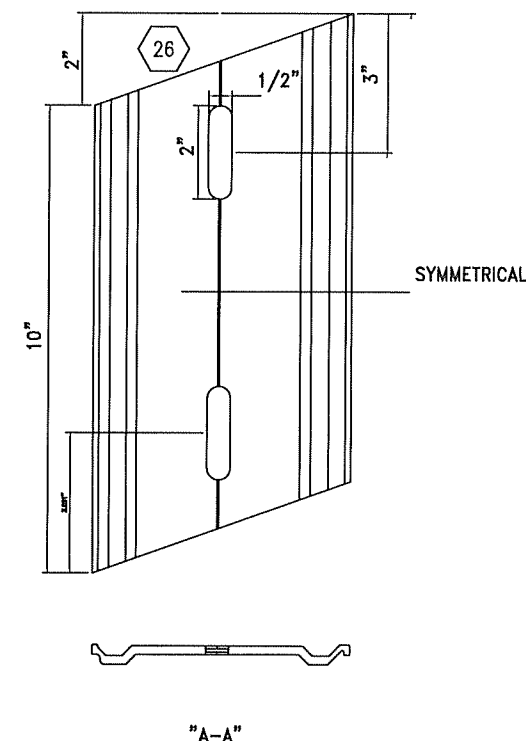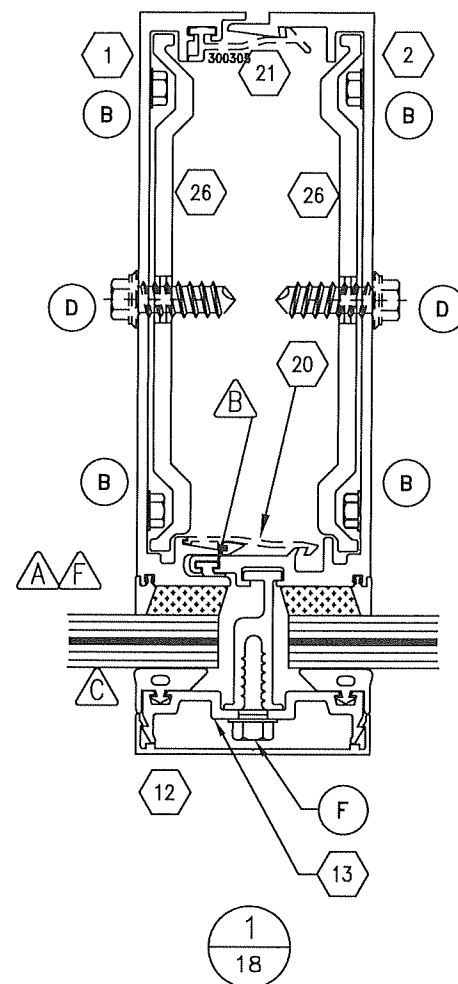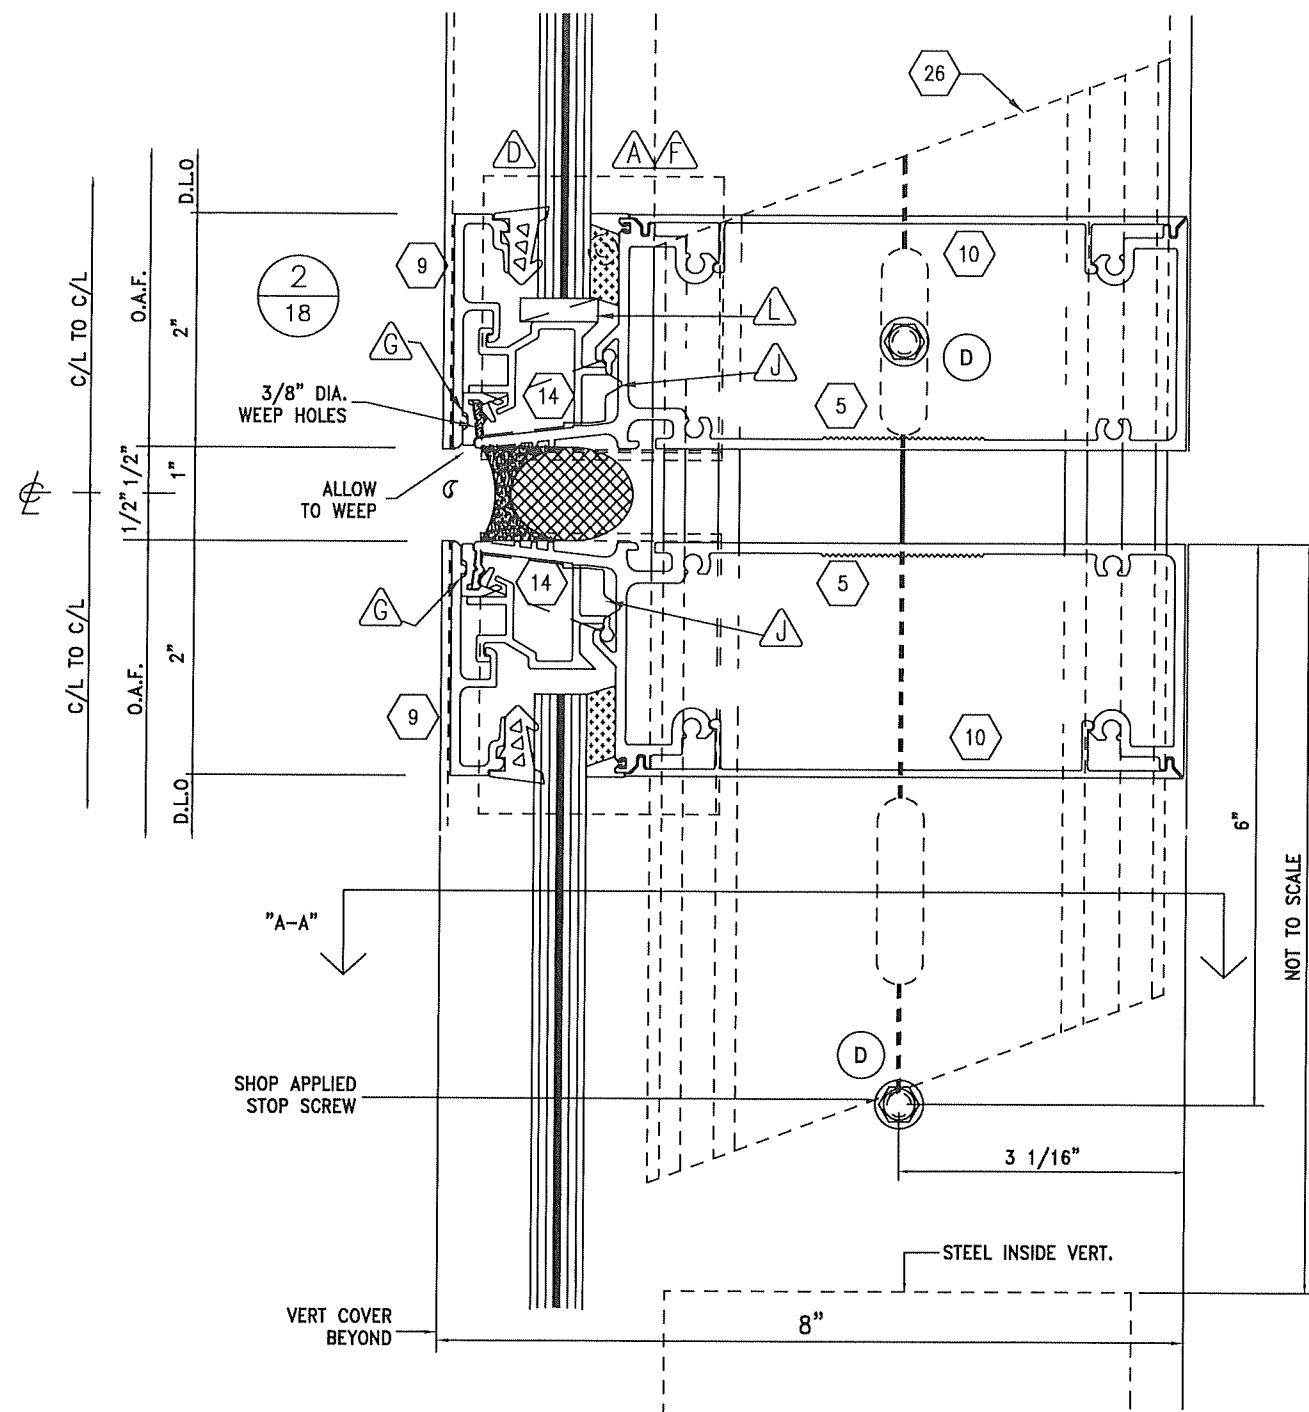

GENERAL NOTES:

- FOR PART IDENTIFICATION REFER TO SHEET 2

- FOR GLAZING DETAILS, GLASS BITE & GASKET CONFIGURATIONS SEE SHEET 3.

- FASTENERS
- GASKETS
- ALUMINUM EXTRUSIONS

Larson Engineering, Inc.
3524 Labore Road
White Bear Lake, MN 55110
(P) 651.481.9120 (F) 651.481.9201

DADE CO. STAMP

PRODUCT REVISED
As complying with the Florida
Building Code
NOA-No. **25-0902.03**
Expiration Date: **09/02/2029**
By: *Manuel Perez*
Miami-Dade Product Control

ENGINEER STAMP

8.19.25
No. 65108
STATE OF
FLORIDA
PROFESSIONAL ENGINEER
Ethan A. Harmon
Registration No. 12500

Harmon


HI 7000 LARGE MISSILE
MULLION SPLICE DETAIL

DATE: 06/28/04	6/17/16
1 11/18/08	3/05/19
2 3/10/09	8 02/25/21
3 3/16/09	9 08/12/25
4 5/22/12	
5 10/03/14	

DWG. NO. HI7000LM

SHEET 18 OF 41

STRAP ANCHOR

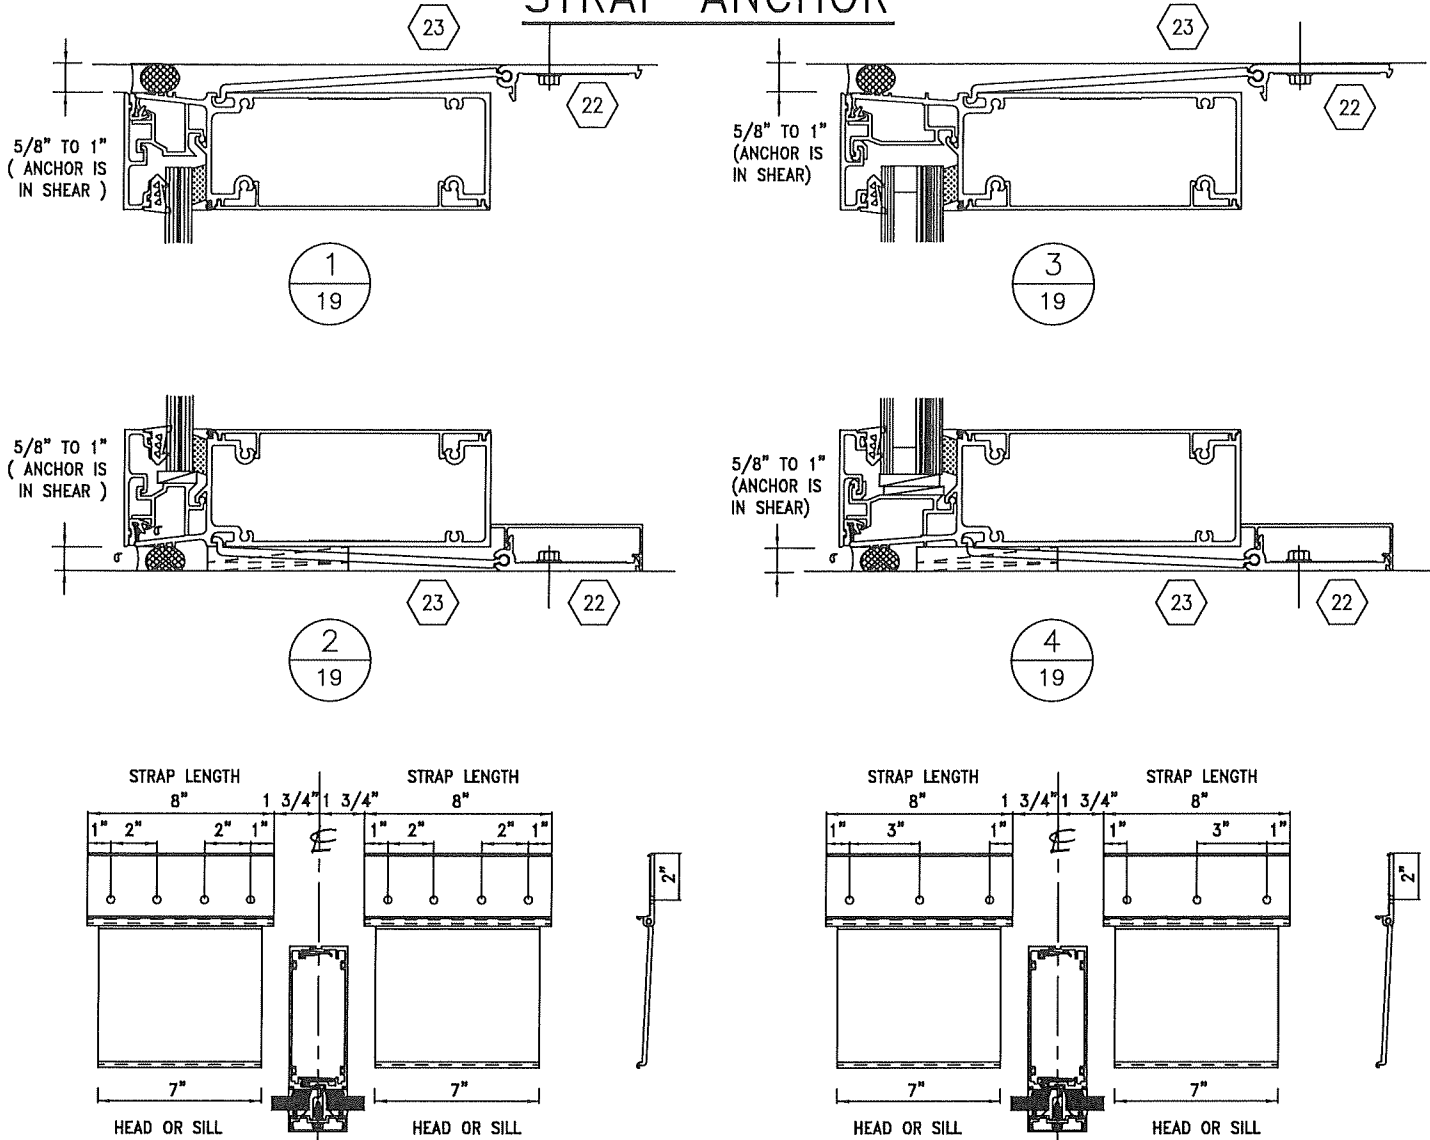

- TESTED CONDITIONS SHOWN ABOVE.
- (2) 8" STRAPS TESTED TO 2715# END REACTION
 - (1) 8" STRAP TESTED TO 1,345# END REACTION
 - ANCHORS MAY BE MADE LONGER TO ACCOMMODATE FASTENERS BASED ON PERIMETER CONDITIONS.
 - A MINIMUM OF TWO (2) FASTENERS SHALL ALWAYS BE USED.


ANCHOR FASTENER REQUIREMENTS					
SUBSTRATE	REACTION	FASTENER TYPE	QTY.	MIN. EMBED.	MIN. EDGE DIST.
WOOD	1,305 #	3/8"x3 1/2" LAG BOLT	3	3"	1 1/2"
CONCRETE	2910 #	3/8" DIA POWERS	2	3"	4 1/2"
STEEL	2,715 #	#14 DRIL-FLEX	3	N/A	1"
METAL STUD	2,230 #	#14 DRIL-FLEX	4	N/A	1"

GENERAL NOTES:

- SIZES OF ANCHOR COMPONENTS LISTED ABOVE ARE A MINIMUM, BASED ON MOCKUP CALCULATIONS COMPLYING WITH CURRENT FBC
- ACTUAL LENGTH AND NUMBER & SIZE OF HOLES TO BE DETERMINED BY PROJECT SPECIFIC PERIMETER CONDITIONS AND TYPES OF FASTENERS USED.
- CONCRETE STRENGTH MUST BE A MINIMUM OF $F_c=4,500$ PSI
- ALL WOOD AND SHEET METAL SCREWS SHALL BE CARBON STEEL GRADE 5

- ALL SELF DRILLING SCREWS SHALL BE ELCO "DRIL-FLEX" WITH STALGUARD COATING.
- ALL CONCRETE ANCHORS TO BE POWERS "WEDGE BOLTS".

THRU-FRAME ANCHOR

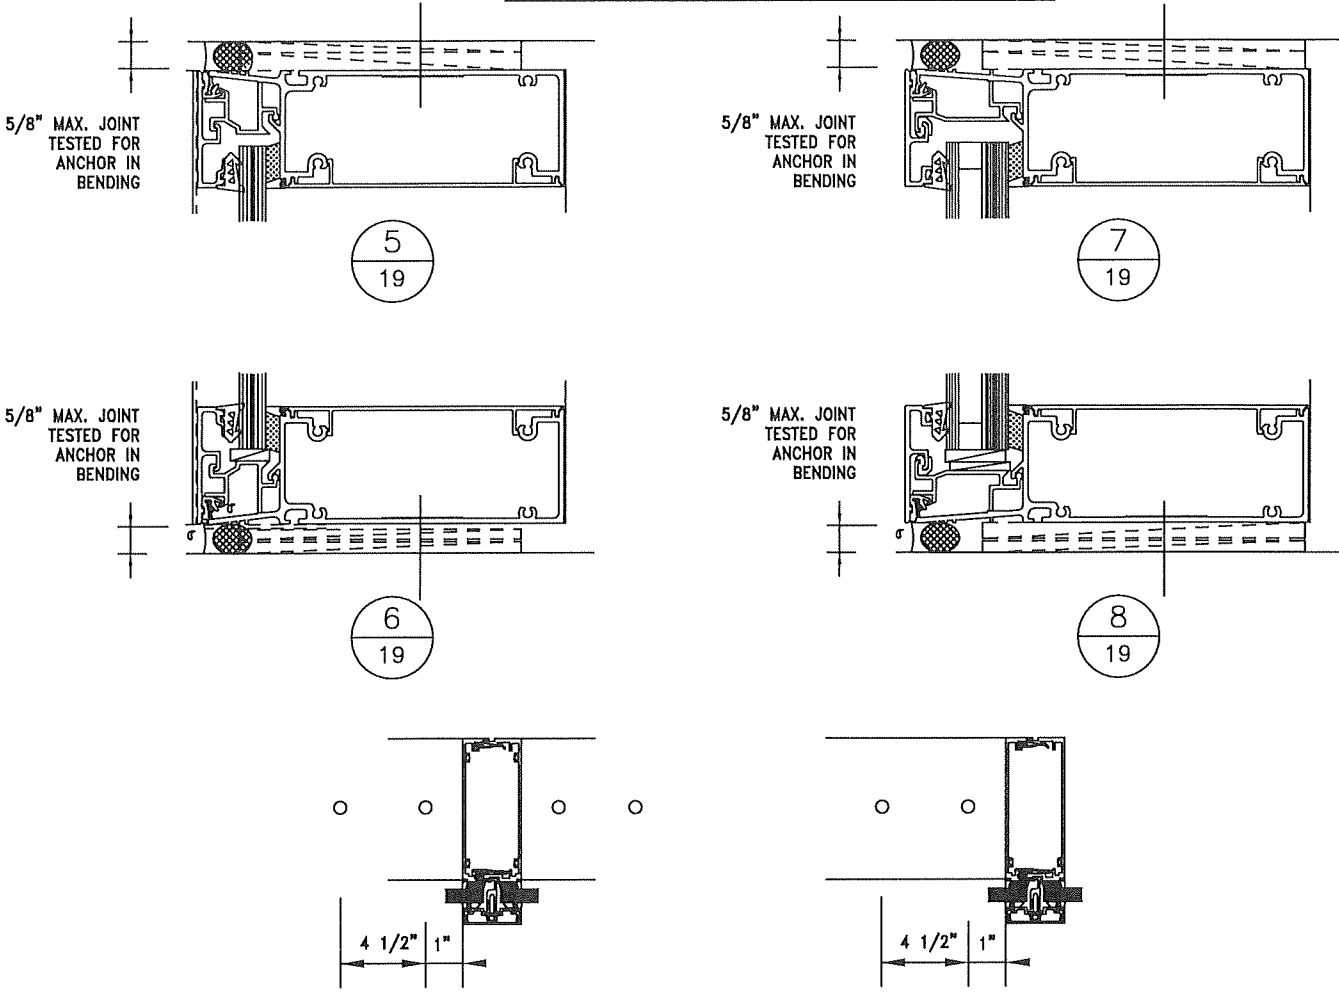

- TESTED CONDITIONS SHOWN ABOVE.
- (4) FASTENERS, (2) EITHER SIDE @ INTERMEDIATE VERTICAL TESTED TO 1,345# END REACTION
 - (1) FASTENER ON SAME SIDE @ JAMBS TESTED TO 1185# END REACTION
 - FASTENER SPACING AND QUANTITY MAY CHANGE BASED ON PERIMETER CONDITIONS.
 - A MINIMUM OF TWO (2) FASTENERS SHALL ALWAYS BE USED (EXCEPT AT JAMBS).

ANCHOR FASTENER REQUIREMENTS					
SUBSTRATE	REACTION	FASTENER TYPE	QTY.	MIN. EMBED.	MIN. EDGE DIST.
WOOD	1,345 #	3/8" DIA LAG BOLT	4	3"	1 1/2"
CONCRETE	1,345 #	3/8" DIA.	4	3"	2 11/16"
STEEL	1,345 #	3/8" DIA	4	N/A	1"
METAL STUD	1,345 #	1/4" DIA DRIL-FLEX	4	N/A	1"

Larson Engineering, Inc.
3524 Labore Road
White Bear Lake, MN 55110
(P) 651.481.9120 (F) 651.481.9201

Harmon
HI 7000 LARGE MISSILE
ANCHOR APPLICATIONS
STRAP & THRU-FRAME

DADE CO. STAMP

ENGINEER STAMP




PRODUCT REVISED
As complying with the Florida Building Code
NOA-No. **25-0902.03**
Expiration Date: **09/02/2029**
By: *Manuel Perez*
Miami-Dade Product Control

ETHAN A. CHARPENTIER
LICENSE
No. 05106
STATE OF
FLORIDA
Professional Engineer
Registration No. 05106

DATE	REVISION
06/28/04	1
11/18/08	2
3/10/09	3
3/16/09	4
5/22/12	5
10/03/14	6
03/05/19	7
02/25/21	8
08/12/25	9

DWG. NO. HI7000LM
SHEET 19 OF 41

STEEL ANGLES IN VERTICALS

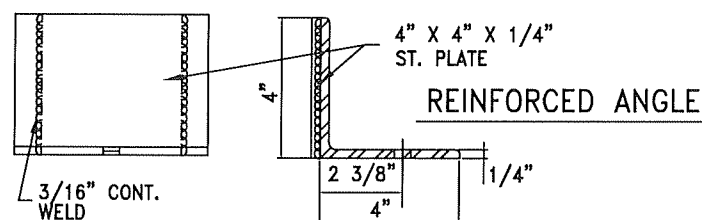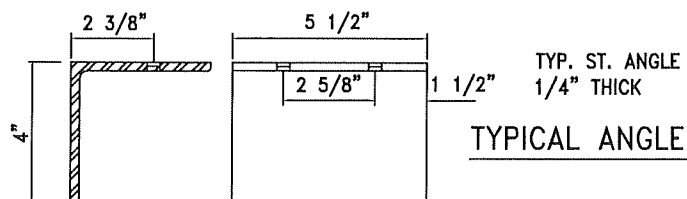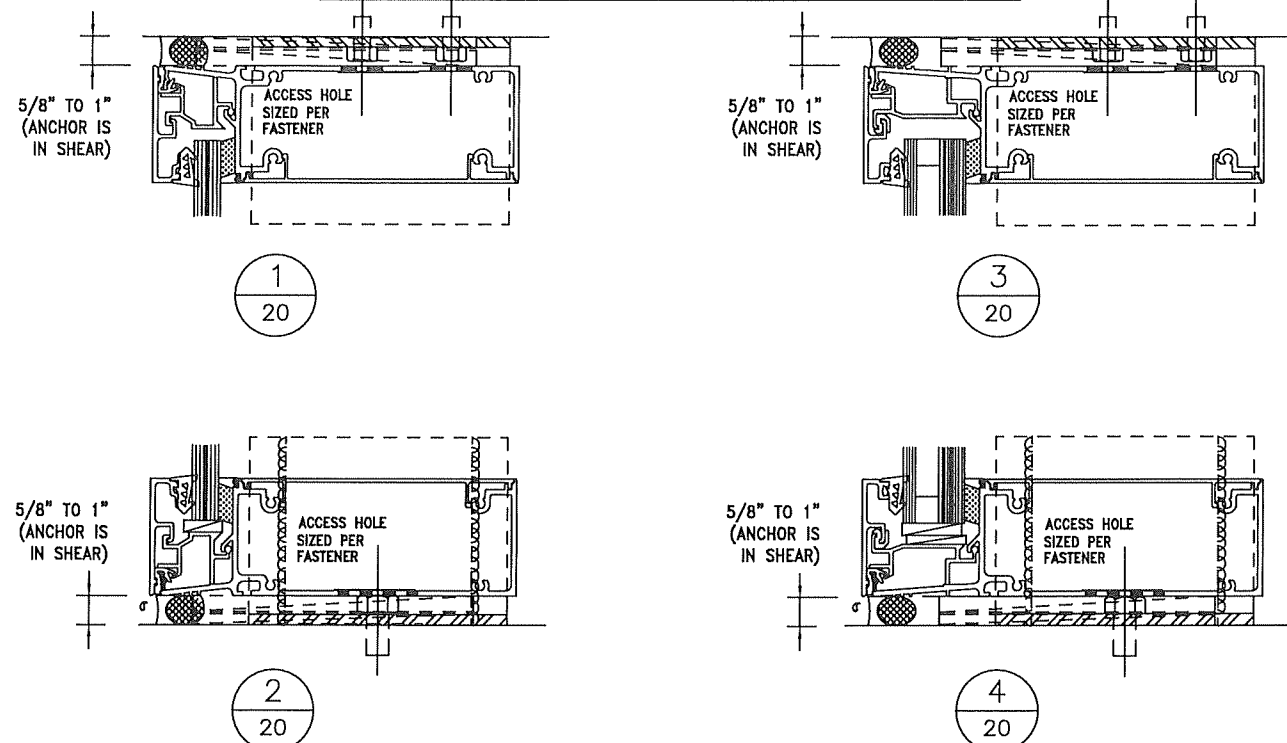

TESTED CONDITIONS SHOWN ABOVE

- TYPICAL ANCHOR USED w/ (2) FASTENERS
- REINFORCED ANGLE USED w/ (1) FASTENER. REINFORCING PLATE ADDED TO PREVENT TWIST IMPOSED BY ONLY (1) FASTENER
- ANCHORS OCCUR ON EACH SIDE OF VERTICAL, (1) @ JAMB

ANCHOR FASTENER REQUIREMENTS FOR TYP. ANGLE

SUBSTRATE	REACTION	FASTENER TYPE	QTY.	MIN. EMBED.	MIN. EDGE DIST.
WOOD	1,175 #	3/8" DIA LAG	4	3"	1 1/2"
CONCRETE	N/A	N/A	N/A	N/A	N/A
STEEL	4,520 #	3/8" DIA	4	N/A	1"
METAL STUD	860 #	#14 DRIL-FLEX	4	N/A	1"

ANCHOR FASTENER REQUIREMENTS FOR REIN. ANGLE

SUBSTRATE	REACTION	FASTENER TYPE	QTY.	MIN. EMBED.	MIN. EDGE DIST.
WOOD	575 #	3/8" DIA LAG	2	3"	1 1/2"
CONCRETE	4,520 #	5/8" DIA	2	4"	4 13/16"
STEEL	3,470 #	3/8" DIA	2	N/A	1"
METAL STUD	595 #	#14 DRIL-FLEX	2	N/A	1"


- 6 ** STEEL ANGLE AND BACKER PLATE MUST BE 50 KSI MINIMUM
 • REINFORCED ANGLE INTO CONCRETE **

GENERAL NOTES:

- SIZES OF ANCHOR COMPONENTS LISTED ABOVE ARE A MINIMUM, BASED ON MOCKUP CALCULATIONS COMPLYING WITH CURRENT FBC
- ACTUAL LENGTH AND NUMBER & SIZE OF HOLES TO BE DETERMINED BY PROJECT SPECIFIC PERIMETER CONDITIONS AND TYPES OF FASTENERS USED.
- CONCRETE STRENGTH MUST BE A MINIMUM OF $F_c=4,500$ PSI
- ALL WOOD AND SHEET METAL SCREWS SHALL BE CARBON STEEL GRADE 5

- ALL SELF DRILLING SCREWS SHALL BE ELCO "DRIL-FLEX" WITH STALGUARD COATING.
- ALL CONCRETE ANCHORS TO BE POWERS "WEDGE BOLTS".

ALUMINUM LUG IN VERTICALS

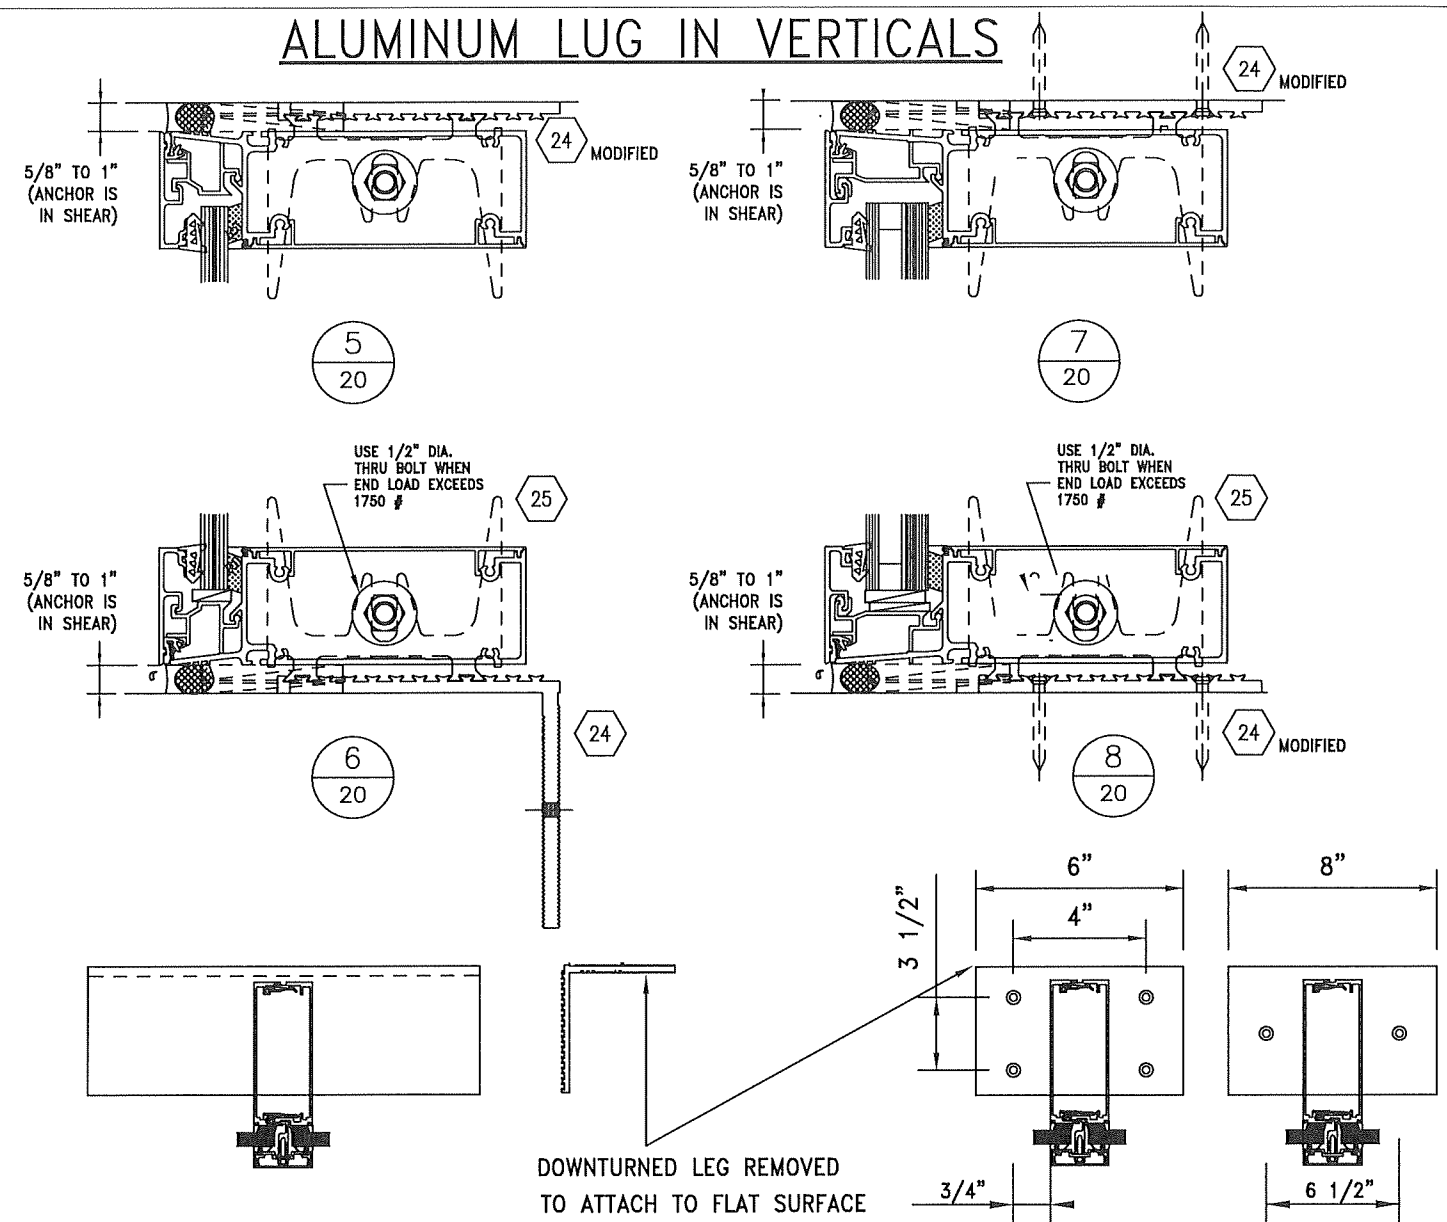

TESTED CONDITIONS SHOWN ABOVE

- LUG ANCHOR NOT TESTED AT A HEAD CONDITION
- WHEN TYPICAL ANCHOR IS USED QUANTITY AND SPACING OF FASTENERS IN DOWN-TURNED LEG TO BE DETERMINED BY PERIMETER CONDITIONS.
- MODIFIED ANCHOR USE w/ (4) FASTENERS IN TOP LEG AS SHOWN

ANCHOR FASTENER REQUIREMENTS

SUBSTRATE	REACTION	FASTENER TYPE	QTY.	MIN. EMBED.	MIN. EDGE DIST.
WOOD	1,110 #	3/8" DIA LAG	4	3"	1 1/2"
CONCRETE	2,715 #	1/2" DIA	2	4 1/8"	3 1/8"
STEEL	2,715 #	#14 DRIL-FLEX	4	N/A	1"
METAL STUD	1,340 #	#14 DRIL-FLEX	4	N/A	1"

Larson Engineering, Inc.

3524 Labore Road
 White Bear Lake, MN 55110
 (P) 651.481.9120 (F) 651.481.9201

DADE CO. STAMP

PRODUCT REVISED
 As complying with the Florida Building Code
 NOA-No. **25-0902.03**
 Expiration Date: **09/02/2029**
 By: *Manuel Perez*
 Miami-Dade Product Control

ENGINEER STAMP

ETHANA CHARPENTER
 LICENSE
 No. 65108
 STATE OF
 FLORIDA
 Professional Engineer
 Registration No. 65108

Harmon

HI 7000 LARGE MISSILE

ANCHOR APPLICATIONS


STEEL ANGLES & ALUMINUM LUGS

DATE: 06/28/04	6/17/16
1 11/18/08	7 03/05/19
2 3/10/09	8 02/25/21
3 3/16/09	9 08/12/25
4 5/22/12	
5 10/03/14	

DWG. NO. HI7000LM

SHEET 20 OF 41

TWIN SPAN MIDPOINT ANCHOR

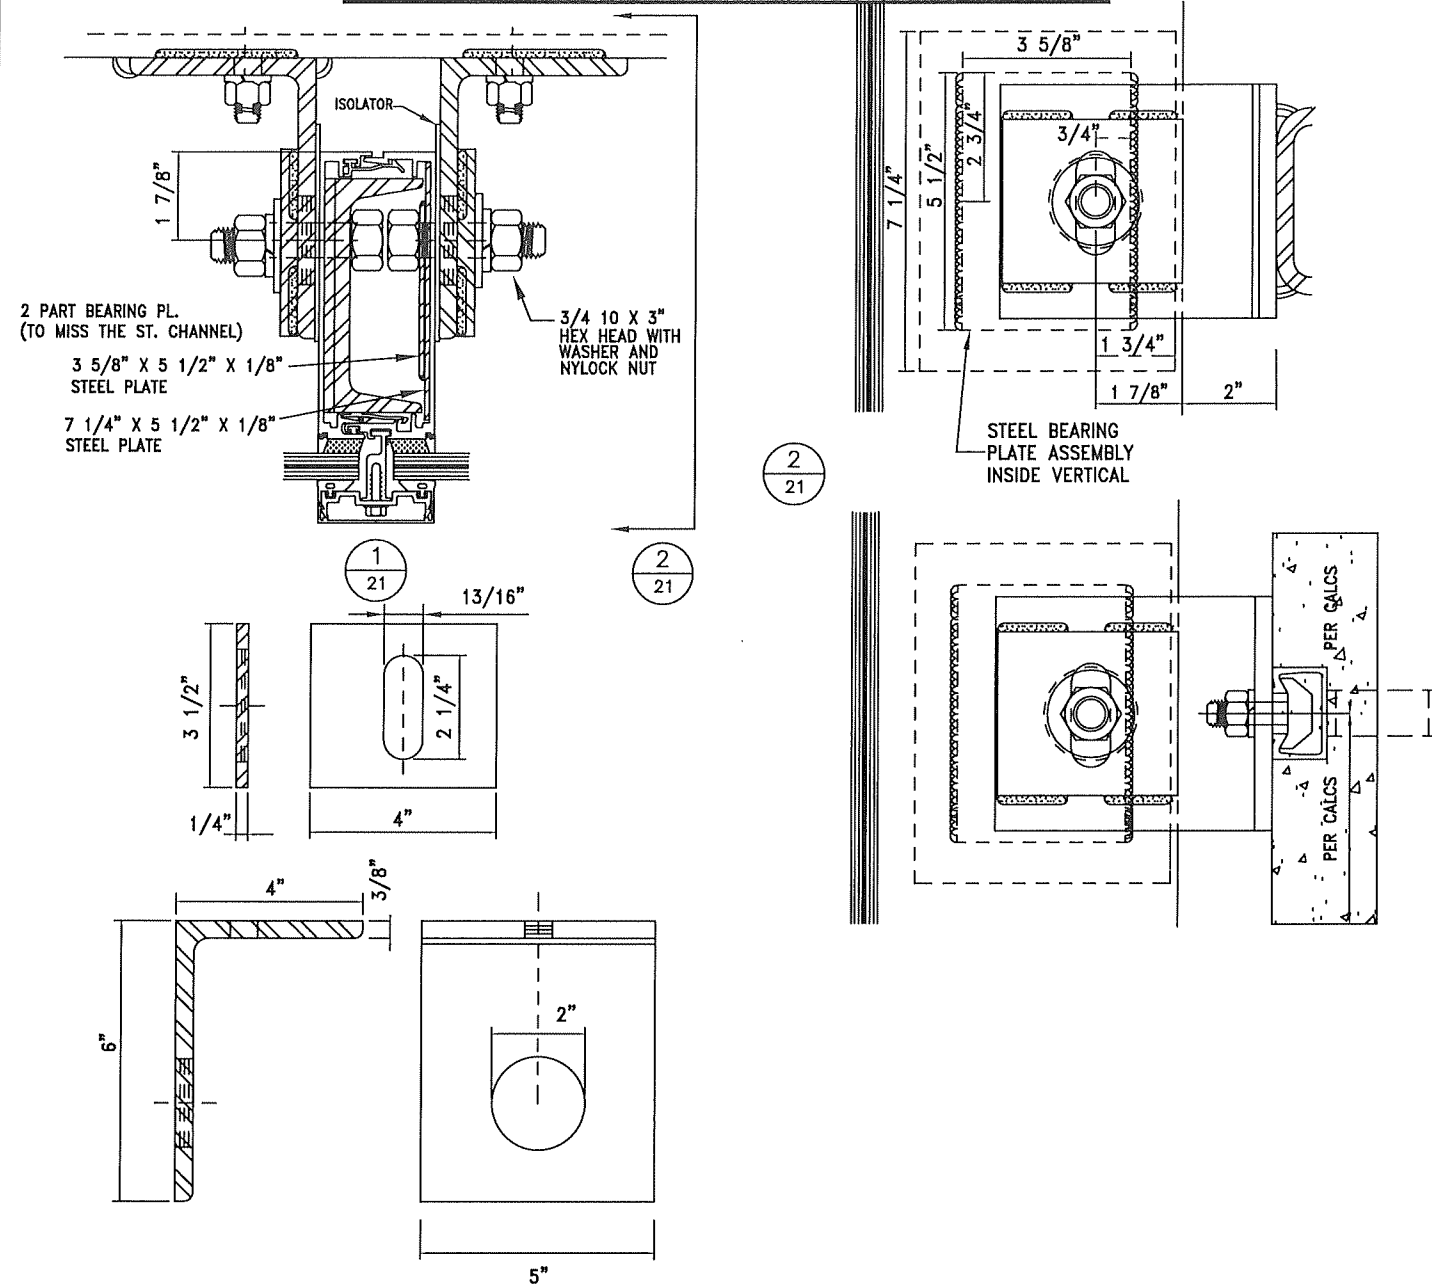

TESTED CONDITION SHOWN ABOVE.


- ANCHOR ACCOMODATED 8,890 # WL REACTION
- ANCHORS MAY BE MADE LONGER TO ACCOMMODATE MORE FASTENERS BASED ON PERIMETER CONDITIONS.
- WELD SIZES TO BE DETERMINED ON A PER JOB BASIS.

GENERAL NOTES:

- SIZES OF ANCHOR COMPONENTS LISTED ABOVE ARE A MINIMUM, BASED ON MOCKUP CALCULATIONS COMPLYING WITH CURRENT FBC
- ACTUAL LENGTH AND NUMBER & SIZE OF HOLES TO BE DETERMINED BY PROJECT SPECIFIC PERIMETER CONDITIONS AND TYPES OF FASTENERS USED.
- CONCRETE STRENGTH MUST BE A MINIMUM OF $F_c=4,500$ PSI
- ALL WOOD AND SHEET METAL SCREWS SHALL BE CARBON STEEL GRADE 5

- ALL SELF DRILLING SCREWS SHALL BE ELCO "DRIL-FLEX" WITH STALGUARD COATING.
- ALL CONCRETE ANCHORS TO BE POWERS "WEDGE BOLTS".

TWIN SPAN W/STACK ANCHOR

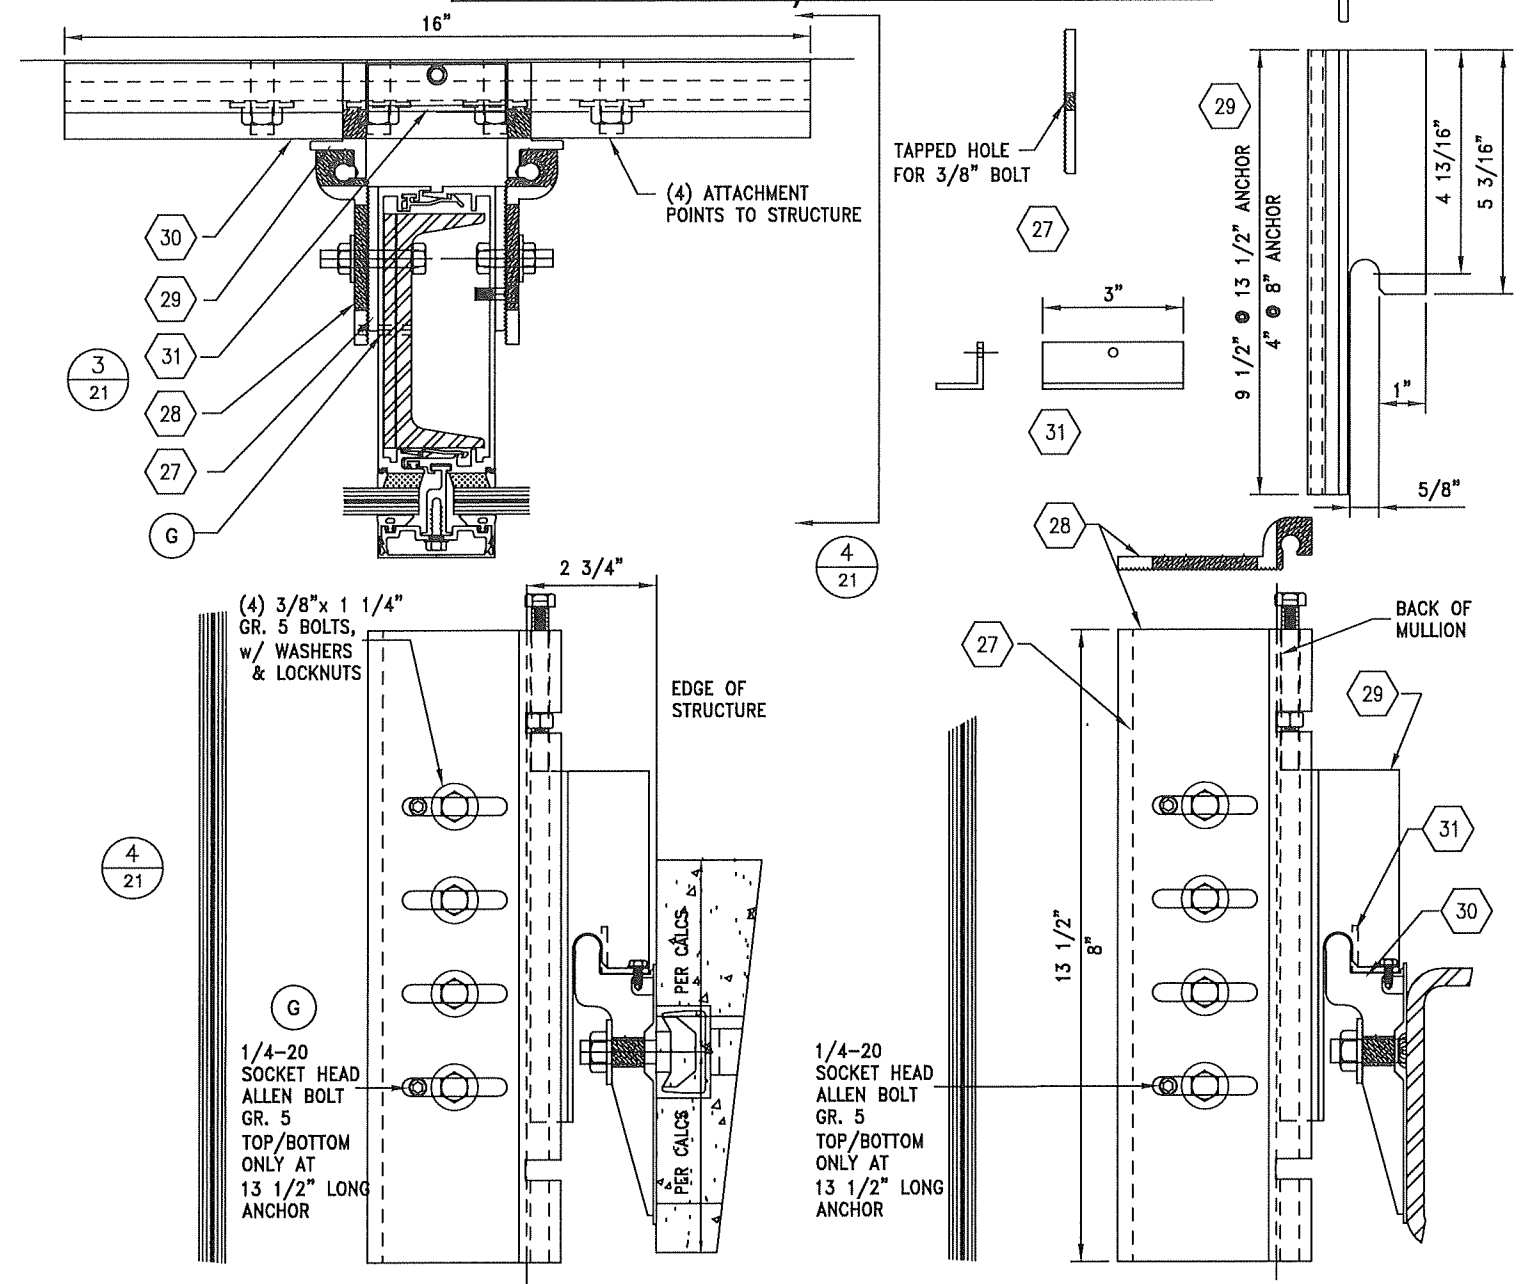

TESTED CONDITION SHOWN ABOVE.

- ANCHOR ACCOMODATED 10,500# WL REACTION, 1,000# DL REACTION FOR 13 1/2" LONG ANCHOR
- ANCHORS MAY BE MADE LONGER TO ACCOMMODATE MORE FASTENERS BASED ON PERIMETER CONDITIONS.
- 8" ANCHOR ACCOMODATED 10,500# WL REACTION, WHEN USED AS WINDLOAD ONLY
- 8" ANCHOR ACCOMODATED 4,400# WL WITH 1,000# DEADLOAD APPLIED

Larson Engineering, Inc.

3524 Labore Road
White Bear Lake, MN 55110
(P) 651.481.9120 (F) 651.481.9201

DADE CO. STAMP

PRODUCT REVISED
As complying with the Florida Building Code
NOA-No. **25-0902.03**
Expiration Date: **09/02/2029**
By: *Manuel Perez*
Miami-Dade Product Control

ENGINEER STAMP

8.19.25
No. 65108
STATE OF FLORIDA
Professional Engineer
Ethan A. Harmon
Registration No. 19880

Harmon

HI 7000 LARGE MISSILE

ANCHOR APPLICATIONS


EDGE OF SLAB

DATE: 06/28/04	6	6/17/16	
1	11/18/08	7	03/05/19
2	3/10/09	8	02/25/21
3	3/16/09	9	08/12/25
4	5/22/12		
5	10/03/14		

DWG. NO. HI7000LM



SHEET 21 OF 41

JAMB ANCHOR

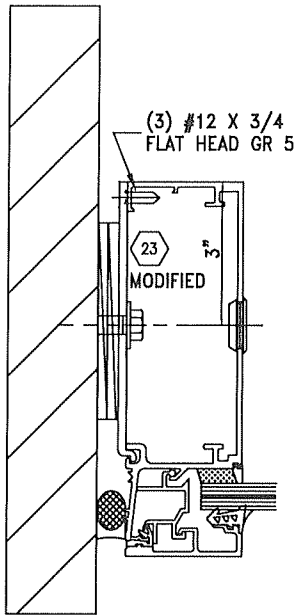

1
22


MODIFIED STRAP
END REMOVED TO FLUSH
OUT w/ BACK OF JAMB

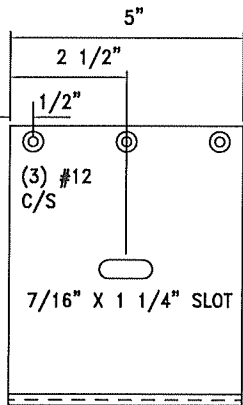

TESTED CONDITIONS SHOWN ABOVE.
- (1) 5" MODIFIED STRAP TESTED TO 1870# END REACTION
- ANCHORS MAY BE MADE LONGER TO ACCOMMODATE
MORE FASTENERS BASED ON JOB SPECIFIC PERIMETER
CONDITIONS.

GENERAL NOTES:
- SIZES OF ANCHOR COMPONENTS LISTED ABOVE ARE A MINIMUM,
BASED ON MOCKUP CALCULATIONS COMPLYING WITH CURRENT FBC
- ACTUAL LENGTH AND NUMBER & SIZE OF HOLES TO BE
DETERMINED BY PROJECT SPECIFIC PERIMETER
CONDITIONS AND TYPES OF FASTENERS USED.
- CONCRETE STRENGTH MUST BE A MINIMUM OF $F_c=4,500$ PSI
- ALL WOOD AND SHEET METAL SCREWS SHALL BE CARBON STEEL
GRADE 5

EXPLODED VIEW OF TYP. CURTAIN WALL ANCHOR

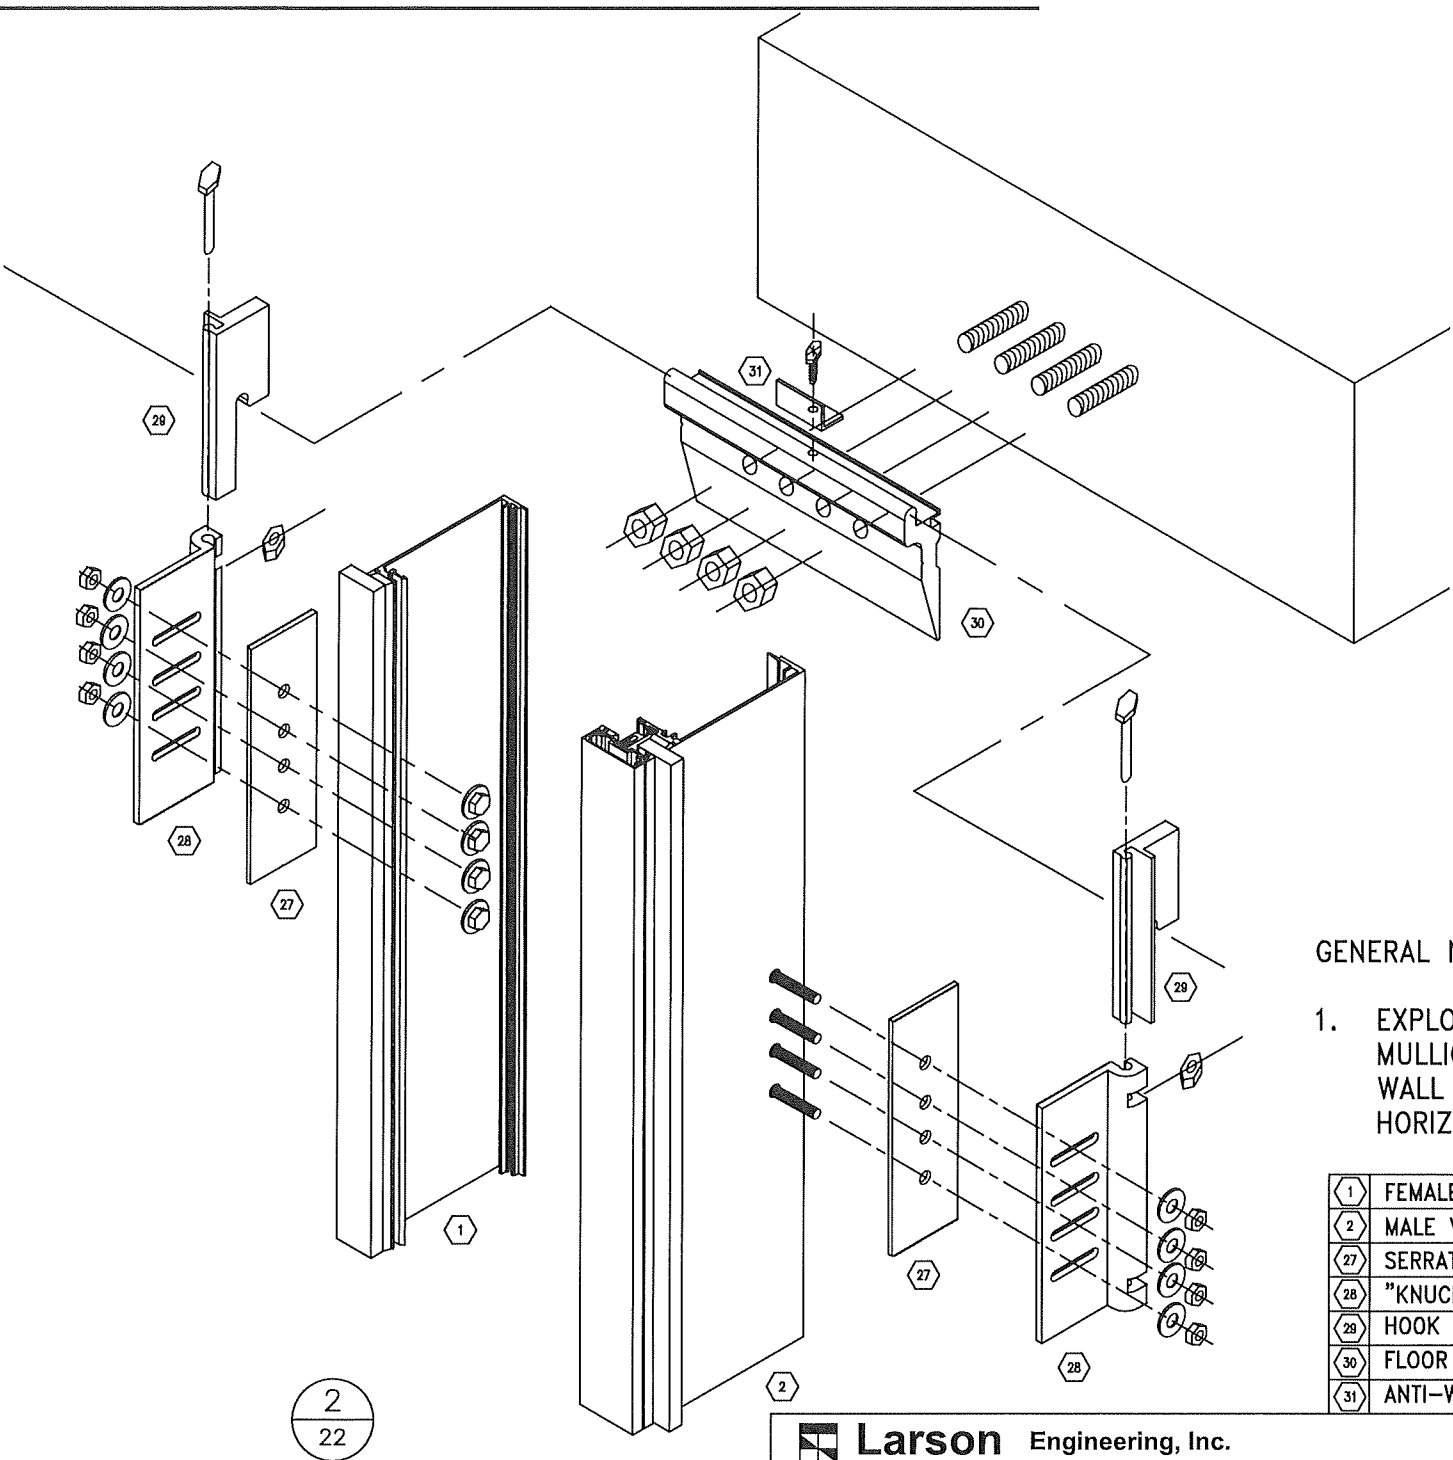

2
22

GENERAL NOTES:
1. EXPLODED VIEW OF TYPICAL
MULLION ANCHOR FOR CURTAIN
WALL APPLICATION WITH STACK
HORIZONTAL

1	FEMALE VERTICAL MULLION	306001
2	MALE VERTICAL MULLION	306002
27	SERRATED PLATE	930110
28	"KNUCKLE" ANCHOR	930109
29	HOOK ANCHOR	930108
30	FLOOR EDGE PLATE	930111
31	ANTI-WALK ANGLE	.

Larson Engineering, Inc.
3524 Labore Road
White Bear Lake, MN 55110
(P) 651.481.9120 (F) 651.481.9201

DADE CO. STAMP

PRODUCT REVISED
As complying with the Florida
Building Code
NOA-No. **25-0902.03**
Expiration Date: **09/02/2029**
By: *Manuel Perez*
Miami-Dade Product Control

ENGINEER STAMP


ETHAN A. CHARPENTIER
LICENSED PROFESSIONAL ENGINEER
No. 65106
STATE OF FLORIDA
Firm No. F-02000005476
Professional Seal No. 19903
Registration No. 65106

Harmon
HI 7000 LARGE MISSILE
ANCHOR APPLICATIONS

EXPLODED VIEW	DATE: 06/28/04	6 6/17/16
1	11/18/08	7 03/05/19
2	3/10/09	8 02/25/21
3	3/16/09	9 08/12/25
4	5/22/12	
5	10/03/14	
DWG. NO.	HI7000LM	
SHEET	22	OF 41

JAMB MULLIONS SINGLE SPAN

REINFORCING
OPTIONS



		Case 8	Case 9	Case 10	Case 11
	"B"	"L"/"R"	"L"/"R"	"L"/"R"	"L"/"R"
UP TO MAXIMUM 60 PSF POS. OR NEG. LOAD	3'-0"	13'-7"	16'-5"	18'-3"	20'-1"
		656	793	879	967
	4'-0"	11'-10"	15'-4"	17'-0"	18'-9"
		751	972	1077	1185
UP TO MAXIMUM 70 PSF POS. OR NEG. LOAD	5'-0"	10'-8"	14'-3"	16'-2"	17'-9"
		836	1118	1264	1391
	6'-0"	9'-9"	13'-1"	15'-5"	17'-0"
		912	1220	1442	1587
UP TO MAXIMUM 80 PSF POS. OR NEG. LOAD	3'-0"	12'-7"	15'-10"	17'-6"	19'-3"
		708	890	987	1086
	4'-0"	11'-0"	14'-8"	16'-4"	18'-0"
		811	1085	1209	1331
UP TO MAXIMUM 90 PSF POS. OR NEG. LOAD	5'-0"	9'-10"	13'-2"	15'-6"	17'-1"
		902	1207	1419	1561
	6'-0"	9'-0"	12'-1"	14'-10"	16'-4"
		985	1318	1618	1781
UP TO MAXIMUM 100 PSF POS. OR NEG. LOAD	3'-0"	11'-9"	15'-3"	16'-11"	18'-8"
		757	984	1091	1200
	4'-0"	10'-3"	13'-9"	15'-10"	17'-5"
		867	1160	1337	1471
UP TO MAXIMUM 110 PSF POS. OR NEG. LOAD	5'-0"	9'-3"	12'-4"	15'-0"	16'-6"
		965	1291	1568	1726
	6'-0"	8'-5"	11'-4"	13'-11"	15'-10"
		1053	1409	1732	1969
UP TO MAXIMUM 120 PSF POS. OR NEG. LOAD	3'-0"	11'-1"	14'-10"	16'-5"	18'-1"
		803	1074	1191	1311
	4'-0"	9'-8"	12'-11"	15'-4"	16'-11"
		920	1230	1460	1607
UP TO MAXIMUM 130 PSF POS. OR NEG. LOAD	5'-0"	8'-8"	11'-8"	14'-4"	16'-0"
		1023	1369	1683	1885
	6'-0"	7'-11"	10'-8"	13'-1"	15'-4"
		1117	1494	1837	2150
UP TO MAXIMUM 140 PSF POS. OR NEG. LOAD	3'-0"	10'-6"	14'-1"	16'-0"	17'-8"
		847	1133	1289	1419
	4'-0"	9'-2"	12'-3"	15'-0"	16'-6"
		970	1297	1580	1739
UP TO MAXIMUM 150 PSF POS. OR NEG. LOAD	5'-0"	8'-3"	11'-0"	13'-7"	15'-7"
		1079	1443	1774	2040
	6'-0"	7'-6"	10'-1"	12'-5"	14'-11"
		1177	1575	1936	2327
UP TO MAXIMUM 160 PSF POS. OR NEG. LOAD	3'-0"	10'-0"	13'-5"	15'-8"	17'-3"
		888	1188	1385	1524
	4'-0"	8'-9"	11'-8"	14'-5"	16'-1"
		1017	1360	1672	1868
UP TO MAXIMUM 170 PSF POS. OR NEG. LOAD	5'-0"	7'-10"	10'-6"	12'-11"	15'-3"
		1131	1513	1860	2191
	6'-0"	7'-2"	9'-8"	11'-10"	13'-9"
		1235	1652	2031	2355
UP TO MAXIMUM 180 PSF POS. OR NEG. LOAD	3'-0"	9'-7"	12'-10"	15'-4"	16'-10"
		927	1241	1478	1626
	4'-0"	8'-4"	11'-2"	13'-9"	15'-9"
		1062	1421	1746	1993
UP TO MAXIMUM 190 PSF POS. OR NEG. LOAD	5'-0"	7'-6"	10'-1"	12'-5"	14'-11"
		1181	1581	1943	2339
	6'-0"	6'-11"	9'-3"	11'-4"	12'-7"
		1290	1726	2121	2355
UP TO MAXIMUM 200 PSF POS. OR NEG. LOAD	3'-0"	9'-3"	12'-4"	15'-0"	16'-6"
		965	1291	1569	1727
	4'-0"	8'-0"	10'-9"	13'-3"	15'-5"
		1105	1479	1818	2117
UP TO MAXIMUM 210 PSF POS. OR NEG. LOAD	5'-0"	7'-3"	9'-8"	11'-11"	13'-10"
		1230	1645	2022	2355
	6'-0"	6'-7"	8'-10"	10'-11"	11'-8"
		1342	1796	2208	2355


JAMB MULLIONS TWIN SPAN

REINFORCING
OPTIONS




		Case 8	Case 9	Case 10	Case 11
	"B"	"L"/"R"	"L"/"R"	"L"/"R"	"L"/"R"
UP TO MAXIMUM 60 PSF POS. OR NEG. LOAD	3'-0"	14'-7"	14'-7"	14'-7"	14'-7"
		538	538	538	538
	4'-0"	13'-7"	14'-7"	14'-7"	14'-7"
		658	706	706	706
UP TO MAXIMUM 70 PSF POS. OR NEG. LOAD	5'-0"	12'-3"	14'-7"	14'-7"	14'-7"
		732	874	874	874
	6'-0"	11'-2"	14'-7"	14'-7"	14'-7"
		799	1041	1041	1041
UP TO MAXIMUM 80 PSF POS. OR NEG. LOAD	3'-0"	14'-5"	14'-7"	14'-7"	14'-7"
		620	628	628	628
	4'-0"	12'-7"	14'-7"	14'-7"	14'-7"
		710	824	824	824
UP TO MAXIMUM 90 PSF POS. OR NEG. LOAD	5'-0"	11'-4"	14'-7"	14'-7"	14'-7"
		790	1019	1019	1019
	6'-0"	10'-4"	13'-11"	14'-7"	14'-7"
		863	1154	1215	1215
UP TO MAXIMUM 100 PSF POS. OR NEG. LOAD	3'-0"	13'-6"	14'-7"	14'-7"	14'-7"
		663	718	718	718
	4'-0"	11'-9"	14'-7"	14'-7"	14'-7"
		759	941	941	941
UP TO MAXIMUM 110 PSF POS. OR NEG. LOAD	5'-0"	10'-7"	14'-2"	14'-7"	14'-7"
		845	1130	1165	1165
	6'-0"	9'-8"	13'-0"	14'-7"	14'-7"
		922	1234	1388	1388
UP TO MAXIMUM 120 PSF POS. OR NEG. LOAD	3'-0"	12'-9"	14'-7"	14'-7"	14'-7"
		703	807	807	807
	4'-0"	11'-1"	14'-7"	14'-7"	14'-7"
		805	1059	1059	1059
UP TO MAXIMUM 130 PSF POS. OR NEG. LOAD	5'-0"	10'-0"	13'-4"	14'-7"	14'-7"
		896	1198	1310	1310
	6'-0"	9'-2"	12'-3"	14'-7"	14'-7"
		978	1308	1562	1562
UP TO MAXIMUM 140 PSF POS. OR NEG. LOAD	3'-0"	12'-9"	14'-7"	14'-7"	14'-7"
		703	807	807	807
	4'-0"	11'-1"	14'-7"	14'-7"	14'-7"
		805	1059	1059	1059
UP TO MAXIMUM 150 PSF POS. OR NEG. LOAD	5'-0"	10'-0"	13'-4"	14'-7"	14'-7"
		896	1198	1310	1310
	6'-0"	9'-2"	12'-3"	14'-7"	14'-7"
		978	1308	1562	1562
UP TO MAXIMUM 160 PSF POS. OR NEG. LOAD	3'-0"	12'-9"	14'-7"	14'-7"	14'-7"
		703	807	807	807
	4'-0"	11'-1"	14'-7"	14'-7"	14'-7"
		805	1059	1059	1059
UP TO MAXIMUM 170 PSF POS. OR NEG. LOAD	5'-0"	10'-0"	13'-4"	14'-7"	14'-7"
		896	1198	1310	1310
	6'-0"	9'-2"	12'-3"	14'-7"	14'-7"
		978	1308	1562	1562
UP TO MAXIMUM 180 PSF POS. OR NEG. LOAD	3'-0"	12'-9"	14'-7"	14'-7"	14'-7"
		703	807	807	807
	4'-0"	11'-1"	14'-7"	14'-7"	14'-7"
		805	1059	1059	1059
UP TO MAXIMUM 190 PSF POS. OR NEG. LOAD	5'-0"	10'-0"	13'-4"	14'-7"	14'-7"
		896	1198	1310	1310
	6'-0"	9'-2"	12'-3"	14'-7"	14'-7"
		978	1308	1562	1562
UP TO MAXIMUM 200 PSF POS. OR NEG. LOAD	3'-0"	12'-9"	14'-7"	14'-7"	14'-7"
		703	807	807	807
	4'-0"	11'-1"	14'-7"	14'-7"	14'-7"
		805	1059	1059	1059
UP TO MAXIMUM 210 PSF POS. OR NEG. LOAD	5'-0"	10'-0"	13'-4"	14'-7"	14'-7"
		896	1198	1310	1310
	6'-0"	9'-2"	12'-3"	14'-7"	14'-7"
		978	1308	1562	1562

REINFORCING
OPTIONS



		Case 8	Case 9	Case 10	Case 11
	"B"	"L"/"R"	"L"/"R"	"L"/"R"	"L"/"R"
UP TO MAXIMUM 100 PSF POS. OR NEG. LOAD	3' 0"	12'-1"	14'-7"	14'-7"	14'-7"
	RE	741	897	897	897
	RM	2363	2860	2860	2860
	4' 0"	10'-6"	14'-1"	14'-7"	14'-7"
	RE	849	1136	1176	1176
	RM	2706	3620	3751	3751
	5' 0"	9'-6"	12'-8"	14'-7"	14'-7"
	RE	944	1263	1456	1456
	RM	3010	4028	4642	4642
	6' 0"	8'-8"	11'-7"	14'-3"	14'-7"
RE	1031	1379	1695	1735	
RM	3287	4397	5405	5533	
UP TO MAXIMUM 110 PSF POS. OR NEG. LOAD	3' 0"	11'-6"	14'-7"	14'-7"	14'-7"
	RE	777	987	987	987
	RM	2478	3146	3146	3146
	4' 0"	10'-0"	13'-5"	14'-7"	14'-7"
	RE	890	1191	1294	1294
	RM	2838	3797	4126	4126
	5' 0"	9'-0"	12'-1"	14'-7"	14'-7"
	RE	990	1325	1601	1601
	RM	3157	4224	5106	5106
	6' 0"	8'-3"	11'-1"	13'-7"	
RE	1081	1446	1778		
RM	3447	4612	5669		
UP TO MAXIMUM 110 PSF POS. OR 120 PSF NEG. LOAD	3' 0"	11'-0"	14'-7"	14'-7"	14'-7"
	RE	812	1076	1076	1076
	RM	2588	3432	3432	3432
	4' 0"	9'-7"	12'-10"	14'-7"	14'-7"
	RE	930	1244	1412	1412
	RM	2964	3966	4501	4501
	5' 0"	8'-8"	11'-7"	14'-3"	14'-7"
	RE	1034	1384	1701	1747
	RM	3298	4412	5423	5570
	6' 0"	7'-11"	10'-7"	13'-0"	
RE	1129	1511	1857		
RM	3600	4817	5921		
UP TO MAXIMUM 110 PSF POS. OR 130 PSF NEG. LOAD	3' 0"	10'-7"	14'-2"	14'-7"	14'-7"
	RE	845	1130	1166	1166
	RM	2694	3604	3718	3718
	4' 0"	9'-3"	12'-4"	14'-7"	14'-7"
	RE	968	1295	1529	1529
	RM	3085	4128	4876	4876
	5' 0"	8'-4"	11'-1"	13'-8"	
	RE	1077	1440	1770	
	RM	3432	4592	5645	
	6' 0"	7'-7"	10'-2"		
RE	1175	1572			
RM	3747	5014			

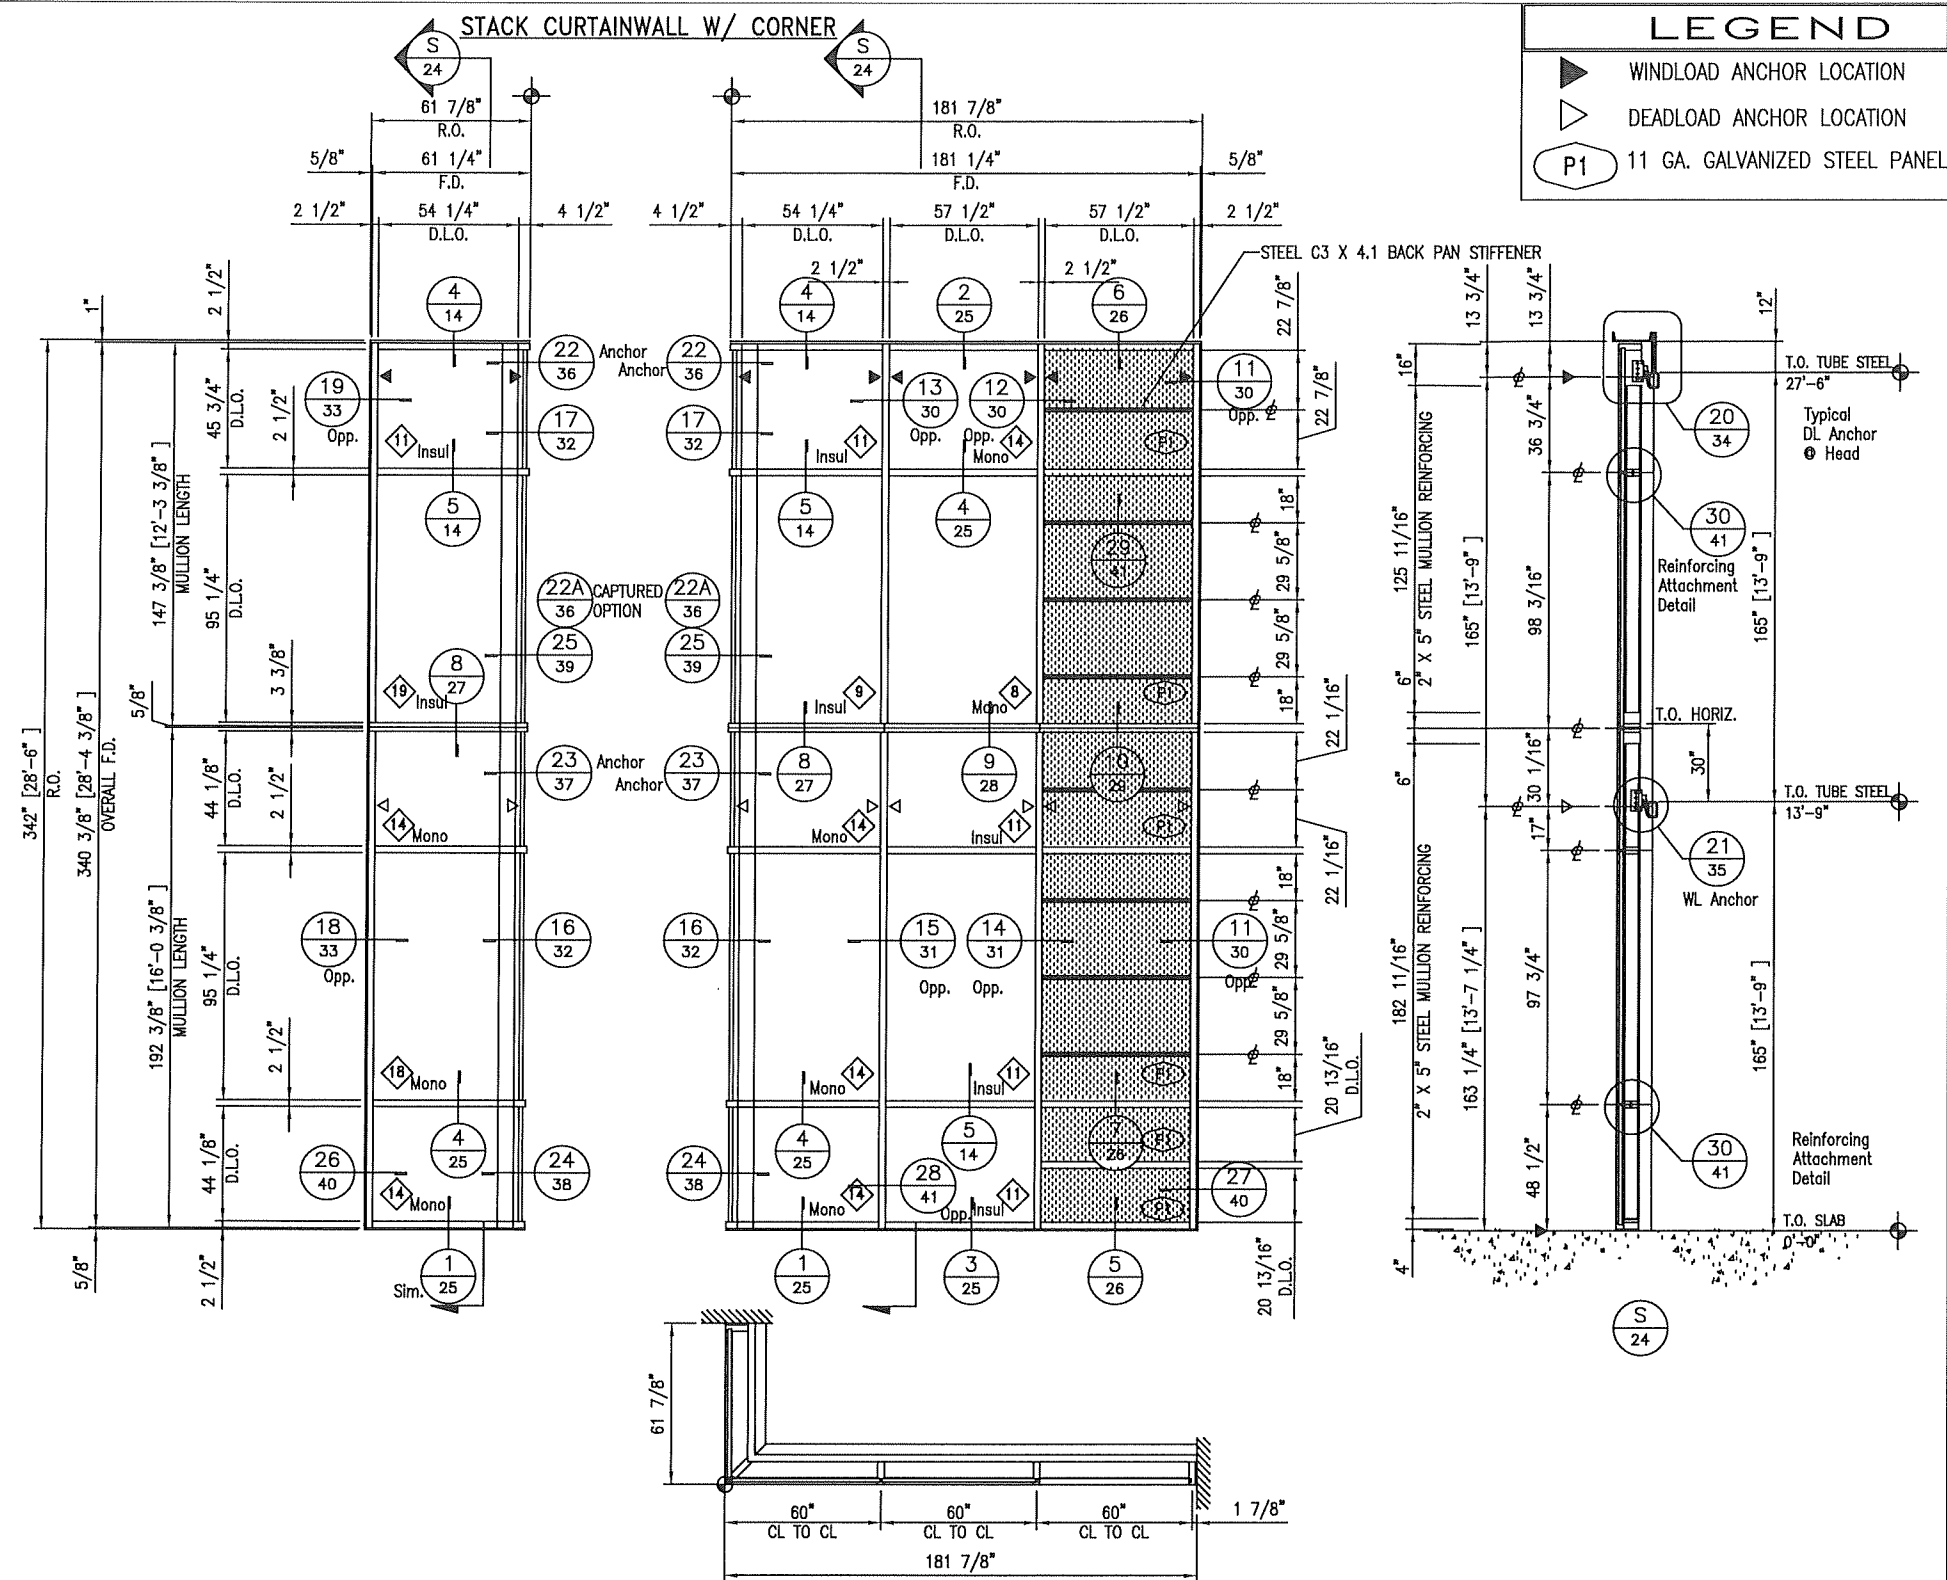

LEGEND

- ▲ WINDLOAD ANCHOR LOCATION
- △ DEADLOAD ANCHOR LOCATION
- P1 11 GA. GALVANIZED STEEL PANEL

HI-7000 OPTIONS

SYSTEM APPLICATION GUIDELINES:

- 1 SELECT GLASS FROM CHARTS ON SHEET 7. NOTE THE GLASS THICKNESS AND 4-SIDE CAPTURED VERSUS CAPTURED/SSG OPTIONS.
- 2 SELECT MULLION & REINFORCING AS REQUIRED FROM CHARTS ON SHEET 12 FOR TWIN SPAN w/ STACK HORIZONTAL APPLICATION. APPLICATION BASED ON WIND LOAD, MODULE "B", AND SPAN "L". REFER TO GENERAL NOTES AND GUIDELINES REGARDING SPAN LIMITATIONS AND COMBINATIONS.
- 3 SELECT ANCHOR APPLICATIONS FROM SHEET 13. MAKE SELECTION BASED ON PERIMETER CONDITION AND END REACTIONS. NOTE MAXIMUM TESTED END REACTIONS FOR PROPER APPLICATION.
- 4 SELECT APPROPRIATE DETAILS FROM ELEVATION AT LEFT, BASED ON GLASS APPLICATION AND MULLION REINFORCING REQUIREMENTS. FOR SPECIFIC ANCHOR DETAILS, SEE DETAILS REFERENCED ON ANCHOR APPLICATION SHEET 13.

CORNER APPLICATION

13'-9" SPAN (MAX.) ANCHOR TO ANCHOR
5'-0" MODULE (MAX.)

SEE SHEET 32 FOR DETAILS
SEE DETAIL 22A ON SHEET 36 FOR
CAPTURED OPTION.

STACK APPLICATION

57 1/2" DLO MAXIMUM.
MAXIMUM TESTED SHEAR
IN STACK HORIZONTAL= 3,695 #

SEE SHEET 27 FOR DETAILS

GENERAL NOTES:

Larson Engineering, Inc.

3524 Labore Road
White Bear Lake, MN 55110
(P) 651.481.9120 (F) 651.481.9201

DADE CO. STAMP

PRODUCT REVISED
As complying with the Florida
Building Code
NOA-No. **25-0902.03**
Expiration Date: **09/02/2029**

By: *Manuel Perez*
Miami-Dade Product Control

ENGINEER STAMP



Harmon

HI 7000 LARGE MISSILE



TWIN SPAN APPLICATION

w/ STACK HORIZONTAL

DATE: 06/28/04	6	6/17/16	
1	11/18/08	7	03/05/19
2	3/10/09	8	02/25/21
3	3/16/09	9	08/12/25
4	5/22/12		
5	10/03/14		

DWG. NO. HI7000LM

SHEET 24 OF 41

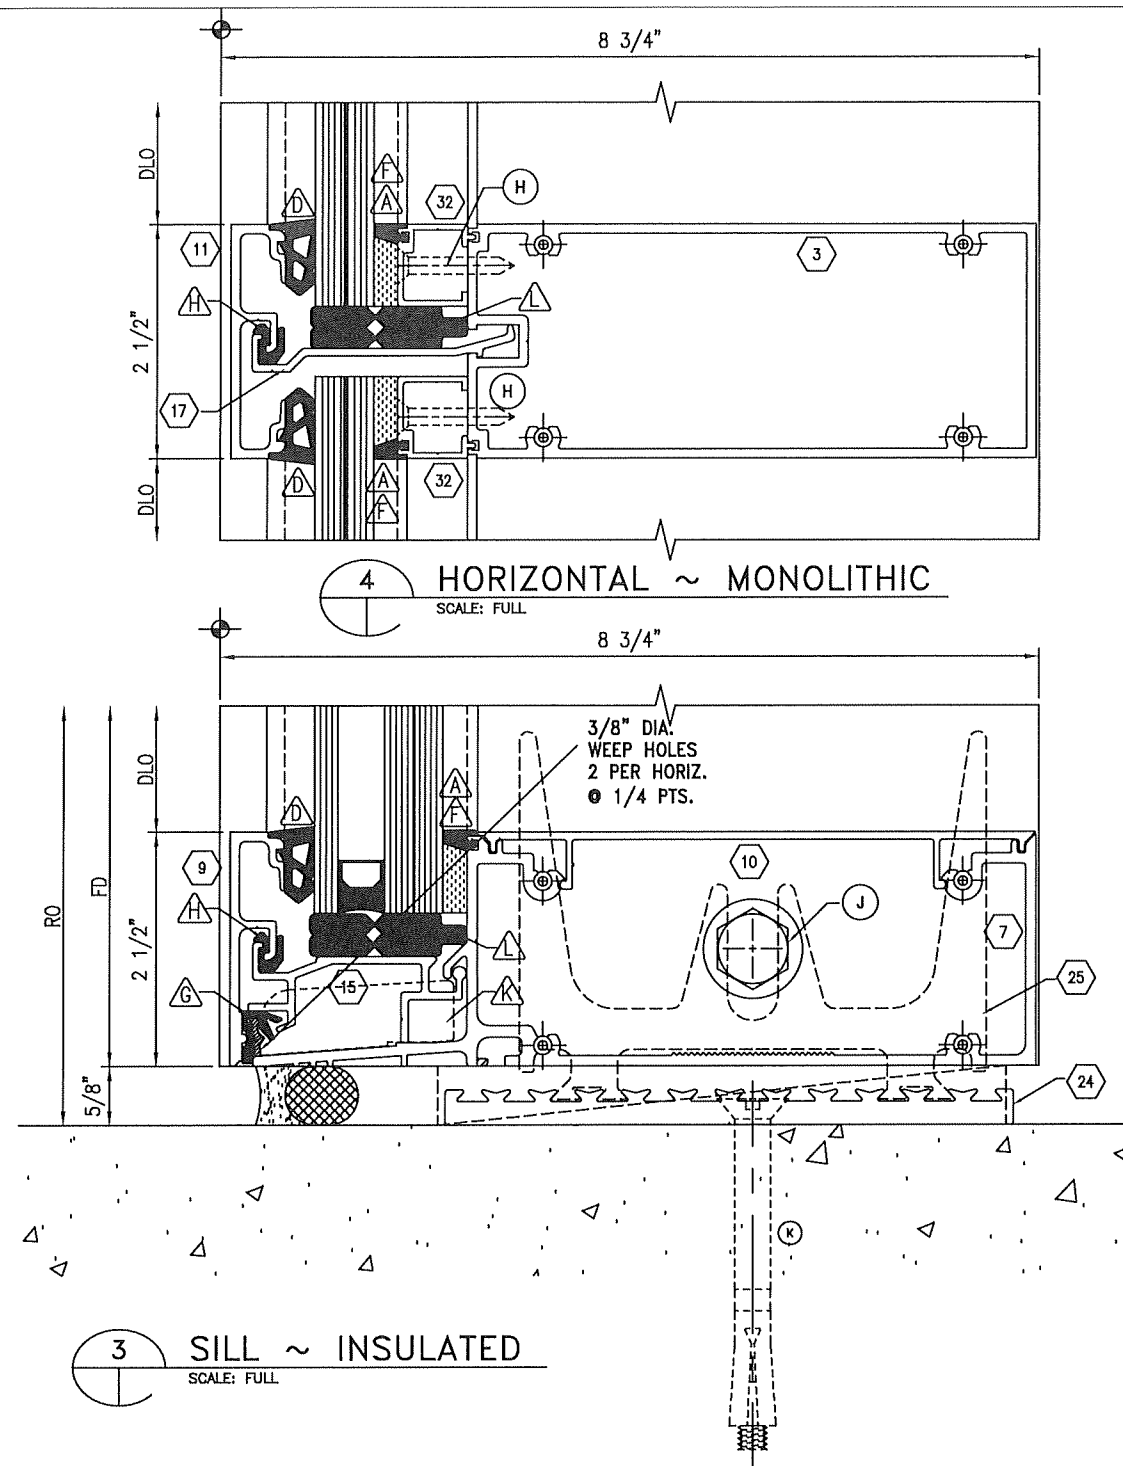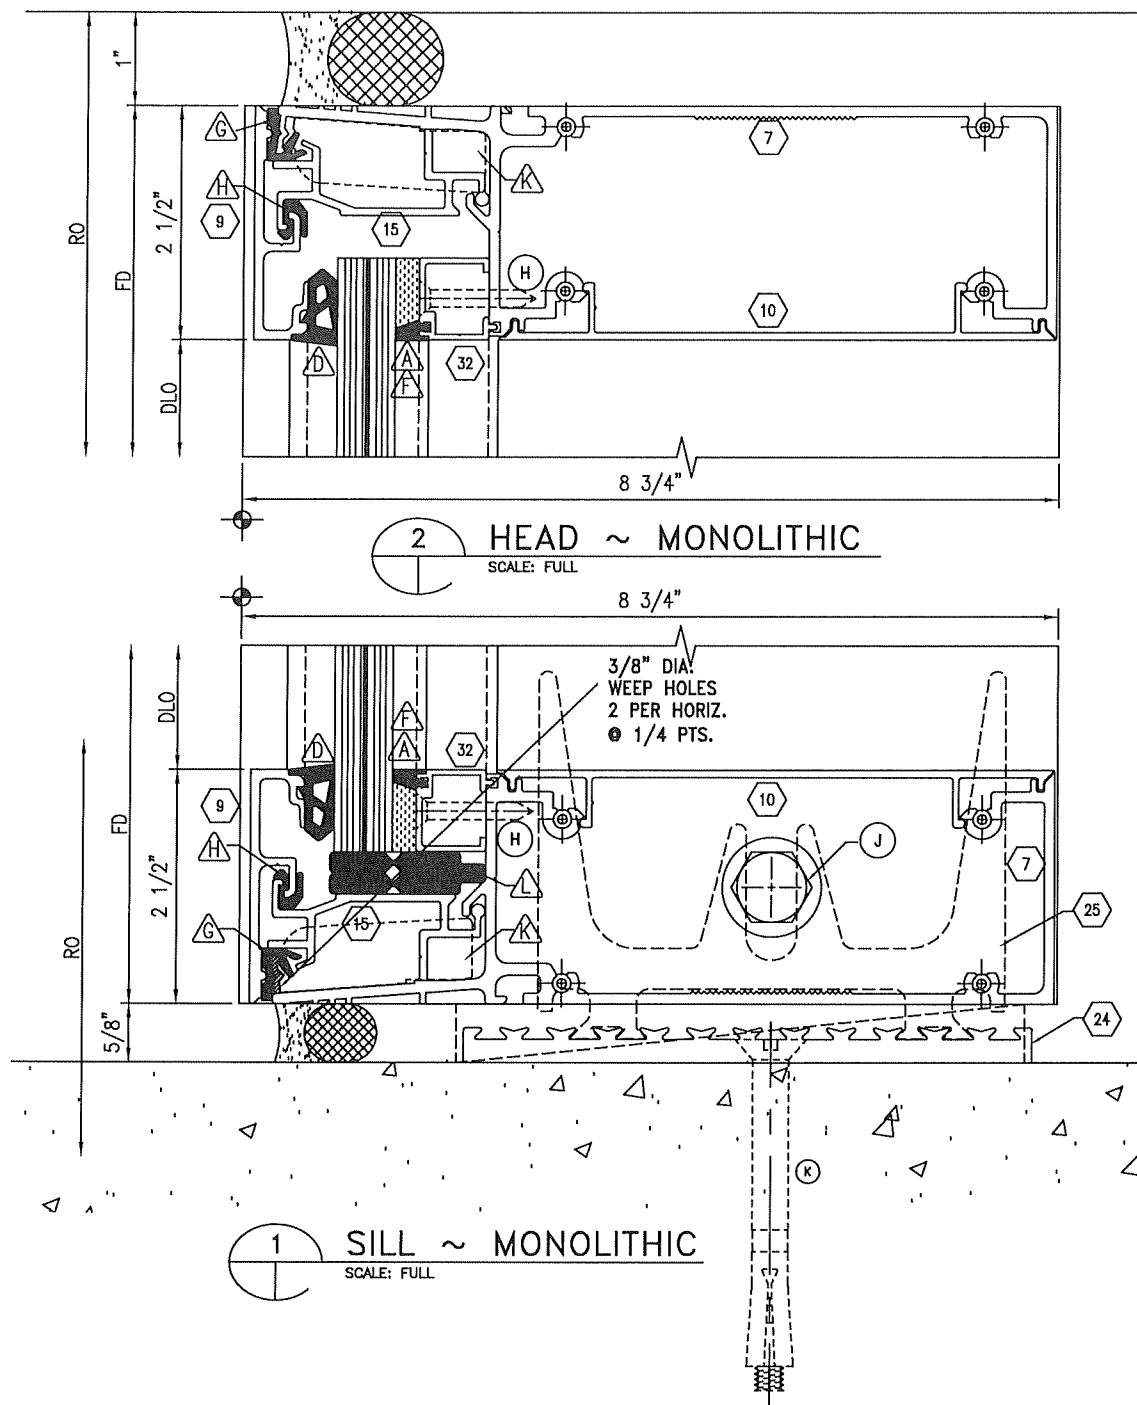

GENERAL NOTES:

- FOR ANCHOR DETAILS REFER TO SHEET 20
- FOR PART IDENTIFICATION REFER TO SHEET 2

- FASTENERS
- △ GASKETS
- ⬡ ALUMINUM EXTRUSIONS

- FOR GLAZING DETAILS, GLASS BITE & GASKET CONFIGURATIONS SEE SHEET 3.

Larson Engineering, Inc.
3524 Labore Road
White Bear Lake, MN 55110
(P) 651.481.9120 (F) 651.481.9201

DADE CO. STAMP

PRODUCT REVISED
As complying with the Florida Building Code
NOA-No. **25-0902.03**
Expiration Date: **09/02/2029**
By: *Manuel Perez*
Miami-Dade Product Control

ENGINEER STAMP
No. 65106
STATE OF FLORIDA
Professional Engineer
Ethan A. Harmon
Registration No. 65106


Harmon

HI 7000 LARGE MISSILE
HORIZONTAL DETAILS


DATE: 06/28/04	6 6/17/16
1 11/18/08	7 03/05/19
2 3/10/09	8 02/25/21
3 3/16/09	9 08/12/25
4 5/22/12	
5 10/03/14	

DWG. NO. HI7000LM


SHEET 25 OF 41

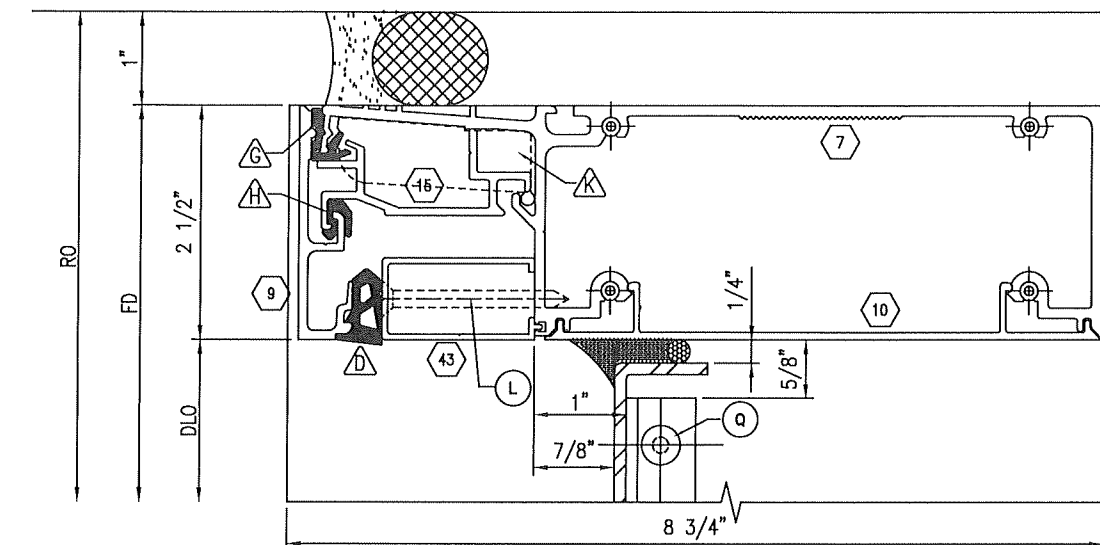

6 HEAD ~ BACK PAN
SCALE: FULL

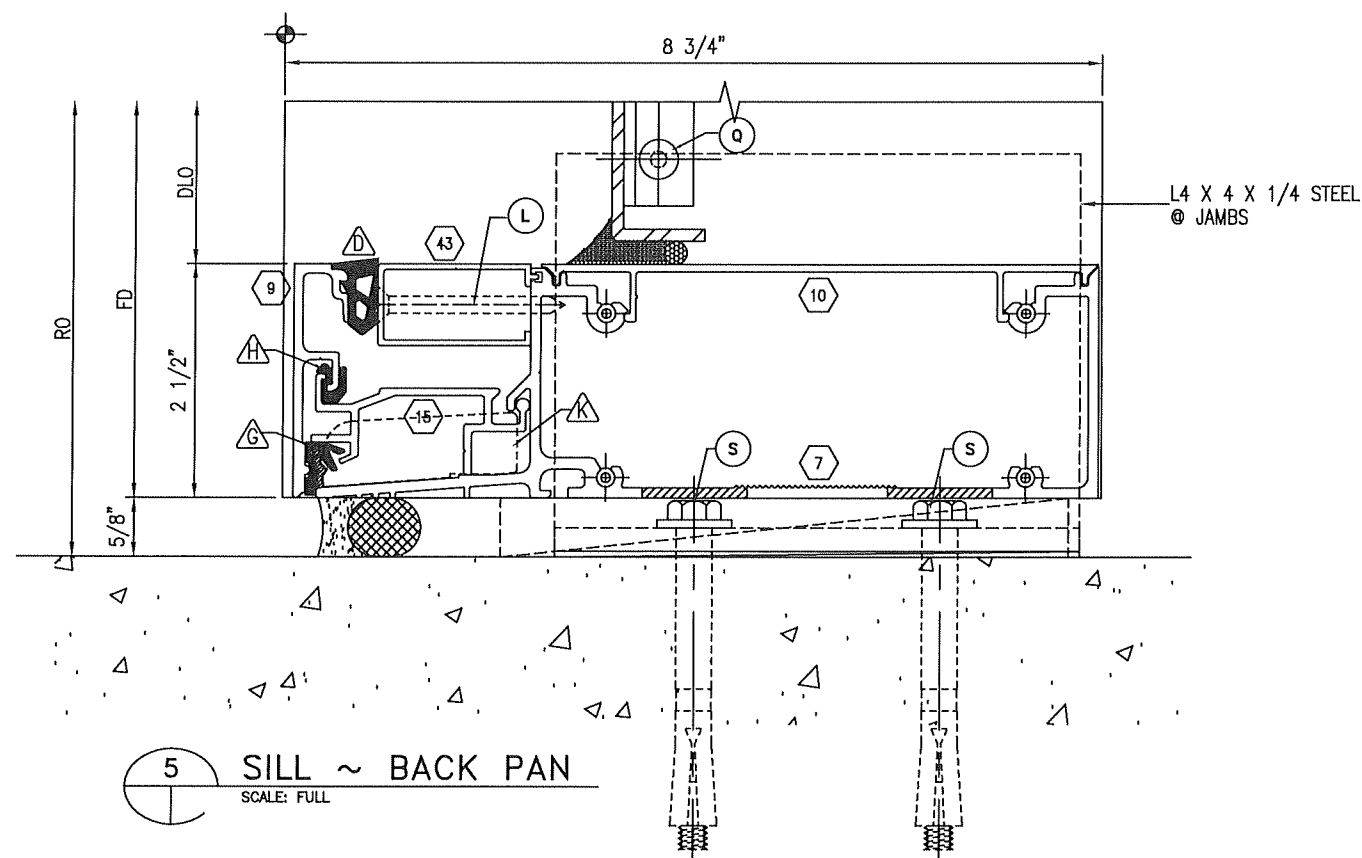

5 SILL ~ BACK PAN
SCALE: FULL

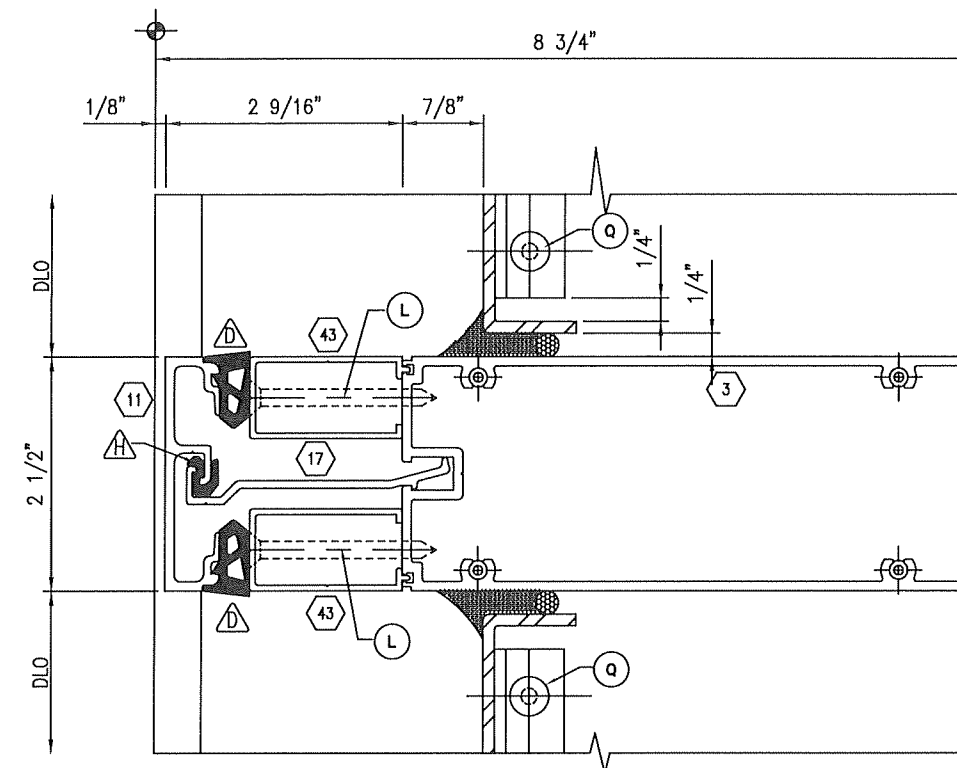

7 HORIZONTAL ~ BACK PAN
SCALE: FULL

GENERAL NOTES:

- FOR ANCHOR DETAILS REFER TO SHEET 20
- FOR PART IDENTIFICATION REFER TO SHEET 2

- FASTENERS
- △ GASKETS
- ⬡ ALUMINUM EXTRUSIONS

- FOR GLAZING DETAILS, GLASS BITE & GASKET CONFIGURATIONS SEE SHEET 3.

Larson Engineering, Inc.
3524 Labore Road
White Bear Lake, MN 55110
(P) 651.481.9120 (F) 651.481.9201

DADE CO. STAMP

PRODUCT REVISED
As complying with the Florida
Building Code
NOA-No. **25-0902.03**
Expiration Date: **09/02/2029**
By: *Manuel Perez*
Miami-Dade Product Control

ENGINEER'S STAMP
No. 65106
STATE OF
FLORIDA
Professional Engineer
Ethan A. Carpenter
Registration No. 65106


Harmon

HI 7000 LARGE MISSILE
HORIZONTAL DETAILS

DATE: 06/28/04	6 6/17/16
1 11/18/08	7 03/05/19
2 3/10/09	8 02/25/21
3 3/16/09	9 08/12/25
4 5/22/12	
5 10/03/14	

DWG. NO. HI7000LM


SHEET 26 OF 41

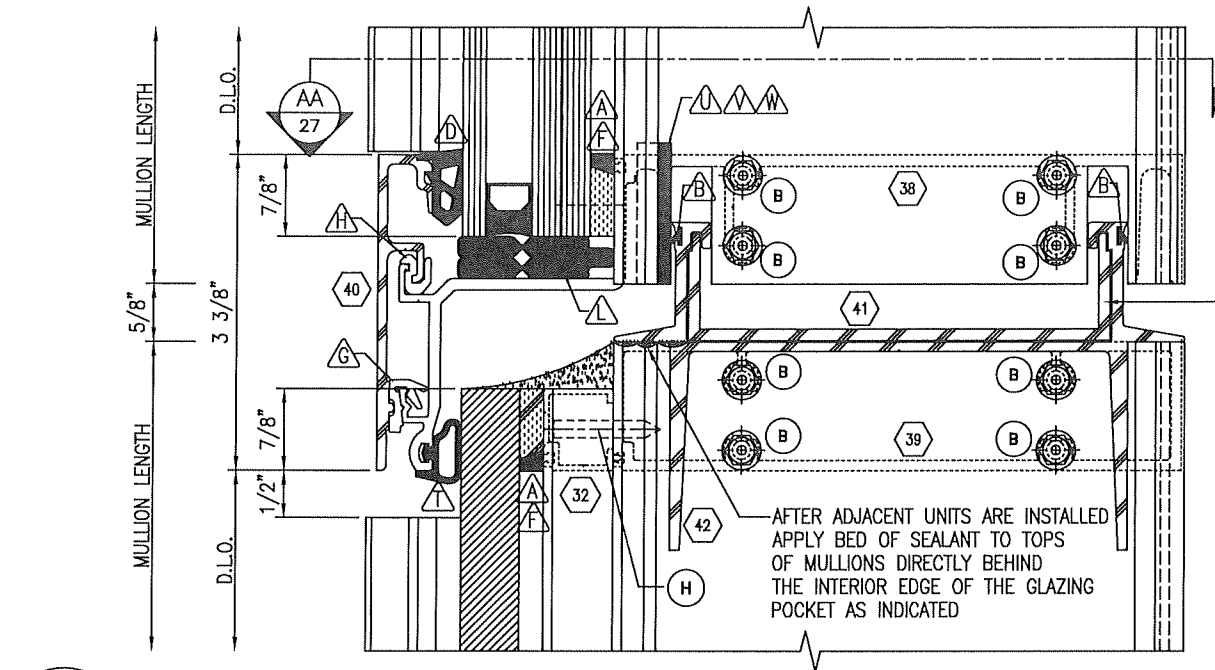

BB SECTION THROUGH STACK
SCALE: FULL

8" LONG STACK RAIL SPLICE
SLID INTO THE STACK RAIL ON FEMALE SIDE
OF UNIT AND TAPED INTO PLACE FOR SHIPPING.
SLIDE OVER TO CENTERLINE OF MULLION @ TIME
OF FRAME ASSEMBLY

AFTER ADJACENT UNITS ARE INSTALLED
APPLY BED OF SEALANT TO TOPS
OF MULLIONS DIRECTLY BEHIND
THE INTERIOR EDGE OF THE GLAZING
POCKET AS INDICATED

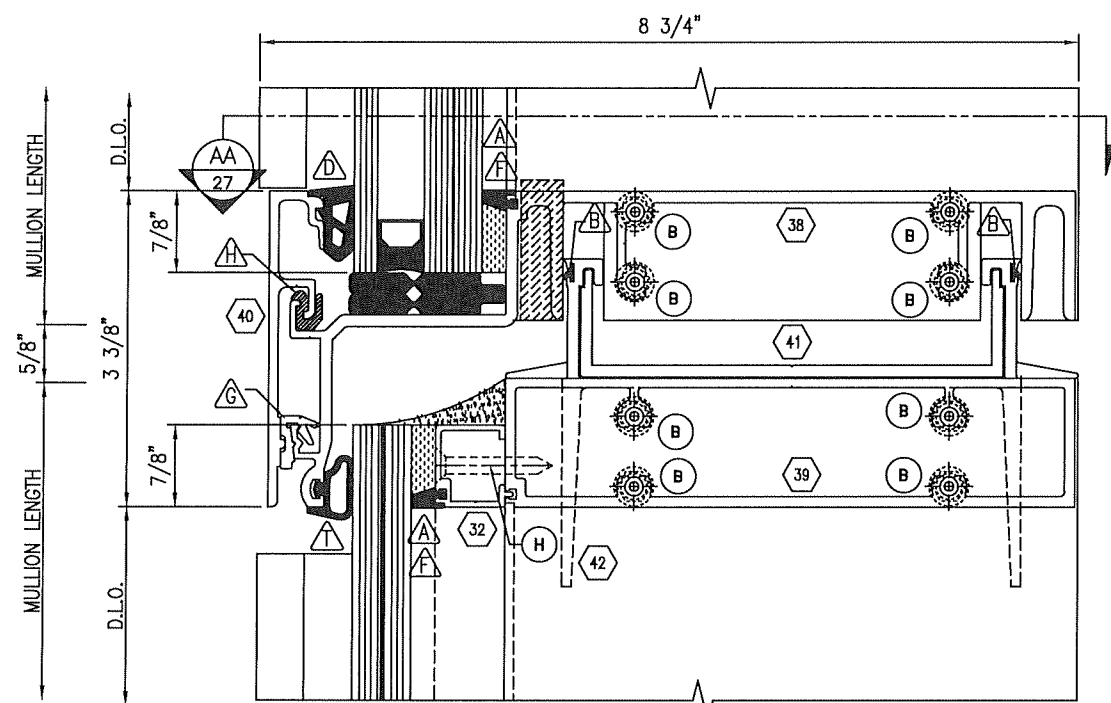

8 STACK HORIZONTAL
SCALE: FULL


MAXIMUM DLO WIDTH=57 1/2"
MAXIMUM SHEAR AT STACK=3,695#

GENERAL NOTES:

- FOR PART IDENTIFICATION REFER TO SHEET 2

- FOR GLAZING DETAILS, GLASS BITE & GASKET
CONFIGURATIONS SEE SHEET 3.

- FASTENERS
- GASKETS
- ALUMINUM EXTRUSIONS

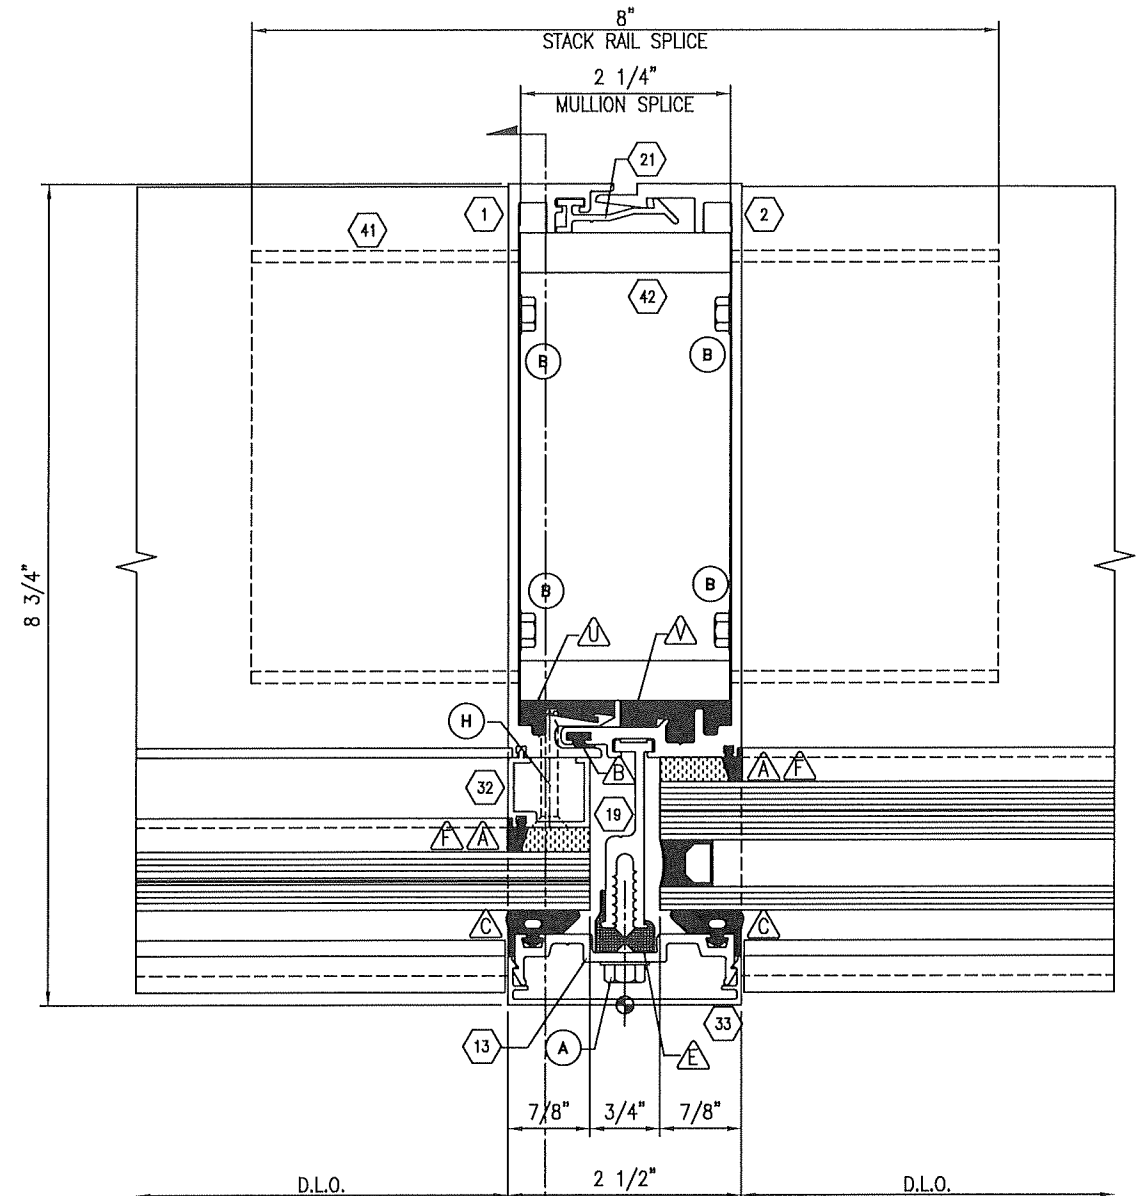

AA MULLION @ STACK
SCALE: FULL



Larson Engineering, Inc.
3524 Labore Road
White Bear Lake, MN 55110
(P) 651.481.9120 (F) 651.481.9201

DADE CO. STAMP

PRODUCT REVISED
As complying with the Florida
Building Code
NOA-No. **25-0902.03**
Expiration Date: **09/02/2029**
By: *Manuel Perez*
Miami-Dade Product Control

ENGINEER'S STAMP

ETHANA SHARP
LICENSED PROFESSIONAL ENGINEER
No. 65106
STATE OF FLORIDA
Professional Seal
Registration No. 65106

Harmon

HI 7000 LARGE MISSILE


STACK HORIZONTAL DETAIL

SECTION CUTS

DATE: 06/28/04	6	6/17/16	
1	11/18/08	7	03/05/19
2	3/10/09	8	02/25/21
3	3/16/09	9	08/12/25
4	5/22/12		
5	10/03/14		


DWG. NO. HI7000LM

SHEET 27 OF 41

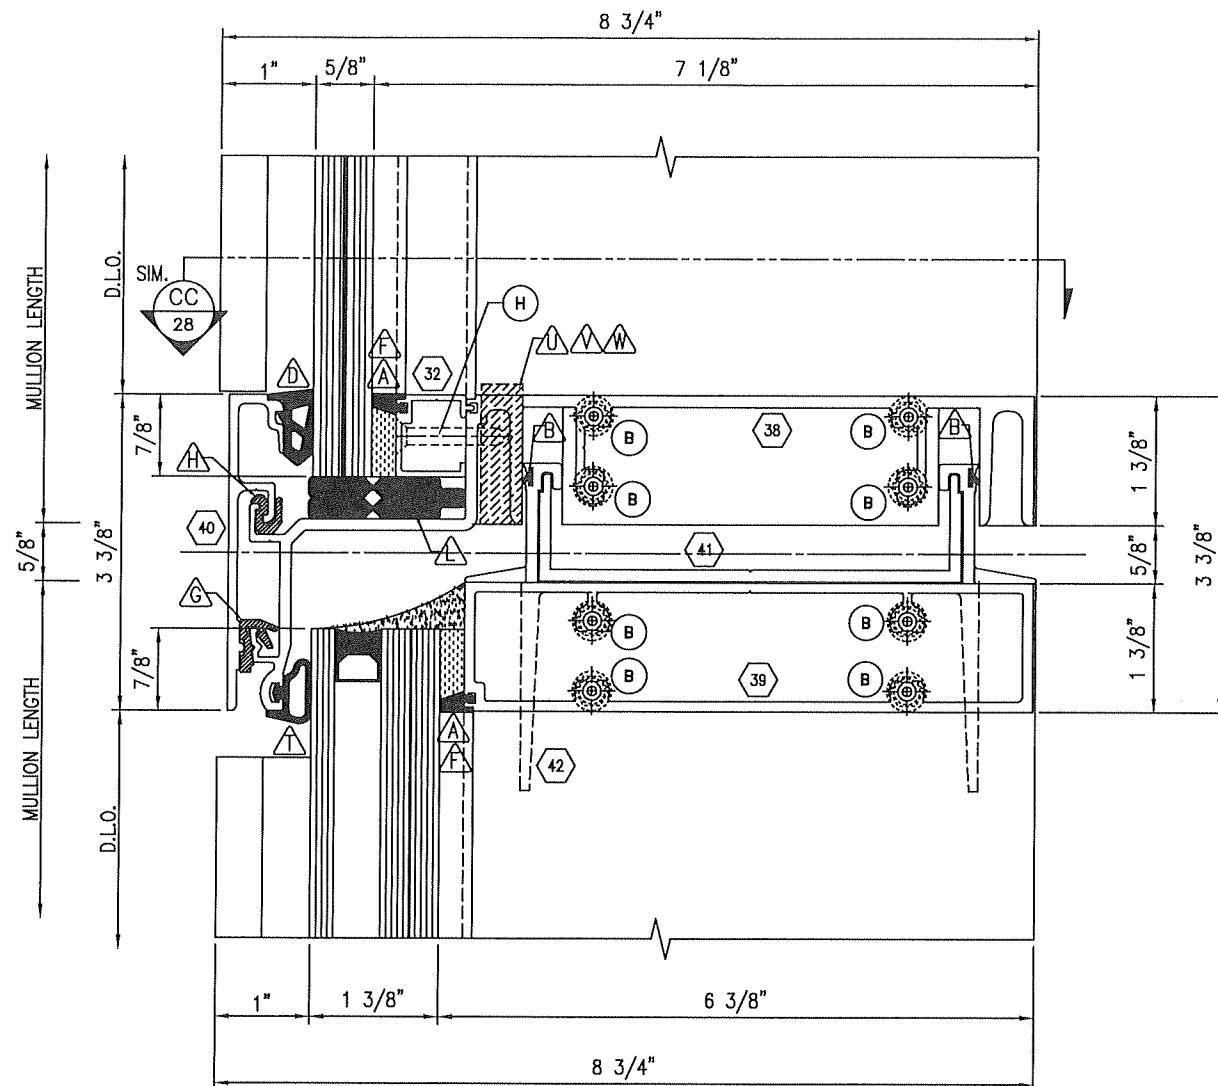

9 STACK HORIZONTAL
SCALE: FULL

MAXIMUM DLO WIDTH=57 1/2"
MAXIMUM SHEAR AT STACK=3,695#

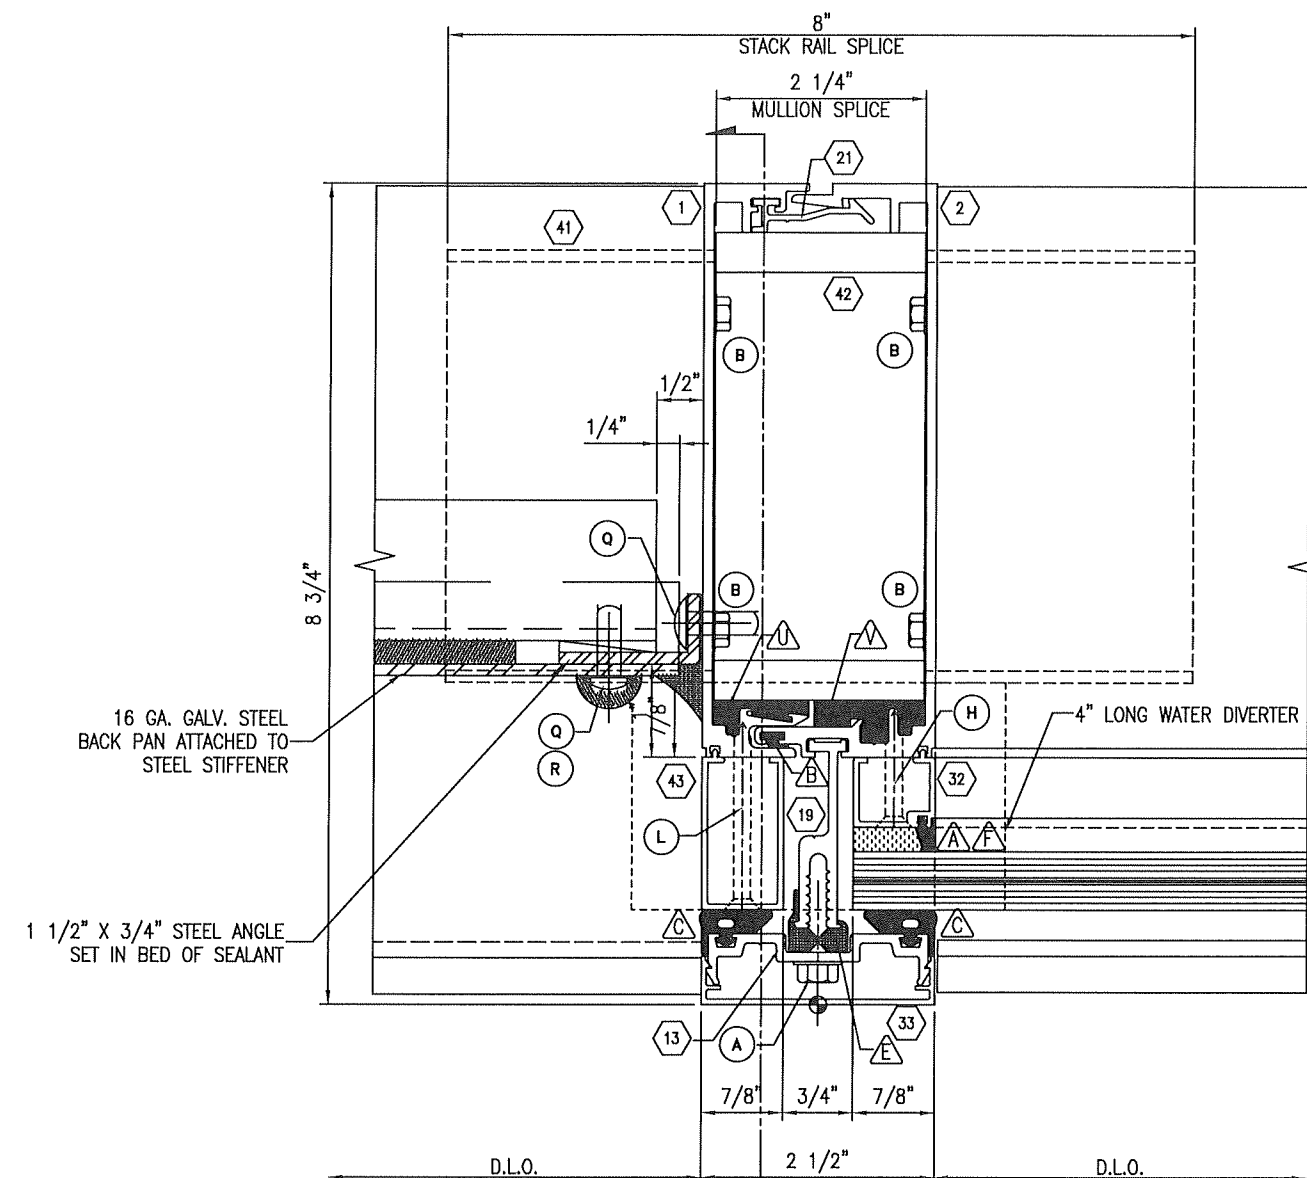

CC MULLION @ STACK
SCALE: FULL

GENERAL NOTES:

- FOR PART IDENTIFICATION REFER TO SHEET 2

- FOR GLAZING DETAILS, GLASS BITE & GASKET CONFIGURATIONS SEE SHEET 3.

- FASTENERS
- △ GASKETS
- ⬡ ALUMINUM EXTRUSIONS

Larson Engineering, Inc.
3524 Labore Road
White Bear Lake, MN 55110
(P) 651.481.9120 (F) 651.481.9201

DADE CO. STAMP

PRODUCT REVISED
As complying with the Florida Building Code
NOA-No. **25-0902.03**
Expiration Date: **09/02/2029**
By: *Manuel Perez*
Miami-Dade Product Control

ENGINEER STAMP

STATE OF FLORIDA
Professional Engineer
No. 65106
Ethan J. Harpelle
Registration No. 1155195

Harmon

HI 7000 LARGE MISSILE


STACK HORIZONTAL DETAIL
& SECTION CUT

DATE: 06/28/04	6/17/16
1 11/18/08	7 03/05/19
2 3/10/09	8 02/25/21
3 3/16/09	9 08/12/25
4 5/22/12	
5 10/03/14	

DWG. NO. HI7000LM

SHEET 28 OF 41

.060" END DAM
SHOP APPLIED TO TOP UNIT ONLY
USED TO BRIDGE GAP
FOR PERIMETER SEAL SUPPORT

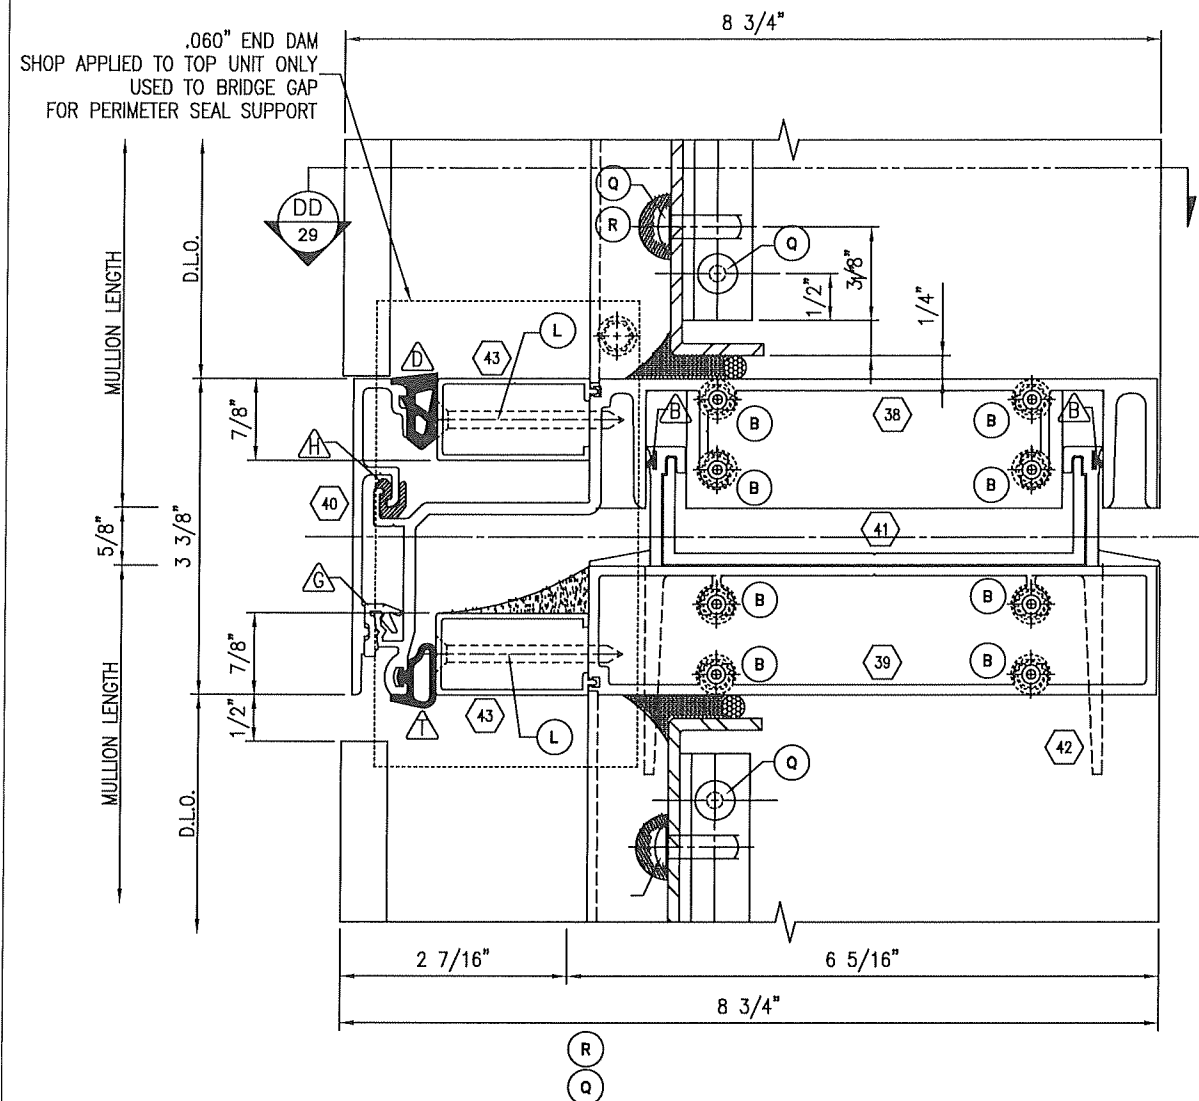

10 STACK HORIZONTAL ~ BACK PAN
SCALE: FULL


MAXIMUM DLO WIDTH=57 1/2"
MAXIMUM SHEAR AT STACK=3,695#

GENERAL NOTES:

- FOR PART IDENTIFICATION REFER TO SHEET 2

- FOR GLAZING DETAILS, GLASS BITE & GASKET CONFIGURATIONS SEE SHEET 3.

- FASTENERS
- GASKETS
- ALUMINUM EXTRUSIONS

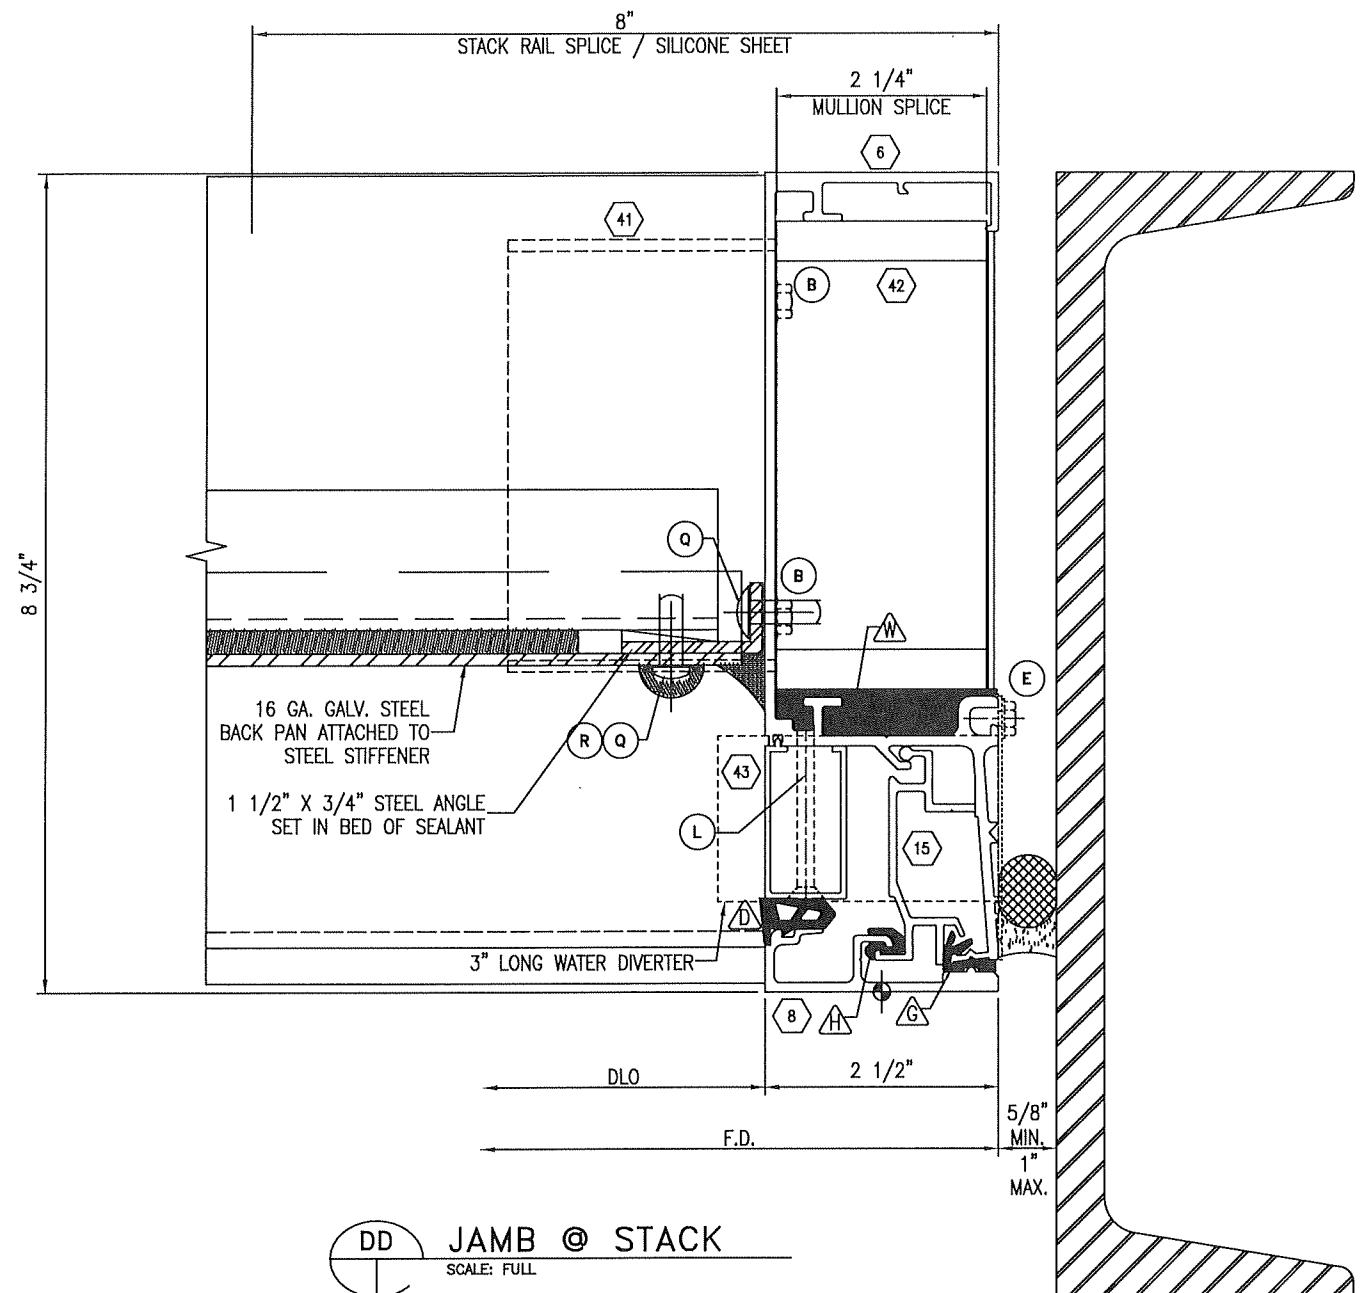

DD JAMB @ STACK
SCALE: FULL

Larson Engineering, Inc.
3524 Labore Road
White Bear Lake, MN 55110
(P) 651.481.9120 (F) 651.481.9201

DADE CO. STAMP

PRODUCT REVISED
As complying with the Florida Building Code
NOA-No. **25-0902.03**
Expiration Date: **09/02/2029**
By: *Manuel Perez*
Miami-Dade Product Control

ENGINEER STAMP

ETHAN A. CHARPENTIER
No. 65106
STATE OF FLORIDA
Professional Engineer
Registration No. 65106

Harmon


HI 7000 LARGE MISSILE

STACK HORIZONTAL DETAIL
& SECTION CUT


DATE: 06/28/04	6	6/17/16	
1	11/18/08	7	03/05/19
2	3/10/09	8	02/25/21
3	3/16/09	9	08/12/25
4	5/22/12		
5	10/03/14		

DWG. NO. HI7000LM

SHEET 29 OF 41

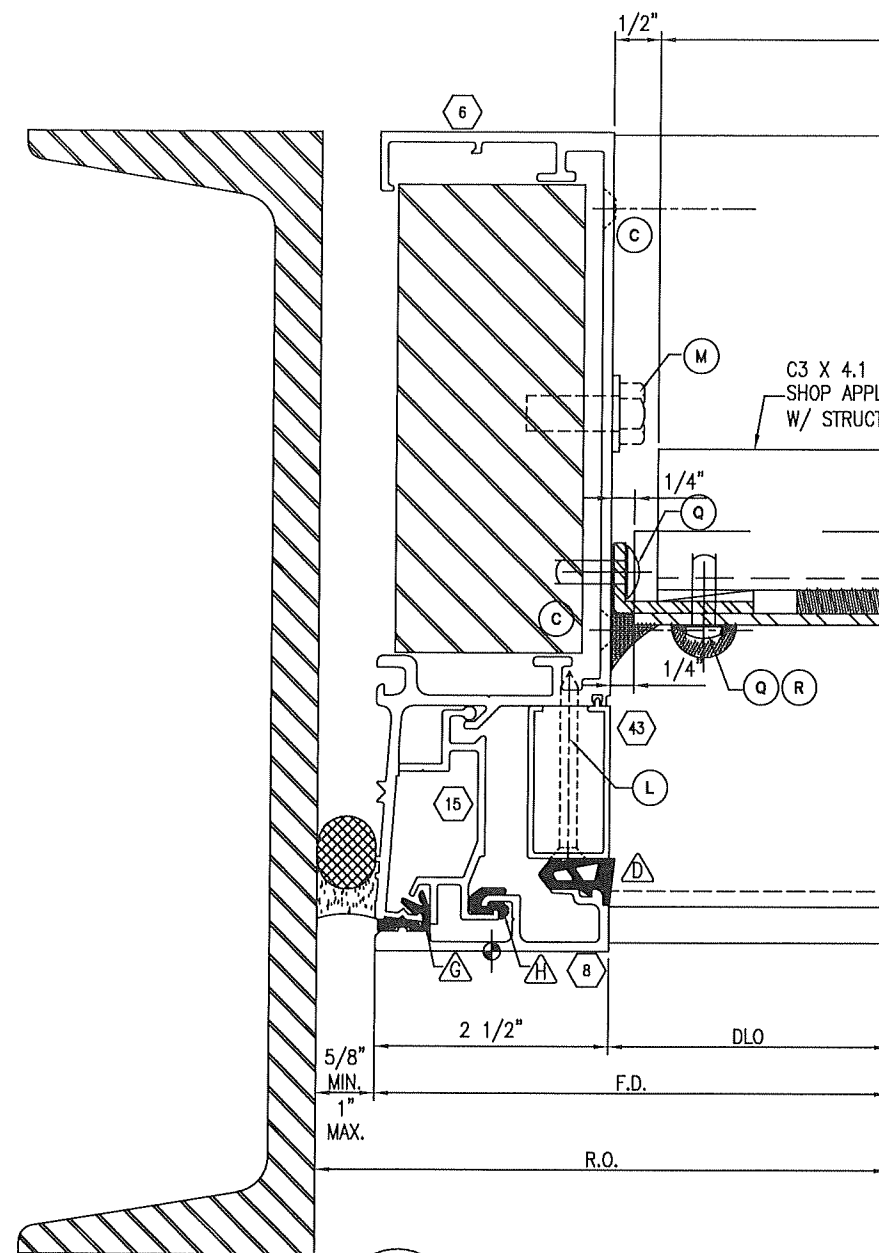


11 JAMB ~ BACK PAN
SCALE: FULL

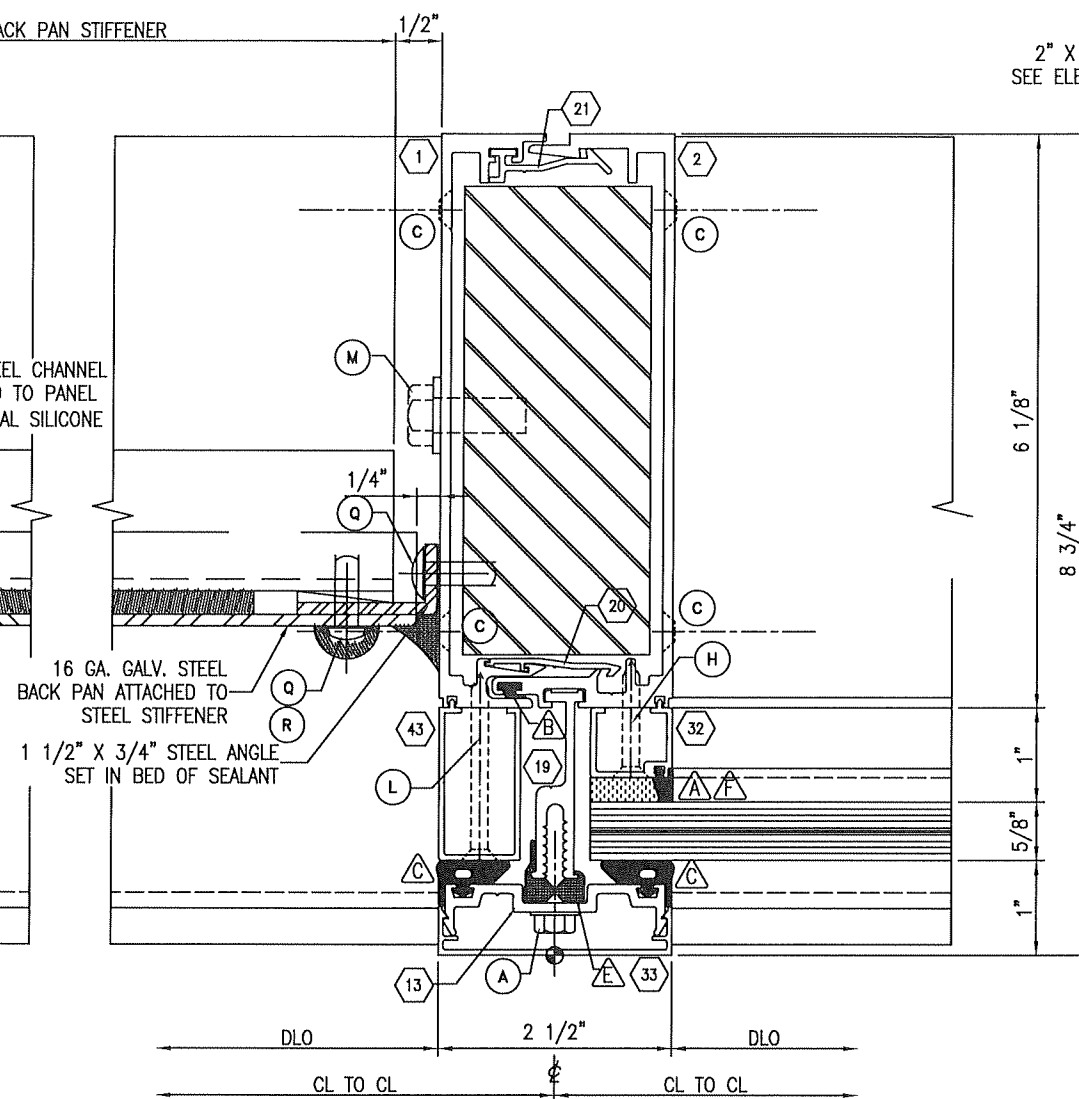

12 MULLION ~ BACK PAN
SCALE: FULL

2" X 5" STEEL REINFORCING BAR
SEE ELEVATION FOR LENGTHS REQD.

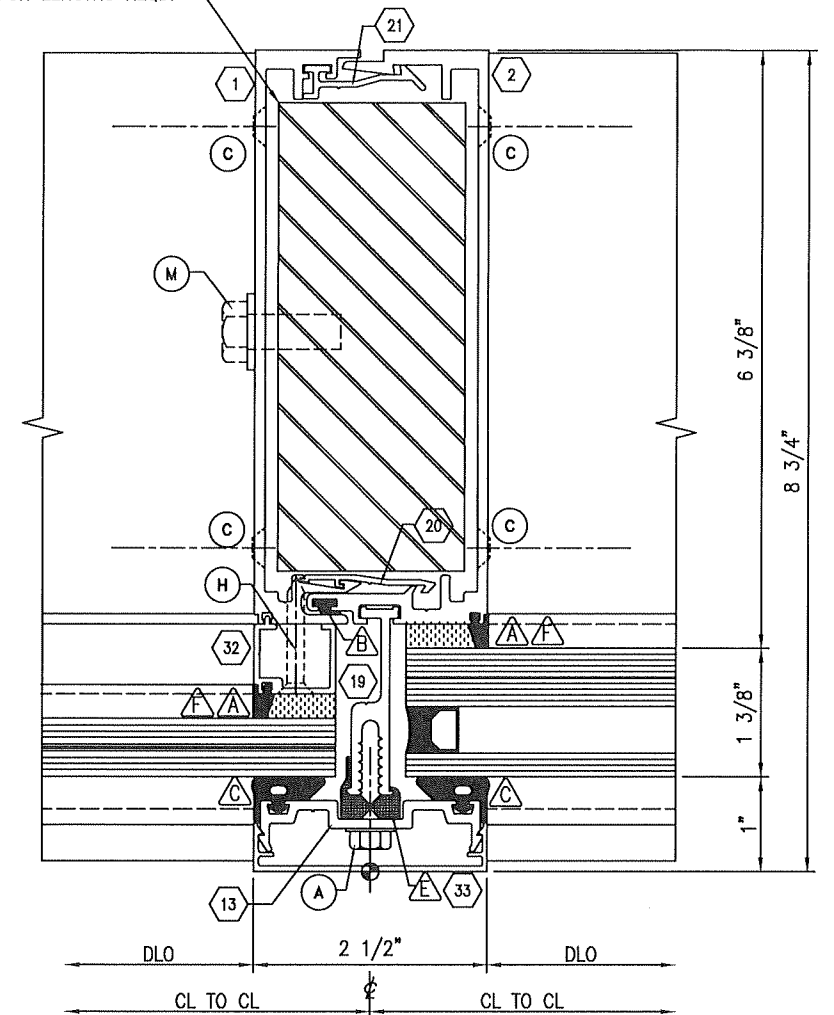

13 MULLION DETAIL
SCALE: FULL

GENERAL NOTES:

- FOR PART IDENTIFICATION REFER TO SHEET 2

- FASTENERS
- △ GASKETS
- ALUMINUM EXTRUSIONS

- FOR GLAZING DETAILS, GLASS BITE & GASKET CONFIGURATIONS SEE SHEET 3.

Larson Engineering, Inc.
3524 Labore Road
White Bear Lake, MN 55110
(P) 651.481.9120 (F) 651.481.9201

DADE CO. STAMP

PRODUCT REVISED
As complying with the Florida Building Code
NOA-No. **25-0902.03**
Expiration Date: **09/02/2029**
By: *Manuel Perez*
Miami-Dade Product Control

ENGINEER STAMP

ETHAN A. HARMON
No. 65106
STATE OF FLORIDA
Professional Engineer
Registration No. 65106


Harmon

HI 7000 LARGE MISSILE
VERTICAL DETAILS


DATE: 06/28/04	6/17/16
1 11/18/08	7 03/05/19
2 3/10/09	8 02/25/21
3 3/16/09	9 08/12/25
4 5/22/12	
5 10/03/14	

DWG. NO. HI7000LM

SHEET 30 OF 41

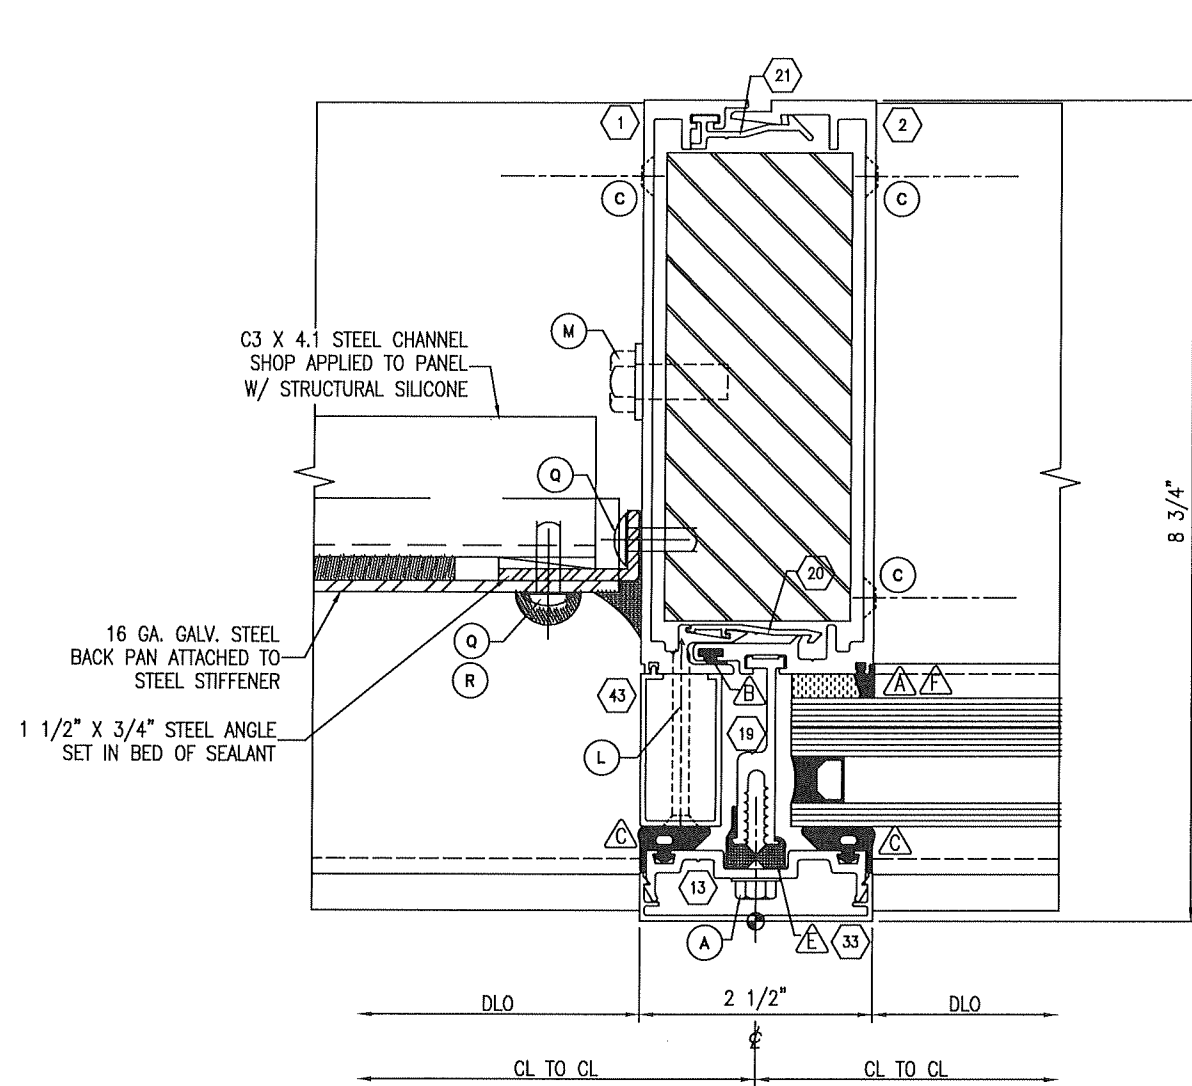

14 MULLION ~ BACK PAN
SCALE: FULL

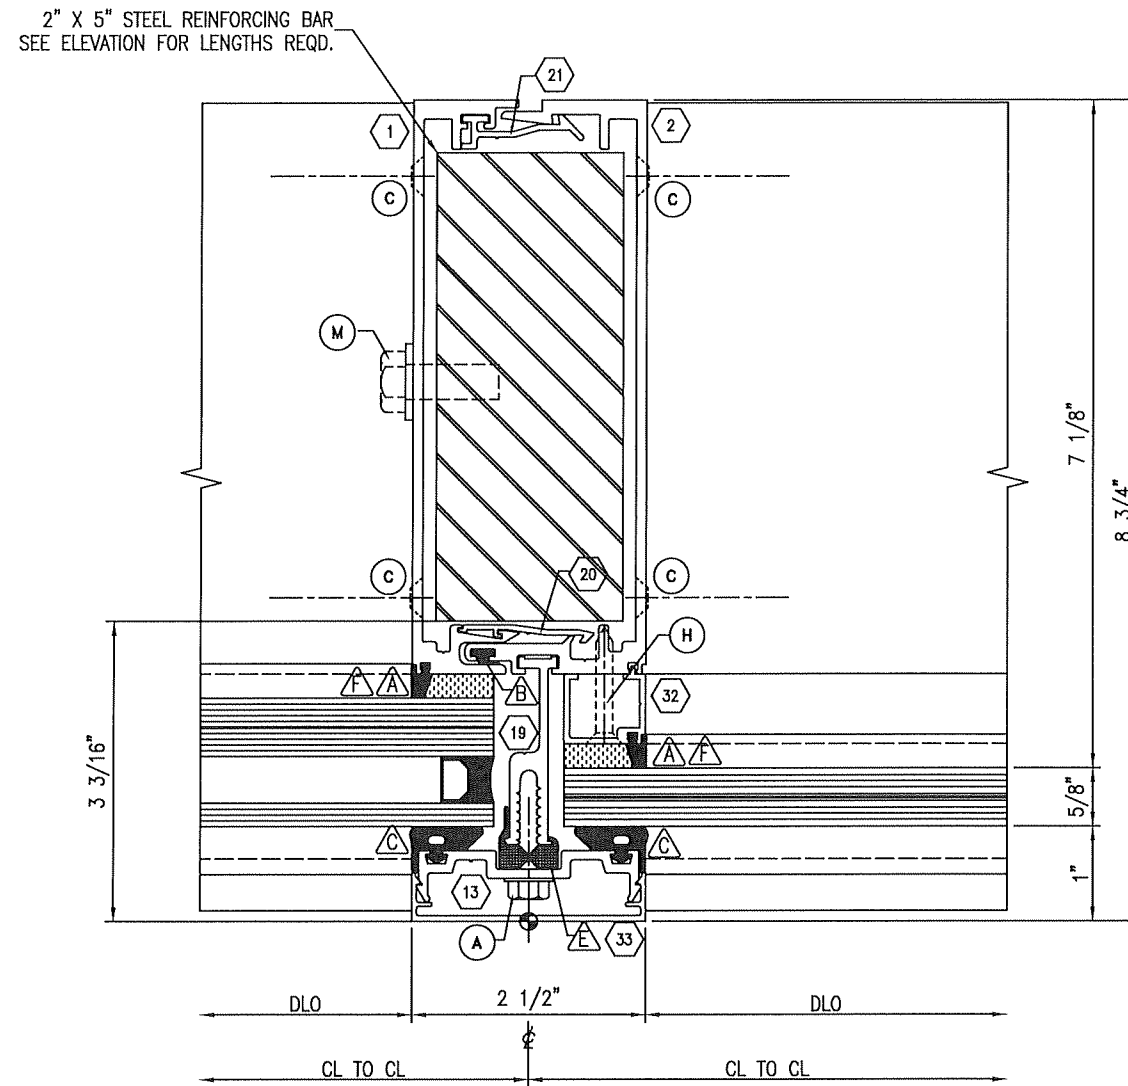

15 MULLION DETAIL
SCALE: FULL

GENERAL NOTES:

- FOR PART IDENTIFICATION REFER TO SHEET 2

- FASTENERS
- △ GASKETS
- ⬡ ALUMINUM EXTRUSIONS

- FOR GLAZING DETAILS, GLASS BITE & GASKET CONFIGURATIONS SEE SHEET 3.

Larson Engineering, Inc.
3524 Labore Road
White Bear Lake, MN 55110
(P) 651.481.9120 (F) 651.481.9201

DADE CO. STAMP

PRODUCT REVISED
As complying with the Florida
Building Code
NOA-No. **25-0902.03**
Expiration Date: **09/02/2029**
By: *Manuel Perez*
Miami-Dade Product Control

ENGINEER STAMP

STATE OF FLORIDA
Professional Engineer
No. 65108
Ethan A. Carpenter
Registration No. 1991091


Harmon

HI 7000 LARGE MISSILE
VERTICAL DETAILS


DATE: 06/28/04	6 6/17/16
1 11/18/08	7 03/05/19
2 3/10/09	8 02/25/21
3 3/16/09	9 08/12/25
4 5/22/12	
5 10/03/14	

DWG. NO. HI7000LM

SHEET 31 OF 41

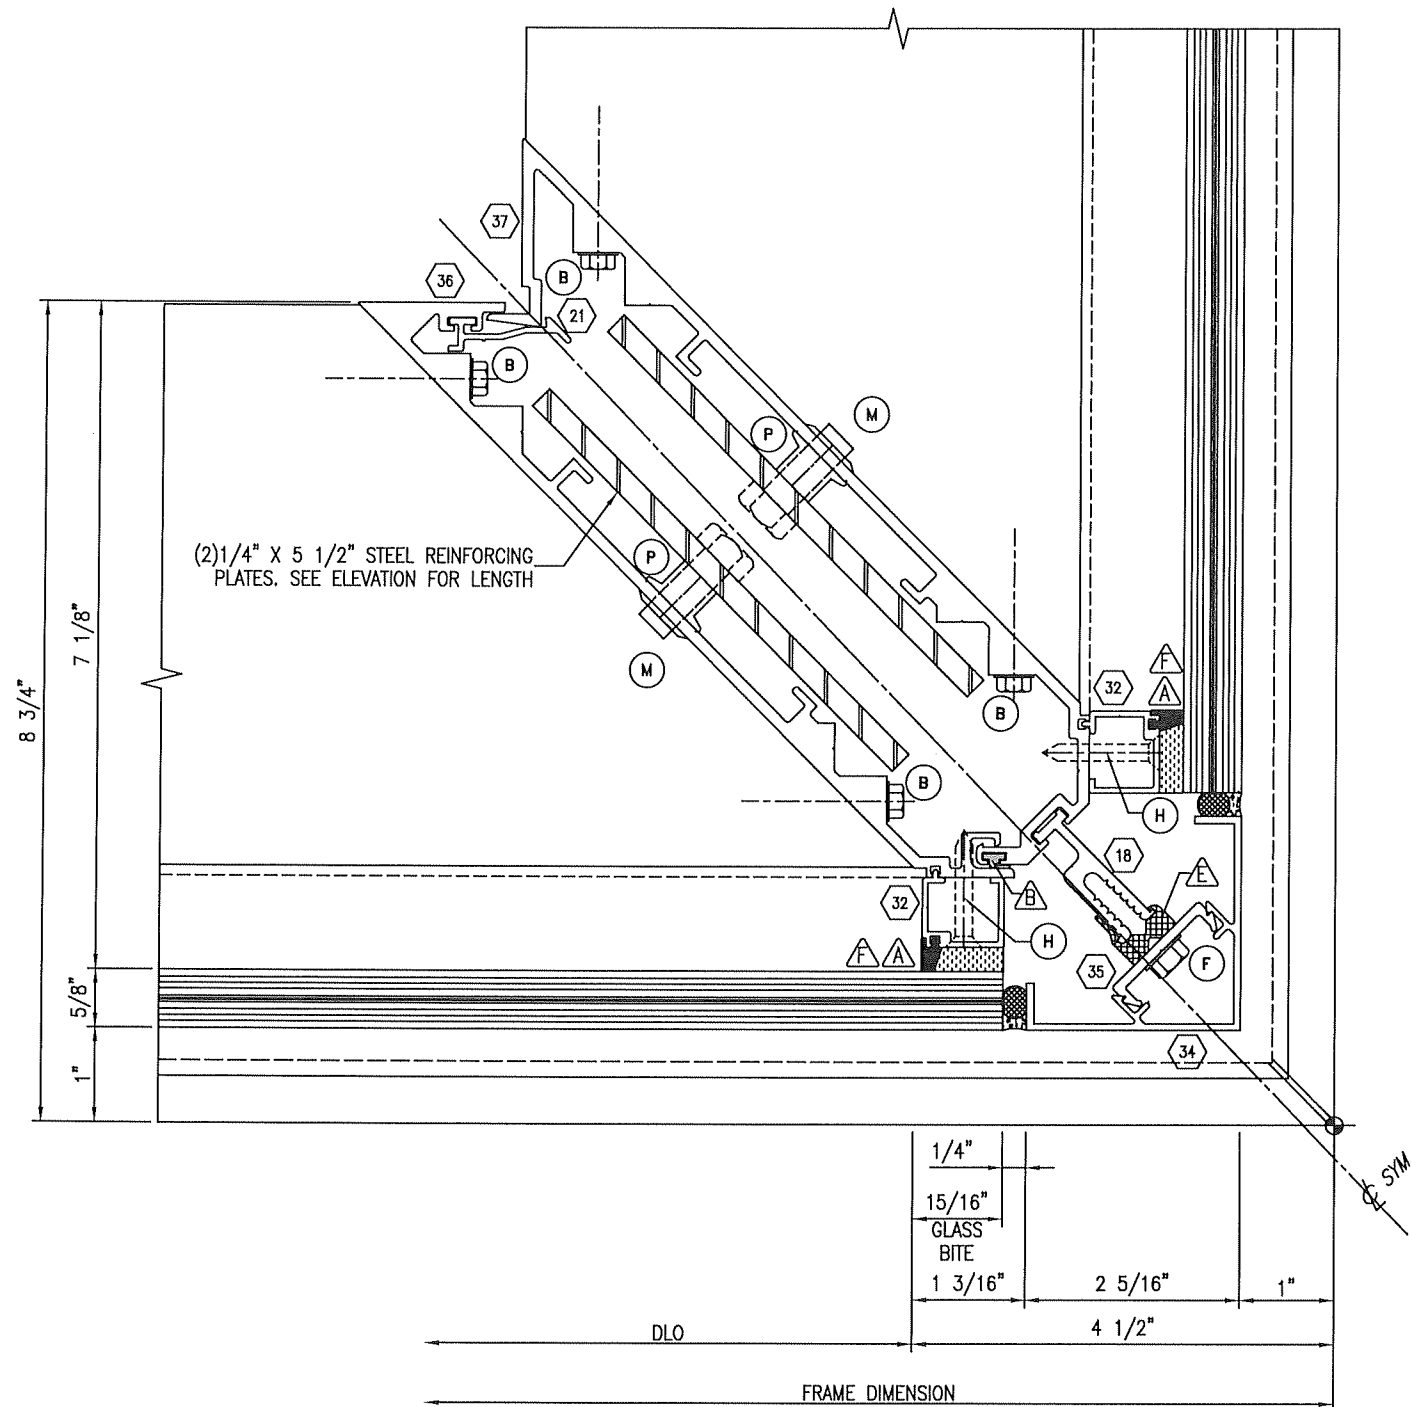

16 OUTSIDE CORNER
SCALE: FULL

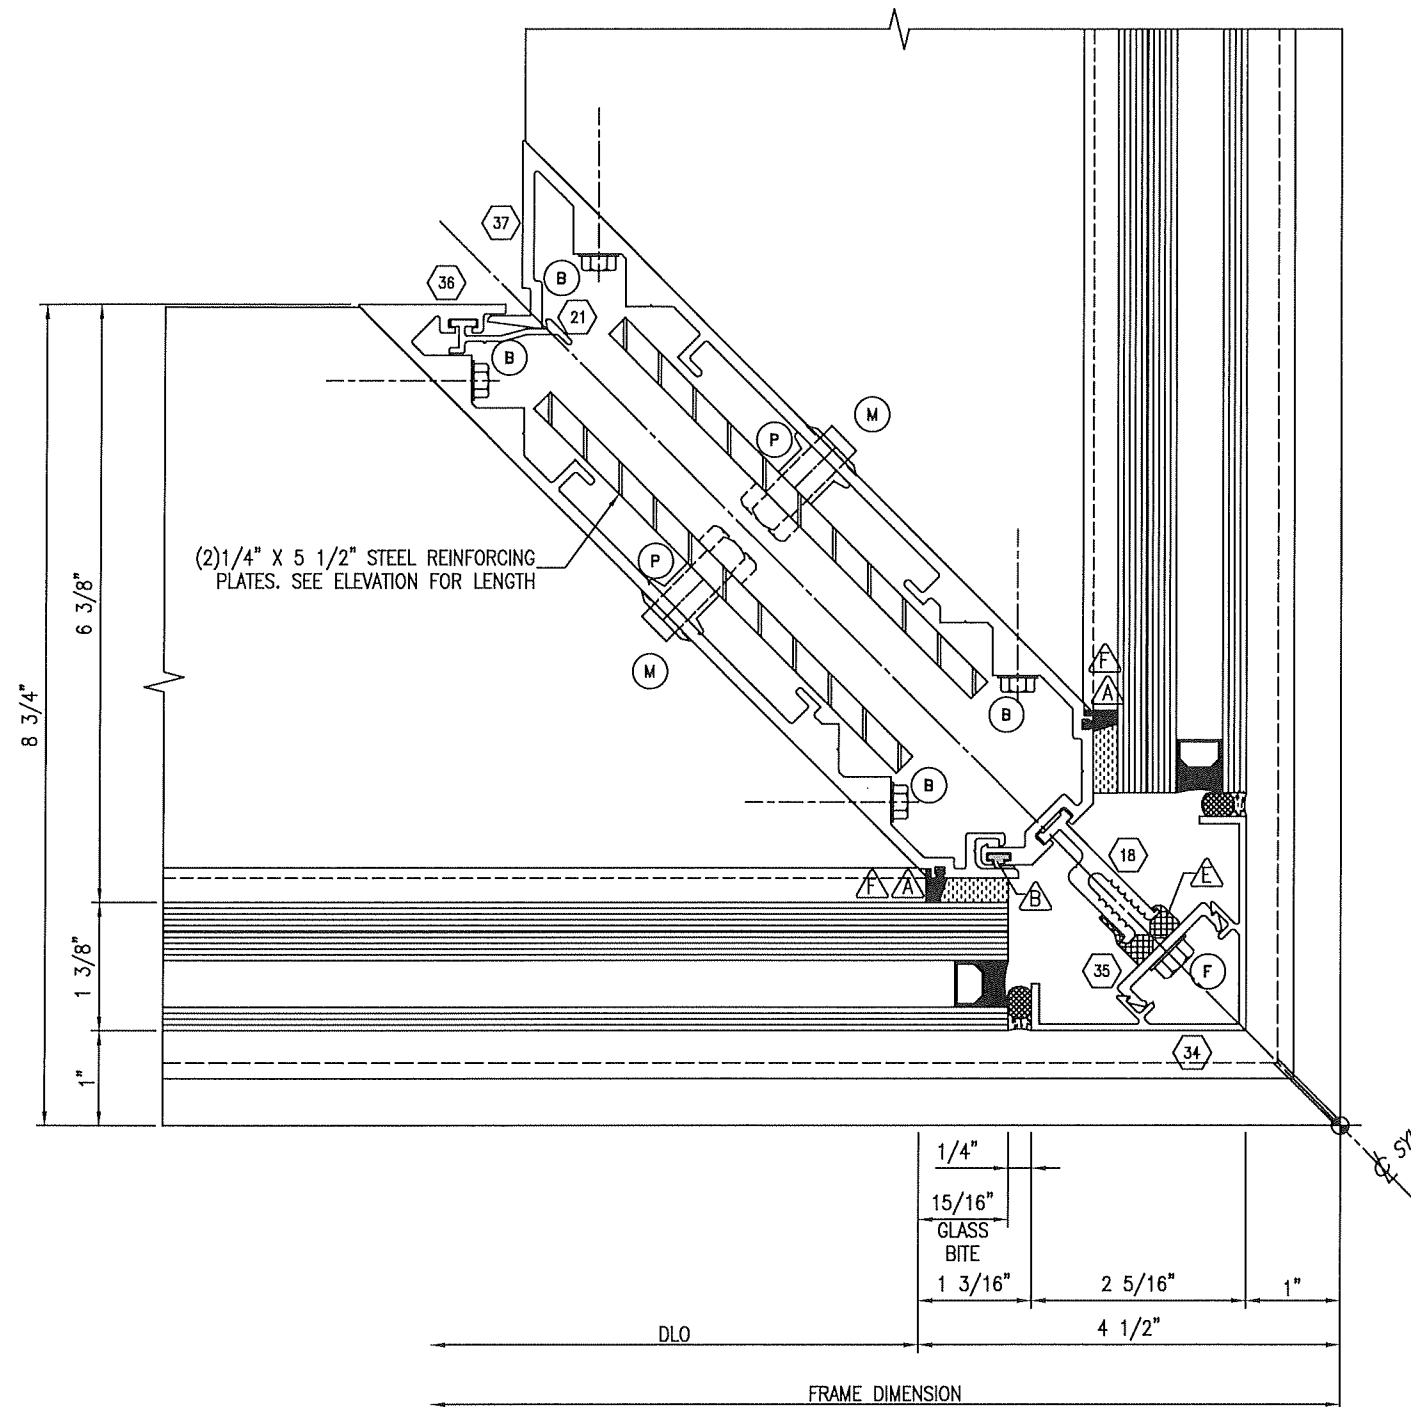

17 OUTSIDE CORNER
SCALE: FULL

GENERAL NOTES:

- FOR PART IDENTIFICATION REFER TO SHEET 2

- FOR GLAZING DETAILS, GLASS BITE & GASKET CONFIGURATIONS SEE SHEET 3.

- FASTENERS
- GASKETS
- ALUMINUM EXTRUSIONS

Larson Engineering, Inc.
3524 Labore Road
White Bear Lake, MN 55110
(P) 651.481.9120 (F) 651.481.9201

DADE CO. STAMP

PRODUCT REVISED
As complying with the Florida Building Code
NOA-No. **25-0902.03**
Expiration Date: **09/02/2029**
By: *Manuel Perez*
Miami-Dade Product Control

ENGINEER'S STAMP
ETHANA CHARPENTIER
LICENSED PROFESSIONAL ENGINEER
No. 65108
STATE OF FLORIDA
Professional Seal No. F-02000005478
Expiration Date 09/03/2029
Ethana Charpentier
Registration No. 65108


Harmon

HI 7000 LARGE MISSILE
CORNER DETAILS


DATE: 06/28/04	6	6/17/16
1 11/18/08	7	03/05/19
2 3/10/09	8	02/25/21
3 3/16/09	9	08/12/25
4 5/22/12		
5 10/03/14		

DWG. NO. HI7000LM

2" X 5" STEEL REINFORCING BAR
SEE ELEVATION FOR LENGTHS REQD.

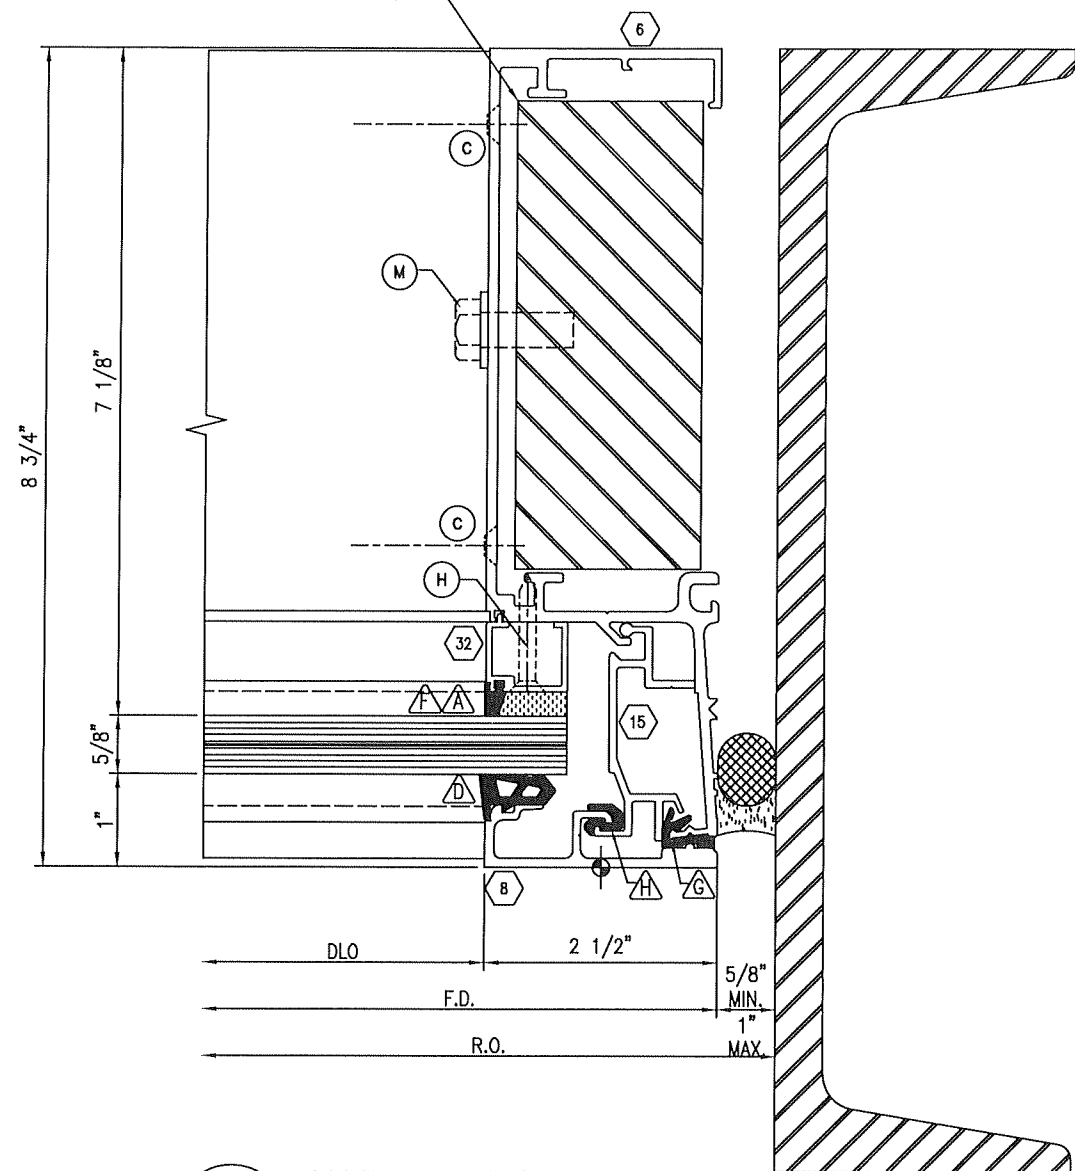

18 JAMB ~ MONOLITHIC
SCALE: FULL

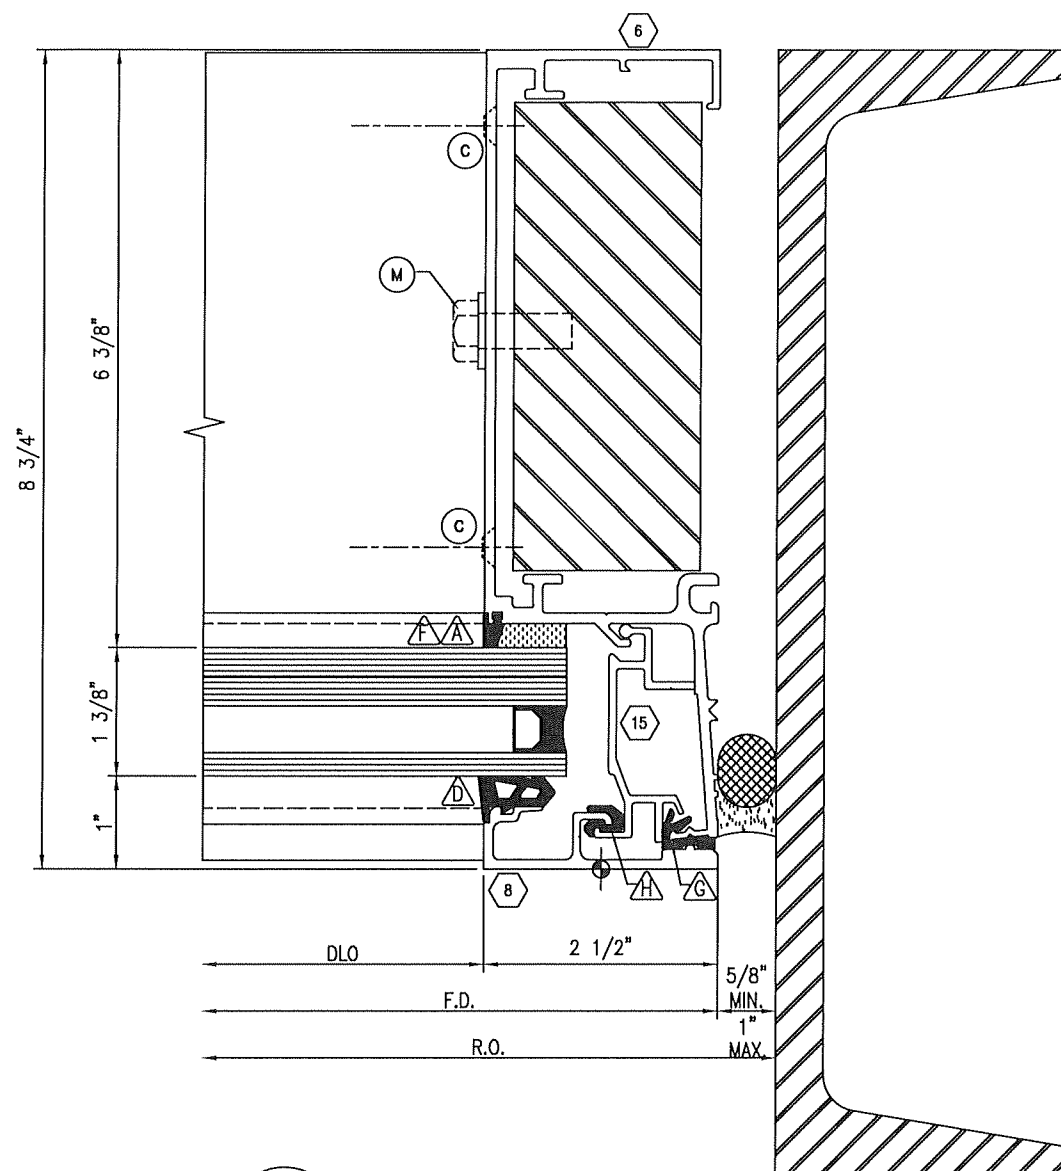

19 JAMB ~ INSULATED
SCALE: FULL

GENERAL NOTES:

- FOR PART IDENTIFICATION REFER TO SHEET 2

- FOR GLAZING DETAILS, GLASS BITE & GASKET CONFIGURATIONS SEE SHEET 3.

- FASTENERS
- △ GASKETS
- ⬡ ALUMINUM EXTRUSIONS

Larson Engineering, Inc.
3524 Labore Road
White Bear Lake, MN 55110
(P) 651.481.9120 (F) 651.481.9201

8.19.25

DADE CO. STAMP

PRODUCT REVISED
As complying with the Florida
Building Code
NOA-No. **25-0902.03**
Expiration Date: **09/02/2029**
By: *Manuel Perez*
Miami-Dade Product Control

ENGINEER STAMP
ETHAN A. CHARPENTIER
LICENSE
No. 65106
STATE OF
FLORIDA
Professional Engineer
Registration No. 65106



Harmon

HI 7000 LARGE MISSILE
VERTICAL DETAILS

DATE: 06/28/04	6	6/17/16	
1	11/18/08	7	03/05/19
2	3/10/09	8	02/25/21
3	3/16/09	9	08/12/25
4	5/22/12		
5	10/03/14		

DWG. NO. HI7000LM

SHEET 33 OF 41

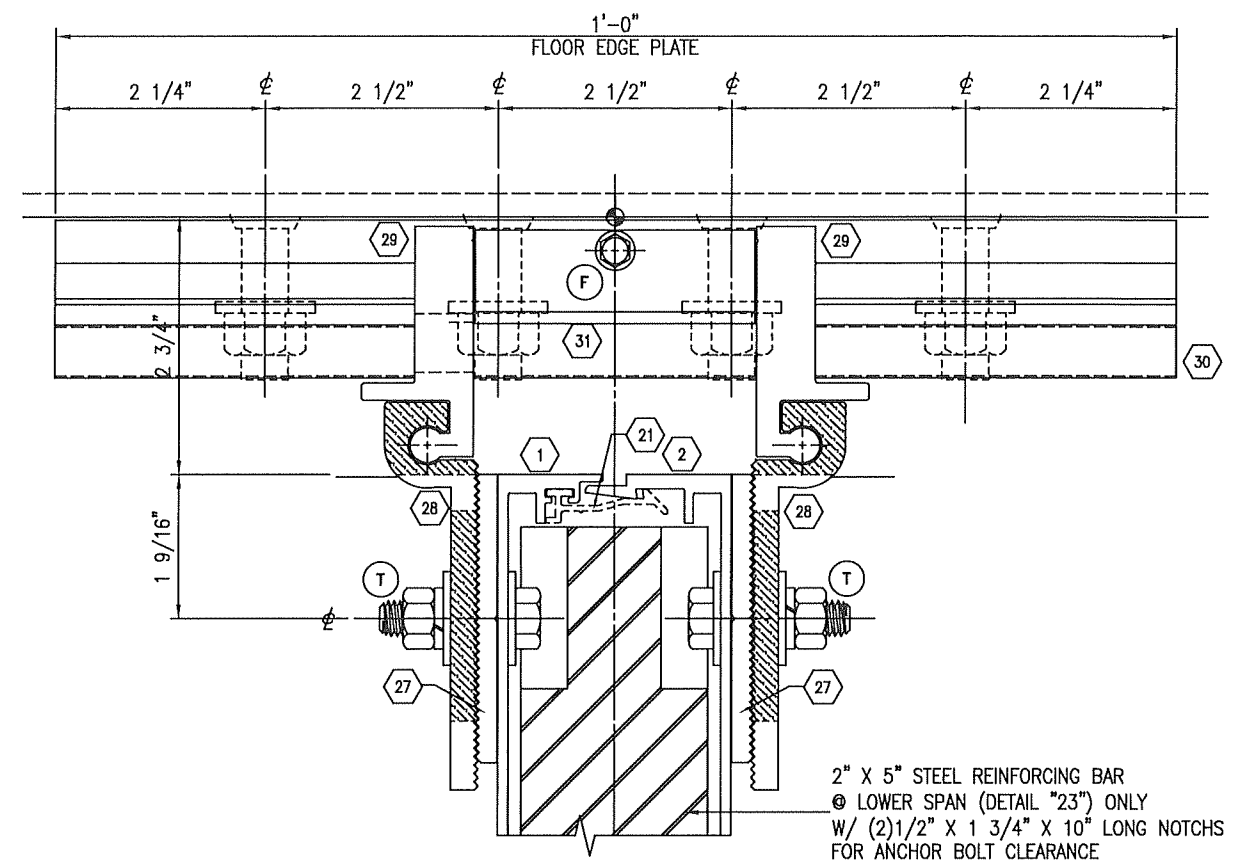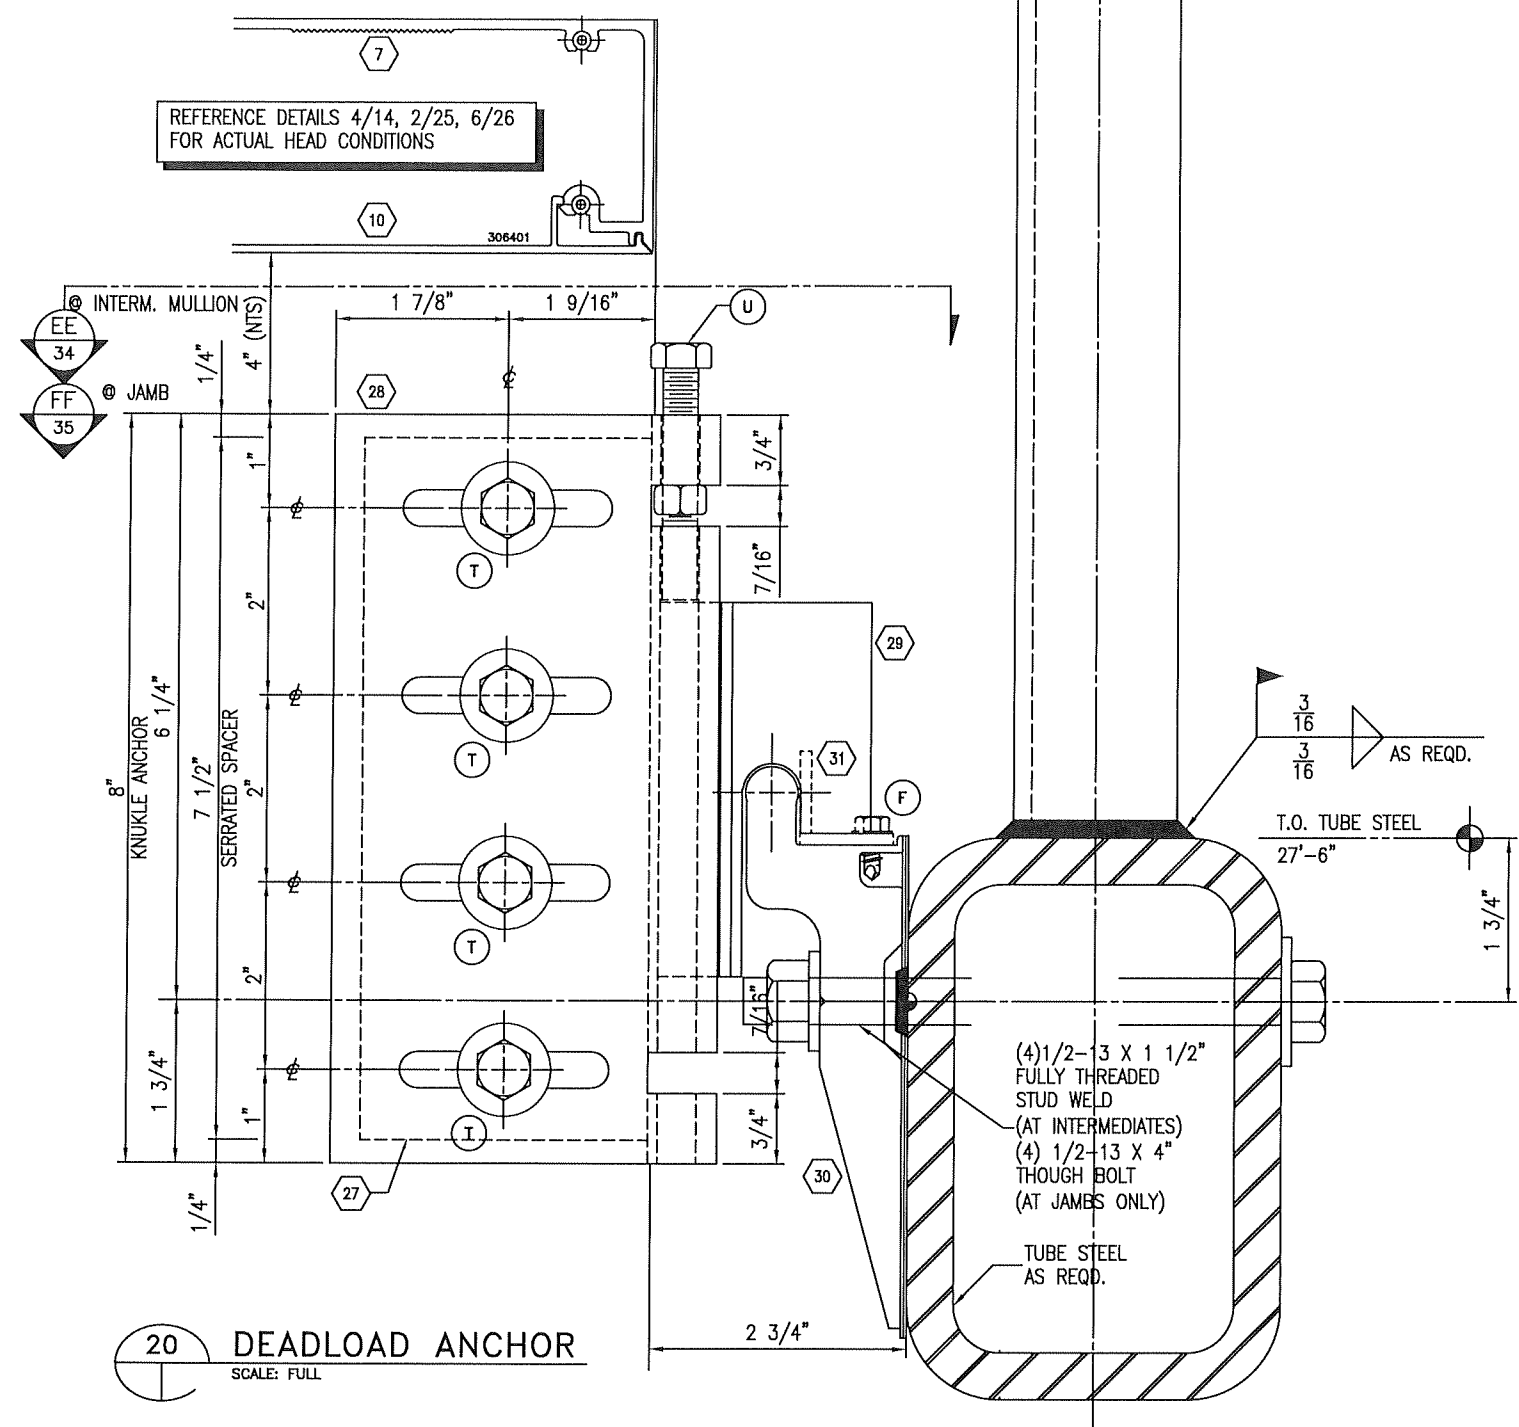

GENERAL NOTES:

- FOR PART IDENTIFICATION REFER TO SHEET 2
- FOR GLAZING DETAILS, GLASS BITE & GASKET CONFIGURATIONS SEE SHEET 3.

- FASTENERS
- GASKETS
- ALUMINUM EXTRUSIONS

Larson Engineering, Inc.
3524 Labore Road
White Bear Lake, MN 55110
(P) 651.481.9120 (F) 651.481.9201



DADE CO. STAMP

PRODUCT REVISED
As complying with the Florida Building Code
NOA-No. **25-0902.03**
Expiration Date: **09/02/2029**
By: *Manuel Perez*
Miami-Dade Product Control

ENGINEER'S STAMP
ETHAN A. SHARPER
LICENSE
No. 65108
STATE OF
Florida
Professional Engineer
Registration No. 65108

Harmon
HI 7000 LARGE MISSILE

ANCHOR DETAILS AND INTERMEDIATE ANCHOR SECTION	
DATE: 06/28/04	6/17/16
1 11/18/08	7 03/05/19
2 3/10/09	8 02/25/21
3 3/16/09	9 08/12/25
4 5/22/12	
5 10/03/14	
DWG. NO. HI7000LM	
SHEET 34 OF 41	

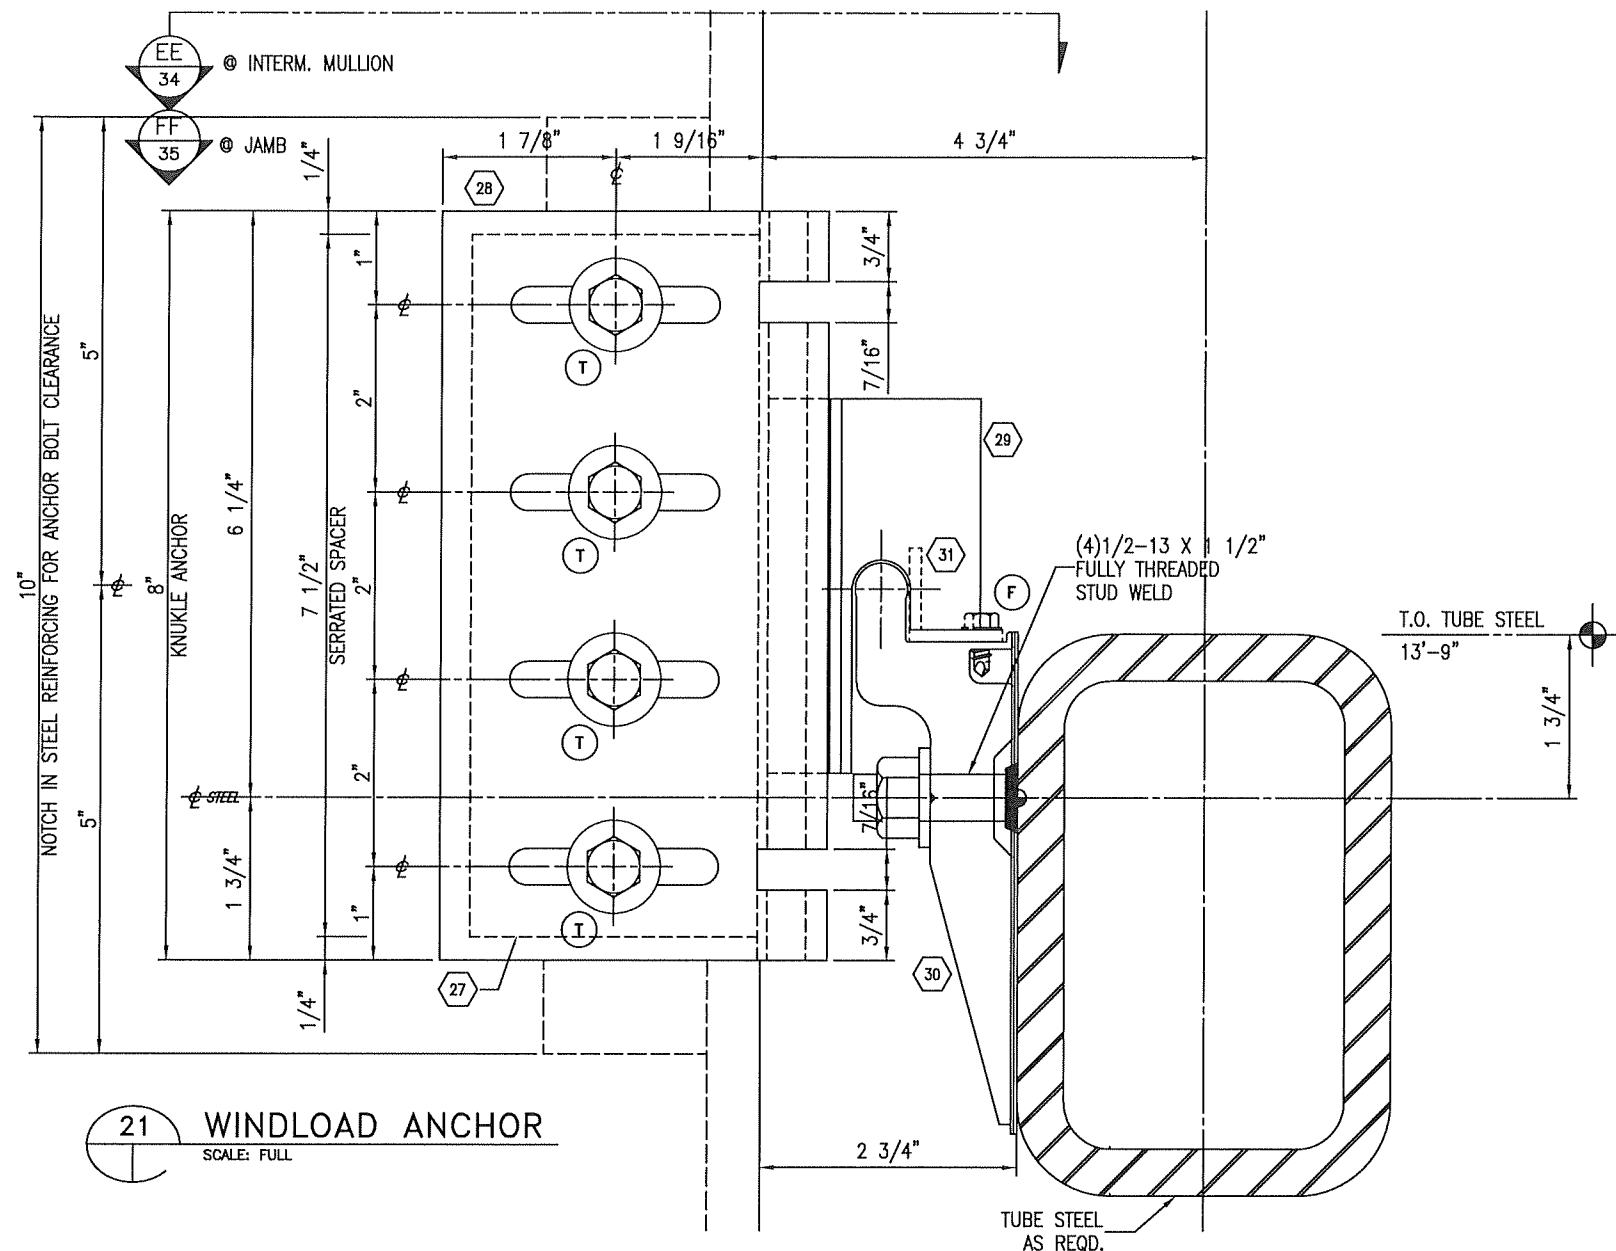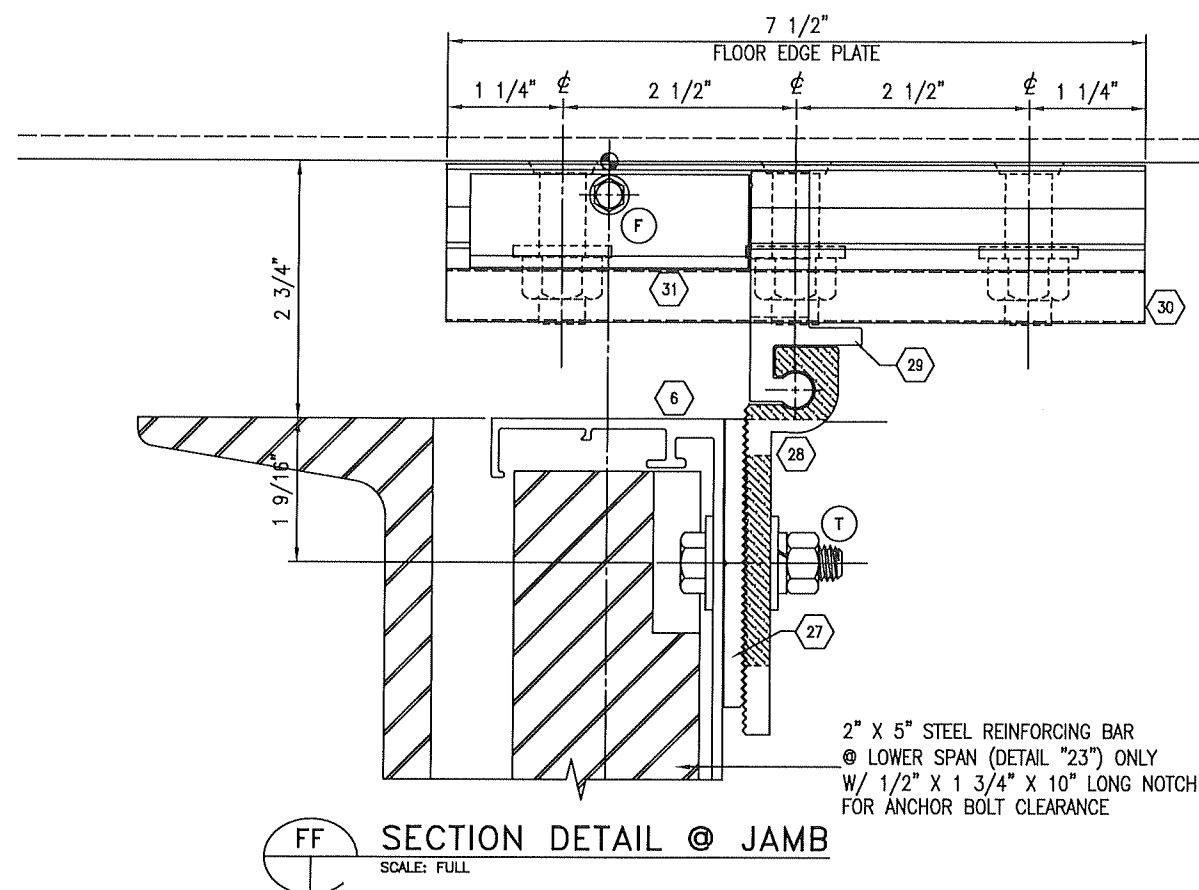

GENERAL NOTES:

- FOR PART IDENTIFICATION REFER TO SHEET 2

- FOR GLAZING DETAILS, GLASS BITE & GASKET CONFIGURATIONS SEE SHEET 3.

- FASTENERS
- △ GASKETS
- ⬡ ALUMINUM EXTRUSIONS

Larson Engineering, Inc.
3524 Labore Road
White Bear Lake, MN 55110
(P) 651.481.9120 (F) 651.481.9201

DADE CO. STAMP

PRODUCT REVISED
As complying with the Florida Building Code
NOA-No. **25-0902.03**
Expiration Date: **09/02/2029**

By: *Manuel Perez*
Miami-Dade Product Control

ENGINEER STAMP

ETHAN CHANDLER
No. 05105
STATE OF FLORIDA
Professional Engineer
Registration No. 155106

Harmon



HI 7000 LARGE MISSILE

ANCHOR DETAIL AND
JAMB ANCHOR SECTION CUT

DATE: 06/28/04	6/17/16
1 11/18/08	7 03/05/19
2 3/10/09	8 02/25/21
3 3/16/09	9 08/12/25
4 5/22/12	
5 10/03/14	

DWG. NO. HI7000LM

SHEET 35 OF 41

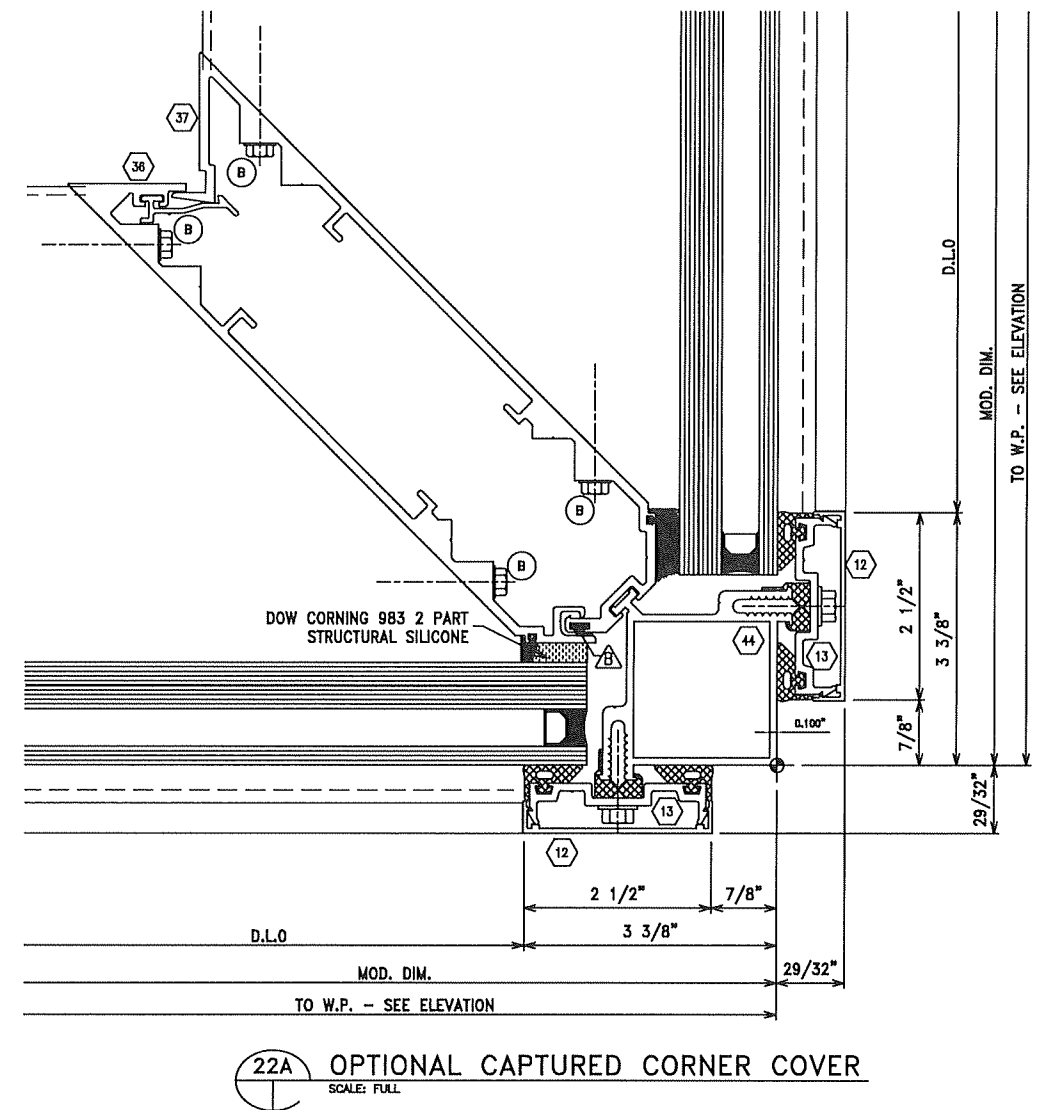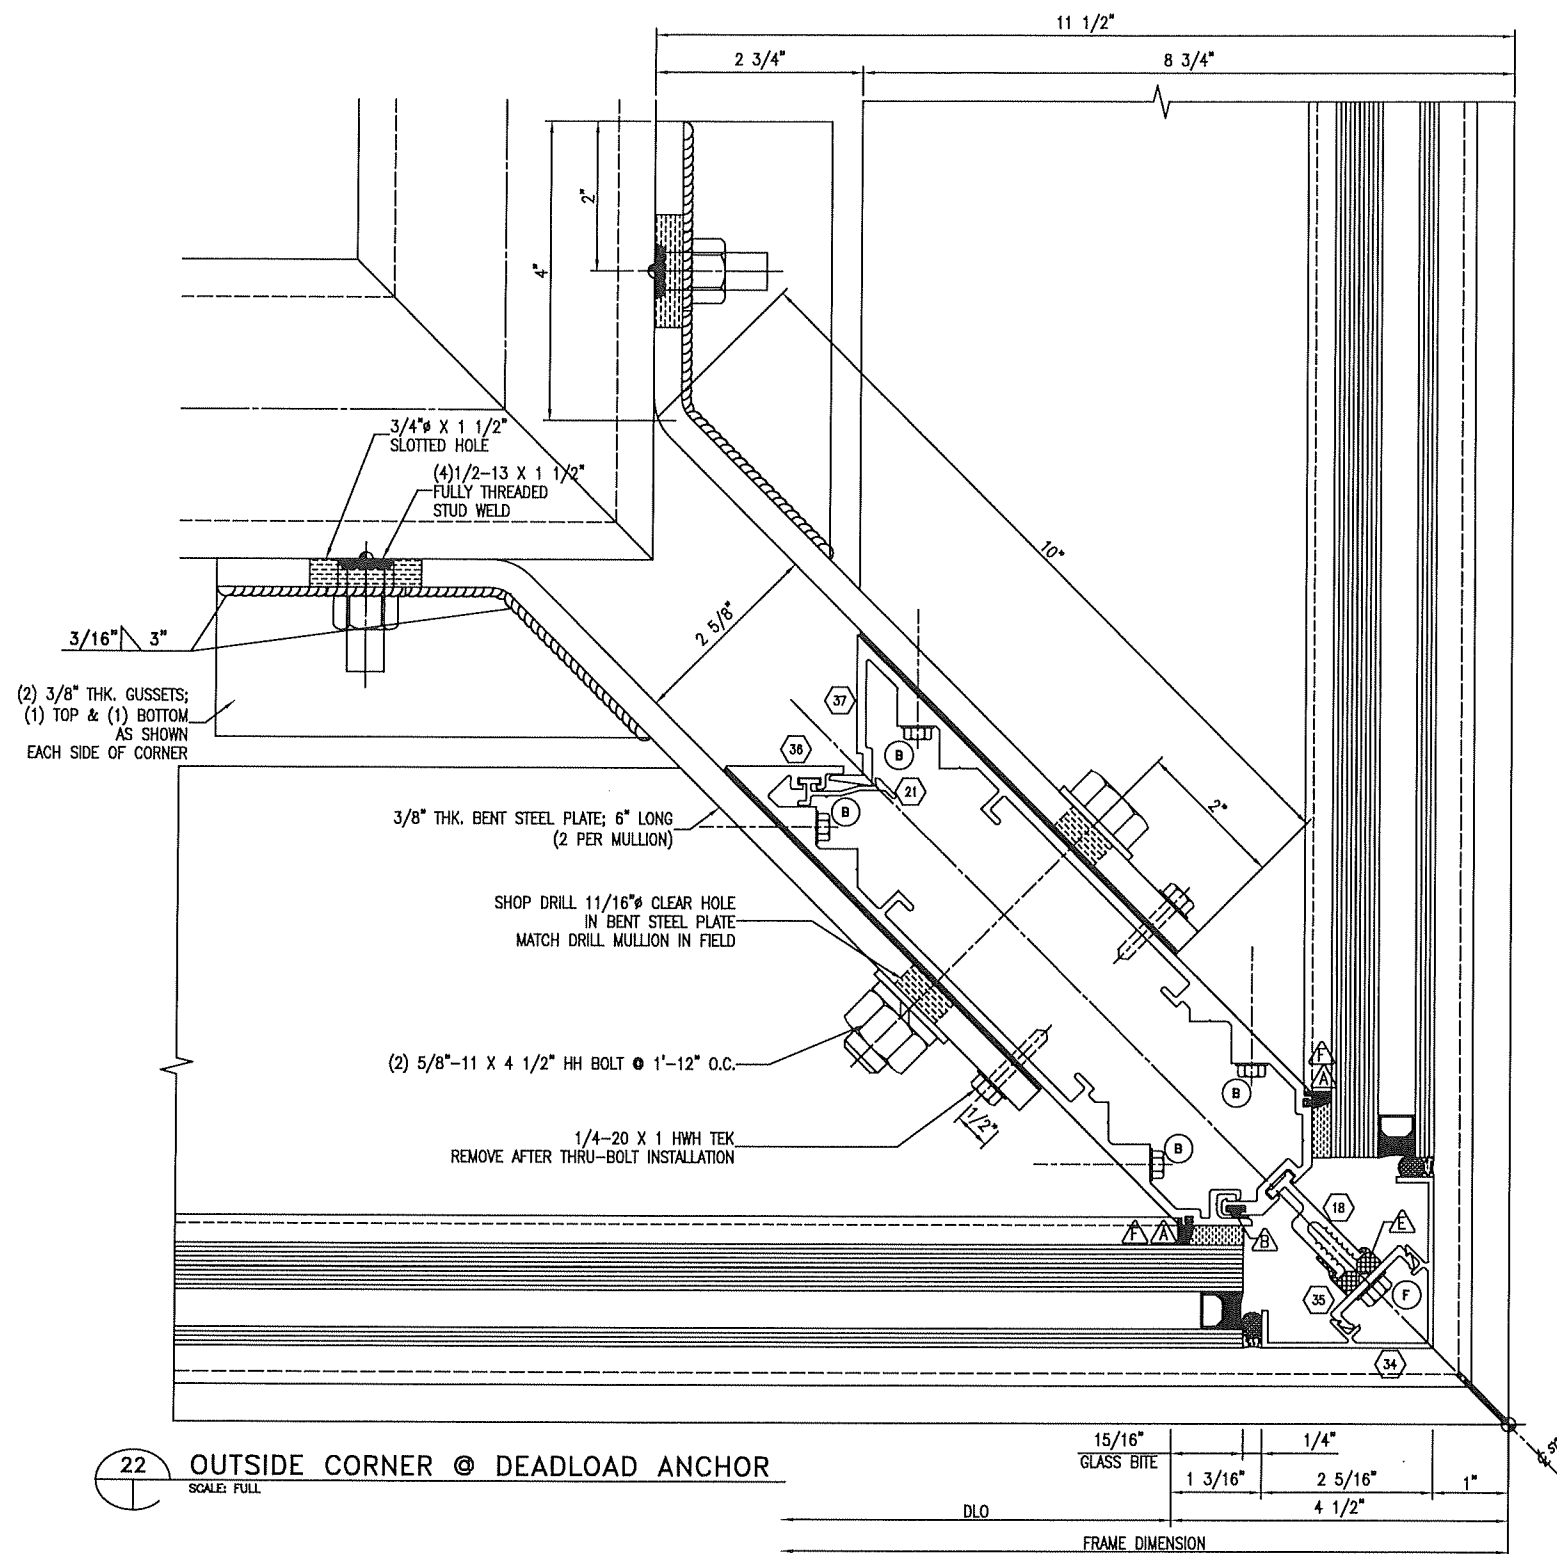

GENERAL NOTES:

- FOR PART IDENTIFICATION REFER TO SHEET 2

- FOR GLAZING DETAILS, GLASS BITE & GASKET CONFIGURATIONS SEE SHEET 3.

- FASTENERS
- △ GASKETS
- ⬡ ALUMINUM EXTRUSIONS

Larson Engineering, Inc.
3524 Labore Road
White Bear Lake, MN 55110
(P) 651.481.9120 (F) 651.481.9201

DADE CO. STAMP

PRODUCT REVISED
As complying with the Florida Building Code
NOA-No. **25-0902.03**
Expiration Date: **09/02/2029**
By: *Manuel Perez*
Miami-Dade Product Control

ENGINEER STAMP

ETHANA CHARPENTIER
No. 05108
STATE OF FLORIDA
Professional Engineer
Registration No. 05108


Harmon

HI 7000 LARGE MISSILE
CORNER ANCHOR DETAIL
OPTIONAL CORNER COVER

DATE: 06/28/04	6	6/17/16
1	11/18/08	7
2	3/10/09	8
3	3/16/09	9
4	5/22/12	
5	10/03/14	

DWG. NO. HI7000LM

SHEET 36 OF 41

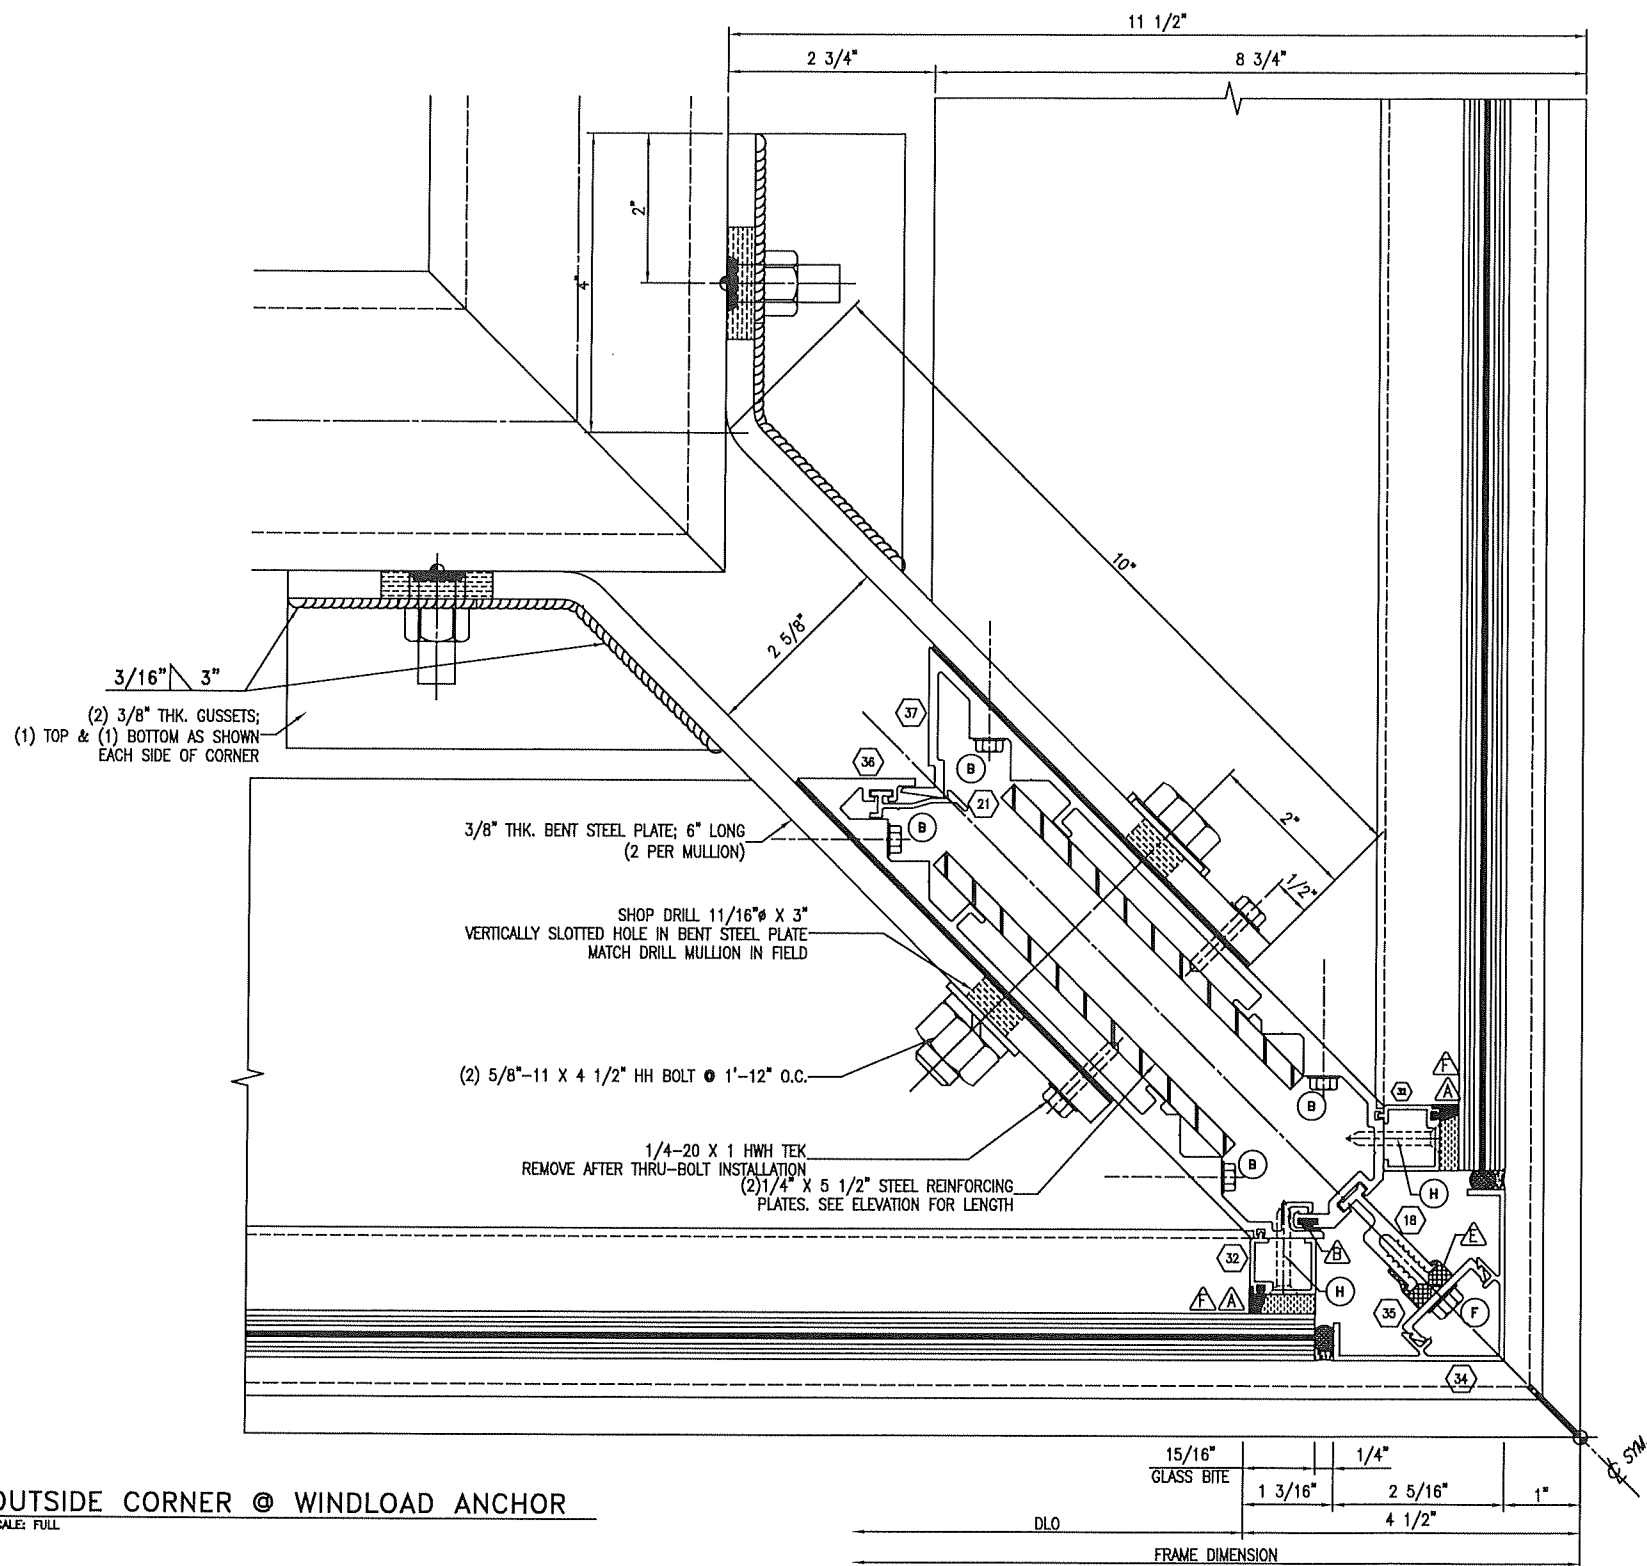

GENERAL NOTES:

- FOR PART IDENTIFICATION REFER TO SHEET 2

- FOR GLAZING DETAILS, GLASS BITE & GASKET CONFIGURATIONS SEE SHEET 3.

- FASTENERS
- △ GASKETS
- ⬡ ALUMINUM EXTRUSIONS



Larson Engineering, Inc.

3524 Labore Road
White Bear Lake, MN 55110
(P) 651.481.9120 (F) 651.481.9201

8.19.25

DADE CO. STAMP

PRODUCT REVISED
As complying with the Florida
Building Code
NOA-No. **25-0902.03**
Expiration Date: **09/02/2029**
By: *Manuel Perez*
Miami-Dade Product Control

ENGINEER'S STAMP

ETHAN A. CHARPENTIER
LICENSED PROFESSIONAL ENGINEER
No. 65108
STATE OF
Florida
Firm No. E-02000005125
Certificate of Authorization #0303
Ethan A. Charpentier
Registration No. 65108




Harmon

HI 7000 LARGE MISSILE
CORNER ANCHOR DETAIL

DATE: 06/28/04	6	6/17/16	
1	11/18/08	7	03/05/19
2	3/10/09	8	02/25/21
3	3/16/09	9	08/12/25
4	5/22/12		
5	10/03/14		

DWG. NO. HI7000LM

SHEET 37 OF 41

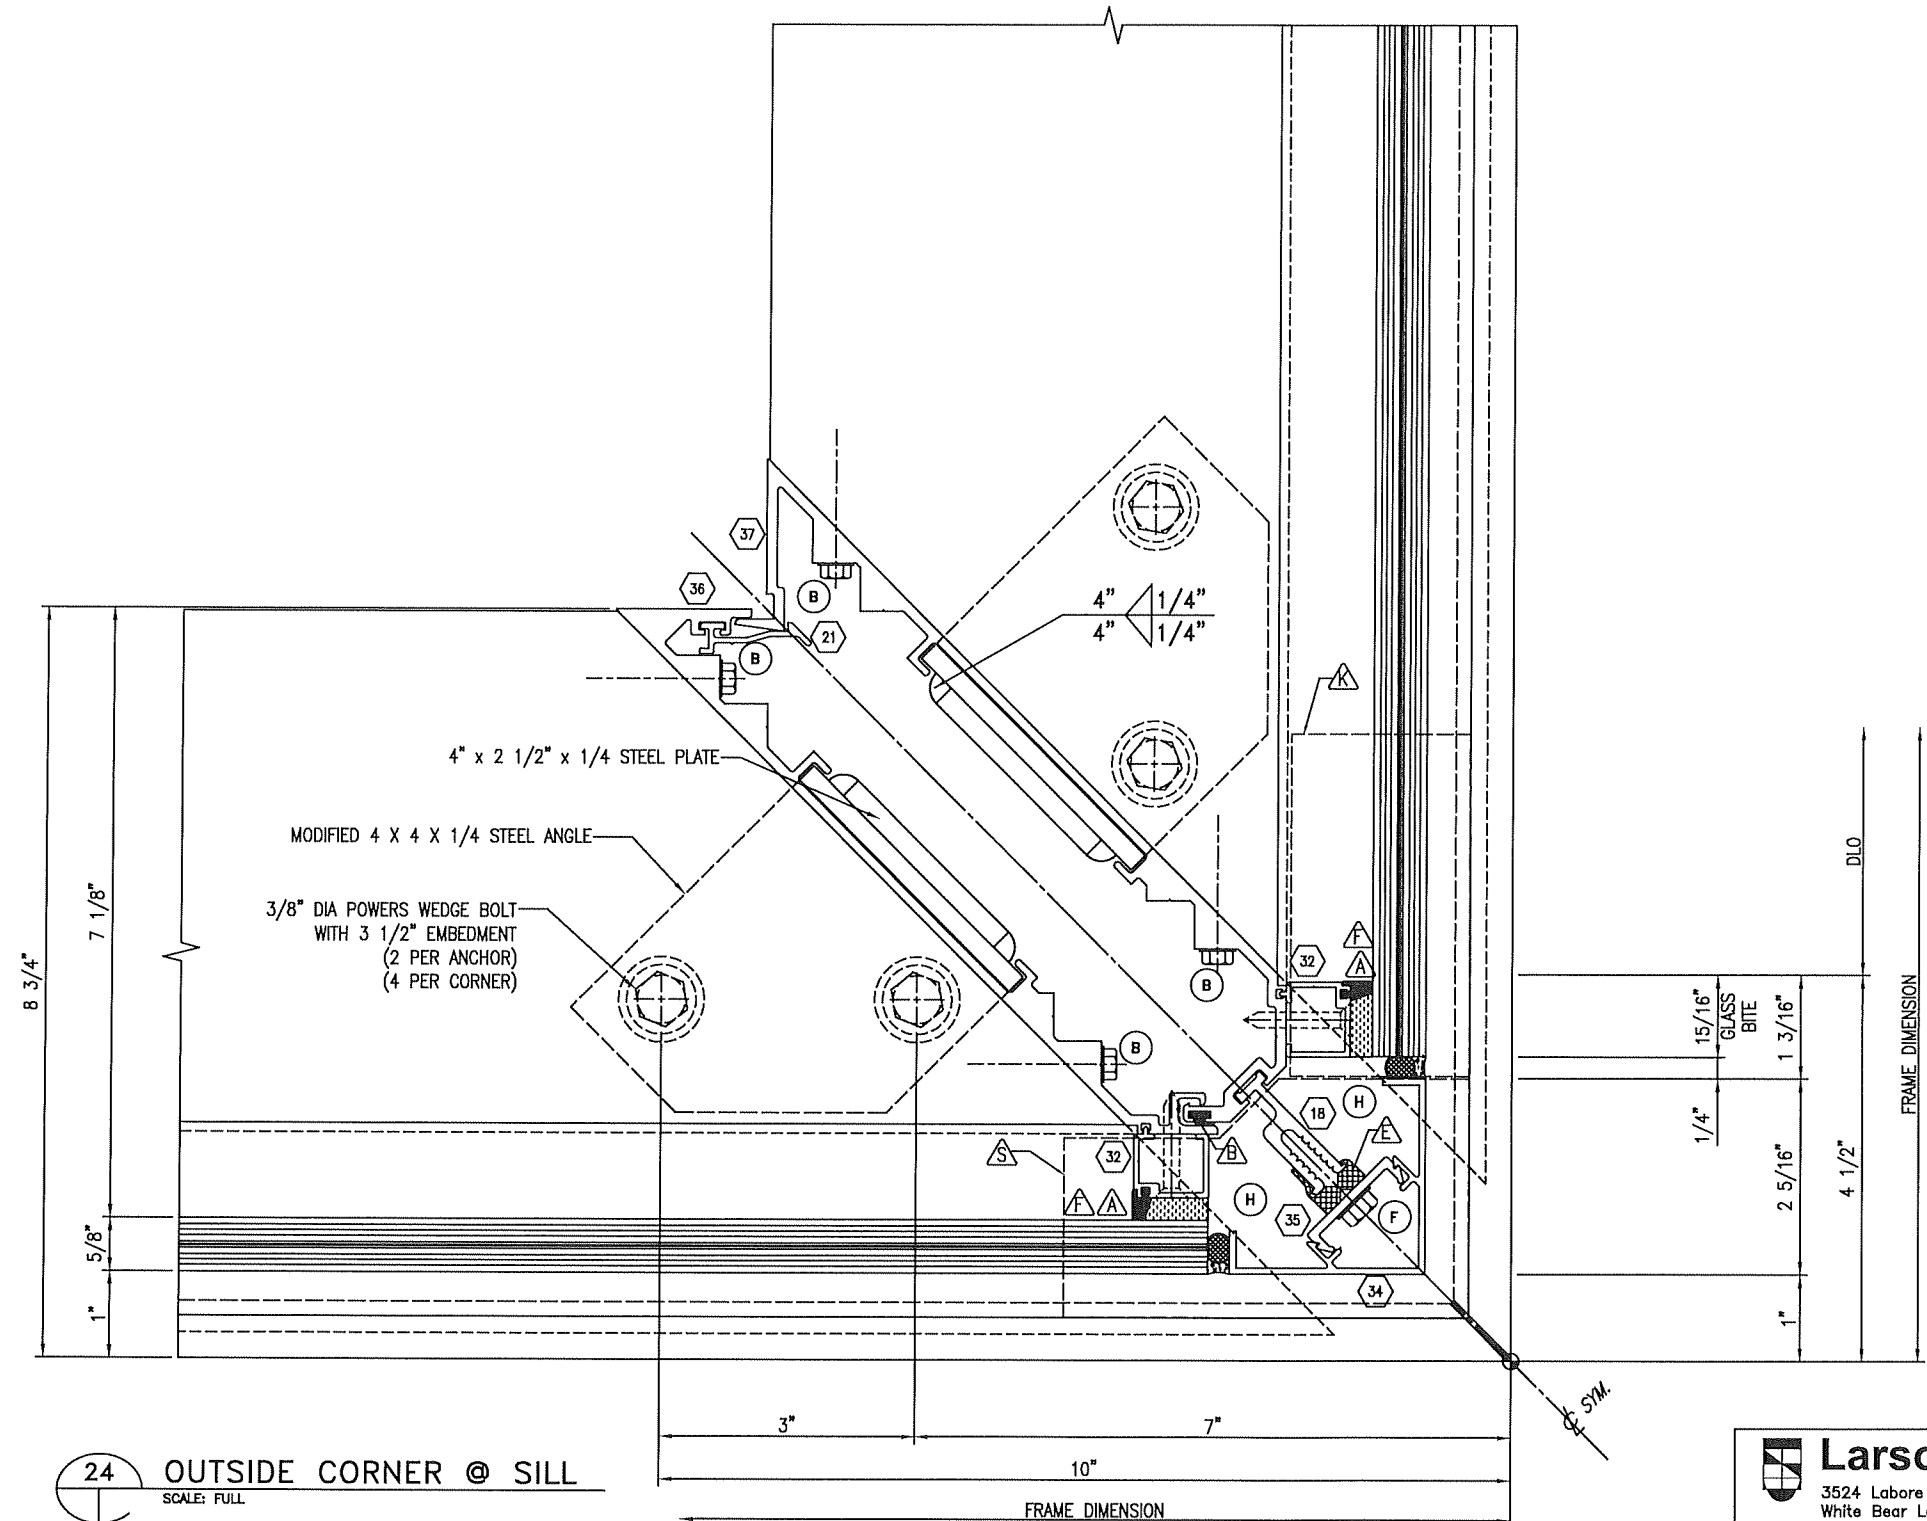

24 OUTSIDE CORNER @ SILL
SCALE: FULL

GENERAL NOTES:

- FOR PART IDENTIFICATION REFER TO SHEET 2

- FASTENERS
- GASKETS
- ALUMINUM EXTRUSIONS

- FOR GLAZING DETAILS, GLASS BITE & GASKET CONFIGURATIONS SEE SHEET 3.

Larson Engineering, Inc.
3524 Labore Road
White Bear Lake, MN 55110
(P) 651.481.9120 (F) 651.481.9201

DADE CO. STAMP

PRODUCT REVISED
As complying with the Florida Building Code
NOA-No. **25-0902.03**
Expiration Date: **09/02/2029**
By: *Manuel Perez*
Miami-Dade Product Control


ENGINEER STAMP
No. 65108
STATE OF FLORIDA
PROFESSIONAL ENGINEER
ETHAN A. SHAPIRO
Florida Firm No. P-30200003
Certification Authorization 0986
Ethan A. Shapiro
Registration No.

Harmon

HI 7000 LARGE MISSILE
CORNER ANCHOR DETAIL

DATE: 06/28/04		6	6/17/16
1	11/18/08	7	03/05/19
2	3/10/09	8	02/25/21
3	3/16/09	9	08/12/25
4	5/22/12		
5	10/03/14		

DWG. NO. HI7000LM
SHEET 38 OF 41

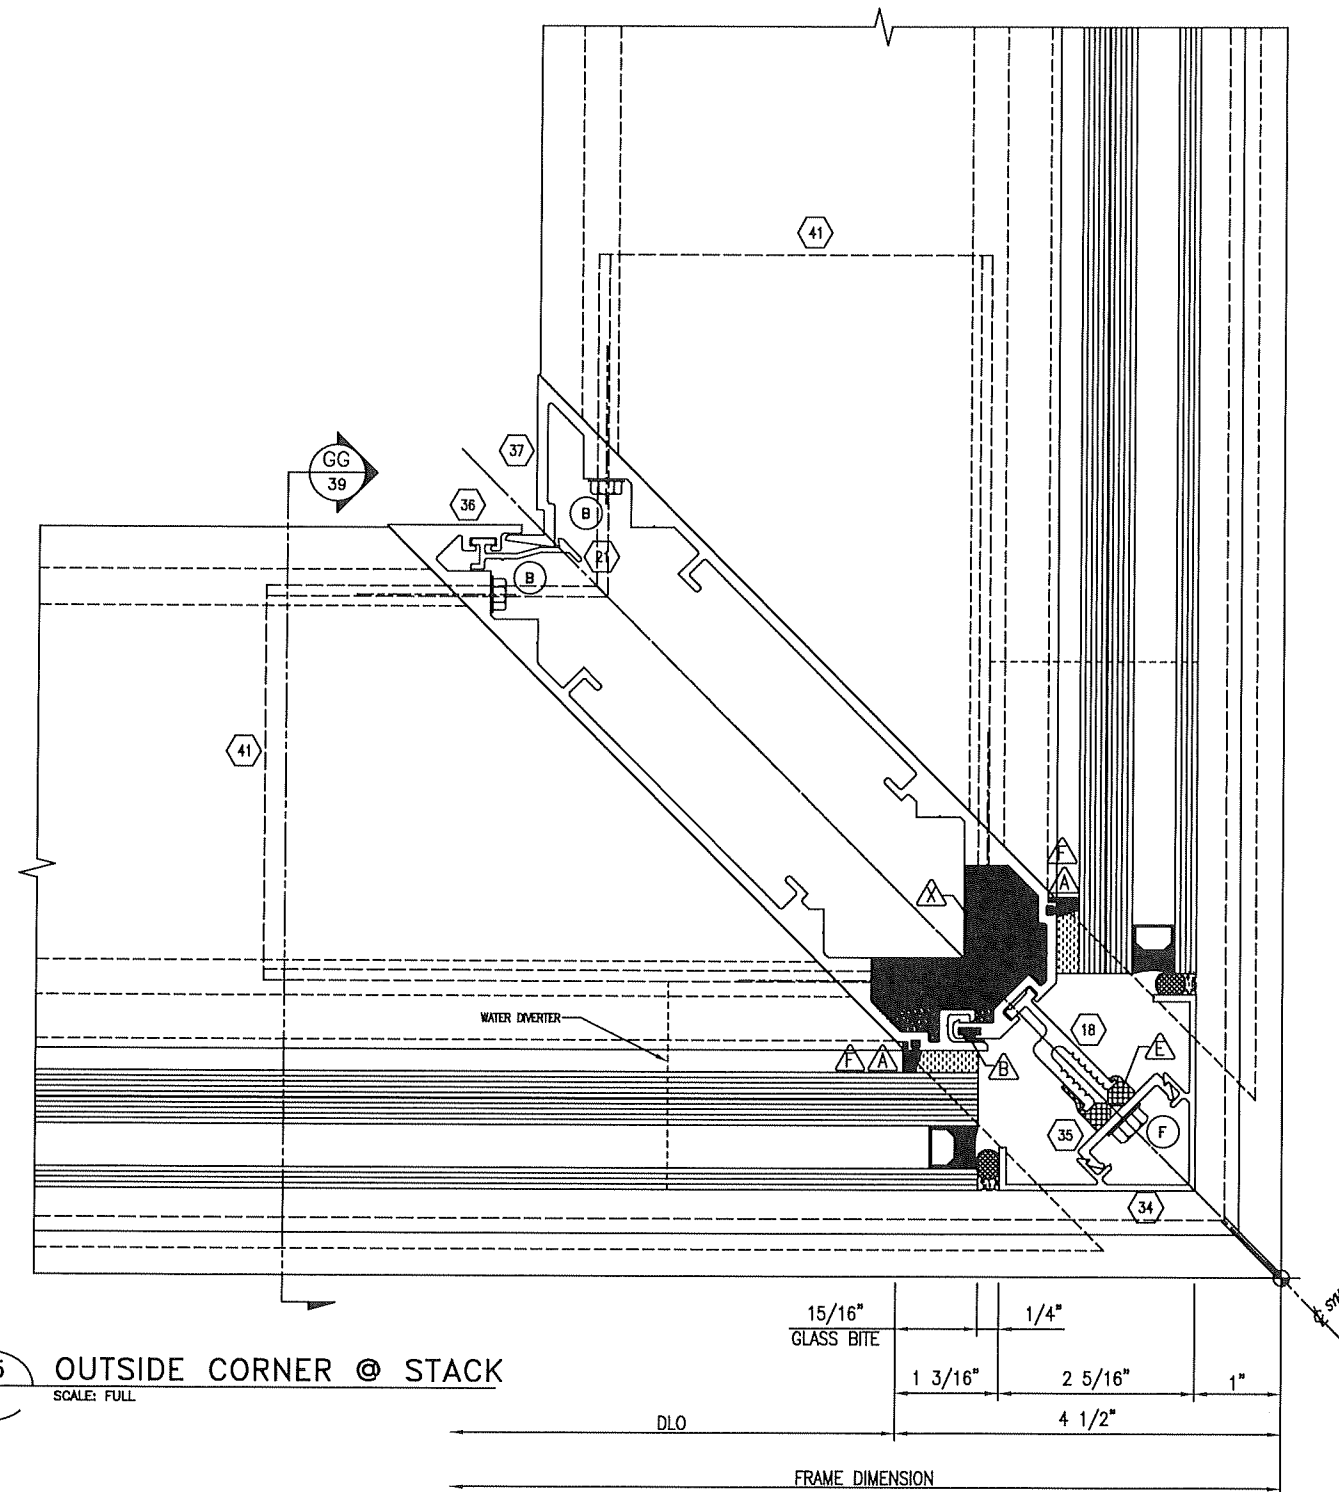


25 OUTSIDE CORNER @ STACK
SCALE: FULL

GENERAL NOTES:

— FOR PART IDENTIFICATION REFER TO SHEET 2

- FASTENERS
- △ GASKETS
- ⬡ ALUMINUM EXTRUSIONS

— FOR GLAZING DETAILS, GLASS BITE & GASKET CONFIGURATIONS SEE SHEET 3.

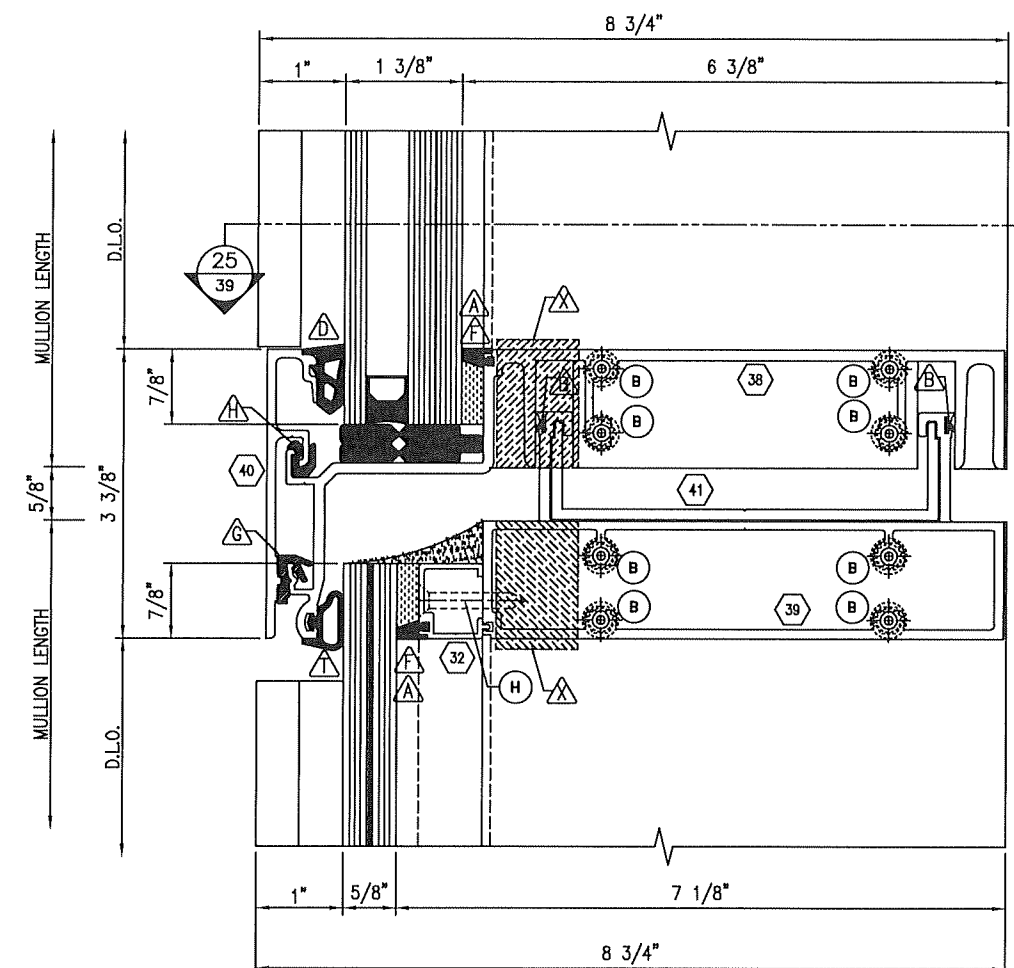

GG STACK HORIZONTAL @ CORNER
SCALE: FULL



Larson Engineering, Inc.

3524 Labore Road
White Bear Lake, MN 55110
(P) 651.481.9120 (F) 651.481.9201

DADE CO. STAMP

PRODUCT REVISED
As complying with the Florida
Building Code
NOA-No. **25-0902.03**
Expiration Date: **09/02/2029**
By: *Manuel Perez*
Miami-Dade Product Control

ENGINEER'S CHAMP

ETHAN A. CHAMP
LICENSE
No. 65108
STATE OF
FLORIDA
PROFESSIONAL ENGINEER
Registration No. 165108

Harmon

HI 7000 LARGE MISSILE


CORNER ANCHOR AND
SECTION CUT AT STACK HORIZ.

DATE: 06/28/04	6/17/16
1 11/18/08	7 03/05/19
2 3/10/09	8 02/25/21
3 3/16/09	9 08/12/25
4 5/22/12	
5 10/03/14	


DWG. NO. HI7000LM

SHEET 39 OF 41

(2) 3/8" DIA POWERS WEDGE BOLT @ SILL
(2) 3/8" DIA HH GRADE 5 THRU BOLT ASSY. @ HEAD

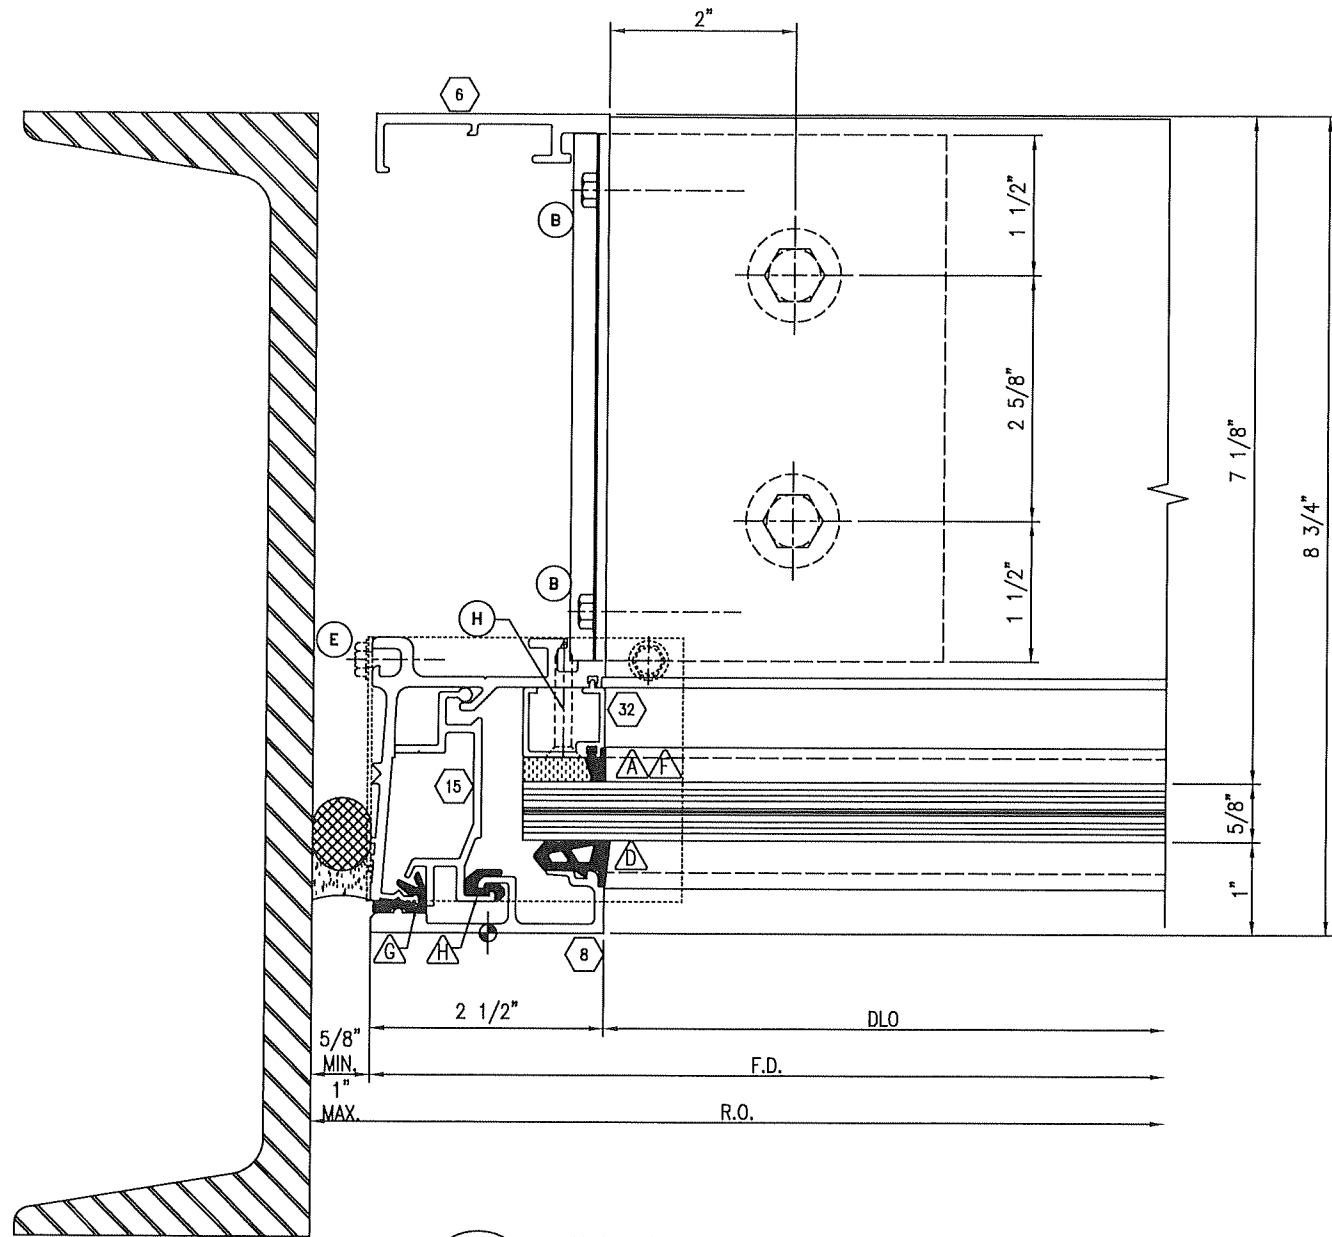

26 SILL ANCHOR @ JAMB
SCALE: FULL

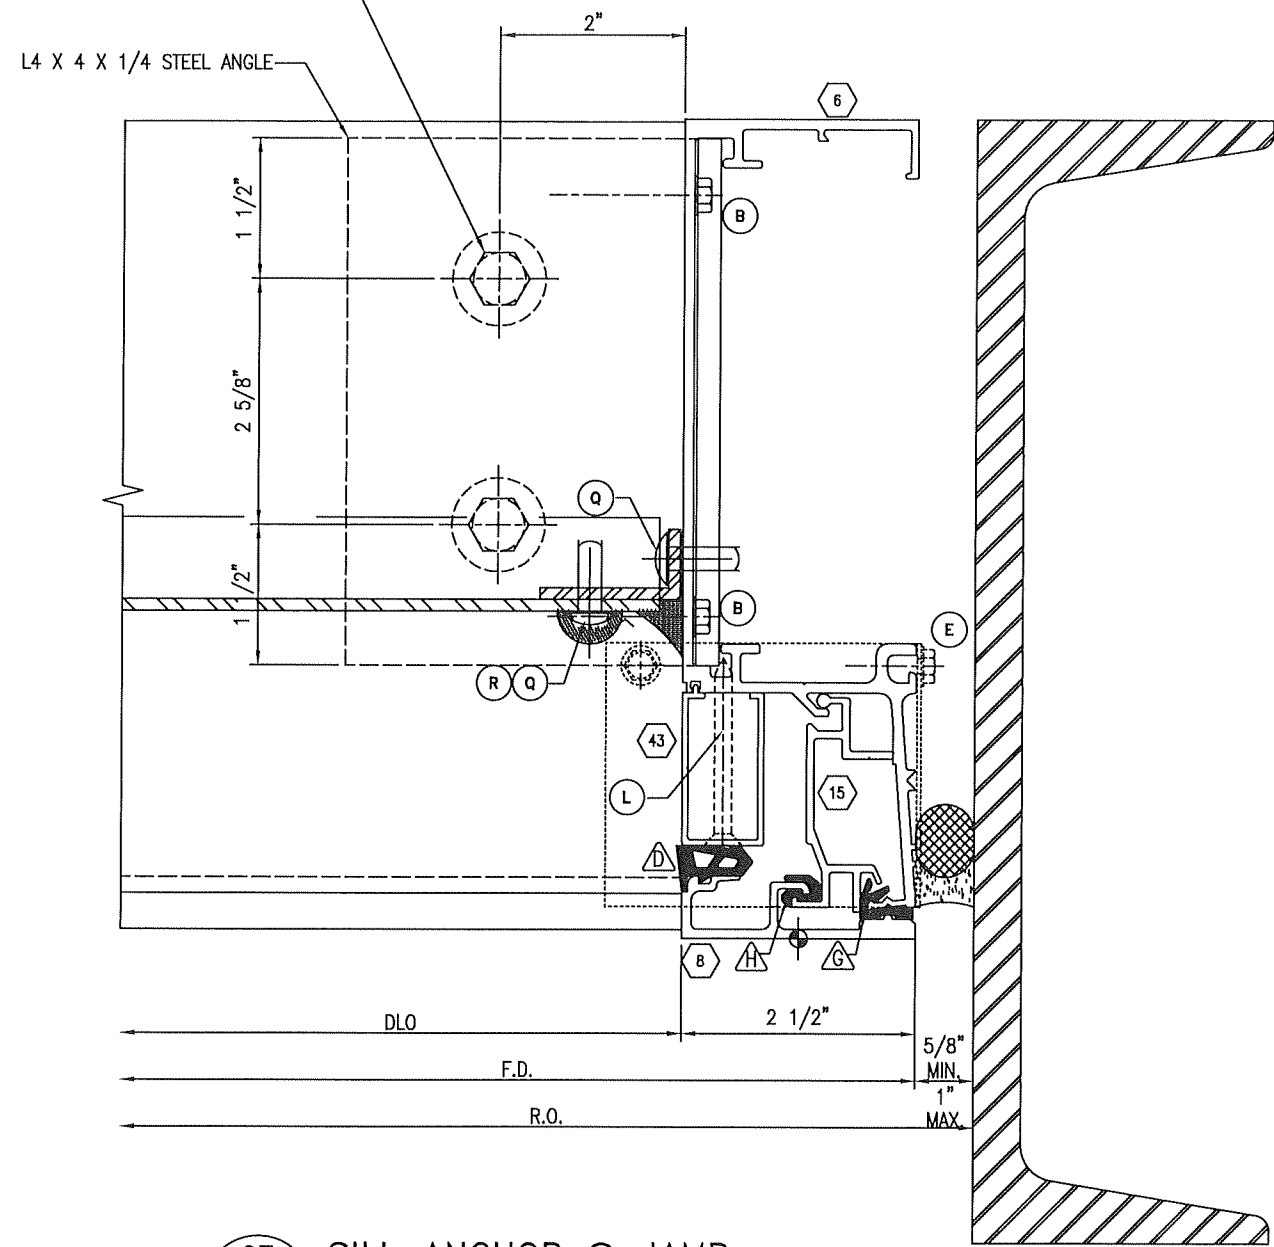

27 SILL ANCHOR @ JAMB
SCALE: FULL

GENERAL NOTES:

- FOR PART IDENTIFICATION REFER TO SHEET 2

- FOR GLAZING DETAILS, GLASS BITE & GASKET CONFIGURATIONS SEE SHEET 3.

- FASTENERS
- GASKETS
- ALUMINUM EXTRUSIONS

Larson Engineering, Inc.
3524 Labore Road
White Bear Lake, MN 55110
(P) 651.481.9120 (F) 651.481.9201

8.19.25

DADE CO. STAMP

ENGINEER STAMP

PRODUCT REVISED
As complying with the Florida Building Code
NOA-No. **25-0902.03**
Expiration Date: **09/02/2029**
By: *Manuel Perez*
Miami-Dade Product Control


ETHAN A. SCAMP
No. 65108
STATE OF FLORIDA
PROFESSIONAL ENGINEER
Florida Exp. No. 040100005175
Certification Authorization 44563
Ethan A. Scamp
Registration 12/2019

Harmon


HI 7000 LARGE MISSILE
VERTICAL DETAILS

DATE: 06/28/04		6	6/17/16
1	11/18/08	7	03/05/19
2	3/10/09	8	02/25/21
3	3/16/09	9	08/12/25
4	5/22/12		
5	10/03/14		


DWG. NO. HI7000LM

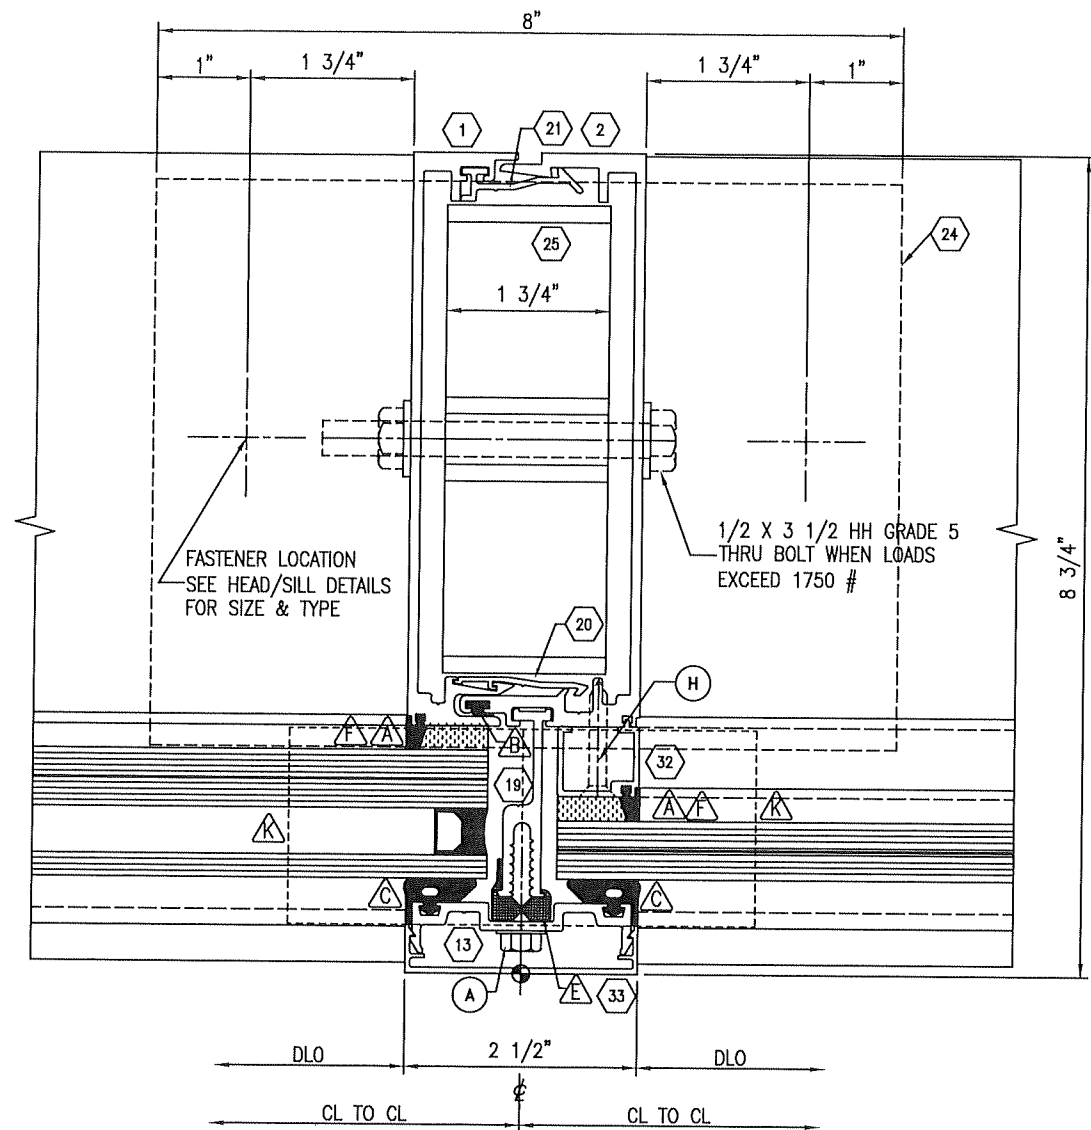

28 SILL ANCHOR @ MULLION
SCALE: FULL

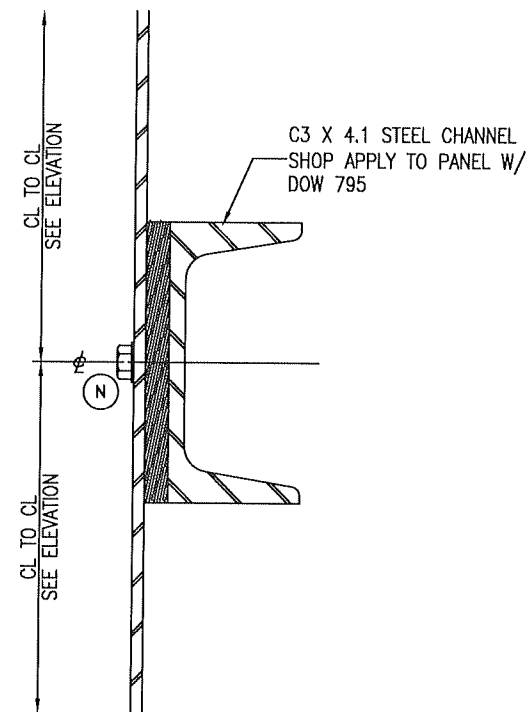

29 BACK-PAN STIFFENER
SCALE: FULL

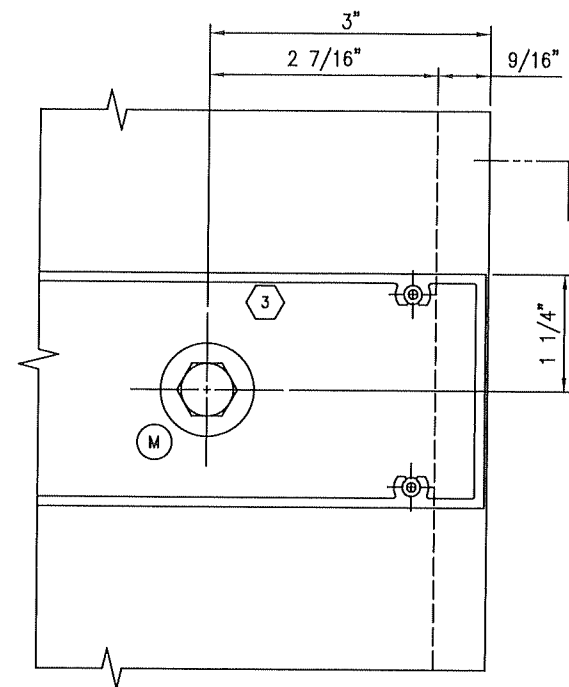

30 REINF. ATTACHMENT
SCALE: FULL

GENERAL NOTES:

- FOR PART IDENTIFICATION REFER TO SHEET 2

- FASTENERS
- △ GASKETS
- ⬡ ALUMINUM EXTRUSIONS

- FOR GLAZING DETAILS, GLASS BITE & GASKET CONFIGURATIONS SEE SHEET 3.

Larson Engineering, Inc.
3524 Labore Road
White Bear Lake, MN 55110
(P) 651.481.9120 (F) 651.481.9201

DADE CO. STAMP

PRODUCT REVISED
As complying with the Florida Building Code
NOA-No. **25-0902.03**
Expiration Date: **09/02/2029**
By: *Manuel Perez*
Miami-Dade Product Control

ENGINEER STAMP
No. 65108
STATE OF FLORIDA
PROFESSIONAL ENGINEER
ETHAN STARR
Registration No. 65108

Harmon

HI 7000 LARGE MISSILE
SILL ANCHOR DETAIL, STIFFENER
DETAIL & REINF. ATTACHMENT
DATE: 06/28/04 6/17/16
1 11/18/08 7 03/05/19
2 3/10/09 8 02/25/21
3 3/16/09 9 08/12/25
4 5/22/12
5 10/03/14
DWG. NO. HI7000LM
SHEET 41 OF 41