



MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
 11805 SW 26 Street, Room 208
 Miami, Florida 33175-2474
 T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/building

DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
 BOARD AND CODE ADMINISTRATION DIVISION
NOTICE OF ACCEPTANCE (NOA)

Custom Window Systems, Inc.
 1900 SW 44th Avenue
 Ocala, FL 34474

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER - Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/ or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "7200 (Flange Frame)" Aluminum Horizontal Sliding Window – L.M.I.

APPROVAL DOCUMENT: Drawing No. CWS-1250 Rev A (former L8700-0901), titled "7200 Aluminum Horizontal Slider Flange Frame", sheets 1 through 10 of 10, dated 12/18/2023 and last revised on SEP 25, 2025, prepared by manufacturer, and signed and sealed by Thomas J. Sotos, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

Limitations:

1. See Sheet 2 for overall maximum Frame width and Frame Height for Window configuration for charts on sheets 6, 7 and 8. Also, see sheet 2 for max DLO of fixed middle lite for XOX configuration.
2. See glazing options in sheet 9. The specified monolithic Annealed, HS or tempered in Insulated make up are in Exterior side. Laminated glass type I interlayer is Saflex w/ PET core.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/ or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA No. 23-1010.04 (Lawson Industries, LLC) and consists of this page 1 and evidence pages E-1, E-2, E-3, E-4, E-5, E-6, E-7 and E-8, as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P.E.**



I
10/15/25

NOA No. 25-0929.04
 Expiration Date: April 11, 2027
 Approval Date: October 23, 2025
 Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's

A. DRAWINGS

1. Manufacturer's die drawings and sections.
(Submitted under NOA No. 02-0227.05)
2. Drawing No. **L8700-0901**, titled "HS-8700 Horizontal Rolling Flange Impact Window", sheets 1 through 10 of 10, dated 05/30/09, with revision **H** dated 06/24/22, prepared by manufacturer, signed and sealed by Thomas J. Sotos, P.E.
(Submitted under NOA No. 22-0719.02)

B. TESTS

1. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of 3 specimens of a series 8700 impact horizontal rollers, XO configuration, prepared by QAI Laboratories, Test Report No. **QAI-13097**, dated 06/20/22, signed and sealed by Idalmis Ortega, P.E.
(Submitted under NOA No. 22-0719.02)
2. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94
along with marked-up drawings and installation diagram of 3 specimens of an aluminum horizontal sliding window, XO configuration, prepared by National Certified Testing Laboratories, Test Report No. **NCTL-210-4148-01**, dated 06/04/21, signed and sealed by Douglas J. McDougall, P.E.
(Submitted under NOA No. 22-0118.01)
3. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94
along with marked-up drawings and installation diagram of a series HS-8700 flange frame aluminum horizontal sliding window, XO and XOX configurations, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-10715**, dated 05/08/19, signed and sealed by Idalmis Ortega, P.E.
(Submitted under NOA No. 19-0708.09)

Ishaq I. Chanda


Ishaq I. Chanda, P.E.
Product Control Unit Supervisor
NOA No. 25-0929.04
Expiration Date: April 11, 2027
Approval Date: October 23, 2025

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. **EVIDENCE SUBMITTED UNDER PREVIOUS NOA's (CONTINUED)**

B. **TESTS (CONTINUED)**

4. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, per FBC 2411.3.2.1, and TAS 202-94
along with marked-up drawings and installation diagram of an aluminum horizontal sliding window, XOX (1/4-1/2-1/4 and 1/3-1/3-1/3) configuration, prepared by Hurricane Engineering & Testing, Inc., Test Reports No. **HETI-10-3049** and **HETI-10-3051**, dated 03/23/11, signed and sealed by Candido F. Font, P.E.
(Submitted under NOA No. 11-0705.10)
5. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
along with marked-up drawings and installation diagram of 8 specimens of an aluminum horizontal sliding window, XOX (1/4-1/2-1/4 and 1/3-1/3-1/3) configuration, prepared by Hurricane Engineering & Testing, Inc., Test Reports No. **HETI-10-3047**, **HETI-10-3053**, **HETI-10-3057**, **HETI-10-3130**, **HETI-10-3223** and **HET-10-3225**, all dated 03/23/11, and signed and sealed by Candido F. Font, P.E.
(Submitted under NOA No. 11-0705.10)
6. Test reports on: 1) Large Missile Impact Test per FBC, TAS 201-94
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of an aluminum horizontal sliding window, XOX (1/4-1/2-1/4 and 1/3-1/3) configuration, prepared by Hurricane Engineering & Testing, Inc., Test Reports No. **HETI-10-3048**, **HETI-10-3049I**, dated 11/09/10, **HETI-10-3050**, **HETI-10-3052B**, **HETI-10-3056**, **HETI-10-3131**, **HETI-10-3224** and **HETI-10-3226**, all dated 03/23/11, and signed and sealed by Candido F. Font, P.E.
(Submitted under NOA No. 11-0705.10)
7. Test reports on: 1) Large Missile Impact Test per FBC, TAS 201-94
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of an aluminum horizontal sliding window, XOX configuration, prepared by Hurricane Engineering & Testing, Inc., Test Report No. **HETI-10-3251**, dated 04/25/11, signed and sealed by Rafael E. Droz-Seda, P.E.
(Submitted under NOA No. 11-0705.10)



Ishaq I. Chanda, P.E.

Product Control Unit Supervisor

NOA No. 25-0929.04

Expiration Date: April 11, 2027

Approval Date: October 23, 2025

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's (CONTINUED)

B. TESTS (CONTINUED)

8. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94

along with marked-up drawings and installation diagram of 8 specimens of an aluminum horizontal sliding window, XO configuration, prepared by Hurricane Engineering & Testing, Inc., Test Reports No. **HETI-08-2033, HETI-08-2034, HETI-08-2035, HETI-08-2036, HETI-08-2037, HETI-08-2038, HETI-08-2116A** and **HETI-08-2116B**, all dated 02/28/08, and signed and sealed by Candido F. Font, P.E. *(Submitted under NOA No. 09-0706.05)*

9. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94

along with marked-up drawings and installation diagram of 8 specimens of an aluminum horizontal sliding window, XO configuration, prepared by Fenestration Testing Laboratory, Inc., Test Reports No. **FTL-3097, FTL-3098** and **FTL-3364**, dated 12/06/01, 12/11/01 and 01/28/02, respectively, all signed and sealed by Luis Antonio Figueredo, P.E.

(Submitted under NOA No. 02-0227.05)

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC 7th Edition (2020), dated 05/28/09, revised on 07/10, 01/25/12 and 01/12/22 and updated on 07/13/22, prepared by manufacturers, signed and sealed by Thomas J. Sotos, P.E. *(Submitted under NOA No. 22-0719.02)*
2. Glazing complies with **ASTM E1300-09**

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER).



Ishaq I. Chanda, P.E.

Product Control Unit Supervisor

NOA No. 25-0929.04

Expiration Date: April 11, 2027

Approval Date: October 23, 2025

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's (CONTINUED)

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **20-0915.22** issued to **Kuraray America, Inc.** for their "Trosifol® Ultraclear, Clear and Color PVB Glass Interlayers" dated 11/19/20, expiring on 07/08/24.
2. Notice of Acceptance No. **21-0216.01** issued to **Eastman Chemical Company (MA)** for their "Saflex PVB Interlayers - Clear and Colored for Glass" dated 04/29/21, expiring on 05/21/26.
3. Notice of Acceptance No. **20-0622.03** issued to **Eastman Chemical Company (MA)** for their "Saflex Storm - Saflex and Saflex HP Composite Glass Interlayers with PET Core" dated 08/06/20, expiring on 12/11/23.

F. STATEMENTS

1. Statement letter of conformance, complying with **FBC 7th Edition (2020)**, dated July 12, 2022, issued by the manufacturer, signed and sealed by Thomas J. Sotos, P.E. *(Submitted under NOA No. 22-0719.02)*
2. Statement letter of no financial interest, dated July 12, 2022, issued by the manufacturer, signed and sealed by Thomas J. Sotos, P.E. *(Submitted under NOA No. 22-0719.02)*
3. Proposal No. **22-0505** issued by the Product Control Section, dated May 12, 2022, signed by Manuel Perez, P.E. *(Submitted under NOA No. 22-0719.02)*
4. Proposal No. **19-1433** issued by the Product Control Section, dated January 15, 2020, signed by Manuel Perez, P.E. *(Submitted under NOA No. 22-0118.01)*
5. Proposal No. **18-1697** issued by the Product Control Section, dated January 04, 2019, signed by Manuel Perez, P.E. *(Submitted under NOA No. 19-0708.09)*
6. Laboratory compliance letter for Test Reports No. **HETI-10-3047, HETI-10-3048, HETI-10-3049, HETI-10-3049I, HETI-10-3050, HETI-10-3051, HETI-10-3052B, HETI-10-3053, HETI-10-3056, HETI-10-3057, HETI-10-3130, HETI-10-3131, HETI-10-3223, HETI-10-3224, HET-10-3225 and HETI-10-3226**, all issued by Hurricane Engineering & Testing, Inc., dated 11/09/10, 03/23/11 and 04/25/11, signed and sealed by Candido F. Font, P.E. *(Submitted under NOA No. 11-0705.10)*



Ishaq I. Chanda, P.E.
Product Control Unit Supervisor
NOA No. 25-0929.04
Expiration Date: April 11, 2027
Approval Date: October 23, 2025

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's (CONTINUED)
F. STATEMENTS (CONTINUED)

7. Laboratory compliance letter for Test Report No. **HETI-10-3251**, issued by Hurricane Engineering & Testing, Inc., dated 04/25/11, signed and sealed by Rafael E. Droz-Seda, P.E.
(Submitted under NOA No. 11-0705.10)
8. Laboratory compliance letter for Test Reports No. **HETI-08-2033, HETI-08-2034, HETI-08-2035, HETI-08-2036, HETI-08-2037, HETI-08-2038, HETI-08-2116A** and **HETI-08-2116B**, all issued by Hurricane Engineering & Testing, Inc., dated 01/15/08 through 02/28/08, and signed and sealed by Candido F. Font, P.E.
(Submitted under NOA No. 09-0706.05)
9. Laboratory compliance letter for Test Reports No. **FTL-3097, FTL-3098** and **FTL-3364**, all issued by Fenestration Testing Laboratory, Inc., dated 12/06/01, 12/11/01 and 01/28/02, and signed and sealed by Luis Antonio Figueredo, P.E.
(Submitted under NOA No. 02-0227.05)

G. OTHERS

1. Notice of Acceptance No. **22-0118.01**, issued to Lawson Industries, Inc. for their Series "HS-8700 (Flange Frame)" Aluminum Horizontal Sliding Window – L.M.I., approved on 02/24/22 and expiring on 04/11/27.

2. EVIDENCE SUBMITTED under previous approval

A. DRAWINGS


1. Drawing No. **L8700-0901**, titled "HS-8700 Horizontal Rolling Flange Impact Window", sheets 1 through 10 of 10, dated 05/30/09, with revision **I** dated 09/25/23, prepared by manufacturer, signed and sealed by Thomas J. Sotos, P.E.

B. TESTS

1. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of a series SH-7700 aluminum single hung window, prepared by Hurricane Engineering & Testing, Inc., Test Report No. **HETI-23-8049**, dated 07/24/23, signed and sealed by Ram N. Tewari, P.E.

C. CALCULATIONS

1. None.



Ishaq I. Chanda, P.E.
Product Control Unit Supervisor
NOA No. 25-0929.04
Expiration Date: April 11, 2027
Approval Date: October 23, 2025

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

2. EVIDENCE SUBMITTED under previous approval (CONTINUED)

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **20-0915.22** issued to **Kuraray America, Inc.** for their “**Trosifol® Ultraclear, Clear and Color PVB Glass Interlayers**” dated 11/19/20, expiring on 07/08/24.
2. Notice of Acceptance No. **21-0216.01** issued to **Eastman Chemical Company (MA)** for their “**Saflex PVB Interlayers - Clear and Colored for Glass**” dated 04/29/21, expiring on 05/21/26.
3. Notice of Acceptance No. **22-1130.05** issued to **Eastman Chemical Company (MA)** for their “**Saflex Storm - Saflex and Saflex HP Composite Glass Interlayers with PET Core**” dated 01/26/23, expiring on 12/11/28.

F. STATEMENTS

1. Statement letter of conformance, complying with **FBC 8th Edition (2023)**, dated October 4, 2023, issued by the manufacturer, signed and sealed by Thomas J. Sotos, P.E.
2. Statement letter of no financial interest, dated October 4, 2023, issued by the manufacturer, signed and sealed by Thomas J. Sotos, P.E.
3. Proposal No. **23-0461R** issued by the Product Control Section, dated June 13, 2023 and revised on June 16, 2023, signed by Manuel Perez, P.E.

G. OTHERS

1. Notice of Acceptance No. **22-0719.02**, issued to Lawson Industries, Inc. for their Series “**HS-8700 (Flange Frame)**” Aluminum Horizontal Sliding Window – L.M.I., approved on 08/11/22 and expiring on 04/11/27.


Ishaq I. Chanda, P.E.
Product Control Unit Supervisor
NOA No. 25-0929.04
Expiration Date: April 11, 2027
Approval Date: October 23, 2025

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

3. NEW EVIDENCE SUBMITTED

A. DRAWINGS

1. Drawing No. **CWS-1250 Rev A** (former **L8700-0901**), titled “7200 Aluminum Horizontal Slider Flange Frame”, sheets 1 through 10 of 10, dated 12/18/2023 and last revised on SEP 25, 2025, prepared by manufacturer, and signed and sealed by Thomas J. Sotos, P.E.

B. TESTS

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of (3) specimens of an aluminum horizontal sliding window, XOX configuration, prepared by QAI Laboratory, Test Reports No. **MED-0023**, dated 04/18/2024, issued to Lawson Industries, signed and sealed by Idalmis Ortega, P.E.

C. CALCULATIONS (Submitted under previous approval)

1. None.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS

- 1 Notice of Acceptance No. **22-1116.01** issued to **Kuraray America, Inc.** for their “**SentryGlas® (Clear and White) Glass Interlayers**” expiring on 07/04/28.
2. Notice of Acceptance No. **24-0205.08** issued to **Kuraray America, Inc.** for their “**Trosifol® Ultraclear, Clear and Color PVB Glass Interlayers**”, expiring on 07/08/29.
3. Notice of Acceptance No. **21-0216.01** issued to **Eastman Chemical Company (MA)** for their “**Saflex PVB Interlayers - Clear and Colored for Glass**”, expiring on 05/21/26.
4. Notice of Acceptance No. **22-1130.05** issued to **Eastman Chemical Company (MA)** for their “**Saflex Storm - Saflex and Saflex HP Composite Glass Interlayers with PET Core**”, expiring on 12/11/28.


Ishaq I. Chanda, P.E.
Product Control Unit Supervisor
NOA No. 25-0929.04
Expiration Date: April 11, 2027
Approval Date: October 23, 2025


NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

F. STATEMENTS

1. Statement letter of conformance, complying with FBC 8th Edition (2023), No financial interest to the lab and the DWG is the same as NOA# **23-1010.04**, except new XOX 111 and 106.25" W x 63"H were added, dated SEP 25, 2025, signed and sealed by Thomas J. Sotos, P.E.
2. Statement letter dated June 25, 2025, issued by Custom Window Systems, Inc. (CWS) that they have legally purchased all assets of (18) listed NOA(s) from Lawson Industries, Inc. and requesting that new corresponding NOA(s) be issued to CWS name. Also, CWS request that (18) listed Private label Agreement NOA(s) between Lawson Industries Inc. and Custom Window System are to be rescinded, signed by Kevin Pine, Vice President CWS.
3. Statement letter dated June 5, 2025, confirming that Custom Window System, Inc. is a wholly owned subsidiary of Pella corporation, signed by Chantel Kramme, Secretary Pella Corp.
4. Statement letter dated June 10, 25 issued by Lawson Industries LLC, that they have legally sold all assets of existing NOA(s) listed in this letter, know how, equipment/machinery and given up all the rights and request to rescind these NOA(s), signed by Harold Bailey, President Lawson Industry, LLC.

G. OTHERS

1. This NOA revises NOA No. **23-1010.04 (Lawson Industries Inc.)**, expiring 04/11/2027.
2. Bill of Sales dated Nov. 28, 2023, between CWS-SF, LLC (Buyer) and Lawson Industries, Inc. (seller), signed by Nicolas Cross (president CWS) and Harold Baily (President Lawson industries).
3. Test Proposal # **21-0183** dated 04/28/21 issued to Lawson Industries approved by RER.
4. Meeting summary dated May 15, 2025, and June 24, 2025, issued by RER, Product Control Section.
5. The NOA # **23-1010.04**, issued to Lawson Industries Inc. for series "**HS-8700** (Flanged Frame) Horizontal Rolling Window-LMI, expiring 04/11/2027. (**This NOA to be rescinded**).
6. NOA #**24-0116.07**, issued to Custom windows System Inc., for the series "**7200** (Flanged Frame) Horizontal Sliding Window-LMI, expiring 04/11/2027. (**This Private label NOA with Lawson Industries Inc., to be rescinded**)



Ishaq I. Chanda, P.E.
Product Control Unit Supervisor
NOA No. 25-0929.04
Expiration Date: April 11, 2027
Approval Date: October 23, 2025




1900 SW 44TH AVE.
OCALA, FLORIDA 34474
WWW.CWS.CC


**7200 ALUMINUM
HORIZONTAL SLIDER -
IMPACT FLANGE FRAME**

General Notes:

- 1.) THIS WINDOW SYSTEM IS DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE (2023-8th Edition), INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ) AND ASTM 1300-16. THIS PRODUCT IS LARGE MISSILE IMPACT RESISTANT. (SHUTTERS NOT REQUIRED)
- 2.) WOOD BUCKS SHALL BE INSTALLED AND ANCHORED SO THAT THE BUILDING RESISTS THE SUPERIMPOSED LOADS IN ACCORDANCE WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE & TO BE REVIEWED BY BUILDING OFFICIAL.
- 3.) ANCHORS SHOWN ON SHEET 2 OF 10 ARE AS PER TEST UNITS. ANCHORS ON ALL WINDOW SIZES ARE NOT TO EXCEED THESE MAXIMUM SPACINGS ON CENTER (O.C.), AND AS TABULATED ON SHEETS 6, 7, or 8.
- 4.) ANCHOR CONDITIONS NOT DESCRIBED IN THESE DRAWING'S ARE TO BE ENGINEERED ON A SITE SPECIFIC BASIS, UNDER SEPARATE APPROVAL AND TO BE REVIEWED BY BUILDING OFFICIAL.
- 5.) WINDOWS ARE QUALIFIED FOR USE WITH SINGLE GLAZE LAMINATED GLASS TYPES TABULATED HEREIN (SEE SHEETS #6, 7, or 8), AND FOR USE WITH DOUBLE GLAZE LAMINATED INSULATED GLASS TYPES TABULATED HEREIN (SEE SHEETS #6, 7 or 8).
- 6.) WINDOWS WITH GLASS TYPES "A, C, OR G" INSTALLED ABOVE 30FT. IN THE HVHZ, THE I.G. EXTERIOR LITE SHALL BE TEMPERED.
- 7.) SEE SHEET 4 FOR LOCK DETAILS & OPTIONS.
- 8.) SEE SHEET 9 FOR GLASS TYPES.
- 9.) SEE SHEET 6 FOR DESIGN PRESSURES ON "XO or OX" WINDOWS.
- 10.) SEE SHEET 7 FOR DESIGN PRESSURES ON EQUAL-LITE "XOX" WINDOWS.
- 11.) SEE SHEET 8 FOR DESIGN PRESSURES ON UN-EQUAL LITE "XOX" WINDOWS.
- 12.) FOR OPTIONAL FRAME INSTALLATION DETAILS SEE SHEETS 3, 4, or 9.
- 13.) EXT. & INT. FALSE COLONIAL MUNTINS ARE OPTIONAL & AND ARE APPLIED W/ SILICONE
- 14.) WOOD BUCKS IN CONTACT WITH CONCRETE MUST BE PRESSURE TREATED AND ANCHORED (BY OTHERS), PRIOR TO WINDOW INSTALLATION. (SEE SHEET #3, 4 & 5 FOR DETAILS & NOTES) WOOD BUCKS TO BE ANCHORED IN COMPLIANCE WITH THE FBC CHAPTER 24 SECTION 11.3.3.3.
- 15.) APPROVAL APPLIES TO SINGLE UNITS OR SIDE BY SIDE MULLED UNITS.
- 16.) SEE SHEET # 5 FOR MULLION/METAL ATTACHMENT DETAILS, NOTES & OPTIONS.
- 17.) MULLING HORIZONTAL SLIDING WINDOWS WITH OTHER TYPES OF MIAMI-DADE COUNTY APPROVED WINDOWS USING A MIAMI-DADE COUNTY APPROVED MULLION IN BETWEEN ARE ACCEPTABLE BUT THE LOWER DESIGN PRESSURE FROM THE WINDOWS OR MULLION APPROVAL WILL APPLY TO THE ENTIRE MULLED SYSTEM.

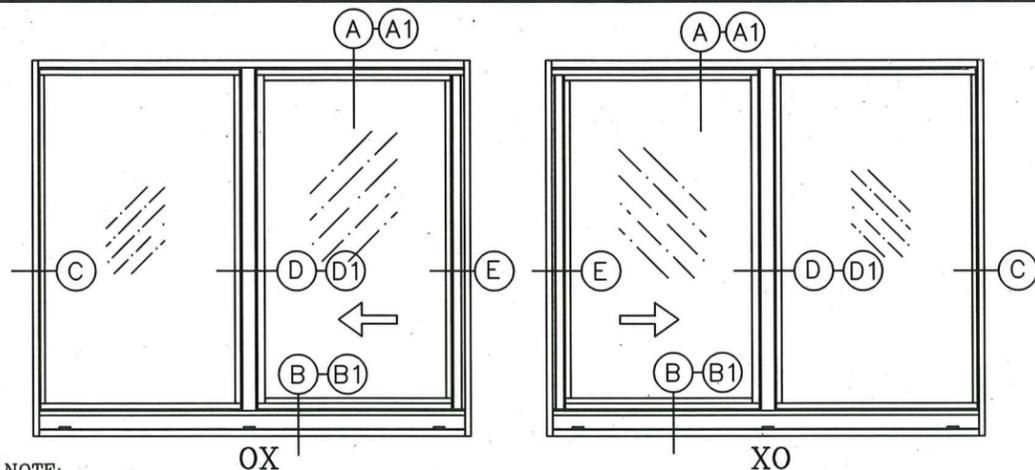


- NOTE:
- 1) REFER TO SHEET 2 OF 10 FOR INSTALLATION ANCHOR DETAILS AND NOTES.
 - 2) FOR VERTICAL CROSS-SECTION DETAILS "A, A1, B, & B1" REFER TO SHEET #3
 - 3) FOR HORIZONTAL CROSS-SECTION DETAILS "C, D, D1, & E" REFER TO SHEET #4
 - 4) REFER TO SHEET 6 OF 10 FOR DESIGN LOAD CHARTS AND NOTES.

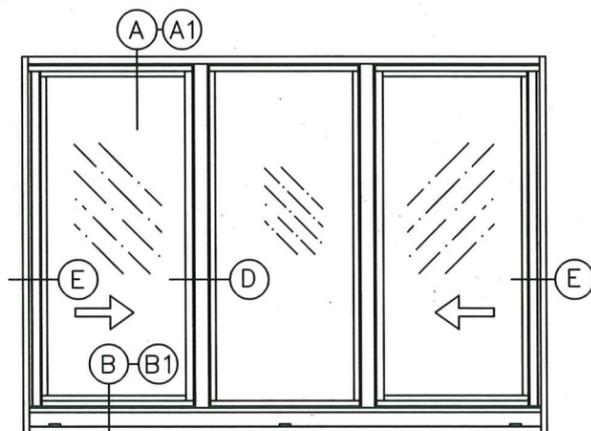

XOX - Equal Lite (1/3-1/3-1/3)

- NOTES:
- 1) REFER TO SHEET 2 OF 10 FOR INSTALLATION ANCHOR DETAILS AND NOTES.
 - 2) FOR VERTICAL CROSS-SECTION DETAILS "A, A1, B, & B1" REFER TO SHEET #3
 - 3) FOR HORIZONTAL CROSS-SECTION DETAILS "D, & E" REFER TO SHEET #5
 - 4) REFER TO SHEET 8 OF 10 FOR DESIGN LOAD CHARTS AND NOTES.

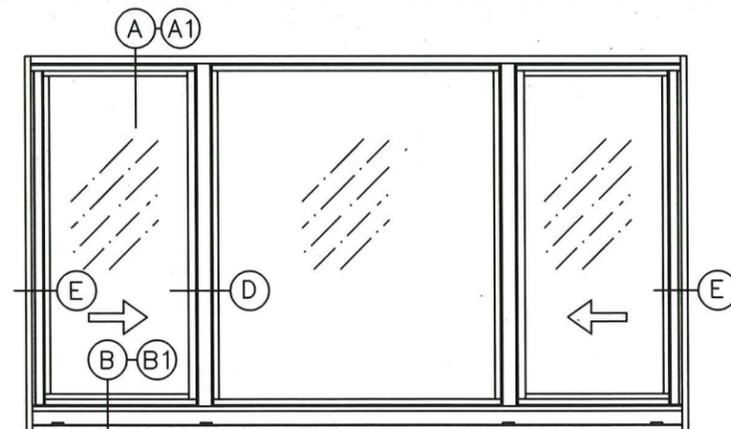


XOX - Un-Equal Lite (1/4-1/2-1/4)

- NOTES:
- 1) REFER TO SHEET 2 OF 10 FOR INSTALLATION ANCHOR DETAILS AND NOTES.
 - 2) FOR VERTICAL CROSS-SECTION DETAILS "A, A1, B, & B1" REFER TO SHEET #3
 - 3) FOR HORIZONTAL CROSS-SECTION DETAILS "D, & E" REFER TO SHEET #5
 - 4) REFER TO SHEET 7 OF 10 FOR DESIGN LOAD CHARTS AND NOTES.

**HORIZONTAL SLIDER WINDOW - IMPACT FLANGE FRAME
APPROVED ELEVATIONS**

NO.	DESCRIPTION	DATE
A	Revises NDA # 23-1010.04	09/05/25

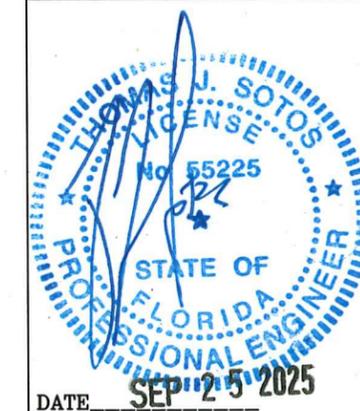

THOMAS J. SOTOS, P.E.
FL P.E. LIC. # 55225

SHEET DESCRIPTION:
APPROVED ELEVATIONS,
CONFIGURATIONS AND
GENERAL NOTES

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 25-0929.04
Expiration Date 4/11/2027
By Ishay I. Chen
Miami Dade Product Control


DRAWN BY:	DATE:
N. Erazo	12/18/2023
REV. BY:	DATE:
N. Erazo	09/05/2025
DWG #:	REV #:
CWS-1250	A
SCALE:	SHEET
--	1 OF 10



1900 SW 44TH AVE.
OCALA, FLORIDA 34474
WWW.CWS.CC

7200 ALUMINUM HORIZONTAL SLIDER - IMPACT FLANGE FRAME

NO.	DESCRIPTION	BY	DATE
A	Revises NDA # 23-1010.04	NE.	09/05/25
REVISIONS			

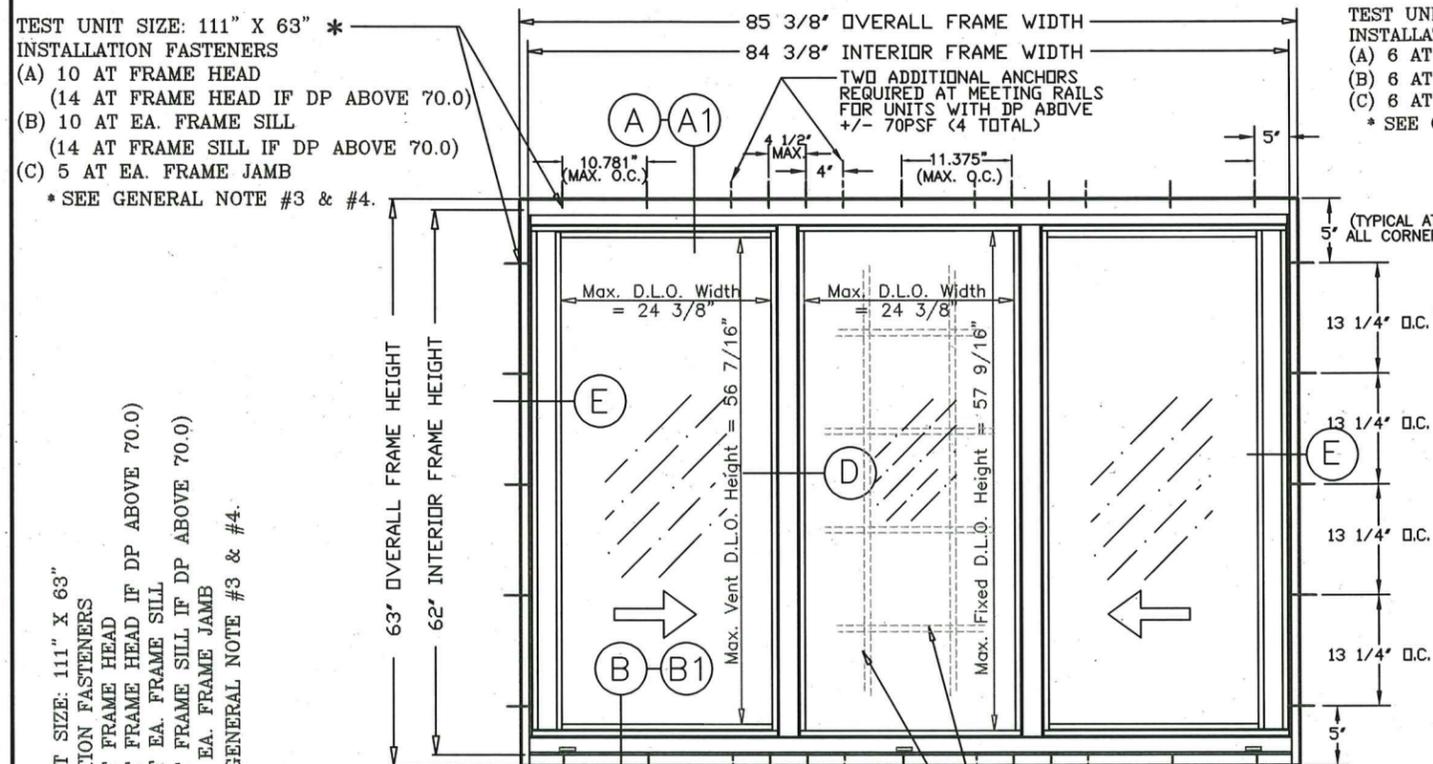


ANCHOR NOTES:

1. SAME ANCHOR SPACING AT HEAD & SILL
2. TWO ADDITIONAL ANCHORS REQUIRED AT MEETING RAILS FOR UNITS WITH DP ABOVE +70PSF / - 75PSF (4 TOTAL)

EXT. & INT. FALSE COLONIAL MUNTINS ARE APPLIED W/ W/ SILICONE AND ARE AVAILABLE AS OPTIONAL.

"XO" WINDOW EQUAL LITE

- NOTES: 1. SEE VERTICAL CROSS-SECTION DETAILS 'A, A1, B, & B1' AT SHEET #3
2. SEE HORIZONTAL CROSS-SECTION DETAILS 'C, D, & E' AT SHEET #5

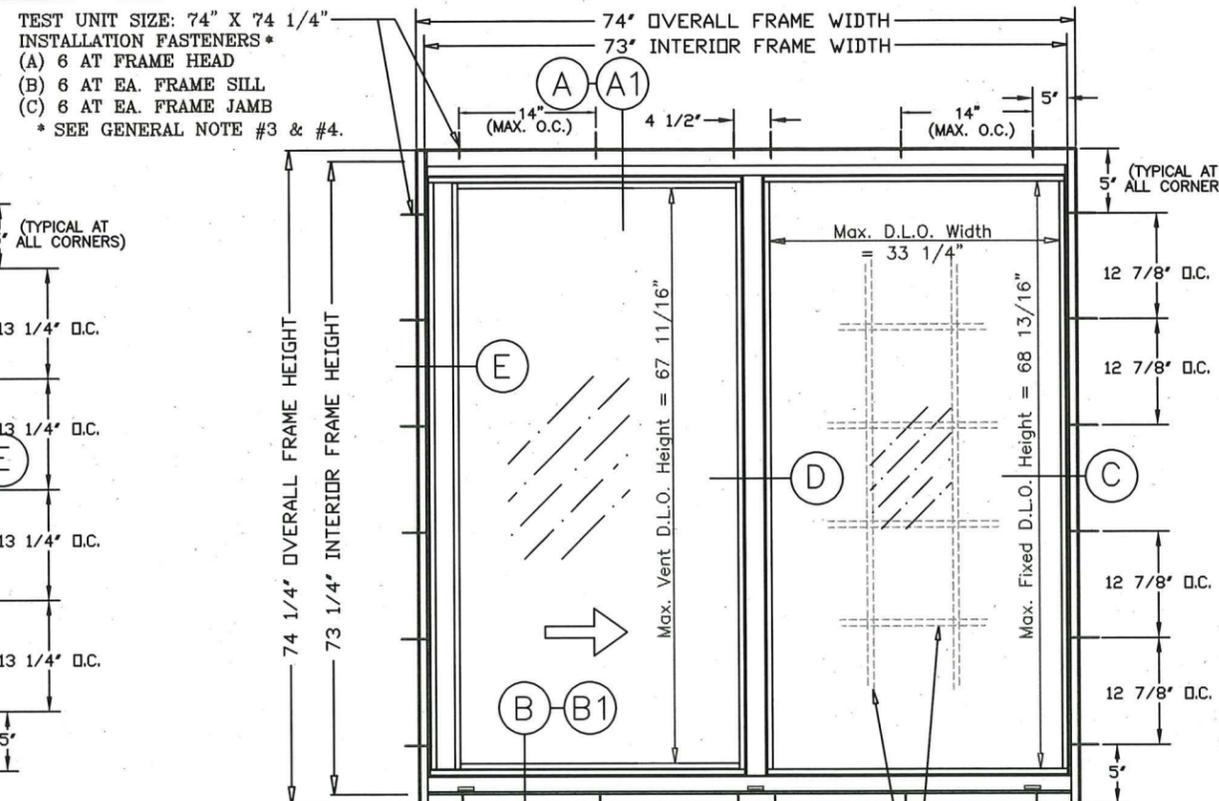


ANCHOR NOTES:

1. SAME ANCHOR SPACING AT HEAD & SILL

EXT. & INT. FALSE COLONIAL MUNTINS ARE APPLIED W/ W/ SILICONE AND ARE AVAILABLE AS OPTIONAL.

"XO" WINDOW EQUAL LITE

- NOTES: 1. SEE VERTICAL CROSS-SECTION DETAILS 'A, A1, B, & B1' AT SHEET #3
2. SEE HORIZONTAL CROSS-SECTION DETAILS 'C, D, & E' AT SHEET #4

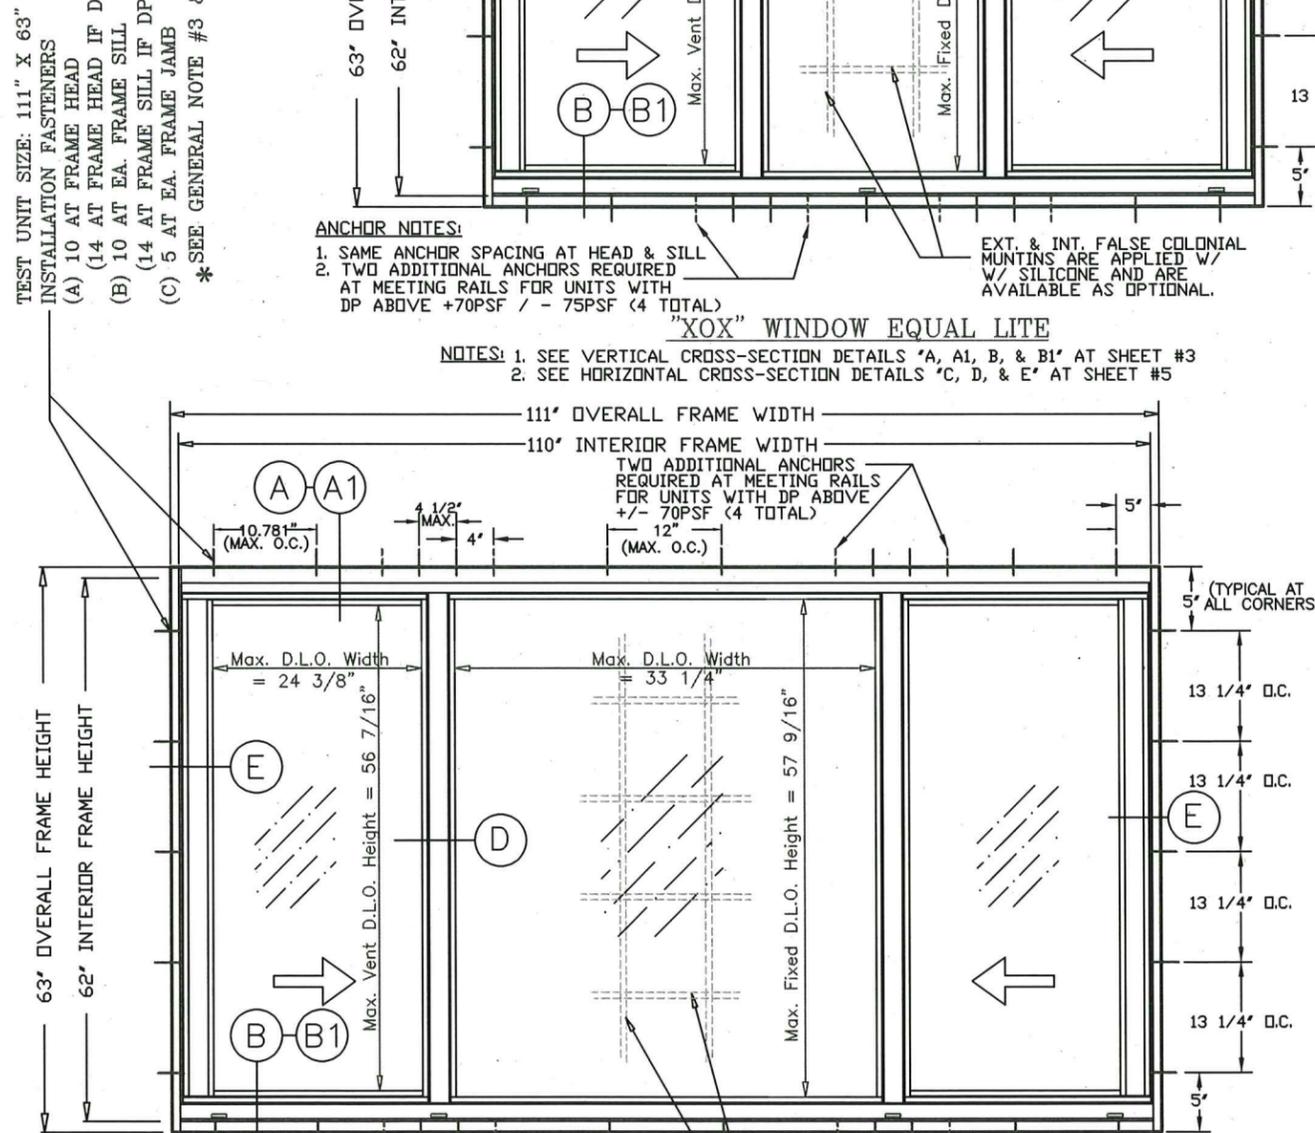


ANCHOR NOTES:

1. SAME ANCHOR SPACING AT HEAD & SILL
2. TWO ADDITIONAL ANCHORS REQUIRED AT MEETING RAILS FOR UNITS WITH DP ABOVE +70PSF / - 75PSF (4 TOTAL)

EXT. & INT. FALSE COLONIAL MUNTINS ARE APPLIED W/ SILICONE AND ARE AVAILABLE AS OPTIONAL.

"XO" WINDOW - UN-EQUAL LITE

- NOTES: 1. SEE VERTICAL CROSS-SECTION DETAILS 'A, A1, B, & B1' AT SHEET #3
2. SEE HORIZONTAL CROSS-SECTION DETAILS 'C, D, & E' AT SHEET #5

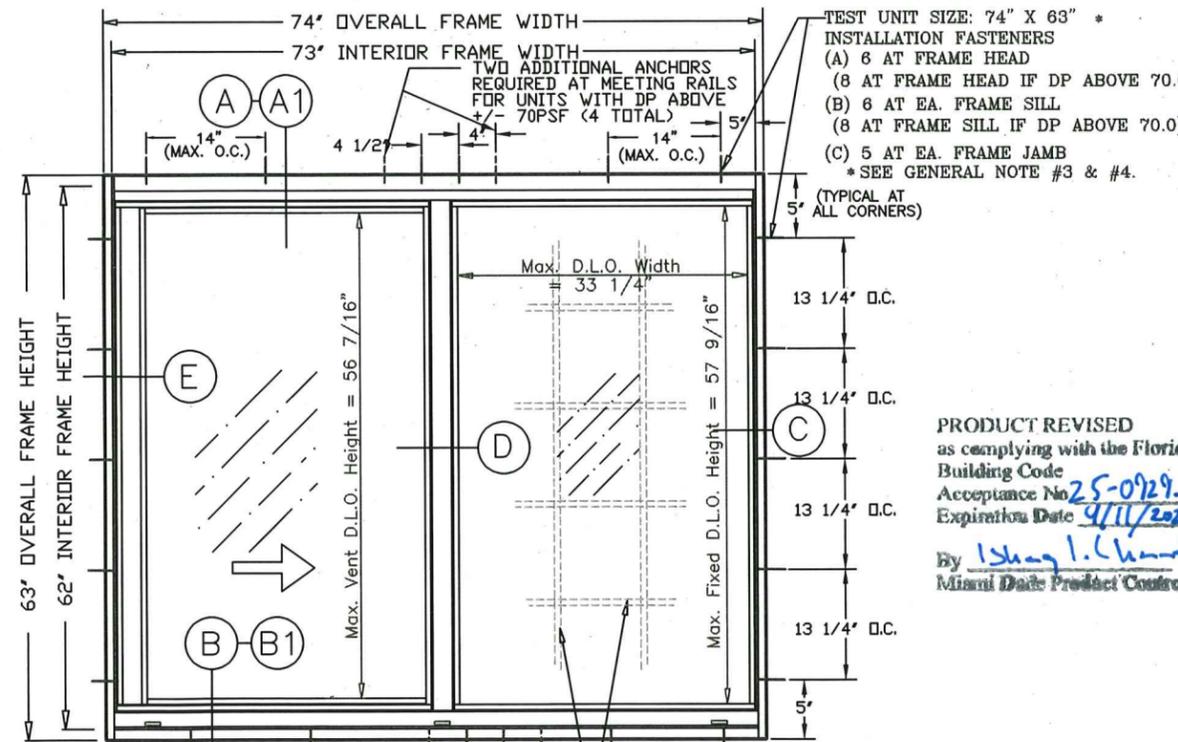


ANCHOR NOTES:

1. SAME ANCHOR SPACING AT HEAD & SILL
2. TWO ADDITIONAL ANCHORS REQUIRED AT MEETING RAILS FOR UNITS WITH DP ABOVE +/- 70PSF (4 TOTAL)

EXT. & INT. FALSE COLONIAL MUNTINS ARE APPLIED W/ W/ SILICONE AND ARE AVAILABLE AS OPTIONAL.

"XO" WINDOW EQUAL LITE

- NOTES: 1. SEE VERTICAL CROSS-SECTION DETAILS 'A, A1, B, & B1' AT SHEET #3
2. SEE HORIZONTAL CROSS-SECTION DETAILS 'C, D, & E' AT SHEET #4

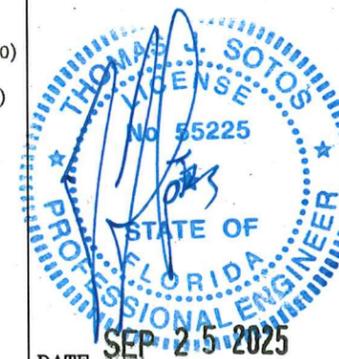

DATE: SEP 25 2025

PRODUCT REVISED as complying with the Florida Building Code Acceptance No. 25-0929.04 Expiration Date 9/11/2027 By: [Signature] Miami Dade Product Control

THOMAS J. SOTOS, P.E.
FL P.E. LIC. # 55225

SHEET DESCRIPTION:
WINDOW ELEVATIONS,
CONFIGURATIONS AND
ANCHOR NOTES

DRAWN BY: N. Erazo
DATE: 12/18/2023

REV. BY: N. Erazo
DATE: 09/05/2025

DWG #: CWS-1250
REV #: A

SCALE: ---
SHEET 2 OF 10



1900 SW 44TH AVE.
OCALA, FLORIDA 34474
WWW.CWS.CC

**7200 ALUMINUM
HORIZONTAL SLIDER -
IMPACT FLANGE FRAME**



NO.	DESCRIPTION	BY	DATE
A	Revises NDA # 23-1010.04	N.E.	09/05/25



DATE: _____
THOMAS J. SOTOS, P.E.
FL P.E. LIC. # 55225

SHEET DESCRIPTION:
**CROSS SECTION DETAILS,
FIXED INTERLOCK OPTION AND
FRAME INSTALLATION NOTES**

DRAWN BY:	DATE:
N. Erazo	12/18/2023
REV. BY:	DATE:
N. Erazo	09/05/2025
DWG #:	REV #:
CWS-1250	A
SCALE:	SHEET
---	4 OF 10

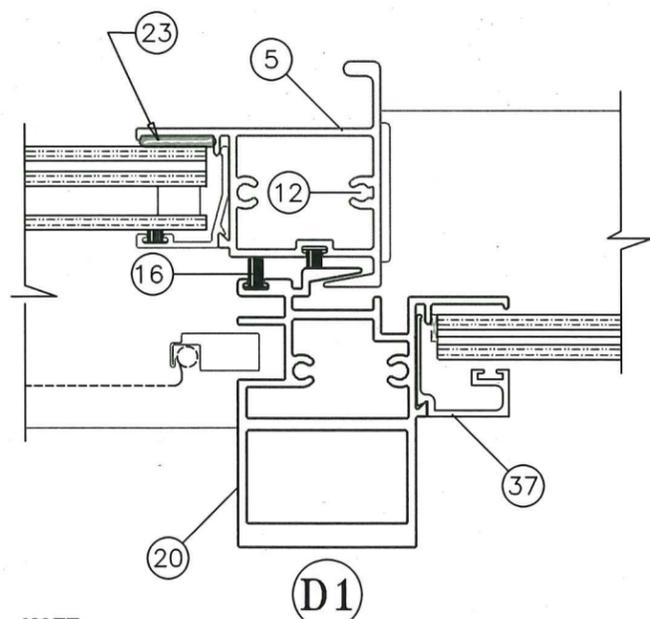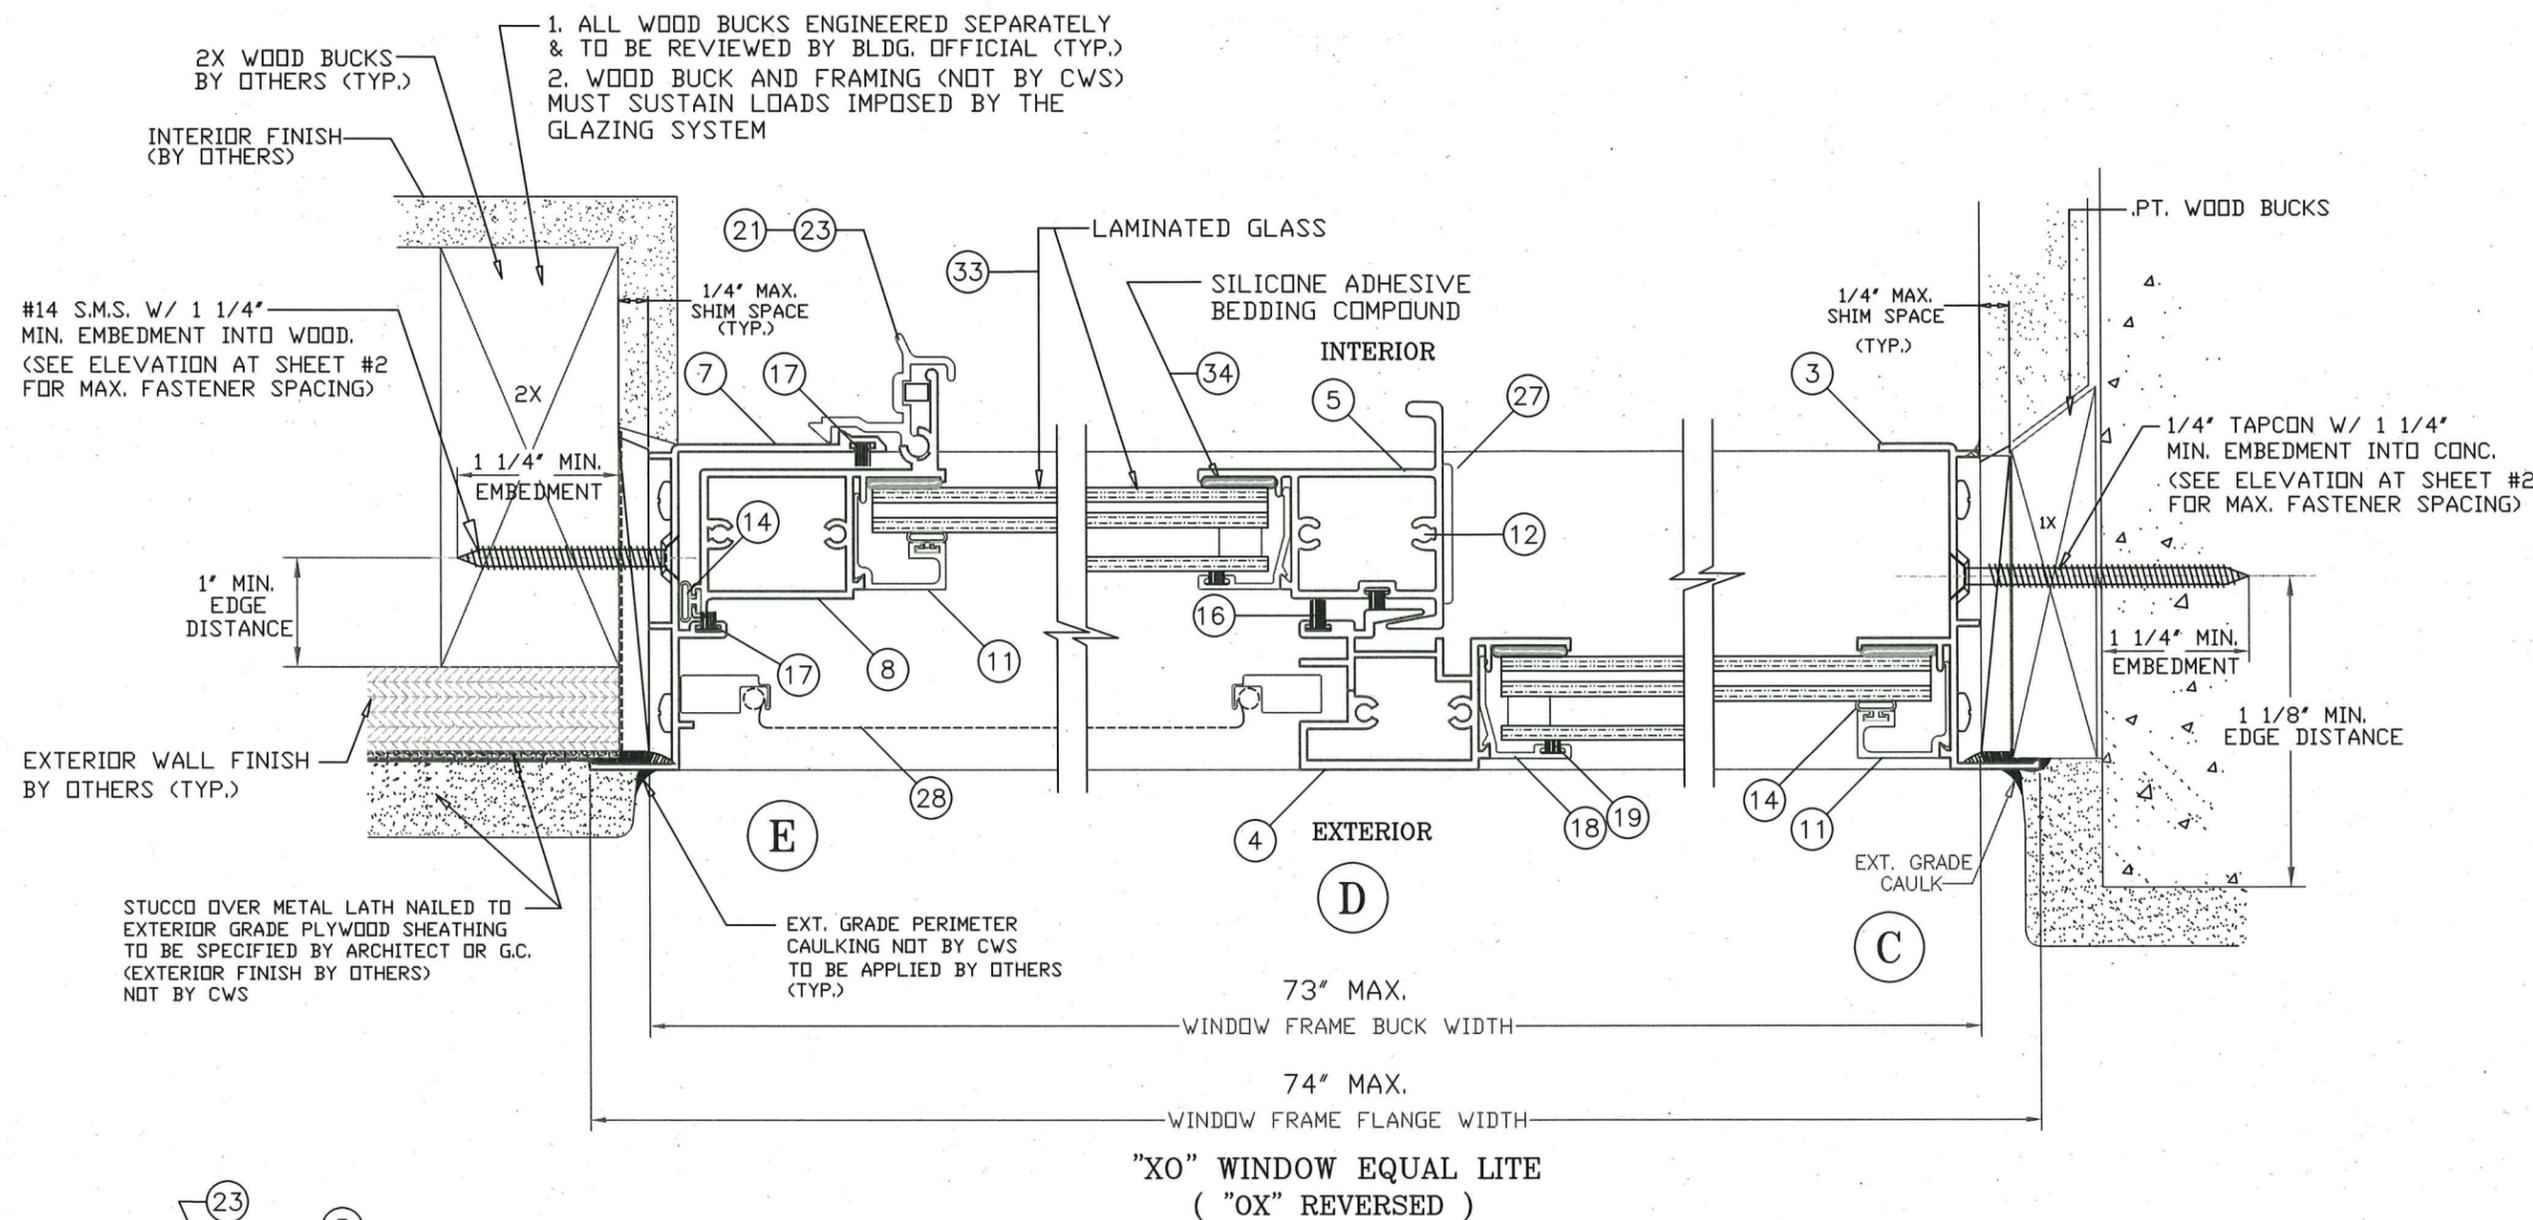

NOTE:
H.D. MEETING RAIL FOR "XO" or "OX" WINDOWS
WITH GLASS TYPE "I" (+80.0 DP and -92.0 DP)
- SEE SHEET 6 OF 10

WINDOW INSTALLATION NOTES:

1. THE WINDOW FRAME FLANGE TO BE BACK-BEDDED W/ AN EXT. GRADE CAULK THROUGHOUT THE ENTIRE PERIMETER OF FLANGE BY WINDOW INSTALLER (TYP.)
2. THE EXPOSED EXT. PERIMETER OF THE WINDOW FRAME TO BE SEALED W/ AN APPROVED EXTERIOR GRADE CAULK BY OTHERS (TYP.)

* WHEN THE GAP BETWEEN THE WINDOW FRAME AND THE BUCK OR MASONRY IS LESS THAN 1/8", SHIMS ARE NOT REQUIRED.

ANCHORS NOTE:


ANCHORS TO BE #12 SMS OR WD. SCREWS INTO WOOD, OR 1/4" TAPCONS or APPROVED CONC. FASTENERS INTO CONC., WITH A MINIMUM OF 1 1/4" PENETRATION INTO WOOD OR CONC. (REFER TO LOAD TABLES FOR QUANTITIES REQUIRED)

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. **25-0929.04**
Expiration Date **9/11/2027**
By **Isang I. Ch...**
Miami State Product Control




1900 SW 44TH AVE.
OCALA, FLORIDA 34474
WWW.CWS.CC

**7200 ALUMINUM
HORIZONTAL SLIDER -
IMPACT FLANGE FRAME**

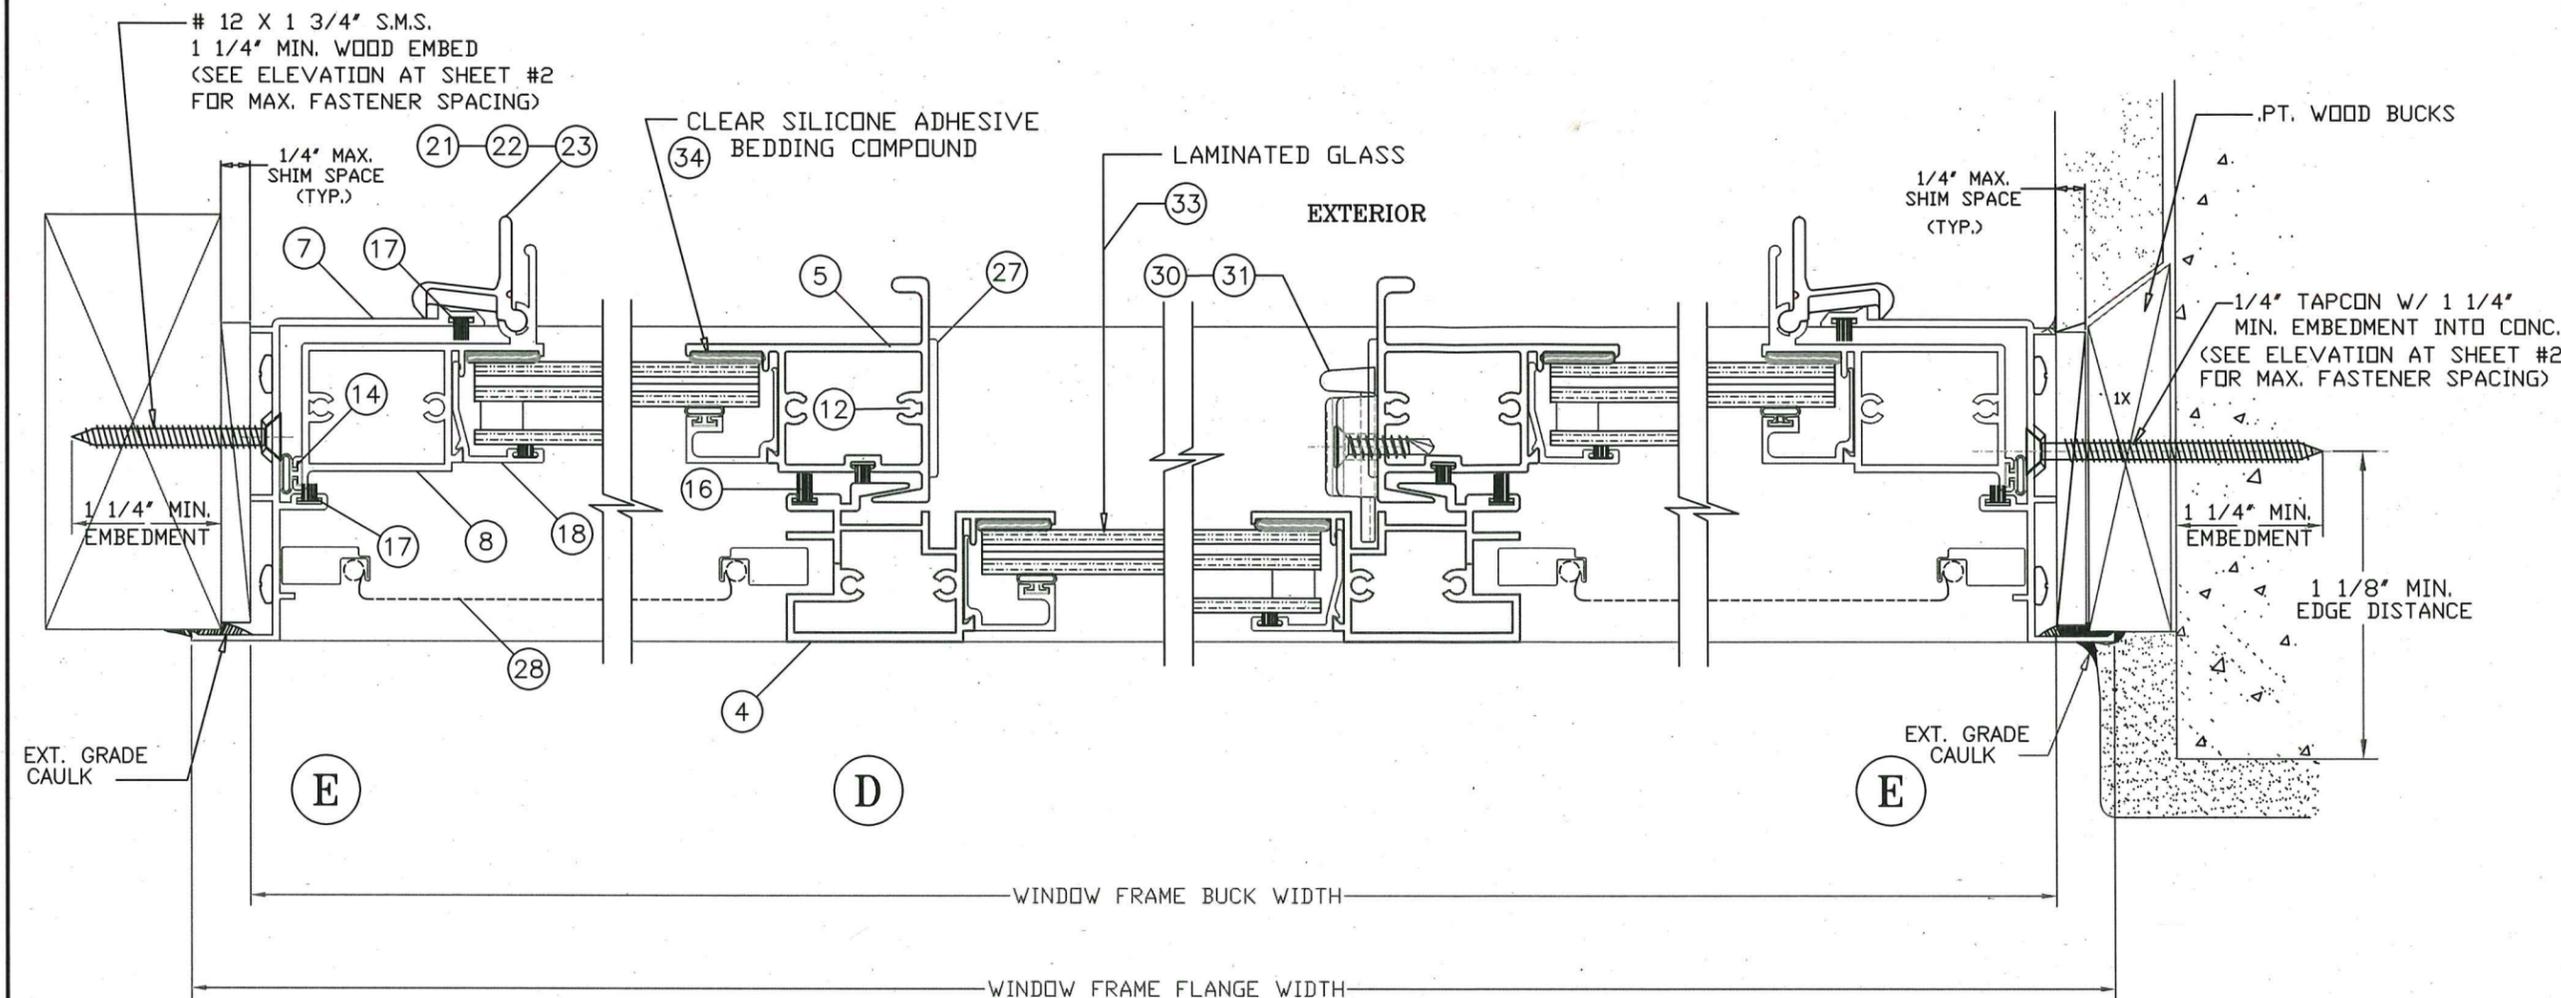

"XOX" WINDOW EQUAL AND UN-EQUAL LITE

NO.	DESCRIPTION	BY	DATE
A	Revises NDA # 23-101004	NE	09/05/25

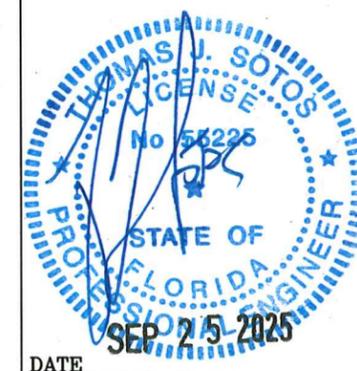

THOMAS J. SOTOS, P.E.
FL P.E. LIC. # 55225


SHEET DESCRIPTION:
CROSS SECTION DETAILS,
LOCK OPTIONS AND
FRAME INSTALLATION NOTES

DRAWN BY: N. Erazo
DATE: 12/18/2023

REV. BY: N. Erazo
DATE: 09/05/2025

DWG #: CWS-1250
REV #: A

SCALE: ---
SHEET 5 OF 10

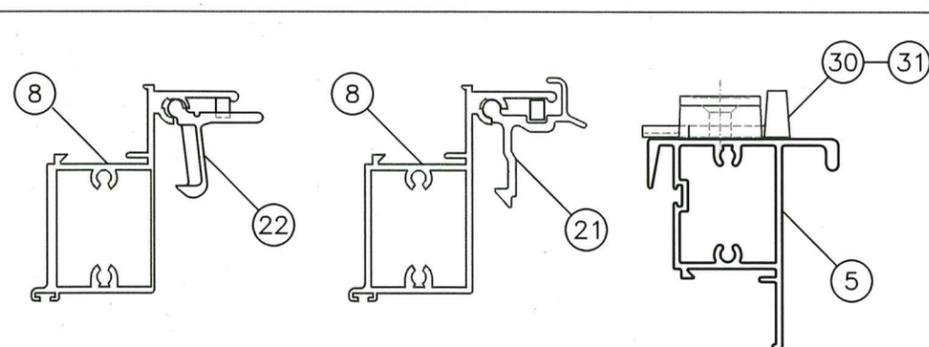

LOCK (LATCH AND SWEEP) OPTIONS

1. BOTH EXTRUDED ALUMINUM AND PLASTIC LIFT HANDLE LOCKS ARE QUALIFIED FOR USE ON ALL WINDOWS.
2. BOTH DIE CAST AND NYLON CAM LOCKS ARE QUALIFIED FOR USE ON ALL WINDOWS.
3. TWO (2) LOCKS ARE REQUIRED PER EACH VENT.

WINDOW INSTALLATION NOTES:

1. THE WINDOW FRAME FLANGE TO BE BACK-BEDDED W/ AN EXT. GRADE CAULK THROUGHOUT THE ENTIRE PERIMETER OF FLANGE BY WINDOW INSTALLER (TYP.)
2. THE EXPOSED EXT. PERIMETER OF THE WINDOW FRAME TO BE SEALED W/ AN APPROVED EXTERIOR GRADE CAULK BY OTHERS (TYP.)

* WHEN THE GAP BETWEEN THE WINDOW FRAME AND THE BUCK OR MASONRY IS LESS THAN 1/8", SHIMS ARE NOT REQUIRED.

ANCHORS NOTE:

ANCHORS TO BE #12 SMS OR WD. SCREWS INTO WOOD, OR 1/4" TAPCONS OR APPROVED CONC. FASTENERS INTO CONC., WITH A MINIMUM OF 1 1/4" PENETRATION INTO WOOD OR CONC. (REFER TO LOAD TABLES FOR QUANTITIES REQUIRED)

PRODUCT REVIEWED
as complying with the Florida
Building Code
Acceptance No. 25-0929.04
Expiration Date: 4/11/2027
By: Ishag I. Ghannouchi
Managing Member, Product Control


DESIGN LOAD CAPACITY (PSF) - XOX WINDOWS with Equal Lite (1/3-1/3-1/3)

+ / - Pressures (psf)

FRAME SIZE		# Jamb Anchors	# H & S Anchors	Glass Type "B" (* 2)		Glass Type "C" (* 2)		Glass Type "D" (* 2)		Glass Type "E" (* 3)		Glass Type "F" (* 3)		Glass Type "G" (* 2)	
WIDTH	HEIGHT			+ psf	- psf										
60	24	3	7	80.0	80.0	80.0	80.0	65.0	75.0	65.0	75.0	52.0	52.0	65.0	75.0
72	24	3	9	80.0	80.0	80.0	80.0	65.0	75.0	65.0	75.0	52.0	52.0	65.0	75.0
84	24	3	9	80.0	80.0	80.0	80.0	65.0	75.0	65.0	75.0	52.0	52.0	65.0	75.0
60	36	3	7	70.0	75.0	70.0	75.0	65.0	75.0	65.0	75.0	52.0	52.0	65.0	75.0
72	36	3	9	70.0	75.0	70.0	75.0	65.0	75.0	65.0	75.0	52.0	52.0	65.0	75.0
84	36	3	9	-	-	52.0	52.0	65.0	75.0	65.0	75.0	52.0	52.0	65.0	75.0
60	48	4	7	-	-	52.0	52.0	65.0	75.0	65.0	75.0	52.0	52.0	65.0	75.0
72	48	4	9	-	-	52.0	52.0	65.0	75.0	65.0	75.0	52.0	52.0	65.0	75.0
84	48	4	9	-	-	52.0	52.0	65.0	75.0	65.0	75.0	52.0	52.0	65.0	75.0
60	60	5	7	-	-	52.0	52.0	65.0	75.0	65.0	75.0	52.0	52.0	65.0	75.0
72	60	5	9	-	-	52.0	52.0	65.0	75.0	65.0	75.0	52.0	52.0	65.0	75.0
84	60	5	9	-	-	52.0	52.0	65.0	75.0	65.0	75.0	52.0	52.0	65.0	75.0
53.125	26	3	6	80.0	80.0	80.0	80.0	65.0	75.0	65.0	75.0	52.0	52.0	65.0	75.0
53.125	38.375	4	6	80.0	80.0	80.0	80.0	65.0	75.0	65.0	75.0	52.0	52.0	65.0	75.0
53.125	50.625	4	6	70.0	75.0	70.0	75.0	65.0	75.0	65.0	75.0	52.0	52.0	65.0	75.0
53.125	58	5	6	-	-	52.0	52.0	65.0	75.0	65.0	75.0	52.0	52.0	65.0	75.0
53.125	63	5	6	-	-	52.0	52.0	65.0	75.0	65.0	75.0	52.0	52.0	65.0	75.0
74	26	3	9	80.0	80.0	80.0	80.0	65.0	75.0	65.0	75.0	52.0	52.0	65.0	75.0
74	38.375	4	9	-	-	52.0	52.0	65.0	75.0	65.0	75.0	52.0	52.0	65.0	75.0
74	50.625	4	9	-	-	52.0	52.0	65.0	75.0	65.0	75.0	52.0	52.0	65.0	75.0
74	58	5	9	-	-	52.0	52.0	65.0	75.0	65.0	75.0	52.0	52.0	65.0	75.0
74	63	5	9	-	-	52.0	52.0	65.0	75.0	65.0	75.0	52.0	52.0	65.0	75.0
79.5	26	3	9	80.0	80.0	80.0	80.0	65.0	75.0	65.0	75.0	52.0	52.0	65.0	75.0
79.5	38.375	4	9	70.0	75.0	52.0	52.0	65.0	75.0	65.0	75.0	52.0	52.0	65.0	75.0
79.5	50.625	4	9	-	-	52.0	52.0	65.0	75.0	65.0	75.0	52.0	52.0	65.0	75.0
79.5	58	5	9	-	-	52.0	52.0	65.0	75.0	65.0	75.0	52.0	52.0	65.0	75.0
79.5	63	5	9	-	-	52.0	52.0	65.0	75.0	65.0	75.0	52.0	52.0	65.0	75.0
84	26	3	9	70.0	75.0	70.0	75.0	65.0	75.0	65.0	75.0	52.0	52.0	65.0	75.0
84	38.375	4	9	70.0	75.0	52.0	52.0	65.0	75.0	65.0	75.0	52.0	52.0	65.0	75.0
84	50.625	4	9	-	-	52.0	52.0	65.0	75.0	65.0	75.0	52.0	52.0	65.0	75.0
84	58	5	9	-	-	52.0	52.0	65.0	75.0	65.0	75.0	52.0	52.0	65.0	75.0
84	63	5	9	-	-	52.0	52.0	65.0	75.0	65.0	75.0	52.0	52.0	65.0	75.0
106.25	26	2	5	-	-	-	-	65.0	75.0	65.0	75.0	-	-	65.0	75.0
106.25	38.375	3	7	-	-	-	-	65.0	75.0	65.0	75.0	-	-	65.0	75.0
106.25	50.625	4	8	-	-	-	-	65.0	75.0	65.0	75.0	-	-	65.0	75.0
106.25	58	5	9	-	-	-	-	65.0	75.0	65.0	75.0	-	-	65.0	75.0
106.25	63	6	9	-	-	-	-	65.0	75.0	65.0	75.0	-	-	65.0	75.0
111	26	2	5	-	-	-	-	65.0	75.0	65.0	75.0	-	-	65.0	75.0
111	38.375	3	8	-	-	-	-	65.0	75.0	65.0	75.0	-	-	65.0	75.0
111	50.625	4	10	-	-	-	-	65.0	75.0	65.0	75.0	-	-	65.0	75.0
111	58	5	10	-	-	-	-	65.0	75.0	65.0	75.0	-	-	65.0	75.0
111	63	6	10	-	-	-	-	65.0	75.0	65.0	75.0	-	-	65.0	75.0

Notes (*):

- SEE SHEET 9 FOR GLAZING TYPES, DETAILS & SILICONE OPTIONS.
- STANDARD SILL USED ON WINDOWS WITH +70.0 DP AND BELOW (WINDOWS WITH GLASS TYPES "A, B, C, & D")
- HI RISE SILL ARE FOR WINDOWS ABOVE +70.0 DP (WINDOWS WITH GLASS TYPES "E, & F") AND +80.0 DP MAX. SEE HI RISE SILL DETAIL "B1" AT SHEET 3 OF 10.
- ADDITIONAL ANCHORS REQUIRED AT FRAME HEAD & SILL ON WINDOWS WITH DP ABOVE 70.0. (SEE ELEVATION AT SHEET 2 OF 10)
- WINDOWS WITH GLASS TYPES "A, C, OR G" INSTALLED ABOVE 30FT. IN THE HVHZ, THE I.G. EXTERIOR LITE SHALL BE TEMPERED.

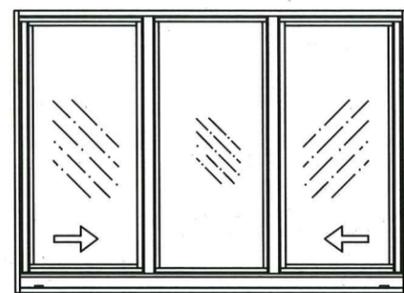


XOX - Equal Lite

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 25-0929.04
Expiration Date 4/11/2027
By *[Signature]*
Miami Dade Product Control



7200 ALUMINUM HORIZONTAL SLIDER - IMPACT FLANGE FRAME

NO.	DESCRIPTION	BY	DATE
A	Revises NDA # 23-101004	NE	09/05/25

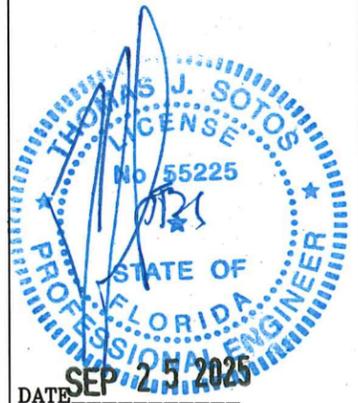


THOMAS J. SOTOS, P.E.
FL P.E. LIC. # 55225

SHEET DESCRIPTION:
DESIGN LOAD CHART WITH
GLASS OPTIONS (XOX UN-EQUAL
LITE) AND NOTES


DRAWN BY:	DATE:
N. Erazo	12/18/2023
REV. BY:	DATE:
N. Erazo	09/05/2025
DWG #:	REV #:
CWS-1250	A
SCALE:	SHEET
--	8 OF 10

HS-8700 FLANGE FRAME WINDOW BILL OF MATERIALS				
ITEM #	PART #	REQD.	DESCRIPTION	REMARKS
1	L-7703	1	FRAME HEAD	6063-T6 ALUMINUM
2	L-8701	1	FRAME SILL	6063-T6 ALUMINUM
3	L-7701	1	FRAME FXD. JAMB	6063-T6 ALUMINUM
4	L-7704	1	FRAME FIXED MEETING RAIL	6063-T6 ALUMINUM
5	L-7705	1	VENT MEETING RAIL	6063-T6 ALUMINUM
6	L-7707	1	VENT TOP/BOTTOM RAIL	6063-T6 ALUMINUM
7	L-8702	1	FRAME VENT JAMB	6063-T6 ALUMINUM
8	L-7706	1	VENT JAMB LATCH RAIL	6063-T6 ALUMINUM
9	L-8703	1	FRAME SILL TRACK	6063-T5 ALUMINUM
10	L-8704	1	FRAME SILL RETAINING CLIP	6063-T5 ALUMINUM
11	L-7708	AS REQ'D.	GLAZING BEAD (3/8")	6063-T5 ALUMINUM
12	FS-006	AS REQ'D.	FRAME ASSEMBLY SCREWS	#8 X 1" P.H. /SQ. RECESS
13	FS-040	AS REQ'D.	INSTALLATION SCREWS	#14 SMS F.H./PHIL.
14	L-7531	AS REQ'D.	VINYL BULB	1/4" DIA. BULB #3033
15	PWS-003	AS REQ'D.	FIN SEAL WEATHERSTRIP	.187" w x .230" h
16	PWS-005	AS REQ'D.	FIN SEAL WEATHERSTRIP	.187" w x .350" h
17	PWS-009	AS REQ'D.	FIN SEAL WEATHERSTRIP	.187" w x .310" h
18	L-7709	AS REQ'D.	GLAZING BEAD (INSULATED)	6063-T5 ALUMINUM
19	PWS-001	AS REQ'D.	PILE @ GLAZING BEAD	.187" w x .150" h
20	L-8752	1	FRAME H.D. MEETING RAIL	6063-T6 ALUMINUM
21	L-7539	2	VENT EXTRUDED SPRING LATCH	6063-T5 ALUMINUM
22	HC-057-1	2	VENT MOLDED SPRING LATCH	MOLDED NYLON
23	L-7523	1 x LATCH	LATCH SPRING	STAINLESS STEEL
24	*	2	SILL/JAMB JOINT GASKET	1/16" CLOSED CELL FOAM
25	FS-041	2	SILL RAIL ASSEMBLY SCREW	#8 X 2 1/4" P.H./PHIL.
26.1	HC-044-1	2	WEEP FLAP & BAFFLE	*
26.2	HC-	1 X WEEP	OPEN CELL FOAM PAD	1/2" X 1/2" X 2" L.
27	HC-040-1	2	SASH ROLLER & HOUSING	*
28	HC-026-1	1	SCREEN FRAME & MESH	*
29	*	1	ATTACHMENT SCREW @ CLIP	#8 X 5/8" S.D.S.
30	HC-058-1	2	VENT SWEEP LATCH	MOLDED NYLON
31	HC-059-1	2	VENT SWEEP LATCH	DIE CAST METAL
32	L-8830	1 X Anchor	FRAME SILL ANCHOR CLIP	6063-T5 ALUMINUM
33	*	2	LAMINATED GLASS	See Details @ L.H. of sheet 9
40 a	"TrueSeal"	AS REQ'D.	Insulated Glass Swiggle Seal	1/4" air space
40 b	"Quanex"	AS REQ'D.	Insulated Glass SuperSpacer	1/4" air space
40 c	"Quanex"	AS REQ'D.	Insulated Glass Duraseal	1/4" air space
34	*	AS REQ'D.	GLAZING SILICONE	See Details @ L.H. of sheet 9
35	L-8301	1	FRAME SILL	6063-T6 ALUMINUM
36	L-8302	1	FRAME SILL RETAINING CLIP	6063-T5 ALUMINUM
37	L-4205	AS REQ'D.	GLAZING BEAD (7/16")	6063-T5 ALUMINUM
38	SEALANT	AS REQ'D.	ACRYL-R JOINT SEALANT	SM-5504/5591
39	*	AS REQ'D.	EXT. GRADE PERIMETER CAULK	OSI POLYSEAMSEAL

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 25-0929.04
Expiration Date 9/11/2027
By *[Signature]*
Miscel Data Product Control

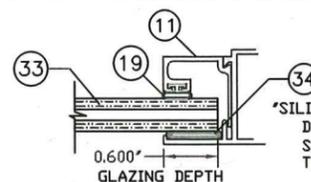

SILICONE OPTIONS
DOW CORNING 899
SCHNEE-MOREHEAD 5731
TREMCO SPECTRUM 2

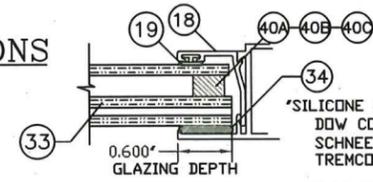

SILICONE OPTIONS
DOW CORNING 899
SCHNEE-MOREHEAD 5731
TREMCO SPECTRUM 2

GLAZING DETAILS AND OPTIONS

LAMINATED GLASS COMPOSITION - TYPE B			
ITEM	GLASS DESCRIPTION	DETAIL	LAMINATE DESCRIPTION
1	1/8" ANNEALED GLASS		SAFLEX PVB by Eastman Chemical co.
2	0.090" PLASTIC INTERLAYER		
3	1/8" ANNEALED GLASS		


LAMINATED GLASS COMPOSITION - TYPE D			
ITEM	GLASS DESCRIPTION	DETAIL	LAMINATE DESCRIPTION
1	1/8" HEAT-STRENGTHENED GLASS		TROSIFOL PVB by Kuraray America, Inc.
2	0.090" PLASTIC INTERLAYER		
3	1/8" HEAT-STRENGTHENED GLASS		

LAMINATED GLASS COMPOSITION - TYPE E			
ITEM	GLASS DESCRIPTION	DETAIL	LAMINATE DESCRIPTION
1	1/8" HEAT-STRENGTHENED GLASS		SAFLEX PVB by Eastman Chemical co.
2	0.090" PLASTIC INTERLAYER		
3	1/8" HEAT-STRENGTHENED GLASS		

LAMINATED GLASS COMPOSITION - TYPE F			
ITEM	GLASS DESCRIPTION	DETAIL	LAMINATE DESCRIPTION
1	1/8" ANNEALED GLASS		TROSIFOL PVB by Kuraray America, Inc.
2	0.090" PLASTIC INTERLAYER		
3	1/8" ANNEALED GLASS		

LAMINATED GLASS COMPOSITION - TYPE I			
ITEM	GLASS DESCRIPTION	DETAIL	LAMINATE DESCRIPTION
1	3/16" HEAT-STRENGTHENED GLASS		SAFLEX "STORM" by Eastman Chemical co.
2	0.077" PLASTIC INTERLAYER		
3	3/16" HEAT-STRENGTHENED GLASS		

* Tempered glass and Laminated Glass marked and in compliance with Section 2406 Safety Glazing: CPSC 16 CFR Part 1201" or "ANSI Z97.1-2015.

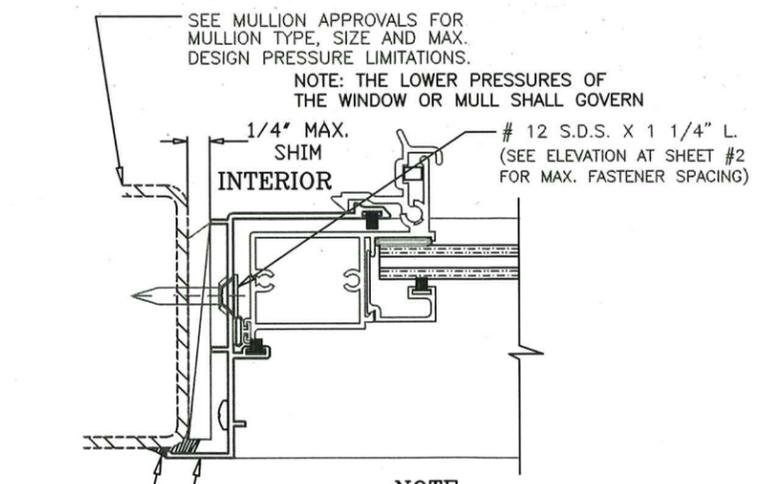

NOTE:
1. ALL STEEL IN CONTACT WITH ALUM. TO BE PAINTED OR PLATED.
2. METAL STRUCTURES:
A) STEEL : Fy = 36 KSI MIN. (STEEL 18 GA. MIN. THICK - 0.048")
B) ALUMINUM : 6063-T5 MIN. (ALUM. 0.078" MIN. THICK)

E1 METAL STRUCTURE ATTACHMENT DETAIL

INSULATED LAMINATED GLASS COMPOSITION TYPE A			
ITEM	GLASS DESCRIPTION	DETAIL	LAMINATE DESCRIPTION
1	1/8" ANNEALED GLASS		SAFLEX PVB by Eastman Chemical co.
2	0.090" PLASTIC INTERLAYER		
3	1/8" ANNEALED GLASS		
4	1/4" INSULATED AIR SPACE		
5	1/8" ANNEALED GLASS (*)		


INSULATED LAMINATED GLASS COMPOSITION TYPE C			
ITEM	GLASS DESCRIPTION	DETAIL	LAMINATE DESCRIPTION
1	1/8" ANNEALED GLASS		TROSIFOL PVB by Kuraray America, Inc.
2	0.090" PLASTIC INTERLAYER		
3	1/8" ANNEALED GLASS		
4	1/4" INSULATED AIR SPACE		
5	1/8" ANNEALED GLASS (*)		

INSULATED LAMINATED GLASS COMPOSITION TYPE G			
ITEM	GLASS DESCRIPTION	DETAIL	LAMINATE DESCRIPTION
1	1/8" HEAT-STRENGTHENED GLASS		TROSIFOL PVB by Kuraray America, Inc.
2	0.090" PLASTIC INTERLAYER		
3	1/8" HEAT-STRENGTHENED GLASS		
4	1/4" INSULATED AIR SPACE		
5	1/8" ANNEALED GLASS (*)		

(*) WINDOWS WITH GLASS TYPES "A, C, OR G" INSTALLED ABOVE 30FT. IN THE HVHZ, THE I.G. EXTERIOR LITE SHALL BE TEMPERED.

INSULATED LAMINATED GLASS COMPOSITION TYPE H			
ITEM	GLASS DESCRIPTION	DETAIL	LAMINATE DESCRIPTION
1	1/8" HEAT-STRENGTHENED GLASS		TROSIFOL PVB by Kuraray America, Inc.
2	0.090" PLASTIC INTERLAYER		
3	1/8" HEAT-STRENGTHENED GLASS		
4	1/4" INSULATED AIR SPACE		
5	1/8" TEMPERED GLASS		

- 40 Insulated Spacer Types & Options
 40 a) "TrueSeal" Swiggle Seal
 40 b) "Quanex" SuperSpacer w/ Isomelt M
 40 c) "Quanex" Duraseal

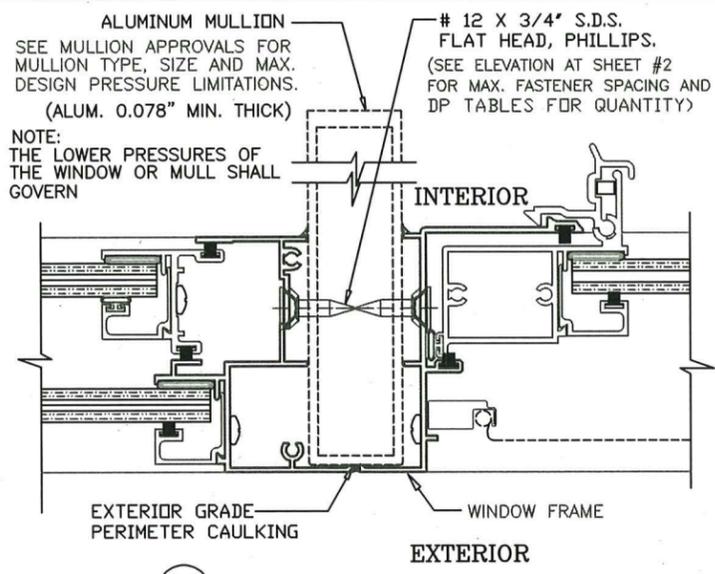


NOTE:
THE LOWER PRESSURES OF THE WINDOW OR MULL SHALL GOVERN

E2 FRAME MULLING DETAIL



7200 ALUMINUM HORIZONTAL SLIDER - IMPACT FLANGE FRAME

NO.	DESCRIPTION	BY	DATE
A	Revises NDA # 23-101004	N.E.	09/05/25

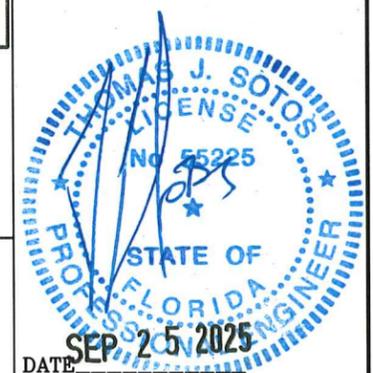

THOMAS J. SOTOS, P.E.
FL P.E. LIC. # 55225

SHEET DESCRIPTION:	
GLAZING DETAILS, MULLION DETAILS, AND BILL OF MATERIALS	
DRAWN BY:	DATE:
N. Erazo	12/18/2023
REV. BY:	DATE:
N. Erazo	09/05/2025
DWG #:	REV #:
CWS-1250	A
SCALE:	SHEET
---	9 OF 10

