



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)  
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY  
PRODUCT CONTROL SECTION

11805 SW 26 Street, Room 208  
Miami, Florida 33175-2474  
T (786) 315-2590 F (786) 315-2599  
[www.miamidade.gov/economy](http://www.miamidade.gov/economy)

## NOTICE OF ACCEPTANCE (NOA)

Sentrigard Metal Systems LLC.  
1000 Dillard Drive  
Forest, VA 24551

### SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER - Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (in Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code including the High Velocity Hurricane Zone of the Florida Building Code.

### DESCRIPTION: Sentrigard ML200 Roof Panel 18" wide x 24 Ga. Steel over Steel Deck

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of pages 1 through 9.

The submitted documentation was reviewed by Rafael Macedo.

12/25/25



NOA No.: 25-1112.14  
Expiration Date: 12/25/30  
Approval Date: 12/25/25  
Page 1 of 9

## ROOFING ASSEMBLY APPROVAL:

|                                       |                              |
|---------------------------------------|------------------------------|
| <b><u>Category:</u></b>               | Roofing                      |
| <b><u>Sub-Category:</u></b>           | Non-Structural Metal Roofing |
| <b><u>Material:</u></b>               | Steel                        |
| <b><u>Deck Type:</u></b>              | Steel                        |
| <b><u>Maximum Design Pressure</u></b> | See Table A                  |

## TRADE NAMES OF PRODUCTS MANUFACTURED OR LABELED BY APPLICANT:

| <b><u>Product</u></b> | <b><u>Dimensions</u></b>                                                                     | <b><u>Test Specifications</u></b> | <b><u>Product Description</u></b>                                                                                                   |
|-----------------------|----------------------------------------------------------------------------------------------|-----------------------------------|-------------------------------------------------------------------------------------------------------------------------------------|
| ML200                 | l = various<br>Height: 2.0"<br>w = 18"<br>Thickness 0.0220<br>Min. Yield Strength: 61.9 ksi. | TAS 110<br>TAS 125                | Corrosion resistant, steel, coated nailstrip panel.                                                                                 |
| ML200 Clip            | Length: 3"<br>Width: 2"<br>Thickness 0.0276"                                                 | TAS 125                           | Corrosion resistant, galvalume, preformed, coated, pre-finished, metal clips for use in Field or Perimeter and Corner Area of Roof. |
| Steel Strap           | min. 24 ga.<br>4-1/2" long x<br>3/4" high                                                    | TAS 110                           | Corrosion resistant, formed, continuous steel strap for metal panel installation.                                                   |
| Trim Pieces           | l = varies<br>w = varies<br>Thickness 0.0220                                                 | TAS 110                           | Standard flashing and trim pieces.<br>Manufactured for each panel width.                                                            |

## TRADE NAMES OF PRODUCTS MANUFACTURED OR LABELED BY OTHERS:

| <b><u>Product</u></b>                     | <b><u>Product Description</u></b>                                                                               | <b><u>Test Specifications</u></b> | <b><u>Manufacturer (with current NOA)</u></b> |
|-------------------------------------------|-----------------------------------------------------------------------------------------------------------------|-----------------------------------|-----------------------------------------------|
| Titebond Metal Roof Weathermaster Sealant | One component, elastomeric polymer sealant.                                                                     | TAS 132                           | Franklin International                        |
| FT Synthetics Platinum HTB                | Self-adhering, waterproofing membrane made with butyl rubber adhesive used in steep slope roofing applications. | ASTM D 1970                       | FT Synthetics, Inc.                           |



**EVIDENCE SUBMITTED:**

| <b><u>Test Agency</u></b>                 | <b><u>Test Identifier</u></b> | <b><u>Test Name/Report</u></b> | <b><u>Date</u></b> |
|-------------------------------------------|-------------------------------|--------------------------------|--------------------|
| Farabaugh Engineering and Testing<br>Inc. | T234-21                       | TAS 125-03                     | 10/18/21           |
|                                           |                               | ASTM E 8-21                    |                    |
|                                           | T251-21                       | TAS 100                        | 10/09/21           |
| Fluropon                                  |                               | ASTM B 117                     | 05/30/19           |
| Fluropon                                  |                               | ASTM G 152                     | 05/30/19           |



## APPROVED ASSEMBLIES:

|                                 |                                                            |
|---------------------------------|------------------------------------------------------------|
| <b>System:</b>                  | ML200 Roof Panel 15" wide x 26 Ga. Steel                   |
| <b>Deck Type:</b>               | Steel, Insulated                                           |
| <b>Deck Description:</b>        | Metal roof deck 22 MSG, G60 coated steel, Minimum 62.5ksi. |
| <b>Slope Range:</b>             | 2": 12" or greater                                         |
| <b>Maximum Uplift Pressure:</b> | See Table A below                                          |

---

|                            |                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                             |
|----------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <b>Deck Attachment:</b>    | Minimum 22 gauge steel deck shall be secured 6" o.c. to structural supports spaced a maximum of 5 ft. o.c. with one (1) ¼-20 x 1-1/2" long tek 5 fastener at every low cell into the support. Deck sidelaps shall be fastened 1' o.c. with ¼-14 x 7/8" long tek fasteners.                                                                                                                                                                                                                                                  |
| <b>Insulation:</b>         | Minimum ¾" thick and Maximum 4" thick of an approved rigid board insulation with current NOA having a minimum 20psi compressive strength. Followed by a ½" layer of Georgia Pacific "Dens Deck" fastened with approved fasteners and plates as noted below under the "underlayment" section. Fastening density shall be in compliance with applicable Building Code and Roofing Application Standard RAS 117.                                                                                                               |
| <b>Underlayment:</b>       | <p>Minimum underlayment shall be a ASTM D 226 Type II installed with a minimum 4" sidelaps and 6" end-laps. Underlayment shall be fastened with corrosion resistant tin-caps and 1¼" annular ring-shank nails, spaced 6" o.c. at all laps and two staggered rows 12" o.c. in the field of the roll. Or, any Miami-Dade County Product Control Approved underlayment having a current NOA.</p> <p>Additionally, install a layer of FT Synthetics Platinum HTB (ice and water shield) underlayment to top of cover board.</p> |
| <b>Fire Barrier Board:</b> | Any approved fire barrier having a current NOA. Refer to a current fire directory listing for fire ratings of this roofing system assembly as well as the location of the fire barrier within the assembly. See Limitation # 1.                                                                                                                                                                                                                                                                                             |
| <b>Valleys:</b>            | Valley construction shall be in compliance with Roofing Application Standard RAS 133 and with Sentrigard's current published installation instructions.                                                                                                                                                                                                                                                                                                                                                                     |



**Metal Panels and Accessories:**

Install the "ML200 Panel" and accessories in compliance with the current published installation instructions and details in Sentrigard's Installation Manual. Flashings, penetrations, valley construction and other details shall be constructed in compliance with Roofing Application Standard RAS 133.

Panels shall be installed with approved clips and (2) two corrosion resistant #14-13 self-tapping pancake screws of sufficient length to penetrate through the deck a minimum of  $\frac{1}{2}$ ". Panel seams shall be Fastening shall start 3" from panel end and shall be at maximum spacing as described below in **Table A**.

Attach adjacent panel by placing the female rib over the male rib and clip. Standing seams shall be hand crimped to a 90 degree single lock, then mechanically seamed to a full 180 degree seam, (double lock).

*For the second perimeter and corner condition option*, before installing the panels, install steel strap running vertically up the slope with #14-13 self-tapping pancake screws, 12" o.c. in a staggered pattern. Steel strap shall be caulked with a minimum  $\frac{3}{8}$ " bead of Titebond Metal Roof Weathermaster Sealant on each side of steel strap prior to roof panel anchorage. Install one steel strap underneath the center of each panel.

| TABLE A<br>MAXIMUM DESIGN PRESSURES                                                               |            |                                   |                                     |
|---------------------------------------------------------------------------------------------------|------------|-----------------------------------|-------------------------------------|
| Roof Areas                                                                                        | Field 1    | Perimeter and Corner <sup>1</sup> | Perimeter and Corner <sup>1,2</sup> |
| Maximum Design Pressures                                                                          | -69.65 psf | -81 psf                           | -104.75 psf                         |
| Maximum Clip Spacing                                                                              | 24" o.c.   | 12" o.c.                          | 12" o.c.                            |
| 1. Extrapolation shall not be allowed                                                             |            |                                   |                                     |
| 2. Steel Strap with Titebond Metal Roof Weathermaster Sealant installed as per description above. |            |                                   |                                     |



## SYSTEM LIMITATIONS


1. Fire classification is not part of this acceptance; refer to a current Approved Roofing Materials Directory for fire ratings of this product.
2. The maximum designed pressure listed herein shall be applicable to all roof pressure zones (i.e. field, perimeters, and corners). Neither rational analysis, nor extrapolation shall be permitted for enhanced fastening at enhanced pressure zones (i.e. perimeters, extended corners and corners).
3. Panels may be rolls formed in continuous lengths from eave to ridge. Maximum lengths shall be as described in Roofing Application Standard RAS 133
4. All panels shall be permanently labeled with the manufacturer's name and/or logo, and the following statement: "Miami-Dade County Product Control Approved" **or** with the Miami-Dade County Product Control Seal as seen below. All clips shall be permanently labeled with the manufacturer's name and/or logo, and/or model.




5. All products listed herein shall have a quality assurance audit in accordance with the Florida Building Code and Rule 61G20-3 of the Florida Administrative Code.
6. Panels may be jobsite roll formed with machine model # **Q98631039A**




## DRAWINGS

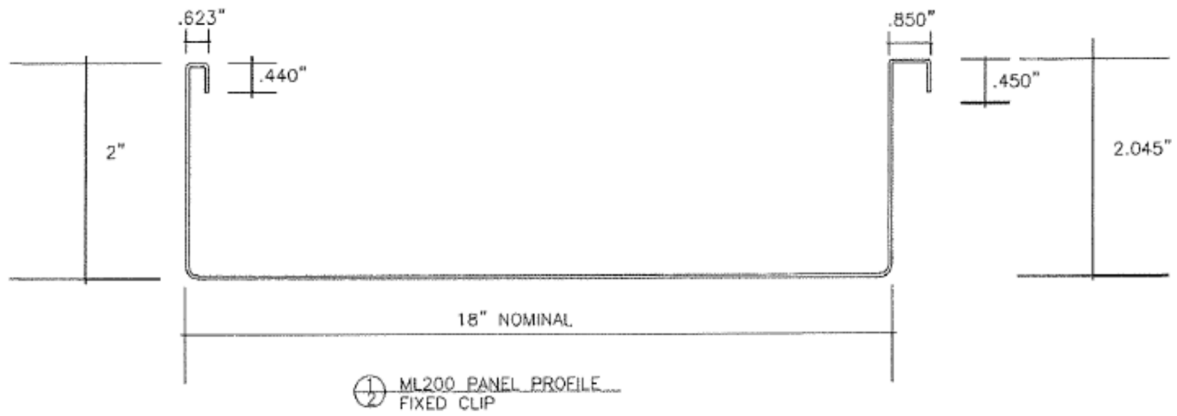


### ML200 PANEL PROFILE

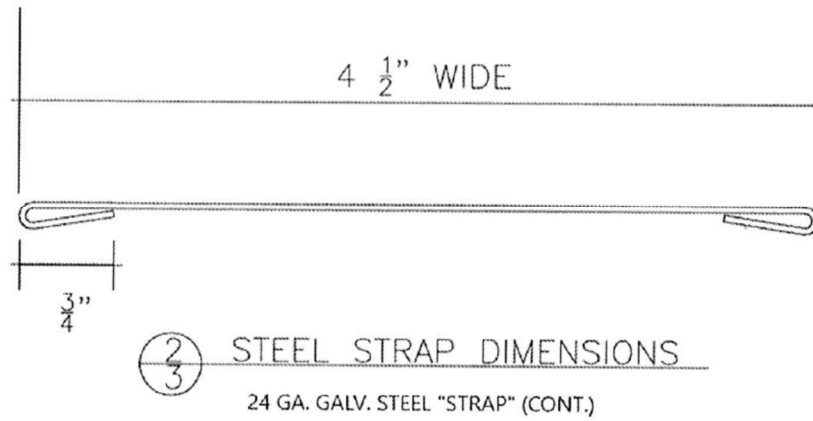


### STEEL STRAP

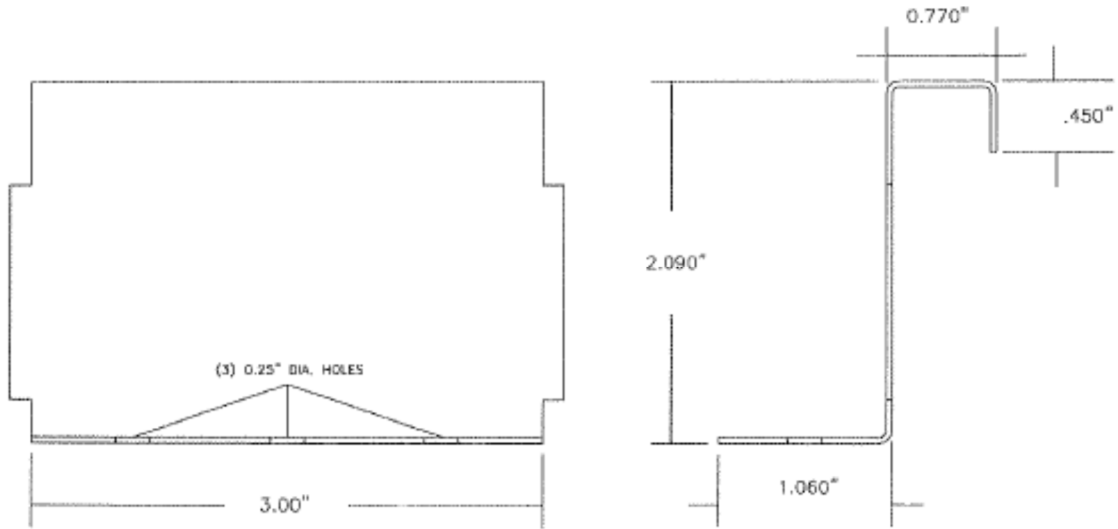

**ML200 PANEL CLIP**

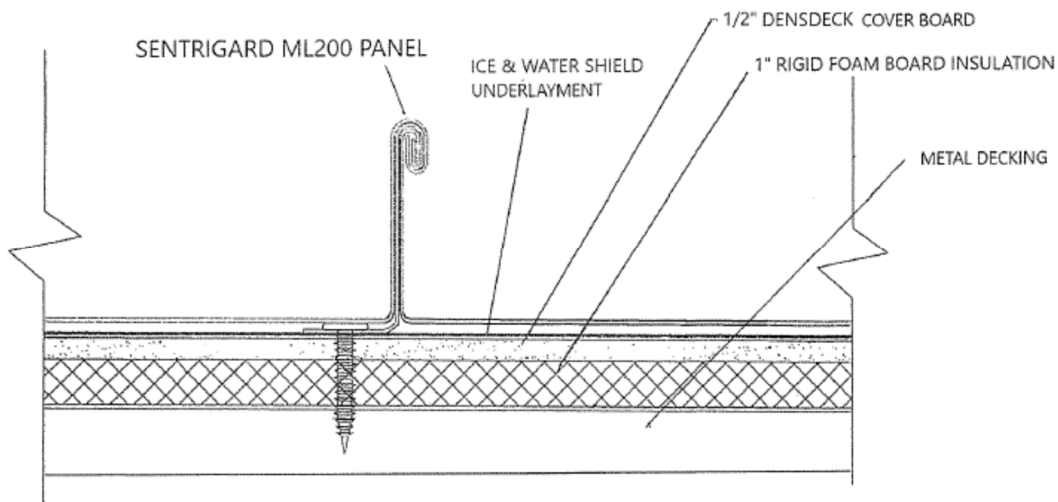

**PANEL ASSEMBLY VIEW  
(WITHOUT STEEL STRAP)**

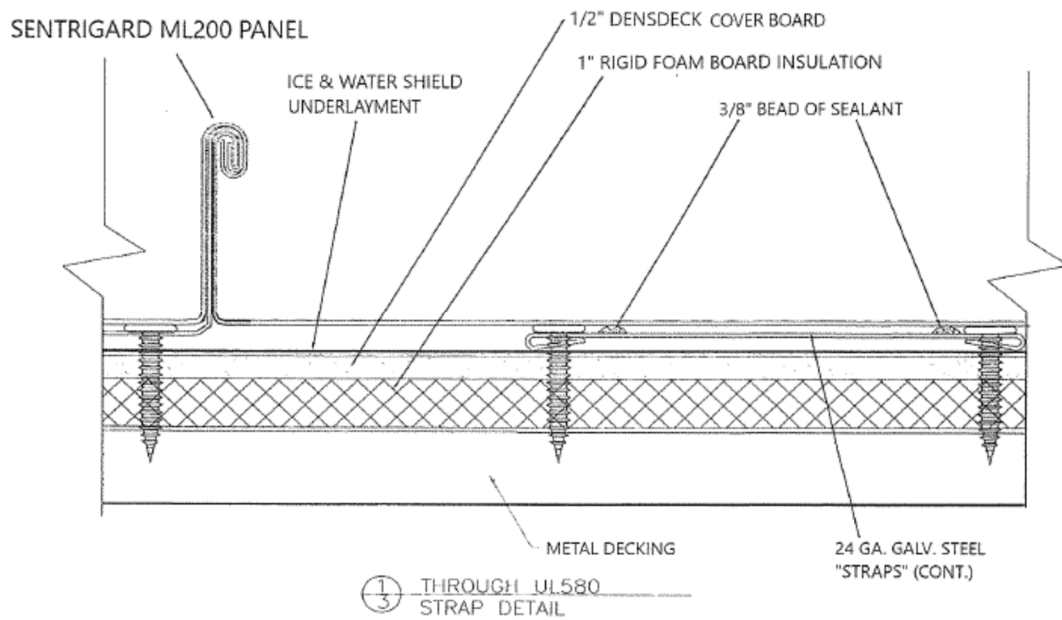

**PANEL ASSEMBLY VIEW  
(WITH STEEL STRAP)**

**END OF THIS ACCEPTANCE**