



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

**MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION**

11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786)315-2590 F (786) 315-2599

www.miamidade.gov/economy

Air Vent, Inc.
4117 Pinnacle Point Drive, Suite 400
Dallas, TX 75211

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER -Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code including the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: ShingleVent Roll Ridge Vent Filtered and Unfiltered

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of pages 1 through 6.
The submitted documentation was reviewed by Rafael Macedo.

03/26/26



NOA No.: 26-0205.02
Expiration Date: 03/26/31
Approval Date: 03/26/26
Page 1 of 6

ROOFING ASSEMBLY APPROVAL

Category: Roofing
Sub-Category: Ventilation
Material: Plastic
Minimum Slope: 2:12

TRADE NAMES OF PRODUCTS MANUFACTURED OR LABELED BY APPLICANT

<u>Manufactured by Applicant</u>	<u>Dimensions</u>	<u>Test Specifications</u>	<u>Product Description</u>
ShingleVent Roll Ridge Vent Filtered and Unfiltered	Length: 30' Width: 13.35" Height: 5/8"	TAS 100(A)	Low profile attic ridge vent in roll form for installation under ridge shingles.

MANUFACTURING LOCATION

1. ML-2

EVIDENCE SUBMITTED

<u>Test Agency</u>	<u>Test Identifier</u>	<u>Test Name/Report</u>	<u>Date</u>
PRI Construction Materials	123T0019	ASTM D 635	01/09/26
Technologies	123T0019	ASTM D 1929	01/09/26
	123T0019	ASTM D 2843	01/09/26
	123T0028	ASTM G155	01/09/26
	123T0012.1	TAS 100(A)	01/22/24



NOA No.: 26-0205.02
Expiration Date: 03/26/31
Approval Date: 03/26/26
Page 2 of 6

APPROVED ASSEMBLIES

Trade name:	ShingleVent Roll Ridge Vent Filtered and Unfiltered
System Type:	Mechanical attachment of ridge vent over asphalt shingle roof systems only.
Cutout:	Cut a slot 1-1/4in wide and 6in from the ends. Miami Dade Approved roof sealant applied 1-1/2in from the cut-slot.
Installation:	Center the vent over the ridge and attach with 12ga, 1-3/4in ring shank nails through premade mounting holes. Miami Dade Approved sealant was placed between the shingles and the leading edge of the vent on the outside edge. Install pre-manufactured or field cut ridge shingles over the ridge vent in compliance with the shingle manufacturer's current approved Notice of Acceptance, and the shingle and ridge vent's installation instructions. Nails shall be of sufficient length to penetrate through the sheathing a minimum 1/8".
Net Free Area:	Refer to manufacturer's published literature
Minimum Slope:	2:12

LIMITATIONS:


1. Refer to applicable building codes for required ventilation.
2. This acceptance is for installations on asphalt shingle roof systems only.
3. ShingleVent Roll Ridge Vent shall not be installed on roof mean heights greater than 33 feet.
4. All products listed herein shall have a quality assurance audit in accordance with the Florida Building Code and Rule 61G20-3 of the Florida Administrative Code.
5. All approved products listed herein shall be labeled and shall bear the imprint or identifiable marking of the manufacturer's name or logo, city and state of manufacturing facility, and following statement: "Miami-Dade County Product Control Approved" or the Miami-Dade County Product Control Seal as shown below.



INSTRUCTIONS FOR CUTTING SLOTS


HIP AND GABLE ROOFS

Cut slot 3/4" on either side of ridge centerline or from ridge board and to within 6" of end wall or hip intersection.

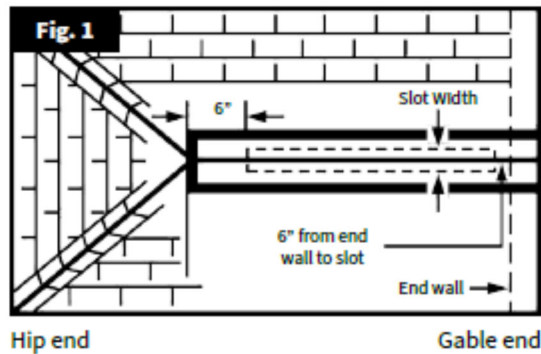


"L" AND "T" SHAPED ROOFS

Cut slot, as per Fig. 1 and run the vent across long ridge. On short ridge, cut slot to within 12" of junction point and run the vent from end of roof to butt against crossing ridge vent.

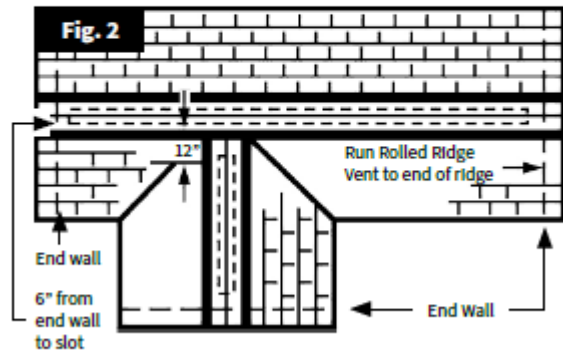


CHIMNEYS


Cut slots to within 12" of chimney. Run the vent from end of roof to butt against chimney.

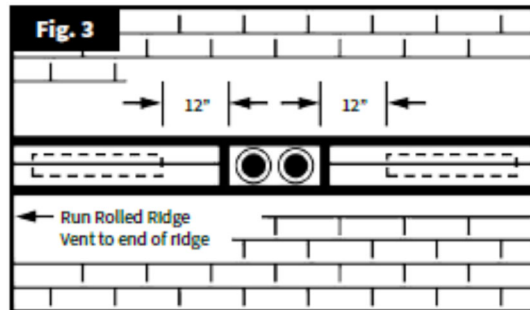

INSTALLATION INSTRUCTIONS

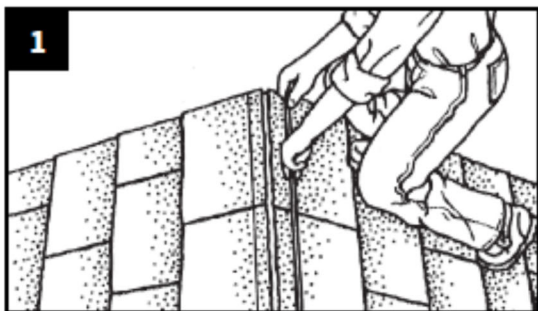


On existing roofs, remove cap shingles. Mark slot width at both ends of ridge. Use slot guides imprinted on vent and refer to instructions for cutting slot. Snap chalk line on both sides of ridge.

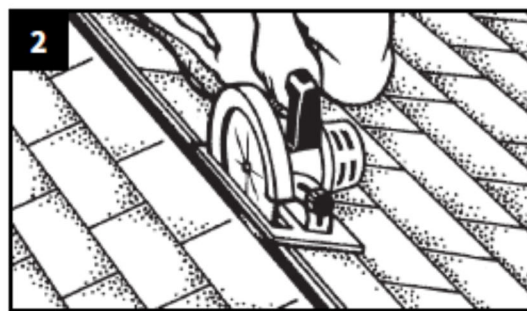

Cut slot (plumb cut, if possible). Refer to instructions for cutting slot for slot dimensions. Remove debris from slot.



Roll out and center vent over slot. End should be flush with end of roof. Make sure vent's support walls sit flat on the roof, and that filter is secure between shingles and vent, if applicable. Nail one end of the vent first utilizing supported nail holes which are located along the Vent Nail Line. Continue nailing the vent while working your way along the vent.

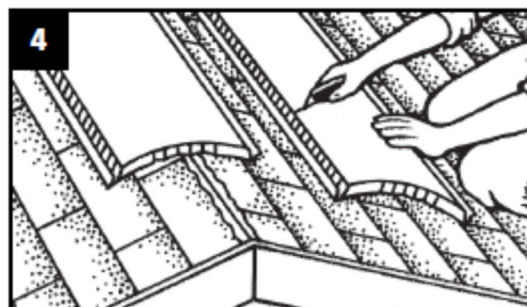


Use utility knife to cut final section to length. End of final section should be flush with end of roof, being sure the built-in end plug is exposed. For ridge lengths shorter than the product, cut product to length. Then cut at nearest, correctly oriented, end plug. Reverse this short section to have end plug flush with end of roof.



Nail cap shingles in place being sure the nails penetrate the underside of the roof deck along the shingle nail line. Apply sealant to any noticeable gaps between the roll vent and shingles.

DETAIL DRAWINGS

ShingleVent Roll Ridge Vent

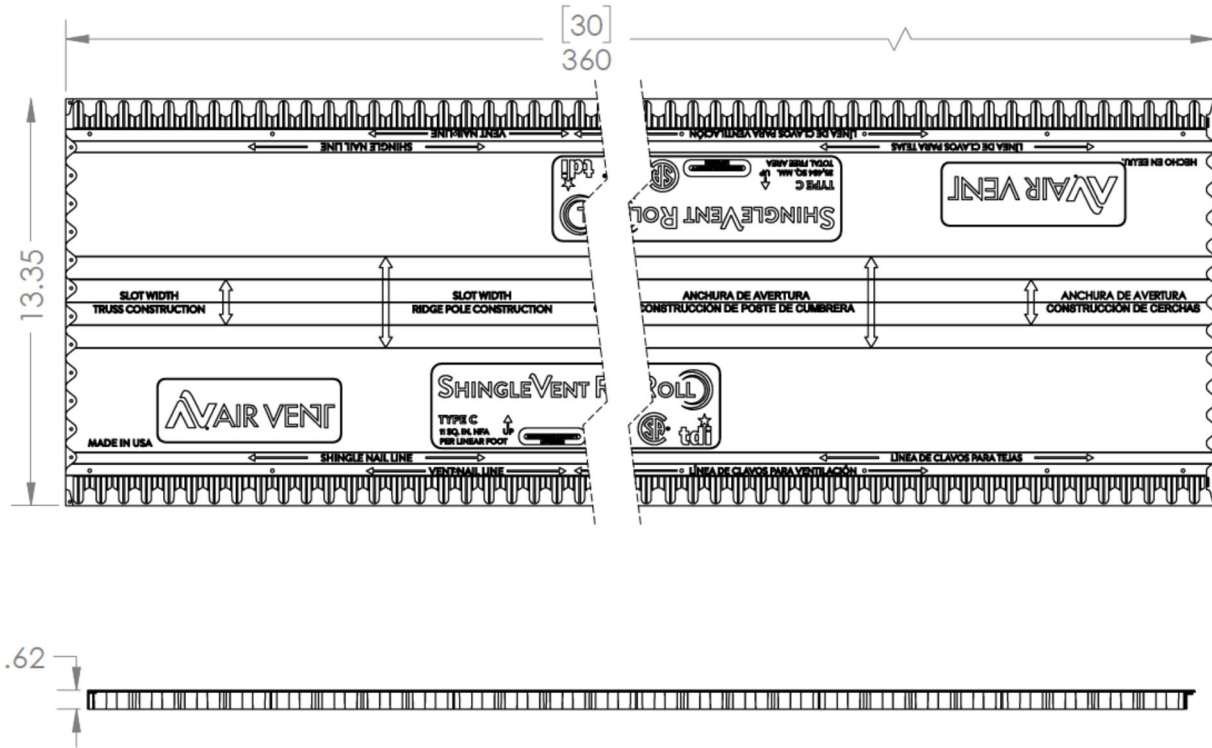

END OF THIS ACCEPTANCE