



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

Securitech Group, Inc., a subsidiary of ASSA ABLOY
225 Episcopal Rd.,
Berlin, CT 06037

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/ or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "5000/7000/8000/ABM" Multi Locking Hardware for Single Inswing Doors - Component Approval – L.M.I. (Level E)

APPROVAL DOCUMENT: Drawing No. **113517-03**, titled "Miami-Dade County Component NOA for Single Inswing Doors - Securitech 5000/7000/8000/ABM Series", sheets 1 through 5 of 5, dated 12/04/25, with revision 2 dated 02/17/26, prepared by manufacturer, signed and sealed by Gordon D. Thomas, P.E., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number & approval date by the Miami-Dade County Product Control Section..

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/ or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.


ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA (Spinoff File No. **25-0527.03**) consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**




3/18/26

NOA No. 26-0213.04
Expiration Date: March 26, 2031
Approval Date: March 26, 2026
Page 1

Securitech Group, Inc., a subsidiary of ASSA ABLOY

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
(Submitted under NOA No. 26-0213.04)
2. Drawing No. **113517-03**, titled "Miami-Dade County Component NOA for Single Inswing Doors - Securitech 5000/7000/8000/ABM Series", sheets 1 through 5 of 5, dated 12/04/25, with revision 2 dated 02/17/26, prepared by manufacturer, signed and sealed by Gordon D. Thomas, P.E.

B. TESTS

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of Securitech multi-point hardware locking exit devices tested in Gensteel 4'4"x9'4" single inswing steel door (specimen D1) and 8'4"x9'4" double outswing doors (specimen A1, B1 and C1), issued to Gensteel Doors, prepared by QAI Laboratories, Test Report No. **22-1078aR3**, dated 01/06/25 and revised on 02/28/24, 04/28/25 and 06/12/25, signed and sealed by Idalmis Ortega, P.E.
(Note: This test report was authorized by Gensteel Doors to Securitech Group, Inc., to obtain Component approval)

C. CALCULATIONS


1. None.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS

1. None.

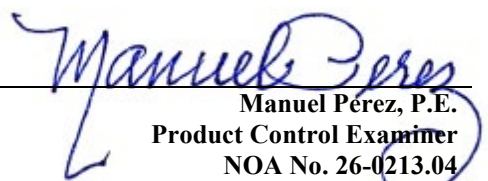
Manuel Pérez, P.E.
Product Control Examiner
NOA No. 26-0213.04
Expiration Date: March 26, 2031
Approval Date: March 26, 2026

Securitech Group, Inc., a subsidiary of ASSA ABLOY

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

F. STATEMENTS

1. Statement letter of conformance, complying with **FBC 8th Edition (2023)** and no financial interest, dated February 22, 2026, issued by manufacturer, signed and sealed by Gordon D. Thomas, P.E.
2. Statement letter dated May 23, 2025, issued by Gensteel Doors, authorizing Securitech Group Inc., to use test reports No. **22-1078aR3** and **MED-0043aR4** to obtain Component NOA(s), signed by Hamidreza Alipour, Mechanical Engineer - Gensteel Doors, Inc.
3. Statement letter dated 12/05/25, issued by ASSA ABLOY group acquisition on OCT 03, 2023, of Securitech Group, Inc. and manufacturing plant, assets, equipment, relocated in Berlin, Connecticut. The acquisition includes all intellectual property, product approval, listing, patents, trademarks and related rights of Securitech Group Inc., signed by Adam Dowden, Director Securitech and Doug Thompson, President ASSA ABLOY, Access & Egress Hardware Group.
4. Press release dated October 04, 2023, by ASSA ABLOY Acquiring Securitech Group Inc.
5. Proposal No. **19-0868R-1** issued by the Product Control Section, dated November 09, 2022, signed by Ishaq Chanda, P.E.



G. OTHERS

1. None.



Manuel Pérez, P.E.
Product Control Examiner
NOA No. 26-0213.04
Expiration Date: March 26, 2031
Approval Date: March 26, 2026

REV.	DATE	DESCRIPTION	BY
1	02/11/26	SINGLE INSWING NOA PER MIAMI-DADE RER	YF
2	02/17/26	REVISED PER MIAMI-DADE RER COMMENTS	YF

**COMPONENT LOCKING DEVICE
DOOR OPENING SIZE LIMITATIONS**
(APPROVED DOOR SYSTEM UNDER
SEPARATE APPROVAL)

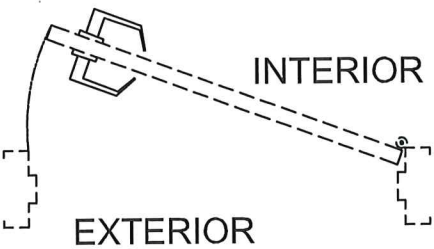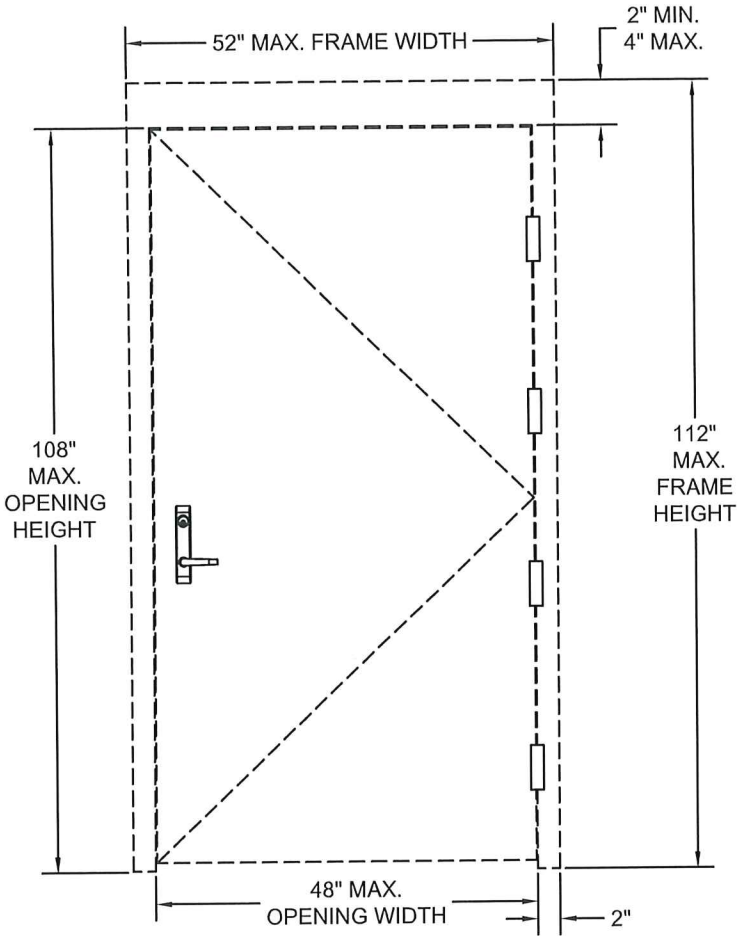

COMPONENT LOCKING DEVICE APPLICATION

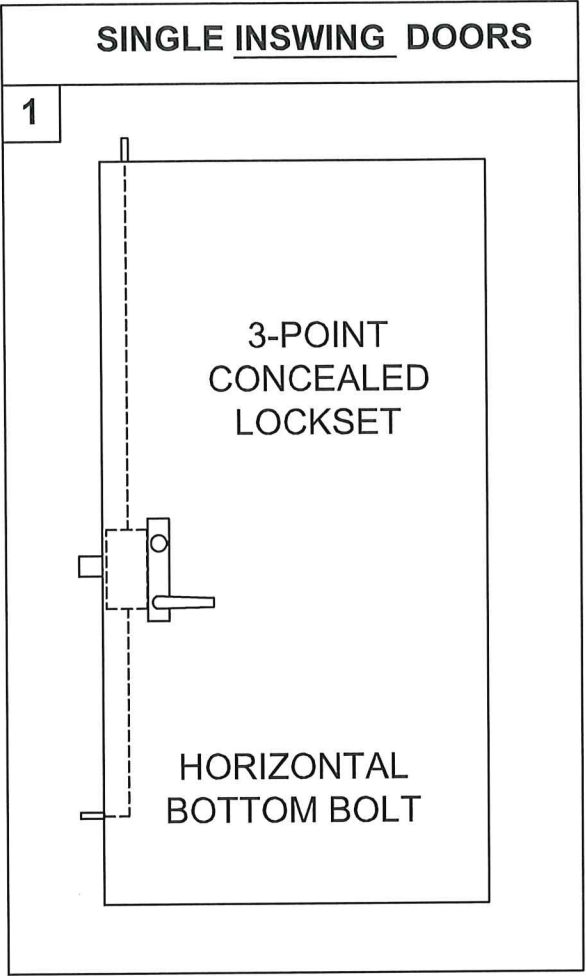

- LIMITATIONS:**
1. INSTALLATION OF THIS MULTI-POINT LOCKING SYSTEM REQUIRES 16 GA. MINIMUM INSWING SINGLE STEEL DOOR AND 16 GA. MINIMUM STEEL FRAME, HOLDING CURRENT LEVEL "E" RATED NOA. LOWER DESIGN PRESSURE RATING OF THE DOOR OR THIS COMPONENT SHALL CONTROL (FOR LEVEL "D" RATED, SEE NOTE 3 ON THIS SHEET) .
 2. LEVEL "E" RATED DOOR PANEL TO HAVE 14 GA. CONTINUOUS VERTICAL 5" WIDE MIN. REINFORCEMENT CHANNEL IN LOCK SIDE, BUTTED BETWEEN 16 GA. MIN TOP AND BOTTOM END CHANNELS.
 3. ELECTRICAL AND ELECTRONIC FUNCTIONS ARE NOT PART OF THIS APPROVAL AND SUCH INSTALLATIONS MUST BE REVIEWED BY CORRESPONDING BUILDING AUTHORITY.
 4. APPROVED LEVEL "E" RATED STEEL SINGLE DOOR PANELS CAN NOT BE WIDER THAN 48" AND HIGHER THAN 108".
 5. SEE TABLE 1.1 ON THIS SHEET FOR HARDWARE SERIES, DESCRIPTION AND DRAWING REFERENCE.

- GENERAL NOTES:**
1. LOCKSETS (COMPONENT APPROVAL) LISTED IN THIS DOCUMENT, HAVE BEEN TESTED TO HVHZ PROTOCOLS TAS-201, TAS-202 AND TAS-203, AND COMPLY WITH 8th EDITION OF FBC (2023) WITH RISK CATEGORY IV IMPACT.

2. THIS COMPONENT APPROVAL IS APPLICABLE TO RISK CATEGORY IV ONLY WHEN USED WITH RISK CATEGORY IV APPROVED DOOR SYSTEMS, TESTED TO LARGE MISSILE IMPACT LEVEL "E".

3. THIS COMPONENT APPROVAL CAN BE USED OUTSIDE OF RISK CATEGORY IV WHEN USED WITH APPROVED DOOR SYSTEM, TESTED TO LARGE MISSILE IMPACT LEVEL "D".

4. ESTABLISHED PERFORMANCE RATINGS ARE:
- | | |
|--------------------------|--|
| POSITIVE DESIGN PRESSURE | +150 PSF |
| NEGATIVE DESIGN PRESSURE | -150 PSF |
| LARGE MISSILE IMPACT | TESTED LEVEL "E" (CAN QUALIFY LEVEL "D" - SEE NOTES 2 & 3) . |

TABLE 1.1

ASSY	DESCRIPTION	HARDWARE SERIES	REF. SHT No.
1	SINGLE INSWING DOOR WITH 3-POINT CONCEALED LOCKSET WITH HORIZONTAL BOTTOM BOLT	53/54XX-IHD-HVL	2
		73/74L-IHD-HVL	2
		83/84L-IHD-HVL	3
		AWDCH-EXX	4
	EXTERIOR LEVER TRIMS	ALL OF THE ABOVE	5



Gordon Thomas, P.E.
3759 Blossom Court
Mason, OH 45040
Florida # 46718

PRODUCT APPROVED
As complying with the Florida
Building Code
NOA-No. **26-0213.04**
Approval Date: **03/26/2026**
By: *Manuel Perez*
Miami-Dade Product Control



ASSA ABLOY









225 Episcopal Rd.
Berlin, CT 06037
(718)392-9000

Securitech, subsidiary of ASSA ABLOY

MIAMI-DADE COUNTY COMPONENT NOA
FOR SINGLE INSWING DOOR ELEVATIONS
SECURITECH LOCKSETS & EXIT DEVICES
5000/7000/8000/ABM SERIES

DATE CREATED 12-04-2025	DRAWN BY YF	DESIGNED BY YF	SCALE N/A	SIZE B
DOCUMENT ID 113517-XX-XXX	DRAWING NUMBER (ALT ID) 113517-03 SHEET 1 OF 5	REV 02		

REV.	DATE	DESCRIPTION	BY
1	2/11/26	SINGLE INSWING NOA PER MIAMI-DADE RER	YF
2	2/17/26	REVISED PER MIAMI-DADE RER COMMENTS	YF

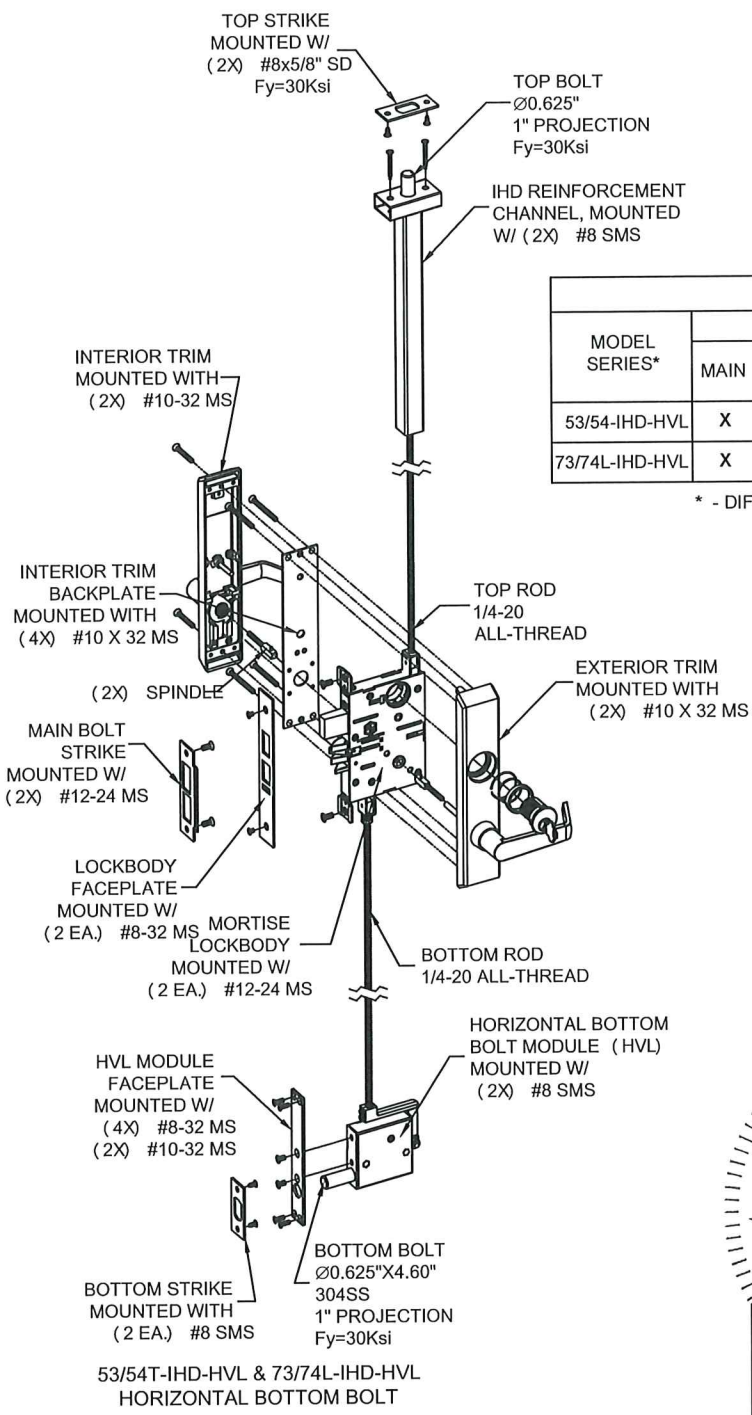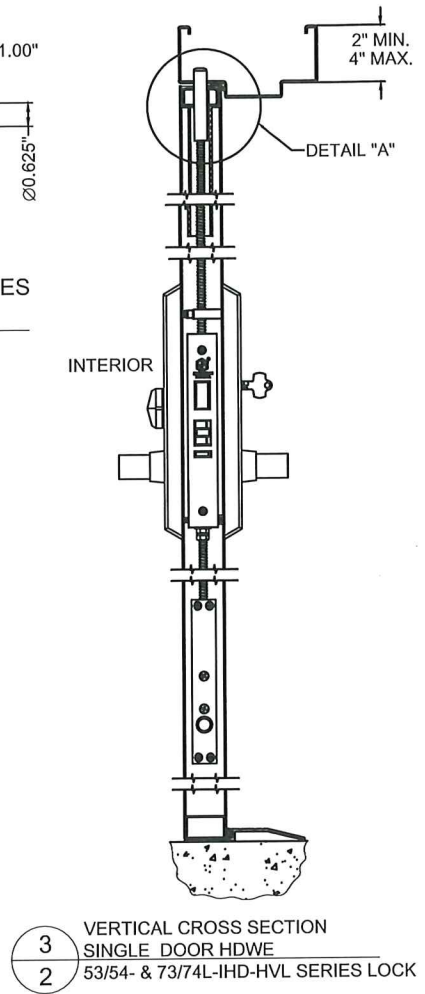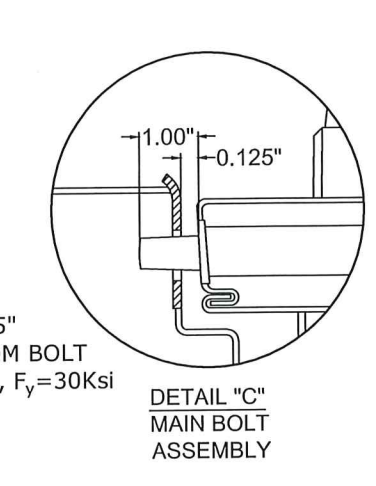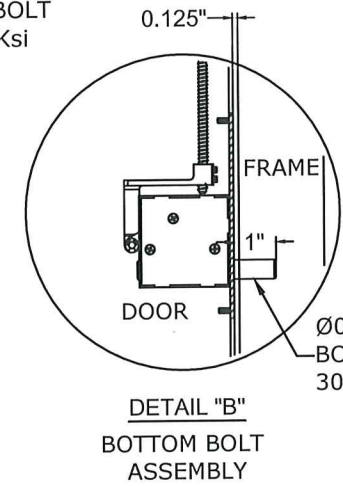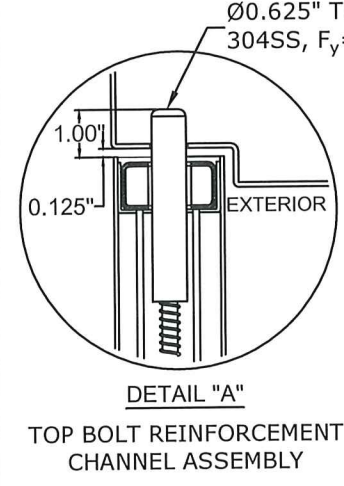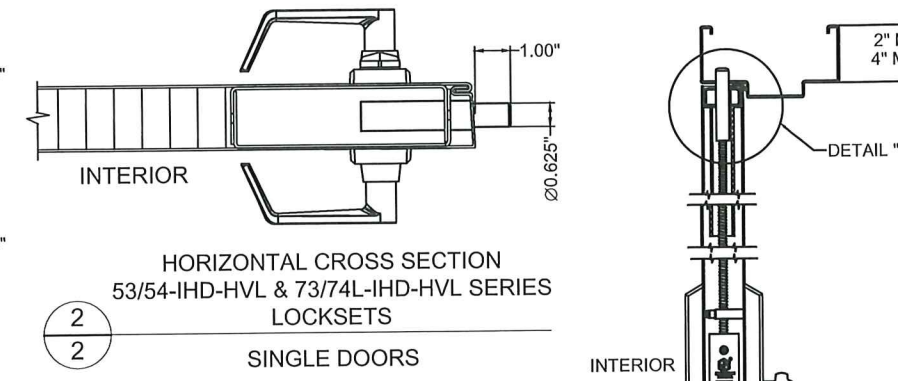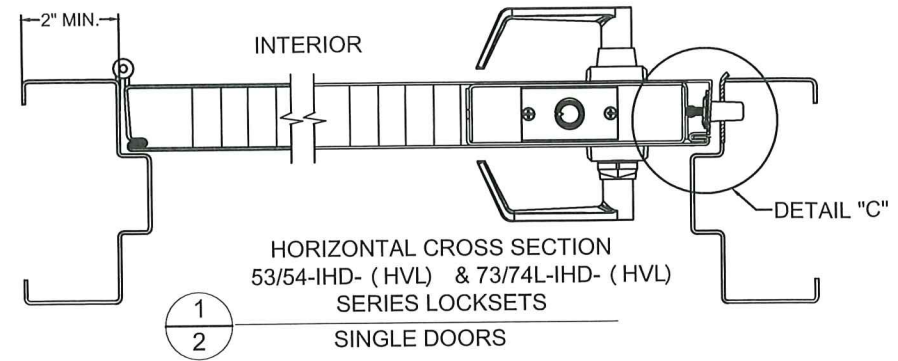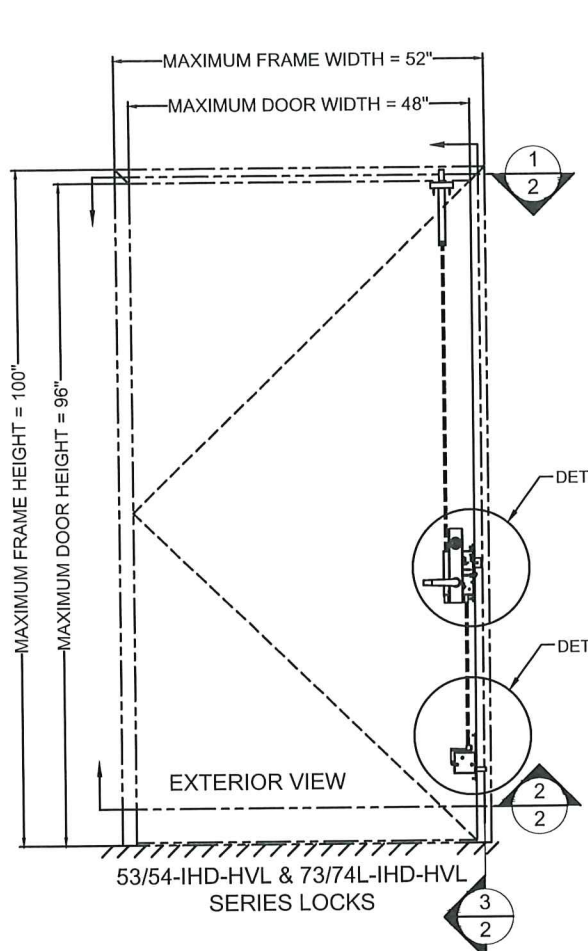

MODEL NUMBER DESCRIPTIONS						TABLE 2.1
MODEL SERIES*	DEADBOLTS CONFIGURATION					APPLICABLE TRIMS (SHT 5 OF 5)
	MAIN	TOP VERTICAL	BOTTOM VERTICAL	BOTTOM HORIZONTAL	HINGE SIDE STATIONARY BOLT	
53/54-IHD-HVL	X	X	-	X	54-MODELS ONLY	S, E
73/74L-IHD-HVL	X	X	-	X	74-MODELS ONLY	G, GG, UG, PB, DX

* - DIFFERENCE BETWEEN 53/54XX AND 73/74L SERIES IS EXTERIOR TRIM ONLY


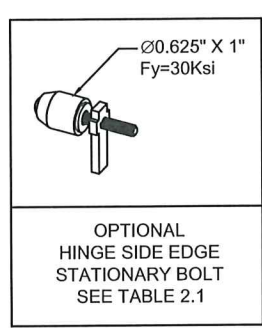


TABLE 2.2	
COMPONENT APPROVAL DESIGN PRESSURE RATING	
POSITIVE	+150 PSF.
NEGATIVE	-150 PSF.

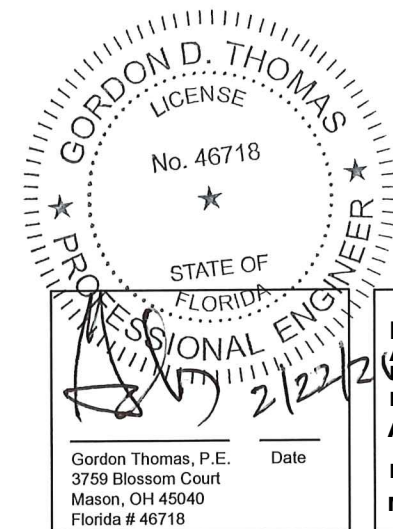



PRODUCT APPROVED
As complying with the Florida Building Code
NOA-No. **26-0213.04**
Approval Date: **03/26/2026**
By: *Manuel Perez*
Miami-Dade Product Control

- NOTES:
- ALL FINISHES AND FUNCTIONS ARE OFFERED.
 - SEE SHEET 5 OF 5 FOR AVAILABLE LEVER TRIM OPTIONS.
 - ELECTRICAL AND ELECTRONIC FUNCTIONS INSTALLATIONS ARE UNDER SEPARATE APPROVAL AND MUST BE REVIEWED BY CORRESPONDING AUTHORITY.
 - THIS DEVICE IS APPROVED TO BE EQUAL ALTERNATIVE TO BE USED IN 16 GA SINGLE INSWING STEEL COMMERCIAL DOORS HOLDING CURRENT IMPACT "E" RATED NOA, THE LOWEST DESIGN PRESSURE AND IMPACT PROTECTION LEVEL RATINGS SHALL APPLY. SEE SHEET 1 OF 5 FOR RATINGS AND LIMITATIONS.
 - THE DEVICE SHALL BE INSTALLED IN COMMERCIAL IMPACT "E" RATED SINGLE STEEL DOOR NO WIDER THAN 48" AND HIGHER THAN 108". FOR IMPACT "D" SEE SHEET 1 OF 5.
 - OPTIONAL SIGNAL SWITCHES AND POWER TRANSFER UNITS MAY BE USED AS ALLOWED BY CODE AND IF IT DOESN'T AFFECT MECHANICAL PROPERTIES OF THIS DEVICE AND/OR INHIBIT EGRESS, TO BE REVIEWED BY AHJ.
 - THIS DEVICE CAN BE INSTALLED AS PART OF "E" & "D" IMPACT RESISTANT UNIT.
 - THREE- OR FOUR-POINT CONCEALED VERTICAL ROD AUTOBOLT MODELS - 53/54-IHD-HVL & 73/74L-IHD-HVL - SEE TABLE 2.1 ON THIS SHEET.

225 Episcopal Rd.
Berlin, CT 06037
(718)392-9000
Securitech, subsidiary of ASSA ABLOY

MIAMI-DADE COUNTY COMPONENT NOA FOR SINGLE INSWING DOORS			
SECURITECH MULTI-POINT CONCEALED THREE OR FOUR-POINT LOCKSETS			
53/54XX-IHD-IHVL & 73/74L-IHD-HVL SERIES			
DATE CREATED 02-11-2026	DRAWN BY HL	DESIGNED BY HL	
DOCUMENT ID 113517-XX-XXX	SCALE N/A	SIZE B	
DRAWING NUMBER (ALT ID) 113517-03 SHEET 2 OF 5	REV 02		

REV.	DATE	DESCRIPTION	BY
1	2/11/26	SINGLE INSWING NOA PER MIAMI-DADE RER	YF
2	2/17/26	REVISED PER MIAMI-DADE RER COMMENTS	YF

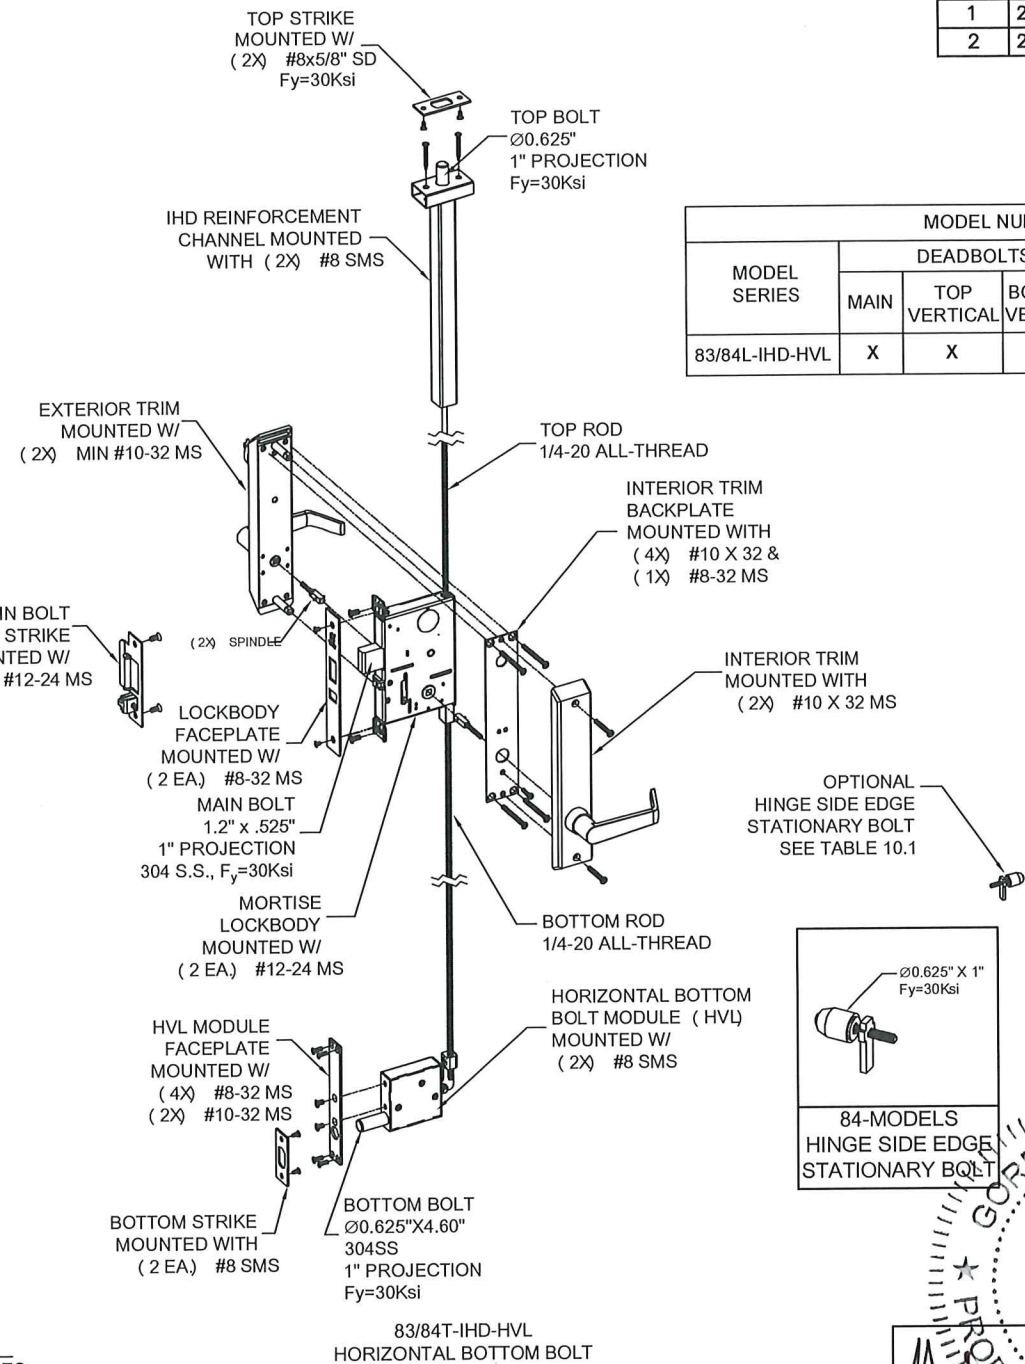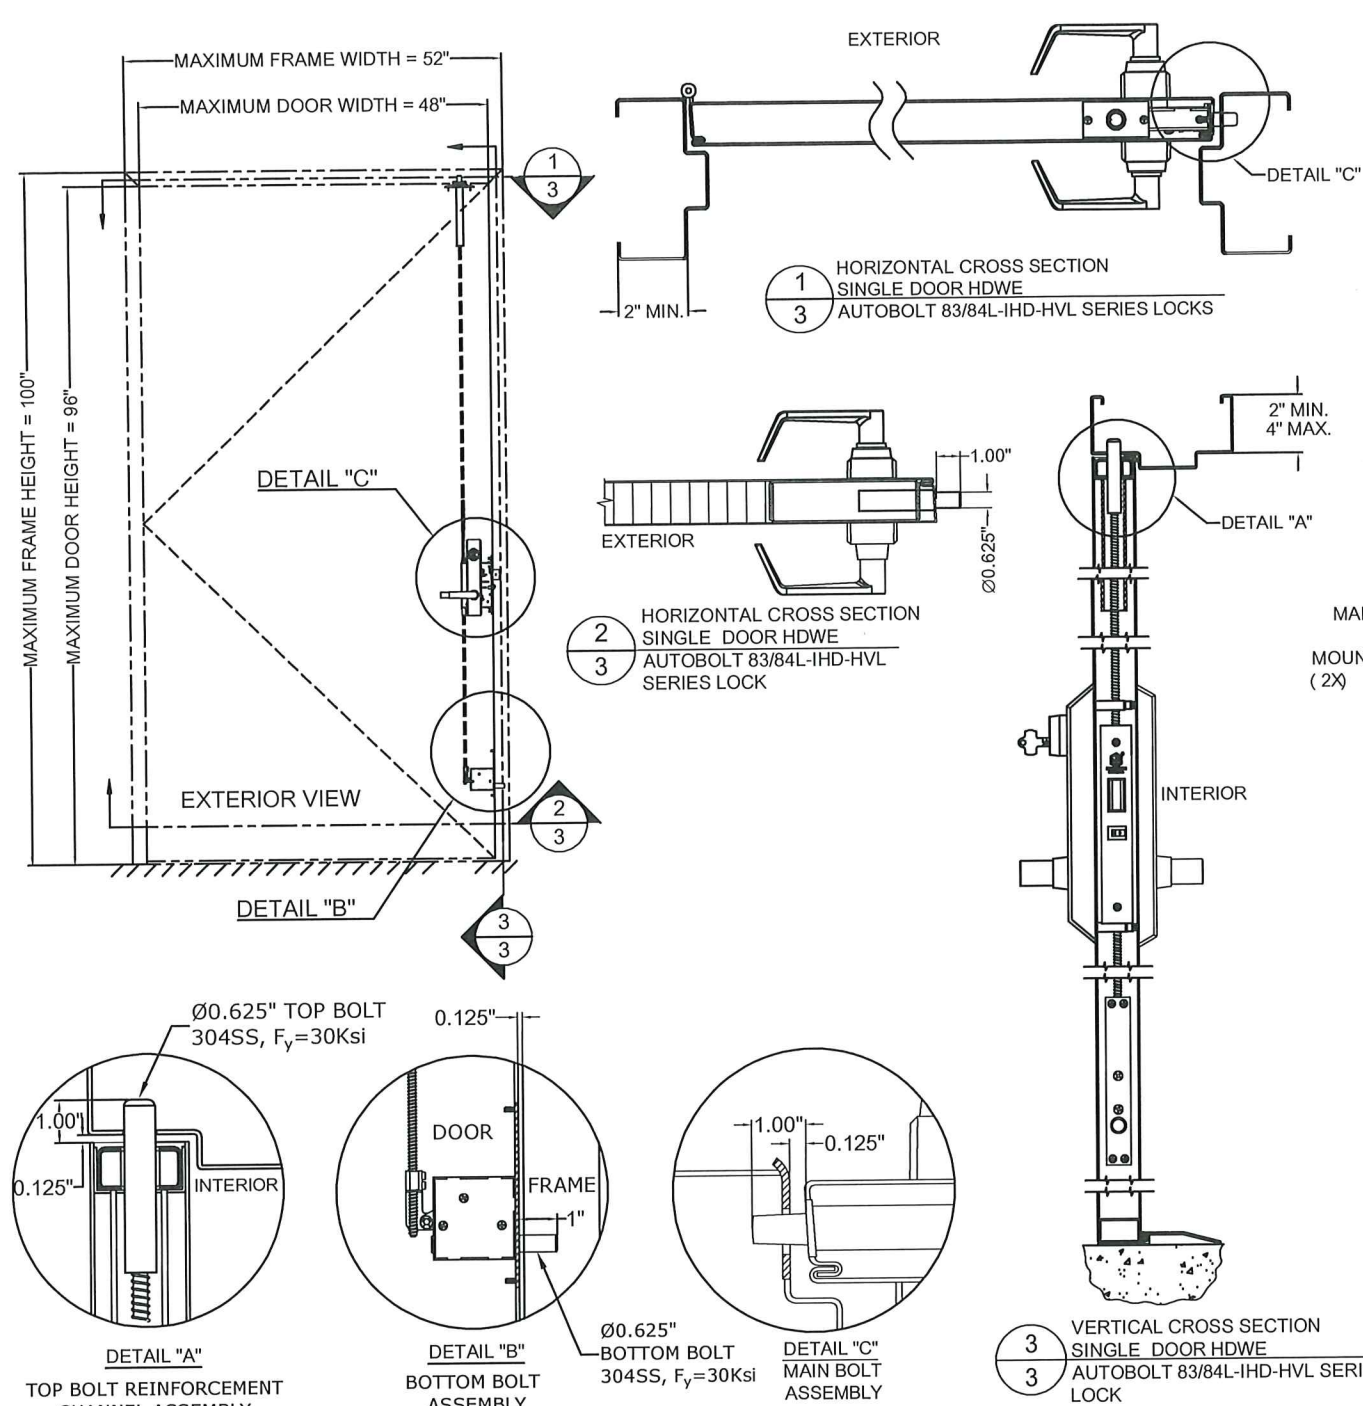

MODEL NUMBER DESCRIPTIONS						
MODEL SERIES	DEADBOLTS CONFIGURATION					APPLICABLE TRIMS (SHT 5 OF 5)
	MAIN	TOP VERTICAL	BOTTOM VERTICAL	BOTTOM HORIZONTAL	HINGE SIDE STATIONARY BOLT	
83/84L-IHD-HVL	X	X	-	X	84-MODELS ONLY	G, GG, UG, PB, DX

COMPONENT APPROVAL DESIGN PRESSURE RATING	
POSITIVE	+150 PSF.
NEGATIVE	-150 PSF.

- NOTES:
1. ALL FINISHES AND FUNCTIONS ARE OFFERED.
 2. SEE SHEET 5 OF 5 FOR AVAILABLE LEVER TRIM OPTIONS.
 3. ELECTRICAL AND ELECTRONIC FUNCTIONS INSTALLATIONS ARE UNDER SEPARATE APPROVAL AND MUST BE REVIEWED BY CORRESPONDING AUTHORITY.
 4. THIS DEVICE IS APPROVED TO BE EQUAL ALTERNATIVE TO BE USED IN 16 GA SINGLE INSWING STEEL COMMERCIAL DOORS HOLDING CURRENT IMPACT "E" RATED NOA, THE LOWEST DESIGN PRESSURE AND IMPACT PROTECTION LEVEL RATINGS SHALL APPLY. SEE SHEET 1 OF 5 FOR RATINGS AND LIMITATIONS.
 5. THE DEVICE SHALL BE INSTALLED IN COMMERCIAL IMPACT "E" RATED SINGLE STEEL DOOR NO WIDER THAN 48" AND HIGHER THAN 108". FOR IMPACT "D" SEE SHEET 1 OF 5.
 6. OPTIONAL SIGNAL SWITCHES AND POWER TRANSFER UNITS MAY BE USED AS ALLOWED BY CODE AND IF IT DOESN'T AFFECT MECHANICAL PROPERTIES OF THIS DEVICE AND/OR INHIBIT EGRESS, TO BE REVIEWED BY AHJ.
 7. THIS DEVICE CAN BE INSTALLED AS PART OF "E" & "D" IMPACT RESISTANT UNIT.
 8. THREE- OR FOUR-POINT CONCEALED VERTICAL ROD AUTOBOLT MODELS - 83/84L-IHD-HVL - SEE TABLE 3.1 ON THIS SHEET.

PROFESSIONAL SEAL

GORDON D. THOMAS
LICENSE
No. 46718

STATE OF FLORIDA

PRODUCT APPROVED
As complying with the Florida Building Code
NOA-No. **26-0213.04**
Approval Date: **03/26/2026**
By: *Manuel Perez*
Miami-Dade Product Control

Gordon Thomas, P.E.
3759 Blossom Court
Mason, OH 45040
Florida # 46718

Date

SECURITECH



ASSA ABLOY

225 Episcopal Rd.
Berlin, CT 06037
(718)392-9000
Securitech, subsidiary of ASSA ABLOY


MIAMI-DADE COUNTY COMPONENT NOA FOR SINGLE INSWING DOORS
SECURITECH MULTI-POINT CONCEALED THREE OR FOUR-POINT LOCKS
83/84L-IHD-HVL SERIES

DATE CREATED 02-11-26	DRAWN BY HL	DESIGNED BY HL
DOCUMENT ID 113517-XX-XXX	SCALE N/A	SIZE B
DRAWING NUMBER (ALT ID) 113517-03 SHEET 3 OF 5		REV 02


REV.	DATE	DESCRIPTION	BY
1	2/12/26	SINGLE INSWING NOA PER MIAMI-DADE RER	YF
2	2/17/26	REVISED PER MIAMI-DADE RER COMMENTS	YF

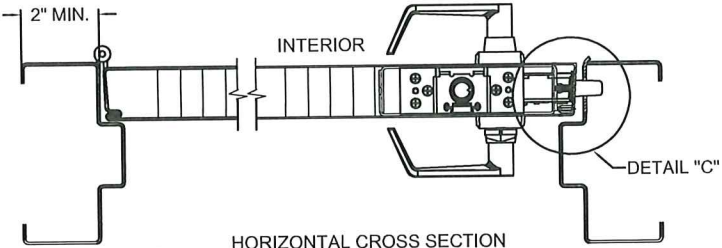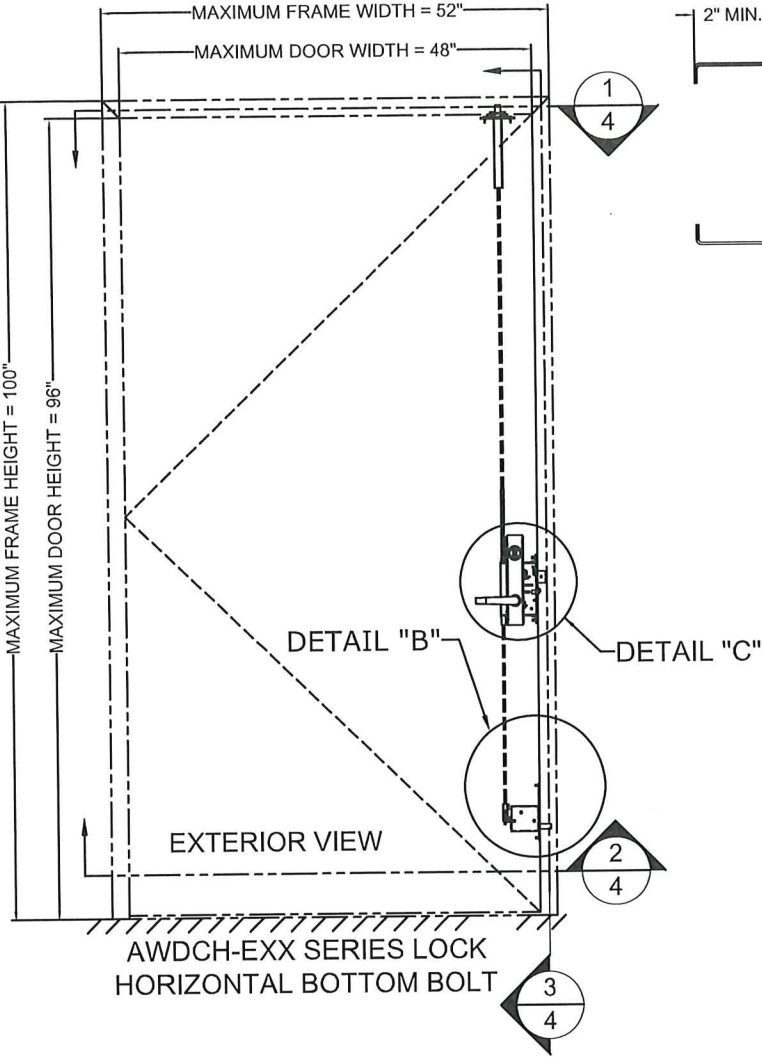


1
4
HORIZONTAL CROSS SECTION
AWDCH & AWDCHJ SERIES LOCKSETS
SINGLE DOORS

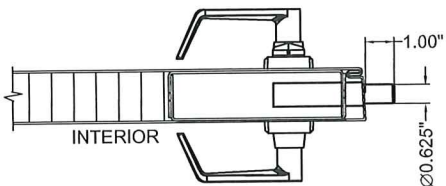


2
4
HORIZONTAL CROSS SECTION
AWDCH SERIES LOCKSETS
SINGLE DOORS

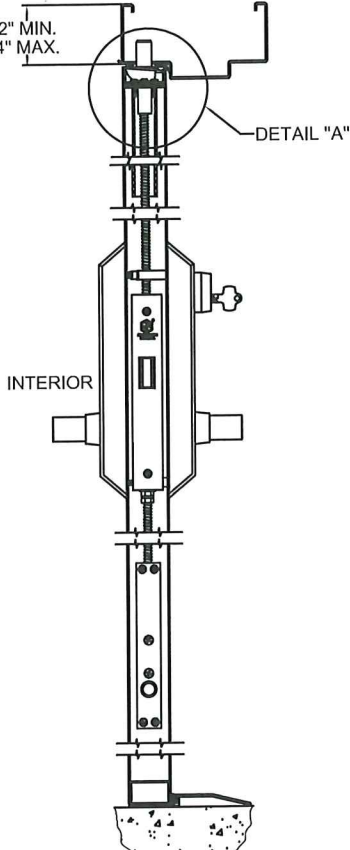


3
4
VERTICAL CROSS SECTION
SINGLE DOOR HDWE
AUTOBOLT-MAX AWDCH-EXX
SERIES LOCK

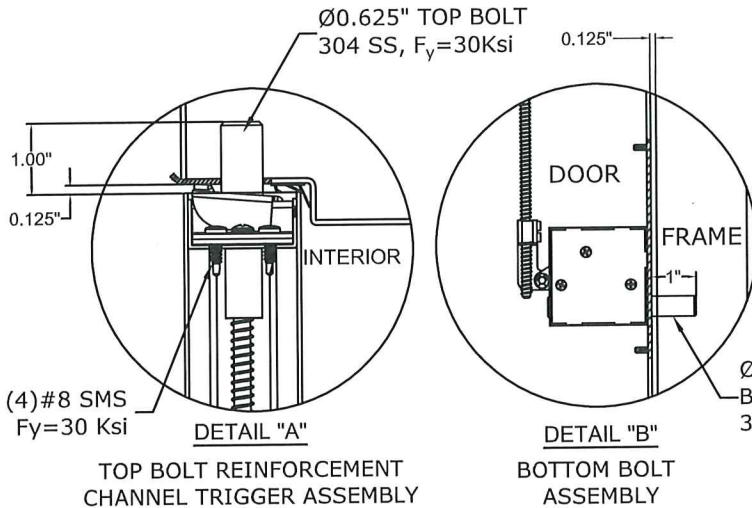


DETAIL "A"
TOP BOLT REINFORCEMENT
CHANNEL TRIGGER ASSEMBLY

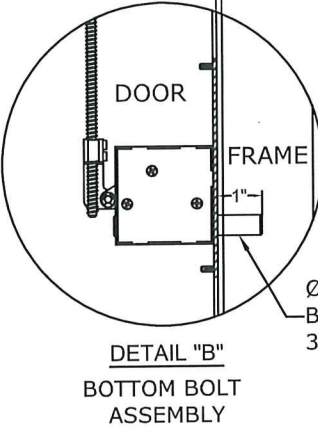

DETAIL "B"
BOTTOM BOLT
ASSEMBLY

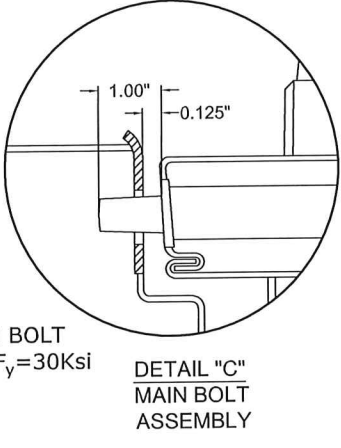


DETAIL "C"
MAIN BOLT
ASSEMBLY

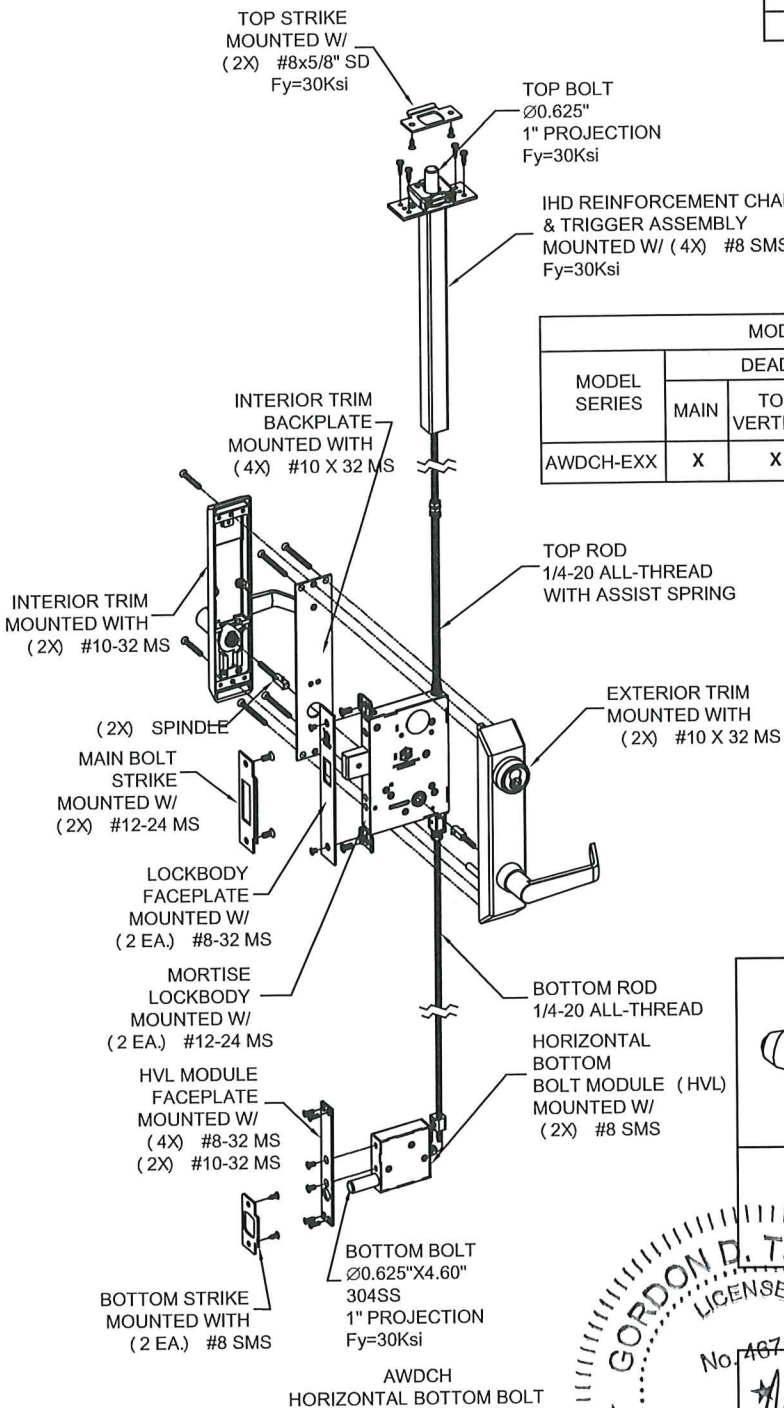


MODEL NUMBER DESCRIPTIONS						TABLE 4.1
MODEL SERIES	DEADBOLTS CONFIGURATION					APPLICABLE TRIMS (SHT 5 OF 5)
	MAIN	TOP VERTICAL	BOTTOM VERTICAL	BOTTOM HORIZONTAL	HINGE SIDE STATIONARY BOLT	
AWDCH-EXX	X	X	-	X	OPTIONAL	G, GG, UG, PB, DX

TABLE 4.2 COMPONENT APPROVAL DESIGN PRESSURE RATING	
POSITIVE	+150 PSF.
NEGATIVE	-150 PSF.

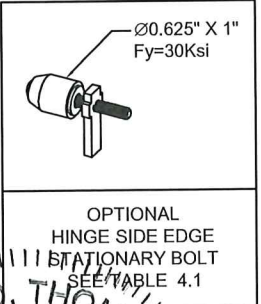










OPTIONAL
HINGE SIDE EDGE
STATIONARY BOLT
SEE TABLE 4.1

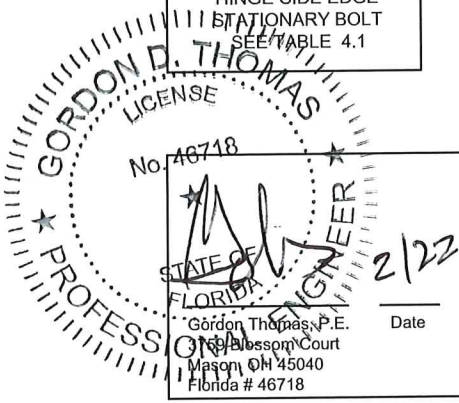

PRODUCT APPROVED
As complying with the Florida Building Code
NOA-No. **26-0213.04**
Approval Date: **03/26/2026**
By: *Manuel Perez*
Miami-Dade Product Control

- NOTES:
- ALL FINISHES AND FUNCTIONS ARE OFFERED.
 - SEE SHEET 5 OF 5 FOR AVAILABLE LEVER TRIM OPTIONS.
 - ELECTRICAL AND ELECTRONIC INSTALLATIONS ARE UNDER SEPARATE APPROVAL AND MUST BE REVIEWED BY CORRESPONDING AUTHORITY.
 - THIS DEVICE IS APPROVED TO BE EQUAL ALTERNATIVE TO BE USED IN 16 GA SINGLE INSWING STEEL COMMERCIAL DOORS HOLDING CURRENT IMPACT "E" RATED NOA, THE LOWEST DESIGN PRESSURE AND IMPACT PROTECTION LEVEL RATINGS SHALL APPLY. SEE SHEET 1 OF 5 FOR RATINGS AND LIMITATIONS.
 - THE DEVICE SHALL BE INSTALLED IN COMMERCIAL IMPACT "E" RATED SINGLE STEEL DOOR NO WIDER THAN 48" AND HIGHER THAN 108". FOR IMPACT "D" SEE SHEET 1 OF 5.
 - OPTIONAL SIGNAL SWITCHES AND POWER TRANSFER UNITS MAY BE USED AS ALLOWED BY CODE AND IF IT DOESN'T AFFECT MECHANICAL PROPERTIES OF THIS DEVICE AND/OR INHIBIT EGRESS, TO BE REVIEWED BY AHJ.
 - THIS DEVICE CAN BE INSTALLED AS PART OF "E" & "D" IMPACT RESISTANT UNIT.
 - THREE- OR FOUR-POINT CONCEALED VERTICAL ROD AUTOBOLT MODELS - AWDCH - SEE TABLE 4.1 ON THIS SHEET.

SECURITECH ASSA ABLOY 225 Episcopal Rd. Berlin, CT 06037 (718)392-9000 Securitech, subsidiary of ASSA ABLOY		MIAMI-DADE COUNTY COMPONENT NOA FOR SINGLE INSWING DOORS SECURITECH MULTI-POINT CONCEALED THREE OR FOUR-POINT LOCKSETS AWDCH-EXX SERIES	
DATE CREATED 02-11-26	DRAWN BY HL	DESIGNED BY HL	SCALE N/A
DOCUMENT ID 113517-XX-XXX	DRAWING NUMBER (ALT ID) 113517-03 SHEET 4 OF 5	SIZE B	REV 02

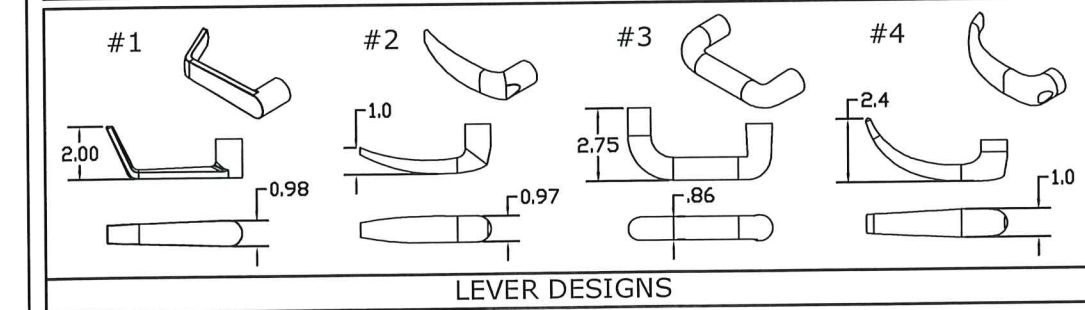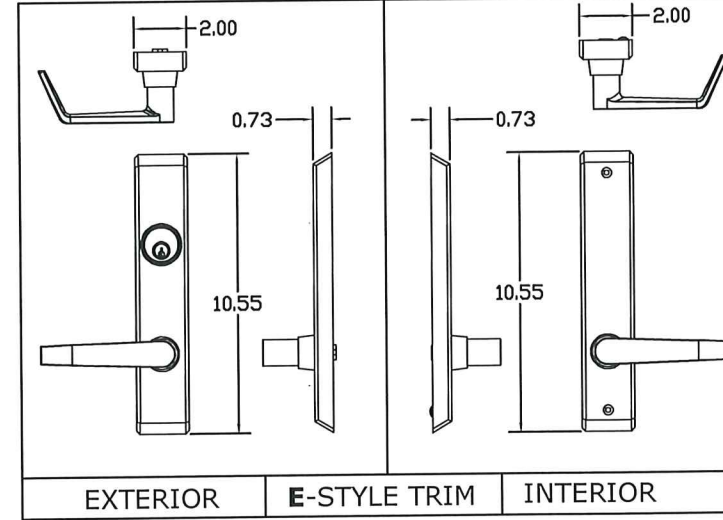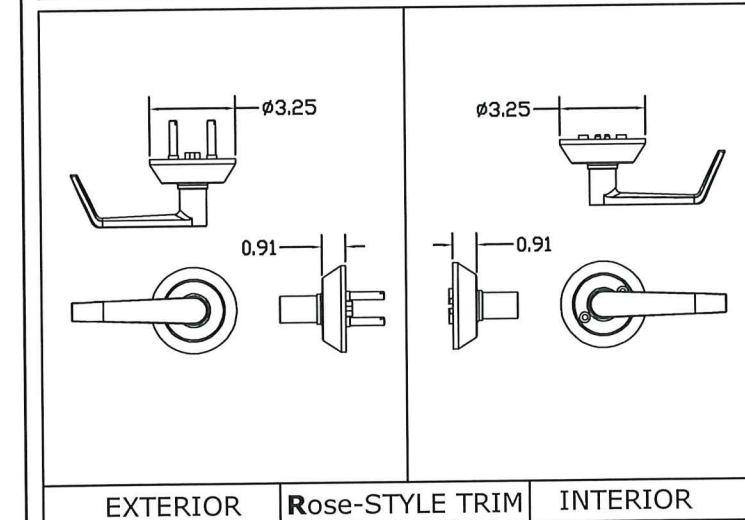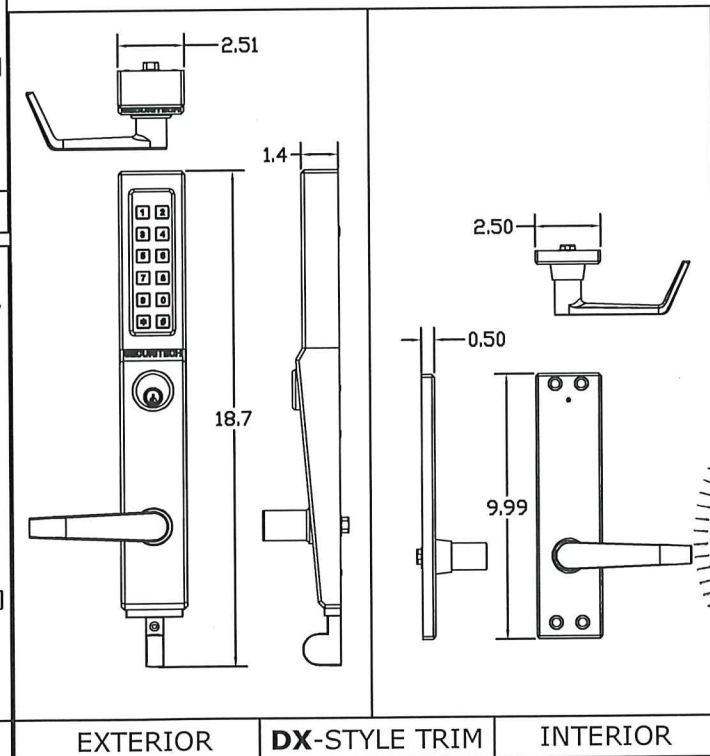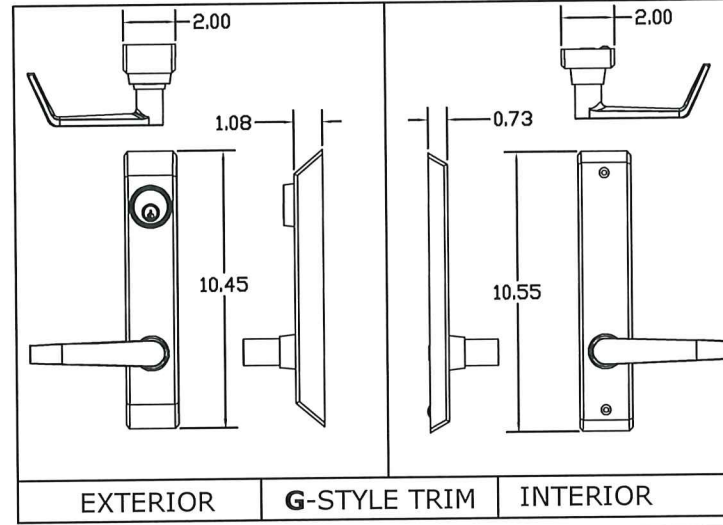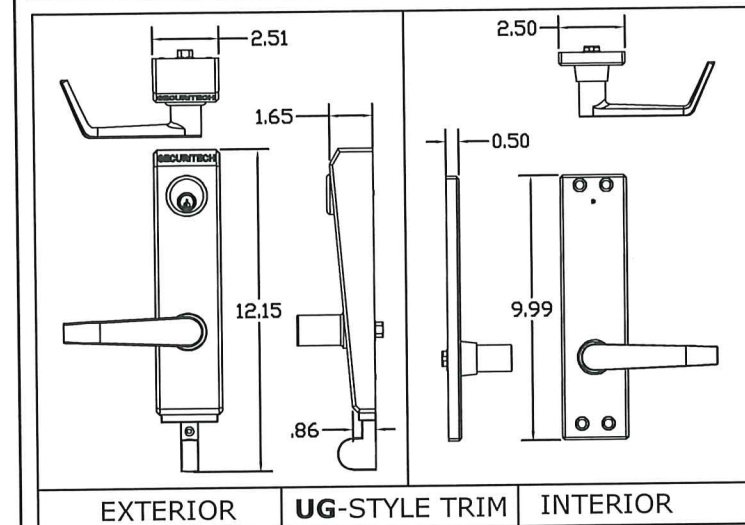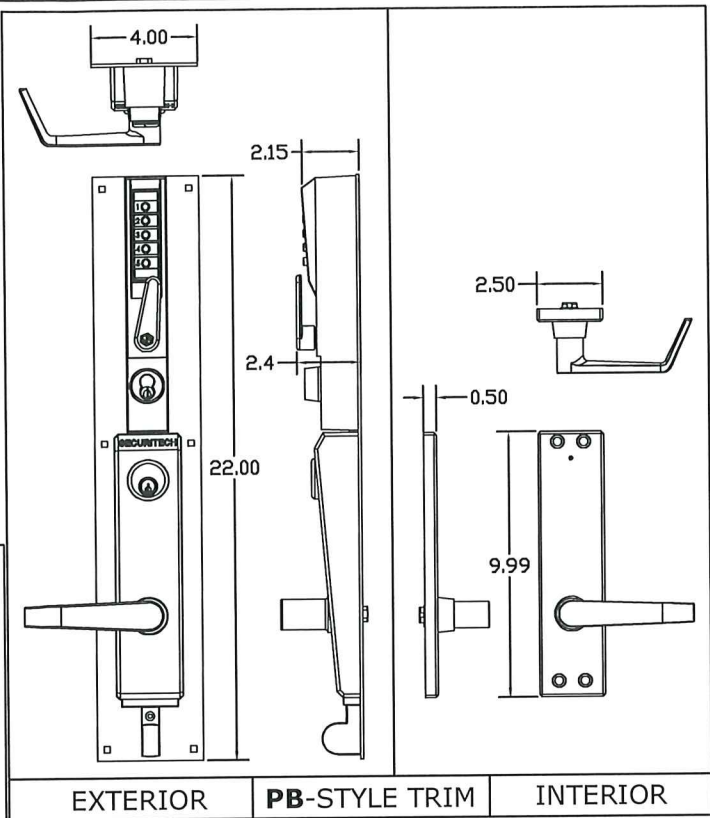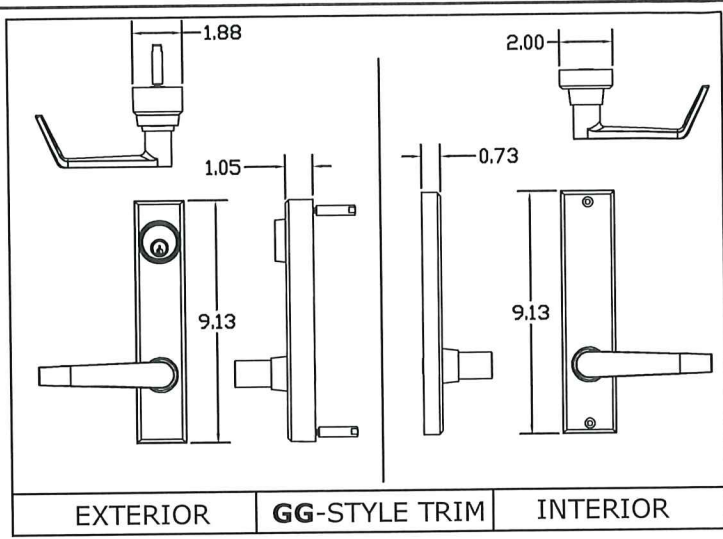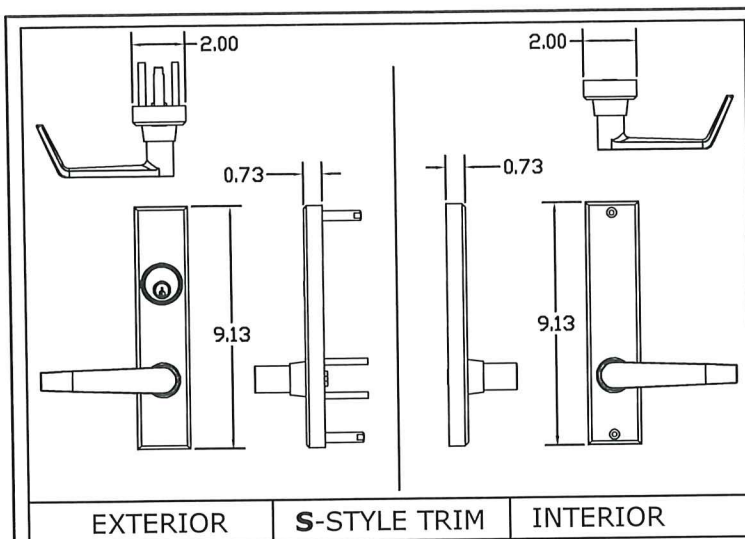


REV.	DATE	DESCRIPTION	BY
1	2/12/26	SINGLE INSWING NOA PER MIAMI-DADE	YF
2	2/17/26	SINGLE INSWING NOA PER MIAMI-DADE	YF

TABLE 5.1

TRIM APPLICATIONS		
SERIES	REF. SHT.	TRIM OPTIONS
53XX AND 54XX-IHD-HVL	2	E, S
73 AND 74L-IHD-HVL	2	G, GG
83 AND 84L-IHD-HVL	3	G, GG, UG, PB, DX
AWDCH-EXX	4	E, G, R, UG, PB, DX

NOTES:
1. ALL FINISHES AND FUNCTIONS ARE OFFERED
2. SEE TABLE 5.1 FOR APPLICABLE SERIES AND DRAWING REFERENCE
3. ELECTRIFIED AND ELECTRONIC FUNCTIONS ARE NOT PART OF THIS APPROVAL AND MUST BE REVIEWED BY CORRESPONDING AUTHORITY

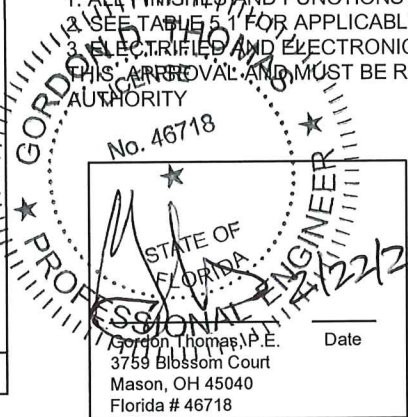

PRODUCT APPROVED
As complying with the Florida Building Code
NOA-No. **26-0213.04**
Approval Date: **03/26/2026**
By: *Manuel Perez*
Miami-Dade Product Control



ASSA ABLOY

225 Episcopal Rd.
Berlin, CT 06037
(718)392-9000

Securitech, subsidiary of ASSA ABLOY

MIAMI-DADE COUNTY COMPONENT NOA FOR SINGLE INSWING DOORS			
SECURITECH CONCEALED AND SURFACE MOUNTED LOCKS AND EXIT DEVICES			
5000/7000/8000/AWM SERIES TRIM			
DATE CREATED 02-11-26	DRAWN BY HL	DESIGNED BY HL	
DOCUMENT ID 113517-XX-XXX	SCALE N/A	SIZE B	
DRAWING NUMBER (ALT ID) 113517-03 SHEET 5 OF 5		REV 02	