



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

Ruskin Company
3900 Dr. Greaves Road
Grandview, MO 64030

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER - Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Model EME6325D Aluminum Louver

APPROVAL DOCUMENT: Drawing No. **60-022167-01D to 07D**, titled "EME6325D Louver", sheets 1 through 7 of 7, prepared by Ruskin Company, dated 06/14/2010, with revision E dated 01/06/2026, signed and sealed by Jeffrey D. Smith, P.E., bearing the Miami-Dade County Product Control revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, Geneva, AL or Juarez, Chihuahua C. P., Mexico, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

LIMITATION: This louver has not been evaluated for compliance with the impact testing standard ANSI/AMCA 540.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **renews and revises** NOA # **23-1116.03** and consists of this page 1 and evidence page E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by **Carlos M. Utrera, P.E.**



03/12/26

NOA No. 26-0224.01
Expiration Date: August 25, 2031
Approval Date: March 19, 2026
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. Evidence submitted under previous NOA's and new

A. DRAWINGS

1. Drawing No. **60-022167-01D to 07D**, titled "EME6325D Louver", sheets 1 through 7 of 7, prepared by Ruskin Company, dated 06/14/2010, with revision E dated 01/06/2026, signed and sealed by Jeffrey D. Smith, P.E.

B. TESTS "*Submitted under NOA #16-0627.12*"

1. Test reports on 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of EME6325D Aluminum Louvers", prepared by National Certified Testing Laboratories, Test Report No. **NCTL-210-4024-01**, dated 04/21/2016, signed and sealed by Gerald J. Ferrara, P.E. "*Submitted under NOA # 10-0622.01*"
2. Test reports on 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of EME6325 Aluminum Louver Systems", prepared by National Certified Testing Laboratories, Report No. **210-3655-1**, dated 01/26/2010, signed and sealed by Gerald J. Ferrara, P.E.
3. Test report of Wind Driven Rain Resistance per TAS 100(A)-95 on EME6325 Aluminum Louver, prepared by PRI Construction Materials Technologies, LLC, Test Report No. **RCV-007-02-01**, dated 02/27/2009, signed and sealed by Duc T. Nguyen, P.E.

C. CALCULATIONS "*Submitted under NOA #16-0627.12*"

1. Wind load review prepared by Ruskin Company, dated 07/06/2016, signed and sealed by Theodore Berman, P.E.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS

1. None.

F. STATEMENTS

1. Statement letter of code conformance to the 8th edition (2023) of the FBC, issued by Ruskin Company, dated 01/22/2026, signed and sealed by Jeffrey Devon Smith, P.E.
2. Statement letter of no financial interest issued by issued by Ruskin Company, dated 01/22/2026, signed and sealed by Jeffrey Devon Smith, P.E.



Carlos M. Utrera, P.E.
Product Control Examiner
NOA No. 26-0224.01
Expiration Date: August 25, 2031
Approval Date: March 19, 2026



FRAME	
6063-T6 extruded aluminum with .095" nominal wall thickness.	☒
Flange frame is same material and thickness as above.	☐
BLADES	
6063-T6 extruded aluminum with .062" nominal wall thickness.	☒
SCREEN	
5/8" x .040" expanded flat-tened aluminum bird screen.	☐
1/2" mesh x .063" aluminum bird screen.	☒
18-16 mesh alum insect screen	☐
No screen.	☐
FINISH	
Mill.	☒
Kynar (opt).	☐
Baked enamel (modified fluoropolymer, 50% Kynar, opt).	☐
Color Anodize (opt).	☐
Clear Anodize (opt).	☐
Color:	☐

NOTES: ©

- 1) THE EME6325D HAS BEEN TESTED IN ACCORDANCE WITH FLORIDA PROTOCOLS TAS-100(A), TAS-201, 202 & 203 FOR WATER PERFORMANCE, LARGE MISSILE IMPACT, UNIFORM PRESSURE AND CYCLIC WIND PRESSURE.
- 2) THIS LOUVER SYSTEM IS APPROVED FOR APPLICATIONS WITH DESIGN PRESSURES OF +/- 150 PSF OR LESS.
- 3) THIS LOUVER SYSTEM IS NON-BEARING AND IS NOT DESIGNED TO WITHSTAND BUILDING DEAD LOADS.
- 4) IT SHALL BE THE RESPONSIBILITY OF PERMIT HOLDER/BUILDING DESIGN ENGINEER OF RECORD TO VERIFY THE STRUCTURAL INTEGRITY OF THE STRUCTURE TO SUPPORT THE LOADS IMPOSED BY THIS LOUVER SYSTEM.
- 5) MAXIMUM SINGLE SECTION SIZE: 47 15/16" WIDE X 120" HIGH.
- 7) MAXIMUM ASSEMBLED LOUVER SIZE: UNLIMITED WIDE X 120" HIGH WITH MAX. MULLION SPACING OF 47 15/16".
- 8) SECTIONS OR ASSEMBLIES MAY BE STACKED VERTICALLY PROVIDED A SUITABLE STRUCTURAL SUPPORT IS DESIGNED AND INSTALLED BY OTHERS TO SUPPORT ALL LOADS TRANSFERRED FROM THE LOUVER.
- 9) CMU BLOCKS MUST BE TYPE 1, GRADE N, LIGHT, MEDIUM OR NORMAL WEIGHT CONFORMING TO ASTM C90. CMU BLOCKS MUST BE FULLY GROUTED WITH COARSE GROUT CONFORMING TO FLORIDA BUILDING CODE SECTION 2122.8. TYPE N, S OR M MORTAR MUST COMPLY WITH FLORIDA BUILDING CODE SECTION 2103.9. MASONRY COMPRESSIVE STRENGTH MUST BE AT LEAST 1500 PSI AT THE TIME OF INSTALLATION.
- © 10) ABBREVIATIONS: NIRC = NOT IN RUSKIN'S CONTRACT, SDS = SELF-DRILLING SCREW, AL = ALUMINUM, S.S.W. = SINGLE SECTION WIDTH
- 11) ALL FASTENERS SHALL BE CORROSION RESISTANT.
- 12) .580" X 3.160" X .580" X .080 EXTRUDED ALUMINUM HHBS ATTACHMENT CHANNEL NOTCHED TO FIT OVER JAMB FRAMES & TO FIT BETWEEN EACH BLADE. WELDED TO EACH BLADE AND TO JAMB FRAMES. HHBS ATTACHMENT CHANNELS ARE REQUIRED AT MIDSPAN FOR LOUVER UNITS EXCEEDING 60" IN HEIGHT. REF DETAIL A/-


DRAWING INDEX: ©

1. EME6325D LOUVER - SPEC, ASSY & NOTES
2. EME6325D LOUVER - WOOD, CONCRETE, STEEL INSTALLATION DETAILS
3. EME6325D LOUVER - CMU INSTALLATION DETAILS
4. EME6325D LOUVER - APPROVED ATTACHMENTS & DRAWING CROSS REFERENCE TABLES
5. EME6325D LOUVER - PART DETAILS
6. EME6325D LOUVER - PART DETAILS
7. EME6325D LOUVER - PART DETAILS

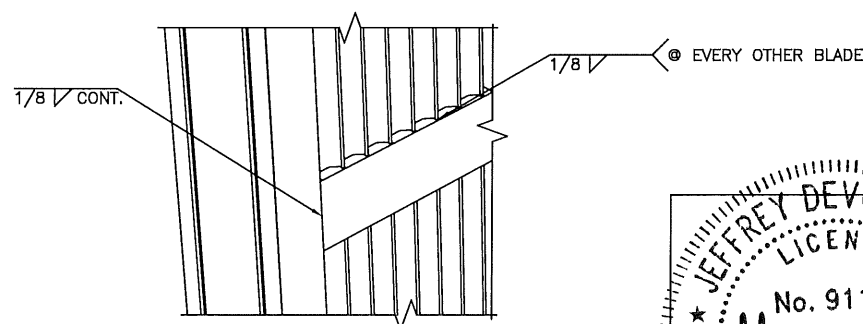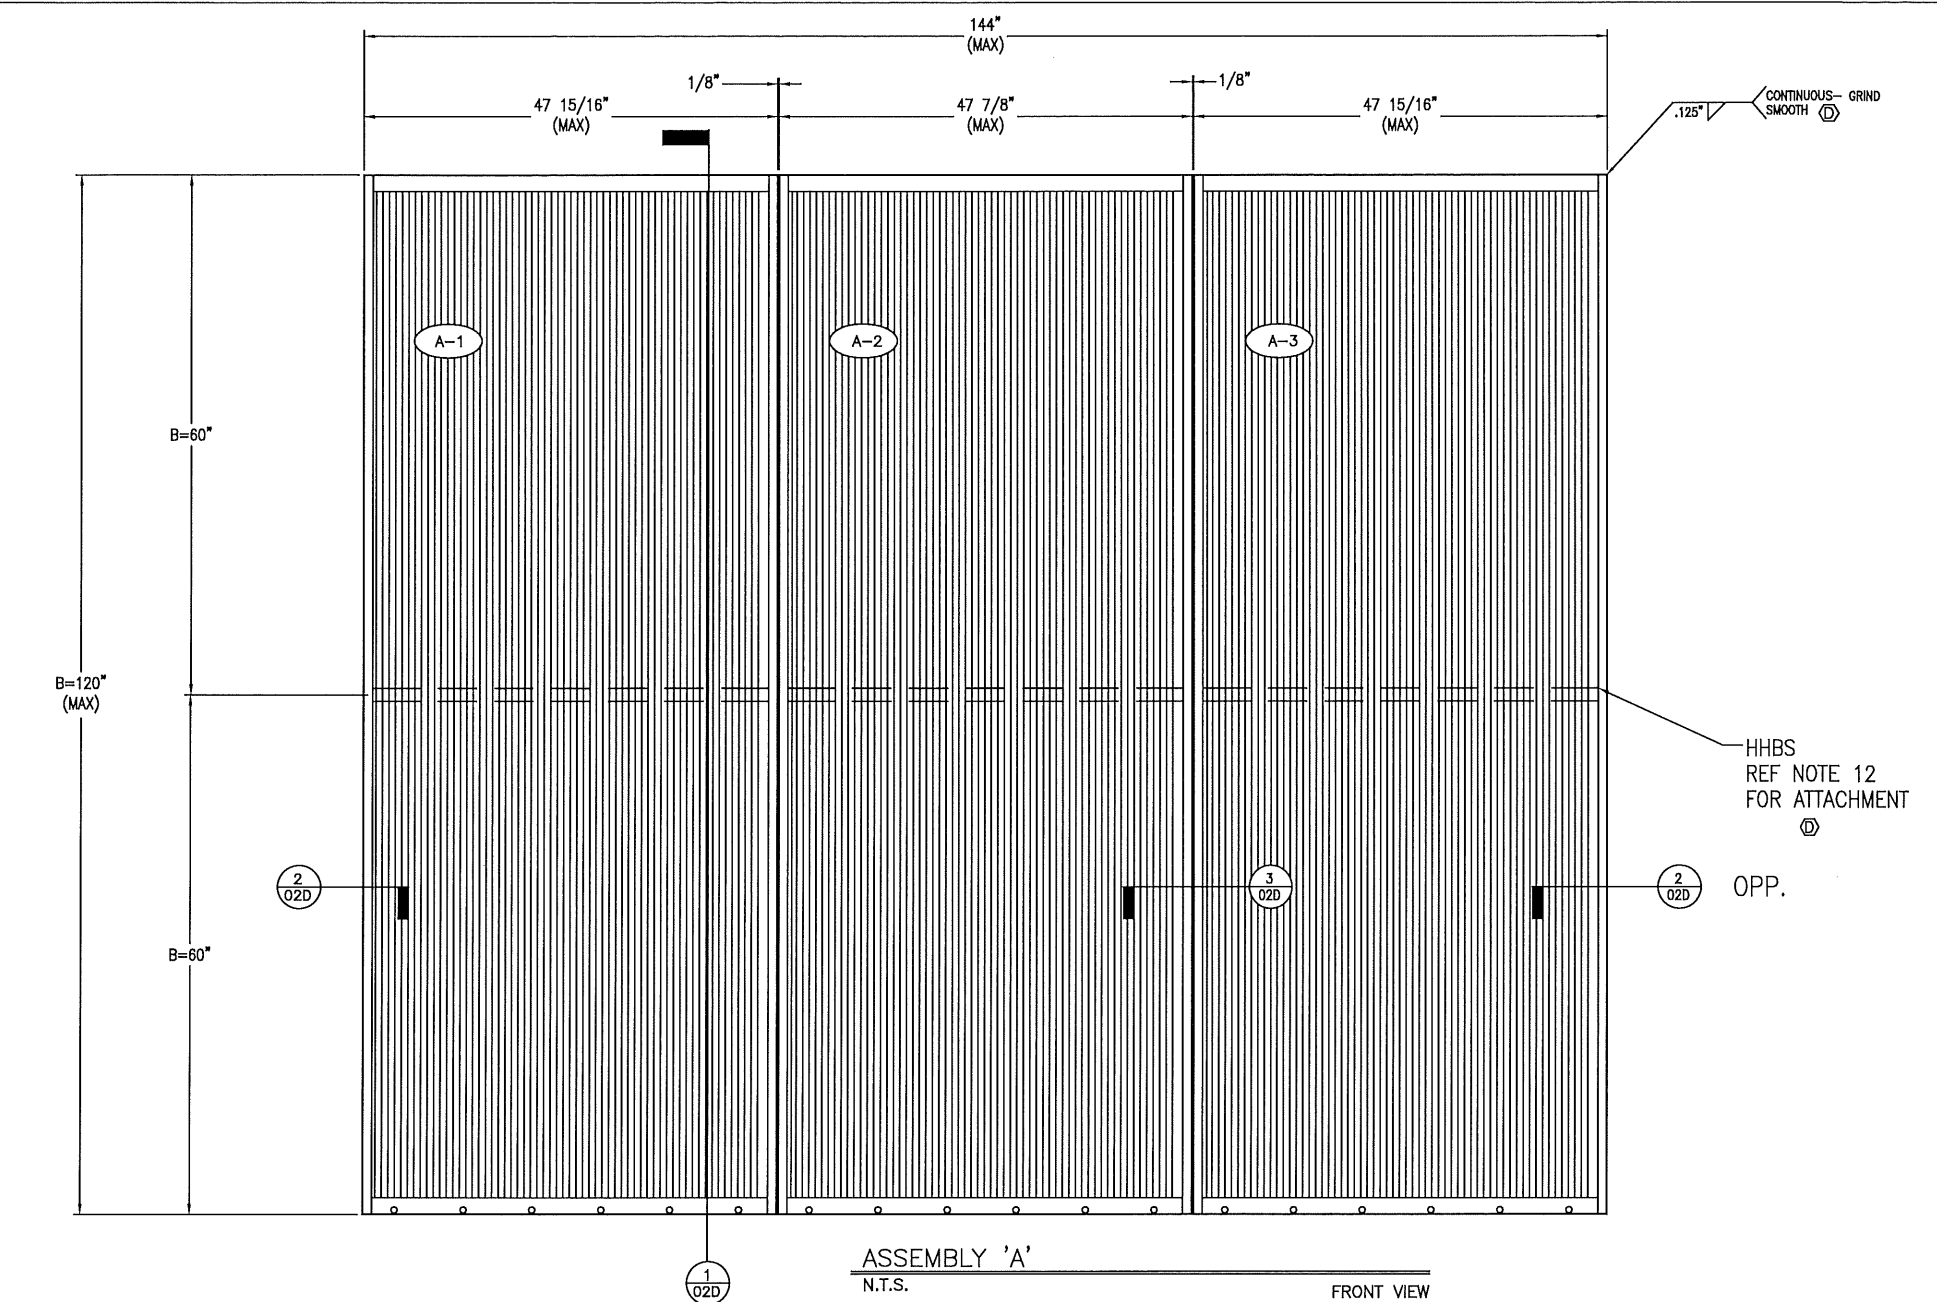

© A H.H.B.S. ATTACHMENT DETAIL
- N.T.S.

TESTS PERFORMED:
TAS-100A WATER PERFORMANCE TEST
TAS-201 LARGE MISSILE IMPACT TEST
TAS-202 UNIFORM STATIC AIR PRESSURE TEST
TAS-203 CYCLIC WIND PRESSURE TEST
DESIGN PRESSURE RATING: 150 PSF

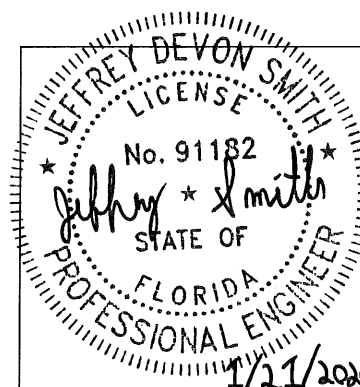

JEFFREY DEVON SMITH, P.E.
NO. 91182


PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 26-0224.01

Expiration Date 08/25/2031


By 
Miami-Dade Product Control

Unless Stated Otherwise
Use WIC-007

E		UPDATED TITLE BLOCK & ENGINEER OF RECORD			E-R	NS	JDS		01/06/26
REV		DESCRIPTION			BY	CHK	APVD	ECN	DATE
AUTHOR		VMA 6/9/09					3900 Doctor Greaves Rd, Grandview, MO 64030 PROPRIETARY AND CONFIDENTIAL		
CHECKED		DJR 6/14/10							
APPROVED		DJR 6/14/10							
APPROVED					PRODUCT		EME6325D		
MATERIAL		TITLE							
ALUMINUM		EME6325D LOUVER SPEC, ASSY & NOTES							
		SIZE D		DWG NO		60-022167-01D			REV E
ECN		14272		SCALE NONE		AUTOCAD		SHEET 1 OF 7	

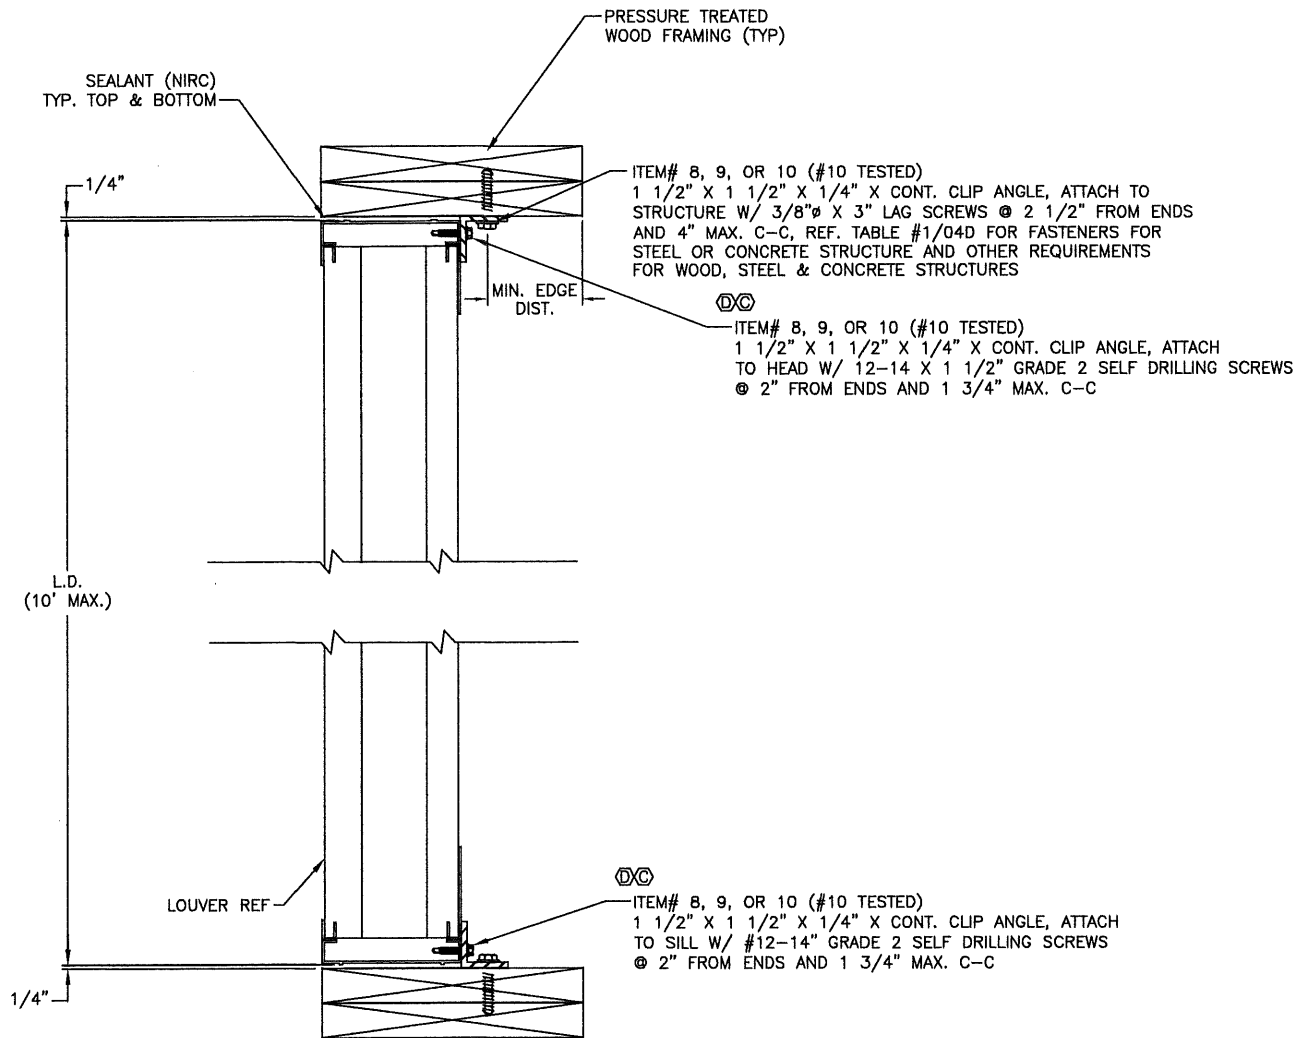


1 HEAD & SILL DETAIL: METHOD 1 - AS TESTED - WOOD FRAMING
01D N.T.S.
ALTERNATE STRUCTURE - STEEL FRAMING, CONCRETE

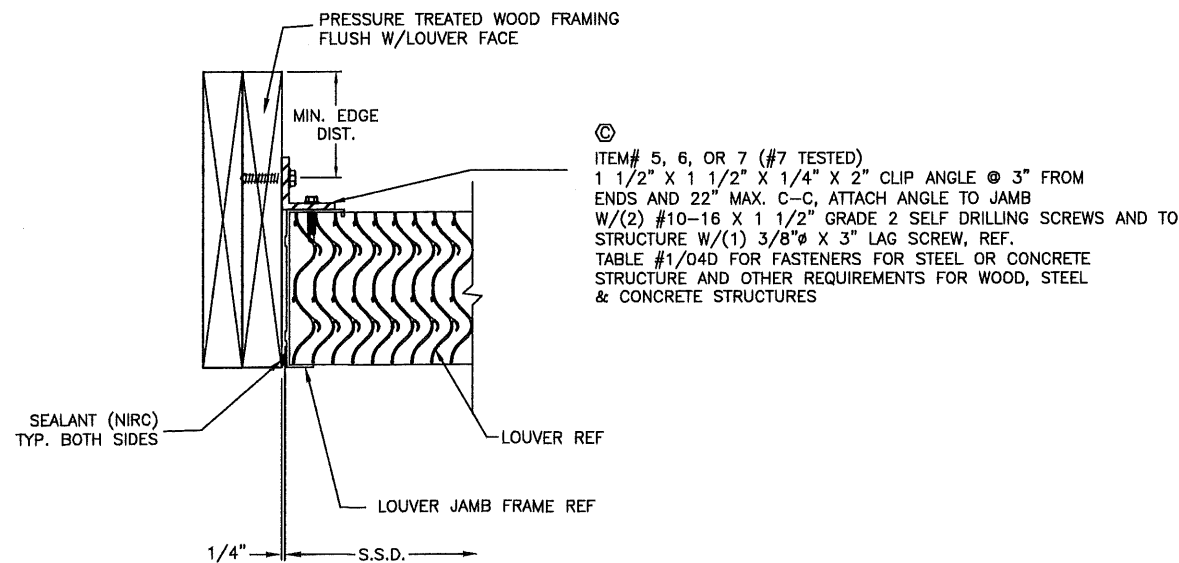


2 JAMB DETAIL: METHOD 1 - AS TESTED - WOOD FRAMING
01D N.T.S.
ALTERNATE STRUCTURE - STEEL FRAMING, CONCRETE


ITEM# 8, 9, OR 10 (#10 TESTED)
1 1/2" X 1 1/2" X 1/4" X CONT. CLIP ANGLE, ATTACH TO
STRUCTURE W/ 3/8" X 3" LAG SCREWS @ 2 1/2" FROM ENDS
AND 4" MAX. C-C, REF. TABLE #1/04D FOR FASTENERS FOR
STEEL OR CONCRETE STRUCTURE AND OTHER REQUIREMENTS
FOR WOOD, STEEL & CONCRETE STRUCTURES

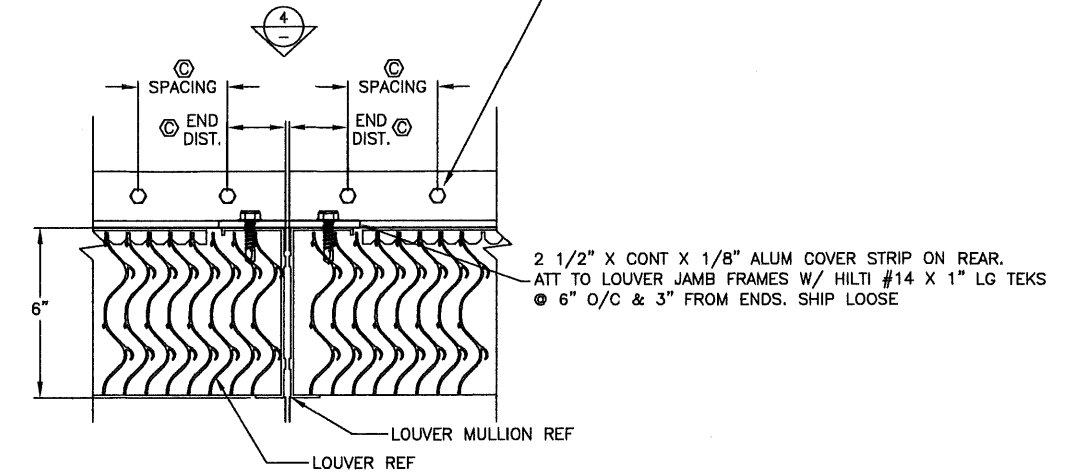

3 MULLION DETAIL: METHOD 1 - AS TESTED - WOOD FRAMING
01D N.T.S.
ALTERNATE STRUCTURE - STEEL FRAMING, CONCRETE

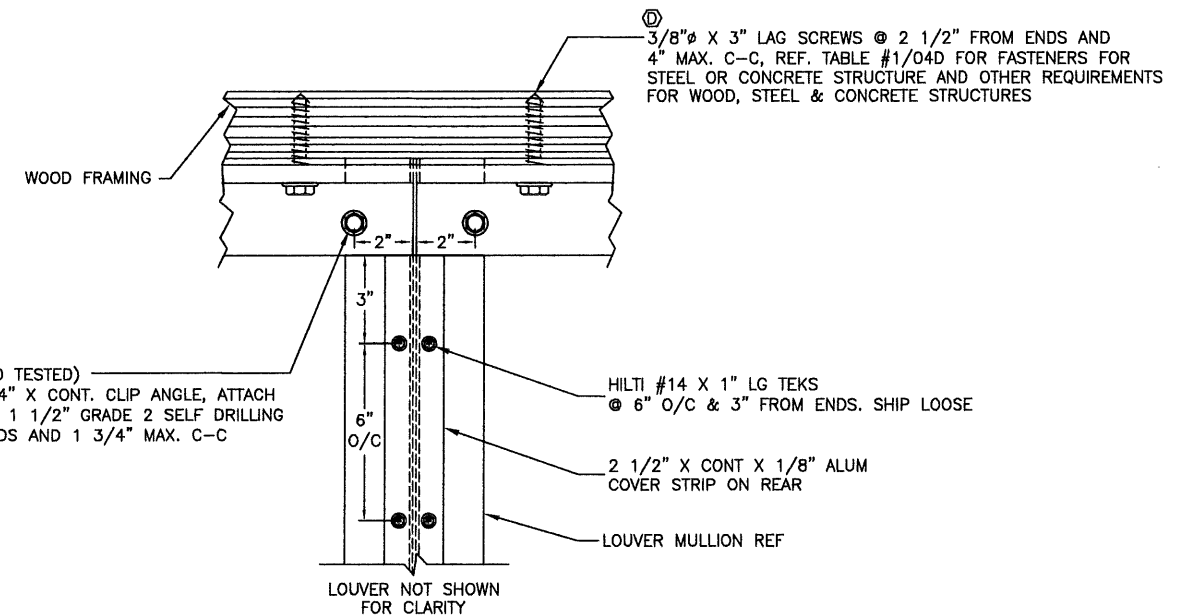

4 MULLION HEAD DETAIL @ STRUCTURE (SILL SIM): METHOD 1 - AS TESTED - WOOD FRAMING
01D N.T.S.
ALTERNATE STRUCTURE - STEEL FRAMING, CONCRETE

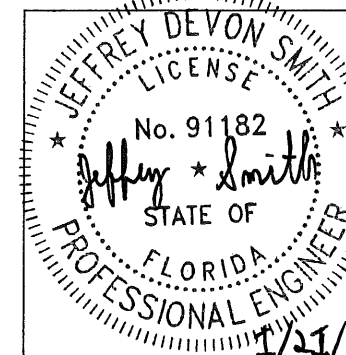

JEFFREY DEVON SMITH, P.E.
NO. 91182


PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 26-0224.01

Expiration Date 08/25/2031


By *[Signature]*
Miami-Dade Product Control

REV	DESCRIPTION	BY	CHK	APVD	ECN	DATE
1	UPDATED TITLE BLOCK & ENGINEER OF RECORD					01/06/26
2						
3						
4						
5						
6						
7						
8						
9						
10						
11						
12						
13						
14						
15						
16						
17						
18						
19						
20						
21						
22						
23						
24						
25						
26						
27						
28						
29						
30						
31						
32						
33						
34						
35						
36						
37						
38						
39						
40						
41						
42						
43						
44						
45						
46						
47						
48						
49						
50						
51						
52						
53						
54						
55						
56						
57						
58						
59						
60						
61						
62						
63						
64						
65						
66						
67						
68						
69						
70						
71						
72						
73						
74						
75						
76						
77						
78						
79						
80						
81						
82						
83						
84						
85						
86						
87						
88						
89						
90						
91						
92						
93						
94						
95						
96						
97						
98						
99						
100						


Unless Stated Otherwise
Use WIC-007

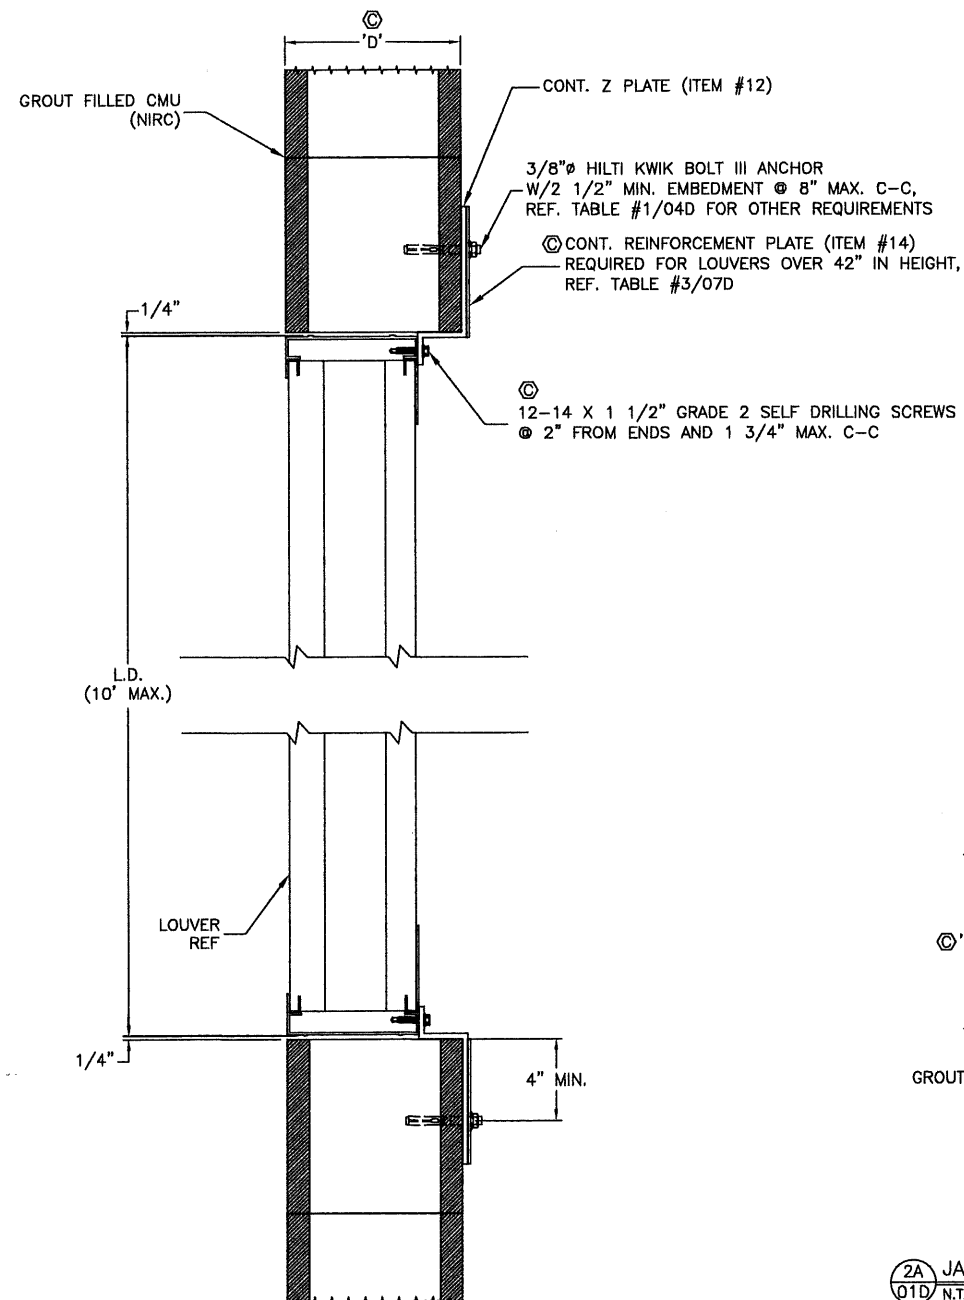


1A HEAD & SILL DETAIL: METHOD 2 - GROUT FILLED CMU (REF. NOTE 9)©
01D N.T.S.

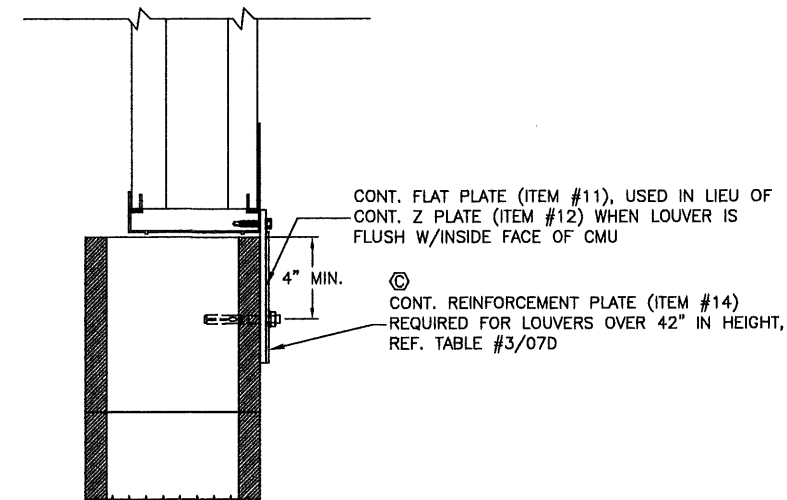


1B HEAD & SILL DETAIL: METHOD 2 - GROUT FILLED CMU (REF. NOTE 9)©
N.T.S.

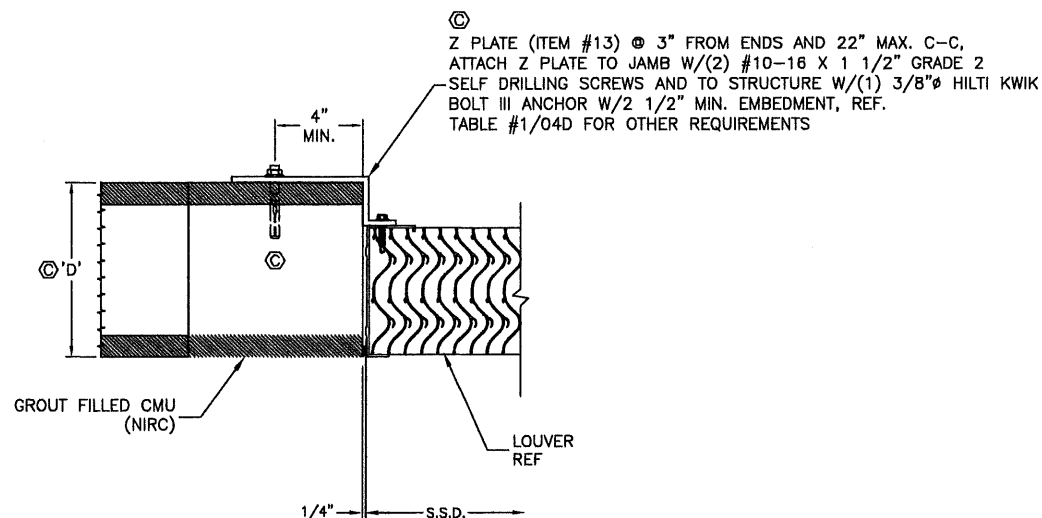

2A JAMB DETAIL: METHOD 2 - GROUT FILLED CMU (REF. NOTE 9)©
01D N.T.S.

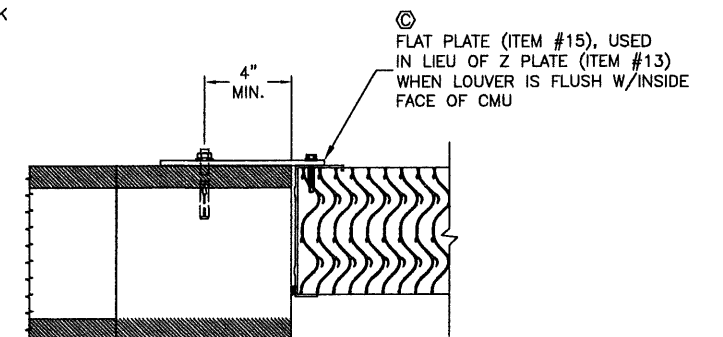

2B JAMB DETAIL: METHOD 2 - GROUT FILLED CMU (REF. NOTE 9)©
01D N.T.S.

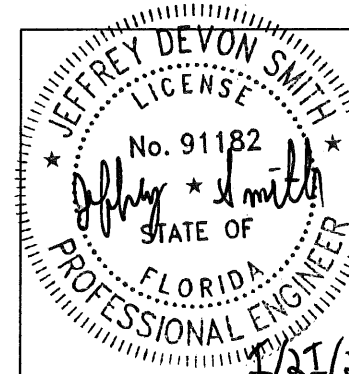

JEFFREY DEVON SMITH, P.E.
NO. 91182

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 26-0224.01

Expiration Date 08/25/2031

By *[Signature]*
Miami-Dade Product Control

E		UPDATED TITLE BLOCK & ENGINEER OF RECORD										E-R		NS		JDS				01/06/26							
REV		DESCRIPTION										BY		CHK		APVD		ECN		DATE							
AUTHOR		VMA		6/9/09												3900 Doctor Greaves Rd, Cheney, MD 64030 PROPRIETARY AND CONFIDENTIAL											
CHECKED		DJR		6/14/10																							
APPROVED		DJR		6/14/10																							
APPROVED						PRODUCT										EME6325D											
MATERIAL ALUMINUM		EME6325D LOUVER CMU INSTALLATION DETAILS										TITLE															
												SIZE		D		DWG NO		60-022167-03D						REV		E	
ECN		14372				SCALE		NONE		AUTOCAD		SHEET 3		OF 7													

Unless Stated Otherwise
Use WIC-007


©TABLE #1: APPROVED ATTACHMENTS

STRUCTURE	CONNECTION TYPE	ANGLE SLOT WIDTH	SPACING	MIN. EMBEDMENT	MIN. EDGE DIST.	END DIST.
(12 GA MIN.) STEEL FRAMING	¼"Ø A307 BOLT OR ¼"-14 GRADE 2 SDS	5/16"	3 ½" MAX. C-C	N/A	½"	2 ½"
(4" MIN.) CONCRETE (4000 PSI MIN.)	3/8"Ø HILTI KB TZ ANCHOR	7/16"	6" MAX. C-C	2"	3"	3"
GROUT FILLED CMU	3/8"Ø HILTI KB III ANCHOR	7/16"	8" MAX. C-C	2 ½"	4"	4" MIN.
(2 - 2 X 10) WOOD FRAMING (MIN. S.G. = 0.55)	3/8"Ø X 3" A307 LAG SCREW	7/16"	4" MAX. C-C	3"	2 ½"	2 ½"

NOTE: ALL FASTENERS MUST BE INSTALLED PER THE MANUFACTURER’S MIAMI-DADE COUNTY APPROVED INSTALLATION INSTRUCTIONS

TABLE #2: DRAWING CROSS REFERENCE

ITEM	DRAWING	MATERIAL	DESCRIPTION	RUSKIN #
1	60-022167-05D	6063-T6 AL	HEAD FRAME	70-021995-00B
2	60-022167-05D	6063-T6 AL	BLADE	70-021868-00B
3	60-022167-05D	6063-T6 AL	SILL FRAME	70-022627-00B
4	60-022167-05D	6063-T6 AL	JAMB FRAME	70-022227-00B
5	60-022167-06D	6063-T6 AL	CLIP ANGLE (STEEL STRUCTURE)	—
6	60-022167-06D	6063-T6 AL	CLIP ANGLE (CONCRETE STRUCTURE)	—
7	60-022167-06D	6063-T6 AL	CLIP ANGLE (WOOD STRUCTURE)	—
8	60-022167-06D	6063-T6 AL	CONT. CLIP ANGLE (STEEL STRUCTURE)	—
9	60-022167-06D	6063-T6 AL	CONT. CLIP ANGLE (CONCRETE STRUCTURE)	—
10	60-022167-06D	6063-T6 AL	CONT. CLIP ANGLE (WOOD STRUCTURE)	—
11	60-022167-07D	3003-H14 AL	HEAD/SILL CONT. FLAT PLATE (CMU STRUCTURE)	—
12	60-022167-07D	3003-H14 AL	HEAD/SILL CONT. Z PLATE (CMU STRUCTURE)	—
13	60-022167-07D	3003-H14 AL	JAMB Z PLATE (CMU STRUCTURE)	—
14	60-022167-07D	REF. TABLE#3	CONT. REINFORCEMENT PLATE (CMU STRUCTURE)	—
15	60-022167-07D	3003-H14 AL	JAMB FLAT PLATE (CMU STRUCTURE)	—

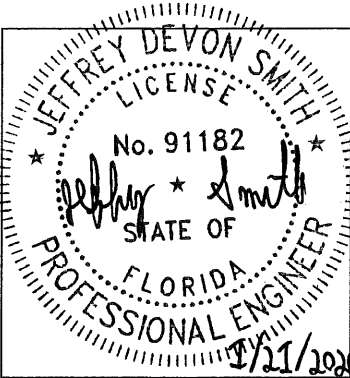


JEFFREY DEVON SMITH, P.E.
NO. 91182

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 26-0224.01
Expiration Date 08/25/2031
By *[Signature]*
Miami-Dade Product Control


E	UPDATED TITLE BLOCK & ENGINEER OF RECORD	E-R	NS	JDS		01/06/26
REV	DESCRIPTION	BY	CHK	APVD	ECN	DATE
AUTHOR	VMA	6/9/09				
CHECKED	DJR	6/14/10				
APPROVED	DJR	6/14/10				
MATERIAL	ALUMINUM					
TITLE	EME6325D LOUVER APPROVED ATTACHMENTS & DWG. CROSS REF. TABLES					
SIZE	D					
SCALE	NONE					
ECN	14272					
AUTOCAD						
SHEET	4					OF 7

Unless Stated Otherwise
Use WIC-007

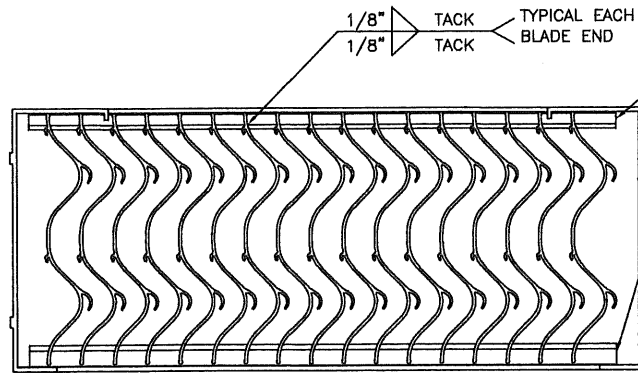


BLADE ANGLE ATTACHMENT DETAIL
N.T.S.


EXTRUDED BLADE ANGLE
REF ITEM "A"

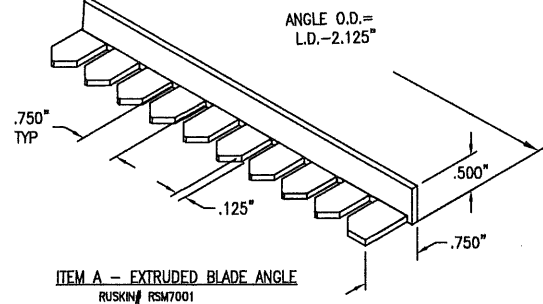


ITEM A - EXTRUDED BLADE ANGLE
RUSKIN# RSM7001

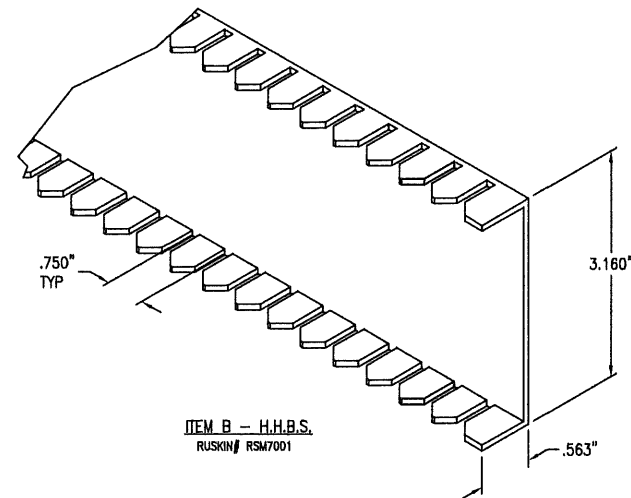


ITEM B - H.H.B.S.
RUSKIN# RSM7001

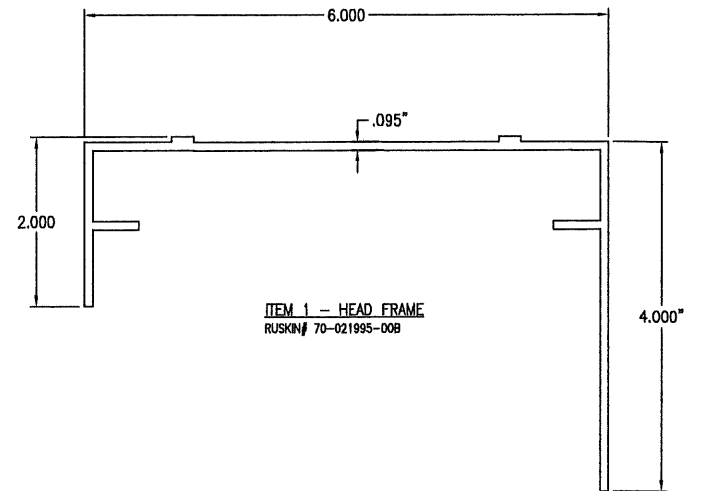


ITEM 1 - HEAD FRAME
RUSKIN# 70-021995-008

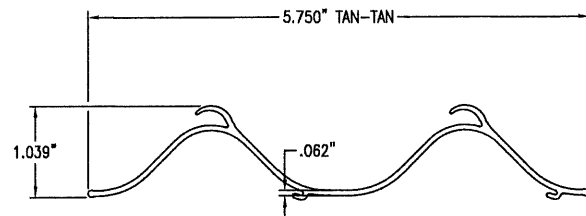


ITEM 2 - BLADE
RUSKIN# 70-021888-008

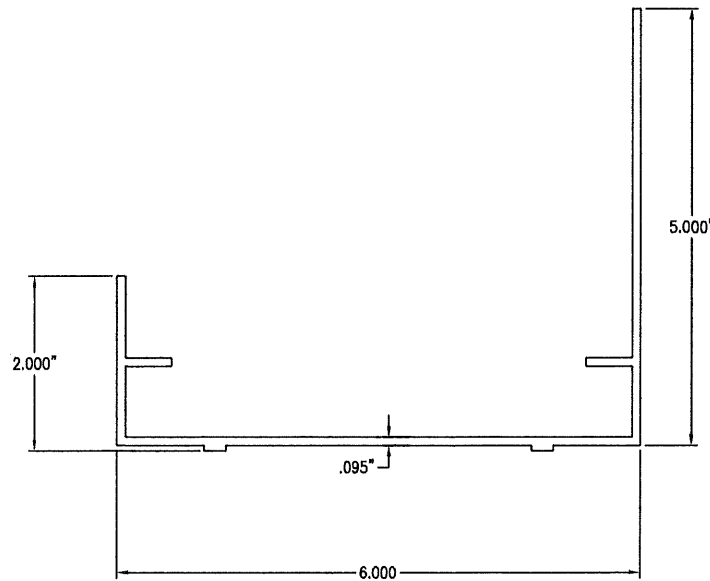

ITEM 3 - SILL FRAME
RUSKIN# 70-022827-008

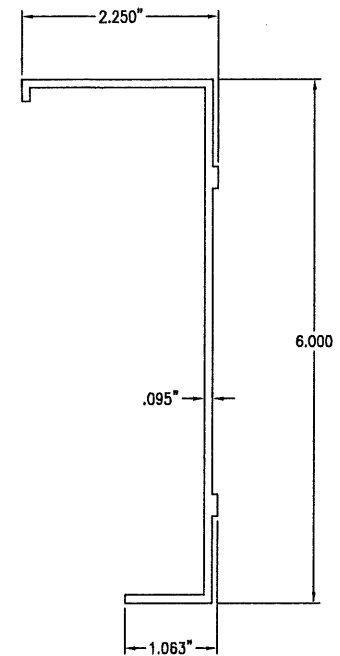

ITEM 4 - JAMB FRAME
RUSKIN# 70-022227-008

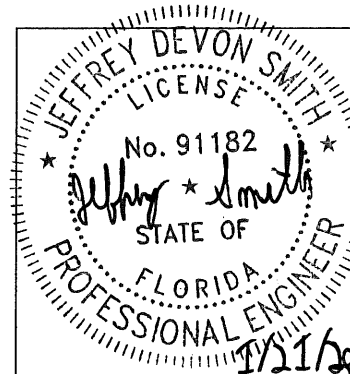

JEFFREY DEVON SMITH, P.E.
NO. 91182










PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 26-0224.01

Expiration Date 08/25/2031

By *[Signature]*
Miami-Dade Product Control

Unless Stated Otherwise
Use WIC-007

E		UPDATED TITLE BLOCK & ENGINEER OF RECORD				E-R	NS	JDS		01/06/26
REV	DESCRIPTION					BY	CHK	APVD	ECN	DATE
AUTHOR	VMA	6/9/09	 3900 Doctor Greaves Rd, Grandview, MO 64030 PROPRIETARY AND CONFIDENTIAL							
CHECKED	DJR	6/14/10								
APPROVED	DJR	6/14/10								
APPROVED										
MATERIAL ALUMINUM			PRODUCT EME6325D							
			EME6325D LOUVER PART DETAILS							
			SIZE	D	DWG NO				REV	
					60-022167-05D				E	
ECN	14272		SCALE	NONE		AUTOCAD	SHEET 5 of 7			

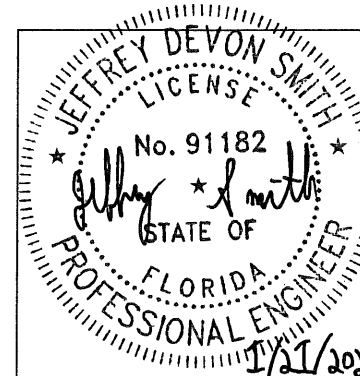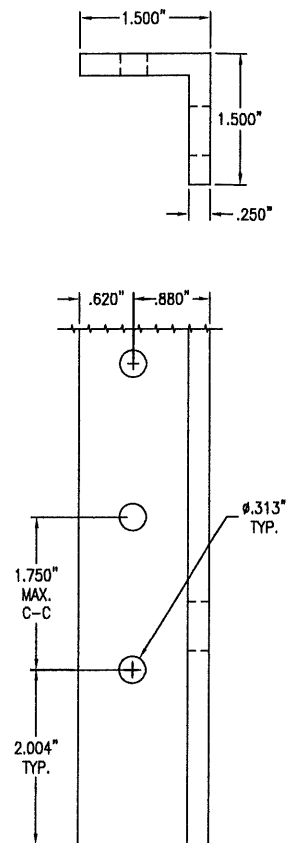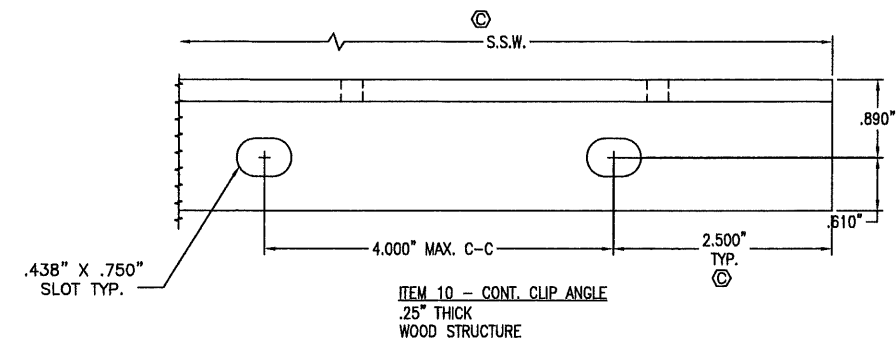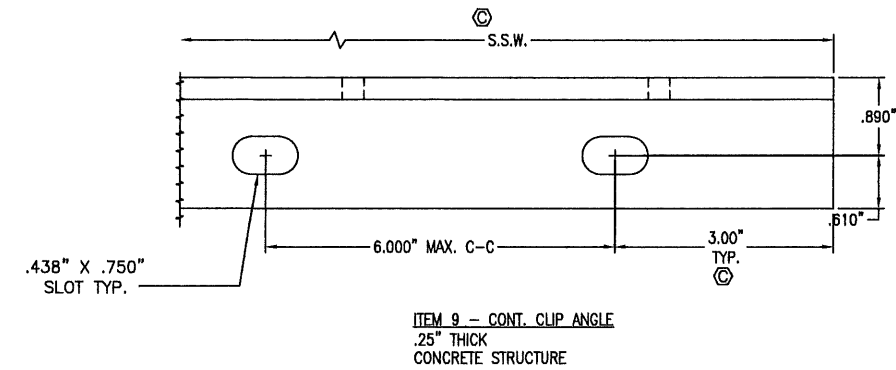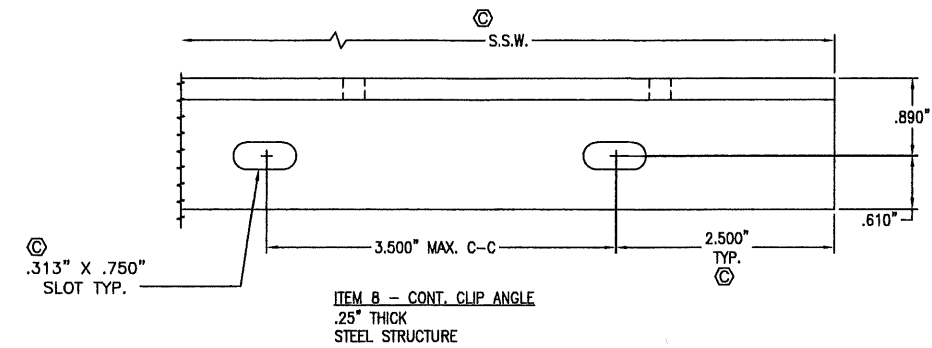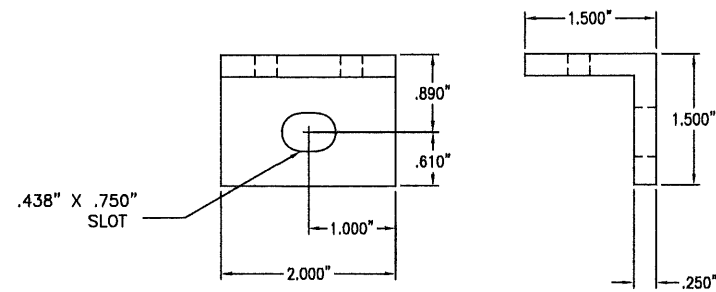

JEFFREY DEVON SMITH, P.E.
NO. 91182


PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 26-0224.01

Expiration Date 08/25/2031


By 
Miami-Dade Product Control

Unless Stated Otherwise
Use WJQ-007


E	UPDATED TITLE BLOCK & ENGINEER OF RECORD				E-R	NS	JDS		01/05/26
REV	DESCRIPTION				BY	CHK	APVD	ECN	DATE
AUTHOR	VMA	6/9/09	 3900 Doctor Greaves Rd, Grandview, MO 64030 PROPRIETARY AND CONFIDENTIAL						
CHECKED	DJR	6/14/10							
APPROVED	DJR	6/14/10							
APPROVED									
MATERIAL ALUMINUM			PRODUCT		EM66325D				
			TITLE		EM66325D LOUVER PART DETAILS				
			SIZE D		DWG NO		REV E		
					60-022167-06D				
ECN	14272		SCALE NONE		DWG NO		SHEET 6 OF 7		

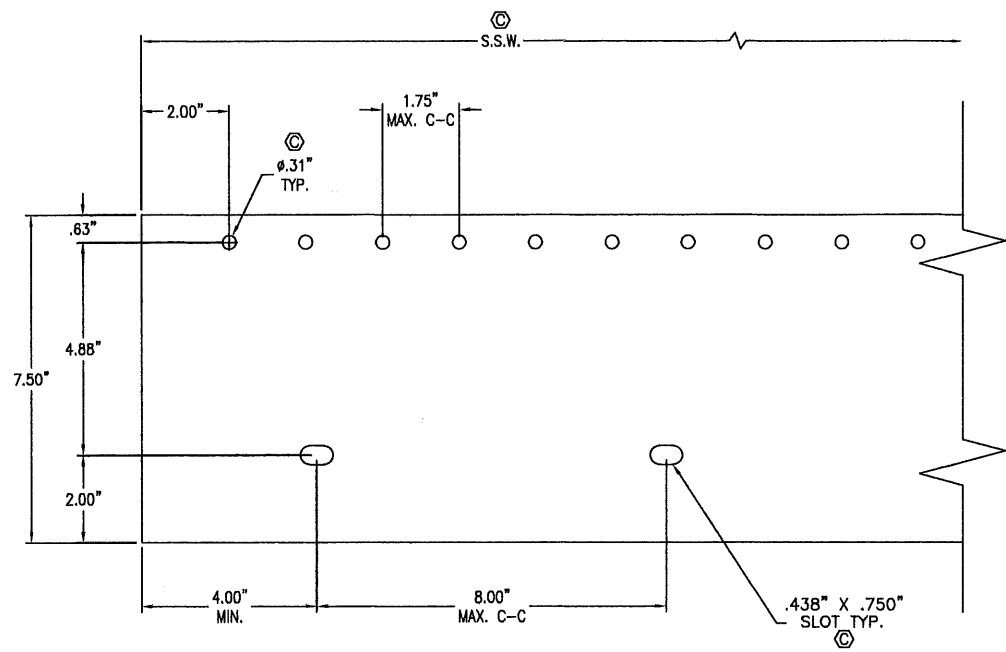



ITEM 11 - HEAD/SILL CONT. FLAT PLATE
.25" THICK
REQUIRES ITEM #14 FOR LOUVERS OVER 42" IN HEIGHT ©

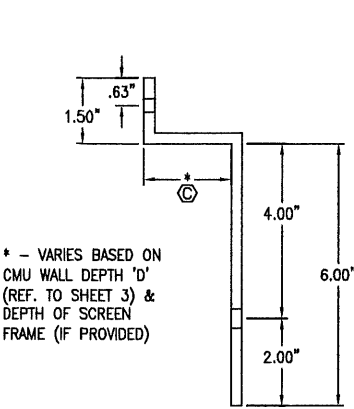


ITEM 13 - JAMB Z PLATE
.25" THICK

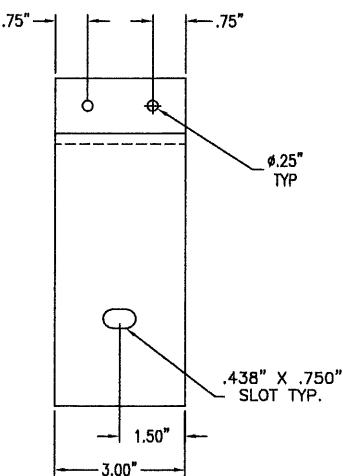

ITEM 15 - JAMB FLAT PLATE
.25" THICK

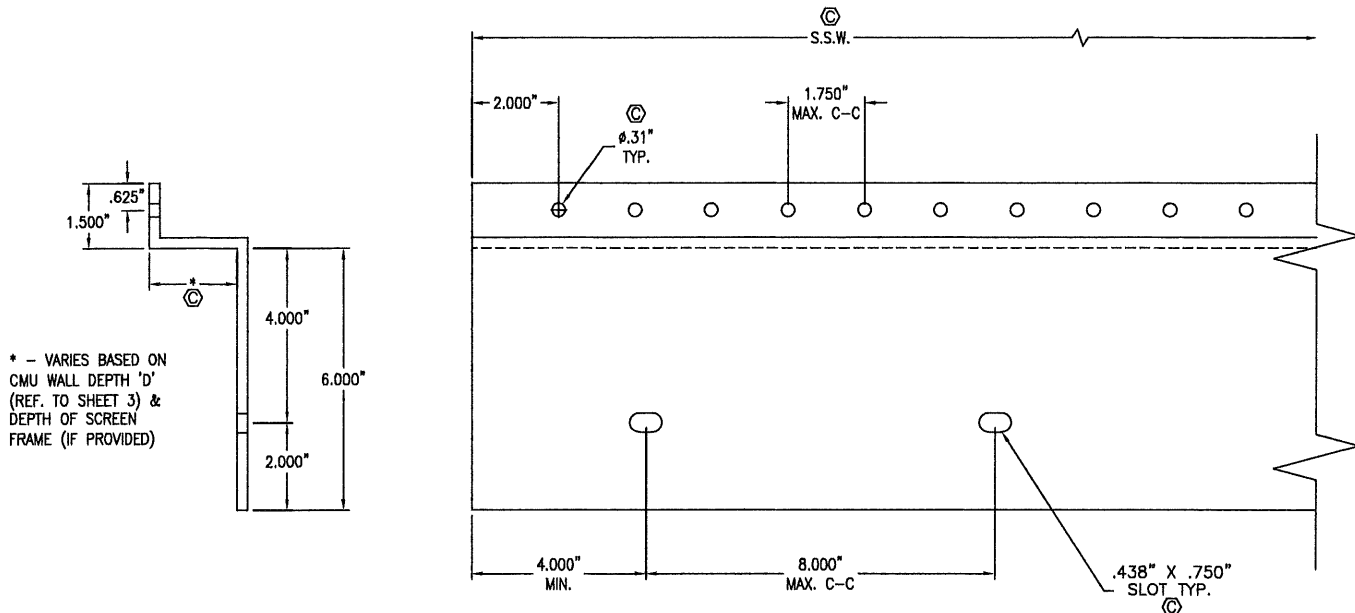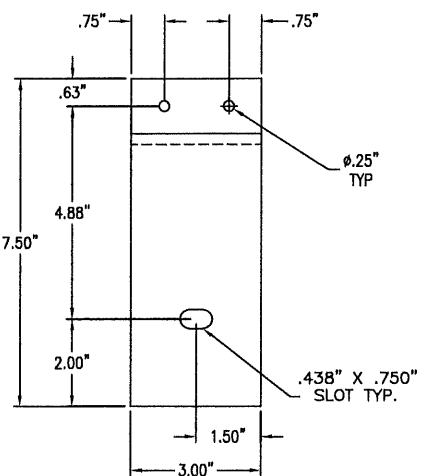


ITEM 12 - HEAD/SILL CONT. Z PLATE
.25" THICK
REQUIRES ITEM #14 FOR LOUVERS OVER 42" IN HEIGHT ©

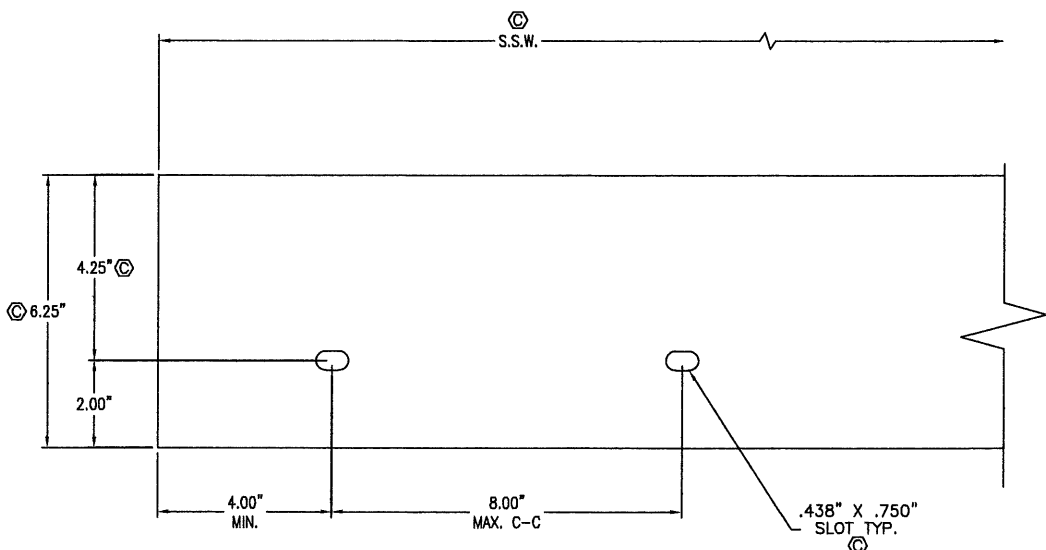

ITEM 14 - CONT. REINFORCEMENT PLATE
REF. TABLE #3

TABLE #3 ©		
LOUVER HEIGHT	ITEM #14 PLATE THICKNESS	MATERIAL
42" - 96"	.125"	5005-H34 AL
96" - 120"	.25"	3003-H14 AL

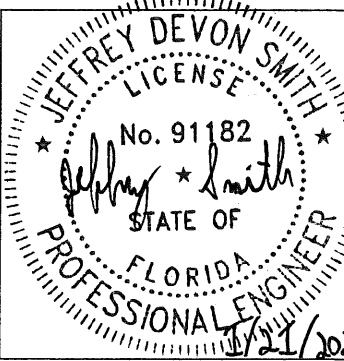

JEFFREY DEVON SMITH, P.E.
NO. 91182

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 26-0224.01
Expiration Date 08/25/2031
By *[Signature]*
Miami-Dade Product Control

E UPDATED TITLE BLOCK & ENGINEER OF RECORD					
REV	DESCRIPTION	BY	CHK	APVD	ECN
AUTHOR	VMA	6/9/09			
CHECKED	DJR	6/14/10			
APPROVED	DJR	6/14/10			
PRODUCT EME6325D					
TITLE EME6325D LOUVER PART DETAILS					
MATERIAL ALUMINUM					
SIZE D					
SCALE NONE					
ECN	14272				
AUTOCAD SHEET 7 OF 7					

Unless Stated Otherwise
Use WIC-007