



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

Sto Corporation
3800 Camp Creek Parkway Bldg. 1400 Suite 120
Atlanta, GA 30331

SCOPE: This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/ or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: StoTherm ci PLY EIFS System

APPROVAL DOCUMENT: Drawing titled "StoTherm ci PLY Large Missile Impact Resistance", sheets 1 through 5 of 5, prepared by Sto Corporation, dated 02/26/2026, signed and sealed by William R Heiden III, P.E., bearing the Miami-Dade County Product Control revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, model, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein. Each container (bucket or drum) needs to be labeled. Unit is further defined as each roll of reinforcing mat or mesh.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/ or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises NOA # 25-0107.08** consists of this page 1 and evidence page E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Carlos M. Utrera, P.E.**




04/14/26

NOA No. 26-0305.08
Expiration Date: June 21, 2028
Approval Date: April 23, 2026
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's

A. DRAWINGS

1. Drawing No. **HI-PLY SF/WF**, titled "StoTherm ci HI-PLY SF/WF for Large Missile Impact Resistance EIFS", sheets 1 through 4 of 4, dated 05/04/2018, prepared by Sto Corporation, signed and sealed by Kurt W. Heinrichs, P.E.

B. TESTS

1. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of StoTherm ci HI-PLY SF EIFS System, prepared by Intertek/ATI, Test Report No. **G5683.02-550-18**, dated 10/17/2017, signed and sealed by Justin P. McDonald, P.E.
2. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of StoTherm ci HI-PLY WF EIFS System, prepared by Intertek/ATI, Test Report No. **G5683.03-550-18**, dated 03/17/2017, signed and sealed by Justin P. McDonald, P.E.

C. CALCULATIONS

1. None.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS

1. None.

F. STATEMENTS

1. Statement of code conformance to the 6th edition (2017) FBC issued by Nova Engineering and Environmental, LLC, dated 03/07/2018, signed and sealed by Kurt W. Heinrichs, P.E.
2. Statement letter of no financial interest issued by Nova Engineering and Environmental, LLC, dated 02/23/2018, signed and sealed by Kurt W. Heinrichs, P.E.



Carlos M. Utrera, P.E.
Product Control Examiner
NOA No. 26-0305.08
Expiration Date: June 21, 2028
Approval Date: April 23, 2026

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

2. EVIDENCE SUBMITTED UNDER NOA # 23-0328.03, # 25-0107.08 AND NEW

A. DRAWINGS

1. Drawing titled “StoTherm ci PLY Large Missile Impact Resistance”, sheets 1 through 5 of 5, prepared by Sto Corporation, dated 02/26/2026, signed and sealed by William R Heiden III, P.E.

B. TESTS

1. Test reports on
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Cyclic Wind Pressure Loading per FBC, TAS 203-94along with marked-up drawings and installation diagram of StoTherm ci PLY SF EIFS System, prepared by Intertek, Test Report No. **P7210.01-550-18 R0**, dated 03/03/2023, signed and sealed by Tanya A. Dolby, P.E.

C. CALCULATIONS

1. None.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS


1. Test report on Flatwise Tensile Strength of Sandwich Constructions per ASTM C297-16, prepared by SGS TEC Services, Test Report No. 23-2159, dated 01/18/2024, signed by James G. McCants III.
2. Notice of Acceptance No. **24-1220.04**, issued to Atlas Molded Products, a div. of Atlas Roofing Corp. for its **ThermalStar GPS EPS Wall Insulation**, approved on 11/13/2025 and expiring on 11/13/2030.

F. STATEMENTS

1. Drawing statement of code conformance to the 8th edition (2023) of the FBC, issued by Sto Corporation, dated 10/21/2024, signed and sealed by William R Heiden III, P.E.



Carlos M. Utrera, P.E.
Product Control Examiner
NOA No. 26-0305.08
Expiration Date: June 21, 2028
Approval Date: April 23, 2026

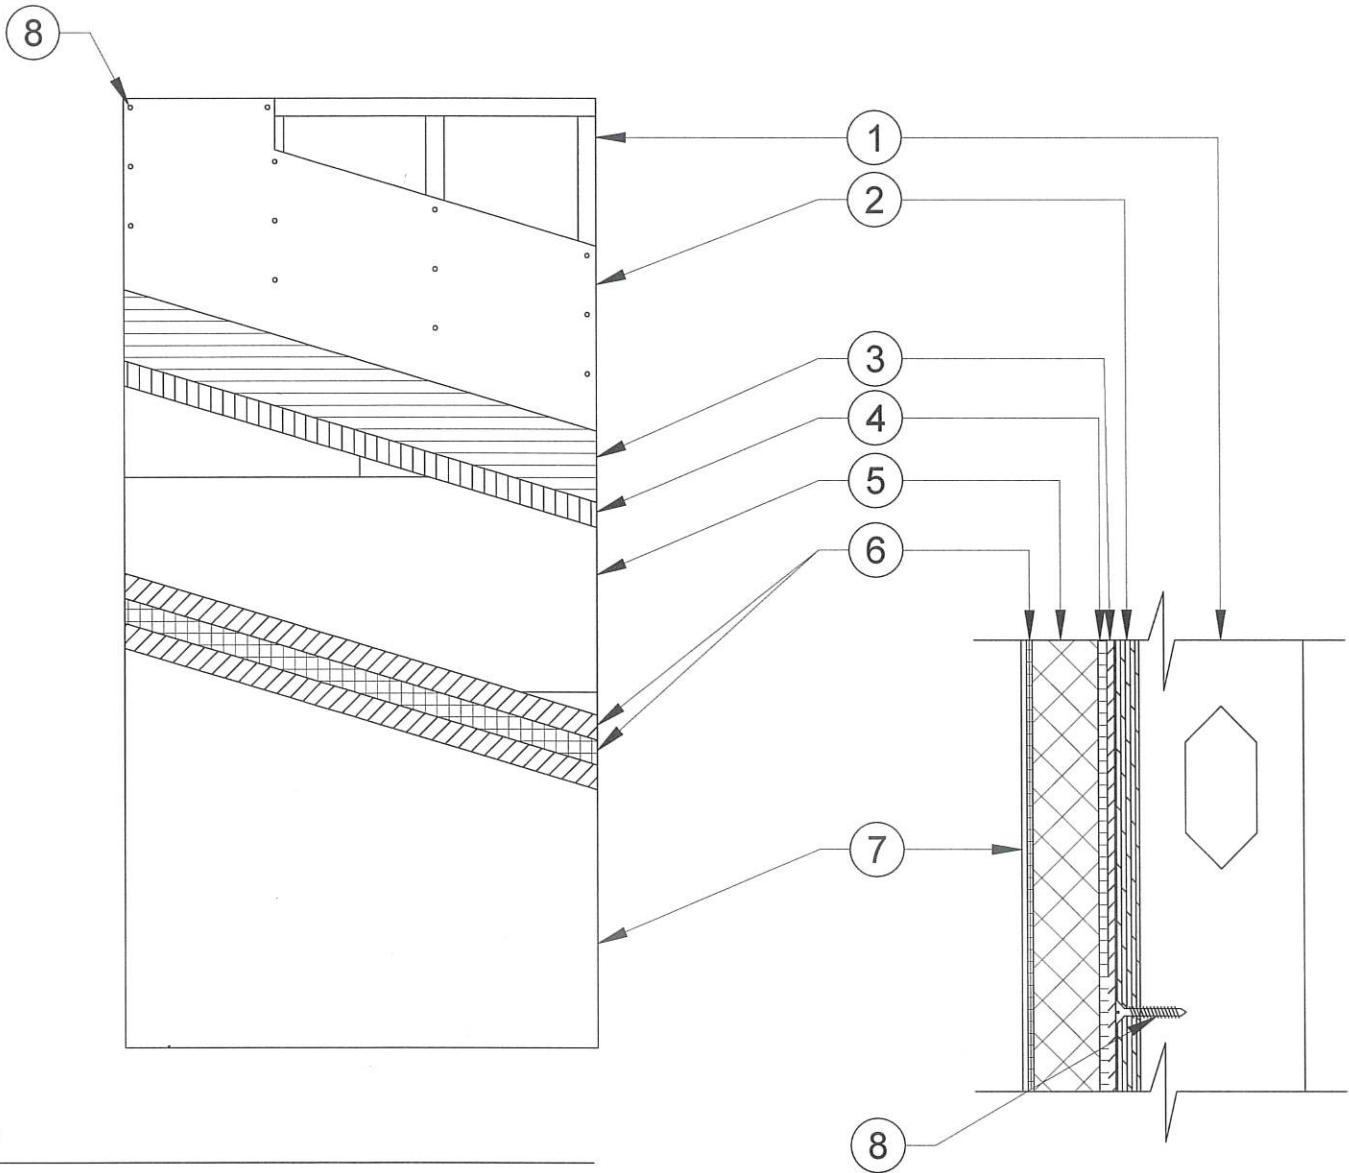

Key

- 1) 6", 18 ga steel studs and track @ 16" O.C.
- 2) 5/8" thick, 5-ply CDX sheathing
- 3) StoGuard with Sto Gold Coat®
- 4) Sto Primer / Adhesive-B or Sto TurboStick®
- 5) Sto Insulation Board @ minimum 1" thick
- 6) Sto Primer/Adhesive-B with Sto Mesh (4.5oz/yd²) embedded
- 7) Sto Textured Finishes or StoCast Finishes
- 8) #8 - S-12, 1-1/4" Wafer Head Self Drill Screws @ 6" O.C. in field and perimeter

Design Pressure Rating: +/-125 psf

Description: Steel Framing with Plywood Sheathing


- 1.1 Substrates and Sto products approved with the system
 - 1.1.1 Sheathing shall be 5/8" thick, 5-ply CDX plywood over steel 6", 18 ga studs @ 16" O.C. w/ 6", 18 ga steel track. Sheathing shall be fastened to the steel studs with #8 - S-12, 1-1/4" wafer head self drill screws @ 6" O.C. in field and perimeter.
- 1.2 Components of the System/Application
 - 1.2.2 Sto Gold Coat - A ready mixed flexible waterproof material applied to the dry Sto base coat via roller to approximately 10 wet mils.
 - 1.2.3 Insulation Board - Minimum 1" thick Sto Insulation Board in compliance with ASTM C 578 type 1, 1lb cu ft density meeting the requirements of FBC 2612. Sto Insulation board supplier shall have a current NOA with Miami-Dade County. The Sto Primer / Adhesive-B mixed with Portland Cement is applied to the back of the insulation board using a 1/2" x 1/2" U shaped notched trowel or Sto TurboStick® applied to the back of the Sto insulation board using a dispensing pistol. Uniform ribbons of adhesive are formed on the insulation board parallel to the short dimension of the board. Ribbons are oriented vertically when insulation is installed to provide drainage. The boards shall be placed, applying pressure in a running bond pattern with the long dimension horizontal and from a level base starting line. Butt all joints tightly to avoid thermal breaks. Adhesive should not get between joints.
 - 1.2.4 Sto Mesh is embedded in the wet Sto base coat by troweling from the center of the mesh to the edges of the mesh and the excess Sto base coat is removed to provide a total minimum 1/16" thickness of the reinforced base coat. This process is repeated until the entire exposed area of the insulation board is covered with base coat and mesh which is then allowed to dry for a minimum of 12 hours.
 - 1.2.5 Sto Textured Finishes or StoCast Finishes applied in accordance with manufacturer's published product instructions.

General Notes

- 1) This system has been designed in accordance with the current 2020 and 2023 Florida Building Code and the latest supplement(s).
- 2) This system has been tested in accordance with the Florida Building Code Test Protocols TAS-201,TAS-202, and TAS-203 Large Missile Impact Structural and Cyclic Testing.
- 3) This system shall be installed by a licensed plastering contractor following the recommendations of Sto Corp, this notice of acceptance and the applicable sections of the Florida Building Code.
- 4) The engineer and/or architect of record for each project using this system shall size all stud framing to ensure conformance with stud deflection and stress limitations as required by governing codes and this document.
- 5) Insulation boards shall be placed in a running bond pattern.
- 6) All studs used with this system shall be completely sheathed at the interior flange or bridged at maximum every 5 ft. of stud length or as specified by stud manufacturer.
- 7) All steel studs shall be structural with min 1-5/8" min. flange width and have minimum yield strength of 33000 PSI.
- 8) Details on page No. 3, 4 and 5 are typical and show intent to prevent water infiltration into and behind the system. Alternate detailing and specific conditions not covered by the typical details are the responsibility of the licensed design professional in consultation with Sto Corp.


SHEET	DATE: 02/03/26		REVISIONS				
	NO.	DESCRIPTION	DATE	BY	APPR.		
1 OF 5		SCALE: HORIZ. N/A					
		PREPARED BY: ZD					
		APPROVED: KS					
DWG NAME:		Property of Sto Corp. All Rights Reserved.					

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 26-0305.08
Expiration Date 06/21/2028
By *[Signature]*
Miami-Dade Product Control

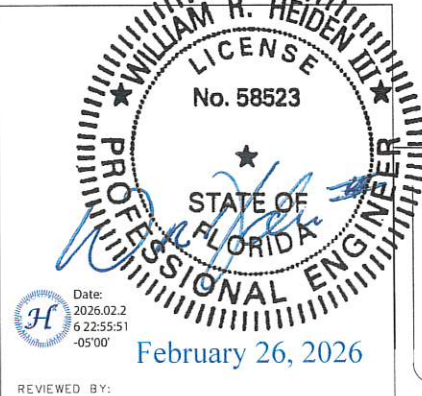

StoTherm®ci PLY
Large and Small Missile

sto
3800 CAMP CREEK PARKWAY
BUILDING 1400 • SUITE 120
ATLANTA, GA • 30331
(800)221-2397 • www.stocorp.com

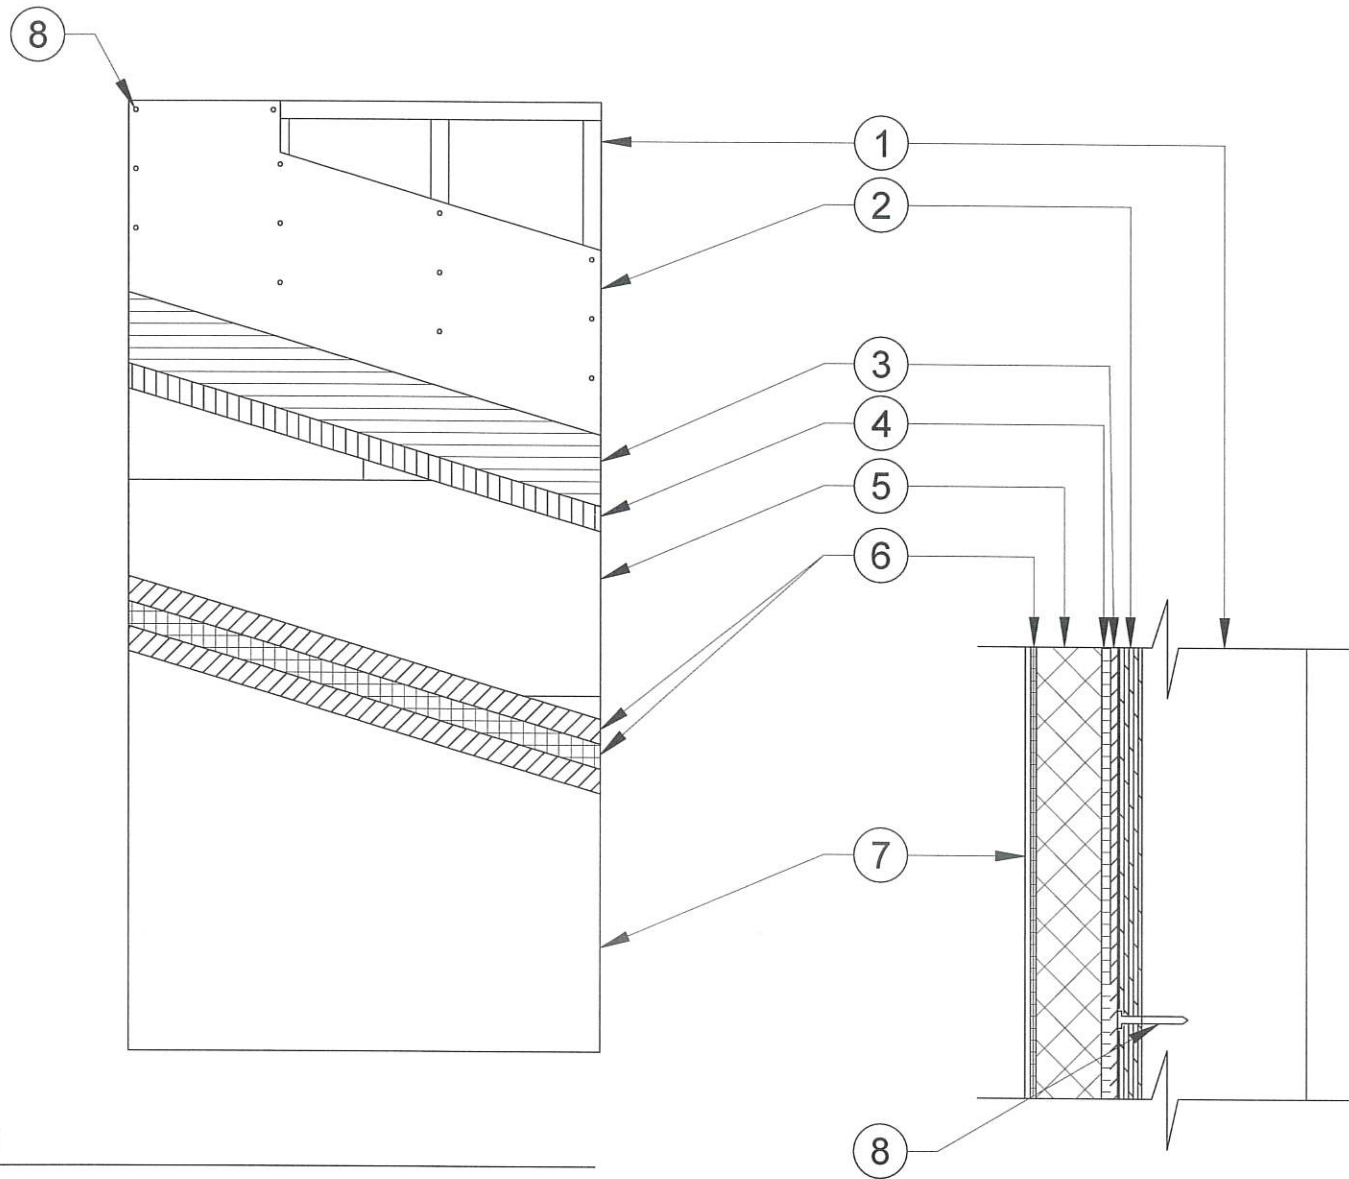

Key

- 1) Minimum 2" x 4" (Nominal) wood studs @ 16" O.C. SPF, Grade 2 Kiln Dried - See General Notes No 4 and 6.
- 2) 5/8" thick, 5-ply CDX sheathing
- 3) Stoguard with Sto Gold Coat®
- 4) Sto Primer / Adhesive-B or Sto TurboStick®
- 5) Sto Insulation Board @ minimum 1" thick
- 6) Sto Primer/Adhesive-B with Sto Mesh (4.5oz/yd²) embedded
- 7) Sto Textured Finishes / StoCast Finishes
- 8) 8D, Common Nails @ 6" O.C. in field and perimeter

Design Pressure Rating: +/-100 psf

Description: Wood Framing with Plywood Sheathing


- 1.1 Substrates and Sto products approved with the system
 - 1.1.1 Sheathing shall be 5/8" thick, 5-ply CDX plywood fastened to framing with minimum 8D common nails spaced maximum 6" O.C. in field and perimeter.
- 1.2 Components of the System/Application
 - 1.2.2 Sto Gold Coat - A ready mixed flexible waterproof material applied to the dry Sto base coat via roller to approximately 10 wet mills.
 - 1.2.3 Insulation Board - Minimum 1" thick Sto Insulation Board in compliance with ASTM C 578 type 1, 1lb cu ft density meeting the requirements of FBC 2612. Sto Insulation board supplier shall have a current NOA with Miami-Dade County. The Sto Primer / Adhesive-B mixed with Portland Cement 1:1 by volume is applied to the back of the insulation board using a 1/2" x 1/2" U shaped notched trowel or Sto TurboStick® applied to the back of the Sto insulation board using a dispensing pistol. Uniform ribbons of adhesive are formed on the insulation board parallel to the short dimension of the board. Ribbons are oriented vertically when insulation is installed to provide drainage. The boards shall be placed, applying pressure in a running bond pattern with the long dimension horizontal and from a level base starting line. Butt all joints tightly to avoid thermal breaks. Adhesive should not get between joints.
 - 1.2.4 Sto Mesh is embedded in the wet Sto base coat by troweling from the center of the mesh to the edges of the mesh and the excess Sto base coat is removed to provide a total minimum 1/16" thickness of the reinforced base coat. This process is repeated until the entire exposed area of the insulation board is covered with base coat and mesh which is then allowed to dry for a minimum of 12 hours.
 - 1.2.5 Sto Textured Finishes / StoCast Finishes applied in accordance with manufacturer's published product instructions.

General Notes

- 1) This system has been designed in accordance with the current 2020 and 2023 Florida Building Code and the latest supplement(s).
- 2) This system has been tested in accordance with the Florida Building Code Test Protocols TAS-201,TAS-202, and TAS-203 Large Missile Impact Structural and Cyclic Testing.
- 3) This system shall be installed by a licensed plastering contractor following the recommendations of Sto Corp, this notice of acceptance and the applicable sections of the Florida Building Code.
- 4) The engineer and/or architect of record for each project using this system shall size all stud framing to ensure conformance with stud deflection and stress limitations as required by governing codes and this document.
- 5) Insulation boards shall be placed in a running bond pattern.
- 6) All studs used with this system shall be completely sheathed at the interior flange or bridged at maximum every 5 ft. of stud length or as specified by stud manufacturer.
- 7) All wood studs shall be a minimum 2" x 4" (nominal) spaced @ 16" o.c. spf, grade 2 kiln dried.
- 8) Details on page No. 3, 4 and 5 are typical and show intent to prevent water infiltration into and behind the system. Alternate detailing and specific conditions not covered by the typical details are the responsibility of the licensed design professional in consultation with Sto Corp.

SHEET	DATE: 02/03/26		REVISIONS				
	NO.	DESCRIPTION	DATE	BY	APPR.		
2		SCALE: HORIZ. N/A					
		PREPARED BY: ZD					
		APPROVED: KS					
OF							
5							
DWG NAME:		Property of Sto Corp. All Rights Reserved					

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 26-0305.08
Expiration Date 06/21/2028
By *[Signature]*
Miami-Dade Product Control

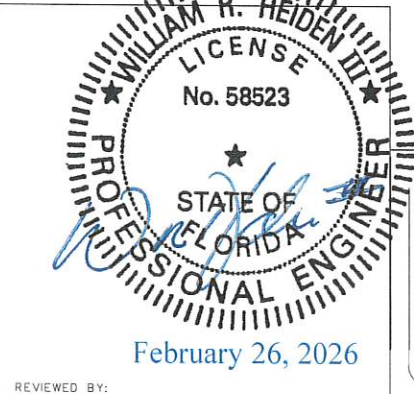


StoTherm® ci PLY
Large and Small Missile


sto
3800 CAMP CREEK PARKWAY
BUILDING 1400 • SUITE 120
ATLANTA, GA • 30331
(800)221-2397 • www.stocorp.com

General Notes


- 1) StoTherm® ci PLY installation same for both steel and wood frame options. Steel frame only shown for typical details.

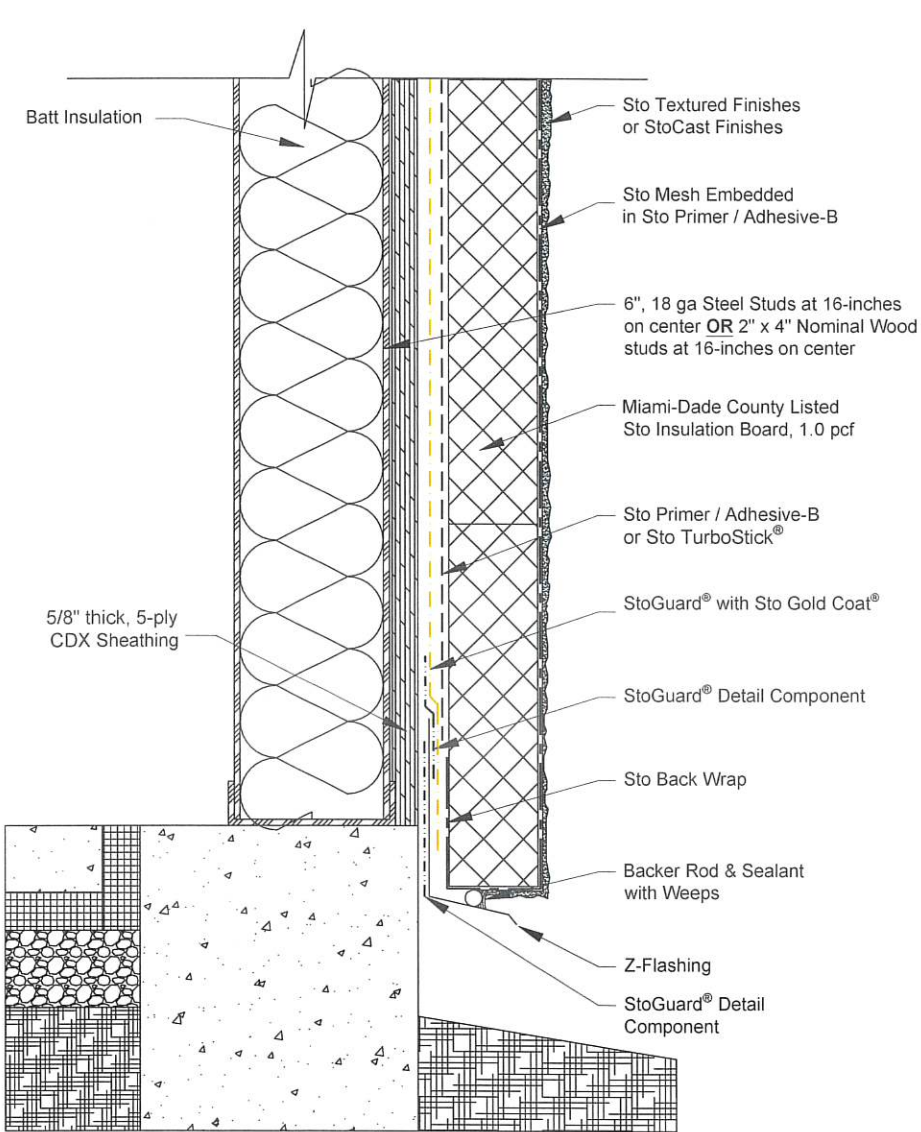

Termination at Grade
Not To Scale

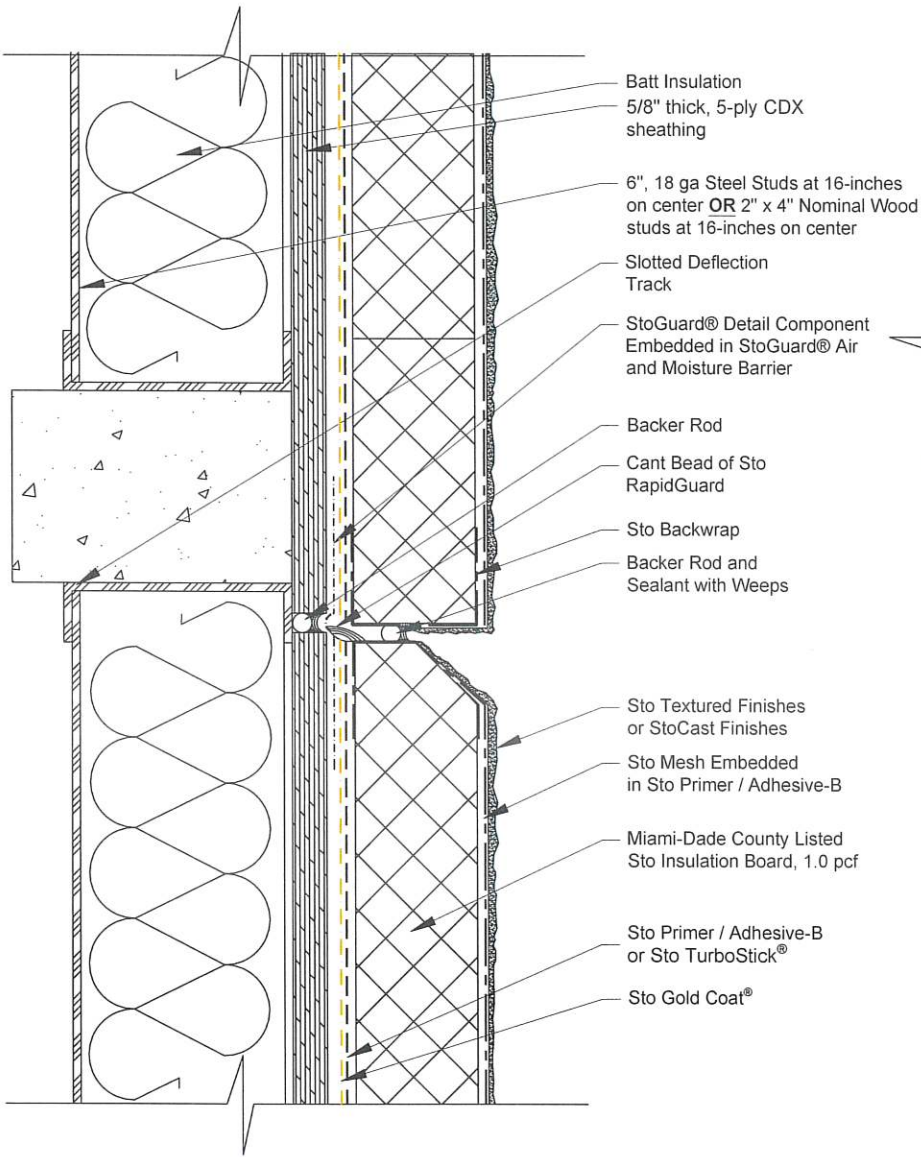

Floor Line With Deflection - Drainage at Floor Line
Not To Scale

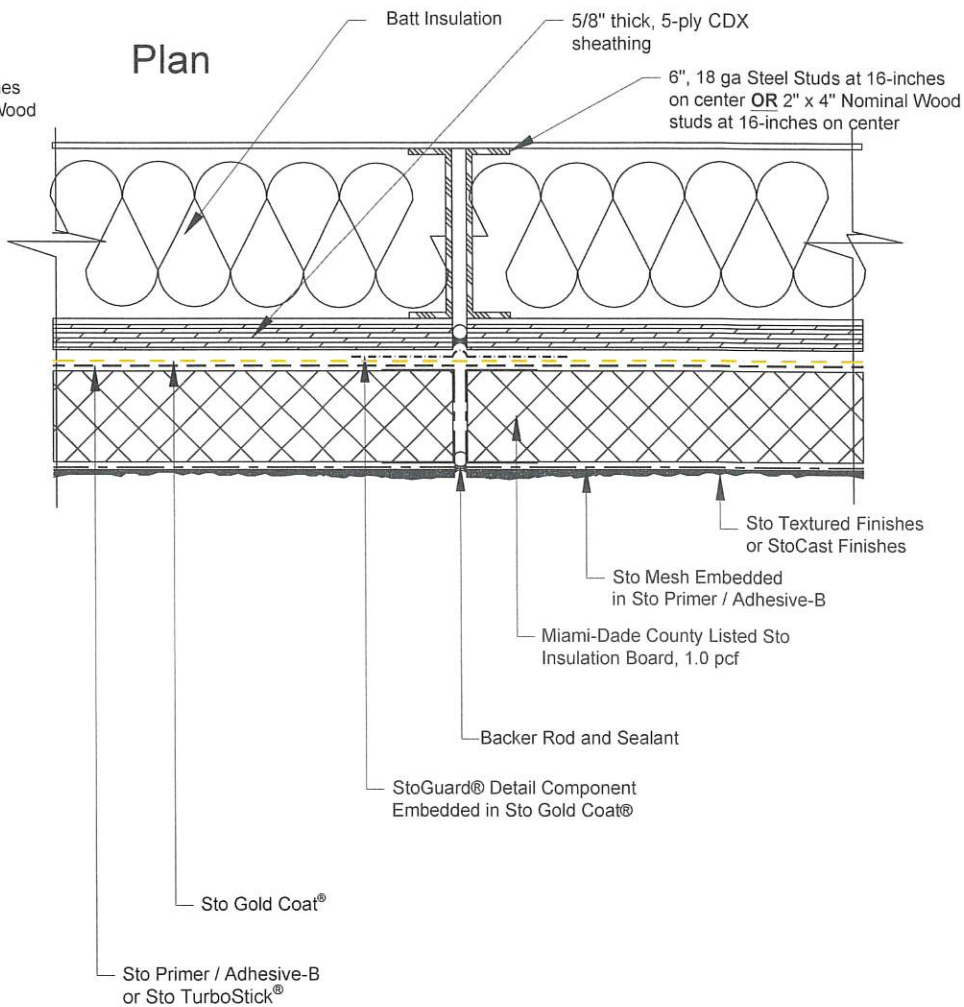

Vertical Expansion Joint In Back-Up Wall
Not To Scale

SHEET	DATE: 02/03/26	REVISIONS				
		NO.	DESCRIPTION	DATE	BY	APPR.
3 OF 5	SCALE: HORZ. N/A					
	PREPARED BY: ZD					
	APPROVED: KS					
DWG NAME:		Property of Sto Corp. All Rights Reserved.				

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 26-0305.08
Expiration Date 06/21/2028
By *[Signature]*
Miami-Dade Product Control




StoTherm® ci PLY
Large and Small Missile


sto
3800 CAMP CREEK PARKWAY
BUILDING 1400 • SUITE 120
ATLANTA, GA • 30331
(800)221-2397 • www.stocorp.com

General Notes


- 1) StoTherm® ci PLY installation same for both steel and wood frame options. Steel frame only shown for typical details.

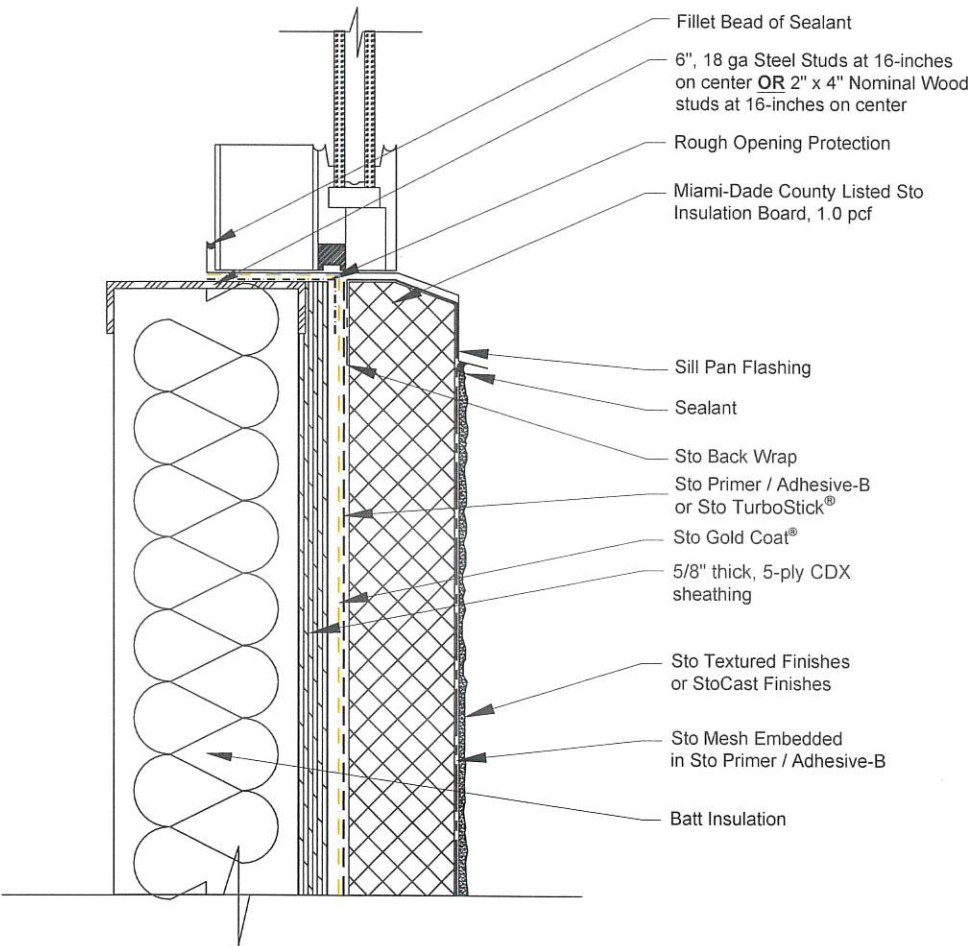

Window Sill / Receptor Style
Not To Scale

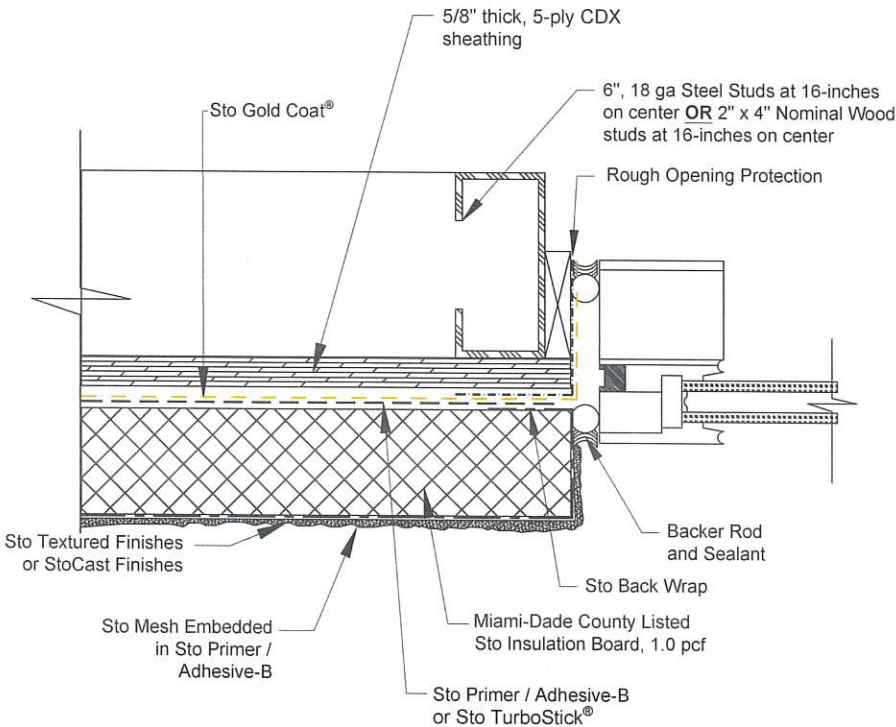


Window Jamb / Receptor Style
Not To Scale

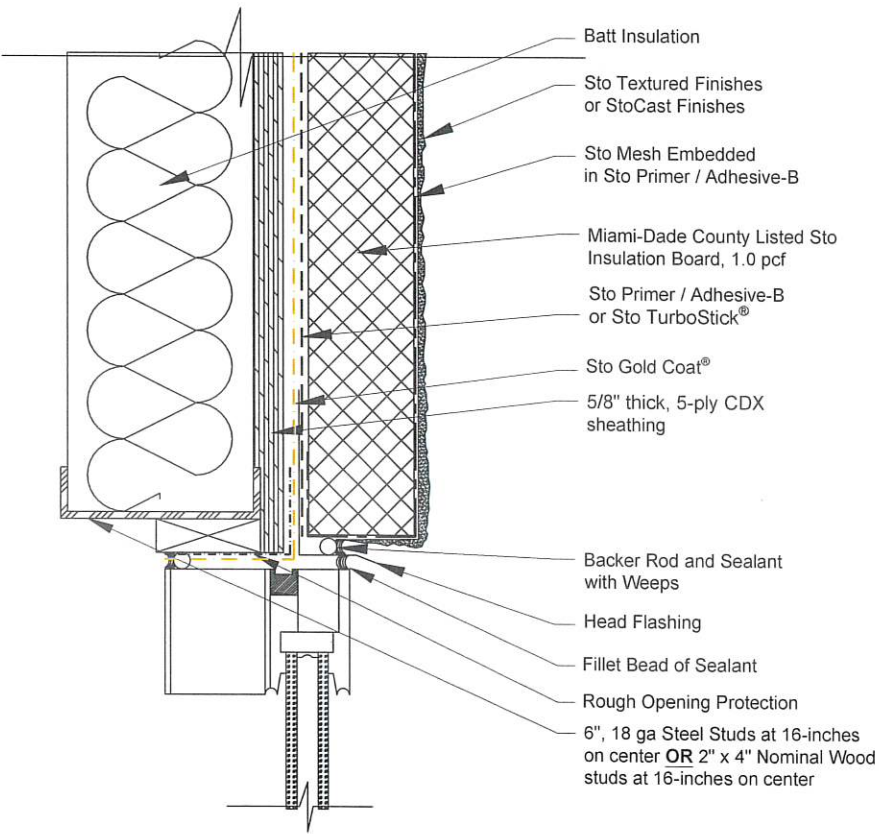

Window Head / Receptor Style
Not To Scale

SHEET	DATE: 02/03/26		REVISIONS				
	SCALE: HORIZ. N/A	NO.	DESCRIPTION	DATE	BY	APPR.	
4	PREPARED BY: ZD						
	APPROVED: KS						
OF							
5							
DWG NAME: Property of Sto Corp. All Rights Reserved.							

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 26-0305.08
Expiration Date 06/21/2028
By *[Signature]*
Miami-Dade Product Control

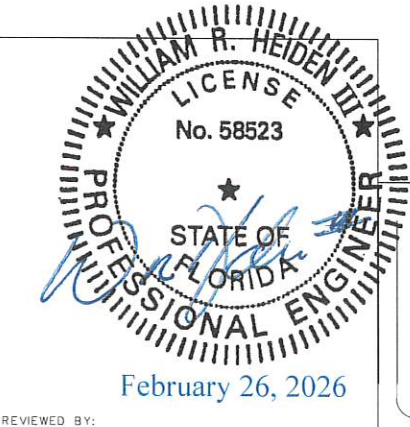


StoTherm® ci PLY
Large and Small Missile


sto
3800 CAMP CREEK PARKWAY
BUILDING 1400 • SUITE 120
ATLANTA, GA • 30331
(800)221-2397 • www.stocorp.com

General Notes


1) StoTherm® ci PLY installation same for both steel and wood frame options. Steel frame only shown for typical details.

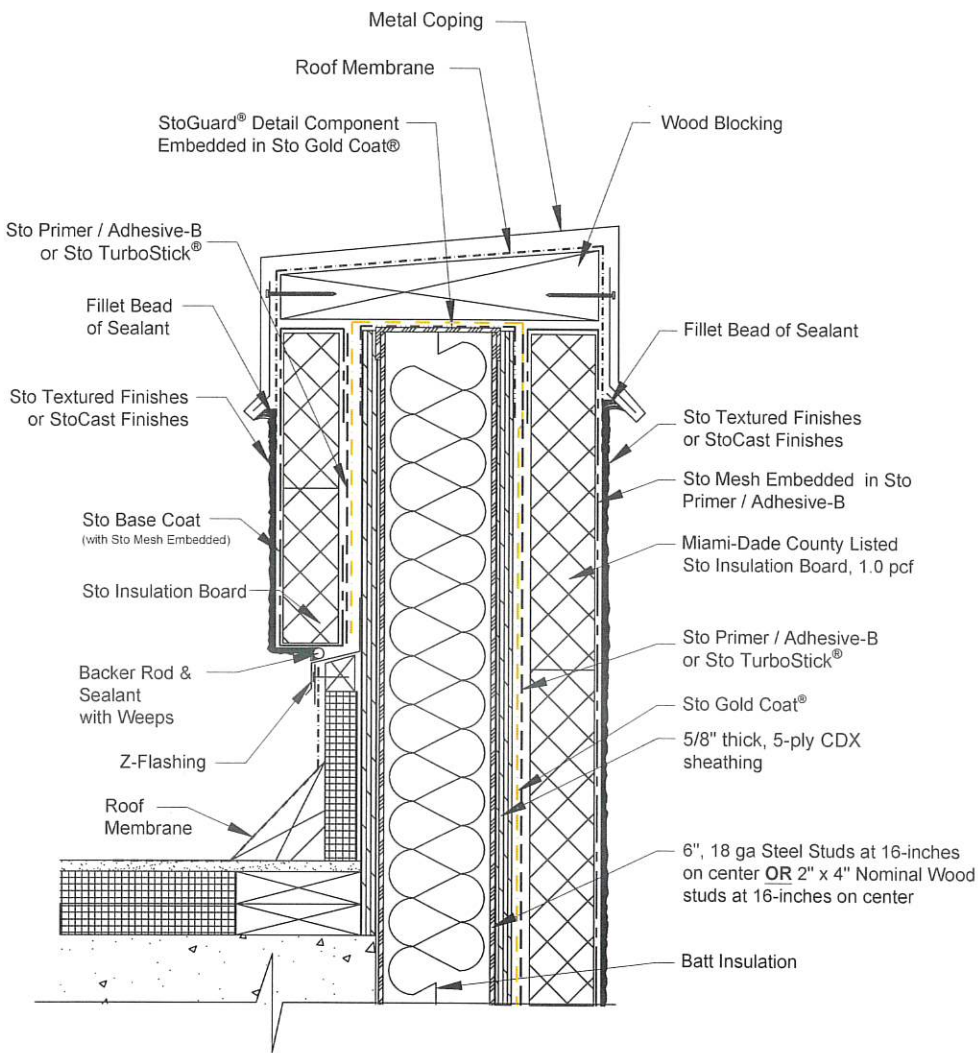

Termination at Parapet
Not To Scale

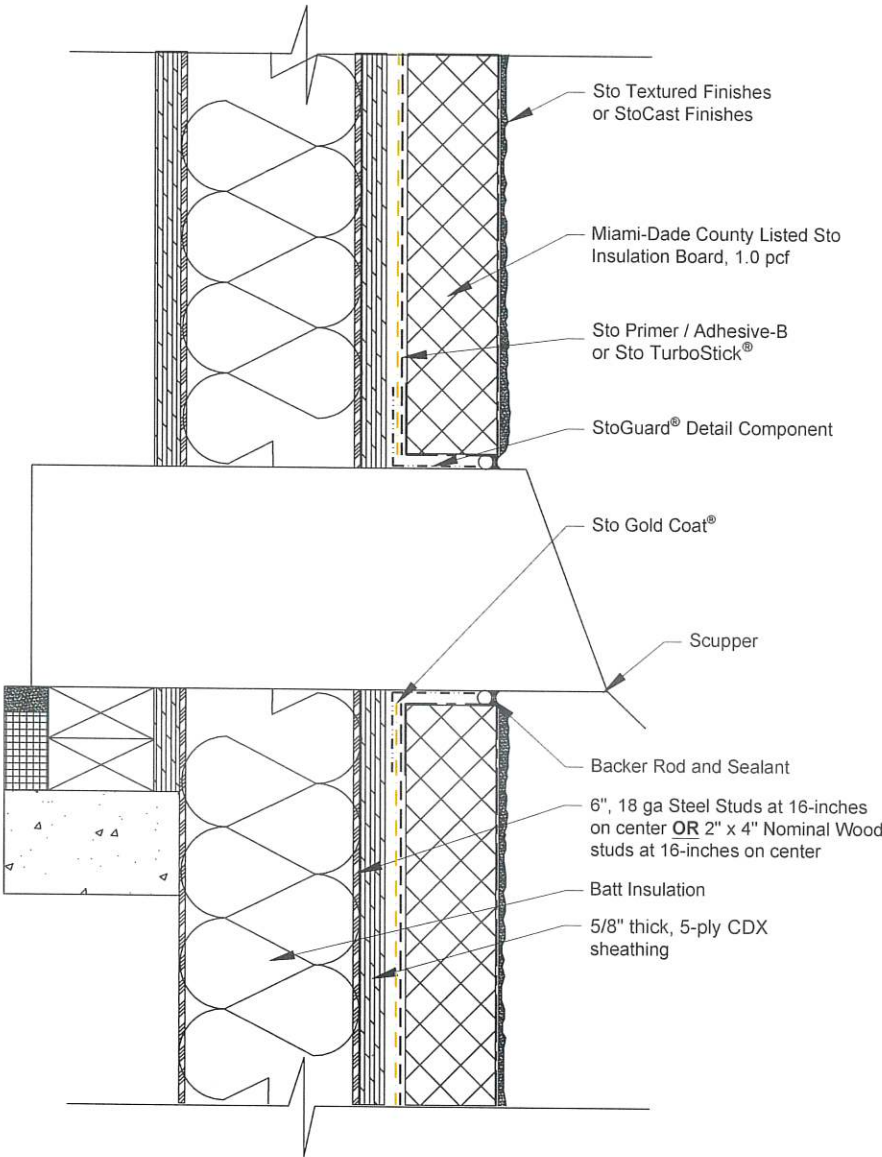


Scupper Penetration
Not To Scale

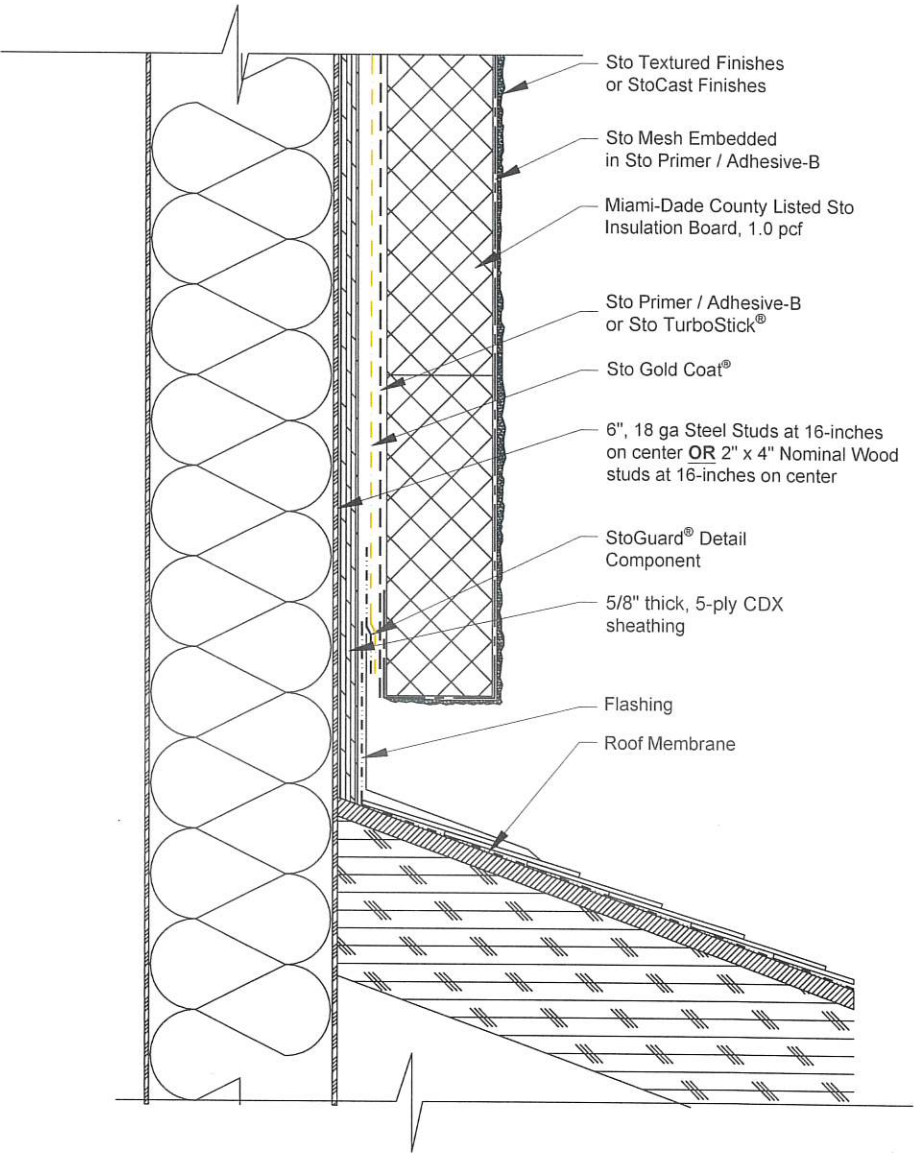

Diverter Flashing at Roof Abutment
Not To Scale

SHEET	DATE: 02/03/26	REVISIONS				
		NO.	DESCRIPTION	DATE	BY	APPR.
5	SCALE: HORIZ. N/A					
	PREPARED BY: ZD					
	APPROVED: KS					
OF						
5						
DWG NAME:		Property of Sto Corp. All Rights Reserved				

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 26-0305.08
Expiration Date 06/21/2028
By *[Signature]*
Miami-Dade Product Control

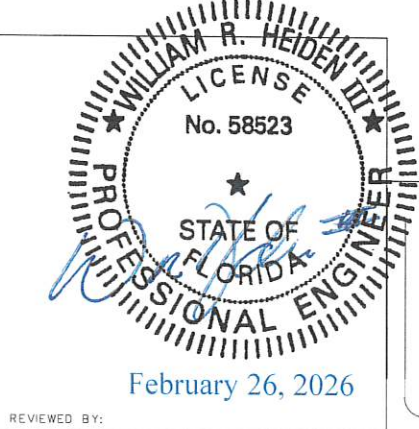

StoTherm® ci PLY
Large and Small Missile

sto
3800 CAMP CREEK PARKWAY
BUILDING 1400 • SUITE 120
ATLANTA, GA • 30331
(800)221-2397 • www.stocorp.com