



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599

www.miamidade.gov/economy

NOTICE OF ACCEPTANCE (NOA)

Red Oaks Shutter, Inc.
221 S.W. 5th Court
Pompano Beach, Florida 33060

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: “Bertha HV” Aluminum Accordion Shutter System

APPROVAL DOCUMENT: Drawing No. 23-118, titled “Bertha HV Accordion Shutter System”, sheets 1 through 28 of 28, and Sheet 15A & 28A, prepared by Tiltco, Inc., dated July 21, 2023, signed and sealed by Walter A. Tillit Jr., P.E., on April 27, 2026 bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and the expiration date by Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, the following statement: "Miami-Dade County Product Control Approved", and NOA number, per TAS-201, TAS-202, and TAS-203, unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises and renews NOA #23-0707.05** and consists of this page 1, evidence submitted pages E-1, E-2, E-3, E-4, E-5, E-6, E-7 & E-8 as well as approval document mentioned above.

The submitted documentation was reviewed by **Helmy A. Makar, P.E., M.S.**



Helmy A. Makar
06/04/26

NOA No. 26-0428.01
Expiration Date: 07/07/2031
Approval Date: 06/04/2026

Red Oaks Shutter, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL #98-0528.01

A. DRAWINGS

1. *Drawing prepared by Tilteco Inc., titled "ASSA/Economy Accordion Shutter," Drawing No. 98-101, dated May 6, 1998, sheets 1 through 9 of 9, signed and sealed by Walter A. Tillit, Jr., P.E.*

B. TESTS

1. *See Association's generic approval under 96-0091.*

C. CALCULATIONS

1. *See Association's generic approval under 96-0091.*

D. MATERIAL CERTIFICATIONS

1. *See Association's generic approval under 96-0091.*

E. STATEMENTS

1. *Release letter issued by the American Shutter Systems Association, Inc., dated May 6, 1998, certifying this product to meet the criteria of product tested and approved, and allowing Red Oaks Shutter, Inc., to use the test results approved under Dade County Approval No. 96-0091, signed by Mr. John J. Cooper.*
2. *Acknowledgment letter by Red Oaks Shutter, Inc., dated May 8, 1998, signed by Mr. David Barbour.*
3. *Letter by Tilteco Inc., dated May 14, 1998, certifying that the drawing (No. 98-101) prepared for Red Oaks Shutter, Inc., signed and sealed by Mr. Walter A. Tillit, Jr., P.E., is engineering wise identical to ASSA's generic drawing (No. 95-62A).*
4. *Letter issued to Mr. David Barbour on June 3, 1998 and returned signed by Mr. David Barbour on July 1, 1998, indicating to please issue the proposed Notice of Acceptance as submitted and reviewed.*

2. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL #01-0228.05

A. DRAWINGS

1. *None.*

B. TESTS


1. *See Association's generic approval under 96-0091.*

C. CALCULATIONS

1. *See Association's generic approval under 96-0091.*

D. MATERIAL CERTIFICATIONS

1. *See Association's generic approval under 96-0091.*



Helmy A. Makar, P.E., M.S.
Product Control Section Supervisor
NOA No. 26-0428.01
Expiration Date: 07/07/2031
Approval Date: 06/04/2026

Red Oaks Shutter, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

E. STATEMENTS

1. *Letter from Red Oaks Shutter, Inc., dated February 22, 2001, signed by Mr. David Barbour requesting the renewal of Product Approval #98-0528.01 and stating that no change has been done.*
2. *Letter by Tilteco Inc., dated February 22, 2001, signed and sealed by Mr. Walter A. Tillit, Jr., P.E., certifying that he is still in the engineering business.*
3. *Acceptance Letter issued to Mr. David Barbour on April 25, 2001, and returned signed by Mr. David Barbour on April 30, 2001, indicating to please issue the proposed Notice of Acceptance as submitted and reviewed.*

3. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL #03-0106.21

A. DRAWINGS

1. *Drawing No. 02-572, titled "ASSA/Economy Accordion Shutter", sheets 1 through 9 of 9, prepared by Tilteco, Inc., dated December 09, 2002, last revision #1 dated December 09, 2002 signed and sealed Walter A. Tillit, Jr., P.E.*

B. TESTS

1. *See Association's generic approval under 03-0112.*

C. CALCULATIONS

1. *See Association's generic approval under 03-0112.*

D. MATERIAL CERTIFICATIONS

1. *See Association's generic approval under 03-0112.*

E. STATEMENTS

1. *Letter issued by Mr. Walter A. Tillit, Jr., P.E., dated December 16, 2002, indicating that the only change is update General Note numbers 1 & 11 to reference the Florida Building Code and ASCE 7-98.*

4. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL #05-0810.01

A. DRAWINGS


1. *Drawing No. 05-223, titled "Bertha HV Accordion Shutter System", sheets 1 through 14 of 14, prepared by Tilteco, Inc., dated July 29, 2005, last revision #1 dated July 29, 2005, signed and sealed by Walter A. Tillit Jr., P.E.*

B. TESTS

1. *See Association's generic approval under 05-0227.*

C. CALCULATIONS

1. *See Association's generic approval under 05-0227.*



Helmy A. Makar, P.E., M.S.
Product Control Section Supervisor
NOA No. 26-0428.01
Expiration Date: 07/07/2031
Approval Date: 06/04/2026

Red Oaks Shutter, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

D. QUALITY ASSURANCE

1. *By Miami-Dade Building Code Compliance Office.*

E. MATERIAL CERTIFICATIONS

1. *See Association's generic approval under 05-0227.*

F. STATEMENTS

1. *Release letter issued by the American Shutter Systems Association, Inc., dated July 29, 2005, certifying this product to meet the criteria of product tested and approved, and allowing Red Oaks Shutter, Inc., to use the test results approved under Dade County Approval No. 05-0227, signed by Mr. Legny Santana.*
2. *Acknowledgment letter by Red Oaks Shutter, Inc., dated July 07, 2005, signed by Mr. David Barbour.*
3. *Letter by Tilteco Inc., dated July 28, 2005, certifying that the drawing (No. 05-223) prepared for Red Oaks Shutter, Inc., signed and sealed by Mr. Walter A. Tillit, Jr., P.E., is engineering wise identical to ASSA's generic drawing (No. 05-072).*

5. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL #06-0711.04

A. DRAWINGS

1. *None.*

B. TESTS

1. *See Association's generic approval under 05-0227.*

C. CALCULATIONS

1. *See Association's generic approval under 05-0227.*

D. QUALITY ASSURANCE

1. *By Miami-Dade Building Code Compliance Office.*

E. MATERIAL CERTIFICATIONS

1. *See Association's generic approval under 05-0227.*


F. STATEMENTS

1. *Letter by Tilteco Inc., dated June 23, 2006, certifying that Tilteco, Inc. is still the engineer of record and continues to be in the engineering business.*

6. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 11-0317.02

A. DRAWINGS

1. *Drawing No. 11-021, titled " Bertha HV Accordion Shutter System ", sheets 1 through 28 of 28, and Sheet 28A, prepared by Tilteco, Inc., dated March 02, 2011, last revision #1 dated March 02, 2011, signed and sealed by Walter A. Tillit Jr., P.E.*



Helmy A. Makar, P.E., M.S.
Product Control Section Supervisor
NOA No. 26-0428.01
Expiration Date: 07/07/2031
Approval Date: 06/04/2026

Red Oaks Shutter, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

B. TESTS

1. *See Association's generic approval under 10-1209.*

C. CALCULATIONS

1. *See Association's generic approval under 10-1209.*

D. MATERIAL CERTIFICATIONS

1. *See Association's generic approval under 10-1209.*

E. STATEMENTS

1. *Release letter issued by the American Shutter Systems Association, Inc., dated March 01, 2011, certifying this product to meet the criteria of product tested and approved, and allowing Red Oaks Shutter, Inc., to use the test results approved under Dade County Approval No. 10-1209, signed by Ms. Legny Rodriguez.*
2. *Acknowledgment letter by Red Oaks Shutter, Inc., dated April 01, 2011, signed by Mr. David Barbour.*
3. *Letter by Tilteco Inc., dated March 17, 2011, certifying that the drawing (No. 11-021) prepared for Red Oaks Shutter, Inc., signed and sealed by Mr. Walter A. Tillit, Jr., P.E., is engineering wise identical to ASSA's generic drawing (No. 10-099).*

7. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 12-0308.44

A. DRAWINGS

1. *Drawing No. 12-014, titled " Bertha HV Accordion Shutter System ", sheets 1 through 28 of 28, and Sheet 28A, prepared by Tilteco, Inc., dated January 18, 2012, last revision #1 dated January 18, 2012, signed and sealed by Walter A. Tillit Jr., P.E.*

B. TESTS

1. *See Association's generic approval under 11-1676.*

C. CALCULATIONS


1. *See Association's generic approval under 11-1676.*

D. MATERIAL CERTIFICATIONS

1. *See Association's generic approval under 11-1676.*

E. STATEMENTS

1. *Release letter issued by the American Shutter Systems Association, Inc., dated January 31, 2012, certifying this product to meet the criteria of product tested and approved, and allowing Red Oaks Shutter, Inc., to use the test results approved under Miami-Dade County Approval No. 11-1676, signed by Ms. Legny Rodriguez.*



Helmy A. Makar, P.E., M.S.
Product Control Section Supervisor
NOA No. 26-0428.01
Expiration Date: 07/07/2031
Approval Date: 06/04/2026

Red Oaks Shutter, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

2. *Acknowledgment letter by Red Oaks Shutter, Inc., dated June 05, 2012, signed by Mr. David Barbour.*
3. *Letter by Tilteco Inc., dated January 30, 2012, certifying that the drawing (No. 12-014) prepared for Red Oaks Shutter, Inc., signed and sealed by Mr. Walter A. Tillit, Jr., P.E., is engineering wise identical to ASSA's generic drawing (No. 11-111).*

8. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 15-0921.01

A. DRAWINGS

1. *Drawing No. 15-254, titled " Bertha HV Accordion Shutter System ", sheets 1 through 28 of 28, and Sheet 15A & 28A, prepared by Tilteco, Inc., dated August 14, 2015, last revision #1 dated August 14, 2015, signed and sealed by Walter A. Tillit Jr., P.E.*

B. TESTS

1. *See Association's generic approval under 15-0803.*

C. CALCULATIONS

1. *See Association's generic approval under 15-0803.*

D. MATERIAL CERTIFICATIONS

1. *See Association's generic approval under 15-0803.*

E. STATEMENTS

1. *Release letter issued by the American Shutter Systems Association, Inc., dated August 24, 2015, certifying this product to meet the criteria of product tested and approved, and allowing Red Oaks Shutter, Inc., to use the test results approved under Miami-Dade County Approval No. 15-0803, signed by Ms. Legny Rodriguez.*
2. *Acknowledgment letter by Red Oaks Shutter, Inc., dated August 14, 2015, signed by Mr. David Barbour.*
3. *Letter by Tilteco Inc., dated August 13, 2015, certifying that the drawing (No. 15-254) prepared for Red Oaks Shutter, Inc., signed and sealed by Mr. Walter A. Tillit, Jr., P.E., is engineering wise identical to ASSA's generic drawing (No. 15-147).*


9. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 17-0829.11

A. DRAWINGS

1. *Drawing No. 17-219, titled " Bertha HV Accordion Shutter System ", sheets 1 through 28 of 28, and Sheet 15A & 28A, prepared by Tilteco, Inc., dated August 14, 2017, signed and sealed by Walter A. Tillit Jr., P.E., on August 23, 2017.*

B. TESTS

1. *See Association's generic approval under 18-0097.*



Helmy A. Makar, P.E., M.S.
Product Control Section Supervisor
NOA No. 26-0428.01
Expiration Date: 07/07/2031
Approval Date: 06/04/2026

Red Oaks Shutter, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

C. CALCULATIONS

1. *See Association's generic approval under 18-0097.*

D. MATERIAL CERTIFICATIONS

1. *See Association's generic approval under 18-0097.*

E. STATEMENTS

1. *Release letter issued by the American Shutter Systems Association, Inc., dated August 10, 2017, certifying this product to meet the criteria of product tested and approved, and allowing Red Oaks Shutter, Inc., to use the test results approved under Miami-Dade County Approval No. 18-0097, signed by Ms. Monica Rodriguez.*
2. *Acknowledgment letter by Red Oaks Shutter, Inc., dated August 10, 2017, signed by Mr. David Barbour.*
3. *Letter by Tilteco Inc., dated August 14, 2017, certifying that the drawing (No. 17-219) prepared for Red Oaks Shutter, Inc., signed and sealed by Mr. Walter A. Tillit, Jr., P.E., is in compliance with the FBC, 2017 Edition.*

10. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 20-0811.10

A. DRAWINGS

1. *Drawing No. 20-189, titled " Bertha HV Accordion Shutter System ", sheets 1 through 28 of 28, and Sheet 15A & 28A, prepared by Tilteco, Inc., dated July 10, 2020, signed and sealed by Walter A. Tillit Jr., P.E., on July 17, 2020.*

B. TESTS

1. *See Association's generic approval under 20-0978.*

C. CALCULATIONS


1. *See Association's generic approval under 20-0978.*

D. MATERIAL CERTIFICATIONS

1. *See Association's generic approval under 20-0978.*

E. STATEMENTS

1. *Release letter issued by the American Shutter Systems Association, Inc., dated June 29, 2020, certifying this product to meet the criteria of product tested and approved, and allowing Red Oaks Shutter, Inc., to use the test results approved under Miami-Dade County Approval No. 20-0978, signed by Ms. Monica Rodriguez.*
2. *Acknowledgment letter by Red Oaks Shutter, Inc., dated June 29, 2020, signed by Mr. David Barbour.*
3. *Letter by Tilteco Inc., dated July 18, 2020, certifying that the drawing (No. 20-189) prepared for Red Oaks Shutter, Inc., signed and sealed by Mr. Walter A. Tillit, Jr., P.E., is in compliance with the FBC, 2017 Edition and 2020 Edition.*



Helmy A. Makar, P.E., M.S.
Product Control Section Supervisor
NOA No. 26-0428.01
Expiration Date: 07/07/2031
Approval Date: 06/04/2026

Red Oaks Shutter, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

11. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 21-0504.04

A. DRAWINGS

1. *None.*

B. TESTS

1. *See Association's generic approval under 20-0978.*

C. CALCULATIONS

1. *See Association's generic approval under 20-0978.*

D. MATERIAL CERTIFICATIONS

1. *See Association's generic approval under 20-0978.*

E. STATEMENTS

1. *Release letter issued by the American Shutter Systems Association, Inc., dated June 29, 2020, certifying this product to meet the criteria of product tested and approved, and allowing Red Oaks Shutter, Inc., to use the test results approved under Miami-Dade County Approval No. 20-0978, signed by Ms. Monica Rodriguez.*
2. *Acknowledgment letter by Red Oaks Shutter, dated 04/02/21, signed by Mr. David Barbour.*
3. *Letter by Tilteco Inc., dated April 15, 2021, certifying that the drawing (No. 20-189) prepared for Red Oaks Shutter, Inc., signed and sealed by Mr. Walter A. Tillit, Jr., P.E., is in compliance with the FBC, 2020 Edition.*

12. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 23-0707.05

A. DRAWINGS

1. *Drawing No. 23-118, titled "Bertha HV Accordion Shutter System", sheets 1 through 28 of 28, and Sheet 15A & 28A, prepared by Tilteco, Inc., dated July 21, 2023, signed and sealed by Walter A. Tillit Jr., P.E., on July 21, 2023.*

B. TESTS

1. *See Association's generic approval under 23-1004.*

C. CALCULATIONS


1. *See Association's generic approval under 23-1004.*

D. MATERIAL CERTIFICATIONS

1. *See Association's generic approval under 23-1004.*

E. STATEMENTS

1. *Acknowledgment letter by Red Oaks Shutter, dated 06/20/23, signed by Mr. David Barbour.*
3. *Letter by Tilteco Inc., dated July 21, 2023, certifying that the drawing (No. 23-118) prepared for Red Oaks Shutter, Inc., signed and sealed by Mr. Walter A. Tillit, Jr., P.E., is in compliance with the FBC, 2023 Edition.*



Helmy A. Makar, P.E., M.S.
Product Control Section Supervisor
NOA No. 26-0428.01
Expiration Date: 07/07/2031
Approval Date: 06/04/2026

Red Oaks Shutter, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

13. NEW EVIDENCE SUBMITTED

A. DRAWINGS

1. Drawing No. 23-118, titled “ Bertha HV Accordion Shutter System ”, sheets 1 through 28 of 28, and Sheet 15A & 28A, prepared by Tilteco, Inc., dated July 21, 2023, signed and sealed by Walter A. Tillit Jr., P.E., on April 27, 2026.

B. TESTS

1. *See Association’s generic approval under 23-1004.*

C. CALCULATIONS


1. *See Association’s generic approval under 23-1004.*

D. MATERIAL CERTIFICATIONS

1. *See Association’s generic approval under 23-1004.*

E. STATEMENTS

1. Acknowledgment letter by Red Oaks Shutter, dated 04/22/26, signed by Mr. David Barbour.
3. *Letter by Tilteco Inc., dated April 27, 2026, certifying that the drawing (No. 23-118) prepared for Red Oaks Shutter, Inc., signed and sealed by Mr. Walter A. Tillit, Jr., P.E., is in compliance with the FBC, 2023 Edition.*



Helmy A. Makar, P.E., M.S.
Product Control Section Supervisor
NOA No. 26-0428.01
Expiration Date: 07/07/2031
Approval Date: 06/04/2026

The following pages in this document were submitted by the manufacturer (third party) to represent the product being approved and establish the limits of use. The pages may include technical drawings, schematics and installation details.

GENERAL NOTES:

1. BERTHA H.V. ACCORDION SHUTTER SYSTEM SHOWN ON THIS **PRODUCT APPROVAL DOCUMENT (P.A.D.)** HAS BEEN VERIFIED FOR COMPLIANCE IN ACCORDANCE WITH THE **2020 (7th EDITION) & 2023 (8th EDITION)** OF THE FLORIDA BUILDING CODE. THIS ACCORDION SHUTTER SYSTEM MAY BE INSTALLED AT HIGH VELOCITY HURRICANE ZONES. DESIGN WIND LOADS SHALL BE DETERMINED AS PER SECTION **1620** OF THE ABOVE MENTIONED CODE, USING **ASCE 7-16 (FBC 2020) & ASCE 7-22 (FBC 2023)** AND SHALL NOT EXCEED THE MAXIMUM (A.S.D) DESIGN PRESSURE RATINGS INDICATED ON SHEETS 12 THRU 17 & 25, 26, 28 & 28A. IN ORDER TO VERIFY THE ABOVE CONDITION, ULTIMATE DESIGN WIND LOADS DETERMINED PER **ASCE 7-16 & ASCE 7-22** SHALL BE FIRST REDUCED TO A.S.D. DESIGN WIND LOADS BY MULTIPLYING THEM BY 0.6 IN ORDER TO COMPARE THESE W/ MAX. (A.S.D) DESIGN PRESSURE RATINGS INDICATED ON SHEETS 12 THRU 17 & 25, 26, 28 & 28A. IN ORDER TO VERIFY THAT ANCHORS ON THIS P.A.D., AS TESTED, WERE NOT OVER STRESSED, A 33% INCREASE IN ALLOWABLE STRESS FOR WIND LOADS WAS **NOT** USED IN THEIR ANALYSIS. BERTHA H.V. ACCORDION SHUTTER SYSTEM'S ADEQUACY FOR WIND AND LARGE MISSILE IMPACT LOAD HAS BEEN VERIFIED IN ACCORDANCE WITH SECTION **1626** OF THE ABOVE MENTIONED CODES AS PER ATL REPORTS:
- HV BLADE **①** #0214.01-03, #0715.01-03, #1004.01-05, #1214.01-05 #0317.02-06 AND #0609.01-10 AS PER TAS 201, TAS 202 AND TAS 203 PROTOCOLS.
- HV WINDOW BLADE **①A** #0505.01-08 AS PER TAS 201, 202 & 203 PROTOCOLS AND 0725.01-08 AS PER TAS 202 PROTOCOL.
- HV BLADE **②** #0422.01-05 AS PER TAS 201, TAS 202 AND TAS 203 PROTOCOLS.
2. HV BLADE **①** AND HV BLADE **②** ARE ENGINEERED TO WORK IN UNISON WITH EACH OTHER IN AREAS WHERE THE DESIGN PRESSURES TRANSITION FROM END ZONE 5 TO INTERIOR ZONE 4. EACH WIND ZONE MUST BE CLEARLY IDENTIFIED IN ACCORDANCE WITH **ASCE 7-16 & ASCE 7-22** ALL MOUNTING CONDITIONS AND FASTENER TYPES SCHEDULES MUST BE APPLIED TO THE CORRESPONDING WIND ZONE. THIS SHALL INCLUDE REQUIREMENTS FOR MIN. SEPARATION TO GLASS. DELIMITATION OF WIND ZONES 4 AND 5 AS WELL AS VALIDITY OF COMPONENTS FOR HV BLADE **①** & **②** ACCORDION SHUTTERS SYSTEMS FOR EITHER WIND ZONE SHALL BE PREPARED AND CERTIFIED BY A FLORIDA REGISTERED ENGINEER OR ARCHITECT BASED ON BUILDING CONFIGURATION AND **ASCE 7** STANDARD, AND SHALL BE SUBMITTED TO THE BUILDING OFFICIAL AT THE TIME PERMIT IS APPLIED FOR.
- HV BLADE **①** AND HV WINDOW BLADE **①A** ARE ALSO ENGINEERED TO WORK IN UNISON WITH EACH OTHER UNDER THE GENERAL LIMITATIONS AND CONDITIONS OF USE INDICATED ON SHEET 28.
3. BERTHA H.V. ACCORDION PINS (HV SCREWS), USED AT BLADES KNUCKLE AND FOR DIRECT MOUNT CONNECTION TO TRACKS SHALL BE # 14X2.75 AND # 14X1.75 RESPECTIVELY, 410-HT MINIMUM SERIES STAINLESS STEEL SCREWS WITH 135.0 ksi YIELD STRENGTH AND 180 ksi TENSILE STRENGTH. PINS SHALL BE COATED WITH BERTHA HV DACROSHIELD COATING SYSTEM AS MANUFACTURED BY APPROVED COATING APPLICATORS, REGISTERED WITH AMERICAN SHUTTER SYSTEMS ASSOCIATION. PINS MUST BEAR THE HV MARKING ON THEIR HEAD.
4. ALL ALUMINUM EXTRUSIONS SHALL BE ALUMINUM ASSOCIATION ALLOY AND TEMPER AS INDICATED ON SHEETS 2 AND 3. MINIMUM YIELD STRENGTH FOR 6063-T6 ALLOY IS 31.7 ksi AND 35.7 ksi FOR 6005-T5 ALLOY. ALL ALUMINUM EXTRUSIONS IN CONTACT WITH DISSIMILAR MATERIALS SHALL COMPLY WITH SECTION III-6 OF THE 2015 AND 2020 ALUMINUM DESIGN MANUAL.
5. ALL SCREWS TO BE STAINLESS STEEL 304 OR 316 AISI SERIES OR CORROSION RESISTANT COATED CARBON STEEL AS PER DIN 50018 WITH 50 ksi MIN. YIELD STRENGTH AND 90 ksi MIN. TENSILE STRENGTH AND TO COMPLY W/ FBC SECTION 2411.3.3.4.
6. BOLTS TO BE ASTM A-307 GALVANIZED STEEL, OR AISI 304 OR 316 SERIES STAINLESS STEEL WITH 35 ksi MINIMUM YIELD STRENGTH.
7. SEE THE FOLLOWING SHEETS FOR ANCHOR SPECIFICATIONS: HV BLADE **①** : 13, 14, 15, 15A, 16, 17 AND 28A.
HV BLADE **②** : 26.
HV BLADE **①** & **①A** WORKING IN UNISON: 13, 14 & 16.
8. THIS BERTHA H.V. ACCORDION SHUTTER SYSTEM BEARS A U.S. PATENT #6'779,582. COMPONENTS OF THIS APPROVAL ARE COVERED, IN WHOLE OR IN PART BY U.S. PATENT #5'458,179 ISSUED TO EASTERN METAL SUPPLY, INC.
9. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO VERIFY THE SOUNDNESS OF THE STRUCTURE WHERE SHUTTER IS TO BE ATTACHED TO INSURE PROPER ANCHORAGE. CONTRACTOR TO SEAL/CAULK ALL SHUTTER COMPONENT EDGES WHICH REMAIN, THRU FASTENING IN CONTINUOUS CONTACT WITH THE BUILDING TO PREVENT WIND/RAIN INTRUSION.
10. EACH UNIT MUST BEAR PERMANENT LABEL IN A VISIBLE PLACE WITH WARNING NOTE: DURING PERIODS OF HURRICANE WARNINGS HOME OWNER, TENANT, OR OTHERS, MUST PROPERLY CLOSE ALL HV AND HD CENTERMATES AND ENGAGE OR LOCK ALL HV AND HD LOCKS.
11. A PERMANENT SHUTTER MANUFACTURER'S LABEL SHALL BE PLACED ON THE EXPOSED SURFACE OF THE SIDE RAIL APPROXIMATELY 4" BELOW THE TOP OF SUCH RAIL LABEL SHALL COMPLY WITH SECTION 1709.9.2 OF THE FLORIDA BUILDING CODE.
12. BERTHA H.V. ACCORDION SHUTTER SYSTEM'S INSTALLATION SHALL COMPLY WITH SPECS INDICATED IN THIS DRAWING PLUS ANY BUILDING AND ZONING REGULATIONS PROVIDED BY THE JURISDICTION WHERE PERMIT IS APPLIED TO.
13. (a) THIS **P.A.D.** PREPARED BY THIS ENGINEER IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT; i.e. WHERE THE SITE CONDITIONS DEVIATE FROM THE
- (b) CONTRACTOR TO BE RESPONSIBLE FOR THE SELECTION, PURCHASE AND INSTALLATION INCLUDING LIFE SAFETY OF THIS PRODUCT, BASED ON THIS FROM THE CONDITIONS DETAILED ON THIS DOCUMENT. CONSTRUCTION SAFETY AT SITE IS THE CONTRACTOR'S RESPONSIBILITY.
- (c) THIS **P.A.D.** WILL BE CONSIDERED INVALID IF ALTERED BY ANY MEANS.
- (d) SITE SPECIFIC PROJECTS SHALL BE PREPARED BY A FLORIDA REGISTERED ENGINEER OR ARCHITECT WHICH WILL BECOME THE ENGINEER OF RECORD (E.O.R.) FOR THE PROJECT AND WHO WILL BE RESPONSIBLE FOR THE PROPER USE OF THE DRAWINGS FOR REVIEW.
- (e) ORIGINAL **P.A.D.** SHALL BEAR THE DATE AND ORIGINAL SEAL AND SIGNATURE OF THE PROFESSIONAL ENGINEER OF RECORD THAT PREPARED IT. **P.A.D. ENGINEER OF RECORD, ACTING AS A DELEGATED ENGINEER TO THE P.A.D. ENGINEER SHALL SUBMIT TO THIS LATTER THE SITE SPECIFIC**

TABLE OF CONTENTS

AREA 1: HV BLADES **①**, **①A** & **②**

GENERAL NOTES		SHEET 1
SYSTEM COMPONENTS	1-20	SHEET 2
SYSTEM COMPONENTS	21-37	SHEET 3
TYPICAL SHUTTER ASSEMBLY	38-43	SHEET 4

AREA 2: HV BLADE **①** AND HV WINDOW BLADE **①A** (WHERE APPLICABLE)

TYPICAL SHUTTER ELEVATION & NOTES ON LOCKS	SHEET 5
INSTALLATION DETAILS A-E, CONCRETE/BLOCK	SHEET 6
INSTALLATION DETAILS F-L, CONCRETE/BLOCK	SHEET 7
CENTERMATE DETAILS HV	SHEET 8
CENTERMATE ALTERNATING DETAILS HV	SHEET 9
CENTERMATE DETAILS HD	SHEET 10
END CONNECTION DETAILS 1-6, CONCRETE/BLOCK	SHEET 11
MAXIMUM SPAN TABLES	SHEET 12
ANCHOR SCHEDULE- CONCRETE	SHEET 13
ANCHOR SCHEDULE- CONCRETE	SHEET 14
ANCHOR SCHEDULE- CONCRETE	SHEET 15
ANCHOR SCHEDULE- CONCRETE BLOCK	SHEET 15A
ANCHOR SCHEDULE- WOOD	SHEET 16
ANCHOR SCHEDULE- WOOD	SHEET 17
INSTALLATION DETAILS M-R, WOOD	SHEET 18
INSTALLATION DETAILS S-X, WOOD	SHEET 19
END CONNECTION DETAILS 7-12 & X, WOOD	SHEET 20

AREA 3: HV BLADE **②** ONLY

TYPICAL SHUTTER ELEVATION & NOTES ON LOCKS	SHEET 21
INSTALLATION DETAILS AA-GG, CONCRETE	SHEET 22
CENTERMATE DETAILS HD	SHEET 23
END CONNECTION DETAILS 1-6 & X, CONCRETE/BLOCK	SHEET 24
MAXIMUM SPAN TABLES	SHEET 25
ANCHOR SCHEDULE, CONCRETE	SHEET 26

AREA 4: HV WINDOW BLADE **①A** ONLY

TYPICAL WINDOW BLADE & WINDOW DETAIL	SHEET 27
TYPICAL SHUTTER ELEVATION	SHEET 28

AREA 5: HV WINDOW BLADE **①** ONLY

INSTALLATION DETAILS, METAL STUD WALLS	SHEET 28A
--	-----------

THIS DRAWING SHALL ONLY BE USED TO OBTAIN PERMITS IN THE STATE OF FLORIDA


FLORIDA BUILDING CODE (High Velocity Hurricane Zone)

© 2020 EASTERN METAL SUPPLY, INC.

BERTHA HV™ Accordion Shutter System				
H.V. BLADE #1 W/ OR W/O H.V. WINDOW BLADE & H.V. BLADE #2				
REV.No	DESCRIPTION	DATE	DRAWN BY:	Y.M.
1	OLD 20-189	7/21/23	DATE:	7/21/2023
2			DRAWING No 23-118	
3				
4				
5				
6			SHEET 1 OF 28	

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. **26-0428.01**
Expiration Date **07/07/31**
By **[Signature]**
Miami Dade Product Control

MIAMI-DADE COUNTY

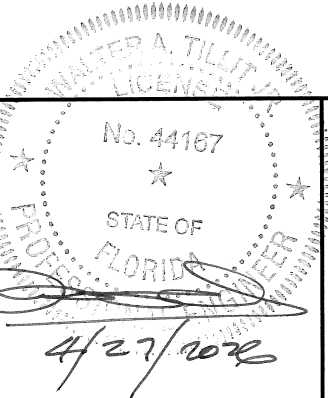

P.E. SEAL/SIGNATURE/DATE

©2023 TILTECO, INC


TILTECO INC.

TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FLORIDA 33166
Phone : (305)871-1530 . Fax : (305)871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr. P.E.
FLORIDA Lic. # 44167

**RED OAKS
SHUTTER, INC**

(ASSA # 15)

221 S.W. 5th COURT
POMPANO BEACH, FL 33060
Phone: (954)782-9325

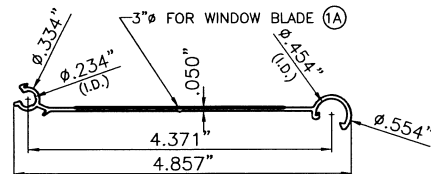


1 HV SOLID BLADE

COVERED UNDER US PATENT # 5458179


1A HV WINDOW BLADE*

*SEE LIMITATIONS OF USE OF BLADE 1A ON SHEET 28
6063-T6 ALLOY AND TEMPER

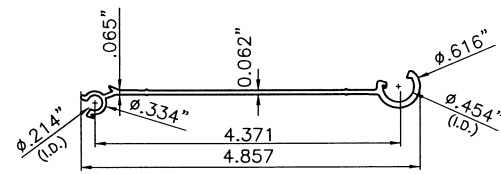


2 HV BLADE

COVERED UNDER US PATENT # 5458179
6005-T5 ALLOY AND TEMPER

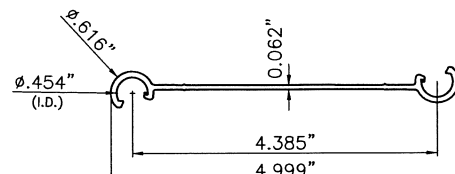


3 HV UNIVERSAL FLOATER

QUALIFIED FOR USE W/ HV BLADE 1 & 2
6005-T5 ALLOY AND TEMPER




4 HV DIRECT MOUNT

QUALIFIED FOR USE W/ HV
BLADE 1, 1A & 2
6063-T6 ALLOY AND TEMPER

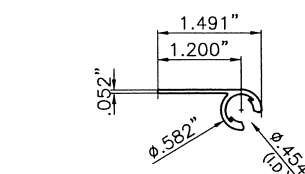


5 HV 90°/180° STARTER

QUALIFIED FOR USE W/ HV
BLADE 1, 1A & 2
6063-T6 ALLOY AND TEMPER

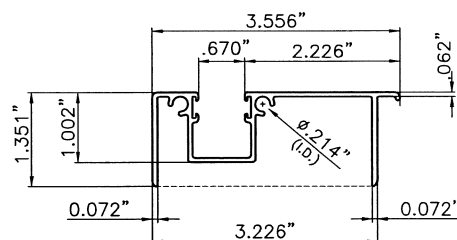


6 HV ADJ. FLOOR TRACK

QUALIFIED FOR USE W/ HV
BLADE 1, 1A & 2
6063-T6 ALLOY AND TEMPER

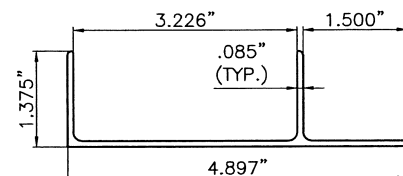


7 HV ADJ. ADAPTER W/LIP

QUALIFIED FOR USE W/ HV
BLADE 1, 1A & 2
6063-T6 ALLOY AND TEMPER

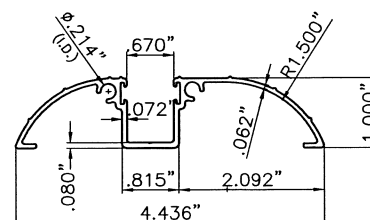


8 HV WALK-OVER TRACK

QUALIFIED FOR USE W/ HV BLADE 1 & 2
6063-T6 ALLOY AND TEMPER




9 HV TRENCH TRACK

QUALIFIED FOR USE W/ HV
BLADE 2 ONLY.
6063-T6 ALLOY AND TEMPER

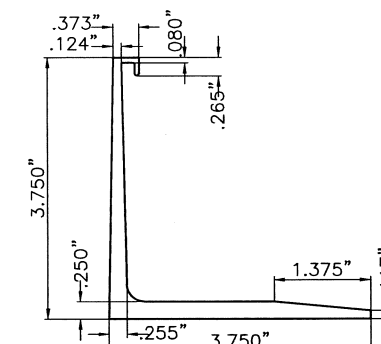


10 HV RAINGUARD

QUALIFIED FOR USE W/ HV
BLADE 1 & 2.
6063-T6 ALLOY AND TEMPER

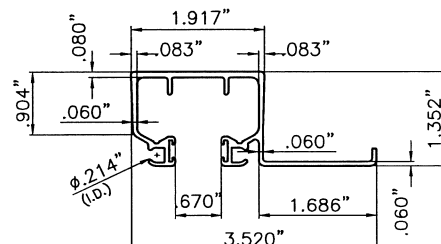


11 HV CEILING HEADER

QUALIFIED FOR USE W/ HV
BLADE 1 & 1A
SEE SECTIONS FOR VALIDITY
6063-T6 ALLOY AND TEMPER

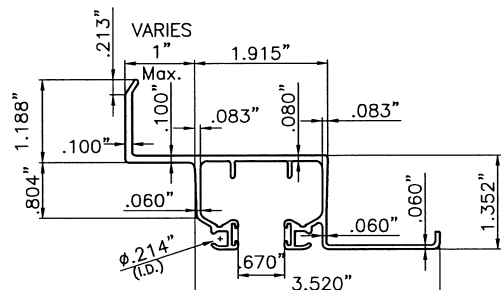


12 HV HEADER/SILL

QUALIFIED FOR USE W/ HV
BLADE 1 & 1A
SEE SECTIONS FOR VALIDITY
6063-T6 ALLOY AND TEMPER

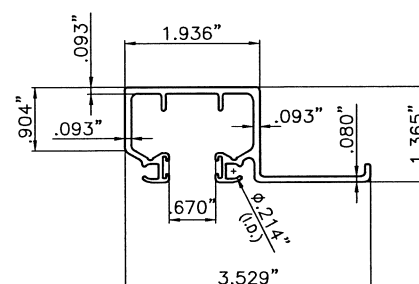


13 HD CEILING HEADER/SILL

QUALIFIED FOR USE W/ HV
BLADE 1 & 1A
SEE SECTIONS FOR VALIDITY
6063-T6 ALLOY AND TEMPER

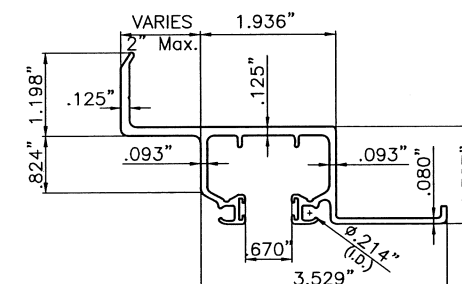


14 HD WALL HEADER/SILL

QUALIFIED FOR USE W/ HV
BLADE 1 & 1A
SEE SECTIONS FOR VALIDITY
6063-T6 ALLOY AND TEMPER

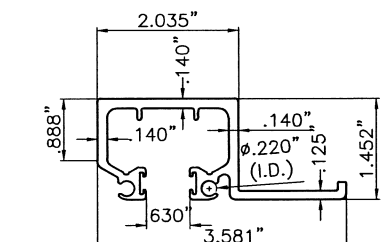


15 SHD CEILING HEADER/SILL

QUALIFIED FOR USE W/ HV
BLADE 1, 1A & 2
6063-T6 ALLOY AND TEMPER

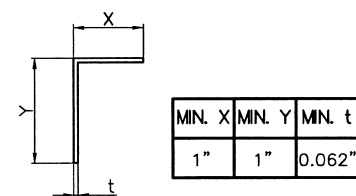

16 SIDE ANGLES


QUALIFIED FOR USE W/ HV
BLADE 1, 1A & 2
6063-T6 ALLOY AND TEMPER

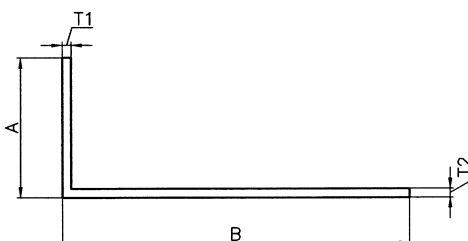

ALUMINUM ANGLES

QUALIFIED FOR USE W/ HV
BLADE (SEE SCHEDULE)
6063-T6 ALLOY AND TEMPER

COMPONENT	A	B	T1	T2	BLADE QUALIFIED
17	2"	5" MAX.	1/8"	1/8"	HV 1
18	2"	5" MAX.	0.192"	0.192"	HV 2
19	2.5"	7" MAX.	0.190"	0.190"	HV 1

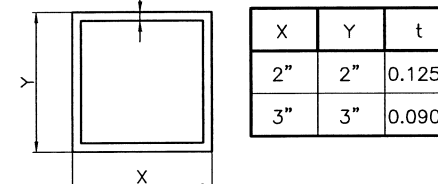

20 CORNER POSTS

QUALIFIED FOR USE W/ HV
BLADE 1, 1A & 2
6063-T6 ALLOY AND TEMPER

FLORIDA BUILDING CODE (High Velocity Hurricane Zone)

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 26-0428.01
Expiration Date 07/07/31
By: [Signature]
Miami Dade Product Control

MIAMI-DADE COUNTY

No. 44167
STATE OF
FLORIDA
WALTER A. TILLIT JR.
P.E.
4/27/2026

P.E. SEAL/SIGNATURE/DATE

©2023 TILTECO, INC



TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FLORIDA 33166
Phone : (305)871-1530 . Fax : (305)871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr. P.E.
FLORIDA Lic. # 44167

**RED OAKS
SHUTTER, INC**

(ASSA # 15)

221 S.W. 5th COURT
POMPANO BEACH, FL 33060
Phone: (954)782-9325

© 2020 EASTERN METAL SUPPLY, INC.

BERTHA HV™ Accordion Shutter System				
H.V. BLADE #1 W/ OR W/O H.V. WINDOW BLADE & H.V. BLADE #2				
REV.No	DESCRIPTION	DATE	DRAWN BY:	Y.M.
1	OLD 20-189	7/21/23	DATE:	7/21/2023
2				
3				
4				
5				
6				
DRAWING No				23-118
SHEET				2 OF 28



22 HV FLOATING CENTERMATE

②③ HV CORNER CENTERMATE

②④ HV LOCK

25 HV EGRESS LOCK

(27) LOCKER FOR "T" LOCK CENTERMATE

28 HV MALE "T" LOCK CENTERMATE

29 HV FEMALE "T" LOCK CENTERMATE

30 HV "T" LOCK

1/4" $\varnothing$ -20 x 3/4"
S.S. THUMBSCREW

Diagram illustrating the dimensions of a riveted joint before and after riveting:

- BEFORE RIVETING:** The vertical plate has a width of $.360''$ and a height of $.758''$.
- AFTER RIVETING:** The vertical plate has a width of $.518''$ and a height of $.512''$.

1/4"Ø-20 RIVNUT*

26 HV ALTERNATIVE LOCK

31 HD CENTERMATE W/ NO LOCKING ROD

32) HD CENTERMATE W/ LOCKING ROD

33 HD CENTERMATE'S INSERT

③⑦ HV 1/4" Ø-20 AISI 304
SERIES S.S. THUMBSCREWS

③⑤ LOCKING ROD 

③⑥ HV 3/8"Ø-16 ACETAL
THUMBSCREWS

③④ HD LOCK

0.875" Min.
1.125" Max.

8.80"

1.57" Min.
1.78" Max.

5.97"

1.000"

THUMBTURN
CYLINDER
OR KEY
CYLINDER

BERTHA HV™ Accordion Shutter System

H.V. BLADE #1 W/ OR W/O H.V. WINDOW BLADE & H.V. BLADE #2

REV. NO	DESCRIPTION	DATE	DRAWN BY:	Y.M.
1	OLD 20-189	7/21/23	DATE:	7/21/2023
2			DRAWING No 23-118	
3				
4				
5				
6			SHEET 3 OF 28	

BERTHA HV™

Accordion Shutter System

#1 W/ OR W/O H.V. WINDOW BLADE & H.V. BLADE #2

DESCRIPTION	DATE	DRAWN BY:	Y.M.
OLD 20-189	7/21/23	DATE:	7/21/2023
		DRAWING No 23-118	
		SHEET 3 OF 28	

SHUTTER ASSEMBLY SCHEDULE FOR
HV ①, HV ①A AND HV ② BLADES.


①	HV BLADE 1
①A	HV BLADE 1A
②	HV BLADE 2
③8	HV LONG RECESSED NYLON BUSHING
③9	HV SHORT RECESSED NYLON BUSHING
④0	HV NYLON HAT WASHER
④1	HV WHEEL CARRIAGE AISI 302-303 SERIES ø.870"x3/16" THICK NYLON WHEEL. 0.188"ø AISI 302 SERIES S.S. RIVETS
④2	HV 1 3/4" ACCORDION PIN W/ #8 HEAD *
④3	HV 2 3/4" ACCORDION PIN W/ #8 HEAD *
④4	POLYCARBONATE IMPACT RESISTANT HV WINDOW (SEE SHEET 27)

* HV PIN REQUIREMENTS AT EXTERIOR BLADE KNUCKLE FOR
HV ①, HV ①A & HV ② BLADES.


(1) HV PIN ④3 SHALL ALWAYS BE USED AT ALL EXTERIOR
BOTTOM KNUCKLES OF HV ACCORDION SYSTEM W/ HV ① OR
HV ①A BLADE.

(2) HV PIN ④2 MAY BE USED IN LIEU OF ④3 AND ONLY AT
EXTERIOR BOTTOM KNUCKLES OF HV ACCORDION SYSTEM W/ HV ②
BLADE WHEN CORRESPONDING TO INSTALLATIONS "CC" AND "DD",
SHEET 22.

(3) HV PIN ④2 OR ④3 W/ 1/2" O.D. 1/16" THICK S.S. WASHER
SHALL BE USED FOR DIRECT MOUNT INSTALLATION PER DETAIL X,
SHEETS 11 & 24.

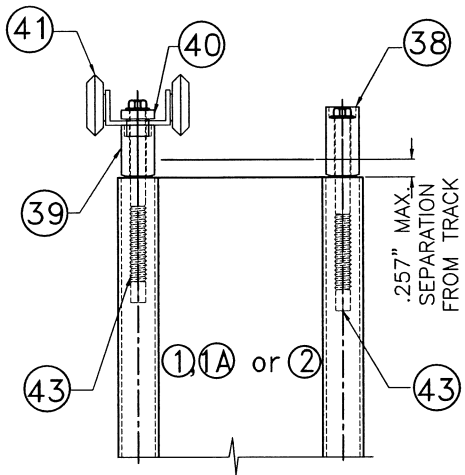


EXTERIOR

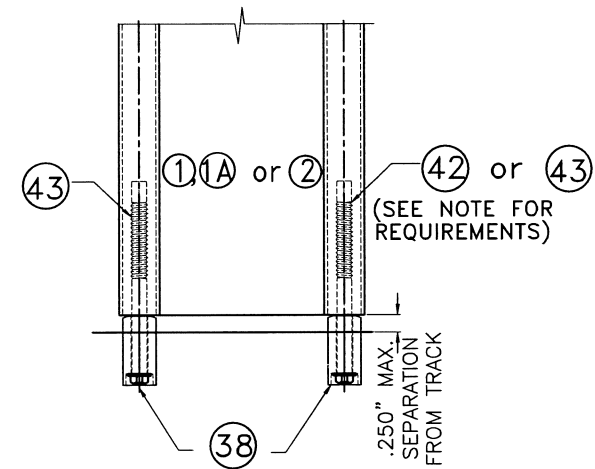


TYPICAL SHUTTER ASSEMBLY

SCALE: 3/8" = 1"



WHEEL CARRIAGE DETAIL

N.T.S.

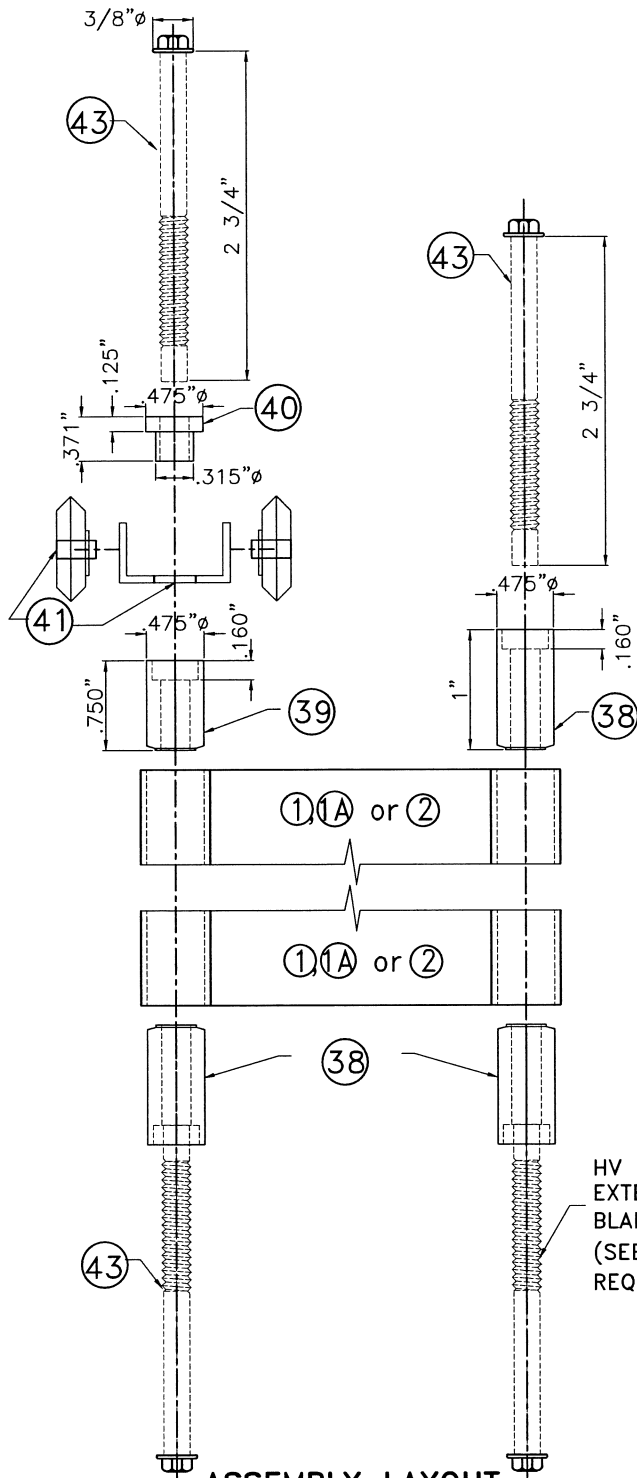

EXTERIOR

HV PIN ④2 OR ④3 AT
EXTERIOR
BLADE'S KNUCKLE.
(SEE NOTE * FOR
REQUIREMENTS)

ASSEMBLY LAYOUT

N.T.S.

FLORIDA BUILDING CODE (High Velocity Hurricane Zone)


© 2020 EASTERN METAL SUPPLY, INC.

BERTHA HV™ Accordion Shutter System				
H.V. BLADE #1 W/ OR W/O H.V. WINDOW BLADE & H.V. BLADE #2				
REV.No	DESCRIPTION	DATE	DRAWN BY:	Y.M.
1	OLD 20-189	7/21/23	DATE:	7/21/2023
2				
3				
4				
5				
6				
DRAWING No				23-118
SHEET				4 OF 28

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 26-0428.01
Expiration Date 07/07/31
By: *Walter A. Tillit Jr.*
Miami-Dade Product Control

MIAMI-DADE COUNTY

P.E. SEAL/SIGNATURE/DATE

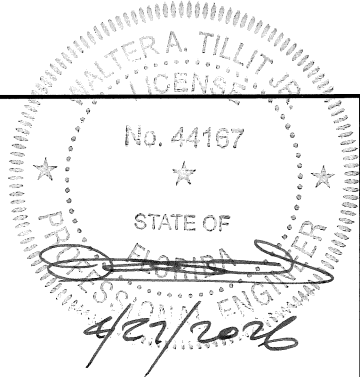

©2023 TILTECO, INC.


TILTECO INC.

TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FLORIDA 33166
Phone : (305)871-1530 . Fax : (305)871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr. P.E.
FLORIDA Lic. # 44167

**RED OAKS
SHUTTER, INC**

(ASSA # 15)

221 S.W. 5th COURT
POMPANO BEACH, FL 33060
Phone: (954)782-9325

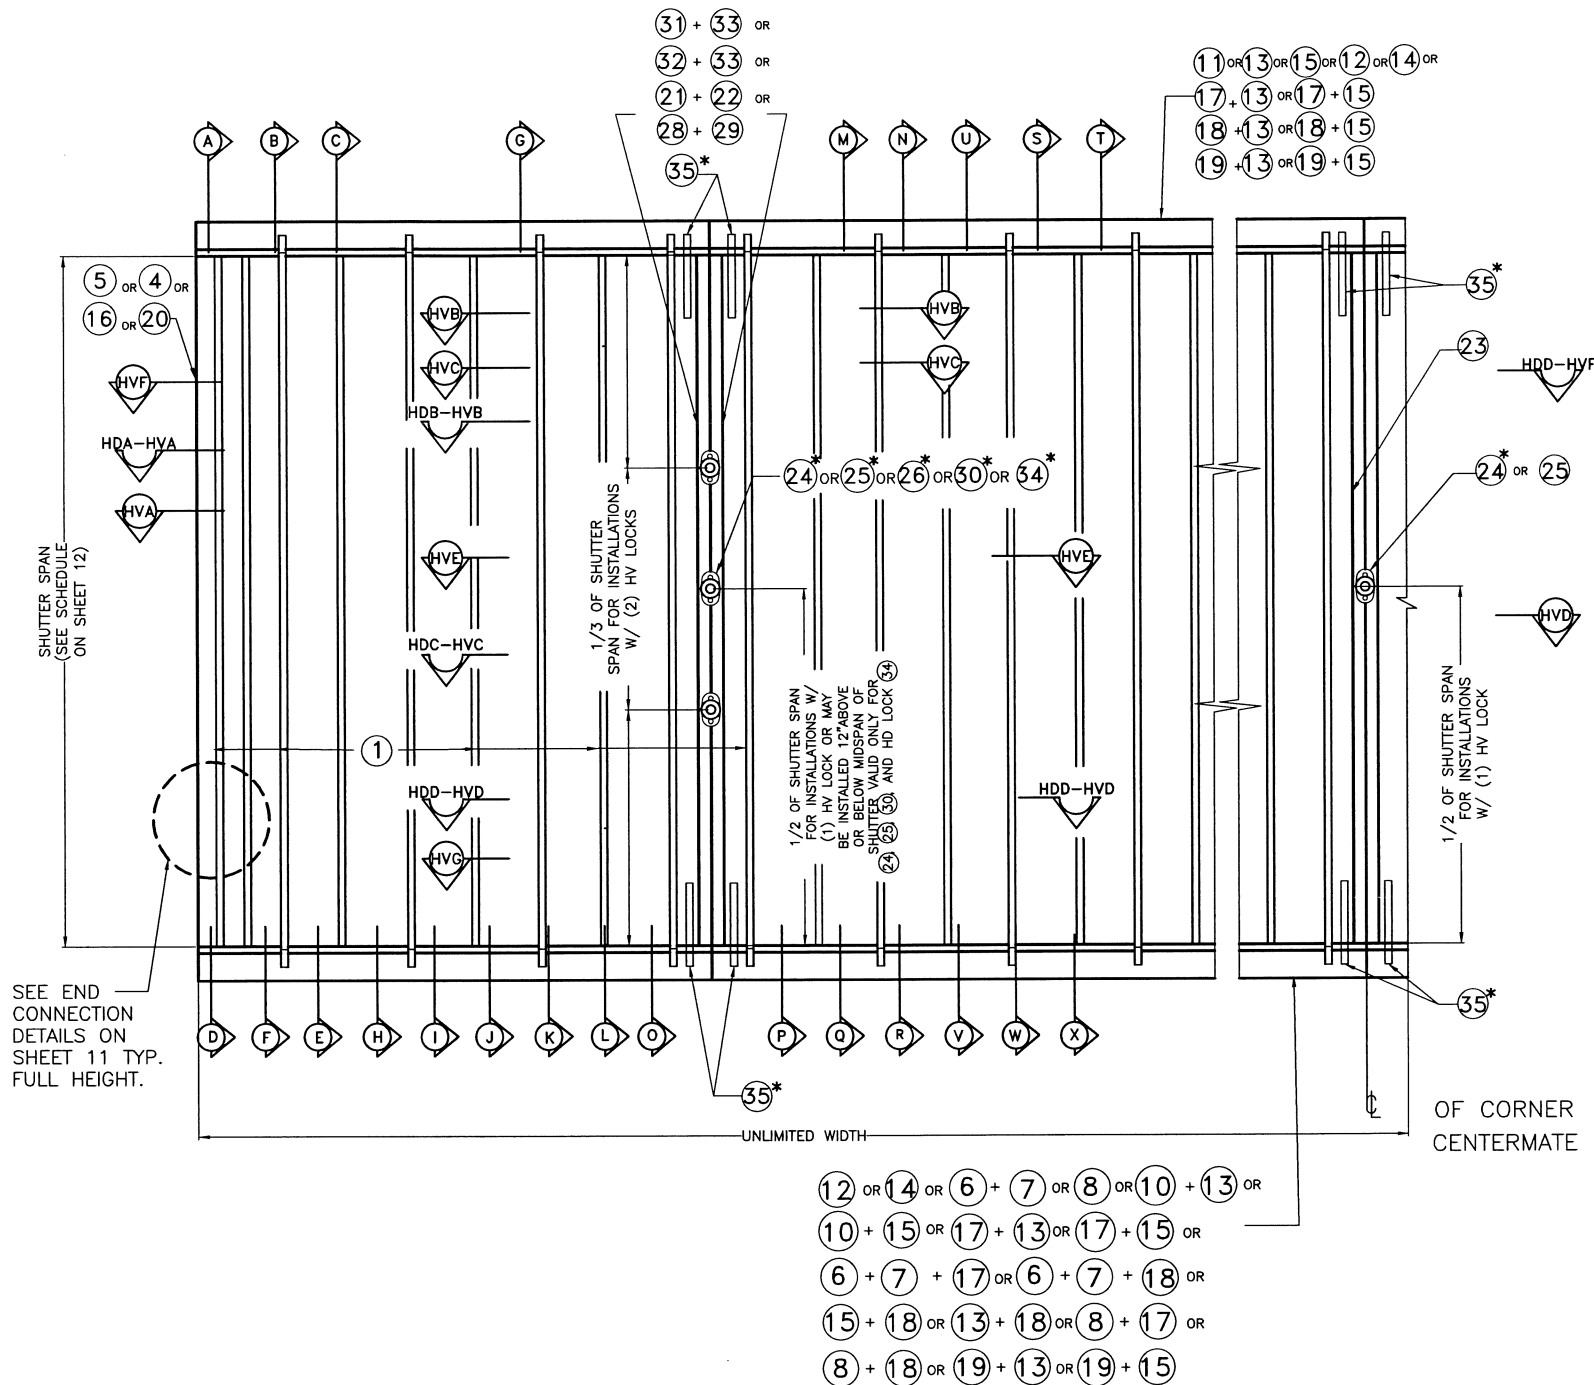

TYPICAL ① HV BLADE SHUTTER ELEVATION
N.T.S.

*** NOTES ON HV LOCKS AND CENTERMATES:**

- MANDATORY CONDITION #1:** ONE HV LOCK 24 or 25 SHALL BE USED AT 1/2 OF SHUTTER SPAN FOR ANY SPAN OR 12" ABOVE OR BELOW 1/2 OF SHUTTER SPAN FOR SPANS UP TO 105", AND FOR INSTALLATIONS AT ANY ELEVATION. HV LOCK 24 or 25 MAY BE USED AS AN INSIDE OR OUTSIDE LOCK, ATTACHED TO 21 OR 22 CENTERMATES W/(2) 1/4"Ø-20 x 1/2" LONG FLAT HEAD S.S. M.S. LOCATION OF LOCK SHALL BE AS INDICATED ON TYPICAL SHUTTER ELEVATION.
- LIMITED MANDATORY CONDITION #2 ALTERNATE TO MANDATORY CONDITION #1 (VALID ONLY FOR FLOOR/CEILING INSTALLATIONS):** TWO HV LOCKS 24 OR 25 OR ONE HV LOCK 24 OR 25 W/ TWO LOCKING RODS 35 AT TOP & BOTTOM SHALL BE USED FOR ANY SPAN AND INSTALLATION AT ANY ELEVATION. HV LOCK 24 OR 25 SHALL BE ATTACHED TO 21 OR 22 CENTERMATES W/ SAME SPECIFICATIONS AS PER MANDATORY CONDITION #1. LOCATION OF LOCK/LOCKS AS APPLICABLE SHALL BE AS INDICATED ON TYPICAL SHUTTER ELEVATION. MAXIMUM SHUTTER SPAN SHALL BE DETERMINED AS PER SCHEDULE #3 ON SHEET 12.
- OPTIONAL CONDITION #1:** IF DESIRED, FOR BETTER PERFORMANCE OR FOR SECURITY PURPOSES, UP TO TWO HV LOCKS 24, 25 OR 26 MAY BE USED AS AN INSIDE OR OUTSIDE LOCK. CONNECTION OF LOCKS TO CENTERMATES 21 OR 22 SHALL BE AS INDICATED ON NOTE (1) ABOVE. LOCATION OF LOCKS SHALL BE AS INDICATED ON TYPICAL SHUTTER ELEVATION.
- OPTIONAL CONDITION #2 (VALID ONLY WHEN MANDATORY CONDITION #1 OR LIMITED MANDATORY CONDITION #2 IS USED W/TWO H.V. LOCKS):** LOCKING RODS 35 ARE NOT REQUIRED AT HURRICANE POSITION, BUT MAY BE USED IF DESIRED TO ENHANCE SHUTTER PERFORMANCE. LOCKING RODS 35 OR AN ALTERNATIVE DEVICE MAY ALSO BE USED AT STACKING POSITION (NON HURRICANE POSITION).
- MANDATORY CONDITION #2:** ONE HV LOCK 24 or 25 SHALL BE USED AT CORNER CENTERMATES FOR ANY SPAN AND INSTALLATIONS AT ANY ELEVATION. HV LOCK 24 or 25 SHALL BE USED AS AN OUTSIDE OR INSIDE LOCK, ATTACHED TO 23 CORNER CENTERMATE W/(2) 1/4"Ø-20 x 1/2" LONG FLAT HEAD S.S. M.S. TWO LOCKING RODS 35 AT TOP & BOTTOM SHALL BE USED. LOCATION OF LOCK SHALL BE AS INDICATED ON TYPICAL SHUTTER ELEVATION. MAXIMUM SHUTTER SPAN SHALL BE DETERMINED AS PER SCHEDULES SHOWN ON SHEET 12.
- FIRST ALTERNATE TO MANDATORY CONDITION #1 VALID ONLY FOR HV LOCK 26 W/ SYMMETRICAL CENTERMATES 21 OR 22:** ONE ALTERNATE HV LOCK 26 MAY BE USED IN LIEU OF HV LOCK 24 or 25 FOR ANY SPAN AND INSTALLATIONS AT ANY ELEVATION. ALTERNATE LOCK 26 MAY BE USED AS AN INSIDE OR OUTSIDE LOCK. ATTACHMENT OF 1/4"Ø-20x3/4" S.S. THUMBSCREW TO 21 OR 22 CENTERMATES SHALL BE MADE W/ 1/4"Ø-20x3/4" ALUM. RIVNUT AS SHOWN ON SECTION HVE, SHEET 8. ONE LOCK SHALL BE USED AT 1/2 OF SHUTTER SPAN OR TWO LOCKS AT 1/3 OF SHUTTER SPAN.

***NOTES ON HV "T" LOCKS AND CENTERMATES:**

- SECOND ALTERNATE TO MANDATORY CONDITION #1 VALID ONLY FOR HV "T" LOCK 30 . AND CENTERMATES 28 AND 29:** ONE ALTERNATE HV "T" LOCK 30 MAY BE INSTALLED IN LIEU OF HV LOCKS 24 OR 25 FOR ANY SPAN AND INSTALLATION AT ANY ELEVATION. ALTERNATE LOCK 30 MAY BE USED AS AN INSIDE OR OUTSIDE LOCK. ATTACHMENT OF LOCK 30 INCLUDES USING REINFORCING LOCKER 27, AS SHOWN ON SECTION HVG, SHEET 9, WHICH MUST BE CONNECTED TO CENTERMATES 28 AND 29 W/ 1/4"Ø-20 x 1 1/2" LONG S.S. THREADED BOLT W/ 7/8"Ø x 3/32" WINGNUT OR W/ 1/4"Ø-20x1" S.S.M.S. INTO A 1/4"Øx 5/8" RIVNUT. LOCK MAY BE INSTALLED AT MIDSPAN OR 12" MAXIMUM ABOVE AND BELOW MIDSPAN. USE OF TWO LOCKING RODS 35 TOP AND BOTOM IS MANDATORY.

***NOTES ON HD LOCKS & CENTERMATES:**

- HD LOCK 34 W/ HD CENTERMATES 31 OR 32 W/ 33:** ONE ALTERNATE HD LOCK 34 MAYBE USED IN LIEU OF HV LOCKS 24 OR 25 FOR ANY SPAN AND INSTALLATIONS AT ANY ELEVATION. ALTERNATE HD LOCK 34 MAY BE USED AS AN INSIDE OR OUTSIDE LOCK. ATTACHMENT OF HD LOCK 34 TO 33 IS W/ 3 #8 x 3/8" F.H. S.S.M.S., AND INCLUDES REINFORCEMENT INSERT 33 AS SHOWN ON SECTIONS HDB-HVB AND HDC-HVC, SHEET 10. LOCK MAY BE INSTALLED AT MIDSPAN OR 12" MAXIMUM BELOW OR ABOVE MIDSPAN. USE OF LOCKING RODS 35 IS COMPLETELY OPTIONAL.

FLORIDA BUILDING CODE (High Velocity Hurricane Zone)

© 2020 EASTERN METAL SUPPLY, INC.

BERTHA HV™
Accordion Shutter System

H.V. BLADE #1 W/ OR W/O H.V. WINDOW BLADE & H.V. BLADE #2


REV.No	DESCRIPTION	DATE	DRAWN BY:	Y.M.
1	OLD 20-189	7/21/23	DATE:	7/21/2023
2				
3				
4				
5				
6				

DRAWING No
23-118

SHEET
5 OF 28

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No **26-0428-01**
Expiration Date **07/07/31**
By *H. G. A. Miller*
Miami Dade Product Control

MIAMI-DADE COUNTY

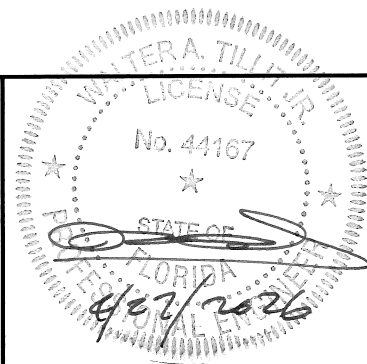

P.E. SEAL/SIGNATURE/DATE

©2023 TILTECO, INC




TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FLORIDA 33166
Phone : (305)871-1530 . Fax : (305)871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr. P.E.
FLORIDA Lic. # 44167


**RED OAKS
SHUTTER, INC**

(ASSA # 15)


221 S.W. 5th COURT
POMPANO BEACH, FL 33060
Phone: (954)782-9325

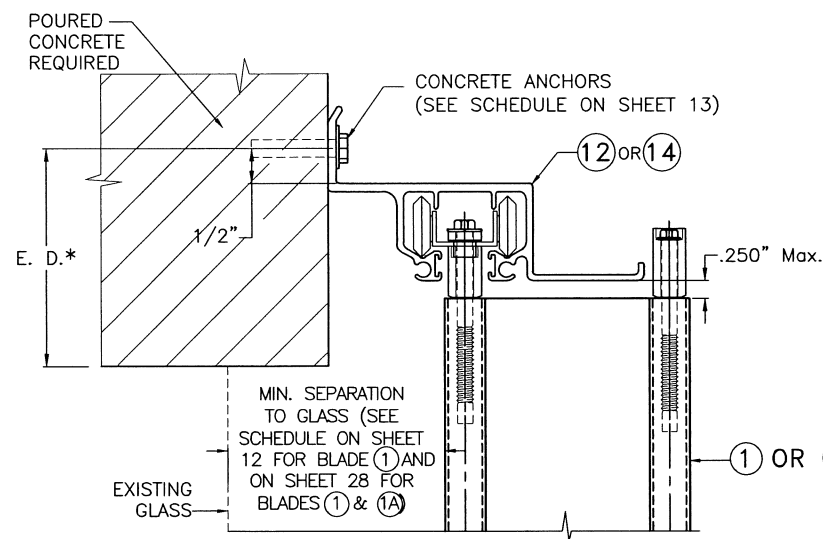


A HV WALL HEADER INSTALLATION

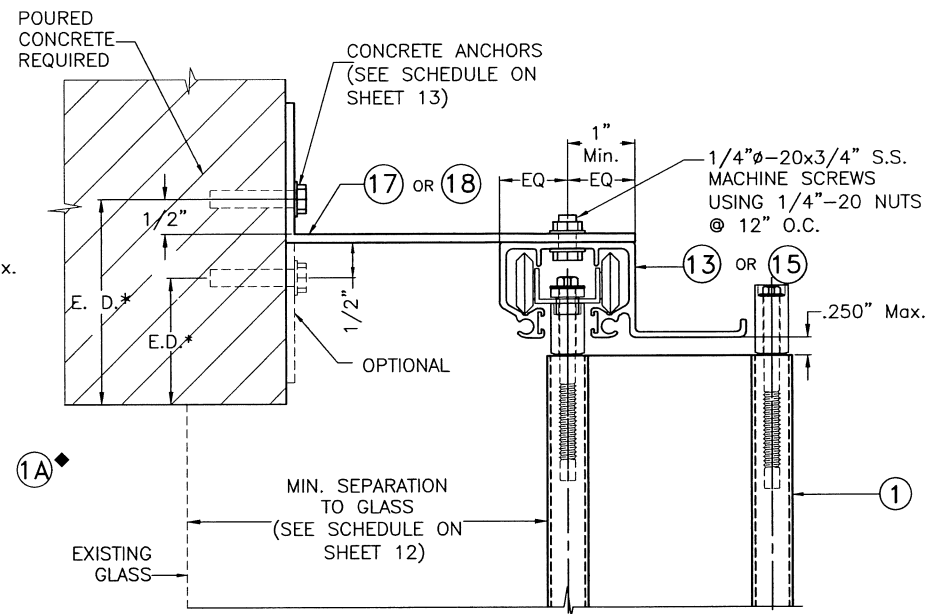


B HV WALL HEADER INSTALLATION

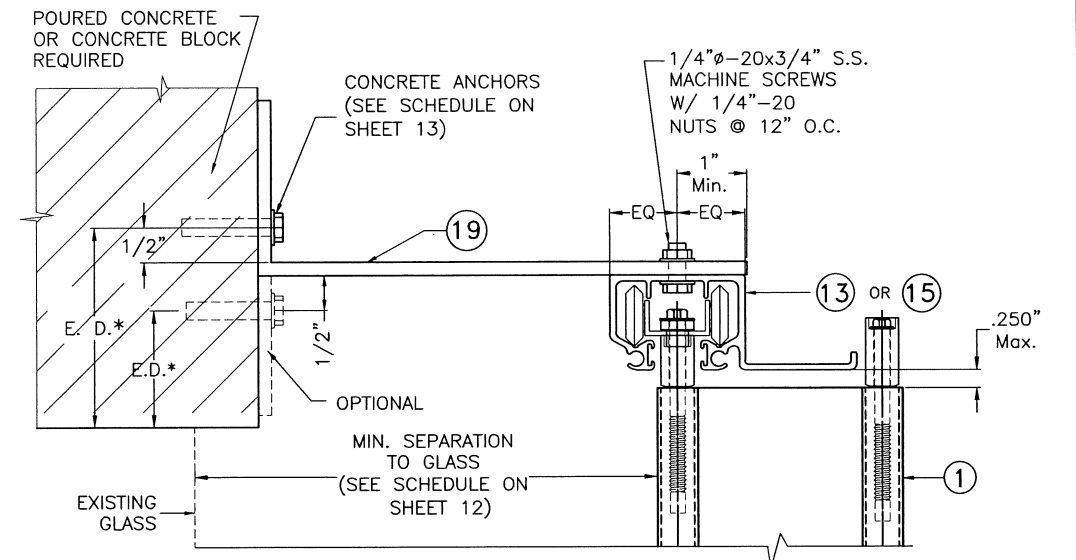


C HV WALL HEADER INSTALLATION

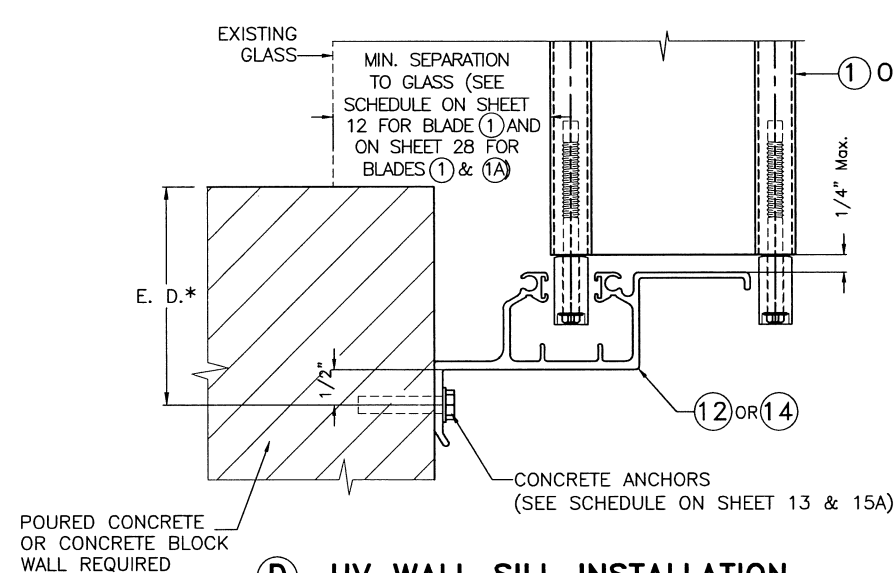

D HV WALL SILL INSTALLATION

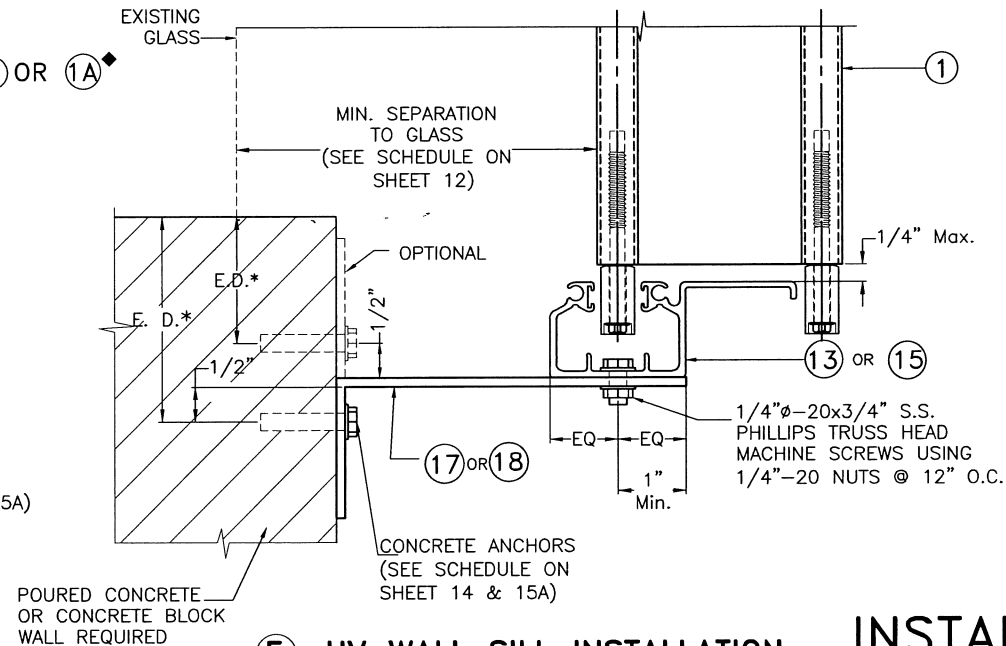

E HV WALL SILL INSTALLATION

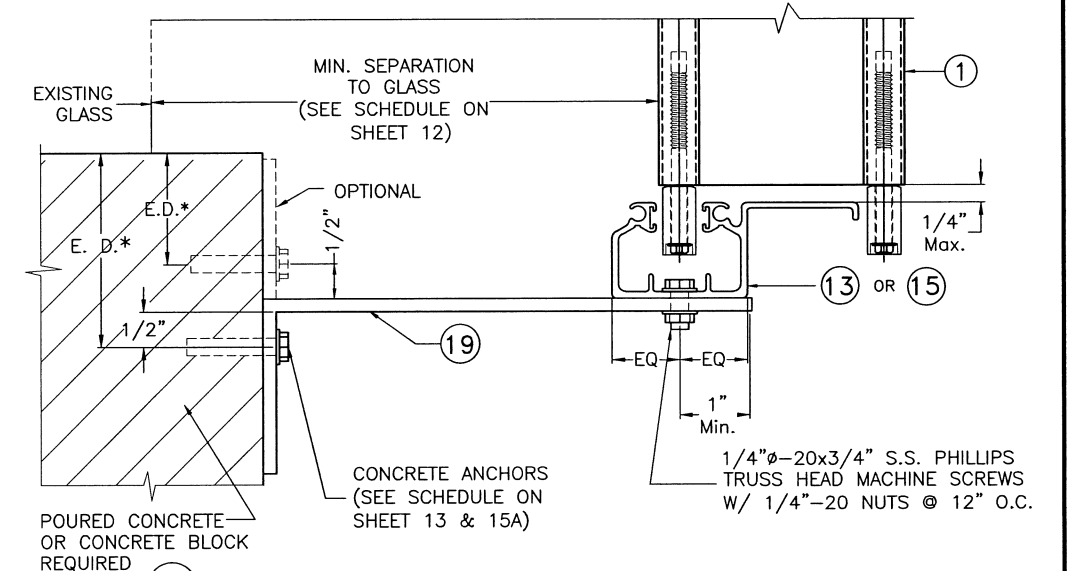

F HV WALL SILL INSTALLATION

NOTE FOR COMBINATION OF SECTIONS:
1- SEE SHEET 4 FOR TYPICAL SHUTTER ASSEMBLY
2- MOUNTING SECTIONS CAN BE COMBINED IN ANY WAY TO SUIT ANY INSTALLATION.

* E. D. = EDGE DISTANCE
(SEE SPECIFICATIONS ON SHEET 14)

◆ SEE LIMITATIONS OF USE FOR
BLADE 1A ON SHEET 28

**INSTALLATION DETAILS W/ 1 HV BLADE &
(1 HV + 1A HV BLADES) AS APPLICABLE**

FLORIDA BUILDING CODE (High Velocity Hurricane Zone)

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 26-0428-01
Expiration Date 07/07/31
By *Heidi D. Miller*
Miami Date Product Control

MIAMI-DADE COUNTY

WALTER A. TILLIT JR.
LICENSE
No. 44167
STATE OF FLORIDA
PROFESSIONAL ENGINEER
4/27/2023

P.E. SEAL/SIGNATURE/DATE

©2023 TILTECO, INC

TILTECO INC.

TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FLORIDA 33166
Phone : (305)871-1530 . Fax : (305)871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr. P.E.
FLORIDA Lic. # 44167


**RED OAKS
SHUTTER, INC**

(ASSA # 15)


221 S.W. 5th COURT
POMPANO BEACH, FL 33060
Phone: (954)782-9325

© 2020 EASTERN METAL SUPPLY, INC.

BERTHA HV™ Accordion Shutter System				
H.V. BLADE #1 W/ OR W/O H.V. WINDOW BLADE & H.V. BLADE #2				
REV.No	DESCRIPTION	DATE	DRAWN BY:	Y.M.
1	OLD 20-189	7/21/23	DATE:	7/21/2023
2				
3				
4				
5				
6				
DRAWING No				
23-118				
SHEET				
6 OF 28				

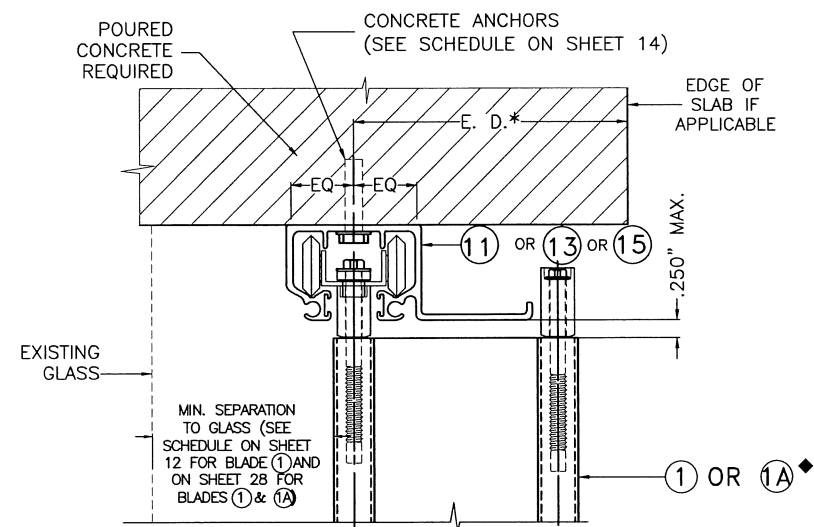

Ⓒ HV CEILING INSTALLATION

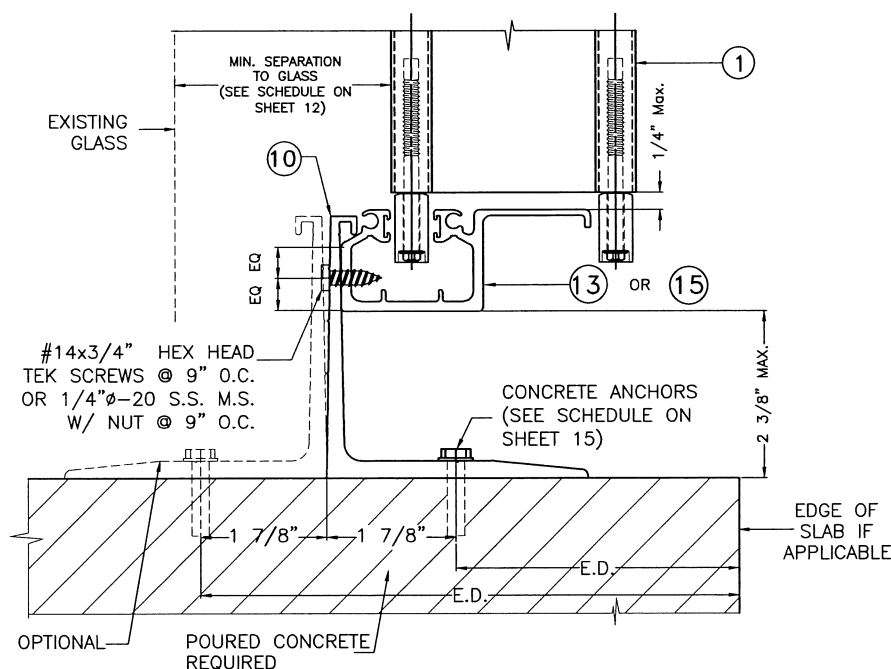

Ⓙ HV RAINGUARD INSTALLATION †

NOTE FOR COMBINATION OF SECTIONS:


1- SEE SHEET 4 FOR TYPICAL SHUTTER ASSEMBLY
2- MOUNTING SECTIONS CAN BE COMBINED IN ANY WAY TO SUIT ANY INSTALLATION.

* E. D. = EDGE DISTANCE
(SEE SPECIFICATIONS ON SHEET 14)


† NOTE:

THIS INSTALLATION SHALL BE REMOVABLE WHEN PERFORMED ADJACENT TO AN OPERABLE EXIT OR ENTRANCE


◆ SEE LIMITATIONS OF USE FOR BLADE 1A ON SHEET 28

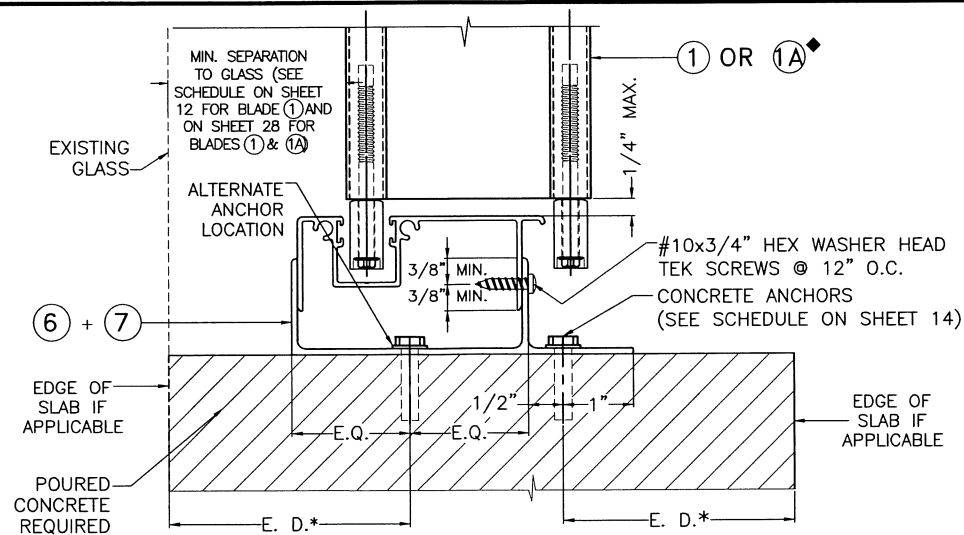


Ⓜ HV FLOOR INSTALLATION †

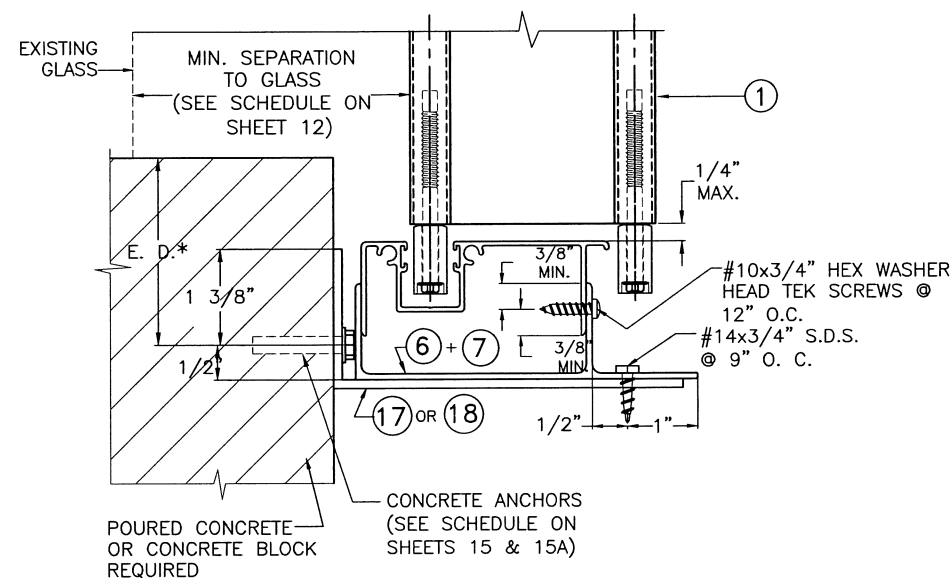

Ⓚ HV WALL FLOOR INSTALLATION

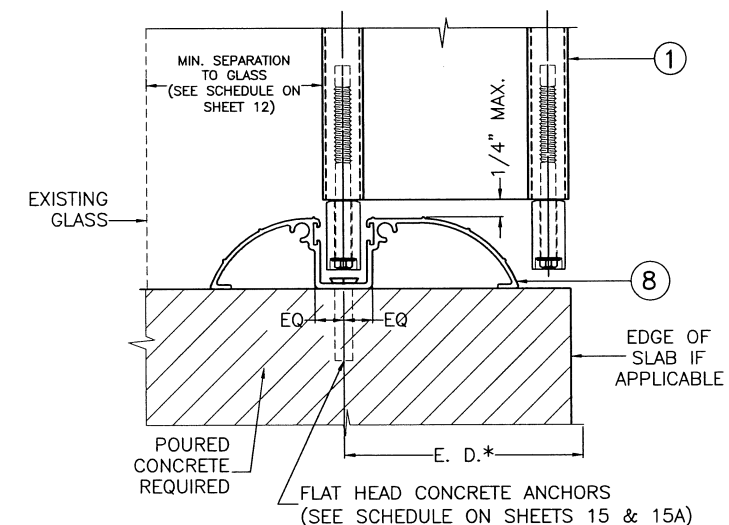

Ⓛ HV WALK-OVER INSTALLATION

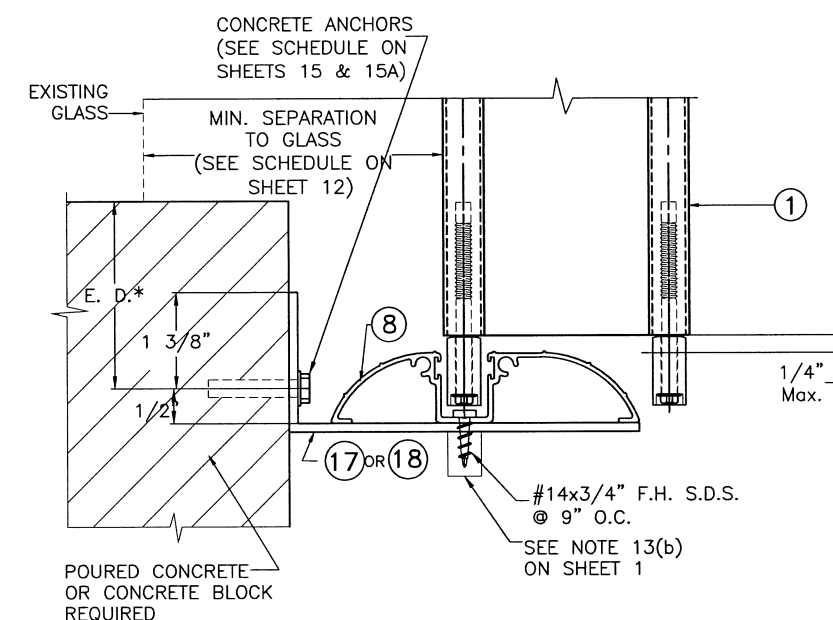

Ⓛ HV WALL WALK-OVER INSTALLATION


INSTALLATION DETAILS W/ 1 HV BLADE & (1 HV + 1A HV BLADES) AS APPLICABLE

FLORIDA BUILDING CODE (High Velocity Hurricane Zone)

© 2020 EASTERN METAL SUPPLY, INC.

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 26-0428-01
Expiration Date 07/07/31
By *H. A. Tillit Jr.*
Miami Date Product Control

MIAMI-DADE COUNTY

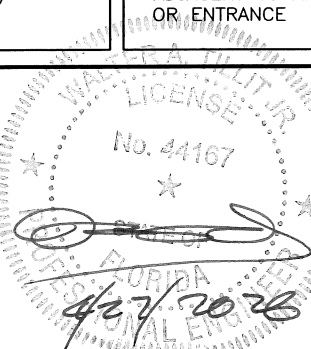

P.E. SEAL/SIGNATURE/DATE

©2023 TILTECO, INC



TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FLORIDA 33166
Phone : (305)871-1530 . Fax : (305)871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr. P.E.
FLORIDA Lic. # 44167

**RED OAKS
SHUTTER, INC**

(ASSA # 15)

221 S.W. 5th COURT
POMPAÑO BEACH, FL 33060
Phone: (954)782-9325

BERTHA HV™
Accordion Shutter System

H.V. BLADE #1 W/ OR W/O H.V. WINDOW BLADE & H.V. BLADE #2

REV.No	DESCRIPTION	DATE	DRAWN BY:	Y.M.
1	OLD 20-189	7/21/23	DATE:	7/21/2023
2				
3				
4				
5				
6				

DRAWING No
23-118

SHEET
7 OF 28

OUT

IN

— EXISTING GLASS

* SEE NOTES ON LOCKING RODS (33), HV LOCKS (24) or (23)
AND ALTERNATE HV LOCK (26) ON SHEET 5.

** BLADE SLACK DETAIL HVF IS VALID FOR ALL
CENTERMATES APPLICATION WITH BLADE (1)

**SEE END WALL CONNECTION
DETAILS ON SHEETS 11 & 20**

2"x2"x1/8"x0'-2"
(6063-T6 ALLOY) ALUM.
ANGLE W/(2) 1/4"Ø TAPCON
ANCHORS TO CONCRETE
(TOP/BOTTOM) &
(4)#10x1/2" S.M.S. TO TUBE
AT EACH ANGLE. (TYP)

#10x3/4" S.M.S. @ 12"
O.C. FULL LENGHT.

— EXISTING GLASS

OPPOSING
CENTERMATES
W/ HV LOCK (24)* or (25)*

SYMMETRICAL
CENTERMATES
W/ HV LOCK (24)* or (25)*

MIN. SEPARATION
TO GLASS
(SEE SCHEDULE ON
SHEET 12)

HVAHVBHVC

SYMMETRICAL
CENTERMATES
W/ HV LOCK (26)*
OPTIONAL
(INTERIOR)

EXISTING GLASS

MIN. SEPARATION TO GLASS
(SEE SCHEDULE ON SHEET 12)

15

8

24 OR 25*
OPTIONAL
(INTERIOR)

OR
MIN. SEPARATION
TO GLASS
OR
(SEE SCHEDULE ON
SHEET 12)

-POURED CONCRETE OR
CONCRETE BLOCK WALL
REQUIRED

CONCRETE
ANCHORS @
16" O.C.

6 1/2" MAX. SLACK

FLORIDA BUILDING CODE (High Velocity Hurricane Zone)

© 2020 EASTERN METAL SUPPLY, INC.

PRODUCT REVISED
as complying with the Florida:
Building Code
Acceptance No 26-0428.0
Expiration Date 07/07/31

By H. G. A. M. M.
Miami Dade Product Control

MIAMI-DADE COUNTY

P.E. SEAL/SIGNATURE/DATE

©2023 TILTECO, INC



TILTECO INC.

TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FLORIDA 33166
Phone : (305)871-1530 . Fax : (305)871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr. P.E.
FLORIDA Lic. # 44167

**RED OAKS
SHUTTER, INC**

(ASSA # 15)


221 S.W. 5th COURT
POMPANO BEACH, FL 33060
Phone: (954)782-9325

BERTHA HV™ Accordion Shutter System

H.V. BLADE #1 W/ OR W/O H.V. WINDOW BLADE & H.V. BLADE #2

REV. No	DESCRIPTION	DATE	DRAWN BY:	Y.M.
1	OLD 20-189	7/21/23	DATE:	7/21/2023
2			DRAWING No 23-118	
3				
4				
5				
6			SHEET 8 OF 28	

SEE END CONNECTION DETAILS ON SHEETS 11 & 20



HVG*


© 2020 EASTERN METAL SUPPLY, INC.

MIAMI-DADE COUNTY




REV.No	DESCRIPTION	DATE	DRAWN BY: Y.M.
1	OLD 20-189	7/21/23	DATE: 7/21/2023
2			DRAWING No 23-118
3			
4			
5			
6			SHEET 9 OF 28

SEE END WALL CONNECTION DETAILS ON SHEETS 11 & 20

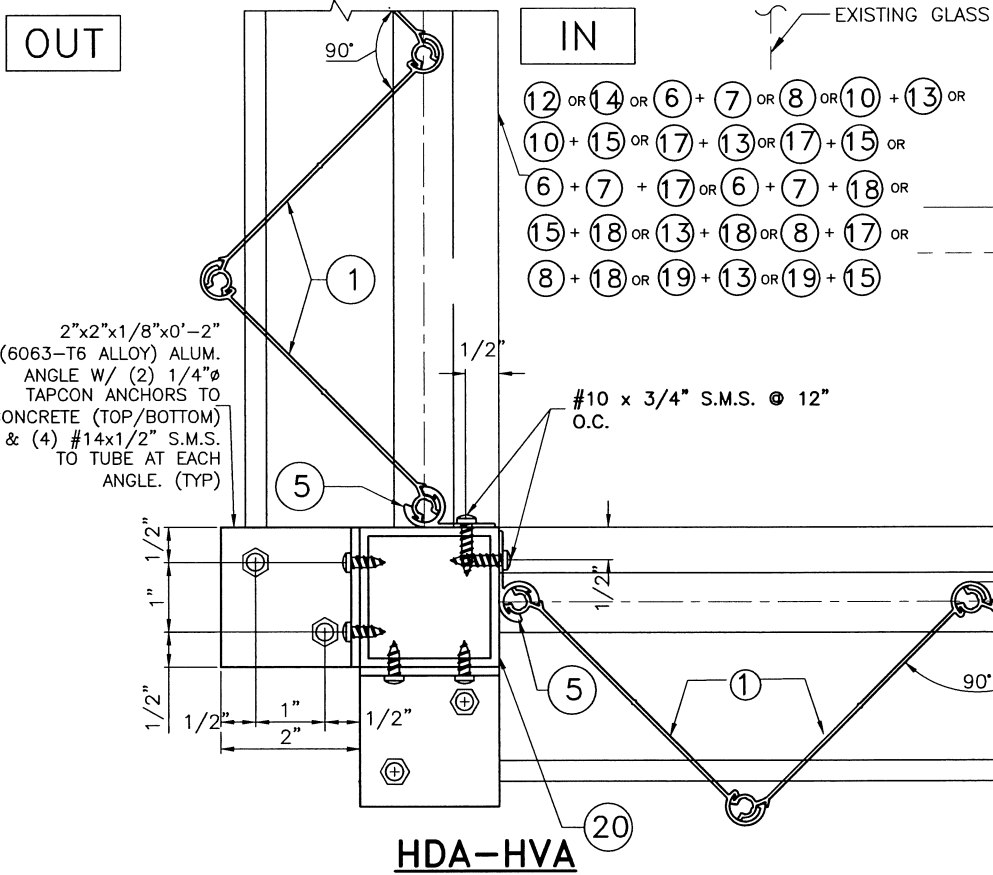


INSTALLATION ① HV BLADE
W/ HD CENTERMATES ③① , ③② , ③③

SEE END WALL CONNECTION
DETAILS ON SHEETS 11 & 20

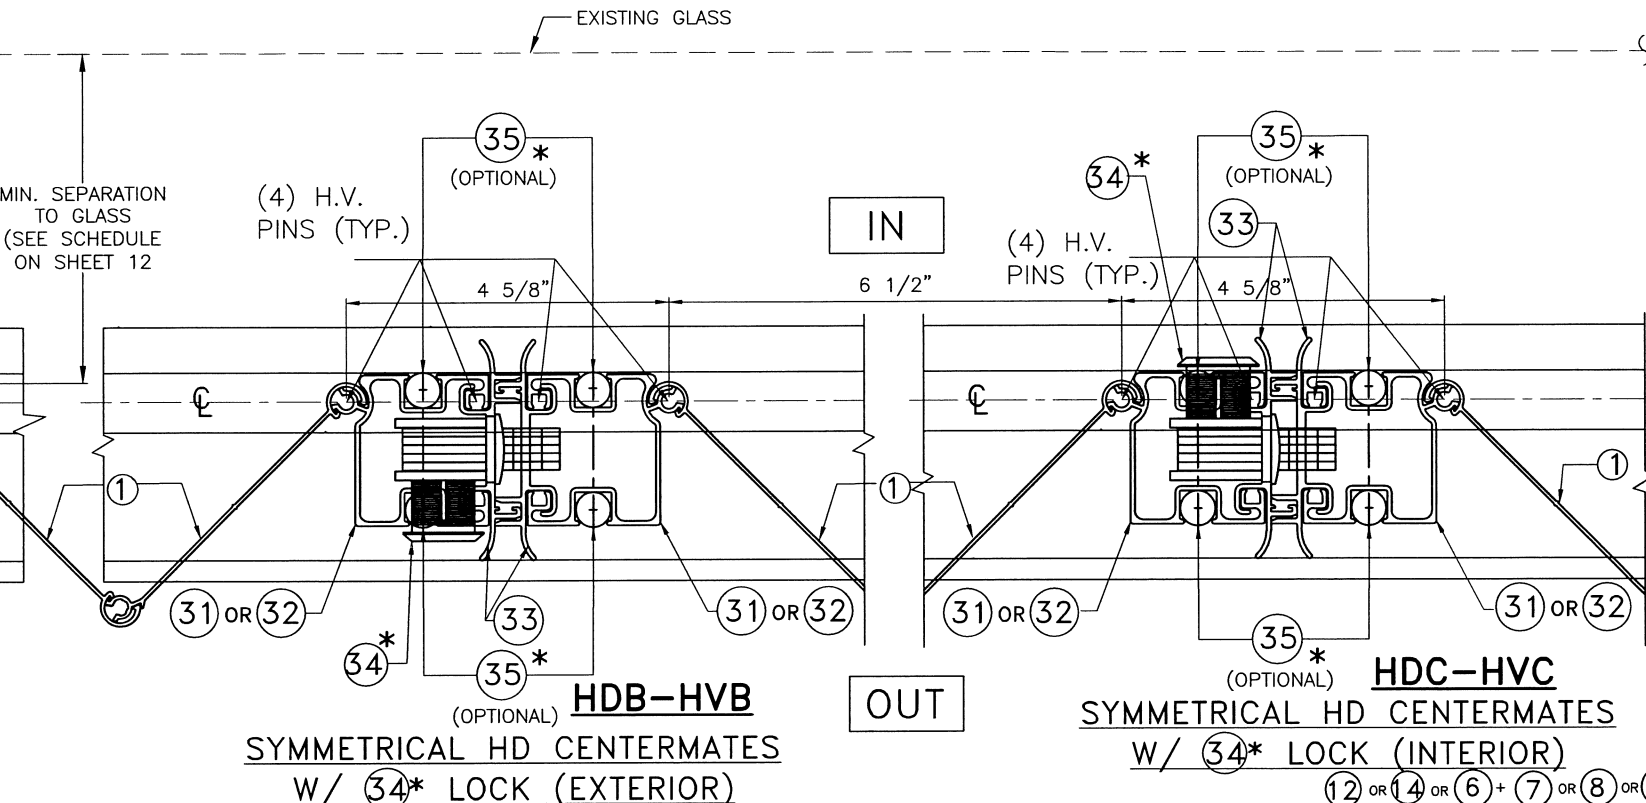

* SEE NOTES ON LOCKING RODS ③⑤ & HD ③④ LOCKS ON SHEET 5
** UNIVERSAL FLOATING BLADE ③ DETAIL HDD-HVD IS
VALID FOR ALL CENTERMATES APPLICATIONS WITH BLADE ①

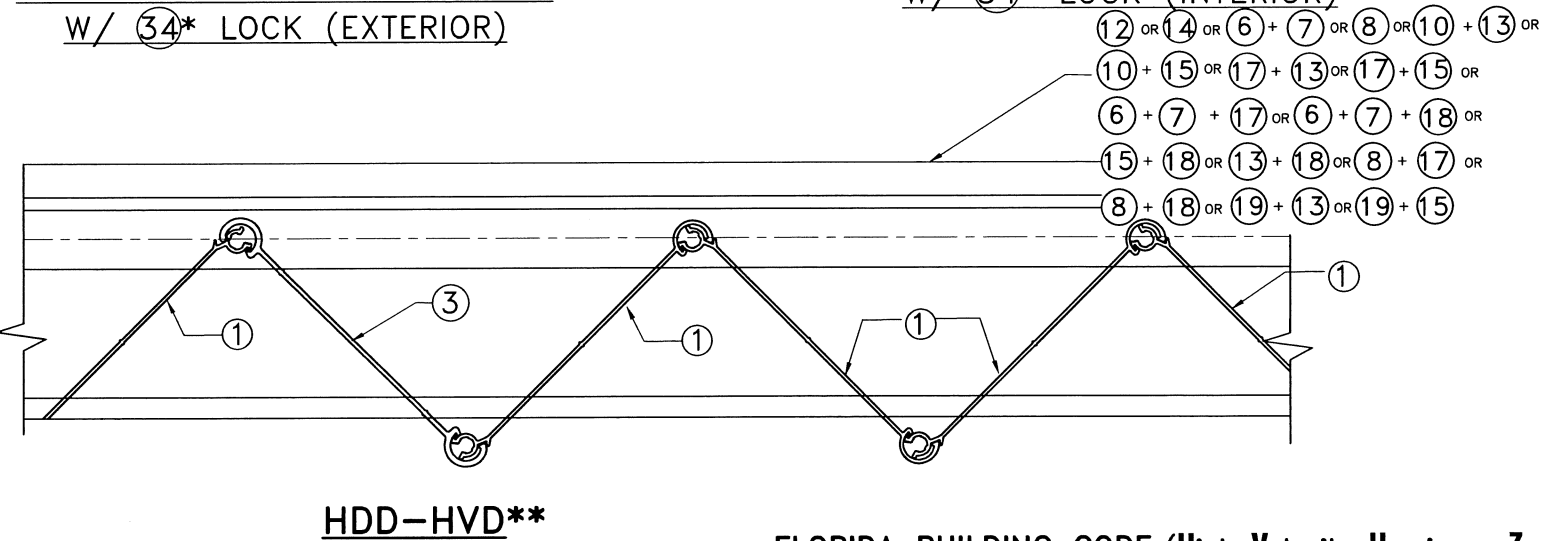

FLORIDA BUILDING CODE (High Velocity Hurricane Zone)


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 26-0428.01
Expiration Date 07/07/31
By *Walter A. Tillit Jr.*
Miami-Dade Product Control
MIAMI-DADE COUNTY

WALTER A. TILLIT JR.
LICENSE
No. 44167
STATE OF
FLORIDA
PROFESSIONAL ENGINEER
Walter A. Tillit Jr.
P.E. SEAL/SIGNATURE/DATE

©2023 TILTECO, INC.
TILTECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FLORIDA 33166
Phone : (305)871-1530 . Fax : (305)871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr. P.E.
FLORIDA Lic. # 44167

**RED OAKS
SHUTTER, INC**
(ASSA # 15)
221 S.W. 5th COURT
POMPANO BEACH, FL 33060
Phone: (954)782-9325

© 2020 EASTERN METAL SUPPLY, INC.				
BERTHA HV™ Accordion Shutter System				
H.V. BLADE #1 W/ OR W/O H.V. WINDOW BLADE & H.V. BLADE #2				
REV.No	DESCRIPTION	DATE	DRAWN BY:	Y.M.
1	OLD 20-189	7/21/23	DATE:	7/21/2023
2				
3				
4				
5				
6				
DRAWING No				23-118
SHEET				10 OF 28

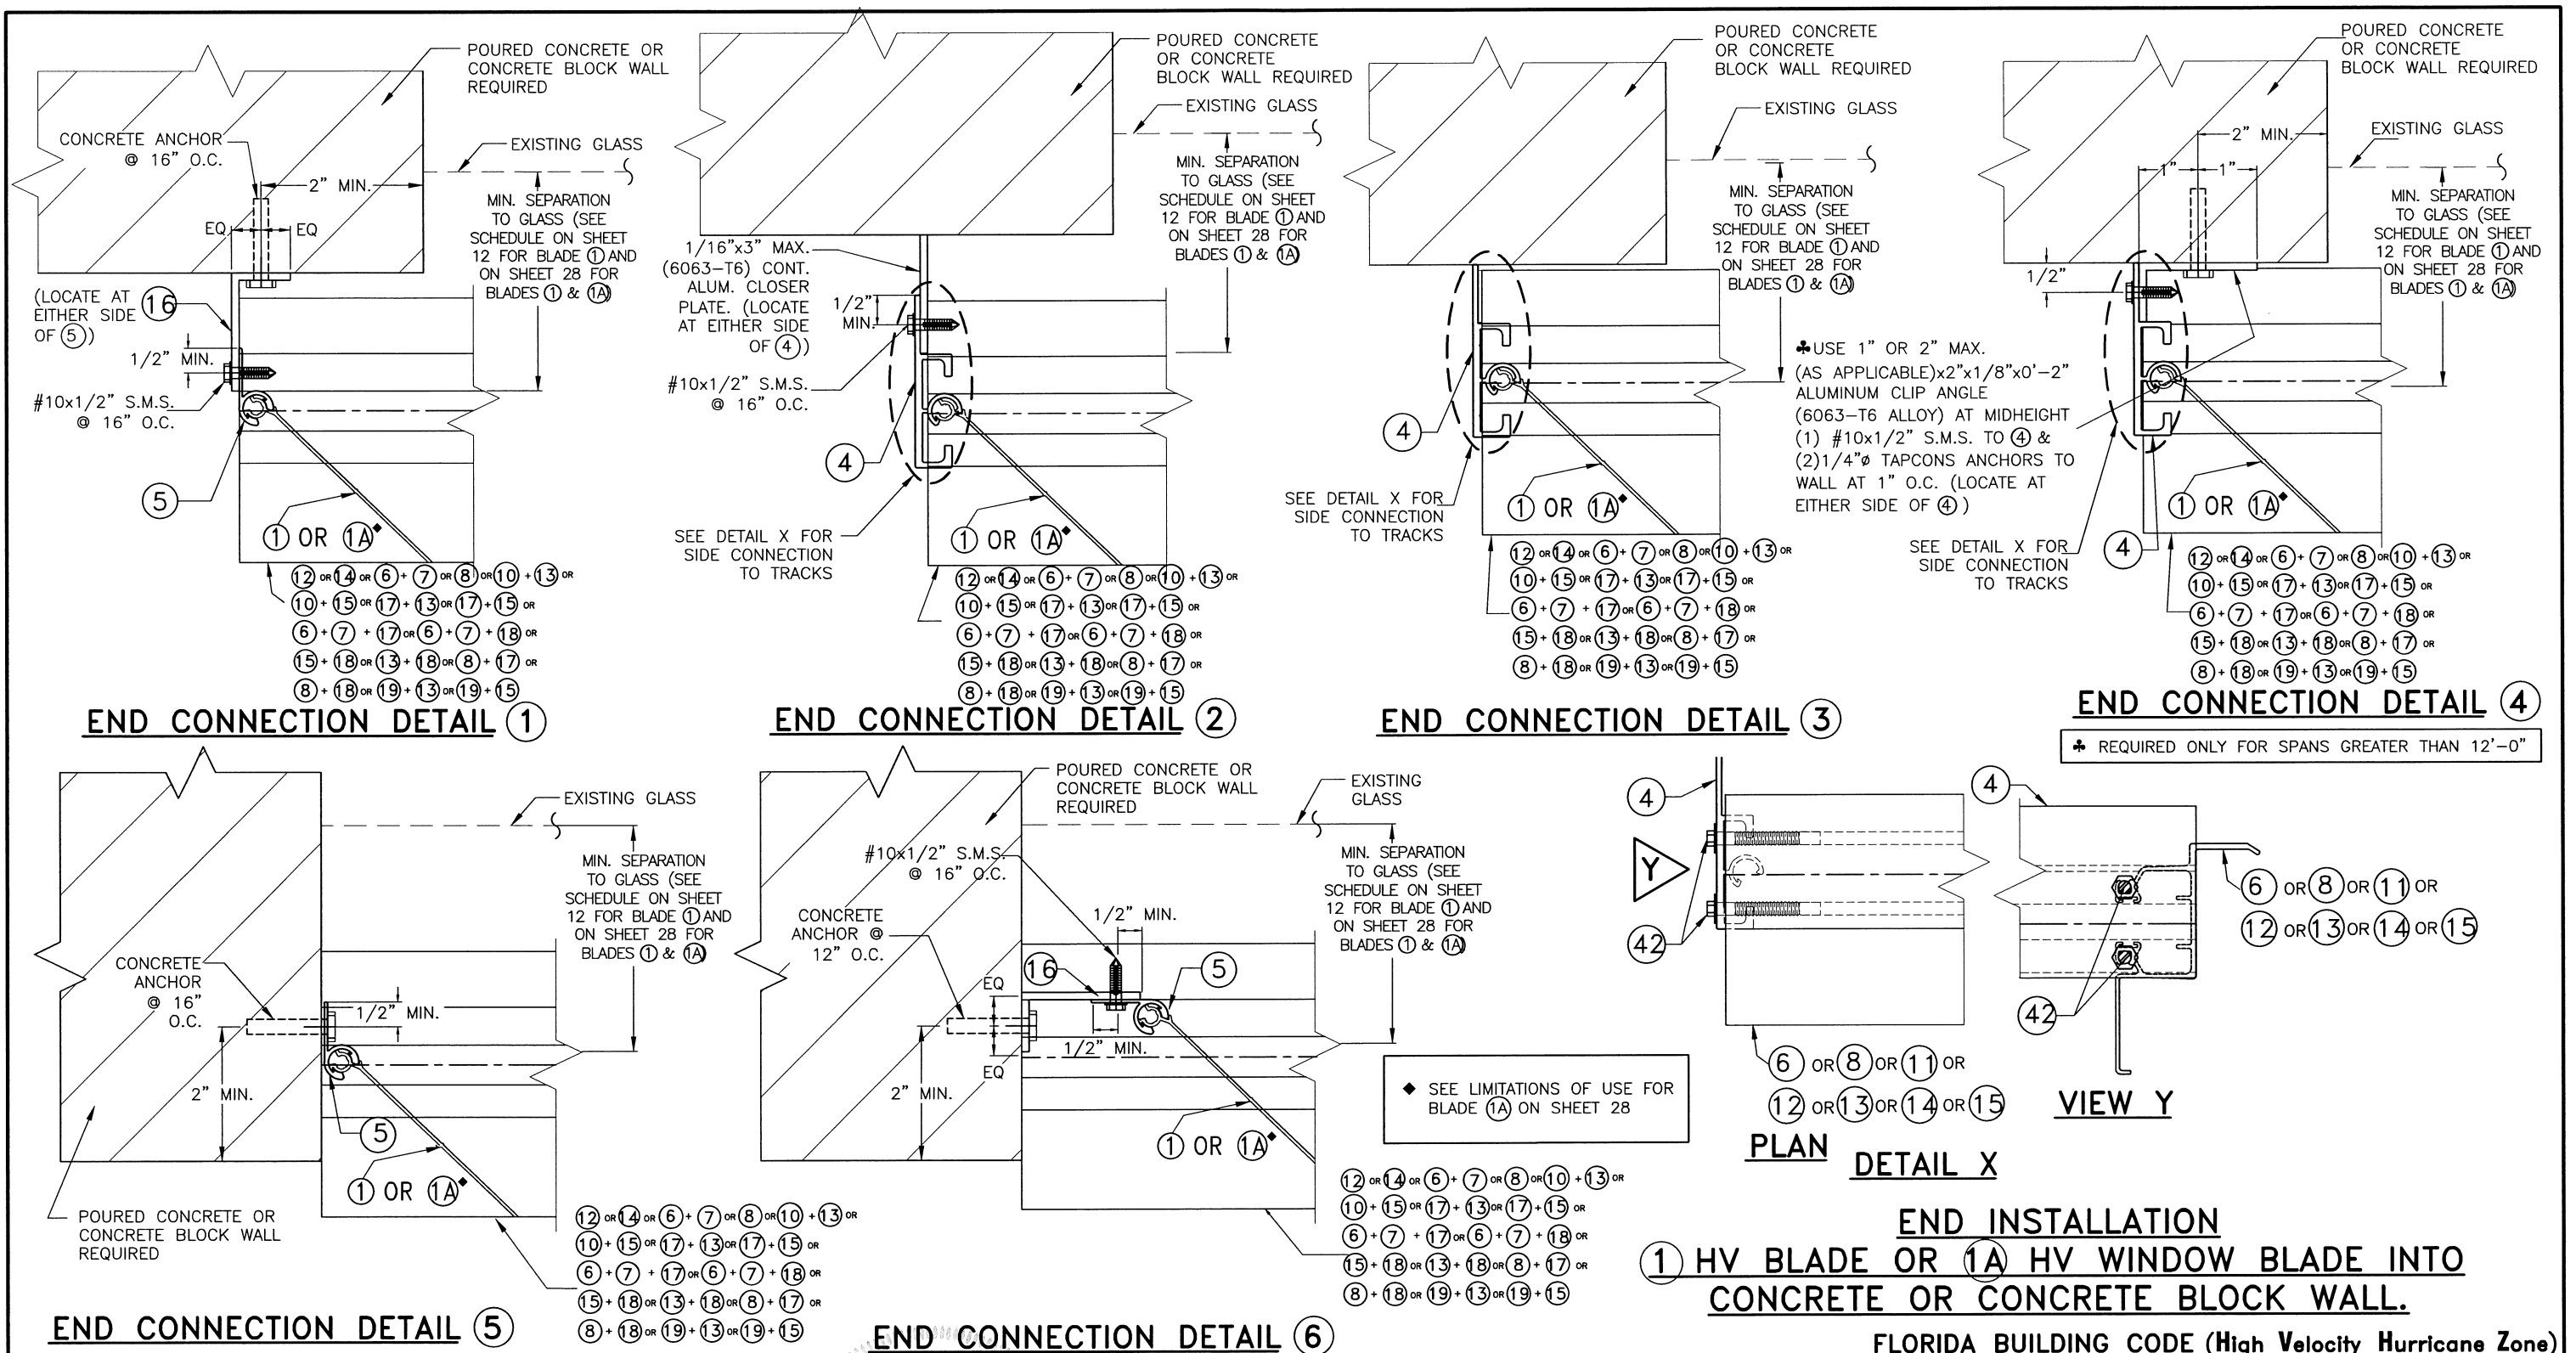

FLORIDA BUILDING CODE (High Velocity Hurricane Zone)

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 26-0428.01
Expiration Date 07/07/31
By Helga B. Mohr
Miami Code Product Control

MIAMI-DADE COUNTY

P.E. SEAL/SIGNATURE/DATE

©2023 TILTECO, INC



TILTECO INC.

TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FLORIDA 33166
Phone : (305)871-1530 . Fax : (305)871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr. P.E.
FLORIDA Lic. # 44167

RED OAKS SHUTTER, INC

(ASSA # 15)

221 S.W. 5th COURT
POMPAÑO BEACH, FL 33060
Phone: (954)782-9325

© 2020 EASTERN METAL SUPPLY, INC.

BERTHA HV™ Accordion Shutter System

H.V. BLADE #1 W/ OR W/O H.V. WINDOW BLADE & H.V. BLADE #2

REV. No	DESCRIPTION	DATE	DRAWN BY:	Y.M.
1	OLD 20-189	7/21/23	DATE:	7/21/2023
2			DRAWING No 23-118	
3				
4				
5				
6			SHEET 11 OF 28	

SCHEDULE #1

MAXIMUM SHUTTER SPAN* [†] "L+" OR "L-" (ft.) FOR INSTALLATIONS W/ <u>SYMMETRICAL</u> <u>CENTERMATES</u> , (21) & (22) or (31) or (32) W/ ONE HV LOCK (24) or (25) or (26) or HD LOCK (34) W/ NO LOCKING RODS (35) OR CENTERMATES (28) & (29) W/ ONE HV LOCK (30) W/ TWO LOCKING RODS (35) TOP & BOTTOM ♦(SEE NOTE †)				
MAXIMUM A.S.D. DESIGN LOAD (p.s.f.) (+ OR -)	CONCRETE & WOOD INSTALLATIONS Ø			
	WALL MOUNTING		FLOOR/CEILING MOUNTING	
	L + (ft)	L - (ft)	L + (ft)	L - (ft)
30	13'-2"	16'-0"	13'-2"	16'-0"
35	12'-8"	14'-10"	12'-8"	14'-10"
40	12'-3"	13'-10"	12'-3"	13'-10"
45	11'-11"	13'-1"	11'-11"	13'-1"
50	11'-7"	12'-5"	11'-7"	12'-5"
55	11'-4"	11'-10"	11'-4"	11'-10"
60	11'-1"	11'-4"	11'-0"	11'-4"
65	10'-10"	10'-10"	10'-7"	10'-10"
70	10'-6"	10'-6"	10'-2"	10'-6"
75	10'-1"	10'-1"	9'-10"	10'-1"
80	9'-10"	9'-9"	9'-7"	9'-10"
85	9'-6"	9'-6"	9'-3"	9'-6"
90	9'-3"	9'-3"	9'-0"	9'-3"
95	9'-0"	8'-9"	8'-9"	9'-0"
100	8'-9"	8'-4"	8'-6"	8'-9"
105	8'-7"	7'-11"	8'-4"	8'-4"
110	8'-4"	7'-7"	8'-2"	7'-11"
115	8'-2"	7'-3"	8'-0"	7'-7"
120	8'-0"	6'-11"	7'-10"	7'-4"
125	7'-10"	6'-8"	7'-8"	7'-0"
130	7'-8"	6'-5"	7'-6"	6'-9"
135	7'-7"	6'-2"	7'-4"	6'-6"
140	7'-5"	5'-11"	7'-3"	6'-3"
145	7'-3"	5'-9"	7'-1"	6'-0"
150	7'-2"	5'-7"	7'-0"	5'-10"
155	7'-0"	5'-5"	6'-10"	5'-8"
160	6'-11"	5'-2"	6'-9"	5'-6"
165	6'-10"	5'-1"	6'-8"	5'-4"
170	6'-9"	4'-11"	6'-7"	5'-2"
175	6'-7"	4'-9"	6'-5"	5'-0"
180	6'-6"	4'-8"	6'-4"	4'-10"
185	6'-5"	4'-6"	6'-3"	4'-9"
190	6'-4"	4'-5"	6'-2"	4'-7"
195	6'-3"	4'-3"	6'-1"	4'-6"
200	6'-2"	4'-2"	6'-0"	4'-5"
205	6'-0"	4'-1"	6'-0"	4'-3"

SCHEDULE #2

MAXIMUM SHUTTER SPAN* "L+" OR "L-" (ft.) FOR INSTALLATIONS W/ <u>OPPOSING</u> <u>CENTERMATES</u> , (21) & (22) ONE HV LOCK (24) OR (25) OR (26) W/ NO LOCKING RODS (35) ♦(SEE NOTE †)		
MAXIMUM A.S.D. DESIGN LOAD (p.s.f.) (+ OR -)	CONCRETE & WOOD INSTALLATIONS Ø	
	WALL MOUNTINGS & FLOOR/CEILING MOUNTINGS	
	L + (ft)	L - (ft)
30	12'-3"	14'-9"
35	11'-9"	13'-8"
40	11'-4"	12'-9"
45	11'-1"	12'-0"
50	10'-9"	11'-5"
55	10'-6"	10'-11"
60	10'-3"	10'-5"
65	10'-0"	10'-0"
70	9'-8"	9'-8"
75	9'-4"	9'-4"
80	9'-0"	9'-0"
85	8'-9"	8'-9"
90	8'-6"	8'-6"
95	8'-3"	8'-3"
100	8'-1"	8'-1"
105	7'-11"	7'-11"
110	7'-8"	7'-7"
115	7'-6"	7'-3"
120	7'-4"	6'-11"
125	7'-3"	6'-8"
130	7'-1"	6'-5"
135	6'-11"	6'-2"
140	6'-10"	5'-11"
145	6'-8"	5'-9"
150	6'-7"	5'-7"
155	6'-6"	5'-5"
160	6'-5"	5'-2"
165	6'-3"	5'-1"
170	6'-2"	4'-11"
175	6'-1"	4'-9"
180	6'-0"	4'-8"
185	5'-11"	4'-6"
190	5'-10"	4'-5"
195	5'-9"	4'-3"
200	5'-9"	4'-2"
205	5'-8"	4'-1"

SCHEDULE #3

MAXIMUM SHUTTER SPAN* [†] "L+" OR "L-" (ft.) INSTALLATIONS W/ <u>SYMMETRICAL CENTERMATES</u> (21) & (22) W/ TWO HV (24) OR (25) OR (26) LOCKS OR TWO LOCKING RODS (35) TOP/BOTTOM W/ ONE HV LOCK (24) OR (25) OR (26) ♦(SEE NOTE †)		
MAXIMUM A.S.D. DESIGN LOAD (p.s.f.) (+ OR -)	CONCRETE & WOOD INSTALLATIONS Ø	
	FLOOR/CEILING MOUNTING	
	L + (ft)	L - (ft)
30	13'-1"	16'-0"
35	12'-7"	15'-7"
40	12'-2"	15'-2"
45	11'-9"	14'-3"
50	11'-6"	13'-7"
55	11'-3"	12'-11"
60	11'-0"	12'-4"
65	10'-9"	11'-11"
70	10'-7"	11'-5"
75	10'-4"	11'-1"
80	10'-0"	10'-9"
85	9'-9"	10'-5"
90	9'-5"	10'-1"
95	9'-2"	9'-10"
100	9'-0"	9'-7"
105	8'-9"	9'-4"
110	8'-7"	9'-2"
115	8'-4"	8'-11"
120	8'-2"	8'-9"
125	8'-0"	8'-5"
130	7'-10"	8'-1"
135	7'-9"	7'-9"
140	7'-7"	7'-6"
145	7'-5"	7'-3"
150	7'-4"	7'-0"
155	7'-2"	6'-9"
160	7'-1"	6'-7"
165	7'-0"	6'-4"
170	6'-11"	6'-2"
175	6'-9"	6'-0"
180	6'-8"	5'-10"
185	6'-7"	5'-8"
190	6'-6"	5'-6"
195	6'-5"	5'-5"
200	6'-4"	5'-3"
205	6'-3"	5'-1"

* NOTES:

(1) L+: MAXIMUM ALLOWABLE SPAN FOR A GIVEN POSITIVE A.S.D. DESIGN LOAD.
L-: MAX. ALLOWABLE SPAN FOR A GIVEN NEGATIVE A.S.D. DESIGN LOAD.

(2) PROCEDURE TO DETERMINE MAXIMUM SPAN FOR WALL MOUNTINGS OR FLOOR/CEILING:

GIVEN A POSITIVE A.S.D. DESIGN LOAD, DETERMINE MAXIMUM SPAN "L+" FROM SCHEDULE.
GIVEN A NEGATIVE A.S.D. DESIGN LOAD, DETERMINE MAXIMUM SPAN "L-" FROM SCHEDULE.

FINAL MAXIMUM ALLOWABLE SPAN IS EQUAL TO THE MINIMUM DETERMINED SPAN BETWEEN "L+" AND "L-".

(3) PROCEDURE TO DETERMINE MAXIMUM SPAN FOR COMBINATIONS IN BETWEEN WALL W/ FLOOR/CEILING MOUNTINGS:

FOR A GIVEN POSITIVE A.S.D. DESIGN LOAD:
DETERMINE:
L1+= MAX. SPAN FOR WALL MOUNTING INSTALLATIONS.
L2+= MAX. SPAN FOR FLOOR/CEILING MOUNTING INSTALLATIONS.

FOR A GIVEN NEGATIVE A.S.D. DESIGN LOAD:
DETERMINE:
L1-= MAX. SPAN FOR WALL MOUNTING INSTALLATIONS.
L2-= MAX. SPAN FOR FLOOR/CEILING MOUNTING INSTALLATIONS.

FINAL MAXIMUM ALLOWABLE SPAN IS EQUAL TO THE MINIMUM BETWEEN "L1+", "L2+", "L1-" AND "L2-"

(4) GO TO ANCHOR SCHEDULE WITH FINAL MAXIMUM ALLOWABLE SPAN AND NEGATIVE A.S.D. DESIGN LOAD TO DETERMINE MAXIMUM ANCHOR SPACING.

Ø MAXIMUM SHUTTER SPAN "L+" OR "L-" FOR INSTALLATIONS INTO WOOD SHALL BE LIMITED TO 105 psf. A.S.D. DESIGN LOAD.

† H.V. CORNER CENTERMATE #3 MAY BE USED AT ALL MOUNTING INSTALLATIONS. LOCKING SPECIFICATIONS SHALL BE AS INDICATED ON MANDATORY CONDITION #2 NOTE #5, SHEET 5.

♦ SEPARATION TO GLASS REQUIREMENTS

(1) SEE BELOW FOR MINIMUM SEPARATION TO GLASS SCHEDULE FOR SHUTTERS INSTALLED WITHIN THE FIRST 30'-0" ELEVATION OF BUILDING MEASURED AT BOTTOM OF SHUTTER.

(2) MINIMUM SEPARATION TO GLASS FOR SHUTTERS INSTALLED ABOVE 30'-0" ELEVATION OF BUILDING, MEASURED AT BOTTOM OF SHUTTER IS 3".

MINIMUM SEPARATION TO GLASS SCHEDULE:
SHUTTER W/ ONE LOCK WITHOUT LOCKING RODS

SHUTTER SPAN	INSTALLATION W/ SYMMETRICAL CENTERMATES	INSTALLATION W/ OPPOSING CENTERMATES
105" OR LESS	3 5/16"s	4"
>105" TO MAX. ALLOWED	3 7/8"s	4"

s USE 2 1/2" FOR HD LOCK (31)+(33) OR (32)+(33) ,
USE INDICATED VALUES FOR HV CENTERMATES.

MINIMUM SEPARATION TO GLASS SCHEDULE:
SHUTTER W/ ONE LOCK & TWO LOCKING RODS OR
WITH ONLY TWO LOCKS

SHUTTER SPAN	INSTALLATION W/ SYMMETRICAL CENTERMATES	INSTALLATION W/ OPPOSING CENTERMATES
105" OR LESS	2 3/4" **	3 3/16"
>105" TO MAX. ALLOWED	3 1/4" ***	3 1/4"

** USE 2 15/16" FOR HV "T" LOCK (30) W/ (35)

*** USE 4 1/8" FOR HV "T" LOCK (30) W/ (35)
USE INDICATED VALUES FOR HV CENTERMATES.

INSTALLATION LEGEND

	CONCRETE & MANSORY	WOOD
WALL MOUNTING	A, B, C, D, E, F, K & L.	M, N, O, P, Q, R, S & V.
FLOOR/CEILING MOUNTING	G, H, I & J.	T, U, W & X.

1 HV BLADE ONLY

FLORIDA BUILDING CODE (High Velocity Hurricane Zone)

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 26-0428.01
Expiration Date 07/07/31
By *Walter A. Tillit Jr.*
Miami-Dade Product Control

MIAMI-DADE COUNTY

WALTER A. TILLIT JR.
LICENSE
No. 44167
STATE OF
FLORIDA
PROFESSIONAL ENGINEER
4/27/2026
P.E. SEAL/SIGNATURE/DATE

©2023 TILTECO, INC



TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FLORIDA 33166
Phone : (305)871-1530 . Fax : (305)871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr. P.E.
FLORIDA Lic. # 44167

RED OAKS
SHUTTER, INC

(ASSA # 15)

221 S.W. 5th COURT
POMPANO BEACH, FL 33060
Phone: (954)782-9325

© 2020 EASTERN METAL SUPPLY, INC.

BERTHA HV™ Accordion Shutter System				
H.V. BLADE #1 W/ OR W/O H.V. WINDOW BLADE & H.V. BLADE #2				
REV.No	DESCRIPTION	DATE	DRAWN BY:	Y.M.
1	OLD 20-189	7/21/23	DATE:	7/21/2023
2			DRAWING No 23-118	
3				
4				
5			SHEET 12 OF 28	
6				

ANCHORS SPACING LEGEND

BLUE TAP

TAPPER+

* SEE ANCHOR
SPECIFICATIONS
ON SHEET 14

◆ SEE LIMITATIONS OF USE FOR
BLADE (1A) ON SHEET 28

① HV BLADE OR ① HV BLADE
W/ ①A HV WINDOW BLADE
WORKING IN UNISON ◆

MAXIMUM SPAN (ft)	POURED CONCRETE																																																		
	(A) WALL HEADER MOUNTING W/ (12)								(A) WALL HEADER MOUNTING W/ (14)								(B) WALL HEADER MOUNTING								(D) WALL SILL MOUNTING W/ (12)								(D) WALL SILL MOUNTING W/ (14)								(C) & (F) WALL HEADER/SILL MOUNTING										
	A.S.D. DESIGN NEGATIVE LOAD (psf)								A.S.D. DESIGN NEGATIVE LOAD (psf)								A.S.D. DESIGN NEGATIVE LOAD (psf)								A.S.D. DESIGN NEGATIVE LOAD (psf)								A.S.D. DESIGN NEGATIVE LOAD (psf)								A.S.D. DESIGN NEGATIVE LOAD (psf)										
	30	40	60	75	90	120	160	205	30	40	60	75	90	120	160	205	30	40	60	75	90	120	160	205	30	40	60	75	90	120	160	205	30	40	60	75	90	120	160	205	30	40	60	75	90	120	160	205			
3'-0" OR LESS	14	12	10	9	8	8	6	6	14	12	10	9	8	8	6	6	14	12	10	9	8	8	6	6	14	12	10	9	8	8	6	6	14	12	10	9	8	8	6	5.5	8	8	8	8	8	8	7	5.5			
	14	12	10	9	8	8	6	5	14	12	10	9	8	8	6	6	14	12	10	9	8	8	6	6	14	12	10	9	8	8	6	3	14	12	10	9	8	8	6	6	8	8	8	8	8	8	8	6.5			
	14	12	10	9	8	8	6	6	14	12	10	9	8	8	6	6	14	12	10	9	8	8	6	6	14	12	10	9	8	8	6	6	14	12	10	9	8	8	6	6	8	8	8	8	8	8	8	7			
4'-0"	14	12	10	9	8	8	6	4	14	12	10	9	8	8	6	6	14	12	10	9	8	8	6	6	14	12	10	9	8	8	7	-	-	14	12	10	9	8	8	7	5.5	-	8	8	8	8	8	8	7	5.5	4
	14	12	10	9	8	8	4.5	-	14	12	10	9	8	8	6	4	14	12	10	9	8	8	6	6	14	12	10	9	8	8	8	-	-	14	12	10	9	8	8	6	-	8	8	8	8	8	8	6.5	5		
	14	12	10	9	8	8	6	4	14	12	10	9	8	8	6	6	14	12	10	9	8	8	6	6	14	12	10	9	8	8	8	-	-	14	12	10	9	8	8	8	6	-	8	8	8	8	8	8	7	5.5	
5'-0"	14	12	10	9	8	8	4.5	-	14	12	10	9	8	8	6	3.5	14	12	10	9	8	8	6	6	14	12	10	9	8	8	7.5	-	-	14	12	10	9	8	7.5	5.5	-	8	8	8	8	8	7.5	5.5	4	3	
	14	12	10	9	8	5.5	-	-	14	12	10	9	8	8	4.5	-	14	12	10	9	8	8	6	5	14	12	10	9	8	8	3	-	-	14	12	10	9	8	7	-	-	8	8	8	8	8	7	5	4		
	14	12	10	9	8	8	4	-	14	12	10	9	8	8	6	3.5	14	12	10	9	8	8	6	6	14	12	10	9	8	8	-	-	14	12	10	9	8	7.5	-	-	8	8	8	8	8	7.5	5.5	4			
6'-0"	14	12	10	9	8	5.5	3	-	14	12	10	9	8	8	4.5	-	14	12	10	9	8	8	6	6	14	12	9.5	7.5	4	-	-	14	12	9.5	7.5	6.5	3.5	-	8	8	8	7.5	6.5	4.5	3.5	-	4	3			
	14	12	10	9	8	3	-	-	14	12	10	9	8	8	-	-	14	12	10	9	8	8	5.5	3.5	14	12	10	9	8	4.5	-	-	14	12	10	9	7.5	4	-	-	8	8	8	8	7.5	5.5	4	3			
	14	12	10	9	8	5	-	-	14	12	10	9	8	8	4	-	14	12	10	9	8	8	6	5.5	14	12	10	9	5	-	-	14	12	10	9	8	4.5	-	-	8	8	8	8	8	6	4.5	-				
7'-0"	14	12	10	9	8	4	-	-	14	12	10	9	8	6.5	3	-	14	12	10	9	8	8	6	-	14	12	8	4.5	-	-	-	14	12	8	6.5	5.5	-	-	8	8	8	6.5	5.5	4	3	-	-				
	14	12	10	9	4.5	-	-	-	14	12	10	9	8	4	-	-	14	12	10	9	8	7	4	-	14	12	10	5.5	-	-	-	14	12	10	8	6.5	-	-	8	8	8	8	6.5	5	3.5	-					
	14	12	10	9	7.5	3.75	-	-	14	12	10	9	8	6	-	-	14	12	10	9	8	8	6	-	14	12	10	6	-	-	-	14	12	10	8.5	7	-	-	8	8	8	8	7	5	4	-					
8'-0"	14	12	10	9	5.5	3	-	-	14	12	10	9	8	4.5	-	-	14	12	10	9	8	8	-	-	14	11	7	-	-	-	-	14	11	7	5.5	3.5	-	-	8	8	7	5.5	4.5	3.5	-	-					
	14	12	10	5.5	3	-	-	-	14	12	10	9	8	-	-	-	14	12	10	9	8	5.5	-	-	14	12	8.5	3	-	-	-	14	12	8.5	7	4	-	-	8	8	8	7	5.5	4	3	-					
	14	12	10	9	5	-	-	-	14	12	10	9	8	4	-	-	14	12	10	9	8	8	-	-	14	12	9.5	-	-	-	-	14	12	9.5	7.5	4.5	-	-	8	8	8	7.5	6	4.5	-	-					
9'-0"	14	12	10	6.5	4.5	-	-	-	14	12	10	9	7.5	-	-	-	14	12	10	9	8	-	-	-	13	9.5	4	-	-	-	-	13	9.5	6.5	5	-	-	-	8	8	6.5	5	4	3	-	-					
	14	12	8.5	4	-	-	-	-	14	12	10	9	4.5	-	-	-	14	12	10	9	7.5	-	-	-	14	11.5	4.5	-	-	-	-	14	11.5	7.5	6	-	-	-	8	8	7.5	6	5	4	-	-					
	14	12	10	6	4	-	-	-	14	12	10	9	7	-	-	-	14	12	10	9	8	-	-	-	14	12	5	-	-	-	-	14	12	8	6.5	-	-	-	8	8	8	6.5	5.5	4	-	-					
10'-0"	14	12	9.5	5	3.5	-	-	-	14	12	10	9	5.5	-	-	-	14	12	10	9	8	-	-	-	11.5	8.5	-	-	-	-	-	11.5	8.5	5.5	-	-	-	-	8	8	5.5	4.5	3.5	-	-						
	14	12	5.5	3	-	-	-	-	14	12	10	6	3	-	-	-	14	12	10	9	6	-	-	-	14	10.5	3	-	-	-	-	14	10.5	7	3.5	-	-	-	8	8	7	5.5	4.5	3.5	-	-					
	14	12	9	4.5	3	-	-	-	14	12	10	9	5	-	-	-	14	12	10	9	8	-	-	-	14	11	-	-	-	-	-	14	11	7.5	-	-	-	-	8	8	7.5	6	5	-	-						
11'-0"	14	12	7	-	-	-	-	-	14	12	10	-	-	-	-	-	14	12	10	-	-	-	-	-	10.5	8	-	-	-	-	-	10.5	8	5	-	-	-	-	8	8	5	4	3.5	-	-						
	14	12	4	-	-	-	-	-	14	12	10	-	-	-	-	-	14	12	10	-	-	-	-	-	12.5	9.5	-	-	-	-	-	12.5	9.5	6	-	-	-	-	8	8	6	5	4	3	-	-					
	14	12	6.5	-	-	-	-	-	14	12	10	-	-	-	-	-	14	12	10	-	-	-	-	-	13.5	10	-	-	-	-	-	14	10	7	-	-	-	-	8	8	7	5.5	4.5	-	-						
12'-0"	14	12	5.5	-	-	-	-	-	14	12	10	-	-	-	-	-	14	12	10	-	-	-	-	-	9.5	7	-	-	-	-	-	9.5	7	3.5	-	-	-	-	8	7	4.5	3.5	3	-	-						
	14	12	3	-	-	-	-	-	14	12	8	-	-	-	-	-	14	12	10	-	-	-	-	-	11.5	8.5	-	-	-	-	-	11.5	8.5	4	-	-	-	-	8	8	5.5	4.5	4	-	-						
	14	12	5	-	-	-	-	-	14	12	10	-	-	-	-	-	14	12	10	-	-	-	-	-	12.5	9.5	-	-	-	-	-	13.5	9.5	4.5	-	-	-	-	8	8	6	5	4	-	-						
13'-0"	14	12	-	-	-	-	-	-	14	12	-	-	-	-	-	-	14	12	-	-	-	-	-	-	9	4.5	-	-	-	-	-	9	6.5	-	-	-	-	-	8	6.5	4.5	3.5	3	-	-						
	14	10	-	-	-	-	-	-	14	12	-	-	-	-	-	-	14	12	-	-	-	-	-	-	10.5	5.5	-	-	-	-	-	10.5	8	-	-	-	-	-	8	8	5	4	3.5	-	-						
	14	12	-	-	-	-	-	-	14	12	-	-	-	-	-	-	14	12	-	-	-	-	-	-	11.5	6	-	-	-	-	-	11.5	8.5	-	-	-	-	-	8	8	5.5	4.5	-	-							
14'-0"	14	12	-	-	-	-	-	-	14	12	-	-	-	-	-	-	14	12	-	-	-	-	-	-	8	3	-	-	-	-	-	8	6	-	-	-	-	-	8	6	4	3	-	-							
	14	7	-	-	-	-	-	-	14	12	-	-	-	-	-	-	14	12	-	-	-	-	-	-	10	4	-	-	-	-	-	10	7.5	-	-	-	-	-	8	7.5	5	4	3	-	-						
	14	11.5	-	-	-	-	-	-	14	12	-	-	-	-	-	-	14	12	-	-	-	-	-	-	10.5	4	-	-	-	-	-	10.5	8	-	-	-	-	-	8	8	5	4	-	-							
15'-0"	14	-	-	-	-	-	-	-	14	-	-	-	-	-	-	-	14	-	-	-	-	-	-	-	7.5	-	-	-	-	-	-	7.5	-	-	-	-	-	-	7.5	5.5	3.5	3	-	-							
	14	-	-	-	-	-	-	-	14	-	-	-	-	-	-	-	14	-	-	-	-	-	-	-	9	-	-	-	-	-	-	9	-	-	-	-	-	-	8	7	4.5	3.5	3	-	-						
	14	-	-	-	-	-	-	-	14	-	-	-	-	-	-	-	14	-	-	-	-	-	-	-	10	-	-	-	-	-	-	10	-	-	-	-	-	-	8	7.5	5	4	-	-							
16'-0"	14	-	-	-	-	-	-	-	14	-	-	-	-	-	-	-	14	-	-	-	-	-	-	-	7	-	-	-	-	-	-	7	-	-	-	-	-	-	7	5.5	3.5	-	-	-							
	14	-	-	-	-	-	-	-	14	-	-	-	-	-	-	-	14	-	-	-	-	-	-	-	8	-	-	-	-	-	-	8	-	-	-	-	-	-	8	6.5	4	3.5	-	-							

FLORIDA BUILDING CODE (High Velocity Hurricane Zone)

© 2020 EASTERN METAL SUPPLY, INC.


BERTHA HV™

Accordion Shutter System

H.V. BLADE #1 W/ OR W/O H.V. WINDOW BLADE & H.V. BLADE #2			
REV.No	DESCRIPTION	DATE	DRAWN BY: Y.M.
1	OLD 20-189	7/21/23	DATE: 7/21/2023
2			DRAWING No 23-118
3			
4			
5			SHEET 13 OF 28
6			

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 26-0428.01
Expiration Date 07/07/31
By Hely A. McW
Miami Dept Product Control

MIAMI-DADE COUNTY

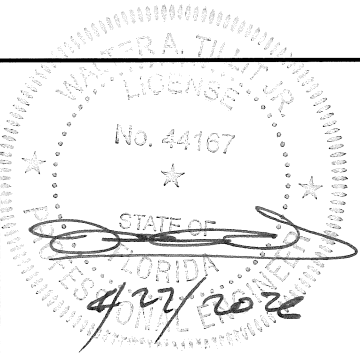

P.E. SEAL/SIGNATURE/DATE

©2023 TILTECO, INC



TILLIT TESTING & ENGINEERING COMPANY

3355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FLORIDA 33166
Phone : (305)871-1530 . Fax : (305)871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr. P.E.
FLORIDA Lic. # 44167

RED OAKS SHUTTER, INC

(ASSA # 15)

221 S.W. 5th COURT
POMPAÑO BEACH, FL 33060
Phone: (954)782-9325

MAXIMUM ANCHOR* SPACING (in.) SCHEDULE FOR A GIVEN MAX. SHUTTER SPAN. A.S.D.
DESIGN NEGATIVE LOAD AND A CORRESPONDING MOUNTING TYPE FOR CONCRETE INSTALLATIONS

(SEE MOUNTINGS E, G, & H ON SHEETS 6 & 7)

MAXIMUM SPAN (ft)	POURED CONCRETE																							
	Ⓔ WALL SILL MOUNTING								Ⓖ CEILING MOUNTING								Ⓕ FLOOR MOUNTING							
	A.S.D. DESIGN NEGATIVE LOAD (psf)								A.S.D. DESIGN NEGATIVE LOAD (psf)								A.S.D. DESIGN NEGATIVE LOAD (psf)							
	30	40	60	75	90	120	160	205	30	40	60	75	90	120	160	205	30	40	60	75	90	120	160	205
3'-0" OR LESS	14	12	10	9	8	8	6	5.5	14	12	10	9	8	8	6	6	14	12	10	9	8	8	6	6
	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	14	12	10	9	8	8	6	6
	14	12	10	9	8	8	6	6	14	12	10	9	8	8	6	6	14	12	10	9	8	8	6	5
4'-0"	14	12	10	9	8	8	6	7	14	12	10	9	8	8	6	6	14	12	10	9	8	8	6	6
	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	14	12	10	9	8	8	6	5.5
	14	12	10	9	8	8	6	4	14	12	10	9	8	8	6	4.5	14	12	10	9	8	8	6	4.5
5'-0"	14	12	10	9	8	8	6	4.5	14	12	10	9	8	8	6	5.5	14	12	10	9	8	8	6	4.5
	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	14	12	10	9	8	8	6	4.5
	14	12	10	9	8	7.5	5.5	3.5	-	14	12	10	9	8	8	6	5	14	12	10	9	8	7	5.5
6'-0"	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	14	12	10	9	8	8	6	4.5
	14	12	10	9	8	7	4	-	14	12	10	9	8	6.5	5	3.5	14	12	10	8	6.5	5	3.5	3
	14	12	10	9	8	7.5	4.5	-	14	12	10	9	8	8	6	4.5	14	12	10	9	8	6	4.5	3.75
7'-0"	14	12	9.5	7.5	6.5	4.5	-	-	14	12	10	9	8	7.5	5.5	4	14	12	10	9	8	6	4.5	3.5
	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	14	12	10	9	8	6.5	5	3.5
	14	12	10	9	8	7.5	5.5	3	-	14	12	10	8.5	7	5.5	4	3	14	12	8	6.5	5.5	4	3
8'-0"	14	12	10	9	8	6	-	-	14	12	10	9	8	6.5	5	3.75	14	12	10	8.5	8	5	4	-
	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	14	12	10	8	7	5	3.5	3
	14	12	8	6.5	5.5	3	-	-	14	12	10	9	8	6.5	4.5	3.5	14	12	10	8	7	5	3.5	3
9'-0"	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	14	12	10	9	7.5	5.5	4	-
	14	12	10	8.5	7	4	-	-	14	12	10	9	7.5	5.5	4	-	14	12	9	7	7.5	4.5	-	-
	14	11	7	5.5	4.5	-	-	-	14	12	10	9	7.5	5.5	4	-	14	12	9	7	6	4.5	3	-
10'-0"	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	14	12	10	8	6.5	5	3.5	-
	14	12	8.5	7	5.5	3	-	-	14	12	8	6.5	5.5	4	3	-	12.5	9.5	6	5	4	3	-	-
	14	12	9.5	7.5	6	-	-	-	14	12	9.5	8	6.5	5	-	-	14	12	8	6	6.5	4	-	-
11'-0"	13	9.5	6.5	5	3.5	-	-	-	14	12	10	8	6.5	5	-	-	14	12	8	6.5	5	4	-	-
	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	14	12	8.5	7	5.5	4	-	-
	14	11.5	7.5	6	4	-	-	-	14	11	7	5.5	5	3.5	-	-	11	8	5.5	4.5	3.5	-	-	-
12'-0"	14	12	8	6.5	4.5	-	-	-	14	12	8.5	7	5.5	4	-	-	14	10.5	7	5.5	6	4.5	-	-
	-	-	-	-	-	-	-	-	14	12	9	7	6	4.5	-	-	14	11	7	5.5	4.5	3.5	-	-
	14	10.5	7	5	3.5	-	-	-	13	9.5	6.5	5	4	3	-	-	10	7.5	5	4	3	-	-	-
13'-0"	14	11	7.5	5.5	-	-	-	-	14	11.5	9	6	5	4	-	-	12.5	9.5	6	5	4	4	-	-
	10.5	8	5	-	-	-	-	-	14	12	8	6.5	5.5	4	-	-	13	10	6.5	5	4	3	-	-
	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	14	10.5	7	5.5	4.5	3.5	-	-
14'-0"	12.5	9.5	5	-	-	-	-	-	12	9	6	4.5	4	3	-	-	9	7	4.5	3.5	3	-	-	-
	14	10	7	-	-	-	-	-	14	10.5	7	5.5	4.5	-	-	-	11.5	8.5	5.5	4.5	3.75	-	-	-
	9.5	7	4.5	-	-	-	-	-	14	11.5	7.5	6	5	-	-	-	12	9	6	4.5	4	-	-	-
15'-0"	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	13	10	6.5	5	4	-	-	-
	11.5	8.5	4.5	-	-	-	-	-	11	8	5.5	4	3.5	-	-	-	8	6	4	3	-	-	-	-
	13.5	9.5	6	-	-	-	-	-	13	9.5	6.5	5	4	-	-	-	10.5	8	5	4	-	-	-	-
16'-0"	9	6.5	-	-	-	-	-	-	14	10.5	7	5.5	4.5	-	-	-	11	8.5	5.5	4.5	3.5	-	-	-
	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	12	9	6	4.5	4	-	-	-
	10.5	8	-	-	-	-	-	-	10	7.5	5	4	3	-	-	-	7.5	5.5	4	3	-	-	-	-
17'-0"	12.5	8.5	-	-	-	-	-	-	12	9	6	4.5	4	-	-	-	9.5	7	5	4	-	-	-	-
	8	6	-	-	-	-	-	-	13	9.5	6.5	5	-	-	-	-	10.5	7.5	5	4	-	-	-	-
	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	11	8.5	5.5	4.5	-	-	-	-
18'-0"	10	7.5	-	-	-	-	-	-	9	7	4.5	3.5	-	-	-	-	7	5	3.5	3	-	-	-	-
	11.5	8	-	-	-	-	-	-	11	8	5.5	4.5	-	-	-	-	9	6.5	4.5	-	-	-	-	-
	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
19'-0"	7.5	-	-	-	-	-	-	-	12	9	6	-	-	-	-	-	9.5	7	4.5	-	-	-	-	-
	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	10.5	8	5	-	-	-	-	-
	9	-	-	-	-	-	-	-	8.5	6.5	4	-	-	-	-	-	6.5	5	3	-	-	-	-	-
20'-0"	10	-	-	-	-	-	-	-	10.5	8	5	-	-	-	-	-	8.5	6	4	-	-	-	-	-
	7	-	-	-	-	-	-	-	11.5	8.5	5.5	-	-	-	-	-	9	6.5	4.5	-	-	-	-	-
	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	10	7.5	5	-	-	-	-	-
21'-0"	8	-	-	-	-	-	-	-	8	6	4	-	-	-	-	-	6	4.5	3	-	-	-	-	-
	9.5	-	-	-	-	-	-	-	9.5	7	5	-	-	-	-	-	8	6	4	-	-	-	-	-
	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-

MAXIMUM ANCHOR* SPACING (in.) SCHEDULE FOR A GIVEN MAX. SHUTTER SPAN, A.S.D.
DESIGN NEGATIVE LOAD AND A CORRESPONDING MOUNTING TYPE FOR CONCRETE INSTALLATIONS
(SEE MOUNTINGS I, J, K & L ON SHEET 7)

MAXIMUM SPAN (ft)	POURED CONCRETE																																									
	(I) WALK OVER & (H) TRENCH MOUNTINGS								(J) RAINGUARD MOUNTING								(K) WALL/FLOOR MOUNTING								(L) WALL/WALK OVER MOUNTING																	
	A.S.D.DESIGN NEGATIVE LOAD (psf)								A.S.D.DESIGN NEGATIVE LOAD (psf)								A.S.D.DESIGN NEGATIVE LOAD (psf)								A.S.D.DESIGN NEGATIVE LOAD (psf)																	
	30	40	60	75	90	120	160	205	30	40	60	75	90	120	160	205	30	40	60	75	90	120	160	205	30	40	60	75	90	120	160	205										
3'-0" OR LESS	14	12	10	9	8	8	6	6	12	12	12	12	12	11.5	8.5	6.5	7	7	7	7	7	7	7	5.5	5	5	5	5	5	5	5	5	5	5	5							
	14	12	10	9	8	8	6	6	12	12	12	12	12	12	9.5	7	7	7	7	7	7	7	7	7	5	5	5	5	5	5	5	5	5	5	5	5						
	14	12	10	9	8	8	6	6	12	12	12	12	12	10.5	8	6	4.5	7	7	7	7	7	7	6.5	5	5	5	5	5	5	5	5	5	5	5	5	5					
4'-0"	14	12	10	9	8	8	6	6	12	12	12	12	12	11.5	8.5	6.5	5	7	7	7	7	7	7	5.5	4	5	5	5	5	5	5	5	5	5	5	5	5	5				
	14	12	10	9	8	8	6	6	12	12	12	12	12	9.5	7	5.5	7	7	7	7	7	7	7	7	5	5	5	5	5	5	5	5	5	5	5	5	5	5				
	14	12	10	9	8	8	6	6	12	12	12	12	10	7.5	5.5	4	7	7	7	7	7	7	7	5.5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5			
5'-0"	14	12	10	9	8	8	6	6	12	12	12	11	9	7	5	4	7	7	7	7	7	7	5.5	4	3	5	5	5	5	5	5	5	5	5	5	5	5	5	5			
	14	12	10	9	8	8	6	6	12	12	12	12	10	7.5	5.5	4	7	7	7	7	7	7	7	7	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5			
	14	12	10	9	8	8	6	6	12	12	9.5	7.5	6	4.5	3.5	-	7	7	7	7	7	7	7	5	3.5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5		
6'-0"	14	12	10	9	8	8	6	6	12	12	11.5	9	7.5	5.5	4	3	7	7	7	7	7	7	4.5	3.5	-	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	
	14	12	10	9	8	8	6	6	12	12	12	10	8	6	4.5	3.5	7	7	7	7	7	7	7	7	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5		
	14	12	10	9	8	8	6	6	12	12	8	6	5	4	3	-	7	7	7	7	7	7	5.5	4	-	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	
7'-0"	14	12	10	9	8	8	6	6	12	12	10	8	6.5	5	3.75	-	7	7	7	7	7	7	6	4.5	-	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	
	14	12	10	9	8	8	6	6	12	12	12	8.5	7	5	4	3	7	7	7	7	7	7	7	6	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5		
	14	12	10	9	8	8	6	6	12	10	6.5	5	4.5	3	-	-	7	7	7	7	7	6.5	5	3	-	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	
8'-0"	14	12	10	9	8	8	6	6	12	12	8.5	7	5.5	4	3	-	7	7	7	7	7	7	6	4.5	-	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	
	14	12	10	9	8	8	6	-	12	12	8.5	7	5.5	4	3	-	7	7	7	7	5.5	4.5	3	-	-	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	
	14	12	10	9	8	8	6	-	12	12	10.5	7.5	6	4.5	3.5	-	7	7	7	7	7	7	7	4	-	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	
9'-0"	14	12	10	9	8	8	-	-	12	11.5	7.5	6	5	3.5	-	-	7	7	6.5	5	4	-	-	-	-	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	
	14	12	10	9	8	8	-	-	12	12	9.5	6.5	5.5	4	3	-	7	7	7	7	7	7	6	3	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	
	14	12	10	9	8	8	-	-	10.5	8	5	4	3.5	-	-	-	7	7	7	6	5	3.5	-	-	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	
10'-0"	14	12	10	9	8	8	-	-	12	10.5	7	5.5	4.5	3.5	-	-	7	7	5.5	4.5	3.5	-	-	-	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5
	14	12	10	9	8	8	-	-	12	11	8.5	6	5	3.5	-	-	7	7	7	7	7	7	4.5	-	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	
	14	12	10	9	8	8	-	-	9.5	7	4.5	3.5	3	-	-	-	7	7	7	5.5	4.5	-	-	-	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	
11'-0"	14	12	10	9	8	8	-	-	12	9	6	5	4	3	-	-	7	7	7	6	5	4	-	-	-	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	
	14	12	10	9	8	8	-	-	12	9.5	6	5	4	3	-	-	7	7	5	4	3	-	-	-	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	
	14	12	10	9	8	8	-	-	12	10	7	5.5	4.5	3.5	-	-	7	7	7	7	7	7	3.5	-	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	
12'-0"	14	12	10	9	8	8	-	-	11	8	5.5	4	3	-	-	-	7	7	7	5.5	4.5	-	-	-	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	
	14	12	10	9	8	8	-	-	12	9.5	6.5	5	4	3	-	-	7	7	7	7	7	6	3	-	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	
	14	12	10	9	8	8	-	-	10	7.5	5	4	3	-	-	-	7	7	6	5	4	3	-	-	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	
13'-0"	14	12	10	9	8	8	-	-	11.5	8.5	5.5	4.5	3.5	-	-	-	7	7	4.5	3.5	-	-	-	-	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	
	14	12	10	9	8	8	-	-	12	9.5	6.5	5	4	3	-	-	7	7	7	7	7	6	3	-	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	
	14	12	10	9	8	8	-	-	10	7.5	5	4	3	-	-	-	7	7	5	4	3	-	-	-	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	
14'-0"	14	12	10	9	8	8	-	-	10.5	8	5	4	3.5	-	-	-	7	6.5	4.5	3.5	-	-	-	-	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	
	14	12	10	9	8	8	-	-	9	7	4.5	3.75	-	-	-	-	7	7	5.5	4.5	-	-	-	-	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	
	14	12	10	9	8	8	-	-	10	7.5	5	4	3	-	-	-	7	6	4	3	-	-	-	-	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	
15'-0"	14	12	10	9	8	8	-	-	10.5	8	5.5	4	3.5	-	-	-	7	7	5	4	3	-	-	-	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	
	14	12	10	9	8	8	-	-	10	7.5	5	4	3	-	-	-	7	7	5	4	3	-	-	-	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	
	14	12	10	9	8	8	-	-	10.5	8	5.5	4	3.5	-	-	-	7	7	7	7	7	4	-	-	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	
16'-0"	14	12	10	9	8	8	-	-	8.5	6.5	4	3	-	-	-	-	7	7	5	4	3	-	-	-	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	
	14	12	10	9	8	8	-	-	9	7	4.5	3.5	3	-	-	-	7	5.5	3.5	-	-	-	-	-	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	
	14	12	10	9	8	8	-	-	10	7.5	5	4	3	-	-	-	7	7	7	7	7	3.5	-	-	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	
17'-0"	14	12	10	9	8	8	-	-	8.5	6.5	4	3	-	-	-	-	7	7	5	4	3	-	-	-	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	
	14	12	10	9	8	8	-	-	9	7	4.5	3.5	3	-	-	-	7	7	5	4	3	-	-</																			

MAXIMUM ANCHOR* SPACING (in.) SCHEDULE FOR A GIVEN MAX. SHUTTER SPAN.
DESIGN NEGATIVE LOAD AND A CORRESPONDING MOUNTING TYPE FOR CONCRETE BLOCK INSTALLATIONS
(SEE MOUNTINGS A, B, C, D AND F ON SHEET 6)

MAXIMUM SPAN (ft)	CONCRETE BLOCK																																																
	① WALL SILL MOUNTING W/ ⑫								① WALL SILL MOUNTING W/ ⑭								③ WALL SILL MOUNTING								③ & ⑥ WALL HEADER/SILL MOUNTING								⑤ WALL/FLOOR MOUNTING								⑦ WALL/WALK OVER MOUNTING								
	A.S.D. DESIGN NEGATIVE LOAD (psf)								A.S.D. DESIGN NEGATIVE LOAD (psf)								A.S.D. DESIGN NEGATIVE LOAD (psf)								A.S.D. DESIGN NEGATIVE LOAD (psf)								A.S.D. DESIGN NEGATIVE LOAD (psf)								A.S.D. DESIGN NEGATIVE LOAD (psf)								
	30	40	60	75	90	120	160	205	30	40	60	75	90	120	160	205	30	40	60	75	90	120	160	205	30	40	60	75	90	120	160	205	30	40	60	75	90	120	160	205									
3'-0" OR LESS	14	12	10	9	8	7.5	-	-	14	12	10	9	8	7.5	4	4	14	12	10	9	8	7.5	5.5	4.5	8	8	8	8	8	7.5	5.5	4.5	14	12	10	9	8	7.5	5.5	-	14	12	10	9	8	7.5	5.5	-	
	14	12	10	9	8	8	6	-	14	12	10	9	8	8	6	6	14	12	10	9	8	8	6	3.5	8	8	8	8	8	8	7.5	6	14	12	10	9	8	8	6	3	14	12	10	9	8	8	6	6	
	14	12	10	9	8	8	6	-	14	12	10	9	8	8	6	6	14	12	10	9	8	8	6	7	8	8	8	8	8	8	8	7	14	12	10	9	8	8	6	-	14	12	10	9	8	8	6	6	
4'-0"	14	12	10	9	7.5	5.5	-	-	14	12	10	9	7.5	5.5	-	-	14	12	10	9	8	7.5	5.5	4	-	8	8	8	8	7.5	5.5	4	-	14	12	10	9	7.5	5.5	-	-	14	12	10	9	7.5	5.5	4	-
	14	12	10	9	8	7.5	-	-	14	12	10	9	8	7.5	5	-	14	12	10	9	8	7.5	5.5	-	8	8	8	8	8	7.5	5.5	4.5	14	12	10	9	8	7.5	-	-	14	12	10	9	8	7.5	6	-	
	14	12	10	9	8	8	-	-	14	12	10	9	8	8	6	-	14	12	10	9	8	8	6	4.5	8	8	8	8	8	8	7	5.5	14	12	10	9	8	8	-	-	14	12	10	9	8	8	6	-	
5'-0"	14	12	9	7.5	6	-	-	-	14	12	9	7.5	6	4.5	-	-	14	12	9	7.5	6	4.5	-	-	8	8	8	7.5	6	4.5	-	-	14	12	9	7.5	6	-	-	-	14	12	9	7.5	6	4.5	-	-	
	14	12	10	9	8	-	-	-	14	12	10	9	8	6	-	-	14	12	10	9	8	6	4	-	8	8	8	8	8	6	4.5	3.5	14	12	10	9	8	6	-	-	14	12	10	9	8	6	-	-	
	14	12	10	9	8	-	-	-	14	12	10	9	8	7.5	-	-	14	12	10	9	8	7.5	4.5	-	8	8	8	8	8	7.5	5.5	4	14	12	10	9	8	-	-	14	12	10	9	8	7.5	-	-		
6'-0"	14	11.5	7.5	6	-	-	-	-	14	11.5	7.5	6	5	-	-	-	14	11.5	7.5	6	5	-	-	-	8	8	7.5	6	5	-	-	-	14	11.5	7.5	6	4	-	-	-	14	11.5	7.5	6	5	-	-	-	
	14	12	10	8	4	-	-	-	14	12	10	8	7	4	-	-	14	12	10	8	7	5	-	-	8	8	8	8	7	5	3.5	-	14	12	10	8	4.5	-	-	-	14	12	10	8	7	4	-	-	
	14	12	10	9	5	-	-	-	14	12	10	9	8	4.5	-	-	14	12	10	9	8	4.5	-	-	8	8	8	8	8	6	4.5	-	14	12	10	9	5	-	-	-	14	12	10	9	8	4.5	-	-	
7'-0"	13.5	10	6.5	-	-	-	-	-	13.5	10	6.5	5	4.5	-	-	-	13.5	10	6.5	5	4.5	-	-	-	8	8	6.5	5	4.5	-	-	-	13.5	10	6.5	5	-	-	-	-	13.5	10	6.5	5	4.5	-	-	-	
	14	12	9	5	-	-	-	-	14	12	9	7	6	-	-	-	14	12	9	7	6	3.5	-	-	8	8	8	7	6	4.5	-	-	14	12	9	7	-	-	-	14	12	9	7	6	-	-	-		
	14	12	10	6	-	-	-	-	14	12	10	8.5	7	-	-	-	14	12	10	8.5	7	4	-	-	8	8	8	8	7	5	4	-	14	12	10	6	-	-	-	-	14	12	10	8.5	7	-	-	-	
8'-0"	11.5	8.5	5	-	-	-	-	-	11.5	8.5	5.5	4.5	-	-	-	-	11.5	8.5	5.5	4.5	-	-	-	-	8	8	5.5	4.5	-	-	-	-	11.5	8.5	5.5	-	-	-	-	-	11.5	8.5	5.5	4.5	-	-	-	-	
	14	11.5	7.5	-	-	-	-	-	14	11.5	7.5	6	4	-	-	-	14	11.5	7.5	6	5	-	-	-	8	8	7.5	6	5	3.5	-	-	14	11.5	7.5	6	-	-	-	-	14	11.5	7.5	6	5	-	-	-	
	14	12	9.5	-	-	-	-	-	14	12	9.5	7.5	4.5	-	-	-	14	12	9.5	7.5	6	-	-	-	8	8	8	7.5	6	4.5	-	-	14	12	9.5	-	-	-	-	-	14	12	9.5	7.5	4.5	-	-	-	
9'-0"	10.5	7.5	-	-	-	-	-	-	10.5	7.5	5	4	-	-	-	-	10.5	7.5	5	4	-	-	-	-	8	7.5	5	4	-	-	-	-	10.5	7.5	5	-	-	-	-	-	10.5	7.5	5	4	-	-	-	-	
	14	10.5	4	-	-	-	-	-	14	10.5	7	5.5	-	-	-	-	14	10.5	7	5.5	3.5	-	-	-	8	8	7	5.5	4.5	3.5	-	-	14	10.5	7	-	-	-	-	-	14	10.5	7	5.5	-	-	-	-	
	14	12	5	-	-	-	-	-	14	12	8	6.5	-	-	-	-	14	12	8	6.5	4.5	-	-	-	8	8	8	6.5	5.5	4	-	-	14	12	5	-	-	-	-	-	14	12	8	6.5	-	-	-	-	
10'-0"	9	7	-	-	-	-	-	-	9	7	4.5	-	-	-	-	-	9	7	4.5	-	-	-	-	-	8	7	4.5	-	-	-	-	-	9	7	-	-	-	-	-	-	9	7	4.5	-	-	-	-	-	
	12.5	9	-	-	-	-	-	-	12.5	9	6	-	-	-	-	-	12.5	9	6	4.5	-	-	-	-	8	8	6	5	4	-	-	-	12.5	9.5	3	-	-	-	-	-	12.5	9.5	6	3.5	-	-	-	-	
	14	11	-	-	-	-	-	-	14	11	7.5	-	-	-	-	-	14	11	7.5	5.5	-	-	-	-	8	8	7.5	6	5	-	-	-	14	11	-	-	-	-	-	-	14	11	7.5	-	-	-	-	-	
11'-0"	8.5	6	-	-	-	-	-	-	8.5	6	4	-	-	-	-	-	8.5	6	4	-	-	-	-	-	8	6	4	-	-	-	-	-	8.5	6.44	-	-	-	-	-	-	8.5	6	4	-	-	-	-	-	
	11	8.5	-	-	-	-	-	-	11.5	8.5	5.5	-	-	-	-	-	11	8.5	5.5	3.5	-	-	-	-	8	8	5.5	4.5	3.5	-	-	-	11.5	8.5	-	-	-	-	-	-	11.5	8.5	5.5	-	-	-	-	-	
	13.5	10	-	-	-	-	-	-	14	10	7	-	-	-	-	-	14	10	7	-	-	-	-	-	8	8	7	5.5	4.5	-	-	-	13.5	10	-	-	-	-	-	-	14	10	7	-	-	-	-	-	
12'-0"	7.5	5.5	-	-	-	-	-	-	7.5	5.5	-	-	-	-	-	-	7.5	5.5	-	-	-	-	-	-	7.5	5.5	-	-	-	-	-	-	7.5	5.5	-	-	-	-	-	-	7.5	5.5	-	-	-	-	-	-	
	10.5	7.5	-	-	-	-	-	-	10.5	7.5	4	-	-	-	-	-	10.5	7.5	5	-	-	-	-	-	8	7.5	5	4	3.5	-	-	-	10.5	7.5	-	-	-	-	-	-	10.5	7.5	5	-	-	-	-	-	
	12.5	9.5	-	-	-	-	-	-	13.5	9.5	4.5	-	-	-	-	-	13.5	9.5	6	-	-	-	-	-	8	8	6	5	4	-	-	-	12.5	9.5	-	-	-	-	-	-	13.5	9.5	4.5	-	-	-	-	-	
13'-0"	7	-	-	-	-	-	-	-	7	5	-	-	-	-	-	-	9	6.5	-	-	-	-	-	-	7	5	-	-	-	-	-	-	7	4.5	-	-	-	-	-	-	7	5	-	-	-	-	-	-	
	9.5	5	-	-	-	-	-	-	9.5	7	-	-	-	-	-	-	10.5	8	-	-	-	-	-	-	8	7	4.5	3.5	-	-	-	-	9.5	5	-	-	-	-	-	-	9.5	7	-	-	-	-	-	-	
	11.5	6	-	-	-	-	-	-	11.5	8.5	-	-	-	-	-	-	12.5	8.5	-	-	-	-	-	-	8	8	5.5	4.5	-	-	-	-	11.5	6	-	-	-	-	-	-	11.5	8.5	-	-	-	-	-	-	
14'-0"	6.5	-	-	-	-	-	-	-	6.5	5	-	-	-	-	-	-	7	5.5	-	-	-	-	-	-	6.5	5	-	-	-	-	-	-	6.5	5	-	-	-	-	-	-	7	5	-	-	-	-	-	-	
	9	3.5	-	-	-	-	-	-	9	6.5	-	-	-	-	-	-	9.5	7	-	-	-	-	-	-	8	6.5	4.5	3.5	-	-	-	-	9	4	-	-	-	-	-	-	9	6.5	-	-	-	-	-	-	
	10.5	4	-	-	-	-	-	-	10.5	8	-	-	-	-	-	-	11.5	8	-	-	-	-	-	-	8	8	5	4	-	-	-	-	10.5	4	-	-	-	-	-	-	10.5	8	-	-	-	-	-	-	
15'-0"	6	-	-	-	-	-	-	-	6	-	-	-	-	-	-	-	6	-	-	-	-	-	-	-	6	4.5	-	-	-	-	-	-	6	-	-	-	-	-											

ANCHORS SPACING LEGEND

TAPCON WITH ADVANCED THREADFORM TECHNOLOGY
BLUE TAP
TAPPER+

* SEE ANCHOR
SPECIFICATIONS
ON SHEET 14

◆ SEE LIMITATIONS OF USE FOR
BLADE 1A ON SHEET 28

1 HV BLADE OR 1 HV BLADE
W/ 1A HV WINDOW BLADE
WORKING IN UNISON ◆

FLORIDA BUILDING CODE (High Velocity Hurricane Zone)

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 26-0428.01
Expiration Date 07/07/31
By *Walter A. Tillit Jr.*
Miami-Dade Product Control

MAXIMUM ANCHOR⁺ SPACING (in.) SCHEDULE FOR A GIVEN MAX. SHUTTER SPAN,
NEGATIVE A.S.D. DESIGN LOAD AND A CORRESPONDING MOUNTING TYPE
(SEE MOUNTINGS ON SHEETS 18 & 19)

MAXIMUM SPAN (ft)	SUBSTRATE																																										
	SOUTHERN PINE No. 2 W/ MIN. G=0.55, DOUGLAS FIR W/ MIN. G=0.50												SPRUCE PINE FIR NORTH W/ MIN. G=0.43												SPRUCE PINE FIR SOUTH W/ MIN. G=0.36												1/2" MIN. CDX PLYWOOD						
	WALL MOUNTINGS M, N, O & R						CEILING MOUNT T FLOOR MOUNTINGS W & X						WALL MOUNTINGS M, N, O & R						CEILING MOUNT T FLOOR MOUNTINGS W & X						WALL MOUNTINGS M, N, O & R						CEILING MOUNT T FLOOR MOUNTINGS W & X						WALL MOUNTINGS P & Q						
	NEGATIVE A.S.D. DESIGN LOAD (psf)						NEGATIVE A.S.D. DESIGN LOAD (psf)						NEGATIVE A.S.D. DESIGN LOAD (psf)						NEGATIVE A.S.D. DESIGN LOAD (psf)						NEGATIVE A.S.D. DESIGN LOAD (psf)						NEGATIVE A.S.D. DESIGN LOAD (psf)						NEGATIVE A.S.D. DESIGN LOAD (psf)						
	30	40	60	75	90	105	30	40	60	75	90	105	30	40	60	75	90	105	30	40	60	75	90	105	30	40	60	75	90	105	30	40	60	75	90	105	30	40	60	75	90	105	
3'-0" OR LESS	12	10	10	9	8	8	6	6	6	6	6	5	12	10	10	9	8	8	6	6	6	6	5	4	12	10	10	9	8	8	6	6	6	4.5	4	3	6	5	4	4	4	4	3
4'-0"	12	10	10	9	8	8	6	6	6	5	4.5	4	12	10	10	9	8	8	6	6	5.5	4.5	3.5	3	12	10	10	9	8	8	6	6	4.5	3.5	3	2.5	6	5	4	4	4	4	3
5'-0"	12	10	10	9	8	8	6	6	5	4	3.5	3	12	10	10	9	8	8	6	6	4.5	3.5	3	2.5	12	10	10	9	8	7	6	5.5	3.5	3	2	2	6	5	4	4	4	4	3
6'-0"	12	10	10	9	8	6.5	6	6	4.5	3.5	3	2.5	12	10	10	9	8	4.5	6	5.5	3.5	3	2.5	2	12	10	10	9	6	3	6	4.5	3	2	2	-	6	5	4	4	3.5	-	
7'-0"	12	10	10	9	6.5	4	6	5.5	4	3	2.5	2	12	10	10	9	4.5	3	6	5	3	2.5	2	-	12	10	10	7	3	-	5	4	2.5	2	-	-	6	5	4	4	-	-	
8'-0"	12	10	10	7.5	4.5	3	6	5	3	2.5	2	2	12	10	10	5.5	3	-	5.5	4	2.5	2	2	-	12	10	10	4	-	-	4.5	3	2	-	-	-	6	5	4	-	-	-	
9'-0"	12	10	10	5	3.5	-	6	4.5	3	2	2	-	12	10	8.5	4	-	-	5	3.5	2.5	2	-	-	12	10	4	2.5	-	-	4	3	2	-	-	-	6	5	3.5	-	-	-	
10'-0"	12	10	7.5	4	-	-	5	4	2.5	2	-	-	12	10	5.5	3	-	-	4.5	3	2	-	-	-	12	10	3	-	-	-	3.5	2.5	-	-	-	-	6	5	-	-	-	-	
11'-0"	12	10	5.5	-	-	-	5	3.5	2	-	-	-	12	10	4	-	-	-	4	3	2	-	-	-	12	10	-	-	-	-	3	2.5	-	-	-	-	6	5	-	-	-	-	
12'-0"	12	10	4.5	-	-	-	4.5	3	2	-	-	-	12	10	3	-	-	-	3.5	2.5	-	-	-	-	12	10	-	-	-	-	3	2	-	-	-	-	6	5	-	-	-	-	
13'-0"	12	10	-	-	-	-	4	3	-	-	-	-	12	10	-	-	-	-	3.5	2.5	-	-	-	-	12	7	-	-	-	-	2.5	2	-	-	-	-	6	4	-	-	-	-	
14'-0"	12	10	-	-	-	-	4	3	-	-	-	-	12	7	-	-	-	-	3	2	-	-	-	-	12	5	-	-	-	-	2.5	2	-	-	-	-	6	3	-	-	-	-	
15'-0"	12	-	-	-	-	-	3.5	-	-	-	-	-	12	-	-	-	-	-	3	-	-	-	-	-	11.5	-	-	-	-	-	2	-	-	-	-	-	6	-	-	-	-	-	
16'-0"	12	-	-	-	-	-	3	-	-	-	-	-	12	-	-	-	-	-	2.5	-	-	-	-	-	11	-	-	-	-	-	2	-	-	-	-	-	6	-	-	-	-	-	

+ NOTES ON ANCHORS REQUIREMENTS: WOOD SUBSTRATES.

1. ANCHORS TO WALL, FLOOR OR SOLID WOOD SOFFIT SHALL BE AS FOLLOWS:

- 1/4"Ø TAPCON OR TAPCON WITH ADVANCED THREADFORM TECHNOLOGY ANCHORS, AS MANUFACTURED BY I.T.W. BUILDDEX W/ MINIMUM THREADED PENETRATION AS INDICATED AT EACH SECTION ON SHEETS 18 & 19. EXCEPTION: SEE NOTE 2 BELOW.

2. ANCHORS TO HOLLOW CEILING SHALL BE AS PER MOUNTING TYPE U, SHEET 19 AND SHALL CONSIST OF LAG SCREWS AS PER N.D.S. 2018 SPECIFICATIONS.

3. SUBSTRATE SHALL CONSIST OF THE FOLLOWING:

-SOUTHERN PINE No. 2 W/ G=0.55 (N.D.S.)
-DOUGLAS FIR W/ G=0.50 (N.D.S.)
-SPRUCE PINE FIR NORTH W/ G=0.43 (N.D.S.)
-SPRUCE PINE FIR SOUTH W/ G=0.36 (N.D.S.)
-MIN. 1/2" CDX PLYWOOD (1986 APA)

4. ANCHORS SHALL BE INSTALLED FOLLOWING ALL OF THE RECOMMENDATIONS AND SPECIFICATIONS OF THE ANCHOR'S MANUFACTURER.

① HV BLADE OR ① HV BLADE W/
①A HV WINDOW BLADE WORKING IN UNISON ♦

♦ SEE LIMITATIONS OF USE OF
BLADE ①A ON SHEET 28


FLORIDA BUILDING CODE (High Velocity Hurricane Zone)

© 2020 EASTERN METAL SUPPLY, INC.

BERTHA HV™ Accordion Shutter System				
H.V. BLADE #1 W/ OR W/O H.V. WINDOW BLADE & H.V. BLADE #2				
REV.No	DESCRIPTION	DATE	DRAWN BY:	Y.M.
1	OLD 20-189	7/21/23	DATE:	7/21/2023
2				
3				
4				
5				
6				
DRAWING No				23-118
SHEET				16 OF 28

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 26-0428.01
Expiration Date 07/07/31
By *Heidi A. Miller*
Miami Dade Product Control!

MIAMI-DADE COUNTY

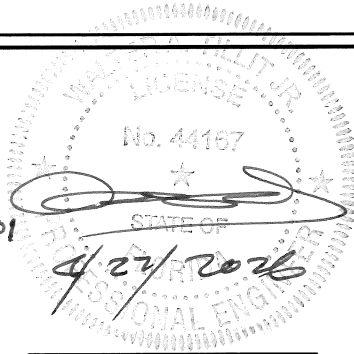

P.E. SEAL/SIGNATURE/DATE

©2023 TILTECO, INC



TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FLORIDA 33166
Phone : (305)871-1530 . Fax : (305)871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr. P.E.
FLORIDA Lic. # 44167

RED OAKS
SHUTTER, INC

(ASSA # 15)

221 S.W. 5th COURT
POMPANO BEACH, FL 33060
Phone: (954)782-9325

MAXIMUM ANCHOR + SPACING (in.) SCHEDULE FOR A GIVEN MAX. SHUTTER SPAN, NEGATIVE A.S.D. DESIGN LOAD AND A CORRESPONDING MOUNTING TYPE
(SEE MOUNTINGS ON SHEET 19)

MAXIMUM SPAN (ft)	SUBSTRATE																	
	SOUTHERN PINE No. 2 W/ MIN. G=0.55, DOUGLAS FIR W/ MIN. G=0.50						SPRUCE PINE FIR NORTH W/ MIN. G=0.43						SPRUCE PINE FIR SOUTH W/ MIN. G=0.36					
	B.O. WALL MOUNTINGS S & V						B.O. WALL MOUNTINGS S & V						B.O. WALL MOUNTINGS S & V					
	NEGATIVE A.S.D. DESIGN LOAD (psf)						NEGATIVE A.S.D. DESIGN LOAD (psf)						NEGATIVE A.S.D. DESIGN LOAD (psf)					
	30	40	60	75	90	105	30	40	60	75	90	105	30	40	60	75	90	105
3'-0" OR LESS	12	12	12	12	12	12	12	12	12	12	12	12	12	12	12	12	12	12
4'-0"	12	12	12	12	12	12	12	12	12	12	12	12	12	12	12	12	12	12
5'-0"	12	12	12	12	12	12	12	12	12	12	12	12	12	12	12	11.5	10	
6'-0"	12	12	12	12	12	12	12	12	12	12	12	12	12	12	12	11.5	9.5	8
7'-0"	12	12	12	12	12	12	12	12	12	12	12	10	12	12	12	10	8	8
8'-0"	12	12	12	12	12	12	12	12	12	12	10.5	9	12	12	11	8.5	7	7
9'-0"	12	12	12	12	12	10.5	12	12	12	11	9	8	12	12	9.5	7.5	6.5	6
10'-0"	12	12	12	12	11.5	9.5	12	12	12	10	8	7	12	12	8.5	7	6	5.5
11'-0"	12	12	12	12	10	8.5	12	12	11.5	9	7.5	6.5	12	12	8	6	5	5
12'-0"	12	12	12	11.5	9.5	8	12	12	10.5	8	7	6	12	11	7	6	5	4.5
13'-0"	12	12	12	10.5	8.5	7.5	12	12	9.5	7.5	6	5.5	12	10	6.5	5	4.5	4
14'-0"	12	12	12	9.5	8	6	12	12	9	7	6	4.5	12	9.5	6	5	4	3.5
15'-0"	12	12	11	9	7.5	5	12	12	8	6.5	5.5	3.5	11.5	8.5	6	4.5	4	3
16'-0"	12	12	10.5	8.5	6.5	4	11.5	12	8	6	4.5	3	11	8	5.5	4	3	-

+ NOTES ON ANCHORS REQUIREMENTS: WOOD SUBSTRATES.

1. ANCHORS TO WALL, FLOOR OR SOLID WOOD SOFFIT SHALL BE AS FOLLOWS:

- 1/4"Ø TAPCON OR TAPCON WITH ADVANCED THREADFORM TECHNOLOGY ANCHORS, AS MANUFACTURED BY I.T.W. BUILDEX W/ MINIMUM THREADED PENETRATION AS INDICATED AT EACH SECTION ON SHEETS 18 & 19. EXCEPTION: SEE NOTE 2 BELOW.
2. ANCHORS TO HOLLOW CEILING SHALL BE AS PER MOUNTING TYPE U, SHEET 19 AND SHALL CONSIST OF LAG SCREWS AS PER NDS 2018 SPECIFICATIONS.
3. SUBSTRATE SHALL CONSIST OF THE FOLLOWING:

-SOUTHERN PINE No. 2 W/ G=0.55 (N.D.S)
-DOUGLAS FIR W/ G=0.50 (N.D.S.)
-SPRUCE PINE FIR NORTH W/ G=0.43 (N.D.S.)
-SPRUCE PINE FIR SOUTH W/ G=0.36 (N.D.S.)
-MIN. 1/2" CDX PLYWOOD (1986 APA)
4. ANCHORS SHALL BE INSTALLED FOLLOWING ALL OF THE RECOMMENDATIONS AND SPECIFICATIONS OF THE ANCHOR'S MANUFACTURER.

① HV BLADE ONLY

FLORIDA BUILDING CODE (High Velocity Hurricane Zone)

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 26-0428.01
Expiration Date 07/07/31
By *Heidi A. Miller*
Miami-Dade Product Control

MIAMI-DADE COUNTY

WALTER A. TILLIT JR.
P.E. SEAL/SIGNATURE/DATE

©2023 TILTECO, INC

TILTECO INC.

TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FLORIDA 33166
Phone : (305)871-1530 . Fax : (305)871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr. P.E.
FLORIDA Lic. # 44167

RED OAKS SHUTTER, INC
(ASSA # 15)

221 S.W. 5th COURT
POMPANO BEACH, FL 33060
Phone: (954)782-9325

© 2020 EASTERN METAL SUPPLY, INC.


BERTHA HV™
Accordion Shutter System
H.V. BLADE #1 W/ OR W/O H.V. WINDOW BLADE & H.V. BLADE #2

REV.No	DESCRIPTION	DATE	DRAWN BY:	Y.M.
1	OLD 20-189	7/21/23	DATE:	7/21/2023
2				
3				
4				
5				
6				


DRAWING No
23-118
SHEET
17 OF 28

INSTALLATION DETAILS ON EXISTING WOOD BUILDINGS FOR ① HV & ①A HV◆ BLADES (AS APPLICABLE)


MAX. SHUTTER SPAN L+ OR L- FOR INSTALLATIONS INTO WOOD WITH HV BLADE (1)
ONLY SHALL BE LIMITED TO 105.0 psf. A.S.D. DESIGN LOAD, SEE SHEET 28 FOR MAX
SPAN & DESIGN LOAD FOR INSTALLATION WITH BLADE (1) & (1A) WORKING IN UNISON

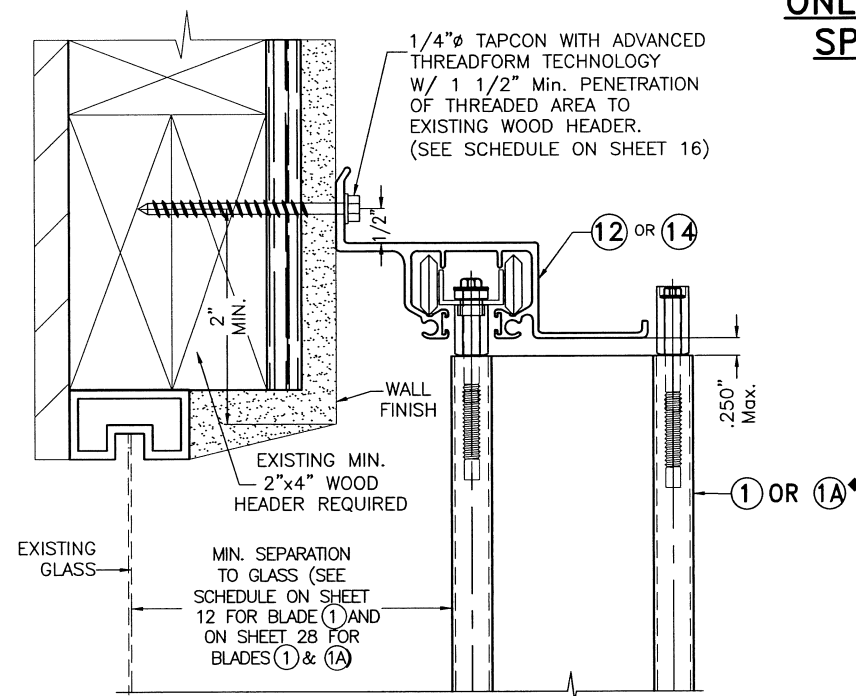


(M) HV WALL HEADER INSTALLATION

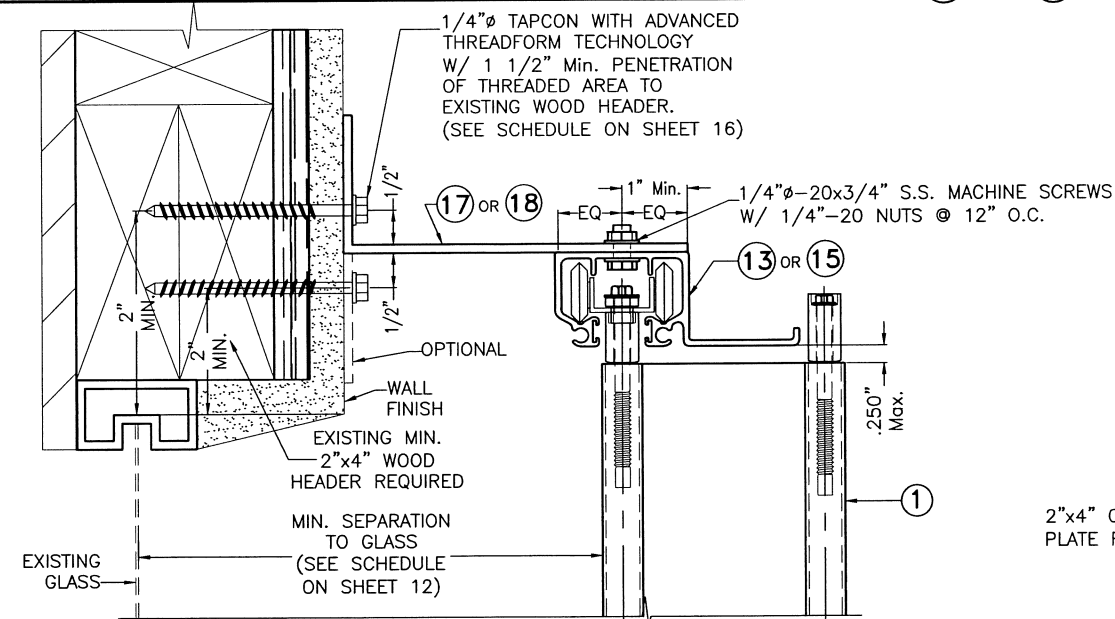


(N) HV WALL HEADER INSTALLATION

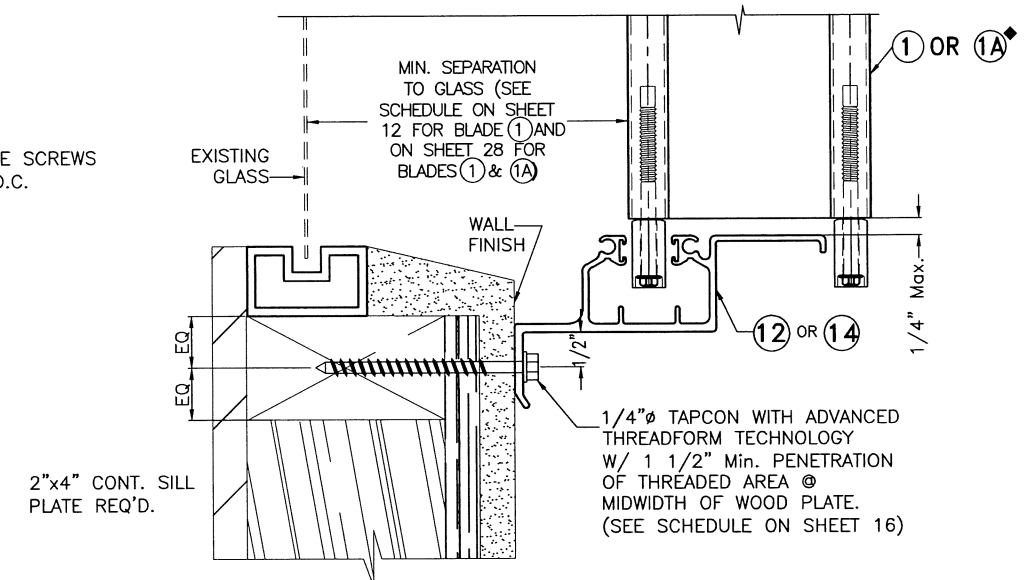

0 HV WALL SILL INSTALLATION

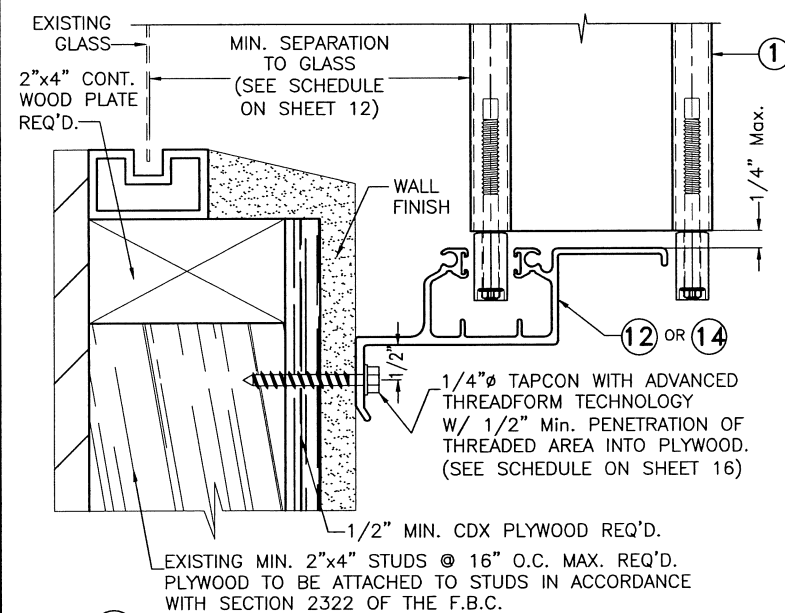


(P) HV WALL SILL INSTALLATION

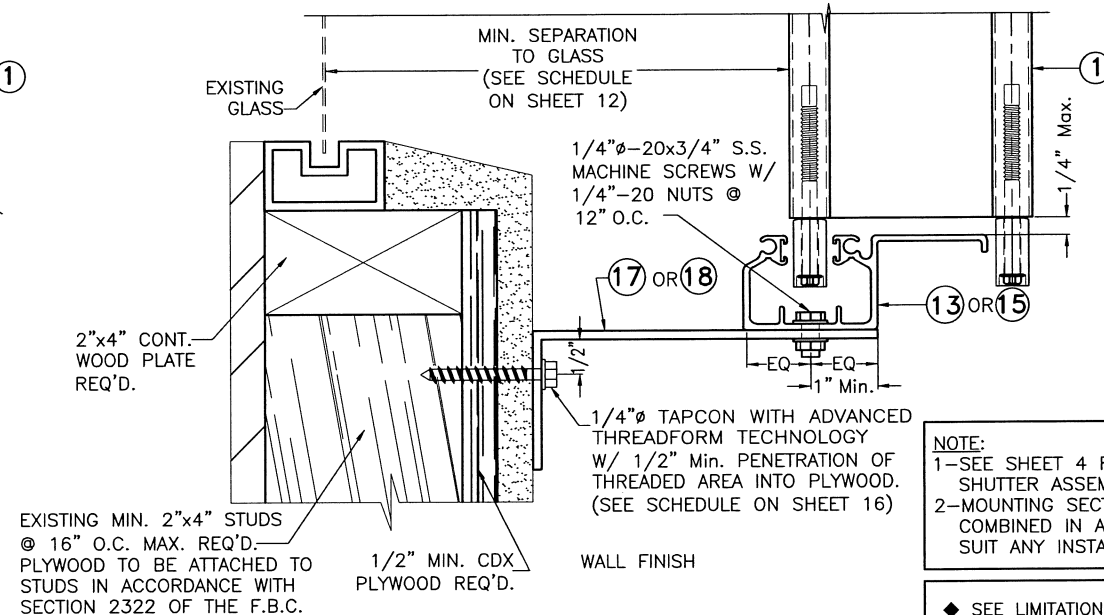

Q HV WALL SILL INSTALLATION

NOTE:
1—SEE SHEET 4 FOR TYPICAL SHUTTER ASSEMBLY.
2—MOUNTING SECTIONS CAN BE COMBINED IN ANY WAY TO SUIT ANY INSTALLATION.

◆ SEE LIMITATIONS OF USE OF
BLADE (1A) ON SHEET 28

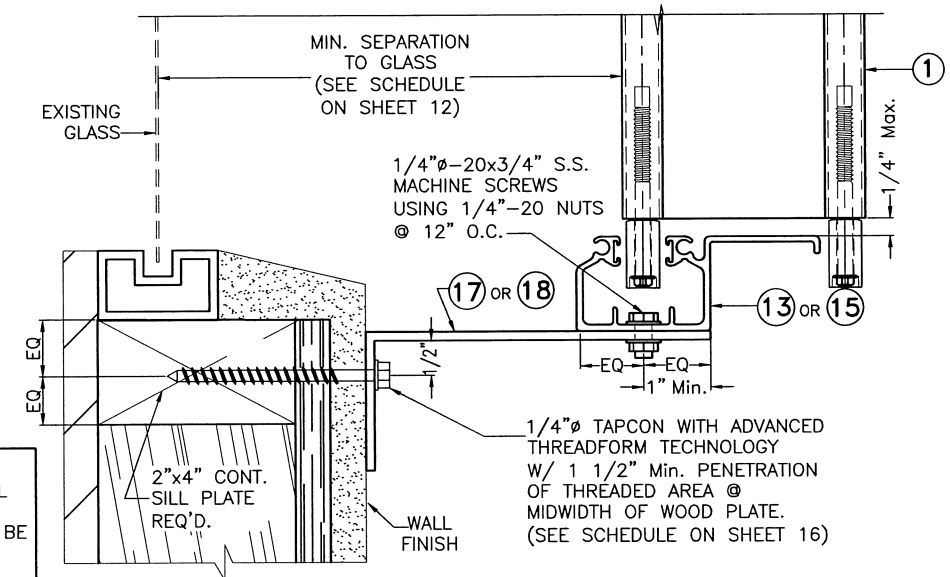

Ⓡ HV WALL SILL INSTALLATION

FLORIDA BUILDING CODE (High Velocity Hurricane Zone)

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 26-0428.01
Expiration Date 07/07/31
By Healy A. Mohr
Miami Dept Product Control

MIAMI-DADE COUNTY

No. 44167

STATE OF

4/27/2020

P.E. SEAL/SIGNATURE/DATE

©2023 TILTECO, INC



TILTECO INC.

TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FLORIDA 33166
Phone : (305)871-1530 . Fax : (305)871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr. P.E.
FLORIDA Lic. # 44167

**RED OAKS
SHUTTER, INC**

(ASSA # 15)

221 S.W. 5th COURT
POMPANO BEACH, FL 33060
Phone: (954)782-9325

© 2020 EASTERN METAL SUPPLY, INC.

BERTHA HV™ Accordian Shutter System

H.V. BLADE #1 W/ OR W/O H.V. WINDOW BLADE & H.V. BLADE #2

REV. No	DESCRIPTION	DATE	DRAWN BY: Y.M.
1	OLD 20-189	7/21/23	DATE: 7/21/2023
2			DRAWING No 23-118
3			
4			
5			SHEET 18 OF 28
6			

MAX. SHUTTER SPAN L+ OR L- FOR INSTALLATIONS INTO WOOD WITH HV BLADE (1)
ONLY SHALL BE LIMITED TO 105.0 psf. A.S.D. DESIGN LOAD, SEE SHEET 28 FOR MAX
SPAN & DESIGN LOAD FOR INSTALLATION WITH BLADE (1) & (1A) WORKING IN UNISON




4"x8" (Min.) EXISTING —
WOOD BEAM REQUIRED.
STRUCTURAL ADEQUACY
OF EXISTING WOOD BEAM
TO BE CERTIFIED BY
REGISTERED ENGINEER OR
ARCHITECT PRIOR TO
SHUTTER INSTALLATION.




FLORIDA BUILDING CODE (High Velocity Hurricane Zone)

REV.No	DESCRIPTION	DATE	DRAWN BY:	Y.M.
1	OLD 20-189	7/21/23	DATE:	7/21/2023
2			DRAWING No 23-118	
3				
4				
5			SHEET 19 OF 28	
6				


END INSTALLATIONS ① HV & ①A HV ♦ BLADES INTO 2"x4" MIN. WOOD STUDS.

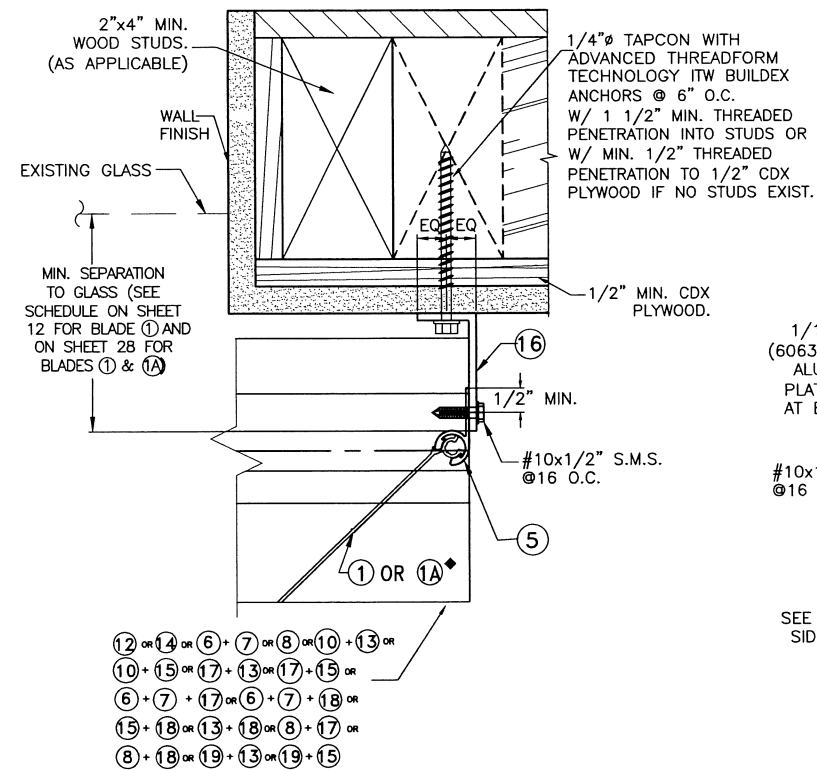


END CONNECTION DETAIL ⑦

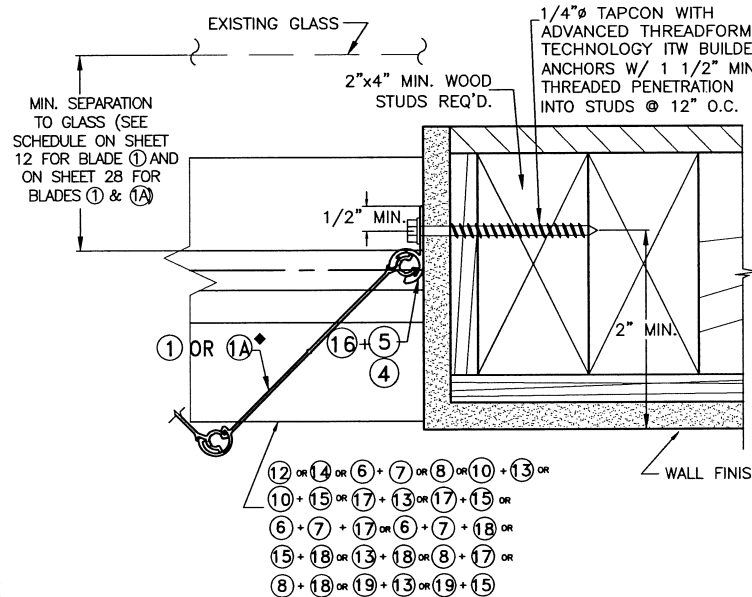


END CONNECTION DETAIL ⑪

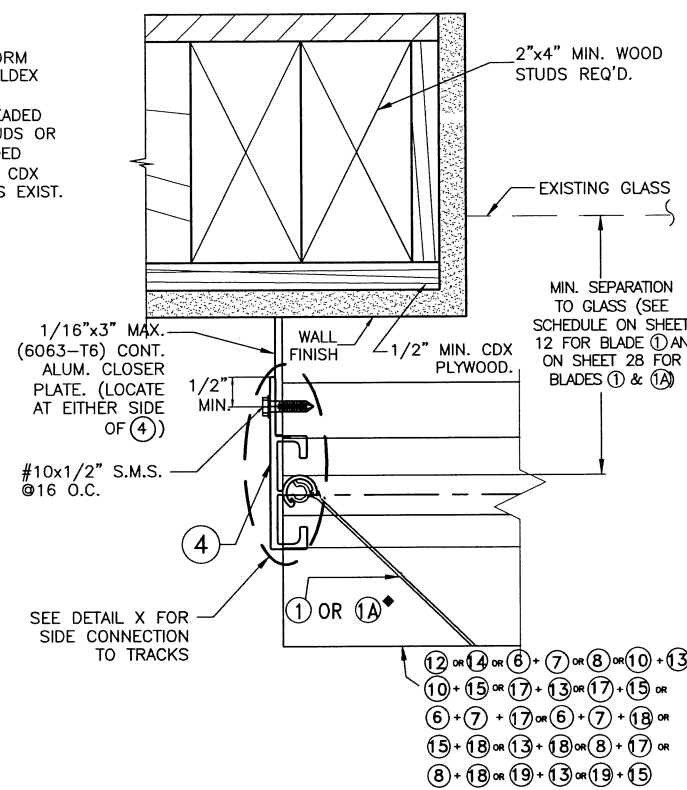


END CONNECTION DETAIL ⑧

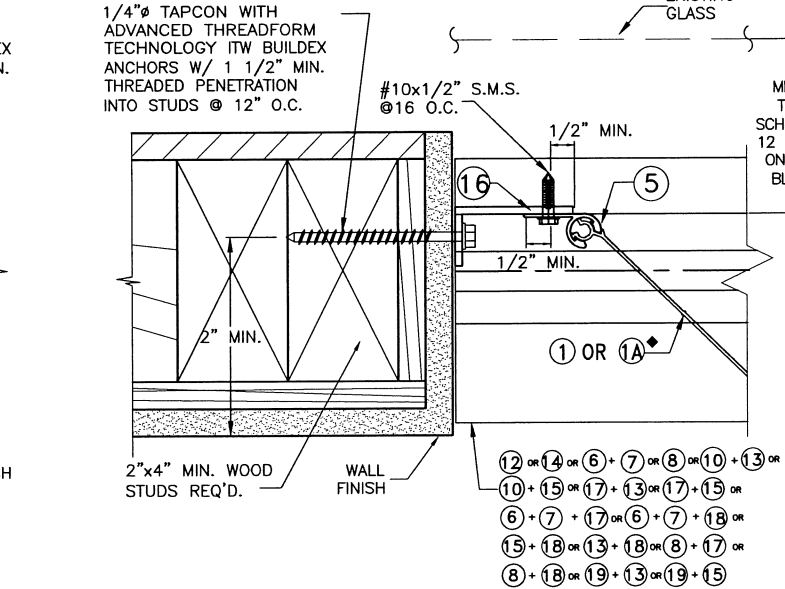


END CONNECTION DETAIL ⑫

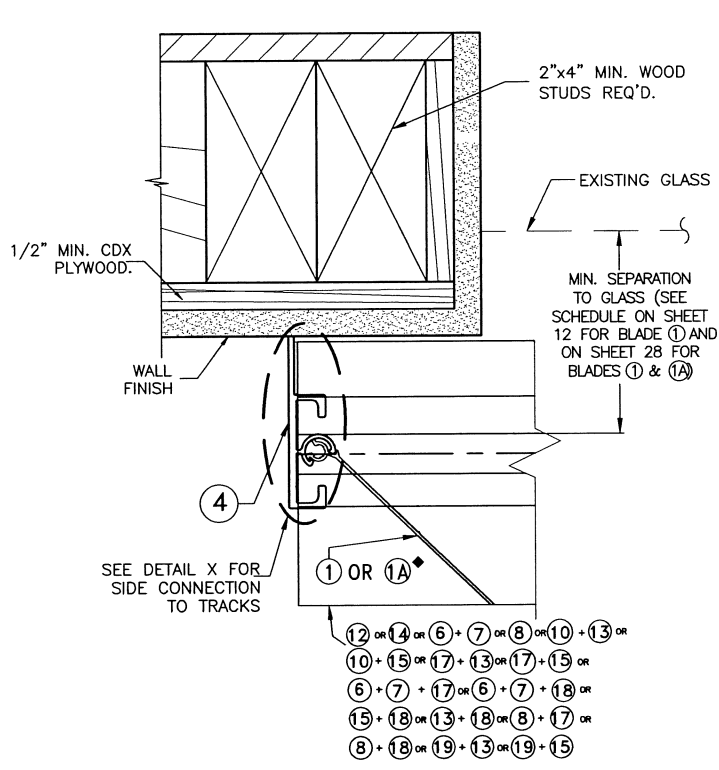

END CONNECTION DETAIL ⑨

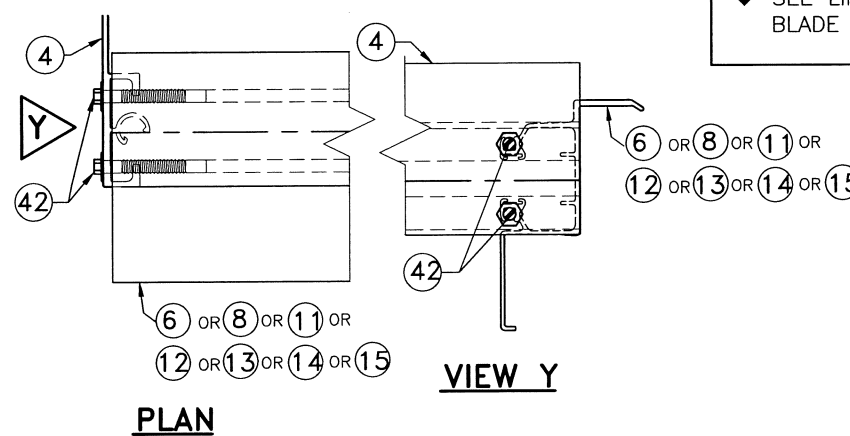

DETAIL X

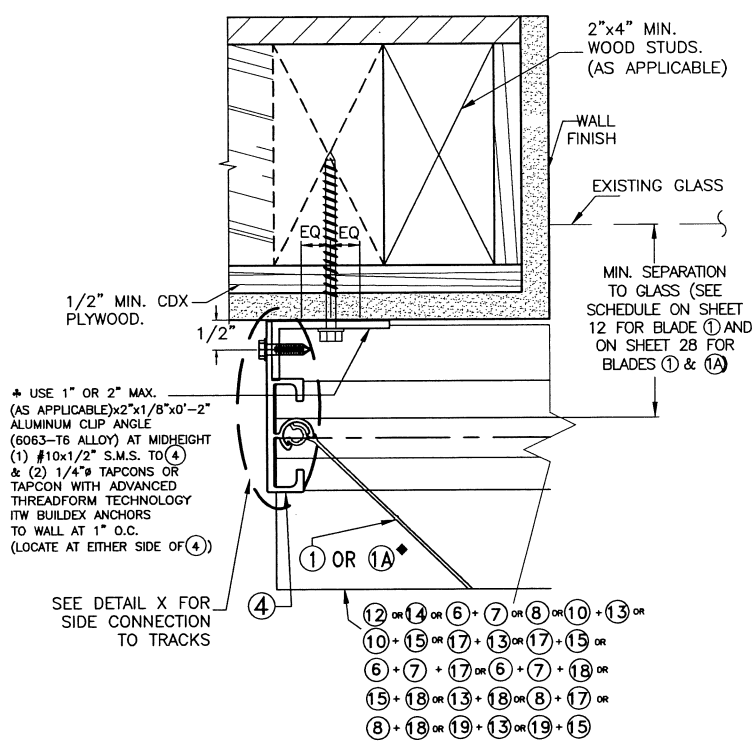

END CONNECTION DETAIL ⑩

* REQUIRED ONLY FOR SPANS GREATER THAN 12'-0"

♦ SEE LIMITATIONS OF USE OF BLADE ①A ON SHEET 28

FLORIDA BUILDING CODE (High Velocity Hurricane Zone)

PRODUCT REVISED as complying with the Florida Building Code Acceptance No. 26-0428.01 Expiration Date 07/07/31 By *Heidi Allen* Miami-DADE Product Control

MIAMI-DADE COUNTY

No. 44167

Walter A. Tillit Jr.

4/27/2026

P.E. SEAL/SIGNATURE/DATE

©2023 TILTECO, INC.

TILTECO INC.

TILLIT TESTING & ENGINEERING COMPANY

6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FLORIDA 33166

Phone : (305)871-1530 . Fax : (305)871-1531

e-mail: tilteco@aol.com

CA-0006719

WALTER A. TILLIT Jr. P.E.

FLORIDA Lic. # 44167

RED OAKS SHUTTER, INC

(ASSA # 15)

221 S.W. 5th COURT

POMPANO BEACH, FL 33060

Phone: (954)782-9325

© 2020 EASTERN METAL SUPPLY, INC.

BERTHA HV™


Accordion Shutter System

H.V. BLADE #1 W/ OR W/O H.V. WINDOW BLADE & H.V. BLADE #2

REV.No	DESCRIPTION	DATE	DRAWN BY:	Y.M.
1	OLD 20-189	7/21/23	DATE:	7/21/2023
2				
3				
4				
5				
6				

DRAWING No **23-118**

SHEET **20 OF 28**

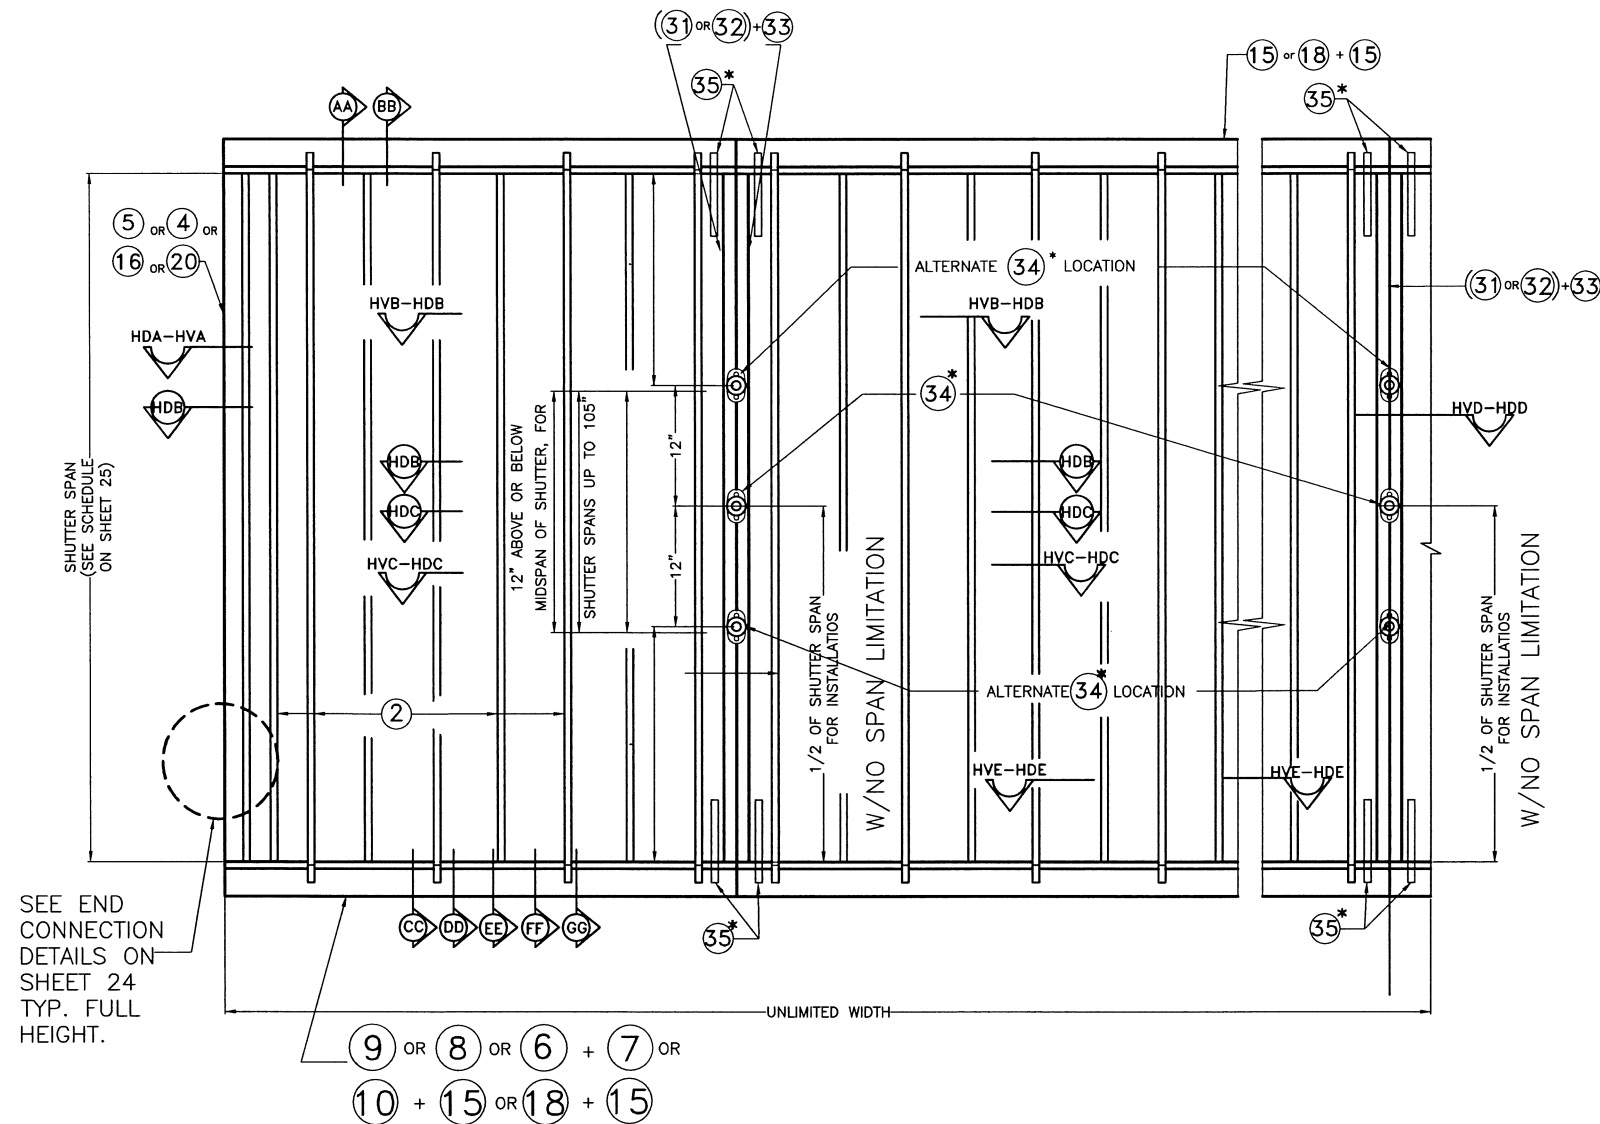

TYPICAL ② HV BLADE SHUTTER ELEVATION
N.T.S.

*** NOTES ON HD LOCKS AND CENTERMATES:**

- MANDATORY CONDITION # 1:** ONE ③④ H.D. LOCK SHALL BE USED FOR ANY SPAN AND INSTALLATION AT HEAVY DUTY SYMMETRICAL CENTERMATES, ③① OR ③② + ③③ AND AT ANY ELEVATION. ③④ H.D. LOCK MAY BE USED AS AN INSIDE OR OUTSIDE LOCK, ATTACHED TO ③③ HEAVY DUTY SYMMETRICAL CENTERMATES WITH (3) #8 x 3/8" LONG FLAT HEAD S.S. M.S. LOCKING RODS ③⑤ ARE NOT MANDATORY, i.e. THEY ARE COMPLETELY OPTIONAL.
- MANDATORY CONDITION # 2:** LOCATION OF ③④ H.D. LOCK SHALL BE AS INDICATED ON SHUTTER ELEVATION, i.e., FOR SHUTTER SPANS UP TO 105". ③④ H.D. LOCK MAY BE INSTALLED AT MID HEIGHT OF SHUTTER OR AT 12" ABOVE OR BELOW MID HEIGHT OF SHUTTER. FOR SHUTTER SPANS GREATER THAN 105", ③④ H.D. LOCK SHALL BE INSTALLED AT MID HEIGHT OF SHUTTER.

FLORIDA BUILDING CODE (High Velocity Hurricane Zone)

© 2020 EASTERN METAL SUPPLY, INC.

BERTHA HV™ Accordion Shutter System H.V. BLADE #1 W/ OR W/O H.V. WINDOW BLADE & H.V. BLADE #2				
REV.No	DESCRIPTION	DATE	DRAWN BY:	Y.M.
1	OLD 20-189	7/21/23	DATE:	7/21/2023
2				
3				
4				
5				
6				
			DRAWING No	
			23-118	
			SHEET	
			21 OF 28	

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No **26-0428-01**
Expiration Date **07/07/31**
By *Helga H. Miller*
Miami Dade Product Control

MIAMI-DADE COUNTY

P.E. SEAL/SIGNATURE/DATE

©2023 TILTECO, INC




TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FLORIDA 33166
Phone : (305)871-1530 . Fax : (305)871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr. P.E.
FLORIDA Lic. # 44167

**RED OAKS
SHUTTER, INC**

(ASSA # 15)

221 S.W. 5th COURT
POMPANO BEACH, FL 33060
Phone: (954)782-9325

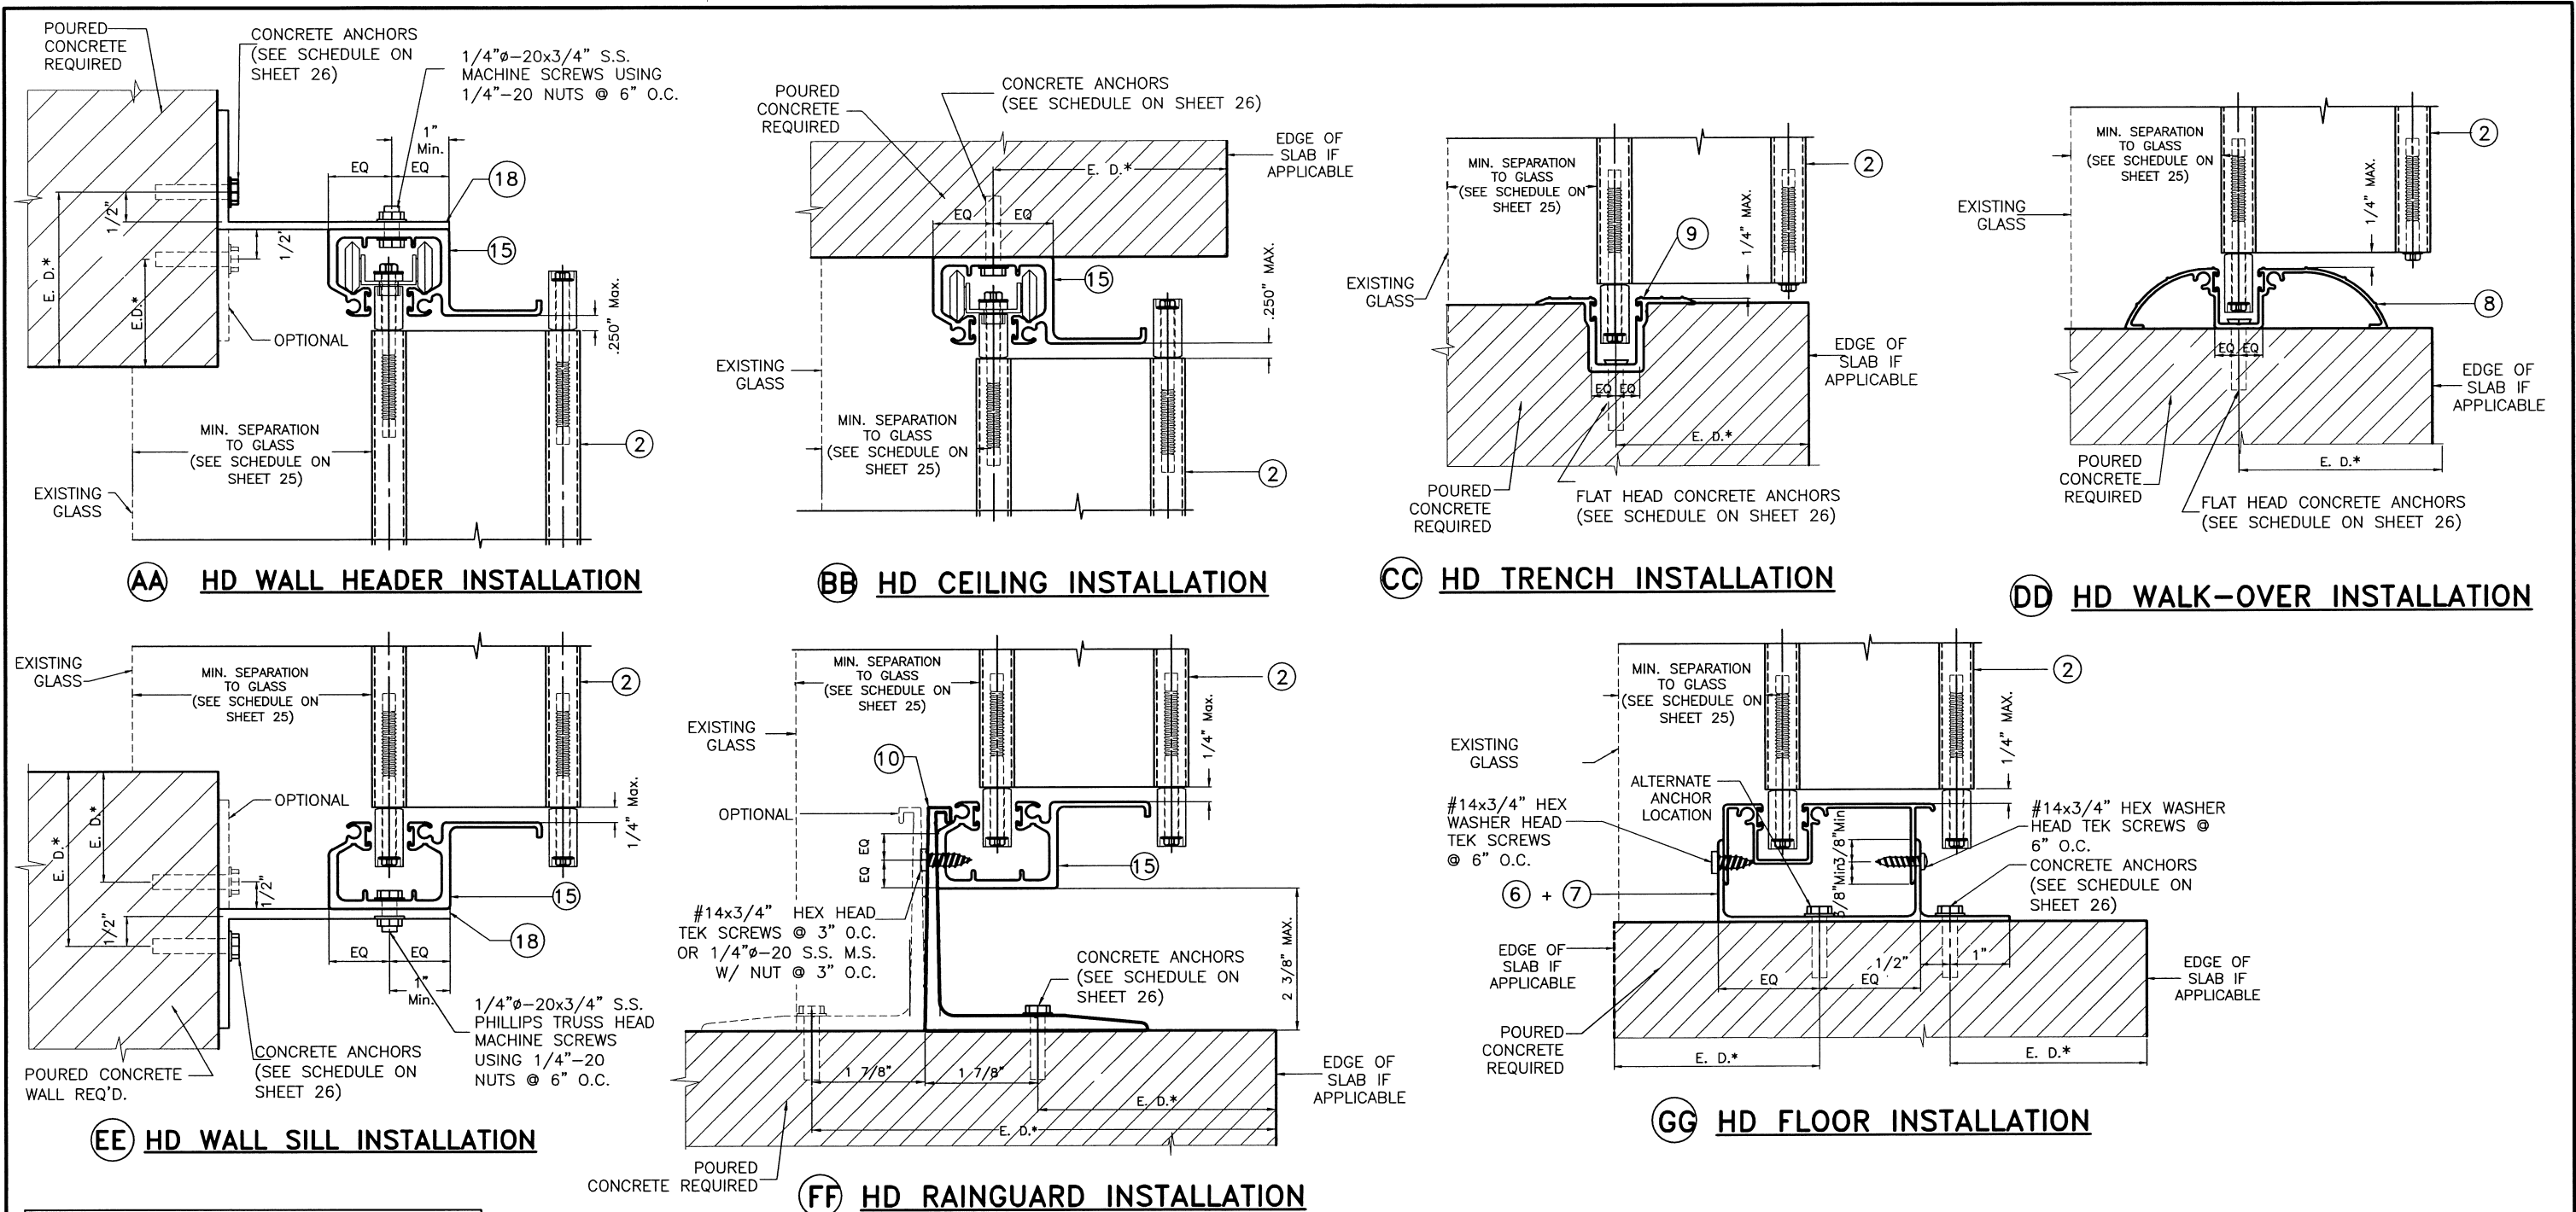

NOTE FOR COMBINATION OF SECTIONS:
 1- SEE SHEET 21 FOR TYPICAL SHUTTER ASSEMBLY.
 2- MOUNTING SECTIONS CAN BE COMBINED
 IN ANY WAY TO SUIT ANY INSTALLATION.

* E. D. = EDGE DISTANCE
 (SEE SPECIFICATIONS ON SHEET 26)

INSTALLATION DETAILS W/ ② HV BLADE

SCALE: 3/8"=1"

FLORIDA BUILDING CODE (High Velocity Hurricane Zone)





PRODUCT REVISED as complying with the Florida Building Code Acceptance No. 26-0428-01 Expiration Date 07/07/31 By <i>Hely A. M...</i> Miami Dade Product Control MIAMI-DADE COUNTY	WALTER A. TILLIT JR. LICENSE # 44167 PROFESSIONAL ENGINEER 4/27/2026 P.E. SEAL/SIGNATURE/DATE	©2023 TILTECO, INC TILTECO INC. TILLIT TESTING & ENGINEERING COMPANY 6355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FLORIDA 33166 Phone : (305)871-1530 . Fax : (305)871-1531 e-mail: tilteco@aol.com CA-0006719 WALTER A. TILLIT Jr. P.E. FLORIDA Lic. # 44167	RED OAKS SHUTTER, INC (ASSA # 15) 221 S.W. 5th COURT POMPANO BEACH, FL 33060 Phone: (954)782-9325	© 2020 EASTERN METAL SUPPLY, INC. BERTHA HV™ Accordion Shutter System H.V. BLADE #1 W/ OR W/O H.V. WINDOW BLADE & H.V. BLADE #2 <table border="1"> <thead> <tr> <th>REV.No</th> <th>DESCRIPTION</th> <th>DATE</th> <th>DRAWN BY:</th> <th>Y.M.</th> </tr> </thead> <tbody> <tr> <td>1</td> <td>OLD 20-189</td> <td>7/21/23</td> <td>DATE:</td> <td>7/21/2023</td> </tr> <tr> <td>2</td> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <td>3</td> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <td>4</td> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <td>5</td> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <td>6</td> <td></td> <td></td> <td></td> <td></td> </tr> </tbody> </table> DRAWING No 23-118 SHEET 22 OF 28	REV.No	DESCRIPTION	DATE	DRAWN BY:	Y.M.	1	OLD 20-189	7/21/23	DATE:	7/21/2023	2					3					4					5					6				
REV.No	DESCRIPTION	DATE	DRAWN BY:	Y.M.																																			
1	OLD 20-189	7/21/23	DATE:	7/21/2023																																			
2																																							
3																																							
4																																							
5																																							
6																																							

SEE END WALL CONNECTION DETAILS ON SHEET 24

INSTALLATION ② HV BLADE

SEE END WALL CONNECTION
DETAILS ON SHEET 24

* SEE NOTES ON LOCKING RODS ③⑤ & HD ③④ LOCKS ON SHEET 21

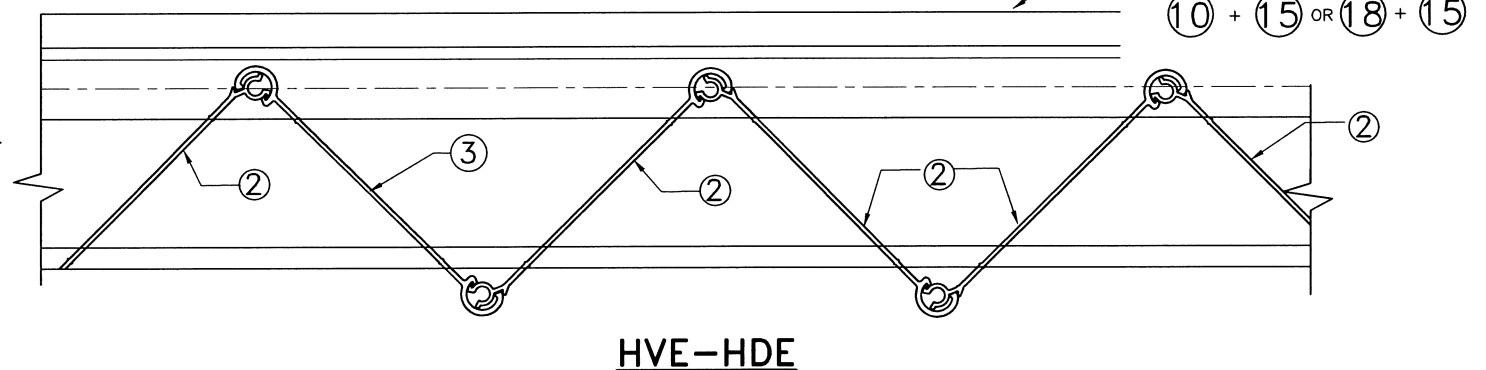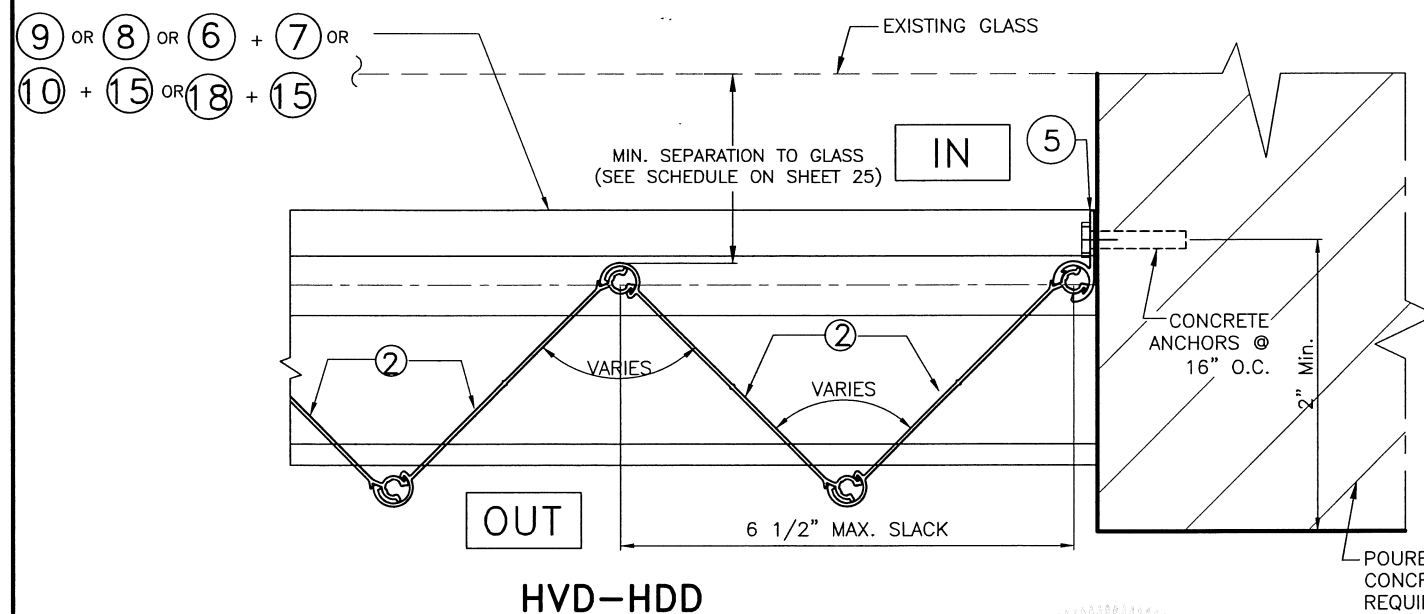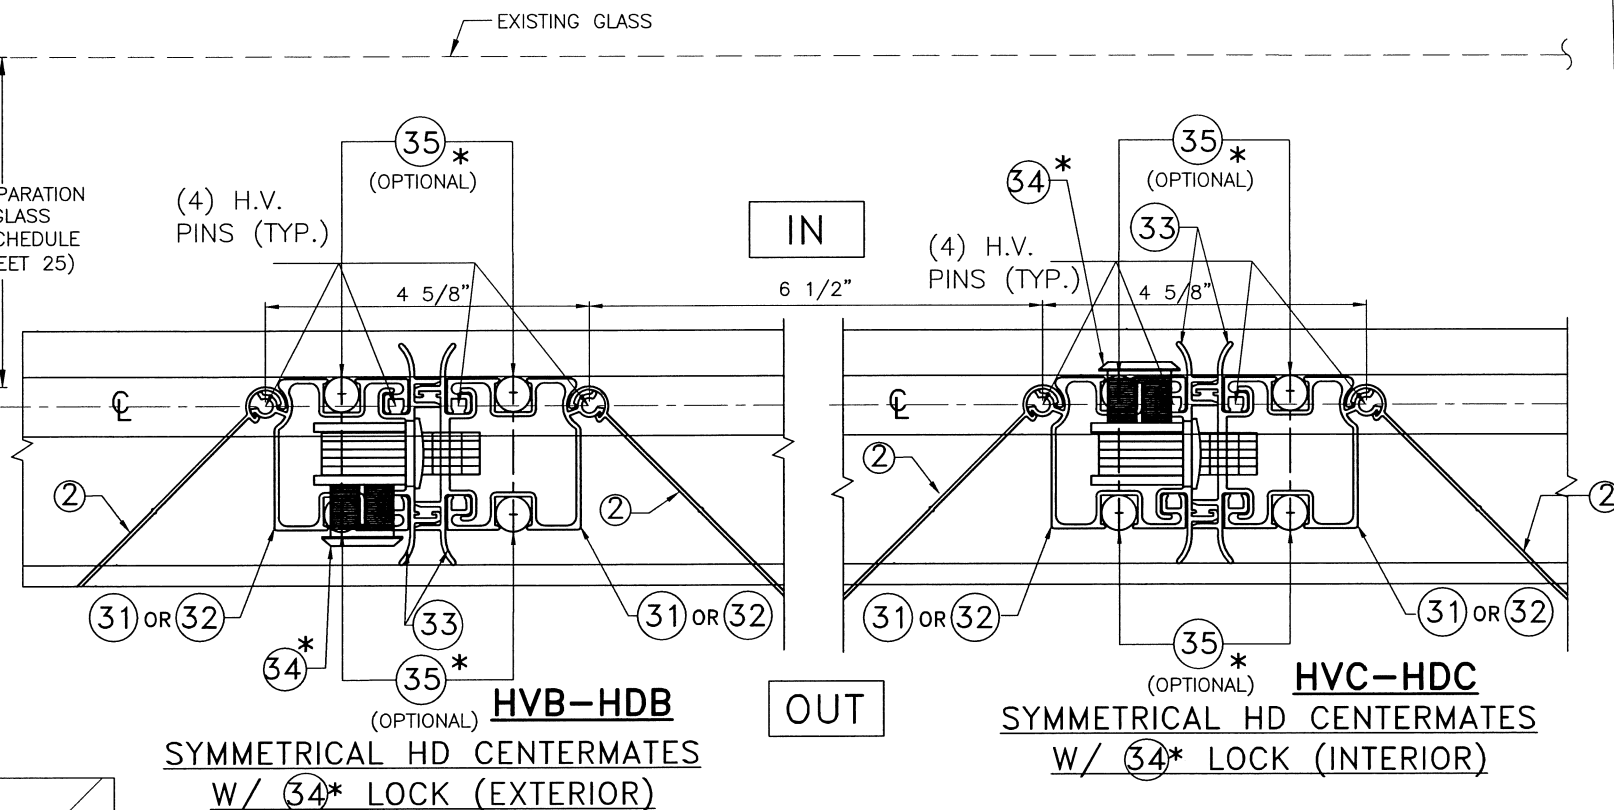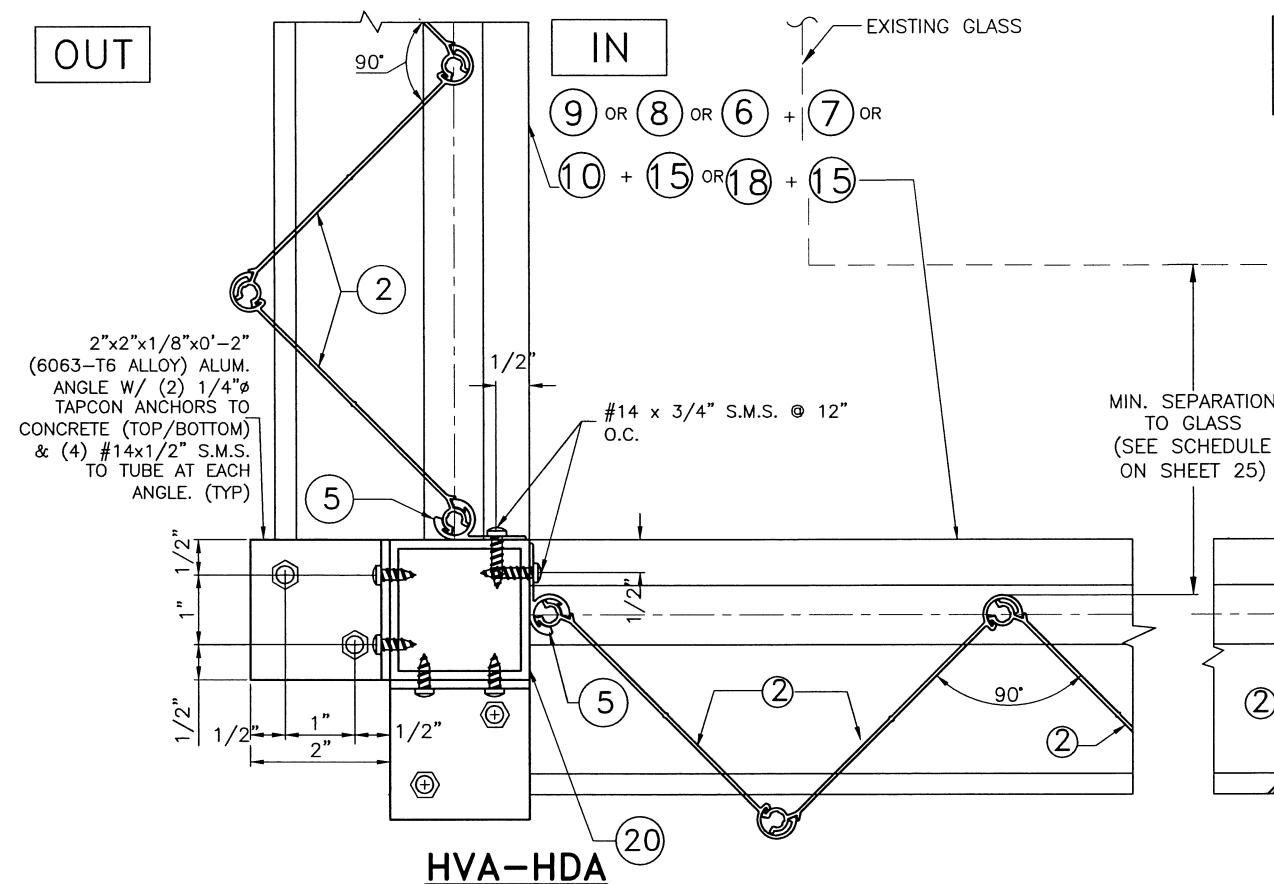

FLORIDA BUILDING CODE (High Velocity Hurricane Zone)

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 26-0428-01
Expiration Date 07/07/31
By *Hugh A. Miller*
Miami Dade Product Control

MIAMI-DADE COUNTY

No. 44167
4/27/2016
P.E. SEAL/SIGNATURE/DATE

©2023 TILTECO, INC

TILTECO INC.

TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FLORIDA 33166
Phone : (305)871-1530 . Fax : (305)871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr. P.E.
FLORIDA Lic. # 44167

**RED OAKS
SHUTTER, INC**

(ASSA # 15)

221 S.W. 5th COURT
POMPANO BEACH, FL 33060
Phone: (954)782-9325

© 2020 EASTERN METAL SUPPLY, INC.


BERTHA HV™
Accordian Shutter System

H.V. BLADE #1 W/ OR W/O H.V. WINDOW BLADE & H.V. BLADE #2

REV.No	DESCRIPTION	DATE	DRAWN BY:	Y.M.
1	OLD 20-189	7/21/23	DATE:	7/21/2023
2				
3				
4				
5				
6				

DRAWING No
23-118

SHEET
23 OF 28

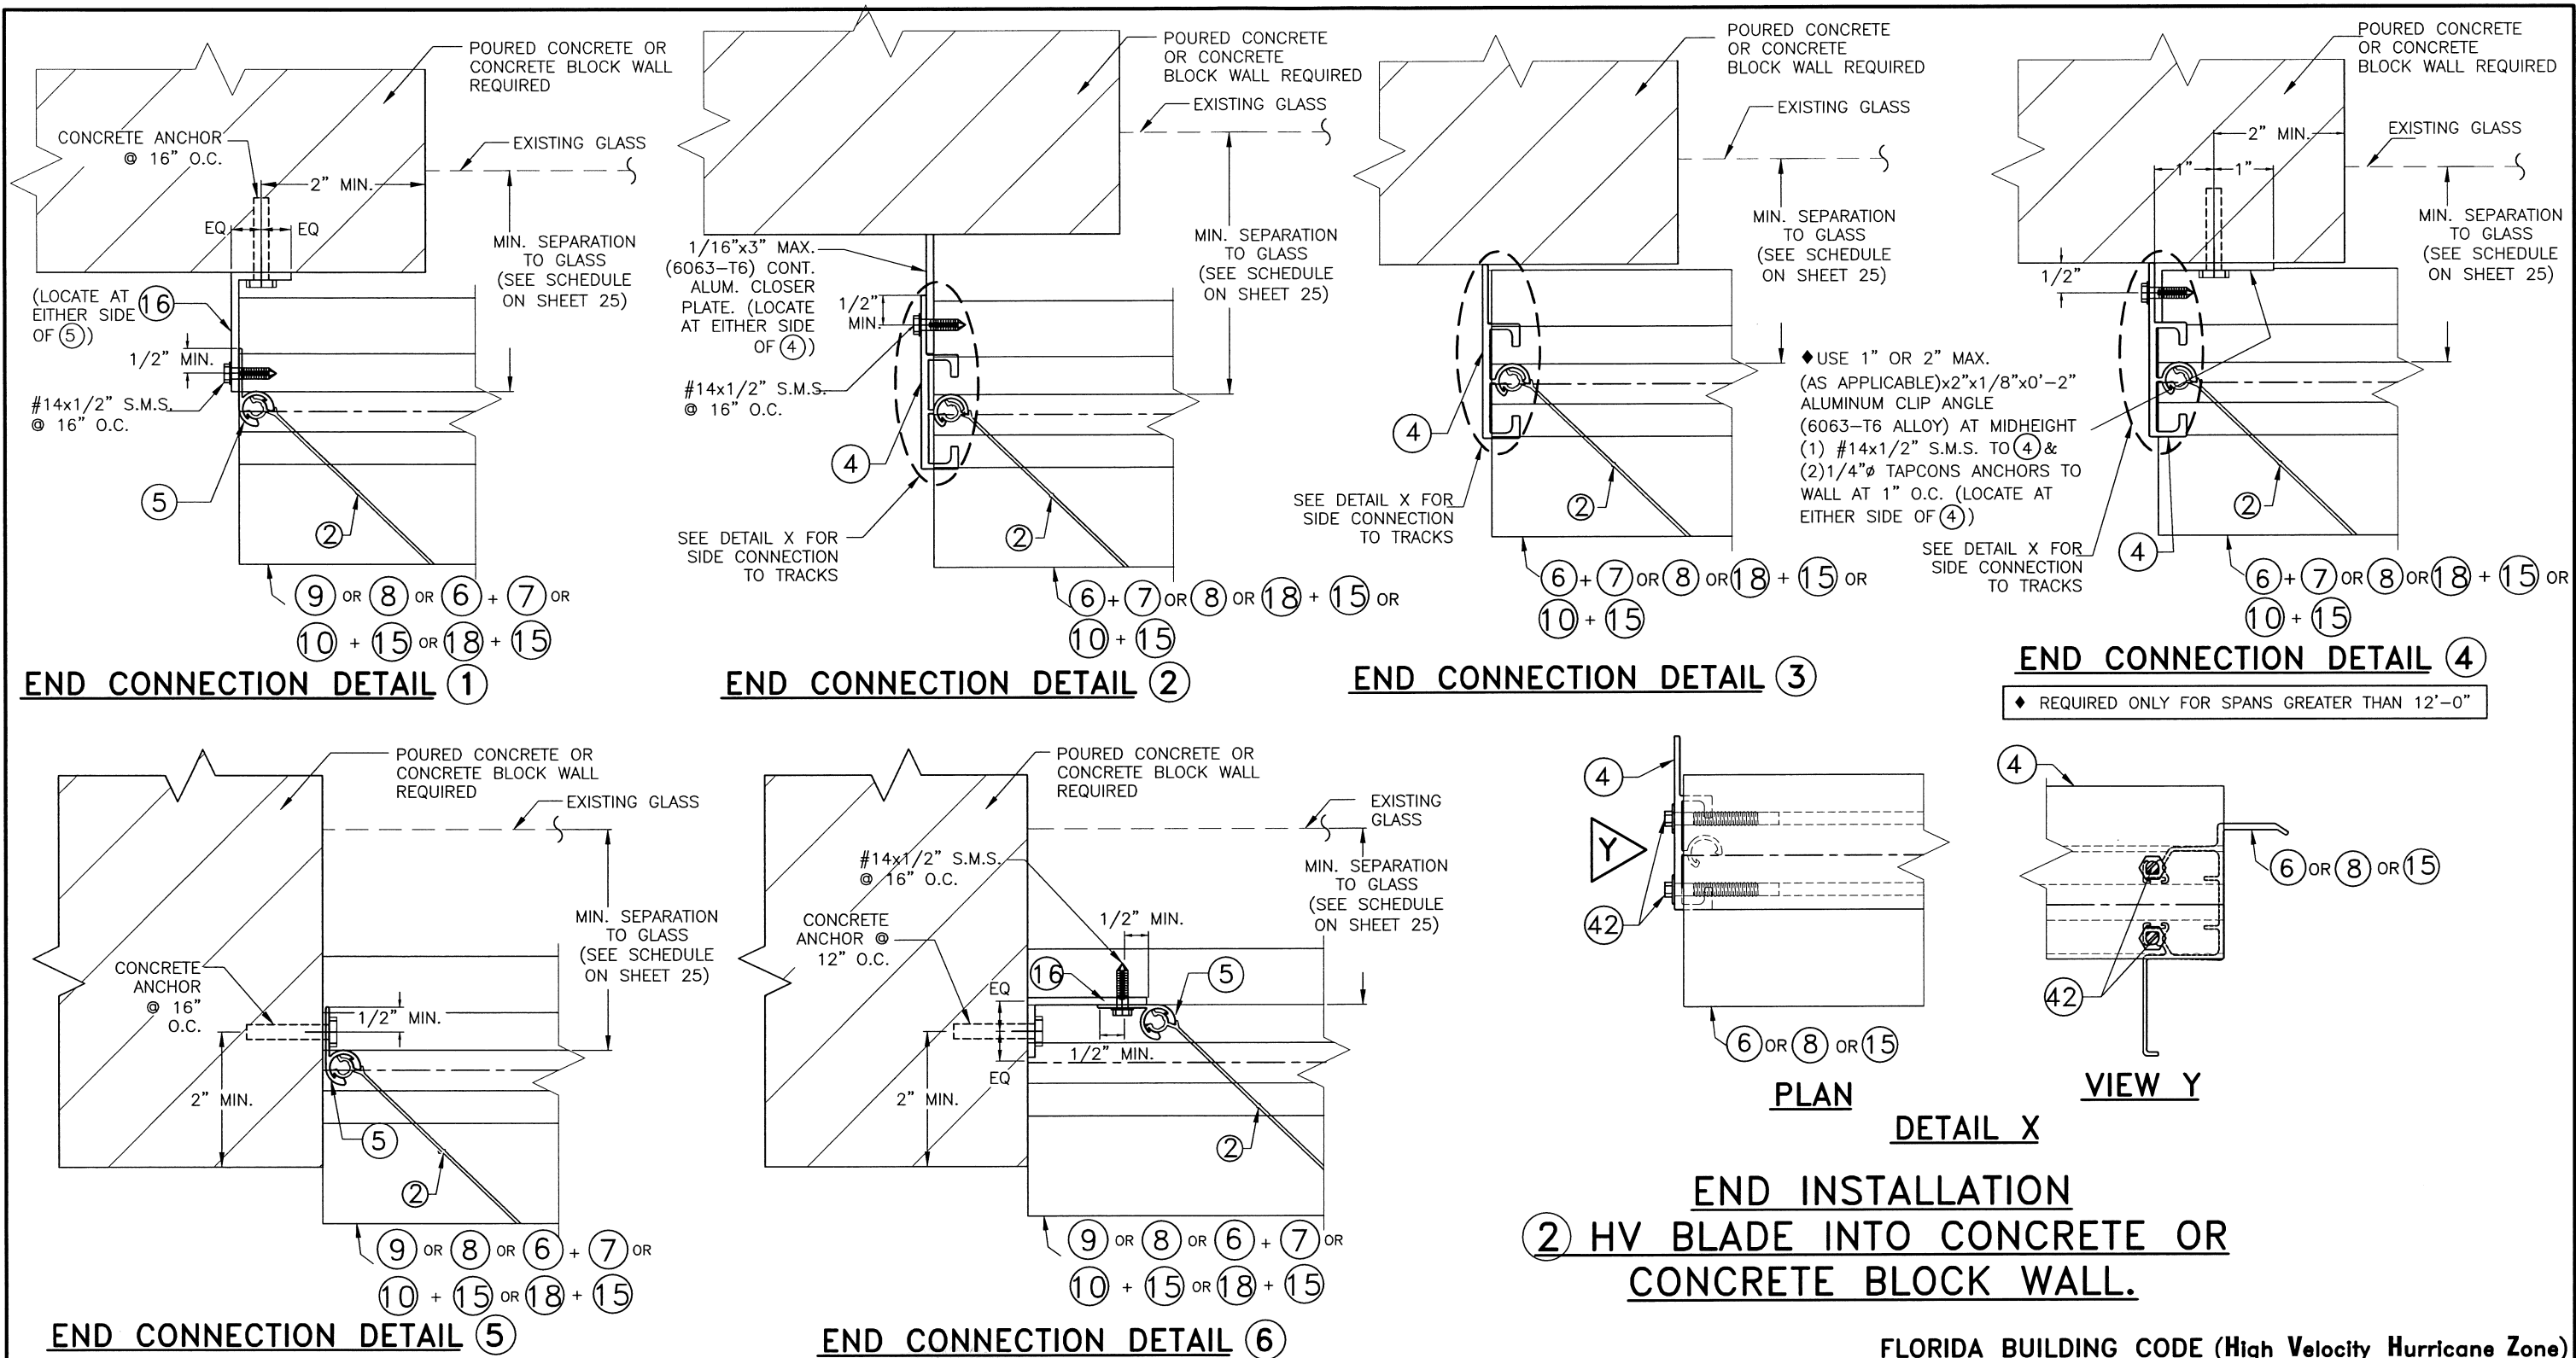

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 26-0428.d1
Expiration Date 07/07/31
By *H. A. Miller*
Miami Date Product Control

MIAMI-DADE COUNTY

P.E. SEAL/SIGNATURE/DATE

4/22/2026

©2023 TILTECO, INC.

TILTECO INC.

TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FLORIDA 33166
Phone : (305)871-1530 . Fax : (305)871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr. P.E.
FLORIDA Lic. # 44167

RED OAKS SHUTTER, INC

(ASSA # 15)

221 S.W. 5th COURT
POMPANO BEACH, FL 33060
Phone: (954)782-9325

© 2020 EASTERN METAL SUPPLY, INC.				
BERTHA HV™				
Accordion Shutter System				
H.V. BLADE #1 W/ OR W/O H.V. WINDOW BLADE & H.V. BLADE #2				
REV.No	DESCRIPTION	DATE	DRAWN BY:	Y.M.
1	OLD 20-189	7/21/23	DATE:	7/21/2023
2				
3				
4				
5				
6				
DRAWING No				
23-118				
SHEET				
24 OF 28				

MAXIMUM SHUTTER SPAN "L+" OR "L-" (ft.) * INSTALLATIONS W/ SYMMETRICAL HD CENTERMATES (31) OR (32), W/ ONE HD (34) LOCK & NO LOCKING RODS (35) ♦		
MAXIMUM A.S.D. DESIGN LOAD (p.s.f.) (+ OR -)	POURED CONCRETE INSTALLATIONS	
	ALL MOUNTING CONDITIONS	
	L + (ft)	L - (ft)
30 OR LESS	15'-5"	18'-0"
35	14'-10"	18'-0"
40	14'-4"	17'-10"
45	13'-11"	17'-6"
50	13'-6"	17'-0"
55	13'-3"	16'-10"
60	12'-11"	16'-2"
65	12'-8"	15'-6"
70	12'-6"	14'-11"
75	12'-3"	14'-5"
80	12'-0"	14'-0"
85	11'-10"	13'-7"
90	11'-6"	13'-2"
95	11'-3"	12'-10"
100	10'-6"	12'-6"
105	10'-0"	12'-2"
110	9'-6"	11'-11"
115	9'-1"	11'-8"
120	8'-9"	11'-5"
125	-	11'-2"
130	-	10'-11"
135	-	10'-9"
140	-	10'-6"
145	-	10'-4"
150	-	10'-2"
155	-	10'-0"
160	-	9'-10"
165	-	9'-9"
170	-	9'-7"
175	-	9'-5"
180	-	9'-4"
185	-	9'-2"
190	-	9'-0"
195	-	8'-9"

* NOTES:

(1) L+: MAXIMUM ALLOWABLE SPAN FOR A GIVEN POSITIVE A.S.D. DESIGN LOAD.
L-: MAX. ALLOWABLE SPAN FOR A GIVEN NEGATIVE A.S.D DESIGN LOAD.

(2) PROCEDURE TO DETERMINE MAXIMUM SPAN FOR WALL MOUNTINGS OR FLOOR/CEILING:

GIVEN A POSITIVE A.S.D. DESIGN LOAD, DETERMINE MAXIMUM SPAN "L+" FROM SCHEDULE.
GIVEN A NEGATIVE A.S.D. DESIGN LOAD, DETERMINE MAXIMUM SPAN "L-" FROM SCHEDULE.

FINAL MAXIMUM ALLOWABLE SPAN IS EQUAL TO THE MINIMUM DETERMINED SPAN BETWEEN "L+" AND "L-".

(3) PROCEDURE TO DETERMINE MAXIMUM SPAN FOR COMBINATIONS IN BETWEEN WALL W/ FLOOR/CEILING MOUNTINGS:

FOR A GIVEN POSITIVE A.S.D. DESIGN LOAD:
DETERMINE:
L1+= MAX. SPAN FOR WALL MOUNTING INSTALLATIONS.
L2+= MAX. SPAN FOR FLOOR/CEILING MOUNTING INSTALLATIONS.

FOR A GIVEN NEGATIVE A.S.D. DESIGN LOAD:
DETERMINE:
L1-= MAX. SPAN FOR WALL MOUNTING INSTALLATIONS.
L2-= MAX. SPAN FOR FLOOR/CEILING MOUNTING INSTALLATIONS.

FINAL MAXIMUM ALLOWABLE SPAN IS EQUAL TO THE MINIMUM BETWEEN "L1+", "L2+", "L1-" AND "L2-"

(4) GO TO ANCHOR SCHEDULE WITH FINAL MAXIMUM ALLOWABLE SPAN AND MAXIMUM A.S.D. DESIGN LOAD TO DETERMINE MAXIMUM ANCHOR SPACING.


♦ SEPARATION TO GLASS REQUIREMENTS

MINIMUM SEPARATION TO GLASS FOR SHUTTERS INSTALLED AT ALL ELEVATIONS OF BUILDING IS 3".

INSTALLATION LEGEND	
SUBSTRATE MOUNTINGS	POURED CONCRETE (SHEET 22)
WALL MOUNTING	AA & EE
FLOOR/CEILING MOUNTING	BB, CC, DD, FF & GG

2 HV BLADE ONLY

FLORIDA BUILDING CODE (High Velocity Hurricane Zone)

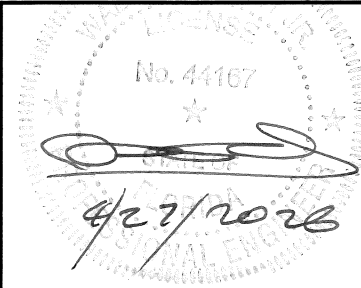		© 2023 TILTECO, INC		© 2020 EASTERN METAL SUPPLY, INC.																																								
PRODUCT REVISED as complying with the Florida Building Code Acceptance No 26-0428-01 Expiration Date 07/07/31 By <i>Hely A. Mator</i> Miami Dade Product Control MIAMI-DADE COUNTY		 P.E. SEAL/SIGNATURE/DATE		TILTECO INC. TILLIT TESTING & ENGINEERING COMPANY 6355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FLORIDA 33166 Phone : (305)871-1530 . Fax : (305)871-1531 e-mail: tilteco@aol.com CA-0006719 WALTER A. TILLIT Jr. P.E. FLORIDA Lic. # 44167		RED OAKS SHUTTER, INC (ASSA # 15) 221 S.W. 5th COURT POMPANO BEACH, FL 33060 Phone: (954)782-9325		BERTHA HV™ Accordion Shutter System H.V. BLADE #1 W/ OR W/O H.V. WINDOW BLADE & H.V. BLADE #2 <table><tr><th>REV.No</th><th>DESCRIPTION</th><th>DATE</th><th>DRAWN BY:</th><th>Y.M.</th></tr><tr><td>1</td><td>OLD 20-189</td><td>7/21/23</td><td>DATE:</td><td>7/21/2023</td></tr><tr><td>2</td><td></td><td></td><td></td><td></td></tr><tr><td>3</td><td></td><td></td><td></td><td></td></tr><tr><td>4</td><td></td><td></td><td></td><td></td></tr><tr><td>5</td><td></td><td></td><td></td><td></td></tr><tr><td>6</td><td></td><td></td><td></td><td></td></tr></table> DRAWING No 23-118 SHEET 25 OF 28		REV.No	DESCRIPTION	DATE	DRAWN BY:	Y.M.	1	OLD 20-189	7/21/23	DATE:	7/21/2023	2					3					4					5					6				
REV.No	DESCRIPTION	DATE	DRAWN BY:	Y.M.																																								
1	OLD 20-189	7/21/23	DATE:	7/21/2023																																								
2																																												
3																																												
4																																												
5																																												
6																																												

ANCHORS SPACING LEGEND

1/4"Ø TAPCON

5/16"Ø TAPCON XL

MAXIMUM ANCHOR* SPACING (in.) SCHEDULE FOR A GIVEN

MAX. SHUTTER SPAN, MAXIMUM A.S.D. DESIGN LOAD AND A

CORRESPONDING MOUNTING TYPE

FOR CONCRETE INSTALLATIONS

MAXIMUM SPAN (ft)	POURED CONCRETE				
	ALL MOUNTINGS AA THRU GG (SHEET 22)				
	USE MAXIMUM VALUES BETWEEN POSITIVE AND NEGATIVE A.S.D. LOADS				
	50 OR LESS	>50 TO 90	>90 TO 120	>120 TO 160	>160 TO 195
8'-9" OR LESS	8"	4 1/2"	3 1/2"	-	-
	12"	8"	6"	4"	3 3/4"
>8'-9" UP TO 12'-1"	6"	3 1/2"	3" ‡	-	-
	10"	6"	4"	4"	-
>12'-1" UP TO 18'-0"	4"	3 1/2"	-	-	-
	7 1/2"	5 1/2"	4"	-	-

NOTE:
‡ VALID ONLY FOR UP TO 10'-0" SPAN

***SPECIFICATIONS ON ANCHOR REQUIREMENTS: POURED CONCRETE SUBSTRATE**

- (A) ANCHORS TO WALL SHALL BE AS FOLLOWS:
- A.1) TO EXISTING POURED CONCRETE: (Min. f'c = 3192 psi)
– 1/4"Ø TAPCON ANCHORS, AS MANUFACTURED BY I.T.W. BUILDEX.
MINIMUM EMBEDMENT INTO POURED CONCRETE OF TAPCON IS 1 3/4".
- A.2) TO EXISTING POURED CONCRETE: (Min. f'c = 2899 psi)
– 5/16"Ø TAPCON XL ANCHORS, AS MANUFACTURED BY I.T.W. BUILDEX.
MINIMUM EMBEDMENT INTO POURED CONCRETE OF 5/16" TAPCON XL ANCHORS IS 2 1/4".
- A.3) IN CASE THAT PRECAST STONE, PRECAST CONCRETE PANELS, PAVERS OR ANY VENEER BE FOUND ON THE EXISTING WALL OR FLOOR, ANCHORS SHALL BE LONG ENOUGH TO REACH THE MAIN STRUCTURE BEHIND SAID WALL FINISHES. ANCHORAGE SHALL BE AS INDICATED ON NOTE A.1) ABOVE. FOR INSTALLATIONS ON VINYL SIDING OR EIFS CONSULT THIS ENGINEER.
- (B) ANCHORS SHALL BE INSTALLED FOLLOWING ALL OF THE RECOMMENDATIONS AND SPECIFICATIONS OF THE ANCHOR'S MANUFACTURER.
- (C) SEE BELOW FOR MINIMUM REQUIRED EDGE DISTANCE FOR ANCHORS.

MINIMUM REQUIRED EDGE DISTANCE FOR ANCHORS

MAXIMUM ANCHOR SPACINGS ARE VALID FOR
3" EDGE DISTANCE FOR 1/4"Ø TAPCON AND
3 5/8" EDGE DISTANCE FOR 5/16"Ø TAPCON XL.

② HV BLADE ONLY

FLORIDA BUILDING CODE (High Velocity Hurricane Zone)

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No **26-0428.01**
Expiration Date **07/07/31**
By **Heidi Miller**
Miami Date Product Control

MIAMI-DADE COUNTY

No. 44167

4/27/2026

P.E. SEAL/SIGNATURE/DATE

©2023 TILTECO, INC

TILTECO INC.

TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FLORIDA 33166
Phone : (305)871-1530 . Fax : (305)871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr. P.E.
FLORIDA Lic. # 44167

**RED OAKS
SHUTTER, INC**

(ASSA # 15)

221 S.W. 5th COURT
POMPANO BEACH, FL 33060
Phone: (954)782-9325


© 2020 EASTERN METAL SUPPLY, INC.

BERTHA HV™
Accordion Shutter System
H.V. BLADE #1 W/ OR W/O H.V. WINDOW BLADE & H.V. BLADE #2


REV.No	DESCRIPTION	DATE	DRAWN BY:	Y.M.
1	OLD 20-189	7/21/23	DATE:	7/21/2023
2				
3				
4				
5				
6				

DRAWING No
23-118

SHEET
26 OF 28

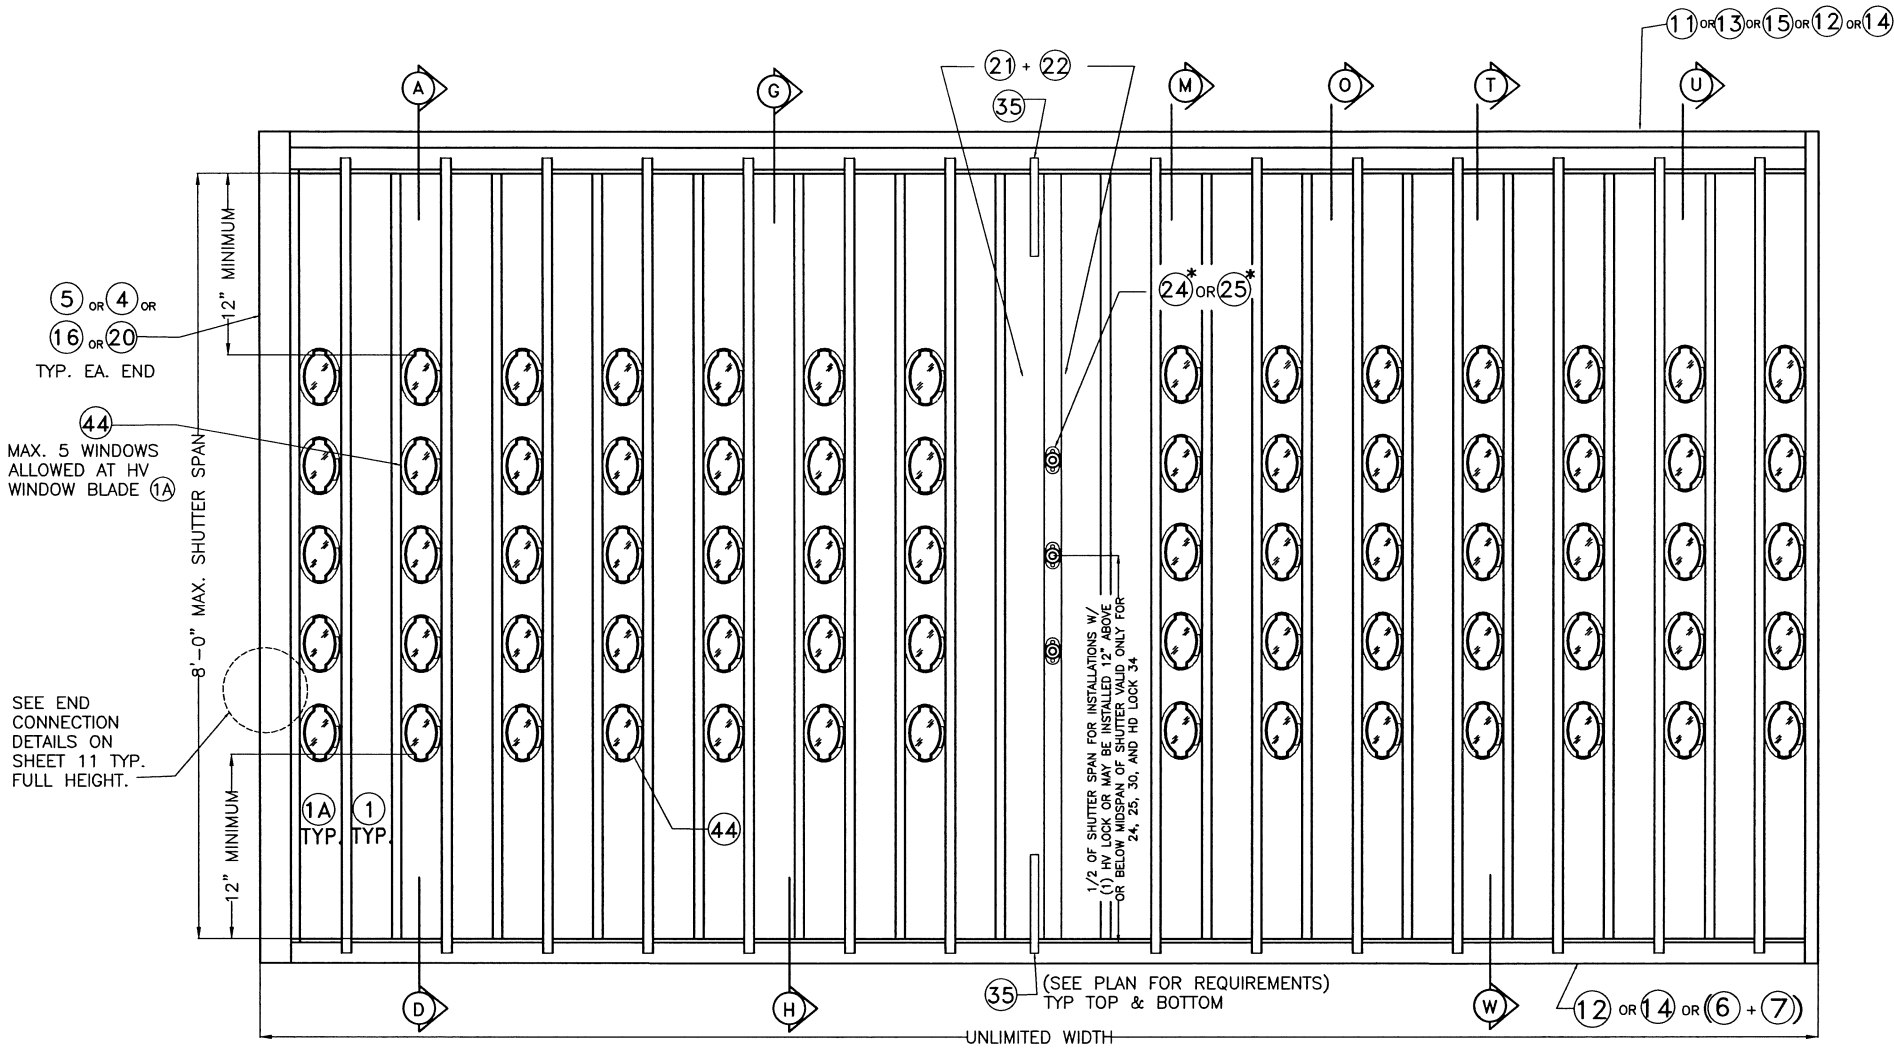

ELEVATION

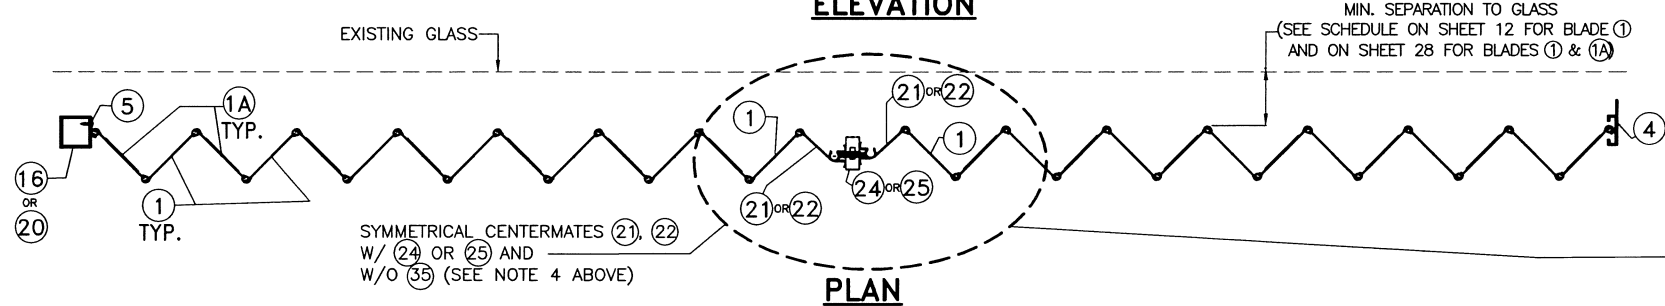

PLAN

TYPICAL 1 HV BLADE WORKING IN UNISON WITH HV WINDOW BLADE 1A SHUTTER*

N.T.S.


* GENERAL LIMITATIONS AND CONDITIONS OF USE FOR BERTHA

1 HV BLADE ACCORDION SHUTTER SYSTEM WORKING IN UNISON WITH HV WINDOW BLADE 1A

1. MAX. A.S.D. DESIGN PRESSURE RATING: +110, - 110 p.s.f.
2. MAX. SHUTTER SPAN: 96".
3. ALLOWED MOUNTINGS: A, D, G & H ON SHEETS 6, 7; AS WELL AS MOUNTINGS M, O, T, U & W ON SHEETS 18 & 19.
4. ONLY CENTERMATES 21, 22 (BOTH W/ 24 OR 25) ARE ALLOWED WITH 21, 22 ARRANGED IN A SYMMETRICAL OR OPPOSING LAYOUT. IN CASE OF OPPOSING LAYOUT, 35 MUST BE INCLUDED ONLY AT EXTERIOR ACCESS SIDE OF CENTERMATE.
5. (A) HV WINDOW BLADE 1A SHALL ONLY ALLOW A MAXIMUM OF 5 OPENINGS (3" HOLES) FOR 44 PER BLADE AT SPACINGS SHOWN ON SHEET 27.
(B) MIN. CLEARANCE FROM TOP OR BOTTOM EDGE OF HV WINDOW BLADE 1A OF ANY 3" HOLE FOR 44 SHALL BE 12".
(C) FIRST OR LAST BLADE COMING OUT FROM STARTERS AT ENDS MAY BE HV WINDOW BLADE 1A
(D) HV WINDOW BLADE 1A MUST BE USED ALTERNATE TO A SOLID HV BLADE 1 THROUGHOUT SHUTTER'S WIDTH.
(E) CENTERMATES SHALL ALWAYS BE INSTALLED ADJACENT TO A SOLID HV BLADE 1 AT EITHER SIDE OF THEM.
(F) POLYCARBONATE HV WINDOW 44 SHALL BE INSTALLED SO THAT TABS FACE THE INTERIOR OF THE OPENING BEING PROTECTED. HV WINDOW 44 MUST BE ONLY INSTALLED AND LOCKED USING A HV SETTING TOOL PROVIDED BY ASSA, INC.
6. SEE ANCHOR SPACING SCHEDULE FOR INSTALLATIONS INTO WOOD FRAME BUILDINGS ON SHEET 16, AS LIMITED BY SPAN AND DESIGN LOAD (SEE NOTES 1 & 2 ABOVE).
7. SEE ANCHOR SPACING SCHEDULE FOR INSTALLATIONS INTO POURED CONCRETE OR CONCRETE BLOCK WALL ON SHEETS 13 & 14 AS LIMITED BY SPAN AND DESIGN LOAD (SEE NOTES 1 & 2 ABOVE).
8. MINIMUM SEPARATION TO GLASS SCHEDULE:

SHUTTER SPAN	MINIMUM SEPARATION TO GLASS
96" Max.	5"

ALTERNATE OPPOSING CENTERMATES 21, 22 W/ 35 (EXTERIOR ONLY) AND W/ 24 OR 25 (SEE NOTE 4 ABOVE)

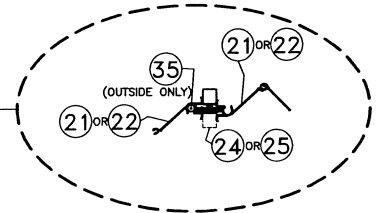

FLORIDA BUILDING CODE (High Velocity Hurricane Zone)

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 26-0428.01
Expiration Date 07/07/31
By *Helga Miller*
Miami Dade Product Control

MIAMI-DADE COUNTY

P.E. SEAL/SIGNATURE/DATE
4/27/2026

©2023 TILTECO, INC.
TILTECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FLORIDA 33166
Phone : (305)871-1530 . Fax : (305)871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr. P.E.
FLORIDA Lic. # 44167

RED OAKS SHUTTER, INC
(ASSA # 15)
221 S.W. 5th COURT
POMPAÑO BEACH, FL 33060
Phone: (954)782-9325

© 2020 EASTERN METAL SUPPLY, INC.

BERTHA HV™
Accordion Shutter System

H.V. BLADE #1 W/ OR W/O H.V. WINDOW BLADE & H.V. BLADE #2

REV.No	DESCRIPTION	DATE	DRAWN BY:	Y.M.
1	OLD 20-189	7/21/23	DATE:	7/21/2023
2				
3				
4				
5				
6				

DRAWING No
23-118

SHEET
28 OF 28

INSTALLATIONS W/ (1) HV BLADE & HV CENTERMATES (21)
INTO METAL STUD WALLS *


* GENERAL LIMITATIONS AND CONDITIONS OF USE
FOR BERTHA (1) HV BLADE ACCORDION SHUTTER
SYSTEM INSTALLATION TO METAL STUD WALLS

1. MAX. A.S.D. DESIGN PRESSURE RATING: +75, - 75 p.s.f.
2. MAX. SHUTTER SPAN: 84"
3. ALLOWED MOUNTING: (MS) ON THIS SHEET.
4. ONLY CENTERMATE (21) W/ (24) HV LOCK ARE ALLOWED WITH (21) ARRANGED IN A SYMMETRICAL LAYOUT. USE OF (2) (35) (6" LONG, MINIMUM) MUST ALWAYS BE INCLUDED AT EXTERIOR OR INTERIOR ACCESS SIDE OF CENTERMATE.

** BLADE SLACK DETAIL HVF IS VALID FOR
CENTERMATE (21) APPLICATION WITH BLADE (1)




SEPARATION TO GLASS SCHEDULE

MAX. SHUTTER SPAN L (in)	MINIMUM SEPARATION TO GLASS
84" OR LESS	3 1/4"

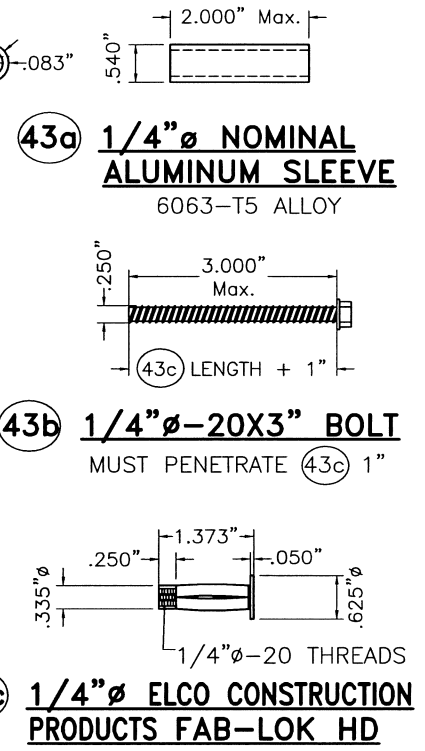

COMPONENTS

SCALE: 3/8" = 1"

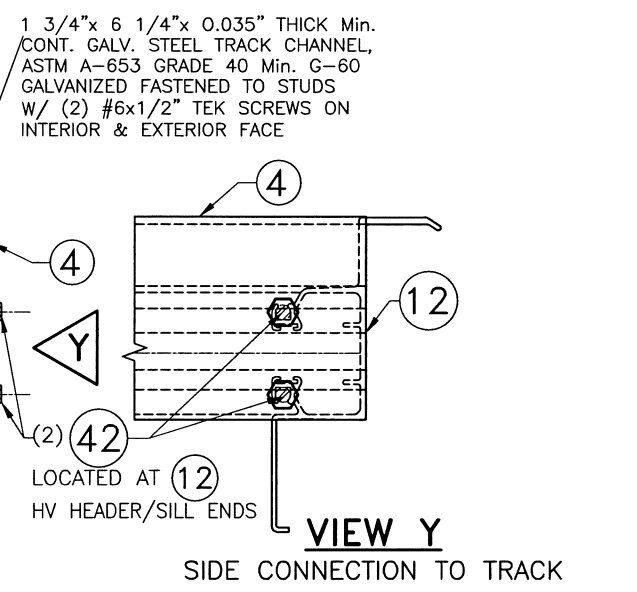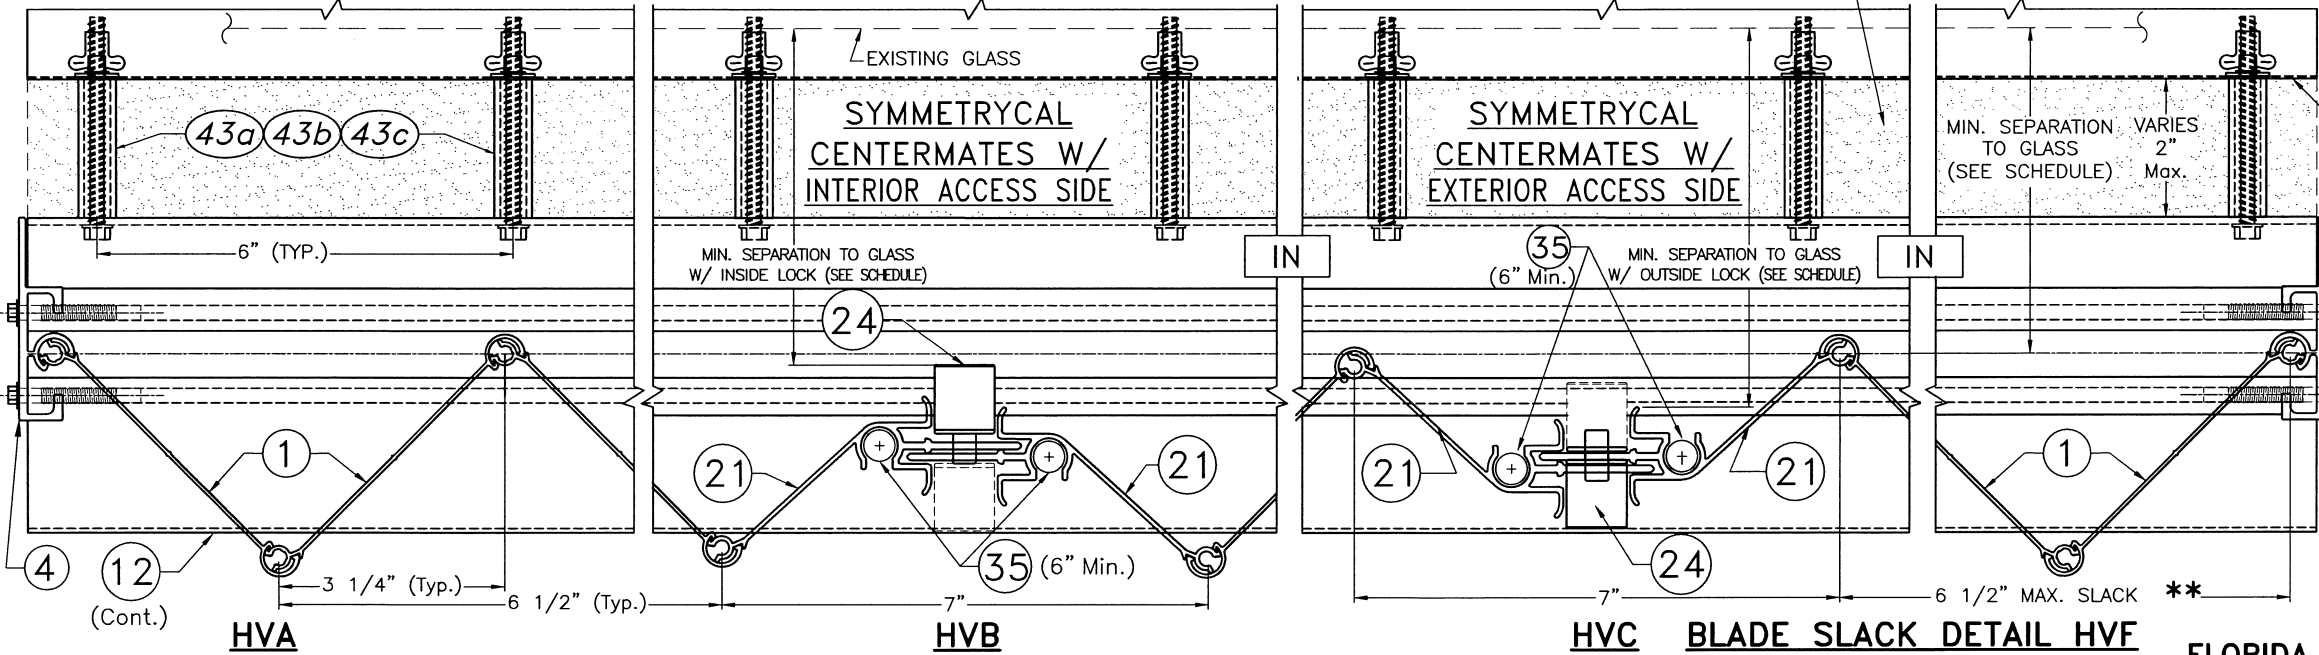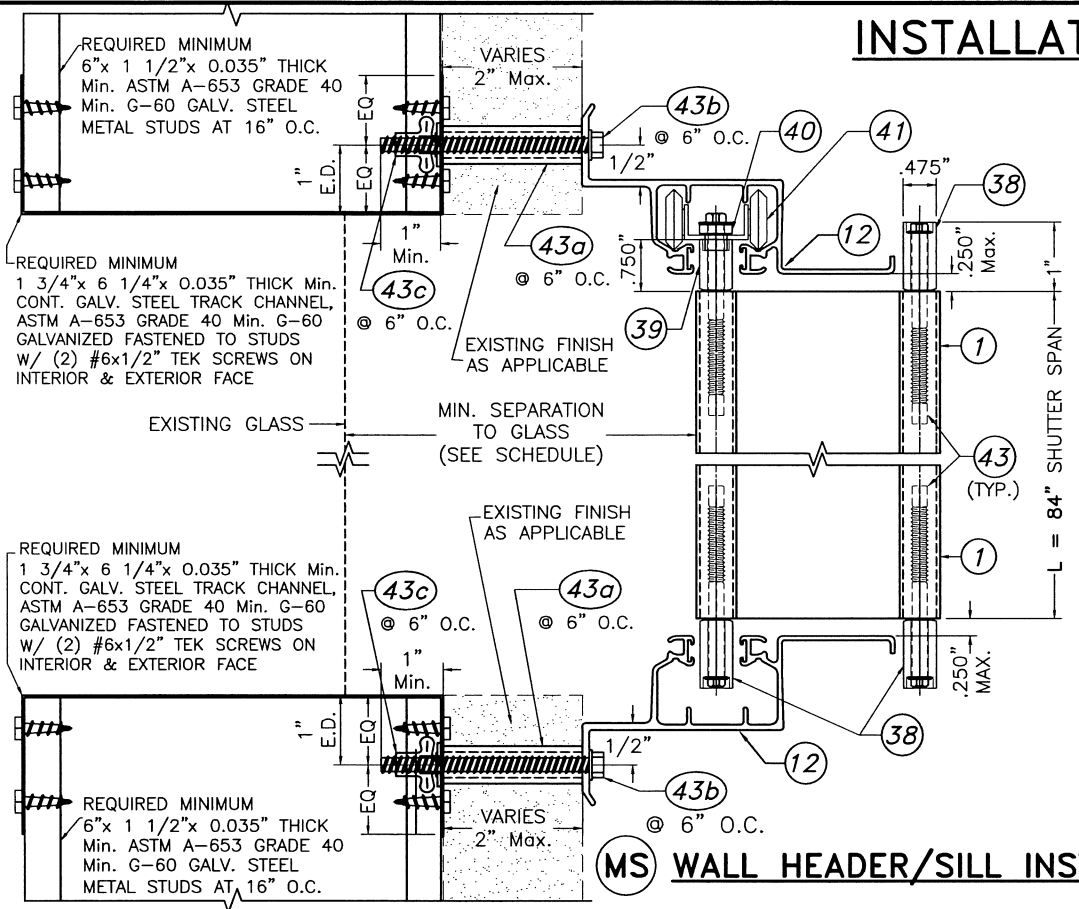

FLORIDA BUILDING CODE (High Velocity Hurricane Zone)

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 26-0428.01
Expiration Date 07/07/31
By *H. A. Miller*
Miami Data Product Control

MIAMI-DADE COUNTY

[Signature]
4/27/2026

P.E. SEAL/SIGNATURE/DATE

©2023 TILTECO, INC.

TILTECO INC.

TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FLORIDA 33166
Phone : (305)871-1530 . Fax : (305)871-1531
e-mail: tilteco@aol.com
CA-0006719
WALTER A. TILLIT Jr. P.E.
FLORIDA Lic. # 44167

**RED OAKS
SHUTTER, INC**

(ASSA # 15)

221 S.W. 5th COURT
POMPANO BEACH, FL 33060
Phone: (954)782-9325

© 2020 EASTERN METAL SUPPLY, INC.

BERTHA HV™
Accordion Shutter System

H.V. BLADE #1 W/ OR W/O H.V. WINDOW BLADE & H.V. BLADE #2

REV.No	DESCRIPTION	DATE	DRAWN BY:	Y.M.
1	OLD 20-189	7/21/23	DATE:	7/21/2023
2				
3				
4				
5				
6				

DRAWING No
23-118

SHEET
28A OF 28