



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

E.S. Windows, LLC
3550 NW 49th Street
Miami, FL 33142

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/ or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "ES-SW340 Thermal" Aluminum Horizontal Sliding Window – S.M.I.

APPROVAL DOCUMENT: Drawing No. **W16-22**, titled "ES-SW340 Thermal Aluminum Sliding Wdw. (S.M.I)", sheets 1 through 11 of 11, dated 04/07/16, with revision **D** dated 09/08/23, prepared by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E., bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, **Barranquilla, Colombia**, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/ or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.


ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **renews NOA No. 23-0928.19** and consists of this page 1, and evidence pages E-1, E-2 and E-3, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**




6/22/26

NOA No. 26-0506.03
Expiration Date: August 25, 2031
Approval Date: July 02, 2026
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's

A. DRAWINGS

1. Manufacturer's die drawings and sections.
(Submitted under NOA No. 15-0305.02)
2. Drawing No. **W16-22**, titled "ES-SW340 Thermal Aluminum Sliding Wdw. (S.M.I)", sheets 1 through 11 of 11, dated 04/07/16, with revision **D** dated 09/08/23, prepared by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.
(Submitted under NOA No. 23-0928.19)

B. TESTS


1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Small Missile Impact Test per FBC, TAS 201-94
6) Cyclic Wind Pressure Loading per FBC, TAS 203-94
7) Standard Test Method for Determination of Operating Force of Sliding Windows and Doors per ASTM E 2068-00 (2008)
8) Forced Entry Test, per ASTM F 588-04/ 07 and per FBC 2411 3.2.1, TAS 202-94
along with marked-up drawings and installation diagram of a horizontal sliding window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-7903**, dated 03/15/16, signed and sealed by Idalmis Ortega, P.E.
(Submitted under NOA No. 15-0305.02)

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC 5th Edition (2014), dated 04/01/16, revised on 07/25/16 and updated on 10/29/20 to comply with FBC 7th Edition (2020), prepared by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.
(Submitted under NOA No. 20-1202.05)
2. Glazing complies with **ASTM E1300-09**

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER).

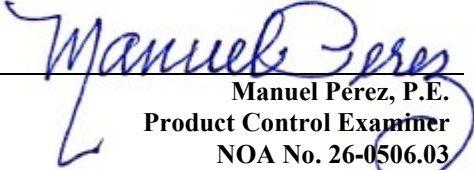
Manuel Pérez, P.E.
Product Control Examiner
NOA No. 26-0506.03
Expiration Date: August 25, 2031
Approval Date: July 02, 2026

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's (CONTINUED)

E. MATERIAL CERTIFICATIONS


1. Notice of Acceptance No. **22-1116.01** issued to **Kuraray America, Inc.** for their "**SentryGlas® (Clear and White) Glass Interlayers**" dated 12/15/22, expiring on 07/04/28.
2. Notice of Acceptance No. **20-0915.22** issued to **Kuraray America, Inc.** for their "**Trosifol® Ultraclear, Clear and Color PVB Glass Interlayers**" dated 11/19/20, expiring on 07/08/24.
3. 0.315-inch (Length) by 0.26-inch (Height) by 0.0059-inch (Thickness) (8x6.6x0.15mm) Aluminum Low Profile Insulated-Glass spacer **Helima AH 800 N** (P/N.: USA K 001 000 000 R7) with Aluminum Alloy **AW-3000** ($F_{t_u}=17$ ksi and $F_{t_y}=12$ ksi) by **Helmut Lingemann GmbH & Co., KG.** (Helima).
4. Ensinger, GmbH Part No. **Tecatherm 66 GF Insulbar** complying with ASTM D638 Tensile Strength of 13,031 psi, ASTM D 1929 Self Ignition 793°F and Flash Ignition – 781°F, ASTM D 2843 Smoke Density of 1.63, ASTM D 635 Rate of Burn 0.752 in./min., ASTM D 790 Flexural Modulus of 870 ksi, ASTM D 256 Notched Izod of 1.9 ft.-lb./in.

F. STATEMENTS

1. Statement letter of conformance, complying with **FBC 7th Edition (2020)**, with **FBC 8th Edition (2023)**, and of no financial interest, dated September 19, 2023, issued by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.
(Submitted under NOA No. 23-0928.19)
2. Distributor Agreement between ES Windows–Energia Solar, S.A., Barranquilla, Columbia, S.A. and ES Windows, LLC, Miami, Florida, dated 09/12/13, signed by Ms. Adriana Montoya, Manager and Andres Chamorro, General Manager respectively on behalf of the companies.
(Submitted under NOA No. 15-0305.02)
3. Laboratory compliance letter for Test Report No. **FTL-7903**, issued by Fenestration Testing Laboratory, Inc., dated 03/15/16, signed and sealed by Idalmis Ortega, P.E.
(Submitted under NOA No. 15-0305.02)
4. Proposal issued by Product Control, dated 02/10/14, signed by Jaime D. Gascon, P.E.
(Submitted under NOA No. 15-0305.02)

G. OTHERS

1. Notice of Acceptance No. **20-1202.05**, issued to E.S. Windows, LLC for their Series "ES-SW340 Thermally Broken" Aluminum Horizontal Sliding Window – S.M.I., approved on 03/25/21 and expiring on 08/25/26.

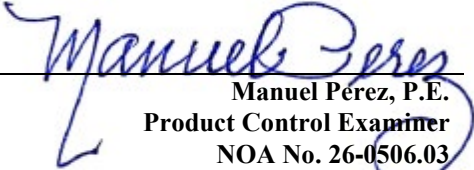
Manuel Pérez, P.E.
Product Control Examiner
NOA No. 26-0506.03
Expiration Date: August 25, 2031
Approval Date: July 02, 2026

E.S. Windows, LLC

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

2. NEW EVIDENCE SUBMITTED

A. DRAWINGS

1. None.

B. TESTS

1. None.

C. CALCULATIONS

1. None.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS


1. Notice of Acceptance No. **23-0717.30** issued to **Kuraray America, Inc.** for their “**SentryGlas® (Clear and White) Glass Interlayers**” dated 08/31/23, expiring on 07/04/28.
2. Notice of Acceptance No. **24-0205.08** issued to **Kuraray America, Inc.** for their “**Trosifol® Ultraclear, Clear and Color PVB Glass Interlayers**” dated 03/21/24, expiring on 07/08/29.

F. STATEMENTS



1. Statement letter of conformance, complying with **FBC 8th Edition (2023)**, and of no financial interest, dated May 1, 2026, issued by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.

G. OTHERS

1. Notice of Acceptance No. **23-0928.19**, issued to E.S. Windows, LLC for their Series “**ES-SW340 Thermal**” Aluminum Horizontal Sliding Window – S.M.I., approved on 11/09/23 and expiring on 08/25/26.

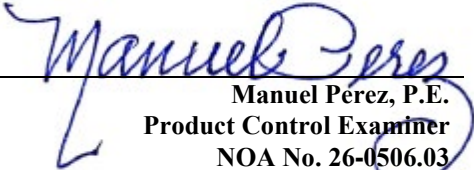
Manuel Pérez, P.E.
Product Control Examiner
NOA No. 26-0506.03
Expiration Date: August 25, 2031
Approval Date: July 02, 2026

The following pages in this document were submitted by the manufacturer (third party) to represent the product being approved and establish the limits of use. The pages may include technical drawings, schematics and installation details.

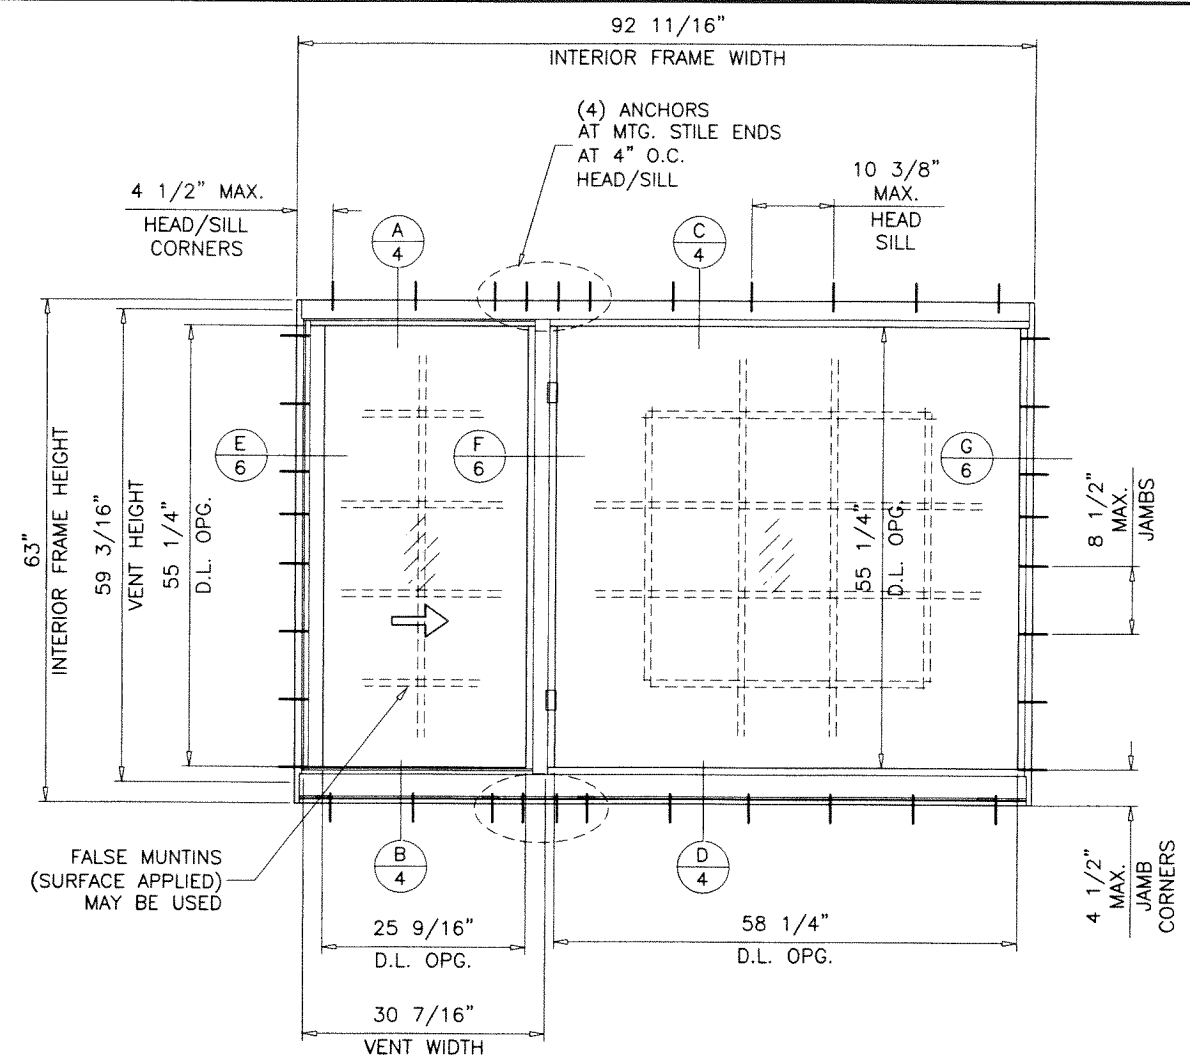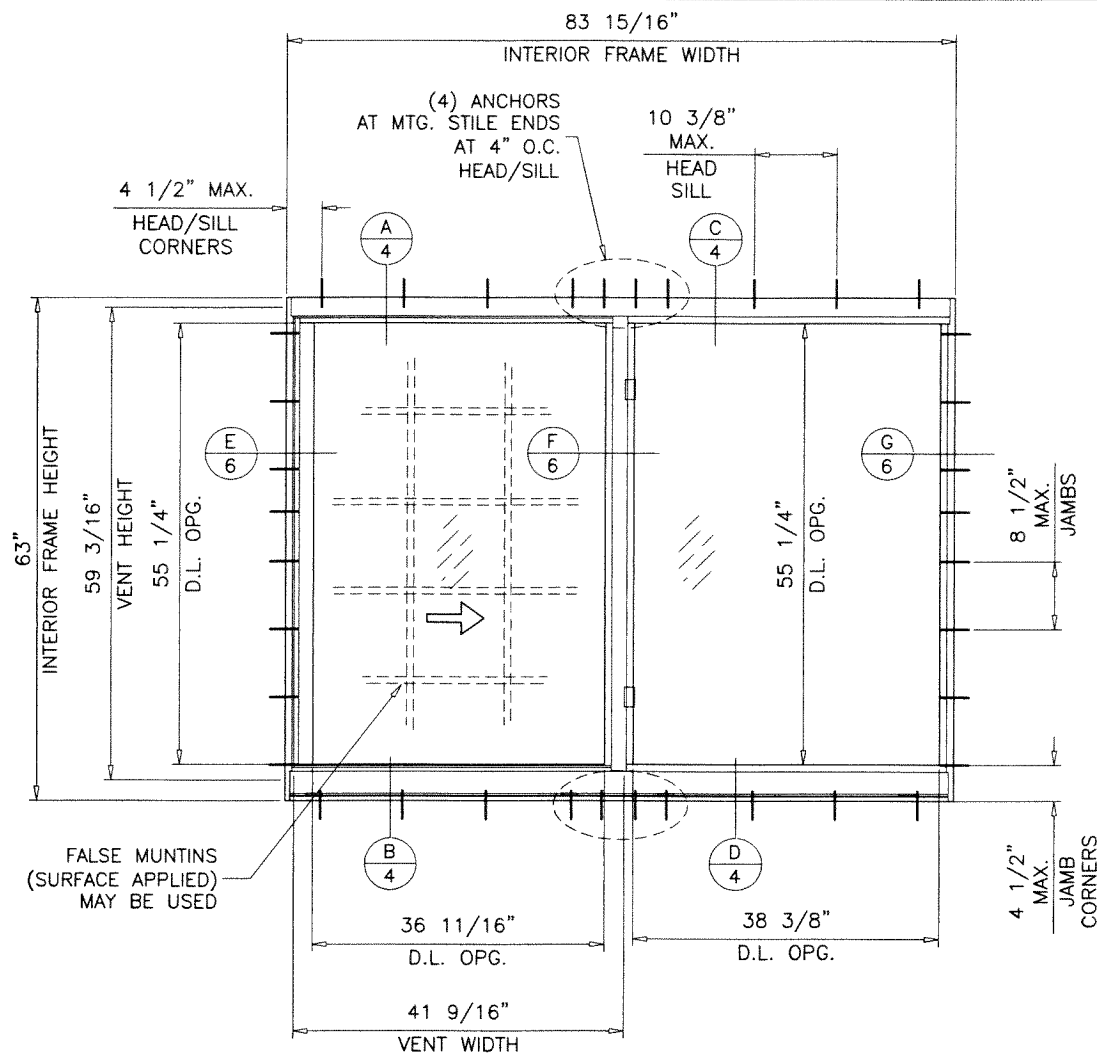

TYPICAL ELEVATIONS

THESE WINDOWS ARE RATED FOR SMALL MISSILE IMPACT.
MIAMI-DADE COUNTY APPROVED IMPACT RESISTANT SHUTTERS REQUIRED
FOR INSTALLATIONS UP TO 30 FT. OF GRADE.
SHUTTERS NOT REQD. FOR INSTALLATIONS ABOVE 30 FT. OF GRADE.



MAXIMUM DESIGN LOAD RATING = + 80.0 PSF
(FOR SIZES SHOWN OR SMALLER) - 110.0 PSF
ALTERNATE SIZES CAN NOT EXCEED VENT OR FIXED SIZES
OF SHOWN ELEVATIONS.

PRODUCT RENEWED
as complying with the Florida
Building Code
NOA-No. **26-0506.03**
Expiration Date: **08/25/2031**
By: *Manuel Perez*
Miami-Dade Product Control

NOTE:
GLASS CAPACITIES ARE BASED ON
ASTM E1300-09 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

PRODUCT REVISED
As complying with the Florida
Building Code
NOA-No. **23-0928.19**
Expiration Date: **08/25/2026**
By: *Manuel Perez*
Miami-Dade Product Control

SEP 20 2023

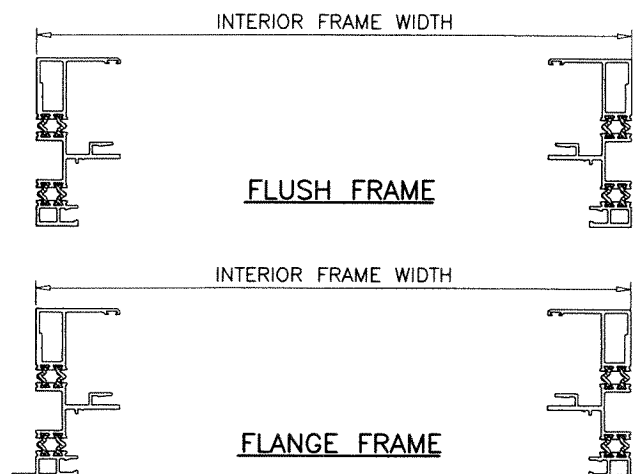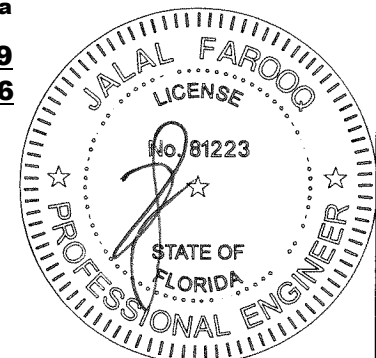

ES-SW340 (S.M.I.) **THERMAL ALUMINUM HORIZONTAL SLIDING WINDOW**

APPROVAL APPLIES TO SINGLE UNITS OR SIDE BY SIDE
COMBINATIONS OF H.R./H.R. OR HORIZ. SLIDING WITH OTHER
WINDOW TYPES IN MODULES OF TWO OR MORE WINDOWS USING
MIAMI-DADE COUNTY APPROVED MULLIONS IN BETWEEN.
LOWER DESIGN PRESSURE FROM WINDOWS OR MULLION APPROVAL
WILL APPLY TO ENTIRE SYSTEM.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE
REQUIREMENTS OF THE 2020 (7TH EDITION)/2023 (8TH EDITION) FLORIDA
BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

1BY OR 2BY WOOD BUCKS & BUCK FASTENERS BY OTHERS, MUST BE
DESIGNED AND INSTALLED ADEQUATELY TO TRANSFER APPLIED PRODUCT
LOADS TO THE BUILDING STRUCTURE.

ANCHORS SHALL BE CORROSION RESISTANT, SPACED AS SHOWN ON DETAILS
AND INSTALLED PER MANUF'S INSTRUCTIONS. SPECIFIED EMBEDMENT TO BASE
MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.
ALL SHIMS TO BE HIGH IMPACT, NON-METALLIC AND NON-COMPRESSIBLE.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT
COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE
REQUIREMENTS OF THE 2020/2023 FLORIDA BLDG. CODE & ADOPTED STANDARDS.

THIS PRODUCT APPROVAL IS GENERIC AND DOES NOT PROVIDE INFORMATION
FOR A SITE SPECIFIC PROJECT, i.e. LIFE SAFETY OF THIS PRODUCT, ADEQUACY
OF STRUCTURE RECEIVING THIS PRODUCT AND SEALING AROUND OPENING FOR
WATER INFILTRATION RESISTANCE ETC.
CONDITIONS NOT SHOWN IN THIS DRAWING ARE TO BE ANALYZED SEPARATELY,
AND TO BE REVIEWED BY BUILDING OFFICIAL.



DESIGN LOADS SHOWN ARE BASED ON 'ALLOWABLE STRESS DESIGN (ASD)'.

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
(C.A.N. 3538)

ES-SW340 THERMAL ALUMINUM SLIDING WDW. (S.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158


date: 04-07-16		scale: 1/2"=1'-0"		drawing no. W16-22	
dr. by: TARIQ		chk. by:		sheet 1 of 11	
revisions:					
no	date	by	description		
A	06.08.16		NO CHANGE THIS SHEET		
B	02.07.18		UPDATED TO 2017 FBC		
C	11.05.20		UPDATED TO 2020 FBC		
D	09.08.23		UPDATED TO 2023 FBC		

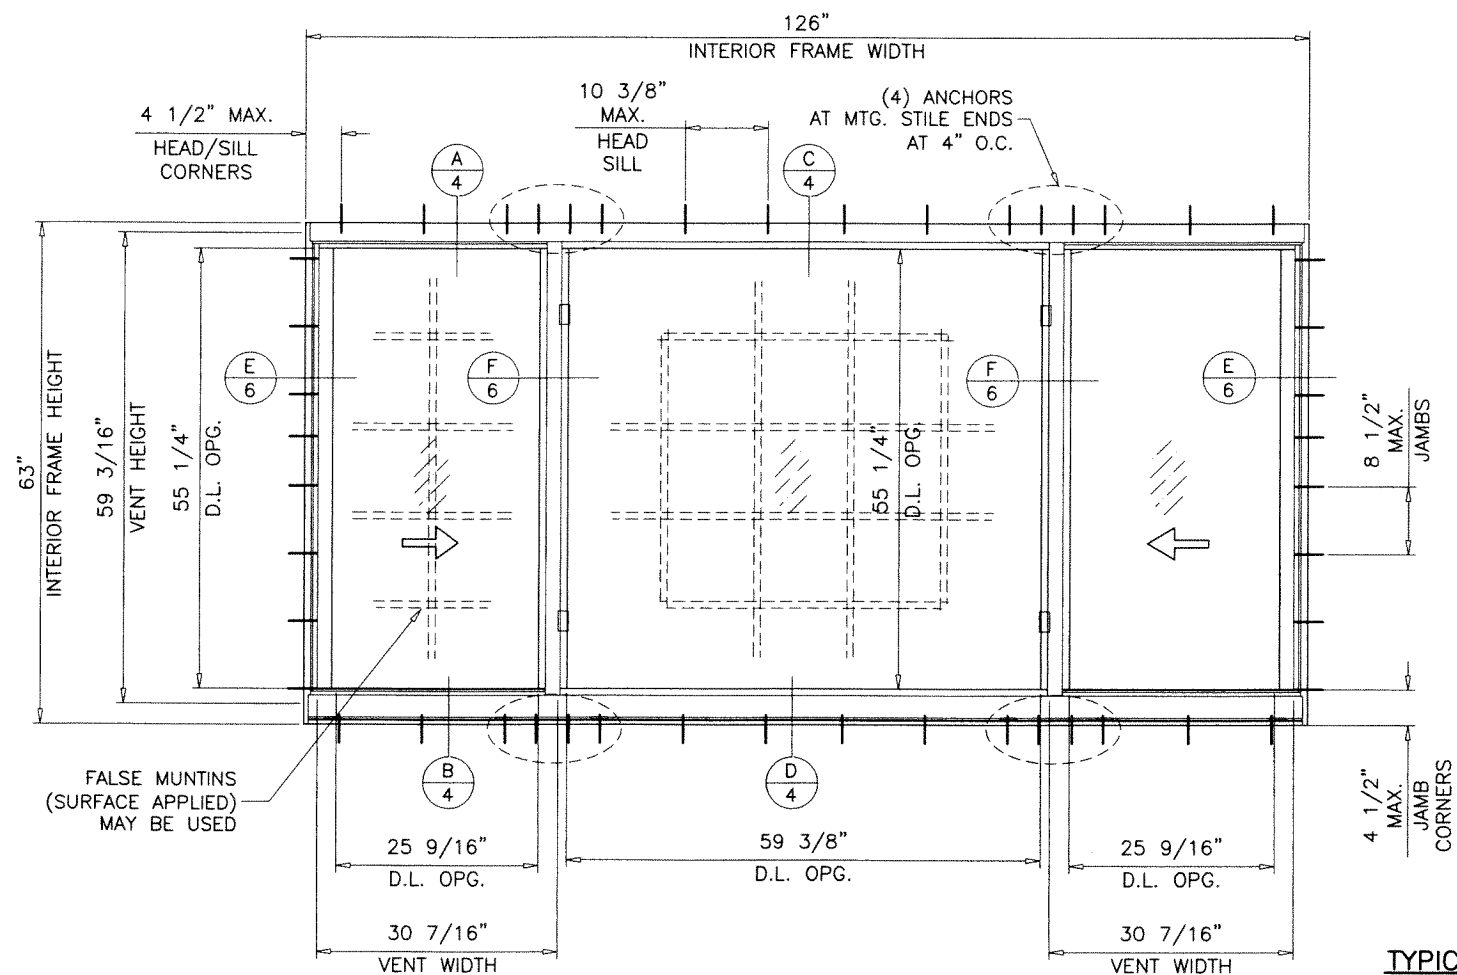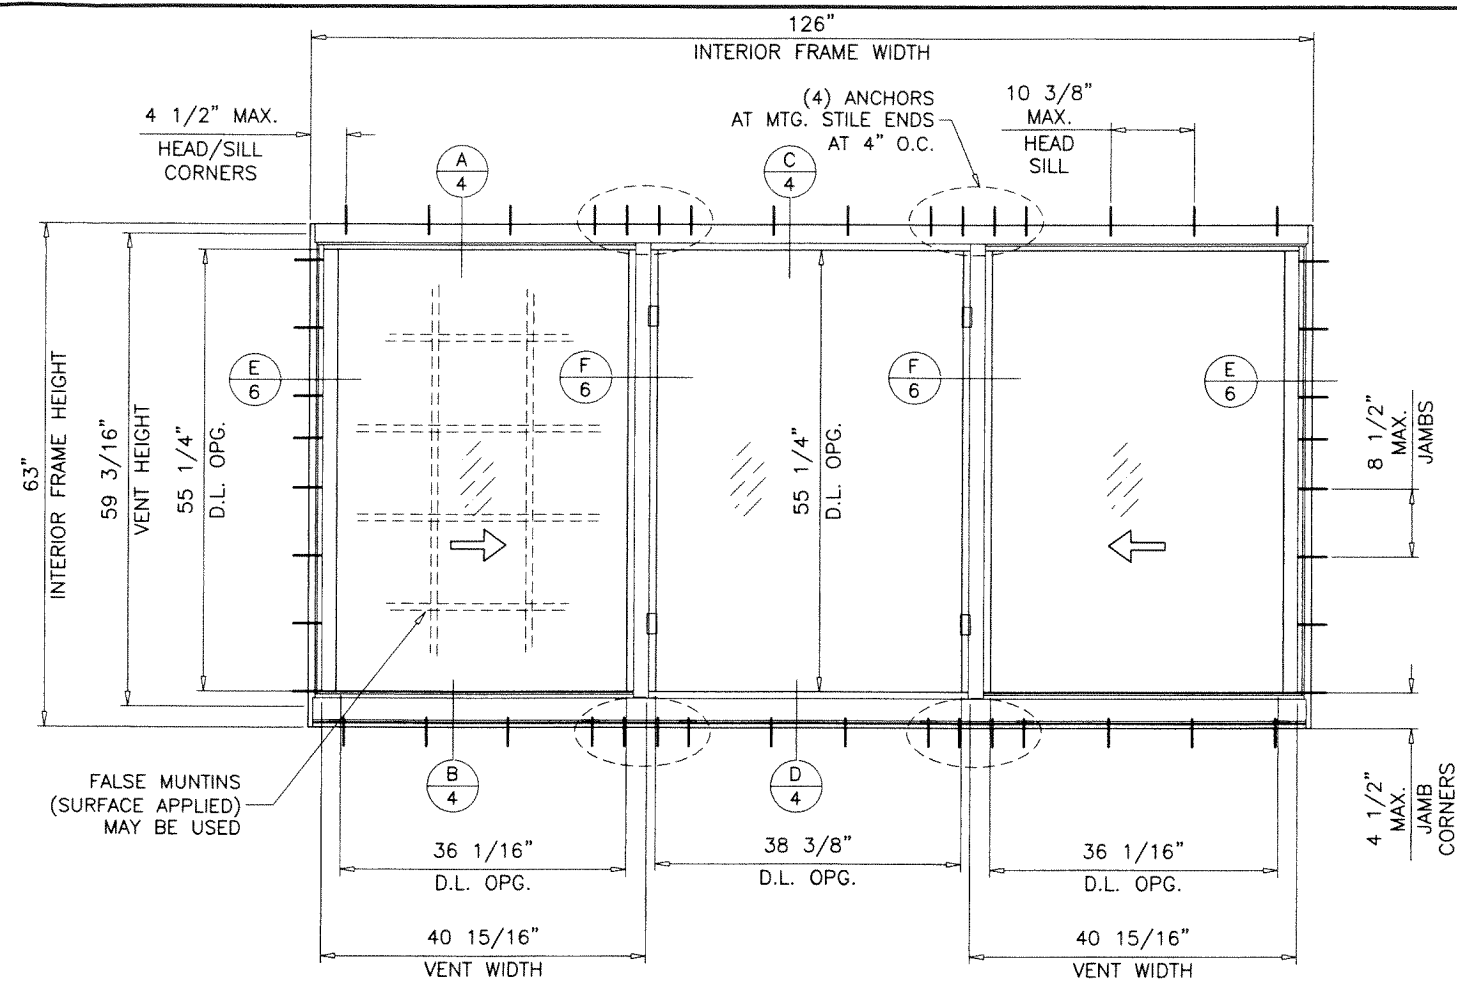

TYPICAL ELEVATIONS


MAXIMUM DESIGN LOAD RATING = + 80.0 PSF
(FOR SIZES SHOWN OR SMALLER) - 110.0 PSF

ALTERNATE SIZES CAN NOT EXCEED VENT OR FIXED SIZES
OF SHOWN ELEVATIONS.

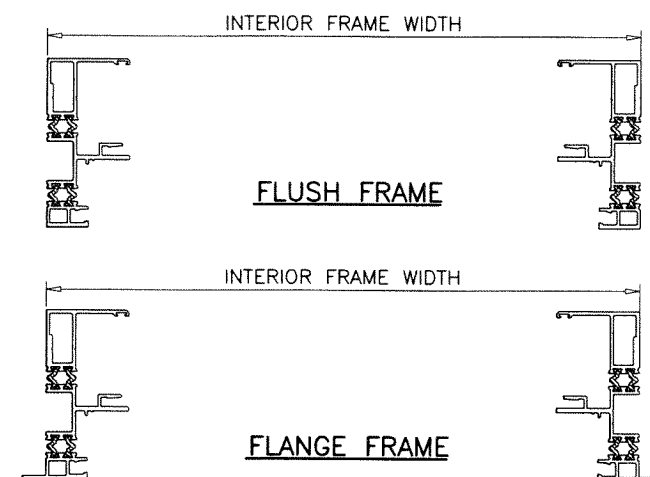

PRODUCT RENEWED
as complying with the Florida
Building Code
NOA-No. 26-0506.03
Expiration Date: 08/25/2031
By: Manuel Perez
Miami-Dade Product Control

PRODUCT REVISED
As complying with the Florida
Building Code
NOA-No. 23-0928.19
Expiration Date: 08/25/2026
By: Manuel Perez
Miami-Dade Product Control
SEP 20 2023

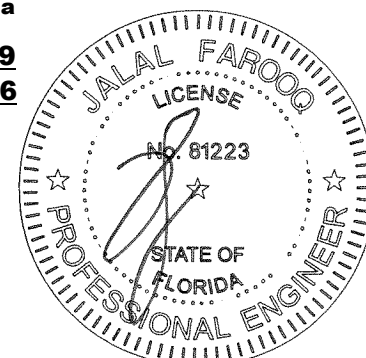

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
(C.A.N. 3538)

ES-SW340 THERMAL ALUMINUM SLIDING WDW. (S.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

drawing no.

W16-22

sheet 2 of 11


date: 04-07-16

scale: 1/2"=1'-0"


dr. by: TARIQ

chk. by:


revisions:		
no	date	description
A	06.08.16	NO CHANGE THIS SHEET
B	02.07.18	NO CHANGE THIS SHEET
C	11.05.20	UPDATED TO 2020 FBC
D	09.08.23	NO CHANGE THIS SHEET

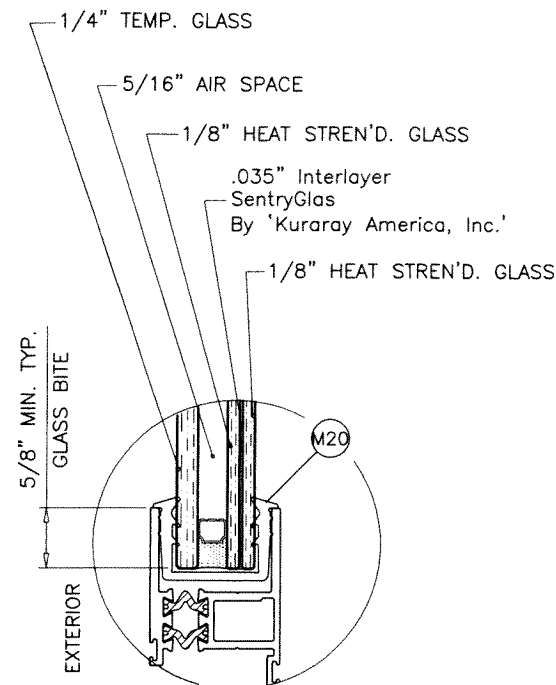


VENT

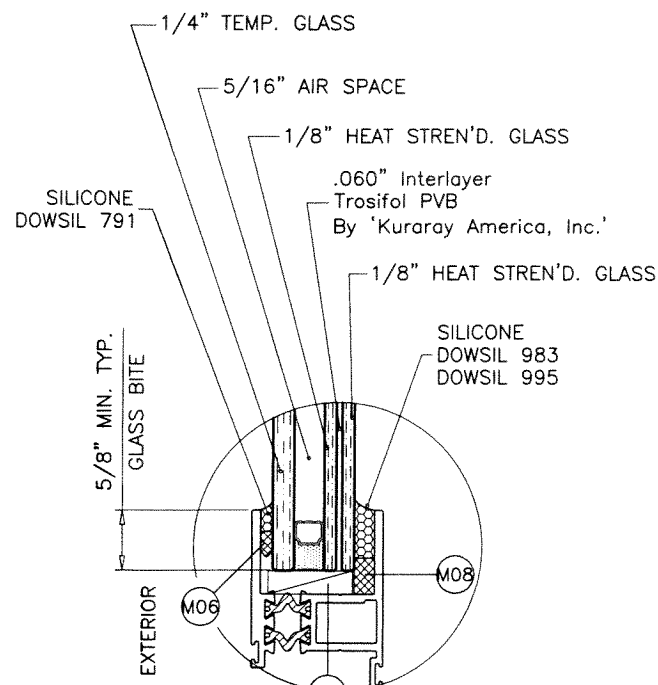


VENT

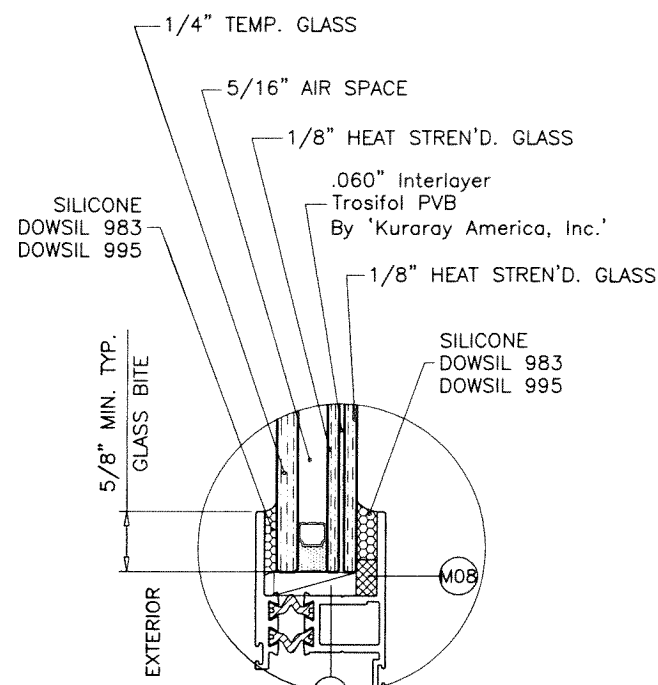


VENT

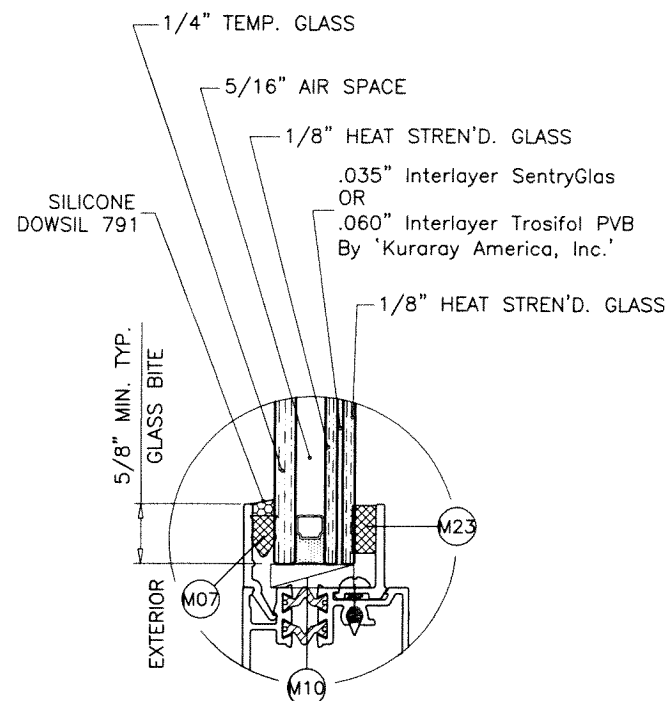


FIX. LITE

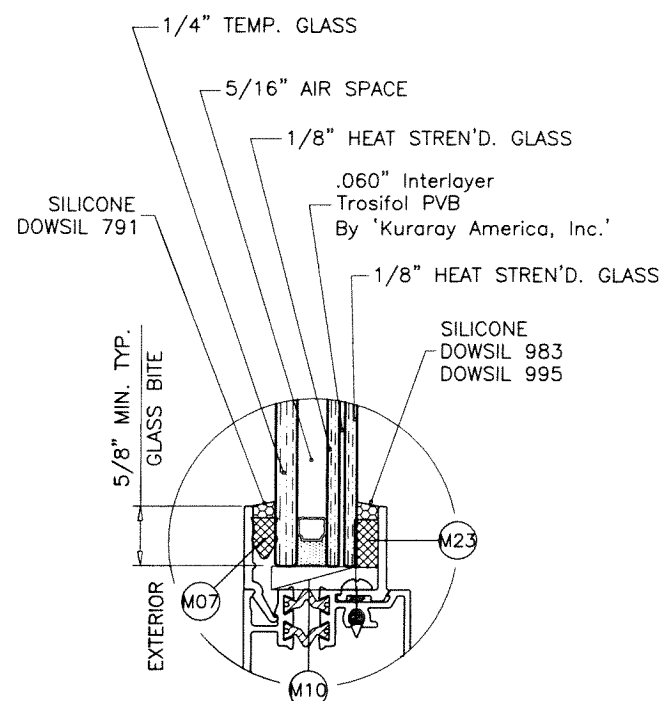

FIX. LITE

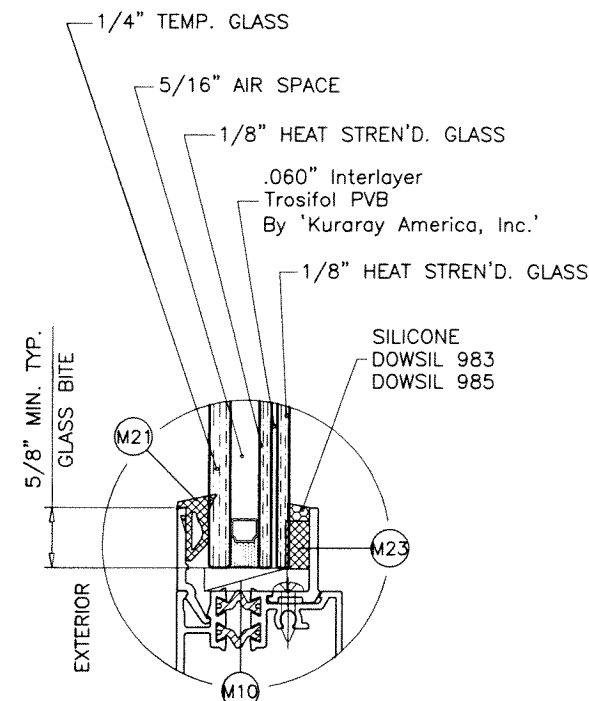

FIX. LITE

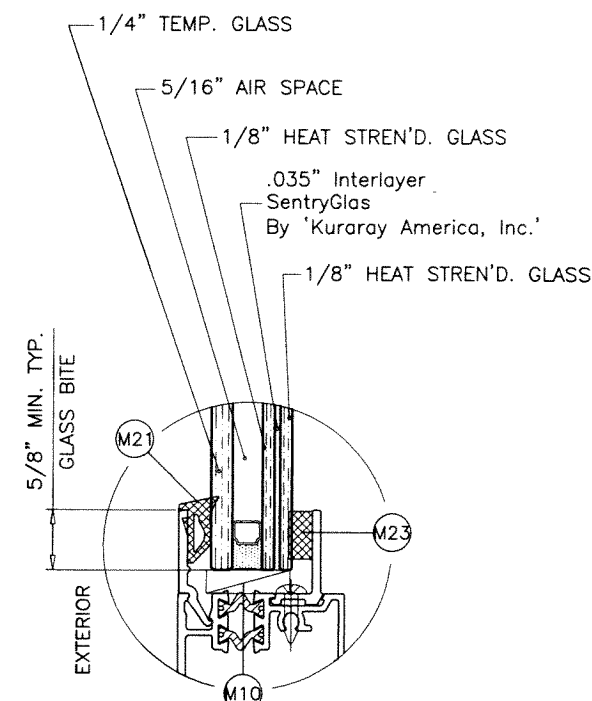

FIX. LITE

GLAZING DETAILS

7/8" OVERALL INSUL. LAM. GLASS


5/16" AIR SPACE CONSISTING OF:
SPACER:
'HELIMA' LOW PROFILE ALUMINUM SPACER
BY 'LINGERMANN GMBH'
AROUND THE PERIMETER OF THE GLASS.
PERIMETER SEALANT:
SILICONE
DOWSIL 791
GE 2000

PRODUCT RENEWED
as complying with the Florida
Building Code
NOA-No. **26-0506.03**
Expiration Date: **08/25/2031**
By: *Manuel Ferraz*
Miami-Dade Product Control

PRODUCT REVISED
As complying with the Florida
Building Code
NOA-No. **23-0928.19**
Expiration Date: **08/25/2026**

By: *Manuel Ferraz*
Miami-Dade Product Control

SEP 20 2023

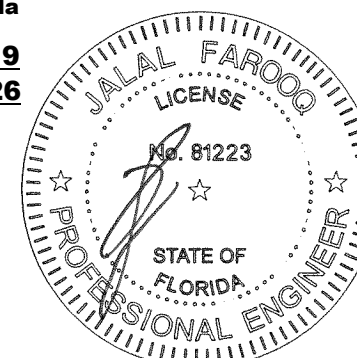

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

ES-SW340 THERMAL ALUMINUM SLIDING WDW. (S.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

no	date	by	description
A	06.08.16		NO CHANGE THIS SHEET
B	02.07.18		UPDATED TO 2017 FBC
C	11.05.20		UPDATED TO 2020 FBC
D	09.08.23		NO CHANGE THIS SHEET

date: 04-07-16

scale: 1/2" = 1"



dr. by: TARIQ

chk. by:

drawing no.
W16-22

sheet **3** of **11**

COMP-ANL\W16-22ESW

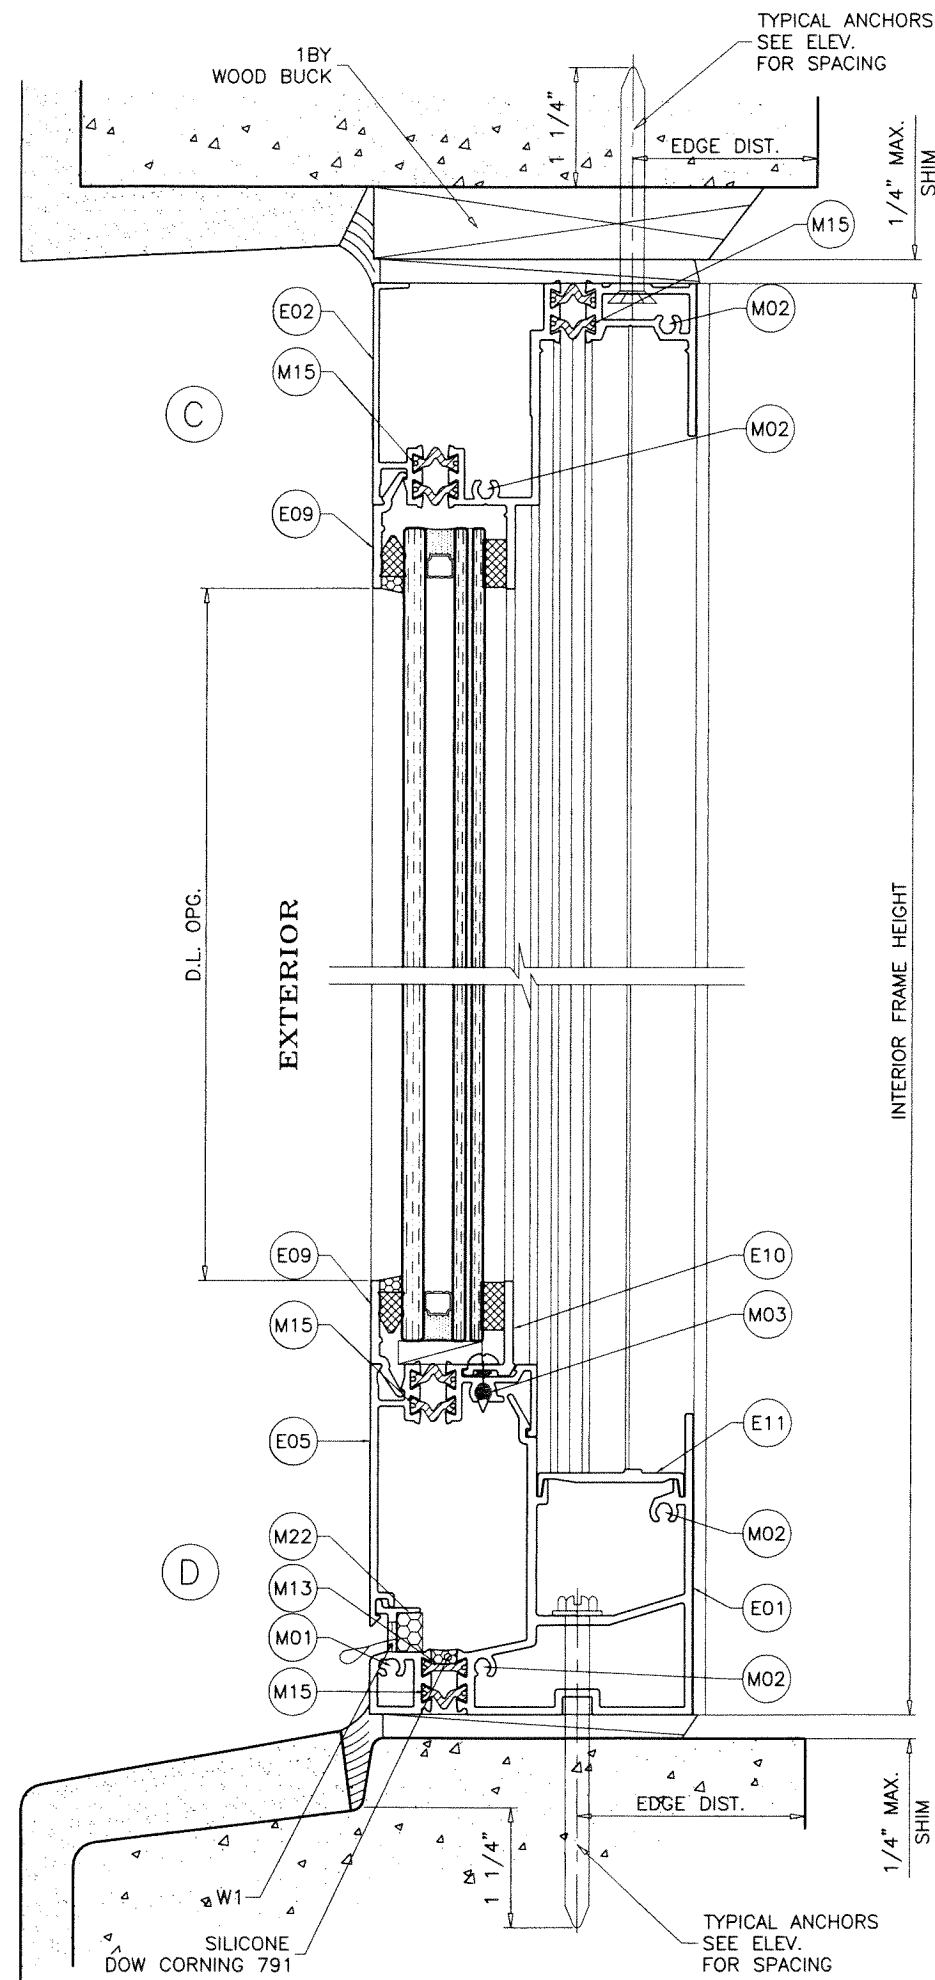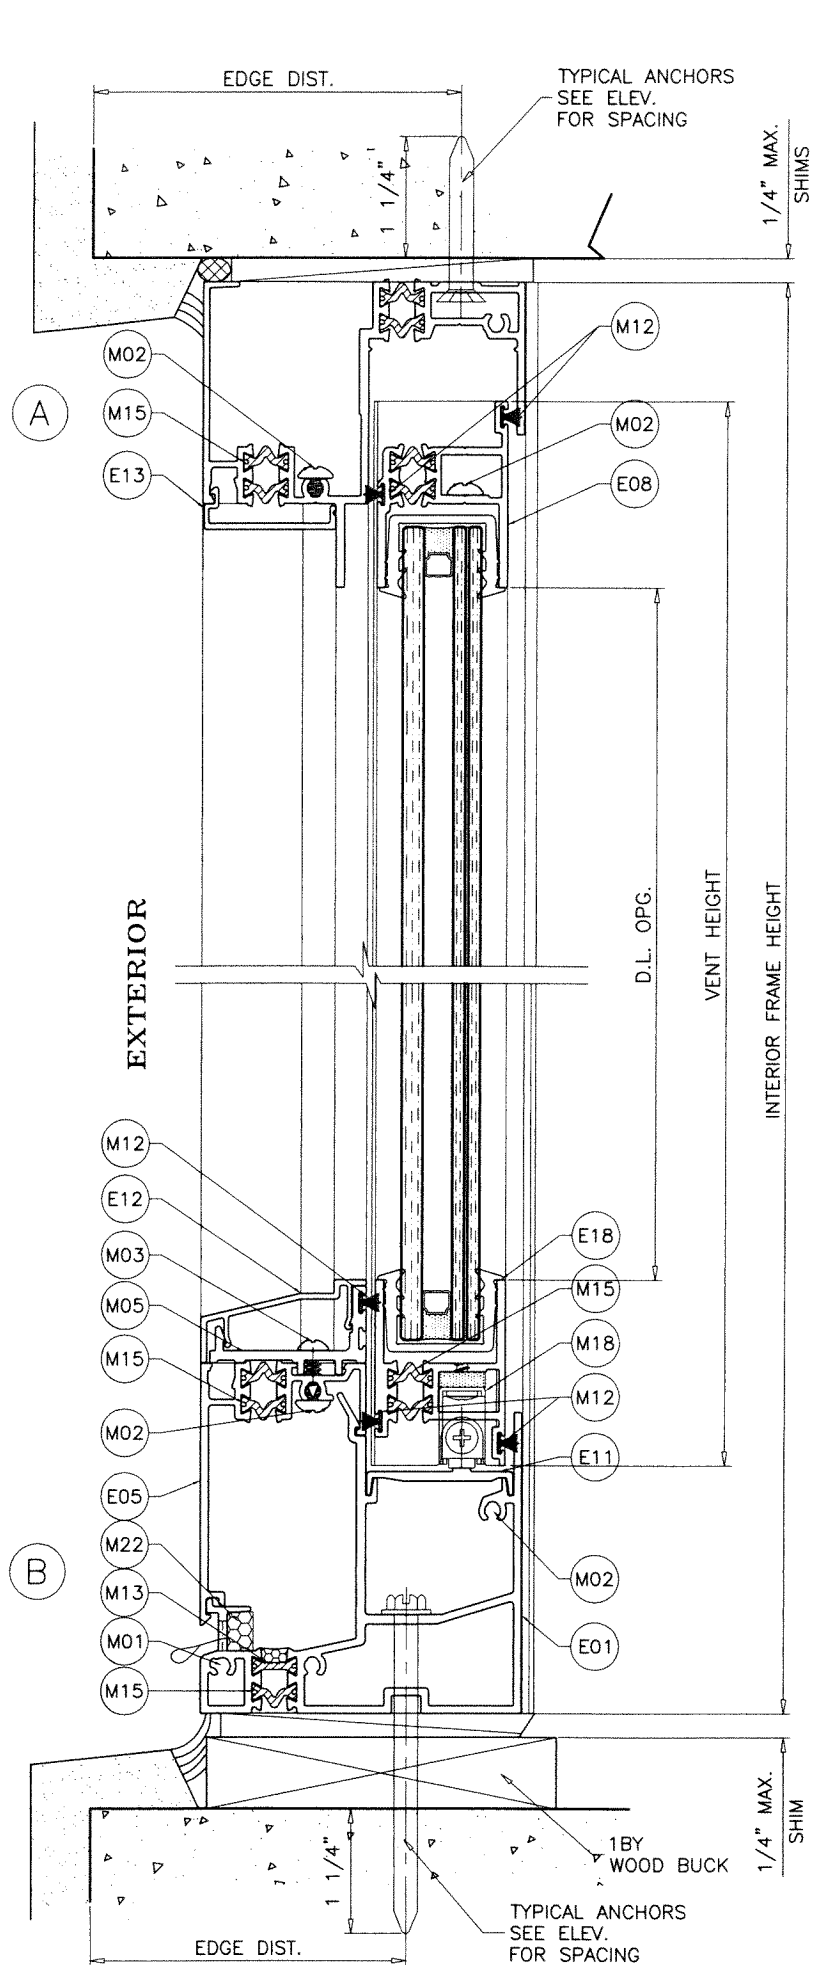


WEEPHOLES:

- W1 = (2) 3/16" X 2" WEEPHOLES AT EACH VENT
(2) 3/16" X 2" WEEP HOLES AT FIX. LITE

PRODUCT REVISED
As complying with the Florida
Building Code
NOA-No. **23-0928.19**
Expiration Date: **08/25/2026**
By: *Manuel Perez*
Miami-Dade Product Control

SEP 20 2023

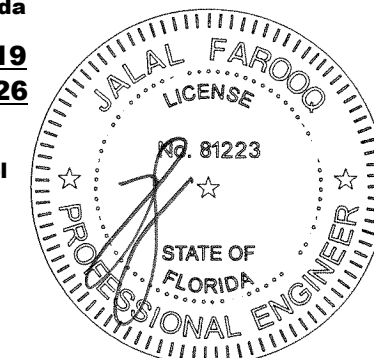

PRODUCT RENEWED
as complying with the Florida
Building Code
NOA-No. **26-0506.03**
Expiration Date: **08/25/2031**
By: *Manuel Perez*
Miami-Dade Product Control

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
(C.A.N. 3538)

ES-SW340 THERMAL ALUMINUM SLIDING WDW. (S.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

no	date	by	description
A	06.08.16	REV. PER RER COMMENTS	
B	02.07.18	NO CHANGE THIS SHEET	
C	11.05.20	UPDATED TO 2020 FBC	
D	09.08.23	NO CHANGE THIS SHEET	

date: 04-07-16	scale: 1/2" = 1"	dr. by: TARIQ	chk. by:
drawing no. W16-22			
sheet 4 of 11			

COMP-ANL\W16-22ESW

WOOD BUCKS AND METAL STRUCTURE NOT BY 'E.S. WINDOWS'
MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM
AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

#14 DIA. CRETE-FLEX SS4 BY 'DEWALT' (Fu=190 KSI, Fy=127 KSI)

1/4" DIA. AGGRE-GATOR 300 BY 'DEWALT' (Fu=96 KSI, Fy=57 KSI)

1/4" DIA. ULTRA CON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)

INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
1-1/2" MIN. PENETRATION INTO WOOD (HEAD/SILL/JAMBS)

THRU 1BY BUCKS INTO CONC. OR BLOCKS
1-1/4" MIN. EMBED INTO CONCRETE (HEAD/SILL)
1-1/4" MIN. EMBED INTO CONC. OR BLOCKS (JAMBS)

DIRECTLY INTO CONC. OR BLOCKS
1-1/4" MIN. EMBED INTO CONCRETE (HEAD/SILL)
1-1/4" MIN. EMBED INTO CONC. OR BLOCKS (JAMBS)

1/4" DIA. ULTRA CON SS4 410 BY 'DEWALT' (Fu=190 KSI, Fy=164 KSI)

INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
1-1/2" MIN. PENETRATION INTO WOOD (HEAD/SILL/JAMBS)

THRU 1BY BUCKS INTO CONC. OR BLOCKS
1-1/4" MIN. EMBED INTO CONCRETE (HEAD/SILL)
1-1/4" MIN. EMBED INTO CONC. OR GROUT-FILLED BLOCKS (JAMBS)

DIRECTLY INTO CONC. OR BLOCKS
1-1/4" MIN. EMBED INTO CONCRETE (HEAD/SILL)
1-1/4" MIN. EMBED INTO CONC. OR GROUT-FILLED BLOCKS (JAMBS)

1/4" DIA. BI-FLEX 300 SELF DRILLING SCREWS BY 'DEWALT' (Fu=96 KSI, Fy=57 KSI)




1/4" DIA. DRIL-FLEX SELF DRILLING SCREWS BY 'DEWALT' (GRADE 5 CRS)

INTO MIAMI-DADE COUNTY APPROVED MULLIONS
OR
INTO METAL STRUCTURES (HEAD/SILL/JAMBS)
(3) THREADS MIN. TO EXTEND BEYOND METAL THICKNESS
ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)
STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.)
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

ANCHOR EDGE DISTANCES


INTO CONCRETE AND BLOCKS = 2-1/2" MIN.
INTO WOOD STRUCTURE = 1" MIN.
INTO METAL STRUCTURE = 3/4" MIN.

WOOD AT HEAD, SILL OR JAMBS SG = 0.55 MIN.
CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.
C-90 HOLLOW/FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

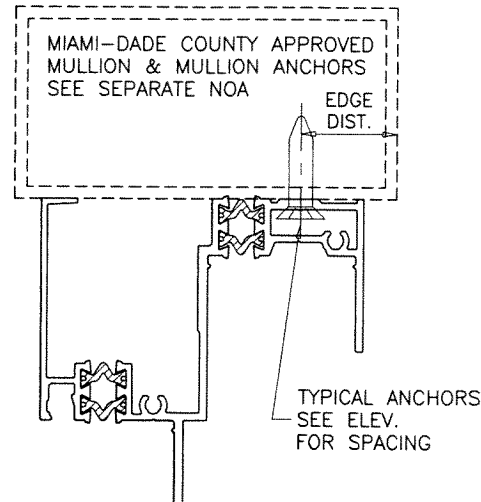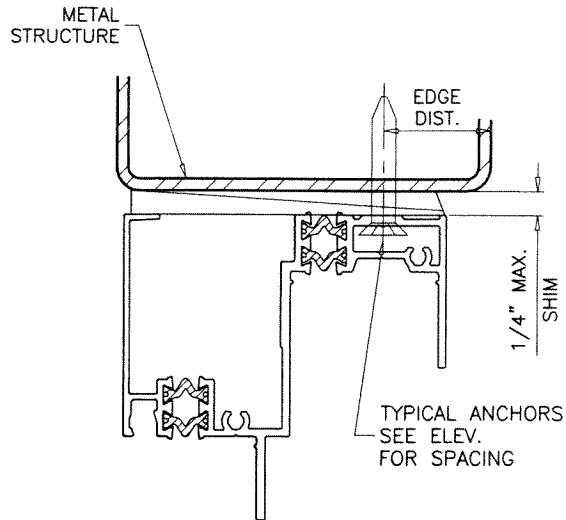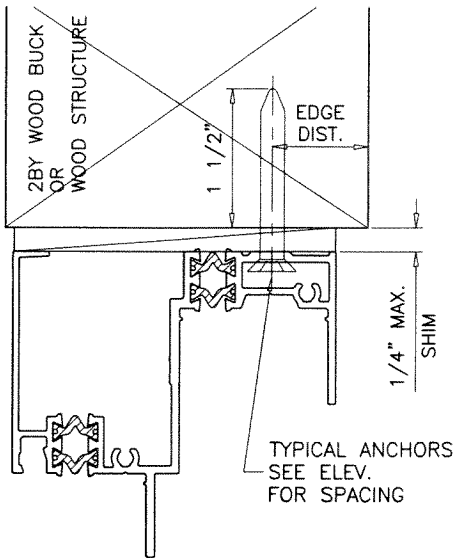

PRODUCT RENEWED
as complying with the Florida
Building Code
NOA-No. **26-0506.03**
Expiration Date: **08/25/2031**
By: *Manuel Perez*
Miami-Dade Product Control

PRODUCT REVISED
As complying with the Florida
Building Code
NOA-No. **23-0928.19**
Expiration Date: **08/25/2026**
By: *Manuel Perez*
Miami-Dade Product Control

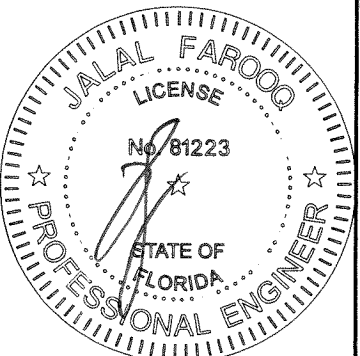

af c

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
(C.A.N. 3538)

ES-SW340 THERMAL ALUMINUM SLIDING WDW. (S.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

no.	date	by	description
A	06.08.16		NO CHANGE THIS SHEET
B	02.07.18		UPDATED TO 2017 FBC
C	11.05.20		UPDATED TO 2020 FBC
D	09.08.23		NO CHANGE THIS SHEET

date: 04-07-16

scale: 1/2" = 1"

dr. by: TARIQ

chk. by:




drawing no.

W16-22

sheet 5 of 11


COMP - ANL \ W16-22ESW

SEP 20 2023

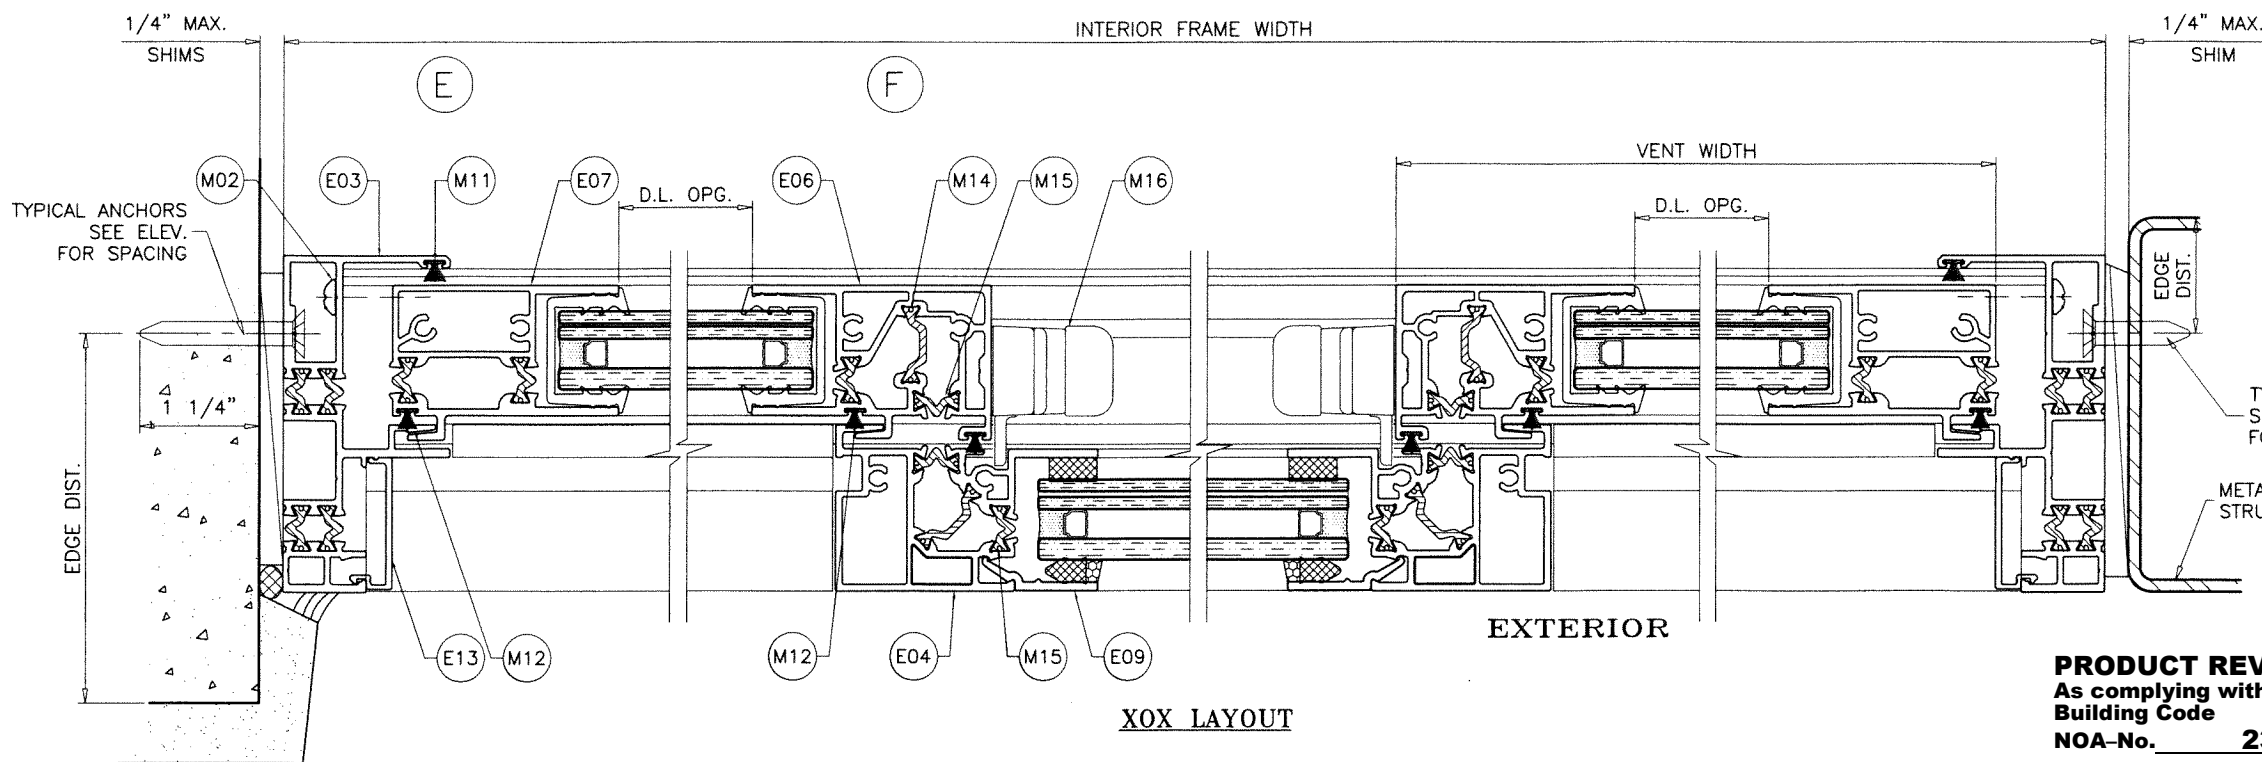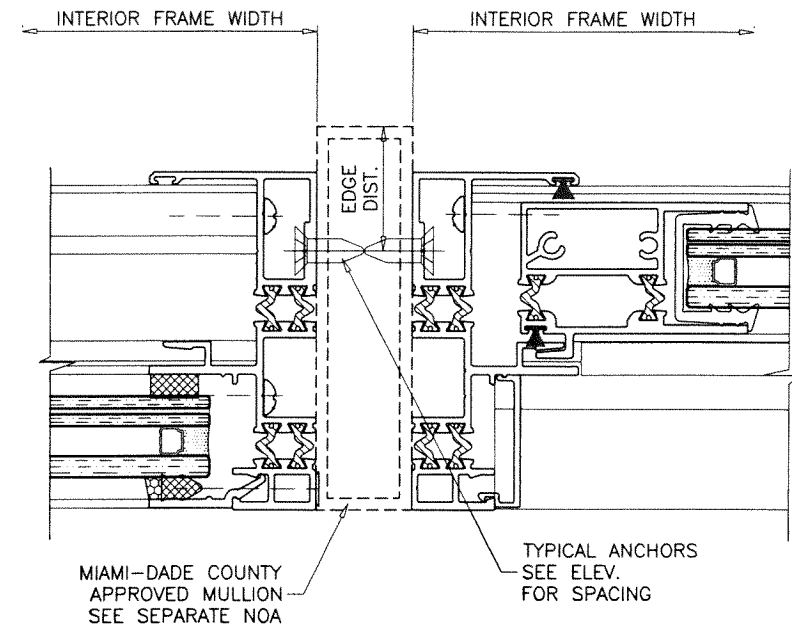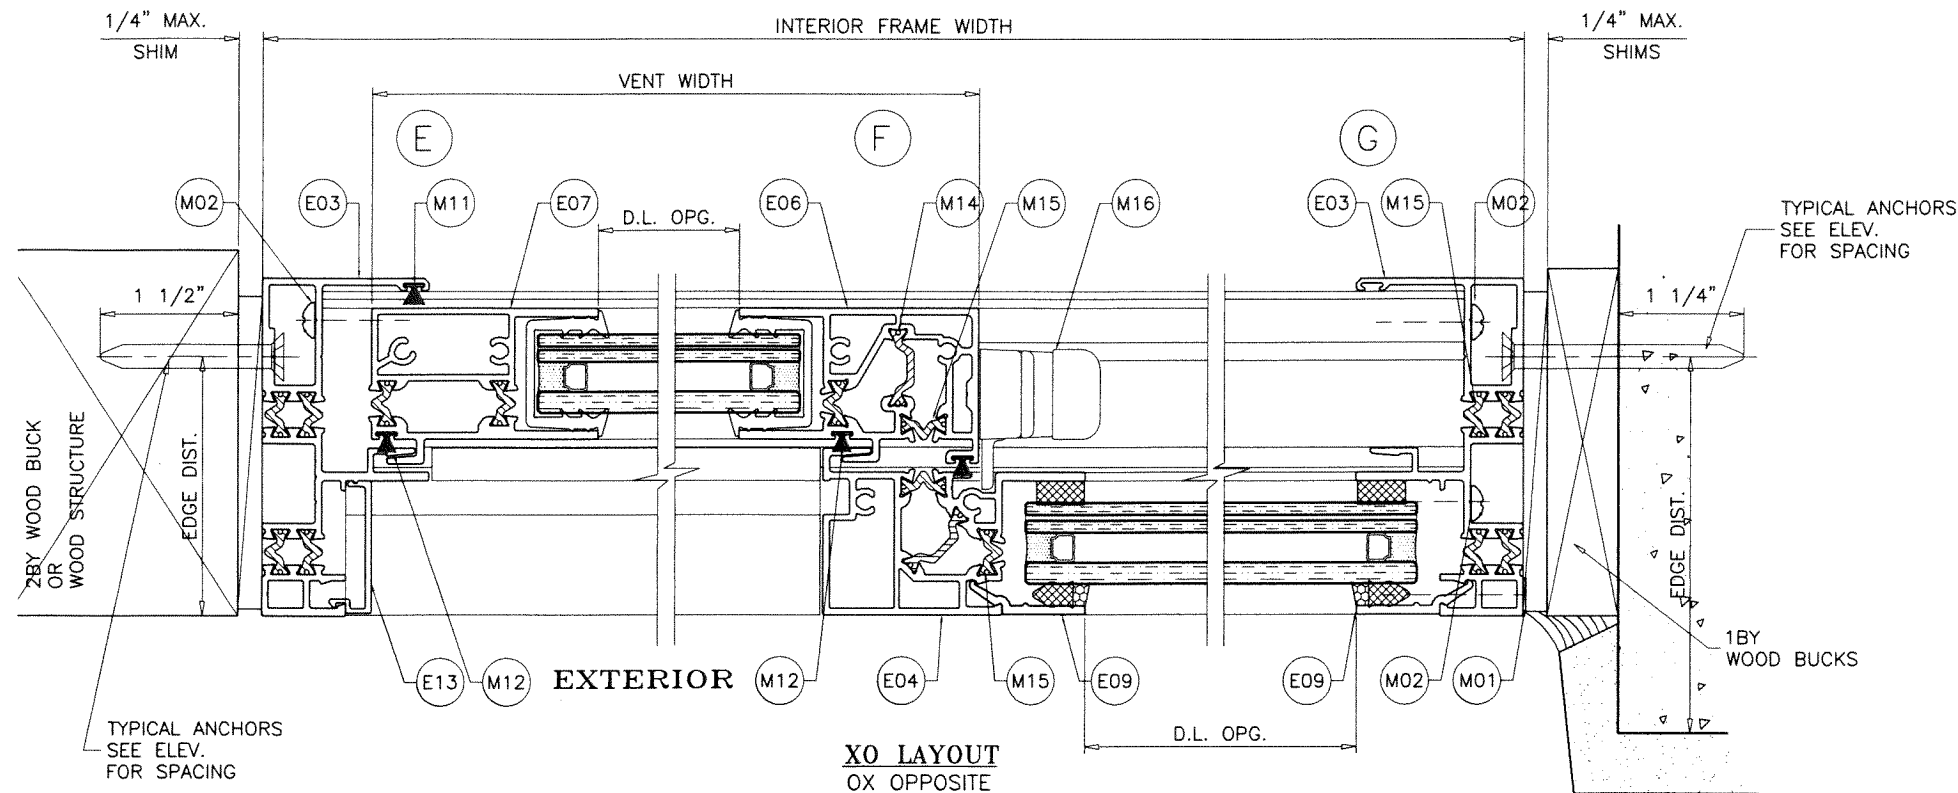

PRODUCT RENEWED
as complying with the Florida
Building Code
NOA-No. **26-0506.03**
Expiration Date: **08/25/2031**
By: *Manuel Ferrer*
Miami-Dade Product Control

PRODUCT REVISED
As complying with the Florida
Building Code
NOA-No. **23-0928.19**
Expiration Date: **08/25/2026**
By: *Manuel Ferrer*
Miami-Dade Product Control
SEP 20 2023

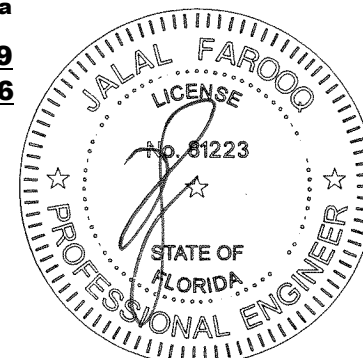







AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL W16-22ESW

ES-SW340 THERMAL ALUMINUM SLIDING WDW. (S.M.I.)
E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

no.	date	by	description
A	06.08.16		NO CHANGE THIS SHEET
B	02.07.18		NO CHANGE THIS SHEET
C	11.05.20		UPDATED TO 2020 FBC
D	09.08.23		NO CHANGE THIS SHEET

date: 04-07-16	scale: 1/2" = 1"	dr. by: TARIQ	chk. by:
----------------	------------------	---------------	----------


drawing no.	W16-22
sheet	6 of 11

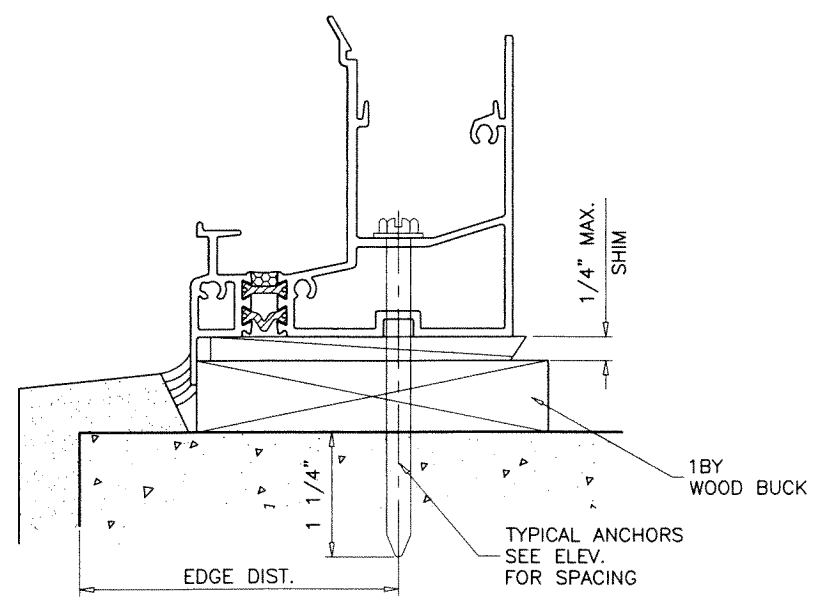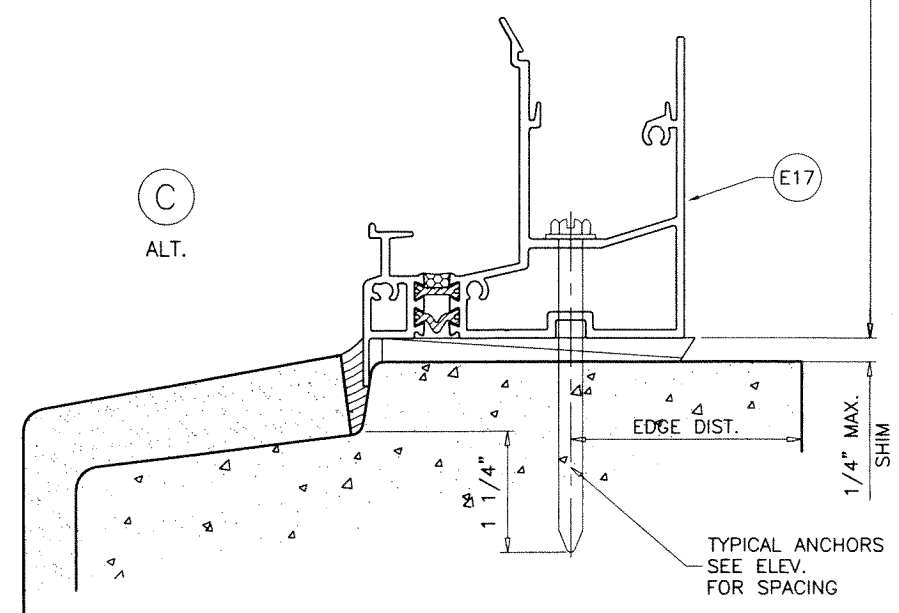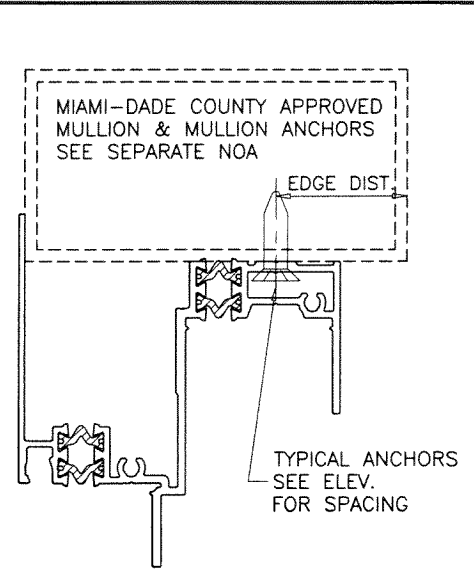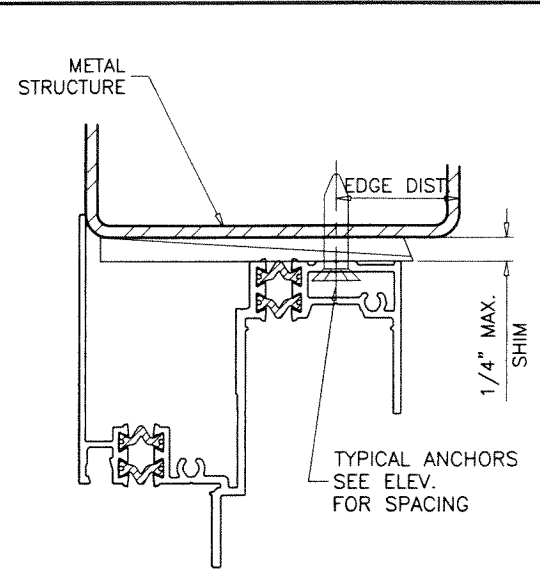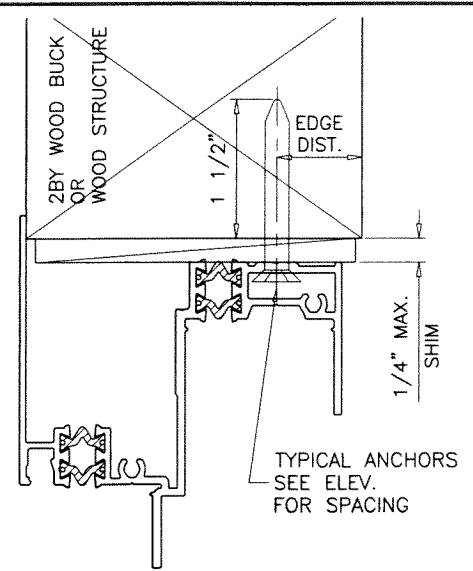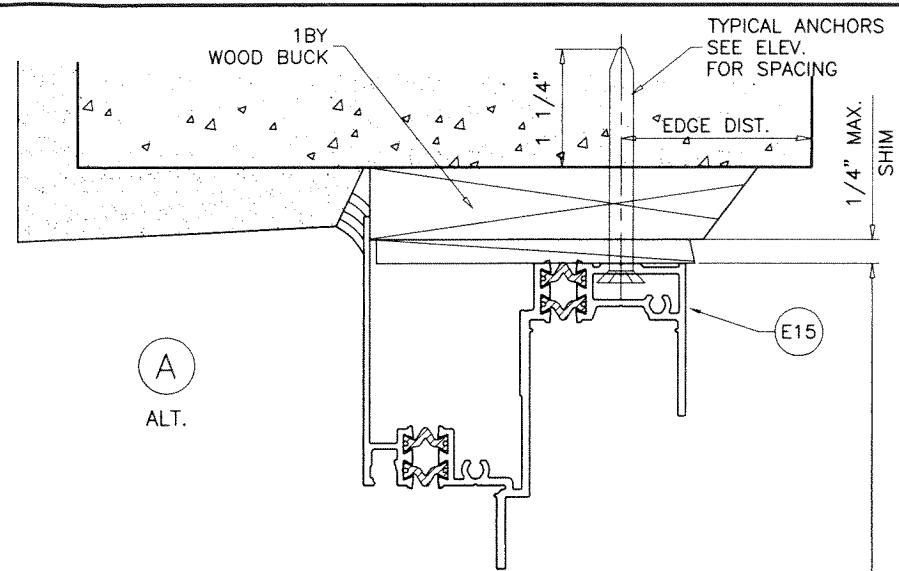

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 NOA-No. **26-0506.03**
 Expiration Date: **08/25/2031**
 By: *Manuel Perez*
 Miami-Dade Product Control

INSTALLATION DETAILS WITH FLANGE FRAMES

PRODUCT REVISED
 As complying with the Florida
 Building Code
 NOA-No. **23-0928.19**
 Expiration Date: **08/25/2026**
 By: *Manuel Perez*
 Miami-Dade Product Control
SEP 20 2023

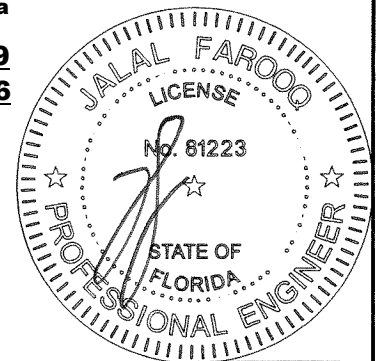

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173
 TEL. (305) 264-8100 FAX. (305) 262-6978

af c
 COMP-ANL W16-22ESW





ES-SW340 THERMAL ALUMINUM SLIDING WDW. (S.M.I.)

E.S. WINDOWS, LLC
 3550 N.W. 49 STREET
 MIAMI, FL. 33142
 TEL. (305) 638-5151 FAX. (305) 638-5158

no	date	by	description
A	06.08.16	REV. PER RER COMMENTS	
B	02.07.18	NO CHANGE THIS SHEET	
C	11.05.20	UPDATED TO 2020 FBC	
D	09.08.23	NO CHANGE THIS SHEET	

date: 04-07-16
 scale: 1/2" = 1"
 dr. by: TARIQ
 chk. by:

drawing no.
W16-22
 sheet 7 of 11

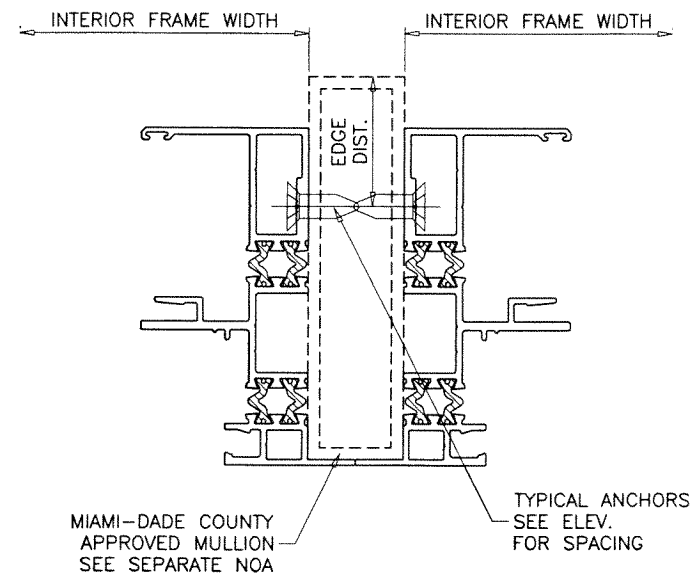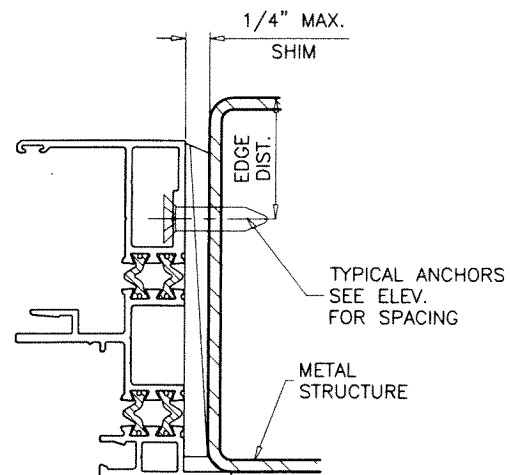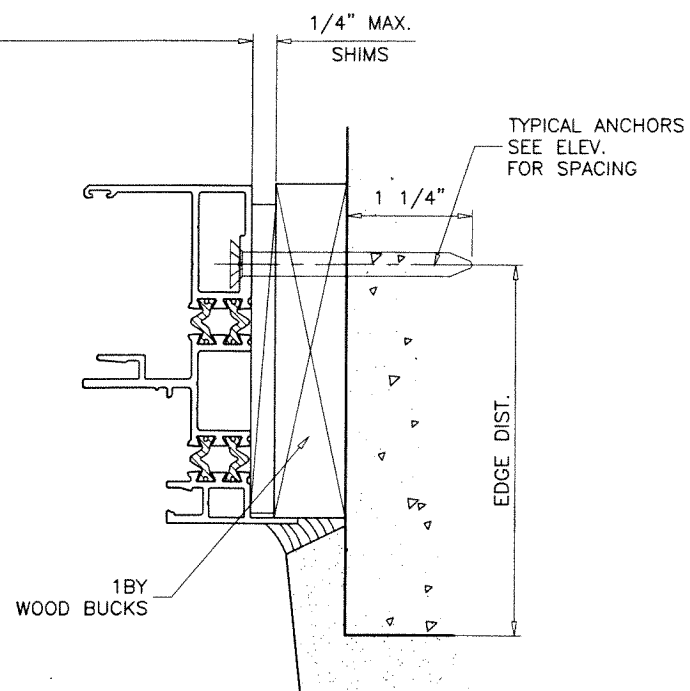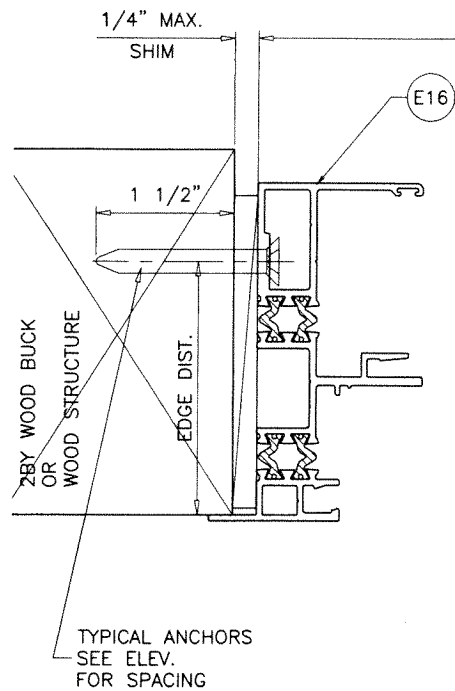


PRODUCT RENEWED
as complying with the Florida Building Code
NOA-No. **26-0506.03**
Expiration Date: **08/25/2031**
By: *Manuel Perez*
Miami-Dade Product Control

INSTALLATION DETAILS WITH FLANGE FRAMES

PRODUCT REVISED
As complying with the Florida Building Code
NOA-No. **23-0928.19**
Expiration Date: **08/25/2026**
By: *Manuel Perez*
Miami-Dade Product Control

SEP 20 2023

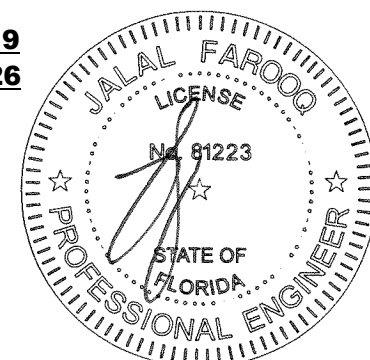

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
(C.A.N. 3538)
COMP-ANL W16-22ESW

ES-SW340 THERMAL ALUMINUM SLIDING WDW. (S.M.I.)
E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

no	date	by	description
A	06.08.16		NO CHANGE THIS SHEET
B	02.07.18		NO CHANGE THIS SHEET
C	11.05.20		UPDATED TO 2020 FBC
D	09.08.23		NO CHANGE THIS SHEET


date:	04-07-16
scale:	1/2" = 1"
dr. by:	TARIQ
chk. by:	

drawing no.
W16-22
sheet 8 of 11

ITEM #	PART #	REQD.	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
E01	ES-SW340-501	1	FRAME SILL FLUSH	6063-T6	-
E02	ES-H340-505	1	FRAME HEAD FLUSH	6063-T6	-
E03	ES-SW340-502	2	FRAME JAMB FLUSH	6063-T6	-
E04	ES-H340-507	AS REQD.	FIX. MEETING RAIL	6063-T6	-
E05	ES-SW340-503	-	FIXED BOTTOM	6063-T6	-
E06	ES-H340-508	-	VENT SIDE RAIL	6063-T6	-
E07	ES-SW340-504	2/ VENT	VERTICAL RAIL	6063-T6	-
E08	ES-H340-510	1/ VENT	VENT TOP RAIL	6063-T6	-
E09	ES-H340-003	4/ LITE	GLASS STOP	6063-T6	-
E10	ES-SW340-005	4/ LITE	HORIZONTAL FIXED GLASS STOP	6063-T5	-
E11	ES-SW340-006	1/ VENT	TRACK	6063-T6	-
E12	ES-SW340-007	-	COVER	6005-T5	-
E13	ES-H340-021	-	HORIZONTAL/VERTICAL TRIM	6063-T5	-
E14	ES-H340-007	-	TRIM FOR SCREEN	6063-T5	-
E15	ES-H340-506	1	FRAME HEAD FLANGE	6063-T6	-
E16	ES-SW340-506	2	FRAME JAMB FLANGE	6063-T6	-
E17	ES-SW340-505	1	FRAME SILL FLANGE	6063-T6	-
E18	ES-SW340-507	1/ VENT	VENT BOTTOM RAIL	6063-T6	-
M01	#10 X 1-1/2" FH	AS REQD.	FRAME ASSEMBLY FASTENER	ST/ST	-
M02	#10 X 1" PH	-	FRAME AND FIX. PANEL FASTENERS	ST/ST	-
M03	#8 X 1/2" PH	-	FOR ROLLER, PLASTIC PROFILE AND GLASS STOP	ST/ST	SPACED AT 10" O.C.
M04	#8 X 3/4" FH SMS	-	SWEEP LOCK FASTENER	-	-
M05	ES-SW340-301	-	PLASTIC EXTRUSION	RIGID PVC	-
M06	ES-H340-G05	AS REQD.	GLAZING GASKET	SILICONE	DUROMETER 70±5 SHORE A
M07	ES-H340-G02	AS REQD.	GLAZING GASKET	SILICONE	DUROMETER 70±5 SHORE A
M08	V2200	AS REQD.	GLAZING TAPE (3/16" X 3/8")	FOAM	-
M10	ES-21-B04A	2 LITE	SETTING BLOCKS	SILICONE	DUROMETER 80±5 SHORE A
M11	W23212NK	AS REQD.	WEATHERSTRIP	-	ULTRAFAB
M12	W23202NK	AS REQD.	WEATHERSTRIP	-	ULTRAFAB
M13	1142	AS REQD.	INSULBAR 12 MM FLAT	POLYAMIDE	ENSINGER
M14	2479	AS REQD.	INSULBAR 20 MM OFFSET	POLYAMIDE	ENSINGER
M15	2531	AS REQD.	INSULBAR 12 MM OFFSET	POLYAMIDE	ENSINGER
M16	3032	1/ VENT	SWEEP LOCK	DIE CAST ALUM	AT 13" FROM EACH END
M17	ES1050-PL1	-	FLAT BOLT	ST/ST	-
M18	RU-340-IR	2/ VENT	TANDEM ROLLER	ST/ST	AT 5" FROM EACH END
M20	ES-H340-G01	-	GLAZING GASKET	SILICONE	DUROMETER 70±5 SHORE A
M21	PS-1127E	-	GLAZING GASKET	SILICONE	DUROMETER 70±5 SHORE A
M22	ES-SD450-F01	AS REQD.	RETICULATED FOAM (5/8" X 5/8" X 2")	FOAM	-
M23	80-378A	-	GLAZING GASKET	EPDM	DUROMETER 80±5 SHORE A


SEALANTS:

FRAME AND VENT CORNERS AND INSTALLATION SCREWS AT SILL SEALED WITH 'ACCURA' ARCYLIC LATEX SEALANT BY 'M-D BUILDING PRODUCTS'.

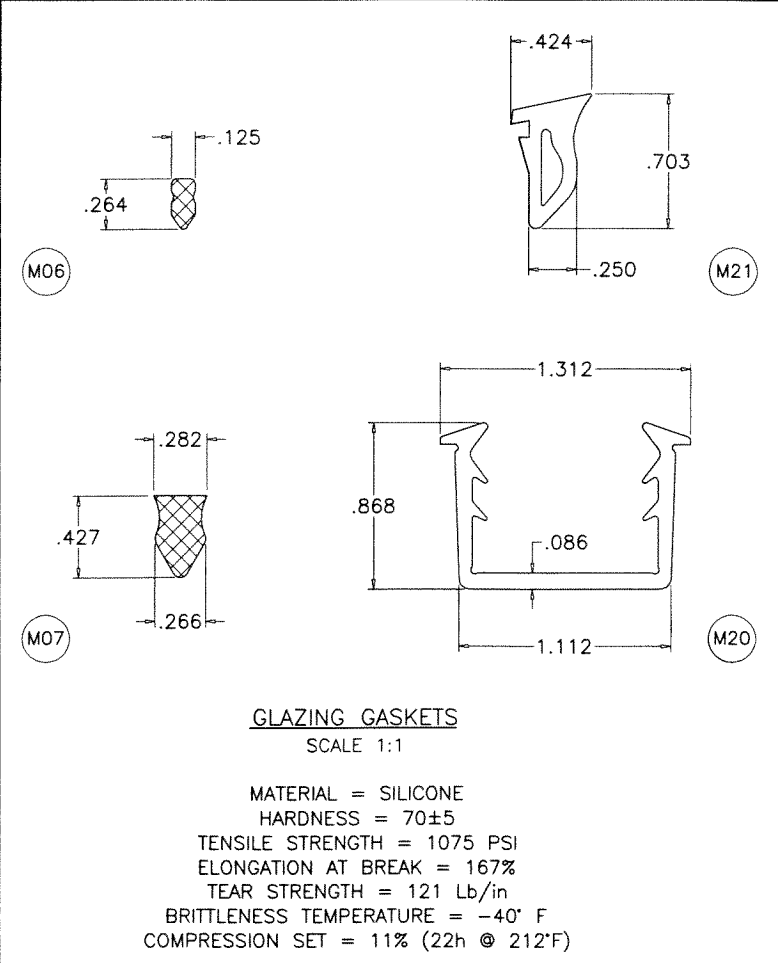

PRODUCT REVISED
As complying with the Florida Building Code
NOA-No. 23-0928.19
Expiration Date: 08/25/2026
By: Manuel Perez
Miami-Dade Product Control

SEP 20 2023

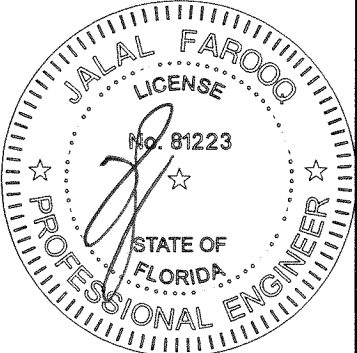

PRODUCT RENEWED
as complying with the Florida Building Code
NOA-No. 26-0506.03
Expiration Date: 08/25/2031
By: Manuel Perez
Miami-Dade Product Control

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
(C.A.N. 3538)






















ES-SW340 THERMAL ALUMINUM SLIDING WDW. (S.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:		date:		scale:		dr. by:		chk. by:	
no	date	no	date	1/2" = 1"		TARIQ			
A	06.08.16								
B	02.07.18								
C	11.05.20								
D	09.08.23								

drawing no. **W16-22**

sheet **9** of **11**

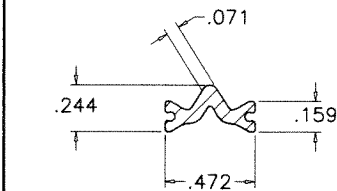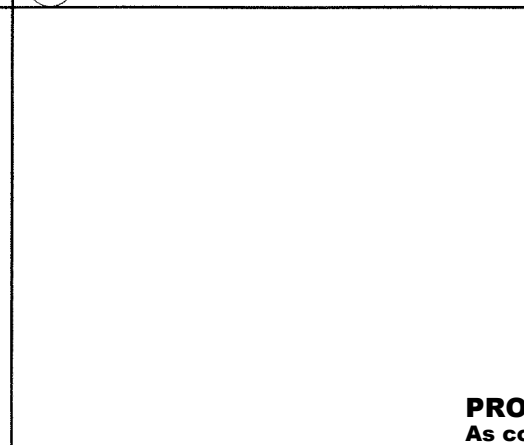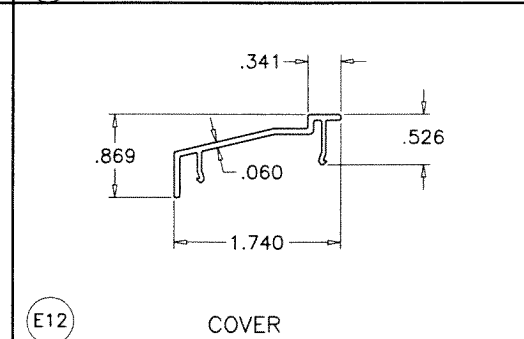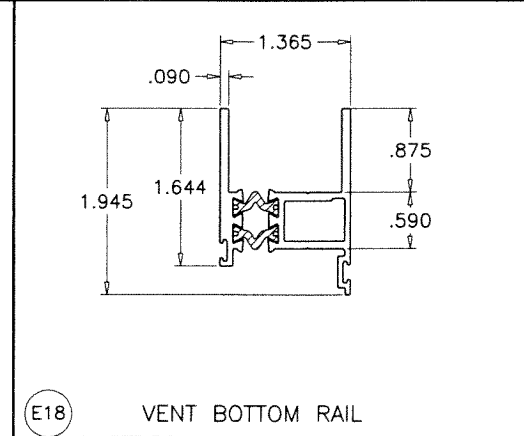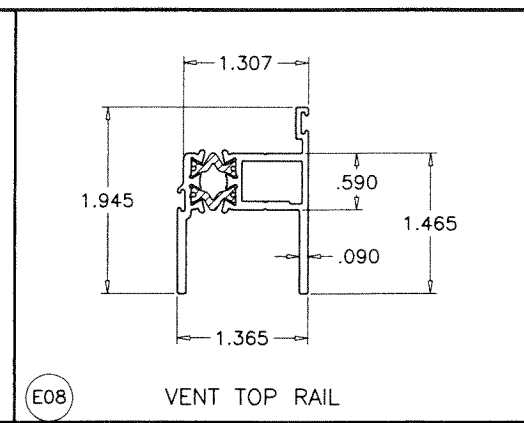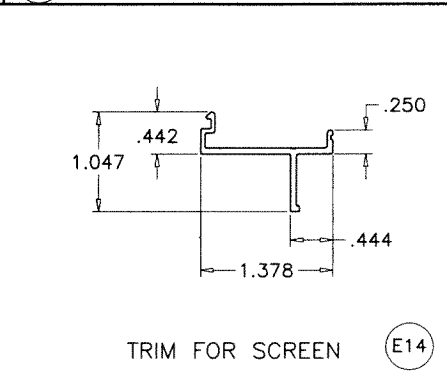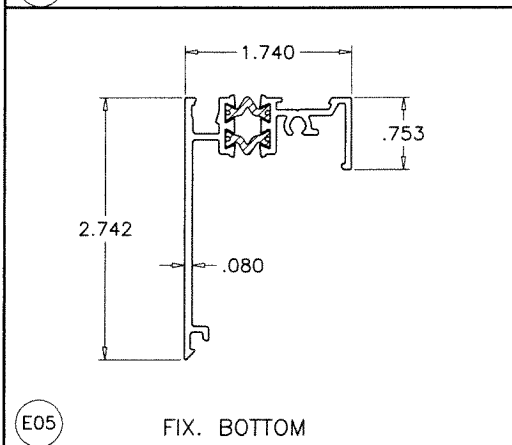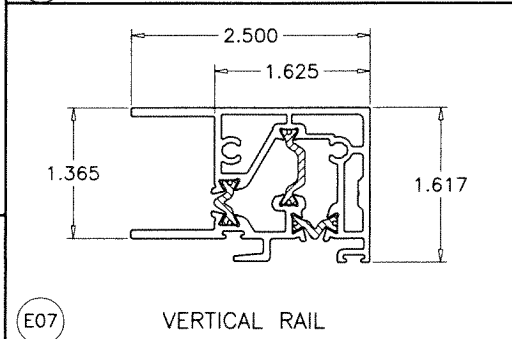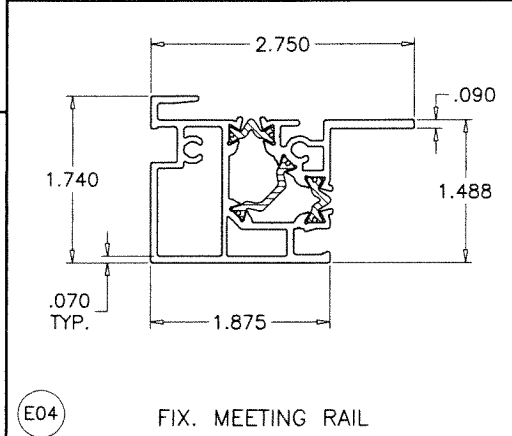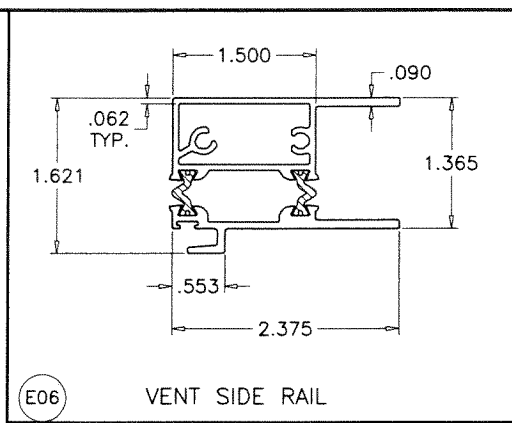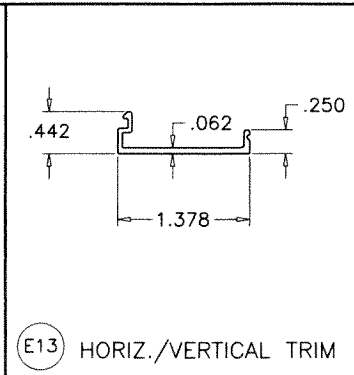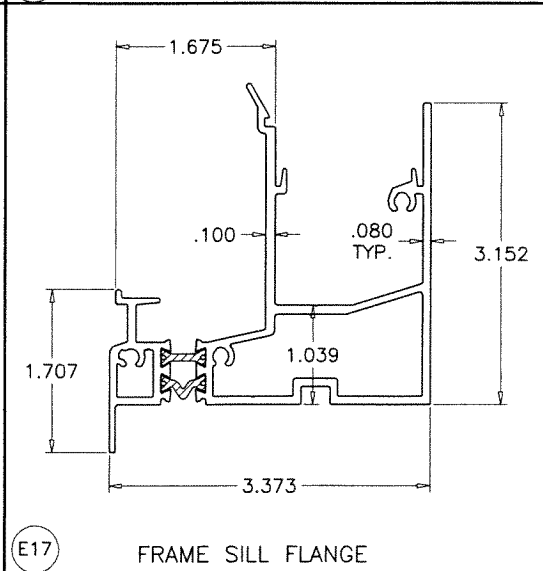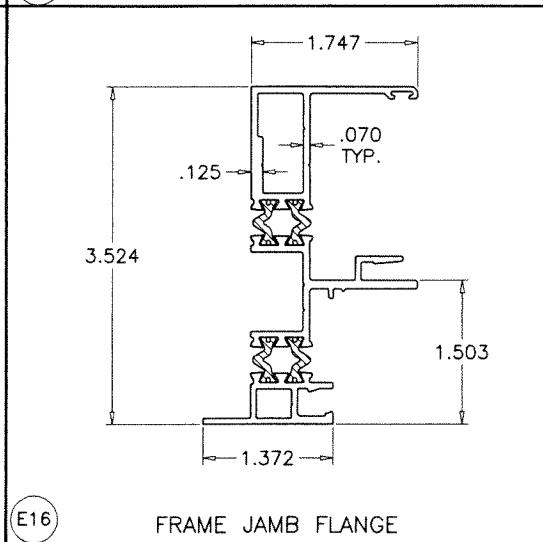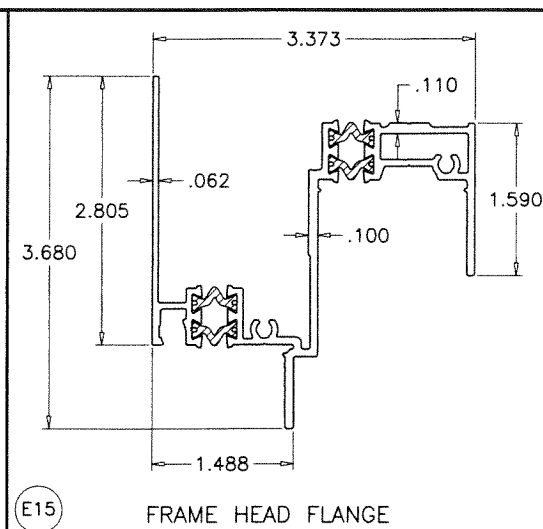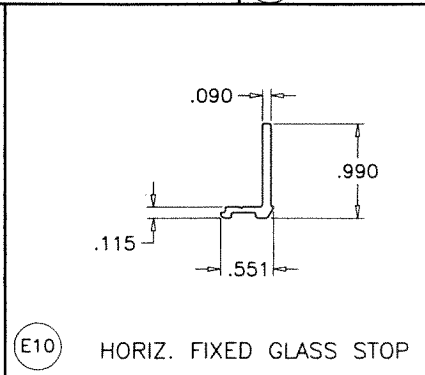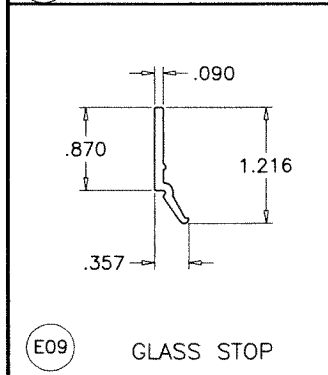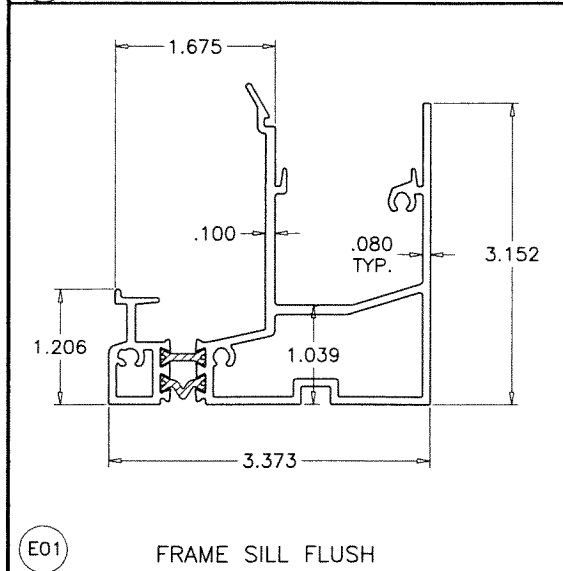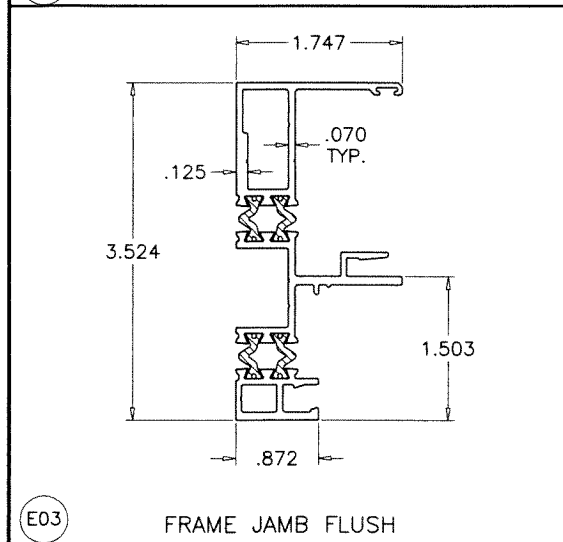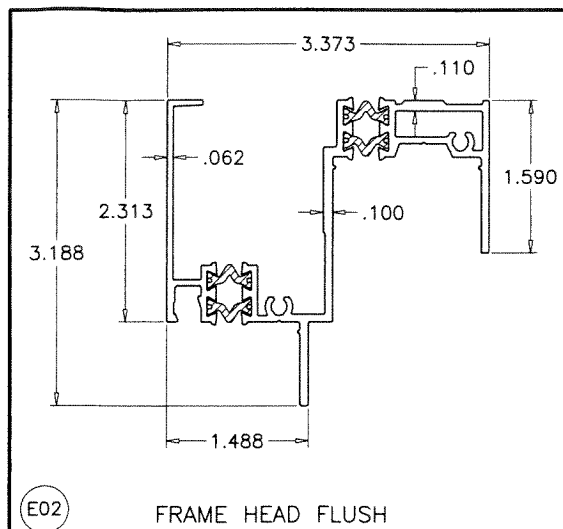


TECATHERM® 66 GF INSULBARS
SCALE 1:1

MATERIAL = POLYAMIDE
TENSILE STRENGTH = 13031 PSI
RATE OF BURN = .752 IN./MIN.
SELF IGNITION TEMP. = 793° F
FLASH IGNITION TEMP. = 781°C
SMOKE DENSITY = 1.63

PRODUCT RENEWED
as complying with the Florida
Building Code
NOA-No. **26-0506.03**
Expiration Date: **08/25/2031**
By: *Manuel Perez*
Miami-Dade Product Control

PRODUCT REVISED
As complying with the Florida
Building Code
NOA-No. **23-0928.19**
Expiration Date: **08/25/2026**
By: *Manuel Perez*
Miami-Dade Product Control

SEP 20 2023

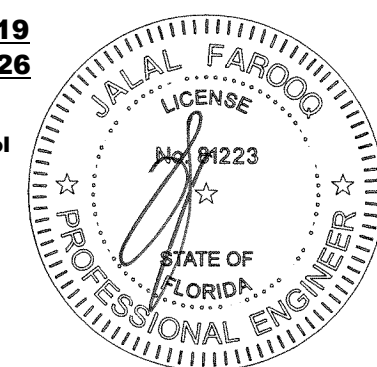

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

COMP-ANL\W16-22ESW


ES-SW340 THERMAL ALUMINUM SLIDING WDW. (S.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158


no	date	by	description
A	06.08.16	REV. PER RER COMMENTS	
B	02.07.18	NO CHANGE THIS SHEET	
C	11.05.20	UPDATED TO 2020 FBC	
D	09.08.23	NO CHANGE THIS SHEET	

date: 04-07-16
scale: 1/2" = 1"
dr. by: TARIQ
chk. by:


drawing no.
W16-22
sheet 10 of 11

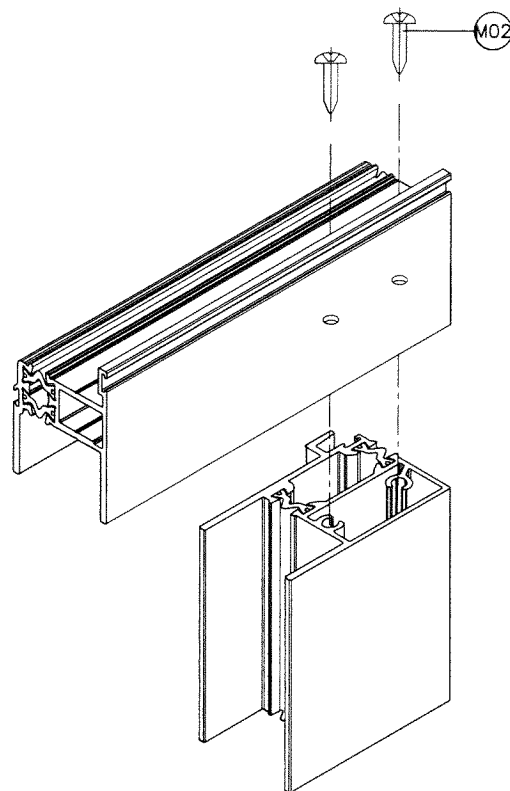


VENT TOP CORNERS

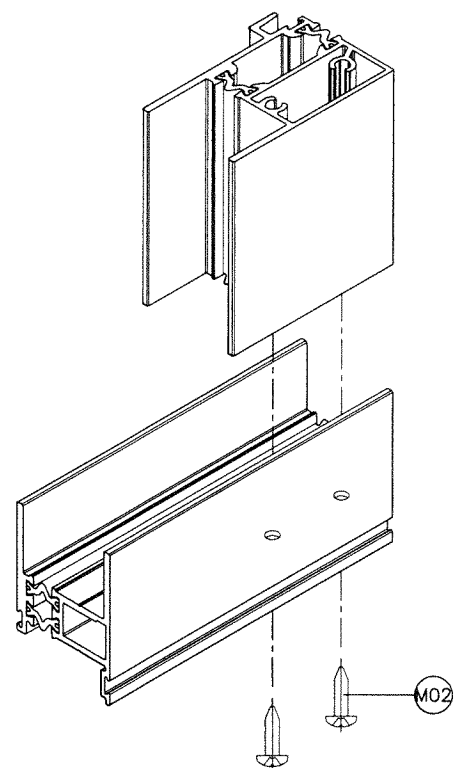


VENT BOTTOM CORNERS

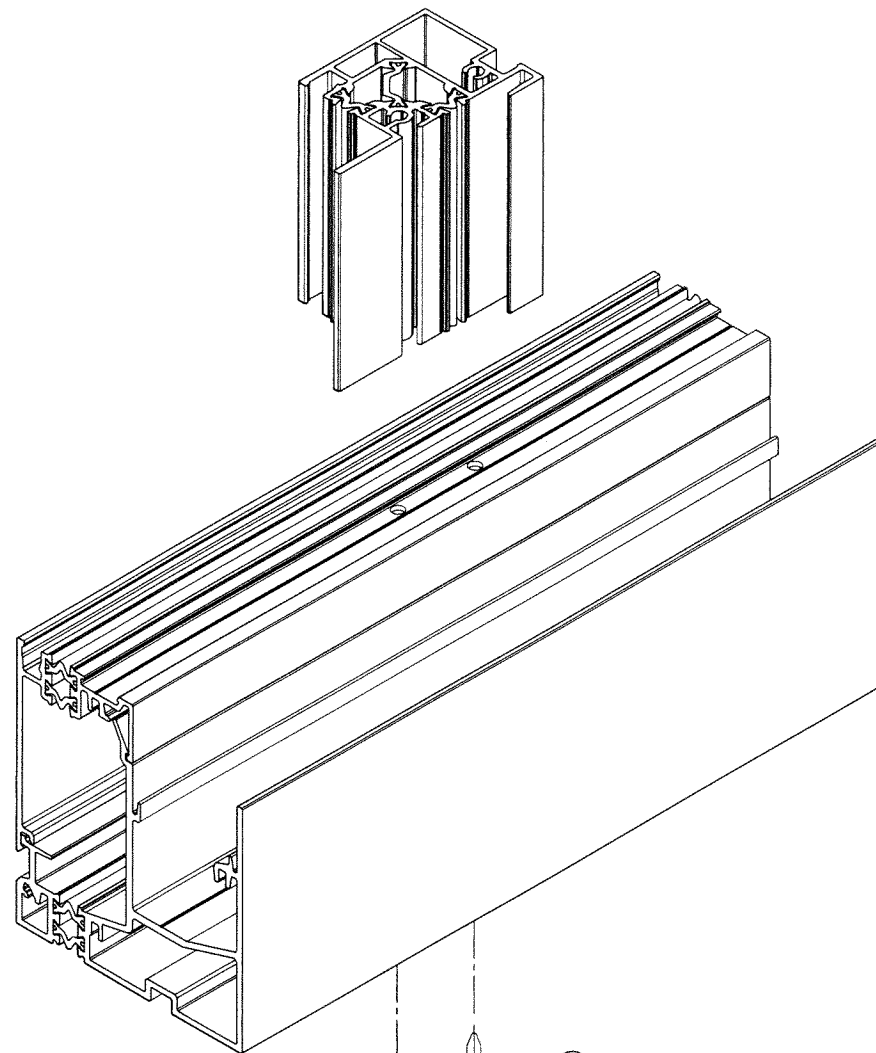

FIXED MTG. RAIL CORNER

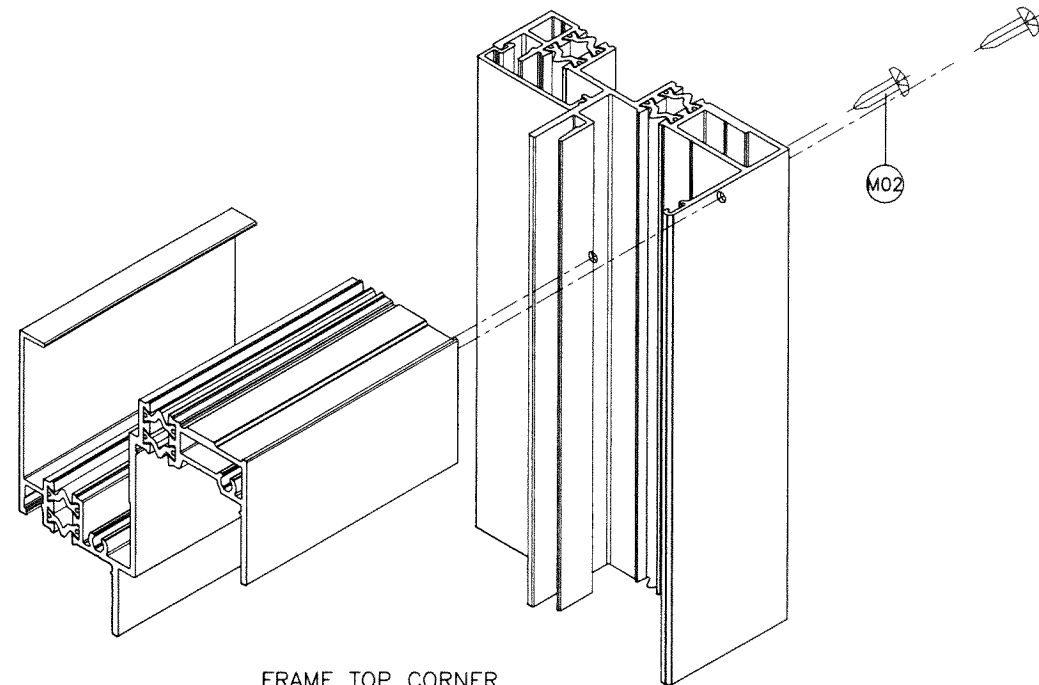

FRAME TOP CORNER

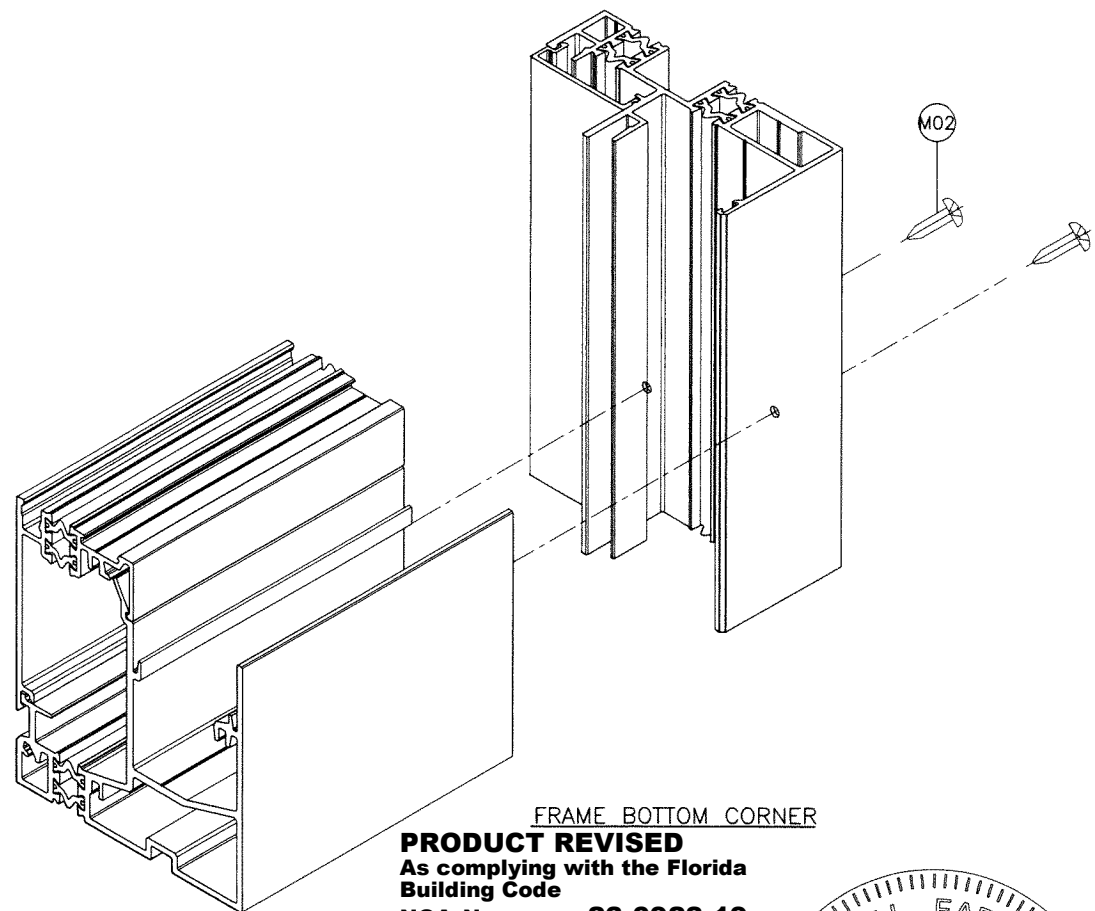


FRAME BOTTOM CORNER

PRODUCT RENEWED
as complying with the Florida
Building Code
NOA-No. **26-0506.03**
Expiration Date: **08/25/2031**
By: *Manuel Ferrer*
Miami-Dade Product Control

PRODUCT REVISED
As complying with the Florida
Building Code
NOA-No. **23-0928.19**
Expiration Date: **08/25/2026**
By: *Manuel Ferrer*
Miami-Dade Product Control

SEP 20 2023

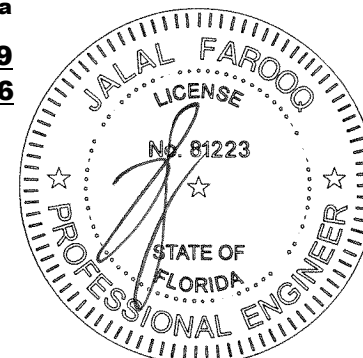

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
(C.A.N. 3538)

ES-SW340 THERMAL ALUMINUM SLIDING WDW. (S.M.I.)
E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:	no	date	by	description
	A	06.08.16		NO CHANGE THIS SHEET
	B	02.07.18		NO CHANGE THIS SHEET
	C	11.05.20		UPDATED TO 2020 FBC
	D	09.08.23		NO CHANGE THIS SHEET

date: 04-07-16
scale: 1/2" = 1"
dr. by: TARIQ
chk. by:

drawing no.
W16-22
sheet 11 of 11

COMP-ANL\W16-22ESW