



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION
NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY, FLORIDA
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/building

PGT Industries, LLC
3400 Precision Drive,
North Venice, Fl. 34275

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER -Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "SGD-5570" Vinyl Sliding Glass Door (Reinforced) w/wo 90° & 135° corners-L.M.I.

APPROVAL DOCUMENT: Drawing No. MD-5570.0 Rev G, titled "Vinyl Sliding Glass Door NOA (LM)", sheets 1 through 21 of 21, dated 04/14/16 and last revised on 05/25/26, prepared by manufacturer, signed and sealed by Anthony Lynn Miller, P.E., bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LIMITATIONS:

1. See table 1 (sheet 7) and consolidated table 2 (sheet 8) for applicable SGD unit sizes, design pressures, reinforcement types, glass types, sill riser (see tables B-1 and B-2, sheets 7 and 8) and anchor layout sheets requirements in 12 thru 16. See Glazing types, interlayers and details in sheet 10.
2. Rigid White PVC, Tan (Non-White) Rigid PVC and Black and lighter shade cap coated Rigid PVC and White Rigid PVC (Painted or laminated) to be labeled per referenced NOA's requirements.
3. Egress operable doors must comply with min clear width or height per FBC requirement, as applicable.
4. Pocket walls under separate approval, to be reviewed by Building official

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **renews NOA No. 23-0710.11** and consists of page 1 and evidence pages E-1, E-2, E-3, E-4, E-5, E-6 and E-7, as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P.E.**



NOA No. 26-0611.02
Expiration Date: August 04, 2031
Approval Date: July 09, 2026

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED


1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's

A. DRAWINGS

1. Manufacturer's die drawings and sections (*Submitted under NOA No. 14-0320.03*)
2. Drawing No. **MD-5570W.0**, titled "Vinyl Sliding Glass Window (LM)", sheets 1 through 21 of 21, dated 04/14/16, with revision **E** dated 11/23/22, prepared by manufacturer, signed and sealed by Anthony Lynn Miller, P.E. (*Submitted under NOA No. 22-1205.02*)

B. TESTS

1. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of series "5570" vinyl sliding glass door w/pockets, prepared by QAI Laboratories, Test Report No. **QAI-22-1081**, dated 11/08/22, signed and sealed by Idalmis Ortega, P.E
(*Submitted under NOA No. 22-1205.02*)
2. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of series "5570" vinyl sliding glass door w/pockets, prepared by QAI Laboratories, Test Report No. **NOK-0004**, dated 10/12/22, signed and sealed by Idalmis Ortega, P.E
(*Submitted under NOA No. 22-1205.02*)
3. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of series "770" aluminum sliding glass door and a series "5570" vinyl sliding glass door, prepared by QAI Laboratories, Test Report No. **QAI-22-1040**, dated 04/03/22, signed and sealed by Idalmis Ortega, P.E
(*Submitted under NOA No. 22-0407.10*)
4. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of series "770" aluminum sliding glass door, prepared by QAI Laboratories, Test Report No. **QAI-21-1218**, dated 01/27/22, signed and sealed by Idalmis Ortega, P.E (*Submitted under NOA No. 22-0407.10*)
5. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of series "5570" vinyl sliding glass door, prepared by QAI Laboratories, Test Report No. **QAI-21-1241**, dated 01/21/22, signed and sealed by Idalmis Ortega, P.E (*Submitted under NOA No. 22-0407.10*)


Ishaq I. Chanda, P.E.
Product Control Unit Supervisor
NOA No. 26-0611.02
Expiration Date: August 04, 2031
Approval Date: July 09, 2026

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's (CONTINUED)

B. TESTS (CONTINUED)

6. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per ASTM F588 and TAS 202-94

along with marked-up drawings and installation diagram of all PGT Industries, Inc. representative units listed below and tested to qualify **Dowsil 791** and **Dowsil 983** silicones, prepared by Fenestration Testing Laboratory, Inc., Test Reports No.:


FTL-7897, PGT PW5520 PVC Fixed Window (unit 6 in proposal), dated 09/03/14

FTL-20-2107.1, PGT SGD780 Aluminum Sliding Glass Door (unit 7 in proposal)

FTL-20-2107.2, PGT CA740 Alum. Outswing Casement Window (unit 8 in proposal) **FTL-20-2107.3**, PGT PW7620A Aluminum Fixed Window (unit 9 in proposal) and **FTL-20-2107.4**, PGT PW7620A Aluminum Fixed Window (unit 10 in proposal) dated 07/13/20, all signed 07/13/20, all signed and sealed by Idalmis Ortega, P.E. (*Submitted under NOA No. 20-0406.06*).

7. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94

along with marked-up drawings and installation diagram of a vinyl sliding glass door, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-8546**, dated 11/06/15 and revised on 01/04/16 and 02/11/16, Test Report No. **FTL-8547**, dated 12/04/15 and revised on 02/15/16, Test Report No. **FTL-8548**, dated 12/04/15 and revised on 01/04/16 and 02/11/16, Test Report No. **FTL-8549**, dated 11/06/15 and revised on 12/04/15 and Test Report No. **FTL-8552**, dated 12/04/15 and revised on 02/15/16, all signed and sealed by Idalmis Ortega, P.E. (*Submitted under NOA's No. 16-0505.01 and 15-1210.01*)



Ishaq I. Chanda, P.E.

Product Control Unit Supervisor

NOA No. 26-0611.02

Expiration Date: August 04, 2031

Approval Date: July 09, 2026

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's (CONTINUED)

B. TESTS (CONTINUED)

8. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94

along with marked-up drawings and installation diagram of a vinyl sliding glass door, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-6338**, (samples A-1 thru A-22), dated 11/19/10, signed and sealed by Jorge A. Causo, P.E.

(The above test report has an addendum letter dated 03/11/11, issued by Fenestration Testing Laboratory, Inc., signed and sealed by Marlin D. Brinson, P.E. reviewing engineer).

(Submitted under NOA's No. 15-0409.02 and 13-1125.05)

9. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94

along with marked-up drawings and installation diagram of a PVC sliding glass door, a PVC fixed window and an aluminum sliding glass door, using: Kodispace 4SG TPS spacer system, Duraseal® spacer system, Super Spacer® NXT™ spacer system and XL Edge™ spacer system at insulated glass, prepared by Fenestration Testing Laboratory, Inc., Test Reports No. **FTL-8717**, **FTL-8970** and **FTL-8968**, dated 02/15/16, 06/07/16 and 06/20/16 respectively, all signed and sealed by Idalmis Ortega, P.E.

(Submitted under NOA No. 17-0420.06) (For reference only)

10. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94

along with marked-up drawings and installation diagram of a vinyl sliding glass door, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-6637**, (samples A-1 thru A-5), dated 12/06/10, signed and sealed by Jorge A. Causo, P.E.


(Submitted under NOA No. 17-0420.06) (For reference only)

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with **FBC 7th Edition (2020)**, dated 04/02/20, prepared by manufacturer, signed and sealed by Anthony Lynn Miller, P.E. *(Submitted under NOA No. 20-0406.06)*
2. Glazing complies with **ASTM E 1300-09**.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER).



Ishaq I. Chanda, P.E.
Product Control Unit Supervisor
NOA No. 26-0611.02
Expiration Date: August 04, 2031
Approval Date: July 09, 2026

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's (CONTINUED)

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **20-0915.22** issued to **Kuraray America, Inc.** for their "**Trosifol® Ultraclear, Clear and Color PVB Glass Interlayers**", expiring on 07/08/24.
2. Notice of Acceptance No. **20-0915.21** issued to **Kuraray America, Inc.** for their "**Trosifol® Extra Stiff (ES) PVB Glass Interlayer**", expiring on 02/08/23.
3. Notice of Acceptance No. **20-0915.19** issued to **Kuraray America, Inc.** for their "**SentryGlas® (Clear and White) Glass Interlayers**", expiring on 07/04/23.
4. Notice of Acceptance No. **21-1109.04**, issued to **Vision Extrusions Group Limited**, for their **White Rigid PVC Exterior Extrusions for Windows and Doors**, approved on 03/31/22, expiring on 09/30/24.
5. Notice of Acceptance No. **22-0214.04**, issued to **Vision Extrusions Group Limited**, for their **VE 1000 Tan 202 and Lighter Shades (Non-White) Rigid PVC Exterior Extrusions for Windows and Doors**, approved on 06/30/22, expiring on 04/16/25.
6. Notice of Acceptance No. **18-1108.10**, issued to **Vision Extrusions Group Limited**, for their **Brown Coated (Painted or Laminated) White Rigid PVC Exterior Extrusions for Windows and Doors**, approved on 12/27/18, expiring on 09/30/24.

F. STATEMENTS

1. Statement letter of conformance, complying with **FBC 7th Edition (2020)** dated November 28, 2022, issued by manufacturer, signed and sealed by Anthony Lynn Miller, P.E. *(Submitted under NOA No. 22-1205.02)*
2. Statement letter of no financial interest, dated November 28, 2022, issued by manufacturer, signed and sealed by A. Lynn Miller, P.E. *(Submitted under NOA No. 22-1205.02)*
3. Proposal No. **22-0160** issued by the Product Control Section, dated 03/02/2 signed by Ishaq Chanda, P.E. *(Submitted under NOA No. 22-1205.02)*
4. Letter of lab. compliance, part of the above test reports. *(Submitted under NOA No. 20-0406.06)*
5. Proposal No. **19-1155** issued by the Product Control Section, dated 01/10/20, signed by Ishaq Chanda, P.E. *(Submitted under NOA No. 20-0406.06)*

G. OTHERS

1. Notice of Acceptance No. **22-0407.10**, issued to **PGT Industries, Inc.**, for their Series "**SGD-5570-Window**" Vinyl Horizontal Sliding Glass Window (Reinforced) w/wo 90° & 135° corners and w/wo Pockets – L.M.I., approved on 04/21/22 and expiring on 08/04/26.

Ishaq I. Chanda

Ishaq I. Chanda, P.E.
Product Control Unit Supervisor
NOA No. 26-0611.02
Expiration Date: August 04, 2031
Approval Date: July 09, 2026

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

- 2. EVIDENCE SUBMITTED under previous approval**
- A. DRAWINGS**
1. Drawing No. **MD-5570W.0**, titled "Vinyl Sliding Glass Window (LM)", sheets 1 through 21 of 21, dated 04/14/16, with revision **F** dated 06/06/23, prepared by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.
- B. TESTS**
1. None.
- C. CALCULATIONS**
1. None
- D. QUALITY ASSURANCE**
1. Miami-Dade Department of Regulatory and Economic Resources (RER).
- E. MATERIAL CERTIFICATIONS**
1. Notice of Acceptance No. **20-0915.22** issued to **Kuraray America, Inc.** for their "**Trosifol® Ultraclear, Clear and Color PVB Glass Interlayers**", expiring on 07/08/24.
 2. Notice of Acceptance No. **22-1116.03** issued to Kuraray America, Inc. for their "**Trosifol® Extra Stiff (ES) PVB Glass Interlayer**", expiring on 02/08/28.
 3. Notice of Acceptance No. **22-1116.01** issued to **Kuraray America, Inc.** for their "**SentryGlas® (Clear and White) Glass Interlayers**", expiring on 07/04/28.
 4. Notice of Acceptance No. **21-1109.04**, issued to **Vision Extrusions Group Limited**, for their **White Rigid PVC Exterior Extrusions for Windows and Doors**, approved on 03/31/22, expiring on 09/30/24.
 5. Notice of Acceptance No. **22-0214.04**, issued to **Vision Extrusions Group Limited**, for their **VE 1000 Tan 202 and Lighter Shades (Non-White) Rigid PVC Exterior Extrusions for Windows and Doors**, approved on 06/30/22, expiring on 04/16/25.
 6. Notice of Acceptance No. **18-1108.10**, issued to **Vision Extrusions Group Limited**, for their **Brown Coated (Painted or Laminated) White Rigid PVC Exterior Extrusions for Windows and Doors**, expiring on 09/30/24.
- F. STATEMENTS**
1. Statement letter of conformance, complying with **FBC 7th Edition (2020)**, and with **FBC 8th Edition (2023)** dated June 06, 2023, issued by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.
 2. Statement letter of no financial interest dated June 06, 2023, issued by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.
- G. OTHERS**
1. Notice of Acceptance No. **22-1205.02**, issued to PGT Industries, Inc., for their Series "SGD-55770-Window" Vinyl Horizontal Sliding Glass Window (Reinforced) w/wo 90° and 135° corners and w/wo Pockets – L.M.I., approved on 01/12/23 and expiring on 08/04/26.

Ishaq I. Chanda

Ishaq I. Chanda, P.E.
Product Control Unit Supervisor
NOA No. 26-0611.02
Expiration Date: August 04, 2031
Approval Date: July 09, 2026

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

3. NEW EVIDENCE SUBMITTED

A. DRAWINGS

1. Drawing No. **MD-5570.0 Rev G**, titled "Vinyl Sliding Glass Door NOA (LM)", sheets 1 through 21 of 21, dated 04/14/16 and last revised on 05/25/26, prepared by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.

B. TESTS

1. None.

C. CALCULATIONS


1. None

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **24-0205.08** issued to **Kuraray America, Inc.** for their "**Trosifol® Ultraclear, Clear and Color PVB Glass Interlayers**", expiring on 07/08/29.
2. Notice of Acceptance No. **20-0915.21** issued to **Kuraray America, Inc.** for their "**Trosifol® Extra Stiff (ES) PVB Glass Interlayer**", expiring on 02/08/28.
3. Notice of Acceptance No. **23-0717.30** issued to **Kuraray America, Inc.** for their "**SentryGlas® (Clear and White) Glass Interlayers**", expiring on 07/04/28.
4. Notice of Acceptance No. **24-0618.01**, issued to **Vision Extrusions Group Limited**, for their **White Rigid PVC Exterior Extrusions for Windows and Doors**, expiring on 09/30/29.
5. Notice of Acceptance No. **25-0609.03**, issued to **Vision Extrusions Group Limited**, for their **Tan 3040 and Lighter Shades (Non-White) Rigid PVC Exterior Extrusions for Windows and Doors**, approved on 07/10/25, expiring on 02/04/31.
6. Notice of Acceptance No. **24-0401.07**, issued to **Vision Extrusions Group Limited**, for their **Black and Lighter Shades of Cap Coated Rigid PVC Exterior Extrusions for Windows and Doors**, approved on 05/09/24, expiring on 07/28/27.
7. Notice of Acceptance No. **23-0830.05**, issued to **Vision Extrusions Group Limited**, for their **VE 1000 Tan 202 and Lighter Shades (Non-White) Rigid PVC Exterior Extrusions for Windows and Doors**, approved on 10/26/23, expiring on 12/29/26.
8. Notice of Acceptance No. **24-0618.02**, issued to **Vision Extrusions Group Limited**, for their **Painted or Laminated White Rigid PVC Exterior Extrusions for Windows and Doors**, approved on 07/18/24, expiring on 09/30/29.



Ishaq I. Chanda, P.E.
Product Control Unit Supervisor
NOA No. 26-0611.02
Expiration Date: August 04, 2031
Approval Date: July 09, 2026

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

F. STATEMENTS

1. Statement letter of conformance, complying with **FBC 8th Edition (2023)** dated 06/10/26, issued by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.
2. Statement letter dated 12/18/24 issued by manufacturer requesting renewal with company name change to PGT industries, LLC, signed and sealed by Anthony Lynn Miller, P.E.
3. e-mail dated 12/23/24 sent by Lynn Miller (PGT Code Compliance Manager), consists of PGT innovation form 8-k filed w/SEC, PGT innovation form 10-K filled w/SEC and Exhibit 21(Form 10-K); PGT innovation's list of subsidiaries.

G. OTHERS

1. This NOA **renews NOA# 23-0710.11**, expiring on 08/04/31.
2. Article of conversion of PGT Industries, Inc to PGT industries, LLC pdf provided on 12/24/24 by Ms. April Lee, Assistant General Counsel.
3. Florida Department of State, Division of Corporation listing # L2400142070 of PGT Industries, LLC as active status since 12/17/24.
4. Florida Department of State, Division of Corporation listing # F03387 of PGT Industries, Inc as Inactive status.
5. PGT Name change organization chart layout prepared by RER (for file use only)



Ishaq I. Chanda, P.E.
Product Control Unit Supervisor
NOA No. 26-0611.02
Expiration Date: August 04, 2031
Approval Date: July 09, 2026

The following pages in this document were submitted by the manufacturer (third party) to represent the product being approved and establish the limits of use. The pages may include technical drawings, schematics and installation details.

SERIES 5570 IMPACT RESISTANT SLIDING GLASS WINDOW
INCLUDING POCKETS & 90°/135° CORNERS

GENERAL NOTES:
1) GLAZING TYPE OPTIONS: SEE GLAZING DETAILS ON SHEET 10.
2) DESIGN PRESSURES:
A. NEGATIVE DESIGN LOADS BASED ON TESTED PRESSURE AND GLASS PER ASTM E1300.
B. POSITIVE DESIGN LOADS BASED ON WATER TEST PRESSURE AND GLASS PER ASTM E1300.
C. DESIGN LOADS ARE BASED ON ALLOWABLE STRESS DESIGN, ASD.
3) ANCHORAGE: THE 33-1/3% STRESS INCREASE HAS NOT BEEN USED IN THE DESIGN OF THIS PRODUCT. MATERIALS, INCLUDING BUT NOT LIMITED TO STEEL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE FLORIDA BUILDING CODE (FBC).
4) SHUTTERS ARE NOT REQUIRED PER FBC REQUIREMENTS, AS APPLICABLE.
5) INSTALLATION SCREWS & FRAME SPLICES TO BE SEALED WITH NARROW JOINT SEALANT. OVERALL SEALING/FLASHING STRATEGY FOR WATER RESISTANCE OF INSTALLATION SHALL BE DONE BY OTHERS AND IS BEYOND THE SCOPE OF THESE INSTRUCTIONS.
6) REFERENCES (NOA'S): DEWALT ULTRAICON+, DEWALT/ELCO CRETEFLEX & AGGRE-GATOR ANCHOR NOA'S, VISION EXTRUSION, LTD. WHITE RIGID PVC NOA, VE 1000 TAN 202 AND LIGHTER SHADES (NON-WHITE) RIGID PVC NOA AND BROWN COATED (PAINTED OR LAMINATED) WHITE RIGID PVC NOA
REFERENCES (TEST REPORTS): FTL-6337, 6338, 8646-8649, 8652 & 8717; QAI 22-1081, QA1-NOK-0004; EXOVA-10-002-792(A) & 10-006-10231; CAMBRIDGE 535753-09;
7) THIS PRODUCT HAS BEEN DESIGNED & TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FBC, INCLUDING THE HIGH VELOCITY HURRICANE ZONE (HVHZ). THE RIGID WHITE, BROWN & TAN PVC MANUFACTURED BY VISION EXTRUSION, LTD. HAS BEEN TESTED TO COMPLY WITH THE FLORIDA BUILDING CODE FOR PLASTICS, (COMPONENT REQUIREMENTS).
8) WINDOW SIZES MUST BE VERIFIED FOR COMPLIANCE WITH EGRESS REQUIREMENTS OF THE FBC, AS APPLICABLE.
9) DRAWINGS DEPICT EXTERIOR-GLAZING, HOWEVER INTERIOR-GLAZING MAY BE SUBSTITUTED.

ANCHOR NOTES:
1) FOR CONCRETE/CMU SUBSTRATE APPLICATIONS IN MIAMI-DADE COUNTY, USE ONLY MIAMI-DADE COUNTY APPROVED ANCHORS. SEE TABLE A ON THIS SHEET FOR EMBEDMENT, EDGE DISTANCE AND SUBSTRATE REQUIREMENTS.
2) FOR OTHER SUBSTRATE APPLICATIONS SEE TABLE A ON THIS SHEET.
3) WOOD BUCKS DEPICTED AS 1X ARE LESS THAN 1-1/2" THICK. PROPERLY SECURED, 1X WOOD BUCKS ARE OPTIONAL IF UNIT IS INSTALLED DIRECTLY TO SOLID CONCRETE OR CMU. WOOD BUCKS DEPICTED AS 2X ARE 1-1/2" THICK OR GREATER. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED TO PROPERLY TRANSFER LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD & TO BE REVIEWED BY THE BUILDING OFFICIAL.
4) METAL SUBSTRATE TO MEET MIN. STRENGTH AND THICKNESS REQUIREMENTS PER THE FBC AND TO BE REVIEWED BY THE AUTHORITY HAVING JURISDICTION.
5) IF SILL IS TIGHT TO SUBSTRATE, GROUT OR OTHER MATERIAL IS NOT REQUIRED. IF USED, NON-SHRINK, NON-METALLIC GROUT, MAX. 1/4" THICK & 3400 PSI MIN., (DONE BY OTHERS) MUST FULLY SUPPORT THE ENTIRE LENGTH OF THE SILL THAT IS NOT TIGHT TO THE SUBSTRATE, AND TRANSFER SHEAR LOAD TO SUBSTRATE. IF SUBSTRATE IS WOOD, 30# FELT PAPER OR MASTIC IS REQUIRED BETWEEN THE GROUT AND WOOD SUBSTRATE, OR AS APPROVED BY THE AUTHORITY HAVING JURISDICTION.

Table with 2 columns: IMPACT RATING, DESIGN PRESSURE RATING. IMPACT RATING: RATED FOR LARGE & SMALL MISSILE IMPACT RESISTANCE. DESIGN PRESSURE RATING: SEE TABLES 1, 2 & B1, B2 ON SHEETS 7 & 8.

TABLE A:

Table with 6 columns: Group, Anchor, Substrate, Frame Member, Min. Edge Distance, Min. Embedment. Rows include various anchor types (e.g., #12 steel SMS, 1/4" DeWalt Ultracon+) and substrates (e.g., P.T. Southern Pine, Concrete, CMU).

- 1) MIN. OF 3 THREADS BEYOND THE METAL SUBSTRATE. METAL SUBSTRATE TO MEET MIN. STRENGTH AND THICKNESS REQUIREMENTS PER CURRENT FLORIDA BUILDING CODE AND TO BE REVIEWED BY THE AUTHORITY HAVING JURISDICTION. ALL ANCHOR HEAD TYPES APPLICABLE.
- 2) "UNGROUTED CMU" VALUES MAY BE USED FOR GROUTED CMU APPLICATIONS.
- 3) FOR THE MINIMUM STRENGTHS OF ANCHORS AND SUBSTRATES, SEE TABLE F, SHEET 21.
- 4) ALL ANCHOR HEAD TYPES ARE APPLICABLE.

- INSTRUCTIONS:
- 1) KNOWING THE REQUIRED DESIGN PRESSURE OF THE OPENING, THE ANCHOR REQUIREMENTS FOR THE SLIDING GLASS WINDOW MAY BE DETERMINED FROM DESIGN PRESSURE TABLES 1 OR 2, DEPENDING ON THE GLASS/REINFORCEMENT.
 - 2) LOCATE THE SLIDING GLASS WINDOW SIZE ON THE TABLE, USING THE FRAME HEIGHT AND THE NOMINAL PANEL WIDTH IF YOUR EXACT SIZE IS NOT LISTED, ROUND UP TO THE NEXT GREATER LISTED WIDTH AND/OR HEIGHT.
 - 3) CHOOSE WHICH ANCHOR GROUP (A-D) IS MOST APPLICABLE. ANCHORS ARE DEFINED IN TABLE A, THIS SHEET, ALONG WITH THE CORRESPONDING SUBSTRATE, MINIMUM EMBEDMENT AND MINIMUM EDGE DISTANCE.
 - 4) FROM THE DESIGN PRESSURE TABLES (TABLES 1 OR 2), VERIFY THAT THE OPENING'S REQUIRED DESIGN PRESSURE IS MET OR EXCEEDED. USE THE ANCHOR QUANTITIES SHOWN.
 - 5) INSTALL AS PER THE GUIDELINES OF THIS SHEET-SET.
 - 6) ADDITIONALLY, SEE THE EXAMPLE ON SHEET 9.

- CODES / STANDARDS USED:
- 2023 FLORIDA BUILDING CODE (FBC), 8TH EDITION
 - ASTM E1300-09
 - ANSI/AF&PA NDS-2018 FOR WOOD CONSTRUCTION
 - ALUMINUM DESIGN MANUAL, ADM-2020
 - AISI S100-16
 - AISC 360-16

GENERAL NOTES..... 1

EXAMPLE CONFIGS.....2

INSTALL DETAILS.....3-6

DP/ANCHOR TABLES.....7-8

EXAMPLE.....9

GLAZING DETAILS..... 10

ANCHOR LAYOUTS.....11-16

PANEL TYPES..... 17

EXTRUSIONS.....18

ACCESSORIES.....19

SCREEN DETAILS.....20

PARTS LIST.....20-21

PRODUCT RENEWED as complying with the Florida Building Code Acceptance No 26-0611-02 Expiration Date Aug 04, 2031 By Ishay L. Miller Miami Dade Product Control

Revision:

PREPARED BY A. LYNN MILLER 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 (941) 480-1600 REGISTRATION #29296

PGT Custom Windows and Doors 3400 PRECISION DRIVE N. VENICE, FL 34275 (941) 480-1600










VINYL SLIDING GLASS WINDOW (LM) 04/14/16 Date

GENERAL NOTES JENS ROSOWSKI Drawn By

SGD-5570 WINDOW 1 OF 21 DWG No.

Rev. G

ANTHONY LYNN MILLER LICENSE No. 58705 05/25/26 STATE OF FLORIDA PROFESSIONAL ENGINEER A. LYNN MILLER, P.E. P.E.# 58705

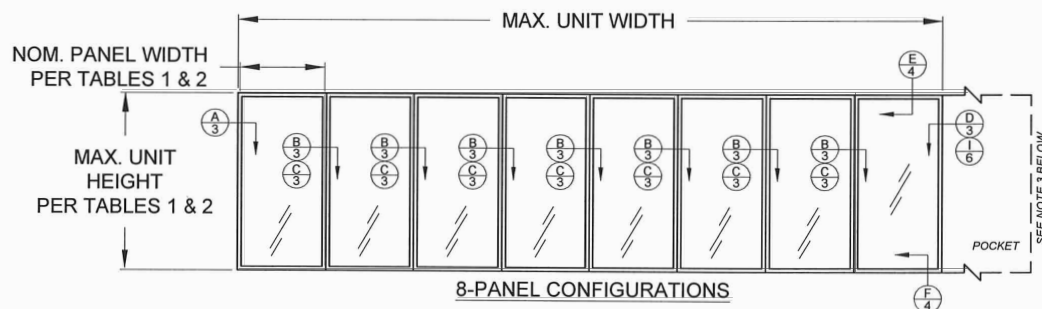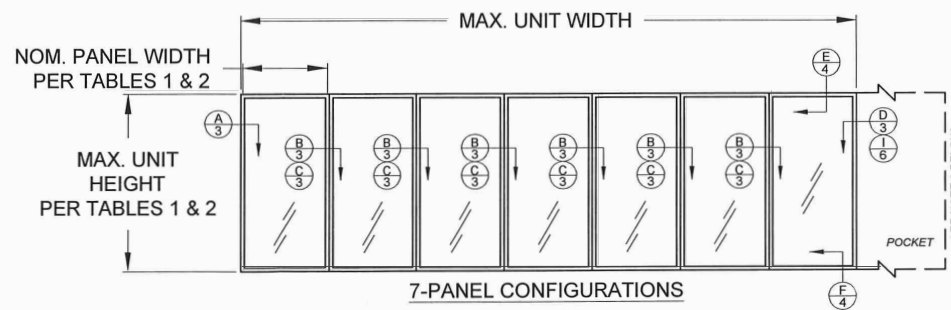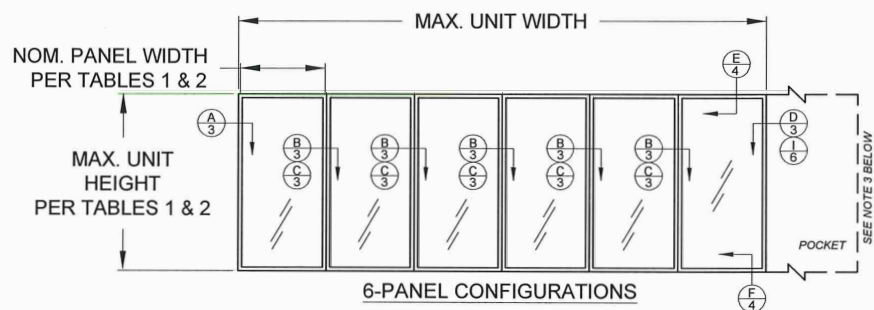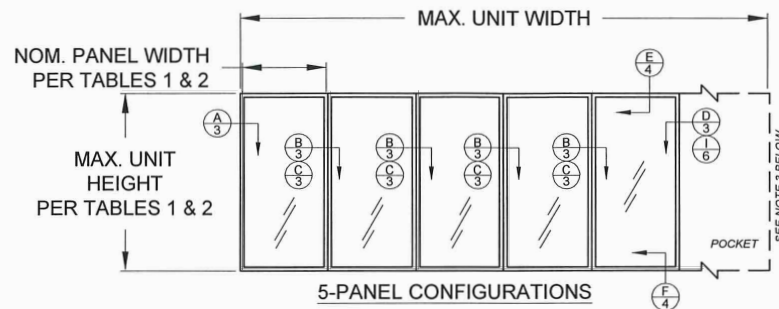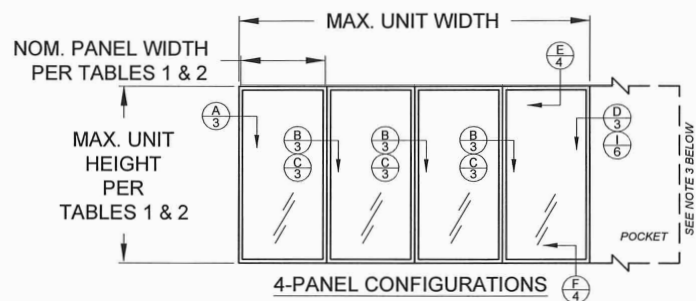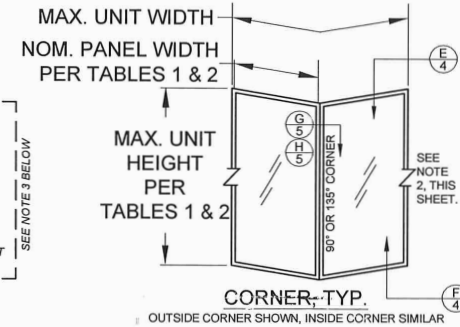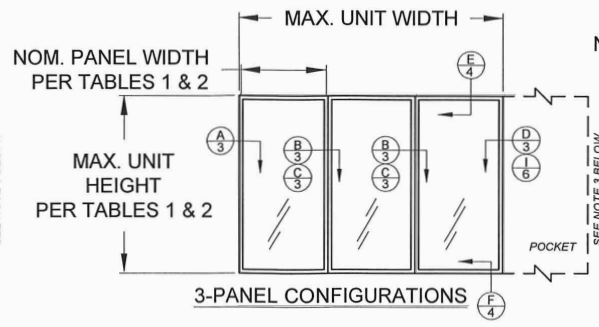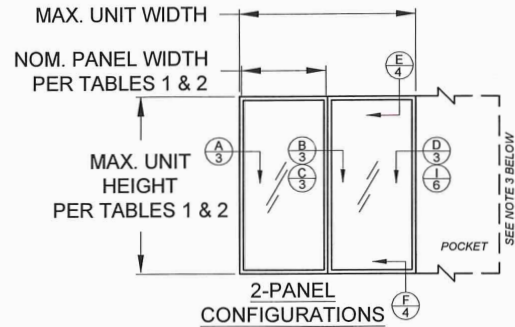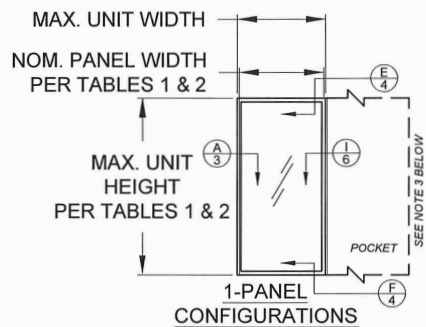

DLO WIDTH = NOM. PANEL WIDTH - 8-9/16"
 NOM. PANEL WIDTH = PANEL WIDTH + 1-3/16"
 DLO HEIGHT = WINDOW HEIGHT - 11-1/16"
 PANEL HEIGHT = WINDOW HEIGHT - 2-1/2"

CONFIGURATIONS NOTES:


- 1) ALL CONFIGURATIONS SHOWN ARE ALSO AVAILABLE AS POCKET CONFIGURATIONS AT EITHER OR BOTH JAMB LOCATIONS. EXAMPLE: 4-PANEL XXXX IN POCKET (p) CONFIGURATION CAN BE pXXXXp, pXXXX OR XXXXp. OXXX IN POCKET CONFIGURATION CAN BE OXXXp.
- 2) 90° & 135° CORNER CONFIGURATIONS ARE A COMBINATION OF ANY 2 STRAIGHT CONFIGURATIONS.
- 3) POCKET WALL OR CAVITY IS NOT PART OF THIS APPROVAL AND IS TO BE DESIGNED BY OTHERS AND REVIEWED BY THE AUTHORITY HAVING JURISDICTION.
- 4) FOR NOM. PANEL WIDTH, SEE TABLES 1 & 2.
- 5) MAX. ALLOWABLE FRAME SQUARE FOOTAGE = 472.656 FT²


"X" = OPERABLE PANEL
 "O" = INOPERABLE PANEL
 "p" = POCKET

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No **24-0611.02**
 Expiration Date **8/4/2031**
 By **Anthony Lynn Miller**
 Miami Dade Product Control

Revision:

PGT Custom Windows and Doors 3400 PRECISION DRIVE N. VENICE, FL 34275 (941) 480-1600	PREPARED BY A. LYNN MILLER 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 (941) 480-1600		REGISTRATION #29296 (941) 480-1600		04/14/16 Date		JENS ROSOWSKI By		MD-5570W.0 No. DWG		G Rev.	
	VINYL SLIDING GLASS WINDOW (LM)		2 OF 21 Sheet		EXAMPLE CONFIGURATIONS		2 OF 21 No. DWG		2 OF 21 No. DWG		2 OF 21 No. DWG	
	SGD-5570 WINDOW		2 OF 21 No. DWG		2 OF 21 No. DWG		2 OF 21 No. DWG		2 OF 21 No. DWG		2 OF 21 No. DWG	
	VINYL SLIDING GLASS WINDOW (LM)		2 OF 21 No. DWG		2 OF 21 No. DWG		2 OF 21 No. DWG		2 OF 21 No. DWG		2 OF 21 No. DWG	

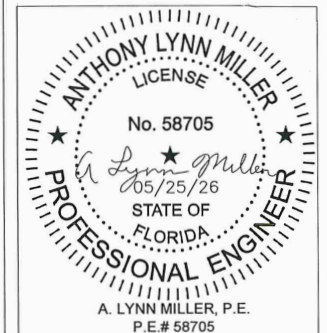

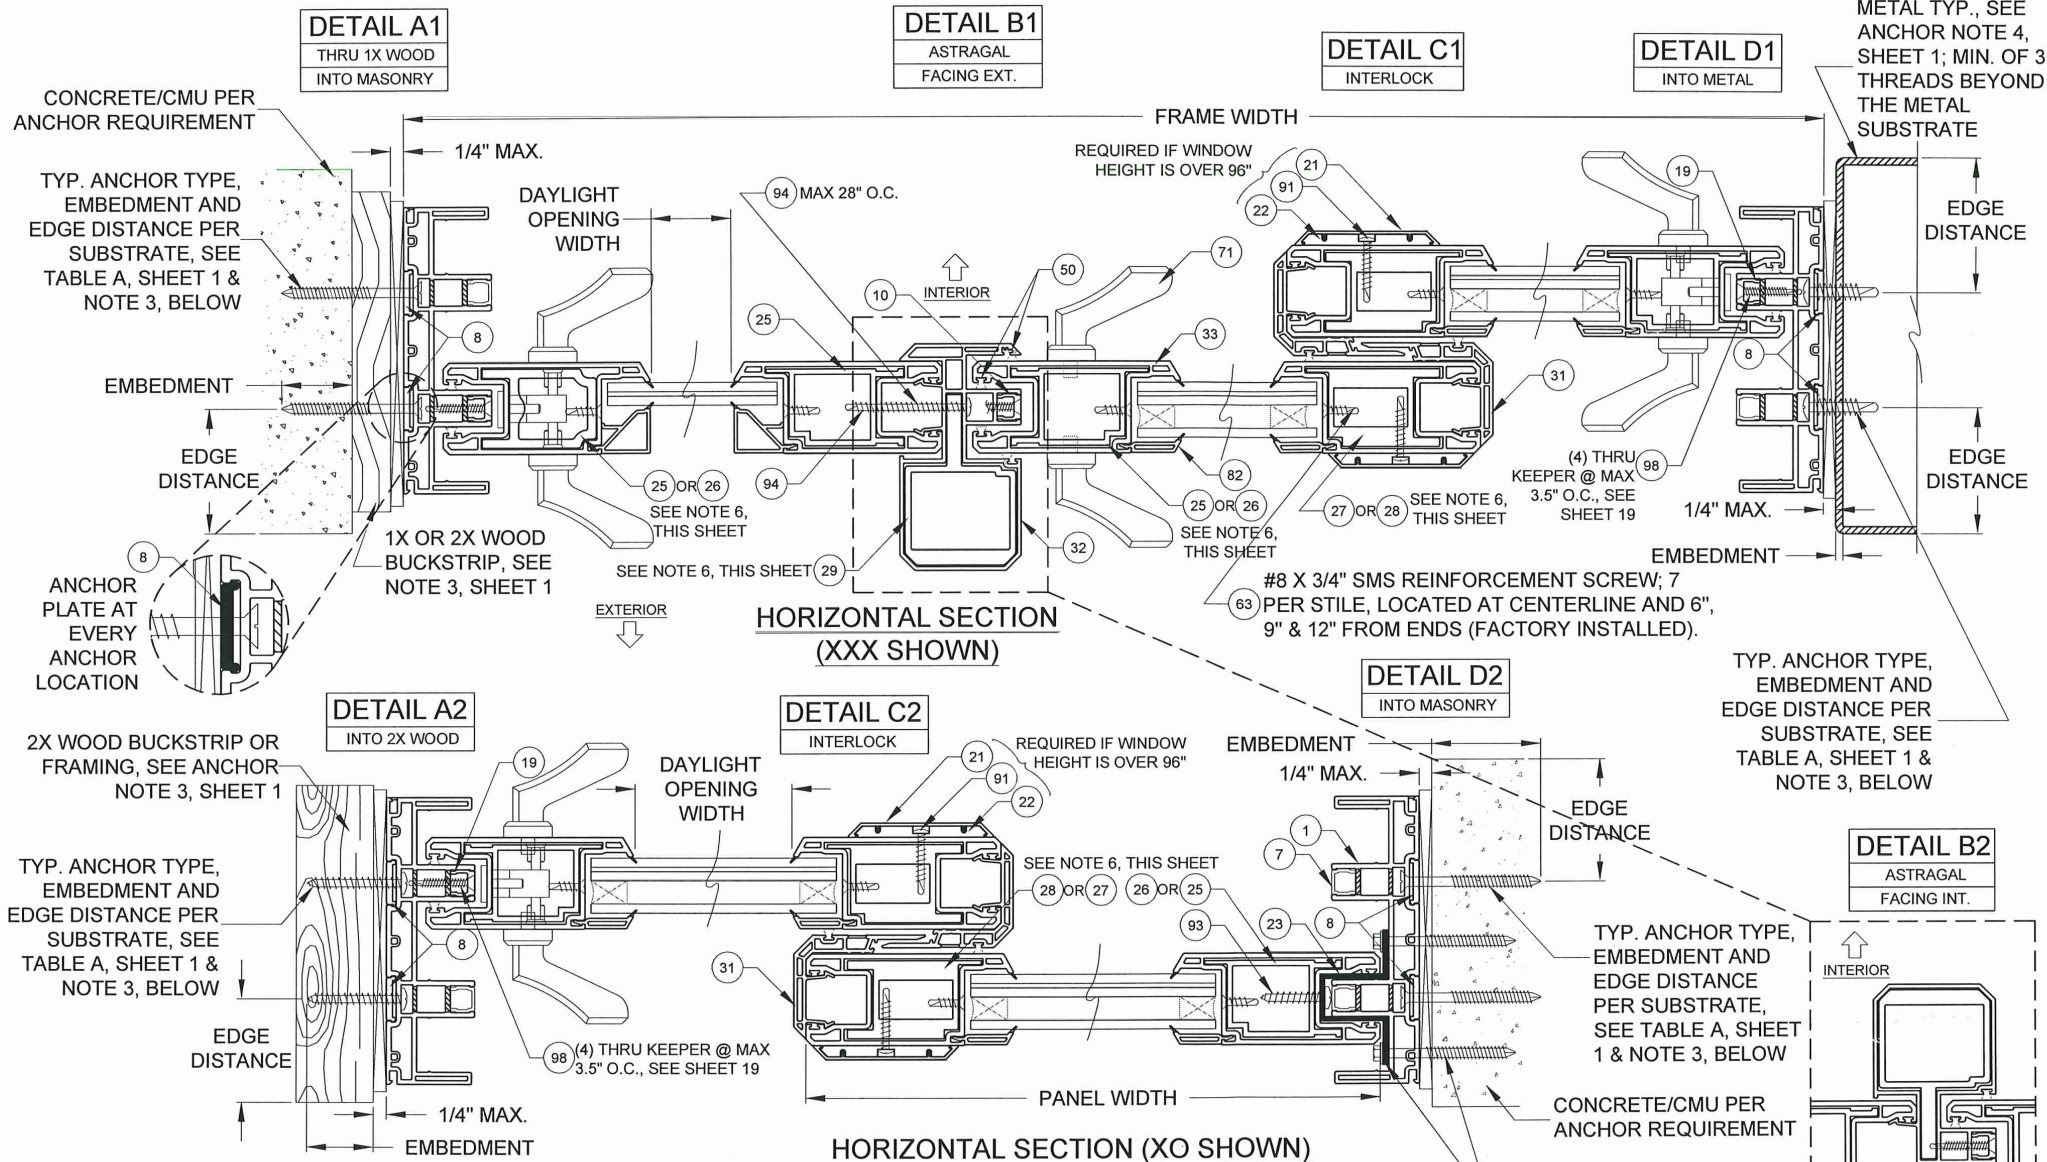

NOTES


- 1) DETAILS APPLY TO 2, 3 AND 4 TRACK CONFIGURATIONS.
- 2) REFER TO ANCHOR NOTES, SHEET 1.
- 3) SEE SHEET 13 FOR ANCHOR LOCATION & SPACING, FOR ANCHOR QUANTITIES, SEE TABLES 1 & 2.
- 4) CONTINUOUS ANCHOR PLATE, ITEM #8, IS REQUIRED AT ALL FRAME ANCHOR LOCATIONS.
- 5) PANEL WIDTH DOES NOT INCLUDE INTERLOCK OR ASTRAGAL ADD-ON.
- 6) SEE TABLES 1 & 2 FOR REINFORCEMENT REQUIREMENTS. ALL REINFORCEMENTS ARE APPROXIMATELY THE FULL LENGTH OF THE EXTRUSION. REFER TO TEST REPORTS FOR EXACT DIMENSIONS.
- 7) SEE SHEET 20 FOR SCREEN DETAILS.

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. **26-0611.02**
Expiration Date **8/4/2031**
By **Anthony Lynn Miller**
Miami Trade Product Council

Revision:

PREPARED BY A. LYNN MILLER
1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275

PGT
Custom Windows and Doors
3400 PRECISION DRIVE
N. VENICE, FL 34275
(941) 480-1600

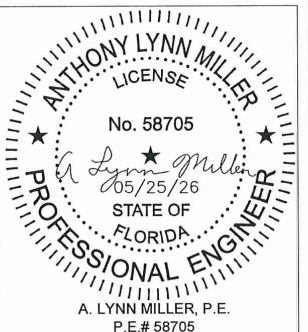

REGISTRATION #29296

Date 04/14/16

Drawn By

JENS ROSOWSKI

HORIZONTAL CROSS SECTIONS

VINYL SLIDING GLASS WINDOW (LM)

Series

Desc.

Title

SGD-5570

WINDOW

3 OF 21

DWG


No.

MD-5570W.0




Rev.

G


DETAIL E1
INTO MASONRY
1X BUCKSTRIP

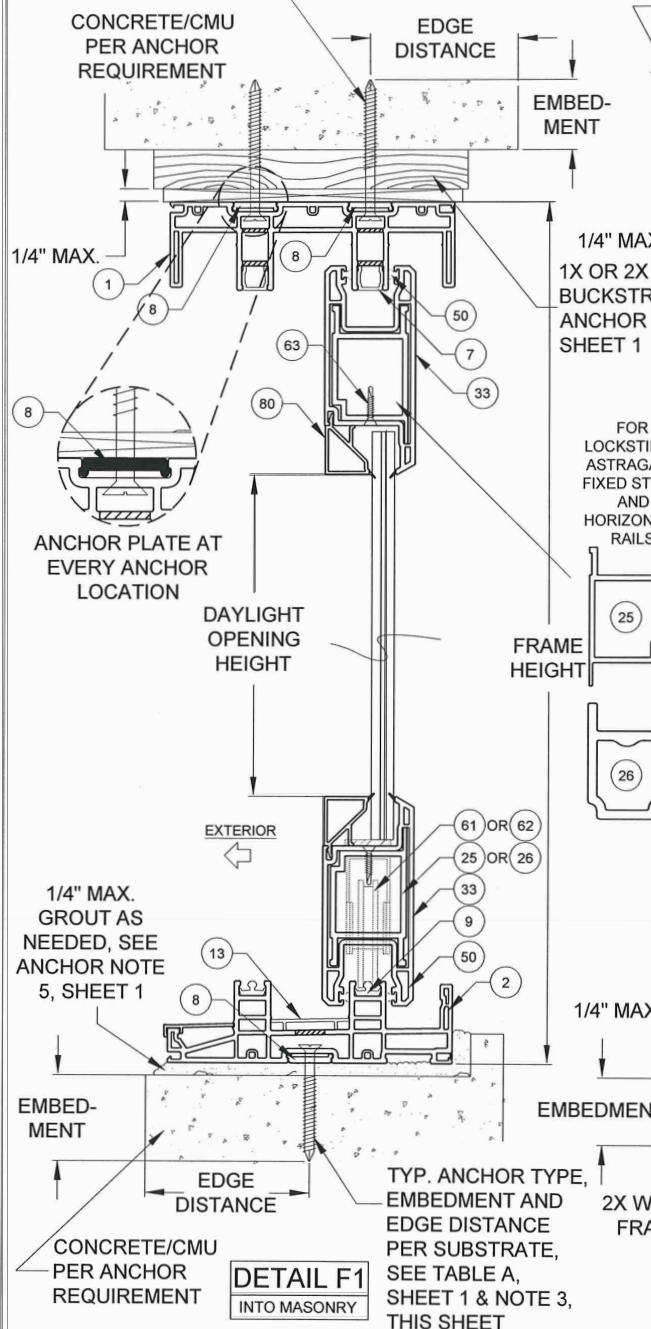

DETAIL E2
INTO WOOD

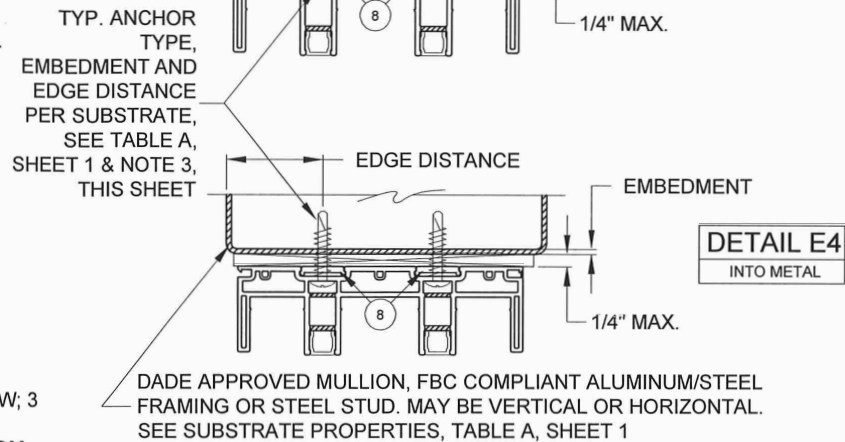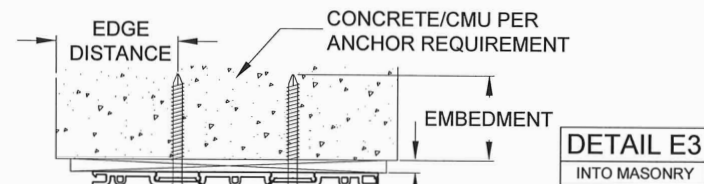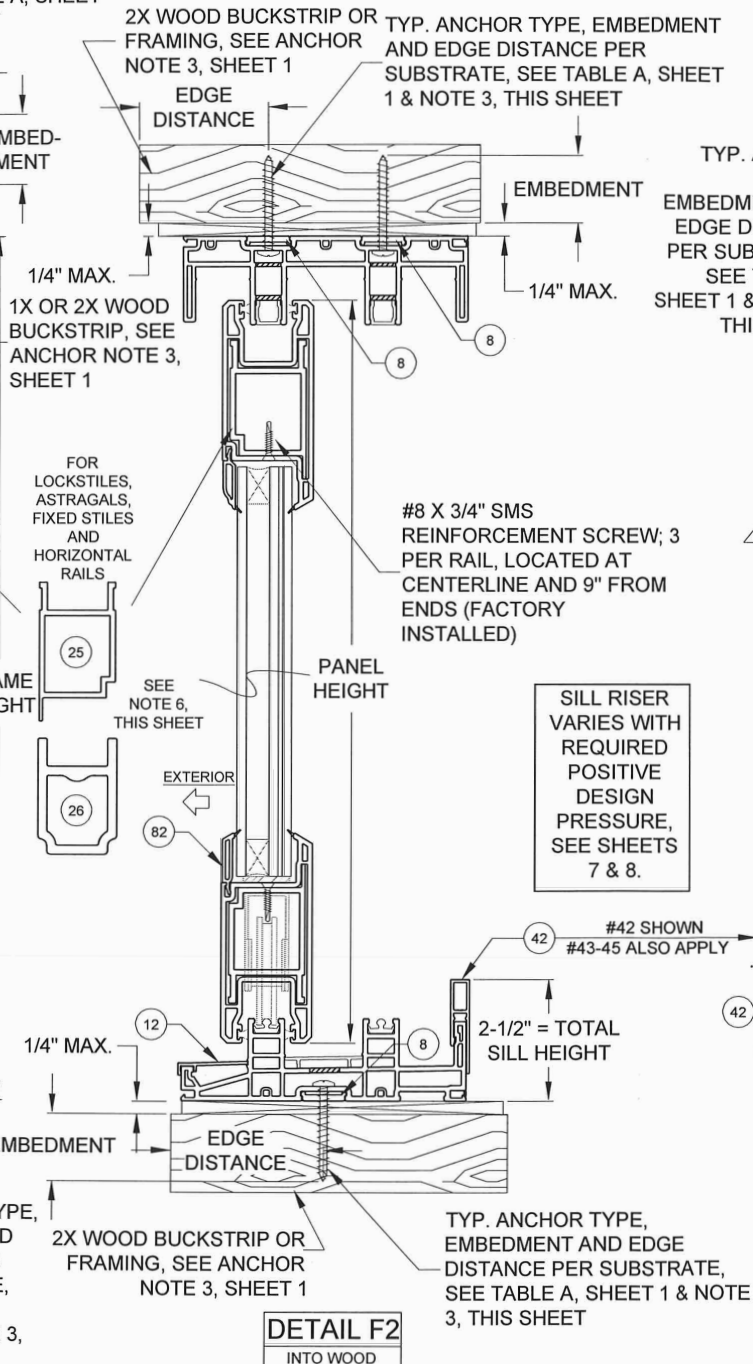

DLO WIDTH = NOM. PANEL WIDTH - 8-9/16"
DLO HEIGHT = WINDOW HEIGHT - 11-1/16"
PANEL HEIGHT = WINDOW HEIGHT - 2-1/2"

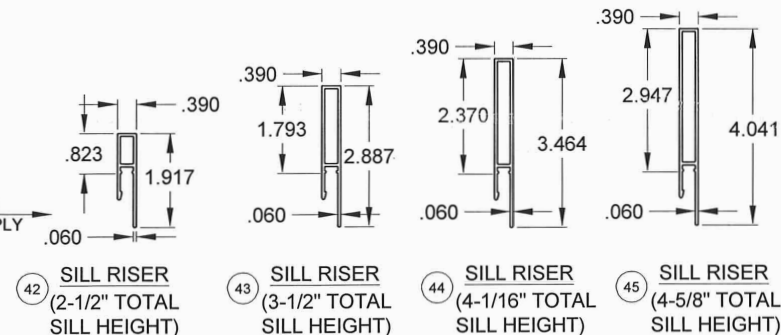

- NOTES**
- 1) DETAILS APPLY TO 2, 3 AND 4 TRACK CONFIGURATIONS.
 - 2) REFER TO ANCHOR NOTES, SHEET 1.
 - 3) SEE SHEETS 11 & 12 FOR ANCHOR LOCATION & SPACING, FOR ANCHOR QUANTITIES, SEE TABLES 1 & 2.
 - 4) CONTINUOUS ANCHOR PLATE, ITEM #8, IS REQUIRED AT ALL FRAME ANCHOR LOCATIONS.
 - 5) SEE SHEET 20 FOR SCREEN DETAILS.
 - 6) SEE TABLES 1 & 2 FOR REINFORCEMENT REQUIREMENTS. ALL REINFORCEMENTS ARE APPROXIMATELY THE FULL LENGTH OF THE EXTRUSION. REFER TO TEST REPORTS FOR EXACT DIMENSIONS.

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. **26-0611.02**
Expiration Date **8/14/2031**
By **Kenny L. Chandra**
Miami Dade Product Control


Revision:



PREPARED BY A. LYNN MILLER
1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275

(941) 480-1600
REGISTRATION #29296

PGI
Custom Windows and Doors
3400 PRECISION DRIVE
N. VENICE, FL 34275
(941) 480-1800

04/14/16	Date	JENS ROSOWSKI	By	MD-5570W.0	Rev.	G
VINYL SLIDING GLASS WINDOW (LM)	Desc.	VERTICAL CROSS SECTIONS	Sheet	4 OF 21	DWG	No.
SGD-5570 WINDOW	Series					

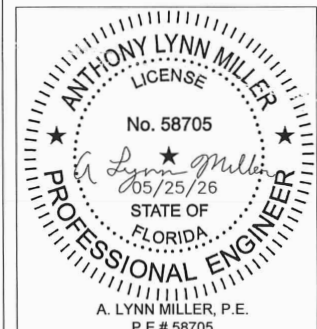

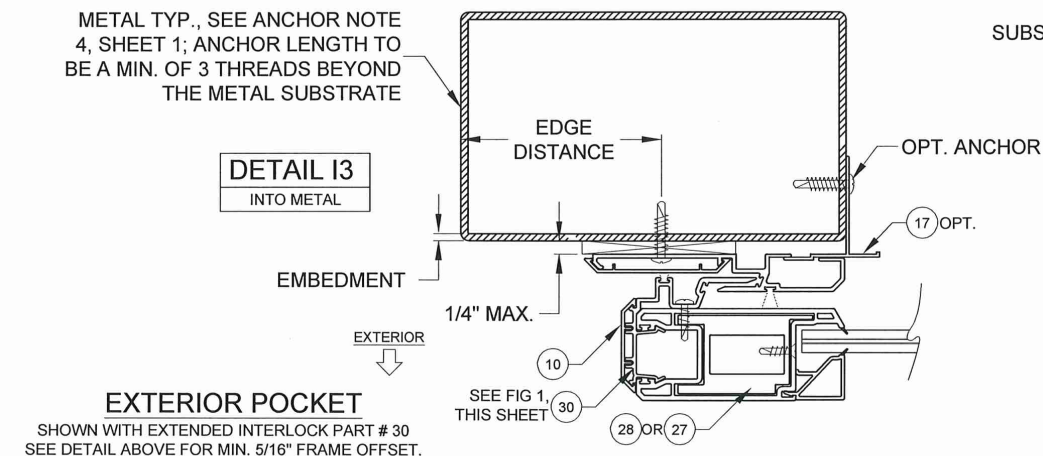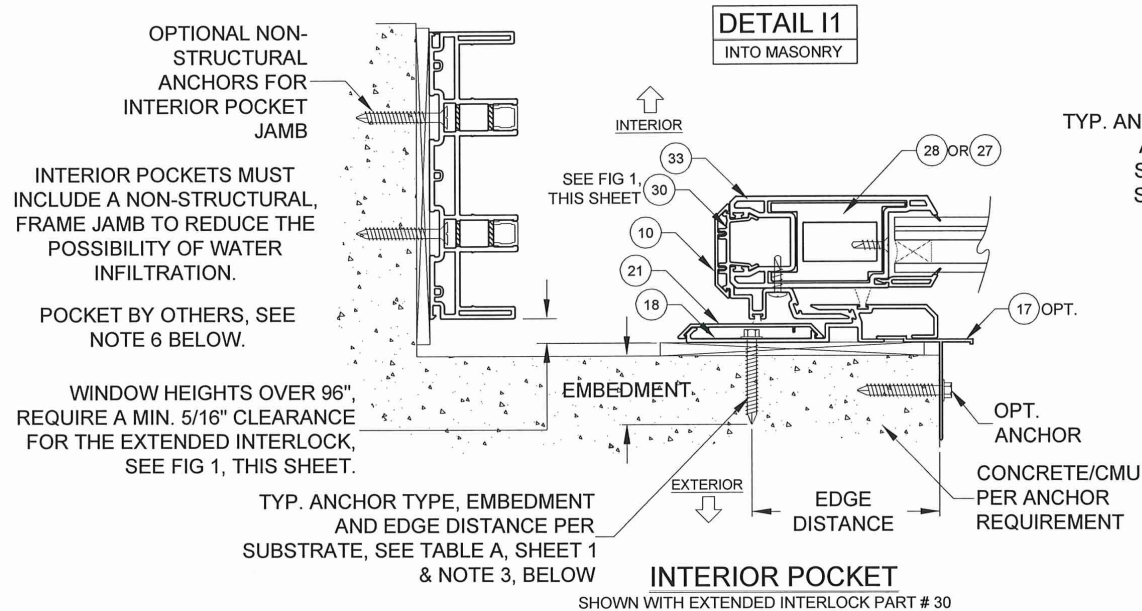

NOTES

- 1) DETAILS APPLY TO 2, 3 AND 4 TRACK CONFIGURATIONS.
- 2) REFER TO ANCHOR NOTES, SHEET 1.
- 3) SEE SHEET 13 FOR ANCHOR LOCATION & SPACING, FOR ANCHOR QUANTITIES, SEE TABLES 1 & 2.
- 4) SEE TABLES 1 & 2 FOR REINFORCEMENT REQUIREMENTS.
- 5) INTERIOR OR EXTERIOR POCKETS APPLICABLE FOR ALL INSTALLATION METHODS.
- 6) POCKET WALL OR CAVITY IS NOT PART OF THIS APPROVAL AND IS TO BE DESIGNED BY OTHERS AND REVIEWED BY THE AUTHORITY HAVING JURISDICTION.



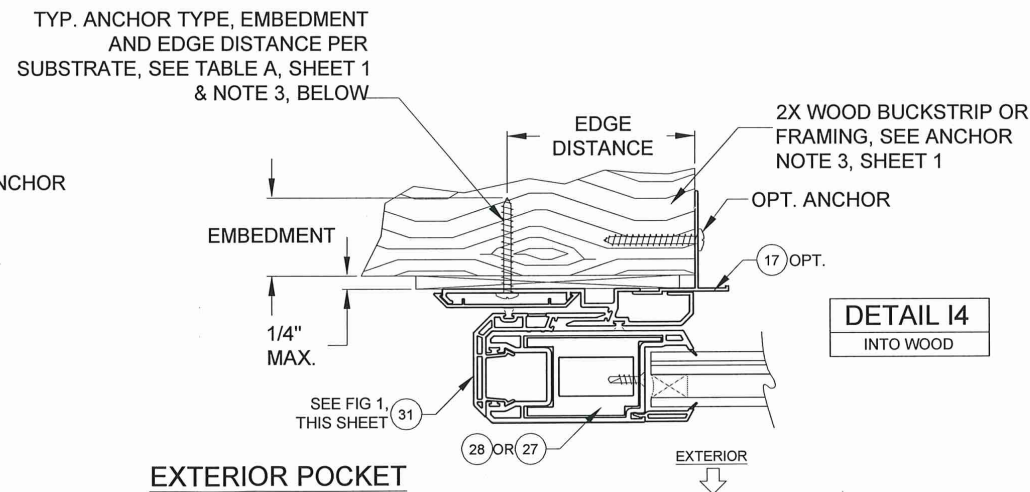


FIGURE 1, INTERLOCKS AT POCKETS:

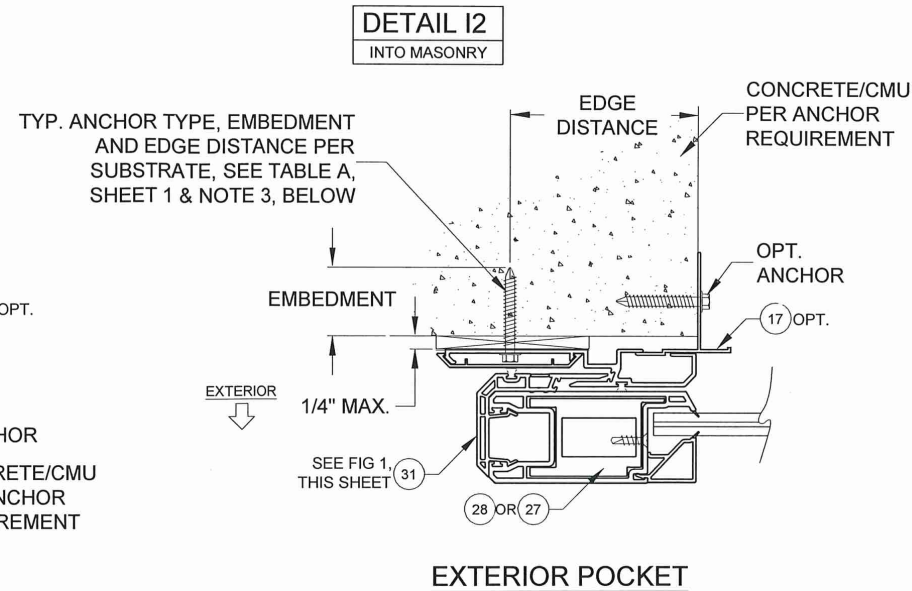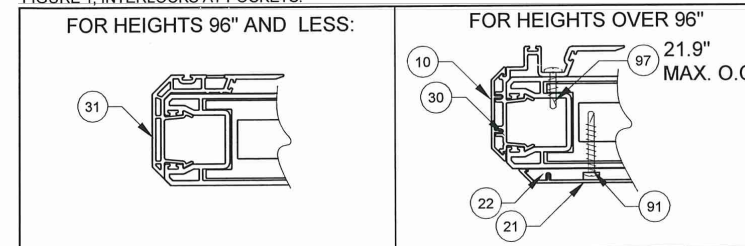

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No 26-0611-02
Expiration Date 8/14/2031
By *Anthony Lynn Miller*
Miami Dade Product Control

Revision:

PGT Custom Windows and Doors 3400 PRECISION DRIVE N. VENICE, FL 34275 (941) 480-1600		REGISTRATION #29296			
		VINYL SLIDING GLASS WINDOW (LM)		Date	04/14/16
		POCKET HORIZ. X-SECTION		Drawn By	JENS ROSOWSKI
Series	SGD-5570 WINDOW	Sheet	6 OF 21	DWG No.	MD-5570W.0
Rev.					G

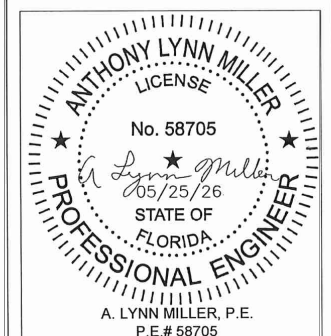


TABLE 1:

Design Pressure (DP) and Anchor Quantities Required (for all approved configurations on Sheet 2)																															
Use this table for: Glass Types 1, 1A, 3 or 3A Astragal Reinforcement #29 Lockstyle Reinforcement #25 or #26 Std. Interlock Reinforcement #27				Window Height																											
				30"				36"				48"				60"				72"				84"				96"			
				18-15/16" DLO Height				24-15/16" DLO Height				36-15/16" DLO Height				48-15/16" DLO Height				60-15/16" DLO Height				72-15/16" DLO Height				84-15/16" DLO Height			
				Anchor Group				Anchor Group				Anchor Group				Anchor Group				Anchor Group				Anchor Group				Anchor Group			
				A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D
Nominal Panel Width	24"	16-5/8" DLO Width	Design Pressure	+60 / -60 psf				+60 / -60 psf				+60 / -60 psf				+60 / -60 psf				+60 / -60 psf				+60 / -60 psf				+60 / -60 psf			
			Head/Sill	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1		
			Jamb	2	2	2	2	3	3	3	3	3	3	3	3	4	4	4	4	4	4	4	4	5	5	5	5	5	5	5	
			P-hook	3	3	3	3	3	3	3	3	4	4	4	4	5	5	5	5	6	6	6	6	7	7	7	7	8	8	8	8
	30"	22-5/8" DLO Width	Design Pressure	+60 / -60 psf				+60 / -60 psf				+60 / -60 psf				+60 / -60 psf				+60 / -60 psf				+60 / -60 psf				+60 / -60 psf			
			Head/Sill	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1		
			Jamb	2	2	2	2	3	3	3	3	3	3	3	3	4	4	4	4	4	4	4	5	5	5	5	5	5	5		
			P-hook	3	3	3	3	3	3	3	3	4	4	4	4	5	5	5	5	6	6	6	6	7	7	7	7	8	8	8	8
	36"	28-5/8" DLO Width	Design Pressure	+60 / -60 psf				+60 / -60 psf				+60 / -60 psf				+60 / -60 psf				+60 / -60 psf				+60 / -60 psf				+60 / -60 psf			
			Head/Sill	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1		
			Jamb	2	2	2	2	3	3	3	3	3	3	3	3	4	4	4	4	4	4	4	5	5	5	5	5	5	5		
			P-hook	3	3	3	3	3	3	3	3	4	4	4	4	5	5	5	5	6	6	6	6	7	7	7	7	8	8	8	8
	42"	34-5/8" DLO Width	Design Pressure	+60 / -60 psf				+60 / -60 psf				+60 / -60 psf				+60 / -60 psf				+60 / -60 psf				+60 / -60 psf				+60 / -60 psf			
			Head/Sill	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1		
			Jamb	2	2	2	2	3	3	3	3	3	3	3	3	4	4	4	4	4	4	4	5	5	5	5	5	5	5		
			P-hook	3	3	3	3	3	3	3	3	4	4	4	4	5	5	5	5	6	6	6	6	7	7	7	7	8	8	8	8
	48"	40-5/8" DLO Width	Design Pressure	+60 / -60 psf				+60 / -60 psf				+60 / -60 psf				+60 / -60 psf				+60 / -60 psf				+60 / -60 psf				+60 / -60 psf			
			Head/Sill	C3+1	C3+1	C3+1	C3+1	C3+2	C3+1	C3+1	C3+1	C3+2	C3+1	C3+1	C3+1	C3+2	C3+1	C3+1	C3+1	C3+2	C3+1	C3+1	C3+1	C3+2	C3+1	C3+1	C3+1	C5+2	C3+1	C3+1	C3+1
			Jamb	2	2	2	2	3	3	3	3	3	3	3	3	4	4	4	4	4	4	4	4	5	5	5	5	5	5	6	5
			P-hook	3	3	3	3	3	3	3	3	4	4	4	4	5	5	5	5	6	6	6	6	7	7	7	7	8	8	8	8

ANCHORAGE TYPE PER SUBSTRATE REQUIRED TO ACHIEVE THE DESIGN PRESSURE, USING THE ANCHOR QUANTITIES LISTED BELOW. SEE TABLE A, SHEET 1 FOR COMPLETE ANCHOR LIMITATIONS.

THE MAXIMUM DP AT THESE ANCHOR QUANTITIES. ADDITIONALLY, THE MAXIMUM POSITIVE DP DUE TO THE SILL HEIGHT MUST ALSO BE CONSIDERED, SEE TABLE B1, THIS SHEET.

OF ANCHORS THROUGH THE HEAD & SILL. (EX: FOR C3+1, 3 ANCHORS CLUSTERED AT PANEL MEETING POINT AND 1 ANCHOR REQUIRED AT MIDSPAN OF PANEL).

TOTAL # OF ANCHORS THROUGH THE JAMB.

THE # OF ANCHORS REQUIRED THROUGH THE P-HOOK, PERPENDICULAR TO THE GLASS.

FIG 1:

OH LENGTH

OH HEIGHT

WINDOW ASSEMBLIES INSTALLED WHERE THE OVERHANG (OH) LENGTH IS EQUAL TO OR GREATER THAN THE OVERHANG HEIGHT IS EXEMPTED FROM WATER INFILTRATION RESISTANCE.

USED IN EXAMPLE ON SHEET 9

TABLE NOTES:

- 1) IF WATER INFILTRATION RESISTANCE IS REQUIRED, THE LESSER VALUES OF EITHER TABLE 1 AND TABLE B1 DETERMINES THE WATER LIMITED (+) DP.
- 2) IF WATER INFILTRATION RESISTANCE IS NOT REQUIRED OR OVERHANG IS PER FIG 1, A SILL RISER IS NOT REQUIRED. IF SO, +DP'S SHOWN IN TABLE 1 MAY BE USED.
- 3) SEE SILL RISER TYPES ON SHEET 4.
- 4) SHEET APPLIES TO 2, 3 AND 4 TRACK CONFIGURATIONS.
- 5) REFER TO ANCHOR NOTES, SHEET 1.
- 6) SEE SHEETS 11-16 FOR ANCHOR LOCATION & SPACING

TABLE B1:

Water-Limited (+) Design Pressure		
Sill Riser	Nom. Sill Height	Max. (+) DP Allowed
None	1-11/16"	See Note 2
42	2-1/2"	+38.7 psf
43	3-1/2"	+60.0 psf
44	4-1/16"	+60.0 psf
45	4-5/8"	+60.0 psf

PRODUCT RENEWED as complying with the Florida Building Code
Acceptance No 26-0611-02
Expiration Date 8/14/2031
By Isheng L. Hernandez
Miami Dade Product Control

PGT
Custom Windows and Doors

3400 PRECISION DRIVE
N. VENICE, FL 34275
(941) 480-1600

PREPARED BY A. LYNN MILLER
1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275
(941) 480-1600

REGISTRATION #29296

Series

Title

Desc.

Rev

SGD-5570 WINDOW

VINYL SLIDING GLASS WINDOW (LM)

DP & ANCHOR QUANTITY TABLE

Sheet

DWG No.

Rev.

7 OF 21

MD-5570W.0

G

Date

Drawn By

Rev Date

04/14/16

JENS ROSOWSKI

ANTHONY LYNN MILLER
LICENSE
No. 58705
05/25/26
STATE OF FLORIDA
PROFESSIONAL ENGINEER

A. LYNN MILLER, P.E.
P.E.# 58705

TABLE 2:

Design Pressure (DP) and Anchor Quantities Required (for all approved configurations on Sheet 2)																											
Use this table for: Glass Types 2, 4, 5 or 6 Astragal Reinforcement #29 Lockstile Reinforcement #25 HD Interlock Reinforcement #28				Window Height																							
				30"				36"				48"				60"				72"				84"			
				18-15/16" DLO Height				24-15/16" DLO Height				36-15/16" DLO Height				48-15/16" DLO Height				60-15/16" DLO Height				72-15/16" DLO Height			
				Anchor Group				Anchor Group				Anchor Group				Anchor Group				Anchor Group				Anchor Group			
				A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D	A	B	C	D
Nominal Panel Width	24"	16-5/8" DLO Width	Design Pressure	+100 / -100 psf				+100 / -100 psf				+100 / -100 psf				+100 / -100 psf				+100 / -100 psf				+100 / -100 psf			
			Head/Sill	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1
			Jamb	2	2	2	2	3	3	3	3	3	3	3	3	4	4	4	4	4	4	4	4	5	5	5	5
			P-hook	3	3	3	3	3	3	3	3	4	4	4	4	5	5	5	5	6	6	6	6	7	7	7	7
	30"	22-5/8" DLO Width	Design Pressure	+100 / -100 psf				+100 / -100 psf				+100 / -100 psf				+100 / -100 psf				+100 / -100 psf				+100 / -100 psf			
			Head/Sill	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C3+1	C5+1	C3+1	C3+1	C3+1
			Jamb	2	2	2	2	3	3	3	3	3	3	3	3	4	4	4	4	4	4	5	4	5	5	6	5
			P-hook	3	3	3	3	3	3	3	3	4	4	4	4	5	5	5	5	6	6	6	6	7	7	7	7
	36"	28-5/8" DLO Width	Design Pressure	+100 / -100 psf				+100 / -100 psf				+100 / -100 psf				+100 / -100 psf				+100 / -100 psf				+100 / -100 psf			
			Head/Sill	C3+1	C3+1	C3+1	C3+1	C3+2	C3+1	C3+1	C3+1	C3+2	C3+1	C3+1	C3+1	C3+2	C3+1	C3+1	C3+1	C5+2	C3+1	C3+1	C3+1	C5+2	C3+1	C5+1	C3+1
			Jamb	2	2	2	2	3	3	3	3	3	3	3	3	4	4	4	4	4	4	5	4	5	5	6	5
			P-hook	3	3	3	3	3	3	3	3	4	4	4	4	5	5	5	5	6	6	6	6	7	7	7	7
	42"	34-5/8" DLO Width	Design Pressure	+100 / -100 psf				+100 / -100 psf				+100 / -100 psf				+100 / -100 psf				+100 / -100 psf				+100 / -100 psf			
			Head/Sill	C3+2	C3+1	C3+2	C3+1	C3+2	C3+1	C3+2	C3+1	C3+2	C3+2	C3+2	C3+1	C3+2	C3+2	C3+2	C3+1	C5+2	C3+2	C5+2	C3+1	C5+2	C5+2	C5+2	C3+1
			Jamb	2	2	2	2	3	3	3	3	3	3	3	3	4	4	4	4	4	4	5	4	5	5	7	5
			P-hook	3	3	3	3	3	3	3	3	4	4	4	4	5	5	5	5	6	6	6	6	7	7	7	7
	48"	40-5/8" DLO Width	Design Pressure	+100 / -100 psf				+100 / -100 psf				+100 / -100 psf				+100 / -100 psf				+100 / -100 psf				+100 / -100 psf			
			Head/Sill	C3+2	C3+2	C3+2	C3+1	C3+2	C3+2	C3+2	C3+1	C3+2	C3+2	C3+2	C3+2	C3+2	C3+2	C3+2	C3+2	C5+2	C3+2	C5+2	C3+2	C5+2	C5+2	C5+2	C5+2
			Jamb	2	2	2	2	3	3	3	3	3	3	3	3	4	4	4	4	4	4	5	4	5	5	8	5
			P-hook	3	3	3	3	3	3	3	3	4	4	4	4	5	5	5	5	6	6	6	6	7	7	8	8
	54"	46-5/8" DLO Width	Design Pressure	+80 / -80 psf				+80 / -80 psf				+80 / -80 psf				+80 / -80 psf				+80 / -80 psf				+80 / -80 psf			
			Head/Sill	C3+2	C3+2	C3+2	C3+2	C3+2	C3+2	C3+2	C3+2	C3+2	C3+2	C3+2	C3+2	C3+2	C3+2	C3+2	C3+2	C5+2	C3+2	C3+2	C3+2	C5+2	C3+2	C5+2	C3+2
			Jamb	2	2	2	2	3	3	3	3	3	3	3	3	4	4	4	4	4	4	5	4	5	5	7	5
			P-hook	3	3	3	3	3	3	3	3	4	4	4	4	5	5	5	5	6	6	6	6	7	7	7	7
	60"	52-5/8" DLO Width	Design Pressure	+80 / -80 psf				+80 / -80 psf				+80 / -80 psf				+80 / -80 psf				+80 / -80 psf				+80 / -80 psf			
			Head/Sill	C3+2	C3+2	C3+2	C3+2	C3+2	C3+2	C3+2	C3+2	C3+3	C3+2	C3+2	C3+2	C3+3	C3+2	C3+3	C3+2	C5+3	C3+2	C3+3	C3+2	C5+3	C3+2	C5+3	C3+2
			Jamb	2	2	2	2	3	3	3	3	3	3	3	3	4	4	4	4	4	4	5	4	5	5	7	5
			P-hook	3	3	3	3	3	3	3	3	4	4	4	4	5	5	5	5	6	6	6	6	7	7	7	7

* +/-100.0 PSF FOR ANCHOR GROUPS B, C & D.

ANCHORAGE TYPE PER SUBSTRATE REQUIRED TO ACHIEVE THE DESIGN PRESSURE, USING THE ANCHOR QUANTITIES LISTED BELOW. SEE TABLE A, SHEET 1 FOR COMPLETE ANCHOR LIMITATIONS.

THE MAXIMUM DP AT THESE ANCHOR QUANTITIES. ADDITIONALLY, THE MAXIMUM POSITIVE DP DUE TO THE SILL HEIGHT MUST ALSO BE CONSIDERED, SEE TABLE B1, THIS SHEET.

OF ANCHORS THROUGH THE HEAD & SILL. (EX: FOR C3+1, 3 ANCHORS CLUSTERED AT PANEL MEETING POINT AND 1 ANCHOR REQUIRED AT MIDSPAN OF PANEL).

TOTAL # OF ANCHORS THROUGH THE JAMB.

THE # OF ANCHORS REQUIRED THROUGH THE P-HOOK, PERPENDICULAR TO THE GLASS.

FIG 1:

OH LENGTH

OH HEIGHT

WINDOW ASSEMBLIES INSTALLED WHERE THE OVERHANG (OH) LENGTH IS EQUAL TO OR GREATER THAN THE OVERHANG HEIGHT IS EXEMPTED FROM WATER INFILTRATION RESISTANCE.

TABLE NOTES:

- 1) IF WATER INFILTRATION RESISTANCE IS REQUIRED, THE LESSER VALUES OF EITHER TABLE 2 AND TABLE B2 DETERMINES THE WATER LIMITED (+) DP.
- 2) IF WATER INFILTRATION RESISTANCE IS NOT REQUIRED OR OVERHANG IS PER FIG 1, A SILL RISER IS NOT REQUIRED. IF SO, +DP'S SHOWN IN TABLE 2 MAY BE USED.
- 3) SEE SILL RISER TYPES ON SHEET 4.
- 4) SHEET APPLIES TO 2, 3 AND 4 TRACK CONFIGURATIONS.
- 5) REFER TO ANCHOR NOTES, SHEET 1.
- 6) SEE SHEETS 11-16 FOR ANCHOR LOCATION & SPACING

TABLE B2:

Water-Limited (+) Design Pressure		
Sill Riser	Nom. Sill Height	Max. (+) DP Allowed
None	1-11/16"	See Note 2
42	2-1/2"	+38.7 psf
43	3-1/2"	+60.0 psf
44	4-1/16"	+80.0 psf
45	4-5/8"	+100.0 psf

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No 26-0611-02
Expiration Date 8/14/2031
By Lynn Miller
Miami Date Product Control

PGT
Custom Windows and Doors


3400 PRECISION DRIVE
N. VENICE, FL 34275
(941) 480-1600

PREPARED BY A. LYNN MILLER
1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275

(941) 480-1600

REGISTRATION #29296



Title	VINYL SLIDING GLASS WINDOW (LM)	Date	04/14/16
Desc.	DP & ANCHOR QUANTITY TABLE	Drawn By	JENS ROSOWSKI
Rev		Rev Date	
Series	SGD-5570 WINDOW	Sheet	8 OF 21
DWG No.	MD-5570W.0	Rev.	G



A. LYNN MILLER, P.E.
P.E.# 58705

DLO WIDTH = NOM. PANEL WIDTH - 7-3/8"
DLO HEIGHT = WINDOW HEIGHT - 11-1/16"
PANEL HEIGHT = WINDOW HEIGHT - 2-1/2"

EXAMPLE:
3-PANEL, 3 TRACK, STRAIGHT
CONFIGURATION - PXXX,
INTERIOR MOUNT POCKET, 48" X 84"
NOM. PANELS,
LAMINATED, IG GLAZING, ANCHOR
GROUP A IN WOOD SUBSTRATE,
PROJECT DESIGN PRESSURE
REQUIRED: +48.2/-58.6 PSF

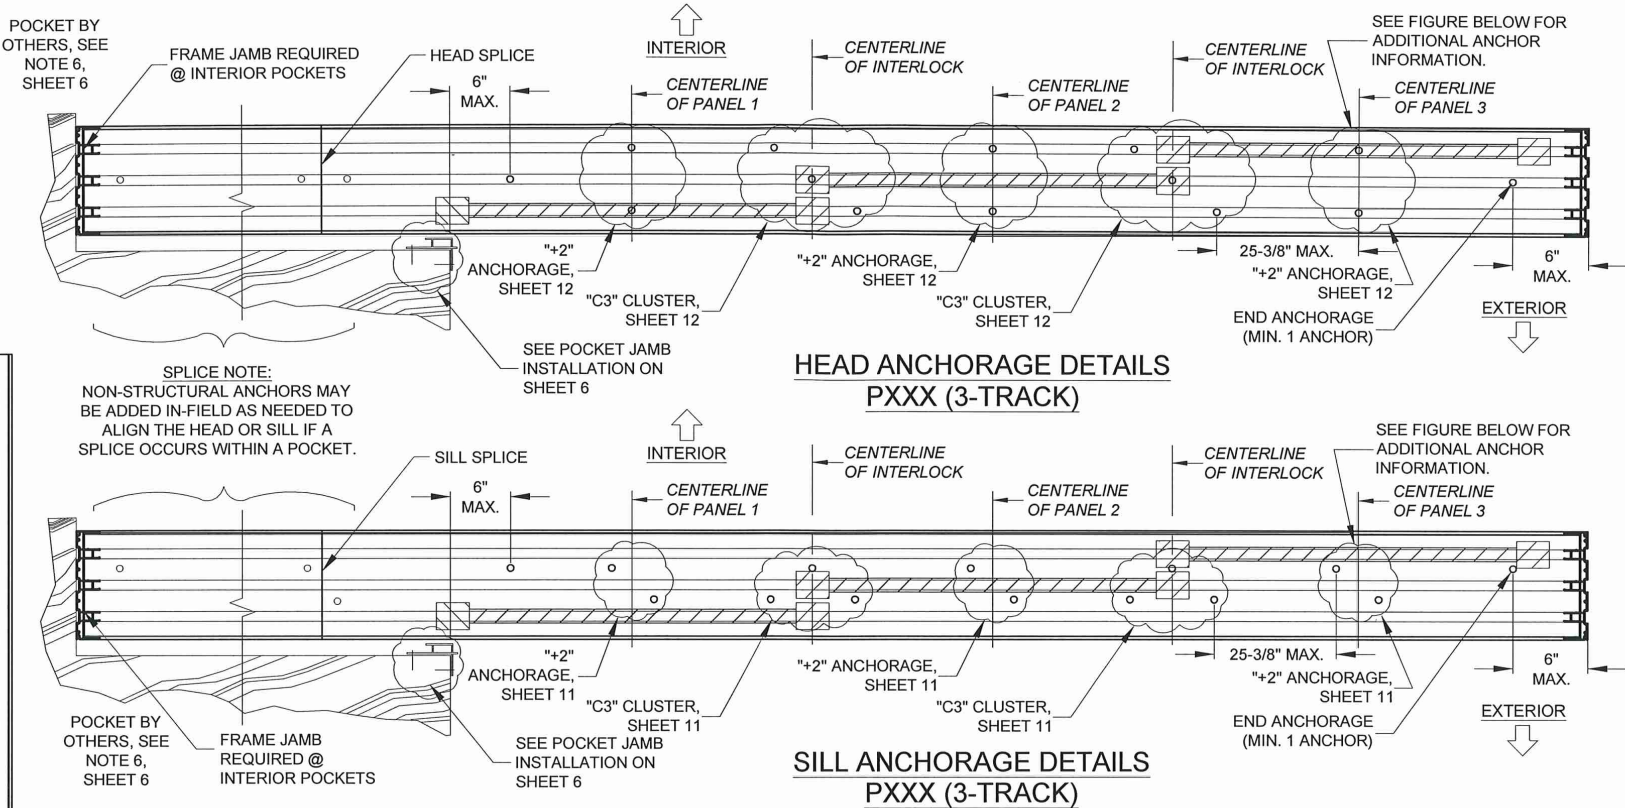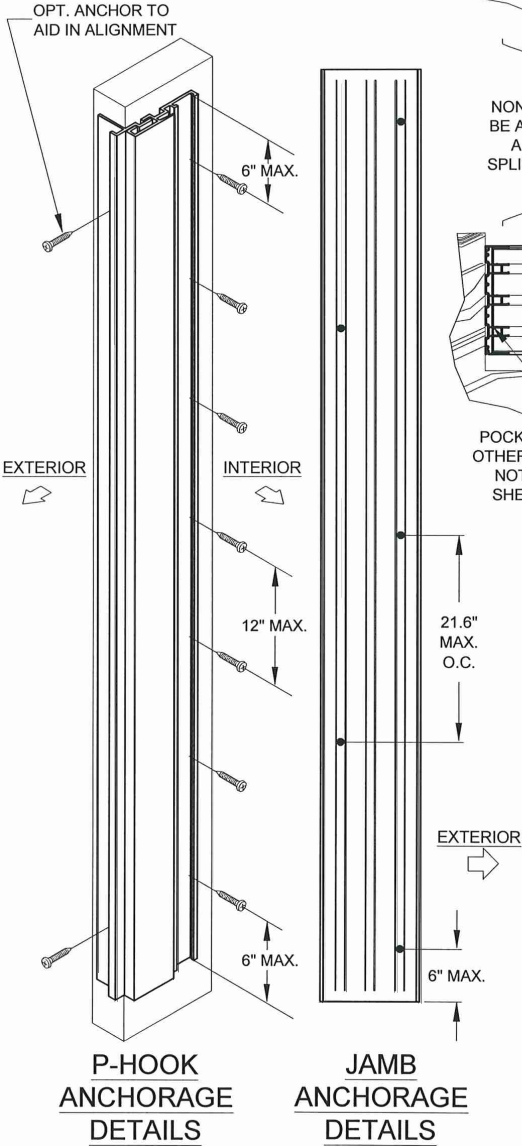

1) KNOWING THE PRODUCT'S REQUIREMENTS, SCAN THROUGH TABLES 1 & 2 FOR A DESIGN PRESSURE THAT MEETS OR EXCEEDS THE REQUIREMENT OF +48.2/-58.6 AT A NOM. PANEL SIZE OF 48" X 84". FROM TABLE 1, SHEET 7, THE DESIGN PRESSURE IS +60/-60 WHICH EXCEEDS THE PROJECT DESIGN PRESSURE REQUIREMENTS.


FOR WOOD INSTALLATION USING ANY ANCHOR IN GROUP A (SEE TABLE A), TABLE 1 SHOWS ANCHOR REQUIREMENTS OF:

Head/Sill	C3+2
Jamb	5
P-hook	7

2) ANCHOR LOCATION DETAILS, CAN BE FOUND ON:
HEAD (CLUSTER ANCHORS): SHEET 12 FOR THE "C3" CLUSTER ANCHORS AT THE INTERLOCK/ASTRAGAL.
HEAD (INTERMEDIATE ANCHORS): SHEET 12 FOR THE "+2" ANCHORS AT THE MIDSPAN OF EACH PANEL.
SILL (CLUSTER ANCHORS): SHEET 11 FOR THE "C3" CLUSTER ANCHORS AT THE INTERLOCK/ASTRAGAL.
SILL (INTERMEDIATE ANCHORS): SHEET 11 FOR THE "+2" ANCHORS AT THE MIDSPAN OF EACH PANEL.
JAMB: 5 ANCHORS, SHEET 13 FOR GEN. LAYOUT.
P-HOOK: 7 ANCHORS, SHEET 13 FOR GENERAL LAYOUT.

3) INSTALLATION DETAILS INTO WOOD CAN BE FOUND ON:
HEAD & SILL: SHEET 4
JAMB: SHEET 3
P-HOOK: SHEET 6

END PANEL ANCHOR EXCEPTION:

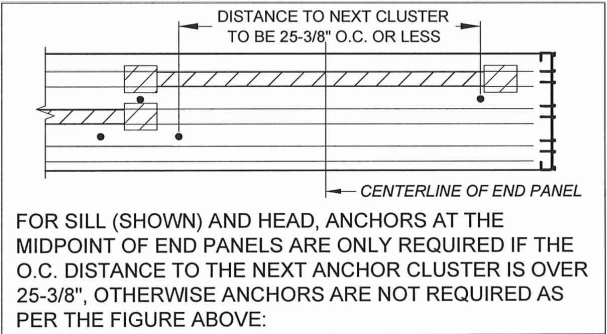


FOR SILL (SHOWN) AND HEAD, ANCHORS AT THE MIDPOINT OF END PANELS ARE ONLY REQUIRED IF THE O.C. DISTANCE TO THE NEXT ANCHOR CLUSTER IS OVER 25-3/8", OTHERWISE ANCHORS ARE NOT REQUIRED AS PER THE FIGURE ABOVE:









FOR PRODUCT REFERENCES, ALSO SEE:
A) SHEET 2 FOR ALLOWABLE CONFIGURATIONS AND EXACT LOCATIONS OF CROSS-SECTION DRAWINGS.
B) SHEET 10 FOR SPECIFIC GLAZING TYPES.
C) SHEET 17 FOR ALLOWABLE PANEL TYPES AND CALL NAMES.
D) SHEETS 4 & 18 FOR EXTRUSION CROSS-SECTION DRAWINGS.
E) SHEET 19 FOR INSTALLATION OF ADDITIONAL ACCESSORIES.
F) SHEET 21 FOR A BILL OF MATERIALS.

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 24-0611-02
Expiration Date 8/4/2031
By Anthony L. Miller
Miami Dade Product Control

Revision:

 Custom Windows and Doors 3400 PRECISION DRIVE N. VENICE, FL 34275 (941) 480-1600	PREPARED BY A. LYNN MILLER 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 (941) 480-1600		REGISTRATION #29296		
	VINYL SLIDING GLASS WINDOW (LM)				
	EXAMPLE				
	SGD-5570 WINDOW				
	9 OF 21				
Title		Date		Rev.	
Series		DWG No.		JENS ROSOWSKI	
Desc.		By		MD-5570W.0	

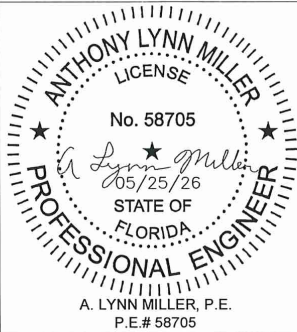

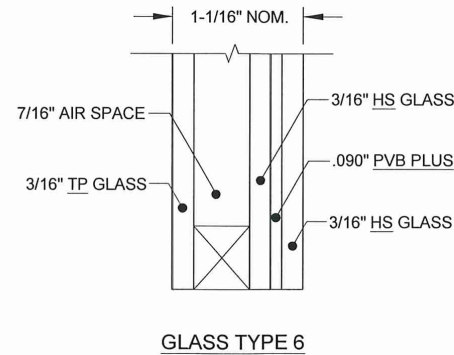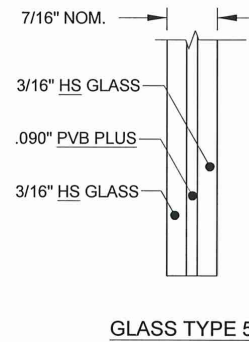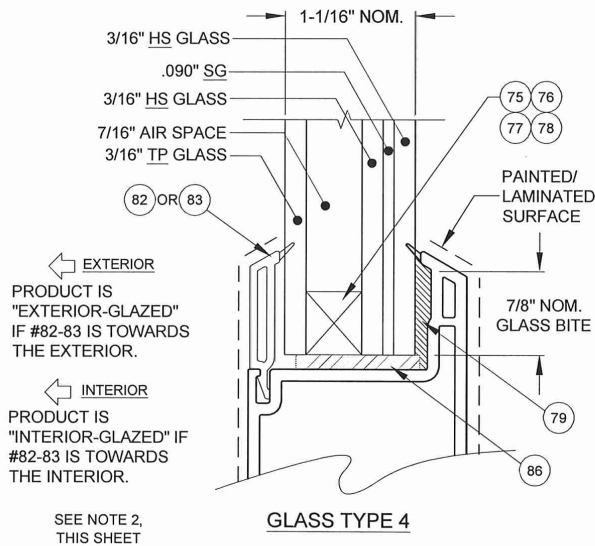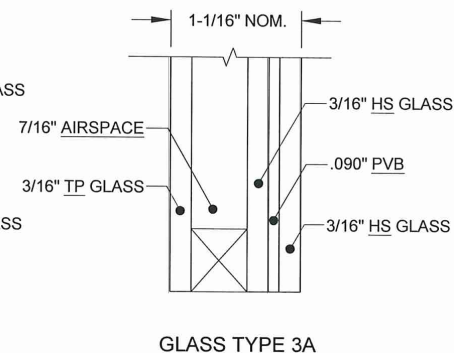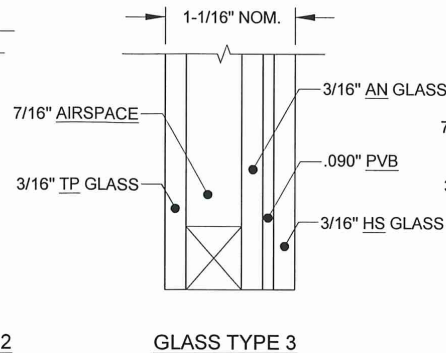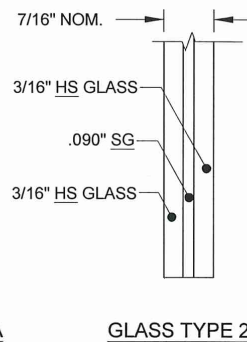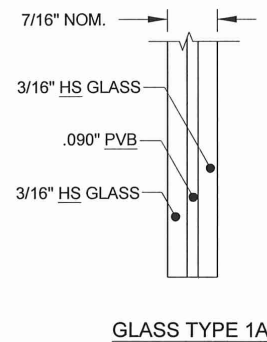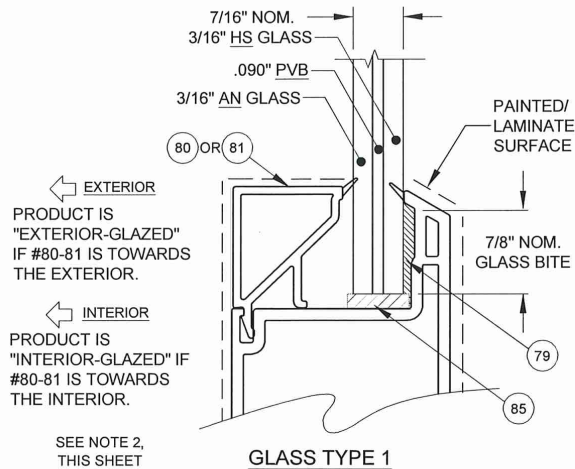

NOTES:

1) BACKBEDDING SURFACES SHALL NOT BE PAINTED OR LAMINATED.

2) PRODUCT MAY BE EITHER INTERIOR OR EXTERIOR GLAZED, PROVIDED THAT THE "HS" SURFACE OF A LAMINATED GLAZING UNIT IS ADHERED TO THE GLAZING LEG.

TABLE B:


Glass Type	Description (Listed from Exterior to Interior)
1	7/16" Lami.: 3/16" AN - .090" PVB - 3/16" HS (Externally-glazed)
1	7/16" Lami.: 3/16" HS - .090" PVB - 3/16" AN (Internally-glazed)
1A	7/16" Lami.: 3/16" HS - .090" PVB - 3/16" HS
2	7/16" Lami.: 3/16" HS - .090" SG - 3/16" HS
3	1-1/16" Lami. I.G.: 3/16" TP - AIR - 3/16" AN - .090" PVB - 3/16" HS (Externally-glazed)
3	1-1/16" Lami. I.G.: 3/16" TP - AIR - 3/16" HS - .090" PVB - 3/16" AN (Internally-glazed)
3A	1-1/16" Lami. I.G.: 3/16" TP - AIR - 3/16" HS - .090" PVB - 3/16" HS
4	1-1/16" Lami. I.G.: 3/16" TP - AIR - 3/16" HS - .090" SG - 3/16" HS
5	9/16" Lami.: 3/16" HS - .090" PVB PLUS - 3/16" HS
6	1-1/16" Lami. I.G.: 3/16" TP - AIR - 3/16" HS - .090" PVB PLUS - 3/16" HS

"AN" = ANNEALED
 "HS" = HEAT STRENGTHENED
 "TP" = TEMPERED
 "PVB" = TROSIFOL® PVB INTERLAYER BY KURARAY AMERICA, INC.
 "SG" = SENTRYGLAS® INTERLAYER BY KURARAY AMERICA, INC.
 "PVB PLUS" = MODIFIED TROSIFOL® PVB INTERLAYER BY KURARAY AMERICA, INC.


PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No. 26-0611.02
 Expiration Date 8/4/2031
 By Anthony L. Miller
 Miami Dade Product Control

Revision:


PGT Custom Windows and Doors 3400 PRECISION DRIVE N. VENICE, FL 34275 (941) 480-1600	PREPARED BY A. LYNN MILLER 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275		REGISTRATION #29296 (941) 480-1600		04/14/16 Date	JENS ROSOWSKI Drawn By	G Rev.
	VINYL SLIDING GLASS WINDOW (LM)		10 OF 21 Sheet		10 OF 21 DWG	MD-5570W.0 No.	G Rev.
	GLAZING DETAILS SGD-5570 WINDOW		10 OF 21 Sheet		10 OF 21 DWG	MD-5570W.0 No.	G Rev.

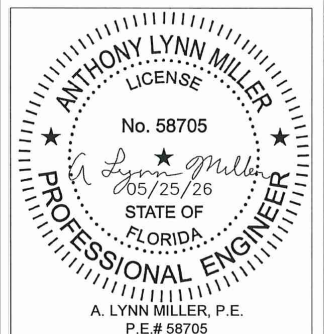

SILL CLUSTER ANCHORS LAYOUT:

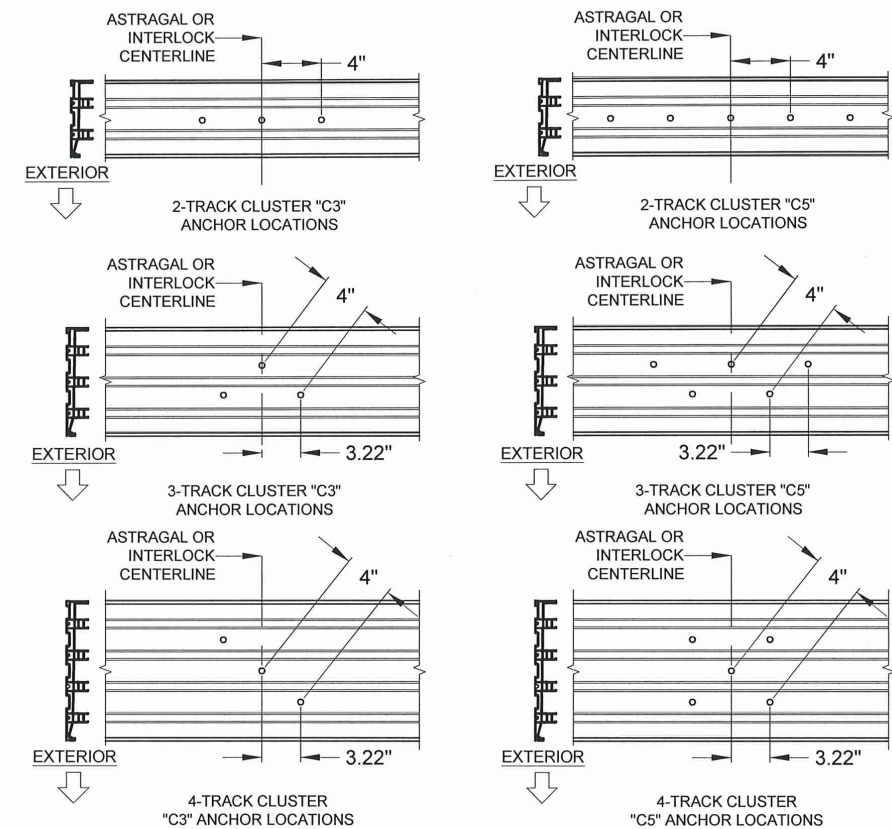


NOTES:
1) ALL DIMENSIONS SHOWN ARE BASED ON MINIMUM ALLOWED.
2) TRACK-TO-TRACK DISTANCE IS 2.375" FOR ALL SILLS:



FIGURES PERTAIN TO THE FOLLOWING SILL CLUSTER ANCHOR LOCATIONS:

Head/Sill	C3+1
Jamb	5
P-hook	7

SILL "+" INTERMEDIATE ANCHORS LAYOUT:

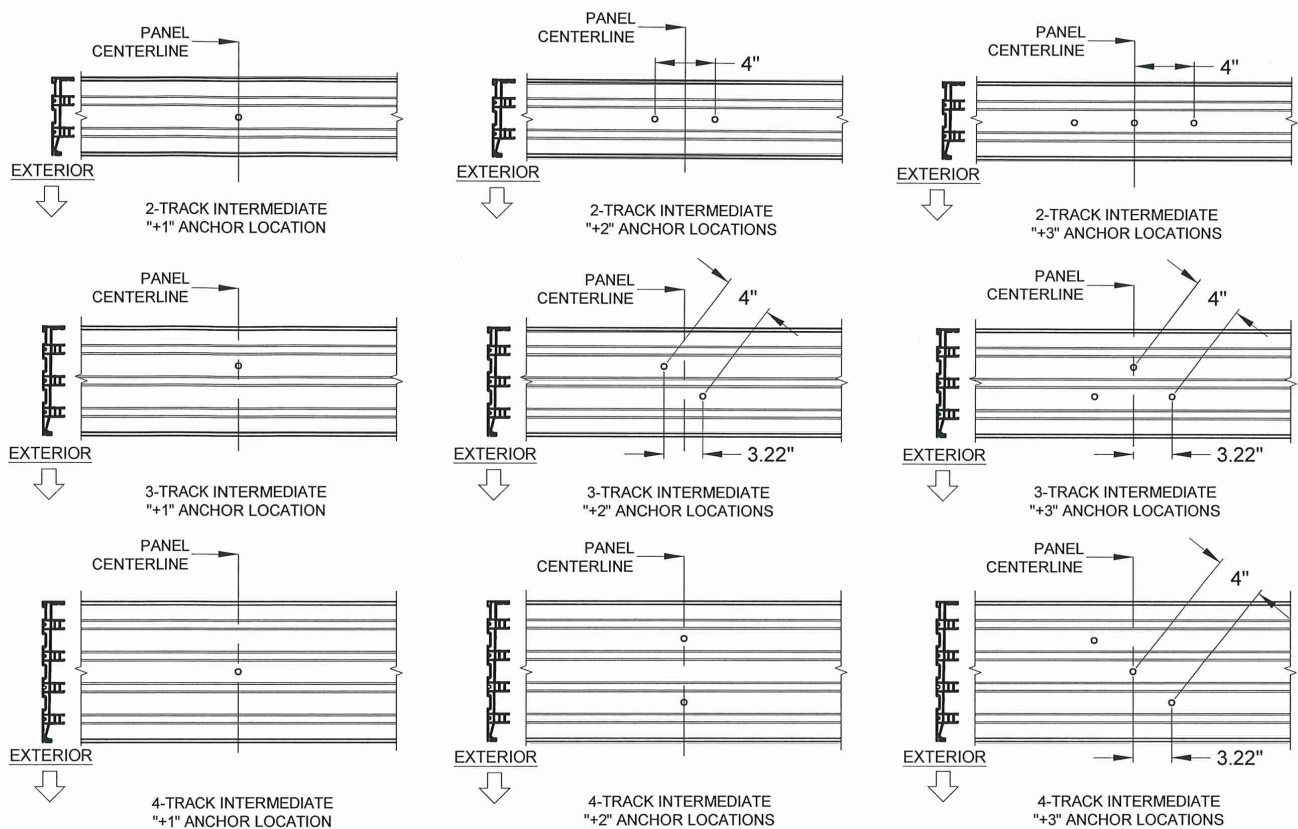


FIGURES PERTAIN TO THE FOLLOWING SILL INTERMEDIATE ANCHOR LOCATIONS:

Head/Sill	C3+1
Jamb	5
P-hook	7

NOTES:
1) ALL DIMENSIONS SHOWN ARE BASED ON MINIMUM ALLOWED.

2) TRACK-TO-TRACK DISTANCE IS 2.375" FOR ALL SILLS:



PRODUCT RENEWED
as complying with the Florida Building Code
Acceptance No **26-0611-07**
Expiration Date **8/4/2021**
By **[Signature]**
Miami Dade Product Control


PGT
Custom Windows and Doors
3400 PRECISION DRIVE
N. VENICE, FL 34275
(941) 480-1600

PREPARED BY A. LYNN MILLER
1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275
(941) 480-1600
REGISTRATION #29296


Series	SGD-5570 WINDOW	Sheet	11 OF 21	DWG No.	MD-5570W.0	Rev.	G
Title	VINYL SLIDING GLASS WINDOW (LM)			Date	04/14/16		
Desc.	ANCHOR LAYOUTS			Drawn By	JENS ROSOWSKI		
Rev				Rev Date			

ANTHONY LYNN MILLER
LICENSE
No. 58705
05/25/26
STATE OF FLORIDA
PROFESSIONAL ENGINEER
A. LYNN MILLER, P.E.
P.E.# 58705


HEAD CLUSTER ANCHORS LAYOUT:

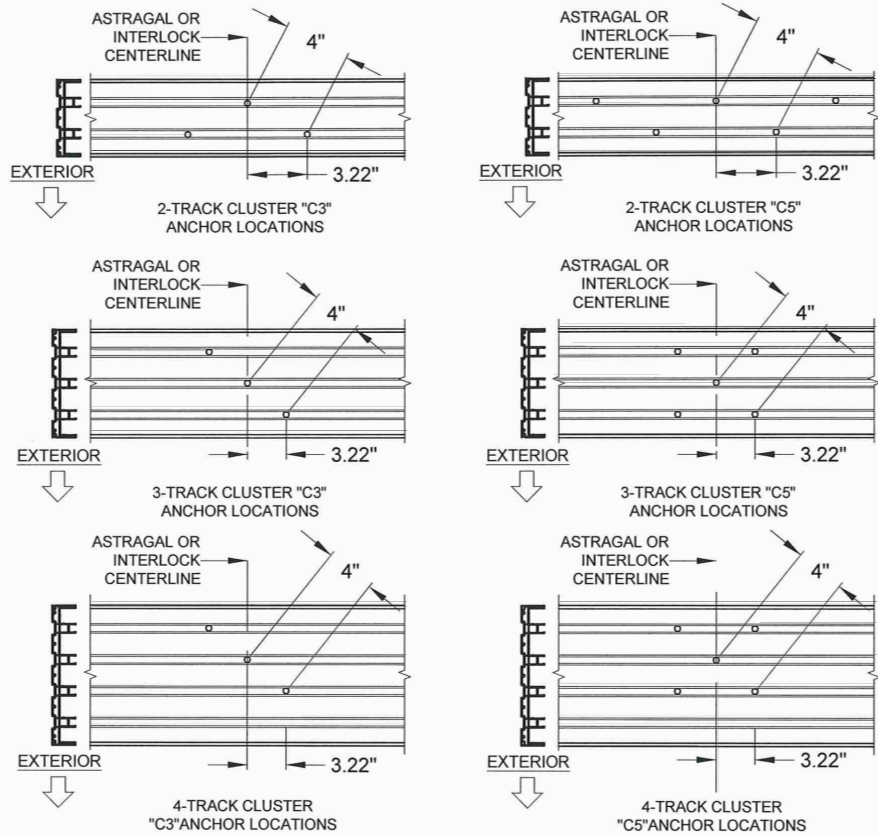


- NOTES:
- 1) ALL DIMENSIONS SHOWN ARE BASED ON MINIMUM ALLOWED.
- 2) TRACK-TO-TRACK DISTANCE IS 2.375" FOR ALL HEADS:




FIGURES PERTAIN TO THE FOLLOWING HEAD CLUSTER ANCHOR LOCATIONS:

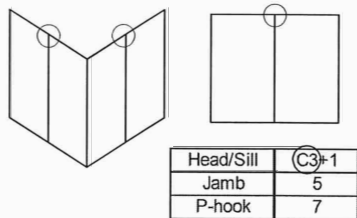

HEAD "+" INTERMEDIATE ANCHORS LAYOUT:

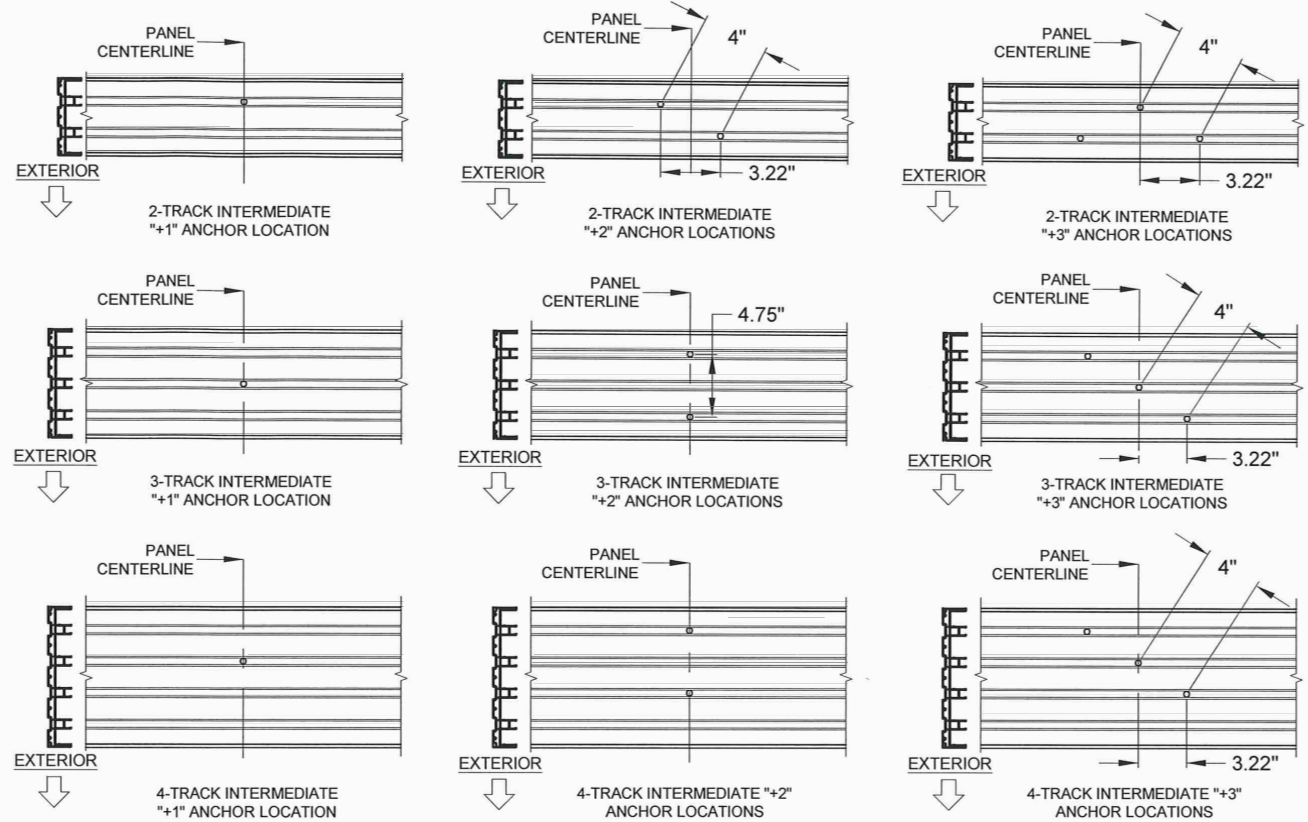


FIGURES PERTAIN TO THE FOLLOWING HEAD INTERMEDIATE ANCHOR LOCATIONS:

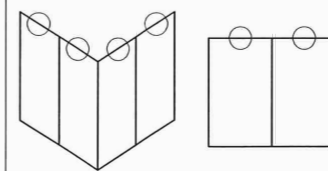

Head/Sill	C3+1
Jamb	5
P-hook	7

- NOTES:
- 1) ALL DIMENSIONS SHOWN ARE BASED ON MINIMUM ALLOWED.

- 2) TRACK-TO-TRACK DISTANCE IS 2.375" FOR ALL SILLS:




PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No 26-0611-02
Expiration Date 8/14/2031
By *Anthony L. Miller*
Miami Date Product Control

PGT
Custom Windows and Doors
3400 PRECISION DRIVE
N. VENICE, FL 34275
(941) 480-1600


PREPARED BY A. LYNN MILLER
1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275
(941) 480-1600

REGISTRATION #29296

Title					VINYL SLIDING GLASS WINDOW (LM)		Date		04/14/16		
Desc.				ANCHOR LAYOUTS			Drawn By		JENS ROSOWSKI		
Rev								Rev		Date	
Series	SGD-5570 WINDOW		Sheet	12 OF 21		DWG No.	MD-5570W.0			Rev.	G

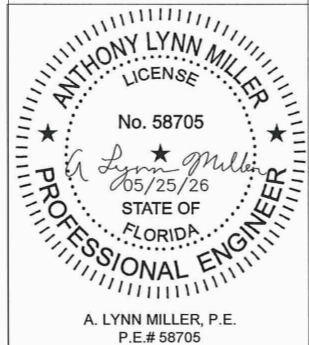

P-HOOK ANCHORS LAYOUT:

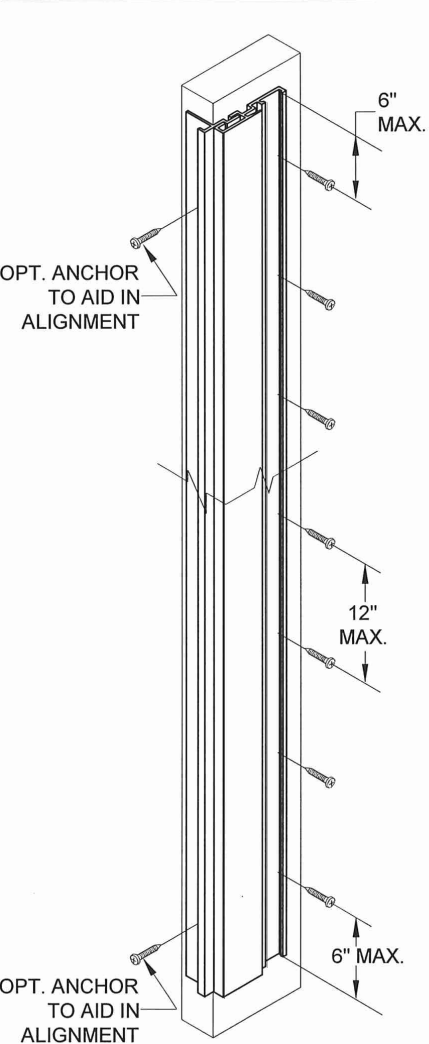


NOTES:
1) SEE TABLES 1 & 2 FOR EXACT QUANTITY OF ANCHORS REQUIRED IN THE P-HOOK.

FIGURES PERTAIN TO THE FOLLOWING POCKET JAMB (P-HOOK) ANCHOR LOCATIONS:

POCKET	POCKET
Head/Sill	C3+1
Jamb	5
P-hook	7


JAMB ANCHORS LAYOUT, (PARTIAL VIEW):

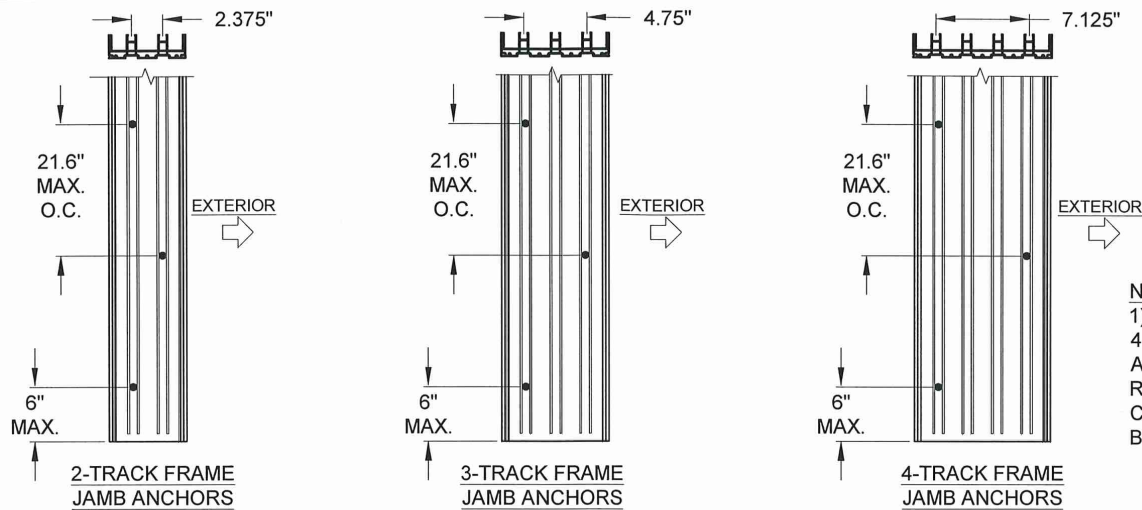

FIGURES PERTAIN TO THE FOLLOWING JAMB ANCHOR LOCATIONS:

Head/Sill	C3+1
Jamb	5
P-hook	7

NOTES:
1) STANDARD ANCHOR LOCATIONS SHOWN. FOR 3 AND 4-TRACK JAMBS, ANCHORS MAY BE LOCATED IN ANY ADJACENT TRACK (SIMILAR TO THE 2-TRACK JAMB) AS REQUIRED TO MEET MIN. EDGE DISTANCE CONSTRAINTS. IN CASE OF AN ODD NUMBER OF ANCHORS, THE MAJORITY MAY BE TOWARD THE INTERIOR OR EXTERIOR.

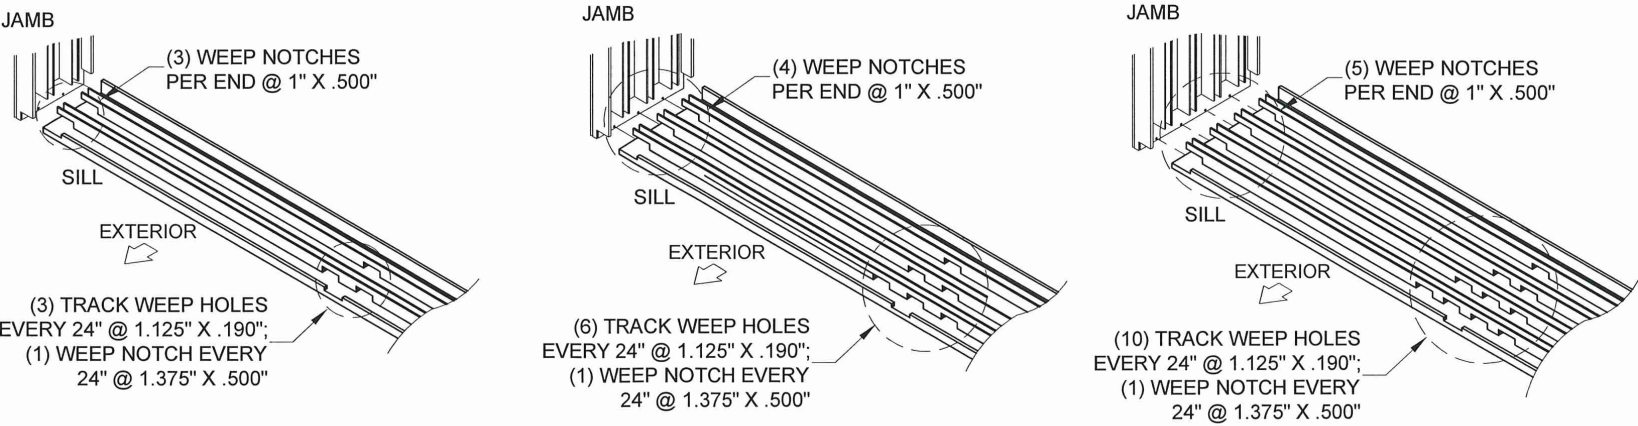

SILL WEEPHOLE LAYOUT (2, 3 & 4 TRACKS)

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 26-0611-02
Expiration Date 8/4/2031
By [Signature]
Miami Dade Product Control

PGT
Custom Windows and Doors
3400 PRECISION DRIVE
N. VENICE, FL 34275
(941) 480-1600


PREPARED BY A. LYNN MILLER
1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275
(941) 480-1600
REGISTRATION #29296

Title	VINYL SLIDING GLASS WINDOW (LM)	Date	04/14/16
Desc.	ANCHOR LAYOUTS	Drawn By	JENS ROSOWSKI
Rev		Rev Date	
Series	SGD-5570 WINDOW	Sheet	13 OF 21
DWG No.	MD-5570W.0	Rev.	G

ANTHONY LYNN MILLER
LICENSE
No. 58705
05/25/26
STATE OF FLORIDA
PROFESSIONAL ENGINEER

A. LYNN MILLER, P.E.
P.E.# 58705


HEAD 90° CORNER CLUSTER ANCHORS LAYOUT:

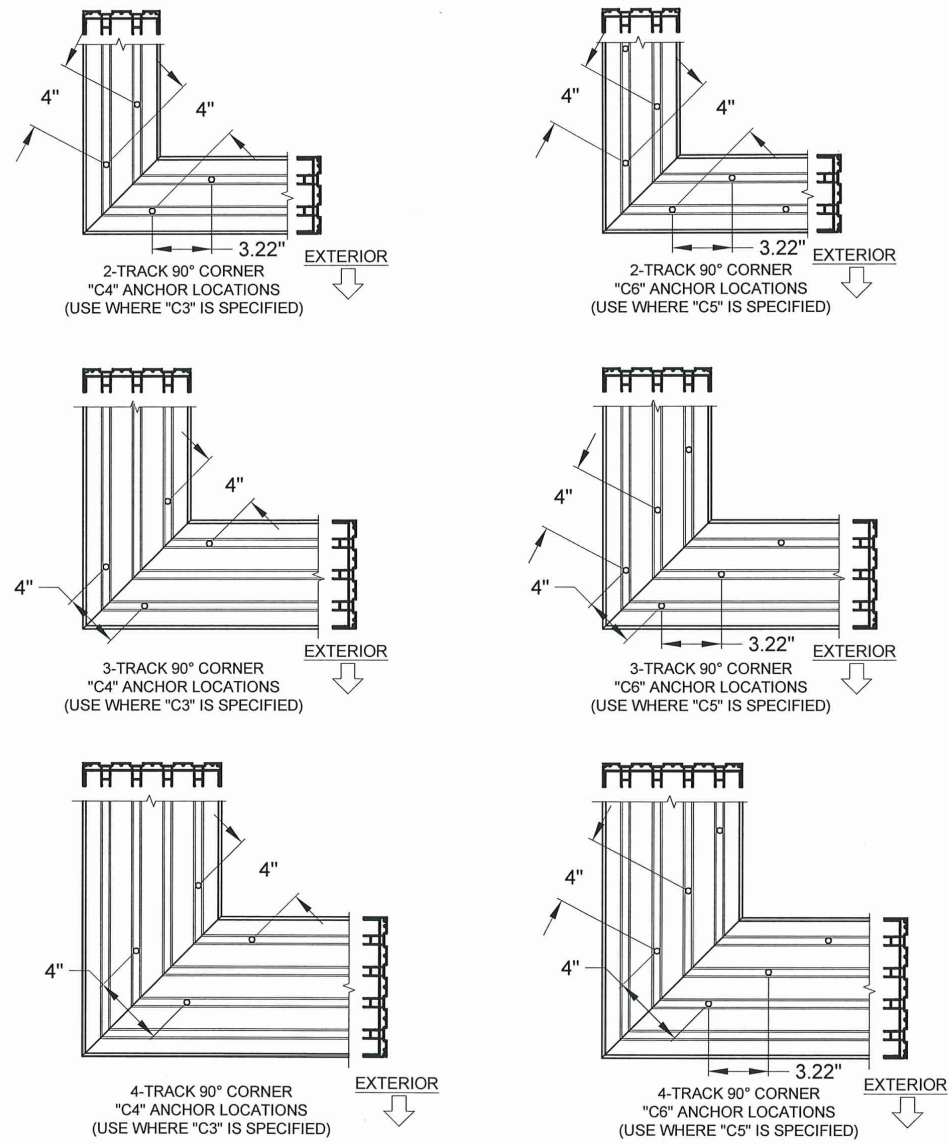


FIGURES PERTAIN TO THE FOLLOWING 90° CORNER HEAD ANCHOR LOCATIONS:

Head/Sill	(C3)+1
Jamb	5
P-hook	7

- NOTES:
- 1) ALL DIMENSIONS SHOWN ARE BASED ON MINIMUM ALLOWED.
 - 2) DETAILS DEPICT ANCHOR QUANTITY AND SPACING, AND WOULD BE SIMILAR FOR OUTSIDE (SHOWN) AND INSIDE CORNER CONFIGURATIONS.
 - 3) TRACK-TO-TRACK DISTANCE IS 2.375" FOR ALL HEADS AND SILLS:

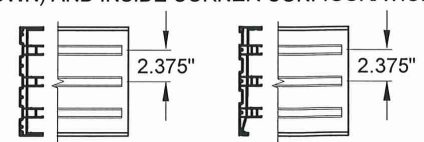

SILL 90° CORNER CLUSTER ANCHORS LAYOUT:

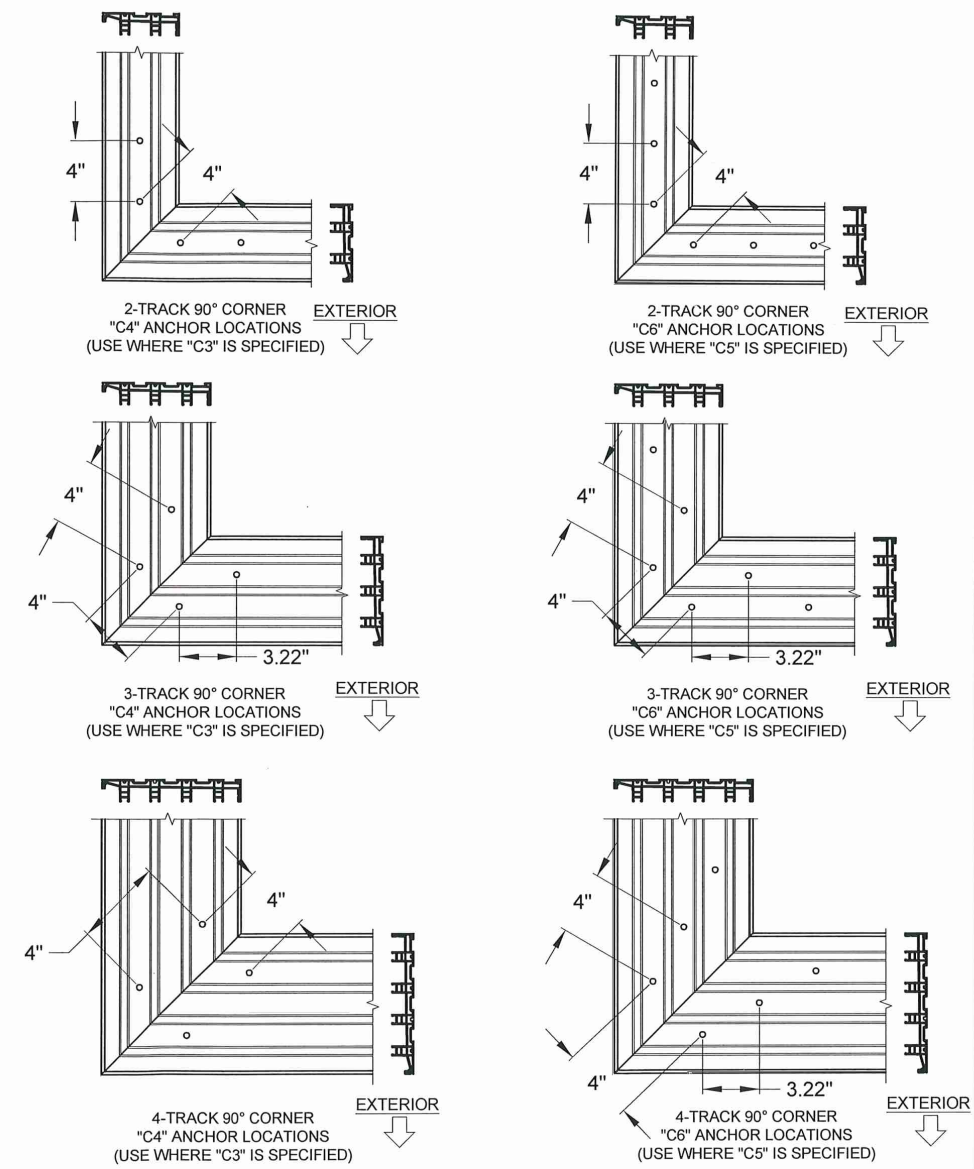

FIGURES PERTAIN TO THE FOLLOWING 90° CORNER SILL ANCHOR LOCATIONS:

Head/Sill	(C3)+1
Jamb	5
P-hook	7

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 26-0611-02
Expiration Date 8/4/2031
By Isling L. L. L.
Miami Dade Product Control

Revision:

PREPARED BY A. LYNN MILLER
1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275
(941) 480-1600
REGISTRATION #29296

DATE 04/14/16
DRAWN BY JENS ROSOWSKI
ANCHOR LAYOUTS
SGD-5570 WINDOW


Rev. G
MD-5570W.0
14 OF 21
Sheet

PGT
Custom Windows and Doors
3400 PRECISION DRIVE
N. VENICE, FL 34275
(941) 480-1600


VINYL SLIDING GLASS WINDOW (LM)
ANCHOR LAYOUTS
SGD-5570 WINDOW

ANTHONY LYNN MILLER
LICENSE
No. 58705
05/25/26
STATE OF FLORIDA
PROFESSIONAL ENGINEER
A. LYNN MILLER, P.E.
P.E.# 58705


HEAD 135° CORNER CLUSTER ANCHORS LAYOUT:

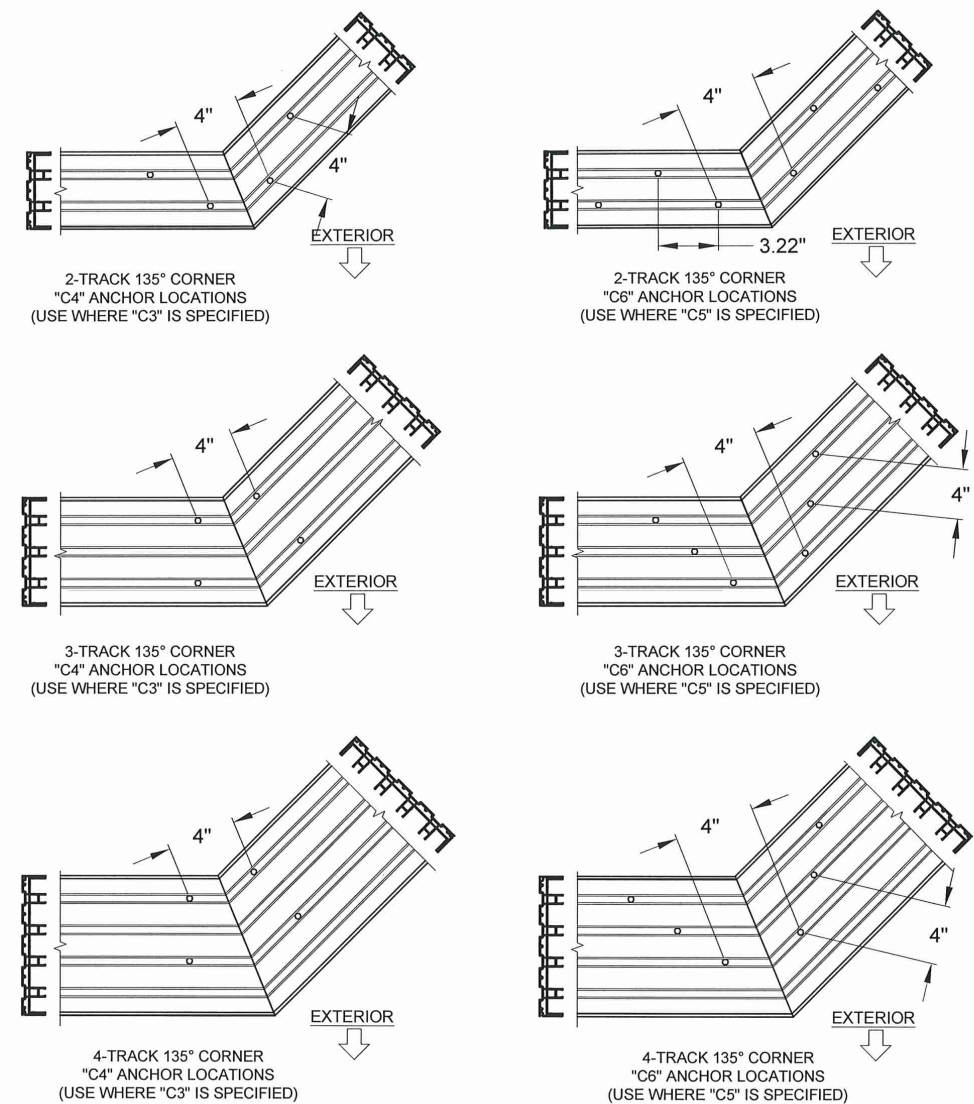

SILL 135° CORNER CLUSTER ANCHORS LAYOUT:

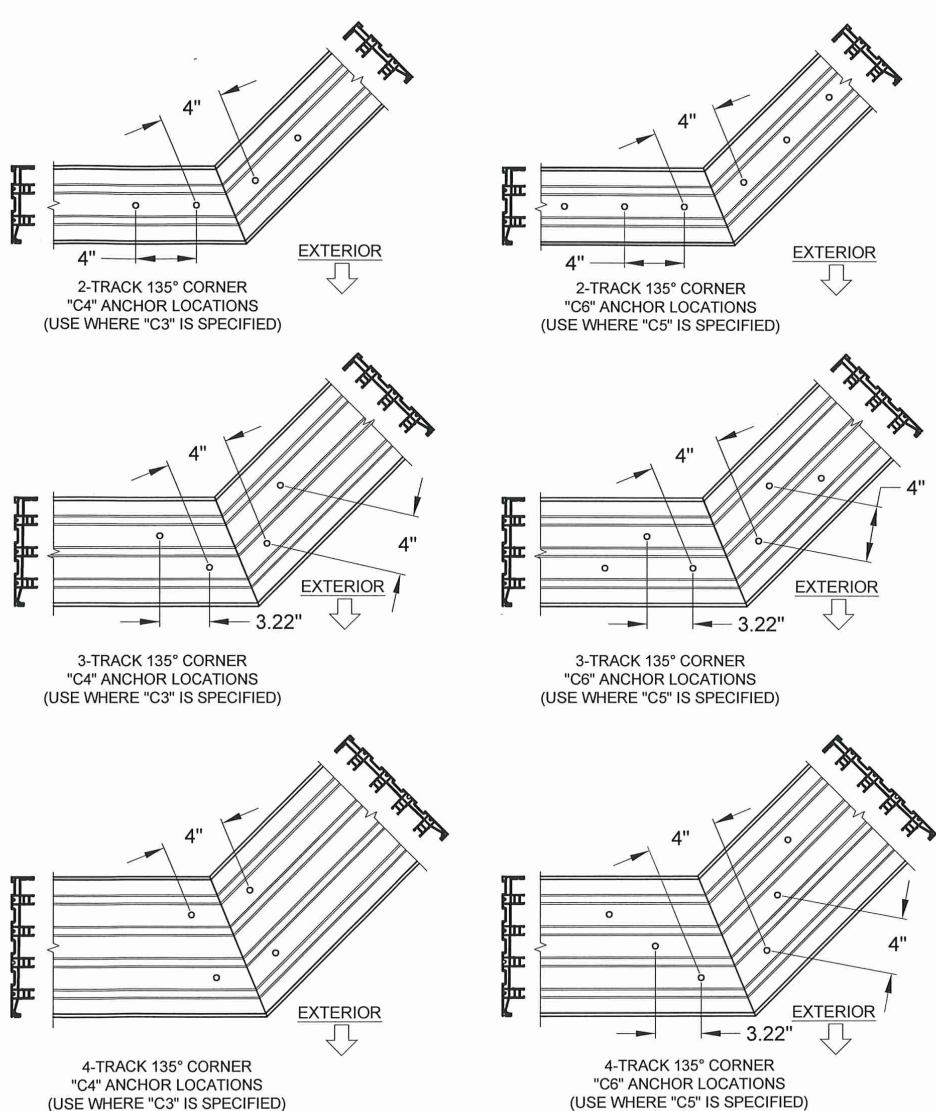

- NOTES:
- 1) ALL DIMENSIONS SHOWN ARE BASED ON MINIMUM ALLOWED.
 - 2) DETAILS DEPICT ANCHOR QUANTITY AND SPACING, AND WOULD BE SIMILAR FOR OUTSIDE (SHOWN) AND INSIDE CORNER CONFIGURATIONS.
 - 3) TRACK-TO-TRACK DISTANCE IS 2.375" FOR ALL HEADS AND SILLS:

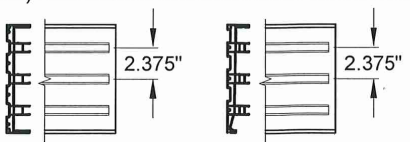

FIGURES PERTAIN TO THE FOLLOWING 135° CORNER HEAD ANCHOR LOCATIONS:

Head/Sill	(C3)+1
Jamb	5
P-hook	7


FIGURES PERTAIN TO THE FOLLOWING 135° CORNER SILL ANCHOR LOCATIONS:

Head/Sill	(C3)+1
Jamb	5
P-hook	7

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 26-0611-02
Expiration Date 8/14/2031
By *Anthony L. Miller*
Miami Dade Product Control



Revision:

PREPARED BY A. LYNN MILLER 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 Custom Windows and Doors 3400 PRECISION DRIVE N. VENICE, FL 34275 (941) 480-1600	REGISTRATION #29296 VINYL SLIDING GLASS WINDOW (LM)	Date	04/14/16	Rev.	G
		Drawn By	JENS ROSOWSKI	DWG No.	MD-5570W.0
		Anchor Layouts	SGD-5570 WINDOW	Sheet	15 OF 21

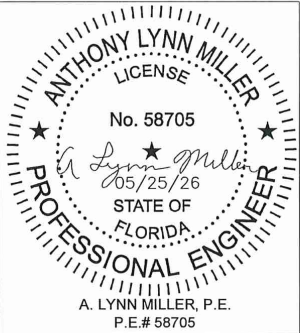

HEAD SPLICE ANCHORS LAYOUT @ INTERLOCK OR ASTRAGAL:

SILL SPLICE ANCHORS LAYOUT @ INTERLOCK OR ASTRAGAL:

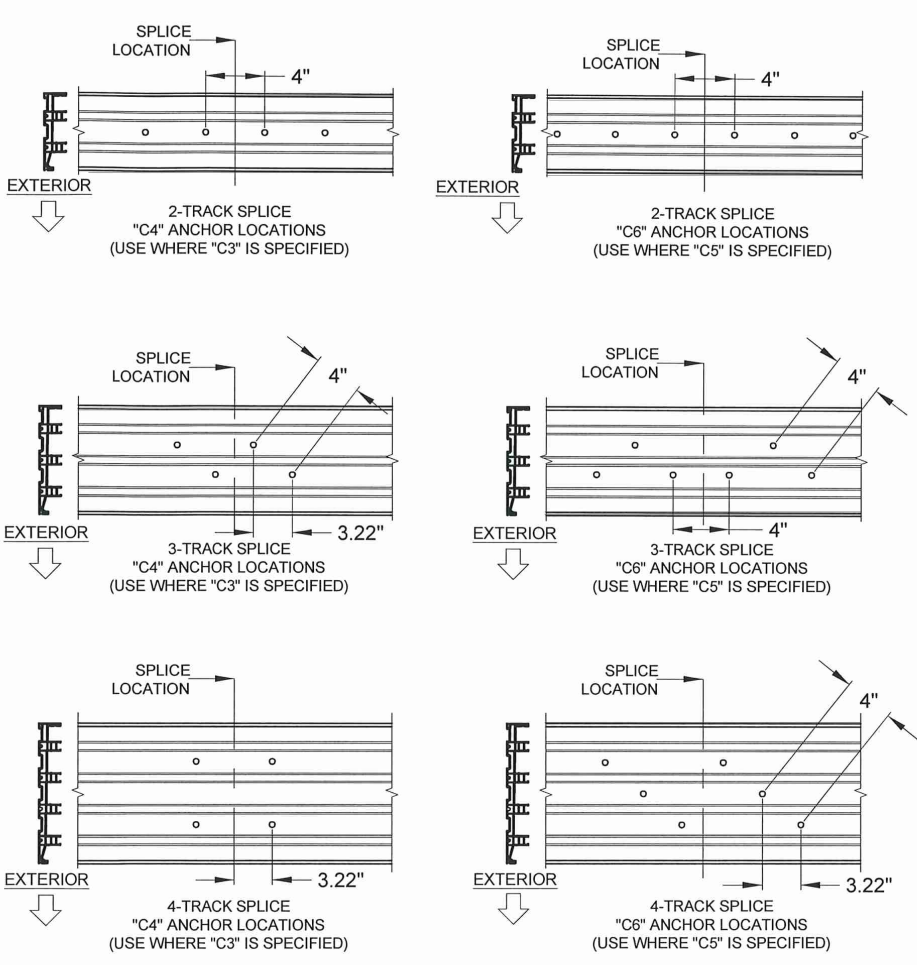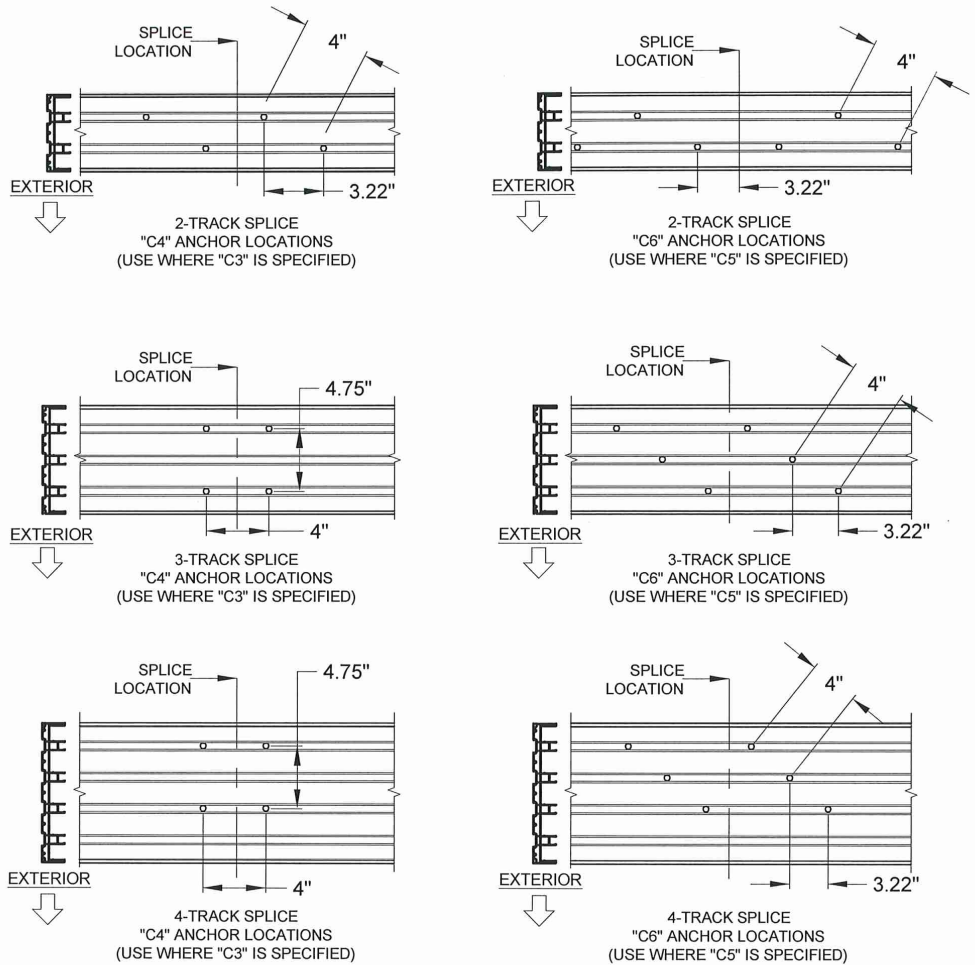

- NOTES:
- 1) ALL DIMENSIONS SHOWN ARE BASED ON MINIMUM ALLOWED.
 - 2) ABOVE FIGURES ARE FOR SPLICES OCCURRING AT THE ASTRAGAL OR INTERLOCK. FOR SPLICES OCCURRING INSIDE OF A POCKET, SEE THE EXAMPLE ON SHEET 9.
 - 3) TRACK-TO-TRACK DISTANCE IS 2.375" FOR ALL HEADS AND SILLS:
 - 4) POCKET WALL OR CAVITY IS NOT PART OF THIS APPROVAL AND IS TO BE DESIGNED BY OTHERS AND REVIEWED BY THE AUTHORITY HAVING JURISDICTION.

FIGURES PERTAIN TO THE FOLLOWING SPLICED HEAD ANCHOR LOCATIONS:

Head/Sill	(C3)+1
Jamb	5
P-hook	7

FIGURES PERTAIN TO THE FOLLOWING SPLICED SILL ANCHOR LOCATIONS:

Head/Sill	(C3)+1
Jamb	5
P-hook	7

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. **26-0611-02**
Expiration Date **8/14/2031**
By **Anthony L. Miller**
Miami Dade Product Control

Revision:

PREPARED BY A. LYNN MILLER
1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275
(941) 480-1600
REGISTRATION #29296

DATE 04/14/16
DRAWN BY JENS ROSOWSKI
MD-5570W.0

DATE 04/14/16
DRAWN BY JENS ROSOWSKI
MD-5570W.0

DATE 04/14/16
DRAWN BY JENS ROSOWSKI
MD-5570W.0

PGT
Custom Windows and Doors
3400 PRECISION DRIVE
N. VENICE, FL 34275
(941) 480-1600

VINYL SLIDING GLASS WINDOW (LM)
ANCHOR LAYOUTS
SGD-5570
WINDOW

DATE 04/14/16
DRAWN BY JENS ROSOWSKI
MD-5570W.0


DATE 04/14/16
DRAWN BY JENS ROSOWSKI
MD-5570W.0

DATE 04/14/16
DRAWN BY JENS ROSOWSKI
MD-5570W.0

ANTHONY LYNN MILLER
LICENSE
No. 58705
05/25/26
STATE OF
FLORIDA
PROFESSIONAL ENGINEER
A. LYNN MILLER, P.E.
P.E.# 58705

HEADER BLOCK TO HEADER ATTACHMENT
TO PREVENT ANY EXTERIOR-OPERABLE
PANEL FROM DISLODGING TO THE
EXTERIOR, INSTALL ONE HEADER BLOCK
AT EACH INTERLOCK, ASTRAGAL AND
P-HOOK INTO THE EXTERIOR TRACK OF THE
HEADER. TRIM THE SCREW COVER AS
NEEDED. SEE SHEET 19 FOR INSTALLATION
DETAILS OF ADDITIONAL HEADER BLOCKS.

EXAMPLE: HEADER BLOCK PLACEMENT IN
3-PANEL CONFIGURATION, OTHERS SIMILAR.

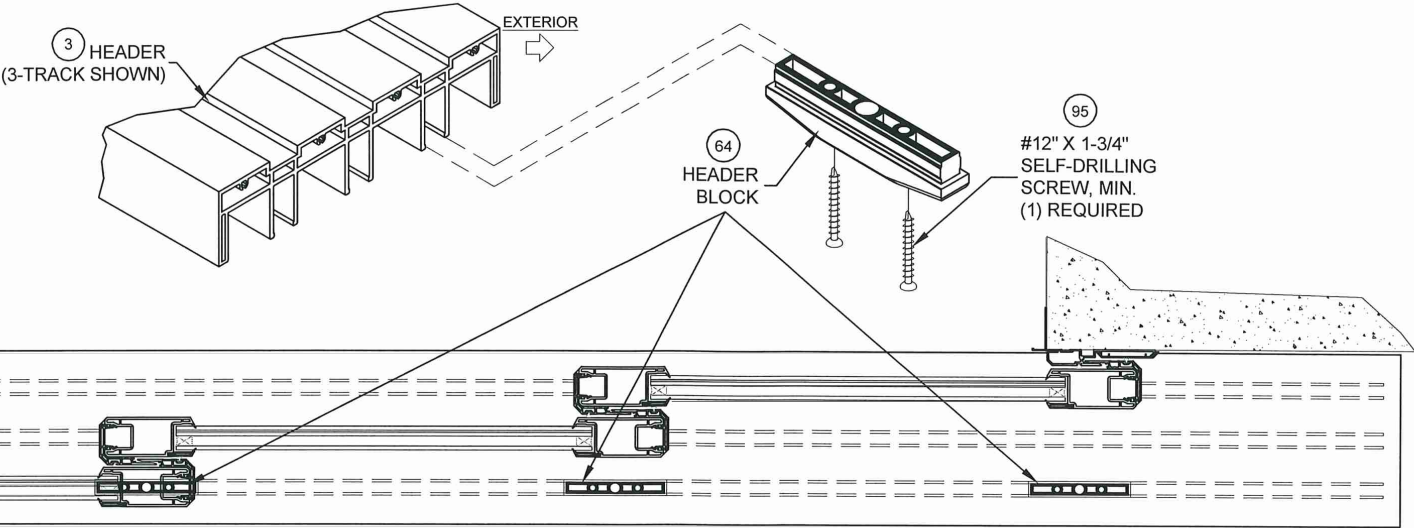





- PANEL NOTES:**
- 1) SEE DP/ANCHOR TABLES 1 & 2, SHEETS 7-8 FOR PANEL SIZES & DESIGN PRESSURE.
 - 2) PANEL TYPES NOT SHOWN ARE NOT REQUIRED FOR ANY CONFIGURATIONS AND ARE NOT AVAILABLE.
 - 3) MAXIMUM NOMINAL PANEL WIDTH FOR ALL PANEL CONFIGURATIONS IS 60".
 - 4) PANEL TYPE MAY BE EITHER EXTERIOR (STANDARD) OR INTERIOR GLAZED, BOTH TYPES QUALIFIED BY THIS APPROVAL, SEE DETAILS SHEET 10.

PANEL TYPES INTERIOR OR EXTERIOR GLAZED		PANEL'S RIGHT STILE TYPE									
		SINGLE INTERLOCK OUT	SINGLE INTERLOCK IN	FIXED STILE	LOCKSTILE W/ HANDLE	ASTRAGAL BOX OUT	ASTRAGAL BOX IN	OUTSIDE 90° ASTRAGAL RECEIVER	INSIDE 90° ASTRAGAL RECEIVER	OUTSIDE 135° ASTRAGAL RECEIVER	INSIDE 135° ASTRAGAL RECEIVER
PANEL'S LEFT STILE TYPE	SINGLE INTERLOCK OUT		F	PP	K	L (BOX OUT)	L (BOX IN)	TC	TA	TV	TW
	SINGLE INTERLOCK IN	B	E	P	A	C (BOX OUT)	C (BOX IN)	SC	SA	SV	SW
	FIXED STILE	RR	R			S (BOX OUT)	S (BOX IN)	FC	FD	FV	FW
	LOCKSTILE W/ HANDLE	D	M			J (BOX OUT)	J (BOX IN)				
	ASTRAGAL BOX OUT	LR (BOX OUT)		T (BOX OUT)	U (BOX OUT)						
	ASTRAGAL BOX IN		N (BOX IN)	T (BOX IN)	U (BOX IN)						
	OUT. 90° ASTRAGAL RECEIVER	CT	CS	CF							
	IN. 90° ASTRAGAL RECEIVER	AT	AS	DF							
	OUT. 135° ASTRAGAL RECEIVER	VT	VS	VF							
	IN. 135° ASTRAGAL RECEIVER	WT	WS	WF							


LEFT
PANEL
STILE


PANEL TYPE "F" SHOWN.

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 26-0611-02
Expiration Date 8/4/2031
By [Signature]
Miami Dade Product Control

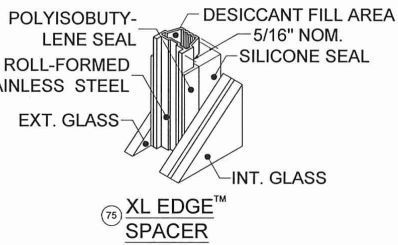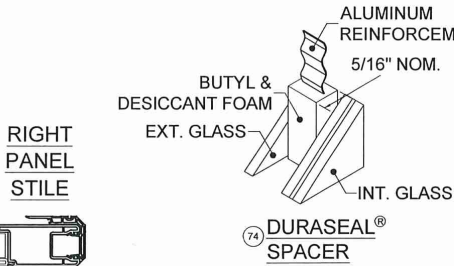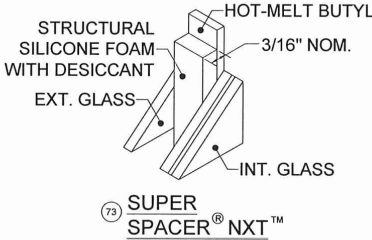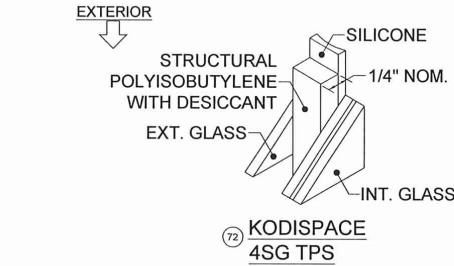


PGT Custom Windows and Doors 3400 PRECISION DRIVE N. VENICE, FL 34275 (941) 480-1600		PREPARED BY A. LYNN MILLER 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 (941) 480-1600 REGISTRATION #29296		
Title	VINYL SLIDING GLASS WINDOW (LM)		Date	04/14/16
Desc.	PANEL TYPES & HEADER BLOCK		Drawn By	JENS ROSOWSKI
Rev			Rev Date	
Series	SGD-5570 WINDOW	Sheet	17 OF 21	DWG No. MD-5570W.0
Rev.			G	


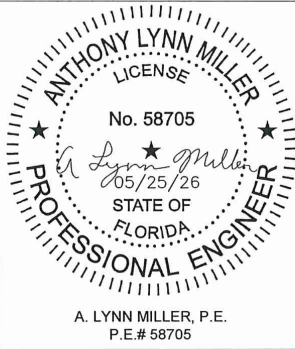


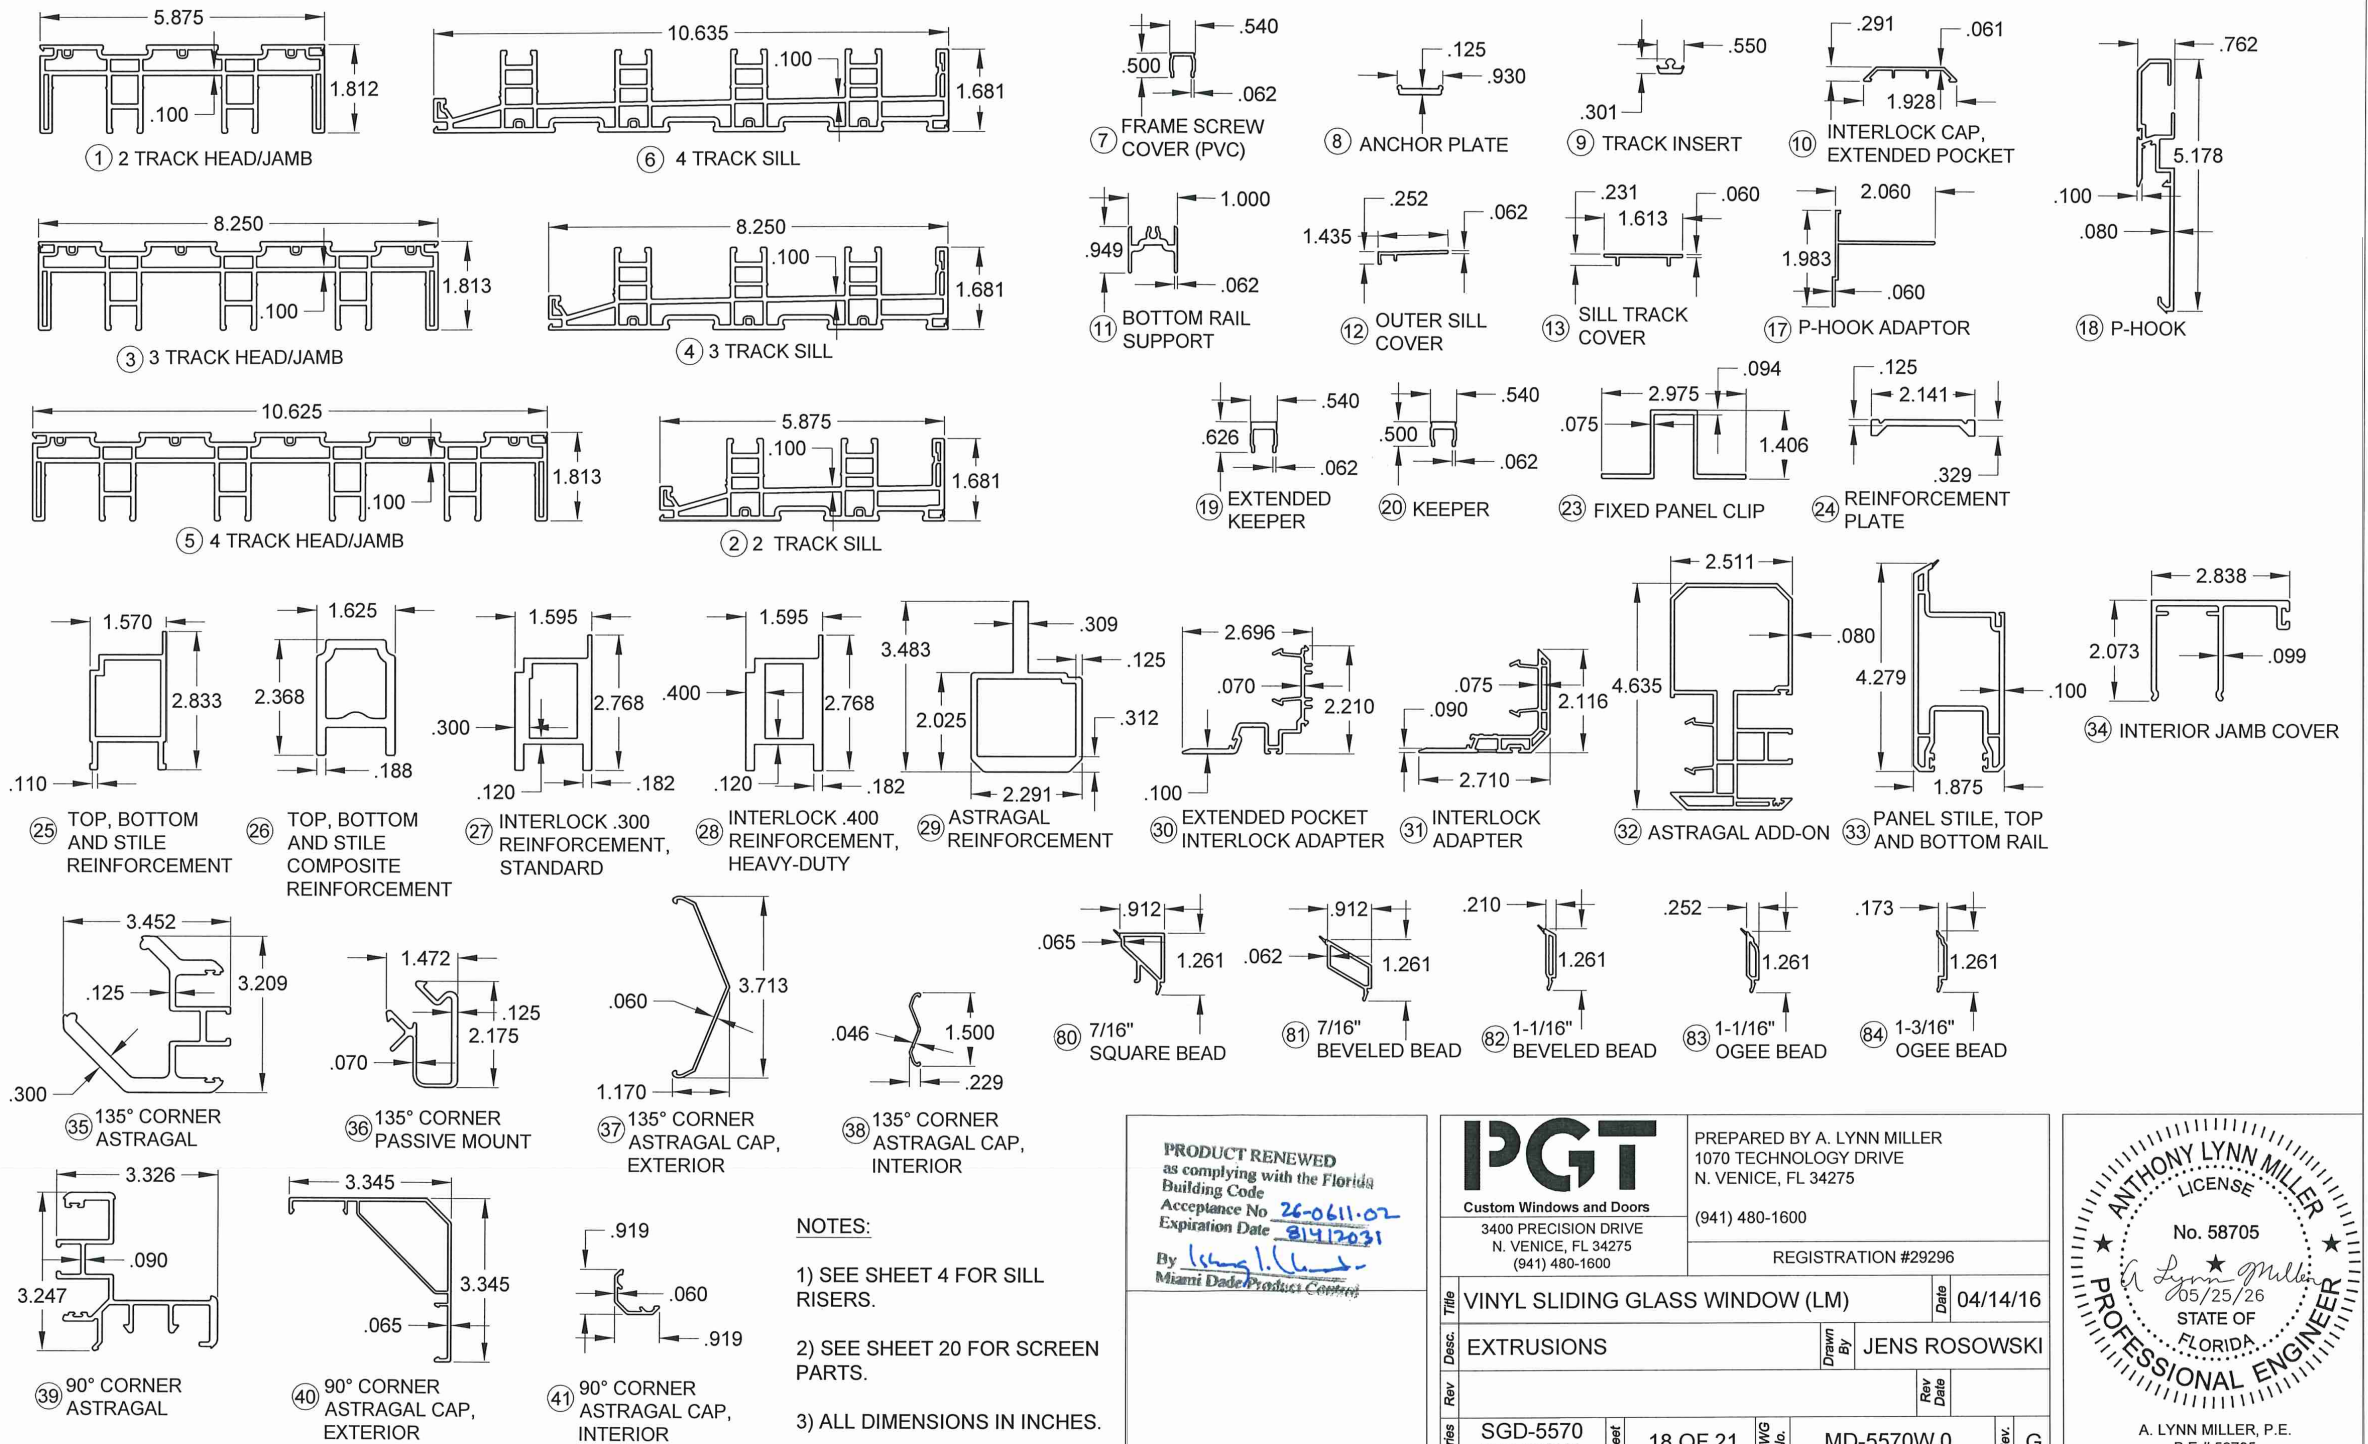

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No 26-0611-02
Expiration Date 8/4/2031
By *[Signature]*
Miami Dade Product Center


PGT Custom Windows and Doors		PREPARED BY A. LYNN MILLER 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 (941) 480-1600	
3400 PRECISION DRIVE N. VENICE, FL 34275 (941) 480-1600		REGISTRATION #29296	
Title	VINYL SLIDING GLASS WINDOW (LM)		Date 04/14/16
Desc.	EXTRUSIONS		Drawn By JENS ROSOWSKI
Rev			Rev Date
Series	SGD-5570 WINDOW	Sheet	18 OF 21
DWG No.	MD-5570W.0		Rev. G

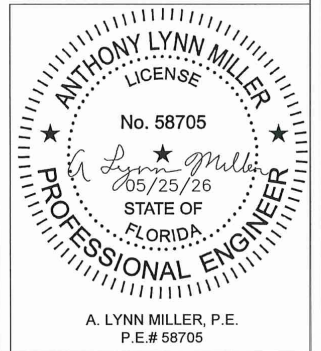

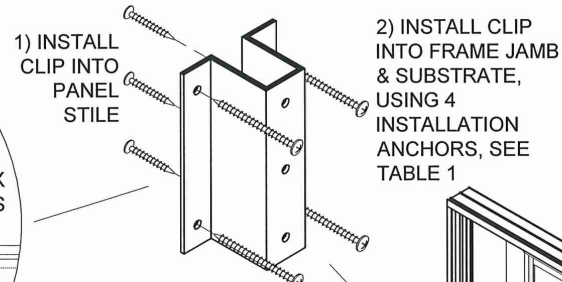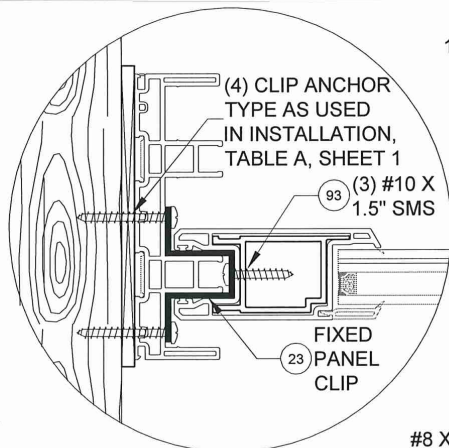


HEADER BLOCK TO HEAD ATTACHMENT


INSTALL ONE BLOCK AT EACH INTERLOCK. AT ASTRAGAL, INSTALL ONE BLOCK THAT SPANS BOTH PANELS.

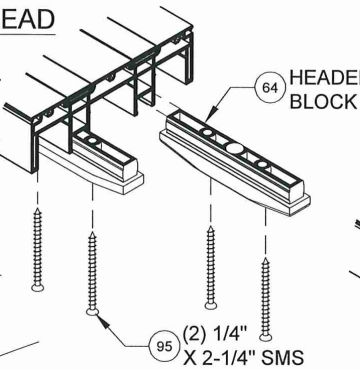

JAMB TO HEAD ASSEMBLY

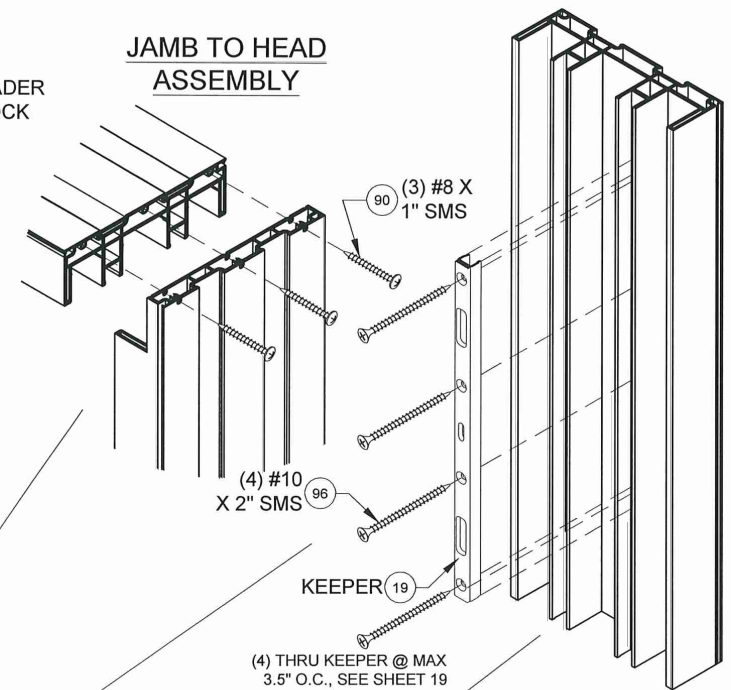


KEEPER TO JAMB ATTACHMENT

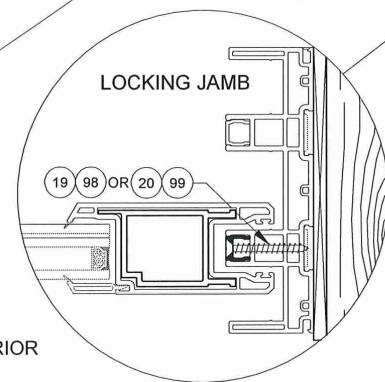

NOTES

- 1) DETAILS APPLY TO 2, 3 AND 4 TRACK CONFIGURATIONS.
- 2) SEE SHEETS 11-16 FOR ANCHOR LOCATION & SPACING.
- 3) SEE TABLES 1 & 2 FOR REINFORCEMENT REQUIREMENTS.
- 4) CONTINUOUS ANCHOR PLATE, ITEM #8, IS REQUIRED AT ALL FRAME ANCHOR LOCATIONS.

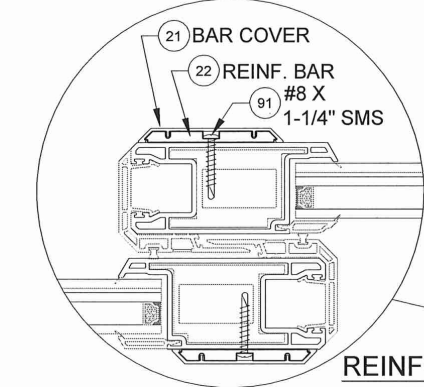


REINFORCEMENT PLATE


ATTACH WITH #8 X 1-1/4\"

@ 34-1/2\"

JAMB TO SILL ASSEMBLY

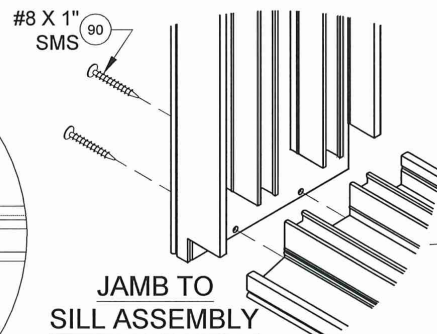


4-PANEL, 2-TRACK
OXXX SHOWN

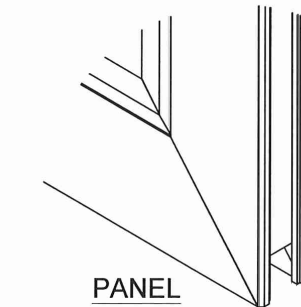

PANEL ASSEMBLY

ALL PANEL CORNERS
WELDED, NO ASSEMBLY
FASTENERS

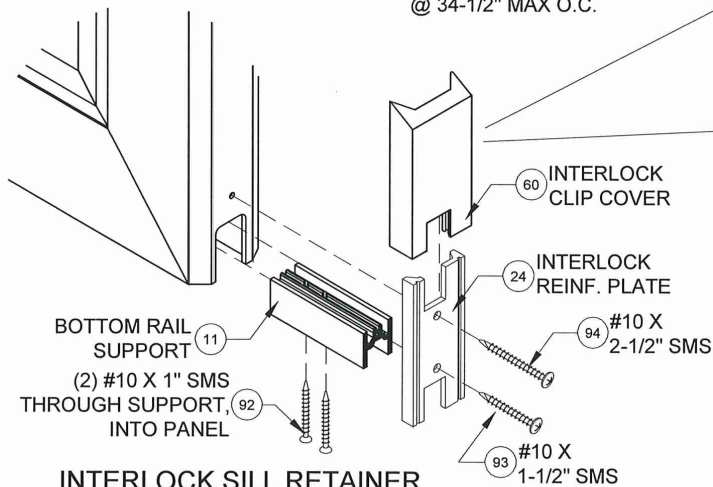

INTERLOCK SILL RETAINER CLIP ATTACHMENT

INSTALL ONE ASSEMBLY AT EACH INTERLOCK


PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No 26-0611-02
Expiration Date 8/14/2031
By *Lynn J. Miller*
Miami Dade Product Control

PGT
Custom Windows and Doors
3400 PRECISION DRIVE
N. VENICE, FL 34275
(941) 480-1600

PREPARED BY A. LYNN MILLER
1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275
(941) 480-1600

REGISTRATION #29296

Title	VINYL SLIDING GLASS WINDOW (LM)					Date	04/14/16	
Desc.	ACCESSORY INSTALLATION				Drawn By	JENS ROSOWSKI		
Rev						Rev Date		
Series	SGD-5570 WINDOW	Sheet	19 OF 21	DWG No.	MD-5570W.0		Rev.	G

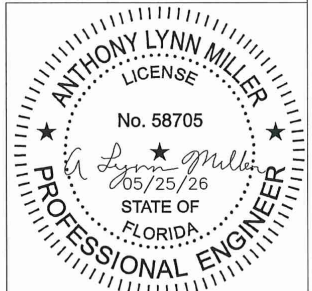

A. LYNN MILLER, P.E.
P.E.# 58705

BOX SCREEN DETAILS:


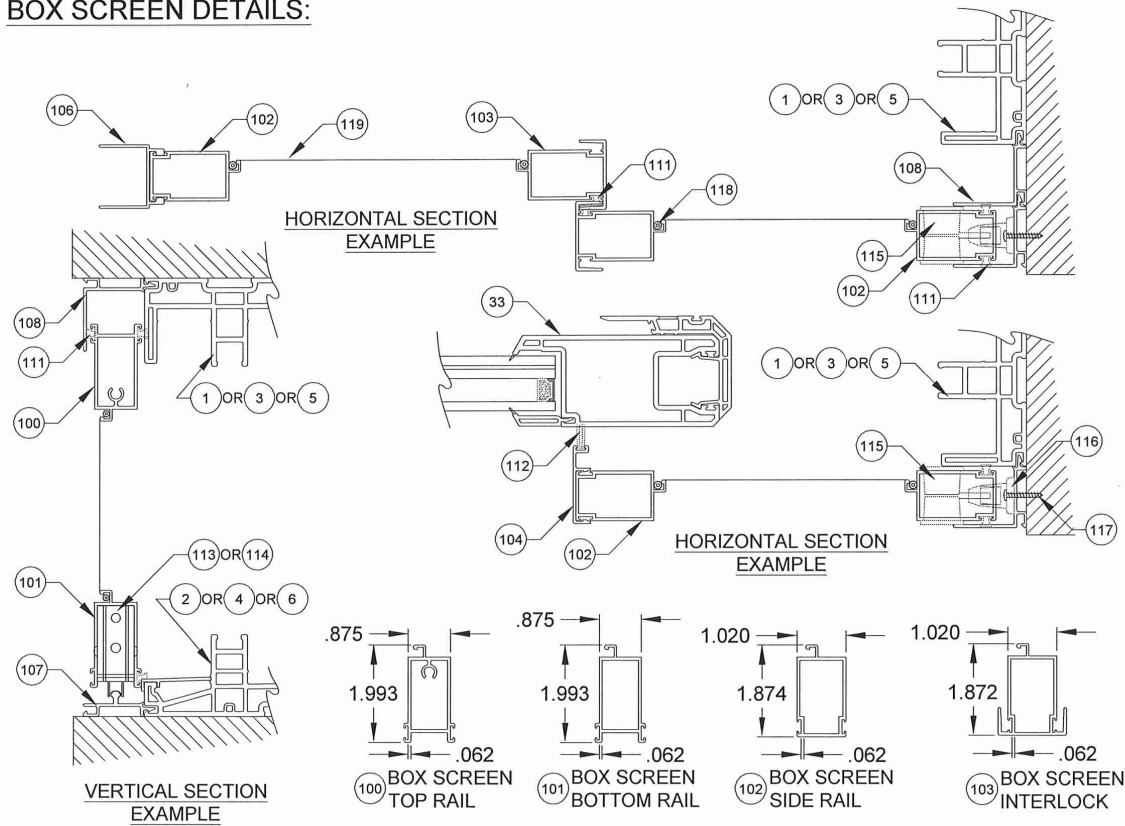


TABLE C: BOX SCREEN

#	Part #	Description	Material
100	12256	Box Screen Top Rail	6063 T5 Al
101	12257	Box Screen Bottom Rail	6063 T5 Al
102	12258	Box Screen Side Rail	6063 T5 Al
103	64428	Box Screen Interlock	6063 T6 Al
104	17347A	Box Screen Snap-on Bug Flap	6063 T6 Al
105	64345	Box Screen OXO Astragal Adapter	6063 T6 Al
106	17349	Box Screen Astragal Adapter	6063 T5 Al
107	19039	Box Screen Frame Sill Add-on	6063 T6 Al
108	19038	Box Screen Head/Jamb Add-on	6063 T6 Al
109	720X1X	#14-20 x 1" MS @ Top Rail	SS
110	720X112X	#14-20 x 1-1/2" MS @ Bottom Rail	SS
111	71793G	Wstp, .270" x .150" - Fin Seal	
112	61805K	Wstp, .187" x .500" @ Bug Flap	
113	7SRAZ	Standard Roller	Nylon
114	7SRAX	HD Roller	SS
115	varies	Screen Locking Hardware	Steel
116	419053	Screen Keeper	Steel
117	76X1PPA	#6 x 1" Ph. PH SMS	Steel
118	1692/3/4	Screen Splice - .150" & .165"	Vinyl
119	1816C20	Screen Cloth	Fiberglass

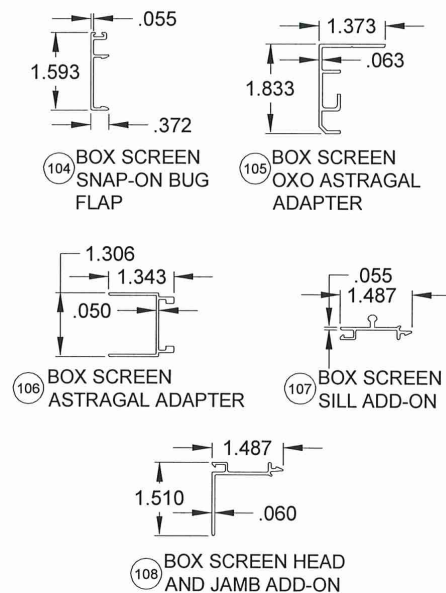

STANDARD SCREEN DETAILS:

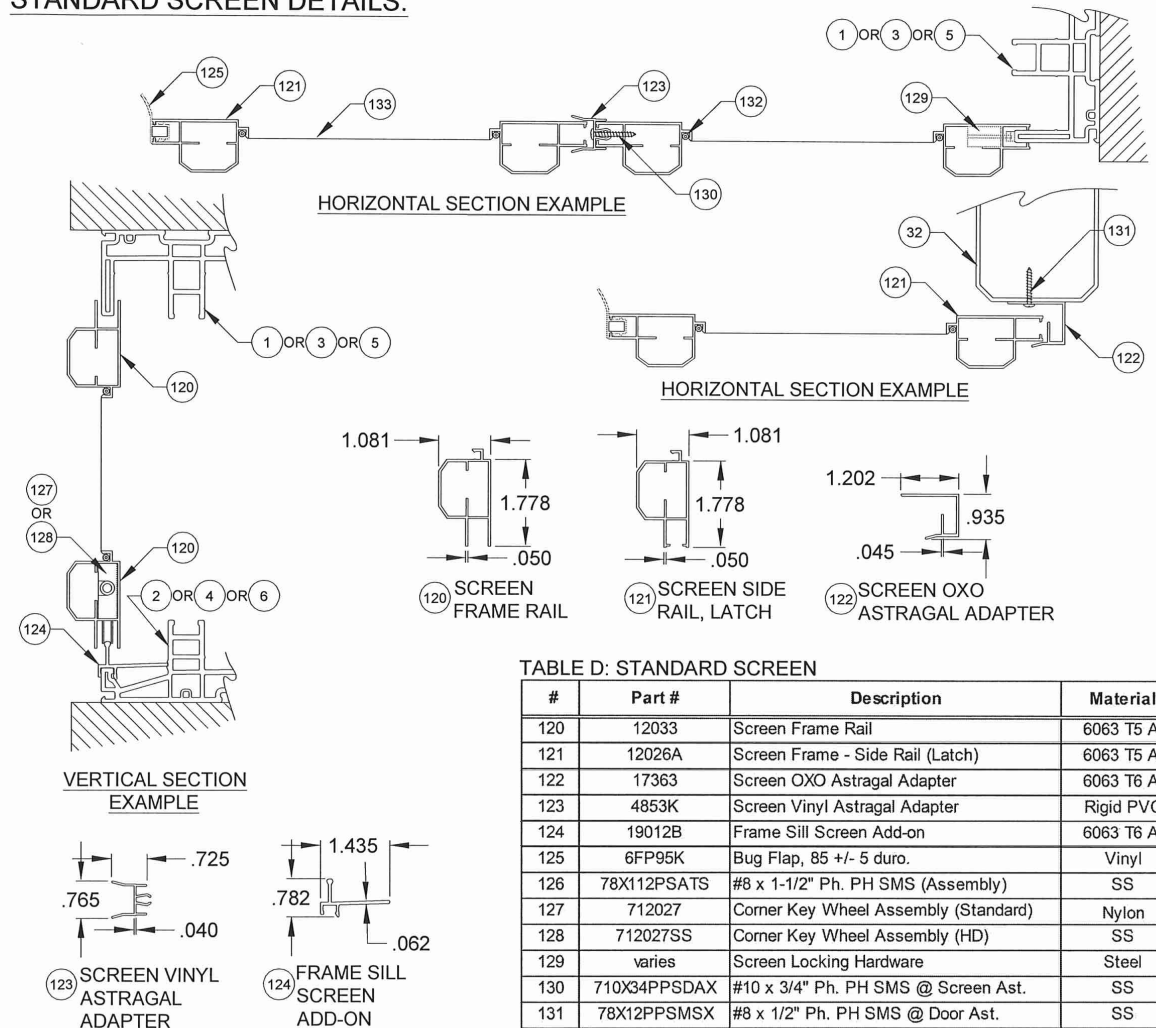


TABLE D: STANDARD SCREEN

#	Part #	Description	Material
120	12033	Screen Frame Rail	6063 T5 Al
121	12026A	Screen Frame - Side Rail (Latch)	6063 T5 Al
122	17363	Screen OXO Astragal Adapter	6063 T6 Al
123	4853K	Screen Vinyl Astragal Adapter	Rigid PVC
124	19012B	Frame Sill Screen Add-on	6063 T6 Al
125	6FP95K	Bug Flap, 85 +/- 5 duro.	Vinyl
126	78X112PSATS	#8 x 1-1/2" Ph. PH SMS (Assembly)	SS
127	712027	Corner Key Wheel Assembly (Standard)	Nylon
128	712027SS	Corner Key Wheel Assembly (HD)	SS
129	varies	Screen Locking Hardware	Steel
130	710X34PPSDAX	#10 x 3/4" Ph. PH SMS @ Screen Ast.	SS
131	78X12PPSM SX	#8 x 1/2" Ph. PH SMS @ Door Ast.	SS
132	1692/3/4	Screen Spline - .145"	Vinyl
133	1816C20	Screen Cloth	Fiberglass

NOTES:

1) ALL DIMENSIONS IN INCHES.

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No 26-0611-02
Expiration Date 8/14/2031
By L. H. J. J. J.
Miami Dade Product Control

PGT
Custom Windows and Doors
3400 PRECISION DRIVE
N. VENICE, FL 34275
(941) 480-1600

PREPARED BY A. LYNN MILLER
1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275

(941) 480-1600

REGISTRATION #29296

Rev	Title				Date	
	VINYL SLIDING GLASS WINDOW (LM)				04/14/16	
	Desc.			Drawn By	JENS ROSOWSKI	
				Rev Date		
Series	SGD-5570 WINDOW	Sheet	20 OF 21	DWG No.	MD-5570W.0	Rev. G

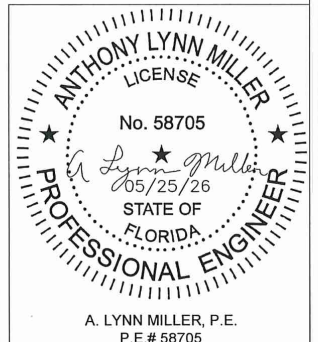


TABLE E:

#	Part #	Description	Material
1	19001	2-Track Head/Jamb	Rigid PVC
2	19002	2-Track Sill	Rigid PVC
3	19025	3-Track Head/Jamb	Rigid PVC
4	19026	3-Track Sill	Rigid PVC
5	19027	4-Track Head/Jamb	Rigid PVC
6	19028	4-Track Sill	Rigid PVC
7	19009	Frame Screw Cover	Rigid PVC
8	19031	Anchor Plate	6063-T6 Alum.
9	19007	Track Insert	6063-T6 Alum.
10	19084	Interlock Cap - Extended Pocket	Rigid PVC
11	19036	Bottom Rail Support	6063-T6 Alum.
12	19006A	Outer Sill Cover	6063-T6 Alum.
13	19011	Sill Track Cover	Rigid PVC
17	19032	P-Hook Adapter	6063-T6 Alum.
18	19020	P-Hook	6063-T6 Alum.
19	19047M	Extended Keeper	6063-T6 Alum.
20	19029M	Keeper	6063-T6 Alum.
23	19037M	Fixed Panel Clip	6063-T6 Alum.
24	19035M	Reinforcement Plate	6063-T6 Alum.
25	19017M	Top Rail, Bottom Rail and Lockstile	6005-T5 Alum.
26	19046	Reinforcement	Composite
27	19018M	Interlock .300 Reinforcement, Std.	6005-T5 Alum.
28	19013M	Interlock .400 Reinforcement, HD	6005-T5 Alum.
29	19019M	Astragal Reinforcement	6005-T5 Alum.
30	19083	Extended Pocket Interlock Adaptor	6063-T6 Alum.
31	19005	Interlock Adaptor	Rigid PVC
32	19008	Astragal Add-on	Rigid PVC
33	19004	Panel Stile, Top/Bottom Rail	Rigid PVC
34	19040	Interior Jamb Cover	6063-T6 Alum.
35	19076	135° Corner Astragal	6063-T6 Alum.
36	19077	135° Corner Astragal Passive Mount	6063-T6 Alum.
37	19079	135° Corner Astragal Cap - Ext.	Rigid PVC
38	19080	135° Corner Astragal Cap - Int.	Rigid PVC
39	19078	90° Corner Astragal	6063-T6 Alum.
40	19081	90° Corner Astragal Cap - Ext.	Rigid PVC
41	19082	90° Corner Astragal Cap - Int.	Rigid PVC
42	19085	Sill Riser - (2-1/2")	6063-T6 Alum.
43	19022A	Sill Riser - (3-1/2")	6063-T6 Alum.
44	19023A	Sill Riser - (4-1/16")	6063-T6 Alum.
45	19024A	Sill Riser - (4-5/8")	6063-T6 Alum.
50	718609W	.187" x .320" Finseal (Stile)	
51	71695K	1-1/2" x 1" x 3/4" Fin Seal Dust Plug	
52	71696	Dust Plug	
60	419041	Interlock Clip Cover	PVC
61	78153X	Tandem Roller Assembly	SS
62	78153N	Tandem Roller Assembly	Nylon
63	78X75FPTX	#8 x 3/4" Ph. FH SMS @ Roller & Reinf.	SS

#	Part #	Description	Material
64	419042	Frame Header Block	Nylon
65	48052	Roller Adj. Hole Plug	PVC
66	44385	4 Hole Bumper Stop	PVC
67	76X114FPTX	#6 x 1-1/4" Ph. FH SMS @Bumper Stop	SS
68	71696G	Sill Plug	PVC
69	78185X	Gemini Mortise Lock w/long Trim plate	Steel/SS
70	71032X1FPFX	10-32 x 1" Ph.FH MS @ Lock	SS
71	varies	Handle Kit	Cast Zinc
72	19054	Interlock Retainer Clip	Nylon
75		Kommerling 4SG TPS Spacer System	See Sheet 10 for Materials
76		Quanex Super Spacer nXT with Hot Melt Butyl	
77		Quanex Duraseal	
78		Cardinal XL Edge Spacer	
79		Dow 791, 983, 995 or GE-7700 Backbedding	Silicone
80	19090	7/16" Square Bead	Rigid PVC
81		7/16" Beveled Bead	Rigid PVC
82	19044	1-1/16" Beveled Bead	Rigid PVC
83	19045	1-1/16" Ogee Bead	Rigid PVC
84	19016	1-3/16" Ogee Bead	Rigid PVC
85	71725K	Setting Block 1/2" x 4" x 1/16", 85 +/- 5 duro.	Neoprene
86	71726K	Setting Block 1" x 4" x 1/16", 85 +/- 5 duro.	Neoprene
90	781PSTX	#8 x 1" Ph. PH SMS @ Frame Assembly	SS
91	78X114PHPT410X	#8 x 1-1/4" Ph. PH SMS @ Reinf. Bar	SS
92	710X1PHPT18-8X	#10 x 1" Ph. PH SMS @ Rail Support	SS
93	710X115PPX	#10 x 1-1/2" Ph. PH SMS @ Fxd. Pnl. Clip	SS
94	710X2.5PHPT18-8X	#10 x 2-1/2" Ph. PH SMS @ Reinf. Plate/Ast.	SS
95	71420X2.25FPFX	#12 x 2-1/4" Ph. PH SMS @ Hdr. Block	SS
96	710X1.75PPX	#10 x 1-3/4" Ph. FH SMS @ Ast. Mount	SS
97	710X34PPX	#10 x 3/4" Ph. PH SMS @ Ext. Pkt. Int.	SS
98	131001	#10 x 2-1/2" Ph. FH SDS, 4 @ Keeper	SS
99	710X2PPX	#10 x 2" Ph. FH SMS, 4 @ Keeper	SS

NOTES:

1) ITEMS #14-16, 21, 22, 46-49, 53-59, 73, 74 & 87-89 ARE NOT USED AND ARE NOT PART OF THIS APPROVAL.

TABLE F:

Material	Min. F _y	Min. F _u
#12 Steel Screw	92 ksi	120 ksi
#12 410 Screw	90 ksi	110 ksi
1/4" DeWalt/Elco Aggre-Gator®	57 ksi	96 ksi
1/4" Elco UltraCon®	155 ksi	177 ksi
1/4" DeWalt UltraCon+®	148 ksi	164 ksi
1/4" 410 SS DeWalt/Elco CreteFlex®	127.4 ksi	189.7 ksi
6063-T5 Aluminum	16 ksi	22 ksi
A36 Steel	36 ksi	58 ksi
Gr. 33 Steel Stud	33 ksi	45 ksi

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 26-0611-02
Expiration Date 8/4/2031
By [Signature]
Miami Dade Product Control

PGT
Custom Windows and Doors

3400 PRECISION DRIVE
N. VENICE, FL 34275
(941) 480-1600

PREPARED BY A. LYNN MILLER
1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275

(941) 480-1600

REGISTRATION #29296

Title	VINYL SLIDING GLASS WINDOW (LM)					Date	04/14/16	
Desc.	PARTS LIST/BOM				Drawn By	JENS ROSOWSKI		
Rev						Rev Date		
Series	SGD-5570 WINDOW	Sheet	21 OF 21	DWG No.	MD-5570W.0		Rev.	G

