



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

Labrador & Fundora Corp. dba V & V Windows
14150 NW 56th Court, Suite 600
Opa-Locka, FL 33054

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/ or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "100" Aluminum Single Hung Window – L.M.I.

APPROVAL DOCUMENT: Drawing No. **W11-38**, titled "Series 100 Alum. Single Hung Wdw. (L.M.I.)", sheets 1 through 9 of 9, dated 07/15/11, with revision **H** dated 06/23/26, prepared by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and Expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/ or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.


ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises and renews NOA No. 25-0423.04** and consists of this page 1 and evidence pages E-1, E-2 and E-3, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**




7/20/26

NOA No. 26-0707.01
Expiration Date: October 20, 2031
Approval Date: July 30, 2026
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's

A. DRAWINGS


1. Manufacturer's die drawings and sections.
(Submitted under NOA No. 11-0907.03)
2. Drawing No **W11-38**, titled "Series 100 Alum. Single Hung Wdw. (L.M.I.)", sheets 1 through 9 of 9, dated 07/15/11, with revision **G** dated 02/06/25, prepared by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.
(Submitted under NOA No. 25-0423.04)

B. TESTS

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per FBC 2411.3.2.1, and TAS 202-94
along with marked-up dwg. & installation diagram of an alum. horiz. sliding window, prepared by Hurricane Engineering & Testing, Inc., Test Report No. **HETI-24-8219**, dated 12/23/24 and 04/17/25, signed and sealed by Ram N. Tawari, P.E.
(Submitted under NOA No. 25-0423.04)
2. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per FBC 2411.3.2.1, and TAS 202-94
along with marked-up drawings and installation diagram of a single hung window, prepared by American Test Lab of South Florida, Inc., Test Report No. **ATLSF-0913.01-10**, dated 07/11/11, signed and sealed by Julio E. Gonzalez, P.E.
(Submitted under NOA No. 11-0907.03)

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, updated and complying with FBC 8th Edition (2023), dated 04/10/25, prepared by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.
(Submitted under NOA No. 25-0423.04)
2. Glazing complies with **ASTM E1300-09**

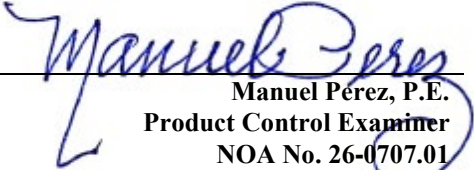
Manuel Pérez, P.E.
Product Control Examiner
NOA No. 26-0707.01
Expiration Date: October 20, 2031
Approval Date: July 30, 2026

Labrador & Fundora Corp. dba V & V Windows

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's (CONTINUED)

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **24-0205.08** issued to **Kuraray America, Inc.** for their "Trosifol® Ultraclear, Clear and Color PVB Glass Interlayers" dated 03/21/24, expiring on 07/08/29.
2. Notice of Acceptance No. **23-0717.30** issued to **Kuraray America, Inc.** for their "SentryGlas® (Clear and White) Glass Interlayers" dated 08/31/23, expiring on 07/04/28.

F. STATEMENTS

1. Statement letter of conformance, complying with **FBC 8th Edition (2023)** and of no financial interest, dated April 09, 2025, issued by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.
(Submitted under NOA No. 25-0423.04)
2. Proposal No. **24-0529** issued by Product Control, dated 06/07/24, signed by Manuel Perez, P.E.
(Submitted under NOA No. 25-0423.04)
3. Laboratory compliance letter for Test Report No. **ATLSF-0913.01-10**, issued by American Test Lab of South Florida, Inc., dated 07/11/11, signed and sealed by Julio E. Gonzales, P.E.
(Submitted under NOA No. 11-0907.03)

G. OTHERS

1. Notice of Acceptance No. **23-0620.07**, issued to Labrador & Fundora Corp. dba V & V Windows for their Series "100" Aluminum Single Hung Window - L.M.I., approved on 07/06/20 and expiring on 10/20/26.


Manuel Perez, P.E.
Product Control Examiner
NOA No. 26-0707.01
Expiration Date: October 20, 2031
Approval Date: July 30, 2026

Labrador & Fundora Corp. dba V & V Windows

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

2. NEW EVIDENCE SUBMITTED

A. DRAWINGS

1. Drawing No **W11-38**, titled “Series 100 Alum. Single Hung Wdw. (L.M.I.)”, sheets 1 through 9 of 9, dated 07/15/11, with revision **H** dated 06/23/26, prepared by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.

B. TESTS

1. None.

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, updated and complying with FBC 8th Edition (2023) and FBC 9th Edition (2026), dated 06/30/26, prepared by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.
2. Glazing complies with **ASTM E1300-16**

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS


1. Notice of Acceptance No. **24-0205.08** issued to **Kuraray America, Inc.** for their “**Trosifol® Ultraclear, Clear and Color PVB Glass Interlayers**” dated 03/21/24, expiring on 07/08/29.
3. Notice of Acceptance No. **23-0717.30** issued to **Kuraray America, Inc.** for their “**SentryGlas® (Clear and White) Glass Interlayers**” dated 08/31/23, expiring on 07/04/28.

F. STATEMENTS


1. Statement letter of conformance, complying with **FBC 8th Edition (2023), FBC 9th Edition (2026)** and of no financial interest, dated June 30, 2026, issued by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.

G. OTHERS


1. Notice of Acceptance No. **25-0423.04**, issued to Labrador & Fundora Corp. dba V & V Windows for their Series “100” Aluminum Single Hung Window - L.M.I., approved on 05/29/25 and expiring on 10/20/26.

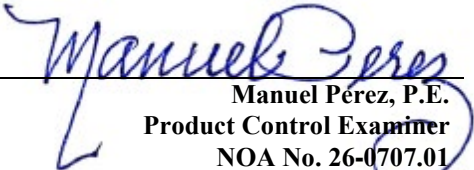
Manuel Pérez, P.E.
Product Control Examiner
NOA No. 26-0707.01
Expiration Date: October 20, 2031
Approval Date: July 30, 2026

The following pages in this document were submitted by the manufacturer (third party) to represent the product being approved and establish the limits of use. The pages may include technical drawings, schematics and installation details.

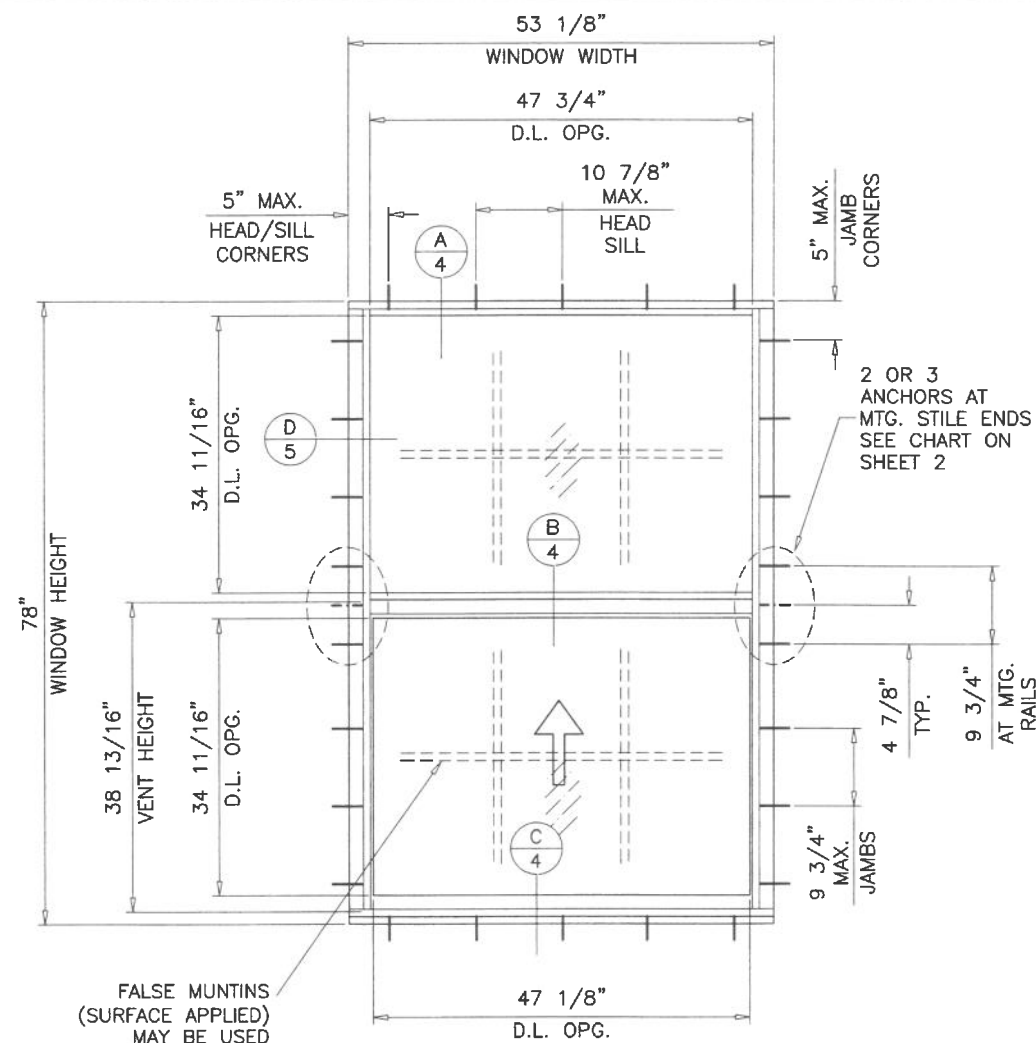

TYPICAL ELEVATIONS

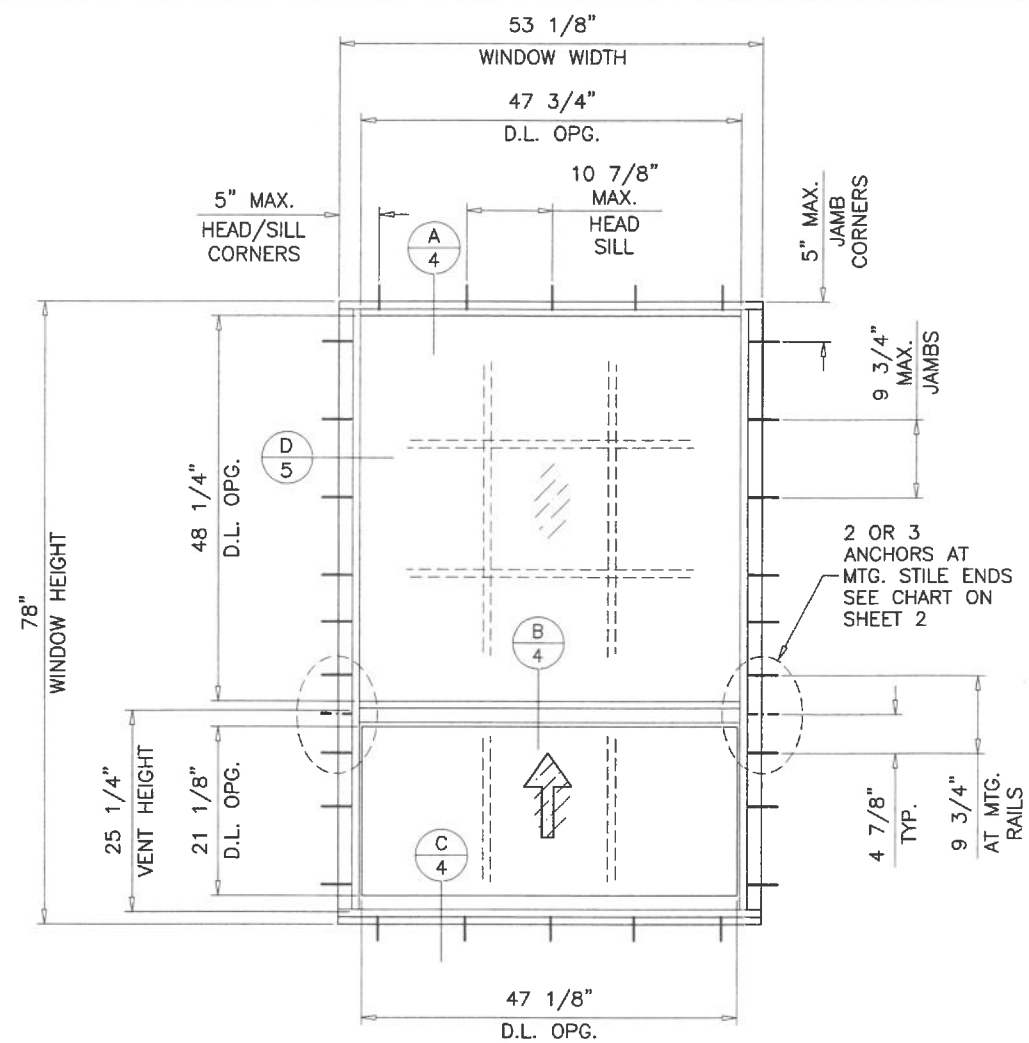

SERIES 100 ALUMINUM SINGLE HUNG WINDOW

DESIGN LOAD RATINGS FOR THESE WINDOWS TO BE AS PER CHARTS SHOWN ON SHEETS 2 & 3.

APPROVAL APPLIES TO SINGLE UNITS OR SIDE BY SIDE COMBINATIONS OF S.H./S.H. OR SINGLE HUNG WITH OTHER WINDOW TYPES IN MODULES OF TWO OR MORE WINDOWS USING MIAMI-DADE COUNTY APPROVED MULLIONS IN BETWEEN. LOWER DESIGN PRESSURE FROM WINDOWS OR MULLION APPROVAL WILL APPLY TO ENTIRE SYSTEM.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE 2023 (8TH EDITION)/2026 (9TH EDITION) FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

1BY OR 2BY WOOD BUCKS & BUCK FASTENERS BY OTHERS, MUST BE DESIGNED AND INSTALLED ADEQUATELY TO TRANSFER APPLIED PRODUCT LOADS TO THE BUILDING STRUCTURE.

ANCHORS TO BE SPACED AS SHOWN ON DETAILS AND INSTALLED PER MANUF'S INSTRUCTIONS. SPECIFIED EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

ALL SHIMS TO BE LOAD-BEARING, (HIGH DENSITY PLASTIC/COMPOSITE, METAL OR OTHER RIGID MATERIALS).

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE 2023/2026 FLORIDA BLDG. CODE & ADOPTED STANDARDS.

THIS PRODUCT APPROVAL IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT, i.e. LIFE SAFETY OF THIS PRODUCT, ADEQUACY OF STRUCTURE RECEIVING THIS PRODUCT AND SEALING AROUND OPENING FOR WATER INFILTRATION RESISTANCE ETC. CONDITIONS NOT SHOWN IN THIS DRAWING ARE TO BE ANALYZED SEPARATELY, AND TO BE REVIEWED BY BUILDING OFFICIAL.


DESIGN LOADS SHOWN ARE BASED ON 'ALLOWABLE STRESS DESIGN (ASD)'.

FASTENERS AND CONNECTORS SHOWN IN THIS APPROVAL MAY NOT MEET CORROSION RESISTANCE REQUIREMENTS FOR COASTAL OR SALT WATER EXPOSURE ZONES. COMPLIANCE WITH THESE CONDITIONS TO BE CHECKED PER FBC 1711.

THESE WINDOWS ARE RATED FOR LARGE & SMALL MISSILE IMPACT. SHUTTERS ARE NOT REQUIRED.

PRODUCT REVISED
As complying with the Florida Building Code
NOA-No. **26-0707.01**
Expiration Date: **10/20/2031**
By: *Manuel Perez*
Miami-Dade Product Control

JUL 02 2026

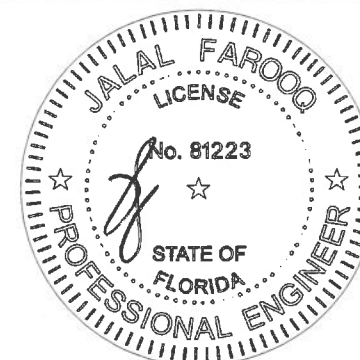

SERIES 100 ALUM SINGLE HUNG WDW. (L.M.I.)

Labrador & Fundora Corp.

dba-V & V Windows

14150 N.W. 56th Court, Suite 600

Opa-Locka, FL 33054

Tel. (305) 888-4151

www.vvwindows.com

revisions:	no	date	by	description
	E	07.14.20		UPDATED TO 2020 FBC
	F	06.07.23		UPDATED TO 2023 FBC
	G	02.06.25		FLUSH FRAME ADAPTER ADD.
	H	06.23.26		UPDATED TO 2026 FBC

date:	07-15-11
scale:	1/2"=1'-0"
dr. by:	TARIQ
chk. by:	


drawing no.	W11-38
sheet	1 of 9

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W11-38W


EQUAL LITES WINDOWS							
DESIGN LOAD CAPACITY - PSF 2 ANCHORS AT MTG. STILE ENDS							
WINDOW DIMS.		GLASS TYPE 'A'		GLASS TYPES 'B' & 'C'		GLASS TYPE 'D'	
WIDTH	HEIGHT	EXT.(+)	1NT.(-)	EXT.(+)	1NT.(-)	EXT.(+)	1NT.(-)
19-1/8"	26"	60.0	60.0	75.0	75.0	80.0	120.0
26-1/2"		60.0	60.0	75.0	75.0	80.0	120.0
37"		60.0	60.0	75.0	75.0	80.0	120.0
42"		60.0	60.0	75.0	75.0	80.0	120.0
48"		60.0	60.0	75.0	75.0	80.0	120.0
53-1/8"		60.0	60.0	75.0	75.0	80.0	120.0
19-1/8"	38-3/8"	60.0	60.0	75.0	75.0	80.0	120.0
26-1/2"		60.0	60.0	75.0	75.0	80.0	120.0
37"		60.0	60.0	75.0	75.0	80.0	120.0
42"		60.0	60.0	75.0	75.0	80.0	120.0
48"		60.0	60.0	75.0	75.0	80.0	120.0
53-1/8"		60.0	60.0	75.0	75.0	80.0	120.0
19-1/8"	50-5/8"	60.0	60.0	75.0	75.0	80.0	120.0
26-1/2"		60.0	60.0	75.0	75.0	80.0	120.0
37"		60.0	60.0	75.0	75.0	80.0	120.0
42"		60.0	60.0	75.0	75.0	80.0	120.0
48"		60.0	60.0	75.0	75.0	80.0	120.0
53-1/8"		60.0	60.0	75.0	75.0	80.0	116.1
19-1/8"	58"	60.0	60.0	75.0	75.0	80.0	120.0
26-1/2"		60.0	60.0	75.0	75.0	80.0	120.0
37"		60.0	60.0	75.0	75.0	80.0	120.0
42"		60.0	60.0	75.0	75.0	80.0	120.0
48"		60.0	60.0	75.0	75.0	80.0	120.0
53-1/8"		60.0	60.0	75.0	75.0	80.0	106.7
19-1/8"	60"	60.0	60.0	75.0	75.0	80.0	120.0
26-1/2"		60.0	60.0	75.0	75.0	80.0	120.0
37"		60.0	60.0	75.0	75.0	80.0	120.0
42"		60.0	60.0	75.0	75.0	80.0	120.0
48"		60.0	60.0	75.0	75.0	80.0	120.0
53-1/8"		60.0	60.0	75.0	75.0	80.0	104.6
19-1/8"	63"	60.0	60.0	75.0	75.0	80.0	120.0
26-1/2"		60.0	60.0	75.0	75.0	80.0	120.0
37"		60.0	60.0	75.0	75.0	80.0	120.0
42"		60.0	60.0	75.0	75.0	80.0	120.0
48"		60.0	60.0	75.0	75.0	80.0	120.0
53-1/8"		60.0	60.0	75.0	75.0	80.0	101.9
19-1/8"	72"	60.0	60.0	75.0	75.0	80.0	120.0
26-1/2"		60.0	60.0	75.0	75.0	80.0	120.0
37"		60.0	60.0	75.0	75.0	80.0	120.0
42"		60.0	60.0	75.0	75.0	80.0	120.0
48"		-	-	75.0	75.0	80.0	114.0
53-1/8"		-	-	75.0	75.0	80.0	95.5
19-1/8"	74-1/4"	60.0	60.0	75.0	75.0	80.0	120.0
26-1/2"		60.0	60.0	75.0	75.0	80.0	120.0
37"		60.0	60.0	75.0	75.0	80.0	120.0
42"		60.0	60.0	75.0	75.0	80.0	120.0
48"		-	-	75.0	75.0	80.0	113.0
53-1/8"		-	-	75.0	75.0	80.0	94.3
19-1/8"	78"	60.0	60.0	75.0	75.0	80.0	120.0
26-1/2"		60.0	60.0	75.0	75.0	80.0	120.0
37"		60.0	60.0	75.0	75.0	80.0	120.0
42"		60.0	60.0	75.0	75.0	80.0	120.0
48"		-	-	75.0	75.0	80.0	111.6
53-1/8"		-	-	75.0	75.0	80.0	92.6

EQUAL LITES WINDOWS			
DESIGN LOAD CAPACITY - PSF 3 ANCHORS AT MTG. STILE ENDS			
WINDOW DIMS.		GLASS TYPE 'D'	
WIDTH	HEIGHT	EXT.(+)	1NT.(-)
19-1/8"	26"	-	-
26-1/2"		-	-
37"		-	-
42"		-	-
48"		-	-
53-1/8"		-	-
19-1/8"	38-3/8"	-	-
26-1/2"		-	-
37"		-	-
42"		-	-
48"		-	-
53-1/8"		-	-
19-1/8"	50-5/8"	-	-
26-1/2"		-	-
37"		-	-
42"		-	-
48"		-	-
53-1/8"		80.0	120.0
19-1/8"	58"	-	-
26-1/2"		-	-
37"		-	-
42"		-	-
48"		-	-
53-1/8"		80.0	120.0
19-1/8"	60"	-	-
26-1/2"		-	-
37"		-	-
42"		-	-
48"		-	-
53-1/8"		80.0	120.0
19-1/8"	63"	-	-
26-1/2"		-	-
37"		-	-
42"		-	-
48"		-	-
53-1/8"		80.0	120.0
19-1/8"	72"	-	-
26-1/2"		-	-
37"		-	-
42"		-	-
48"		80.0	120.0
53-1/8"		80.0	120.0
19-1/8"	74-1/4"	-	-
26-1/2"		-	-
37"		-	-
42"		-	-
48"		80.0	120.0
53-1/8"		80.0	120.0
19-1/8"	78"	-	-
26-1/2"		-	-
37"		-	-
42"		-	-
48"		80.0	120.0
53-1/8"		80.0	120.0


* NO. IN PARENTHESIS INDICATE NO. OF ANCHORS PER JAMB.

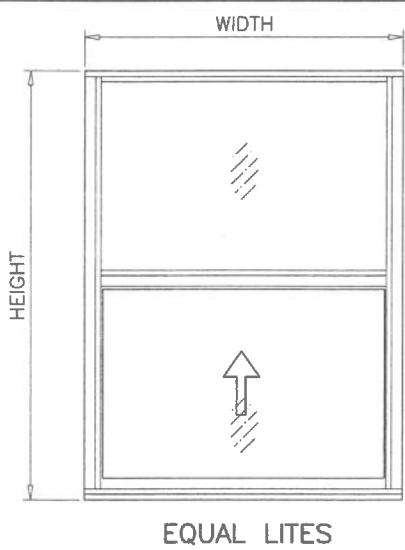


EQUAL LITES

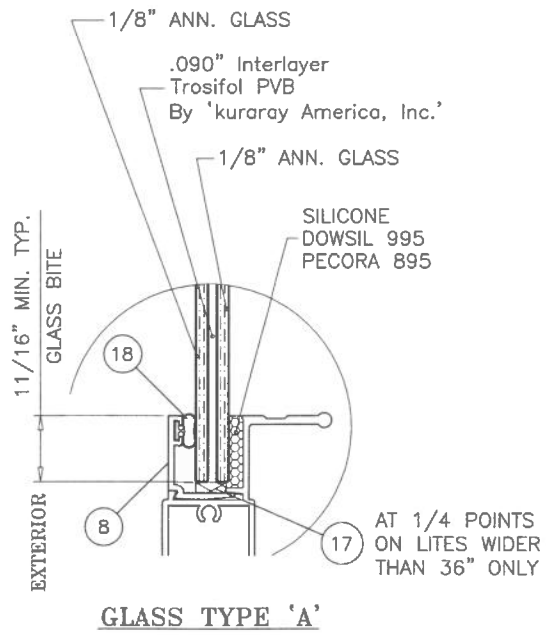


GLASS TYPE 'A'

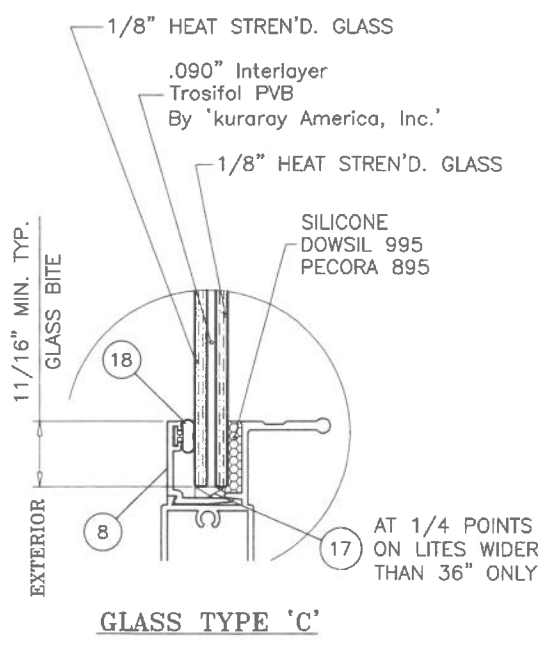

GLASS TYPE 'C'

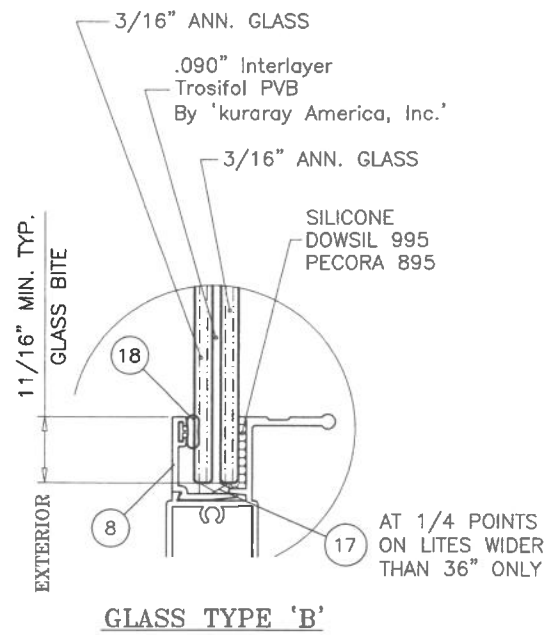


GLASS TYPE 'B'

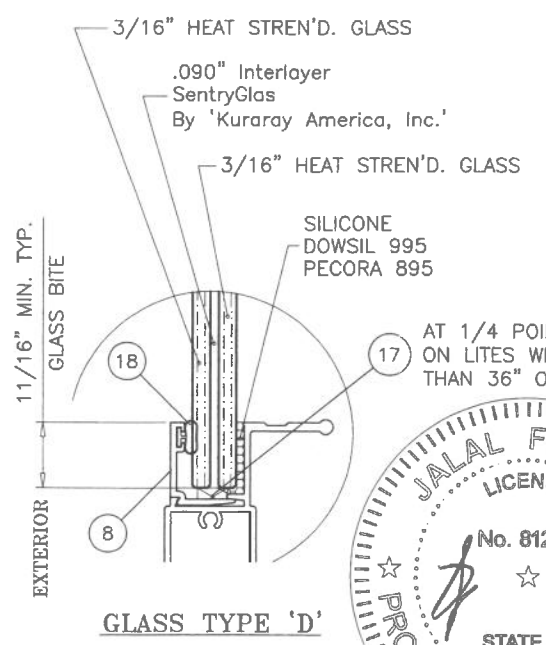

GLASS TYPE 'D'

NOTE:
GLASS CAPACITIES ARE BASED ON
ASTM E1300-16 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

PRODUCT REVISED
As complying with the Florida
Building Code
NOA-No. **26-0707.01**
Expiration Date: **10/20/2031**
By: *Manuel Perez*
Miami-Dade Product Control

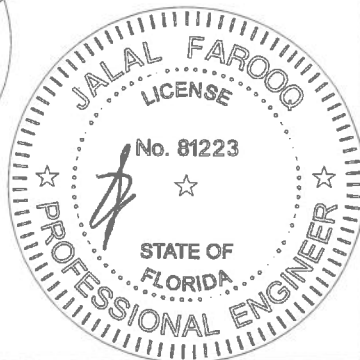

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 262-6978
FAX. (305) 262-6978
COMP-ANL W11-38V

SERIES 100 ALUM SINGLE HUNG WDW. (L.M.I.)

Labrador & Fundora Corp.
dba-V & V Windows
14150 N.W. 56th Court, Suite 600
Opa-Locka, FL. 33054
Tel. (305) 888-4151
www.vvwindows.com

revisions:

no	date	by	description
E	07.14.20		UPDATED TO 2020 FBC
F	06.07.23		UPDATED TO 2023 FBC
G	02.06.25		NO CHANGE THIS SHEET
H	06.23.26		UPDATED TO 2026 FBC


date: 07-15-11
scale: -
dr. by: TARIQ
chk. by:

drawing no.
W11-38
sheet 2 of 9

UNEQUAL LITES WINDOWS							
DESIGN LOAD CAPACITY - PSF 2 ANCHORS AT MTG. STILE ENDS							
WINDOW DIMS.		GLASS TYPE 'A'		GLASS TYPES 'B' & 'C'		GLASS TYPE 'D'	
WIDTH	HEIGHT	EXT.(+)	1NT.(-)	EXT.(+)	1NT.(-)	EXT.(+)	1NT.(-)
19-1/8"	50-5/8" (6)	60.0	60.0	75.0	75.0	80.0	120.0
26-1/2"		60.0	60.0	75.0	75.0	80.0	120.0
37"		60.0	60.0	75.0	75.0	80.0	120.0
42"		60.0	60.0	75.0	75.0	80.0	120.0
48"		60.0	60.0	75.0	75.0	80.0	120.0
53-1/8"		60.0	60.0	75.0	75.0	80.0	116.1
19-1/8"	58" (6)	60.0	60.0	75.0	75.0	80.0	120.0
26-1/2"		60.0	60.0	75.0	75.0	80.0	120.0
37"		60.0	60.0	75.0	75.0	80.0	120.0
42"		60.0	60.0	75.0	75.0	80.0	120.0
48"		60.0	60.0	75.0	75.0	80.0	120.0
53-1/8"		-	-	75.0	75.0	80.0	107.4
19-1/8"	60" (7)	60.0	60.0	75.0	75.0	80.0	120.0
26-1/2"		60.0	60.0	75.0	75.0	80.0	120.0
37"		60.0	60.0	75.0	75.0	80.0	120.0
42"		60.0	60.0	75.0	75.0	80.0	120.0
48"		-	-	75.0	75.0	80.0	120.0
53-1/8"		-	-	75.0	75.0	80.0	105.8
19-1/8"	63" (7)	60.0	60.0	75.0	75.0	80.0	120.0
26-1/2"		60.0	60.0	75.0	75.0	80.0	120.0
37"		60.0	60.0	75.0	75.0	80.0	120.0
42"		60.0	60.0	75.0	75.0	80.0	120.0
48"		-	-	75.0	75.0	80.0	120.0
53-1/8"		-	-	75.0	75.0	80.0	103.8
19-1/8"	72" (8)	60.0	60.0	75.0	75.0	80.0	120.0
26-1/2"		60.0	60.0	75.0	75.0	80.0	120.0
37"		-	-	75.0	75.0	80.0	120.0
42"		-	-	75.0	75.0	80.0	120.0
48"		-	-	-	-	80.0	120.0
53-1/8"		-	-	-	-	80.0	100.6
19-1/8"	74-1/4" (8)	60.0	60.0	75.0	75.0	80.0	120.0
26-1/2"		60.0	60.0	75.0	75.0	80.0	120.0
37"		-	-	75.0	75.0	80.0	120.0
42"		-	-	75.0	75.0	80.0	120.0
48"		-	-	-	-	80.0	120.0
53-1/8"		-	-	-	-	80.0	100.4
19-1/8"	78" (8)	60.0	60.0	75.0	75.0	80.0	120.0
26-1/2"		60.0	60.0	75.0	75.0	80.0	120.0
37"		-	-	75.0	75.0	80.0	120.0
42"		-	-	-	-	80.0	120.0
48"		-	-	-	-	80.0	120.0
53-1/8"		-	-	-	-	80.0	100.4

UNEQUAL LITES WINDOWS							
DESIGN LOAD CAPACITY - PSF 3 ANCHORS AT MTG. STILE ENDS							
WINDOW DIMS.		GLASS TYPE 'D'					
WIDTH	HEIGHT	EXT.(+)	1NT.(-)				
19-1/8"	50-5/8" (6)	-	-				
26-1/2"		-	-				
37"		-	-				
42"		-	-				
48"		-	-				
53-1/8"		80.0	120.0				
19-1/8"	58" (6)	-	-				
26-1/2"		-	-				
37"		-	-				
42"		-	-				
48"		-	-				
53-1/8"		80.0	120.0				
19-1/8"	60" (7)	-	-				
26-1/2"		-	-				
37"		-	-				
42"		-	-				
48"		-	-				
53-1/8"		80.0	120.0				
19-1/8"	63" (7)	-	-				
26-1/2"		-	-				
37"		-	-				
42"		-	-				
48"		-	-				
53-1/8"		80.0	120.0				
19-1/8"	72" (8)	-	-				
26-1/2"		-	-				
37"		-	-				
42"		-	-				
48"		-	-				
53-1/8"		80.0	120.0				
19-1/8"	74-1/4" (8)	-	-				
26-1/2"		-	-				
37"		-	-				
42"		-	-				
48"		-	-				
53-1/8"		80.0	120.0				
19-1/8"	78" (8)	-	-				
26-1/2"		-	-				
37"		-	-				
42"		-	-				
48"		-	-				
53-1/8"		80.0	120.0				


* NO. IN PARENTHESIS INDICATE NO. OF ANCHORS PER JAMB.

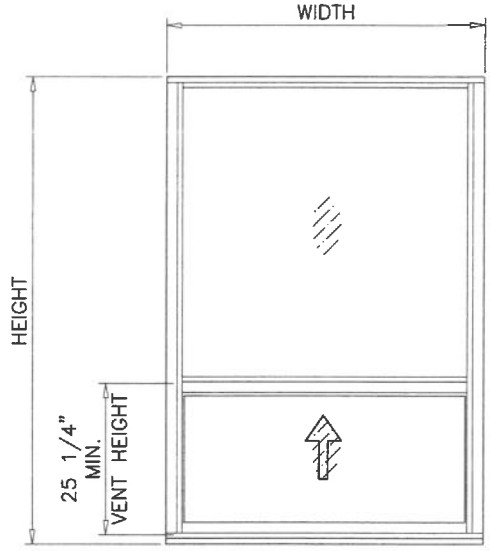

UNEQUAL LITES (ORIEL TYPE)

NOTE:
GLASS CAPACITIES ARE BASED ON
ASTM E1300-16 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

JUL 02 2026

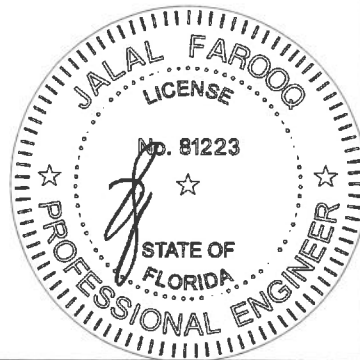

PRODUCT REVISED
As complying with the Florida
Building Code
NOA-No. **26-0707.01**
Expiration Date: **10/20/2031**
By: *Manuel Ferrn*
Miami-Dade Product Control

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 262-6978 FAX. (305) 262-6978
COMP-ANL\W11-38W

SERIES 100 ALUM SINGLE HUNG WDW. (L.M.I.)

Labrador & Fundora Corp.
dba-V & V Windows
14150 N.W. 56th Court, Suite 600
Opa-Locka, FL. 33054
Tel. (305) 888-4151
www.vvwindows.com

no	date	by	description
E	07.14.20		EDITORIAL CHANGES
F	06.07.23		UPDATED TO 2023 FBC
G	02.06.25		NO CHANGE THIS SHEET
H	06.23.26		UPDATED TO 2026 FBC

date: 07-15-11

scale: -



dr. by: TARIQ

chk. by:



drawing no.

W11-38

sheet 3 of 9

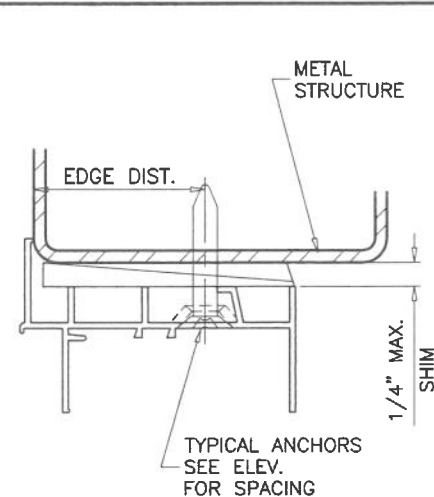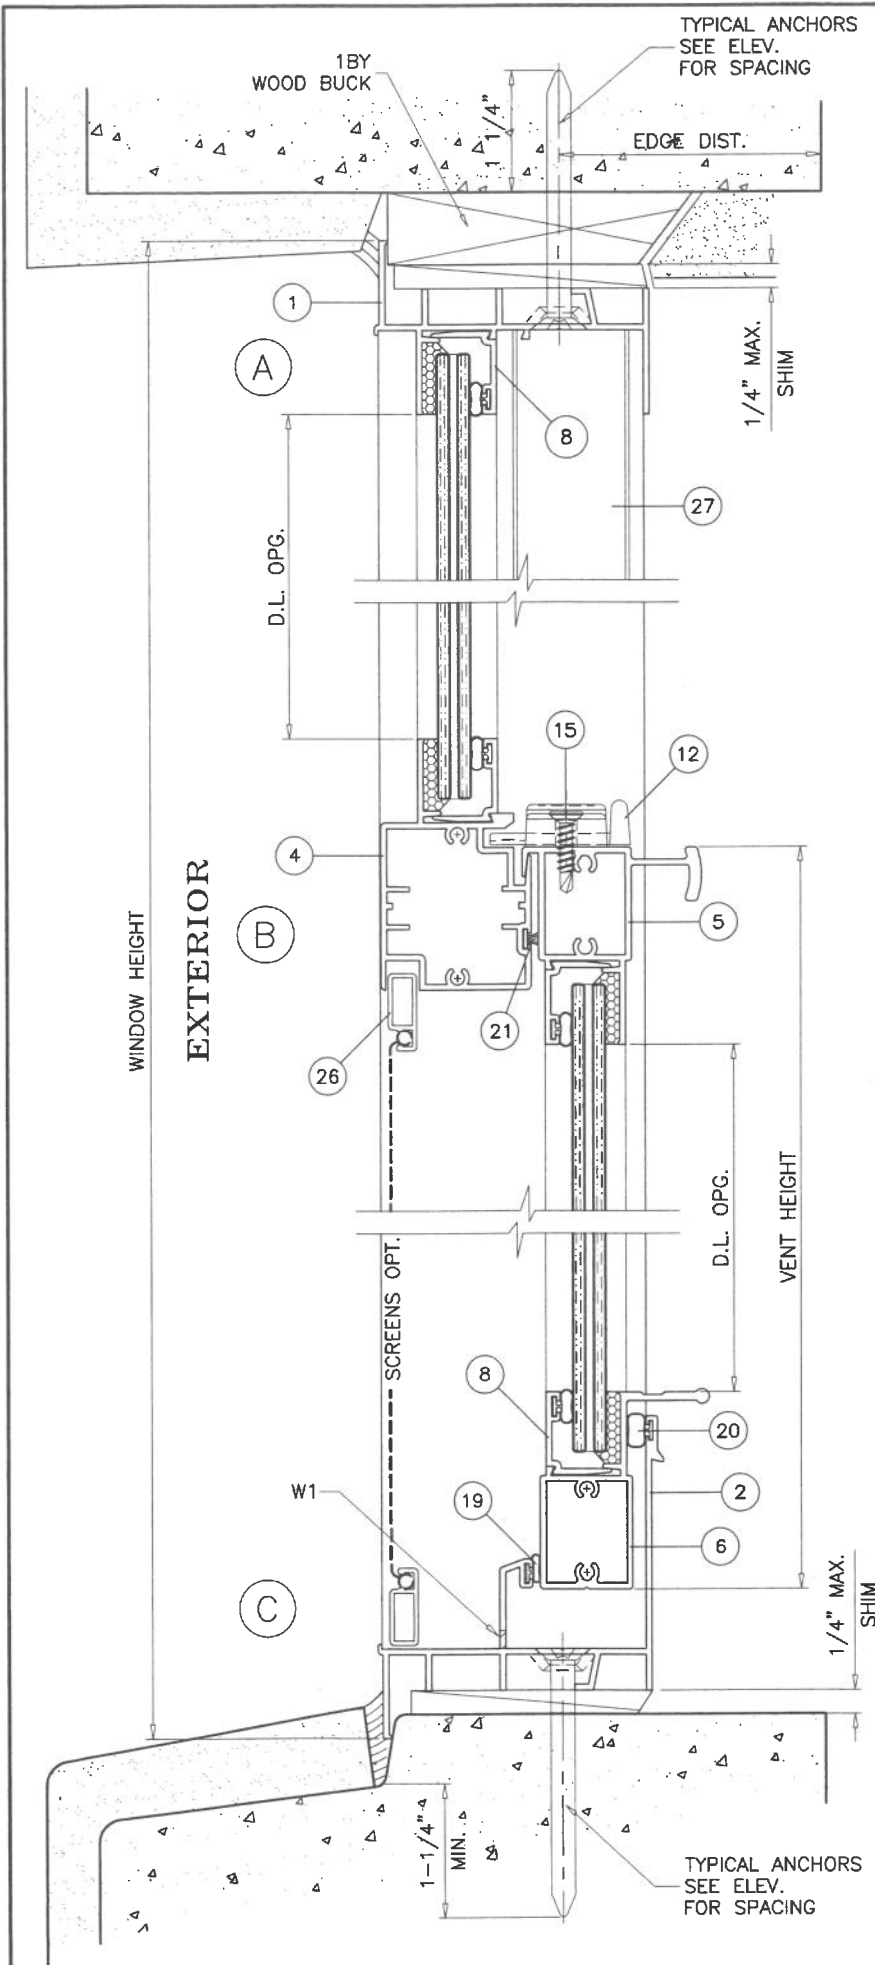

WOOD BUCKS AND METAL STRUCTURE NOT BY 'V & V WDW.' MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

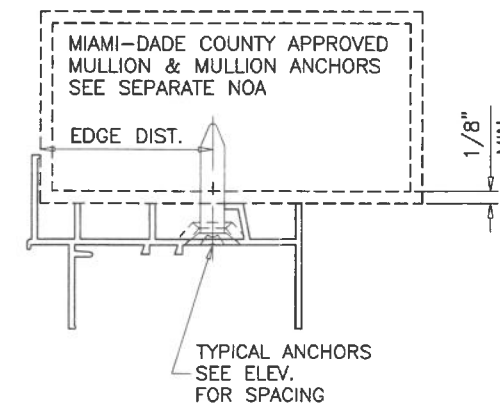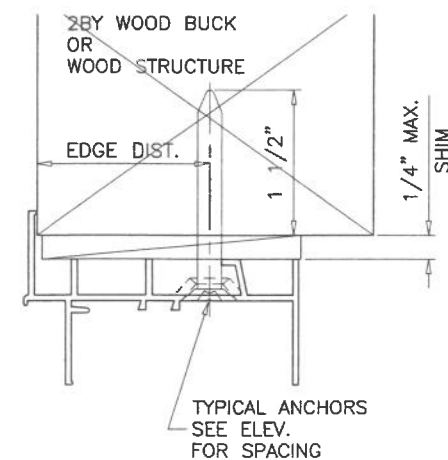

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

1/4\" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 1-1/2\" MIN. PENETRATION INTO WOOD (HEAD/SILL/JAMBS)
 THRU 1BY BUCKS INTO CONC. OR BLOCKS
 1-1/4\" MIN. EMBED INTO CONCRETE (HEAD/SILL/JAMBS)
 1-1/4\" MIN. EMBED INTO BLOCKS (JAMBS)

DIRECTLY INTO CONCRETE OR BLOCKS
 1-1/4\" MIN. EMBED INTO CONCRETE (HEAD/SILL/JAMBS)
 1-1/4\" MIN. EMBED INTO BLOCKS (JAMBS)

#14 SMS OR SELF DRILLING SCREWS (GRADE 2 CRS)
 INTO MIAMI-DADE COUNTY APPROVED MULLIONS OR
 INTO METAL STRUCTURES (HEAD/SILL/JAMBS)
 (3) THREADS MIN. PENETRATION BEYOND SUBSTRATE
 ALUMINUM: 1/8\" THK. MIN. (6063-T5 MIN.)
 STEEL: 1/8\" THK. MIN. (Fy = 36 KSI MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL EDGE DISTANCE

INTO CONCRETE AND MASONRY = 2-1/2\" MIN.
 INTO WOOD STRUCTURE = 1\" MIN.
 INTO METAL STRUCTURE = 3/4\" MIN.


WOOD AT HEAD, SILL OR JAMBS SG = 0.55 MIN.
 CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.
 C-90 HOLLOW/FILLED NORMAL WEIGHT BLOCK AT JAMBS f'm = 2000 PSI MIN.

WEEPHOLES:


W1 = 3/16\" X 3/4\" WEEP SLOT AT 1-3/8\" FROM EACH END

SEALANT:

ALL FRAME AND VENT CORNERS, INSTALLATION SCREWS AT SILL AND ALL METAL PARTS CONNECTIONS SEALED WITH PTI SILICONE.

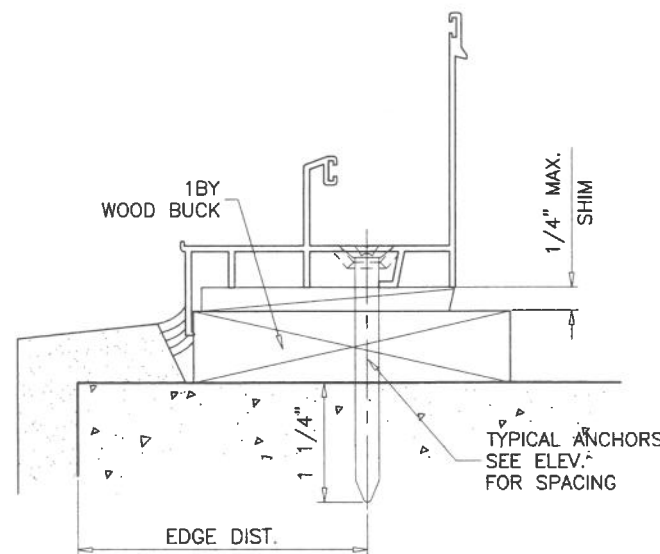

PRODUCT REVISED
 As complying with the Florida Building Code
 NOA-No. **26-0707.01** JUL 02 2026
 Expiration Date: **10/20/2031**
 By: *Manuel Perez*
 Miami-Dade Product Control



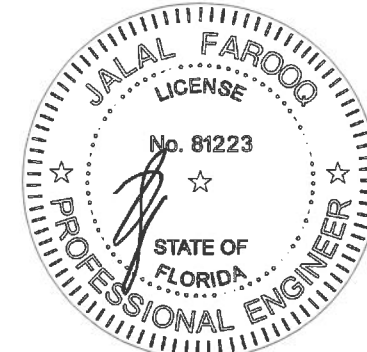


AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173 (C.A.N. 3538)
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL W11-38W


SERIES 100 ALUM SINGLE HUNG WDW. (L.M.I.)
Labrador & Fundora Corp.
dba-V & V Windows
 14150 N.W. 56th Court, Suite 600
 Opa-Locka, FL. 33054
 Tel. (305) 888-4151 www.vvwindows.com

revisions:	no	date	by	description
	E	07.14.20		UPDATED TO 2020 FBC
	F	06.07.23		UPDATED TO 2023 FBC
	G	02.06.25		NO CHANGE THIS SHEET
	H	06.23.26		NO CHANGE THIS SHEET

date: 07-15-11
 scale: 1/2\" = 1\"
 dr. by: TARIQ
 chk. by:
 drawing no. **W11-38**
 sheet 4 of 9

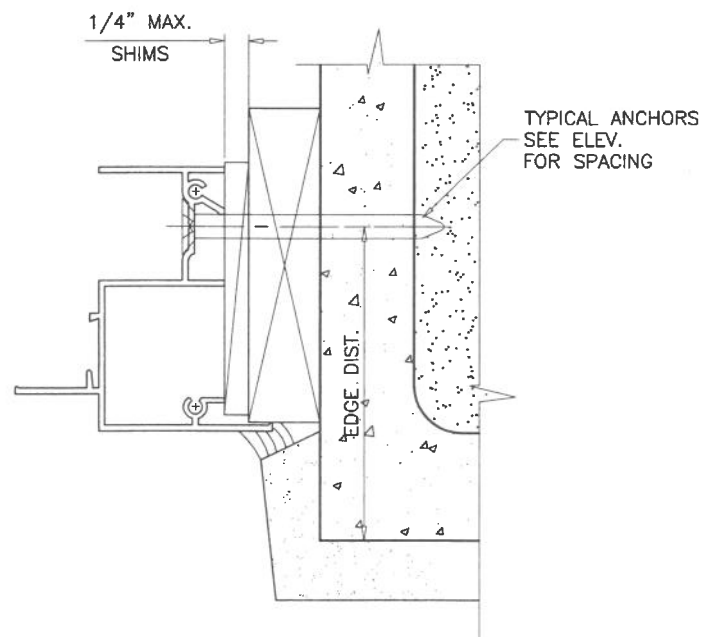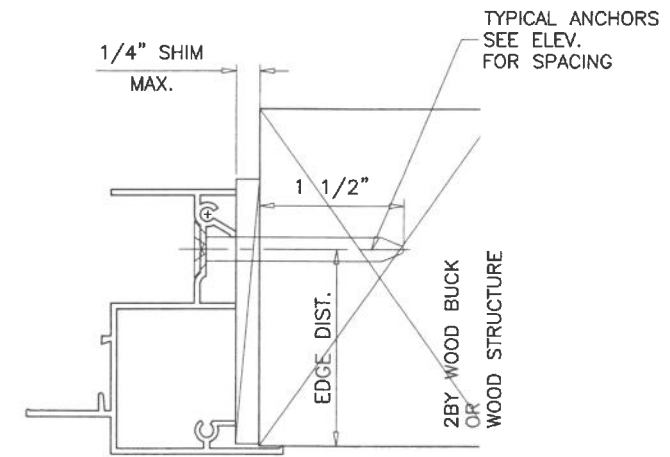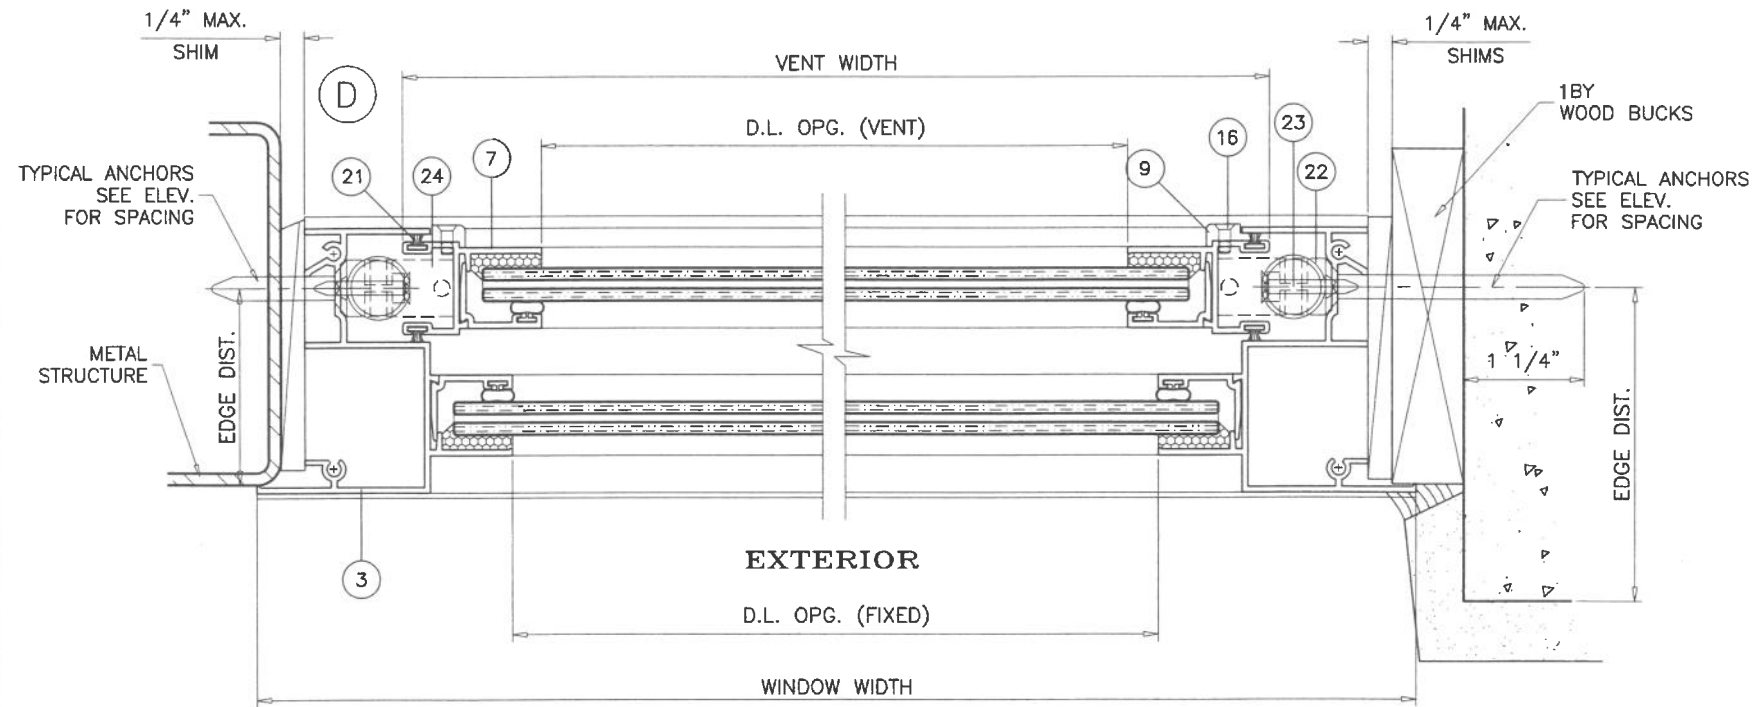

JUL 02 2026

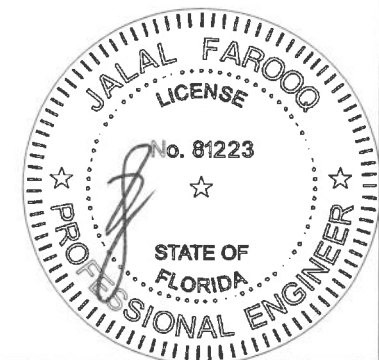

PRODUCT REVISED
As complying with the Florida Building Code
NOA-No. **26-0707.01**
Expiration Date: **10/20/2031**
By: *Manuel Ferrer*
Miami-Dade Product Control

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL W11-38W






SERIES 100 ALUM SINGLE HUNG WDW. (L.M.I.)
Labrador & Fundora Corp.
dba-V & V Windows
14150 N.W. 56th Court, Suite 600
Opa-Locka, FL. 33054
Tel. (305) 888-4151 www.vvwindows.com

revisions:		date		description	
no	date	no	date	no	description
E	07.14.20				EDITORIAL CHANGES
F	06.07.23				UPDATED TO 2023 FBC
G	02.06.25				FLUSH FRAME ADAPTER ADD.
H	06.23.26				NO CHANGE THIS SHEET

date:	07-15-11	scale:	1/2" = 1"	dr. by:	TARIQ	chk. by:	
drawing no.	W11-38						
sheet	5 of 9						


WINDOW HEIGHT

EXTERIOR

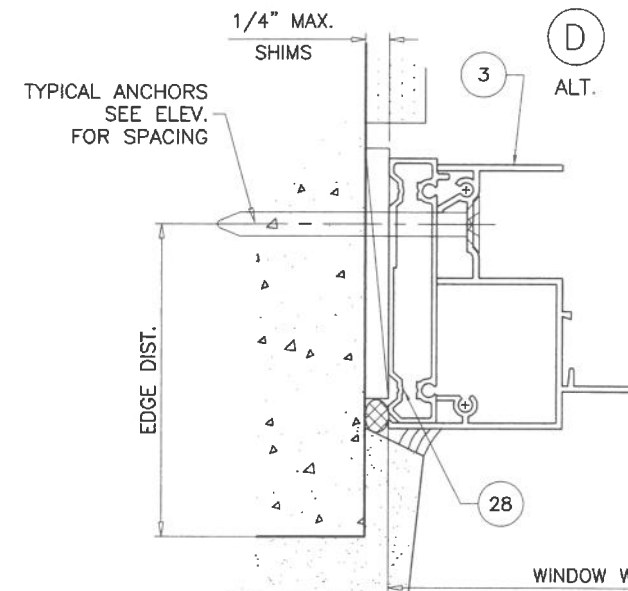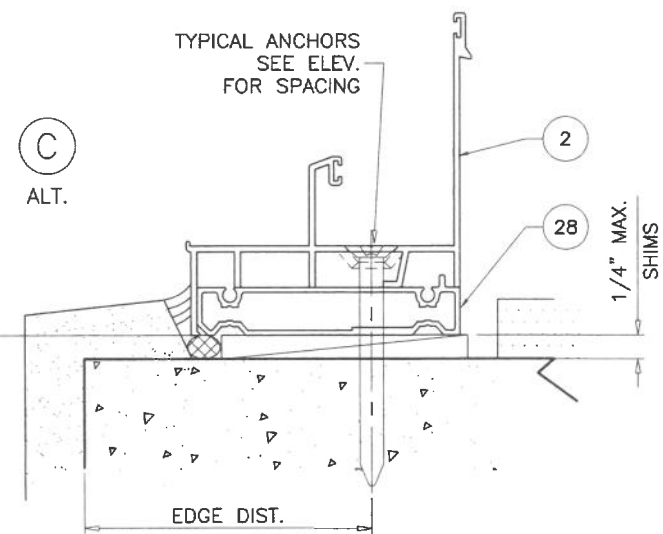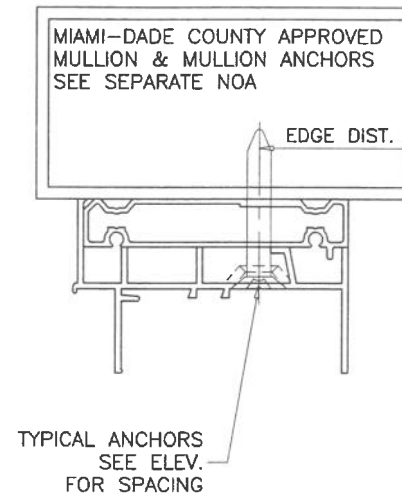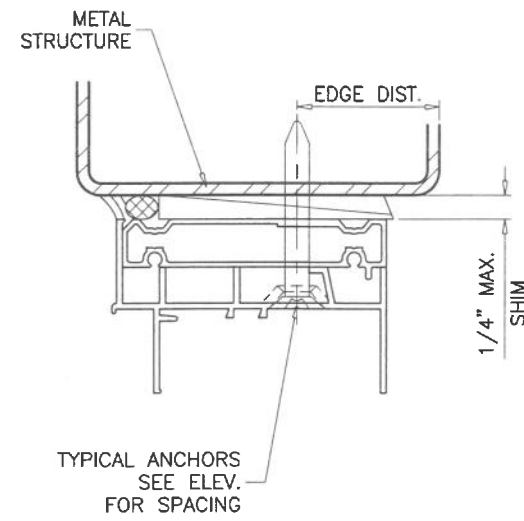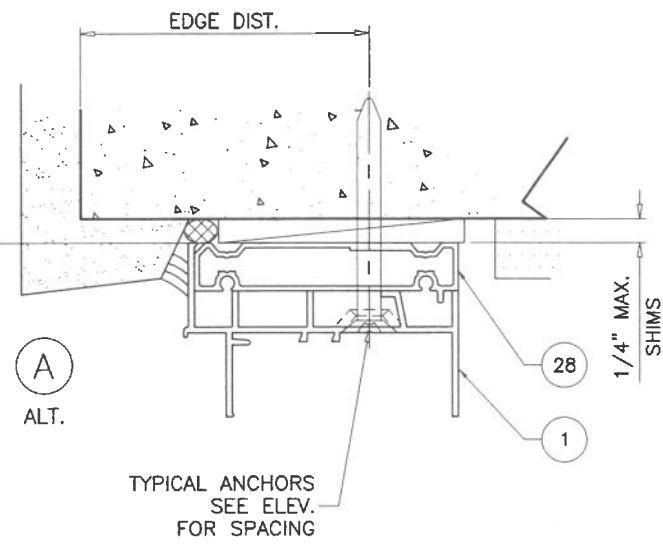

INSTALLATION DETAILS WITH FLUSH FRAME ADAPTERS
SEE SHEETS 4 & 5 FOR WINDOW DETAILS

PRODUCT REVISED
As complying with the Florida
Building Code
NOA-No. **26-0707.01**
Expiration Date: **10/20/2031**
By: *Manuel Ferrer*
Miami-Dade Product Control











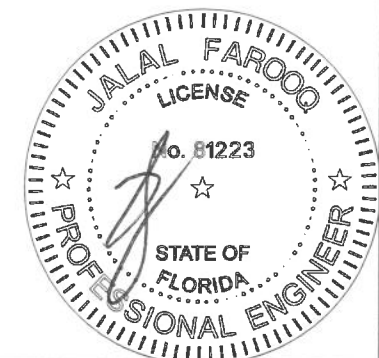


JUL 02 2026

afC
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL W11-38W


SERIES 100 ALUM SINGLE HUNG WDW. (L.M.I.)
Labrador & Fundora Corp.
dba-V & V Windows
14150 N.W. 56th Court, Suite 600
Opa-Locka, FL. 33054
Tel. (305) 888-4151 www.vvwindows.com

revisions:		no		date		by		description	
		G		02.06.25				FLUSH FRAME ADAPTER ADD.	
		H		06.23.26				NO CHANGE THIS SHEET	
date:		07-15-11							
scale:		1/2" = 1"							
dr. by:		TARIQ							
chk. by:									
drawing no.									
								W11-38	
sheet		6 of 9							

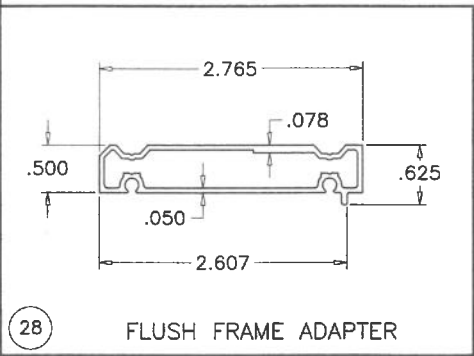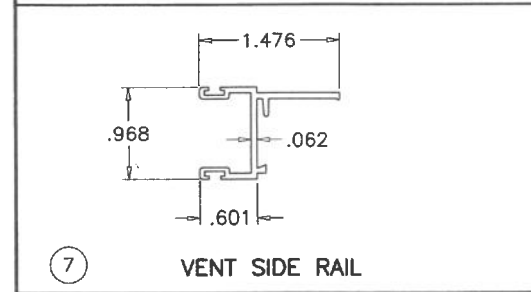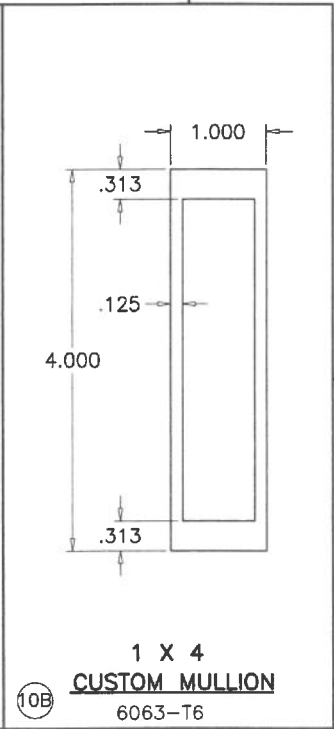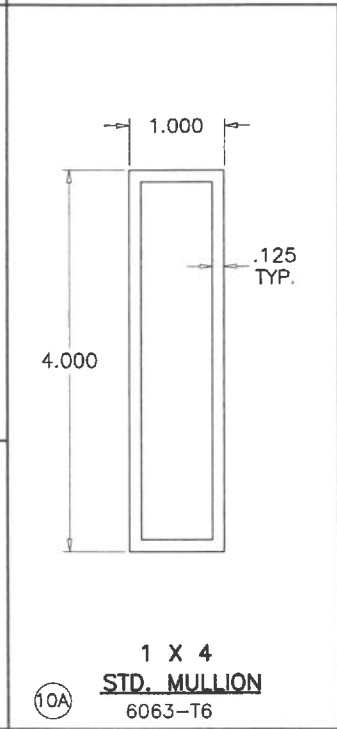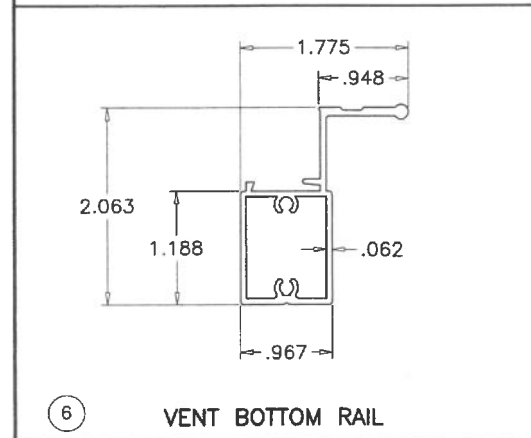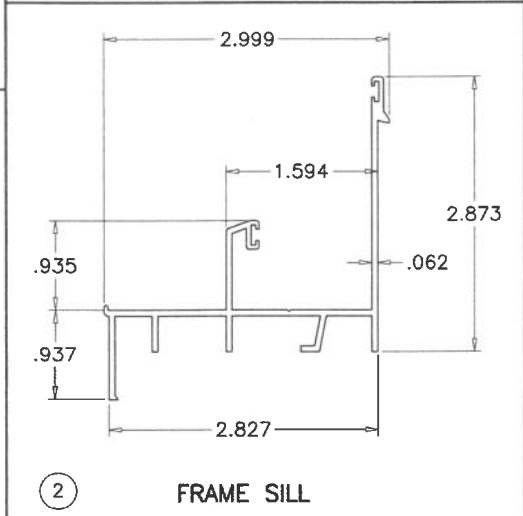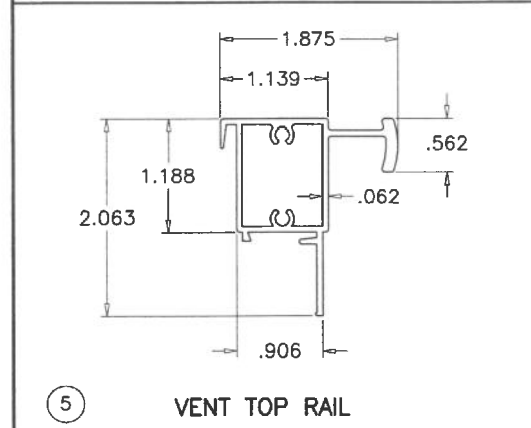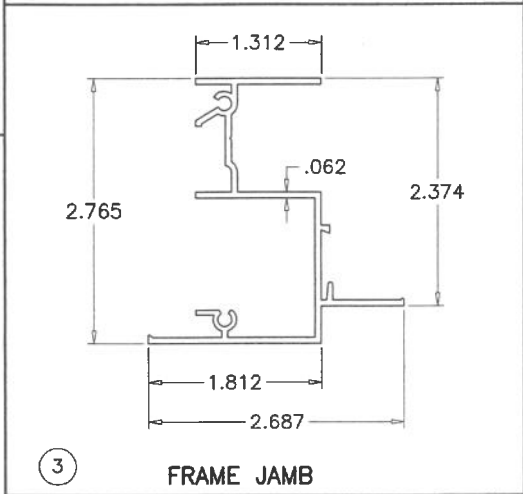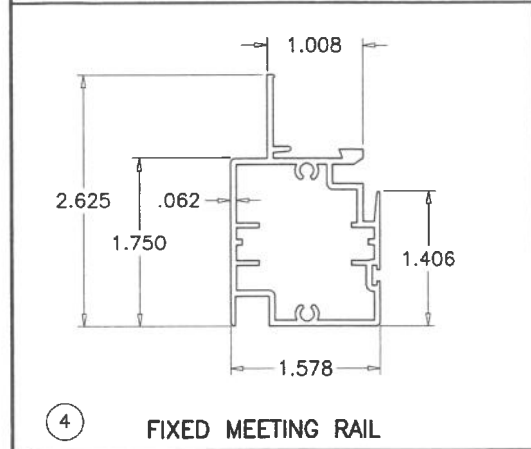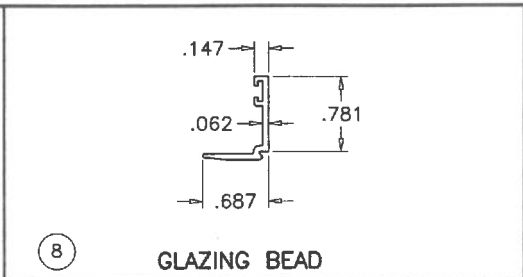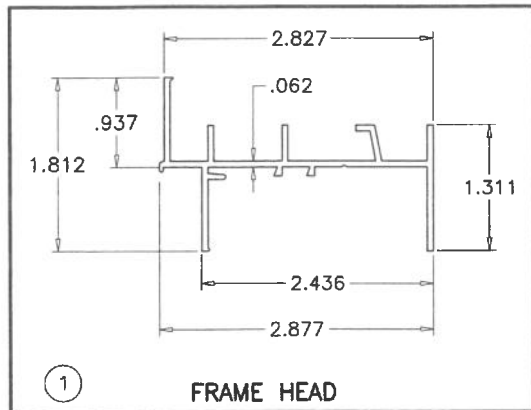

ITEM	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	V101	1	FRAME HEAD	6063-T6	-
2	V102	1	FRAME SILL	6063-T6	-
3	V103	2	FRAME JAMB	6063-T6	-
4	V104	1/ VENT	FIXED MTG. RAIL	6063-T6	-
5	V105	1/ VENT	VENT TOP RAIL	6063-T6	-
6	V106	1/ VENT	VENT BOTTOM RAIL	6063-T6	-
7	V107	2/ VENT	VENT SIDE RAIL	6063-T6	-
8	V108	AS REQD.	GLAZING BEAD	6063-T6	-
9	V109	4	SASH GUIDE	NYLON	-
10A	-	AS REQD.	1X4 STD. MULLION	6063-T6	-
10B	-	AS REQD.	1X4 CUSTOM MULLION	6063-T6	-
12	SL203	2/ VENT	SWEEP LATCH	-	SULLIVAN & ASSOC.
13	#8 X 1-1/4"	AS REQD.	FRAME/VENT ASSEMBLY SCREWS	-	PH SMS
14	#8 X 1/2"	2	BOTTOM RAIL LOWER SCREW	-	PH SMS
15	#8 X 1/2"	2	LATCH INSTALLATION SCREW	-	OH SMS
16	#6 X 1"	4	SASH GUIDE INSTALLATION SCREW	-	OH SMS
17	-	2/ LITE	SETTING BLOCKS	EPDM	DUROMETER 80±5 SHORE A
18	9146QU	AS REQD.	GLAZING BEAD BULB	NEOPRENE	ULTRAFAB, DUAL DUROMETER, T-SLOT=50, BULB=73
19	9146QU	AS REQD.	BULB SEAL	NEOPRENE	ULTRAFAB, DUAL DUROMETER, T-SLOT=50, BULB=73
20	-	AS REQD.	FRAME SILL W'STRIPPING	NEOPRENE	-
21	W222122G	AS REQD.	FIN SEAL W'STRIPPING	WOOL	ULTRAFAB
22	-	2	SUPERBOOST BALANCES	-	BALANCE SYSTEMS INC.
23	#10 X 1"	1/ BALANCE	BALANCE MOUNTING SCREWS	-	FH SMS
24	-	1/ BALANCE	BALANCE CONNECTING CLIP	-	-
25	#8 X 1/2"	2/ BALANCE	CONNECTING CLIP SCREWS	-	OH SMS
26	-	AS REQD.	5/16" BOX SCREEN	-	OPTIONAL
27	2/ WDW.	AS REQD.	SASH STOP (3" LONG)	RIGID PVC	-
28	V110	AS REQD.	FLUSH FRAME ADAPTER	6063-T6	-

PRODUCT REVISED
As complying with the Florida
Building Code
NOA-No. **26-0707.01**
Expiration Date: **10/20/2031**
By: *Manuel Fern*
Miami-Dade Product Control

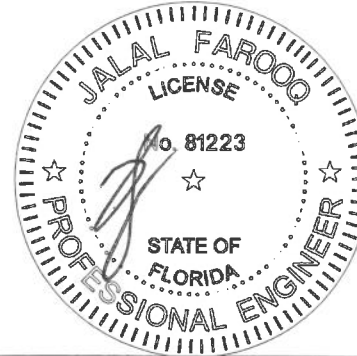

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 262-8100 FAX. (305) 262-6978
COMP-ANL\W11-38W

SERIES 100 ALUM SINGLE HUNG WDW. (L.M.I.)
Labrador & Fundora Corp.
dba-v & v Windows
14150 N.W. 56th Court, Suite 600
Opa-Locka, FL 33054
Tel. (305) 888-4151
www.vvwindows.com


revisions:	no	date	by	description
	E	07.14.20		EDITORIAL CHANGES
	F	06.07.23		UPDATED TO 2023 FBC
	G	02.06.25		FLUSH FRAME ADAPTER ADD.
	H	06.23.26		NO CHANGE THIS SHEET
date:	07-15-11			
scale:	1/2" = 1"			
dr. by:	TARIQ			
chk. by:				
drawing no.	W11-38			
sheet	7 of 9			

MULLION LOAD CAPACITY - PSF					
WINDOW DIMS.		2 ANCHORS AT EACH SIDE OF MULL		3 ANCHORS AT EACH SIDE OF MULL	
		1 X 4 STD. MULL	1 X 4 CUSTOM MULL	1 X 4 STD. MULL	1 X 4 CUSTOM MULL
WIDTH (W)	LENGTH (L)	EXT.(+) INT.(-)	EXT.(+) INT.(-)	EXT.(+) INT.(-)	EXT.(+) INT.(-)
19-1/8"	50-5/8"	120.0	120.0	120.0	120.0
26-1/2"		120.0	120.0	120.0	120.0
37"		120.0	120.0	120.0	120.0
42"		120.0	120.0	120.0	120.0
48"		120.0	120.0	120.0	120.0
53-1/8"		120.0	120.0	120.0	120.0
19-1/8"	58"	120.0	120.0	120.0	120.0
26-1/2"		120.0	120.0	120.0	120.0
37"		120.0	120.0	120.0	120.0
42"		120.0	120.0	120.0	120.0
48"		120.0	120.0	120.0	120.0
53-1/8"		120.0	120.0	120.0	120.0
19-1/8"	60"	120.0	120.0	120.0	120.0
26-1/2"		120.0	120.0	120.0	120.0
37"		120.0	120.0	120.0	120.0
42"		120.0	120.0	120.0	120.0
48"		120.0	120.0	120.0	120.0
53-1/8"		116.7	116.7	120.0	120.0
19-1/8"	63"	120.0	120.0	120.0	120.0
26-1/2"		120.0	120.0	120.0	120.0
37"		120.0	120.0	120.0	120.0
42"		117.6	117.6	120.0	120.0
48"		110.8	110.8	120.0	120.0
53-1/8"		107.1	107.1	120.0	120.0
19-1/8"	72"	120.0	120.0	120.0	120.0
26-1/2"		120.0	120.0	120.0	120.0
37"		104.8	104.8	120.0	120.0
42"		96.8	96.8	120.0	120.0
48"		90.0	90.0	115.0	120.0
53-1/8"		85.9	85.9	108.2	120.0
19-1/8"	74-1/4"	120.0	120.0	120.0	120.0
26-1/2"		120.0	120.0	120.0	120.0
37"		100.5	100.5	120.0	120.0
42"		92.7	92.7	117.5	120.0
48"		86.0	86.0	106.8	120.0
53-1/8"		81.9	81.9	100.2	120.0
19-1/8"	78"	120.0	120.0	120.0	120.0
26-1/2"		120.0	120.0	120.0	120.0
37"		94.2	94.2	116.4	120.0
42"		86.6	86.6	104.9	120.0
48"		80.0	80.0	94.9	119.2
53-1/8"		75.9	75.9	88.7	111.4

NOTES:


- USE CHART ON THIS SHEET FOR SIDE BY SIDE CONNECTION CAPACITY OF WINDOW MULLION.
- FOR SINGLE HUNG WINDOW CAPACITY SEE SHEETS 2 & 3.
- LOWER VALUES FROM STEPS 1 OR 2 WILL APPLY TO ENTIRE SYSTEM.

UN-CLIPPED MULLIONS

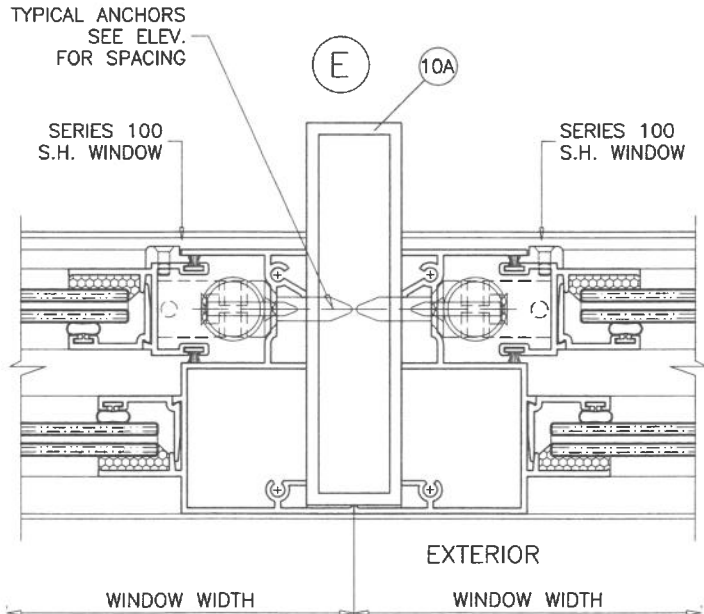


1X4 STD. MULLION

TOTAL PRPERTIES
Ix = 3.2036 IN⁴
Sx = 1.6018 IN³

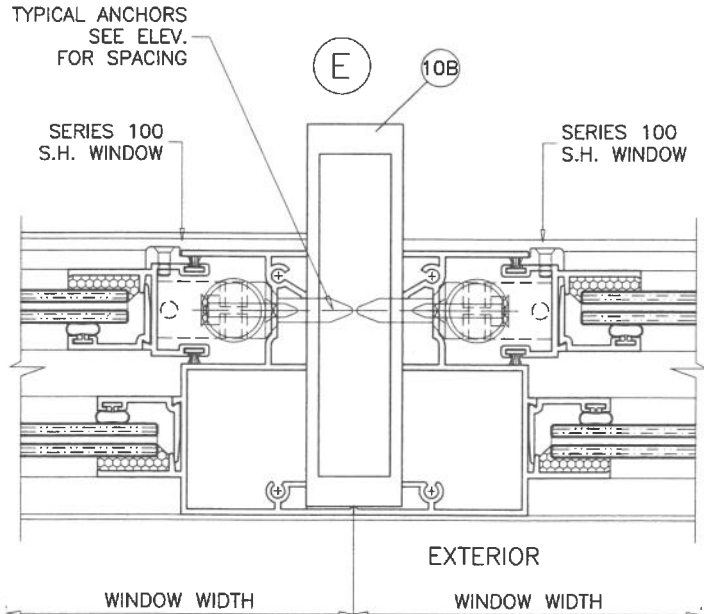

1X4 CUSTOM MULLION

TOTAL PRPERTIES
Ix = 4.0996 IN⁴
Sx = 2.0498 IN³

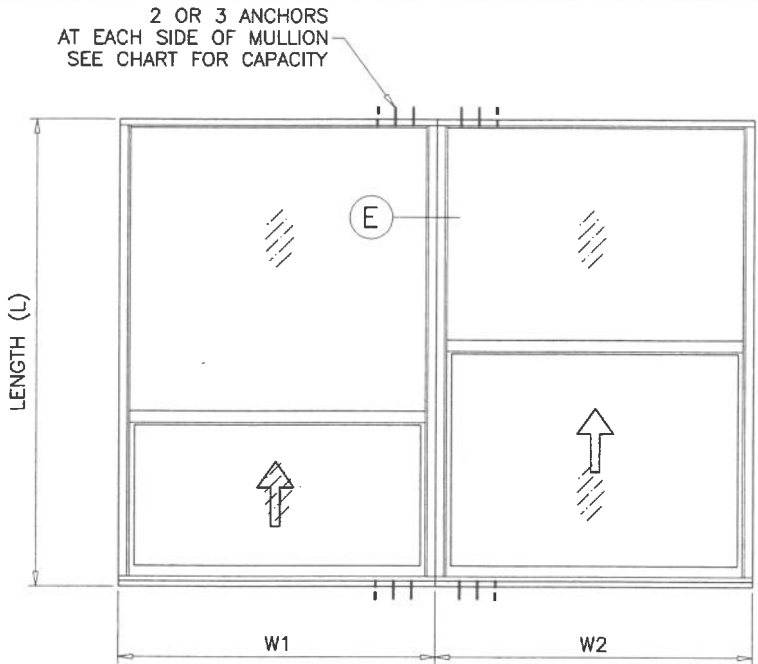


TYPICAL ELEVATION
SIDE BY SIDE WINDOWS

SIDE BY SIDE APPLIES TO TWO OR MORE WINDOWS

$$\text{WIDTH (W)} = \frac{W1 + W2}{2}$$

PRODUCT REVISED
As complying with the Florida Building Code
NOA-No. **26-0707.01**
Expiration Date: **10/20/2031**
By: *Manuel Fern*
Miami-Dade Product Control

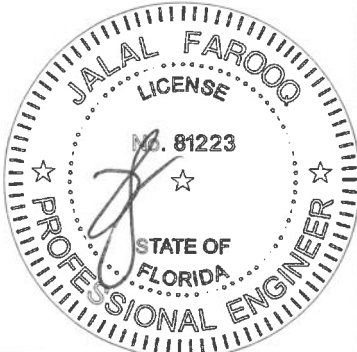

JUL 02 2026


afC
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W11-38W

SERIES 100 ALUM SINGLE HUNG WDW. (L.M.I.)
Labrador & Fundora Corp.
dba-V & V Windows
14150 N.W. 56th Court, Suite 600
Opa-Locka, FL 33054
Tel. (305) 888-4151
www.vvwindows.com


revisions:	no	date	by	description
	E	07.14.20		EDITORIAL CHANGES
	F	06.07.23		UPDATED TO 2023 FBC
	G	02.06.25		NO CHANGE THIS SHEET
	H	06.23.26		NO CHANGE THIS SHEET

date: 07-15-11
scale: 1/2" = 1"
dr. by: TARIQ
chk. by:


drawing no.
W11-38
sheet 8 of 9

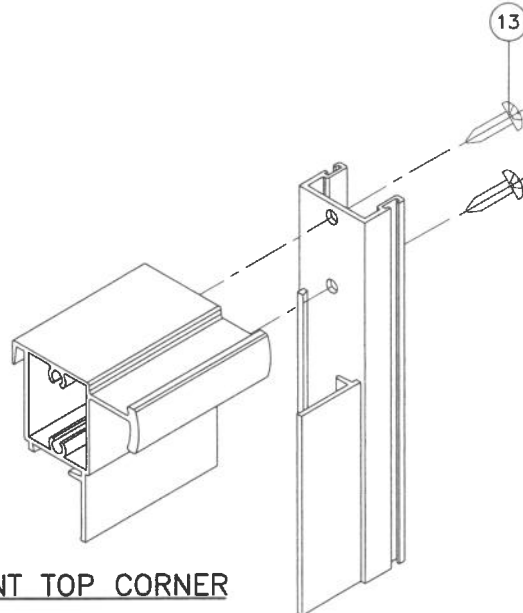


VENT TOP CORNER

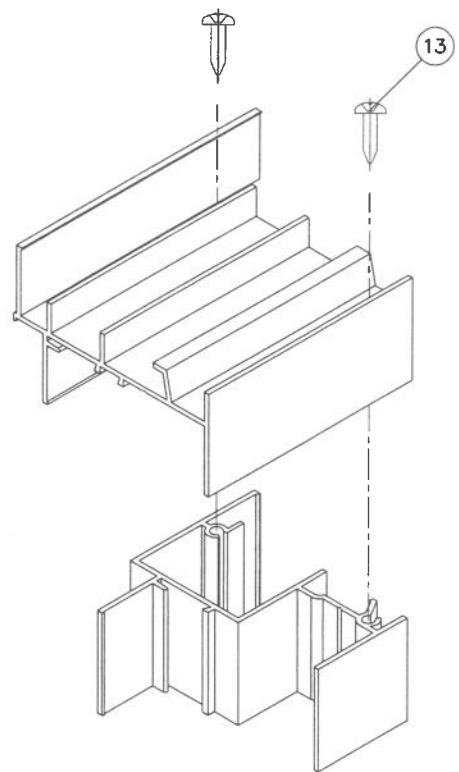


FRAME TOP CORNER

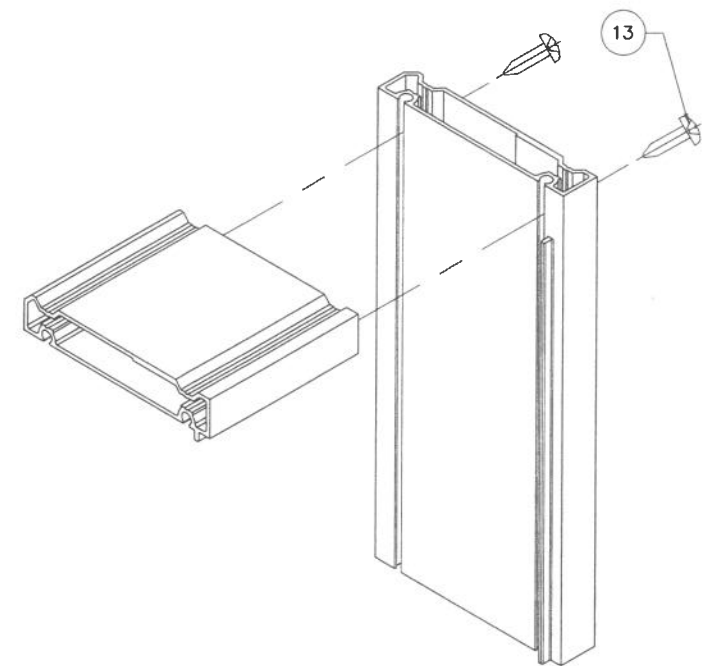

FRAME ADAPTER CORNER

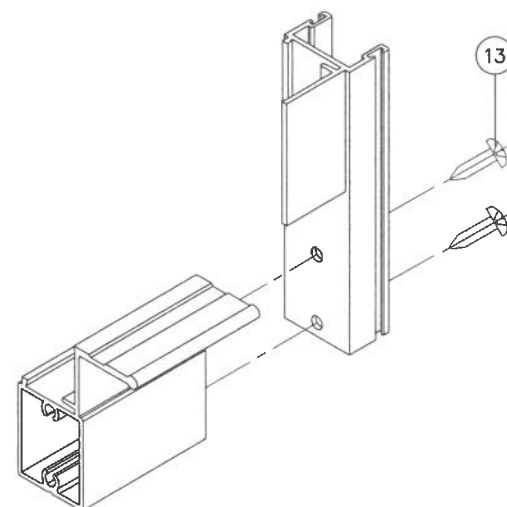


VENT BOTTOM CORNER

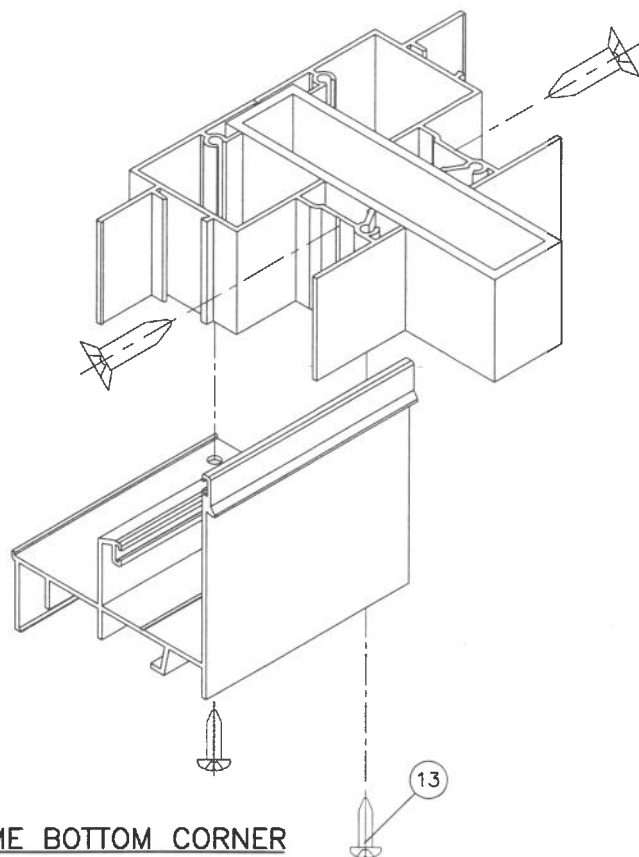

FRAME BOTTOM CORNER

JUL 02 2026

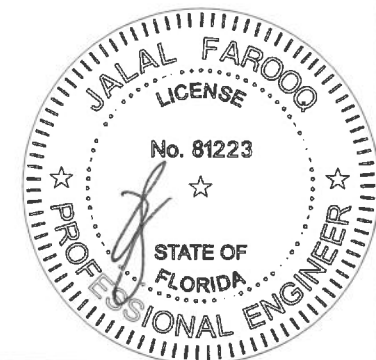

PRODUCT REVISED
As complying with the Florida Building Code
NOA-No. **26-0707.01**
Expiration Date: **10/20/2031**
By: *Manuel Ferrer*
Miami-Dade Product Control

af c

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978

COMP-ANL W11-38W

SERIES 100 ALUM SINGLE HUNG WDW. (L.M.I.)

Labrador & Fundora Corp.
dba-V & V Windows
14150 N.W. 56th Court, Suite 600
Opa-Locka, FL. 33054
Tel. (305) 888-4151 www.vvwindows.com

no	date	description	by
E	07.14.20	EDITORIAL CHANGES	
F	06.07.23	UPDATED TO 2023 FBC	
G	02.06.25	FLUSH FRAME ADAPTER ADD.	
H	06.23.26	NO CHANGE THIS SHEET	

date: 07-15-11
scale: 1/2" = 1"
dr. by: TARIQ
chk. by:

drawing no.
W11-38
sheet 9 of 9