



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

Labrador & Fundora Corp. dba V & V Windows
14150 NW 56th Court, Suite 600
Opa-Locka, FL 33054

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/ or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "S-3000" Aluminum Horizontal Sliding Window – L.M.I.

APPROVAL DOCUMENT: Drawing No. **25-69D**, titled "S-3000 Alum. Horizontal Sliding Window (L.M.I.)", sheets 1 through 20 of 20, dated 07/10/25, with revision A dated 06/23/26, prepared by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/ or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises NOA No. 25-0815.03** and consists of this page 1 and evidence pages E-1, E-2 and E-3, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**




7/21/26

NOA No. 26-0707.04
Expiration Date: September 02, 2031
Approval Date: July 30, 2026
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's

A. DRAWINGS

1. Manufacturer's die drawings and sections.
(Submitted under NOA No. 25-0815.03)
2. Drawing No **25-69D**, titled "S-3000 Alum. Horizontal Sliding Window (L.M.I.)", sheets 1 through 20 of 20, dated 07/10/25, prepared by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.
(Submitted under NOA No. 25-0815.03)

B. TESTS

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per FBC 2411.3.2.1, and TAS 202-94
along with marked-up drawings and installation diagram of an aluminum SGD OXXX, OXO & OX, prepared by Fenestration Testing Lab. Inc., Test Report No. **FTL-10698**, dated 04/22/21 signed and sealed by Idalmis Ortega, P.E.
(Submitted under NOA No. 21-0601.01)

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC 7th Edition (2020), dated 05/28/21 and updated on 07/10/25 to comply with FBC 8th Edition (2023), prepared by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.
(Submitted under NOA No. 25-0815.03)
2. Glazing complies with **ASTM E1300-09**

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **23-0717.30** issued to **Kuraray America, Inc.** for their "SentryGlas® (Clear and White) Glass Interlayers" dated 08/31/23, expiring on 07/04/28.
2. Notice of Acceptance No. **23-0713.18** issued to **Eastman Chemical Company (MA)** for their "Saflex® PVB Clear and Colored Interlayers for Laminated Glass" dated 08/17/23, expiring on 05/21/26.


Manuel Pérez, P.E.
Product Control Examiner
NOA No. 26-0707.04
Expiration Date: September 02, 2031
Approval Date: July 30, 2026

Labrador & Fundora Corp. dba V & V Windows


NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's (CONTINUED)
F. STATEMENTS

1. Statement letter of conformance, complying with **FBC 8th Edition (2023)** and of no financial interest, dated July 10, 2025, issued by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.
(Submitted under NOA No. 25-0815.03)
2. Laboratory compliance as part of the above-referenced test report.
(Submitted under NOA No. 21-0601.01)
3. Asset purchase agreement dated July 28, 2009, signed by Mr. David Labrador and Mr. Candido D. Vega.
(Submitted under NOA No. 10-0406.04)
4. Proposal No. **22-0975** issued by the Product Control Section, dated May 23, 2023, signed by Ishaq Chanda, P.E.
(Submitted under NOA No. 24-0613.01)
5. Proposal No. **24-0407** issued by the Product Control Section, dated April 25, 2024, signed by Ishaq Chanda, P.E.
(Submitted under NOA No. 24-0613.01)
6. Florida Department of State, Div of Corporations, active listing of Labrador & Fundora Corporation, dated 08/31/15 and updated annual report year 02/25/25.
(Submitted under NOA No. 25-0829.07)
7. Florida Department of State, active fictitious name listing of V& V Windows, (registration #G15000089765), dated 08/31/15, verified active listing on 09/05/25.
(Submitted under NOA No. 25-0829.07)

G. OTHERS

1. Notice of Acceptance No. **25-0829.07**, issued to Labrador & Fundora Corp. dba V & V Windows for their Series "S-3000" Aluminum Sliding Glass Door - L.M.I., approved on 09/18/25 and expiring on 09/02/31. **(For reference only)**

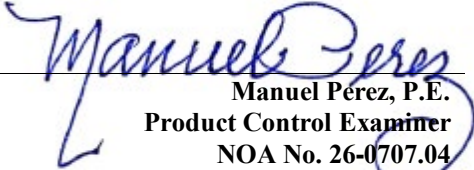
Manuel Pérez, P.E.
Product Control Examiner
NOA No. 26-0707.04
Expiration Date: September 02, 2031
Approval Date: July 30, 2026

Labrador & Fundora Corp. dba V & V Windows

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

2. NEW EVIDENCE SUBMITTED

A. DRAWINGS

1. Drawing No **25-69D**, titled “S-3000 Alum. Horizontal Sliding Window (L.M.I.)”, sheets 1 through 20 of 20, dated 07/10/25, with revision **A** dated 06/23/26, prepared by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.

B. TESTS

1. None.

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC 8th Edition (2023) and FBC 9th Edition (2026), dated 07/06/26, prepared by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.
2. Glazing complies with **ASTM E1300-16**

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS


1. Notice of Acceptance No. **23-0717.30** issued to **Kuraray America, Inc.** for their “**SentryGlas® (Clear and White) Glass Interlayers**” dated 08/31/23, expiring on 07/04/28.
2. Notice of Acceptance No. **23-0713.18** issued to **Eastman Chemical Company (MA)** for their “**Saflex® PVB Clear and Colored Interlayers for Laminated Glass**” dated 08/17/23, expiring on 05/21/26.

F. STATEMENTS

1. Statement letter of conformance, complying with **FBC 8th Edition (2023), FBC 9th Edition (2026)** and of no financial interest, dated July 1, 2026, issued by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.

G. OTHERS

1. Notice of Acceptance No. **25-0815.03**, issued to Labrador & Fundora Corp. dba V & V Windows for their Series “S-3000” Aluminum Horizontal Sliding Window - L.M.I., approved on 09/25/25 and expiring on 09/02/31.


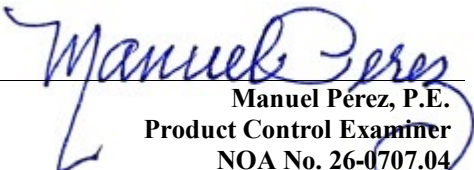

Manuel Perez, P.E.
Product Control Examiner
NOA No. 26-0707.04
Expiration Date: September 02, 2031
Approval Date: July 30, 2026

The following pages in this document were submitted by the manufacturer (third party) to represent the product being approved and establish the limits of use. The pages may include technical drawings, schematics and installation details.

DESIGN LOAD CAPACITY - PSF					
AVERAGE PANEL WIDTH INCHES	WDW. FRAME HEIGHT INCHES	UNREINFORCED INTERLOCKS		REINFORCED INTERLOCKS	
		GLASS TYPES 'A' & 'Ai'		GLASS TYPES 'B' & 'Bi'	
		EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
30	84	60.0	60.0	60.0	65.0
36		60.0	60.0	60.0	65.0
42		60.0	60.0	60.0	65.0
48		60.0	60.0	60.0	65.0
54		60.0	60.0	60.0	65.0
60		55.7	55.7	60.0	65.0
30	90	60.0	60.0	60.0	65.0
36		60.0	60.0	60.0	65.0
42		60.0	60.0	60.0	65.0
48		60.0	60.0	60.0	65.0
54		60.0	60.0	60.0	65.0
60		-	-	60.0	65.0

AVERAGE PANEL WIDTH = WINDOW FRAME WIDTH / NUMBER OF PANELS

NOTE:
PANEL GUIDES AND END COVERS (ITEMS #27 & #28)
ARE INSTALLED AT TOP AND BOTTOM OF EACH PANEL
AFTER IT'S INSTALLATION INTO WINDOW FRAME AND PREVENT
THE PANELS FROM BEING LIFTED.
REFER TO SHEET 19 FOR DETAILS

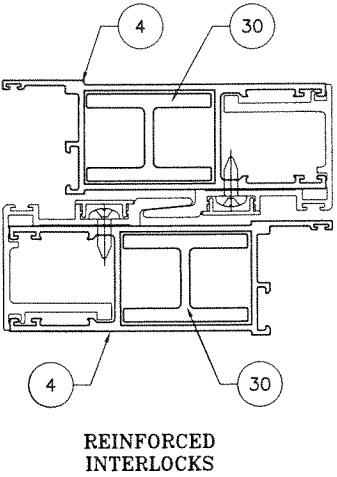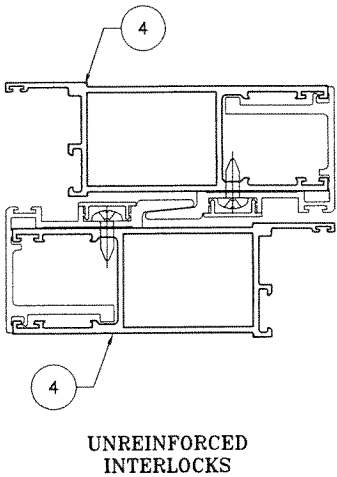

THESE WINDOWS ARE RATED FOR LARGE & SMALL MISSILE IMPACT.
SHUTTERS ARE NOT REQUIRED.

SERIES-3000
ALUMINUM HORIZONTAL SLIDING WINDOW

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE 2023 (8TH EDITION)/2026 (9TH EDITION) FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

1BY OR 2BY WOOD BUCKS & BUCK FASTENERS BY OTHERS, MUST BE DESIGNED AND INSTALLED ADEQUATELY TO TRANSFER APPLIED PRODUCT LOADS TO THE BUILDING STRUCTURE.

ANCHORS TO BE SPACED AS SHOWN ON DETAILS AND INSTALLED PER MANUF'S INSTRUCTIONS. SPECIFIED EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

ALL SHIMS TO BE LOAD-BEARING, (HIGH DENSITY PLASTIC/COMPOSITE, METAL OR OTHER RIGID MATERIALS).

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE 2023/2026 FLORIDA BLDG. CODE & ADOPTED STANDARDS.

THIS PRODUCT APPROVAL IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT, i.e. LIFE SAFETY OF THIS PRODUCT, ADEQUACY OF STRUCTURE RECEIVING THIS PRODUCT AND SEALING AROUND OPENING FOR WATER INFILTRATION RESISTANCE ETC.

CONDITIONS NOT SHOWN IN THIS DRAWING ARE TO BE ANALYZED SEPARATELY, AND TO BE REVIEWED BY BUILDING OFFICIAL.

DESIGN LOADS SHOWN ARE BASED ON 'ALLOWABLE STRESS DESIGN (ASD)'.


FASTENERS AND CONNECTORS (AS APPLICABLE) SHOWN IN THIS APPROVAL MAY NOT MEET CORROSION RESISTANCE REQUIREMENTS FOR COASTAL OR SALT WATER EXPOSURE ZONES. COMPLIANCE WITH THESE CONDITIONS TO BE CHECKED PER FBC 1711.

LAMINATED GLASS
INSUL. LAM. GLASS
LARGE MISSILE IMPACT

NOTE:
GLASS CAPACITIES ARE BASED ON
ASTM E1300-16 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

PRODUCT REVISED
As complying with the Florida
Building Code
NOA-No. 26-0707.04
Expiration Date: 09/02/2031
By: Manuel Perez
Miami-Dade Product Control


JUL 06 2026

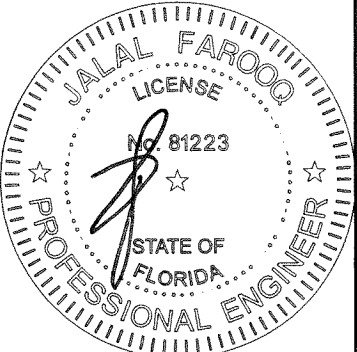


afC
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\25-69D-W

S-3000 ALUM HORIZONTAL SLIDING WINDOW (L.M.I.)
Labrador & Fundora Corp.
dba-V & V Windows
14150 N.W. 56th Court, Suite 600
Opa-Locka, FL 33054
Tel. (305) 888-4151
www.vvwindows.com


revisions:		no	date	by	description
		A	06.23.26		UPDATED TO 2026 FBC
date:	07-10-25	scale:	3/8" = 1"	dr. by:	TARIQ
				chk. by:	
drawing no.		25-69D			
sheet		1 of 20			

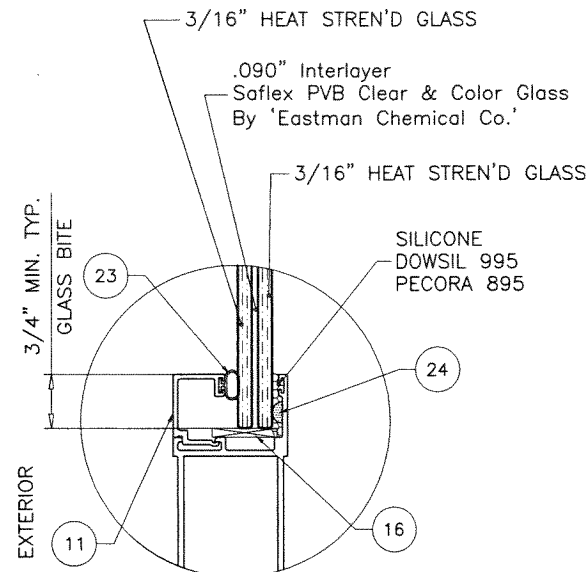


GLASS TYPE 'A'
7/16" OVERALL LAM. GLASS

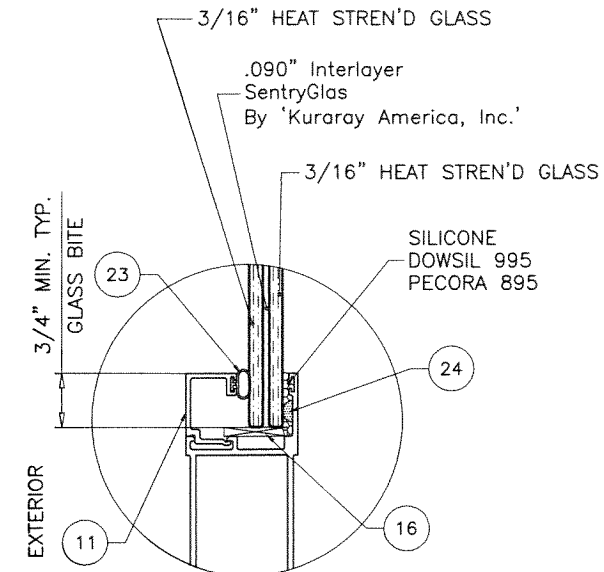

GLASS TYPE 'B'
7/16" OVERALL LAM. GLASS

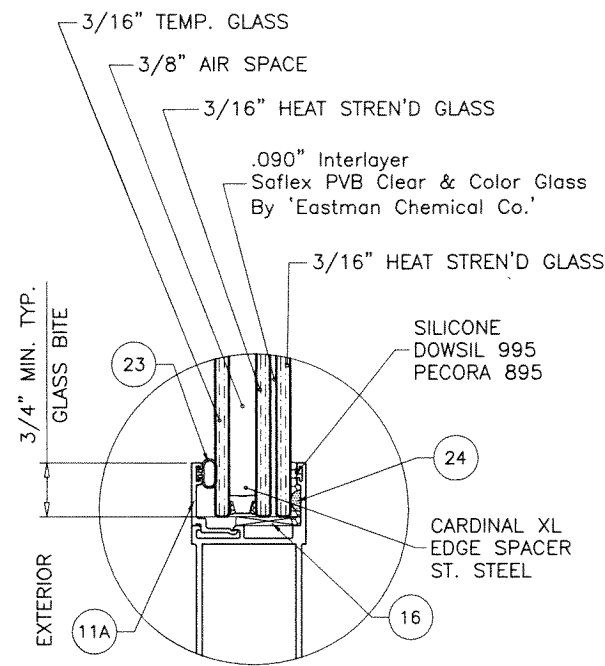


GLASS TYPE 'Ai'
1" OVERALL INSUL. LAM. GLASS

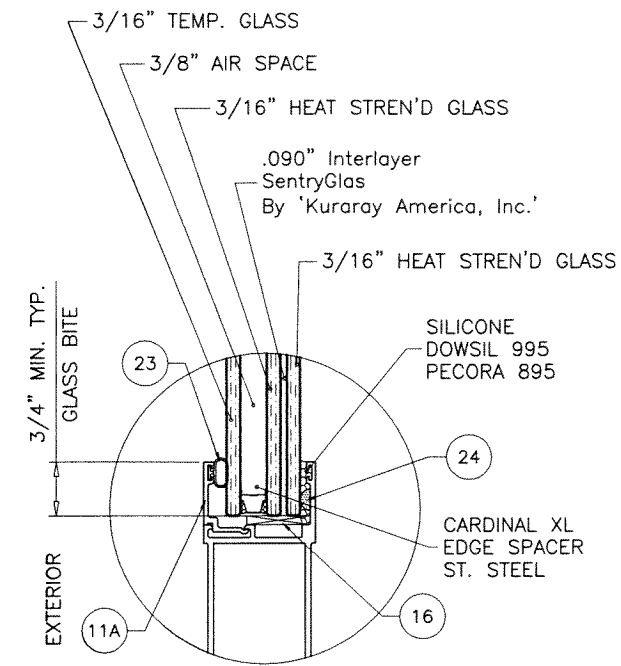

GLASS TYPE 'Bi'
1" OVERALL INSUL. LAM. GLASS

PRODUCT REVISED
As complying with the Florida Building Code
NOA-No. **26-0707.04**
Expiration Date: **09/02/2031**
By: *Manuel Perez*
Miami-Dade Product Control

JUL 06 2026

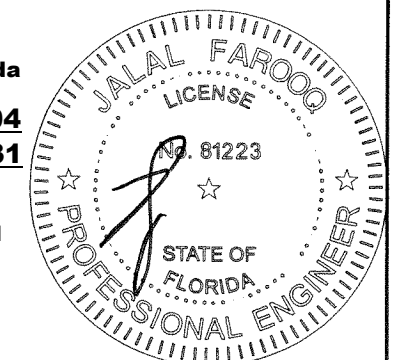

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL 25-69D-W

Labrador & Fundora Corp.
dba-V & V Windows
14150 N.W. 56th Court, Suite 600
Opa-Locka, FL 33054
Tel. (305) 888-4151
www.vvwindows.com

revisions:		date:	scale:	dr. by:	chk. by:
no	description				
A	06.23.26		3/8" = 1"	TARIQ	
	UPDATED TO 2026 FBC				

date: 07-10-25


drawing no. **25-69D**

sheet **2** of **20**

no. 81223

STATE OF FLORIDA

PROFESSIONAL ENGINEER

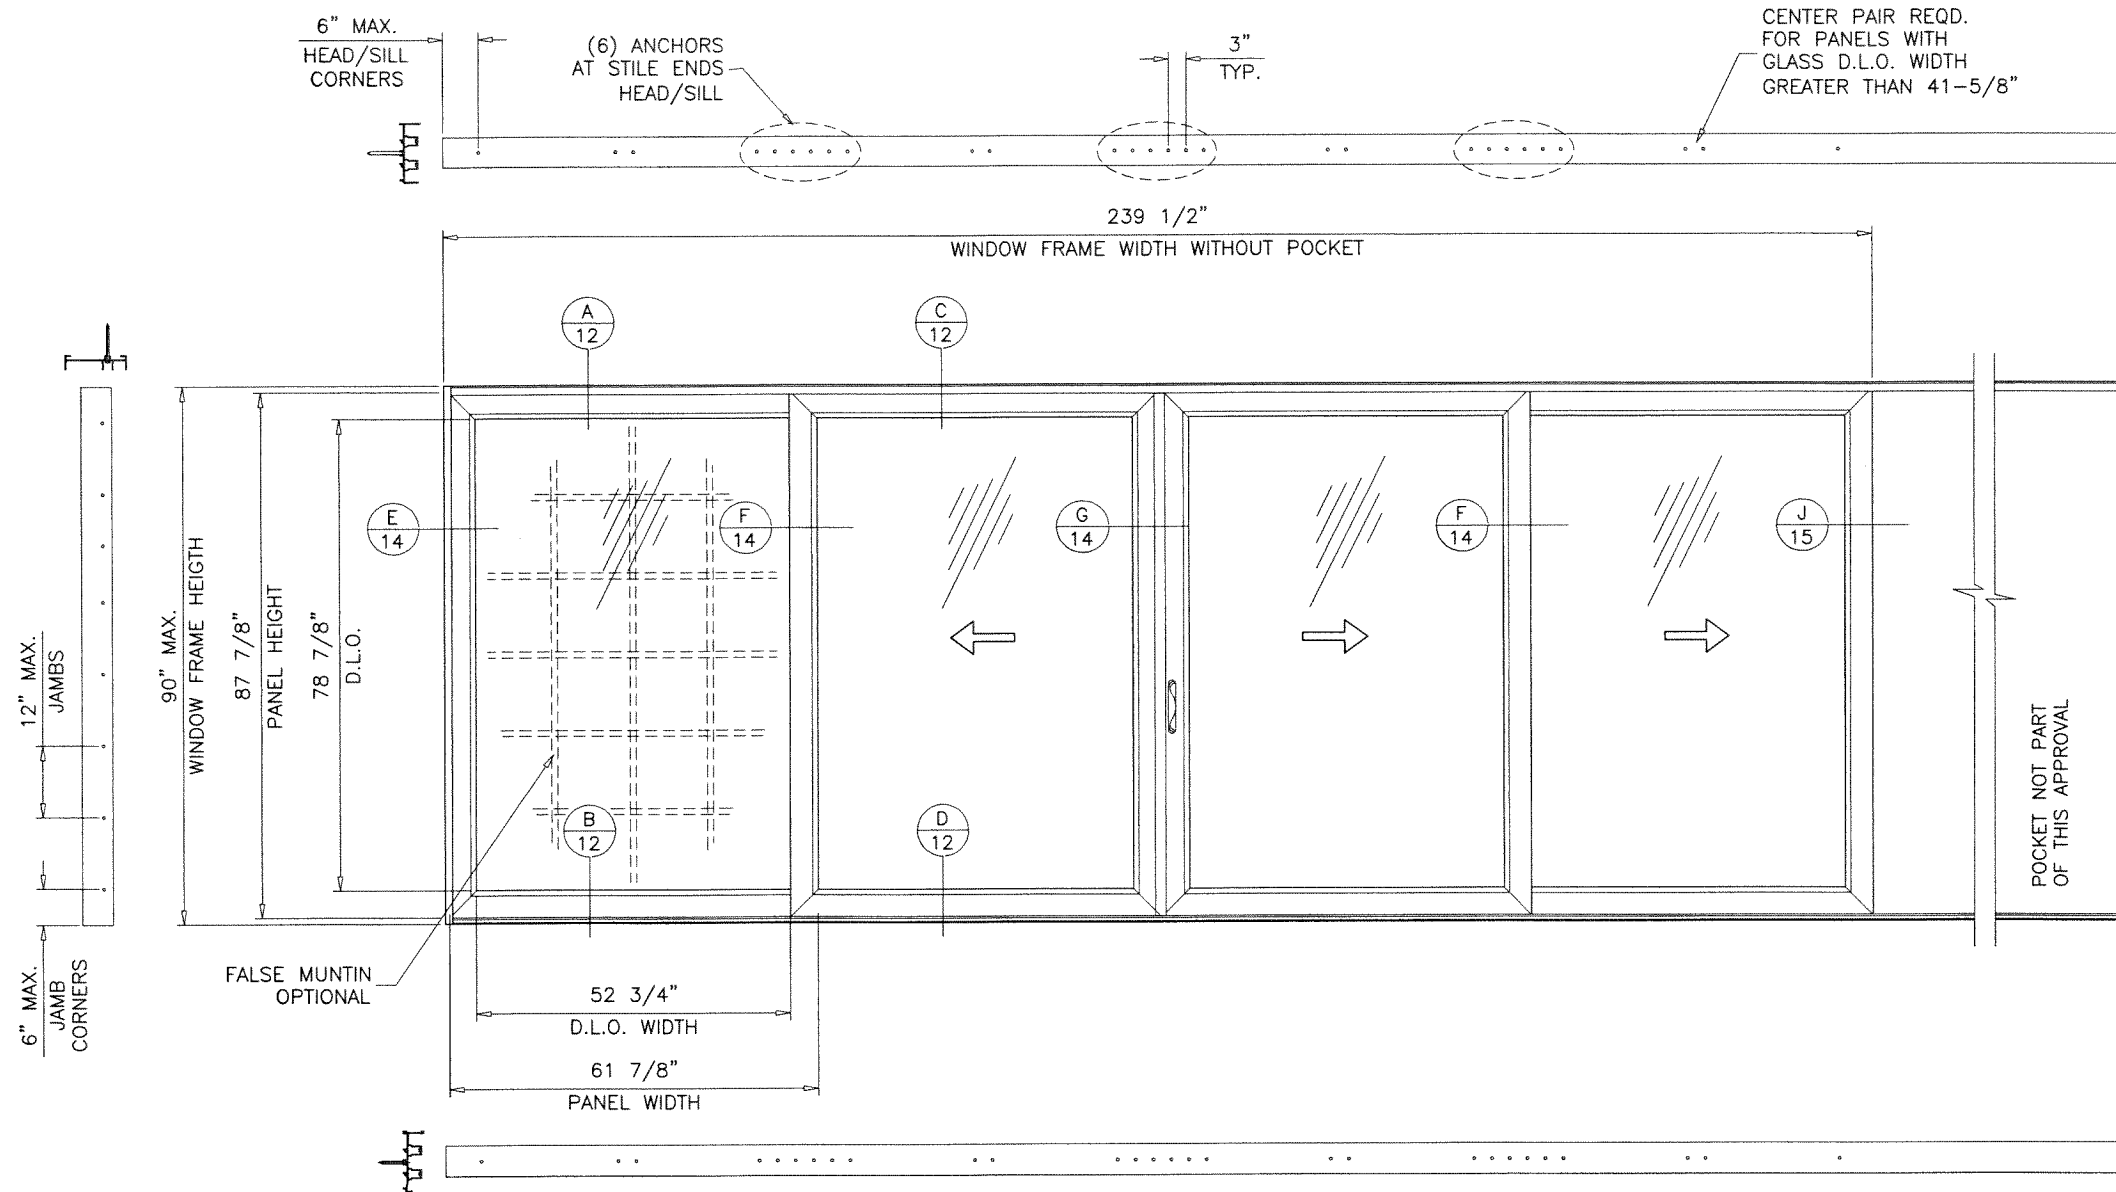


TYPICAL ELEVATION
OX-XXP (2 TRACKS)

2 TRACK FRAMES:
FOR ALTERNATE SIZES/NUMBER OF PANELS
MAX. WINDOW AREA NOT TO EXCEED 240.0 SQ. FT.
PANEL WIDTH AND HEIGHT NOT TO EXCEED SIZES SHOWN IN CHART ON SHEET 1
POCKETS NOT INCLUDED.

PRODUCT REVISED
As complying with the Florida
Building Code
NOA-No. **26-0707.04**
Expiration Date: **09/02/2031**
By: *Manuel Perez*
Miami-Dade Product Control

JUL 06 2026

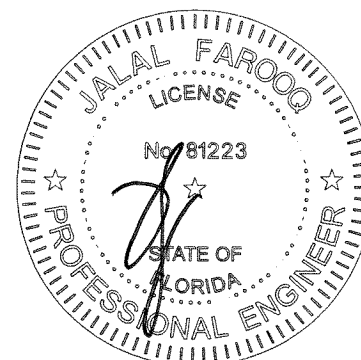

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

af c
COMP-ANL\25-69D-W

S-3000 ALUM HORIZONTAL SLIDING WINDOW (L.M.I.)

Labrador & Fundora Corp.
dba-V & V Windows
14150 N.W. 56th Court, Suite 600
Opa-Locka, FL 33054
Tel. (305) 888-4151
www.vvwindows.com

revisions:	
no	date by description
A	06.23.26 NO CHANGE THIS SHEET

date: 07-10-25

scale: 3/8"=1'-0"


dr. by: TARIQ

chk. by:

drawing no.

25-69D


sheet **3** of 20

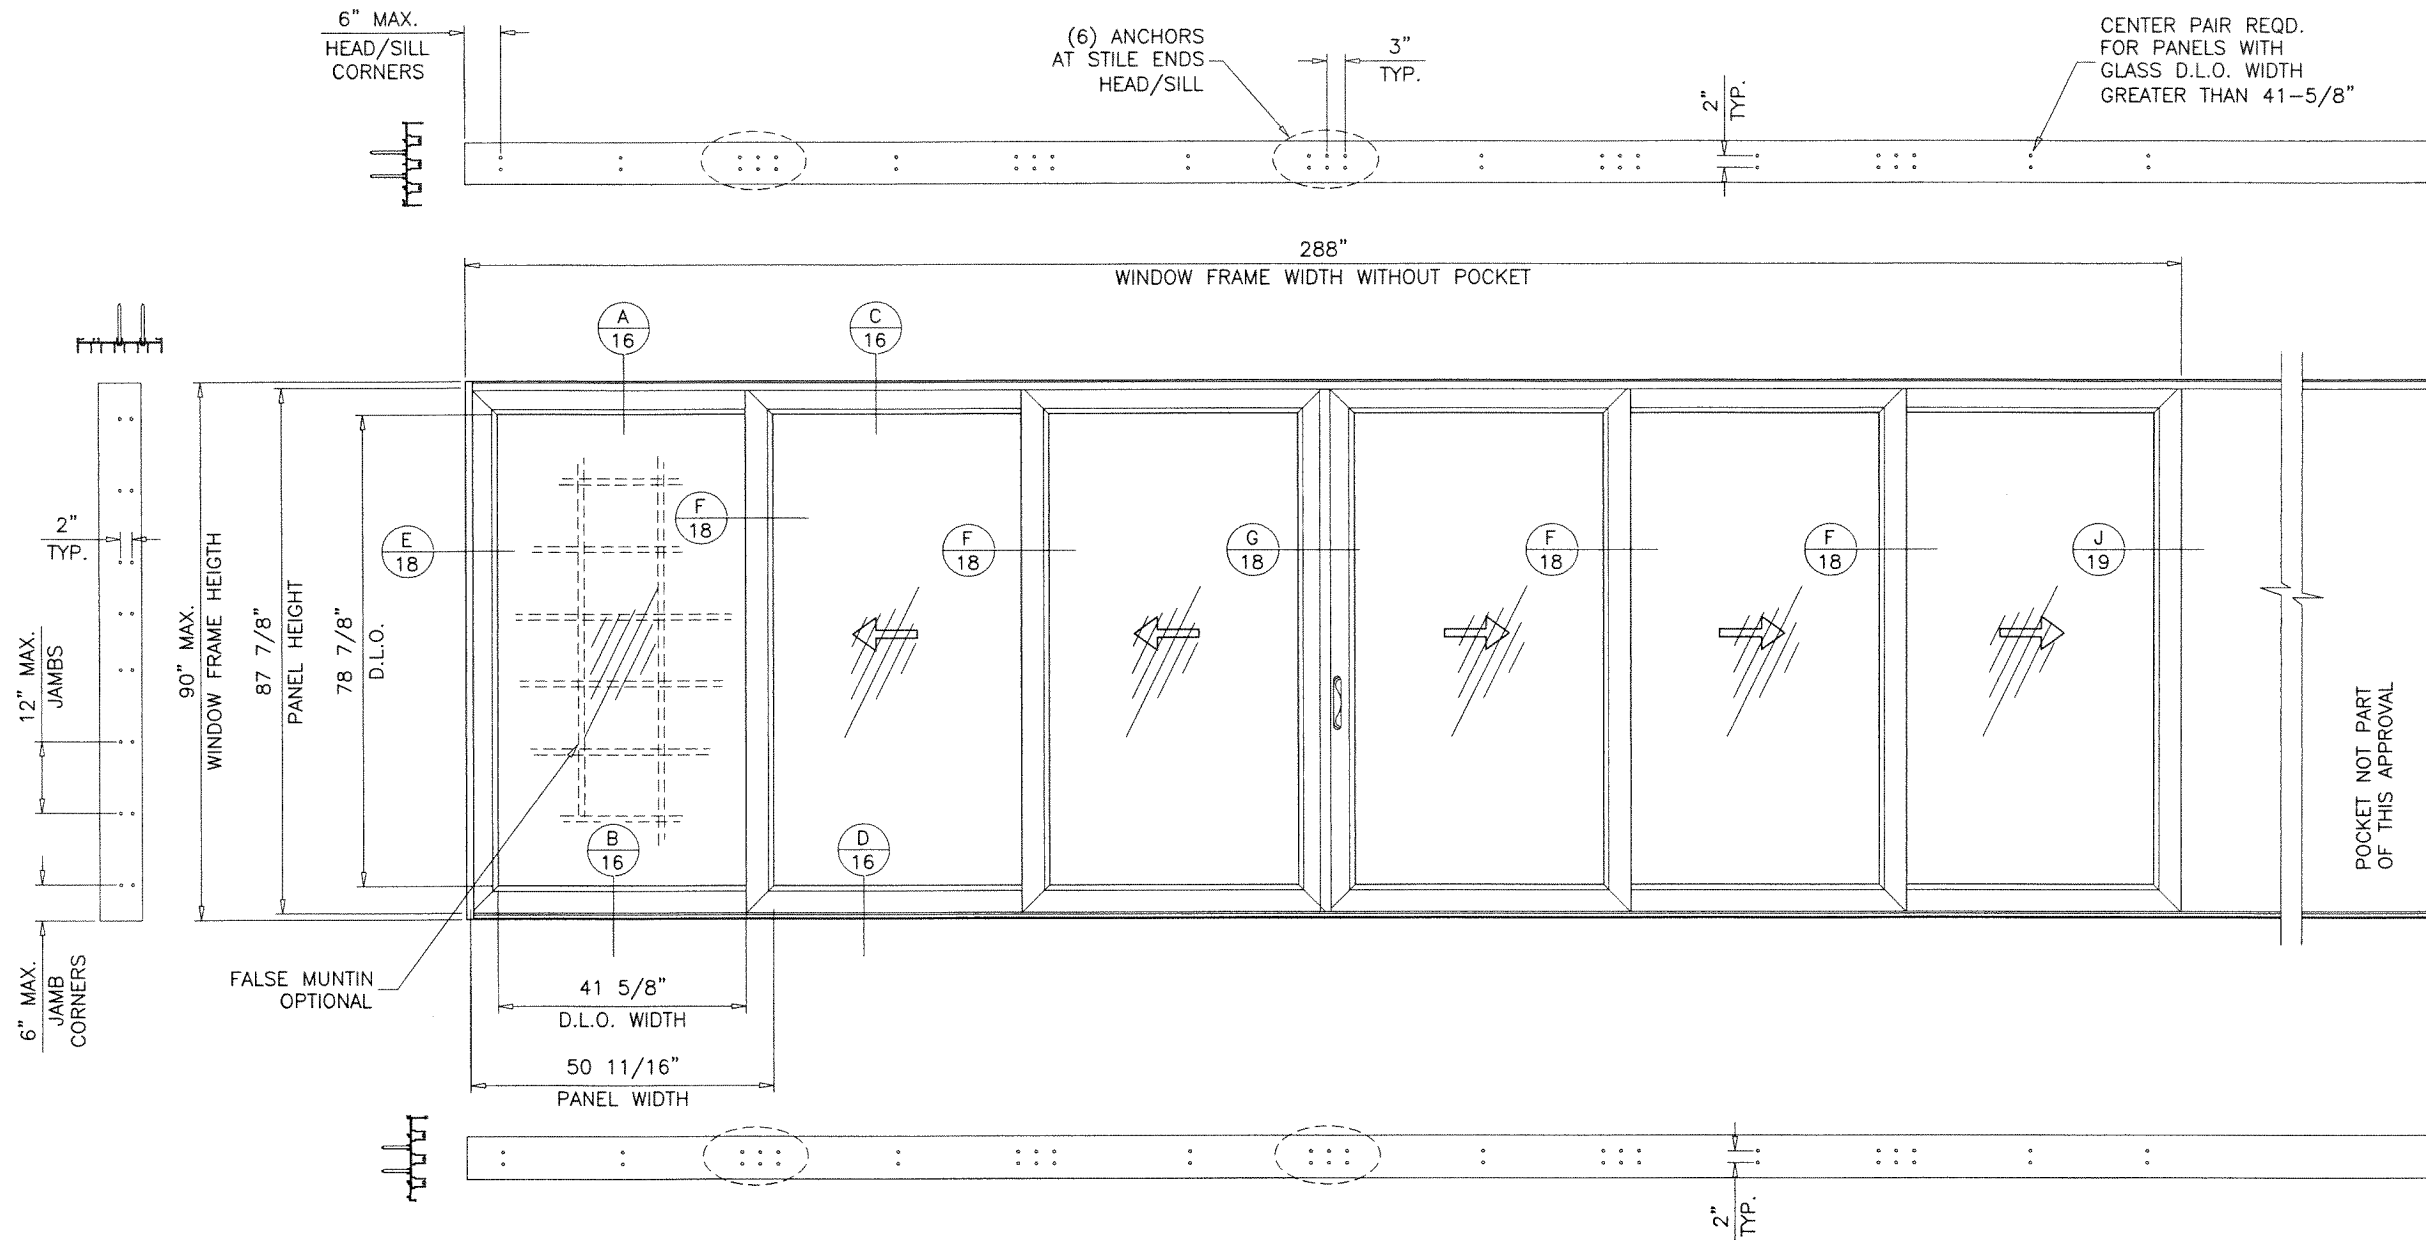

TYPICAL ELEVATION
OXX-XXXXP (3 TRACKS)

3 TRACK FRAMES:
FOR ALTERNATE SIZES/NUMBER OF PANELS
MAX. WINDOW AREA NOT TO EXCEED 360.0 SQ. FT.
PANEL WIDTH AND HEIGHT NOT TO EXCEED SIZES SHOWN IN CHART ON SHEET 1
POCKETS NOT INCLUDED.

PRODUCT REVISED
As complying with the Florida
Building Code
NOA-No. **26-0707.04**
Expiration Date: **09/02/2031**
By: *Manuel Perez*
Miami-Dade Product Control
JUL 06 2026

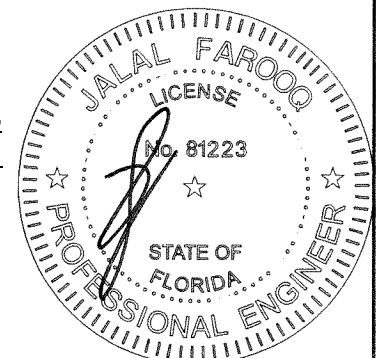









af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\25-69D-W

S-3000 ALUM HORIZONTAL SLIDING WINDOW (L.M.I.)
Labrador & Fundora Corp.
dba-V & V Windows
14150 N.W. 56th Court, Suite 600
Opa-Locka, FL. 33054
Tel. (305) 888-4151
www.vvwindows.com


revisions:		no	date	by	description
		A	06.23.26		NO CHANGE THIS SHEET
date:	07-10-25	scale:	3/8"=1'-0"	dr. by:	TARIQ
chk. by:					
drawing no.	25-69D				
sheet	4 of 20				

revisions:		no	date	by	description
		A	06.23.26		NO CHANGE THIS SHEET
date:	07-10-25	scale:	-	dr. by:	TARIQ
				chk. by:	
drawing no.		25-69D			
sheet		5 of 20			







- NOTE:
1. CONFIGURATIONS SHOWN FOR ILLUSTRATION PURPOSES ONLY.
 2. FOR APPLICABLE DESIGN PRESSURES SEE SHEET 1.
 3. FOR ANCHOR DETAILS SEE SHEETS 9 THRU 12.

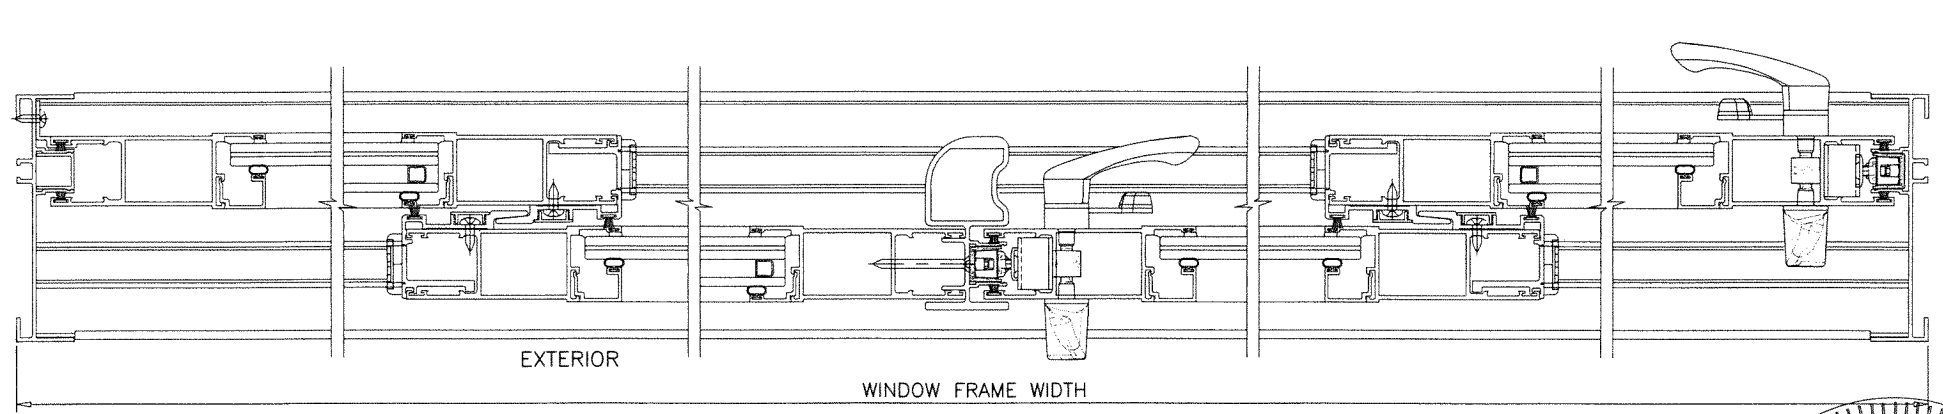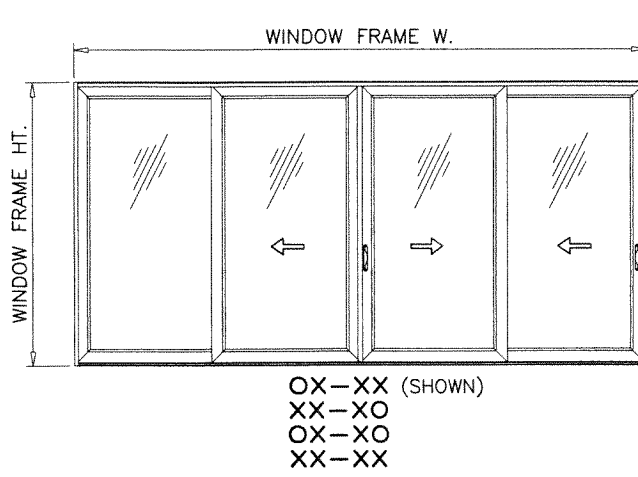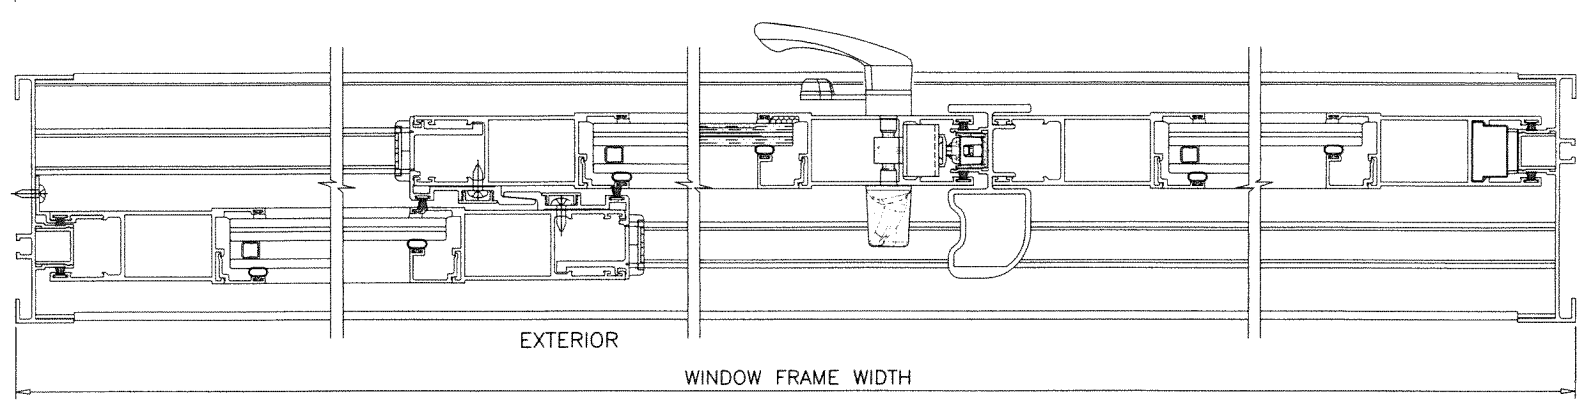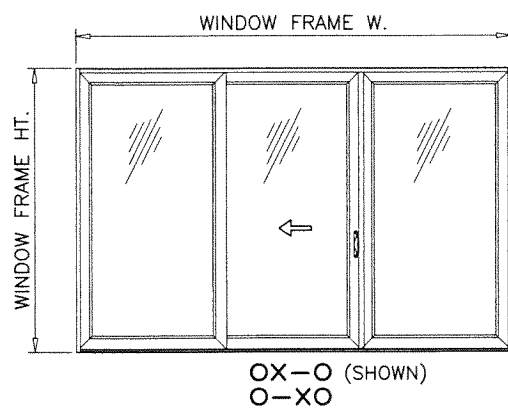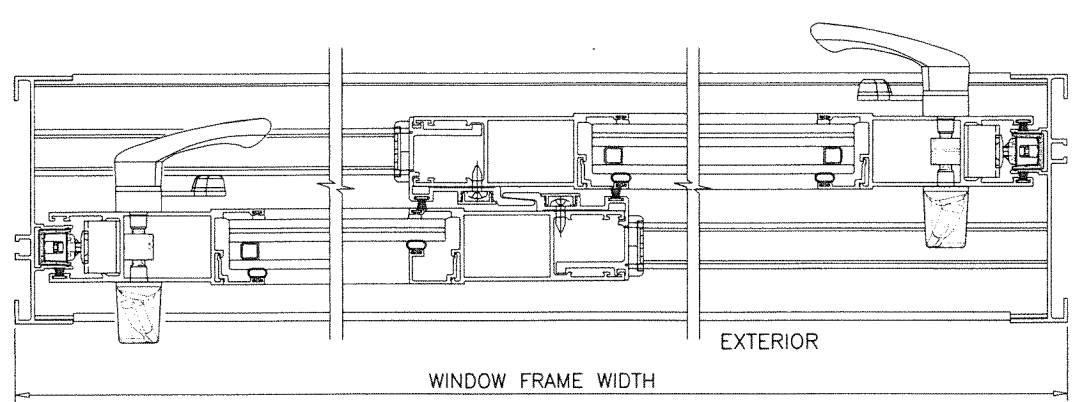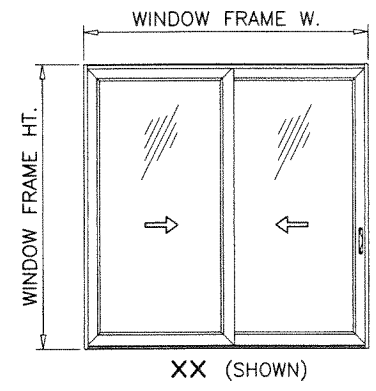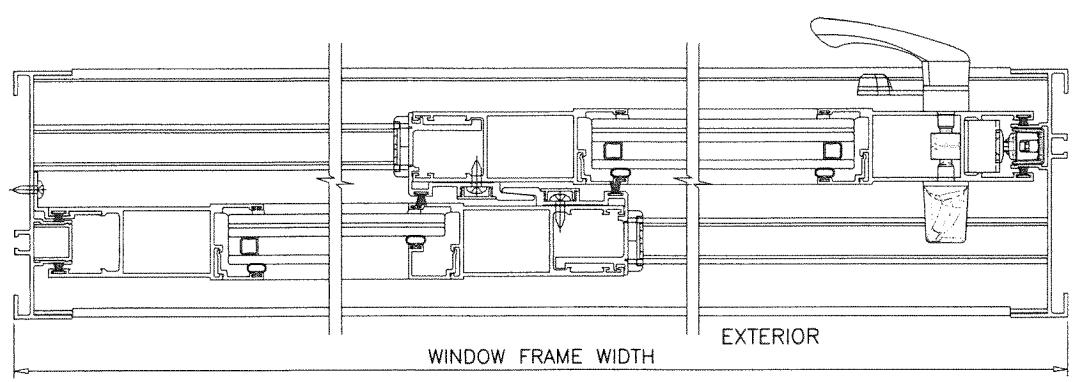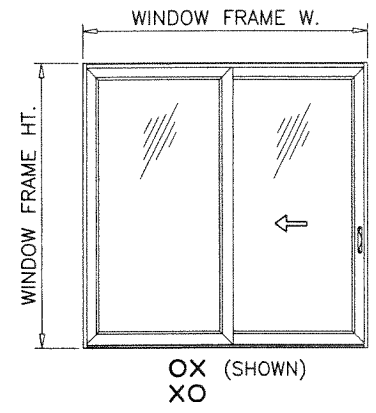

PRODUCT REVISED
 As complying with the Florida
 Building Code
 NOA-No. **26-0707.04**
 Expiration Date: **09/02/2031**
 By: *Manuel Perez*
 Miami-Dade Product Control
JUL 06 2026

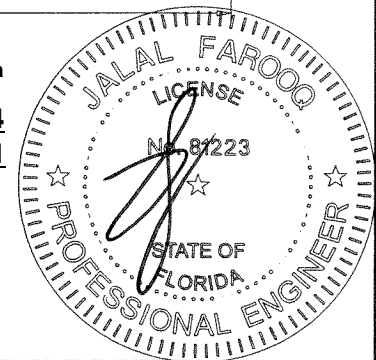


APPROVED CONFIGURATIONS
NON-POCKETED WINDOWS
2 TRACK FRAMES

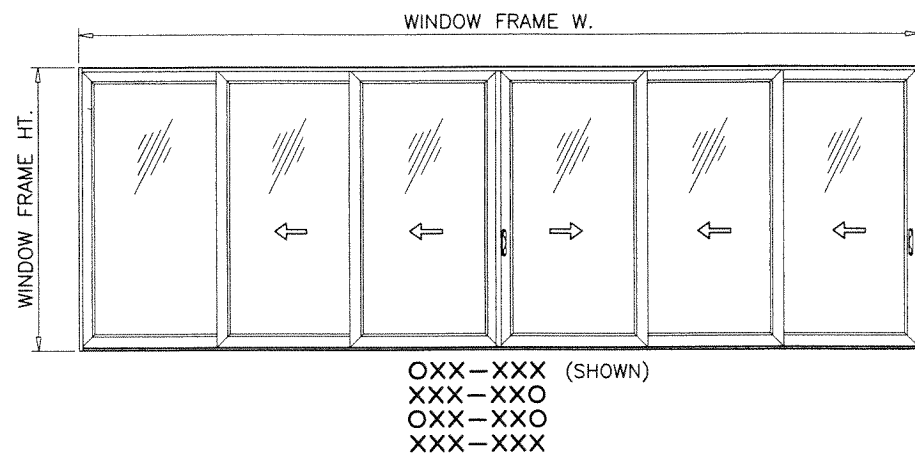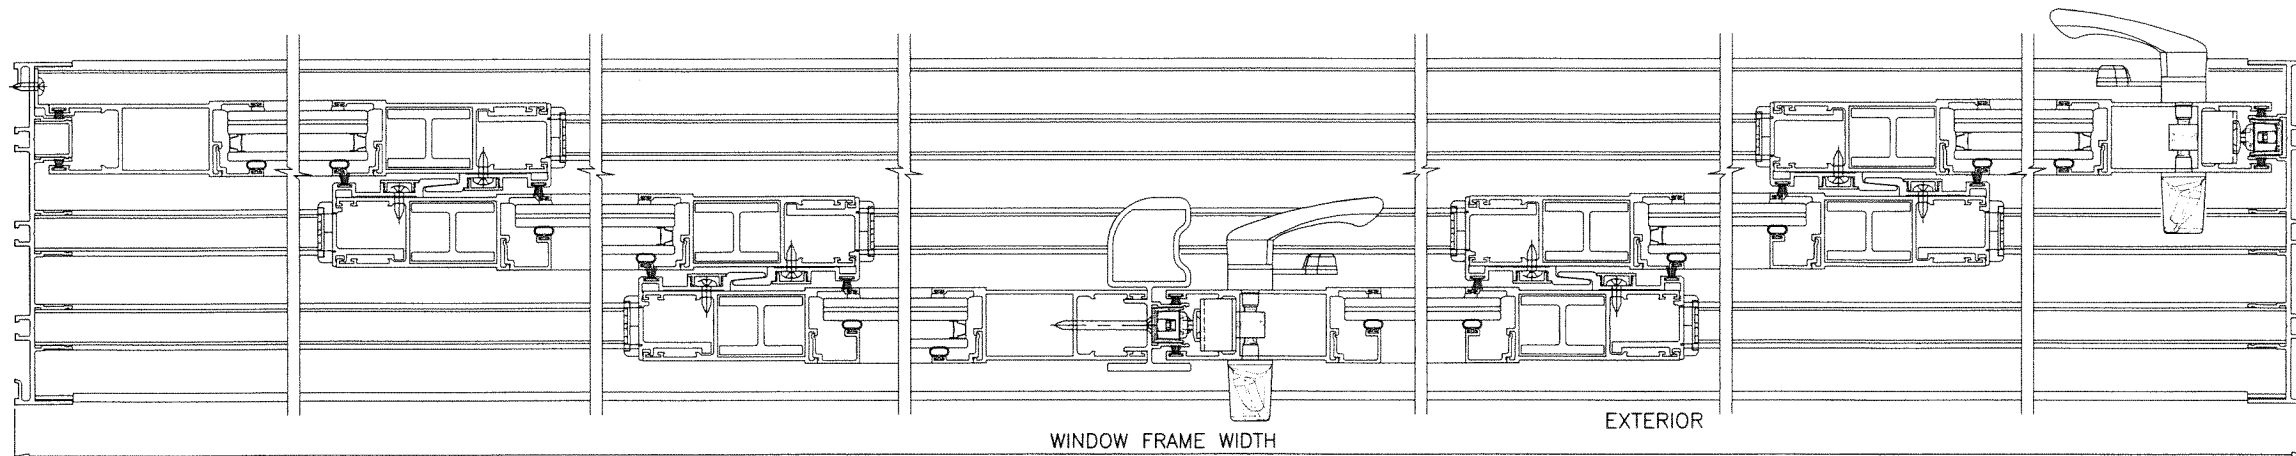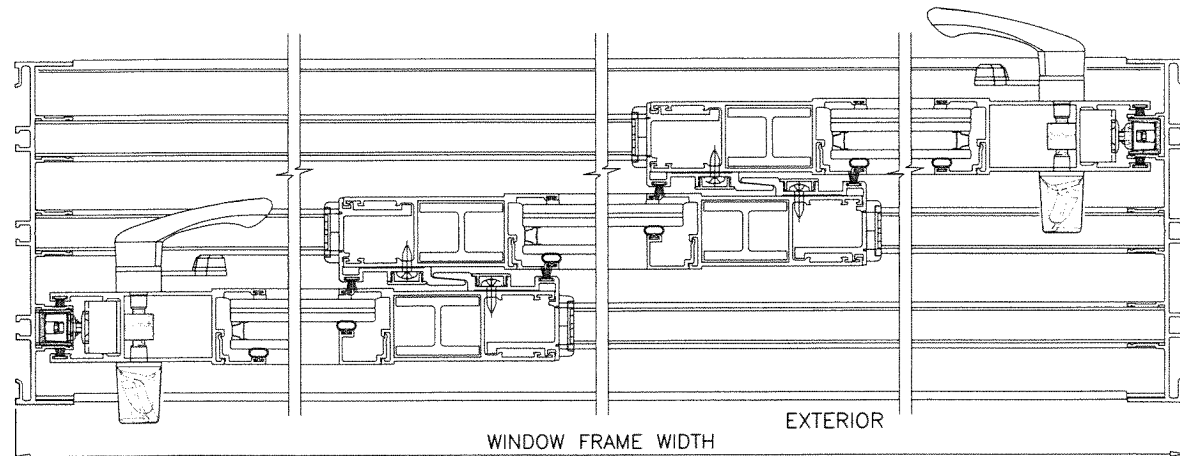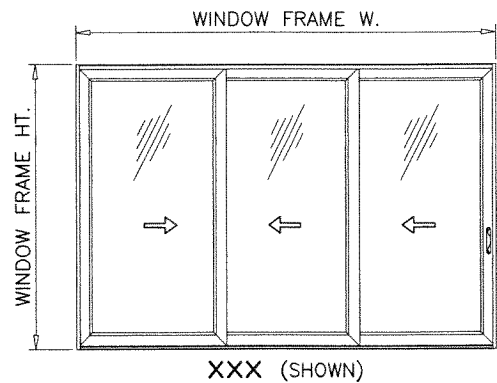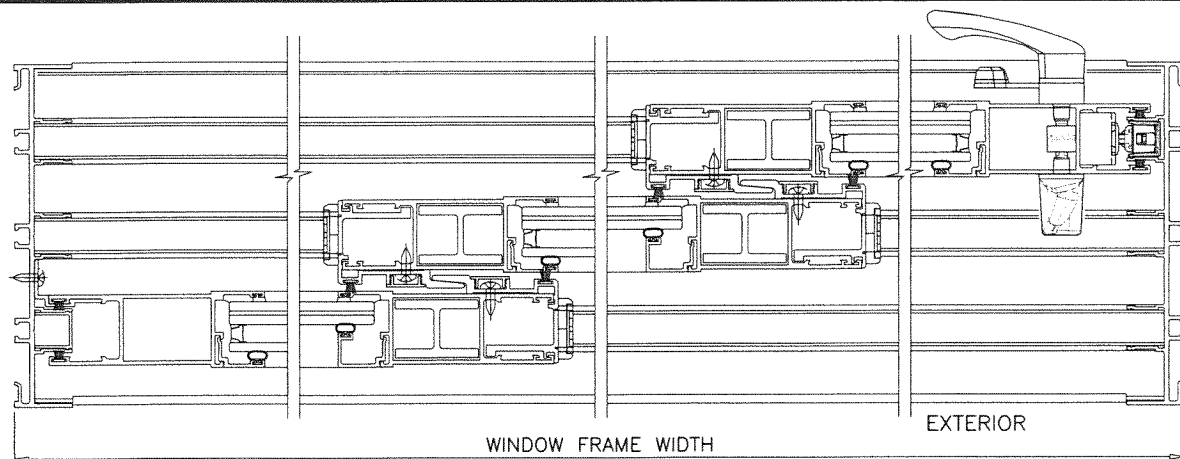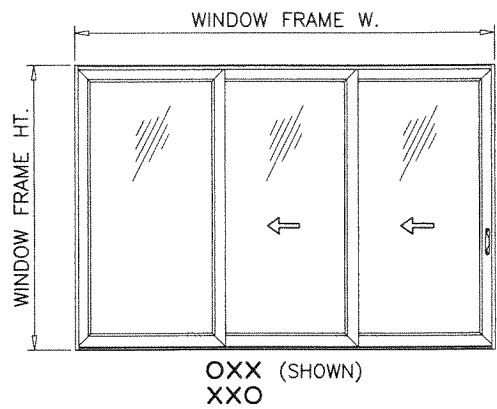

APPROVED CONFIGURATIONS
NON-POCKETED WINDOWS
3 TRACK FRAMES

- NOTE:
1. CONFIGURATIONS SHOWN FOR ILLUSTRATION PURPOSES ONLY.
 2. FOR APPLICABLE DESIGN PRESSURES SEE SHEET 1.
 3. FOR ANCHOR DETAILS SEE SHEETS 13 THRU 16.

PRODUCT REVISED
As complying with the Florida
Building Code
NOA-No. **26-0707.04**
Expiration Date: **09/02/2031**
By: *Manuel Perez*
Miami-Dade Product Control
JUL 06 2026

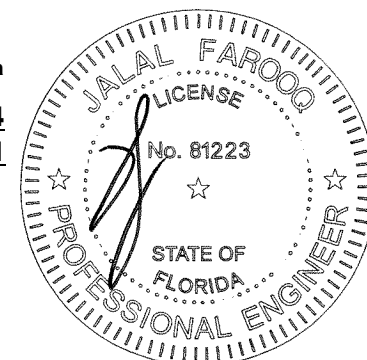


AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
C.A.N. 3538




S-3000 ALUM HORIZONTAL SLIDING WINDOW (L.M.I.)
Labrador & Fundora Corp.
dba-V & V Windows
14150 N.W. 56th Court, Suite 600
Opa-Locka, FL. 33054
Tel. (305) 888-4151
www.vvwindows.com

revisions:		no	date	by	description
		A	06.23.26		NO CHANGE THIS SHEET
date:	07-10-25	scale:	-	dr. by:	TARIQ
		chk. by:			
drawing no.	25-69D				
sheet	7 of 20				

COMP-ANL\25-69D-W

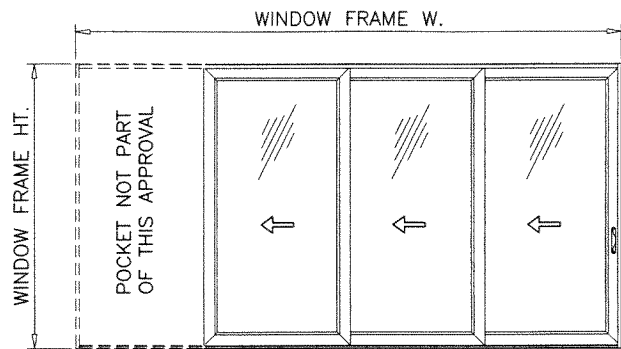

PXXX (SHOWN)
 XXXP
 PXXO
 OXXP

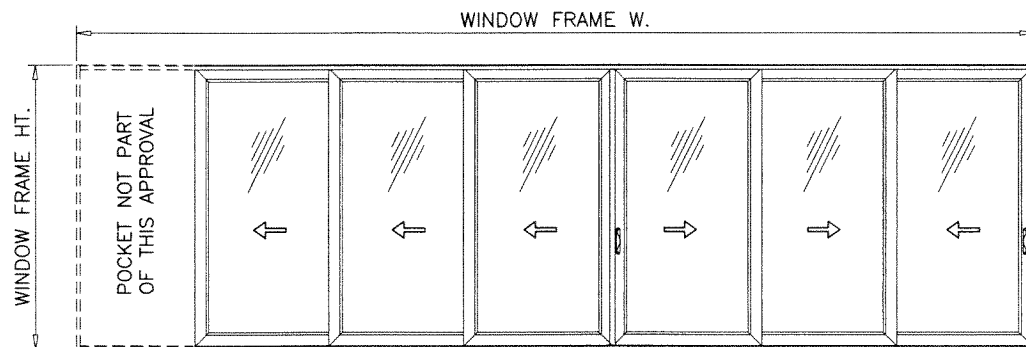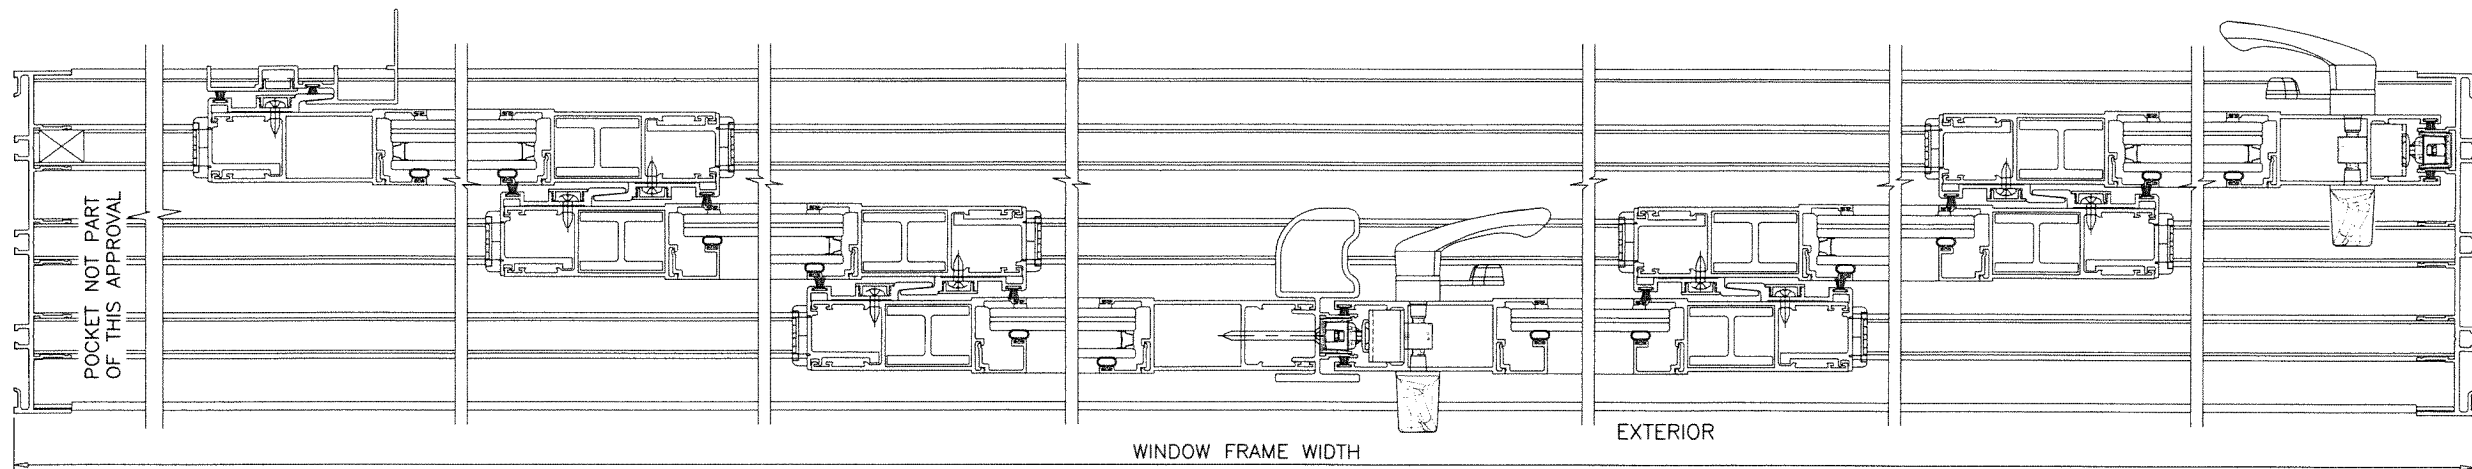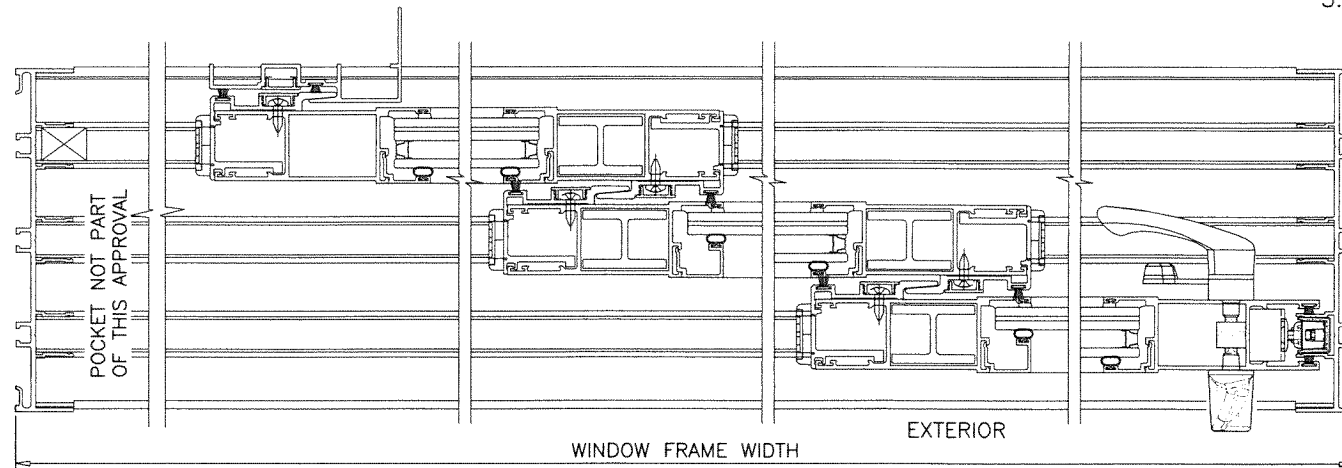

PXXX-XXX (SHOWN)
 XXX-XXXP
 PXXX-XXXO
 OXXX-XXXP

NOTE:

1. CONFIGURATIONS SHOWN FOR ILLUSTRATION PURPOSES ONLY.
2. FOR APPLICABLE DESIGN PRESSURES SEE SHEET 1.
3. FOR ANCHOR DETAILS SEE SHEETS 13 THRU 16.

af c

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173 (C.A.N. 3538)
 TEL. (305) 264-8100 FAX. (305) 262-6978

COMP-ANL 25-69D-V

S-3000 ALUM HORIZONTAL SLIDING WINDOW (L.M.I.)

Labrador & Fundora Corp.

dba-V & V Windows
 14150 N.W. 56th Court, Suite 600
 Opa-Locka, FL. 33054


Tel. (305) 888-4151 www.vvwindows.com

revisions:			
no	date	by	description
A	06.23.26		NO CHANGE THIS SHEET



date: 07-10-25	scale: -	dr. by: TARIQ	chk. by:
----------------	----------	---------------	----------

drawing no.
25-69D
 sheet 8 of 20

PRODUCT REVISED
 As complying with the Florida
 Building Code
 NOA-No. **26-0707.04**
 Expiration Date: **09/02/2031**
 By: *Manuel Perez*
 Miami-Dade Product Control
JUL 06 2026

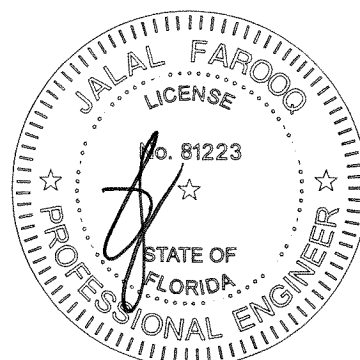

APPROVED CONFIGURATIONS
POCKETED WINDOWS
3 TRACK FRAMES

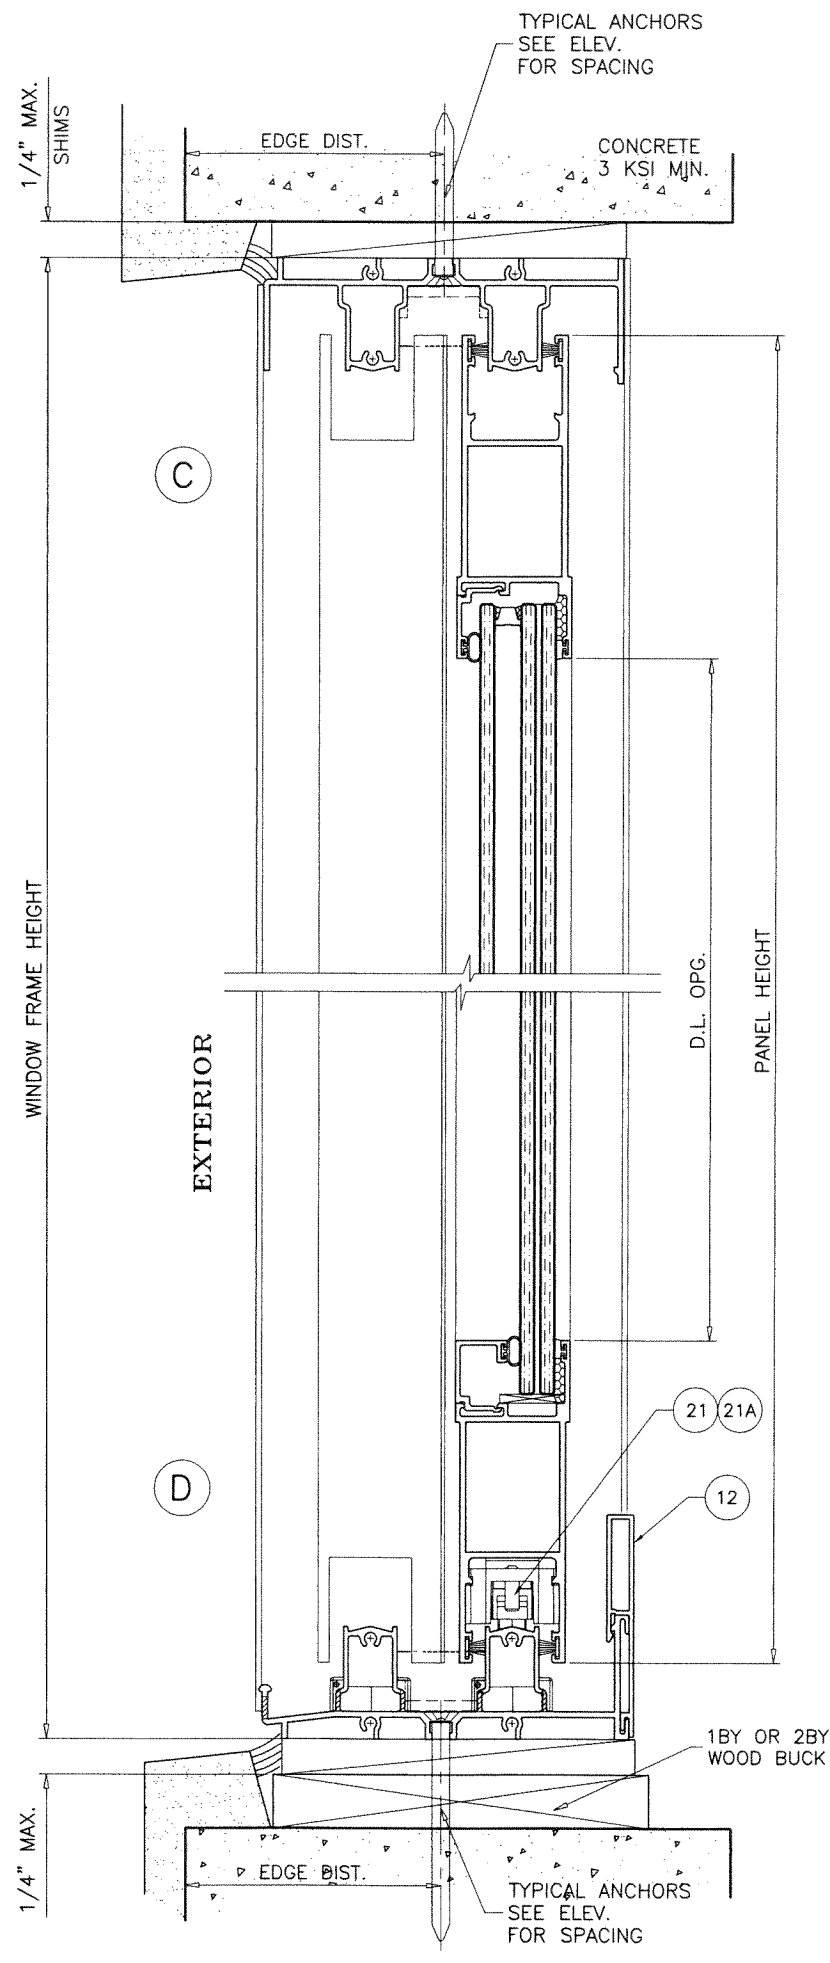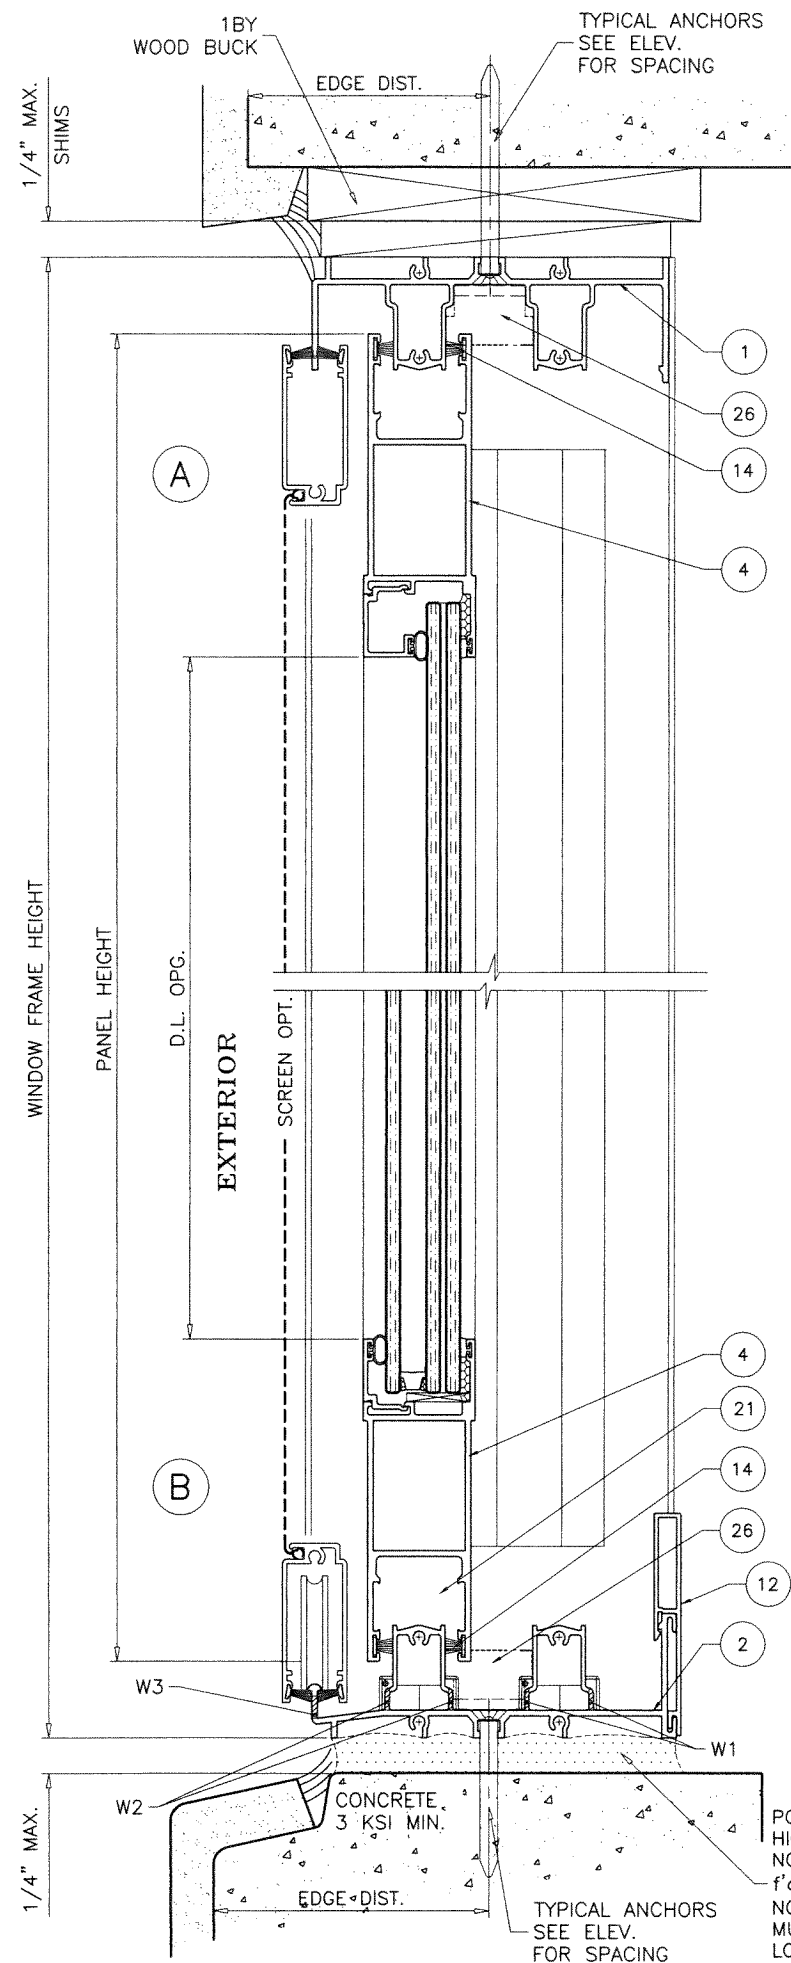


WEEPHOLES:

- W1 = 1-1/2" X 1/4" WEEP SLOTS
AT 7" FROM EACH END AND 34" O.C.
- W2 = 1-1/2" X 1/4" WEEP SLOTS
AT 5" FROM ENDS AND 24" O.C.
- W3 = 1-1/2" X 1/4" WEEP SLOTS
AT 7" FROM ENDS AND 24" O.C.

2 TRACK FRAMES

PRODUCT REVISED
As complying with the Florida Building Code
NOA-No. **26-0707.04**
Expiration Date: **09/02/2031**
By: *Manuel Perez*
Miami-Dade Product Control
JUL 06 2026



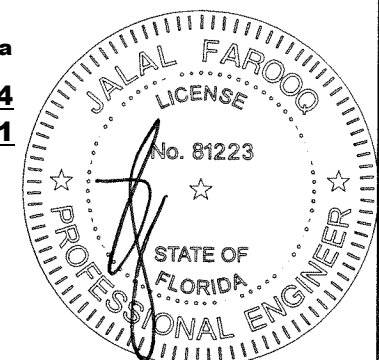


AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
C.A.N. 3538

S-3000 ALUM HORIZONTAL SLIDING WINDOW (L.M.I.)
Labrador & Fundora Corp.
dba-V & V Windows
14150 N.W. 56th Court, Suite 600
Opa-Locka, FL 33054
Tel. (305) 888-4151
www.vvwindows.com

revisions:		no	date	by	description
		A	06.23.26		NO CHANGE THIS SHEET
date:	07-10-25	scale:	3/8" = 1"	dr. by:	TARIQ
chk. by:		drawing no.	25-69D	sheet	9 of 20

COMP-ANL 25-69D-V

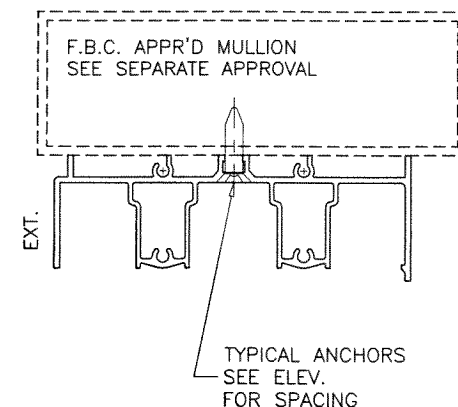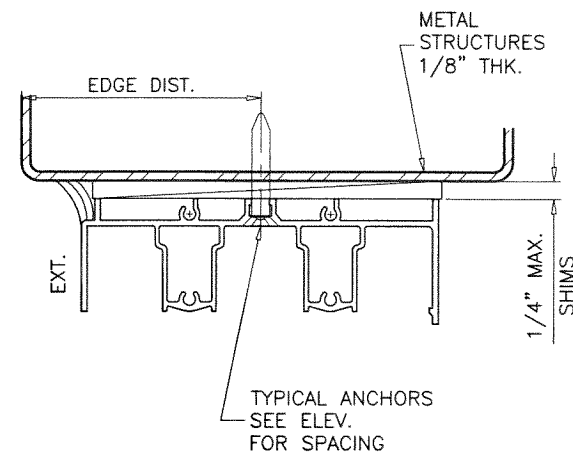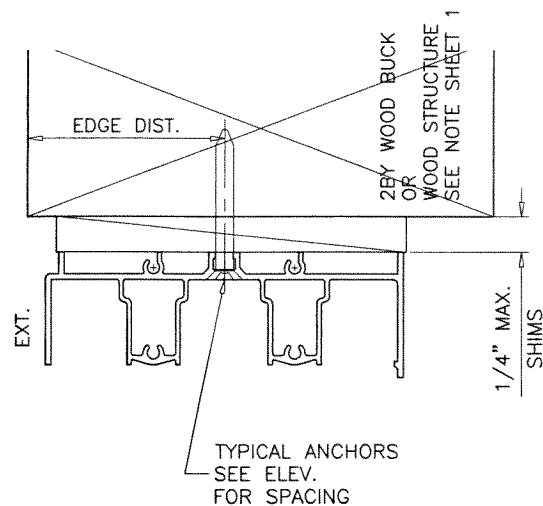

1BY OR 2BY WOOD BUCKS AND METAL STRUCTURE NOT BY 'V & V WINDOWS' MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)

INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
1-1/2" MIN. PENETRATION INTO WOOD (HEAD/JAMBS)

THRU 1BY BUCKS INTO CONC. OR BLOCKS
1-1/4" MIN. EMBED INTO CONCRETE (HEAD/JAMBS)
1-1/4" MIN. EMBED INTO BLOCKS (JAMBS)

DIRECTLY INTO CONCRETE OR BLOCKS
1-1/4" MIN. EMBED INTO CONCRETE (HEAD/SILL/JAMBS)
1-1/4" MIN. EMBED INTO BLOCKS (JAMBS)

1/4" DIA. TEKS OR SELF-DRILLING SCREWS (GRADE 5 CRS)

INTO MIAMI-DADE COUNTY APPROVED MULLIONS
AND
INTO METAL STRUCTURES (HEAD/JAMBS)
(3) THREADS MIN. TO EXTEND BEYOND METAL THICKNESS
ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)
STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.)
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

CRITICAL EDGE DISTANCE

INTO CONCRETE AND BLOCKS = 2-1/2" MIN.
INTO WOOD STRUCTURE = 5/8" MIN.
INTO METAL STRUCTURE = 1/2" MIN.

WOOD AT HEAD, SILL OR JAMBS SG = 0.55 MIN.
CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.
C-90 HOLLOW/FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

2 TRACK FRAMES

PRODUCT REVISED
As complying with the Florida
Building Code


NOA-No. **26-0707.04**

Expiration Date: **09/02/2031**

By: *Manuel Perez*

Miami-Dade Product Control

JUL 06 2026

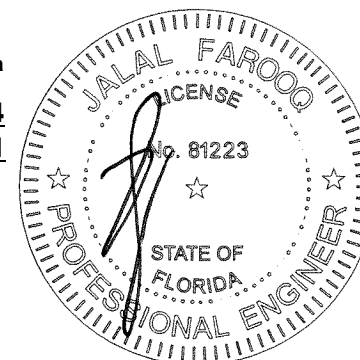

afc

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
(C.A.N. 3538)

COMP-ANL 25-69D-W

S-3000 ALUM HORIZONTAL SLIDING WINDOW (L.M.I.)

Labrador & Fundora Corp.

dba-V & V Windows

14150 N.W. 56th Court, Suite 600

Opa-Locka, FL 33054

Tel. (305) 888-4151

www.vvwindows.com



revisions:	no	date	by	description
	A	06.23.26		NO CHANGE THIS SHEET

date: 07-10-25	scale: 3/8" = 1"	dr. by: TARIQ	chk. by:
----------------	------------------	---------------	----------

drawing no.

25-69D


sheet 10 of 20

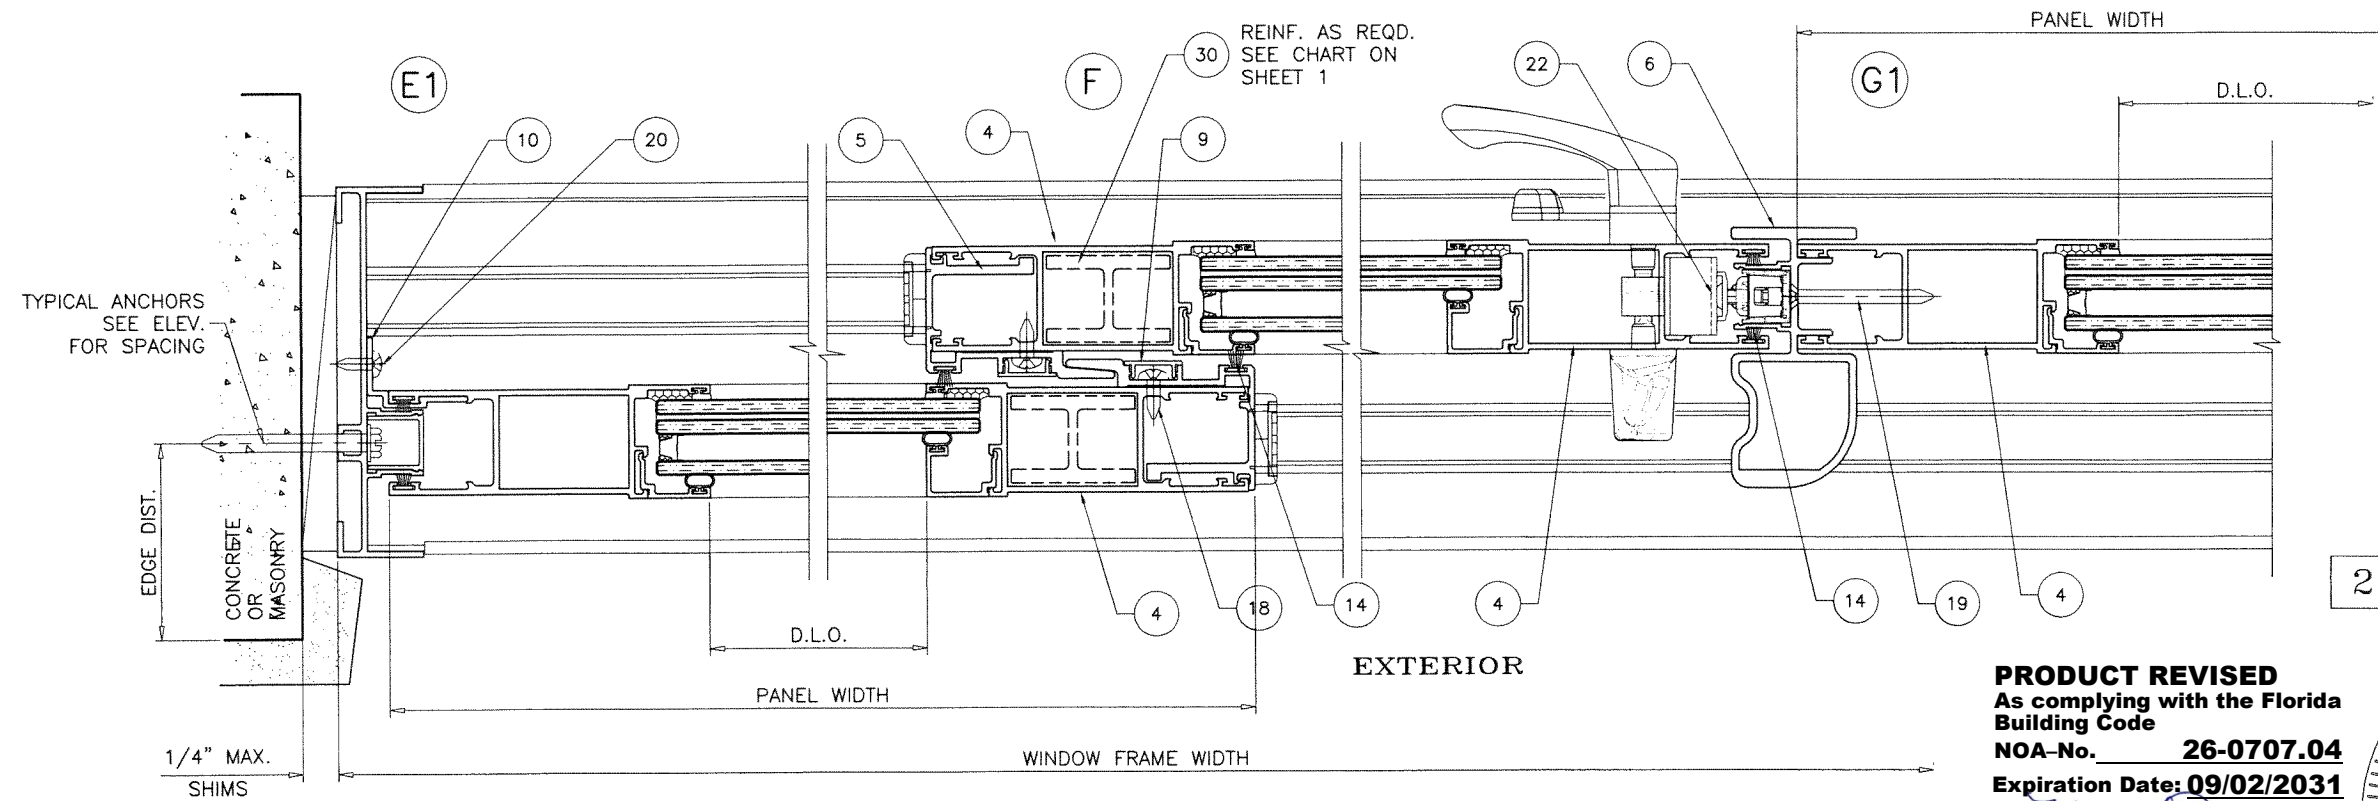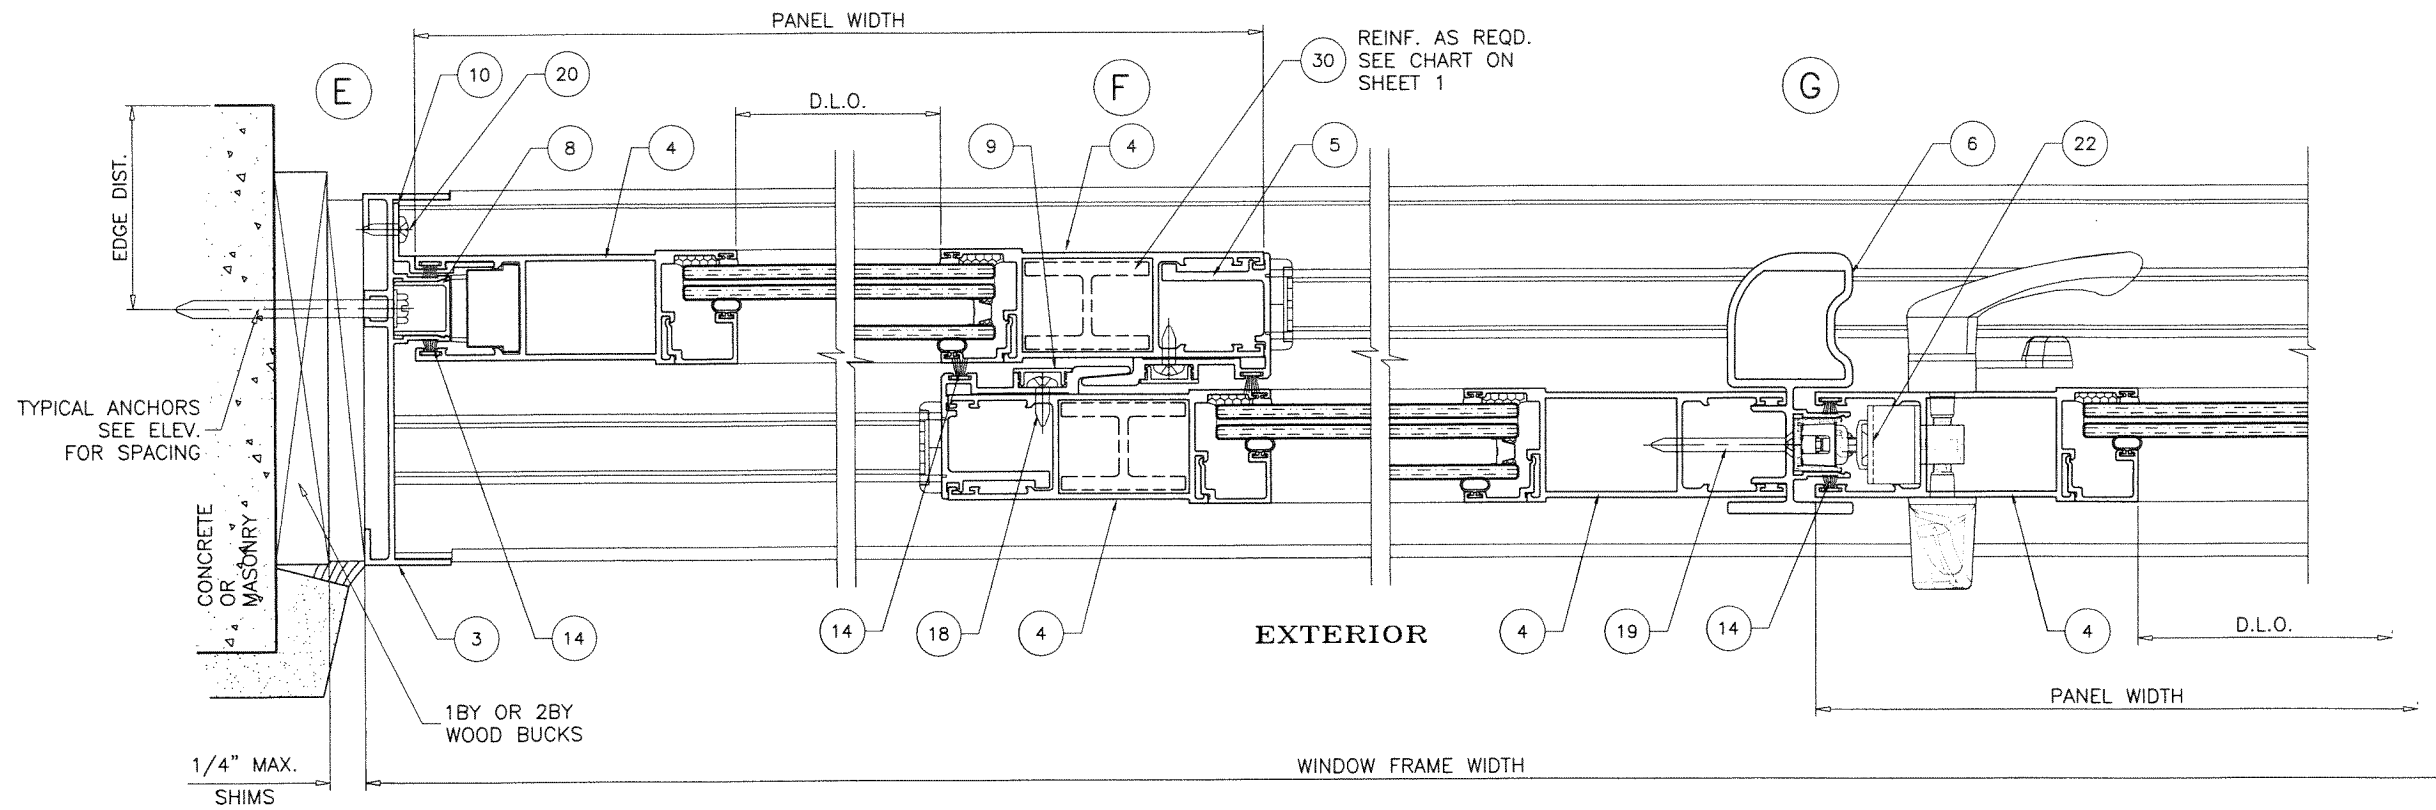

2 TRACK FRAMES

PRODUCT REVISED
As complying with the Florida Building Code
NOA-No. **26-0707.04**
Expiration Date: **09/02/2031**
By: *Manuel Perez*
Miami-Dade Product Control

JUL 06 2026


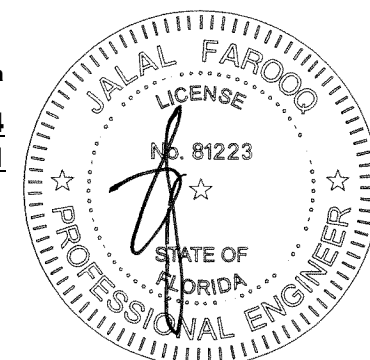


af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\25-69D-W

S-3000 ALUM HORIZONTAL SLIDING WINDOW (L.M.I.)

Labrador & Fundora Corp.
dbo-V & V Windows
14150 N.W. 56th Court, Suite 600
Opa-Locka, FL 33054
Tel. (305) 888-4151
www.vvwindows.com


revisions:		no	date	by	description
		A	06.23.26		NO CHANGE THIS SHEET
date:	07-10-25	scale:	3/8" = 1"	dr. by:	TARIQ
chk. by:					
drawing no.	25-69D				
sheet	11 of 20				

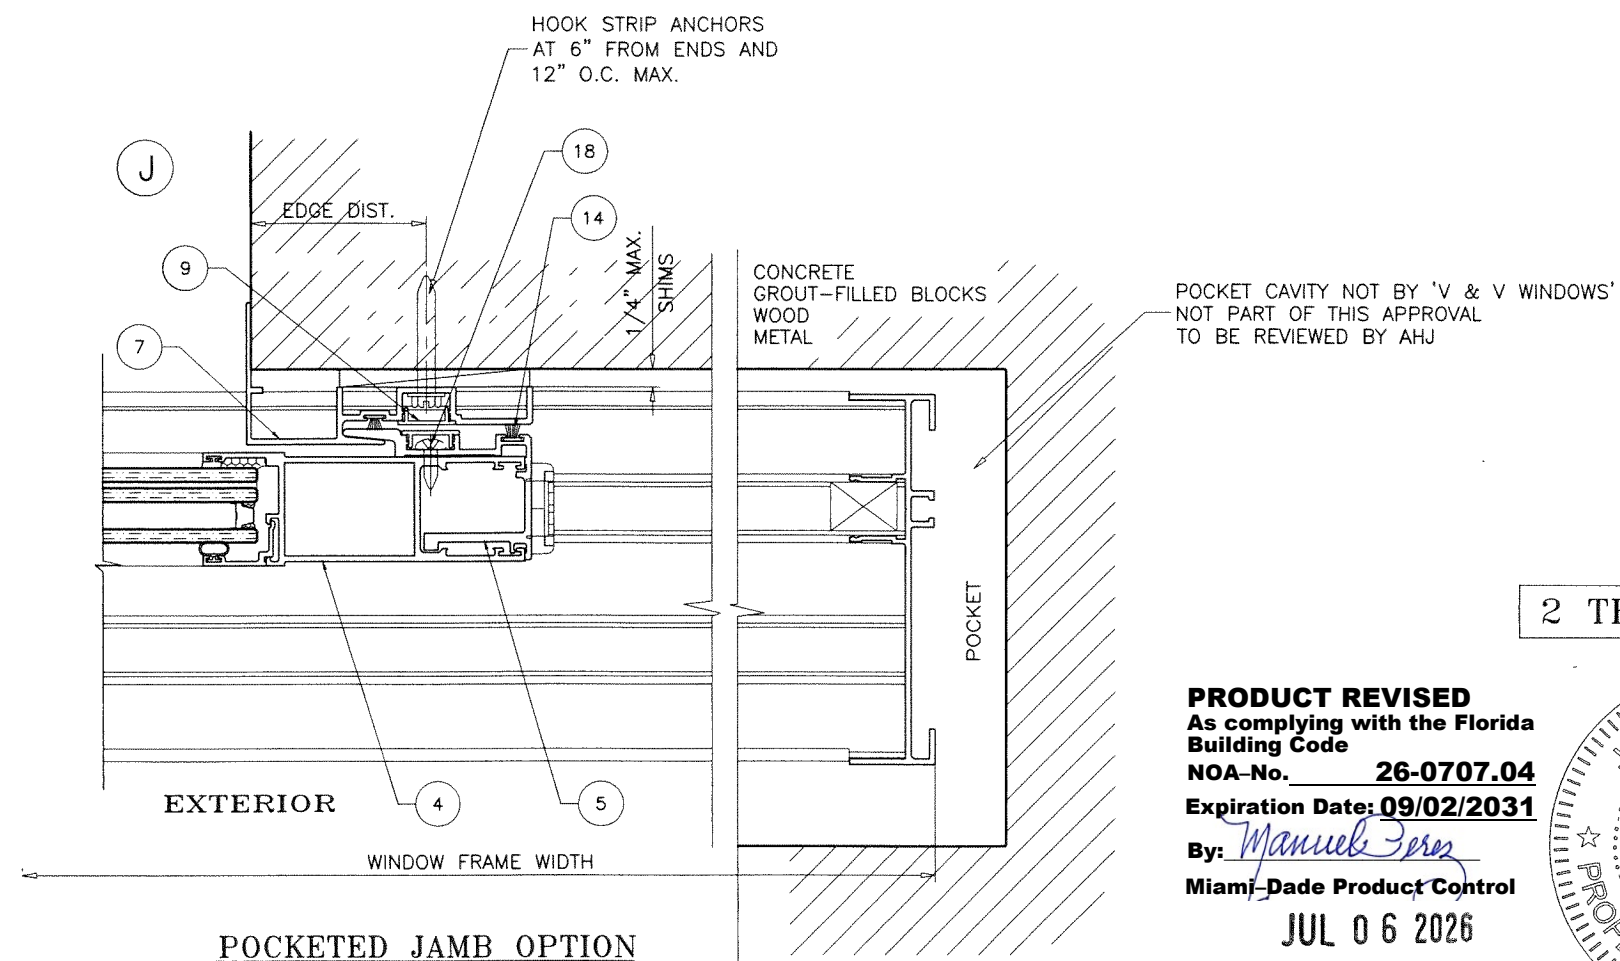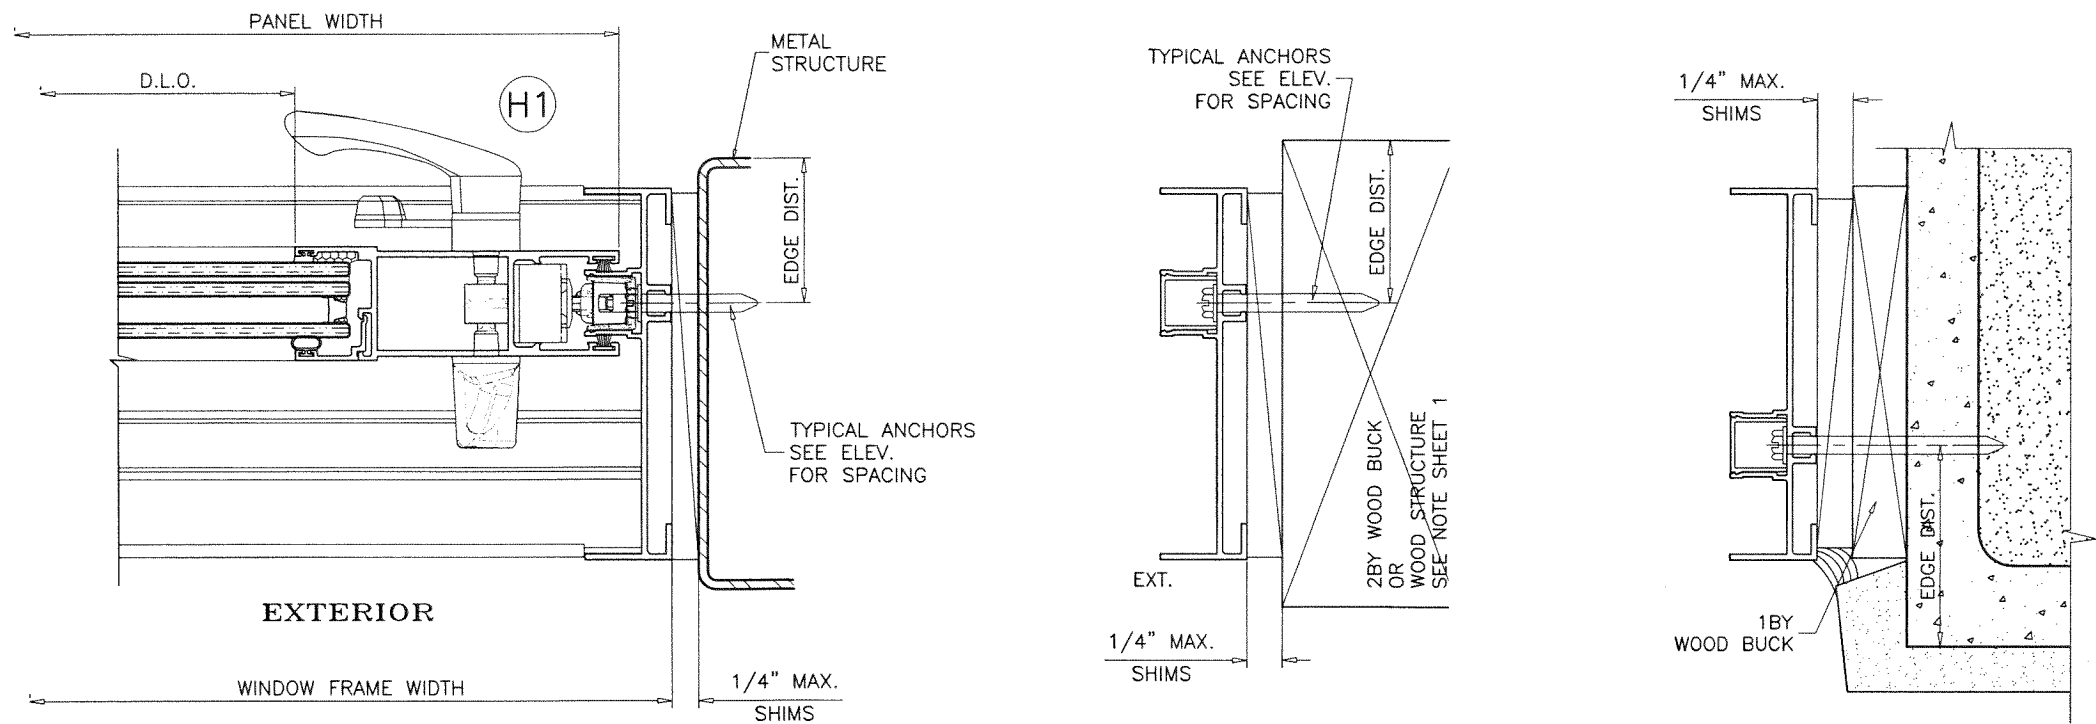

HOOK STRIP ANCHORS: SEE ELEV. FOR SPACING

PRODUCT REVISED
As complying with the Florida
Building Code
NOA-No. 26-0707.04
Expiration Date: 09/02/2031
By: Manuel Perez
Miami-Dade Product Control

JUL 06 2026

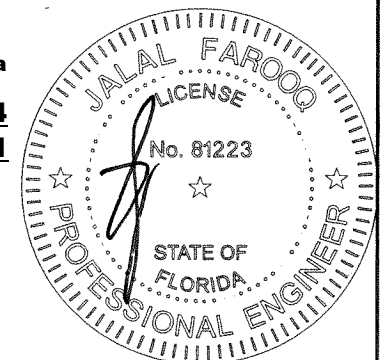

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978

S-3000 ALUM HORIZONTAL SLIDING WINDOW (L.M.I.)

Labrador & Fundora Corp.
dba-V & V Windows
14150 N.W. 56th Court, Suite 600
Opa-Locka, FL 33054
Tel. (305) 888-4151
www.vv.com

www.vvwindows.com

Tel. (305) 888-4151

[illegible]

date: 07-10-25


scale: $3/8" = 1"$

dr. by: TARIQ

chk. by:

drawing no.
25-69D

sheet 12 of 20



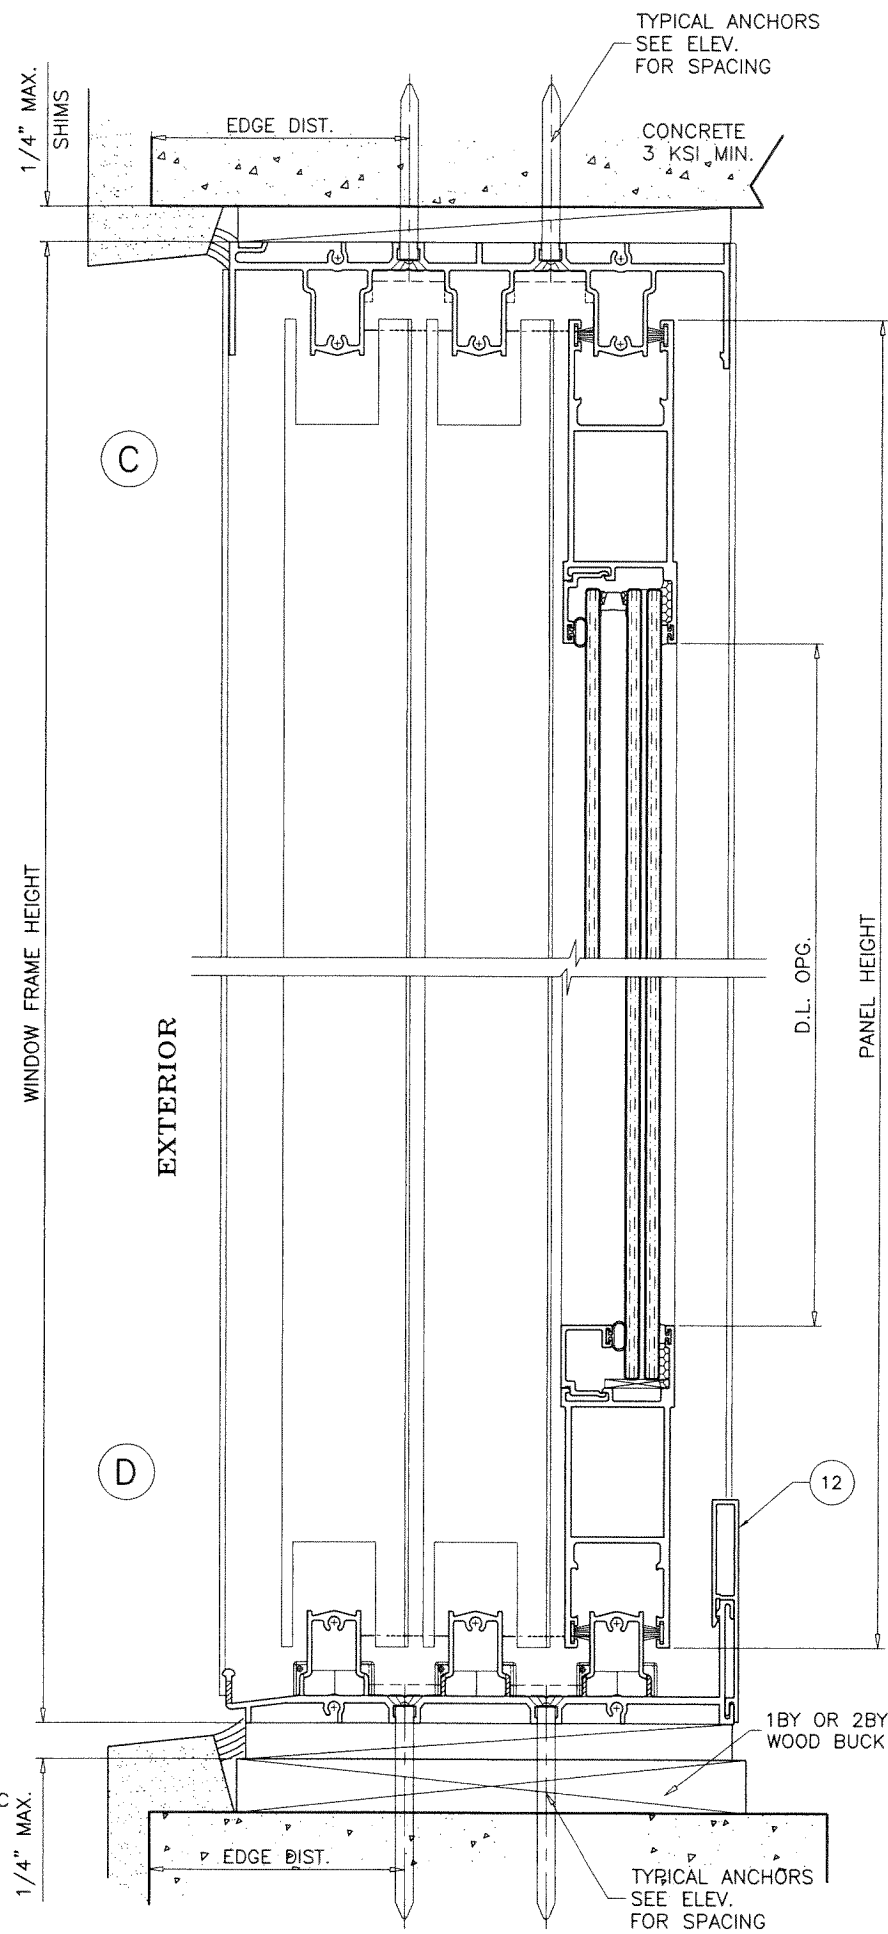


A circular professional engineer seal for the State of Florida. The outer ring contains the text "JALAL FAROOQ" at the top and "PROFESSIONAL ENGINEER" at the bottom, separated by two stars. Inside this ring, the word "LICENSE" is at the top and "STATE OF FLORIDA" is at the bottom, also separated by two stars. In the center, the license number "No. 81223" is printed. A stylized signature is written across the center of the seal, overlapping the license number and the words "LICENSE" and "STATE OF FLORIDA".

COMP--ANL\25--69D--W

drawing no.
25-69D

sheet 13 of 20

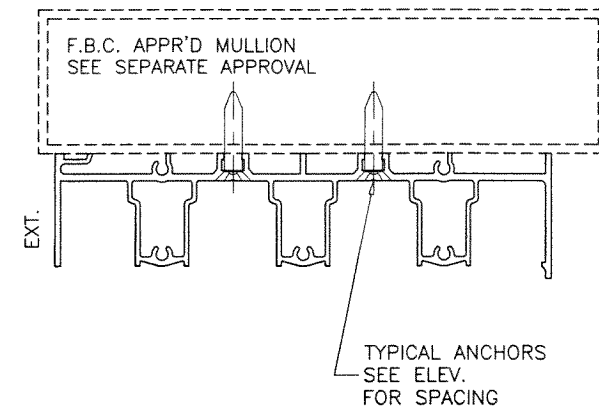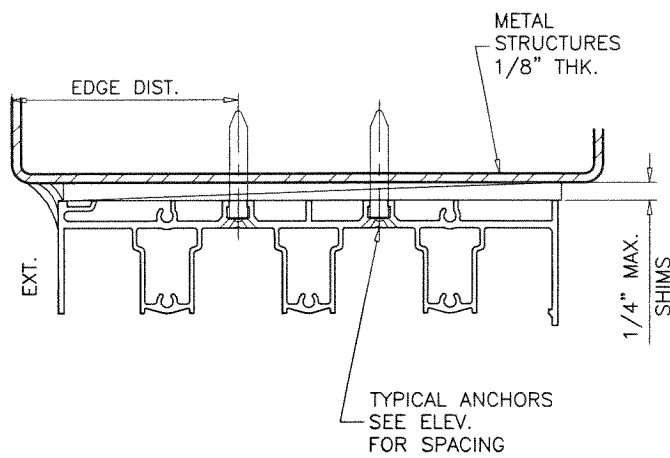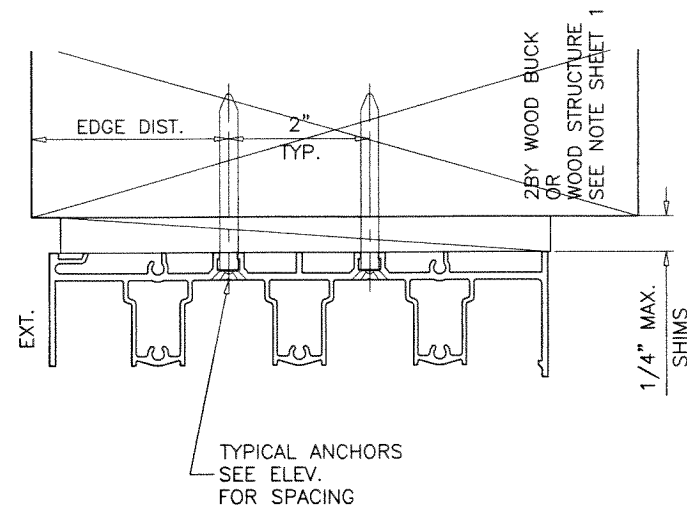

1BY OR 2BY WOOD BUCKS AND METAL STRUCTURE NOT BY 'V & V WINDOWS' MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

1/4\" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)

INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
1-1/2\" MIN. PENETRATION INTO WOOD (HEAD/JAMBS)

THRU 1BY BUCKS INTO CONC. OR BLOCKS
1-1/4\" MIN. EMBED INTO CONCRETE (HEAD/JAMBS)
1-1/4\" MIN. EMBED INTO BLOCKS (JAMBS)

DIRECTLY INTO CONCRETE OR BLOCKS
1-1/4\" MIN. EMBED INTO CONCRETE (HEAD/SILL/JAMBS)
1-1/4\" MIN. EMBED INTO BLOCKS (JAMBS)

1/4\" DIA. TEKS OR SELF-DRILLING SCREWS (GRADE 5 CRS)

INTO MIAMI-DADE COUNTY APPROVED MULLIONS
AND
INTO METAL STRUCTURES (HEAD/JAMBS)
(3) THREADS MIN. TO EXTEND BEYOND METAL THICKNESS
ALUMINUM: 1/8\" THK. MIN. (6063-T5 MIN.)
STEEL: 1/8\" THK. MIN. (Fy = 36 KSI MIN.)
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)


CRITICAL EDGE DISTANCE

INTO CONCRETE AND BLOCKS = 2-1/2\" MIN.
INTO WOOD STRUCTURE = 5/8\" MIN.
INTO METAL STRUCTURE = 1/2\" MIN.

WOOD AT HEAD, SILL OR JAMBS SG = 0.55 MIN.
CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.
C-90 HOLLOW/FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

3 TRACK FRAMES



PRODUCT REVISED
As complying with the Florida
Building Code
NOA-No. **26-0707.04**
Expiration Date: **09/02/2031**
By: *Manuel Perez*
Miami-Dade Product Control
JUL 06 2026

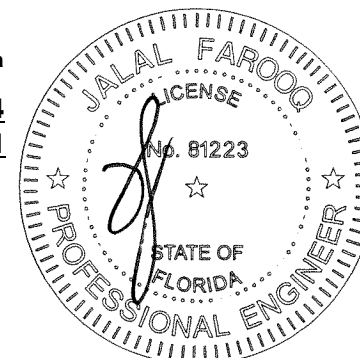

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL 25-69D-W


S-3000 ALUM HORIZONTAL SLIDING WINDOW (L.M.I.)
Labrador & Fundora Corp.
dba-V & V Windows
14150 N.W. 56th Court, Suite 600
Opa-Locka, FL 33054
Tel. (305) 888-4151
www.vvwindows.com

revisions:		no	date	by	description
		A	06.23.26		NO CHANGE THIS SHEET
date:	07-10-25	scale:	3/8" = 1"	dr. by:	TARIO
				chk. by:	
drawing no.		25-69D			
sheet		14 of 20			

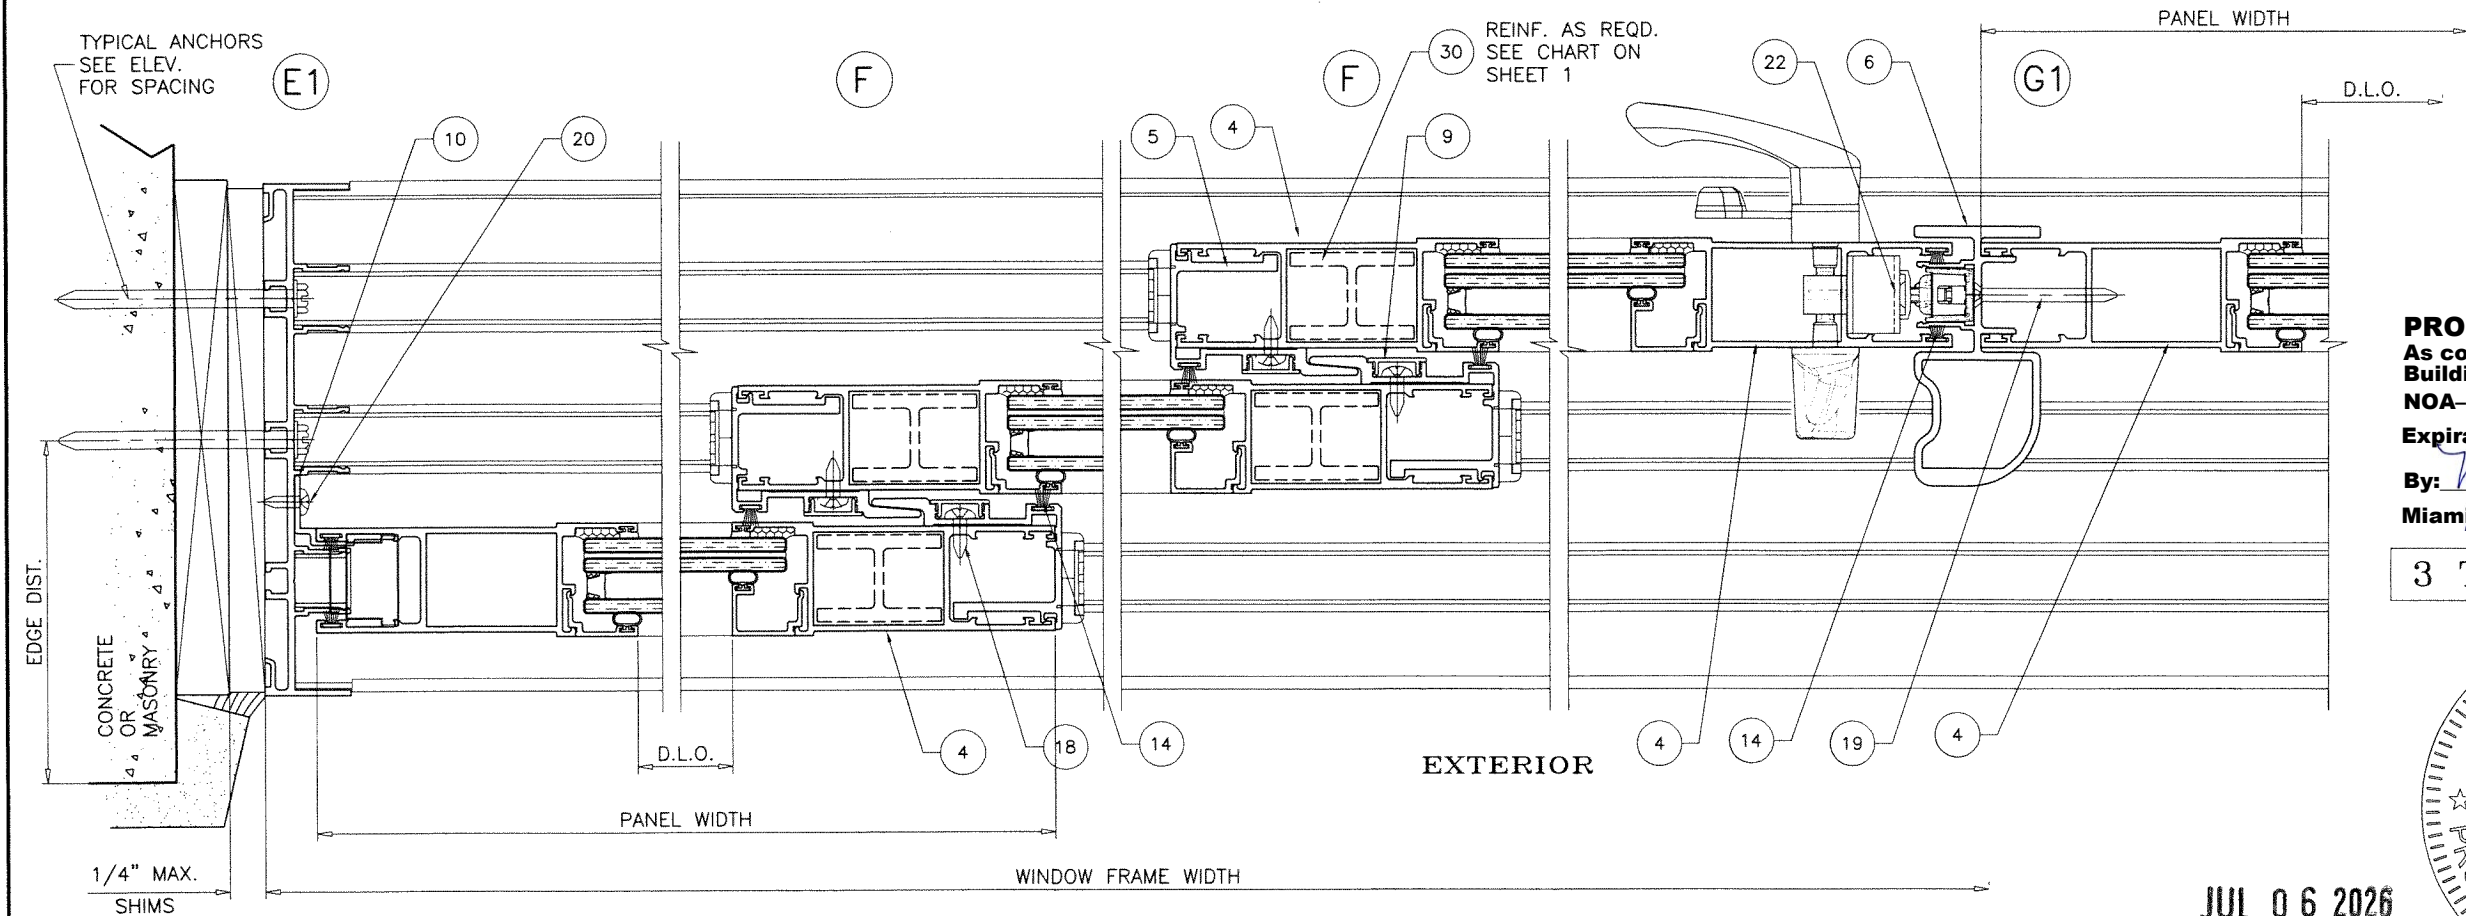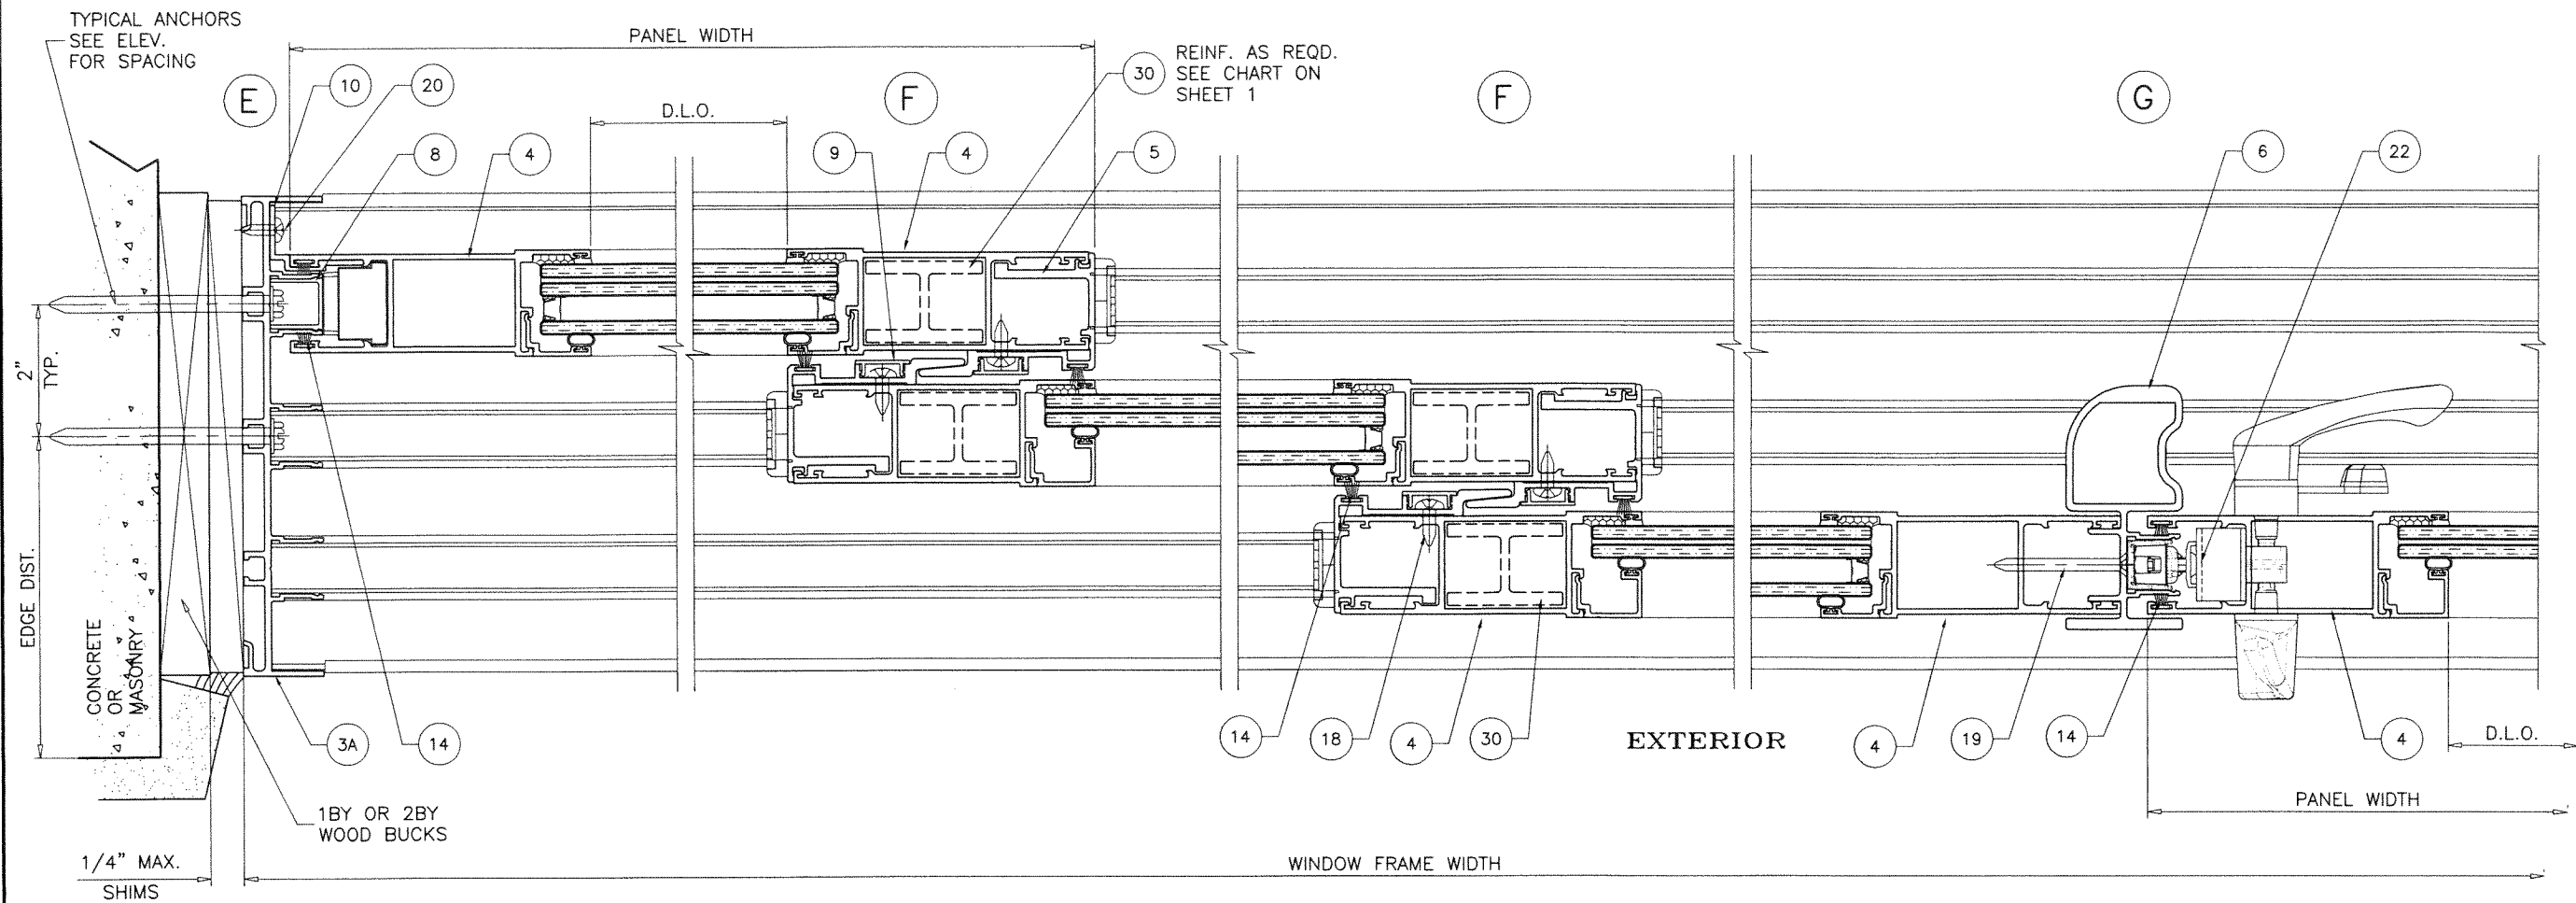

PRODUCT REVISED
 As complying with the Florida
 Building Code
 NOA-No. **26-0707.04**
 Expiration Date: **09/02/2031**
 By: *Manuel Torres*
 Miami-Dade Product Control

3 TRACK FRAMES




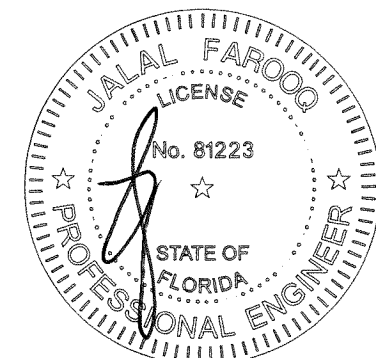


JUL 06 2026

af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173 (C.A.N. 3538)
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\25-69D-W

S-3000 ALUM HORIZONTAL SLIDING WINDOW (L.M.I.)
Labrador & Fundora Corp.
dba-V & V Windows
 14150 N.W. 56th Court, Suite 600
 Opa-Locka, FL 33054
 Tel. (305) 888-4151
 www.vvwindows.com

revisions:		no	date	by	description
		A	06.23.26		NO CHANGE THIS SHEET
date:	07-10-25	scale:	3/8" = 1"	dr. by:	TARIQ
chk. by:		drawing no.	25-69D	sheet	15 of 20

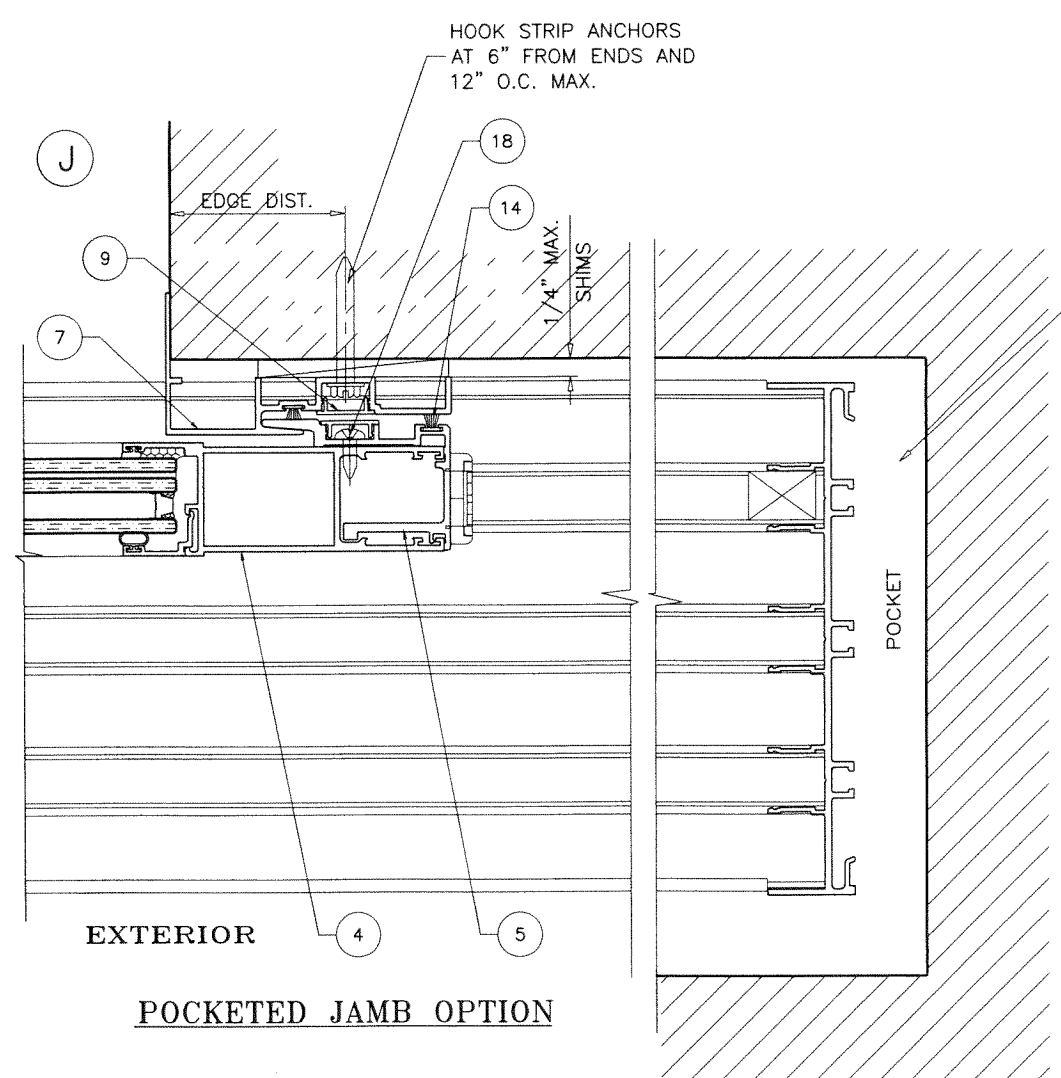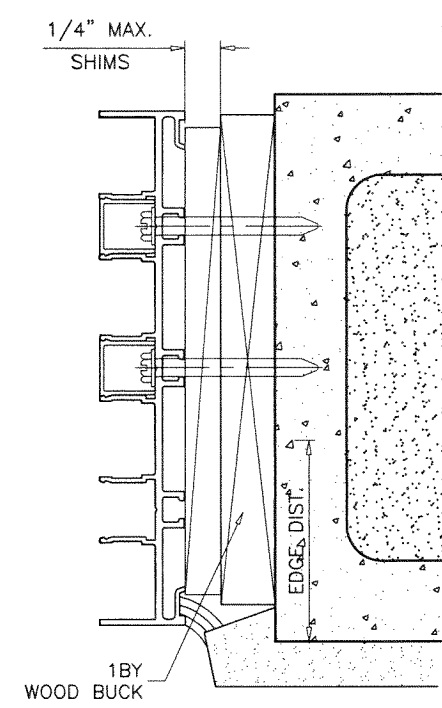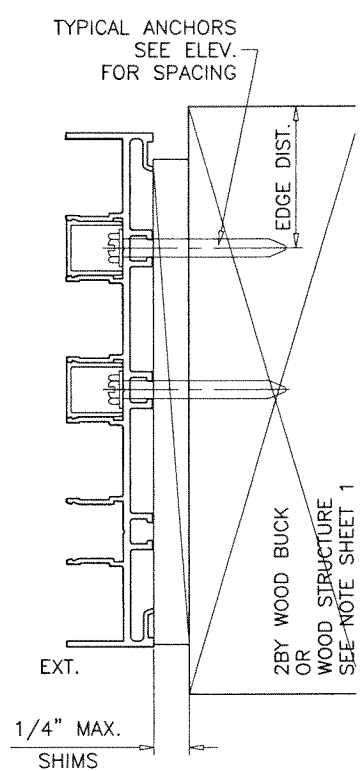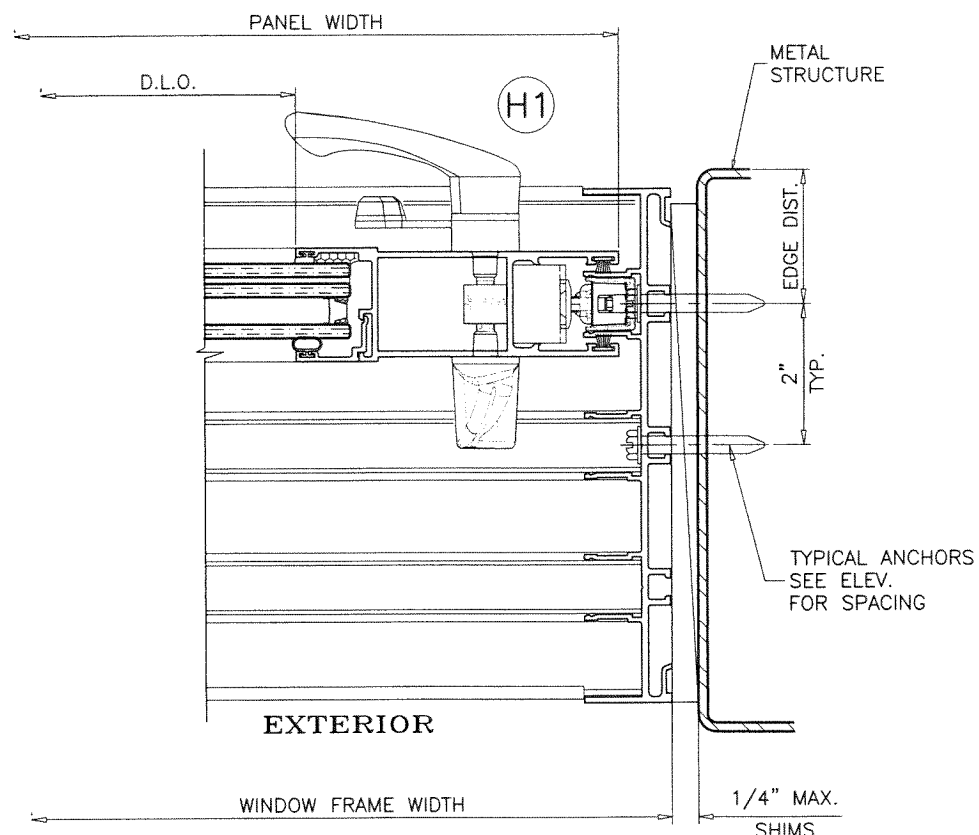

POCKET CAVITY NOT BY 'V & V WINDOWS'
NOT PART OF THIS APPROVAL
TO BE REVIEWED BY AHJ

HOOK STRIP ANCHORS: SEE ELEV. FOR SPACING
1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)
 DIRECTLY INTO CONCRETE OR BLOCKS
 1-3/8" MIN. EMBED INTO CONCRETE
 1-3/4" MIN. EMBED INTO GROUT-FILLED BLOCKS


#14 SMS (GRADE 2 CRS)
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 1-1/2" MIN. PENETRATION INTO WOOD

#14 SMS OR SELF DRILLING SCREWS (GRADE 2 CRS)
 INTO METAL STRUCTURES
 (3) THREADS MIN. PENETRATION BEYOND SUBSTRATE
 ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)
 STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL EDGE DISTANCE
 INTO CONCRETE AND BLOCKS = 2" MIN.
 INTO WOOD STRUCTURE = 1" MIN.
 INTO METAL STRUCTURE = 3/4" MIN.

PRODUCT REVISED
 As complying with the Florida
 Building Code
NOA-No. 26-0707.04
Expiration Date: 09/02/2031
 By: *Manuel Perez*
 Miami-Dade Product Control

3 TRACK FRAMES

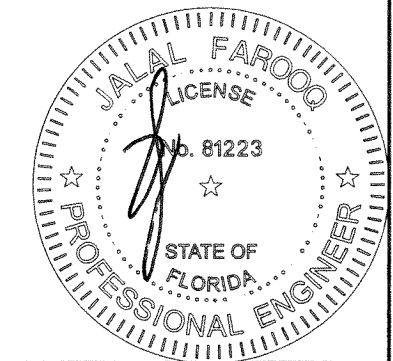

JUL 06 2026

af c

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173 (C.A.N. 3538)
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\25-69D-W

S-3000 ALUM HORIZONTAL SLIDING WINDOW (L.M.I.)

Labrador & Fundora Corp.
 dba-V & V Windows
 14150 N.W. 56th Court, Suite 600
 Opa-Locka, FL. 33054
 Tel. (305) 888-4151
 www.vvwindows.com

revisions:		no	date	by	description
		A	06.23.26		NO CHANGE THIS SHEET

date: 07-10-25

scale: 3/8" = 1"


dr. by: TARIQ

chk. by:


drawing no.

25-69D

sheet 16 of 20

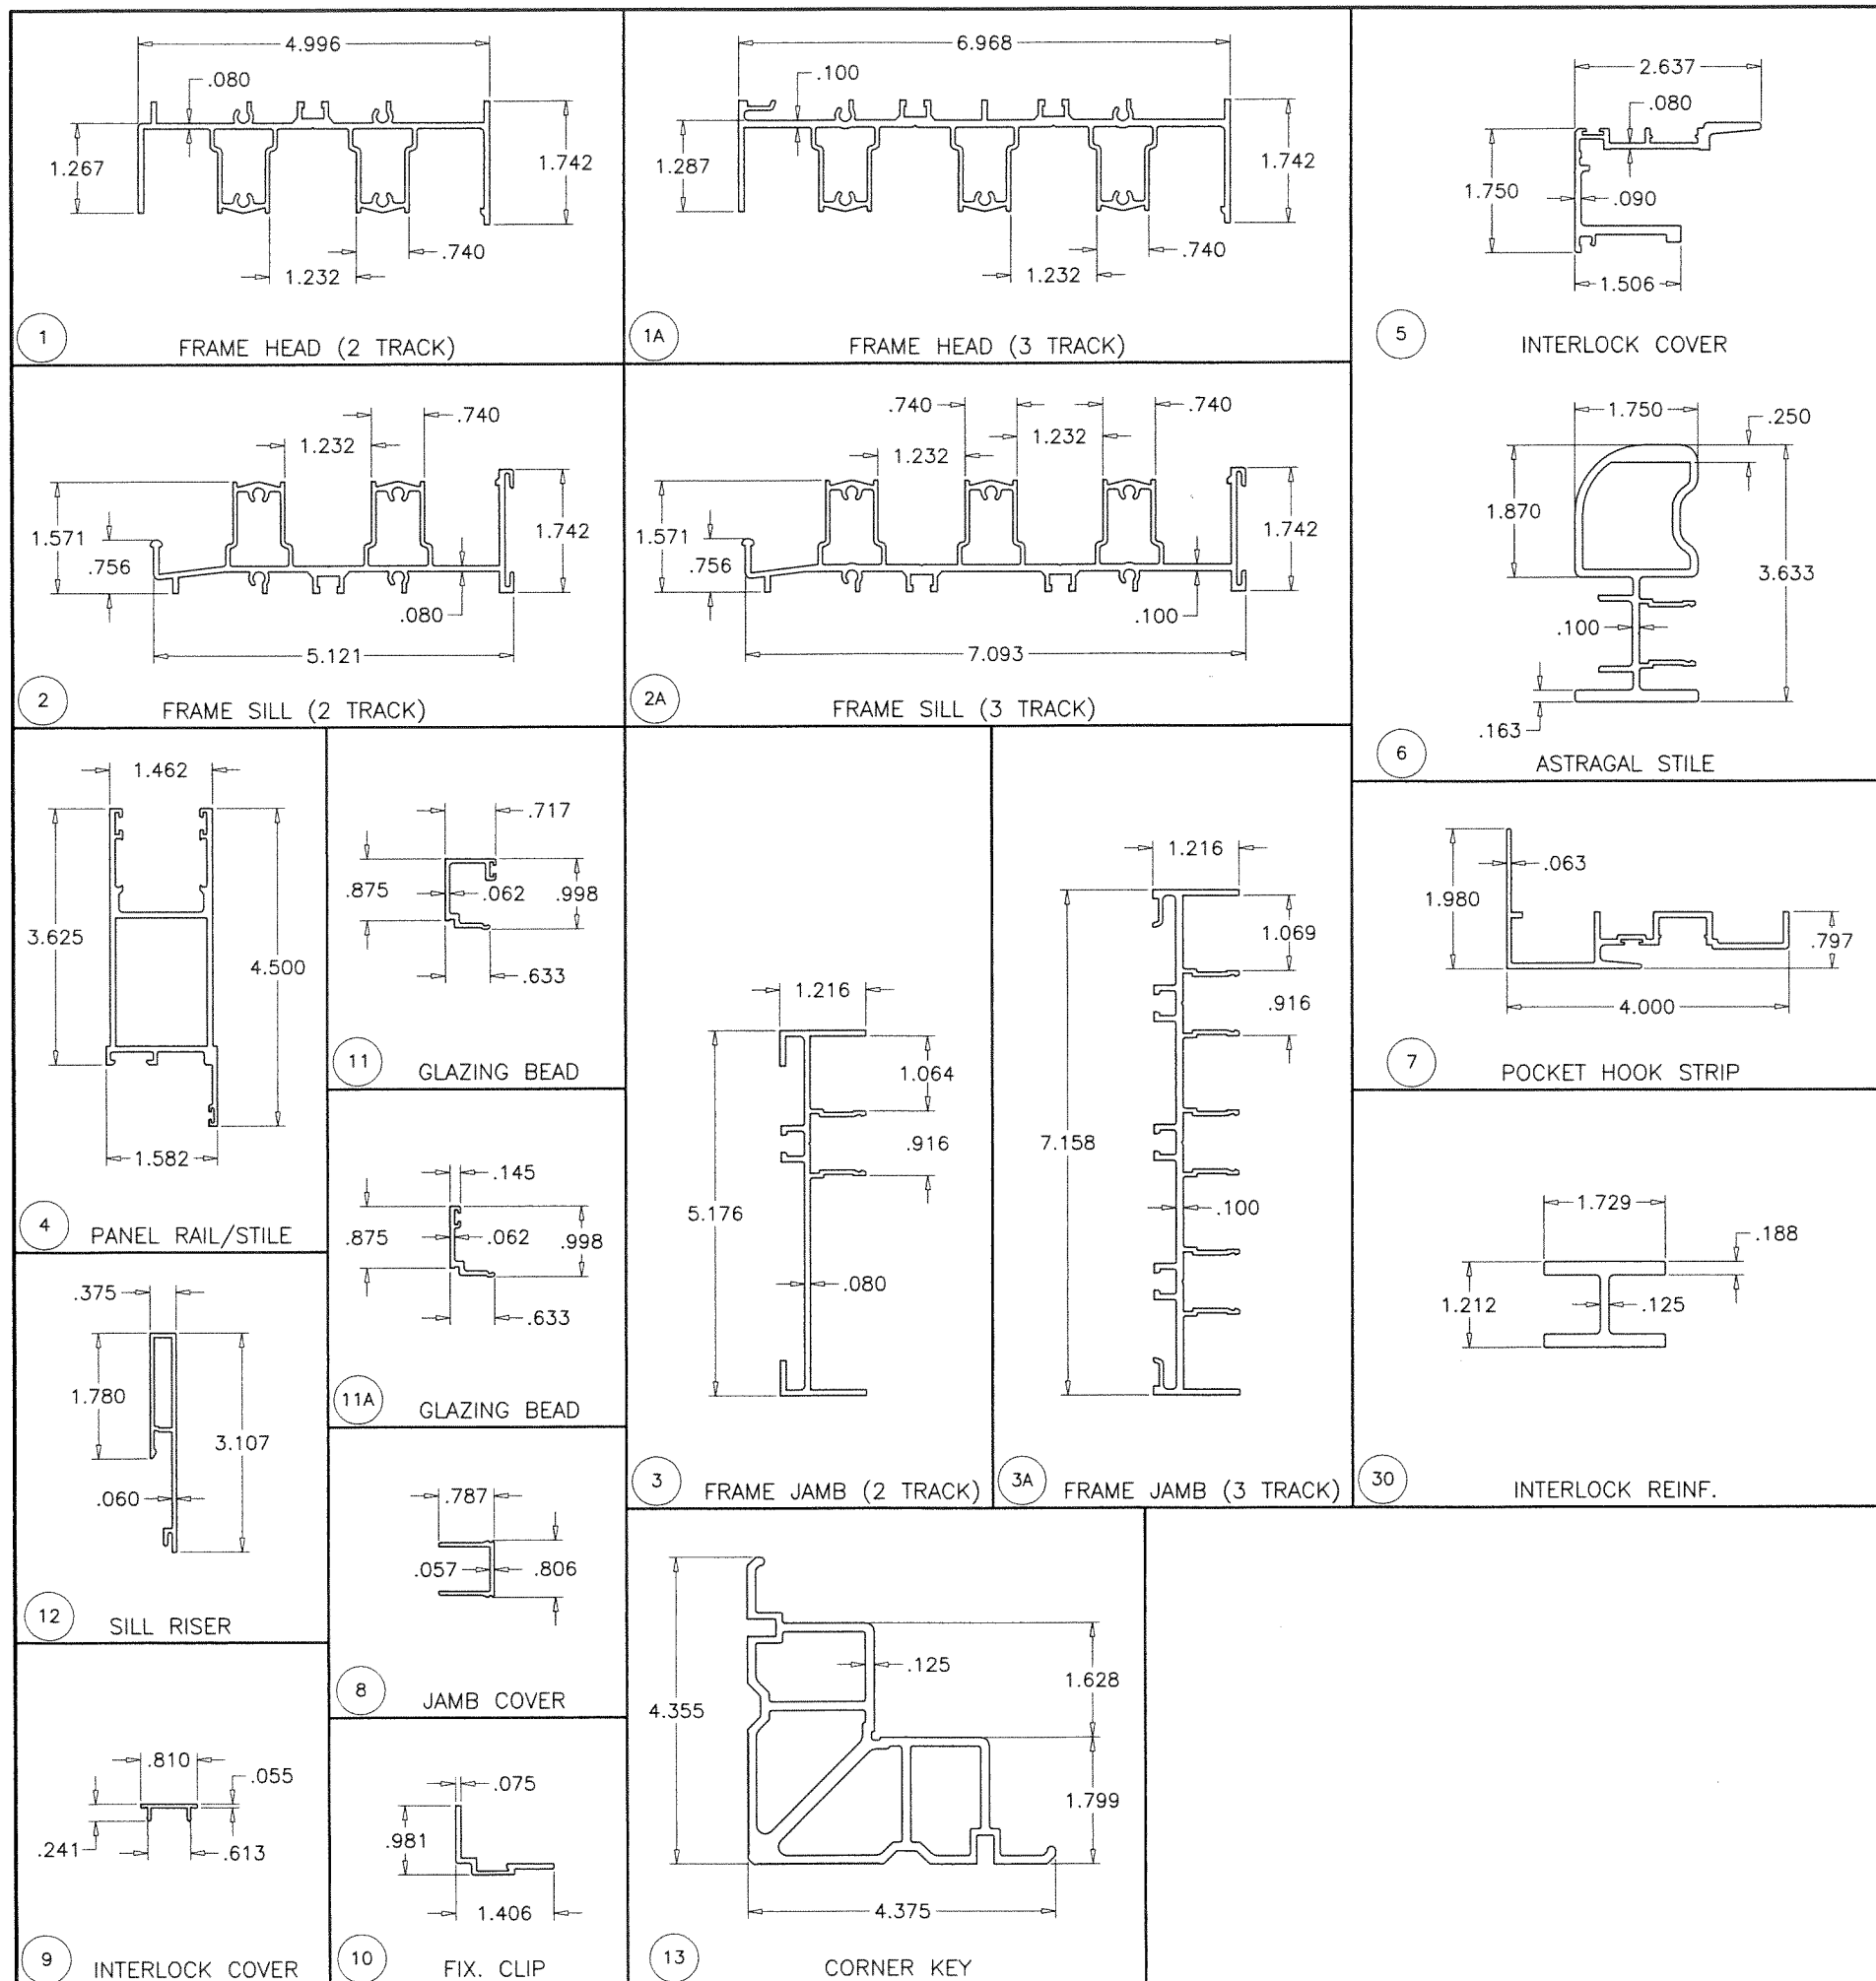

PRODUCT REVISED
 As complying with the Florida
 Building Code
 NOA-No. **26-0707.04**
 Expiration Date: **09/02/2031**
 By: *Manuel Perez*
 Miami-Dade Product Control
 JUL 06 2026

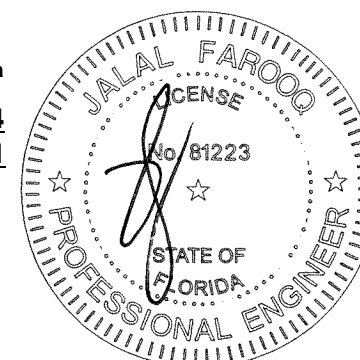

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173
 TEL. (305) 262-6978 FAX. (305) 262-6978
 COMP-ANL\25-69D-W

S-3000 ALUM HORIZONTAL SLIDING WINDOW (L.M.I.)

Labrador & Fundora Corp.
 dba-V & V Windows
 14150 N.W. 56th Court, Suite 600
 Opa-Locka, FL. 33054
 Tel. (305) 888-4151
 www.vvwindows.com

revisions:	no	date	by	description
	A	06.23.26		NO CHANGE THIS SHEET

date: 07-10-25
 scale: 3/8" = 1"
 dr. by: TARIQ
 chk. by:

drawing no.
25-69D
 sheet 17 of 20

ITEM #	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	E-3003	1	FRAME HEAD (2 TRACK)	6063-T6	-
1A	VV3028	1	FRAME HEAD (3 TRACK)	6063-T6	-
2	E-3002	1	FRAME SILL (2 TRACK)	6063-T6	-
2A	VV3030	1	FRAME SILL (3 TRACK)	6063-T6	-
3	E-3005	2	FRAME JAMB (2 TRACK)	6063-T6	-
3A	VV3032	2	FRAME JAMB (3 TRACK)	6063-T6	-
4	E-3010	4/ PANEL	PANEL RAIL/STILE	6063-T6	-
5	E-3012	AS REQD.	INTERLOCK COVER	6063-T6	-
6	E-3014	AS REQD.	ASTRAGAL STILE	6063-T6	-
7	E-3027	AS REQD.	POCKET HOOK STRIP	6063-T6	-
8	E-3015	AS REQD.	JAMB COVER	6063-T6	-
9	E-3013	AS REQD.	INTERLOCK COVER	6063-T6	-
10	E-3023	3/ PANEL	FIX. PANEL CLIP, 2" LONG, AT 3" FROM ENDS & 16" O.C.	6063-T6	-
11	E-3021	AS REQD.	GLAZING BEAD (LAM. GLASS)	6063-T5	-
11A	E-3022	AS REQD.	GLAZING BEAD (INSUL. LAM. GLASS)	6063-T5	-
12	E-3026	AS REQD.	SILL RISER	6063-T6	-
13	E-3018	4/ PANEL	CORNER KEY	6063-T6	-
14	W31256NK000B	AS REQD.	FIN PILE W'STRIPPING (.310"W X .250"H)	WOOL	ULTRAFAB
16	-	2/ LITE	SETTING BLOCK	EPDM	DUROMETER 80±5 SHORE A
17	#10 X 1-1/2"	AS REQD.	FRAME ASSEMBLY FASTENERS	ST. STEEL	PH SMS
18	#10 X 1/2"	AS REQD.	INTERLOCK FASTENERS AT 6" FROM EACH END & 18" O.C.	ST. STEEL	PH SMS
19	#12 X 2"	AS REQD.	ASTRAGAL FASTENERS AT 6" FROM ENDS & 24" O.C. *	ST. STEEL	PH SMS
20	#12 X 5/8"	1/ CLIP	FIX. CLIP FASTENERS	ST. STEEL	PH SMS
21	RU-098ZR-INOX	2/ MOV. PANEL	TANDEM WHEEL ROLLER ASSEMBLY	ZAMAK	IDH
21A	#10 X 1/2"	1/ ASSY.	FIX. CLIP FASTENERS	ST. STEEL	PH SMS
22	-	1/ MOV. PANEL	DOOR LOCK	-	INTERLOCK
23	-	AS REQD.	EXTERIOR BULB GASKET	EPDM	DUROMETER 75±5 SHORE A
24	-	AS REQD.	BUMP ON SPACER	SILICONE	-
26	KT0207-1	2	WIND BREAKER	EPDM	-
27	KT0207-2	AS REQD.	PANEL END COVER	NYLON	-
28	KT0207-3	AS REQD.	GUIDE STOP/ANTI LIFT CLIP	NYLON	-
29	KT0207-10	2	FRAME END COVER	EPDM	-
30	VV3034	AS REQD.	INTERLOCK REINFORCEMENT	6063-T6	-

* AVG. SPACING

SEALANT:

ALL JOINTS AND FRAME CONNECTIONS SEALED WITH WHITE/ALUMINUM COLORED SILICONE.


LOCKS:

SURFACE MOUNT METALLIC MORTISE LOCK
AT 39-1/2" FROM BOTTOM
FASTENED TO LOCK STILE WITH
(2) #8 X 1/2" PH SELF DRILLING SCREWS

SURFACE MOUNT METALLIC HANDLE AT 39-1/2" FROM BOTTOM
FASTENED TO LOCK STILE WITH
(2) 10-32 X 1-1/2" FH MS

SURFACE MOUNT METALLIC KEEPER FACING LOCK AT 39 1/2" FROM BOTTOM
FASTENED WITH
(2) #10 X 3/4" FH SELF DRILLING SCREWS

PRODUCT REVISED
As complying with the Florida
Building Code
NOA-No. 26-0707.04
Expiration Date: 09/02/2031
By: Manuel Perez
Miami-Dade Product Control
JUL 06 2026


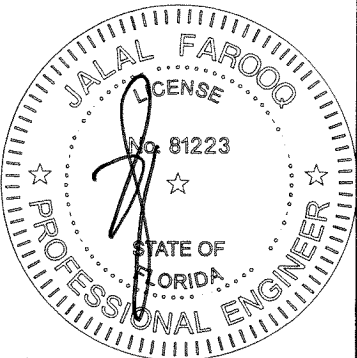


af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 262-6978
FAX (305) 262-6978
C.A.N. 3538


S-3000 ALUM HORIZONTAL SLIDING WINDOW (L.M.I.)
Labrador & Fundora Corp.
dba-V & V Windows
14150 N.W. 56th Court, Suite 600
Opa-Locka, FL. 33054
Tel. (305) 888-4151
www.vvwindows.com

revisions:	
no	date
1	06.23.26
by description	
A NO CHANGE THIS SHEET	
date:	07-10-25
scale:	3/8" = 1"
dr. by:	TARIQ
chk. by:	
drawing no.	25-69D
sheet 18 of 20	


COMP-ANL\25-69D-W

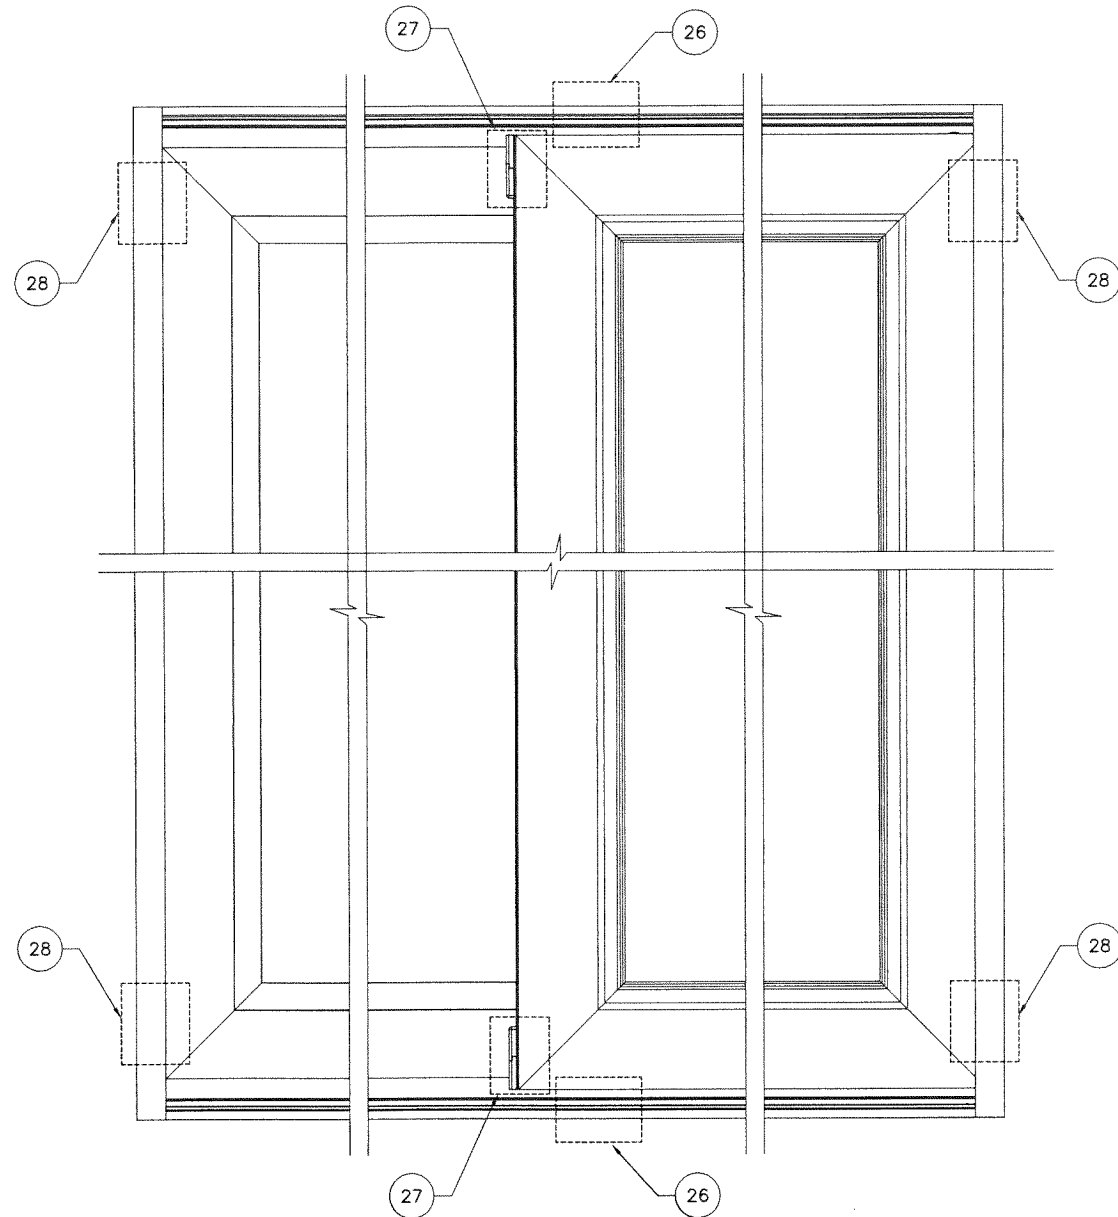


26 WIND BREAKER







27 PANEL END COVER




28 GUIDE STOP



29 FRAME END COVER

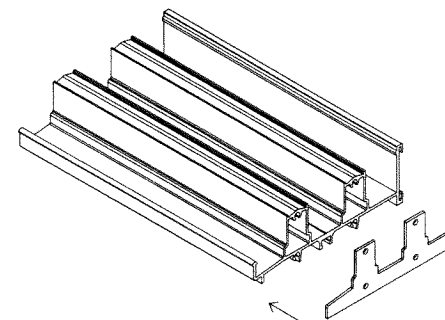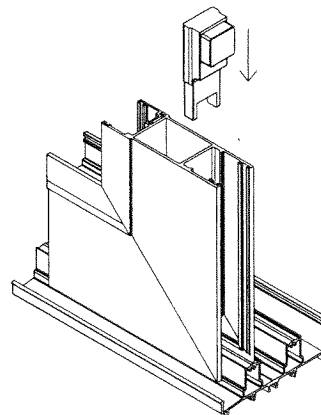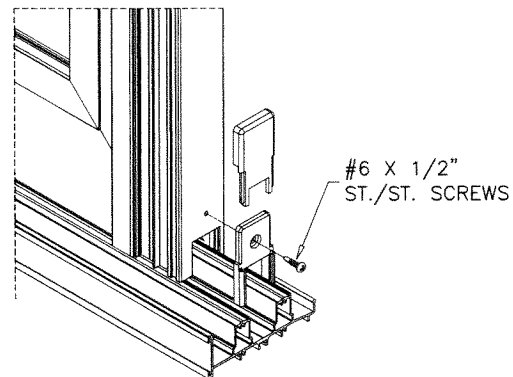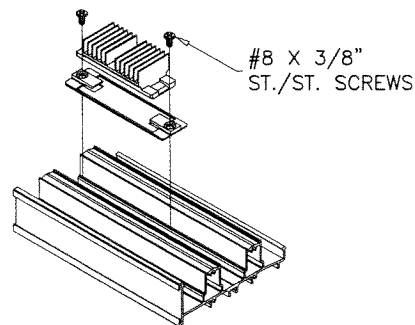




PRODUCT REVISED
As complying with the Florida
Building Code
NOA-No. **26-0707.04**
Expiration Date: **09/02/2031**
By: *Manuel Perez*
Miami-Dade Product Control
JUL 06 2026

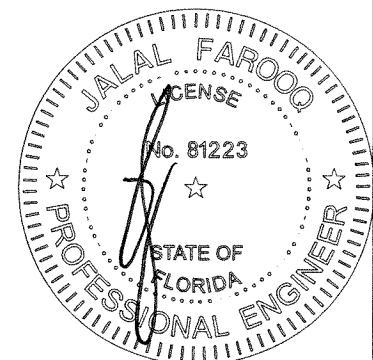

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\25-69D-W


S-3000 ALUM HORIZONTAL SLIDING WINDOW (L.M.I.)
Labrador & Fundora Corp.
dba-V & V Windows
14150 N.W. 56th Court, Suite 600
Opa-Locka, FL 33054
Tel. (305) 888-4151
www.vvwindows.com

revisions:		no	date	by	description
		A	06.23.26		NO CHANGE THIS SHEET
date:	07-10-25	scale:	3/8" = 1"	dr. by:	TARIQ
chk. by:					
drawing no.	25-69D				
sheet	19 of 20				

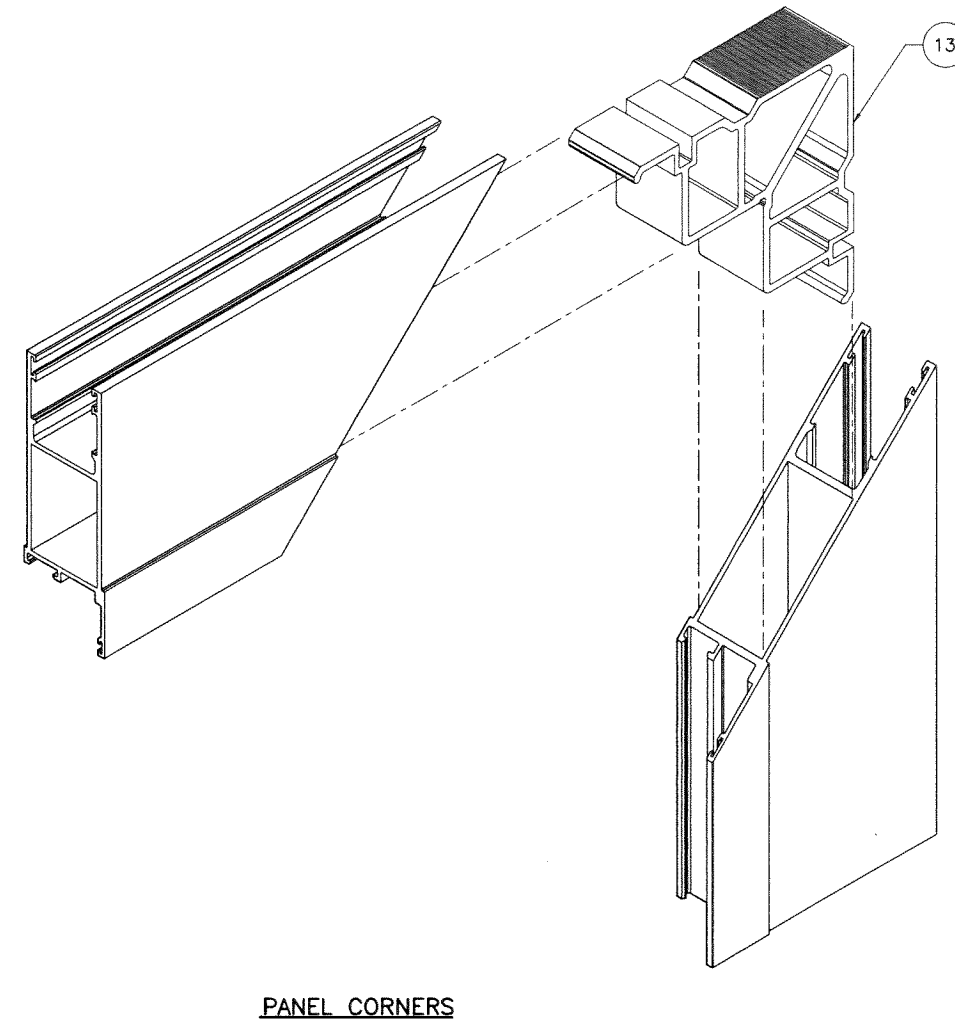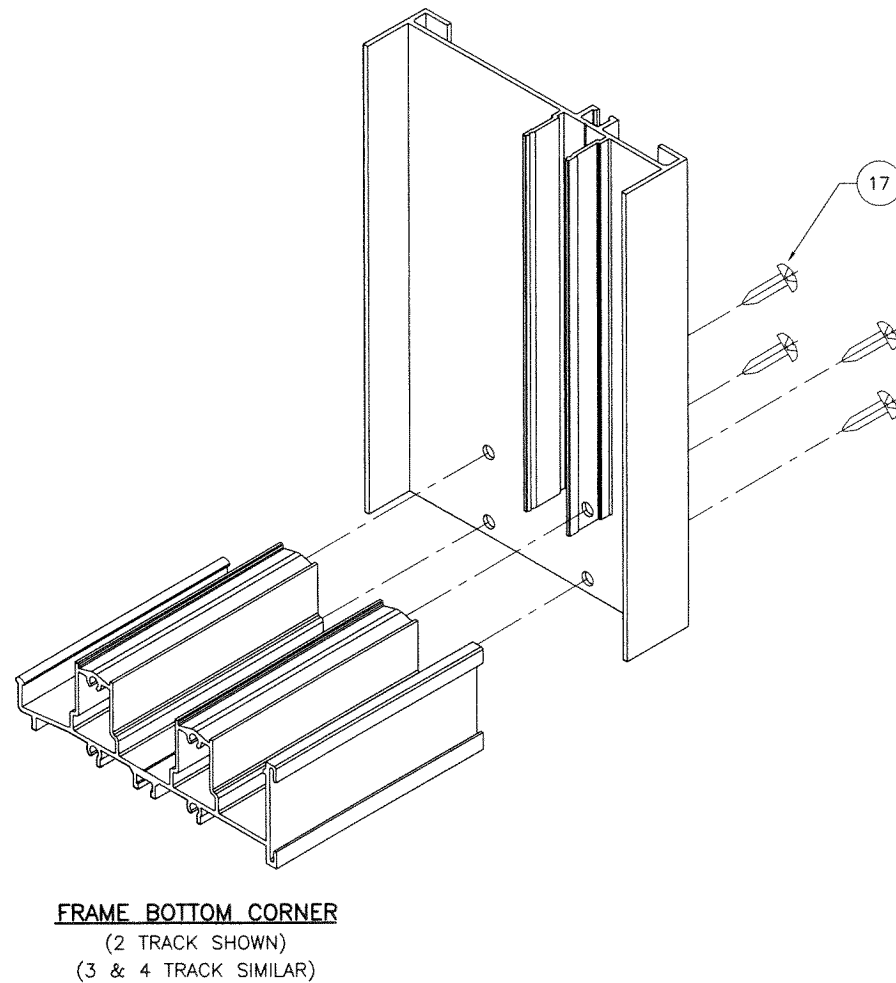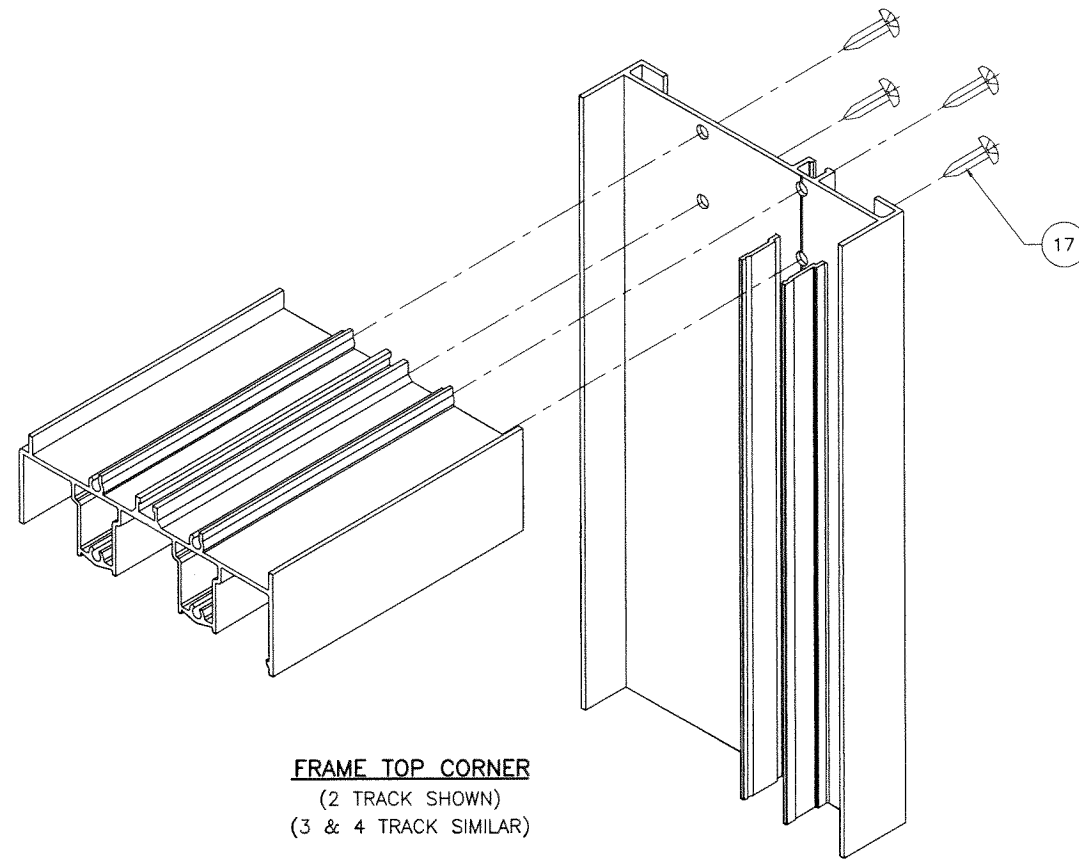

PRODUCT REVISED
As complying with the Florida
Building Code
NOA-No. **26-0707.04**
Expiration Date: **09/02/2031**
By: *Manuel Perez*
Miami-Dade Product Control

JUL 06 2026

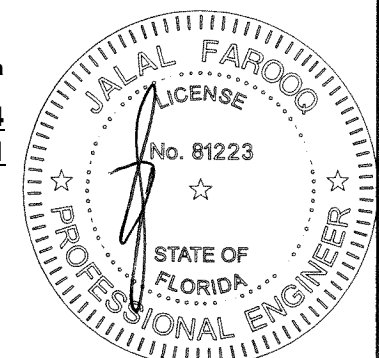

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\25-69D-W

S-3000 ALUM HORIZONTAL SLIDING WINDOW (L.M.I.)
Labrador & Fundora Corp.
dba-V & V Windows
14150 N.W. 56th Court, Suite 600
Opa-Locka, FL. 33054
Tel. (305) 888-4151
www.vvwindows.com

revisions:		no	date	by	description
		A	106.23.26		NO CHANGE THIS SHEET
date:	07-10-25	scale:	3/8" = 1"	dr. by:	TARIQ
		chk. by:			
drawing no.	25-69D				
sheet	20 of 20				