



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

DAB Door Company, Inc.
12195 NW 98th Avenue
Hialeah Gardens, FL 33018

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: AB 1956 Steel Sectional Garage Door up to 10ft-4in Wide w/ Optional Insulation

APPROVAL DOCUMENT: Drawing No. **25-90D**, titled "AB 1956 Steel Overhead Garage Door", sheets 1, through 8 of 8, dated 12/10/2025, with revision A dated 07/01/2026, prepared by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E., bearing the Miami-Dade County Product Control revision stamp with the Notice of Acceptance number and the expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: A permanent label with the manufacturer's name or logo, model number, the positive and negative design pressure rating, indicate impact rated if applicable, installation instruction drawing reference number, approval number (NOA), the applicable test standards, and the statement reading 'Miami-Dade County Product Control Approved' is to be located on the door's side track, bottom angle, or inner surface of a panel.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises NOA # 26-0528.01** and consists of page 1 and evidence page E-1 as well as approval document mentioned above.

The submitted documentation was reviewed by **Carlos M. Utrera, P.E.**



07/17/26

NOA No. 26-0709.05
Expiration Date: July 9, 2031
Approval Date: July 30, 2026
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. Evidence submitted under NOA # 26-0528.01 and new

A. DRAWINGS

1. Drawing No. **25-90D**, titled “AB 1956 Steel Overhead Garage Door”, sheets 1, through 8 of 8, dated 12/10/2025, with revision A dated 07/01/2026, prepared by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.

B. TESTS

1. Test reports on 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
4) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94
along with marked-up drawings and installation diagram of AB1956 24ga Steel Sectional Commercial Garage Door, prepared by Hurricane Engineering & Testing, Inc., Test Report No. **HETI-25-8295**, dated 12/03/2025, signed and sealed by Ram N. Tewari, P.E.
2. Test Report on Tensile Test per ASTM E-8 of “Sectional Commercial Garage Door (skin)”, prepared by Hurricane Engineering & Testing Inc, Report No. **HETI 25-T407**, dated 12/04/2025, signed and sealed by Ram N. Tewari, P.E.

C. CALCULATIONS

1. Anchor verification calculations prepared by Al-Farooq Corporation, dated 05/18/2026, signed and sealed by Jalal Farooq, P.E.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS

1. None.


F. STATEMENTS

1. Statement letter of code conformance to the 8th edition (2023) and 9th edition (2026) of the FBC, including special limitation note that anchors in saltwater environment must meet corrosion resistance requirements of FBC, Chapter 17, and of no financial interest, issued by Al-Farooq Corporation, dated 06/30/2026, signed and sealed by Jalal Farooq, P.E.
2. Statement letter of code conformance to the 8th edition (2023) of the FBC and of no financial interest, issued by Al-Farooq Corporation, dated 03/10/2026, signed and sealed by Jalal Farooq, P.E.



Carlos M. Utrera, P.E.
Product Control Examiner
NOA No. 26-0709.05
Expiration Date: July 9, 2031
Approval Date: July 30, 2026

The following pages in this document were submitted by the manufacturer (third party) to represent the product being approved and establish the limits of use. The pages may include technical drawings, schematics and installation details.

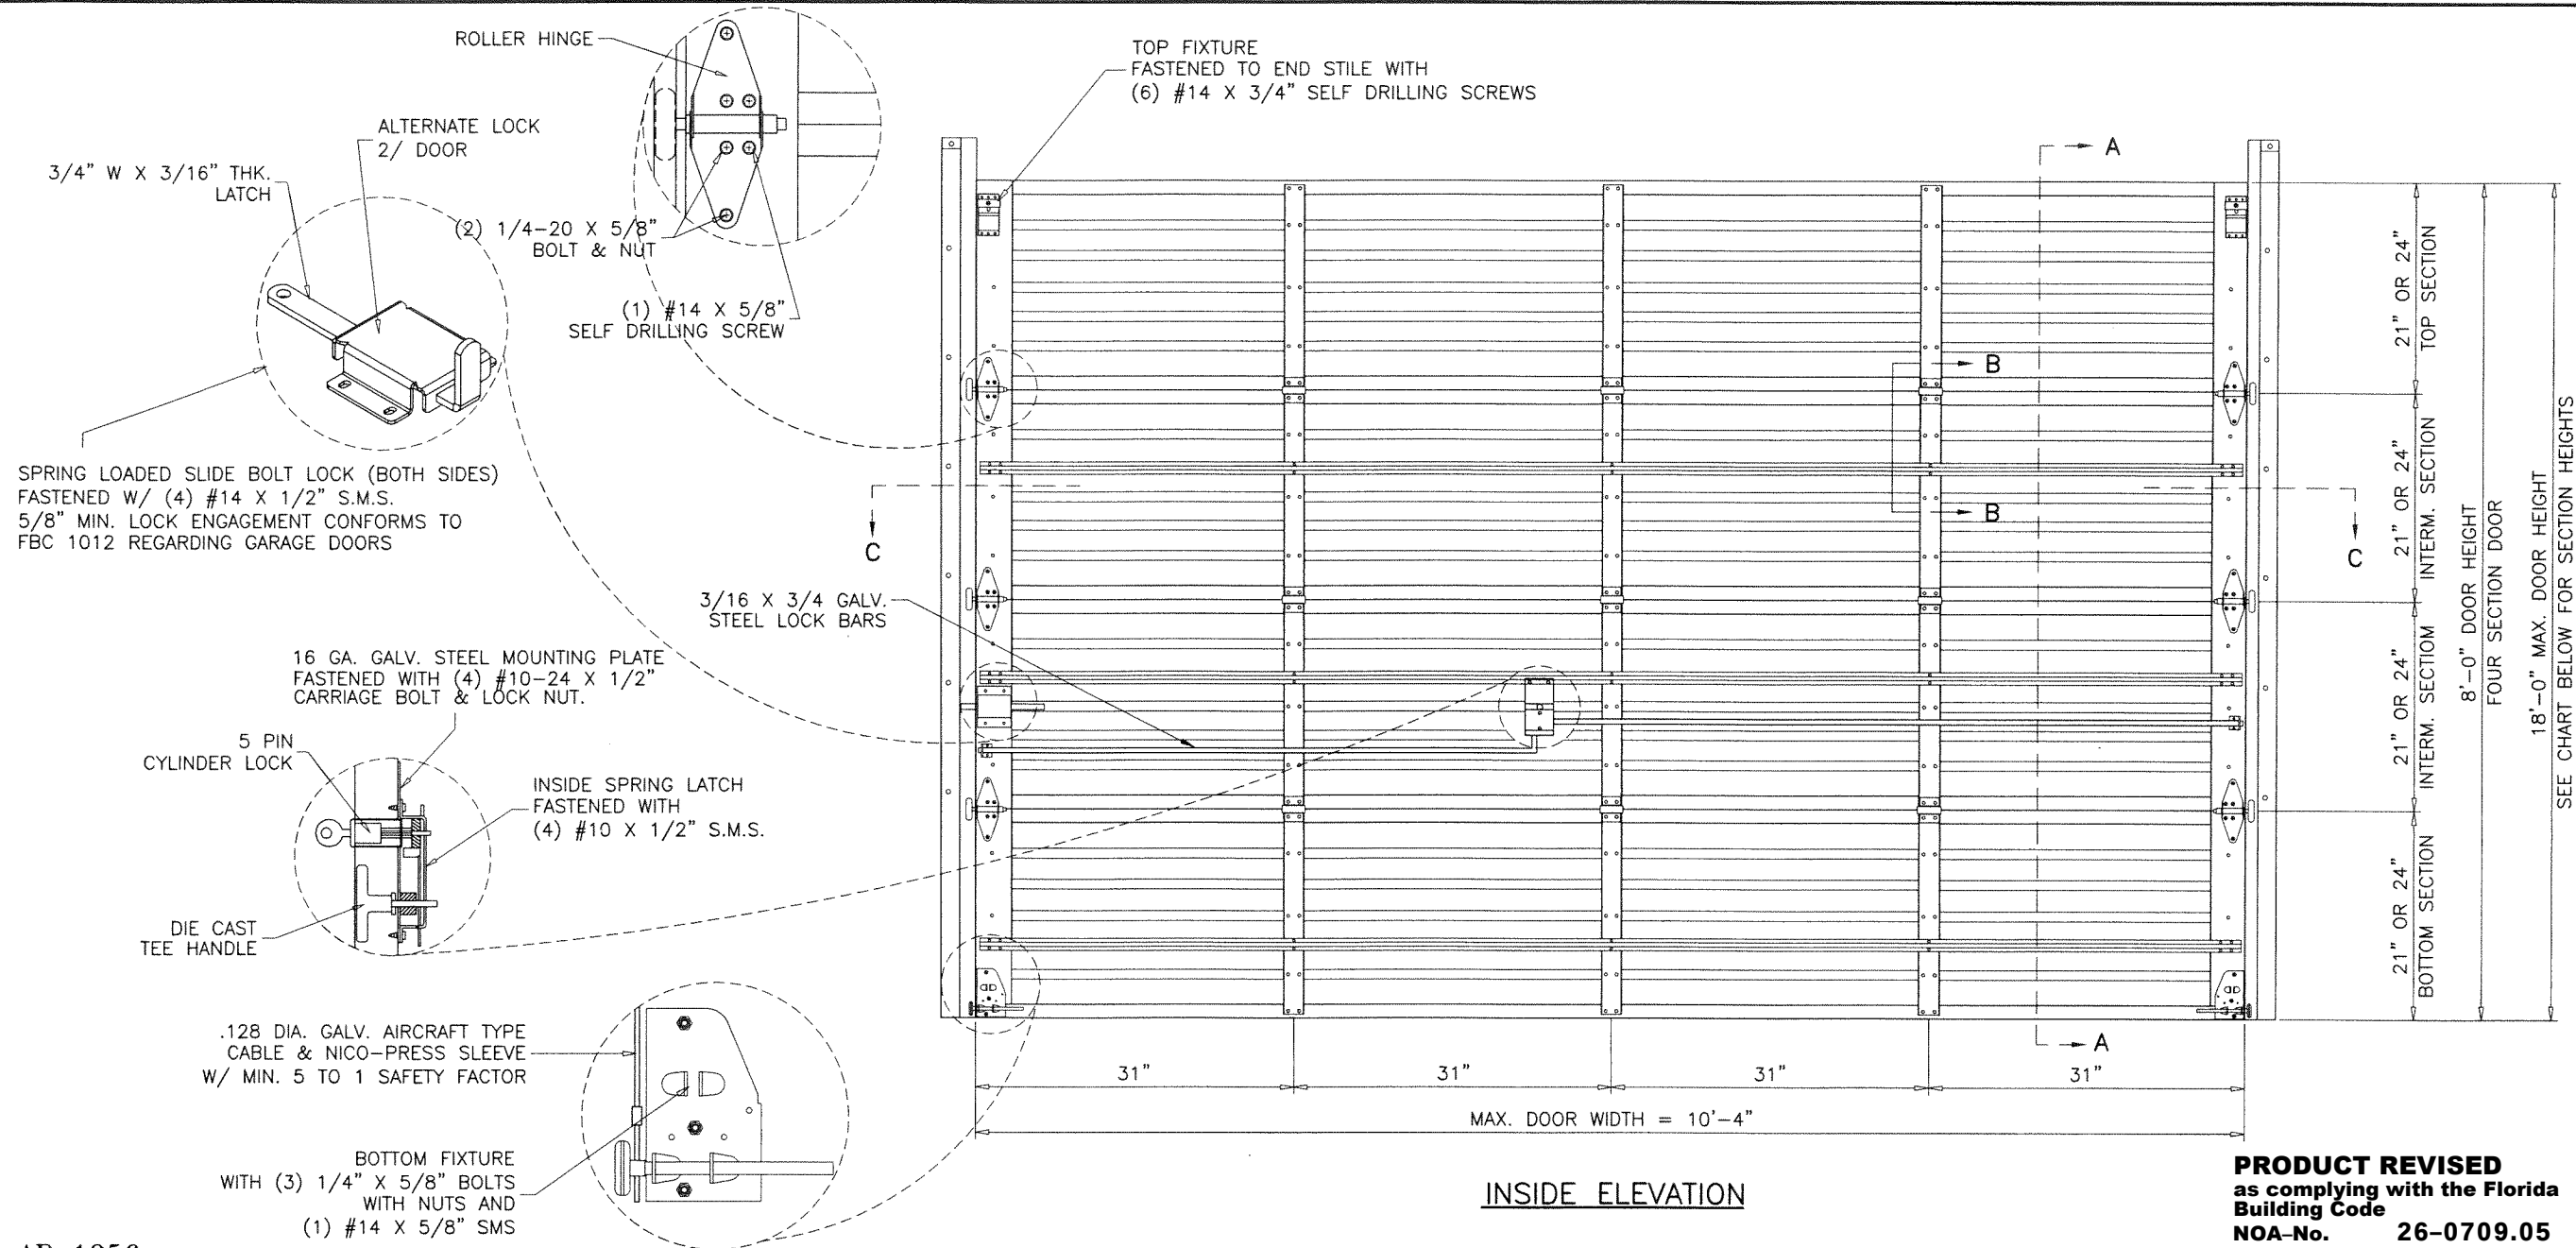

AB 1956
STEEL OVERHEAD GARAGE DOOR

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE 2023 (8TH EDITION)/2026 (9TH EDITION) FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

WOOD BUCKS & BUCK FASTENERS BY OTHERS, MUST BE DESIGNED AND INSTALLED ADEQUATELY TO TRANSFER APPLIED PRODUCT LOADS TO THE BUILDING STRUCTURE.

ANCHORS SHALL BE CORROSION RESISTANT, SPACED AS SHOWN ON DETAILS AND INSTALLED PER MANUF'S INSTRUCTIONS. SPECIFIED EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

ALL SHIMS TO BE HIGH IMPACT, NON-METALLIC AND NON-COMPRESSIBLE.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE 2023/2026 FLORIDA BLDG. CODE & ADOPTED STANDARDS.

THIS PRODUCT APPROVAL IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT, I.E. LIFE SAFETY OF THIS PRODUCT, ADEQUACY OF STRUCTURE RECEIVING THIS PRODUCT AND SEALING AROUND OPENING FOR WATER INFILTRATION RESISTANCE ETC.

CONDITIONS NOT SHOWN IN THIS DRAWING ARE TO BE ANALYZED SEPARATELY, AND TO BE REVIEWED BY BUILDING OFFICIAL.

DESIGN LOADS SHOWN ARE BASED ON 'ALLOWABLE STRESS DESIGN (ASD)'.

MAXIMUM DESIGN LOAD RATING = + 62.0 PSF
(FOR SIZES SHOWN OR SMALLER) **- 72.0 PSF**

DOOR HEIGHT	NO. OF TRUSSES	SECTION HEIGHTS *								
		1ST	2ND	3RD	4TH	5TH	6TH	7TH	8TH	9TH
7'-0"	3	21"	21"	21"	21"	N/A	N/A	N/A	N/A	N/A
8'-0"	3	24"	24"	24"	24"	N/A	N/A	N/A	N/A	N/A
9'-0"	4	24"	21"	21"	21"	21"	N/A	N/A	N/A	N/A
10'-0"	4	24"	24"	24"	24"	24"	N/A	N/A	N/A	N/A
11'-0"	5	24"	24"	21"	21"	21"	21"	N/A	N/A	N/A
12'-0"	5	24"	24"	24"	24"	24"	24"	N/A	N/A	N/A
13'-0"	6	24"	24"	24"	21"	21"	21"	21"	N/A	N/A
14'-0"	6	24"	24"	24"	24"	24"	24"	24"	N/A	N/A
15'-0"	7	24"	24"	24"	24"	21"	21"	21"	21"	N/A
16'-0"	7	24"	24"	24"	24"	24"	24"	24"	24"	N/A
17'-0"	8	24"	24"	24"	24"	24"	21"	21"	21"	21"
18'-0"	8	24"	24"	24"	24"	24"	24"	24"	24"	24"

*-SECTIONS ARE NUMBERED STARTING AT THE BOTTOM

PRODUCT REVISED
as complying with the Florida Building Code
NOA-No. 26-0709.05


Expiration Date 07/09/2031

By 
Miami-Dade Product Control

FASTENERS AND CONNECTORS SHOWN IN THIS APPROVAL MAY NOT MEET CORROSION RESISTANCE REQUIREMENTS FOR COASTAL OR SALT WATER EXPOSURE ZONES. COMPLIANCE WITH THESE CONDITIONS TO BE CHECKED PER FBC 1711.

THESE DOORS ARE RATED FOR LARGE MISSILE IMPACT. SHUTTERS ARE NOT REQUIRED.

JUL 01 2026

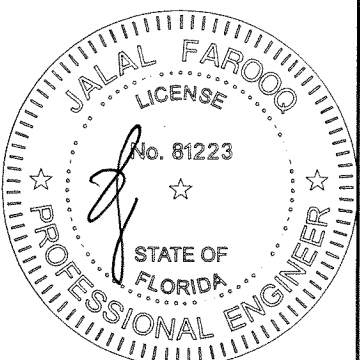



AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100
FBPE #3538

AB 1956 STEEL OVERHEAD GARAGE DOOR

DAB Door Company, Inc.
12193 N.W. 98th Ave.
Hialeah Gardens, FL 33018
Tel: (800) 257-2016 Fax: (305) 362-9272


revisions:	no.	date	by	description
	A	07.01.26		UPDATED TO 2026 FBC

date:	12-10-25	scale:	1/2" = 1'-0"	dr. by:	TARIQ	chk. by:	
drawing no.	25-90D						
sheet	1 of 8						


WWW.AFCENG.COM

GARAGE\25-90D-DAB

TOP SECTION

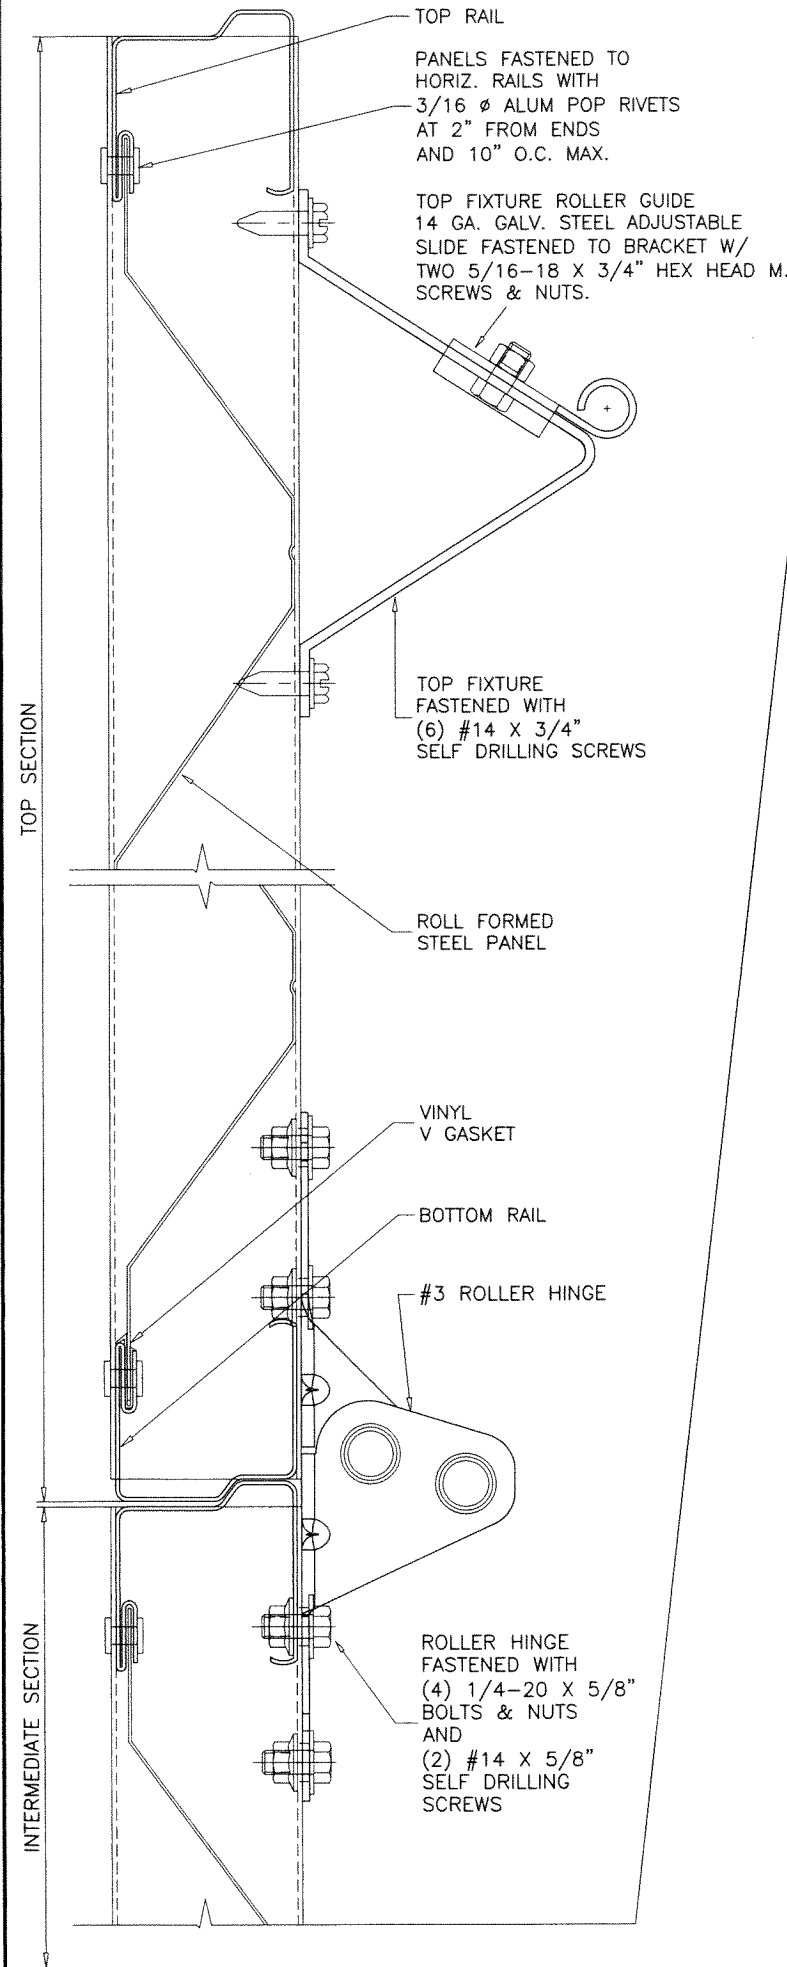


INTERMEDIATE SECTION

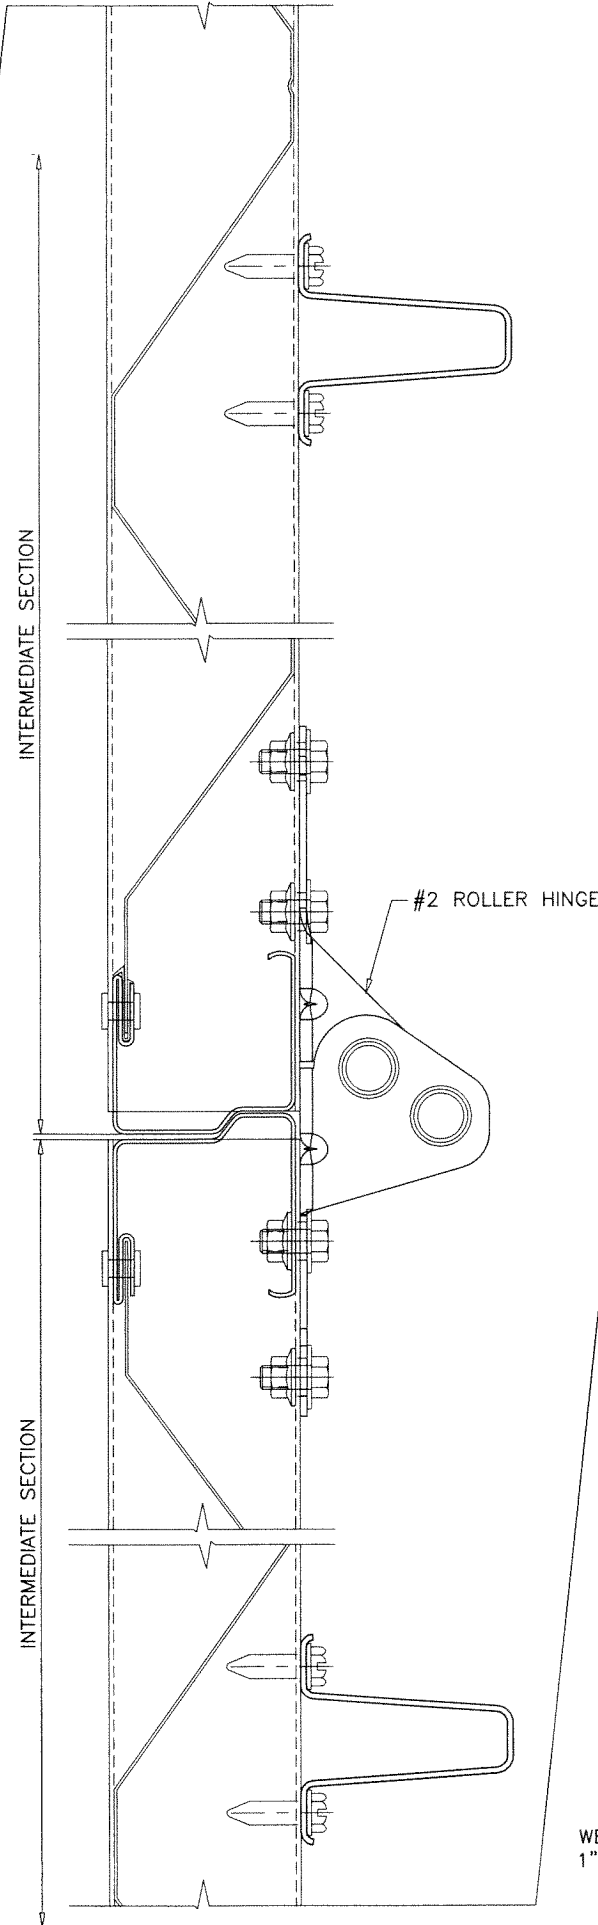


EXTERIOR

BOTTOM SECTION

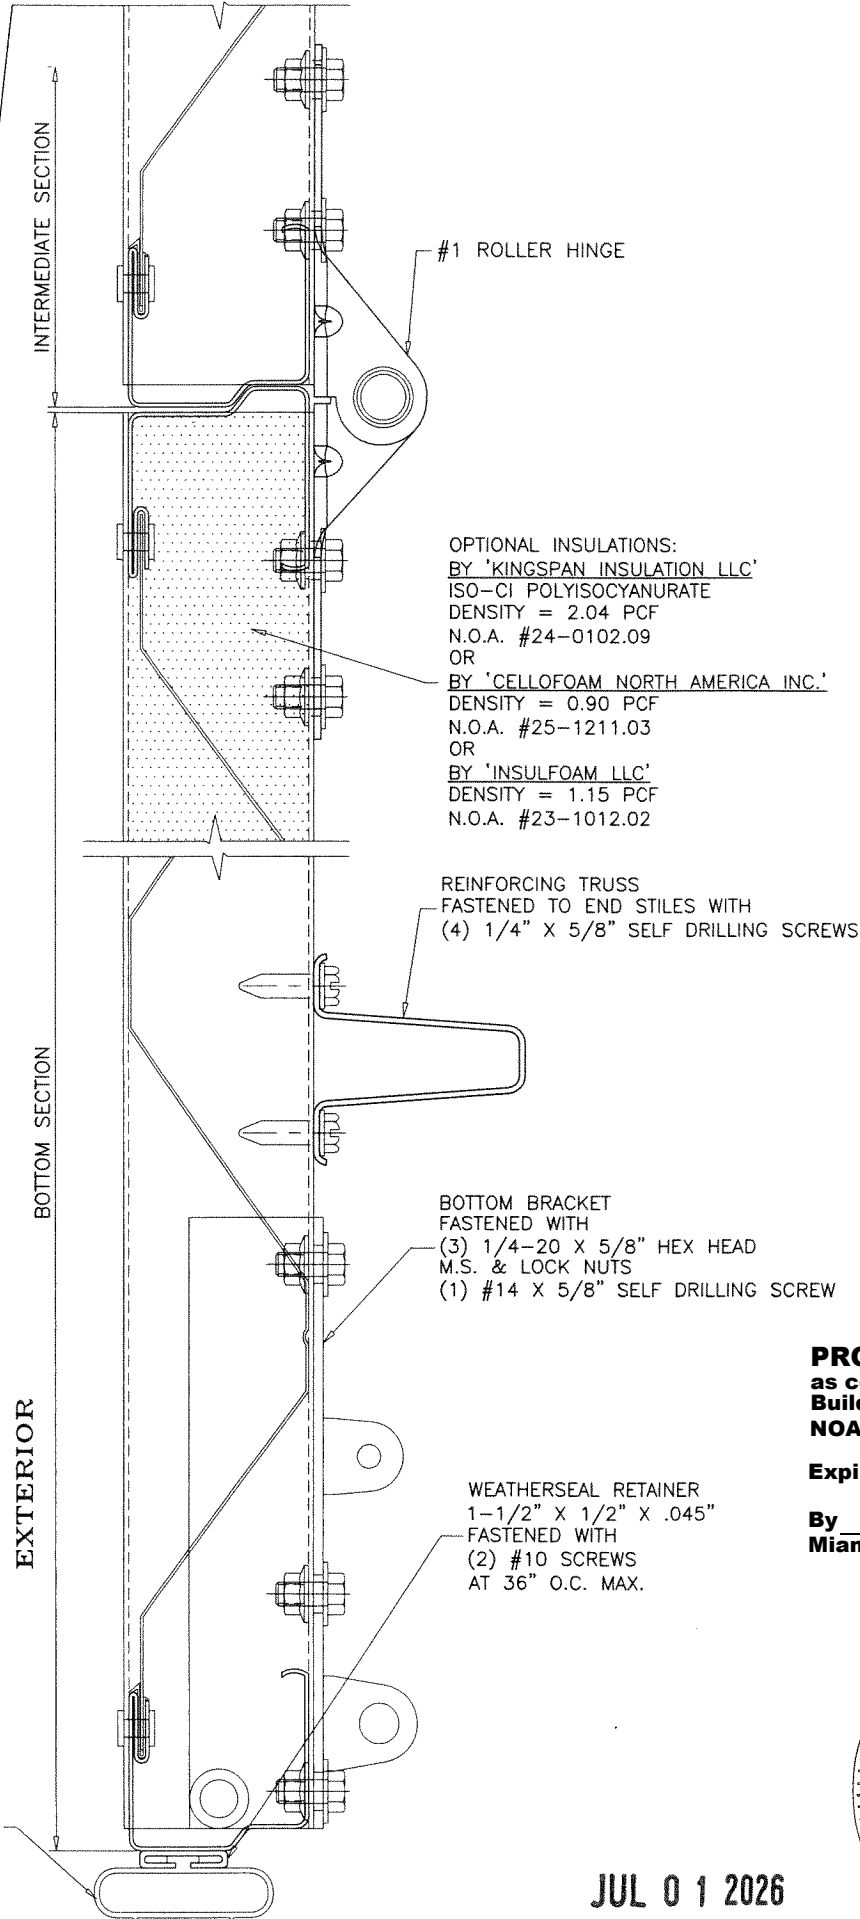

SECTION A-A

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. **26-0709.05**
Expiration Date **07/09/2031**
By *[Signature]*
Miami-Dade Product Control

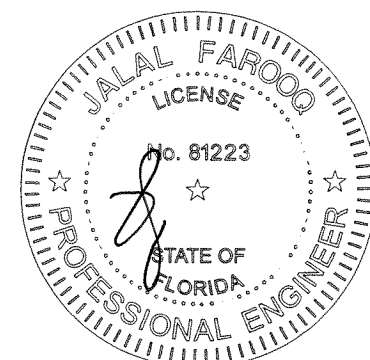

JUL 01 2026


AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL (305) 264-8100
WWW.AFCENG.COM
FBPE #3538

AB 1956 STEEL OVERHEAD GARAGE DOOR


DAB Door Company, Inc.
12193 N.W. 98th Ave.
Hialeah Gardens, FL 33018
Tel: (800) 257-2016 Fax: (305) 362-9272

revisions:		no	date	by	description
		A	07.01.26		NO CHANGE THIS SHEET
date:	12-10-25	scale:	1/2" = 1"	dr. by:	TARIQ
		chk. by:			
drawing no.	25-90D				
sheet	2 of 8				

GARAGE\25-90D-DAB

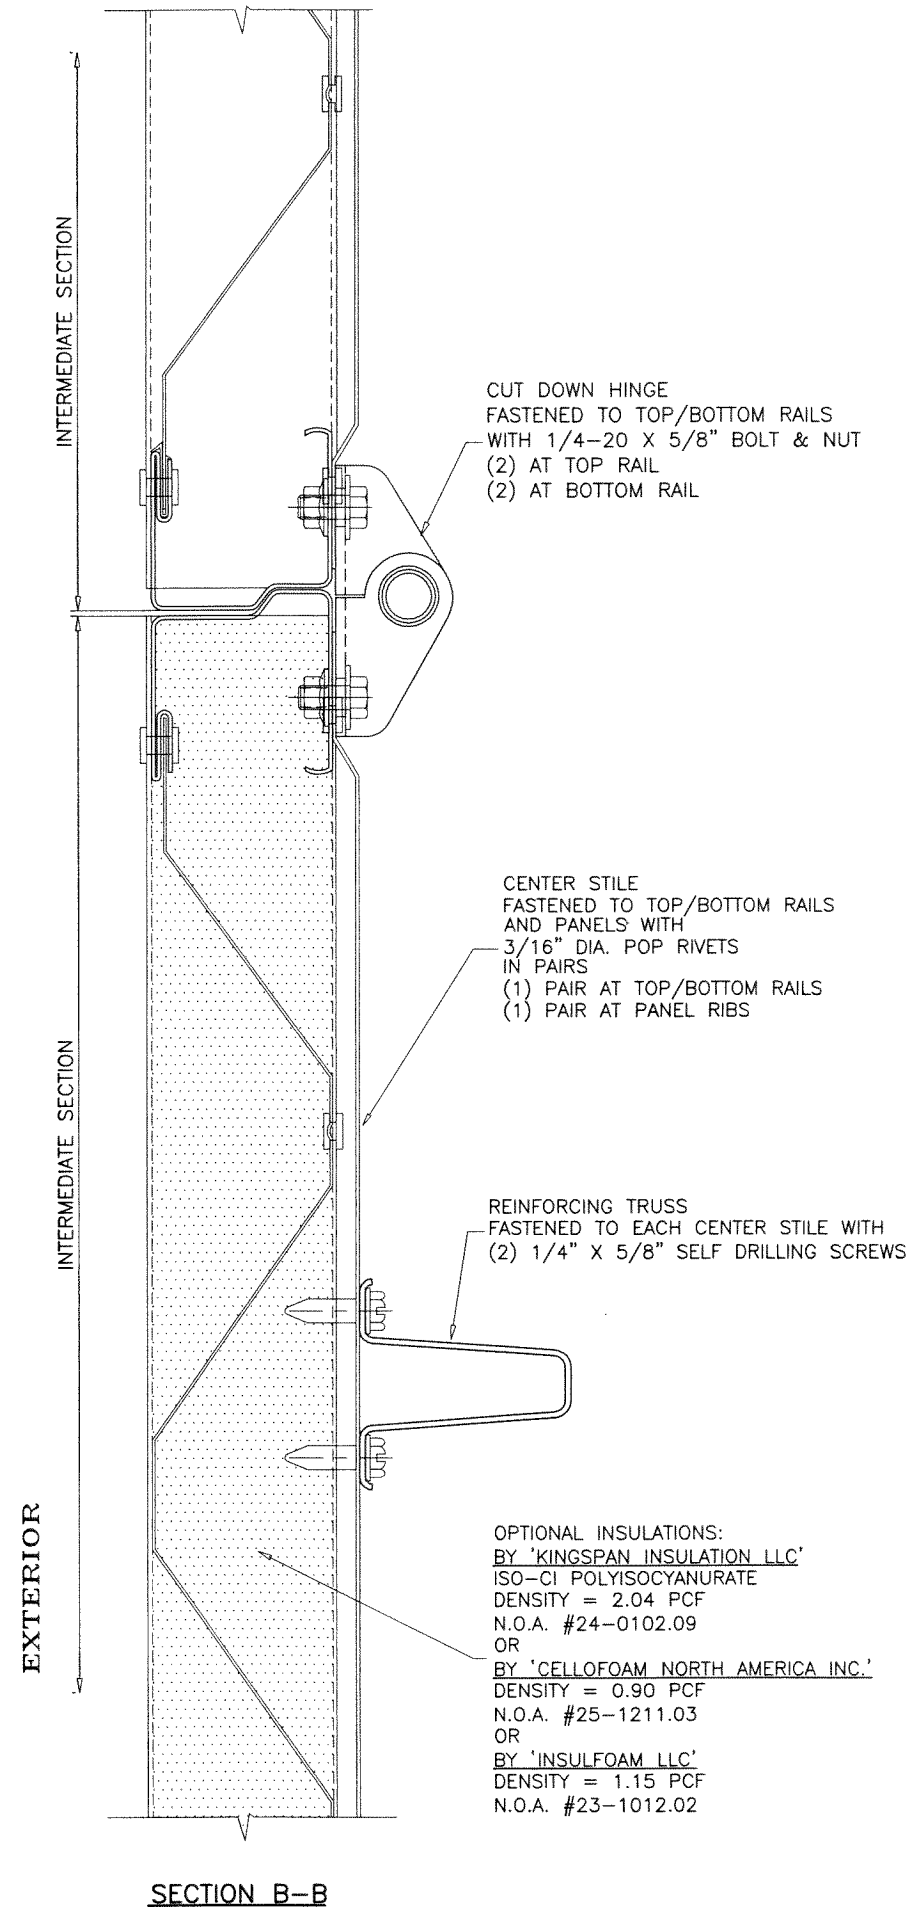

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 26-0709.05
Expiration Date 07/09/2031
By [Signature]
Miami-Dade Product Control

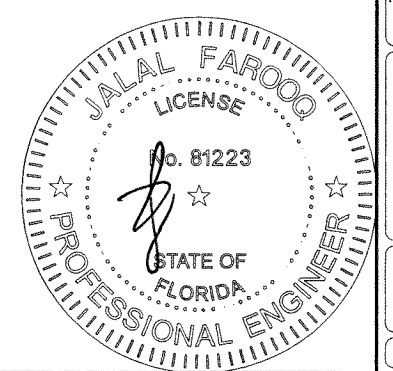

JUL 01 2026

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100
WWW.AFCENG.COM
FBPE #3538

af c
GARAGE 25-90D-DAB

AB 1956 STEEL OVERHEAD GARAGE DOOR


DAB Door Company, Inc.
12193 N.W. 98th Ave.
Hialeah Gardens, FL 33018
Tel: (800) 257-2016 Fax: (305) 362-9272

revisions:


no	date	description
A	07.01.26	NO CHANGE THIS SHEET

date: 12-10-25
scale: 1/2" = 1"
dr. by: TARIQ
chk. by:

drawing no.
25-90D
sheet 3 of 8

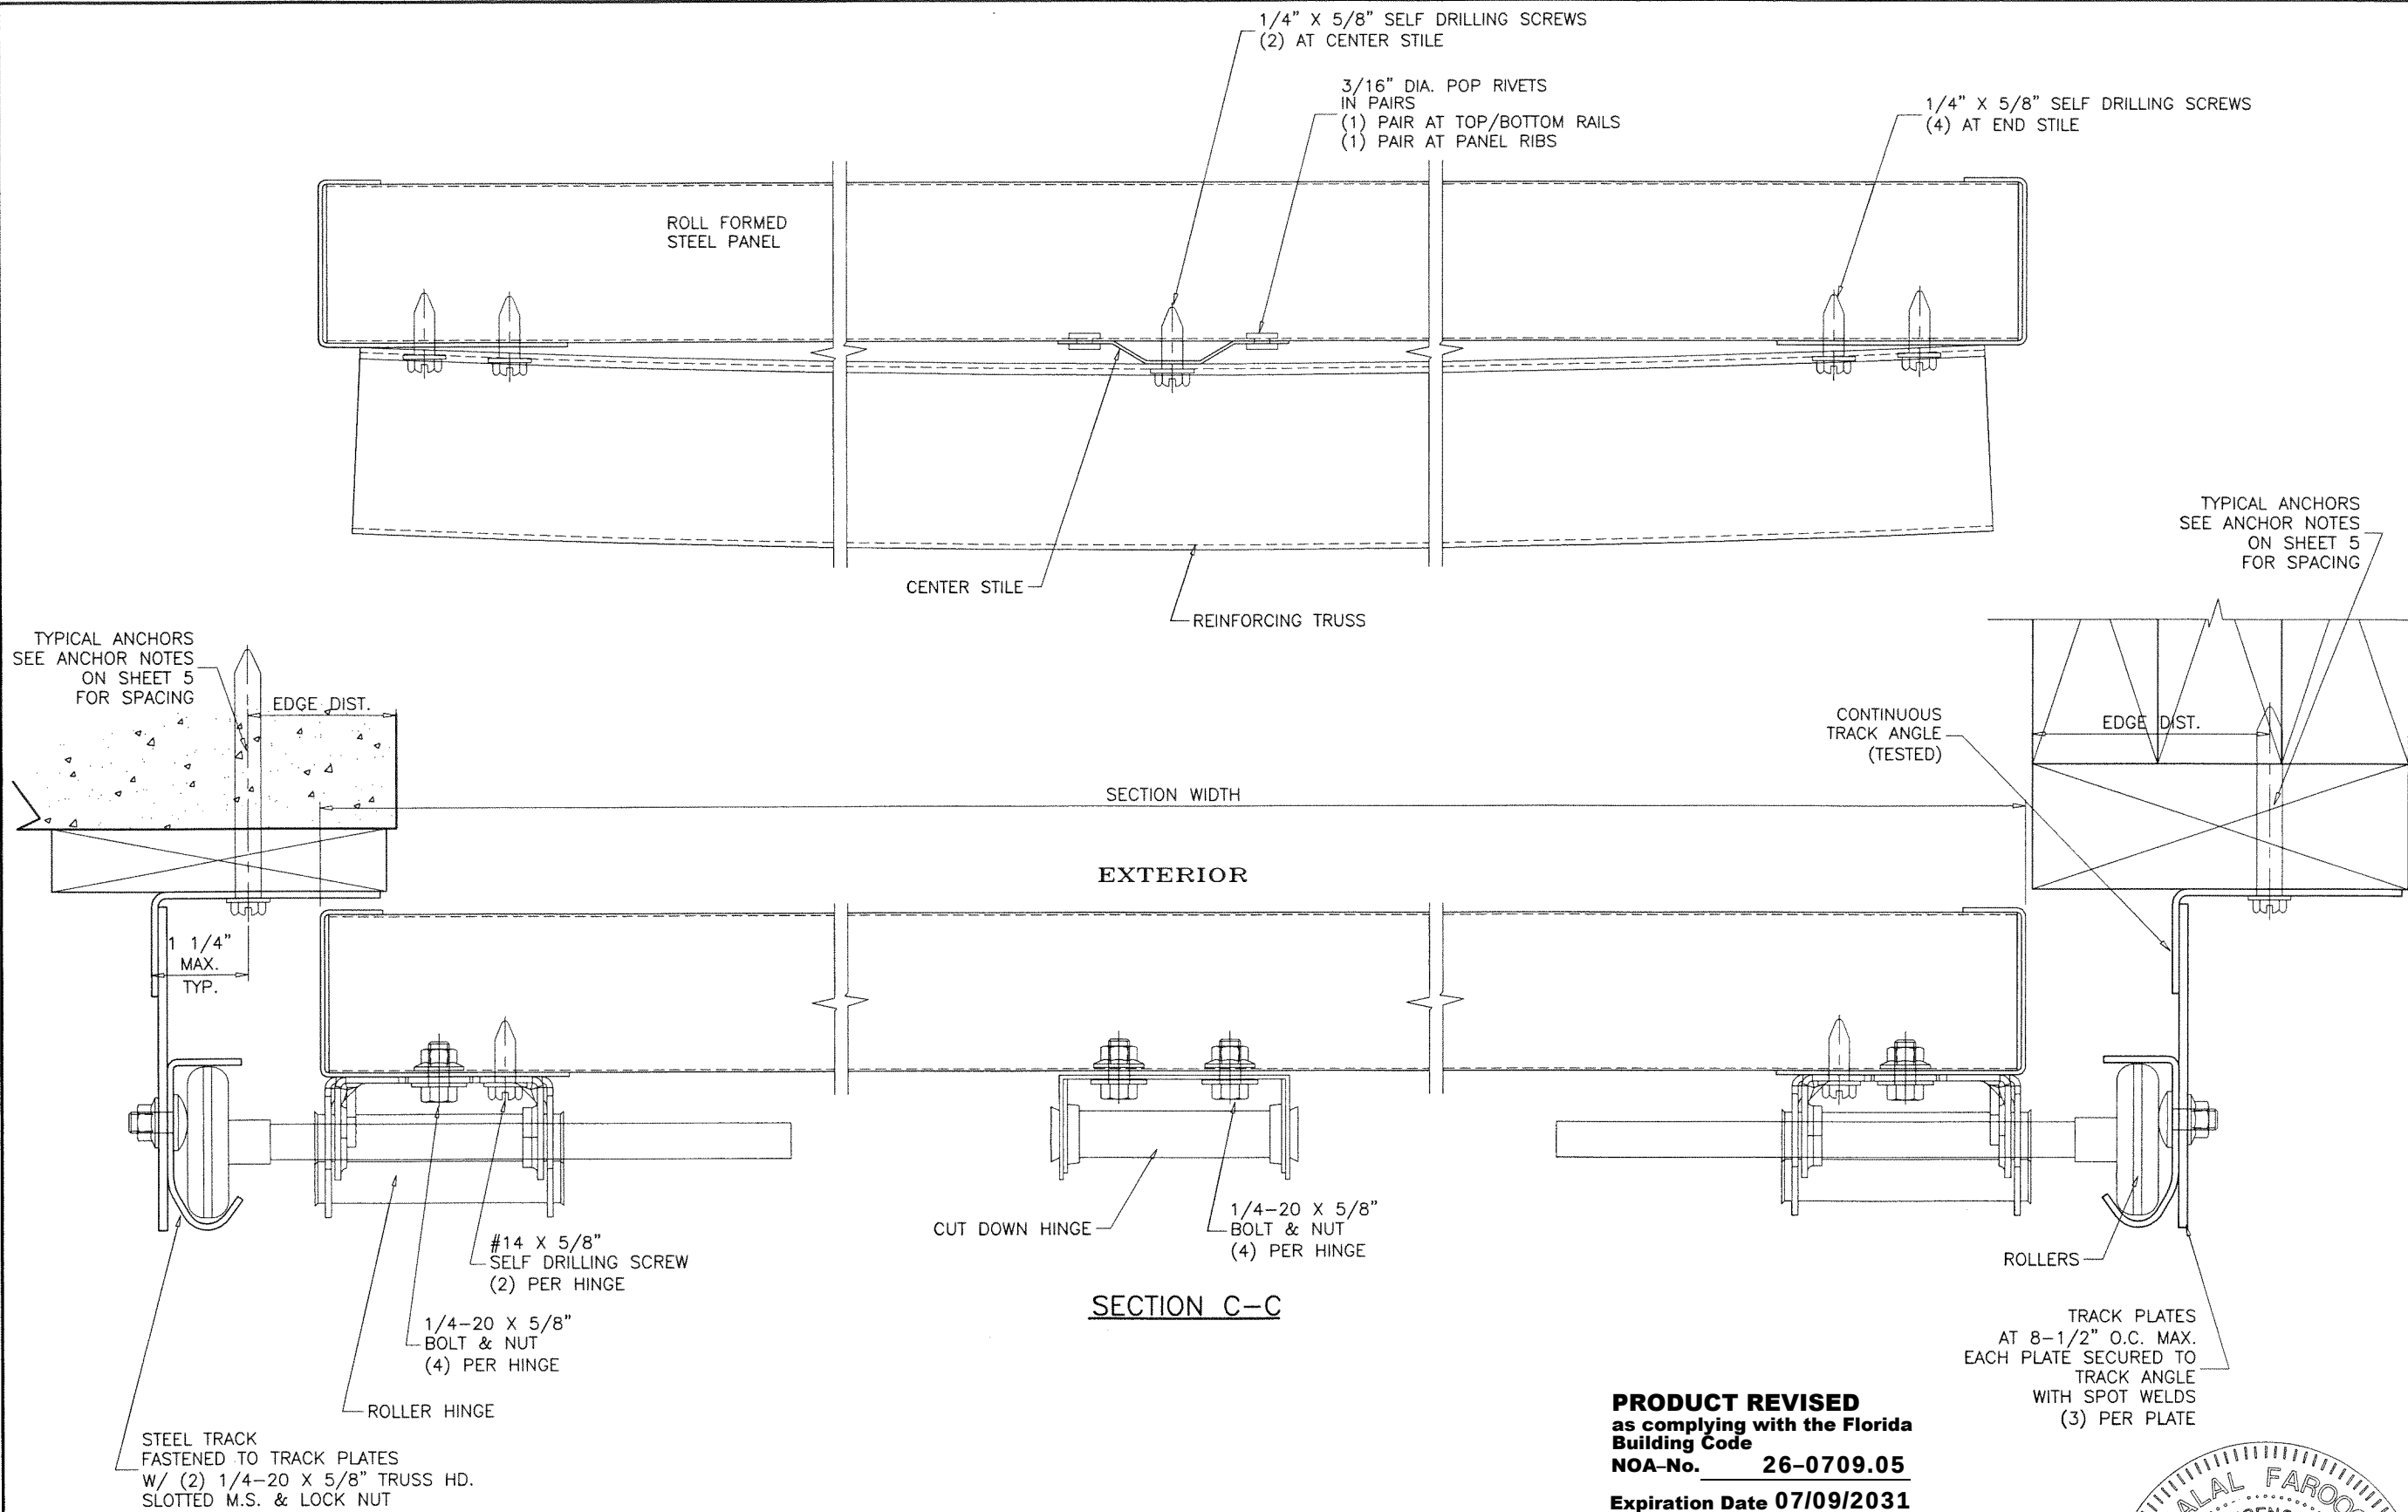

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 26-0709.05
Expiration Date 07/09/2031
By *[Signature]*
Miami-Dade Product Control

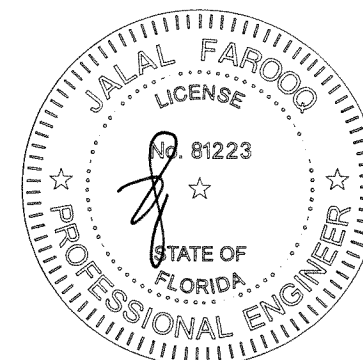

JUL 01 2026

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100
FBPE #3538

GARAGE 25-90D-DAB

AB 1956 STEEL OVERHEAD GARAGE DOOR

DAB Door Company, Inc.
12193 N.W. 98th Ave.
Hialeah Gardens, FL 33018
Tel: (800) 257-2016 Fax: (305) 362-9272

revisions:

no.	date	by	description
A	07.01.26		NO CHANGE THIS SHEET







date: 12-10-25
scale: 1/2" = 1"
dr. by: TARIQ
chk. by:

drawing no.
25-90D

sheet 4 of 8

drawing no.
25-90D

sheet 4 of 8

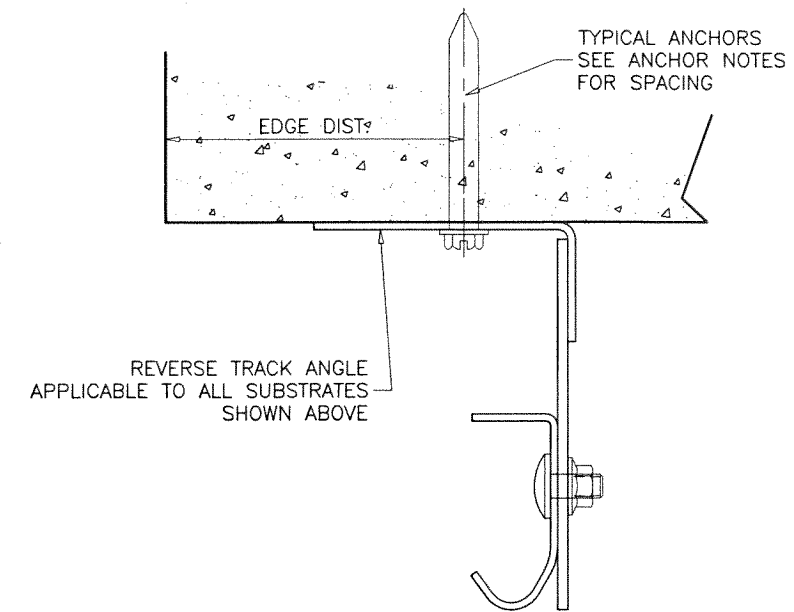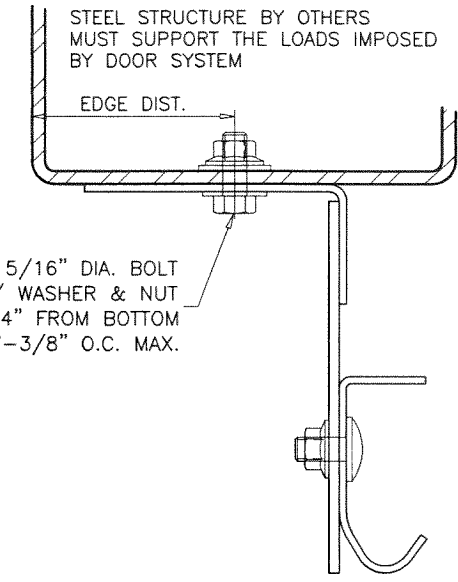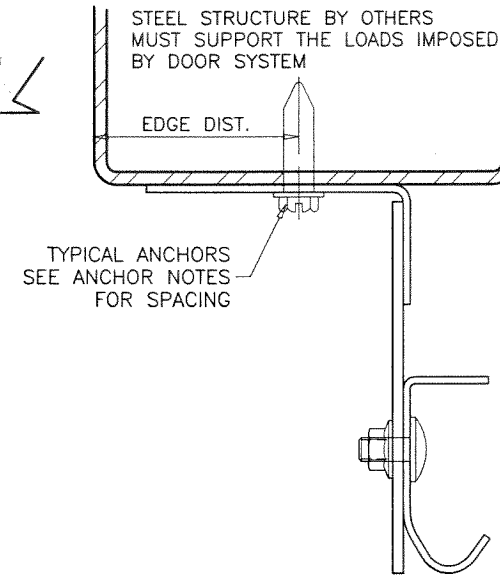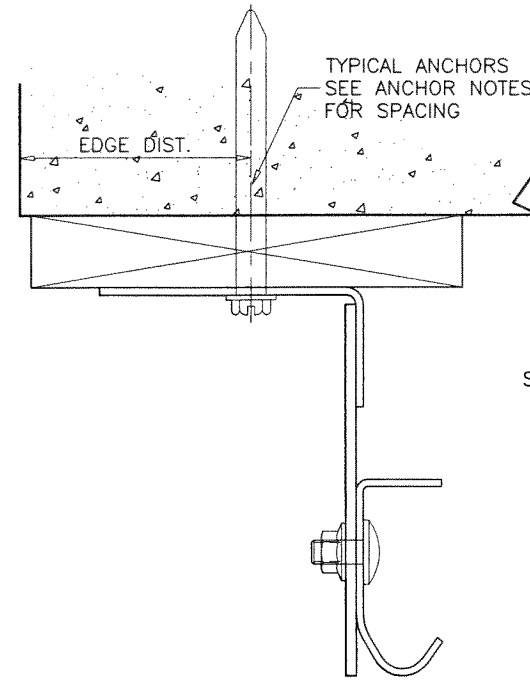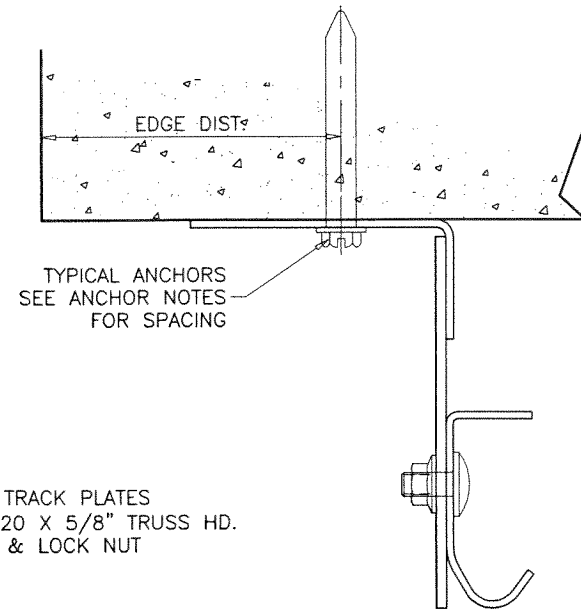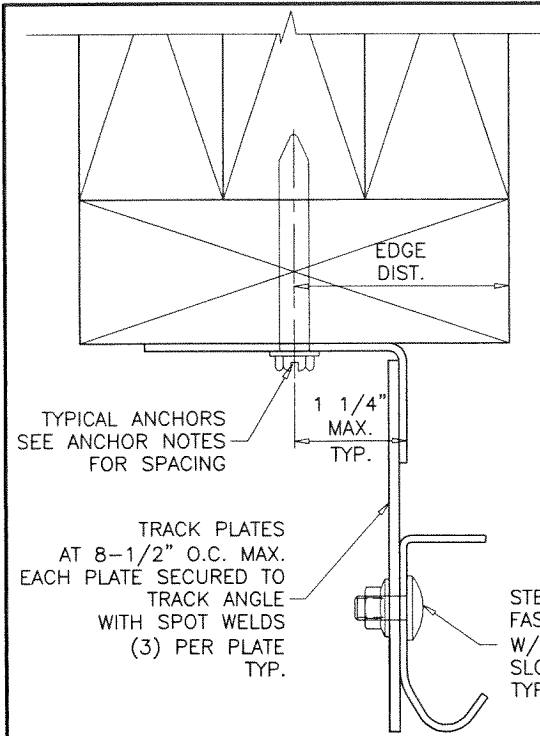

ANCHOR DETAILS AT TRACK ANGLE

TYPICAL ANCHORS:

5/16" DIA. LAG SCREWS

INTO WOOD STRUCTURES
2-1/4" MIN. PENETRATION INTO WOOD
AT 4" FROM BOTTOM AND 7-3/8" O.C. MAX.

5/16" DIA. ULTRACON BY 'DEWALT'

(Fu=177 KSI, Fy=155 KSI)

THRU 1BY OR 2BY BUCKS INTO CONCRETE
2" MIN. EMBED INTO CONCRETE
AT 4" FROM BOTTOM AND 7-3/8" O.C. MAX.

DIRECTLY INTO CONCRETE
2" MIN. EMBED INTO CONCRETE
AT 4" FROM BOTTOM AND 7-3/8" O.C. MAX.

5/16" DIA. DYNABOLT BY 'ITW'

DIRECTLY INTO CONCRETE
1-1/4" MIN. EMBED INTO CONCRETE
AT 4" FROM BOTTOM AND 7-3/8" O.C. MAX.

5/16" DIA. DRIL-FLEX SCREWS BY 'DEWALT'

(Fu=100 KSI, Fy=65 KSI)

INTO METAL STRUCTURES
AT 4" FROM BOTTOM AND 7-3/8" O.C. MAX.
STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.)
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL EDGE DISTANCE

INTO CONCRETE = 3-1/8" MIN.
INTO WOOD STRUCTURE = 1-1/4" MIN.
INTO METAL STRUCTURE = 3/4" MIN.

WOOD SG = 0.55 MIN.
CONCRETE f'c = 3000 PSI MIN.
C-90 GROUT FILLED BLOCK f'm = 2000 PSI MIN.

3/8" DIA. SCREW-BOLT+ BY 'DEWALT'

(Fu=105 KSI, Fy=84 KSI)

THRU 1BY OR 2BY BUCKS INTO CONCRETE
2-1/2" MIN. EMBED INTO CONCRETE
AT 4" FROM BOTTOM AND 7-3/8" O.C. MAX.

DIRECTLY INTO CONCRETE
3-1/4" MIN. EMBED INTO CONCRETE
AT 4" FROM BOTTOM AND 7-3/8" O.C. MAX.

DIRECTLY INTO GROUT FILLED BLOCKS
3-1/4" MIN. EMBED INTO FILLED BLOCKS
AT 4" FROM BOTTOM AND 7-3/8" O.C. MAX.

3/8" DIA. SLEEVE ANCHOR BY 'FASTENAL'

DIRECTLY INTO CONCRETE OR GROUT FILLED BLOCKS
1-1/2" MIN. EMBED INTO CONCRETE/BLOCKS
AT 4" FROM BOTTOM AND 7-3/8" O.C. MAX.

3/8" DIA. LOK-BOLT AS BY 'DEWALT'

DIRECTLY INTO CONCRETE
1-1/4" MIN. EMBED INTO CONCRETE
AT 4" FROM BOTTOM AND 7-3/8" O.C. MAX.

3/8" DIA. MACHINE SCREWS (GRADE 5 CRS)

INTO METAL STRUCTURES
AT 4" FROM BOTTOM AND 7-3/8" O.C. MAX.
STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.)
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL EDGE DISTANCE

INTO CONCRETE AND FILLED BLOCKS = 3-1/8" MIN.
INTO WOOD STRUCTURE = 1-1/2" MIN.
INTO METAL STRUCTURE = 1" MIN.

WOOD SG = 0.55 MIN.
CONCRETE f'c = 3000 PSI MIN.
C-90 GROUT FILLED BLOCK f'm = 2000 PSI MIN.


3/8" DIA. DYNABOLT BY 'ITW'

DIRECTLY INTO CONCRETE
1-1/2" MIN. EMBED INTO CONCRETE
AT 4" FROM BOTTOM AND 7-3/8" O.C. MAX.

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 26-0709.05

Expiration Date 07/09/2031

By *[Signature]*
Miami-Dade Product Control


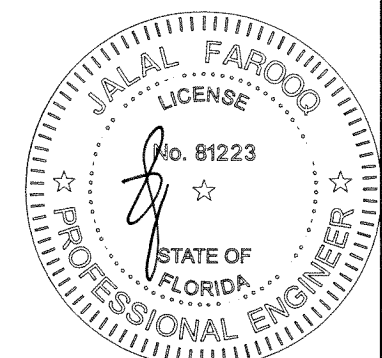


JUL 01 2026

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100
WWW.AFCENG.COM
FBPE #3538
GARAGE 25-90D-DAB

AB 1956 STEEL OVERHEAD GARAGE DOOR
DAB Door Company, Inc.
12193 N.W. 98th Ave.
Hialeah Gardens, FL 33018
Tel: (800) 257-2016 Fax: (305) 362-9272

revisions:		no	date	by	description
		A	07.01.26		NO CHANGE THIS SHEET
date:	12-10-25	scale:	1/2" = 1"	dr. by:	TARIQ
		chk. by:			
drawing no.	25-90D				
sheet	5 of 8				

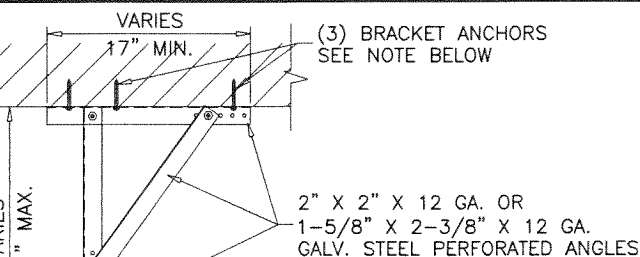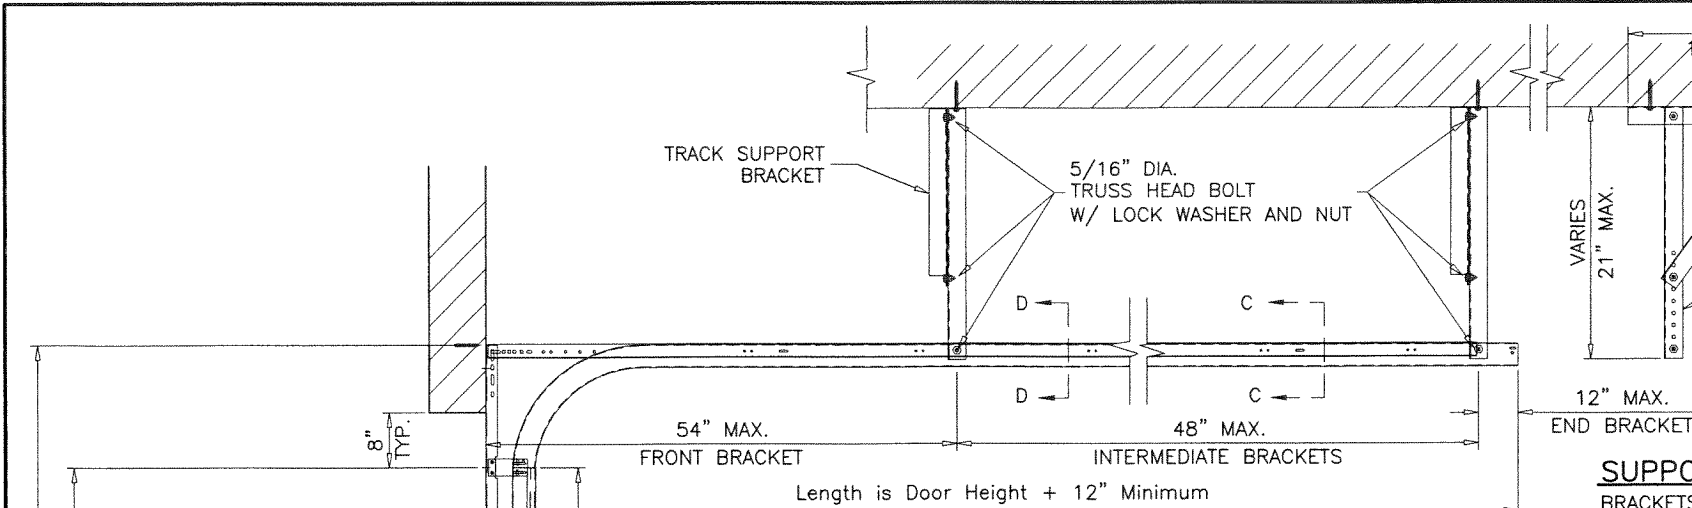

NOTE:
IT SHALL BE VERIFIED THAT THE CEILING STRUCTURE CAN SUSTAIN LOADS IMPOSED BY DOOR WHEN LEFT IN OPEN POSITION.
BRACES MAY BE MOVED IN ORDER TO ENGAGE THE CEILING STRUCTURE.
ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND ALL CEILING NON STRUCTURAL MATERIAL STUCCO OR CEILING DRESSING.

SUPPORT BRACKETS AT EACH TRACK

BRACKETS RUN PERPENDICULAR TO TRACKS
FRONT AND END BRACKETS TO BE SPACED AS SHOWN ABOVE.
ADDITIONAL INTERMEDIATE BRACKETS TO BE INSTALLED FOR SPACING MORE THAN 48" IN BETWEEN FRONT AND END BRACKETS.

BRACKET ANCHORS:


5/16" DIA. LAG SCREWS

INTO WOOD STRUCTURES, (S.G.=0.50)
1-1/2" MIN. PENETRATION
1-1/4" MIN. EDGE DISTANCE

1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)

INTO CONCRETE, 3000 PSI MIN.
1-3/4" MIN. EMBED, 3" MIN. SPACING
1-5/8" MIN. EDGE DISTANCE

ANCHORING TO CEILING OTHER THAN WOOD OR CONCRETE
TO BE REVIEWED SEPARATELY.

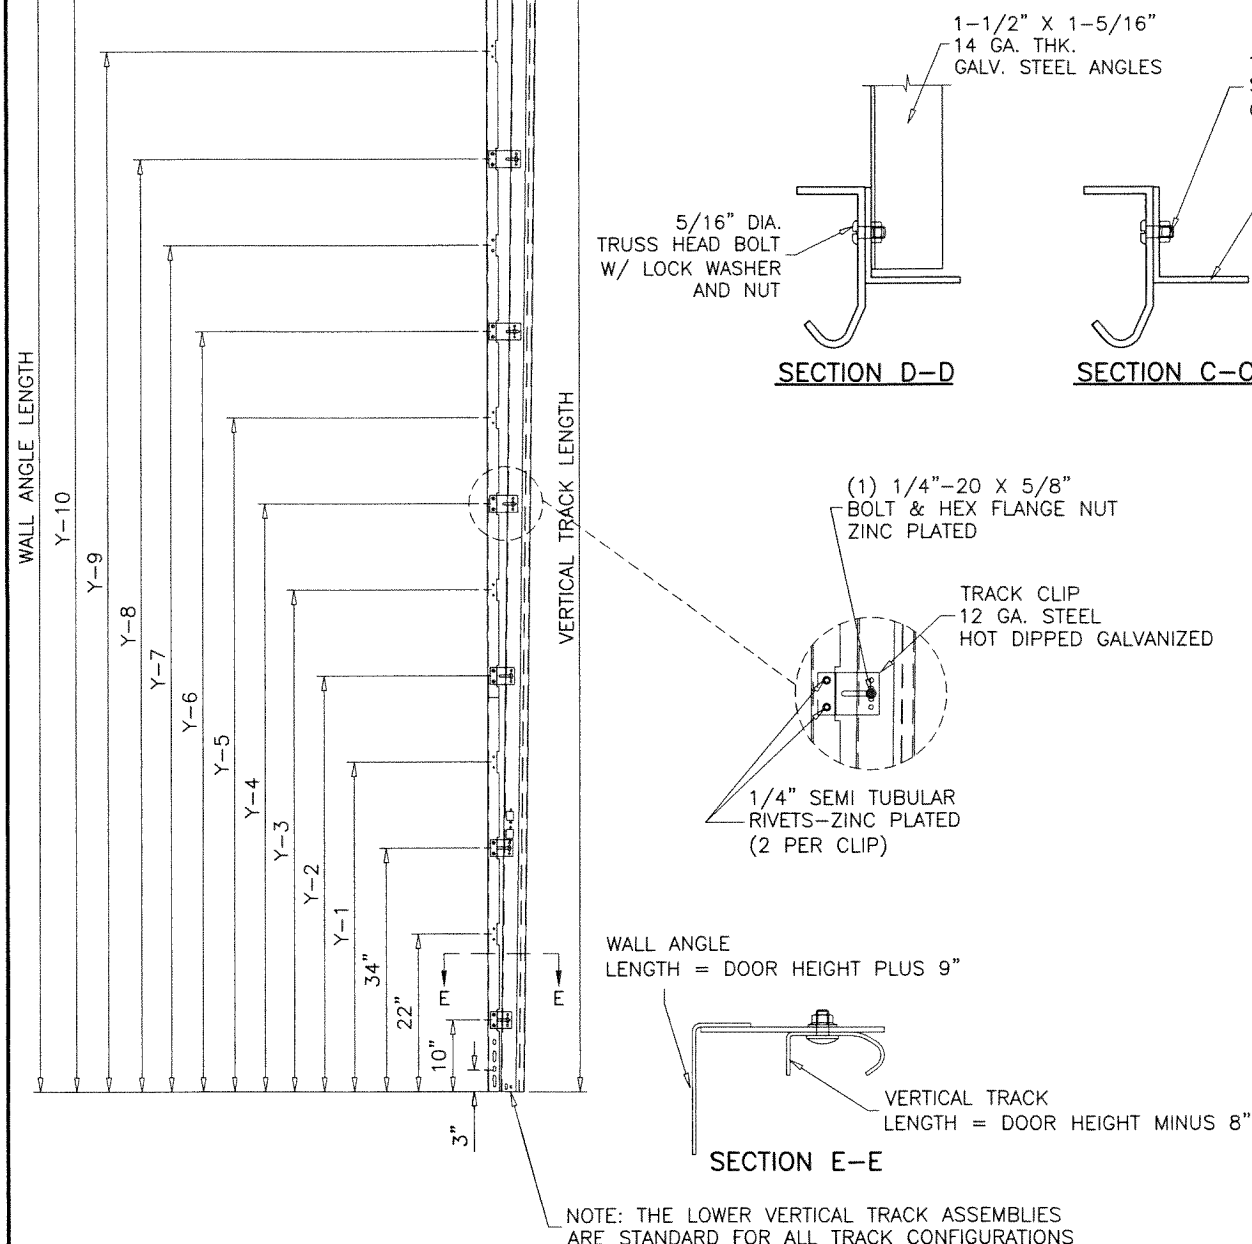


DOOR HEIGHT	VERTICAL TRACK LENGTH	WALL ANGLE LENGTH	TRACK CLIP SPACING									
			Y-1	Y-2	Y-3	Y-4	Y-5	Y-6	Y-7	Y-8	Y-9	Y-10
5' 3"	55"	72"	44"	55"	70"	NA	NA	NA	NA	NA	NA	NA
7' 0"	76"	93"	46"	58"	67"	76"	NA	NA	NA	NA	NA	NA
7' 6"	82"	99"	46"	58"	70"	82"	NA	NA	NA	NA	NA	NA
8' 0"	88"	105"	46"	58"	73"	88"	NA	NA	NA	NA	NA	NA
8' 9"	97"	114"	46"	58"	70"	82"	97"	NA	NA	NA	NA	NA
9' 0"	100"	117"	46"	58"	70"	82"	91"	100"	NA	NA	NA	NA
10' 0"	112"	129"	46"	58"	70"	82"	97"	112"	NA	NA	NA	NA
11' 0"	124"	141"	46"	58"	70"	82"	94"	106"	118"	124"	NA	NA
12' 0"	136"	153"	46"	58"	70"	82"	94"	106"	121"	136"	NA	NA
13' 0"	148"	165"	46"	58"	70"	82"	94"	106"	121"	136"	148"	NA
14' 0"	160"	177"	46"	58"	70"	82"	94"	106"	121"	136"	148"	160"

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 26-0709.05

Expiration Date 07/09/2031

By 
Miami-Dade Product Control

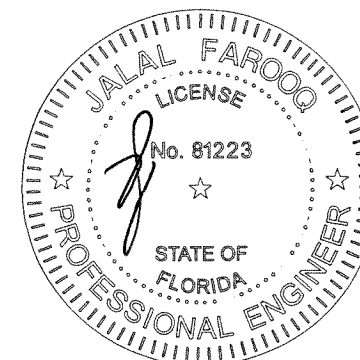




STD. LIFT HIGH LIFT VERTICAL LIFT
AVAILABLE TRACK OPTIONS

JUL 01 2026


AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100
WWW.AFCENG.COM
FBPE #3538

AB 1956 STEEL OVERHEAD GARAGE DOOR
DAB Door Company, Inc.
12193 N.W. 98th Ave.
Hialeah Gardens, FL 33018
Tel: (800) 257-2016 Fax: (305) 362-9272

revisions:	no.	date	by	description
	A	07.01.26		NO CHANGE THIS SHEET
date:	12-10-25			
scale:	1/2" = 1"			
dr. by:	TARIQ			
chk. by:				
drawing no.	25-90D			
sheet	6 of 8			

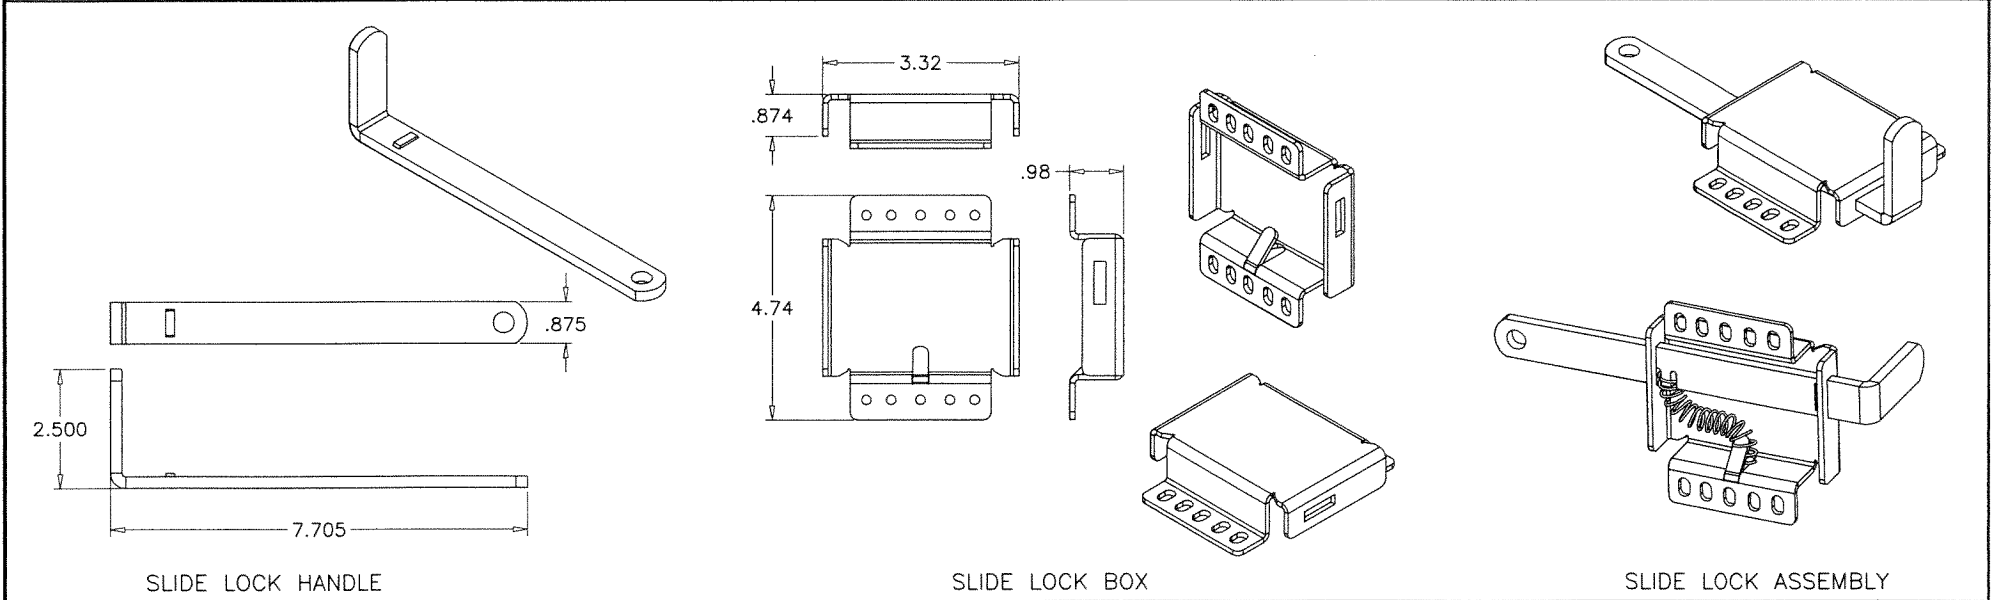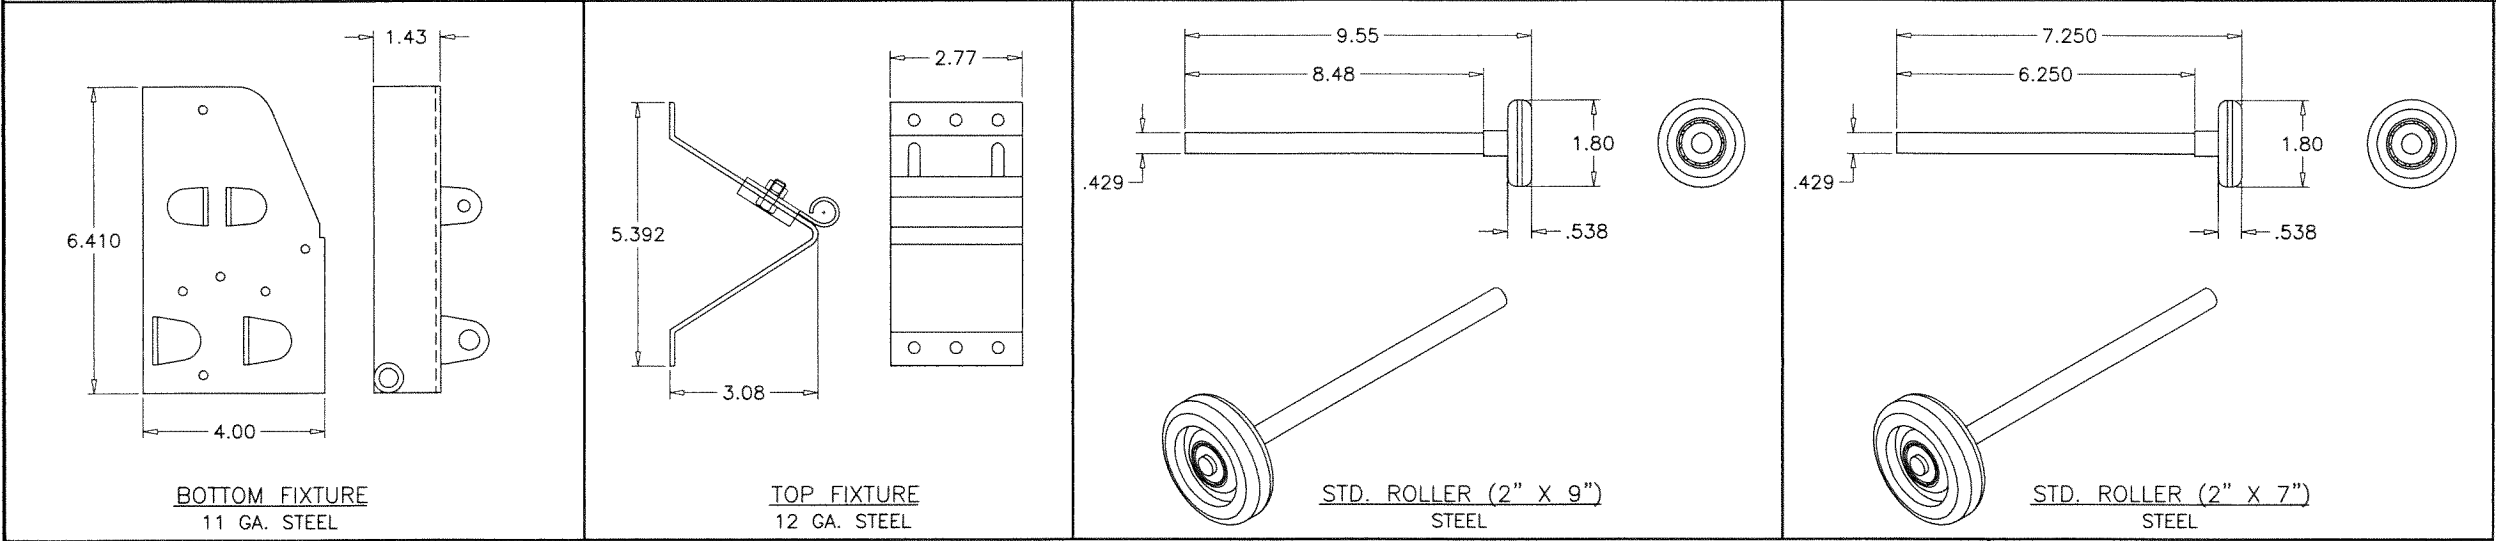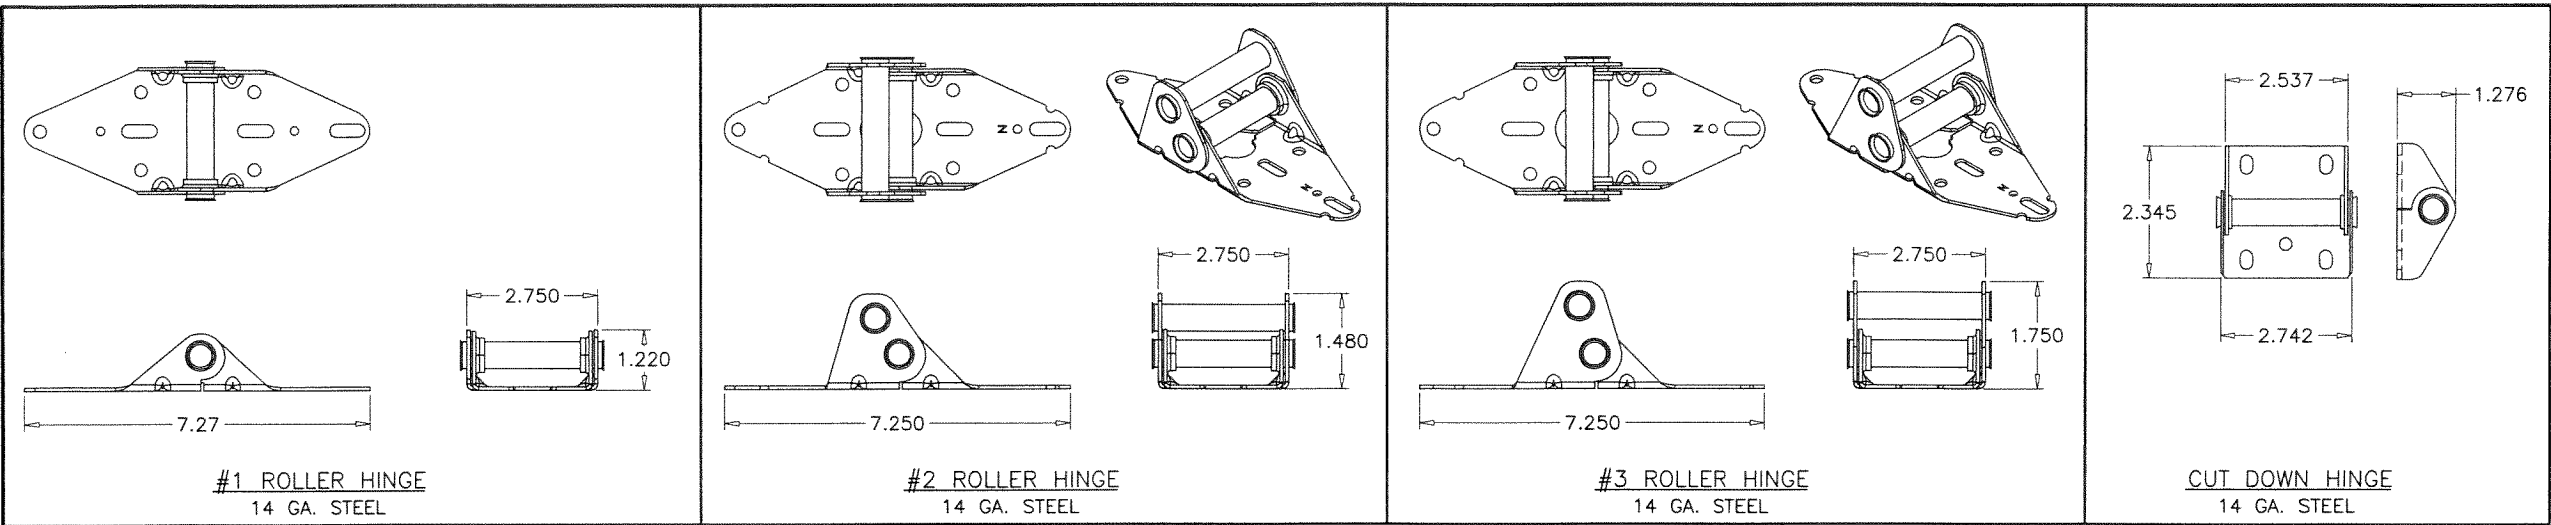

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. **26-0709.05**
Expiration Date **07/09/2031**
By *[Signature]*
Miami-Dade Product Control

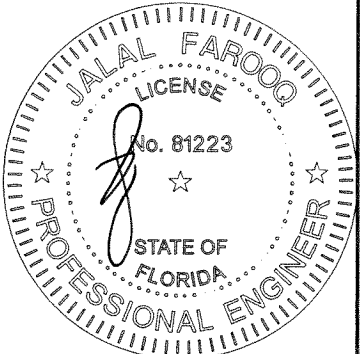

JUL 01 2026

af c

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100
WWW.AFCENG.COM
FBPE #3538

AB 1956 STEEL OVERHEAD GARAGE DOOR

DAB Door Company, Inc.
12193 N.W. 98th Ave.
Hialeah Gardens, FL 33018
Tel: (800) 257-2016 Fax: (305) 362-9272

revisions:		date		description	
no	date	no	date	no	description
A	07.01.26				NO CHANGE THIS SHEET

date: 12-10-25
scale: 1/4" = 1"
dr. by: TARIQ
chk. by:

drawing no.
25-90D
sheet **8** of **8**