



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

Labrador & Fundora Corp dba V & V Windows
14150 N.W. 56th Court, Opa-Locka, FL 33054

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER -Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "S-3000" Aluminum Sliding Glass Doors-LMI.

APPROVAL DOCUMENT: Drawing No. W19-115D Rev D, titled "Series S-3000 Alum Sliding Glass Doors (LMI)", sheets 1 through 28 of 28, prepared by Al-Farooq Corporation, dated 10/25/19 and last revised JUL 07, 2026, signed and sealed by Jalal Farooq, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact.

Limitations:

1. 2-tracks unreinforced SGD with Glass type A & A1 is limited to +/-60 PSF with Max area= 240 SqFt.
2. 3-tracks or 2-tracks reinforced SGD with Glass type B & B1 is limited to +60/-65 PSF with Max area= 360 SqFt. This SGD (Sliding Glass Door) can't be used as Window or as Horizontal Slider.
3. For panel size 48" or wider see extra anchors at head & sill in sheet 3, 4 & 5. Jambs at 3 & 4-tracks require pairs of anchors per location. Sill to be in Concrete substrates only. Head into Concrete, wood or Steel.
4. Pocket wall under separate approval, to be reviewed by AHJ. Pocket jambs into Conc. or grout filled CMU.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and series and following statement: "Miami-Dade County Product Control Approved", noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises # 25-0829.07 consists of this page 1 and evidence pages E-1, E-2, E-3, E-4, E-5 and E-6, as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P.E.**



Ishaq I. Chanda

NOA No. 26-0709.08
Expiration Date: September 02, 2031
Approval Date: July 30, 2026
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections (submitted under files See below)
2. Drawing No. **W19-115D Rev A**, titled "Series S-3000 Alum Sliding Glass Doors (LMI)", sheets 1 through 13 of 13, prepared by Al-Farooq Corporation, dated 10/25/19 and last revised 08/13/21, signed and sealed by Jalal Farooq, P.E.

B. TESTS

1. Test reports on1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
 - 6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94

Along with installation diagrams of Aluminum SGD OXXX, OXO & OX, prepared by Fenestration Testing Lab. Inc., Test reports # **FTL 10698** dated 04/22/21 signed and sealed by Idalmis Ortega, P.E

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC-2020(7th Edition), prepared by Al Farooq Corporation, dated 05/28/21 and last revised on August 13, 2021, signed and sealed by Jalal Farooq, P.E.
2. Glazing complies w/ ASTM E-1300-09 &-16.

D. QUALITY ASSURANCE

1. Miami Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS


1. Notice of Acceptance No. **21-0216.01** issued to Eastman Chemical Company (MA) former Solutia Inc. for their "**Saflex Clear or colored interlayer**", expiring on 05/21/26.

F. STATEMENTS

1. Statement letter of conformance to FBC 2020 (7th Edition) and letter of no financial interest, prepared by Al Farooq Corporation, dated 05/28/21, signed and sealed by Jalal Farooq, P.E.
2. Lab compliance as part of the above referenced test report.
3. Asset purchase agreement dated July 28, 2009, signed by Mr. David Labrador and Mr. Candido D. Vega. *(Submitted under previous NOA No. 10-0406.04)*
4. Florida Department of State, Div of Corporation, active listing of Labrador & Foundora Corporation, dated 08/31/2015 and renewal dated 01/08/2020.
5. Florida Department of State, active fictitious name listing of V& V Windows, dated 08/31/15.

G. OTHER

1. None.



Ishaq I. Chanda, P.E.
Product Control Unit Supervisor
NOA No. 26-0709.08

Expiration Date: September 02, 2031
Approval Date: July 30, 2026

Labrador & Fundora Corp dba V & V Windows

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

2. EVIDENCE SUBMITTED under previous approval

A. DRAWINGS

1. Drawing No. **W19-115D Rev B**, titled "Series S-3000 Alum Sliding Glass Doors (LMI)", sheets 1 through 13 of 13, prepared by Al-Farooq Corporation, dated 10/25/19 and last revised Jun 13, 2023, signed and sealed by Jalal Farooq, P.E.

Note: This revision consists of FBC 2023 (8th Edition) only.

B. TESTS (submitted under previous approval)

1. None.

C. CALCULATIONS (submitted under previous approval)

1. None.

D. QUALITY ASSURANCE

1. Miami Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **21-0216.01** issued to Eastman Chemical Company (MA) former Solutia Inc. for their "**Saflex Clear or colored interlayer**", expiring on 05/21/26.

F. STATEMENTS (items #2 thru #4, submitted under previous approval)

1. Statement letter of conformance to FBC 2020 (7th Edition) and FBC 2023 (8th Edition) and letter of no financial interest, prepared by Al Farooq Corporation, dated 06/14/23, signed and sealed by Jalal Farooq, P.E.
2. Asset purchase agreement dated July 28, 2009, signed by Mr. David Labrador and Mr. Candido D. Vega. (*Submitted under previous NOA No. 10-0406.04*)
3. Florida Department of State, Div of Corporation, active listing of Labrador & Foundora Corporation, dated 08/31/2015 and renewal dated 01/08/2020.
4. Florida Department of State, active fictitious name listing of V& V Windows, dated 08/31/15.

G. OTHER

1. This NOA revises # **21-0601.01**, expiring 09/02/2026.


Ishaq I. Chanda, P.E.
Product Control Unit Supervisor
NOA No. 26-0709.08
Expiration Date: September 02, 2031
Approval Date: July 30, 2026

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

3. EVIDENCE SUBMITTED under previous approval

A. DRAWINGS

1. Drawing No. **W19-115D Rev C**, titled "Series S-3000 Alum Sliding Glass Doors (LMI)", sheets 1 through 28 of 28, prepared by Al-Farooq Corporation, dated 10/25/19 and last revised MAY 01, 2024, signed and sealed by Jalal Farooq, P.E.

B. TESTS

1. Test reports on
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
 - 6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94

Along with installation diagrams of Aluminum SGD OXXX and OXXXXXXp, prepared by Hurricane Engineering & Testing Lab. Inc., Test reports # **HETI -23-8096 & HETI -23-8098** dated 01/24/24 & 02/07/24 respectively, signed and sealed by Ram N. Tewari, P.E.

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC-2023 (8th Edition), prepared by Al Farooq Corporation, dated 05/01/24, signed and sealed by Jalal Farooq, P.E.
2. Remedial weep holes analysis w/ higher sill riser dated 03/27/24 due to test errors, compared for equivalency with previous test, prepared by Al-Farooq Corporation.
3. Glazing complies w/ ASTM-E-1300-09 &-16.

D. QUALITY ASSURANCE


1. Miami Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **21-0216.01** issued to Eastman Chemical Company (MA) former Solutia Inc. for their "**Saflex Clear or colored interlayer**", expiring on 05/21/26.
2. Notice of Acceptance No. **22-1116.01** issued to **Kuraray America, Inc.** for their "**SentryGlas® (Clear and White) Glass Interlayers**", expiring on 07/04/28.

F. STATEMENTS (items #2 thru #4, submitted under previous approval)

1. Statement letter of conformance to FBC 2023 (8th Edition) and letter of no financial interest, prepared by Al Farooq Corporation, dated 05/01/24, signed and sealed by Jalal Farooq, P.E.
2. Asset purchase agreement dated July 28, 2009, signed by Mr. David Labrador and Mr. Candido D. Vega. *(Submitted under previous NOA No. 10-0406.04)*


Ishaq I. Chanda, P.E.
Product Control Unit Supervisor
NOA No. 26-0709.08
Expiration Date: September 02, 2031
Approval Date: July 30, 2026

Labrador & Fundora Corp dba V & V Windows


NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

F. STATEMENTS (continue)

3. Florida Department of State, Div of Corporation, active listing of Labrador & Foundora Corporation, dated 08/31/2015 and updated annual report year 01/29/24.
4. Florida Department of State, active fictitious name listing of V& V Windows (registration #G15000089765), dated 08/31/15, verified active listing on 06/28/24.

G. OTHER

1. This NOA **revises # 23-0620.12**, updated to FBC 2023 (8th Edition), expiring 09/02/2026.
2. Test Proposals #24-0407 dated 04/19/24 & # 22-0975 dated 05/23/23 approved by RER.



Ishaq I. Chanda, P.E.
Product Control Unit Supervisor
NOA No. 26-0709.08
Expiration Date: September 02, 2031
Approval Date: July 30, 2026

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

4. EVIDENCE SUBMITTED under previous files

A. DRAWINGS

1. Drawing No. **W19-115D Rev C**, titled "Series S-3000 Alum Sliding Glass Doors (LMI)", sheets 1 through 28 of 28, prepared by Al-Farooq Corporation, dated 10/25/19 and last revised MAY 01, 2024, signed and sealed by Jalal Farooq, P.E.

B. TESTS (submitted under previous approval)

1. None.

C. CALCULATIONS (submitted under previous approval)

1. None.

D. QUALITY ASSURANCE

1. Miami Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS


1. Notice of Acceptance No. **21-0216.01** issued to Eastman Chemical Company (MA) former Solutia Inc. for their "**Saflex Clear or colored interlayer**", expiring on 05/21/26.
2. Notice of Acceptance No. **22-1116.01** issued to **Kuraray America, Inc.** for their "**SentryGlas® (Clear and White) Glass Interlayers**", expiring on 07/04/28.

F. STATEMENTS (items #2 thru #5, submitted under previous approval)

1. Statement letter dated AUG 28, 2025 for the compliance to FBC 2023 (8th Edition) and letter of no financial interest, prepared by Al Farooq Corporation, signed and sealed by Jalal Farooq, P.E
2. Statement letter of conformance to FBC 2023 (8th Edition) and letter of no financial interest, prepared by Al Farooq Corporation, dated 05/01/24, signed and sealed by Jalal Farooq, P.E.
3. Asset purchase agreement dated July 28, 2009, signed by Mr. David Labrador and Mr. Candido D. Vega. *(Submitted under previous NOA No. 10-0406.04)*
4. Florida Department of State, Div of Corporation, active listing of Labrador & Foundora Corporation, dated 08/31/2015 and updated annual report year 02/25/25.
5. Florida Department of State, active fictitious name listing of V& V Windows (registration #G15000089765), dated 08/31/15, verified active listing on 09/05/25.

G. OTHER

1. This NOA **renews # 24-0613.01**, expiring 09/02/2031.


Ishaq I. Chanda, P.E.
Product Control Unit Supervisor
NOA No. 26-0709.08
Expiration Date: September 02, 2031
Approval Date: July 30, 2026

Labrador & Fundora Corp dba V & V Windows

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

5. New EVIDENCE SUBMITTED

A. DRAWINGS

1. Drawing No. **W19-115D Rev D**, titled "Series S-3000 Alum Sliding Glass Doors (LMI)", sheets 1 through 28 of 28, prepared by Al-Farooq Corporation, dated 10/25/19 and last revised JUL 07, 2026, signed and sealed by Jalal Farooq, P.E.

B. TESTS (submitted under previous approval)

1. None.

C. CALCULATIONS (submitted under previous approval)

1. None.

D. QUALITY ASSURANCE

1. Miami Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **25-0904.04** issued to Eastman Chemical Company (MA) former Solutia Inc. for their "**Saflex Clear or colored interlayer**", expiring on 05/21/31.
2. Notice of Acceptance No. **22-1116.01** issued to **Kuraray America, Inc.** for their "**SentryGlas® (Clear and White) Glass Interlayers**", expiring on 07/04/28.

F. STATEMENTS

1. Statement letter dated JUL 07, 2026 for the compliance to FBC 2026 (9th Edition) and FBC 2023 (8th Edition) and letter of no financial interest, prepared by Al Farooq Corporation, signed and sealed by Jalal Farooq, P.E.

G. OTHER

1. This NOA revises # **25-0829.07**, updates to FBC 2026, expiring 09/02/2031.



Ishaq I. Chanda, P.E.
Product Control Unit Supervisor
NOA No. 26-0709.08
Expiration Date: September 02, 2031
Approval Date: July 30, 2026


The following pages in this document were submitted by the manufacturer (third party) to represent the product being approved and establish the limits of use. The pages may include technical drawings, schematics and installation details.

DESIGN LOAD CAPACITY - PSF					
AVERAGE PANEL WIDTH INCHES	DOOR FRAME HEIGHT INCHES	UNREINFORCED INTERLOCKS		REINFORCED INTERLOCKS	
		GLASS TYPES 'A' & 'Ai'		GLASS TYPES 'B' & 'Bi'	
		EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
30	84	60.0	60.0	60.0	65.0
36		60.0	60.0	60.0	65.0
42		60.0	60.0	60.0	65.0
48		60.0	60.0	60.0	65.0
54		60.0	60.0	60.0	65.0
60		55.7	55.7	60.0	65.0
30	90	60.0	60.0	60.0	65.0
36		60.0	60.0	60.0	65.0
42		60.0	60.0	60.0	65.0
48		60.0	60.0	60.0	65.0
54		60.0	60.0	60.0	65.0
60		-	-	60.0	65.0
30	96	60.0	60.0	60.0	65.0
36		60.0	60.0	60.0	65.0
42		60.0	60.0	60.0	65.0
48		60.0	60.0	60.0	65.0
54		-	-	60.0	65.0
60		-	-	60.0	65.0
30	102	60.0	60.0	60.0	65.0
36		60.0	60.0	60.0	65.0
42		60.0	60.0	60.0	65.0
48		60.0	60.0	60.0	65.0
54		-	-	60.0	65.0
60		-	-	60.0	65.0
30	108	60.0	60.0	60.0	65.0
36		60.0	60.0	60.0	65.0
42		60.0	60.0	60.0	65.0
48		60.0	60.0	60.0	65.0
47-3/4	108	60.0	60.0 *	60.0	65.0
30	114"	-	-	60.0	65.0
36		-	-	60.0	65.0
42		-	-	60.0	65.0
48		-	-	60.0	65.0
30	120"	-	-	60.0	65.0
36		-	-	60.0	65.0
42		-	-	60.0	65.0
48		-	-	60.0	65.0


*
FOR 4 PANEL DOORS ONLY

AVERAGE PANEL WIDTH = $\frac{\text{DOOR FRAME WIDTH}}{\text{NUMBER OF PANELS}}$

DOOR HEIGHT AND WIDTH SIZE MUST COMPLY
EGRESS REQUIREMENTS PER FBC AS REQUIRED.

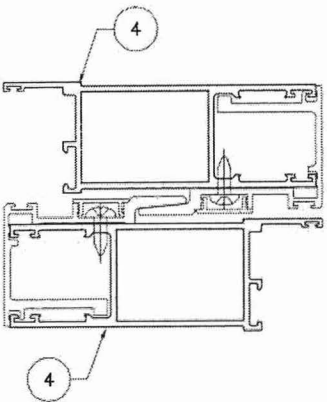

UNREINFORCED
INTERLOCKS

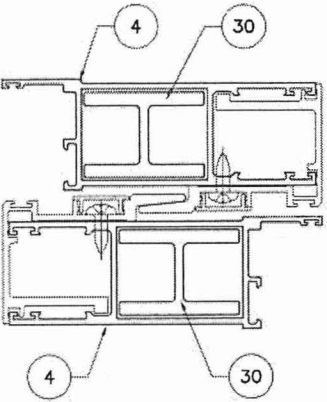

REINFORCED
INTERLOCKS

THESE DOORS ARE RATED FOR LARGE & SMALL MISSILE IMPACT.
SHUTTERS ARE NOT REQUIRED.

SERIES-3000

ALUMINUM SLIDING GLASS DOOR

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE
REQUIREMENTS OF THE 2023 (8TH EDITION)/2026 (9TH EDITION) FLORIDA
BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

1BY OR 2BY WOOD BUCKS & BUCK FASTENERS BY OTHERS, MUST BE
DESIGNED AND INSTALLED ADEQUATELY TO TRANSFER APPLIED PRODUCT
LOADS TO THE BUILDING STRUCTURE.

ANCHORS TO BE SPACED AS SHOWN ON DETAILS AND INSTALLED PER
MANUF'S INSTRUCTIONS. SPECIFIED EMBEDMENT TO BASE MATERIAL SHALL
BE BEYOND WALL DRESSING OR STUCCO.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

ALL SHIMS TO BE LOAD-BEARING, (HIGH DENSITY PLASTIC/COMPOSITE, METAL
OR OTHER RIGID MATERIALS).

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT
COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE
REQUIREMENTS OF THE 2023/2026 FLORIDA BLDG. CODE & ADOPTED STANDARDS.

THIS PRODUCT APPROVAL IS GENERIC AND DOES NOT PROVIDE INFORMATION
FOR A SITE SPECIFIC PROJECT, i.e. LIFE SAFETY OF THIS PRODUCT, ADEQUACY
OF STRUCTURE RECEIVING THIS PRODUCT AND SEALING AROUND OPENING FOR
WATER INFILTRATION RESISTANCE ETC.

CONDITIONS NOT SHOWN IN THIS DRAWING ARE TO BE ANALYZED SEPARATELY,
AND TO BE REVIEWED BY BUILDING OFFICIAL.


DESIGN LOADS SHOWN ARE BASED ON 'ALLOWABLE STRESS DESIGN (ASD)'.

FASTENERS AND CONNECTORS (AS APPLICABLE) SHOWN IN THIS APPROVAL MAY NOT MEET
CORROSION RESISTANCE REQUIREMENTS FOR COASTAL OR SALT WATER EXPOSURE ZONES.
COMPLIANCE WITH THESE CONDITIONS TO BE CHECKED PER FBC 1711.

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 26-0708-08
Expiration Date 9/2/2031

By Jahangir Ullah
Miami Dade Product Control

**LAMINATED GLASS
INSUL. LAM. GLASS
LARGE MISSILE IMPACT**

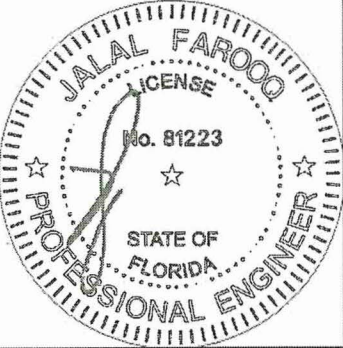

JUL 07 2026

NOTE:
GLASS CAPACITIES ARE BASED ON
ASTM E1300-16 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219


afC
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL 19-115D-W

S-3000 ALUM SLIDING GLASS DOOR (L.M.I.)
Labrador & Fundora Corp.
dba - Y & V Windows
14150 N.W. 56th Court, Suite 600
Opa-Locka, FL 33054
Tel. (305) 888-4151
www.vvwindows.com


revisions:	no.	date	by	description
	A	08.13.21		NO CHANGE THIS SHEET
	B	06.07.23		UPDATED TO 2023 FBC
	C	02.23.24		GENERAL REVISION
	D	06.23.26		UPDATED TO 2026 FBC

date:	10-25-19
scale:	3/8" = 1"
dr. by:	TARIO
chk. by:	


drawing no.	19-115D
sheet	1 of 28

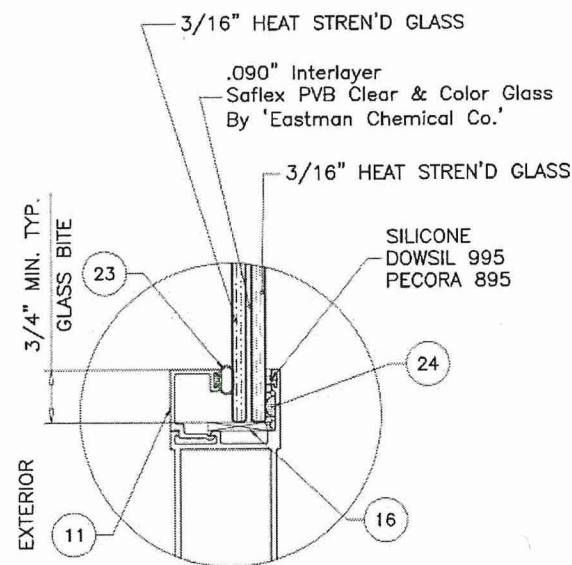


GLASS TYPE 'A'
7/16" OVERALL LAM. GLASS

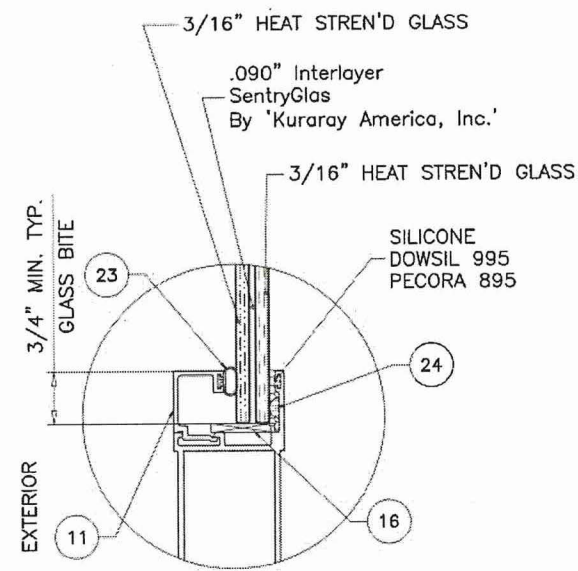

GLASS TYPE 'B'
7/16" OVERALL LAM. GLASS

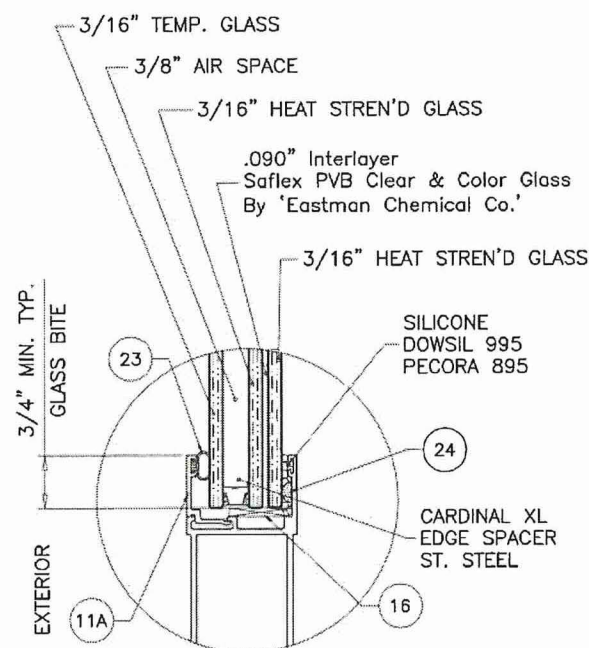


GLASS TYPE 'Ai'
1" OVERALL INSUL. LAM. GLASS

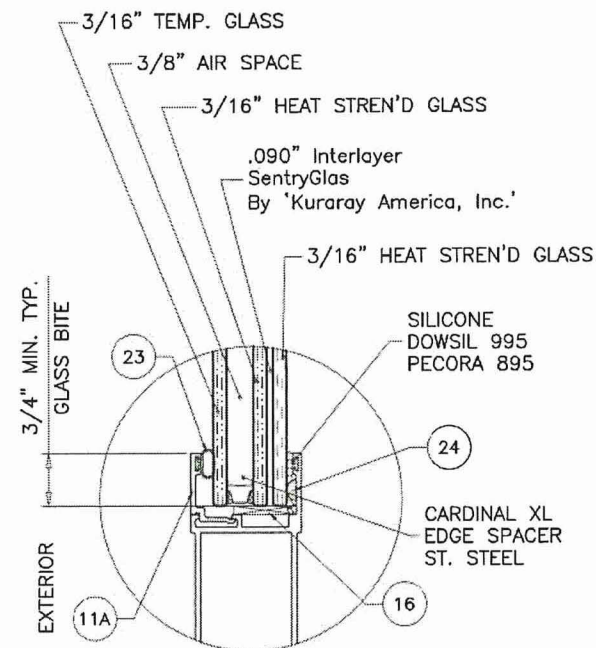

GLASS TYPE 'Bi'
1" OVERALL INSUL. LAM. GLASS

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 26-0709-08
Expiration Date 9/2/2031
By Khalid I. Ummat
Miami-Dade Product Control

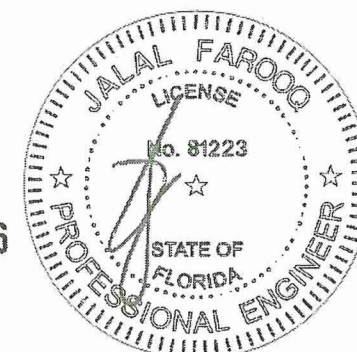

JUL 07 2026

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL (305) 264-8100 FAX (305) 262-6978
COMP-ANL 19-115D-W

www.vvwindows.com

S-3000 ALUM SLIDING GLASS DOOR (L.M.I.)


Labrador & Fundora Corp.
dba - V & V Windows
14150 N.W. 56th Court, Suite 600
Opa-Locka, FL 33054
Tel. (305) 888-4151

revisions:

no	date	description
A	08.13.21	NO CHANGE THIS SHEET
B	06.07.23	UPDATED TO 2023 FBC
C	02.23.24	GENERAL REVISION
D	06.23.26	UPDATED TO 2025 FBC

date: 10-25-19
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:

drawing no.
19-115D
sheet 2 of 28

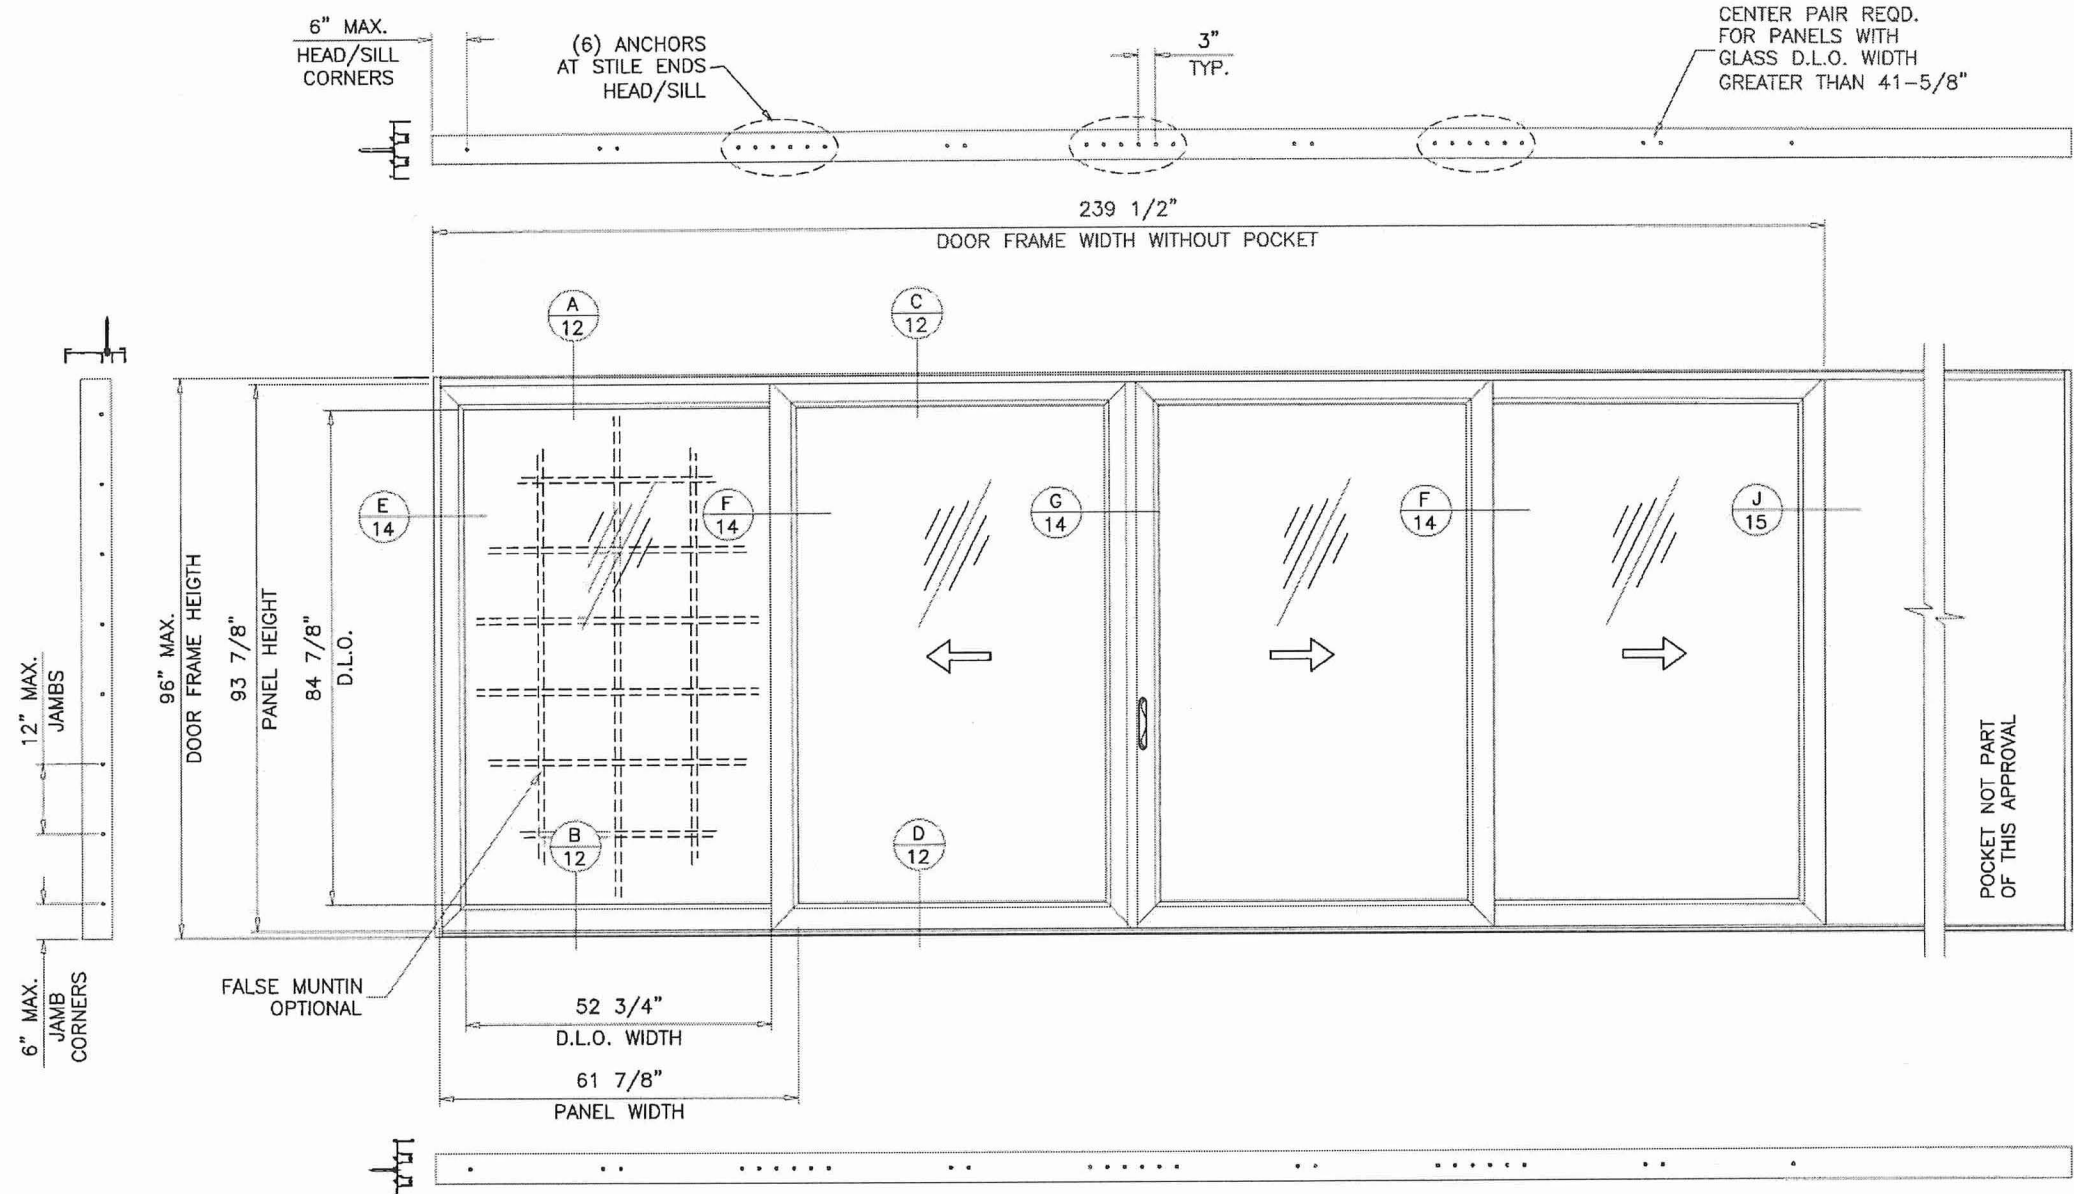

TYPICAL ELEVATION
OX-XXP (2 TRACKS)
(TESTED UNIT)

2 TRACK FRAMES:
FOR ALTERNATE SIZES/NUMBER OF PANELS
MAX. DOOR AREA NOT TO EXCEED 240.0 SQ. FT.
PANEL WIDTH AND HEIGHT NOT TO EXCEED SIZES SHOWN IN CHART ON SHEET 1
POCKETS NOT INCLUDED.

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 26-0709-08
Expiration Date 9/2/2031
By Ishag L. Khan
Miami Dade Product Control



JUL 07 2026

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
C.A.N. 3538

COMP-ANL 19-115D-W


S-3000 ALUM SLIDING GLASS DOOR (L.M.I.)

Labrador & Fundora Corp.
dba-V & V Windows
14150 N.W. 56th Court, Suite 600
Opa-Locka, FL 33054
Tel. (305) 888-4151
www.vvwindows.com

revisions:	
no	description
A	08.13.21 NO CHANGE THIS SHEET
B	06.07.23 UPDATED TO 2023 FBC
C	02.23.24 GENERAL REVISION
D	06.23.26 NO CHANGE THIS SHEET

date: 10-25-19
scale: 3/8"=1'-0"
dr. by: TARIQ
chk. by:

drawing no.
19-115D
sheet 3 of 28

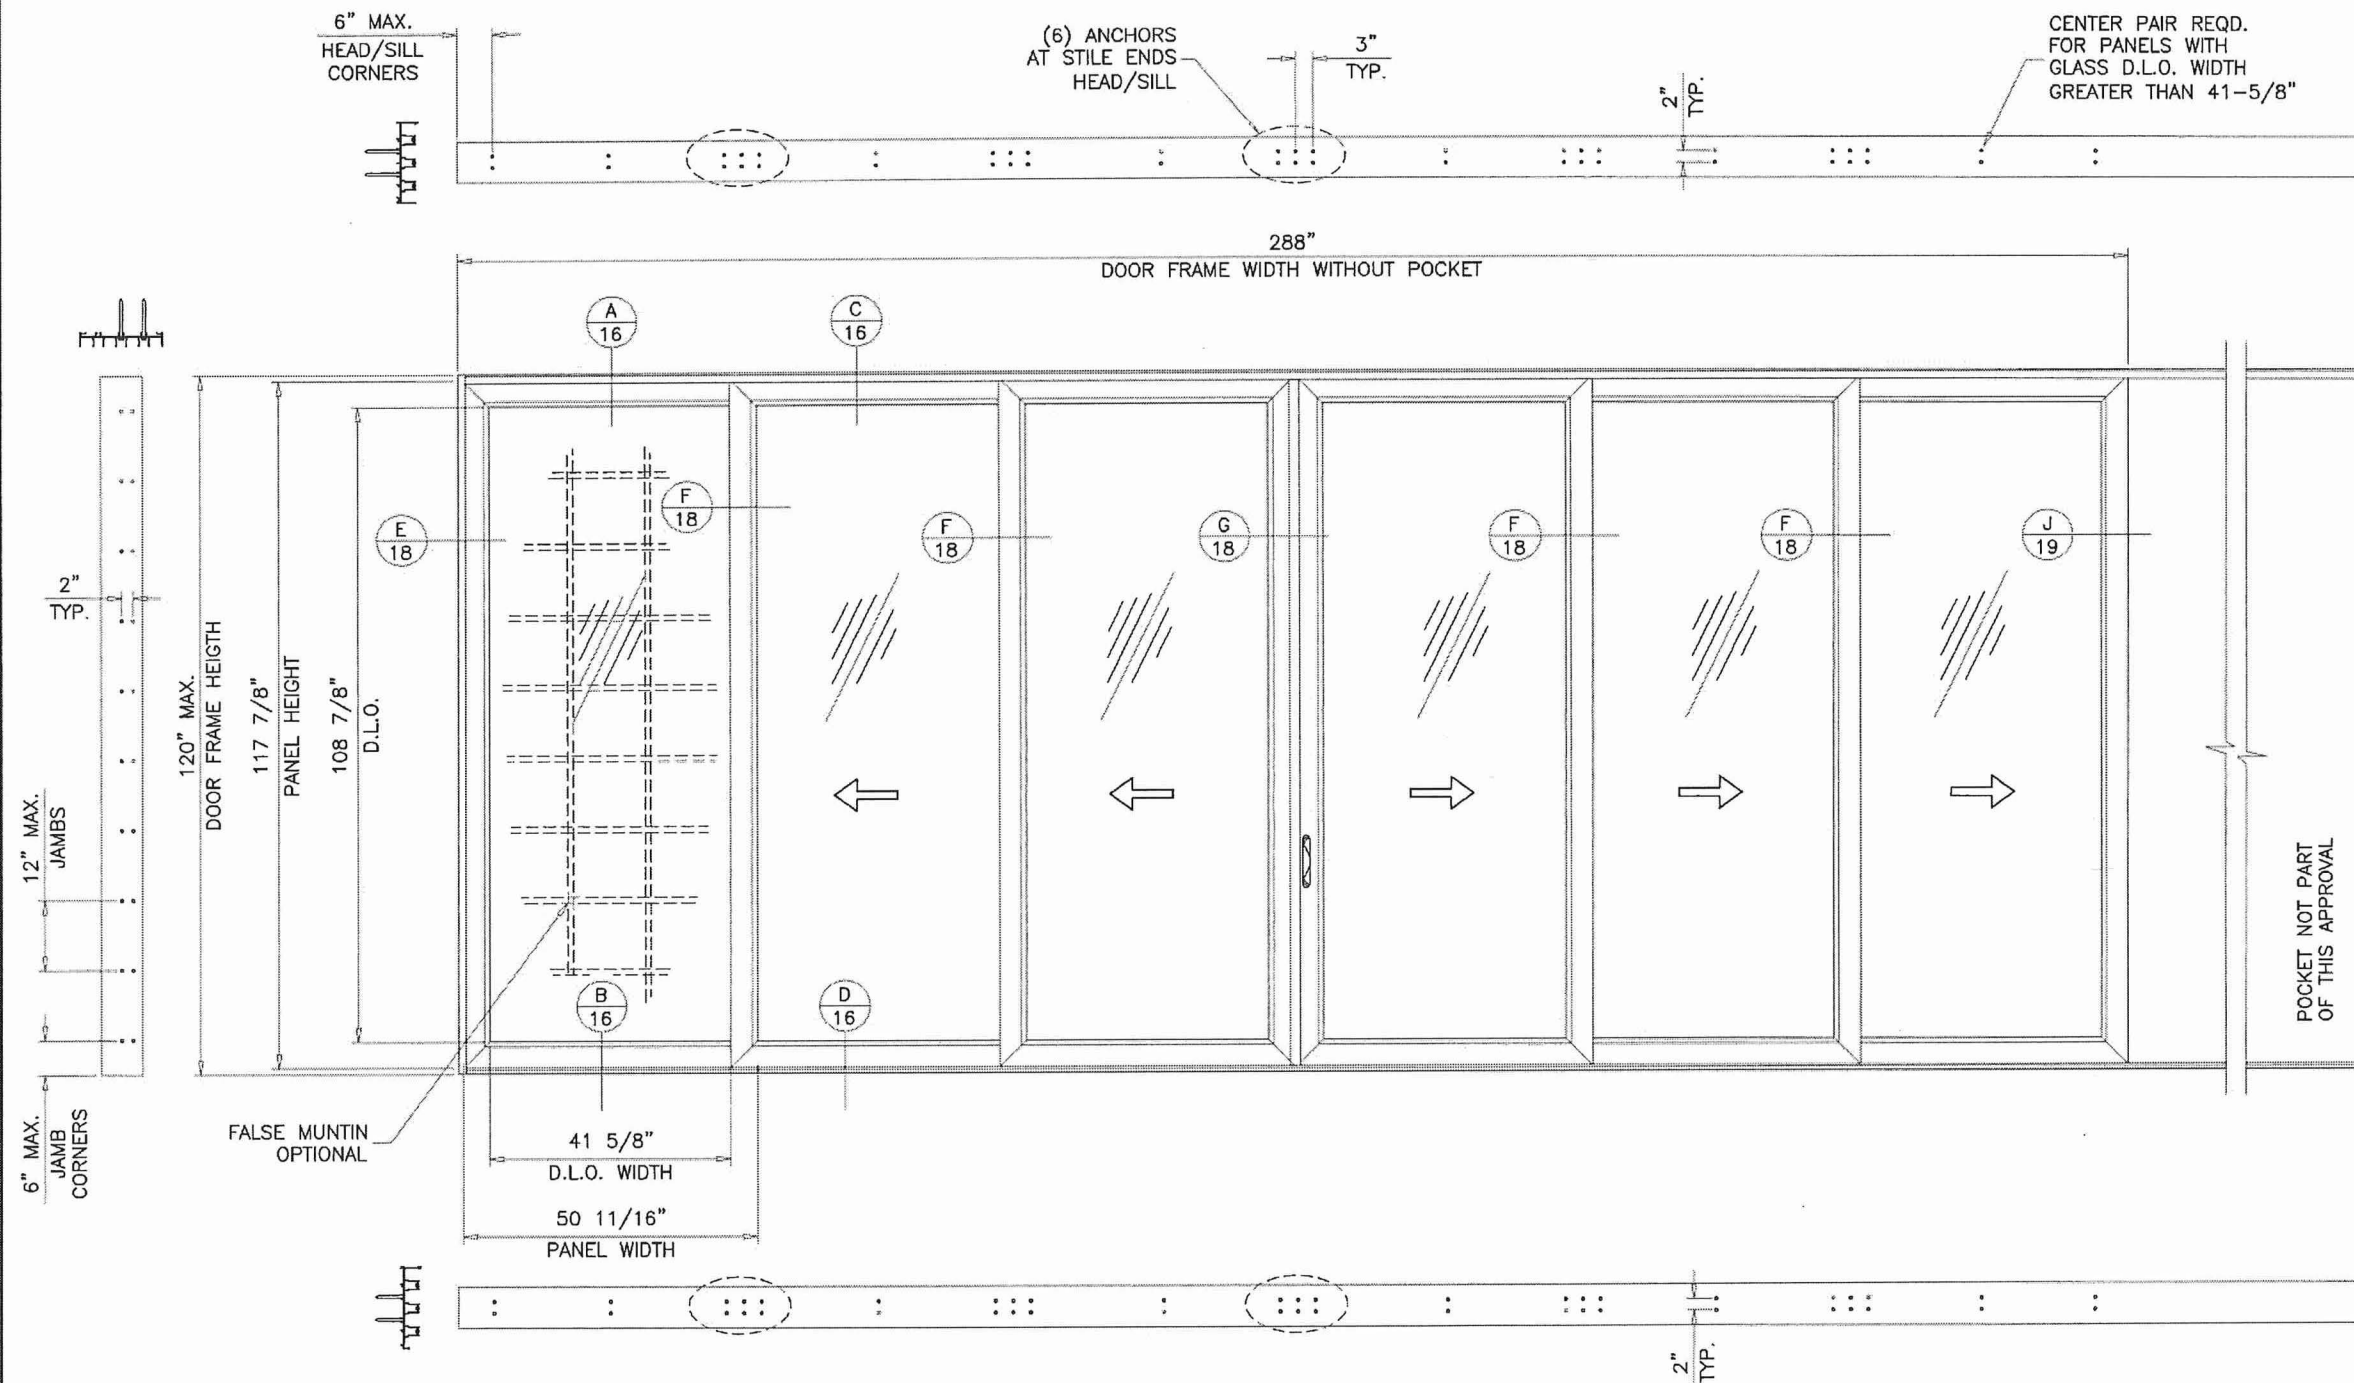


TYPICAL ELEVATION

OXX-XXXP (3 TRACKS)
(TESTED UNIT)

3 TRACK FRAMES:
FOR ALTERNATE SIZES/NUMBER OF PANELS
MAX. DOOR AREA NOT TO EXCEED 360.0 SQ. FT.
PANEL WIDTH AND HEIGHT NOT TO EXCEED SIZES SHOWN IN CHART ON SHEET 1
POCKETS NOT INCLUDED.

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 26-0709-08
Expiration Date 9/2/2031
By Iskander I. Ullah
Miami Dade Product Control

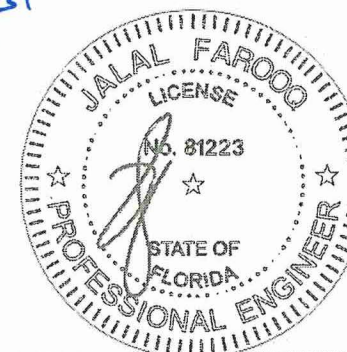

JUL 07 2026

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
(C.A.N. 3538)

S-3000 ALUM SLIDING GLASS DOOR (L.M.I.)

Labrador & Fundora Corp.

dba-V & V Windows

14150 N.W. 56th Court, Suite 600

Opa-Locka, FL 33054

Tel. (305) 888-4151

www.vvwindows.com

revisions:		by description	
no	date	no	date
C	02.23.24		
D	06.23.26		
GENERAL REVISION		NO CHANGE THIS SHEET	


date: 10-25-19
scale: 3/8"=1'-0"
dr. by: TARIQ
chk. by:

drawing no.

19-115D

sheet 4 of 28


COMP-ANL\19-115D-W

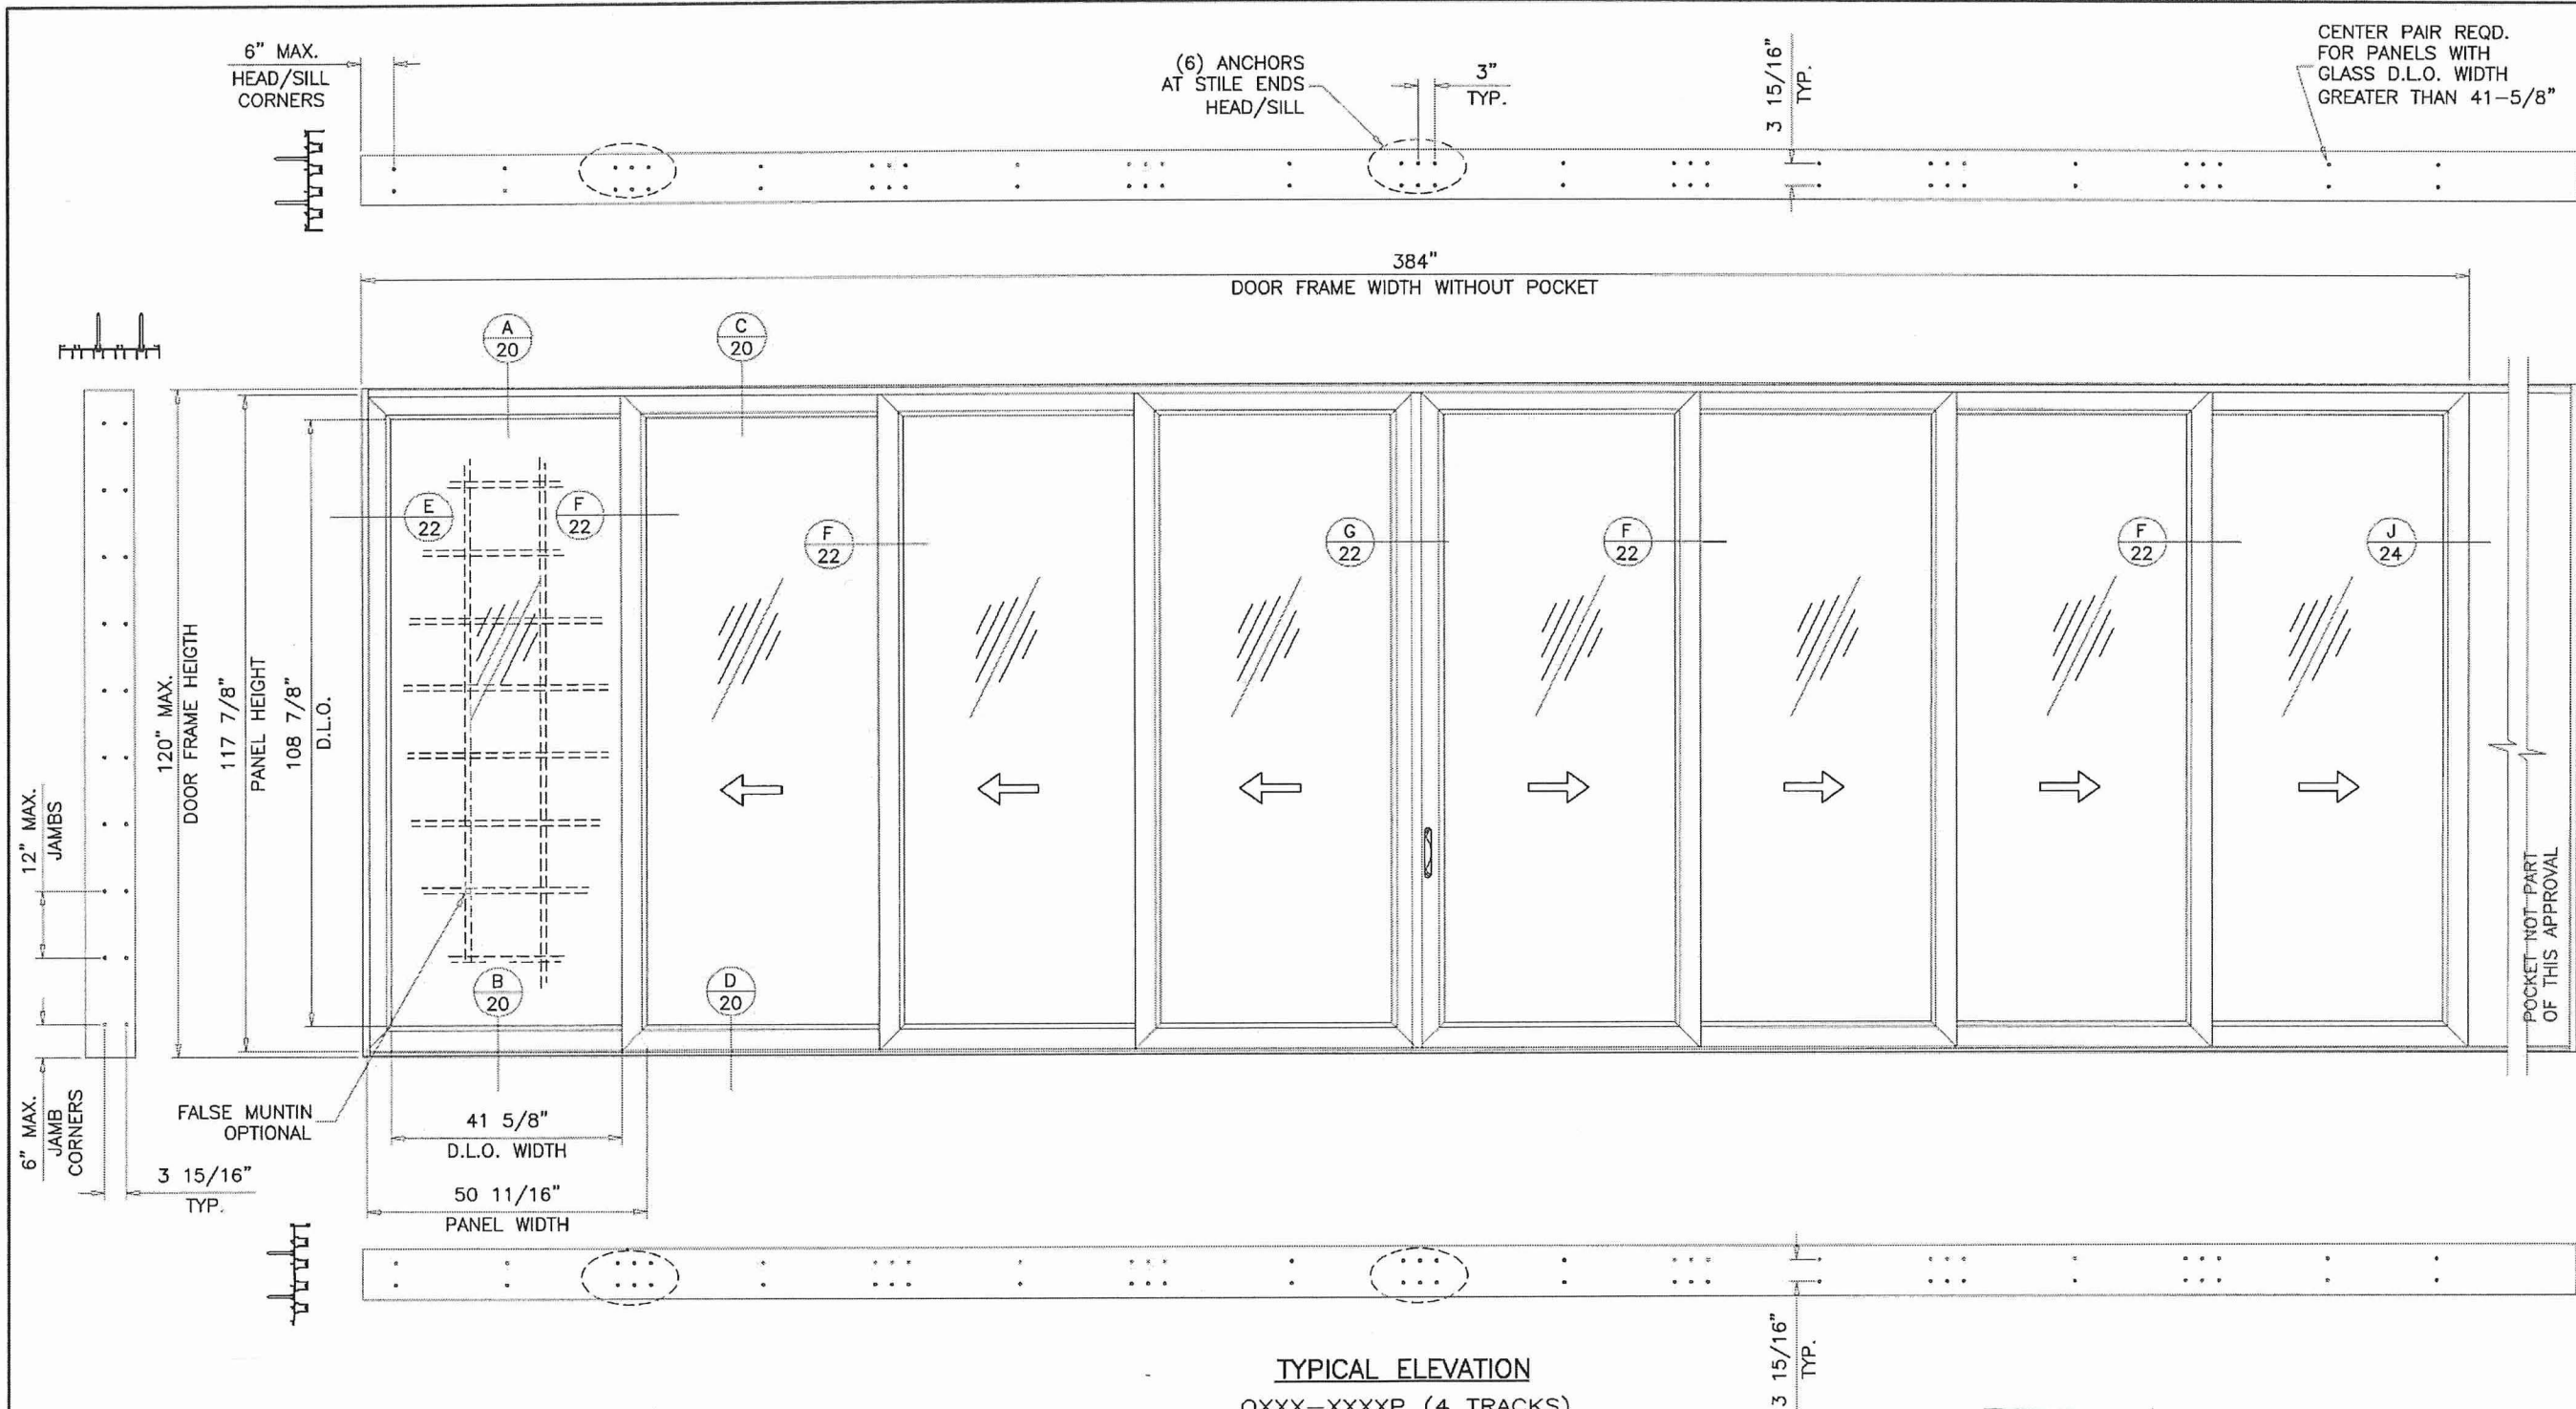

TYPICAL ELEVATION
OXXX-XXXXP (4 TRACKS)

4 TRACK FRAMES:
FOR ALTERNATE SIZES/NUMBER OF PANELS
MAX. DOOR AREA NOT TO EXCEED 360.0 SQ. FT.
PANEL WIDTH AND HEIGHT NOT TO EXCEED SIZES SHOWN IN CHART ON SHEET 1
POCKETS NOT INCLUDED.

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 27-0709.08
Expiration Date 9/2/2031
By Ismael I. Hernandez
Miami Dade Product Control

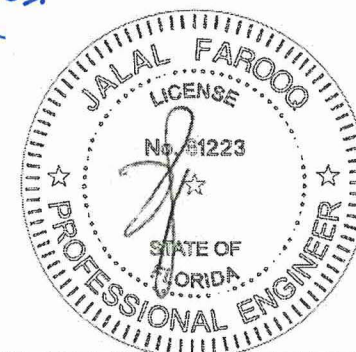

JUL 07 2026

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\19-115D-W

a f c

S-3000 ALUM SLIDING GLASS DOOR (L.M.I.)









Labrador & Fundora Corp.
dba-V & V Windows
14150 N.W. 56th Court, Suite 600
Opa-Locka, FL. 33054
Tel. (305) 888-4151
www.vvwindows.com

revisions:

no	date	by	description
C	02.23.24	TARIQ	GENERAL REVISION
D	06.23.26		NO CHANGE THIS SHEET

date: 10-25-19
scale: 3/8"=1'-0"
dr. by: TARIQ
chk. by:

drawing no.
19-115D
sheet 5 of 28

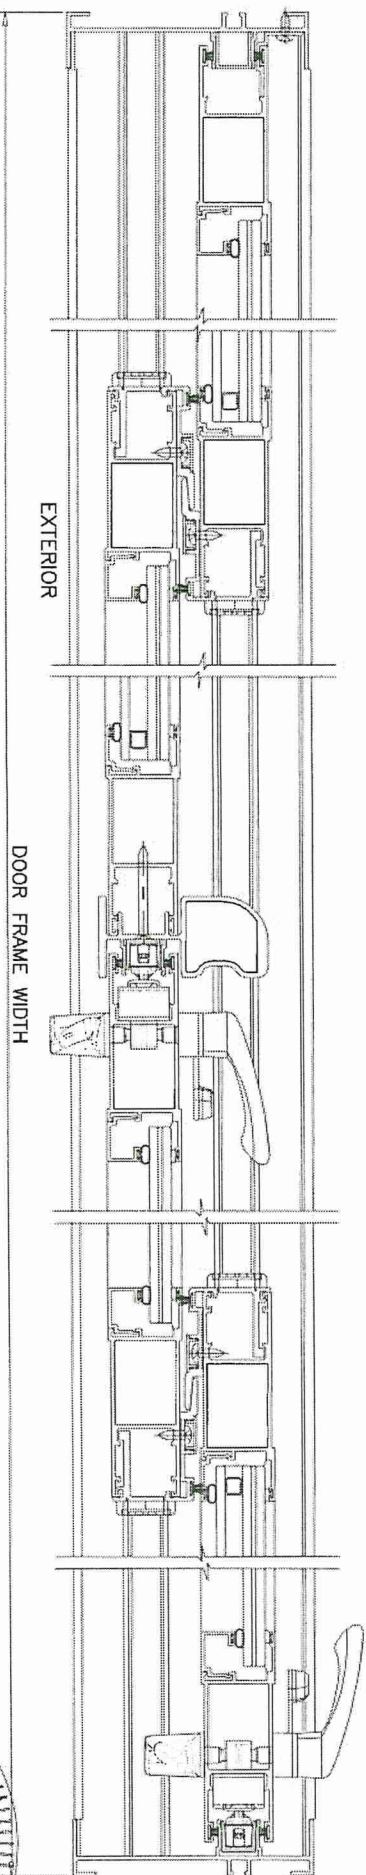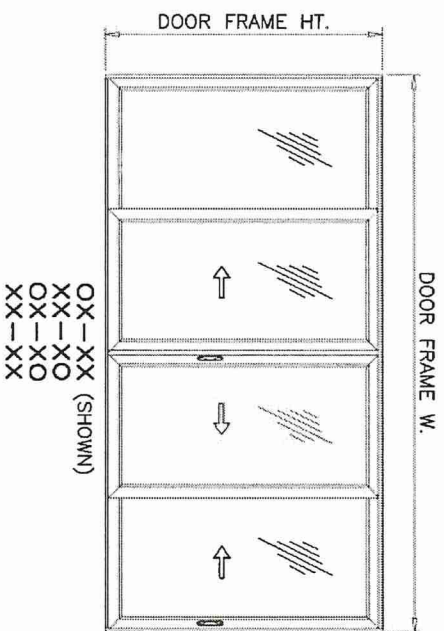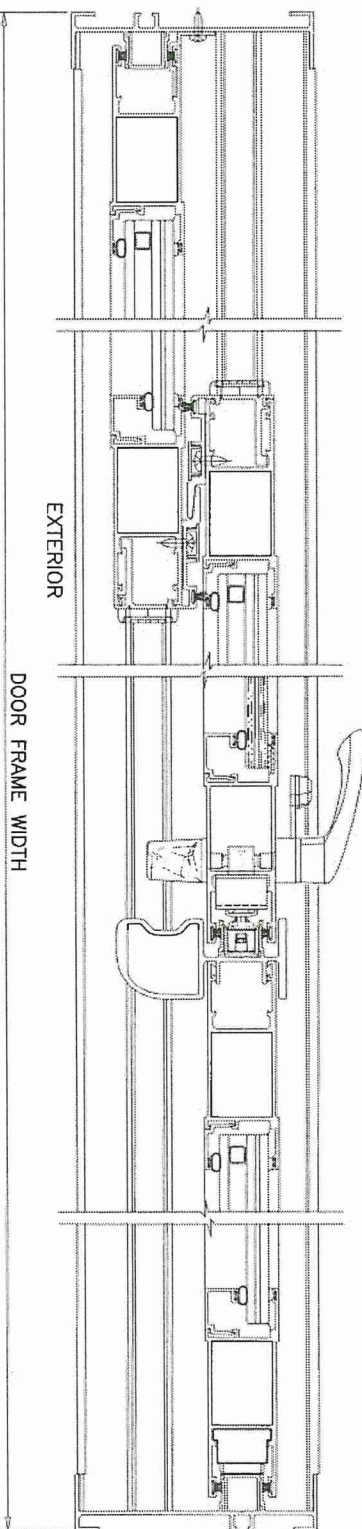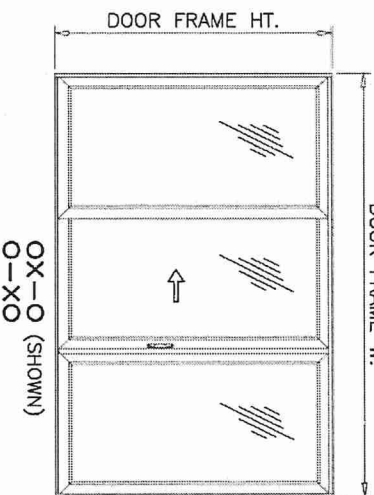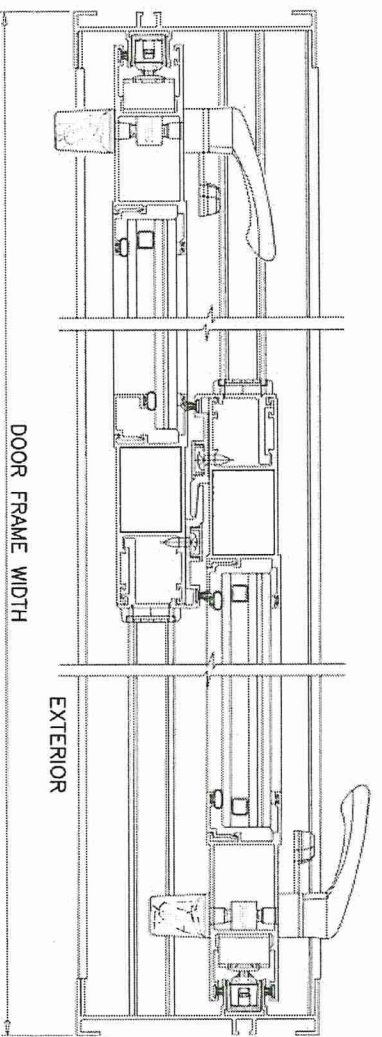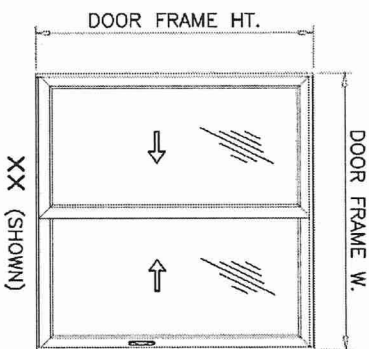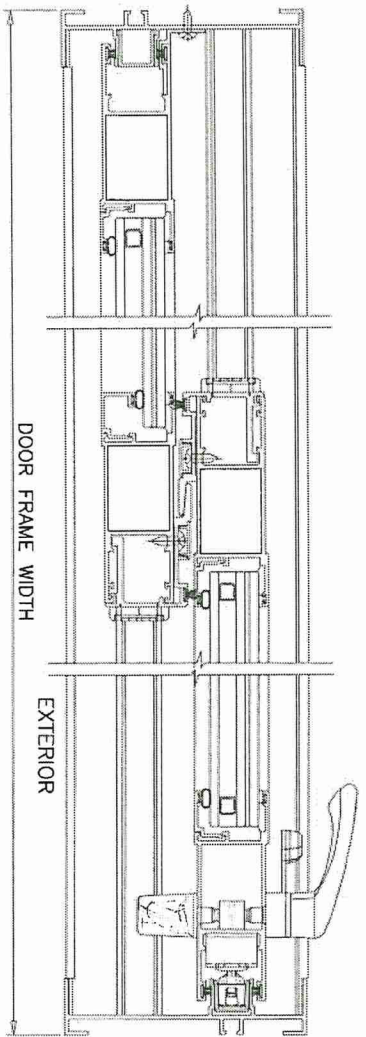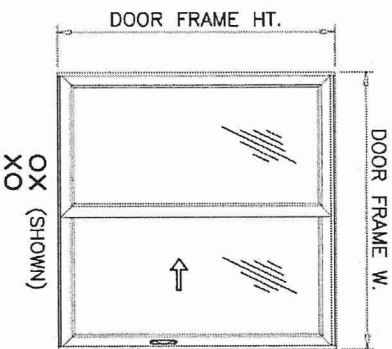

NOTE:
1. CONFIGURATIONS SHOWN FOR ILLUSTRATION PURPOSES ONLY.
2. FOR APPLICABLE DESIGN PRESSURES SEE SHEET 1.
3. FOR ANCHOR DETAILS SEE SHEETS 12 THRU 15.

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978

a
f
c

COMP-ANL\19-115D-WV

S-3000 ALUM SLIDING GLASS DOOR (L.M.I.)

Labrador & Fundora Corp.
dba-V & V Windows
14150 N.W. 56th Court, Suite 600
Opa-Locka, FL. 33054
Tel. (305) 888-4151 www.vvwindows.com

revisions:			
no	date	by	description
A	08.13.21		NO CHANGE THIS SHEET
B	06.07.23		UPDATED TO 2023 FBC
C	02.23.24		GENERAL REVISION
D	06.23.26		NO CHANGE THIS SHEET


date:	10-25-19
scale:	-
dr. by:	TARIQ
chk. by:	

drawing no.
19-115D









sheet 6 of 28

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 26-0709.08
Expiration Date 7/27/2031
By Ismael L. L.
Miami Trade Product Control

JUL 07 2026

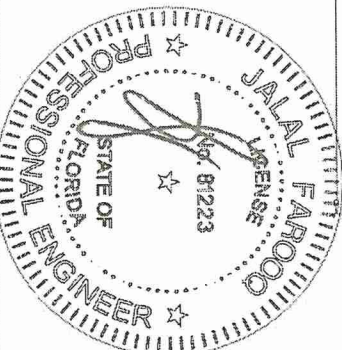


APPROVED CONFIGURATIONS
NON-POCKETED DOORS
2 TRACK FRAMES

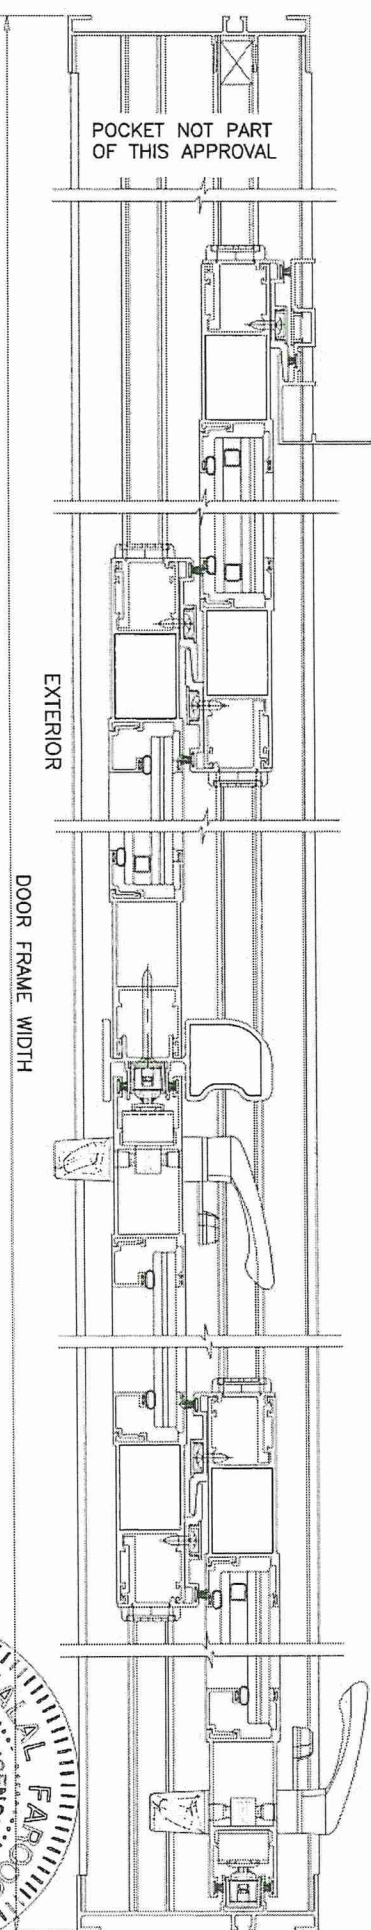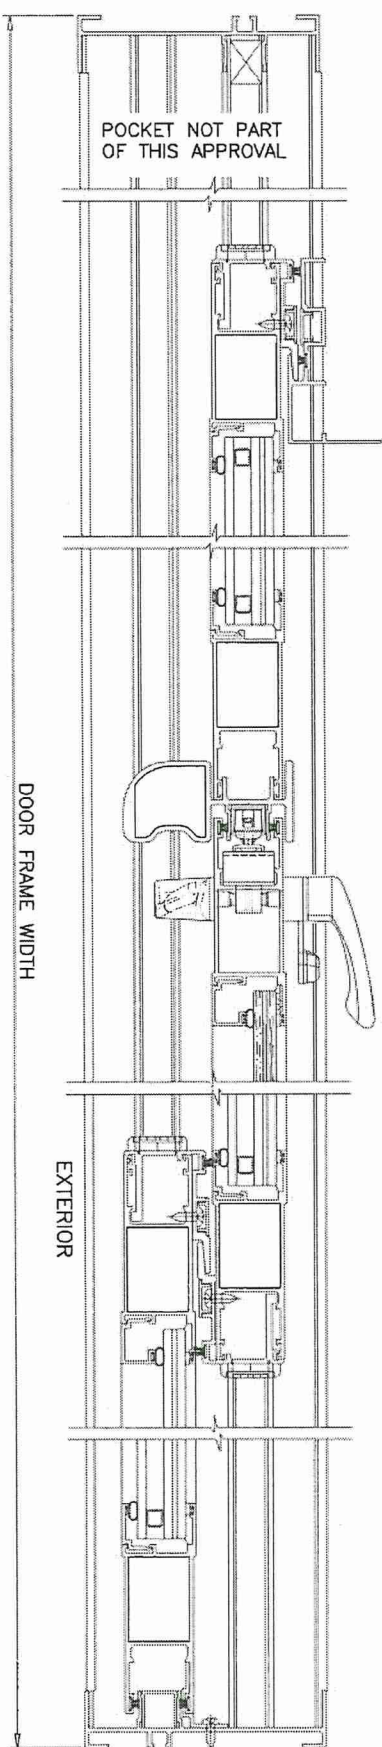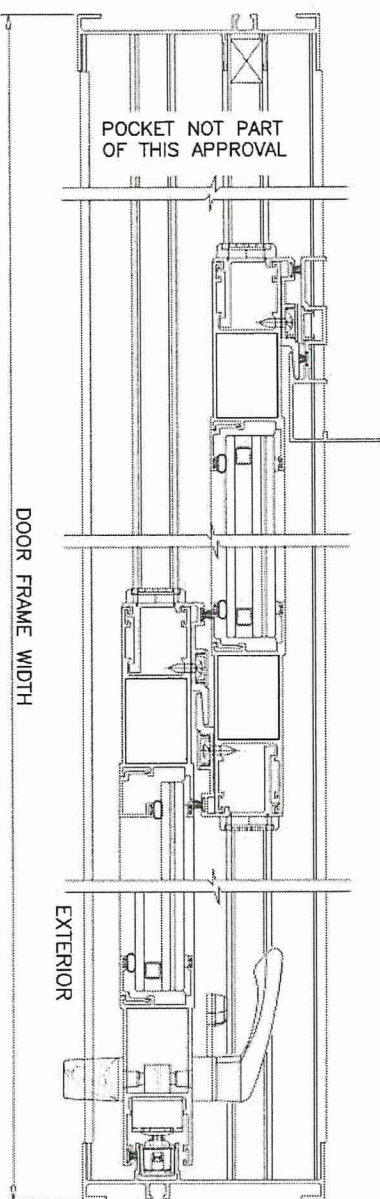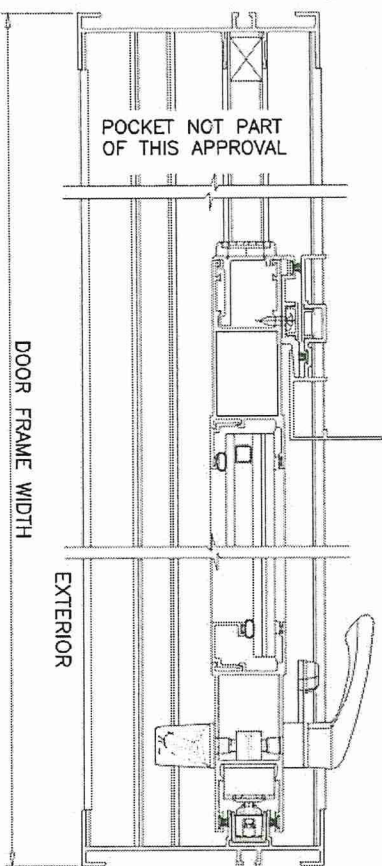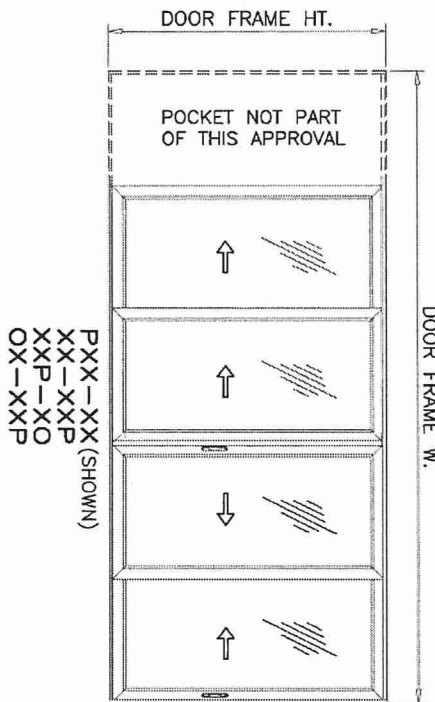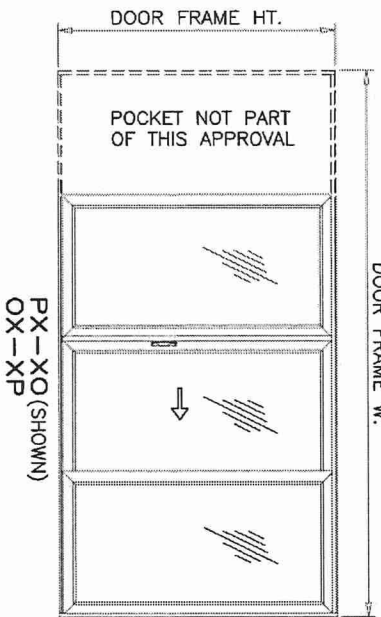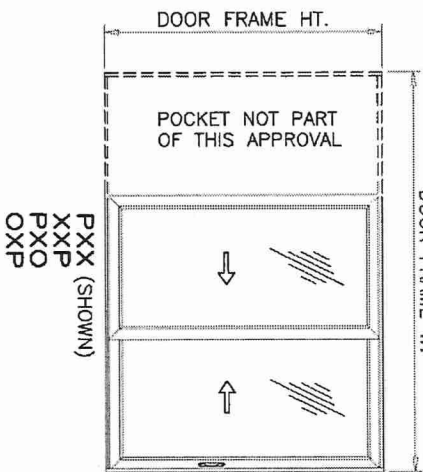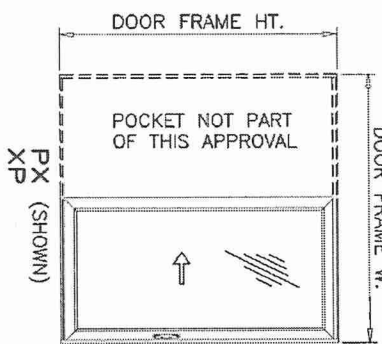







NOTE:
1. CONFIGURATIONS SHOWN FOR ILLUSTRATION PURPOSES ONLY.
2. FOR APPLICABLE DESIGN PRESSURES SEE SHEET 1.
3. FOR ANCHOR DETAILS SEE SHEETS 12 THRU 15.

APPROVED CONFIGURATIONS
POCKETED DOORS
2 TRACK FRAMES

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 26-8709-08
Expiration Date 9/29/2031
JUL 07 2026

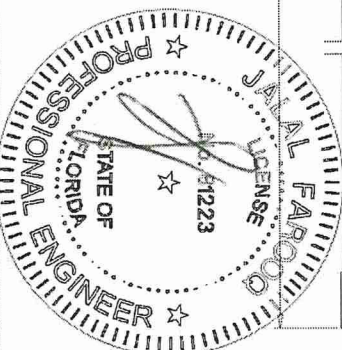

drawing no. 19-115D sheet 7 of 28	date: 10-25-19		revisions:				S-3000 ALUM SLIDING GLASS DOOR (L.M.I.)				AL-FAROOQ CORPORATION ENGINEERS & PRODUCT DEVELOPMENT 9360 SUNSET DRIVE, SUITE 220 MIAMI, FLORIDA 33173 (C.A.N. 3538) TEL. (305) 264-8100 FAX. (305) 262-6978 COMP-ANL\19-115D-W				
	scale: -		no	date	by	description	Labrador & Fundora Corp. dba-V & V Windows 14150 N.W. 56th Court, Suite 600 Opa-Locka, FL. 33054 Tel. (305) 888-4151 www.vvwindows.com								
	dr. by: TARIQ		A	08.13.21		NO CHANGE THIS SHEET									
	chk. by:		B	06.07.23		UPDATED TO 2023 FBC									
			C	02.23.24		GENERAL REVISION									
			D	06.23.25		NO CHANGE THIS SHEET									

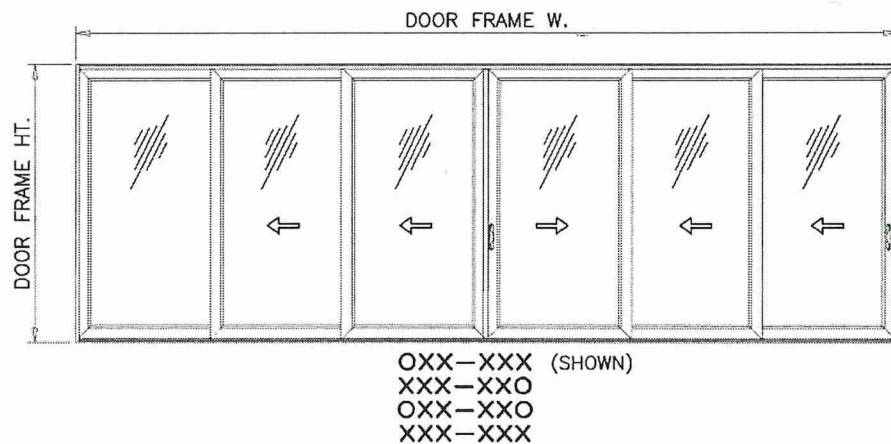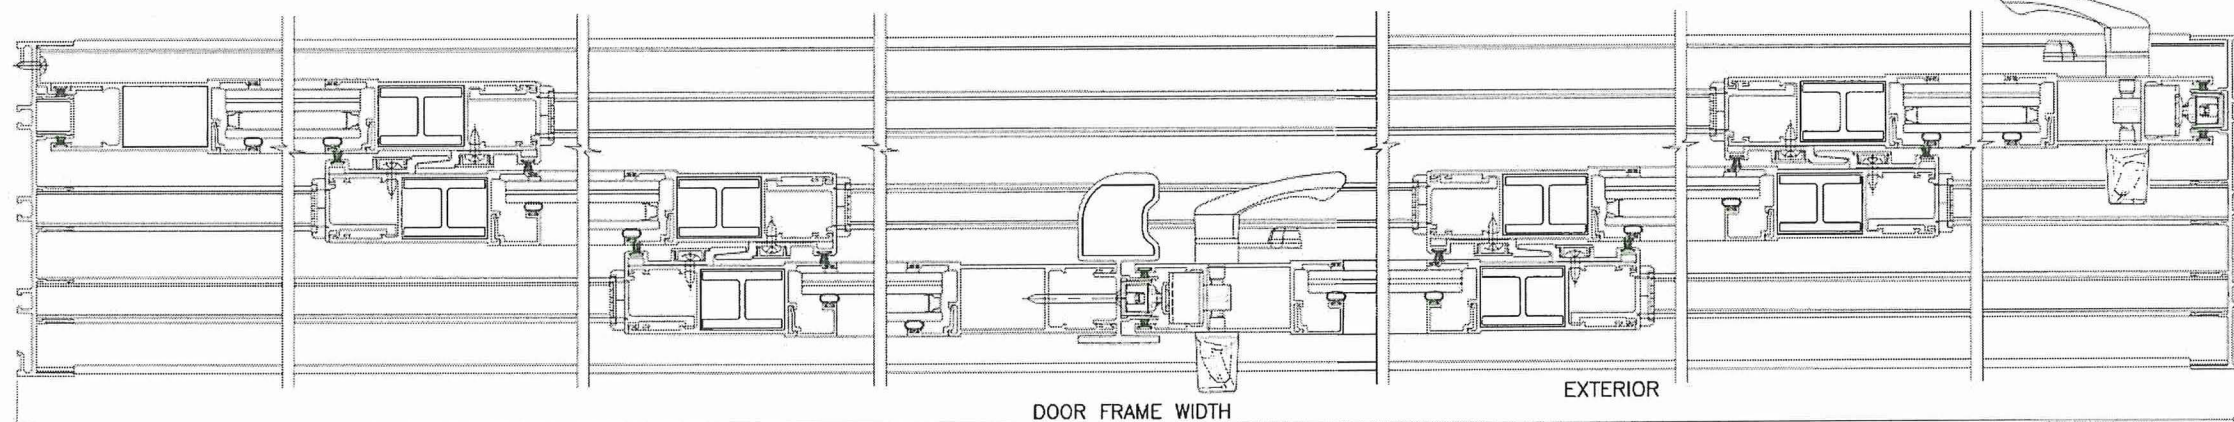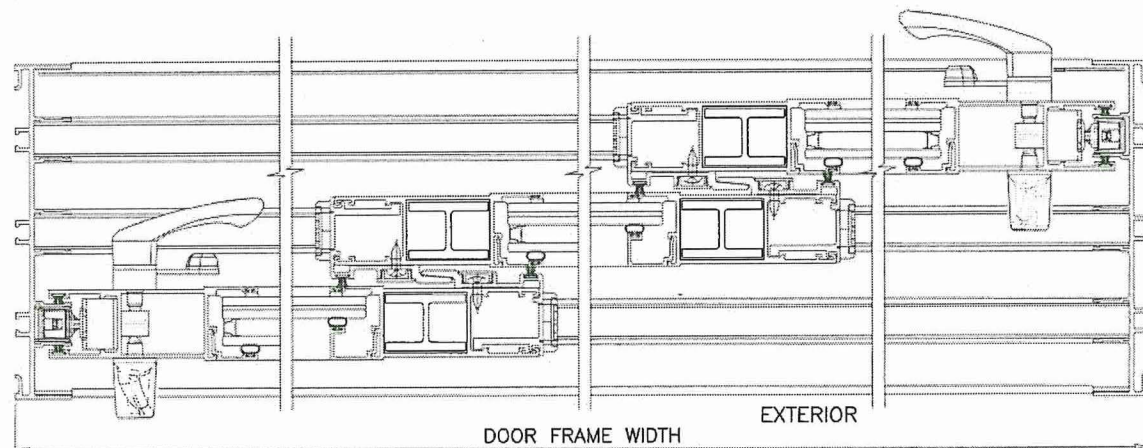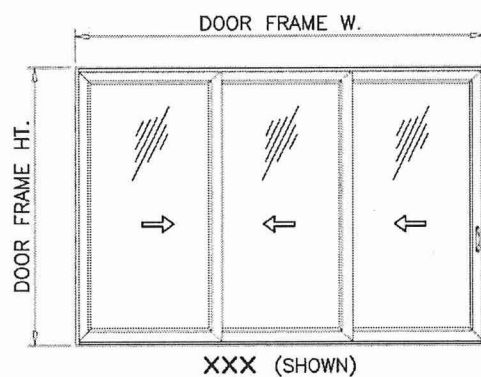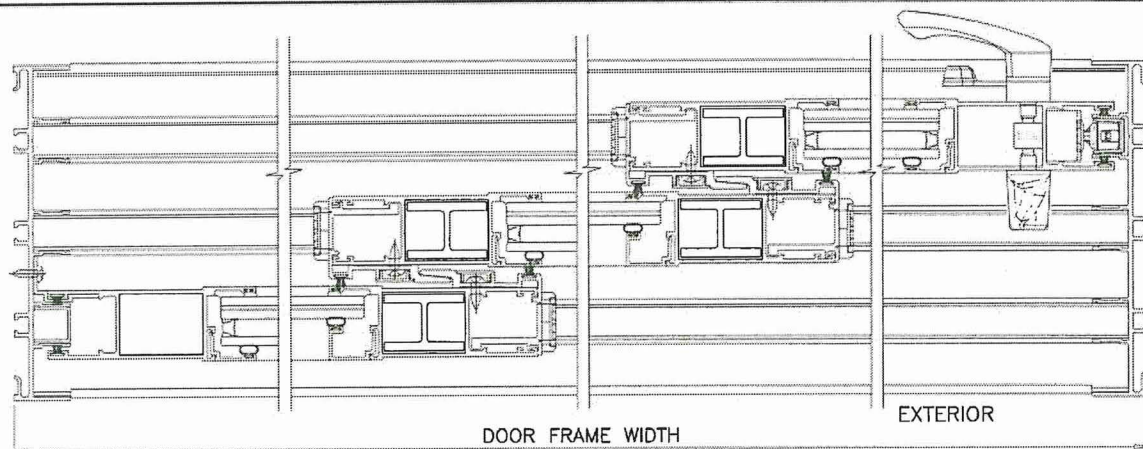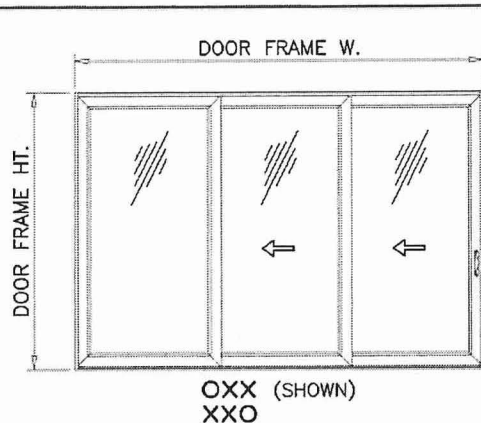


APPROVED CONFIGURATIONS
NON-POCKETED DOORS
3 TRACK FRAMES

NOTE:

1. CONFIGURATIONS SHOWN FOR ILLUSTRATION PURPOSES ONLY.
2. FOR APPLICABLE DESIGN PRESSURES SEE SHEET 1.
3. FOR ANCHOR DETAILS SEE SHEETS 16 THRU 19.

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. **26-0709.08**
Expiration Date **9/2/2031**
By **My I. Ch**
Miami Dade Product Control

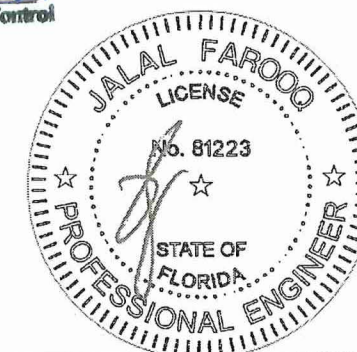

JUL 07 2026

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL 19-115D-W

af c

S-3000 ALUM SLIDING GLASS DOOR (L.M.I.)

Labrador & Fundora Corp.
dba-V & V Windows
14150 N.W. 56th Court, Suite 600
Opa-Locka, FL 33054
Tel. (305) 888-4151
www.vvwindows.com

revisions:


no	date	by	description
C	02.23.24	TARIQ	GENERAL REVISION
D	06.23.26		NO CHANGE THIS SHEET

date: 10-25-19
scale: -
dr. by: TARIQ
chk. by:



drawing no.
19-115D

sheet 8 of 28

date: 10-25-19
scale: -
dr. by: TARIQ
chk. by:

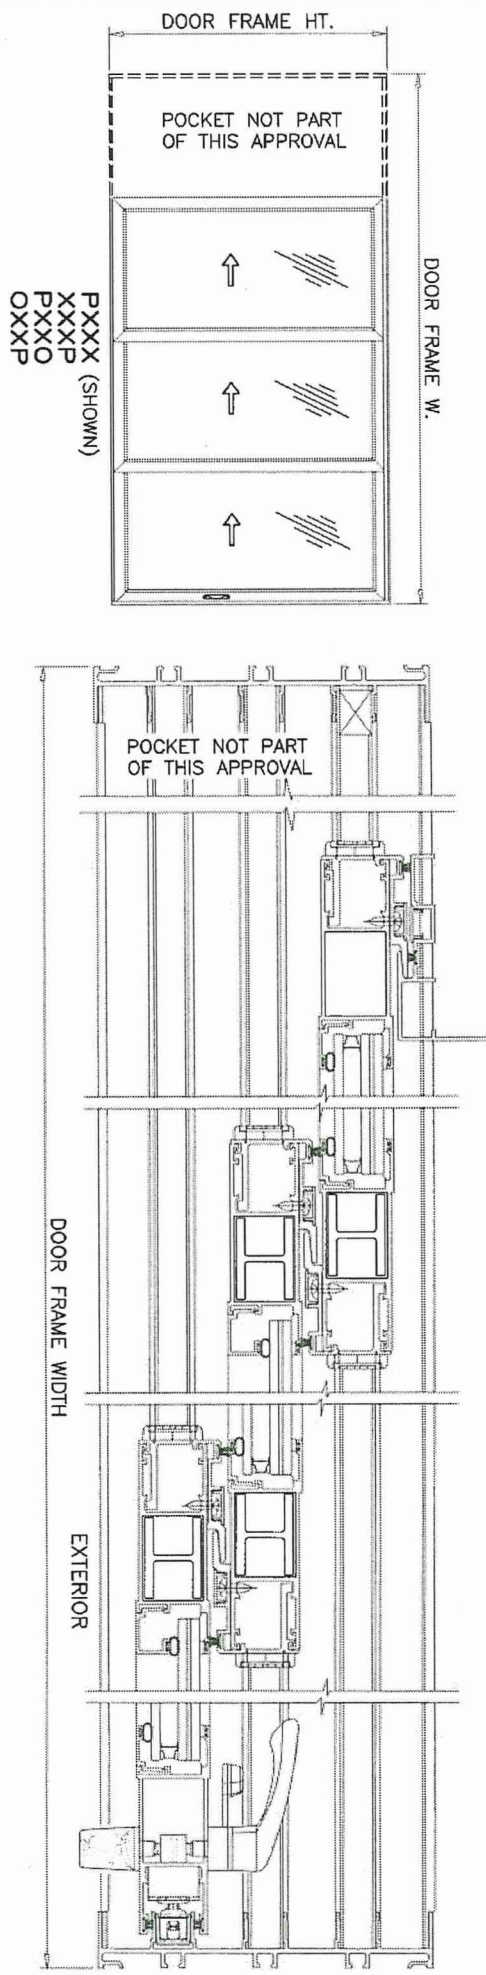


- NOTE:
1. CONFIGURATIONS SHOWN FOR ILLUSTRATION PURPOSES ONLY.
 2. FOR APPLICABLE DESIGN PRESSURES SEE SHEET 1.
 3. FOR ANCHOR DETAILS SEE SHEETS 16 THRU 19.

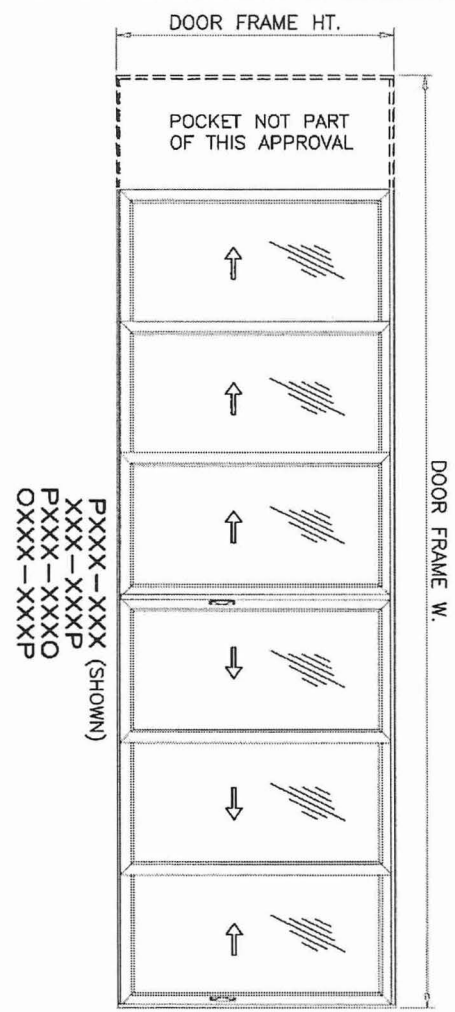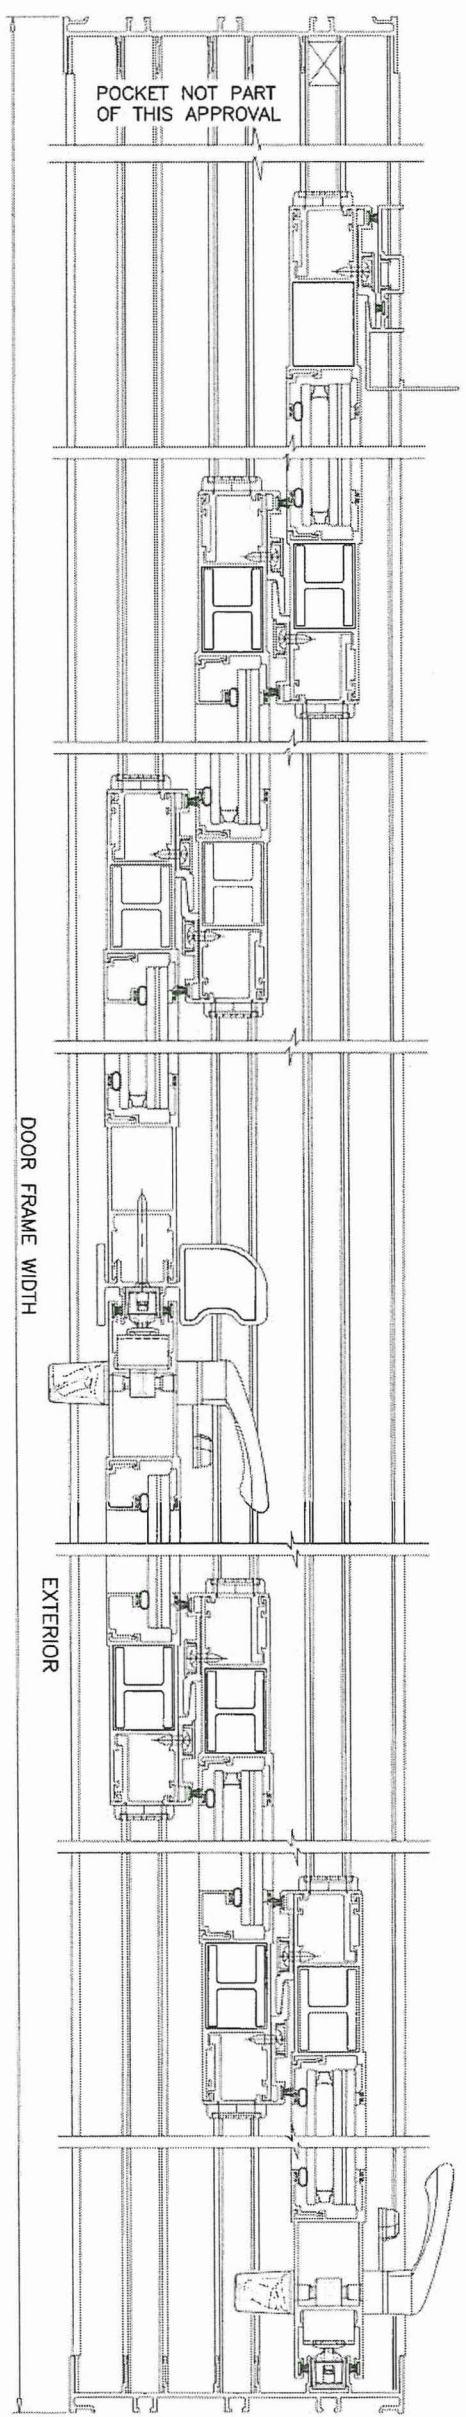







APPROVED CONFIGURATIONS
POCKETED DOORS
3 TRACK FRAMES

JUL 07 2026

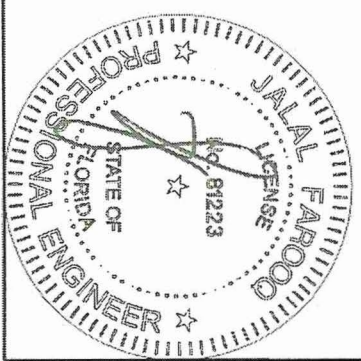


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 26-0708-08
Expiration Date 9/21/2031
By: [Signature]
Infrared Thermal Product Control

date: 10-25-19		revisions:		S-3000 ALUM SLIDING GLASS DOOR (L.M.I.)		AL-FAROOQ CORPORATION		
scale: -		no date by description		Labrador & Fundora Corp.		ENGINEERS & PRODUCT DEVELOPMENT		
dr. by: TARIQ		C 02.23.24 GENERAL REVISION		dba-V & V Windows		9360 SUNSET DRIVE, SUITE 220		
chk. by:		D 06.23.26 NO CHANGE THIS SHEET		14150 N.W. 56th Court, Suite 600		MIAMI, FLORIDA 33173 (C.A.N. 3538)		
drawing no. 19-115D				Opa-Locka, FL. 33054		TEL. (305) 264-8100 FAX. (305) 262-6978		
sheet 9 of 28				Tel. (305) 888-4151 www.vvwindows.com		COMP-ANL\19-115D-WV		

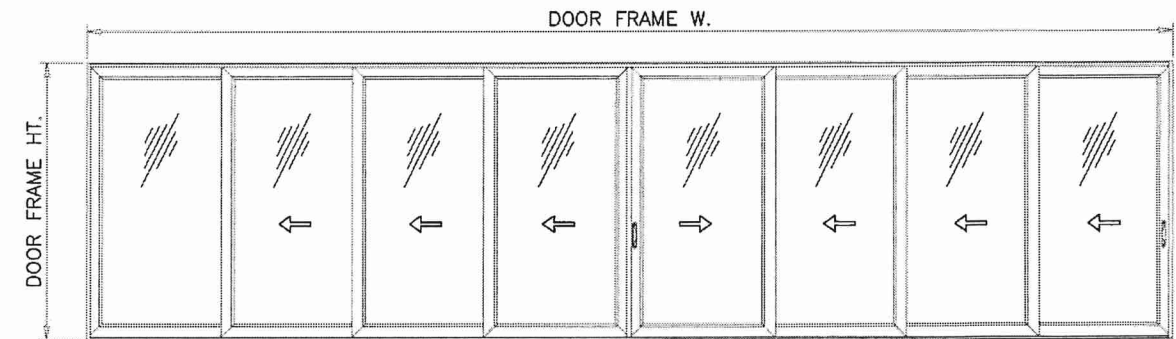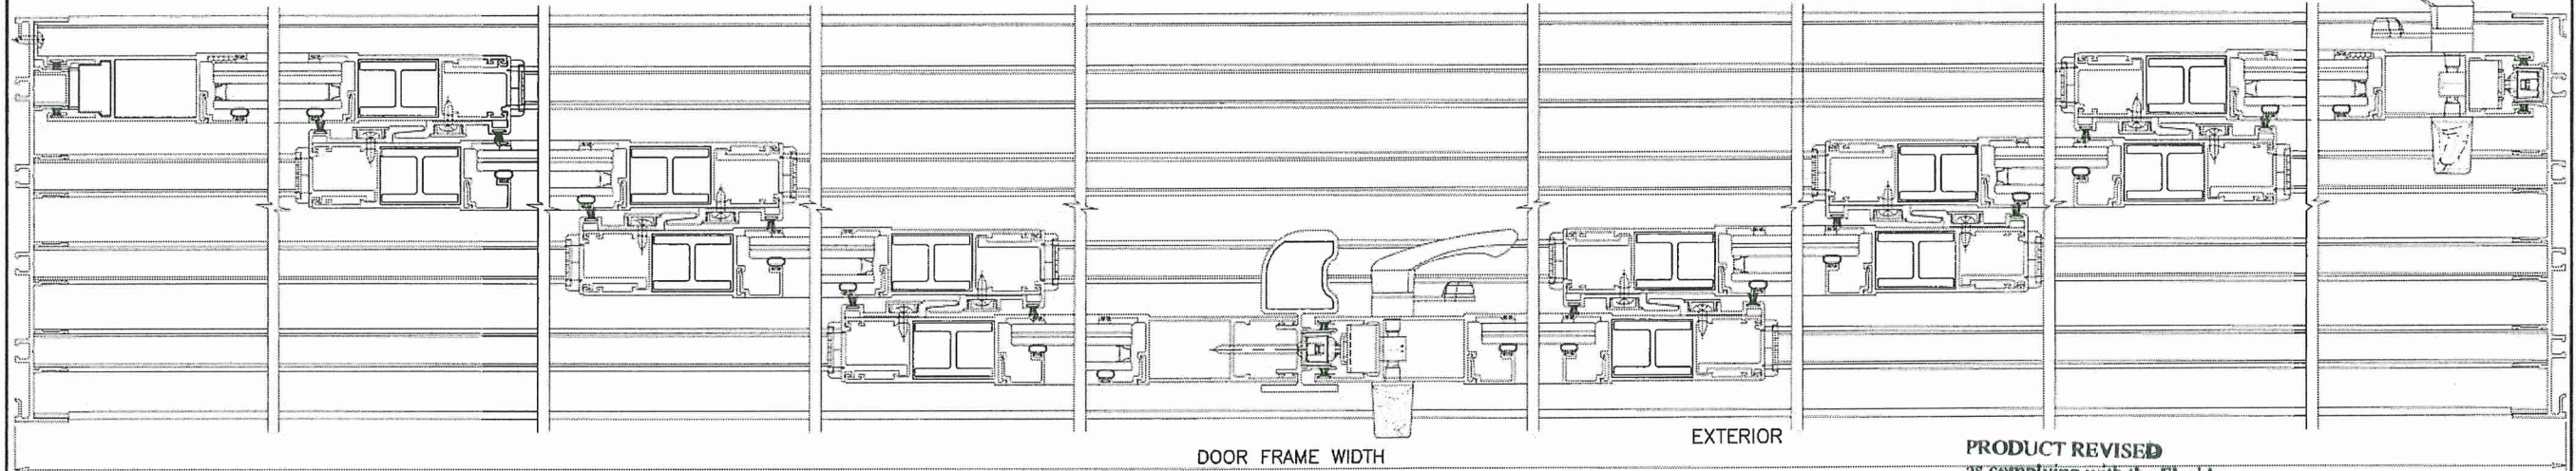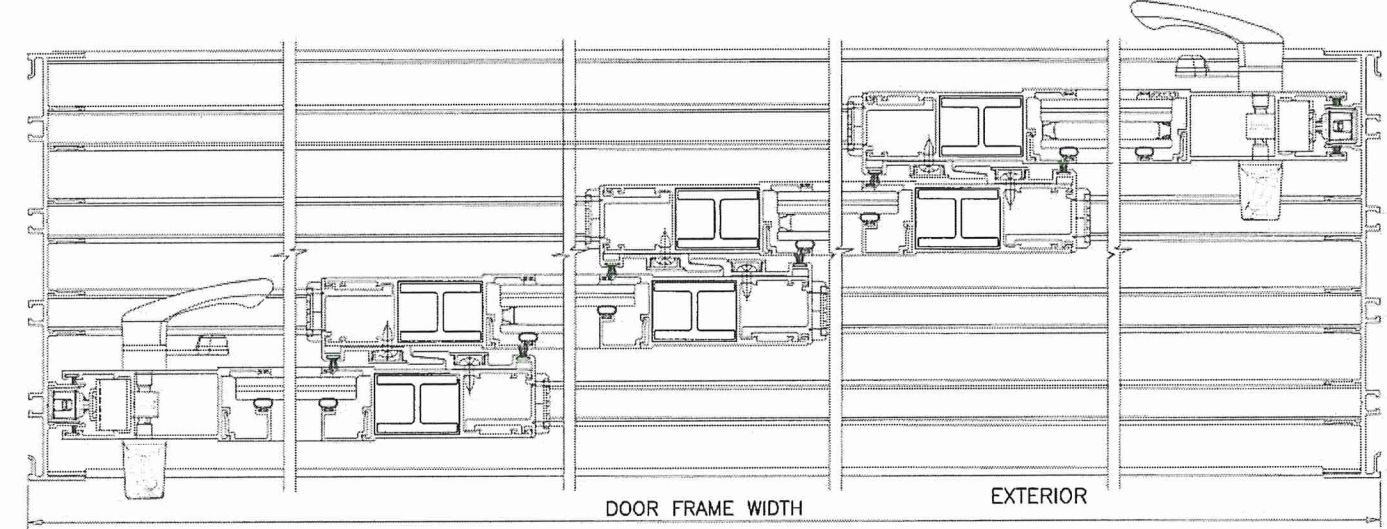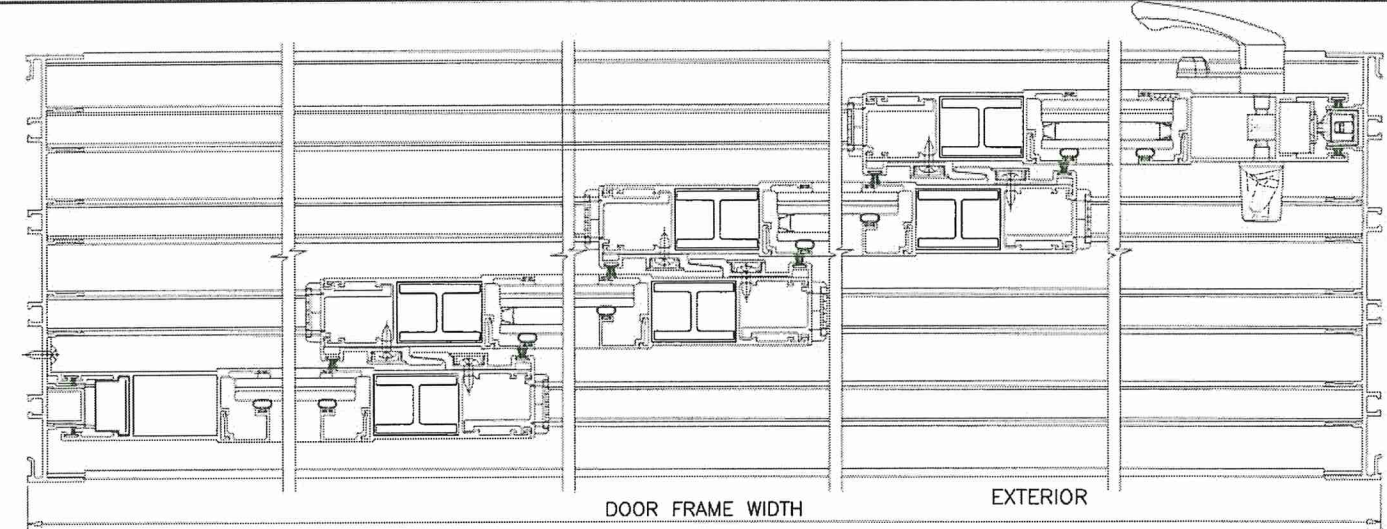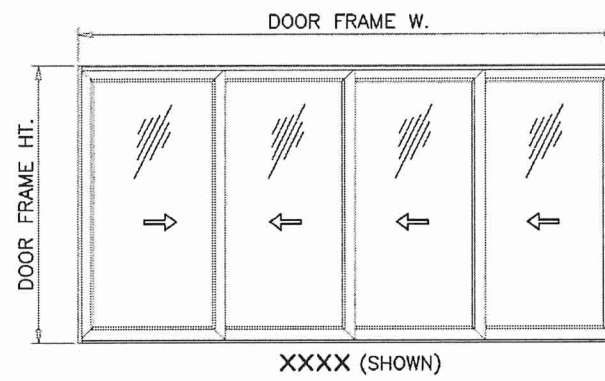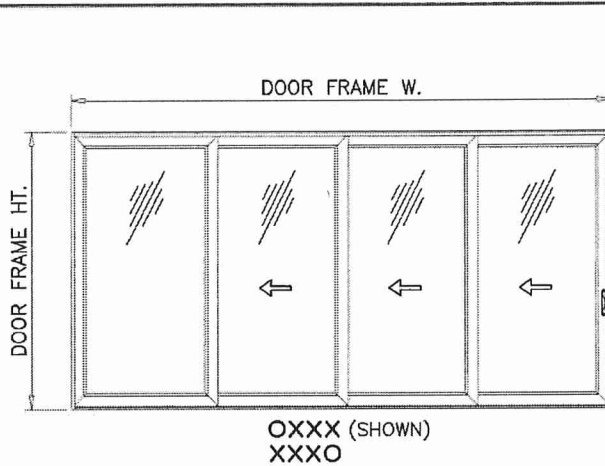

APPROVED CONFIGURATIONS
NON-POCKETED DOORS
4 TRACK FRAMES

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 26-074908
Expiration Date 9/2/2031
By Isly I. (Signature)
Miami Dade Product Control

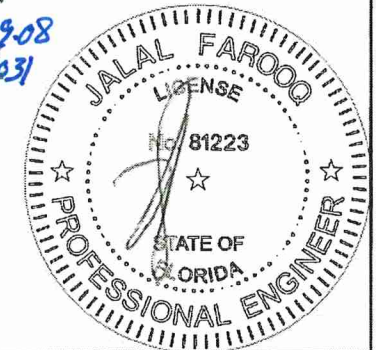

JUL 07 2026

NOTE:
1. CONFIGURATIONS SHOWN FOR ILLUSTRATION PURPOSES ONLY.
2. FOR APPLICABLE DESIGN PRESSURES SEE SHEET 1.
3. FOR ANCHOR DETAILS SEE SHEETS 20 THRU 24.

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-8978
COMP-ANL\19-115D-W

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-8978
COMP-ANL\19-115D-W

S-3000 ALUM SLIDING GLASS DOOR (L.M.I.)
Labrador & Fundora Corp.
dba-V & V Windows
14150 N.W. 56th Court, Suite 600
Opa-Locka, FL 33054
Tel. (305) 888-4151
www.vvwindows.com

S-3000 ALUM SLIDING GLASS DOOR (L.M.I.)
Labrador & Fundora Corp.
dba-V & V Windows
14150 N.W. 56th Court, Suite 600
Opa-Locka, FL 33054
Tel. (305) 888-4151
www.vvwindows.com

revisions:		no date by description	
date:	10-25-19	no:	
scale:	-	by:	TARIQ
dr:	TARIQ	GENERAL REVISION	
chk:		NO CHANGE THIS SHEET	

drawing no.
19-115D


sheet 10 of 28

date: 10-25-19



scale: -

dr: TARIQ


chk: by:

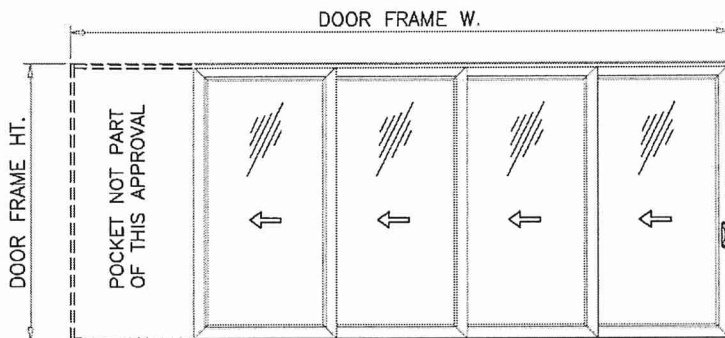

PXXXX(SHOWN)
XXXXP
XXXXO
XXXXP

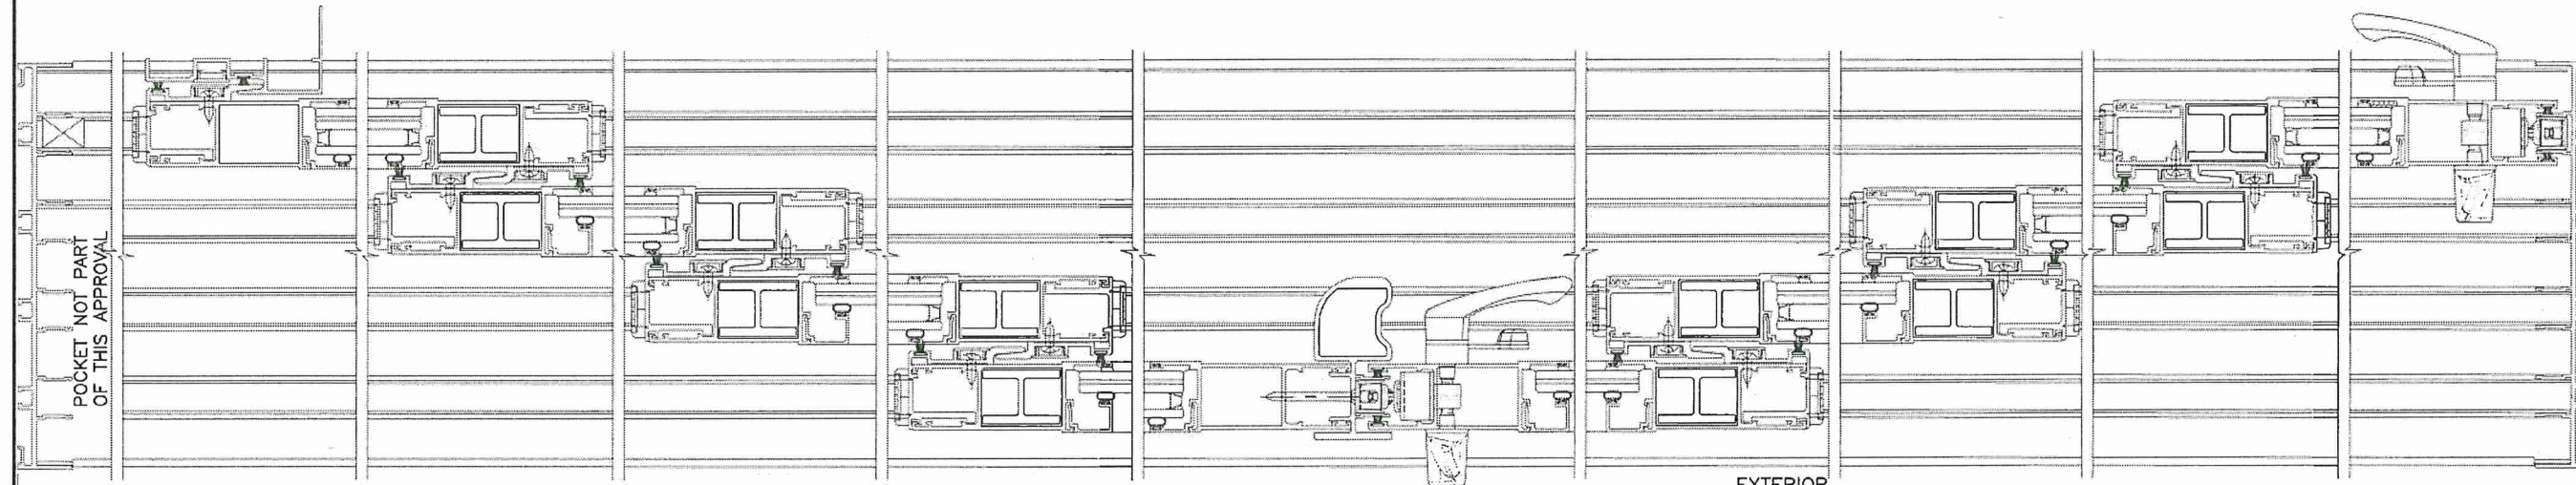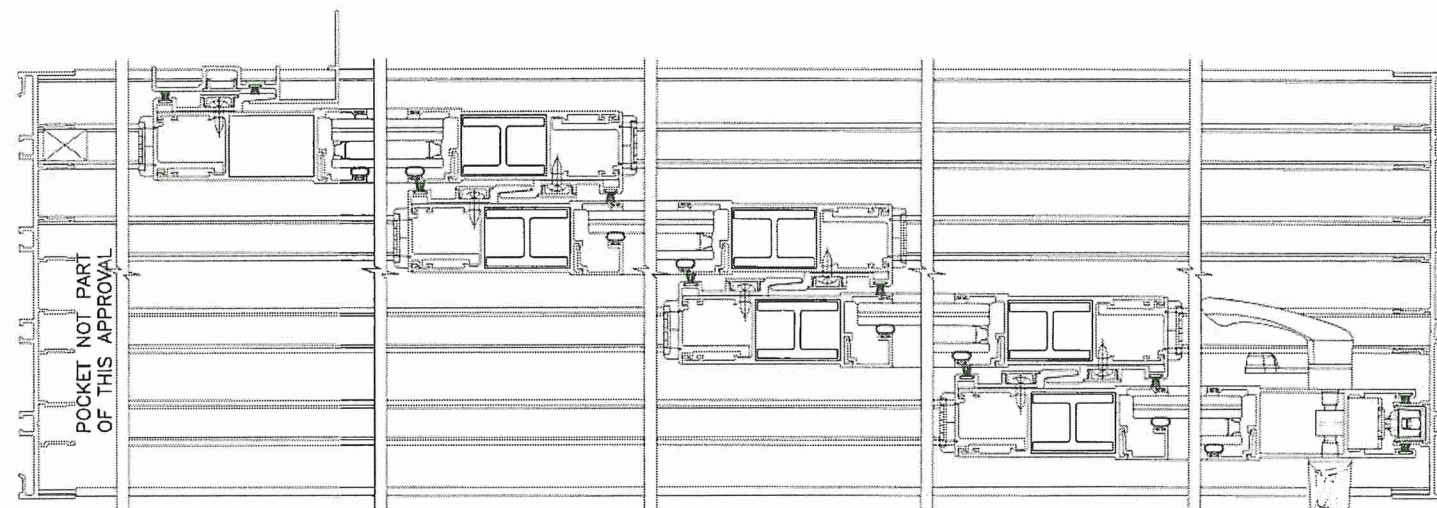

DOOR FRAME WIDTH

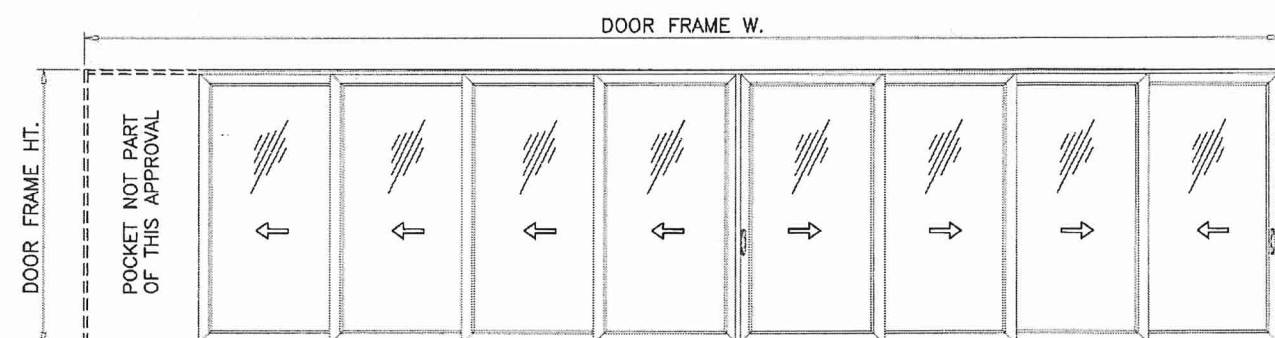


PXXXX-XXXX (SHOWN)
XXXX-XXXXP
PXXXX-XXXXO
OXXXX-XXXXP

APPROVED CONFIGURATIONS
POCKETED DOORS
4 TRACK FRAMES

- NOTE:
1. CONFIGURATIONS SHOWN FOR ILLUSTRATION PURPOSES ONLY.
 2. FOR APPLICABLE DESIGN PRESSURES SEE SHEET 1.
 3. FOR ANCHOR DETAILS SEE SHEETS 20 THRU 24.

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 26-0709-08
Expiration Date 9/2/2031
By *[Signature]*
Miami Dade Product Control

JUL 07 2026

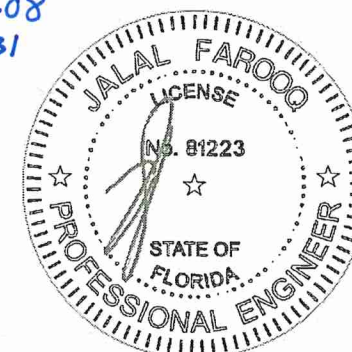

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL (305) 264-8100 FAX (305) 262-6978
C.A.N. 3538

COMP-ANL\19-115D-W



S-3000 ALUM SLIDING GLASS DOOR (L.M.I.)

Labrador & Fundora Corp.
dba-V & V Windows
14150 N.W. 56th Court, Suite 600
Opa-Locka, FL 33054
Tel. (305) 888-4151
www.vvwindows.com

revisions:	
no	date by description
C	02.23.24 GENERAL REVISION
D	06.23.26 NO CHANGE THIS SHEET

date: 10-25-19
scale: -
dr. by: TARIQ
chk. by:

drawing no.
19-115D
sheet 11 of 28

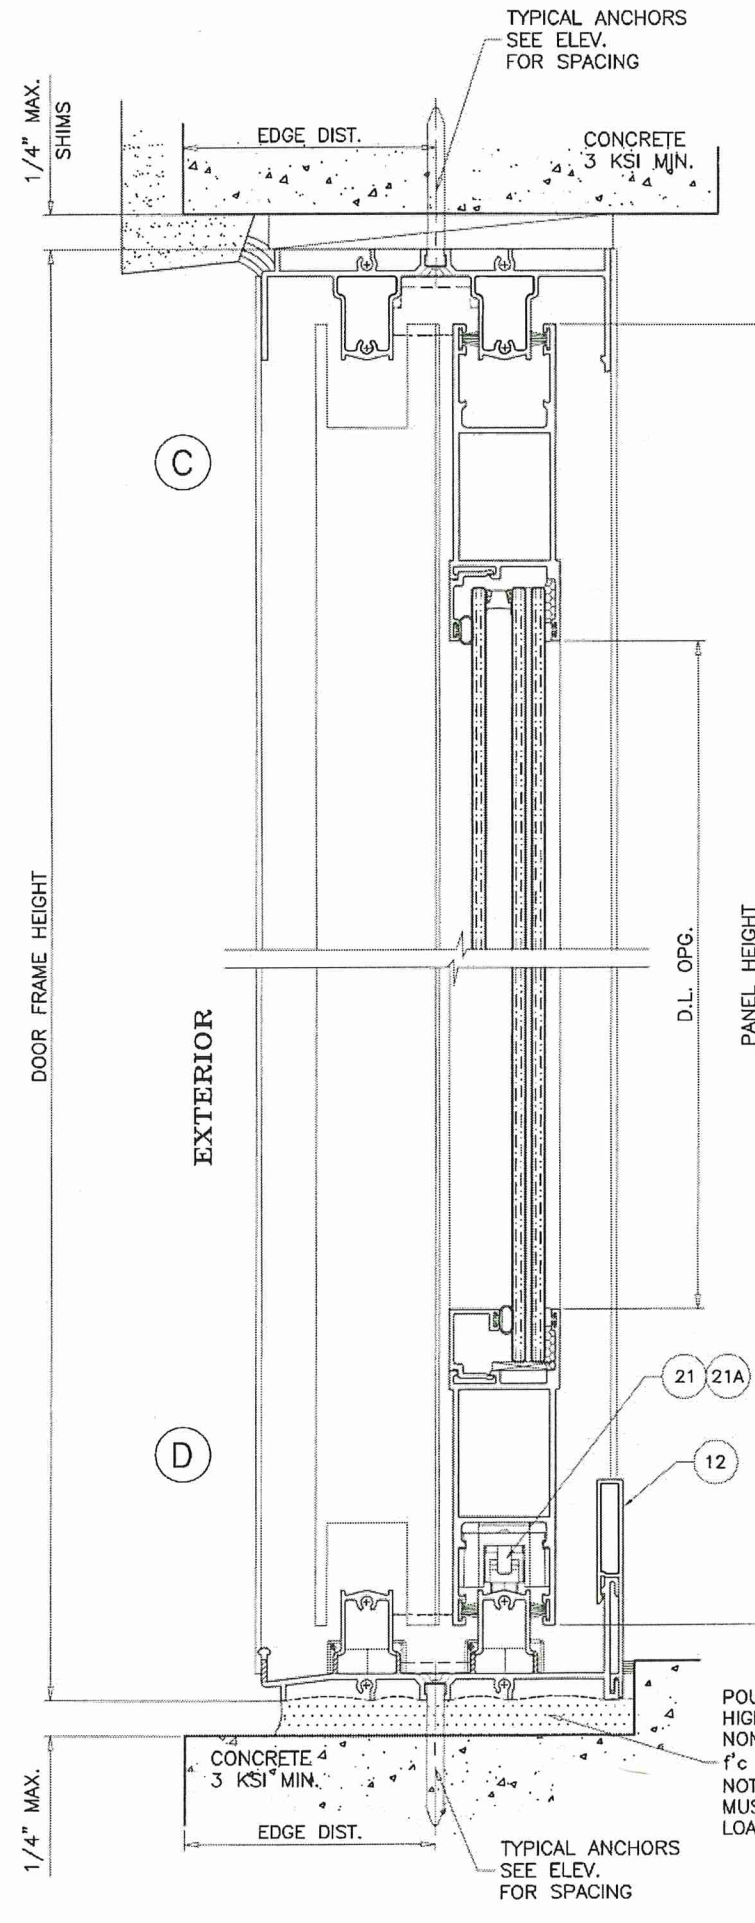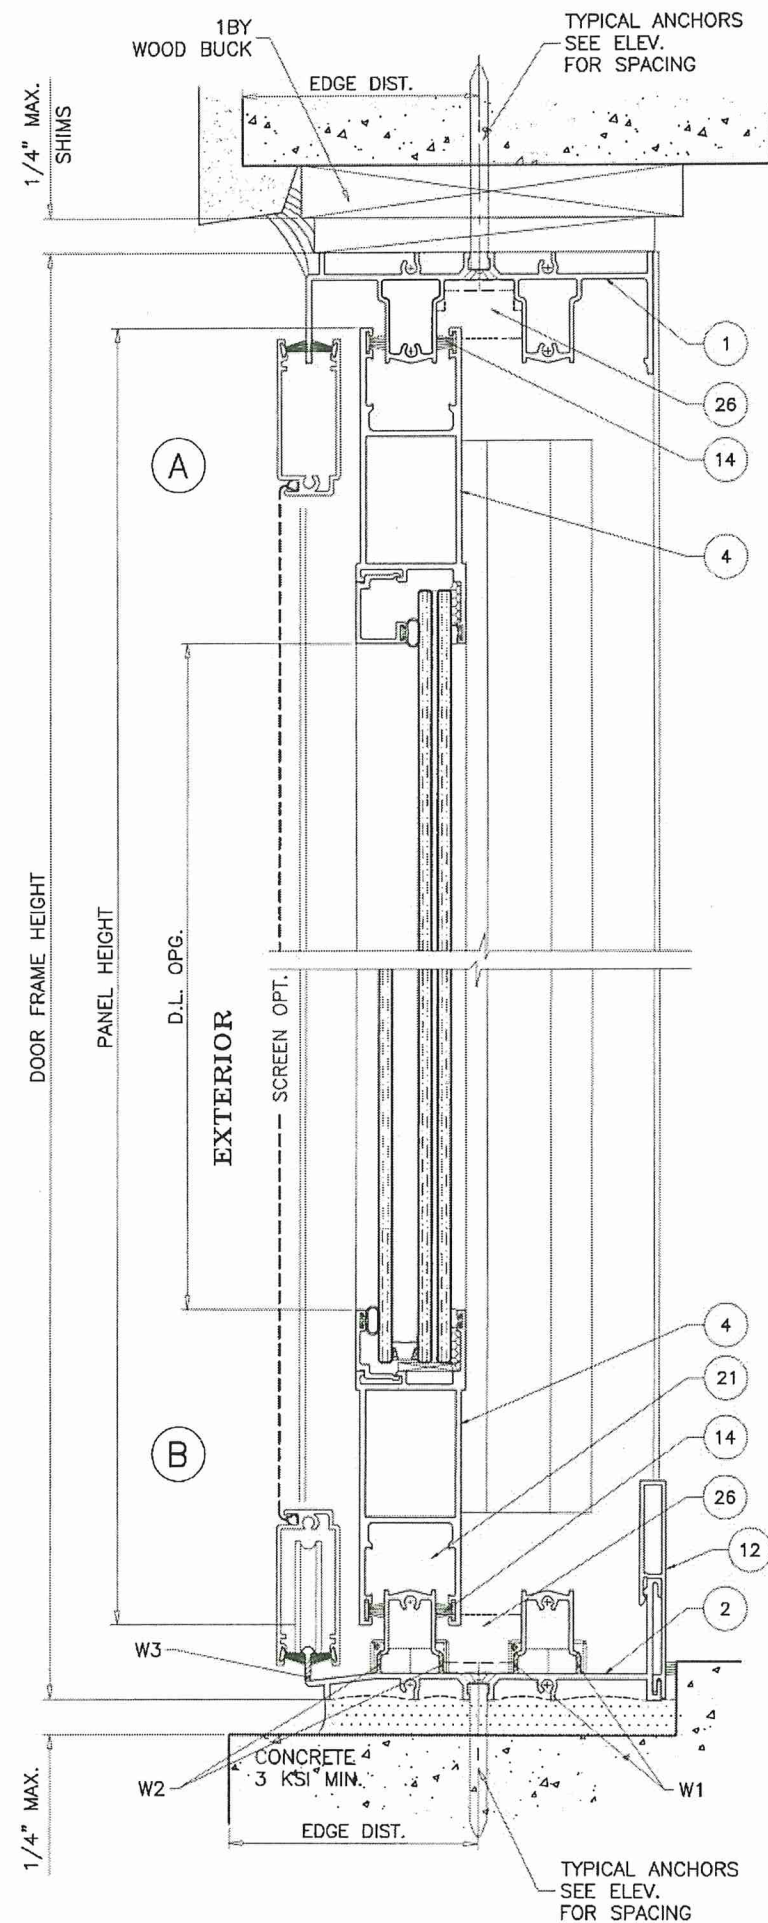


WEEPHOLES:

- W1 = 1-1/2" X 1/4" WEEP SLOTS
AT 7" FROM EACH END AND 34" O.C.
- W2 = 1-1/2" X 1/4" WEEP SLOTS
AT 5" FROM ENDS AND 24" O.C.
- W3 = 1-1/2" X 1/4" WEEP SLOTS
AT 7" FROM ENDS AND 24" O.C.

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. **26-070908**
Expiration Date **9/2/2031**
By **Ismael L. Lopez**
Miami Dade Product Control

2 TRACK FRAMES

JUL 07 2026

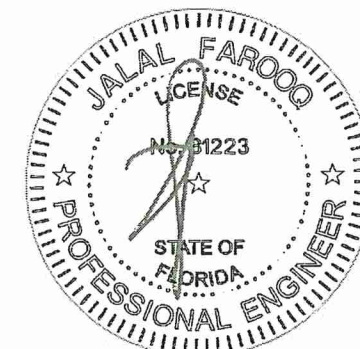

revisions:		no.	date	description
A	08.13.21	NO CHANGE THIS SHEET		
B	06.07.23	UPDATED TO 2023 FBC		
C	02.23.24	GENERAL REVISION		
D	06.23.26	NO CHANGE THIS SHEET		




date:	10-25-19	scale:	3/8" = 1"
dr. by:	TARIO	chk. by:	

drawing no.	19-115D
sheet	12 of 28

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
(C.A.N. 3538)

S-3000 ALUM SLIDING GLASS DOOR (L.M.I.)
Labrador & Fundora Corp.
dba - Y & V Windows
14150 N.W. 56th Court, Suite 600
Opa-Locka, FL 33054
Tel. (305) 888-4151
www.vvwindows.com

COMP-ANL 19-115D-W

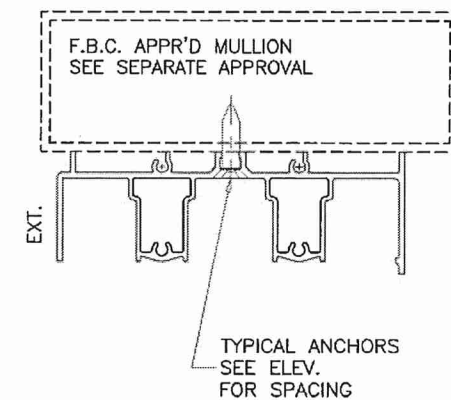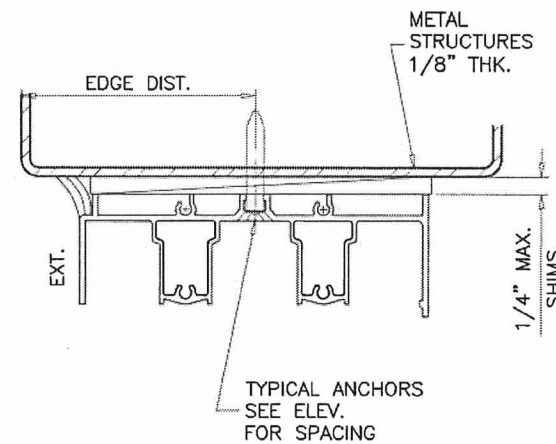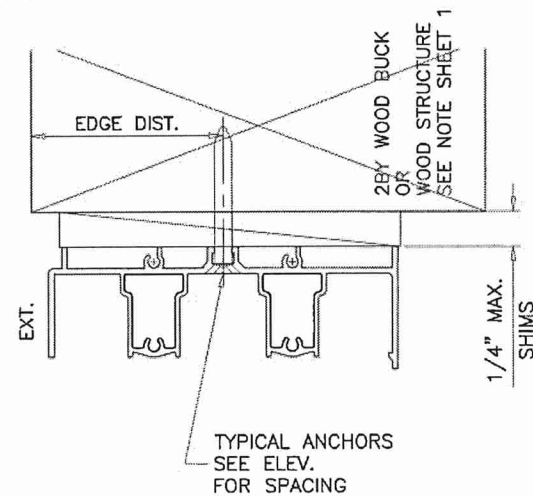

1BY OR 2BY WOOD BUCKS AND METAL STRUCTURE NOT BY 'V & V WINDOWS' MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

1/4\"/>

INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
1-1/2\"/>

THRU 1BY BUCKS INTO CONC. OR BLOCKS
1-1/4\"/>

DIRECTLY INTO CONCRETE OR BLOCKS
1-1/4\"/>

1/4\"/>

INTO MIAMI-DADE COUNTY APPROVED MULLIONS
AND
INTO METAL STRUCTURES (HEAD/JAMBS)
(3) THREADS MIN. TO EXTEND BEYOND METAL THICKNESS
ALUMINUM: 1/8\"/>

CRITICAL EDGE DISTANCE

INTO CONCRETE AND BLOCKS = 2-1/2\"/>

WOOD AT HEAD, SILL OR JAMBS SG = 0.55 MIN.
CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.
C-90 HOLLOW/FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No **26-0709.08**
Expiration Date **9/2/2021**
By **[Signature]**
Miami Dade Product Control

2 TRACK FRAMES



JUL 07 2026

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

COMP-ANL 19-115D-W

S-3000 ALUM SLIDING GLASS DOOR (L.M.I.)



Labrador & Fundora Corp.
dba-V & V Windows
14150 N.W. 56th Court, Suite 600
Opa-Locka, FL 33054
Tel. (305) 888-4151
www.vvwindows.com

revisions:

no	date	description
A	08.13.21	NO CHANGE THIS SHEET
B	06.07.23	UPDATED TO 2023 FBC
C	02.23.24	GENERAL REVISION
D	06.23.26	NO CHANGE THIS SHEET

date: 10-25-19
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:


drawing no.
19-115D
sheet 13 of 28

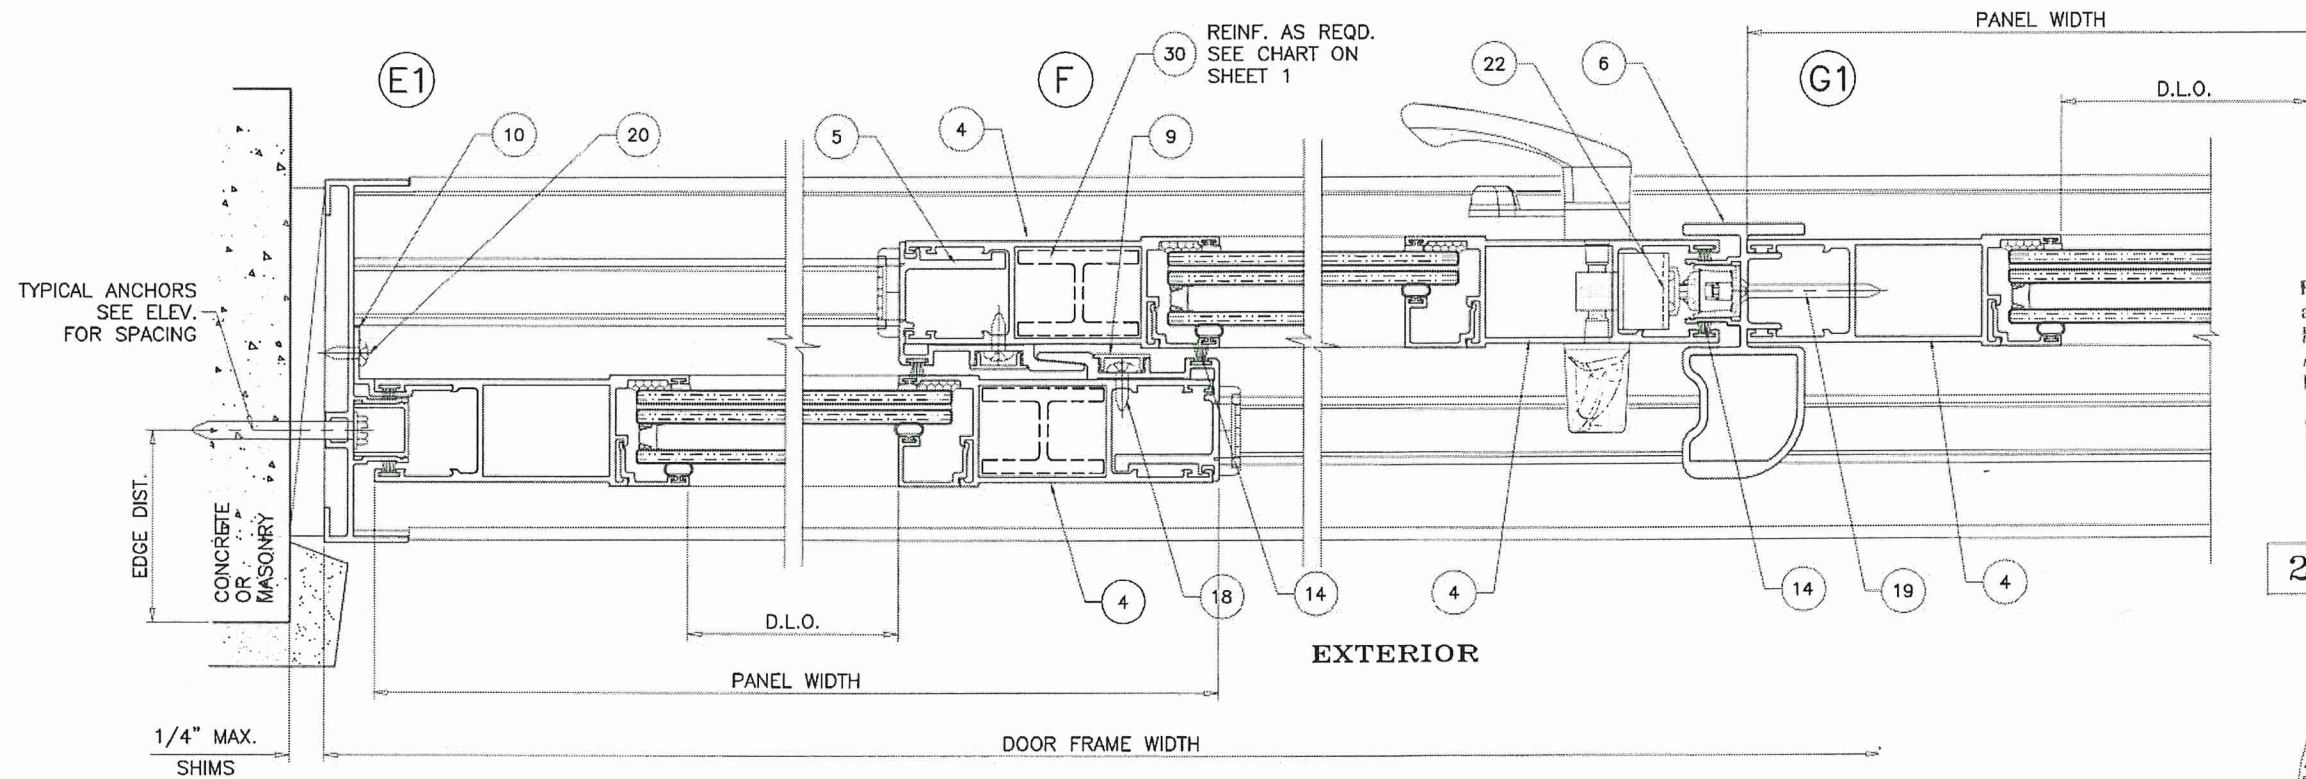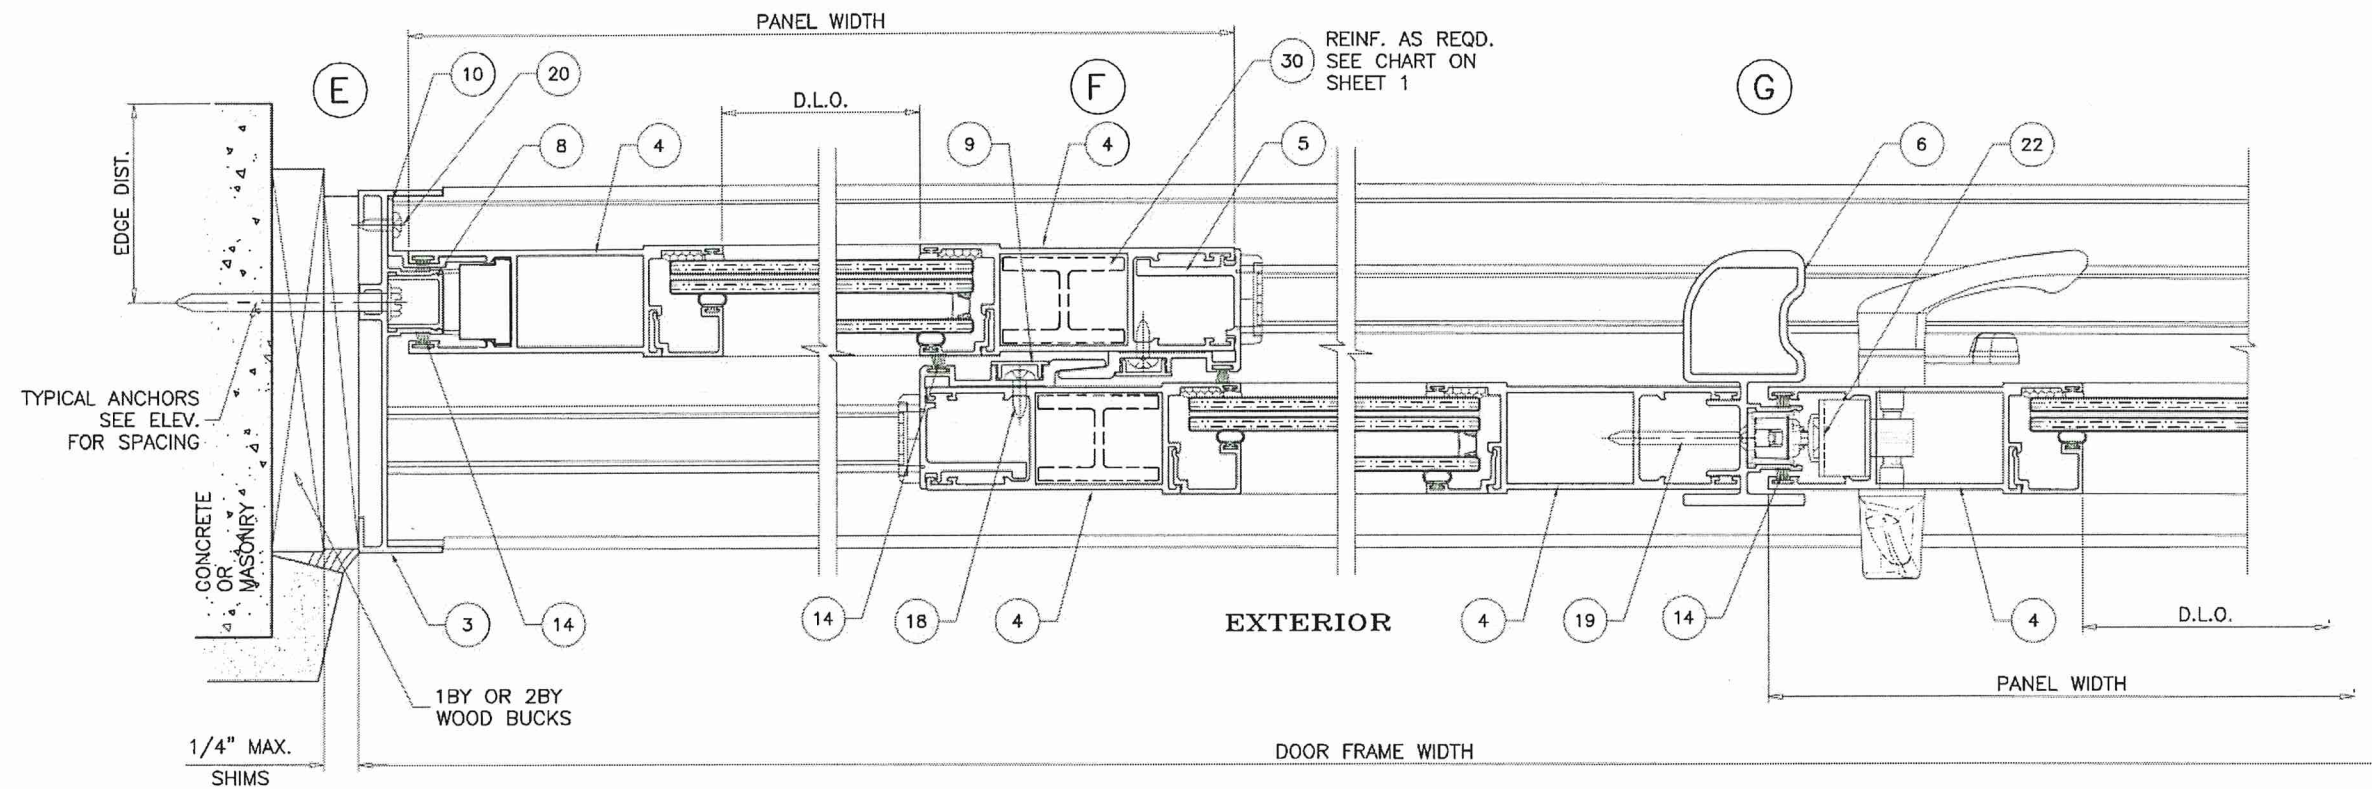

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No **26-6709.08**
Expiration Date **9/2/2031**
By **J. L. L.**
Miami Dade Product Control

2 TRACK FRAMES

JUL 07 2026

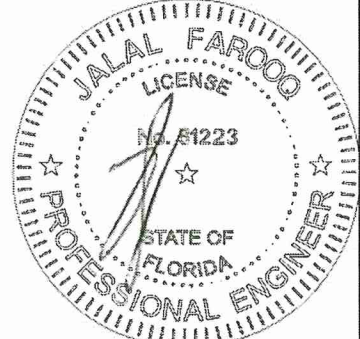

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

COMP-ANL \ 19-115D-W

S-3000 ALUM SLIDING GLASS DOOR (L.M.I.)




Labrador & Fundora Corp.
dba-V & V Windows
14150 N.W. 56th Court, Suite 600
Opa-Locka, FL 33054
Tel. (305) 888-4151
www.vvwindows.com

revisions:

no	date	by	description
A	08.13.21		NO CHANGE THIS SHEET
B	06.07.23		UPDATED TO 2023 FBC
C	02.23.24		GENERAL REVISION
D	06.23.26		NO CHANGE THIS SHEET

date: 10-25-19
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:

drawing no.
19-115D
sheet 14 of 28

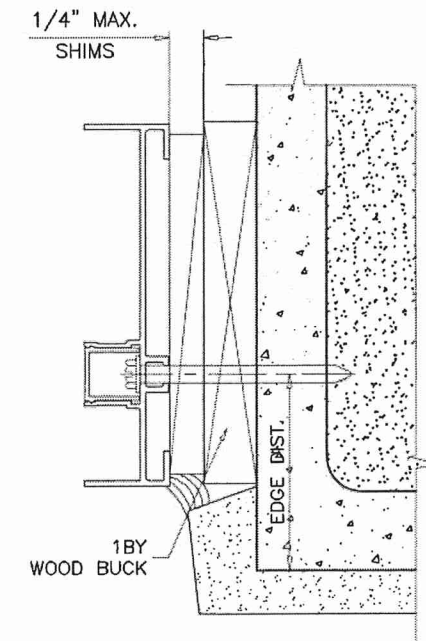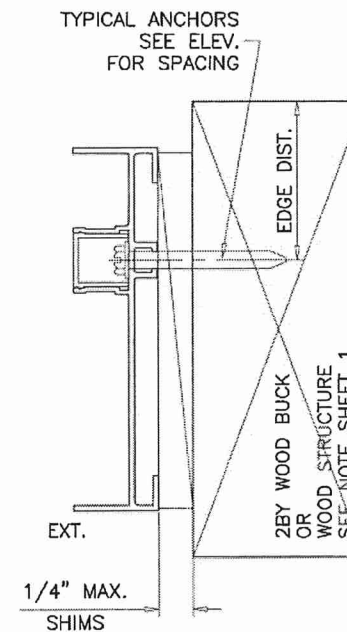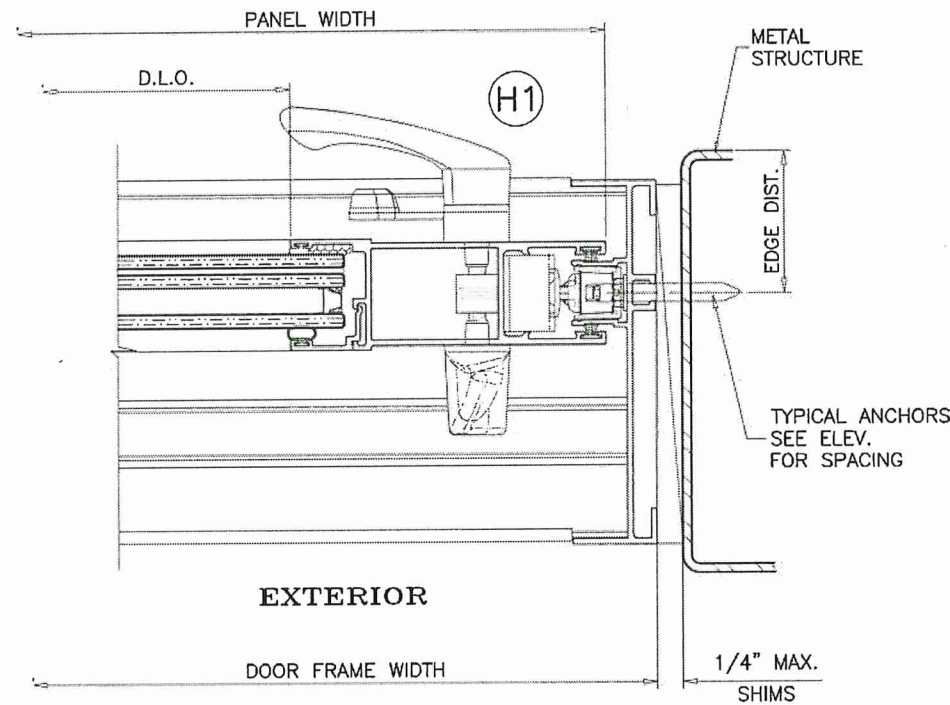

HOOK STRIP ANCHORS: SEE ELEV. FOR SPACING
1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)


DIRECTLY INTO CONCRETE OR BLOCKS
 1-3/8" MIN. EMBED INTO CONCRETE
 1-3/4" MIN. EMBED INTO GROUT-FILLED BLOCKS

#14 SMS (GRADE 2 CRS)
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 1-1/2" MIN. PENETRATION INTO WOOD

#14 SMS OR SELF DRILLING SCREWS (GRADE 2 CRS)
 INTO METAL STRUCTURES
 (3) THREADS MIN. PENETRATION BEYOND SUBSTRATE
 ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)
 STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL EDGE DISTANCE

INTO CONCRETE AND BLOCKS = 2" MIN.
 INTO WOOD STRUCTURE = 1" MIN.
 INTO METAL STRUCTURE = 3/4" MIN.

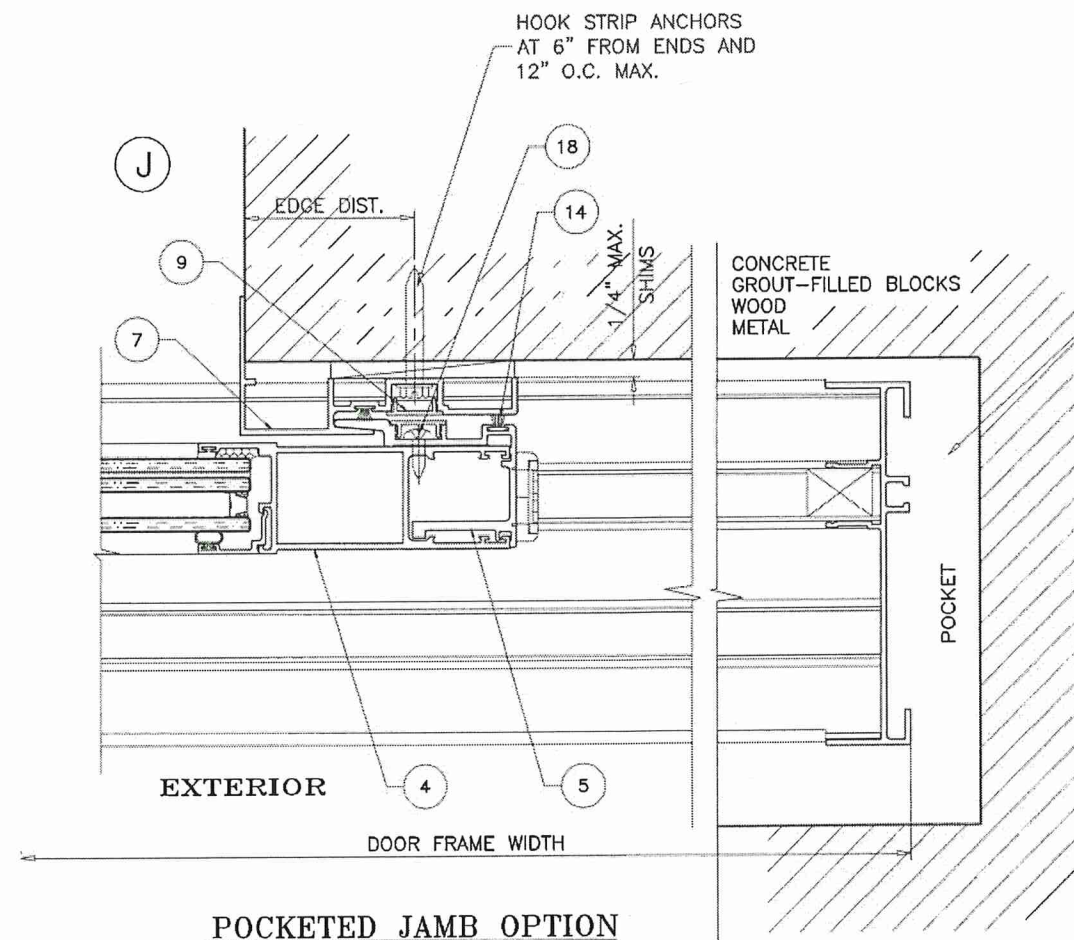

POCKET CAVITY NOT BY 'V & V WINDOWS'
 NOT PART OF THIS APPROVAL
 TO BE REVIEWED BY AHJ

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No **26-0709.08**
 Expiration Date **9/21/2031**
 By **Ismael I. Linares**
 Miami Dade Product Control

2 TRACK FRAMES



JUL 07 2026

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220 (C.A.N. 3538)
 MIAMI, FLORIDA 33173
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\19-115D-W



S-3000 ALUM SLIDING GLASS DOOR (L.M.I.)

Labrador & Fundora Corp.
 dba-V & V Windows
 14150 N.W. 56th Court, Suite 600
 Opa-Locka, FL 33054
 Tel. (305) 888-4151
 www.vvwindows.com

revisions:	no	date	by	description
	A	08.13.21		NO CHANGE THIS SHEET
	B	06.07.23		UPDATED TO 2023 FBC
	C	02.23.24		GENERAL REVISION
	D	06.23.26		NO CHANGE THIS SHEET

date: 10-25-19
 scale: 3/8" = 1"
 dr. by: TARIQ
 chk. by:

drawing no.
19-115D
 sheet 15 of 28

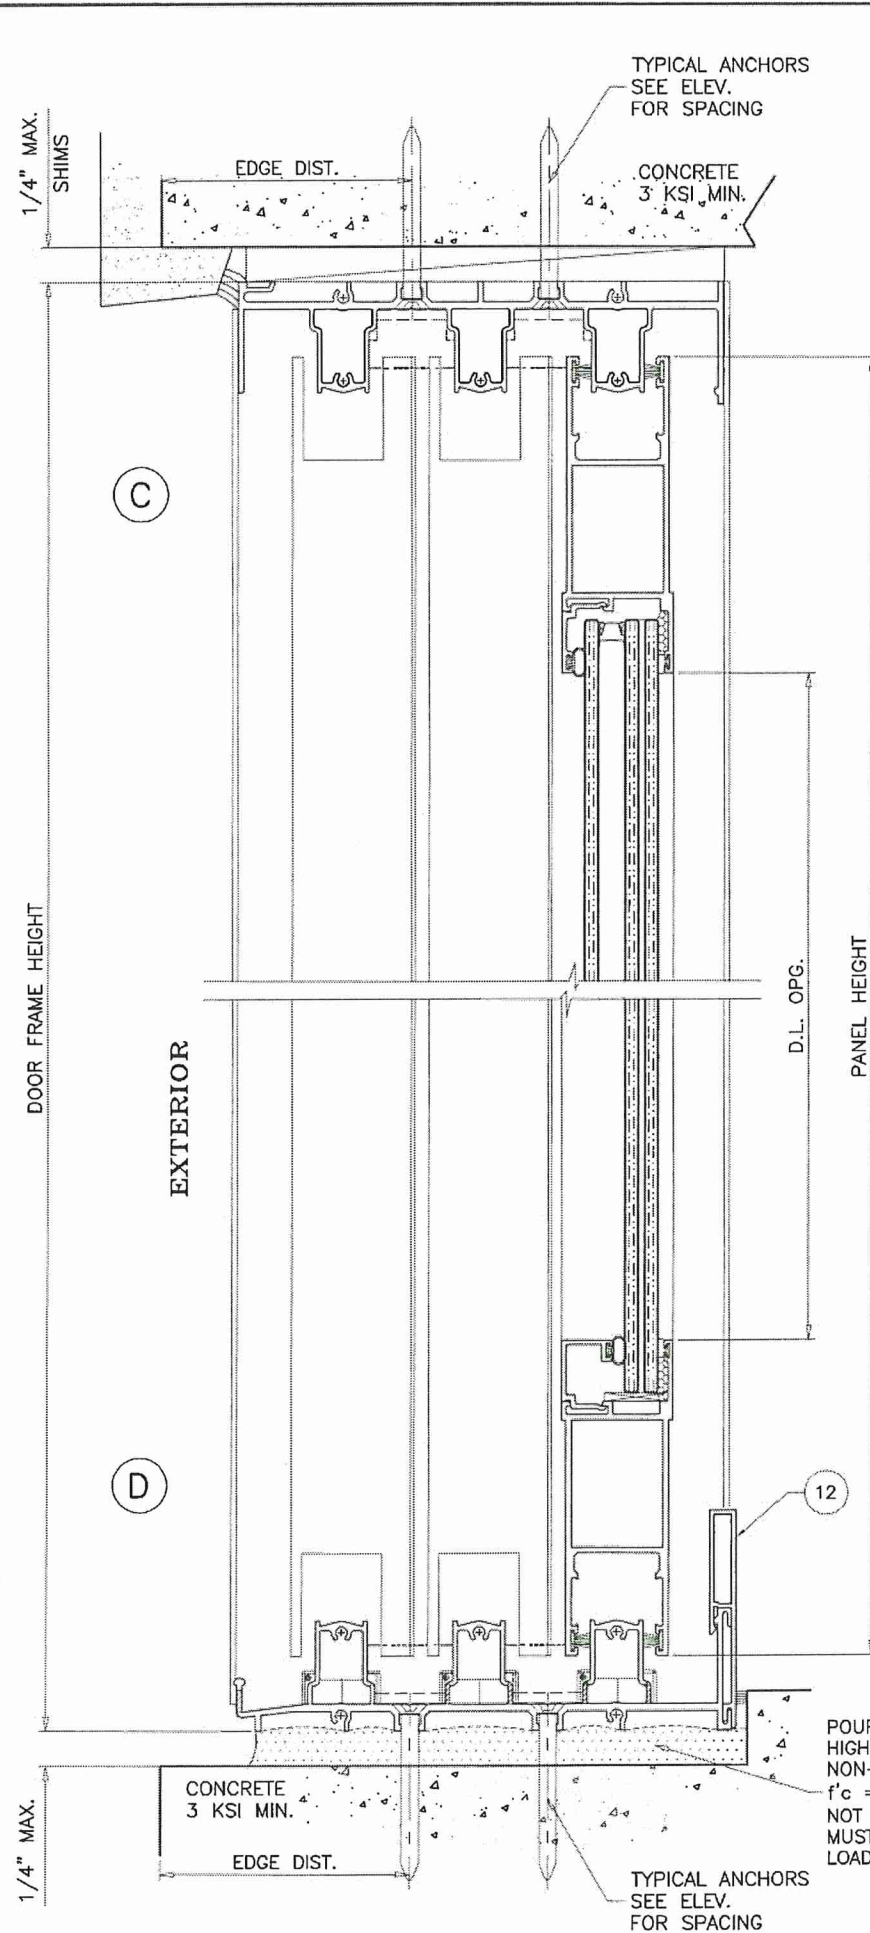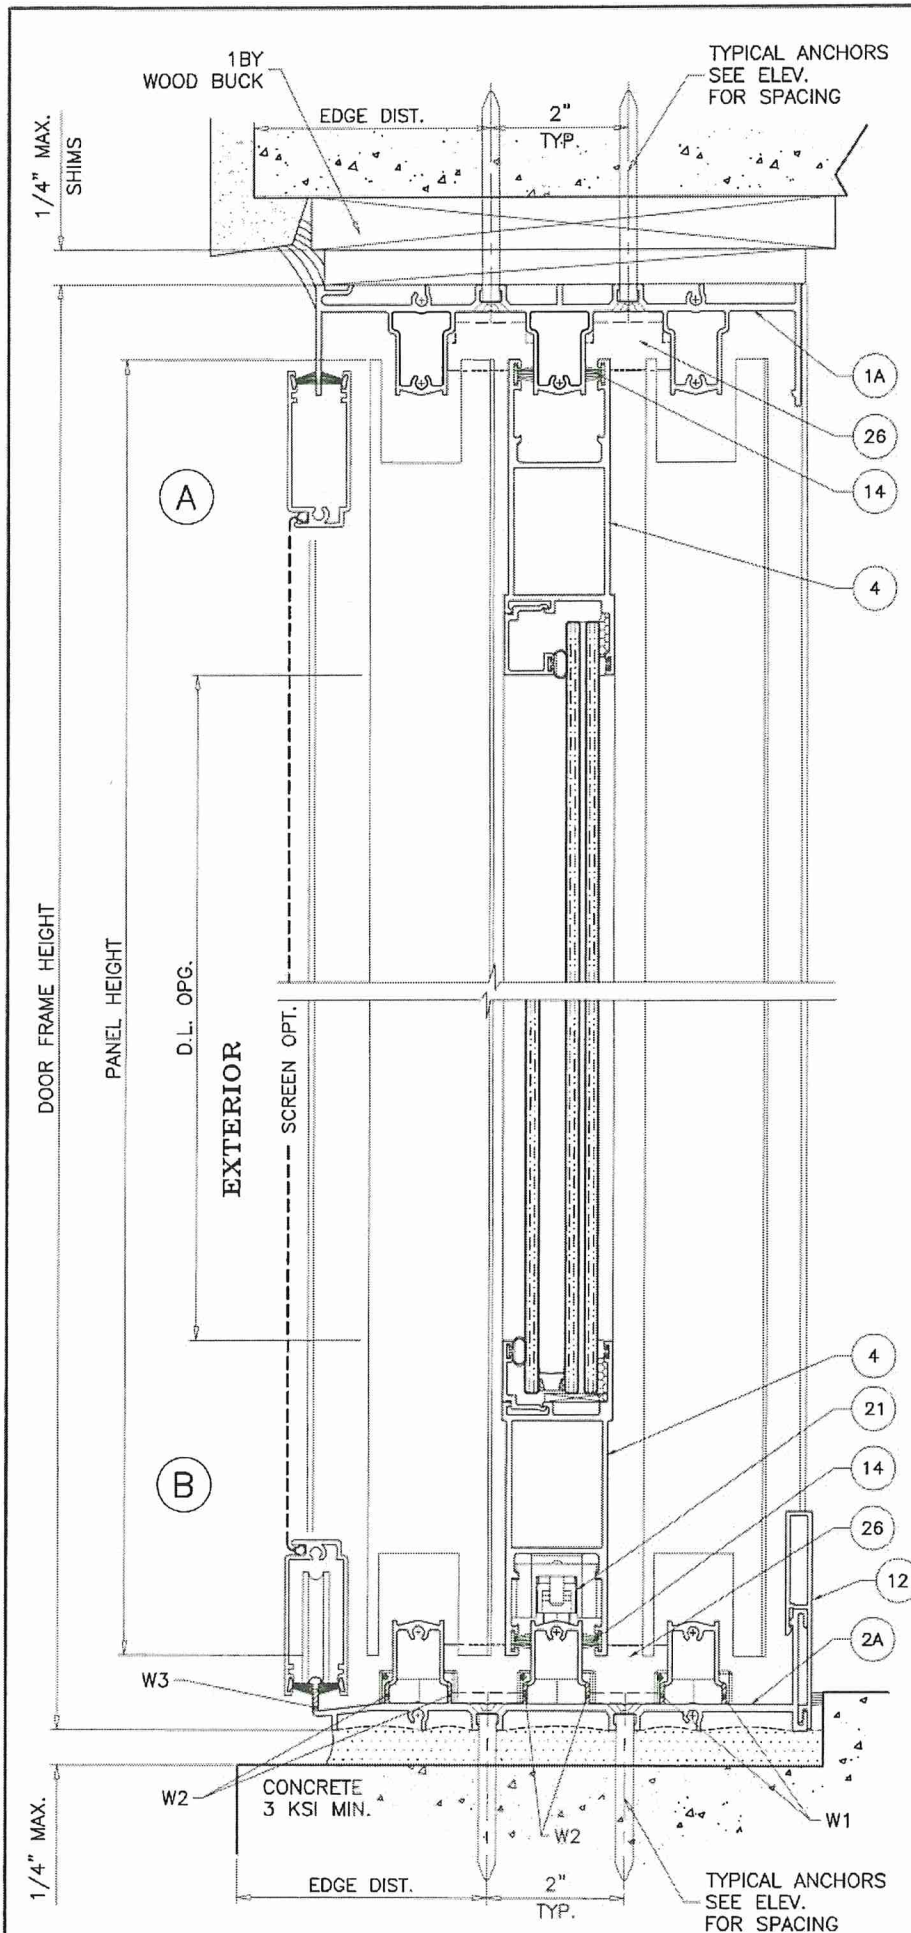


WEEPHOLES:

- W1 = 1-1/2" X 1/4" WEEP SLOTS
AT 7" FROM EACH END AND 34" O.C.
- W2 = 1-1/2" X 1/4" WEEP SLOTS
AT 5" FROM ENDS AND 24" O.C.
- W3 = 1-1/2" X 1/4" WEEP SLOTS
AT 7" FROM ENDS AND 24" O.C.

PRODUCT REVISED
complying with the Florida
Building Code
Acceptance No. 26-0709-08
Expiration Date 9/21/2031
By J. J. L.
Miami Dade Product Control

3 TRACK FRAMES

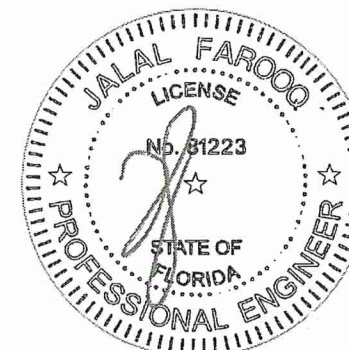

JUL 07 2026

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL (305) 264-8100 FAX (305) 262-6978
COMP-ANL\19-115D-W

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL (305) 264-8100 FAX (305) 262-6978
COMP-ANL\19-115D-W

S-3000 ALUM SLIDING GLASS DOOR (L.M.I.)

Labrador & Fundora Corp.
dba-V & V Windows
14150 N.W. 56th Court, Suite 600
Opa-Locka, FL 33054
Tel. (305) 888-4151
www.vvwindows.com

revisions:

no	date	by	description
C	02.23.24		GENERAL REVISION
D	06.23.26		NO CHANGE THIS SHEET




date: 10-25-19
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:

drawing no.
19-115D

sheet 16 of 28

drawing no.
19-115D

sheet 16 of 28

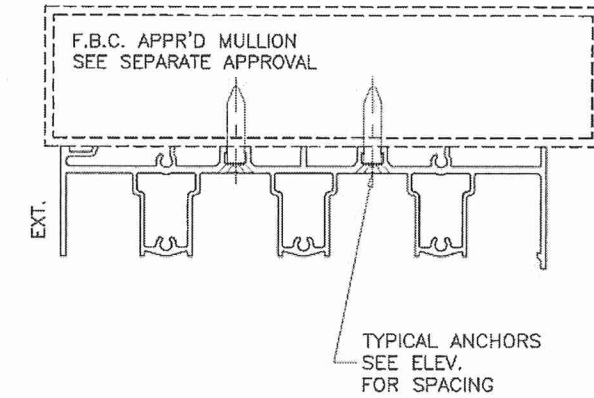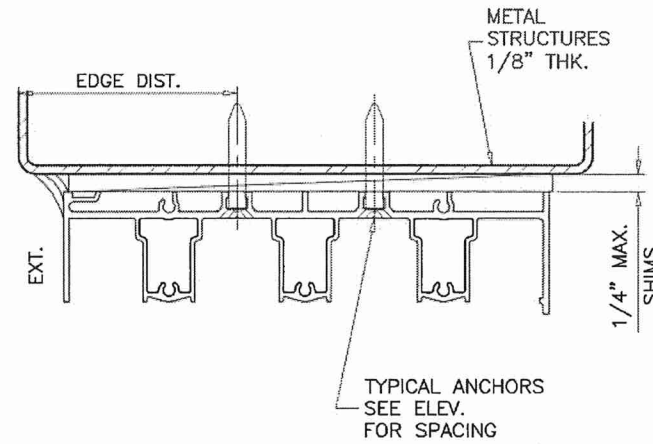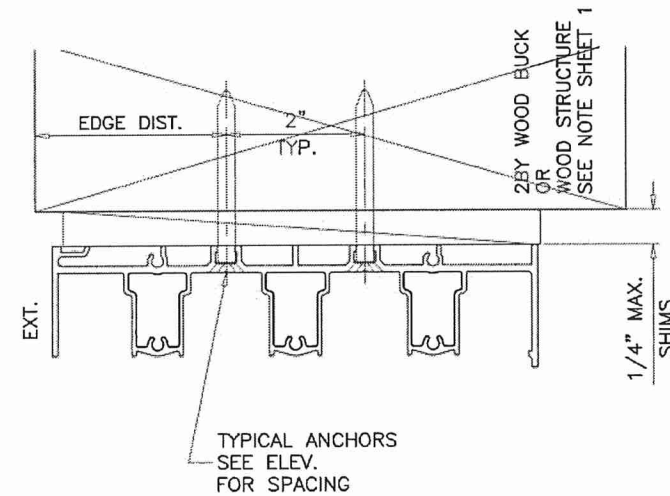

1BY OR 2BY WOOD BUCKS AND METAL STRUCTURE NOT BY 'V & V WINDOWS' MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)

INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
1-1/2" MIN. PENETRATION INTO WOOD (HEAD/JAMBS)

THRU 1BY BUCKS INTO CONC. OR BLOCKS
1-1/4" MIN. EMBED INTO CONCRETE (HEAD/JAMBS)
1-1/4" MIN. EMBED INTO BLOCKS (JAMBS)

DIRECTLY INTO CONCRETE OR BLOCKS
1-1/4" MIN. EMBED INTO CONCRETE (HEAD/SILL/JAMBS)
1-1/4" MIN. EMBED INTO BLOCKS (JAMBS)

1/4" DIA. TEKS OR SELF-DRILLING SCREWS (GRADE 5 CRS)

INTO MIAMI-DADE COUNTY APPROVED MULLIONS
AND
INTO METAL STRUCTURES (HEAD/JAMBS)
(3) THREADS MIN. TO EXTEND BEYOND METAL THICKNESS
ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)
STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.)
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)


CRITICAL EDGE DISTANCE

INTO CONCRETE AND BLOCKS = 2-1/2" MIN.
INTO WOOD STRUCTURE = 5/8" MIN.
INTO METAL STRUCTURE = 1/2" MIN.

WOOD AT HEAD, SILL OR JAMBS SG = 0.55 MIN.
CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.
C-90 HOLLOW/FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No **26-0709-08**
Expiration Date **9/2/2031**
By **Ismael J. Llanos**
Miami Dade Product Control

3 TRACK FRAMES

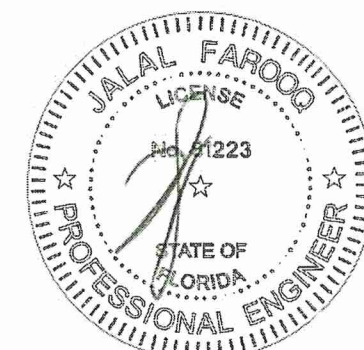

JUL 07 2026

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

af c

COMP-ANL\19-115D-W

S-3000 ALUM SLIDING GLASS DOOR (L.M.I.)

Labrador & Fundora Corp.
dba - Y & V Windows
14150 N.W. 56th Court, Suite 600
Opa-Locka, FL. 33054
Tel. (305) 888-4151
www.vvwindows.com

19-115D



sheet 17 of 28

revisions:		date		by description	
no	date	no	date	by	description

date: 10-25-19
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:


drawing no.
19-115D

sheet 17 of 28

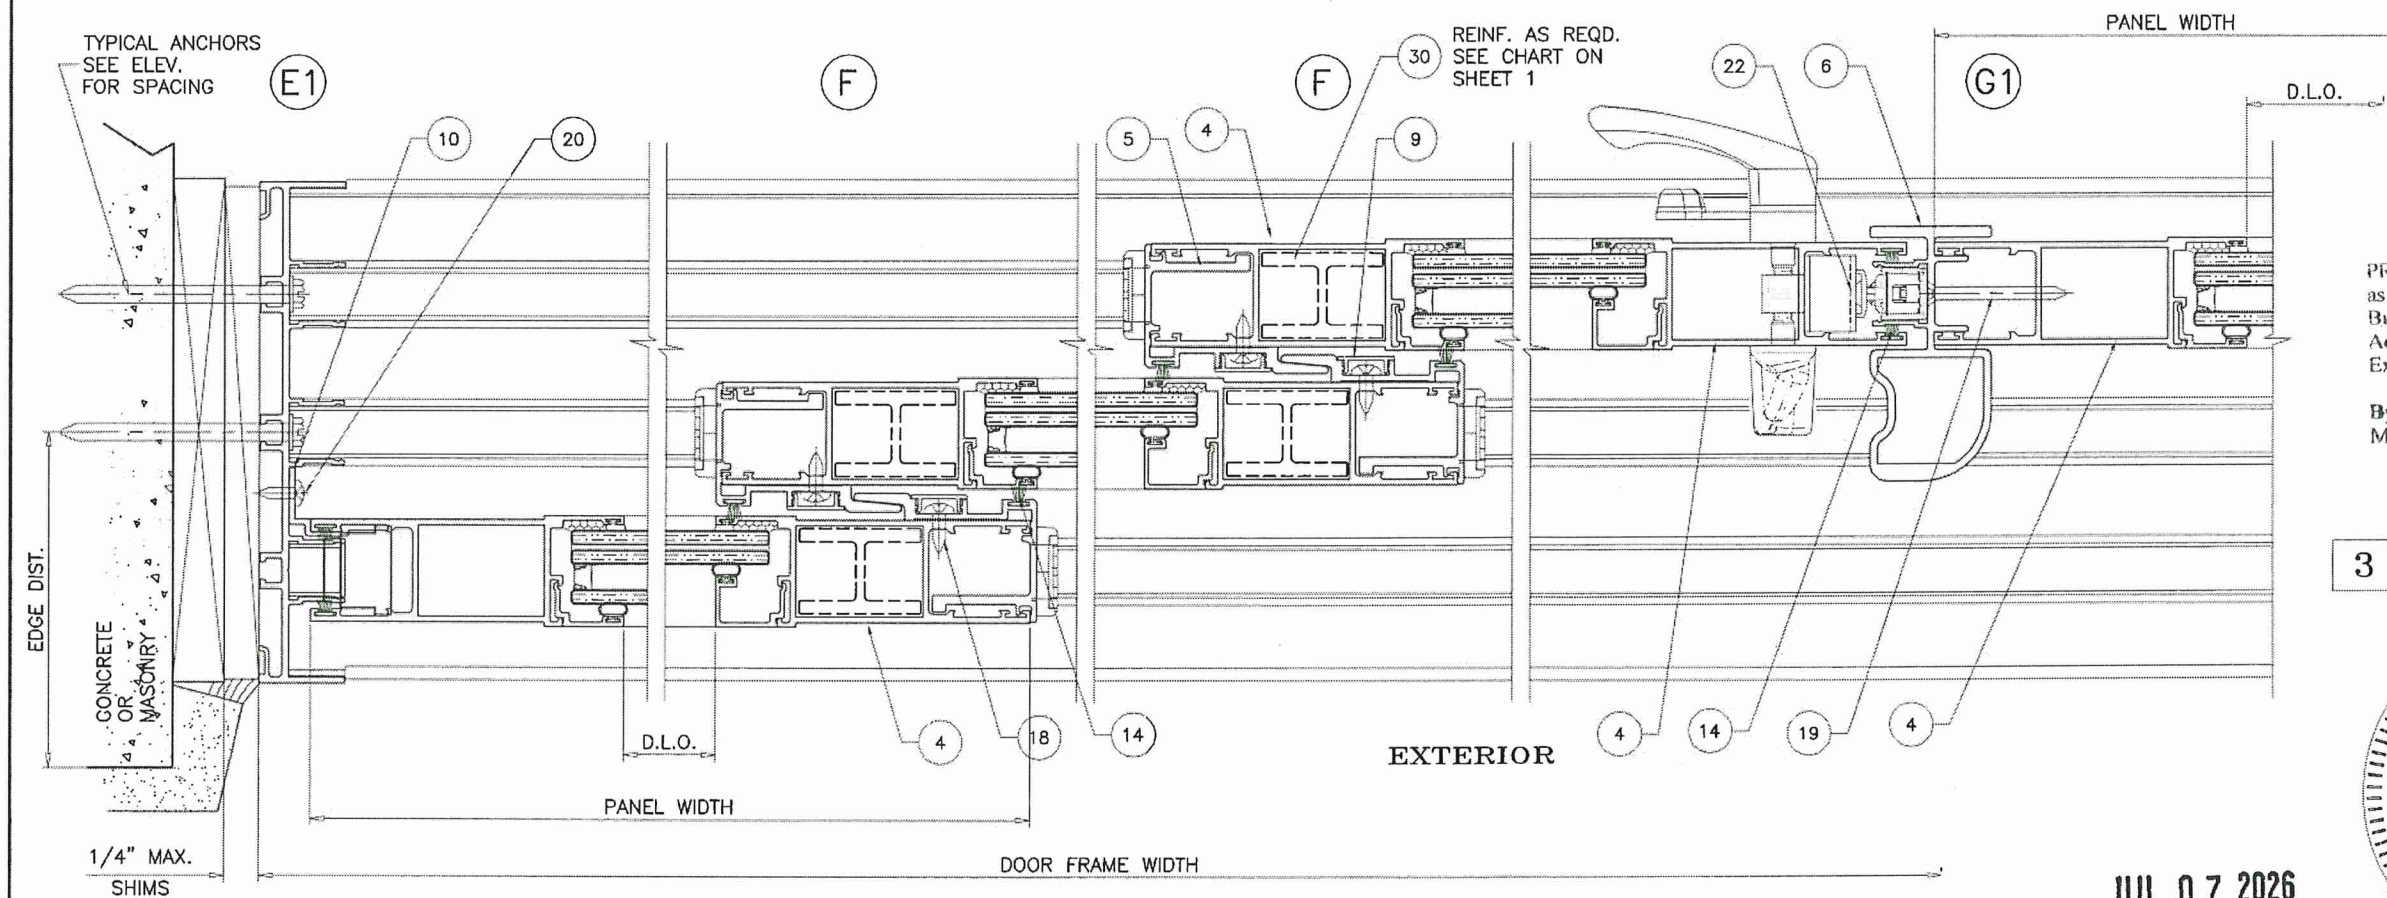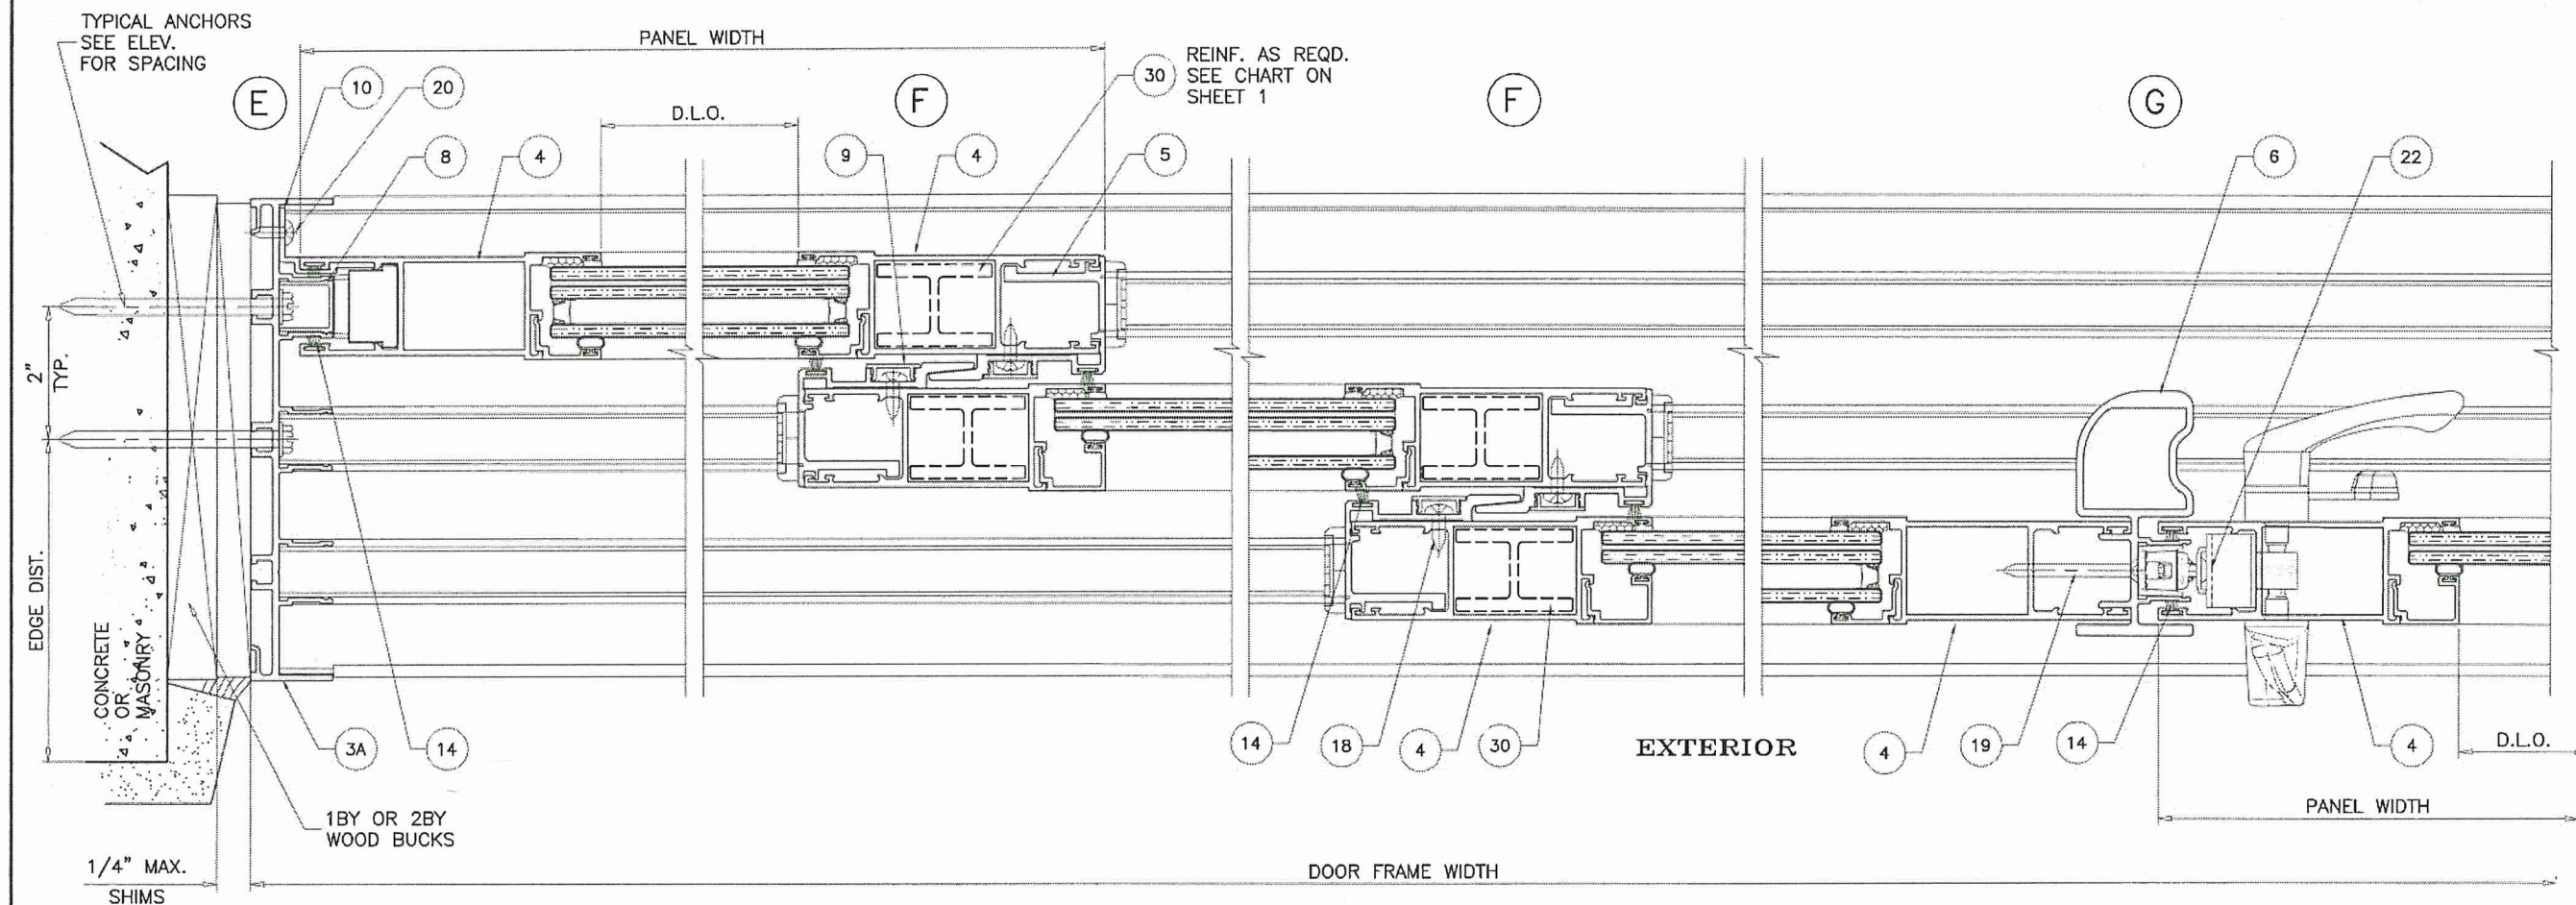

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 26-0709-02
Expiration Date 9/21/2021
By Ismael I. Llanusa
Miami Dade Product Control

3 TRACK FRAMES

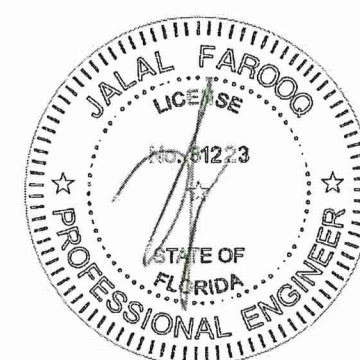

JUL 07 2026

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
C.A.N. 3538

COMP-ANL\19-115D-W

S-3000 ALUM SLIDING GLASS DOOR (L.M.I.)





Labrador & Fundora Corp.
dba-V & V Windows
14150 N.W. 56th Court, Suite 600
Opa-Locka, FL 33054
Tel. (305) 888-4151
www.vvwindows.com

revisions:

no	date	by	description
C	02.23.24	TARIQ	GENERAL REVISION
D	06.23.26		NO CHANGE THIS SHEET

date: 10-25-19
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:

drawing no.
19-115D
sheet 18 of 28

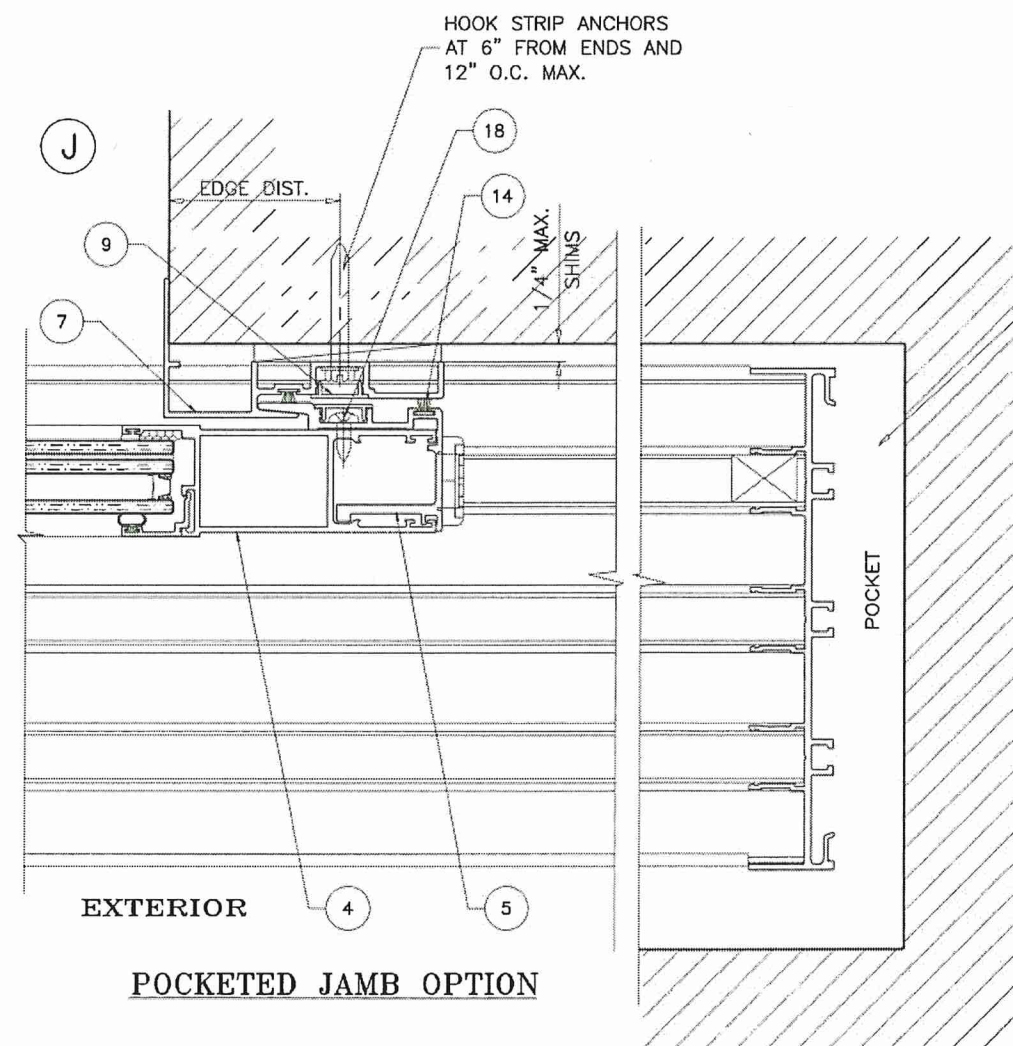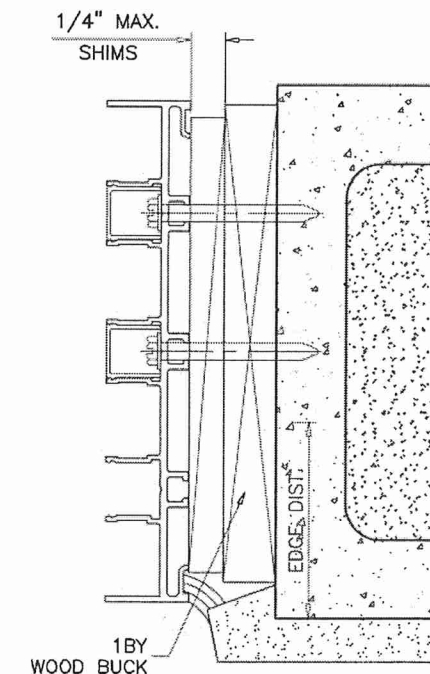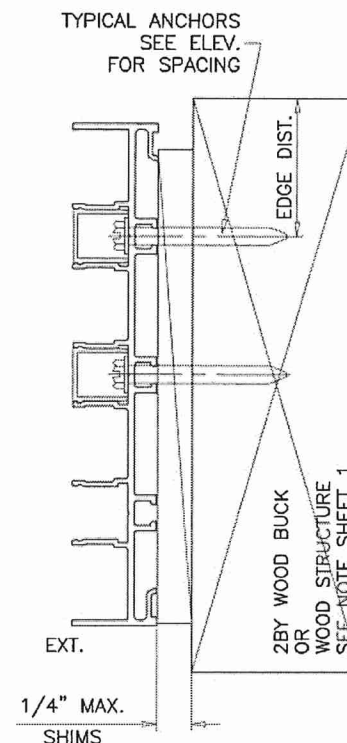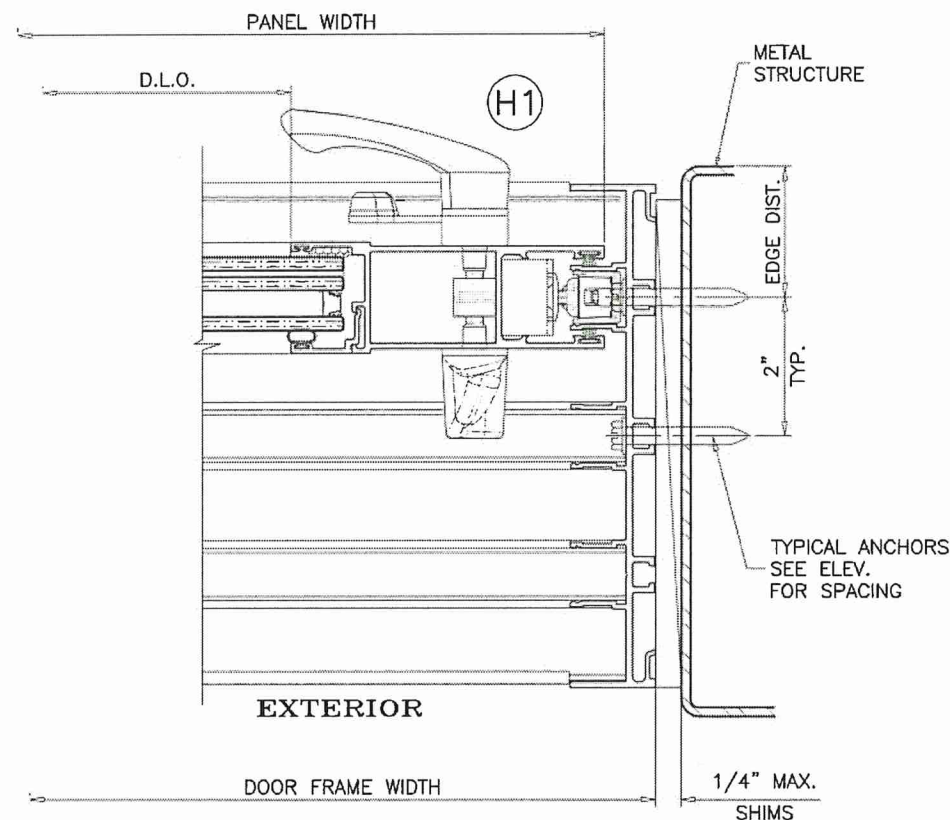

POCKET CAVITY NOT BY 'V & V WINDOWS'
NOT PART OF THIS APPROVAL
TO BE REVIEWED BY AHJ

HOOK STRIP ANCHORS: SEE ELEV. FOR SPACING
1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)

DIRECTLY INTO CONCRETE OR BLOCKS
1-3/8" MIN. EMBED INTO CONCRETE
1-3/4" MIN. EMBED INTO GROUT-FILLED BLOCKS

#14 SMS (GRADE 2 CRS)
INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
1-1/2" MIN. PENETRATION INTO WOOD


#14 SMS OR SELF DRILLING SCREWS (GRADE 2 CRS)
INTO METAL STRUCTURES
(3) THREADS MIN. PENETRATION BEYOND SUBSTRATE
ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)
STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.)
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL EDGE DISTANCE

INTO CONCRETE AND BLOCKS = 2" MIN.
INTO WOOD STRUCTURE = 1" MIN.
INTO METAL STRUCTURE = 3/4" MIN.

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No **26-6789-08**
Expiration Date **9/2/2031**
By **Larry I. L.**
Miami Dade Product Control

3 TRACK FRAMES

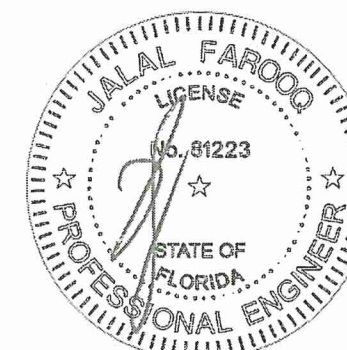

JUL 07 2026

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL (305) 264-8100 FAX (305) 262-6978
C.A.N. 3538

COMP-ANL\19-115D-W

S-3000 ALUM SLIDING GLASS DOOR (L.M.I.)

Labrador & Fundora Corp.
dba-V & V Windows
14150 N.W. 56th Court, Suite 600
Opa-Locka, FL 33054
Tel. (305) 888-4151
www.vvwindows.com

revisions:



no	date	by	description
C	02.23.24		GENERAL REVISION
D	06.23.26		NO CHANGE THIS SHEET

date: 10-25-19
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:

drawing no.
19-115D

sheet 19 of 28


date: 10-25-19
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:

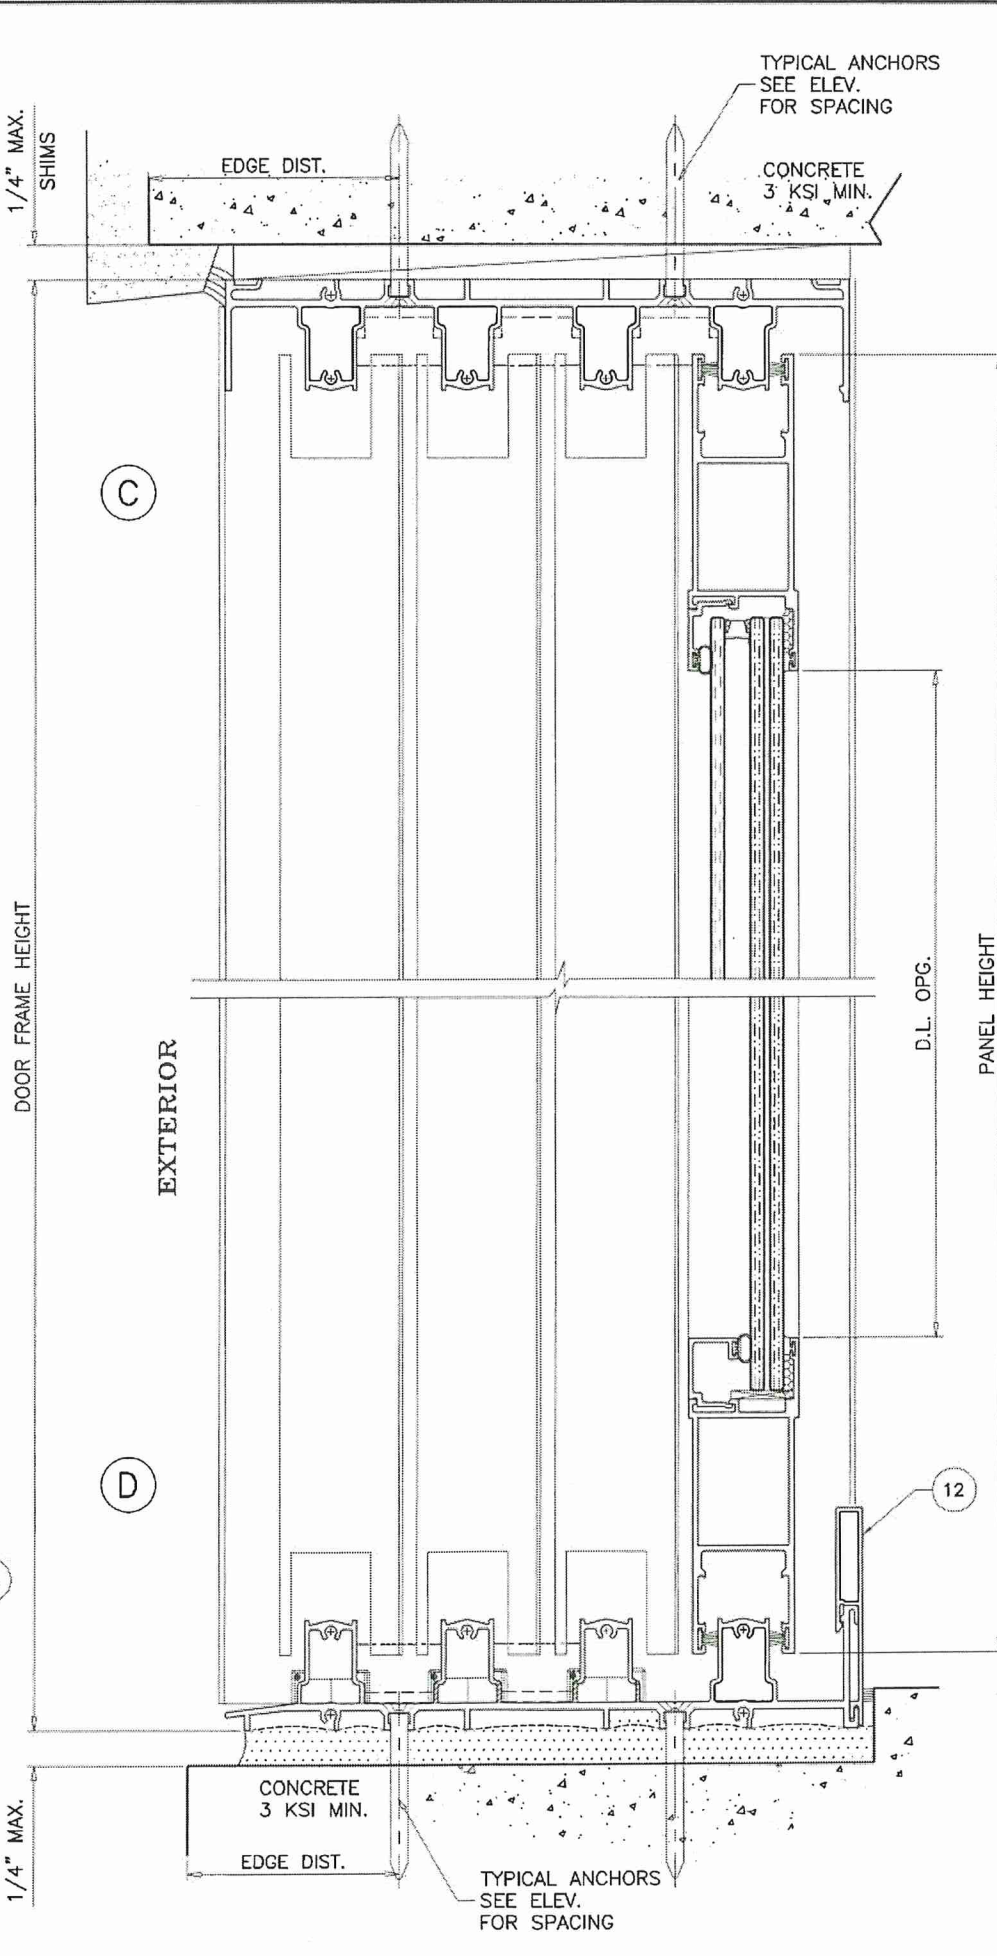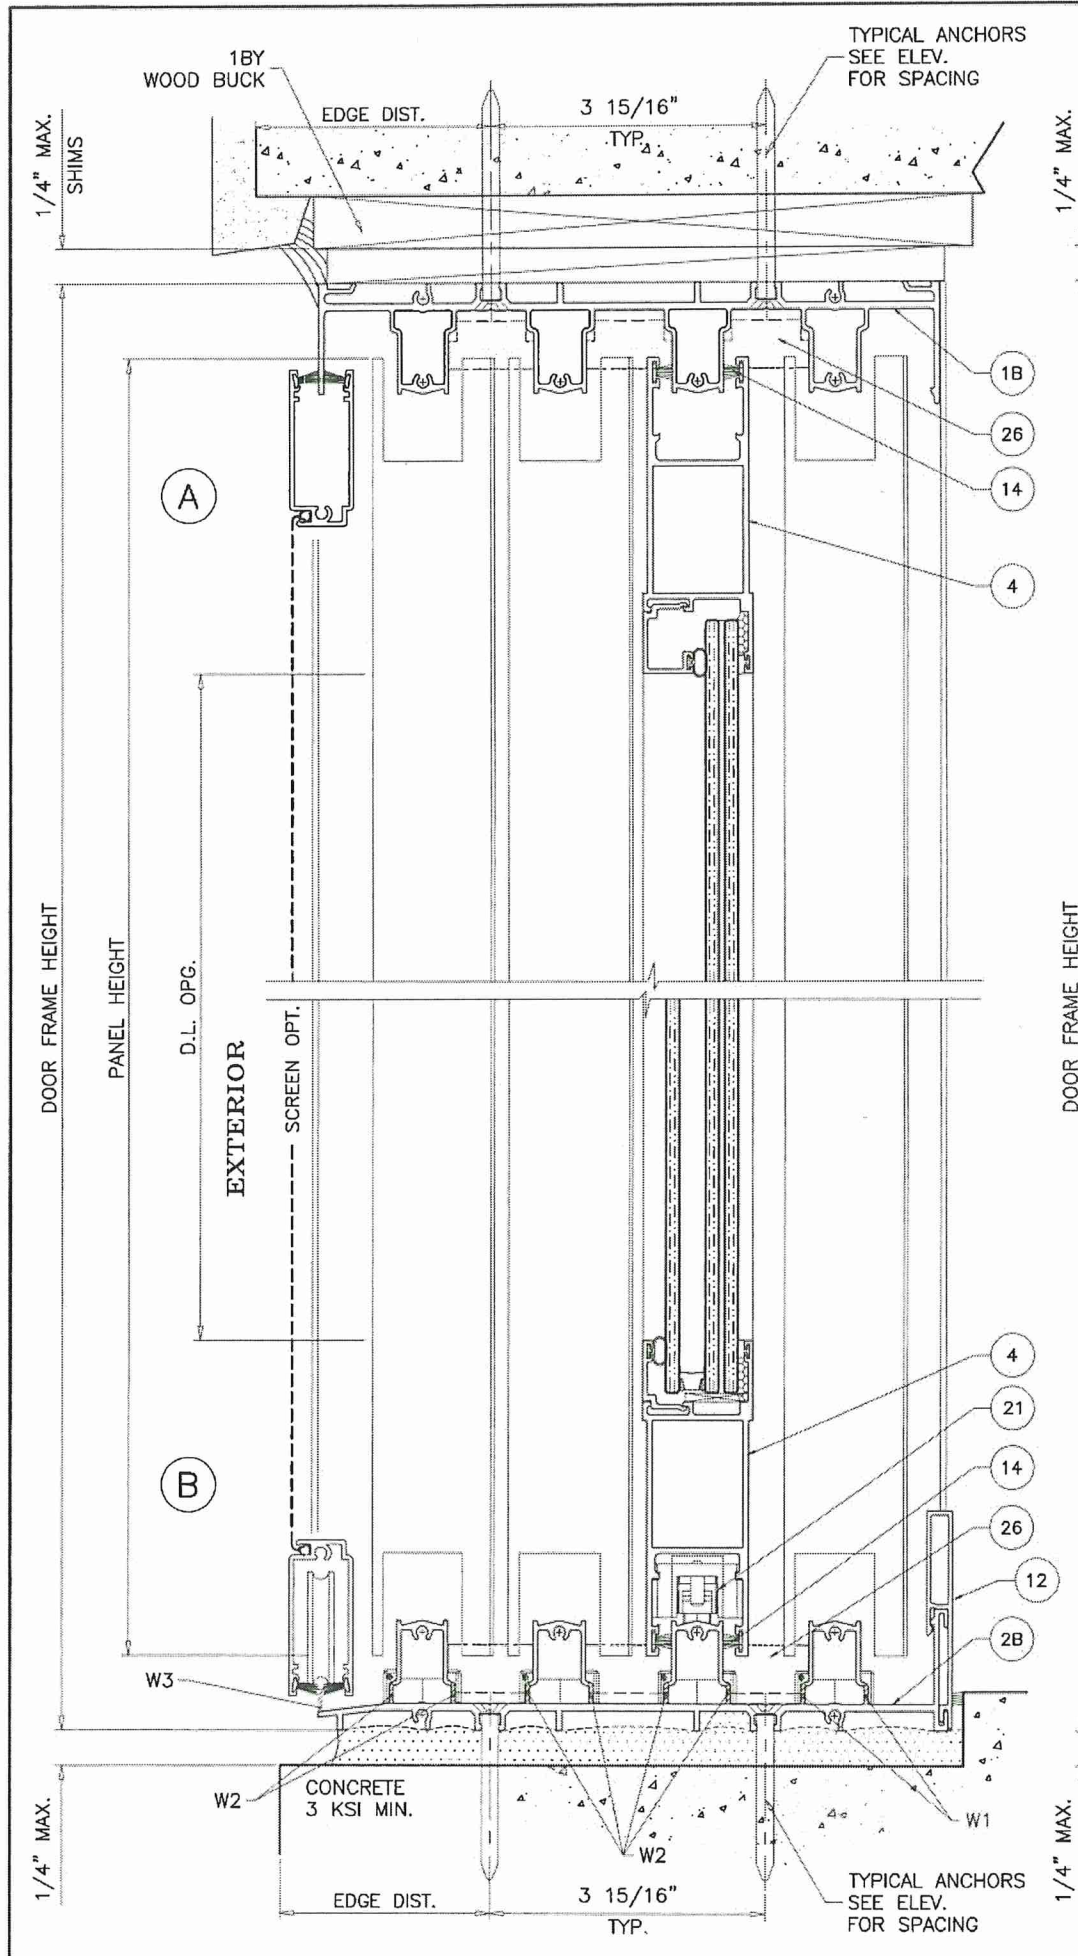

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 26-0709-08
 Expiration Date 9/2/2031
 By Ishtaq Ali
 Miami Dade Product Control

WEEPHOLES:
 W1 = 1-1/2" X 1/4" WEEP SLOTS
 AT 7" FROM EACH END AND 34" O.C.
 W2 = 1-1/2" X 1/4" WEEP SLOTS
 AT 5" FROM ENDS AND 24" O.C.
 W3 = 1-1/2" X 1/4" WEEP SLOTS
 AT 7" FROM ENDS AND 24" O.C.

4 TRACK FRAMES

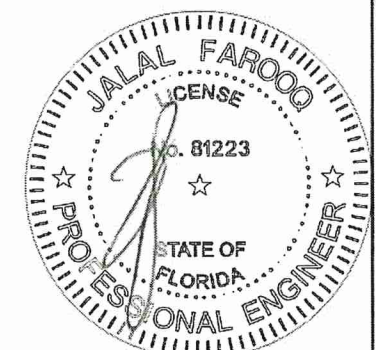

JUL 07 2026

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\19-115D-W

S-3000 ALUM SLIDING GLASS DOOR (L.M.I.)

Labrador & Fundora Corp.
 dba-V & V Windows
 14150 N.W. 56th Court, Suite 600
 Opa-Locka, FL 33054
 Tel. (305) 888-4151
 www.vvwindows.com

revisions:		no		date		description	
10-25-19	3/8" = 1"	dr.	by:	TARIQ	chk.	by:	
C 02.23.24		GENERAL REVISION					
D 06.23.26		NO CHANGE THIS SHEET					

date: 10-25-19




scale: 3/8" = 1"

dr. by: TARIQ

chk. by:

drawing no. 19-115D

sheet 20 of 28

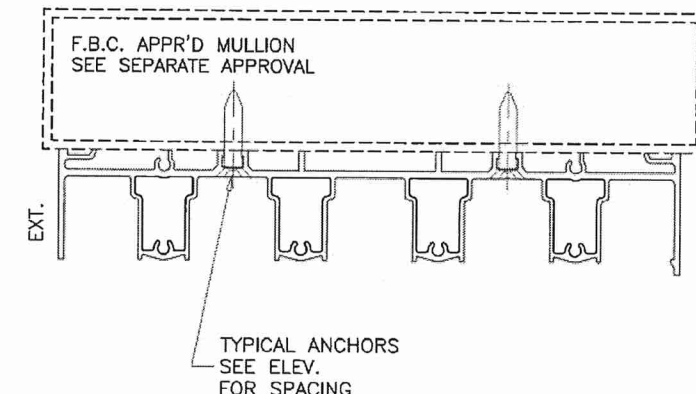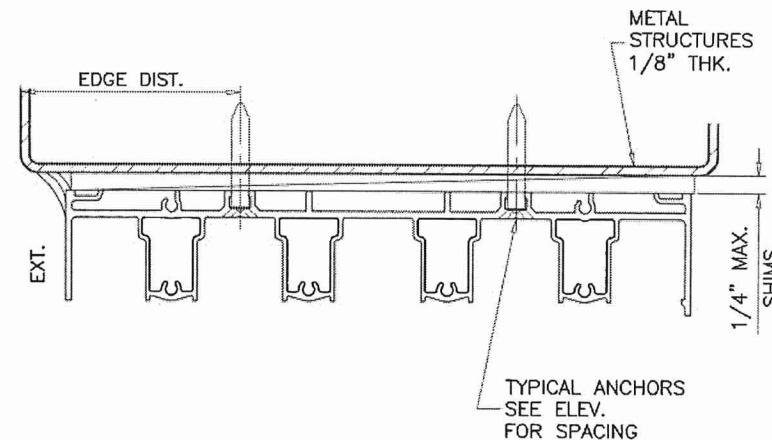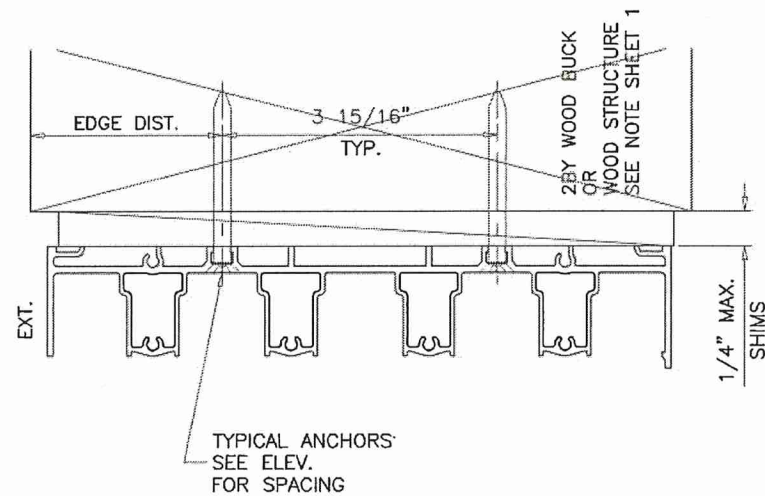

1BY OR 2BY WOOD BUCKS AND METAL STRUCTURE NOT BY 'V & V WINDOWS' MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

1/4\"/>

INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
1-1/2\"/>

THRU 1BY BUCKS INTO CONC. OR BLOCKS
1-1/4\"/>

DIRECTLY INTO CONCRETE OR BLOCKS
1-1/4\"/>

1/4\"/>

INTO MIAMI-DADE COUNTY APPROVED MULLIONS
AND
INTO METAL STRUCTURES (HEAD/JAMBS)
(3) THREADS MIN. TO EXTEND BEYOND METAL THICKNESS
ALUMINUM: 1/8\"/>


CRITICAL EDGE DISTANCE

INTO CONCRETE AND BLOCKS = 2-1/2\"/>

WOOD AT HEAD, SILL OR JAMBS SG = 0.55 MIN.
CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.
C-90 HOLLOW/FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No **26-0709-08**
Expiration Date **9/2/2031**
By **Ishag I. U.**
Miami Dade Product Control

4 TRACK FRAMES

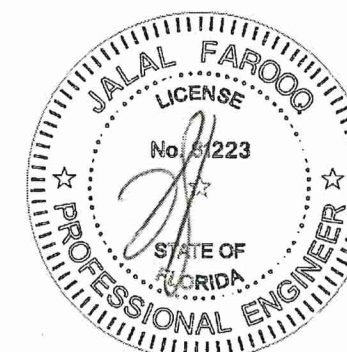

JUL 07 2026

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\19-115D-W

af c

S-3000 ALUM SLIDING GLASS DOOR (L.M.I.)


Labrador & Fundora Corp.
dba-V & V Windows
14150 N.W. 56th Court, Suite 600
Opa-Locka, FL 33054
Tel. (305) 888-4151
www.vvwindows.com

revisions:

no	date	by	description
C	02.23.24		GENERAL REVISION
D	06.23.26		NO CHANGE THIS SHEET


date: 10-25-19
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:

drawing no.
19-115D
sheet **21** of **28**

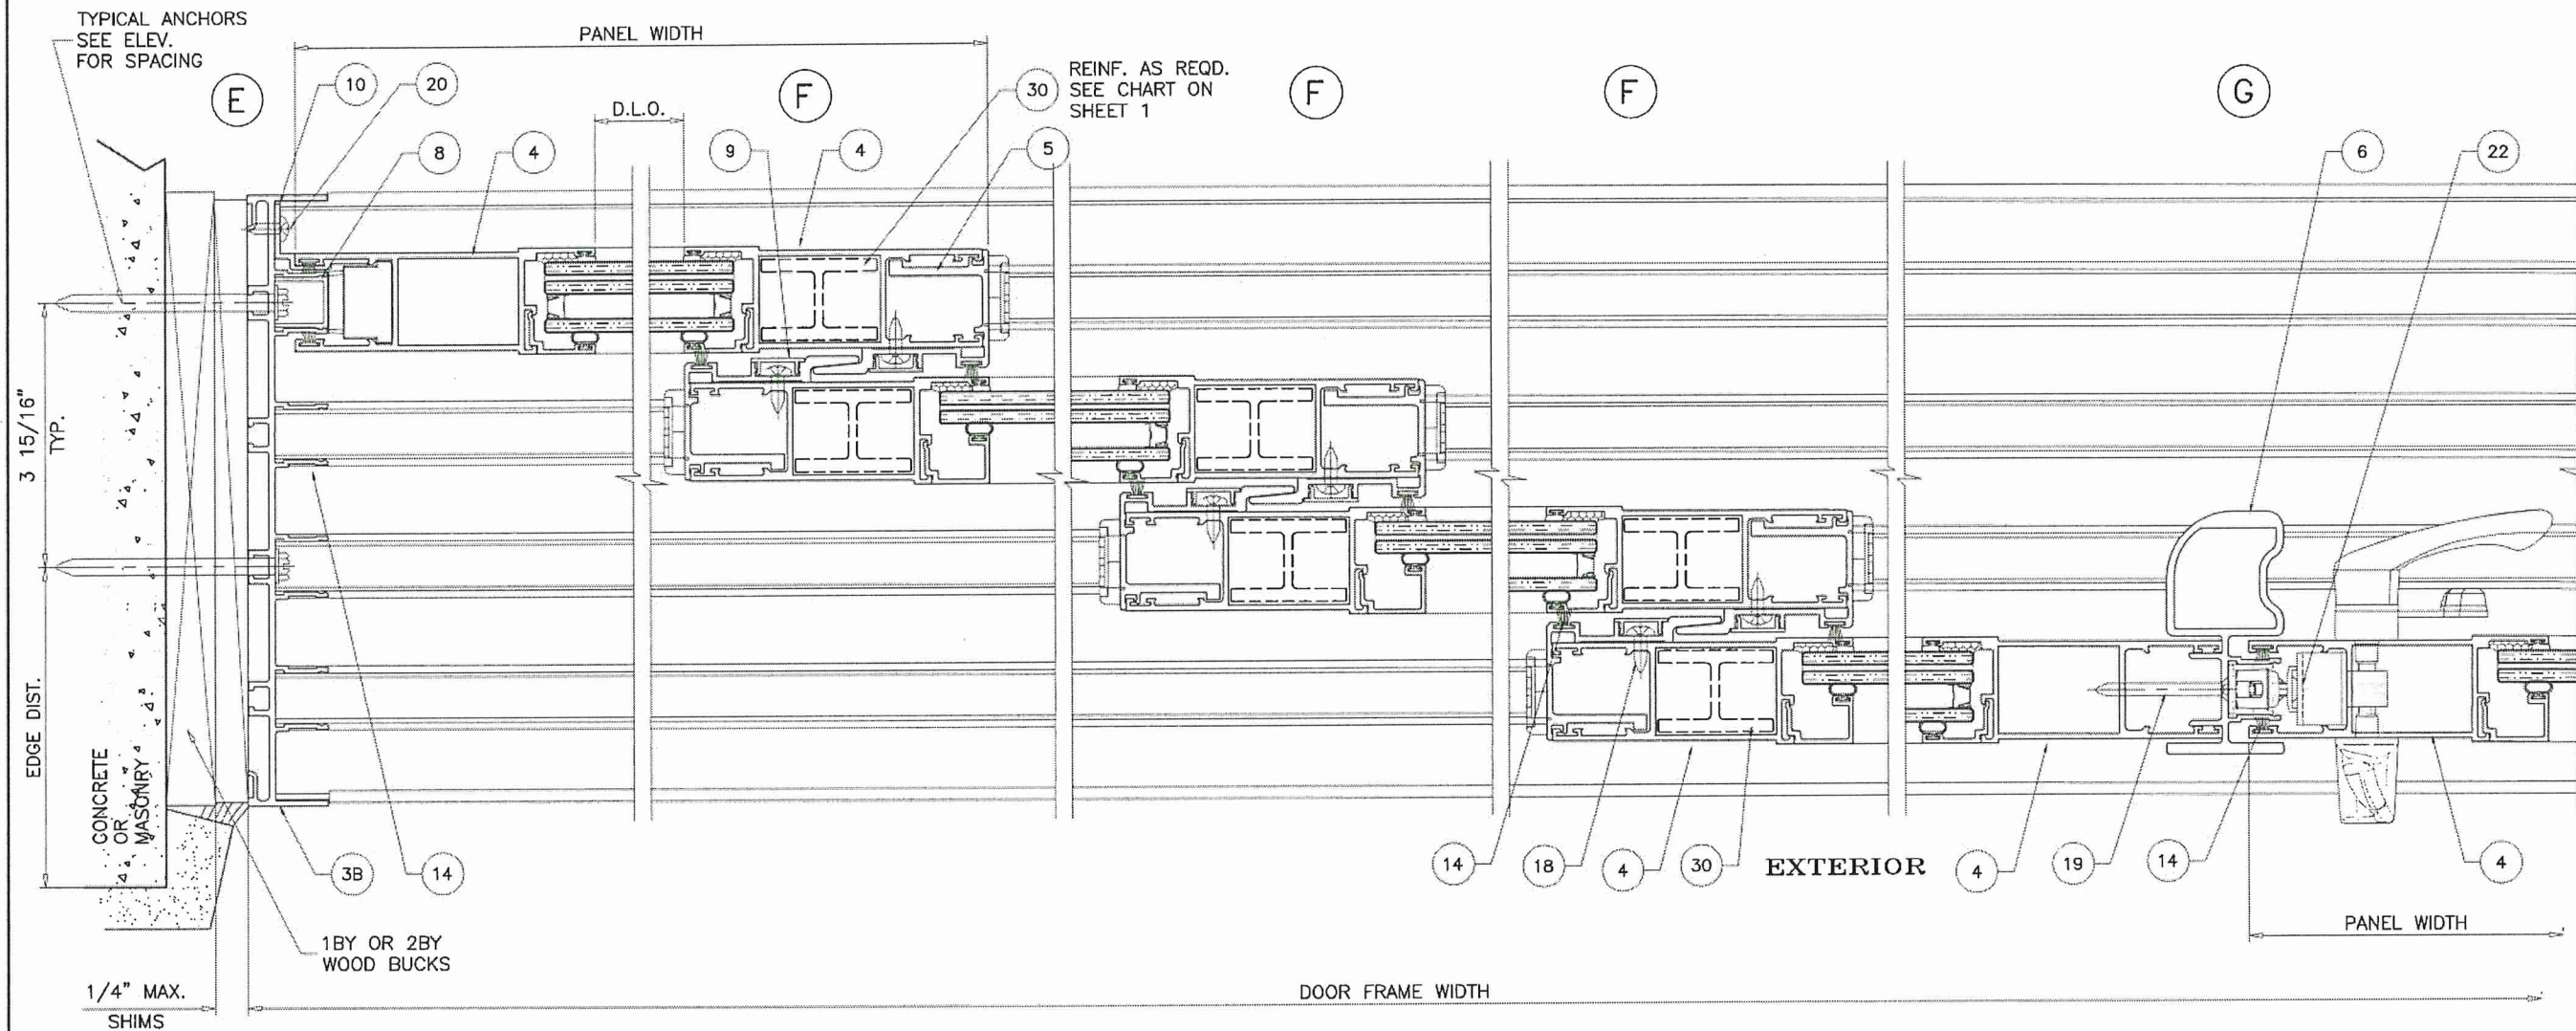

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 26-0769-08
Expiration Date 9/2/2031
By [Signature]
Miami Dade Product Control


4 TRACK FRAMES

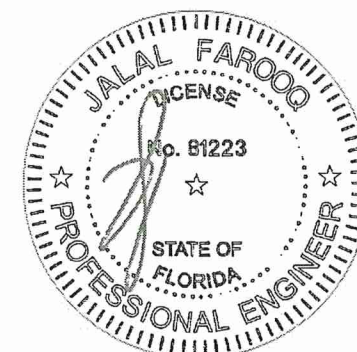

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL 19-115D-W


1111 07 2026

S-3000 ALUM SLIDING GLASS DOOR (L.M.I.)	
Labrador & Fundora Corp. dba-V & V Windows 14150 N.W. 56th Court, Suite 600 Opa-Locka, FL 33054 Tel. (305) 888-4151 www.vvwindows.com	
revisions:	by description
no	date
C	02.23.24
D	06.23.26
GENERAL REVISION NO CHANGE THIS SHEET	
date: 10-25-19	scale: 3/8" = 1"
dr. by: TARIQ	chk. by:
drawing no. 19-115D	
sheet 22 of 28	

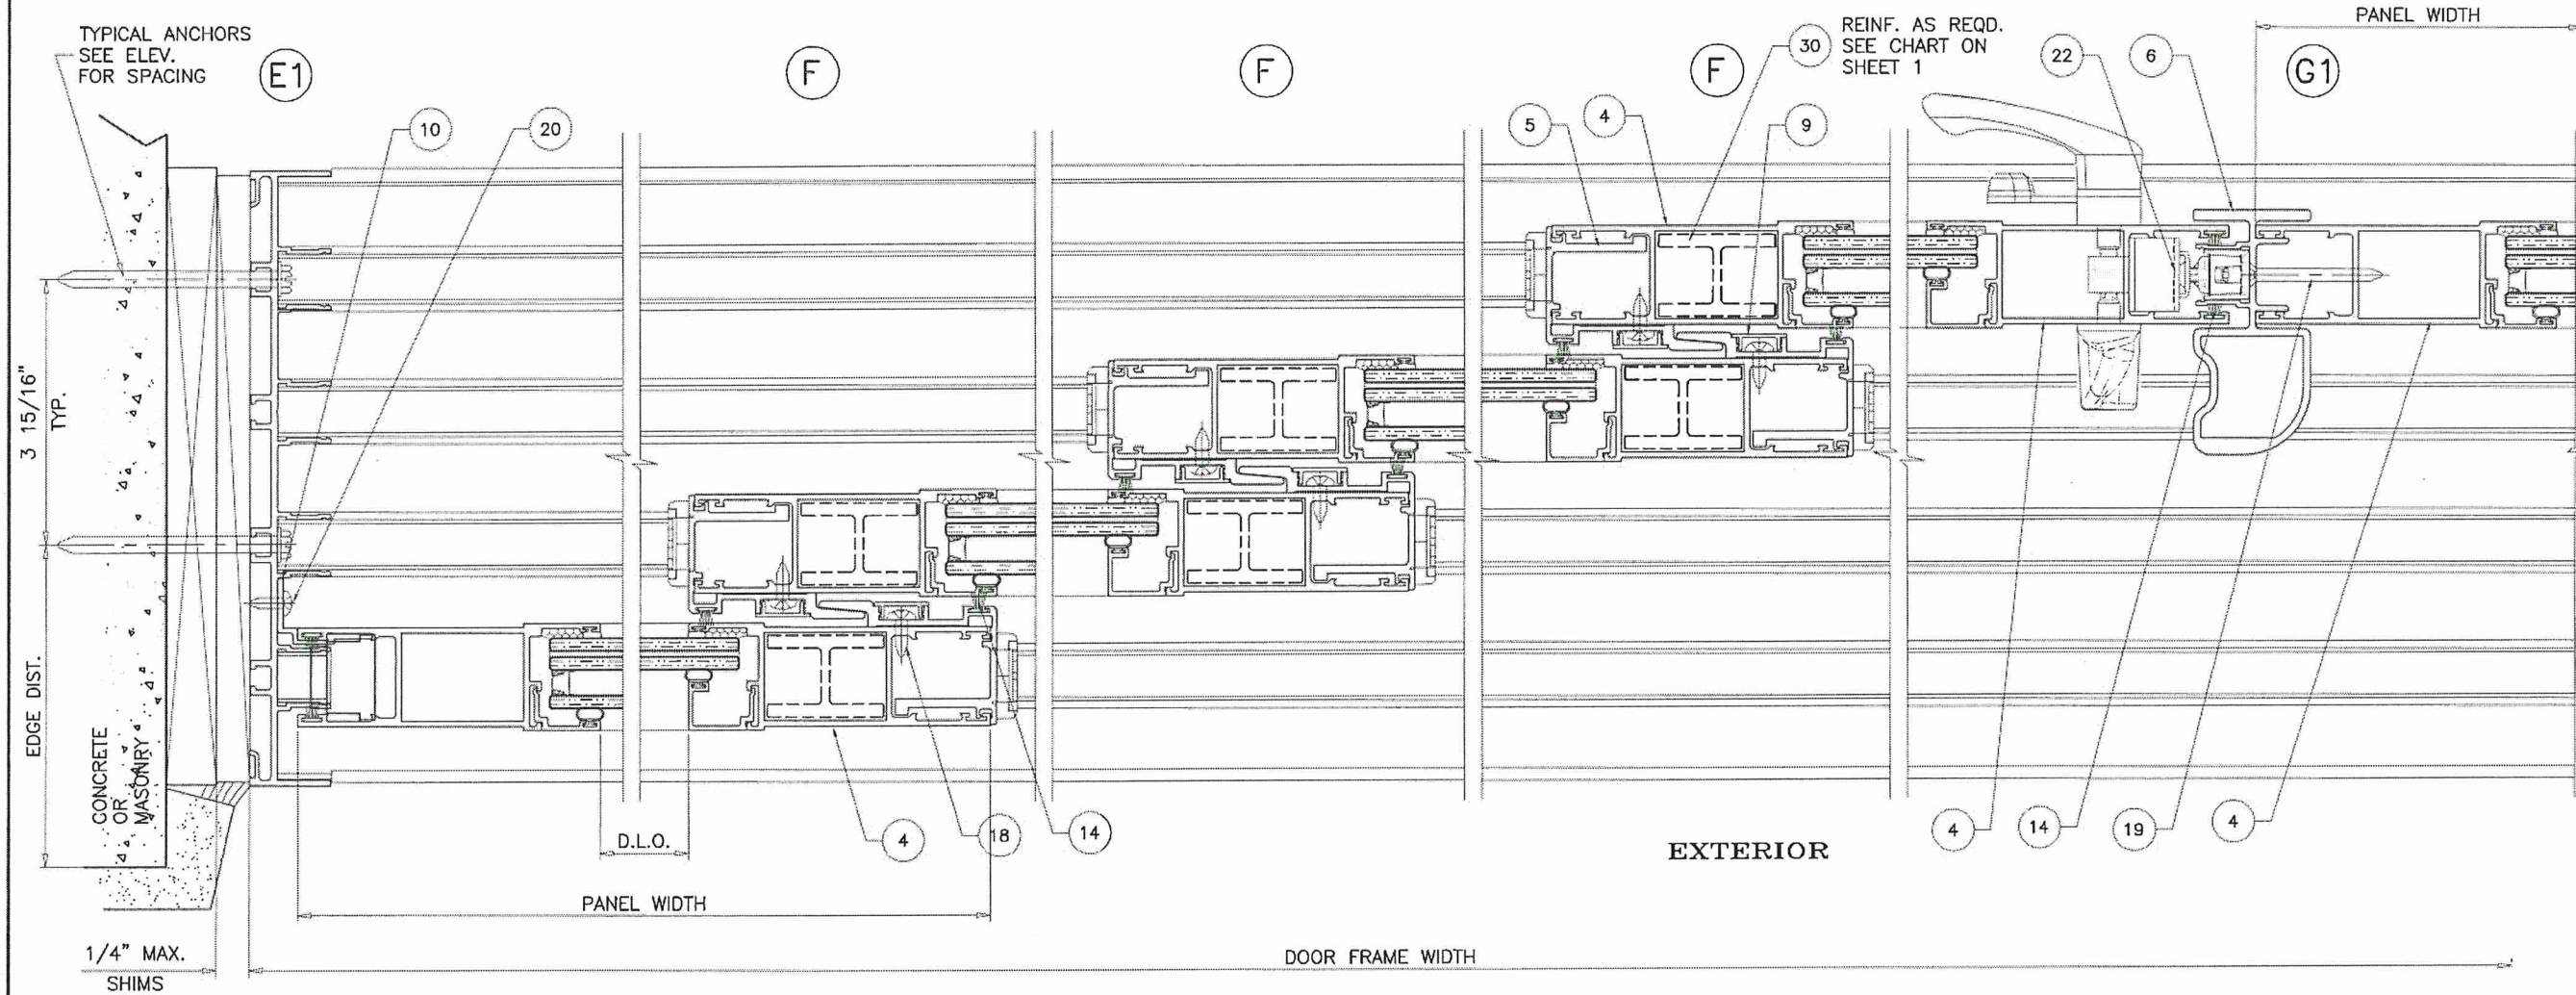

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 26-0709-08
 Expiration Date 9/2/2031
 By Ishag J. L.
 Miami Dade Product Control

4 TRACK FRAMES

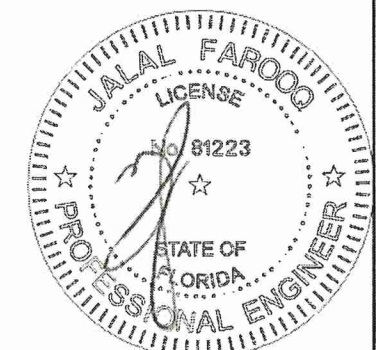

JUL 07 2026

a f c

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173 (C.A.N. 3538)
 TEL. (305) 264-8100 FAX. (305) 262-6978

COMP-ANL\19-115D-W

S-3000 ALUM SLIDING GLASS DOOR (L.M.I.)

Labrador & Fundora Corp.
 dba-V & V Windows
 14150 N.W. 56th Court, Suite 600
 Opa-Locka, FL 33054
 Tel. (305) 888-4151
www.vvwindows.com

revisions:

no	date	by	description
C	02.23.24		GENERAL REVISION
D	06.23.26		NO CHANGE THIS SHEET

date: 10-25-19
 scale: 3/8" = 1"
 dr. by: TARIQ
 chk. by:

drawing no.
19-115D
 sheet 23 of 28

HOOK STRIP ANCHORS: SEE ELEV. FOR SPACING
1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)


DIRECTLY INTO CONCRETE OR BLOCKS
 1-3/8" MIN. EMBED INTO CONCRETE
 1-3/4" MIN. EMBED INTO GROUT-FILLED BLOCKS

#14 SMS (GRADE 2 CRS)
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 1-1/2" MIN. PENETRATION INTO WOOD



#14 SMS OR SELF DRILLING SCREWS (GRADE 2 CRS)
 INTO METAL STRUCTURES
 (3) THREADS MIN. PENETRATION BEYOND SUBSTRATE
 ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)
 STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL EDGE DISTANCE

INTO CONCRETE AND BLOCKS = 2" MIN.
 INTO WOOD STRUCTURE = 1" MIN.
 INTO METAL STRUCTURE = 3/4" MIN.

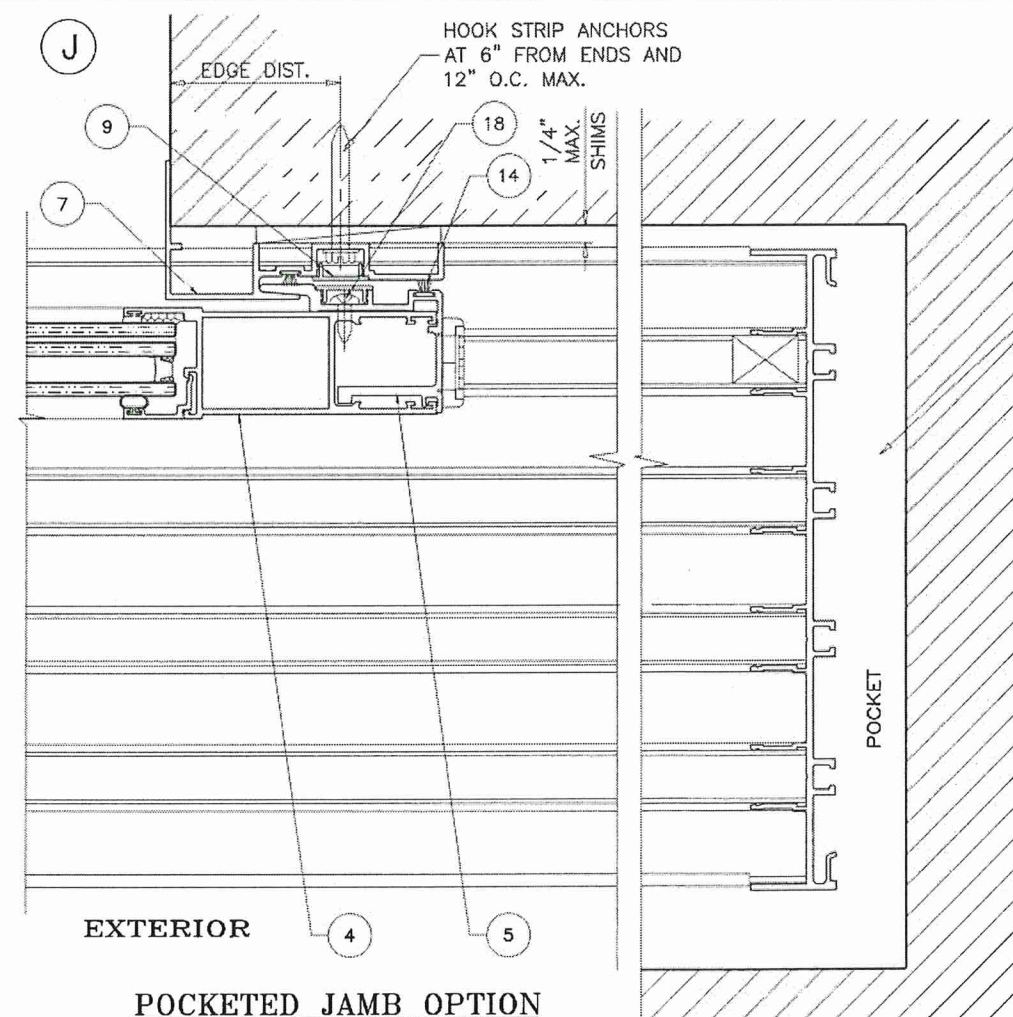


POCKETED JAMB OPTION

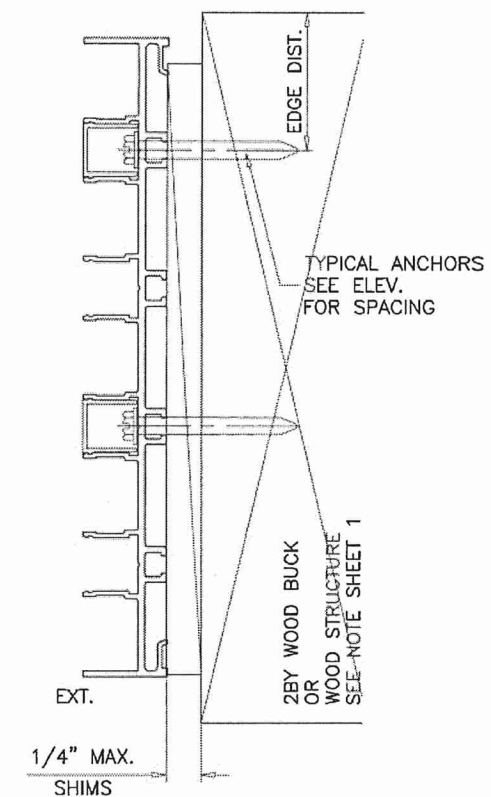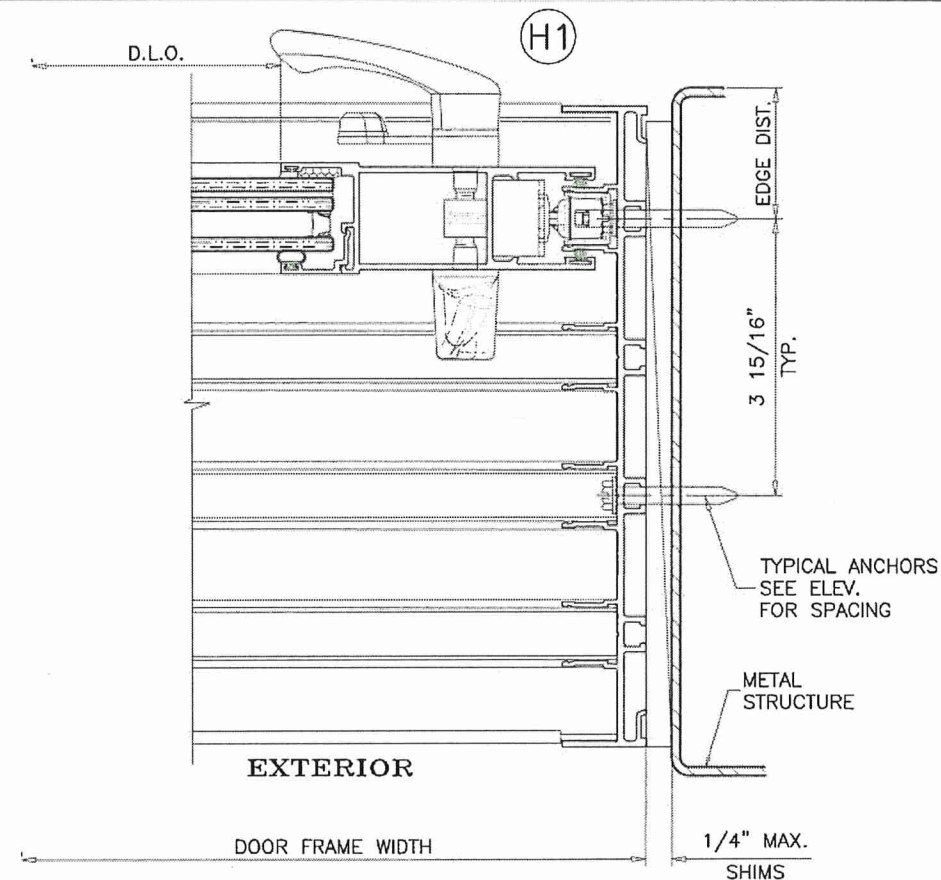

POCKET CAVITY NOT BY 'V & V WINDOWS'
 NOT PART OF THIS APPROVAL
 TO BE REVIEWED BY AHJ

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. **26-0708-08**
 Expiration Date **9/2/2031**
 By **Ismael L. Linares**
 Miami Dade Product Control

4 TRACK FRAMES

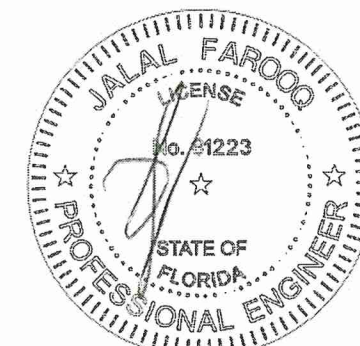

JUL 07 2026

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\19-115D-W

S-3000 ALUM SLIDING GLASS DOOR (L.M.I.)

Labrador & Fundora Corp.
 dba-V & V Windows
 14150 N.W. 56th Court, Suite 600
 Opa-Locka, FL 33054
 Tel. (305) 888-4151
 www.vvwindows.com

revisions:		date		by description	
no	date	no	date	by	description
		C	02.23.24		GENERAL REVISION
		D	05.23.26		NO CHANGE THIS SHEET

date: 10-25-19

scale: 3/8" = 1"


dr. by: TARIO

chk. by:


drawing no.

19-115D

sheet 24 of 28

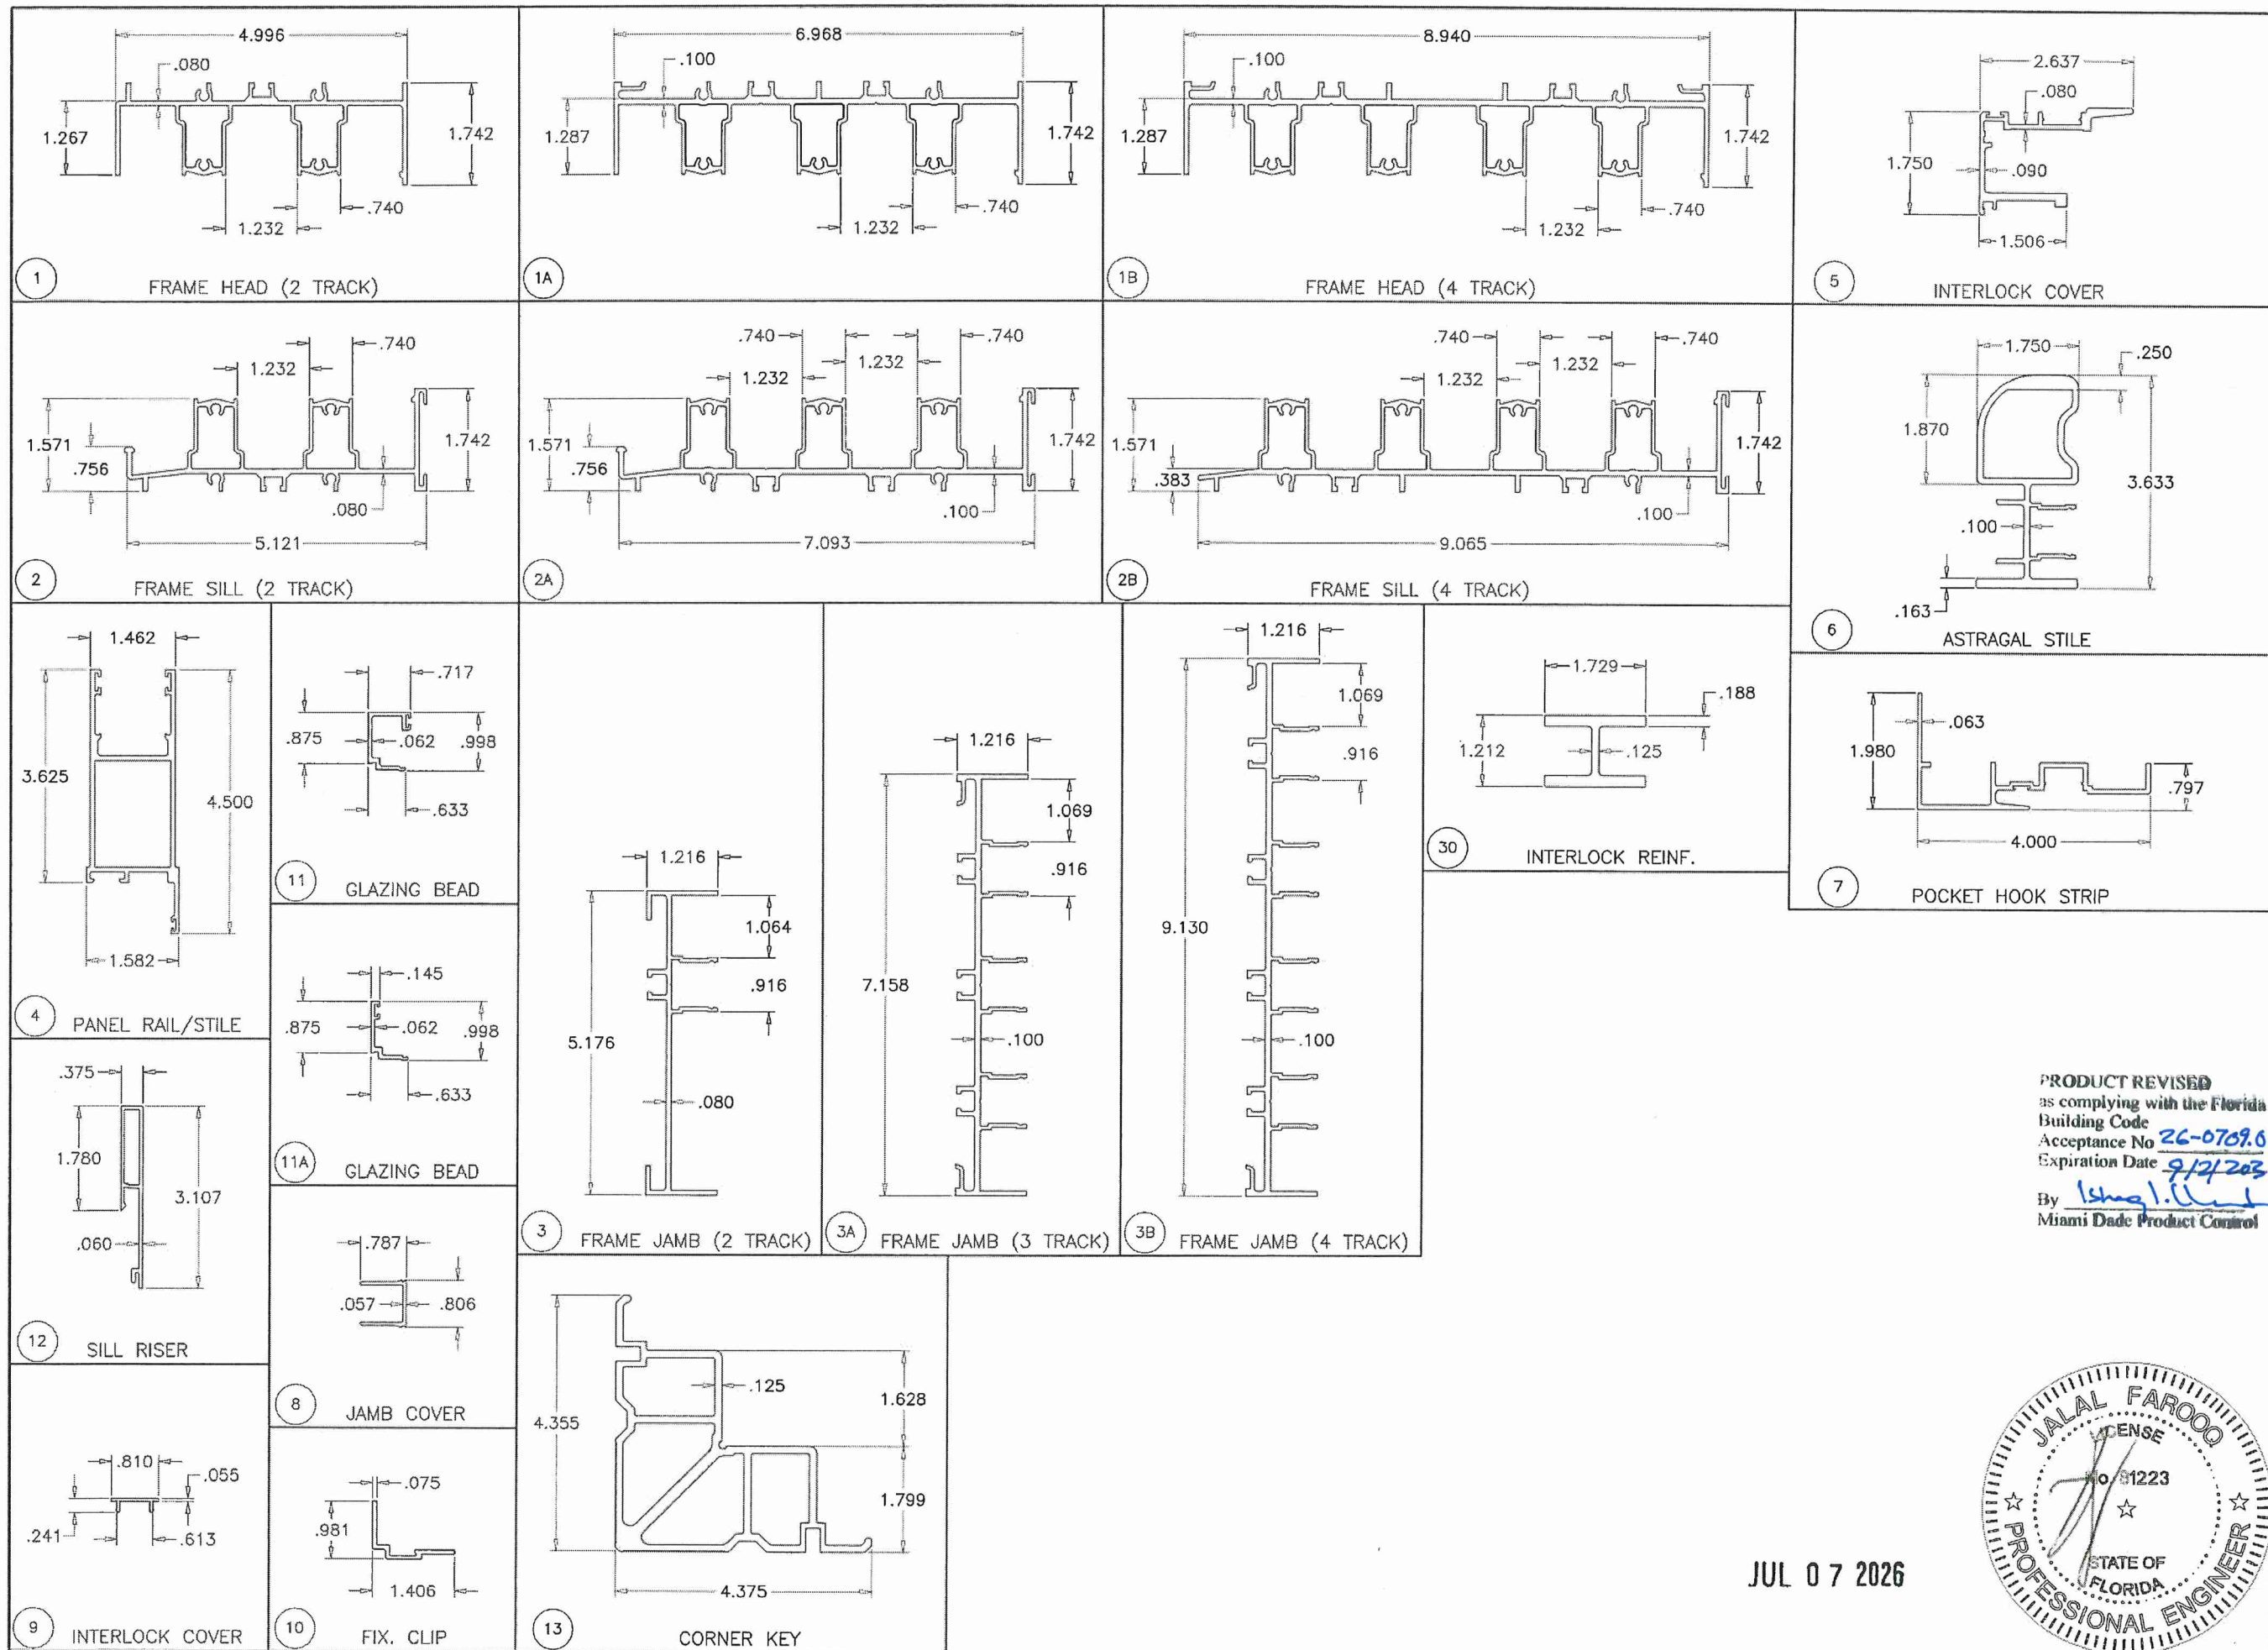

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 26-0709.08
Expiration Date 9/2/2023
By Ishag I. Alshag
Miami Dade Product Control

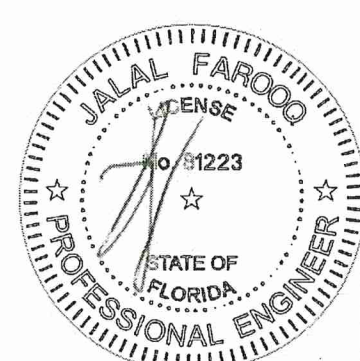

JUL 07 2026

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL (305) 262-6978 FAX (305) 264-8100
COMP-ANL 19-115D-W

S-3000 ALUM SLIDING GLASS DOOR (L.M.I.)

Labrador & Fundora Corp.
dba-V & V Windows
14150 N.W. 56th Court, Suite 600
Opa-Locka, FL 33054
Tel. (305) 888-4151
www.vvwindows.com

no	date	by	description
A	08.13.21		NO CHANGE THIS SHEET
B	06.07.23		UPDATED TO 2023 FBC
C	02.23.24		GENERAL REVISION
D	06.23.26		NO CHANGE THIS SHEET

date: 10-25-19
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:

drawing no.
19-115D
sheet 25 of 28

ITEM #	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	E-3003	1	FRAME HEAD (2 TRACK)	6063-T6	-
1A	VV3028	1	FRAME HEAD (3 TRACK)	6063-T6	-
1B	VV3029	1	FRAME HEAD (4 TRACK)	6063-T6	-
2	E-3002	1	FRAME SILL (2 TRACK)	6063-T6	-
2A	VV3030	1	FRAME SILL (3 TRACK)	6063-T6	-
2B	VV3031	1	FRAME SILL (4 TRACK)	6063-T6	-
3	E-3005	2	FRAME JAMB (2 TRACK)	6063-T6	-
3A	VV3032	2	FRAME JAMB (3 TRACK)	6063-T6	-
3B	VV3033	2	FRAME JAMB (4 TRACK)	6063-T6	-
4	E-3010	4/	PANEL RAIL/STILE	6063-T6	-
5	E-3012	AS REQD.	INTERLOCK COVER	6063-T6	-
6	E-3014	AS REQD.	ASTRAGAL STILE	6063-T6	-
7	E-3027	AS REQD.	POCKET HOOK STRIP	6063-T6	-
8	E-3015	AS REQD.	JAMB COVER	6063-T6	-
9	E-3013	AS REQD.	INTERLOCK COVER	6063-T6	-
10	E-3023	3/	PANEL FIX. PANEL CLIP, 2" LONG, AT 3" FROM ENDS & 16" O.C.	6063-T6	-
11	E-3021	AS REQD.	GLAZING BEAD (LAM. GLASS)	6063-T5	-
11A	E-3022	AS REQD.	GLAZING BEAD (INSUL. LAM. GLASS)	6063-T5	-
12	E-3026	AS REQD.	SILL RISER	6063-T6	-
13	E-3018	4/	PANEL CORNER KEY	6063-T6	-
14	W31256NKO00B	AS REQD.	FIN PILE W'STRIPPING (.310"W X .250"H)	WOOL	ULTRAFAB
16	-	2/	LITE SETTING BLOCK	EPDM	DUROMETER 80±5 SHORE A
17	#10 X 1-1/2"	AS REQD.	FRAME ASSEMBLY FASTENERS	ST. STEEL	PH SMS
18	#10 X 1/2"	AS REQD.	INTERLOCK FASTENERS AT 6" FROM EACH END & 18" O.C.	ST. STEEL	PH SMS
19	#12 X 2"	AS REQD.	ASTRAGAL FASTENERS AT 6" FROM ENDS & 24" O.C. *	ST. STEEL	PH SMS
20	#12 X 5/8"	1/	CLIP FIX. CLIP FASTENERS	ST. STEEL	PH SMS
21	RU-098ZR-INOX	2/	MOV. PANEL TANDEM WHEEL ROLLER ASSEMBLY	ZAMAK	IDH
21A	#10 X 1/2"	1/	ASSY. FIX. CLIP FASTENERS	ST. STEEL	PH SMS
22	-	1/	MOV. PANEL DOOR LOCK	-	INTERLOCK
23	-	AS REQD.	EXTERIOR BULB GASKET	EPDM	DUROMETER 75±5 SHORE A
24	-	AS REQD.	BUMP ON SPACER	SILICONE	-
26	KT0207-1	2	WIND BREAKER	EPDM	-
27	KT0207-2	AS REQD.	PANEL END COVER	NYLON	-
28	KT0207-3	AS REQD.	GUIDE STOP	NYLON	-
29	KT0207-10	2	FRAME END COVER	EPDM	-
30	VV3034	AS REQD.	INTERLOCK REINFORCEMENT	6063-T6	-

* AVG. SPACING

SEALANT:

ALL JOINTS AND FRAME CONNECTIONS SEALED WITH WHITE/ALUMINUM COLORED SILICONE.


LOCKS:

SURFACE MOUNT METALLIC MORTISE LOCK
AT 39-1/2" FROM BOTTOM
FASTENED TO LOCK STILE WITH
(2) #8 X 1/2" PH SELF DRILLING SCREWS

SURFACE MOUNT METALLIC HANDLE AT 39-1/2" FROM BOTTOM
FASTENED TO LOCK STILE WITH
(2) 10-32 X 1-1/2" FH MS

SURFACE MOUNT METALLIC KEEPER FACING LOCK AT 39 1/2" FROM BOTTOM
FASTENED WITH
(2) #10 X 3/4" FH SELF DRILLING SCREWS

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 26-0709-08
Expiration Date 9/2/2031
By Istvan I. Chiriac
Miami Dade Product Control

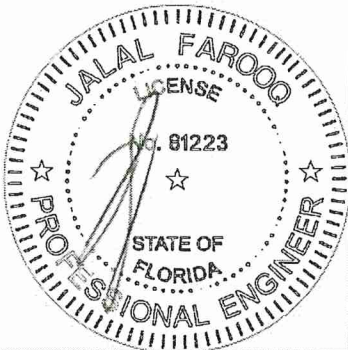

JUL 07 2026

afC

AL-FAROOQ CORPORATION

ENGINEERS & PRODUCT DEVELOPMENT

9360 SUNSET DRIVE, SUITE 220

MIAMI, FLORIDA 33173

TEL: (305) 262-6978

FAX: (305) 262-6978

COMP-ANL\19-115D-W

S-3000 ALUM SLIDING GLASS DOOR (L.M.I.)

Labrador & Fundora Corp.

dba-V & V Windows

14150 N.W. 56th Court, Suite 600

Opa-Locka, FL 33054

Tel: (305) 888-4151

www.vvwindows.com

revisions:

no	date	by	description
A	08.13.21		NO CHANGE THIS SHEET
B	06.07.23		UPDATED TO 2023 FBC
C	02.23.24		GENERAL REVISION
D	06.23.26		NO CHANGE THIS SHEET

date: 10-25-19

scale: 3/8" = 1"



dr. by: TARIQ

chk. by:


drawing no.

19-115D


sheet 26 of 28

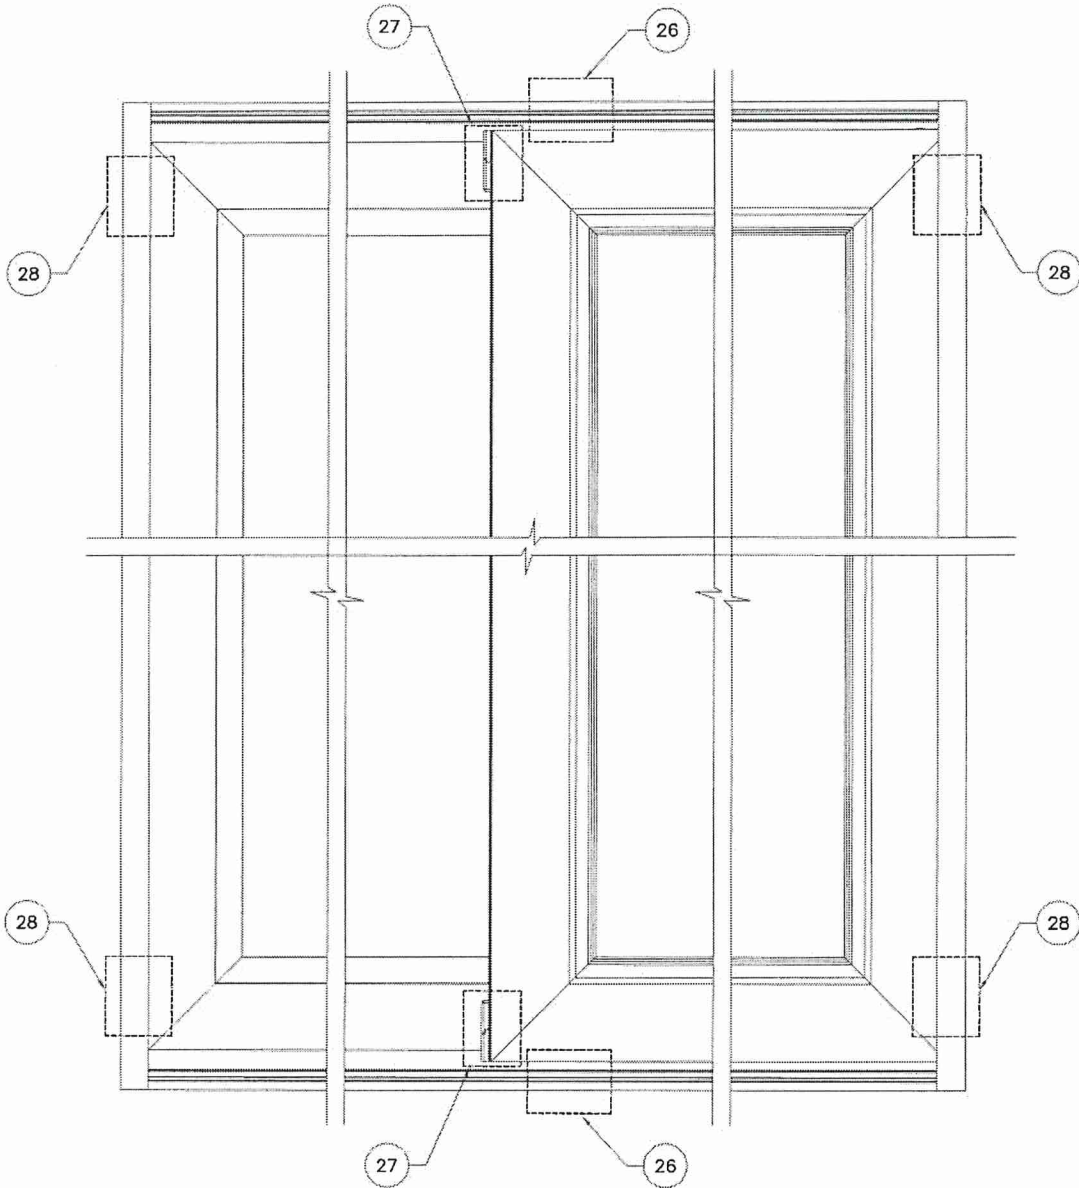


26 WIND BREAKER







27 PANEL END COVER




28 GUIDE STOP




29 FRAME END COVER

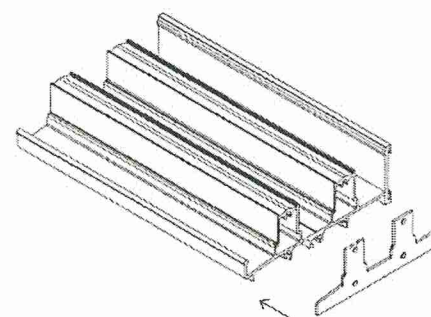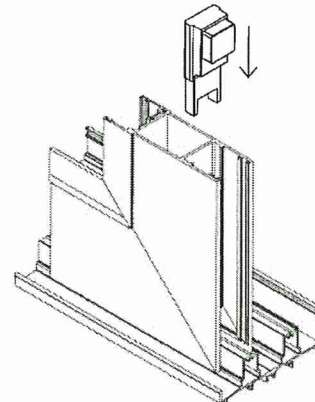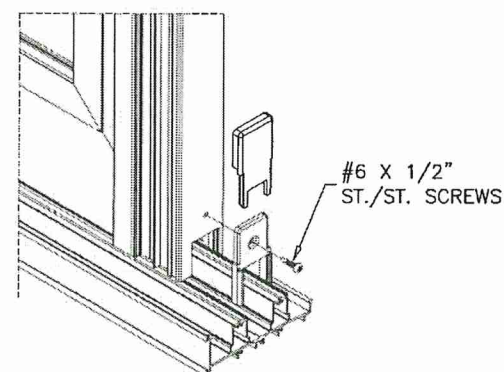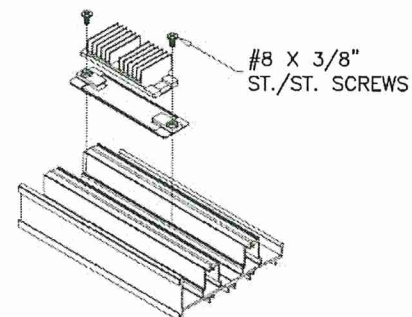

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 26-6709-08
Expiration Date 9/21/2031
By Ishay I. Linder
Miami Dade Product Control

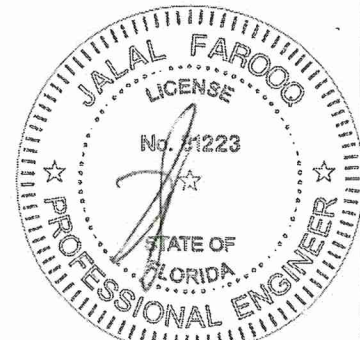

JUL 07 2026






AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\19-115D-W


S-3000 ALUM SLIDING GLASS DOOR (L.M.I.)
Labrador & Fundora Corp.
dba-V & V Windows
14150 N.W. 56th Court, Suite 600
Opa-Locka, FL 33054
Tel. (305) 888-4151
www.vvwindows.com

revisions:	no.	date	by	description
	A	08.13.21		NO CHANGE THIS SHEET
	B	06.07.23		UPDATED TO 2023 FBC
	C	02.23.24		GENERAL REVISION
	D	06.23.26		NO CHANGE THIS SHEET

date:	10-25-19	scale:	3/8" = 1"	dr. by:	TARIQ	chk. by:	
drawing no.	19-115D	sheet	27 of 28				

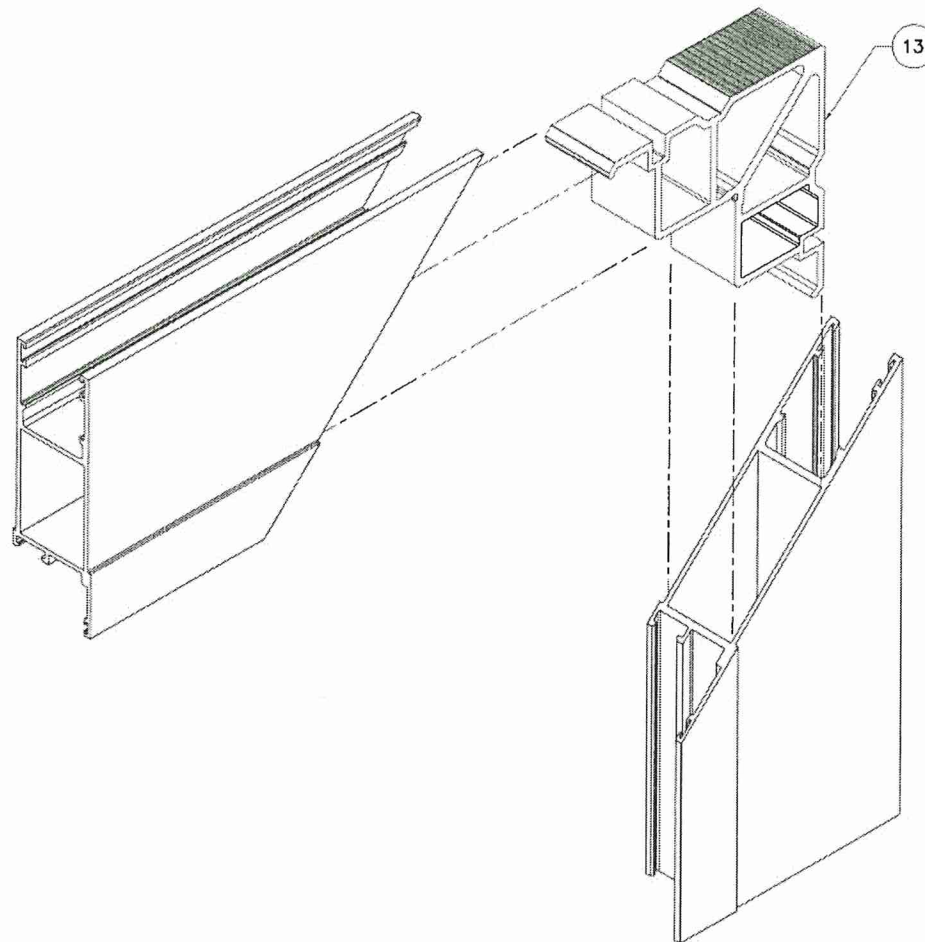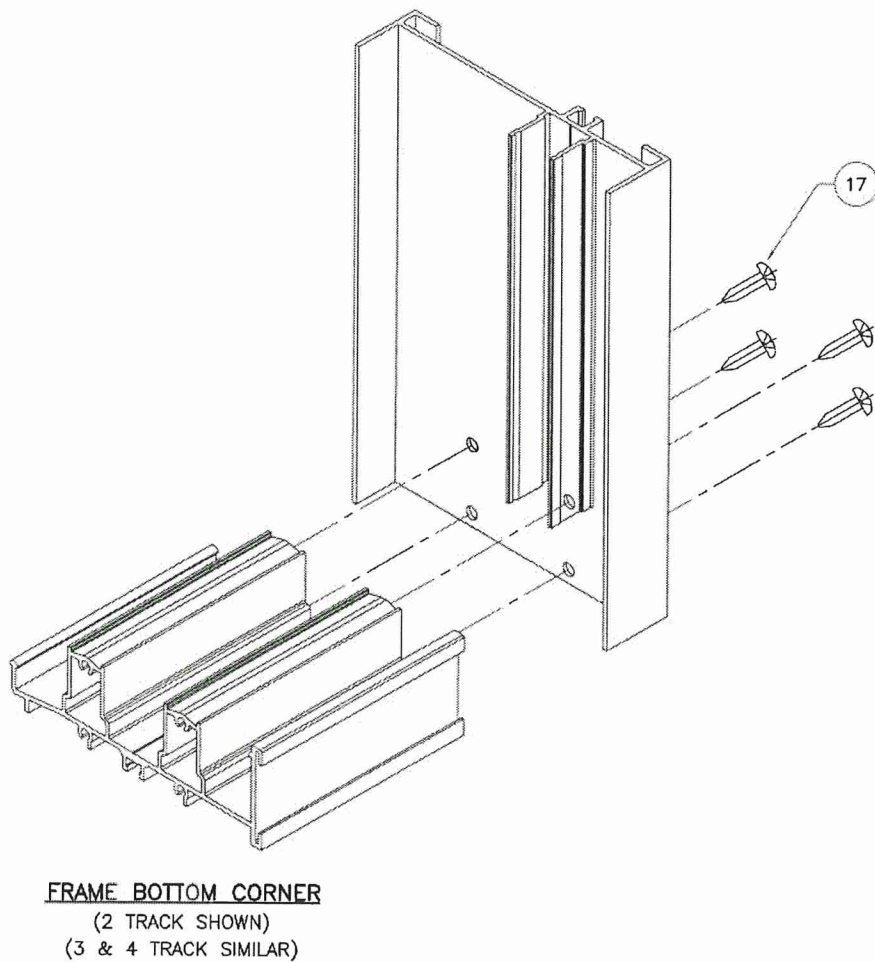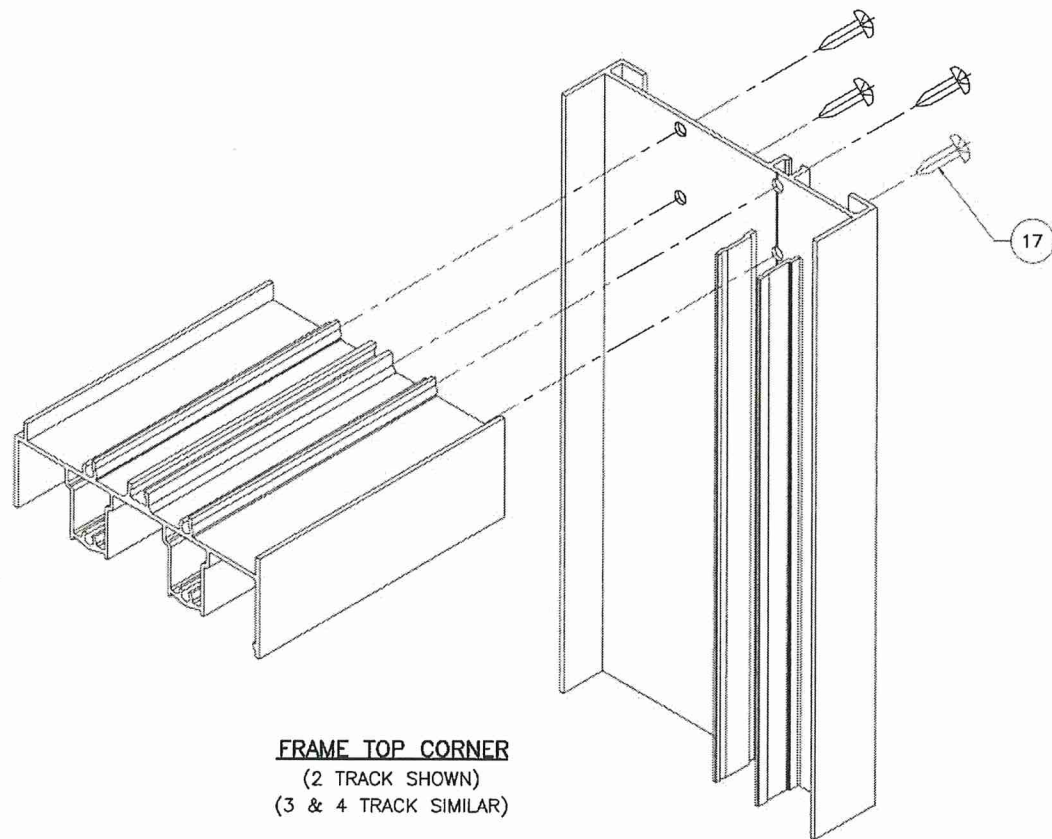

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 26-0709.08
Expiration Date 9/2/2031
By Ishaghi, H.
Miami Dade Product Control

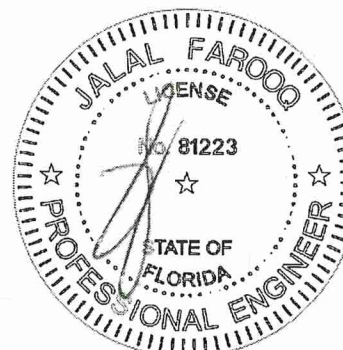

JUL 07 2026

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

COMP-ANL 19-115D-W

S-3000 ALUM SLIDING GLASS DOOR (L.M.I.)

Labrador & Fundora Corp.
dba-V & V Windows
14150 N.W. 56th Court, Suite 600
Opa-Locka, FL 33054
Tel. (305) 888-4151
www.vvwindows.com

revisions:

no	date	by	description
A	08.13.21		NO CHANGE THIS SHEET
B	06.07.23		UPDATED TO 2023 FBC
C	02.23.24		GENERAL REVISION
D	06.23.26		NO CHANGE THIS SHEET

date: 10-25-19
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:

drawing no.
19-115D
sheet 28 of 28