



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

E.S. Windows, LLC
3550 NW 49th Street
Miami, FL 33142

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/ or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "1000/1050" Aluminum Single Hung Window – L.M.I.

APPROVAL DOCUMENT: Drawing No. **W03-56 Rev P**, titled "Series-1000/1050 Alum. Single Hung Wdw. (L.M.I)", sheets 1, 1.1, 2, 2.1 and 3 through 8 of 8, dated 07/31/03 and last revised on JUL 09, 2026, prepared by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, **Barranquilla, Colombia**, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/ or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA No. **25-0728.07** and consists of this page 1 and evidence pages E-1, E-2, E-3, E-4, E-5 and E-6, as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P.E.**



NOA No. 26-0715.05
Expiration Date: November 06, 2028
Approval Date: August 13, 2026
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's

A. DRAWINGS

1. Manufacturer's die drawings and sections.
(Submitted under NOA No. 03-0910.03)
2. Drawing No. **W03-56**, titled "Series-1000/1050 Alum. Single Hung Wdw. (L.M.I)", sheets 1, 1.1, 2, 2.1 and 3 through 8 of 8, dated 07/31/03, with revision **N**, dated 07/06/23, prepared by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.
(Submitted under NOA No. 23-0714.14)

B. TESTS

1. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of an aluminum single hung window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-12222**, dated 07/10/20, signed and sealed by Idalmis Ortega, P.E.
(Submitted under NOA No. 20-0915.01)
2. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per ASTM F 588-04/ 07 and per FBC 2411 3.2.1, TAS 202-94
along with marked-up drawings and installation diagram of an aluminum single hung window, prepared by Fenestration Testing Laboratory, Inc., Test Reports No. **FTL-5815** and **FTL-5337**, dated 02/13/09 and 01/25/08 respectively, both signed and sealed by Michael R. Wenzel, P.E.
(Submitted under NOA's No. 09-1008.05 and 07-0928.14)



Ishaq I. Chanda, P.E.

Product Control Unit Supervisor

NOA No. 26-0715.05

Expiration Date: November 06, 2028

Approval Date: August 13, 2026

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's (CONTINUED)

B. TESTS (CONTINUED)

3. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per ASTM F 588-04/ 07 and per FBC 2411 3.2.1, TAS 202-94

along with marked-up drawings and installation diagram of an aluminum single hung window, prepared by Hurricane Engineering & Testing, Inc., Test Reports No.

HETI-05-1448 and **HETI-05-1953**, dated 04/22/05 and 04/25/05 respectively, both signed and sealed by Ivonne Ghia, P.E.

(Submitted under NOA No. 05-0720.01)

4. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per ASTM F 588-04/ 07 and per FBC 2411 3.2.1, TAS 202-94

along with marked-up drawings and installation diagram of an aluminum single hung window, prepared by Fenestration Testing Laboratory, Inc., Test Reports No. **FTL-3820** and **FTL-3806**, dated 06/09/03, signed and sealed by Joseph C. Chan, P.E.

(Submitted under NOA No. 03-0910.03)

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC 7th Edition (2020), prepared by Al-Farooq Corporation, dated 07/24/20, signed and sealed by Jalal Farooq, P.E.
(Submitted under NOA No. 20-0915.01)
2. Glazing complies with **ASTM E1300-09**

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER).



Ishaq I. Chanda, P.E.

Product Control Unit Supervisor

NOA No. 26-0715.05

Expiration Date: November 06, 2028

Approval Date: August 13, 2026

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's (CONTINUED)

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **22-1116.01** issued to **Kuraray America, Inc.** for their "SentryGlas® (Clear and White) Glass Interlayers" dated 12/15/22, expiring on 07/04/28.
2. Notice of Acceptance No. **20-0915.22** issued to **Kuraray America, Inc.** for their "Trosifol® Ultraclear, Clear and Color PVB Glass Interlayers" dated 11/19/20, expiring on 07/08/24.

F. STATEMENTS

1. Statement letter of conformance, complying with **FBC 7th Edition (2020)**, with **FBC 8th Edition (2023)**, and of no financial interest, dated July 12, 2023, issued by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.
(Submitted under NOA No. 23-0714.14)
2. Laboratory compliance letter for Test Reports No. **FTL-5815** and **FTL-5337**, issued by Fenestration Testing Laboratory, Inc., dated 02/13/09 and 01/25/08 respectively, both signed and sealed by Michael R. Wenzel, P.E.
(Submitted under NOA's No. 09-1008.05 and 07-0928.14)
3. Distributor Agreement, dated 04/04/16, signed by Carlos Garcia and by Andres Chamorro.
(Submitted under NOA No. 17-1114.09)
4. Laboratory compliance letter for Test Reports No. **HETI-05-1448** & **HETI-05-1953**, issued by Hurricane Engineering & Testing, Inc., dated 04/22/05 and 04/25/05 respectively, both signed and sealed by Ivonne Ghia, P.E.
(Submitted under NOA No. 05-0720.01)
5. Laboratory compliance letter for Test Reports No. **FTL-3820** and **FTL-3806**, issued by Fenestration Testing Laboratory, Inc., dated 06/09/03, both signed and sealed by Joseph C. Chan, P.E.
(Submitted under NOA No. 03-0910.03)

G. OTHERS

1. Notice of Acceptance No. **20-0915.01**, issued to E.S. Windows, LLC, for their Series "1000/1050" Aluminum Single Hung Window - L.M.I., approved on 12/17/20 and expiring on 11/06/23.



Ishaq I. Chanda, P.E.
Product Control Unit Supervisor
NOA No. 26-0715.05
Expiration Date: November 06, 2028
Approval Date: August 13, 2026

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

2. NEW EVIDENCE SUBMITTED

A. DRAWINGS

1. Drawing No. **W03-56**, titled "Series-1000/1050 Alum. Single Hung Wdw. (L.M.I)", sheets 1, 1.1, 2, 2.1 and 3 through 8 of 8, dated 07/31/03, with revision **O**, dated 08/09/24, prepared by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.

B. TESTS

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Small Missile Impact Test per FBC, TAS 201-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of aluminum single hung windows, prepared by IFET, Inc. Test Report No. **TR-IFET-23-0036.1** dated 06/12/25, signed and sealed by Arshad Viqar, P.E.

C. CALCULATIONS


1. Anchor verification calculations and structural analysis, complying with FBC 8th Edition (2023), dated 06/27/25, prepared by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **23-0717.30** issued to **Kuraray America, Inc.** for their "**SentryGlas® (Clear and White) Glass Interlayers**" dated 08/31/23, expiring on 07/04/28.
2. Notice of Acceptance No. **24-0205.08** issued to **Kuraray America, Inc.** for their "**Trosifol® Ultraclear, Clear and Color PVB Glass Interlayers**" dated 03/21/24, expiring on 07/08/29.
3. Notice of Acceptance No. **23-0713.13** issued to **Chang Chun Chemical Corporation** for their "**WINLITE® PVB Film Glass Interlayer**" dated 08/17/23, expiring on 10/08/25.



Ishaq I. Chanda, P.E.

Product Control Unit Supervisor

NOA No. 26-0715.05

Expiration Date: November 06, 2028

Approval Date: August 13, 2026

E.S. Windows, LLC

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

2. NEW EVIDENCE SUBMITTED (CONTINUED)

F. STATEMENTS

1. Statement letter of conformance, complying with **FBC 8th Edition (2023)**, and of no financial interest, dated June 27, 2025, issued by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.

G. OTHERS

1. Notice of Acceptance No. **23-0714.14**, issued to E.S. Windows, LLC, for their Series "1000/1050" Aluminum Single Hung Window - L.M.I., approved on 08/24/23 and expiring on 11/06/28.



Ishaq I. Chanda, P.E.

Product Control Unit Supervisor

NOA No. 26-0715.05

Expiration Date: November 06, 2028

Approval Date: August 13, 2026

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

3. NEW EVIDENCE SUBMITTED

A. DRAWINGS

1. Drawing No. **W03-56 Rev P**, titled "Series-1000/1050 Alum. Single Hung Wdw. (L.M.I)", sheets 1, 1.1, 2, 2.1 and 3 through 8 of 8, dated 07/31/03 and last revised on JUL 09, 2026, prepared by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.

B. TESTS (submitted under previous approval)

1. None

C. CALCULATIONS (submitted under previous approval)

1. None

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **23-0717.30** issued to **Kuraray America, Inc.** for their "**SentryGlas® (Clear and White) Glass Interlayers**", expiring on 07/04/28.
2. Notice of Acceptance No. **24-0205.08** issued to **Kuraray America, Inc.** for their "**Trosifol® Ultraclear, Clear and Color PVB Glass Interlayers**", expiring on 07/08/29.
3. Notice of Acceptance No. **23-0713.13** issued to **Chang Chun Chemical Corporation** for their "**WINLITE® PVB Film Glass Interlayer**", expiring on 10/08/25.

F. STATEMENTS

1. Statement letter of conformance, complying with **FBC 9th Edition (2026)** and **FBC 8th Edition (2023)**, and of no financial interest, dated July 09, 2026, issued by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.

G. OTHERS

1. *This NOA revises NOA No. 25-0728.07, updates to FBC 2026, expiring on 11/06/28.*



Ishaq I. Chanda, P.E.

Product Control Unit Supervisor

NOA No. 26-0715.05

Expiration Date: November 06, 2028

Approval Date: August 13, 2026

The following pages in this document were submitted by the manufacturer (third party) to represent the product being approved and establish the limits of use. The pages may include technical drawings, schematics and installation details.

SERIES-1000/1050 ALUMINUM SINGLE HUNG WINDOW

DESIGN LOAD RATINGS FOR THESE WINDOWS TO BE AS PER CHARTS SHOWN ON SHEETS 2 & 2.1.

APPROVAL APPLIES TO SINGLE UNITS OR SIDE BY SIDE COMBINATIONS OF S.H./S.H. OR SINGLE HUNG WITH OTHER WINDOW TYPES IN MODULES OF TWO OR MORE WINDOWS USING MIAMI-DADE COUNTY APPROVED MULLIONS IN BETWEEN. LOWER DESIGN PRESSURE FROM WINDOWS OR MULLION APPROVAL WILL APPLY TO ENTIRE SYSTEM.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE 2023 (8TH EDITION)/2026 (9TH EDITION) FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

1BY OR 2BY WOOD BUCKS & BUCK FASTENERS BY OTHERS, MUST BE DESIGNED AND INSTALLED ADEQUATELY TO TRANSFER APPLIED PRODUCT LOADS TO THE BUILDING STRUCTURE.

ANCHORS TO BE SPACED AS SHOWN ON DETAILS AND INSTALLED PER MANUF'S INSTRUCTIONS. SPECIFIED EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.


ALL SHIMS TO BE LOAD-BEARING, (HIGH DENSITY PLASTIC/COMPOSITE, METAL OR OTHER RIGID MATERIALS).

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE 2023/2026 FLORIDA BLDG. CODE & ADOPTED STANDARDS.

THIS PRODUCT APPROVAL IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT, i.e. LIFE SAFETY OF THIS PRODUCT, ADEQUACY OF STRUCTURE RECEIVING THIS PRODUCT AND SEALING AROUND OPENING FOR WATER INFILTRATION RESISTANCE ETC.


CONDITIONS NOT SHOWN IN THIS DRAWING ARE TO BE ANALYZED SEPARATELY, AND TO BE REVIEWED BY BUILDING OFFICIAL.

DESIGN LOADS SHOWN ARE BASED ON 'ALLOWABLE STRESS DESIGN (ASD)'.

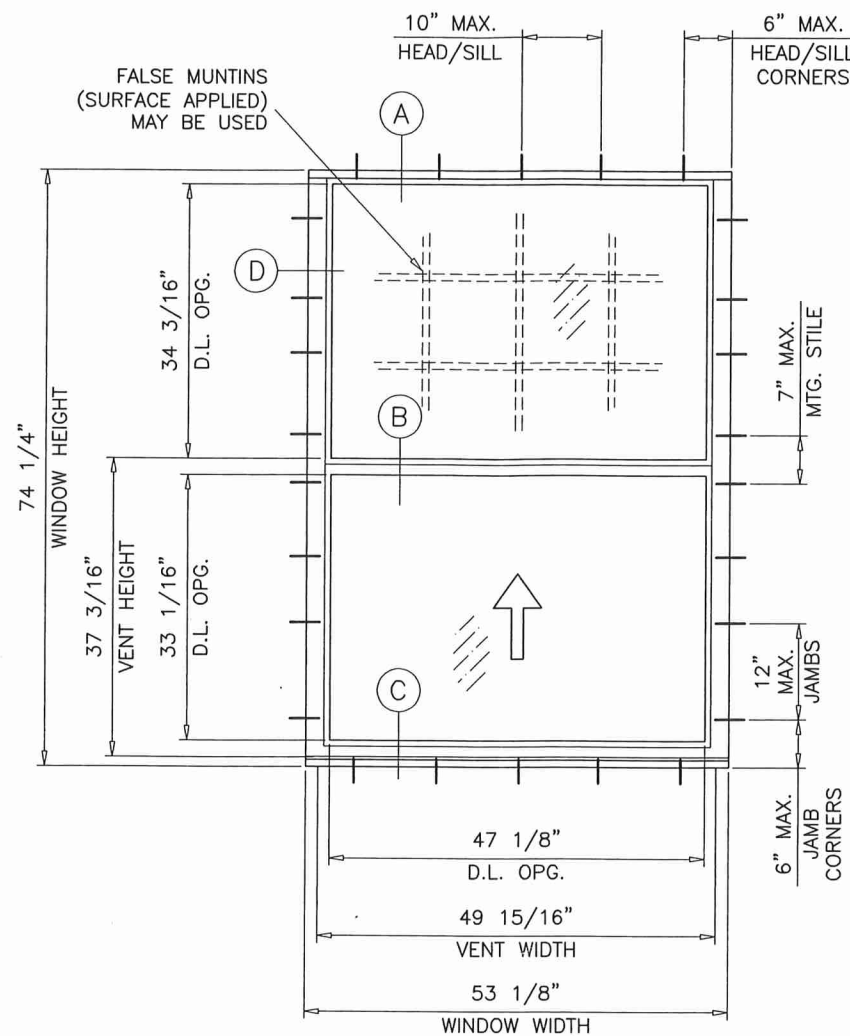

TYPICAL ELEVATION

SERIES 1000 (STD. SILL)

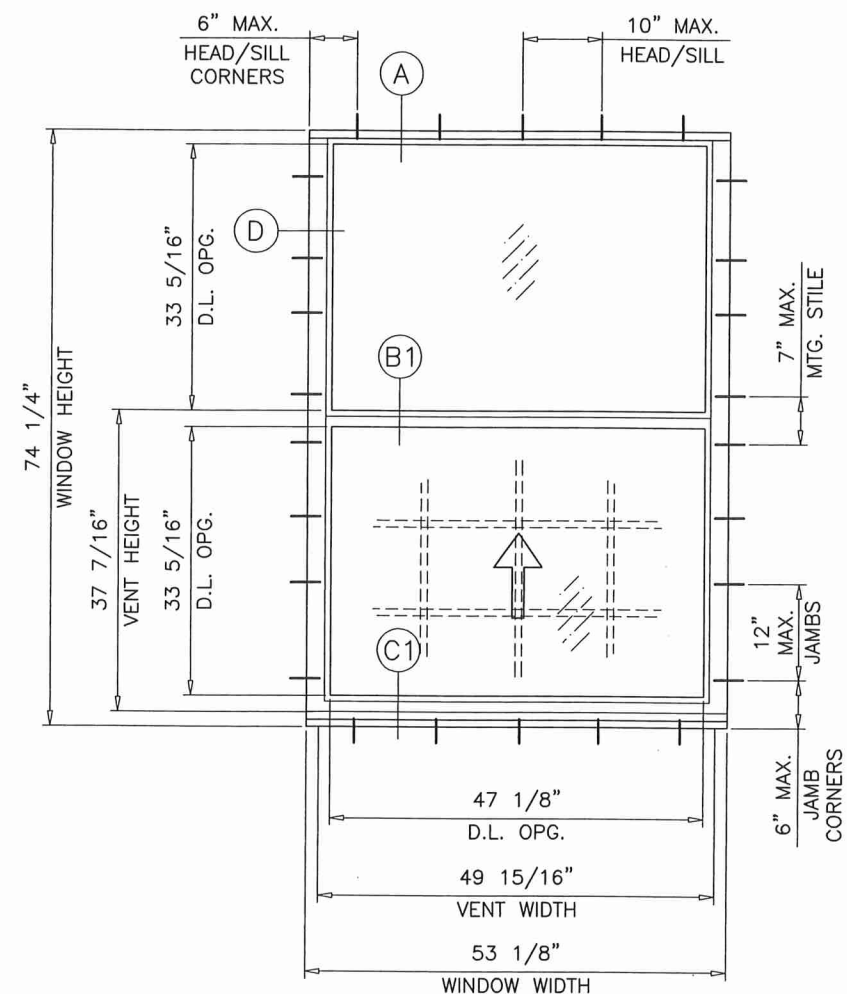


TYPICAL ELEVATION

SERIES 1000 (HI-RISE SILL)

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 26-0715-05
Expiration Date 11/6/2028
By J. L. L...
Miami Dade Product Control

FASTENERS AND CONNECTORS (AS APPLICABLE) SHOWN IN THIS APPROVAL MAY NOT MEET CORROSION RESISTANCE REQUIREMENTS FOR COASTAL OR SALT WATER EXPOSURE ZONES. COMPLIANCE WITH THESE CONDITIONS TO BE CHECKED PER FBC 1711.

THESE WINDOWS ARE RATED FOR LARGE & SMALL MISSILE IMPACT. SHUTTERS ARE NOT REQUIRED.

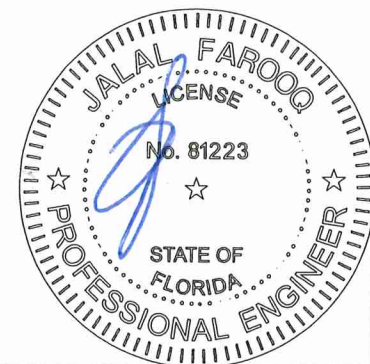

JUL 09 2026

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
(C.A.N. 3538)

SERIES-1000/1050 ALUM SINGLE HUNG WDW. (L.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158






no	date	by	description
M	07.17.20		GENERAL REVISION
N	07.06.23		UPDATED TO 2023 FBC
O	08.09.24		WINLITE INTERLAYER ADDED
P	07.02.26		UPDATED TO 2026 FBC

date:	07-31-03
scale:	1/2"=1'-0"
dr. by:	TARIG
chk. by:	


drawing no.

W03-56

sheet 1 of 8

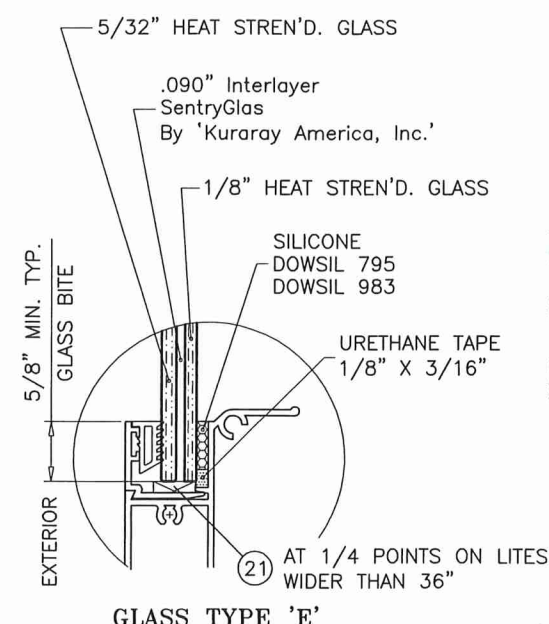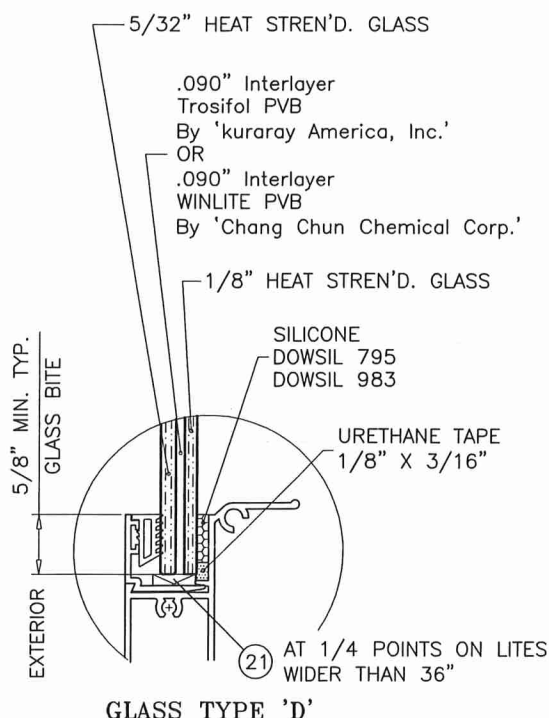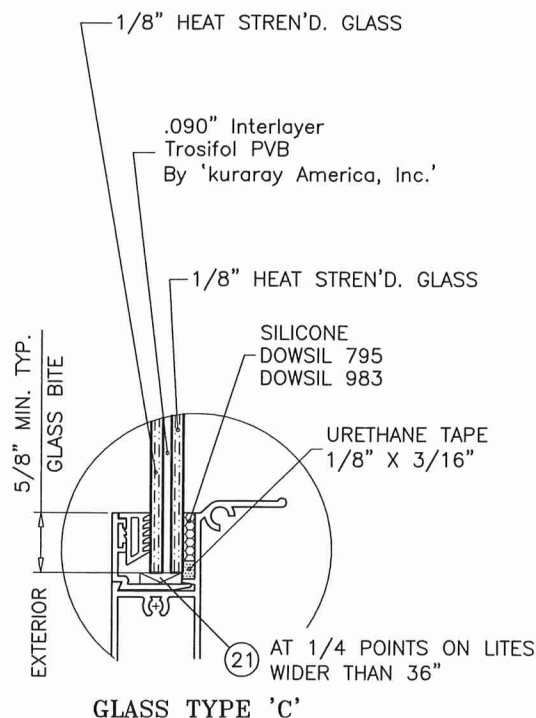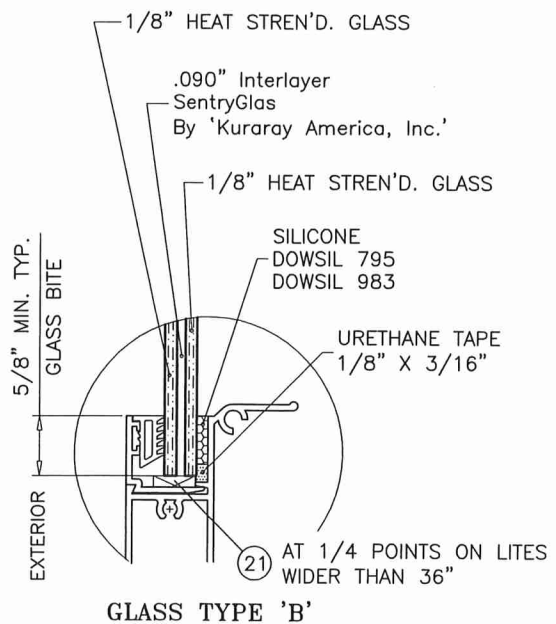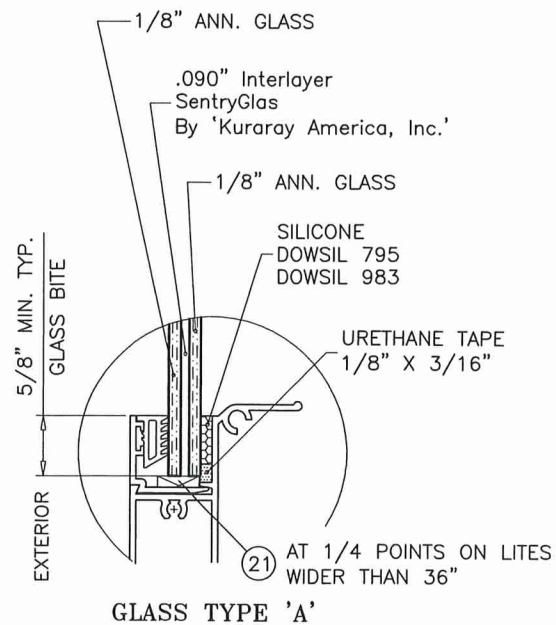


GLAZING OPTIONS

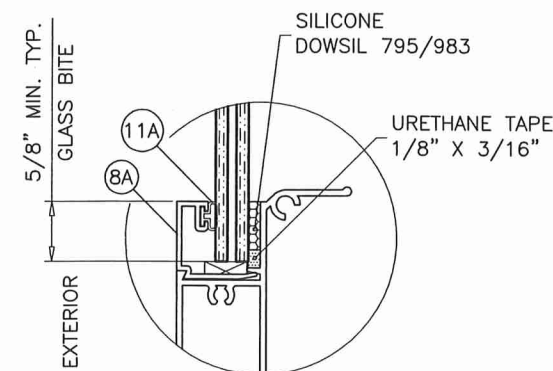

ALT. GLAZING OPTION

SQUARE GLAZING STOP CAN BE USED
WITH ALL GLASS TYPES SHOWN ON
THIS SHEET.

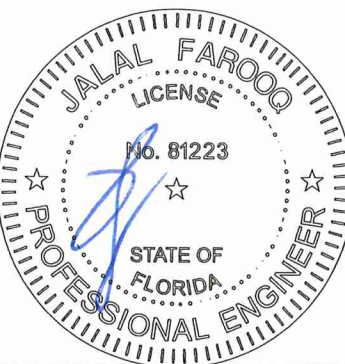

JUL 09 2026

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 262-6978
FAX. (305) 262-6978
COMP-ANL\W03-56ESW




SERIES-1000/1050 ALUM SINGLE HUNG WDW. (L.M.I.)
E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:		no	date	by	description
	M	07.17.20			GENERAL REVISION
	N	07.06.23			NO CHANGE THIS SHEET
	O	08.09.24			WINLITE INTERLAYER ADDED
	P	07.02.26			NO CHANGE THIS SHEET
date:	07-31-03	scale:	1/2"=1'-0"	dr. by:	TARIQ
chk. by:					
drawing no.	W03-56	sheet	1,1 of 8		


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 26-0715-05
Expiration Date 11/6/2028
By Jalal Farooq
Miami Dade Product Council

EQUAL LITES WINDOWS DESIGN LOAD CAPACITY - PSF (HI-RISE SILL)							
WINDOW DIMS.		STANDARD TOP RAIL				HEAVY DUTY TOP RAIL	
		GLASS TYPE 'A'		GLASS TYPES 'B', 'C', 'D' & 'E'		GLASS TYPES 'B', 'C', 'D' & 'E'	
		EXT.(+)	1NT.(-)	EXT.(+)	1NT.(-)	EXT.(+)	1NT.(-)
19-1/8"	26" (3)	70.0	80.0	80.0	90.0	80.0	90.0
26-1/2"		70.0	80.0	80.0	90.0	80.0	90.0
37"		70.0	80.0	80.0	90.0	80.0	90.0
42"		70.0	80.0	80.0	90.0	80.0	90.0
49"		70.0	80.0	80.0	90.0	80.0	90.0
53-1/8"		70.0	80.0	80.0	90.0	80.0	90.0
19-1/8"	38-3/8" (4)	70.0	80.0	80.0	90.0	80.0	90.0
26-1/2"		70.0	80.0	80.0	90.0	80.0	90.0
37"		70.0	80.0	80.0	90.0	80.0	90.0
42"		70.0	80.0	80.0	90.0	80.0	90.0
49"		70.0	80.0	80.0	90.0	80.0	90.0
53-1/8"		70.0	80.0	80.0	90.0	80.0	90.0
19-1/8"	50-5/8" (5)	70.0	80.0	80.0	90.0	80.0	90.0
26-1/2"		70.0	80.0	80.0	90.0	80.0	90.0
37"		70.0	80.0	80.0	90.0	80.0	90.0
42"		70.0	80.0	80.0	90.0	80.0	90.0
49"		70.0	80.0	80.0	90.0	80.0	90.0
53-1/8"		70.0	80.0	80.0	90.0	80.0	90.0
19-1/8"	58" (5)	70.0	80.0	80.0	90.0	80.0	90.0
26-1/2"		70.0	80.0	80.0	90.0	80.0	90.0
37"		70.0	80.0	80.0	90.0	80.0	90.0
42"		70.0	80.0	80.0	90.0	80.0	90.0
49"		70.0	80.0	80.0	90.0	80.0	90.0
53-1/8"		70.0	80.0	80.0	90.0	80.0	90.0
19-1/8"	63" (6)	70.0	80.0	80.0	90.0	80.0	90.0
26-1/2"		70.0	80.0	80.0	90.0	80.0	90.0
37"		70.0	80.0	80.0	90.0	80.0	90.0
42"		70.0	80.0	80.0	90.0	80.0	90.0
49"		70.0	80.0	80.0	90.0	80.0	90.0
53-1/8"		70.0	80.0	80.0	90.0	80.0	90.0
19-1/8"	68" (6)	70.0	80.0	80.0	90.0	80.0	90.0
26-1/2"		70.0	80.0	80.0	90.0	80.0	90.0
37"		70.0	80.0	80.0	90.0	80.0	90.0
42"		70.0	80.0	80.0	90.0	80.0	90.0
49"		70.0	80.0	80.0	90.0	80.0	90.0
53-1/8"		-	-	-	-	80.0	90.0
19-1/8"	74-1/4" (7)	70.0	80.0	80.0	90.0	80.0	90.0
26-1/2"		70.0	80.0	80.0	90.0	80.0	90.0
37"		70.0	80.0	80.0	90.0	80.0	90.0
42"		70.0	80.0	80.0	90.0	80.0	90.0
49"		-	-	-	-	80.0	90.0
53-1/8"		-	-	-	-	80.0	90.0
19-1/8"	80" (7)	-	-	-	-	80.0	90.0
26-1/2"		-	-	-	-	80.0	90.0
37"		-	-	-	-	80.0	90.0
42"		-	-	-	-	80.0	90.0
49"		-	-	-	-	80.0	90.0


* NO. IN PARENTHESIS INDICATE NO. OF ANCHORS PER JAMB.
LIMIT EXTERIOR(+) LOADS TO 70.0 PSF FOR STD. SILL.

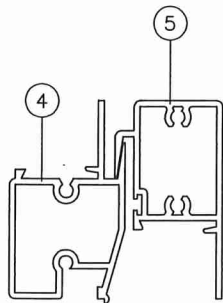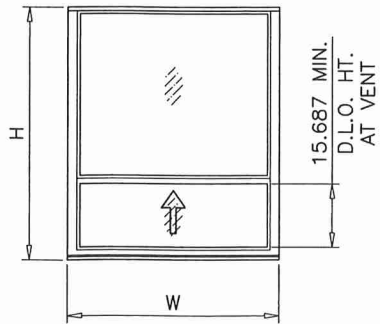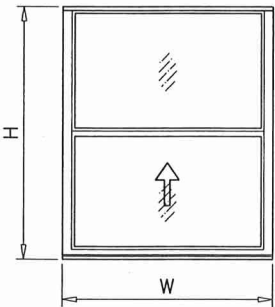


STD. TOP RAIL
S-1000

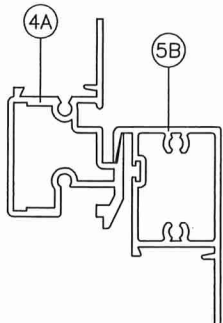

STD. TOP RAIL
S-1050

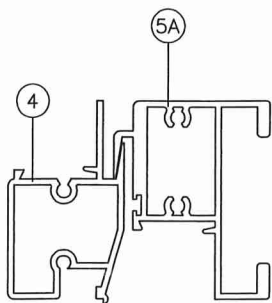

HEAVY DUTY TOP RAIL
S-1000

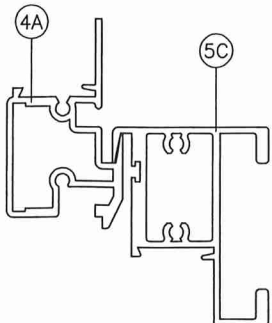


HEAVY DUTY TOP RAIL
S-1050

UNEQUAL LITES (ORIEL TYPES) WINDOWS DESIGN LOAD CAPACITY - PSF (HI-RISE SILL)							
WINDOW DIMS.		STANDARD TOP RAIL				HEAVY DUTY TOP RAIL	
		GLASS TYPE 'A'		GLASS TYPES 'B', 'C', 'D' & 'E'		GLASS TYPES 'B', 'C', 'D' & 'E'	
		EXT.(+)	1NT.(-)	EXT.(+)	1NT.(-)	EXT.(+)	1NT.(-)
19-1/8"	50-5/8" (5)	70.0	80.0	80.0	90.0	80.0	90.0
26-1/2"		70.0	80.0	80.0	90.0	80.0	90.0
37"		70.0	80.0	80.0	90.0	80.0	90.0
42"		70.0	80.0	80.0	90.0	80.0	90.0
49"		70.0	80.0	80.0	90.0	80.0	90.0
53-1/8"		70.0	74.0	80.0	90.0	80.0	90.0
19-1/8"	58" (5)	70.0	80.0	80.0	90.0	80.0	90.0
26-1/2"		70.0	80.0	80.0	90.0	80.0	90.0
37"		70.0	80.0	80.0	90.0	80.0	90.0
42"		70.0	80.0	80.0	90.0	80.0	90.0
49"		-	-	-	-	80.0	90.0
19-1/8"	63" (6)	70.0	80.0	80.0	90.0	80.0	90.0
26-1/2"		70.0	80.0	80.0	90.0	80.0	90.0
37"		70.0	80.0	80.0	90.0	80.0	90.0
42"	68" (6)	-	-	-	-	80.0	90.0
19-1/8"		70.0	80.0	80.0	90.0	80.0	90.0
26-1/2"	74-1/4" (7)	70.0	80.0	80.0	90.0	80.0	90.0
37"		70.0	80.0	80.0	90.0	80.0	90.0

* NO. IN PARENTHESIS INDICATE NO. OF ANCHORS PER JAMB.
LIMIT EXTERIOR(+) LOADS TO 70.0 PSF FOR STD. SILL.

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 26-0715.05
Expiration Date 11/6/2028
By *[Signature]*
Miami Dade Product Control

NOTE:
GLASS CAPACITIES ARE BASED ON
ASTM E1300-16 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

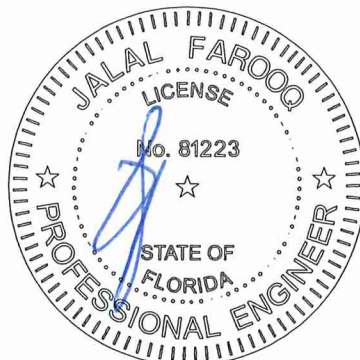

JUL 09 2026

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 262-6978
FAX. (305) 262-8100

COMP-ANL\W03-56SW

SERIES-1000/1050 ALUM SINGLE HUNG WDW. (L.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151
FAX. (305) 638-5158

revisions:	no	date	by	description
	M	07.17.20		GENERAL REVISION
	N	07.06.23		NO CHANGE THIS SHEET
	O	08.09.24		NO CHANGE THIS SHEET
	P	07.02.26		UPDATED TO 2026 FBC

date: 07-31-03

scale: 1/2" = 1"

dr. by: TARIQ

chk. by:




drawing no.
W03-56

sheet 2 of 8


EQUAL LITES WINDOWS
DESIGN LOAD CAPACITY - PSF
STD. & HI-RISE SILL

WINDOW DIMS.		STANDARD TOP RAIL	
		GLASS TYPE 'F'	
WIDTH	HEIGHT	EXT.(+)	1NT.(-)
19-1/8"	26" (3)	70.0	75.0
26-1/2"		70.0	75.0
37"		70.0	75.0
42"		70.0	75.0
49"		70.0	75.0
53-1/8"		70.0	75.0
19-1/8"	38-3/8" (4)	70.0	75.0
26-1/2"		70.0	75.0
37"		70.0	75.0
42"		70.0	75.0
49"		70.0	75.0
53-1/8"		70.0	75.0
19-1/8"	50-5/8" (5)	70.0	75.0
26-1/2"		70.0	75.0
37"		70.0	75.0
42"		70.0	75.0
49"		70.0	75.0
53-1/8"		70.0	75.0
19-1/8"	58" (5)	70.0	75.0
26-1/2"		70.0	75.0
37"		70.0	75.0
42"		70.0	75.0
49"		70.0	75.0
53-1/8"		70.0	75.0
19-1/8"	63" (6)	70.0	75.0
26-1/2"		70.0	75.0
37"		70.0	75.0
42"		70.0	75.0
49"		70.0	75.0
53-1/8"		70.0	75.0
19-1/8"	68" (6)	70.0	75.0
26-1/2"		70.0	75.0
37"		70.0	75.0
42"		70.0	75.0
49"		70.0	75.0
53-1/8"		70.0	75.0
19-1/8"	74-1/4" (7)	70.0	75.0
26-1/2"		70.0	75.0
37"		70.0	75.0
42"		70.0	75.0
49"		70.0	75.0
53-1/8"		70.0	75.0
19-1/8"	80" (7)	70.0	75.0
26-1/2"		70.0	75.0
37"		70.0	75.0
42"		70.0	75.0
49"		70.0	75.0


* NO. IN PARENTHESIS INDICATE NO. OF ANCHORS PER JAMB.

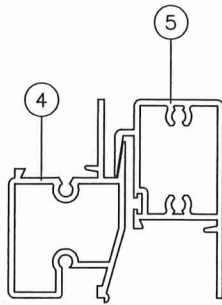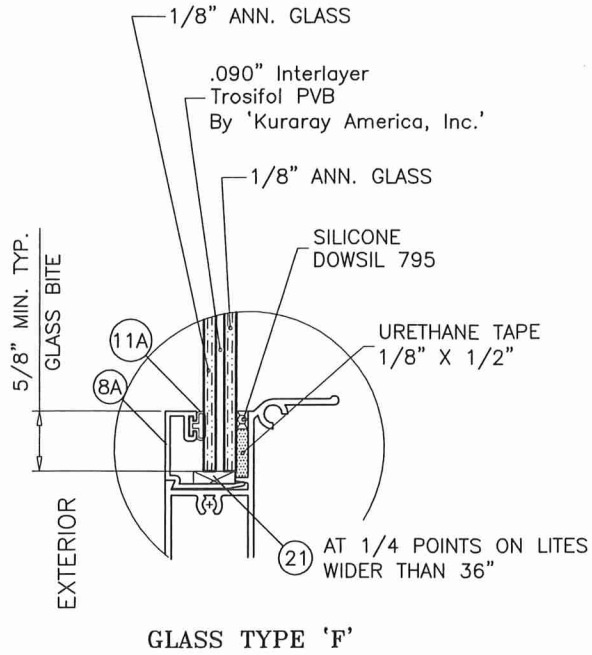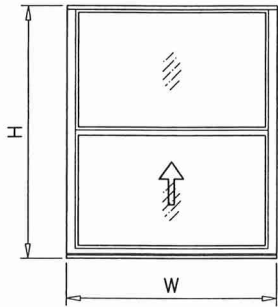

STD. TOP RAIL
S-1000

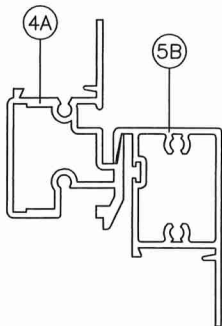

STD. TOP RAIL
S-1050

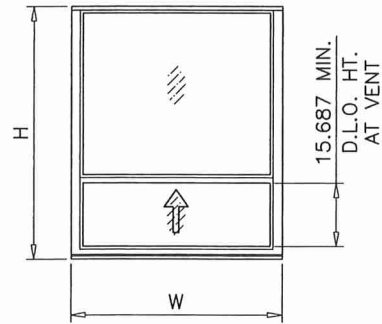


UNEQUAL LITES (ORIEL TYPES) WINDOWS
DESIGN LOAD CAPACITY - PSF
STD. & HI-RISE SILL

WINDOW DIMS.		STANDARD TOP RAIL	
		GLASS TYPE 'F'	
WIDTH	HEIGHT	EXT.(+)	1NT.(-)
19-1/8"	50-5/8" (5)	70.0	75.0
26-1/2"		70.0	75.0
37"		70.0	75.0
42"		70.0	75.0
49"		70.0	75.0
53-1/8"		70.0	75.0
19-1/8"	58" (5)	70.0	75.0
26-1/2"		70.0	75.0
37"		70.0	75.0
42"		70.0	75.0
49"		70.0	75.0
19-1/8"	63" (6)	70.0	75.0
26-1/2"		70.0	75.0
37"		70.0	75.0
42"		70.0	75.0
49"		70.0	75.0
19-1/8"	68" (6)	70.0	75.0
26-1/2"		70.0	75.0
37"		70.0	75.0
42"		70.0	75.0
49"		70.0	75.0
19-1/8"	74-1/4" (7)	70.0	75.0
26-1/2"		70.0	75.0
37"		70.0	75.0
42"		70.0	75.0
49"		70.0	75.0

* NO. IN PARENTHESIS INDICATE NO. OF ANCHORS PER JAMB.

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 26-0715-05
Expiration Date 11/6/2028
By Ishay L. Chaudhary
Miami Dade Product Control

NOTE:
GLASS CAPACITIES ARE BASED ON
ASTM E1300-16 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

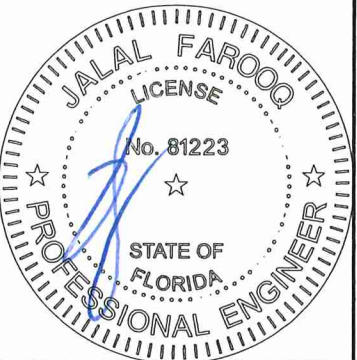





JUL 09 2026

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 262-8100 FAX. (305) 262-6978
COMP-ANL\W03-56ESW


SERIES-1000/1050 ALUM SINGLE HUNG WDW. (L.M.I.)
E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:	no	date	by	description
	M	07.17.20		GENERAL REVISION
	N	07.06.23		NO CHANGE THIS SHEET
	O	08.09.24		NO CHANGE THIS SHEET
	P	07.02.26		UPDATED TO 2026 FBC

date: 07-31-03	scale: 1/2" = 1"	dr. by: TARIQ	chk. by:
drawing no. W03-56		sheet 2.1 of 8	

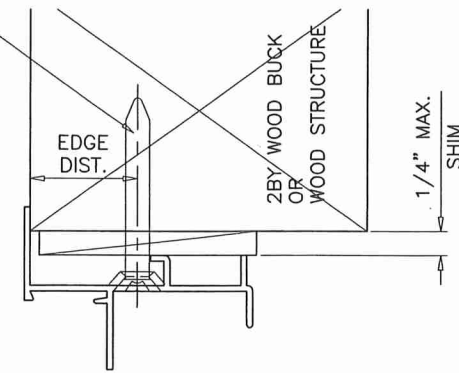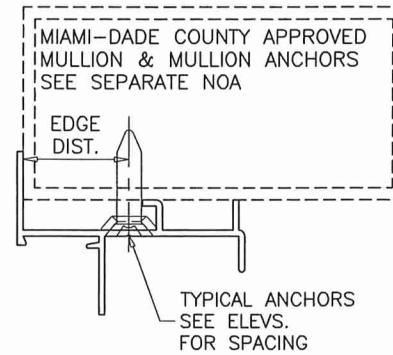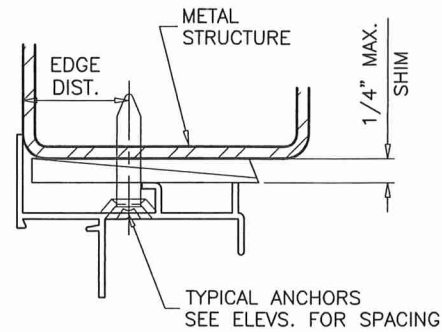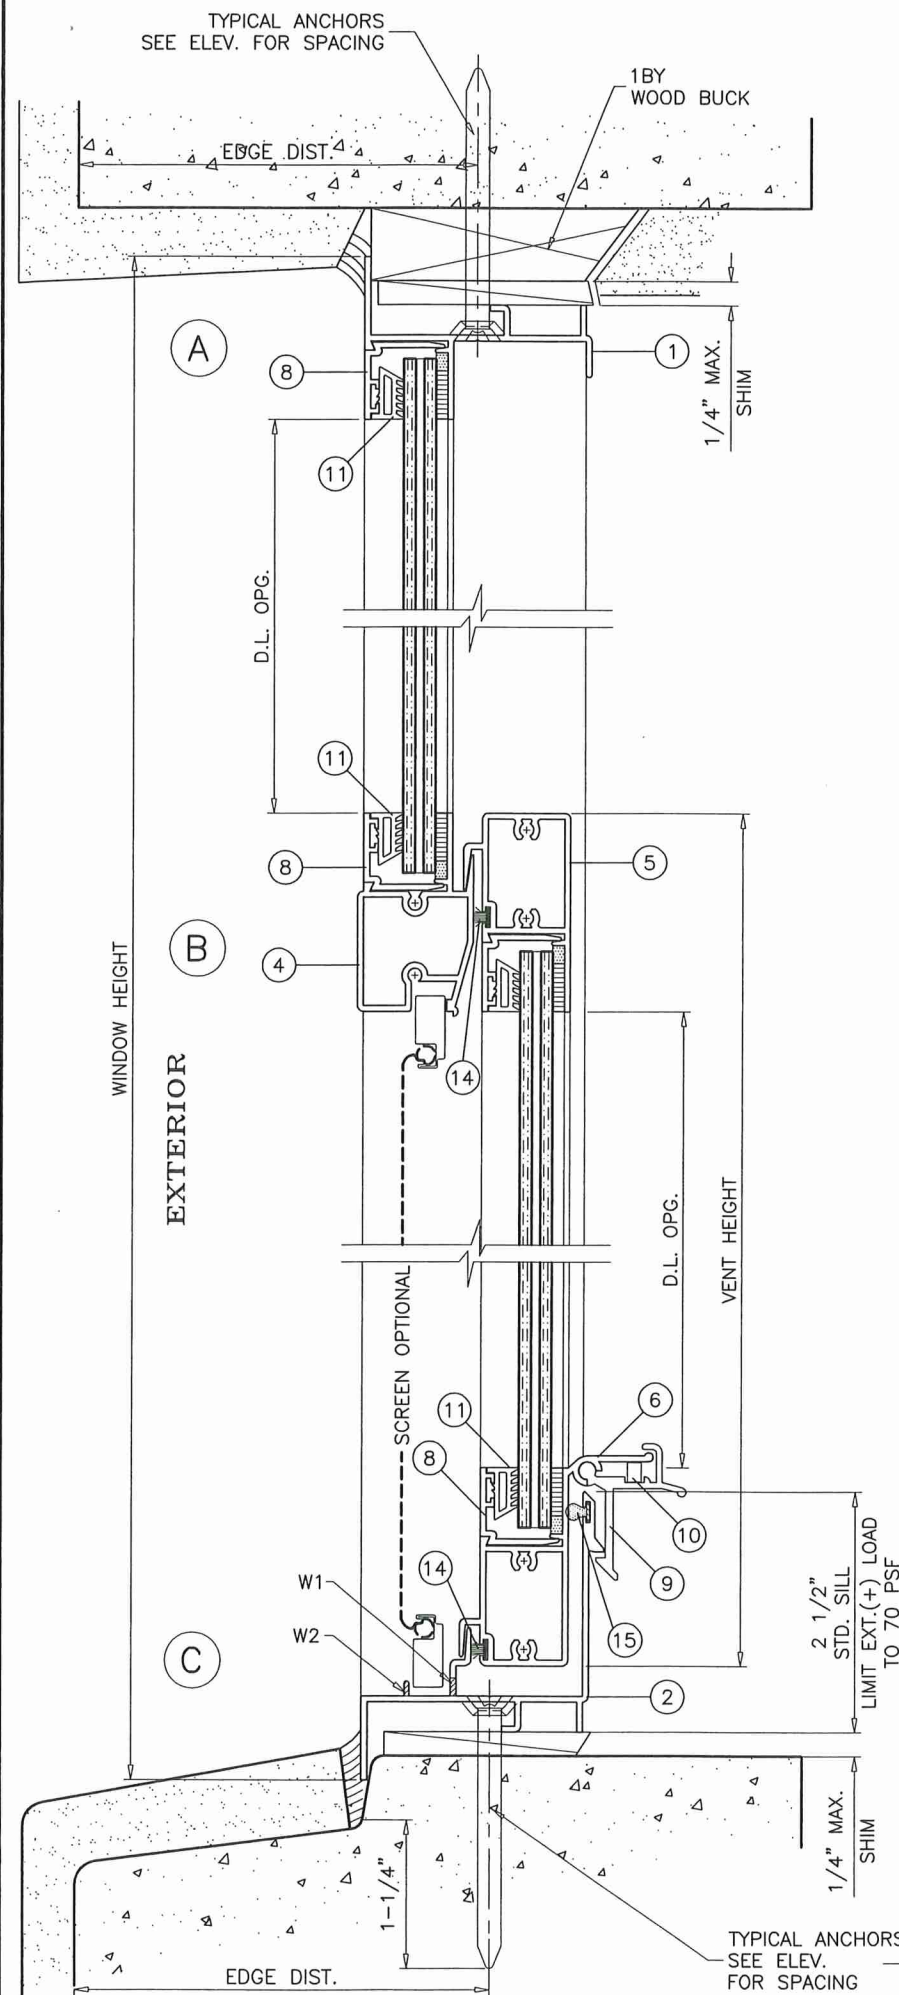

WOOD BUCKS AND METAL STRUCTURE NOT BY 'E.S. WINDOWS' MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

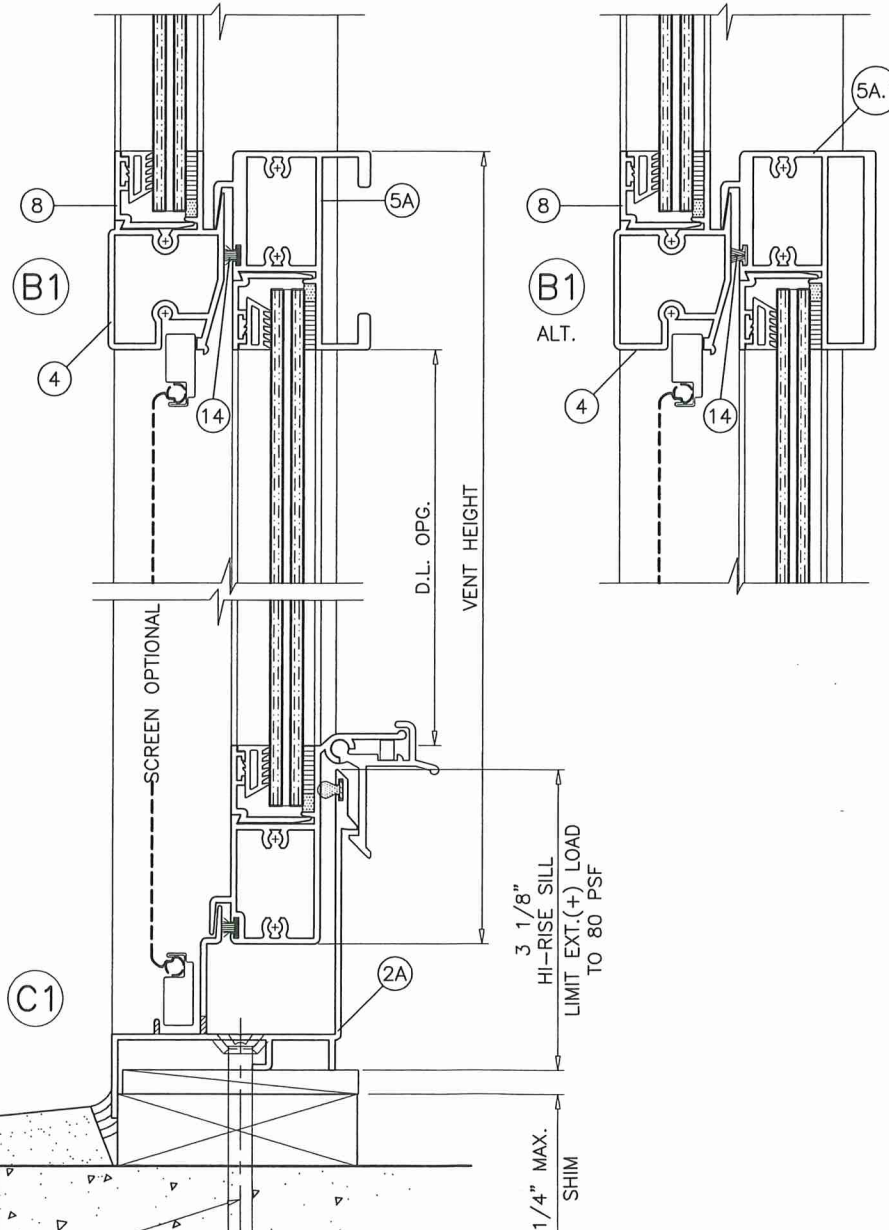

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 1-1/2" MIN. PENETRATION INTO WOOD (HEAD/SILL/JAMBS)
 THRU 1BY BUCKS INTO CONC. OR BLOCKS
 1-1/4" MIN. EMBED INTO CONCRETE (HEAD/SILL/JAMBS)
 1-1/4" MIN. EMBED INTO BLOCKS (JAMBS)

DIRECTLY INTO CONCRETE OR BLOCKS
 1-1/4" MIN. EMBED INTO CONCRETE (HEAD/SILL/JAMBS)
 1-1/4" MIN. EMBED INTO BLOCKS (JAMBS)

#14 SMS OR SELF DRILLING SCREWS (GRADE 2 CRS)
 INTO MIAMI-DADE COUNTY APPROVED MULLIONS OR
 INTO METAL STRUCTURES (HEAD/SILL/JAMBS)
 (3) THREADS MIN. PENETRATION BEYOND SUBSTRATE
 ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)
 STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL EDGE DISTANCE

INTO CONCRETE AND MASONRY = 2-1/2" MIN.
 INTO WOOD STRUCTURE = 1" MIN.
 INTO METAL STRUCTURE = 3/4" MIN.

WOOD AT HEAD, SILL OR JAMBS SG = 0.55 MIN.
 CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.
 C-90 HOLLOW/FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.


SEALANT:

ALL JOINTS AND FRAME CONNECTIONS SEALED WITH SCHNEE MOREHEAD SEAM SEALER SM5504.

WEEPHOLES:

W1 = 1-1/2" X 3/16" WEEPHOLES AT 4" FROM EACH END
 W2 = 1-5/16" NOTCH AT EACH END

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 26-0715-05
 Expiration Date 11/6/2028
 By: Ishag J. Chah
 Miami-Dade Building Control

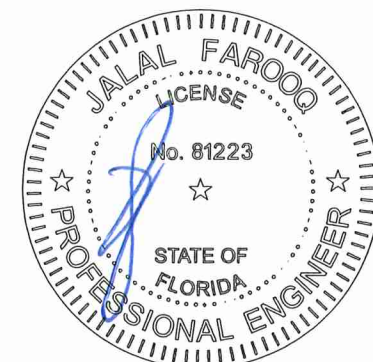

SERIES-1000
 VENT WITH SPRING LOADED LATCHES




JUL 09 2026

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173
 TEL. (305) 264-8100 FAX. (305) 262-6978
 (C.A.N. 3538)

SERIES-1000/1050 ALUM SINGLE HUNG WDW. (L.M.I.)
E.S. WINDOWS, LLC
 3550 N.W. 49 STREET
 MIAMI, FL. 33142
 TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:		no	date	by	description
		M	07.17.20		GENERAL REVISION
		N	07.06.23		NO CHANGE THIS SHEET
		O	08.09.24		NO CHANGE THIS SHEET
		P	07.02.26		NO CHANGE THIS SHEET


date: 07-31-03	scale: 1/2" = 1"	dr. by: TARIQ	chk. by:
drawing no. W03-56			
sheet 3 of 8			

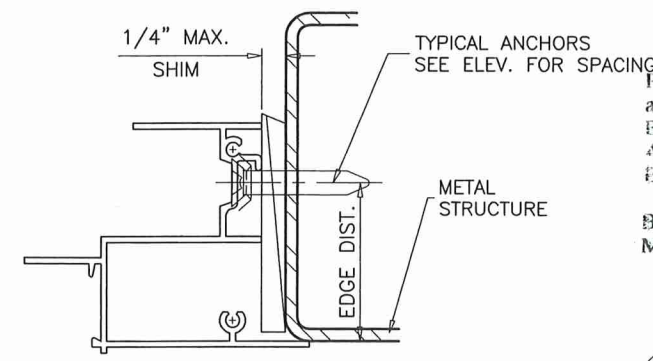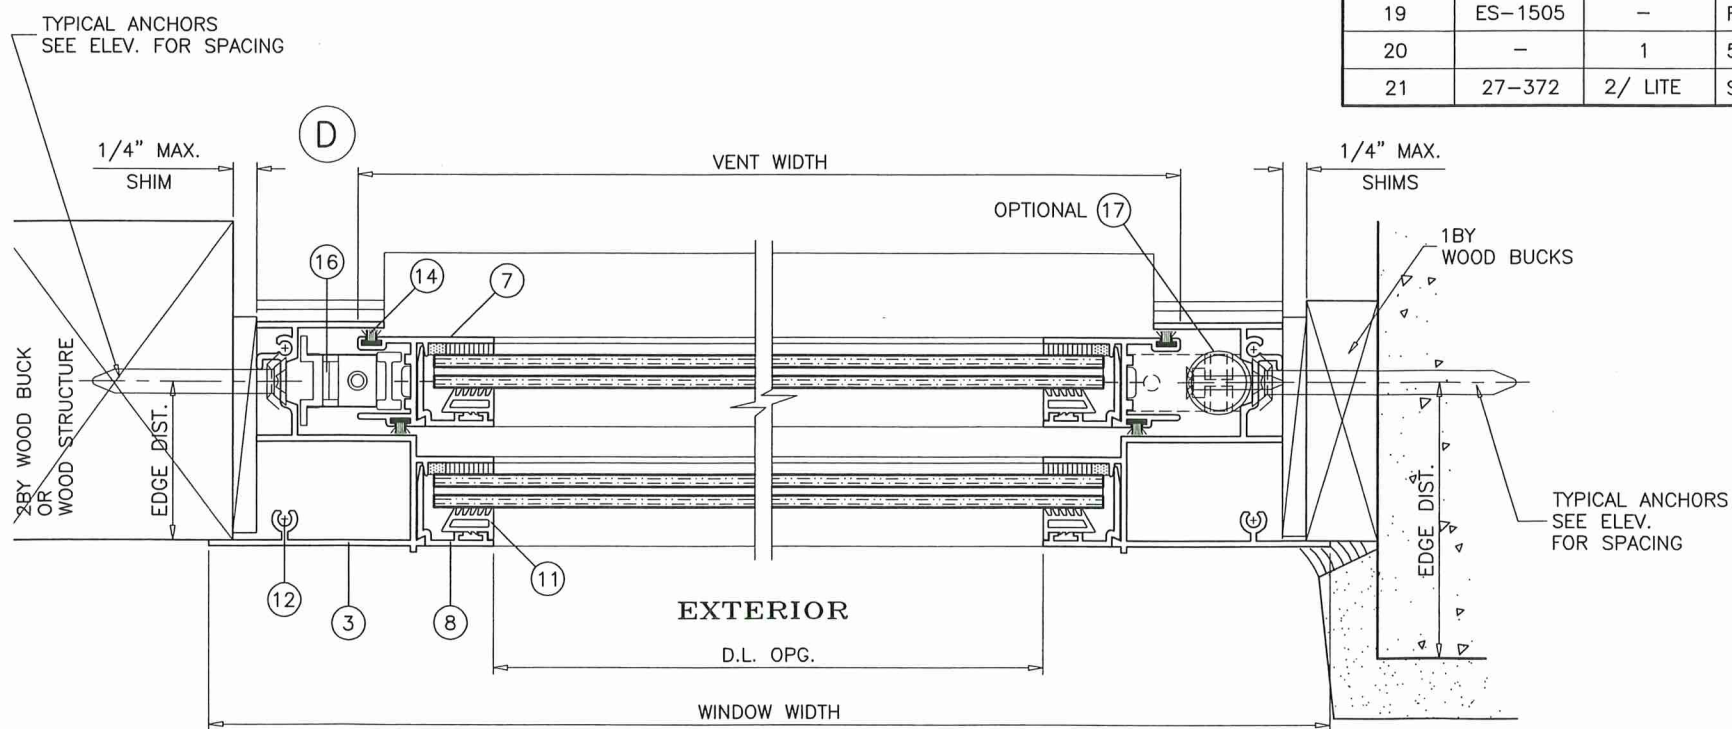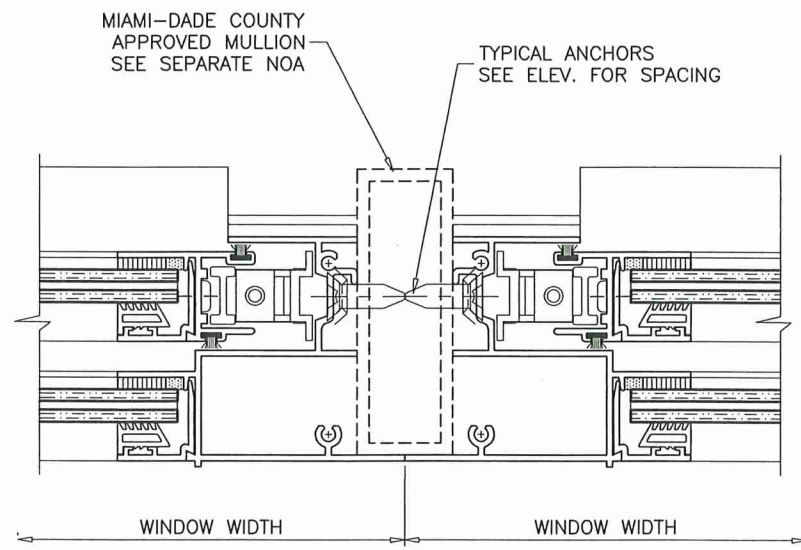

ITEM #	PART #	REQD.	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	ES-1001	1	FRAME HEAD	6063-T6	-
2	ES-1002	1	FRAME SILL (STD.)	6063-T6	-
2A	ES-1101	1	FRAME SILL (HI-RISE)	6063-T6	-
3	ES-1003A	2	FRAME JAMB	6005-T5	-
4	ES-1005	1	FIXED MTG. RAIL (FOR SPRING LATCH)	6063-T6	-
4A	ES-1051	1	FIXED MTG. RAIL (FOR SWEEP LATCH)	6063-T6	-
5	ES-1004	1	STD. VENT TOP RAIL (FOR SPRING LATCH)	6063-T6	-
5A	ES-2004	1	HEAVY DUTY VENT TOP RAIL (FOR SPRING LATCHES)	6063-T6	-
5A.1	ES-2004A	1	HEAVY DUTY VENT TOP RAIL (FOR SPRING LATCHES)	6063-T6	ALTERNATE TO 5A
5B	ES-1052	1	STD. VENT TOP RAIL (FOR SWEEP LATCH)	6063-T6	-
5C	ES-1053	1	HEAVY DUTY VENT TOP RAIL (FOR SWEEP LATCHES)	6063-T6	-
5C.1	ES-1053A	1	HEAVY DUTY VENT TOP RAIL (FOR SWEEP LATCHES)	6063-T6	ALTERNATE TO 5C
6	ES-1006	1	VENT BOTTOM RAIL	6063-T6	-
7	ES-1007	2	VENT SIDE RAIL	6063-T5	-
8	ES-1008	AS RQD.	GLAZING BEAD	6063-T6	-
8A	ES-1103	AS RQD.	SQUARE GLAZING BEAD	6063-T5	-
9	ES-1009	2/VENT	SPRING LOADED VENT LATCH	6063-T5	AT 6" FROM ENDS
9A	3032	2/VENT	SWEEP LATCH	ZAMAK	AT 11" FROM ENDS
9B	#8 X 1"	2/ LATCH	LATCH INSTALLATION SCREWS	-	FH SMS
10	ES-1012	1/LATCH	LATCH SPRING	ST. STEEL	-
11	ES-1010	AS REQD.	GLAZING WEDGE	SOFT PVC	DUROMETER 70±5 SHORE 'A'
11A	ES-5008A	AS REQD.	GLAZING GASKET	EPDM	DUROMETER 65±5 SHORE 'A'
12	#8 X 1"	20	FRAME & VENT ASSEMBLY SCREWS	CRS	PH SMS
13	ES-1011	2/VENT	SASH CAM	CELCON	-
14	43620-187	AS REQD.	PILE W'STRIPPING WITH PLASTIC FIN	-	AMESBURY OR EQUIV.
15	Q300X190	AS REQD.	FRAME SILL W'STRIPPING	-	Q-LON2
16	-	2/ VENT	BLOCK & TACKLE BALANCE	-	SERIES 120 BY BSI
17	-	2/ VENT	SPIRAL BALANCE	-	-
18	ES-1013	2	SASH STOP	-	-
19	ES-1505	-	FLUSH FRAME ADAPTER	6063-T5	OPTIONAL
20	-	1	5/16" BOX SCREEN	-	OPTIONAL
21	27-372	2/ LITE	SETTING BLOCK, 7/16" X 3/16" X 3-1/2" LONG	EPDM	DUROMETER 75±5 SHORE A

SERIES-1000
SERIES-1050

JUL 09 2026

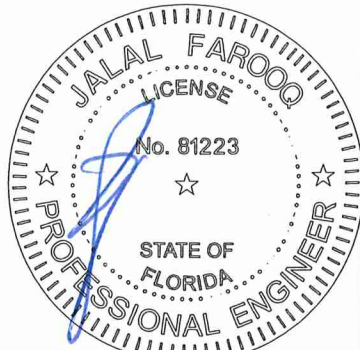

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 262-6978 FAX. (305) 262-6978

COMP-ANL\W03-56ESW

SERIES-1000/1050 ALUM SINGLE HUNG WDW. (L.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

no	date	description	by
M	07.17.20	GENERAL REVISION	
N	07.06.23	NO CHANGE THIS SHEET	
O	08.09.24	NO CHANGE THIS SHEET	
P	07.02.26	NO CHANGE THIS SHEET	

date: 07-31-03

scale: 1/2" = 1"


dr. by: TARIQ

chk. by:




drawing no.
W03-56

sheet 5 of 8


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 7C-071505
Expiration Date 11/16/2028
By: Jalal Farooq
Miami Dade Product Control

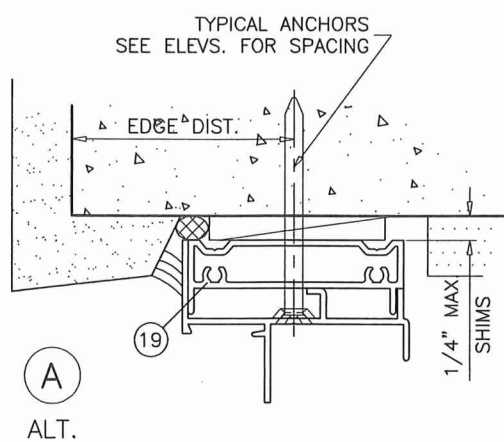

A
ALT.

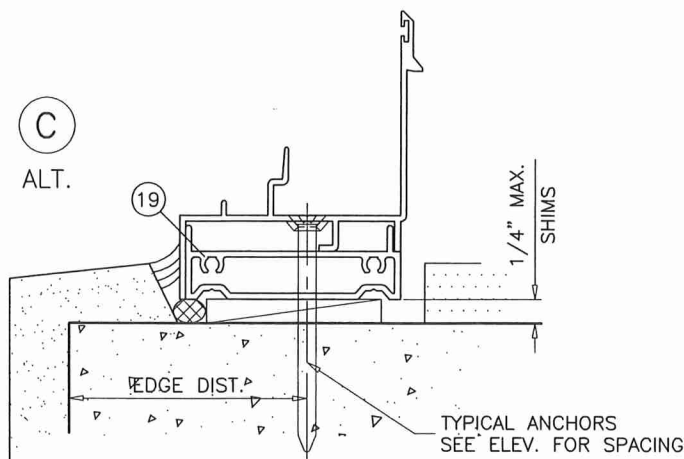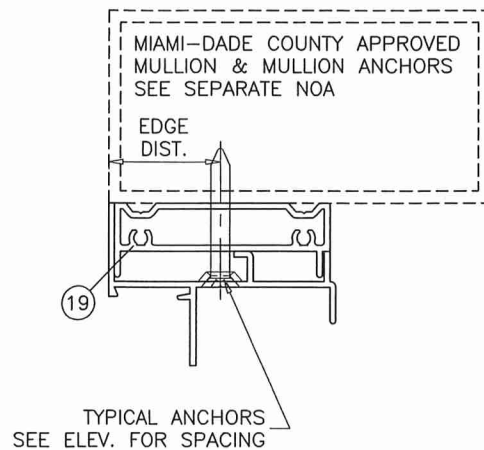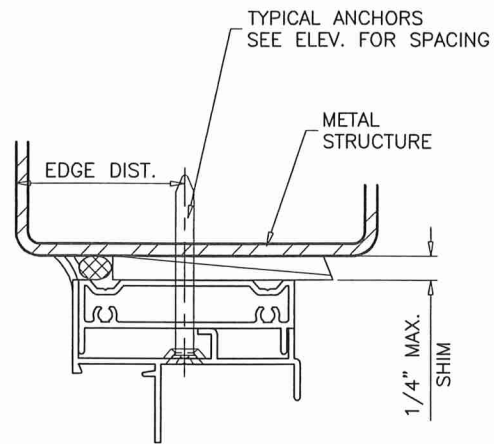


C
ALT.

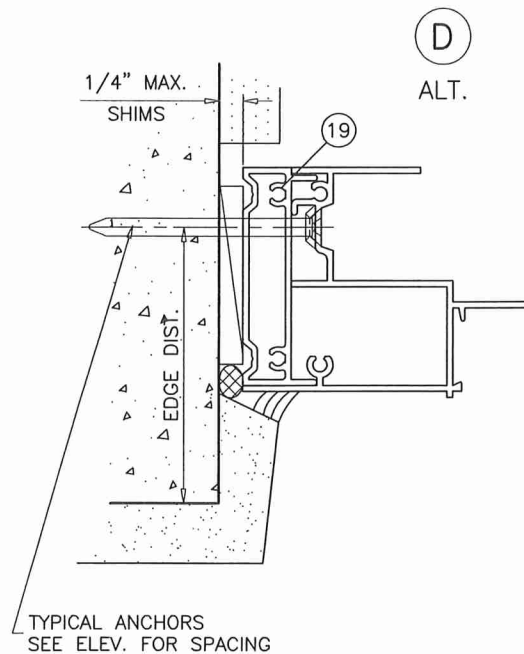

D
ALT.

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 26-0715-05
Expiration Date 11/6/2028
By J. Farooq
Miami Dade Product Council

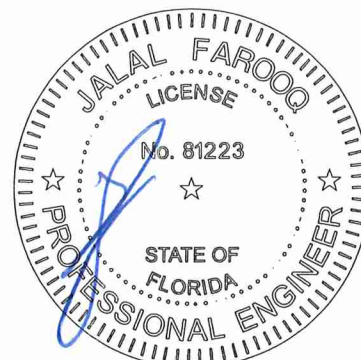

INSTALLATION DETAILS WITH FLUSH FRAME ADAPTER

JUL 09 2026




AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
(C.A.N. 3538)

SERIES-1000/1050 ALUM SINGLE HUNG WDW. (L.M.I.)
E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158


revisions:		no	date	by	description
	M	07.17.20			GENERAL REVISION
	N	07.06.23			NO CHANGE THIS SHEET
	O	08.09.24			NO CHANGE THIS SHEET
	P	07.02.26			NO CHANGE THIS SHEET

date: 07-31-03	scale: 1/2" = 1"	dr. by: TARIQ	chk. by:
drawing no. W03-56	sheet 6 of 8		

COMP-ANL\W03-56ESW

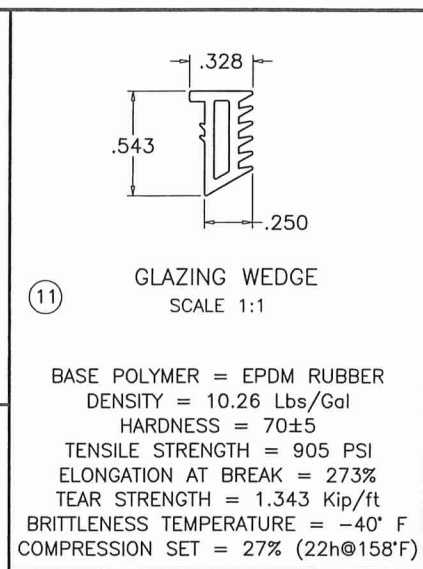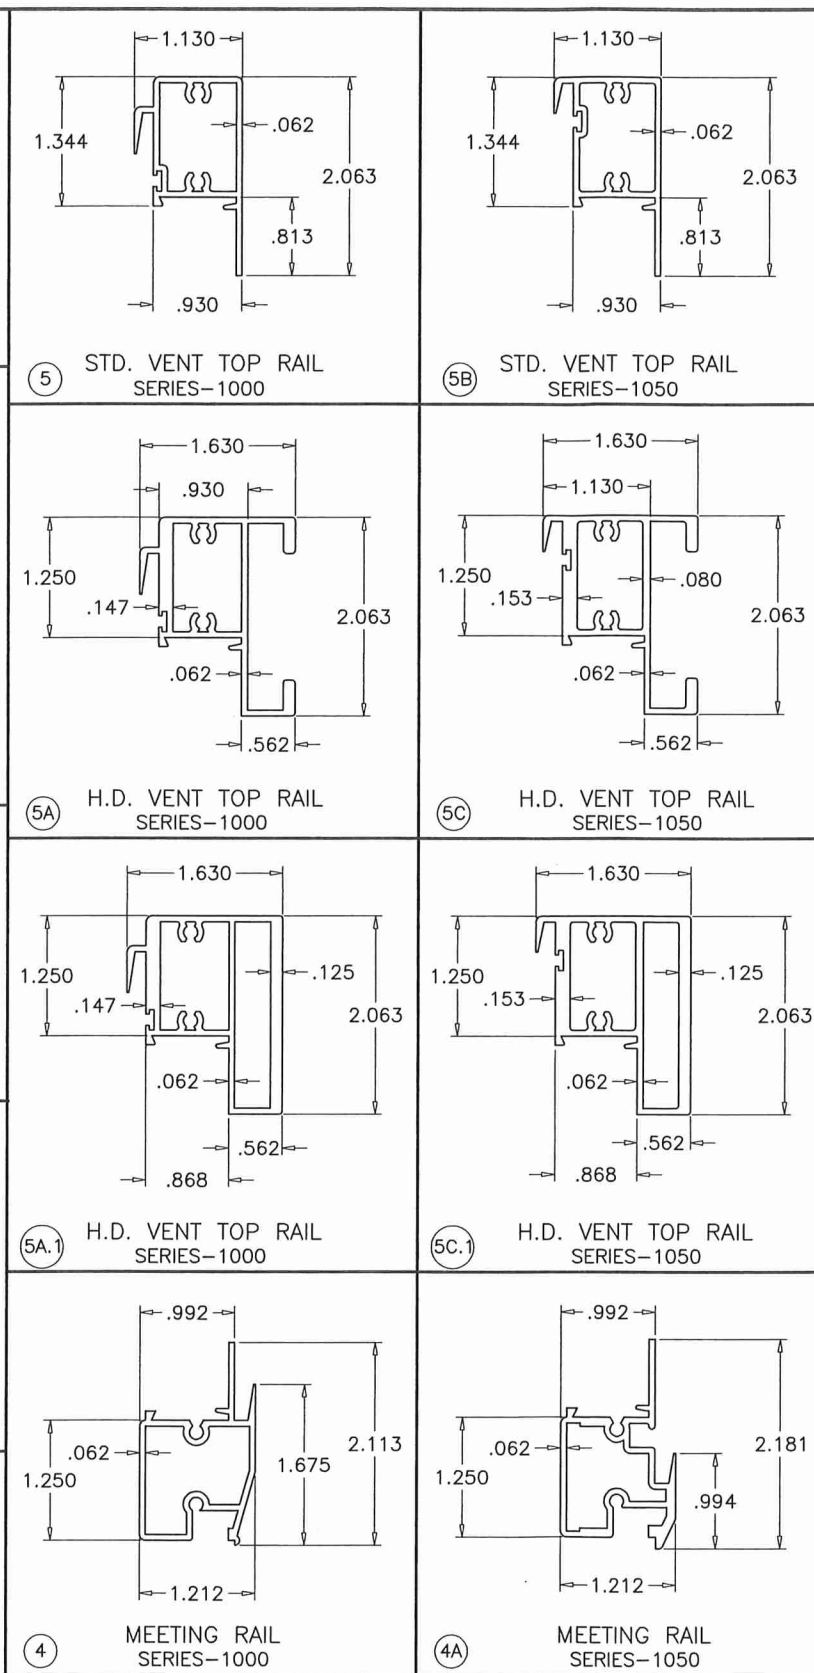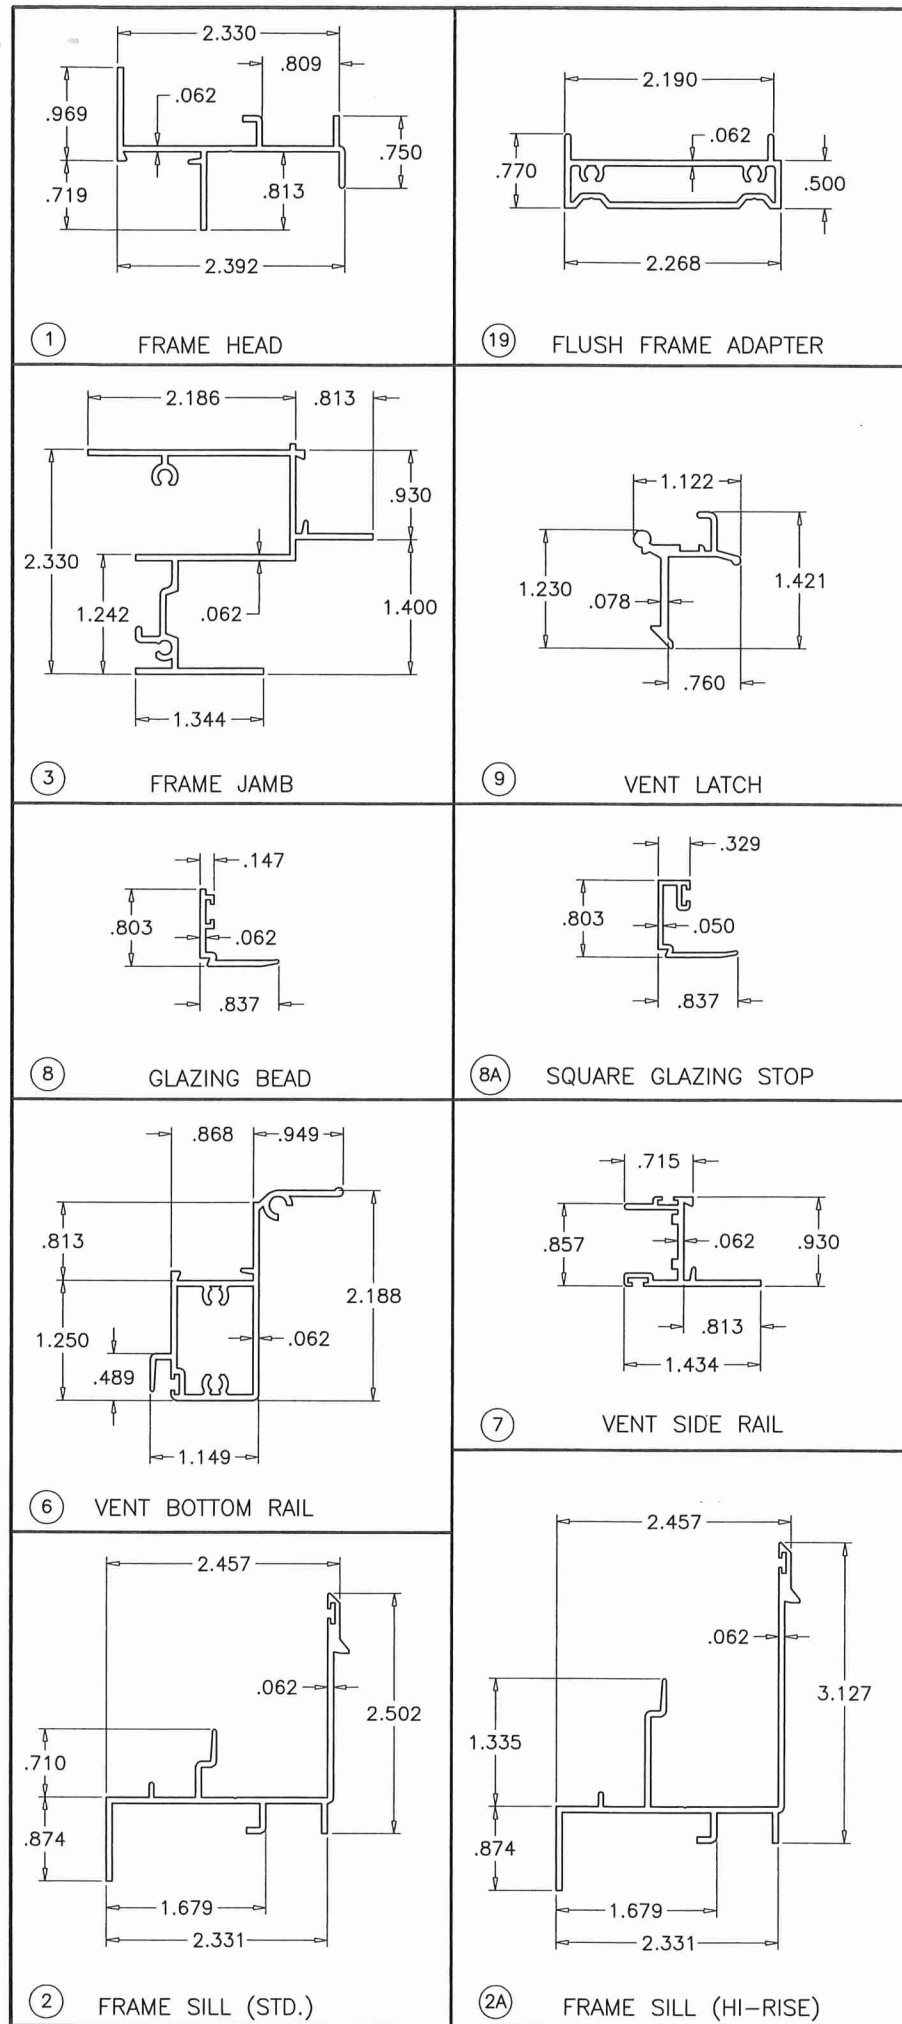

JUL 09 2026

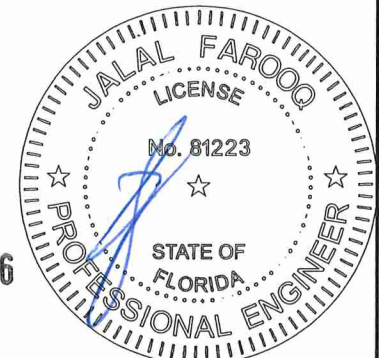

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 262-6978 FAX. (305) 262-6978
(C.A.N. 3538)

SERIES-1000/1050 ALUM SINGLE HUNG WDW. (L.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

no	date	description	by
M	07.17.20	GENERAL REVISION	
N	07.06.23	NO CHANGE THIS SHEET	
O	08.09.24	NO CHANGE THIS SHEET	
P	07.02.26	NO CHANGE THIS SHEET	


date: 07-31-03
scale: 1/2" = 1"
dr. by: TARIQ
chk. by:

drawing no.
W03-56


sheet 7 of 8

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 26-0715-05
Expiration Date 11/6/2028
By: [Signature]
Miami Dade Product Control

COMP-ANL\W03-56ESW

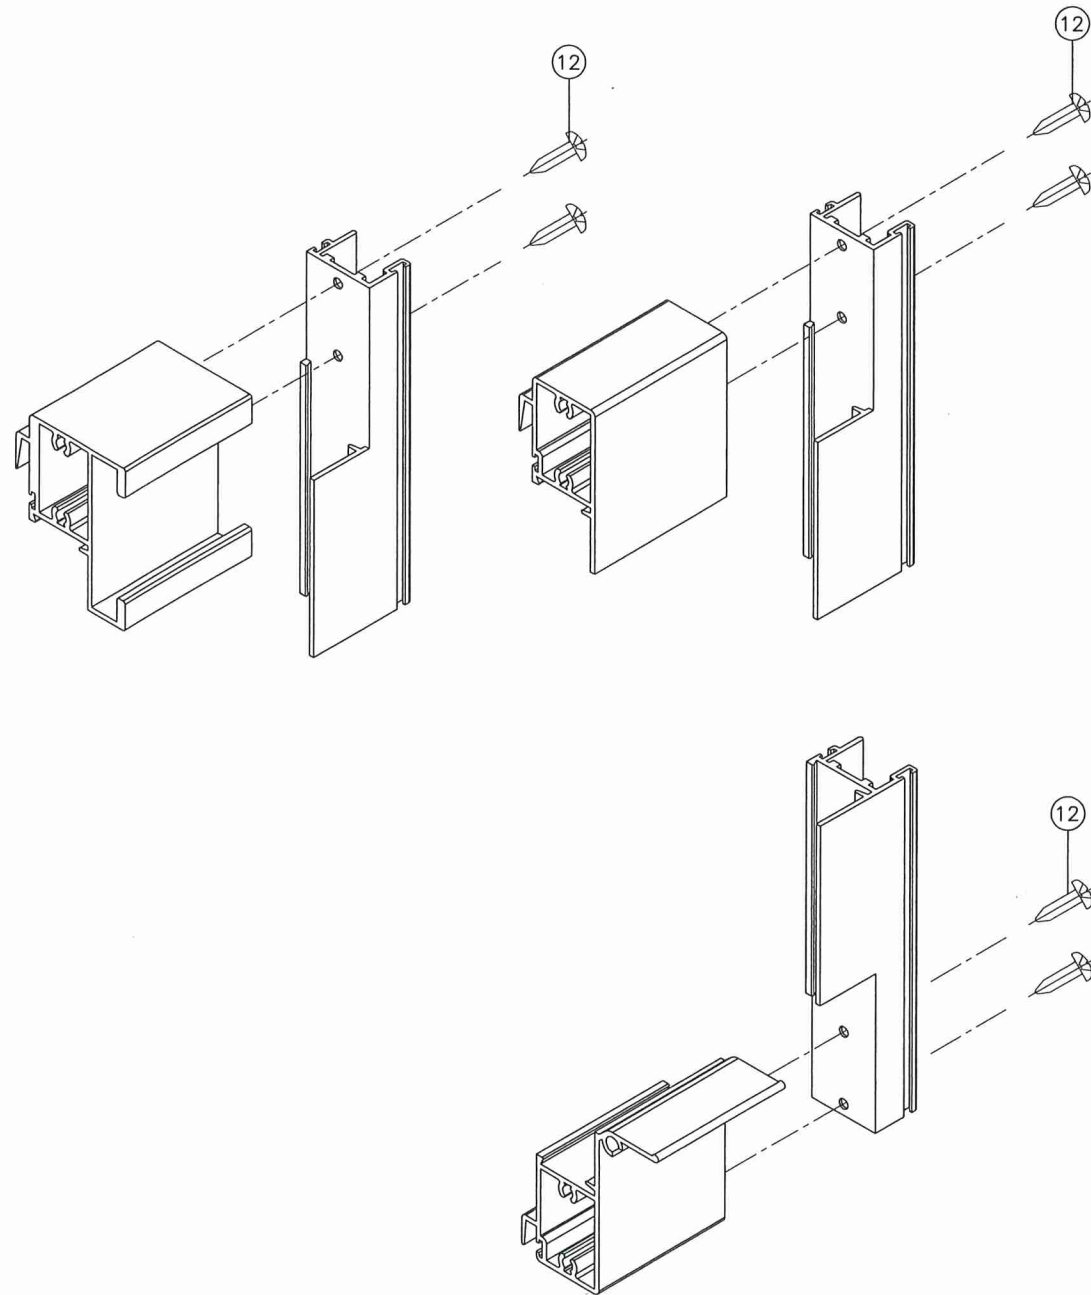


VENT CORNER DETAIL

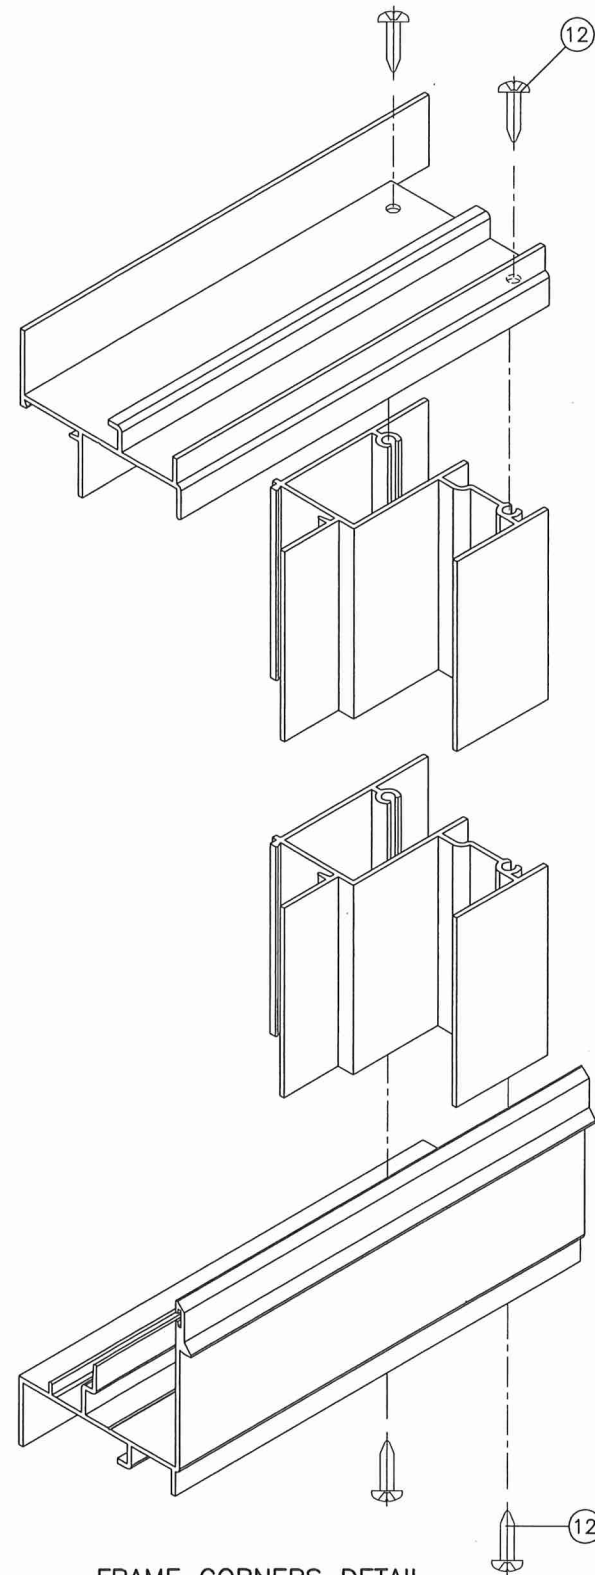

FRAME CORNERS DETAIL

PRODUCT REVISBD
as complying with the Florida
Building Code
Acceptance No. 26-0715-05
Expiration Date 11/6/2028
By [Signature]
Miami Dade Product Control

JUL 09 2026

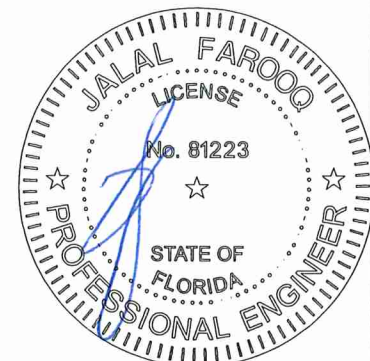

SERIES-1000/1050 ALUM SINGLE HUNG WDW. (L.M.I.)
E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
(C.A.N. 3538)
COMP-ANL\W03-56ESW

Revisions:		no	date	by	description
	M	07.17.20			GENERAL REVISION
	N	07.06.23			NO CHANGE THIS SHEET
	O	08.09.24			NO CHANGE THIS SHEET
	P	07.02.26			NO CHANGE THIS SHEET
date:	07-31-03	scale:	1/2" = 1"	dr. by:	TARIQ
chk. by:					
drawing no.	W03-56	sheet	8 of 8		