



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION

11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599

www.miamidade.gov/building

Overhead Door Corporation

2501 South State Hwy. 121, Suite 200

Lewisville, Texas 75067

SCOPE: This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ). This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Models 5745/5765/7565/7655/515 and 525 Insulated Steel Sectional Garage Door up to 16ft.-2in. Wide w/ Optional Impact Resistant Glazing

APPROVAL DOCUMENT: Drawing No. **D-411530**, titled "Windload Models 5745/5765/7565/7655/515 /525, +46/-52 PSF Dade County, 16'2" Max. Width", sheets 1 through 4 of 4, dated 08/28/2018, prepared by Overhead Door Corporation, signed and sealed by Dwayne J. Kornish, P.E. on 09/03/2024, bearing the Miami-Dade County Product Control Revision stamp with the NOA number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, manufacturing address, model number, the positive and negative design pressure rating, indicate impact rated if applicable, installation instruction drawing reference number, approval number (NOA), the applicable test standards, and the statement reading 'Miami-Dade County Product Control Approved' is to be located on the door's side track, bottom angle, or inner surface of a panel.

LIMITATION: This door has not been tested for air infiltration.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises NOA No. 24-0814.07** and consists of this page 1 and evidence pages E-1, E-2 and E-3, as well as approval document mentioned above.

The submitted documentation was reviewed by **Carlos M. Utrera, P.E.**




10/08/2026

NOA No. 26-0820.09
Expiration Date: October 10, 2029
Approval Date: October 15, 2026
Page 1

Overhead Door Corporation

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's

A. DRAWINGS

1. Manufacturer's die drawings and sections.
(Submitted under NOA No. 19-0815.04)
2. Drawing No. **D-411530**, titled "Windload Models 5745 / 5765 / 7565 / 7655 / 515 / 525, +46/-52 PSF Dade County, 16'2" Max. Width", sheets 1 through 4 of 4, dated 08/28/18, prepared by manufacturer, signed and sealed by Dwayne J. Kornish, P.E.
(Submitted under NOA No. 19-0815.04)

B. TESTS

1. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
4) Forced Entry Test, per FBC, TAS 202-94
5) Tensile Test per ASTM E8
along with marked-up drawings and installation diagram of a 12'-2" wide, model 5745 sectional garage door, prepared by Intertek/Architectural Testing, Inc., Test Report No. **J1626.05-801-18R1**, dated 07/10/19, revised on 07/18/19, signed and sealed by Tyler Westerling, P.E.
(Submitted under NOA No. 19-0815.04)
2. Test report on Standard Test Method for Evaluation of Painted or Coated Specimens Subjected to Corrosive Environments per ASTM D1654-08(2016)-e1 and Standard Practice for Operating Salt Spray (Fog) Apparatus per ASTM B117-16 and on garage door exterior steel, prepared by Intertek, Report No. **J4650.02-106-18 R0**, dated 05/24/19, signed by Gary T. Hartman, P.E.
(Submitted under NOA No. 19-0815.04)

C. CALCULATIONS

1. Anchor load calculations prepared by manufacturer, dated 06/07/19, signed and sealed by Dwayne J. Kornish, P.E.
(Submitted under NOA No. 19-0815.04)



Carlos M. Utrera, P.E.
Product Control Examiner
NOA No. 26-0820.09
Expiration Date: October 10, 2029
Approval Date: October 15, 2026

Overhead Door Corporation

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's (CONTINUED)

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS

1. Test report on Ignition Temperatures of Plastic per ASTM D1929-16 on BASF Corp. Elastopor P19670R polyurethane foam insulation, prepared by QAI Laboratories, Inc., Test Report No. **RJ6431F-1**, dated 09/28/18, signed by Bryan Ortega.
2. Test report on Surface Burning Characteristics of Building Materials per ASTM E84-18b on BASF Corp. Elastopor P19670R polyurethane foam insulation, prepared by QAI Laboratories, Inc., Test Report No. **RJ6648F-4**, dated 12/12/18, signed by Bryan Ortega.
3. Notice of Acceptance No. **18-0918.06** issued to **Plaskolite, LLC** for its **TUFFAK Polycarbonate Sheets**, approved on 11/15/18 and expiring on 08/27/22.

F. STATEMENTS

1. Statement letter of conformance, complying with **FBC 7th Edition (2020)**, dated October 23, 2020, issued by manufacturer, signed and sealed by Dwayne J. Kornish, P.E.
(Submitted under NOA No. 20-1106.11)
2. Statement letter of no financial interest, dated August 07, 2019, issued by manufacturer, signed and sealed by Dwayne J. Kornish, P.E.
(Submitted under NOA No. 19-0815.04)

G. OTHERS

1. Notice of Acceptance No. **19-0815.04**, issued to Overhead Door Corporation, for their Models 5745 / 5765 / 7565 / 7655 / 515 / 525 Insulated Steel Sectional Garage Door up to 16'-2" Wide w/ Optional Impact Resistant Glazing, approved on 10/10/19 and expiring on 10/10/24.



Carlos M. Utrera, P.E.
Product Control Examiner
NOA No. 26-0820.09
Expiration Date: October 10, 2029
Approval Date: October 15, 2026

Overhead Door Corporation

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

2. EVIDENCE SUBMITTED UNDER NOA # 23-1120.22, 24-0814.07 AND NEW

A. DRAWINGS

1. Drawing No. **D-411530**, titled “Windload Models 5745/5765/7565/7655/515/525, +46/-52 PSF Dade County, 16’2” Max. Width”, sheets 1 through 4 of 4, dated 08/28/2018, prepared by Overhead Door Corporation, signed and sealed by Dwayne J. Kornish, P.E. on 09/03/2024.

B. TESTS

1. None.

C. CALCULATIONS

1. None.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **22-0317.02** issued to **Plaskolite, LLC** for their “**TUFFAK Polycarbonate Sheets**” dated 04/21/22 expiring on 08/27/27.

F. STATEMENTS

1. Statement letter of code conformance to the 9th Edition (2026) of the FBC, including special limitation note that anchors in saltwater environment must meet corrosion resistance requirements of FBC, Chapter 17, issued by Overhead Door Corporation, dated 09/09/2026, signed and sealed by Dwayne J. Kornish, P.E.
2. Statement letter of conformance with the 8th edition (2023) of the FBC, dated 08/29/2024, issued by Overhead Door Corporation, signed and sealed by Dwayne J. Kornish, P.E.
3. Statement letter of conformance with the 8th edition (2023) of the FBC and of no financial interest, dated 01/25/2024, issued by Overhead Door Corporation, signed and sealed by Dwayne J. Kornish, P.E. “**Submitted under NOA # 23-1120.22**”




Carlos M. Utrera, P.E.
Product Control Examiner
NOA No. 26-0820.09
Expiration Date: October 10, 2029
Approval Date: October 15, 2026

The following pages in this document were submitted by the manufacturer (third party) to represent the product being approved and establish the limits of use. The pages may include technical drawings, schematics and installation details.

1. RATED DESIGN LOAD 465.52 PSF.
2. SECTION HEIGHTS MAY VARY TO CREATE VARIOUS DOOR HEIGHTS, 24" MAXIMUM SECTION HEIGHT.
3. MINIMUM 1" OVERLAP ON BOTH JAMBS REQUIRED TO MEET NEGATIVE DESIGN PRESSURES.
4. TESTED IN ACCORDANCE WITH DADE COUNTY PROTOCOLS TAS 201-94, TAS 202-94, & TAS 203-94.
5. DOOR SKIN MUST BE 30,000 PSI MIN. YIELD STRENGTH.
6. JAMB LOAD CALCULATIONS:
(1/2 DOOR WIDTH)(1 FT OF HEIGHT)(DESIGN PRESSURE)
(8.08)(1 FOOT)(46.00 AND -52.00)(371.68/-420.16) LB
7. JAMB FASTENER REQUIREMENTS:
 $F_x = (1/2 \text{ DOOR WIDTH})(1 \text{ FT OF HEIGHT})(\text{DESIGN PRESSURE})$
 $F_x = 371 \text{ LBS.}$
8. DOOR SKIN MATERIAL SHALL BE GALVANIZED ACCORDING TO ASTM A-525 TO G40 MIN, WITH BAKED.
9. FOR ANCHORING INTO WOOD USE ONE 5/16" LAG SCREW PER TRACK BRACKET WITH 1-1/2" EMBEDMENT.
10. WELD SLOT ON ANGLE 3/32" X 1" LONG ON 12" CENTERS. "IF WELDING MOUNTING OPTION IS CHOSEN."
11. LIFT UP MECHANISM-MANUAL CHAIN LIFT, OR OPERATOR IS NOT PART OF THIS APPROVAL.
12. STANDARD LIFT, HIGH LIFT, VERTICAL LIFT, AND LOW HEADROOM TRACK IS AVAILABLE. FOR LOW HINGE
(3) 1/4" - 1/4" 7/8" SELF DRILLING CRIMPITE SCREWS IN LIEU OF THE BRACKET SHOWN ON DRAWING. U
(3) 1/4" - 1/4" 7/8" SELF DRILLING CRIMPITE SCREWS IN LIEU OF THE BRACKET SHOWN ON DRAWING. U
13. ATTACH STRUTS WITH (3) 1/4" - 1/4" 7/8" SELF DRILLING CRIMPITE SCREWS AT ALL HINGE LOCATIONS.
14. KEY LOCK, OR SIDE LOCK REQUIRED.
15. IMPACT RESISTANT GLAZING OPTION- IMPACT RESISTANT GLAZING SYSTEM MAY BE INSTALLED IN
X 1" SMS. SEE DETAIL F-F ON SHEET 2 FOR ASSEMBLY DETAILS. MAXIMUM OF ONE GLAZED SECTION.
16. THE DESIGN OF THE SUPPORTING STRUCTURAL ELEMENTS SHALL BE THE RESPONSIBILITY OF THE
DESIGNER. BUILDING CODES AND LOADS LISTED ON THIS DRAWING.
17. A 2-1/4" X 6-3/8" X 22 GA BACKER PLATE IS TO BE LOCATED AT EVERY CENTER HINGE AND 3" X 3-3/4"
THE SECTION BACKER STEEL.

REVISIONS				
ER	REV	DESCRIPTION	DATE	APV
ER	P00	NEW DRAWING	8/28/18	ESG



SECTION B-B
SCALE 1 : 12

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 26-0820.09



Expiration Date 10/10/2029

By R. F. [Signature]
Miami-Dade Product Control

PRODUCT RENEWED
as complying with the Florida
Building Code
NOA-No. **24-0814.07**


Expiration Date 10/10/2029

By R. J. [Signature]
Miami-Dade Product Control

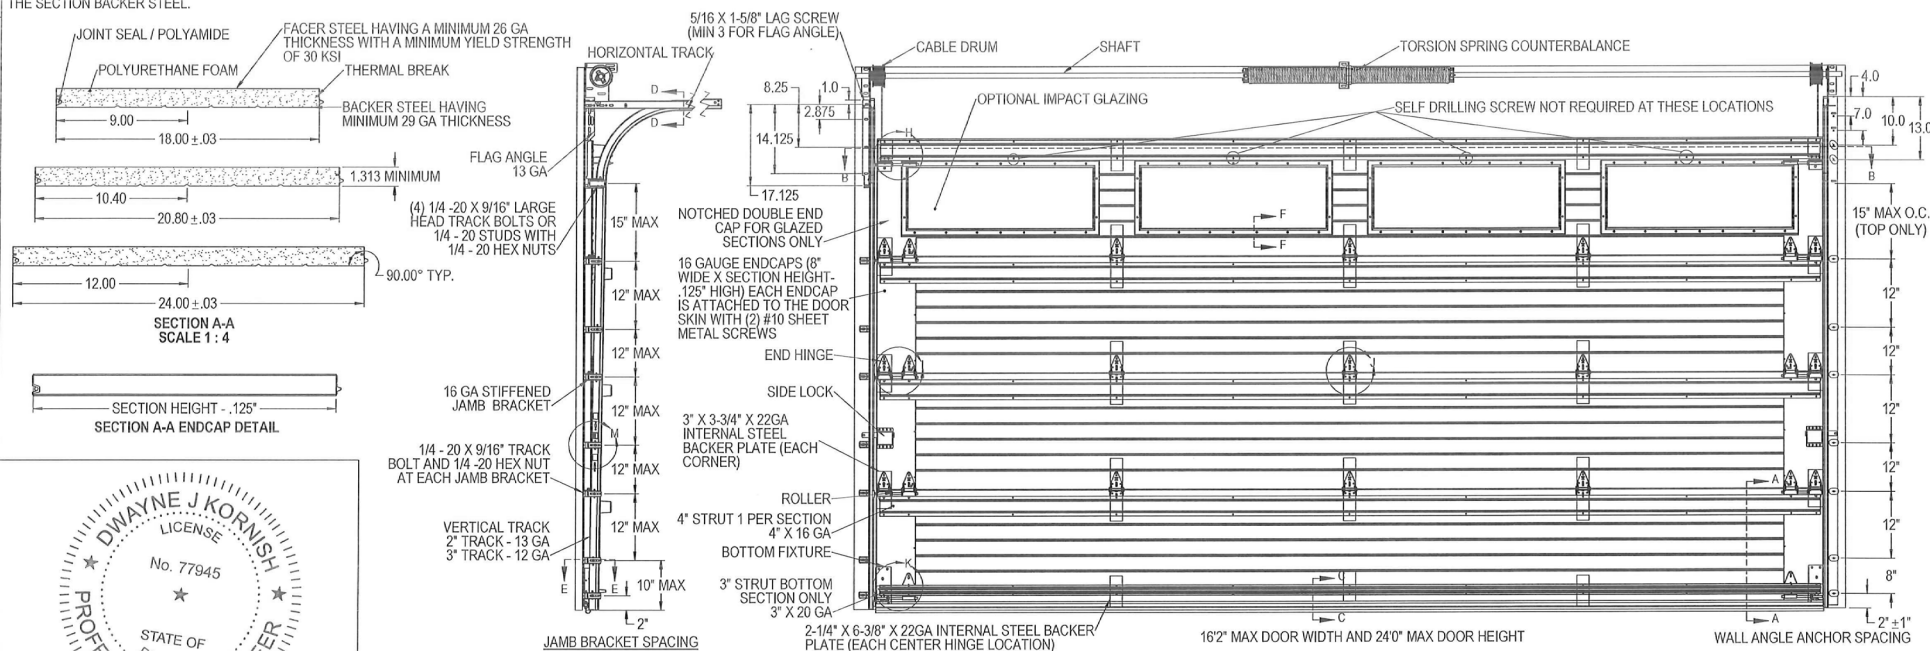

DWAYNE J. KORNISH, PE
4576 COUNTY ROAD 160
MOUNT HOPE, OHIO
FL PE 77945 TX PE 117868

PROFESSIONAL ENGINEER'S SEAL PROVIDED ONLY FOR
VERIFICATION OF WINDLOAD CONSTRUCTION DETAILS.



THIRD ANGLE PROJECTION




A DIVISION OF OVERHEAD
DOOR CORP
3395 ADDISON DRIVE
PENSACOLA, FLORIDA 32514
(850)-474-9890


UNLESS OTHERWISE SPECIFIED:
 INTERPRET DIMS & TOLS
 PER ASME Y14.5M
 ALL DIMS ARE IN
 INCHES
 DO NOT SCALE
 DIMS CIRCLED WITH SYMBOL 'O'
 ARE CRITICAL TO QUALITY DESIGN
 FEATURES & MUST MEET APPLICABLE
 IN-PROCESS INSPECTION STANDARDS

RWISE SPECIFIED TOLERANCES: $X = \pm .1$ $XX = \pm .03$ $XXX = \pm .010$ ANGULAR $\pm .5^\circ$ HOLES: $< \varnothing .251 = +.004/-.003$ $\varnothing .251\text{--}\varnothing .500 = +.006/-.003$ $> \varnothing .500 = +.008/-.003$	APPROVED DRAWN E. CO CHECKED D. CO APPROVED MATERIAL FINISH WINDLOAD S OPTION C
ALL GEOMETRY GOVERNED BY 3D CAD DATABASE:	


	APPROVALS	DATE		
DRAWN	E. CONRAD	8/28/18		
CHECKED	D. KORNISH	-		
APPROVED	-	-	DESCRIPTION	
MATERIAL	-	-	WINDLOAD MODELS	
FINISH	-	-	5745/5765/7565/7655/15/5525, +46/-52PS	
			DADE COUNTY, 16"Z MAX WIDTH	
	WINDLOAD SPECIFICATION OPTION CODE Z341		SIZE D	DWG NO. D-11550
BY 3D CAD DATABASE:			SCALE 1:12	UOM = FA SHEET 1 OF

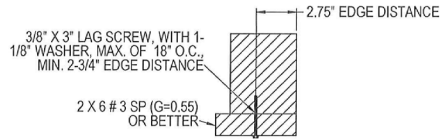



WOOD MOUNTED TO #3 SOUTHERN PINE SUBSTRATE

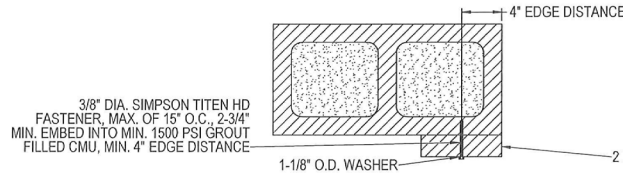


WOOD MOUNTED TO GROUT FILLED MASONRY BLOCK DETAIL

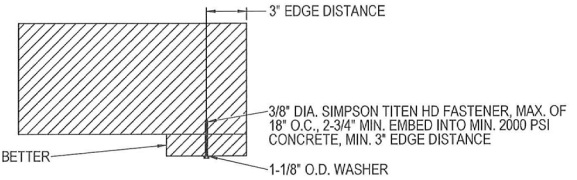


WOOD MOUNTED TO 2000 PSI CONCRETE DETAIL

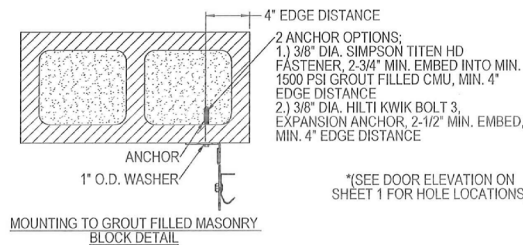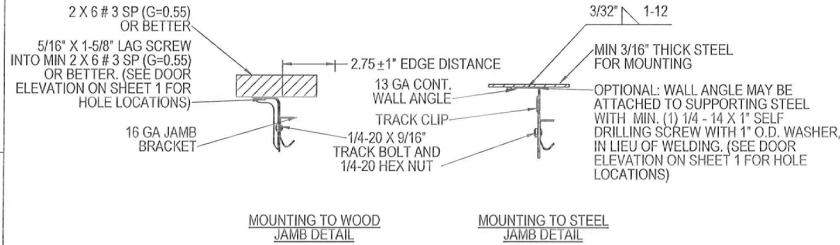


SECTION E-E SCALE 1:4

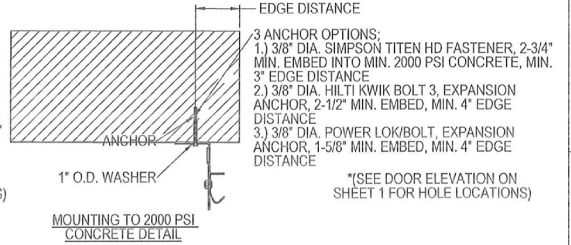


MOUNTING TO 2000 PSI CONCRETE DETAIL

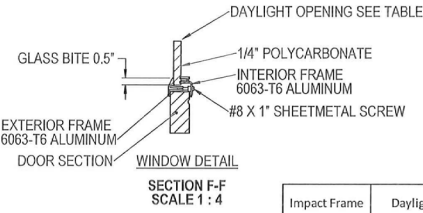


SECTION F-F SCALE 1:4

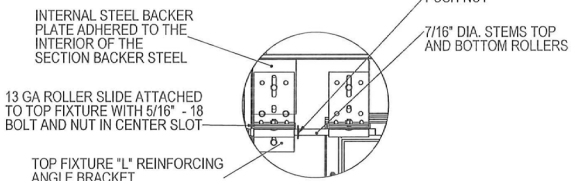


TOP FIXTURE "L" REINFORCING ANGLE BRACKET

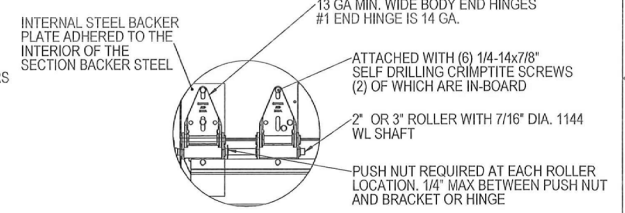

DETAIL I SCALE 1:4

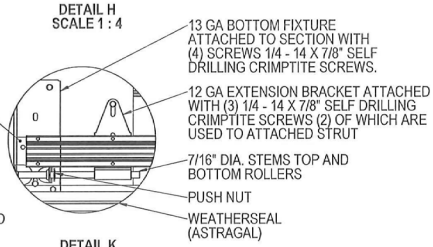


DETAIL K SCALE 1:4

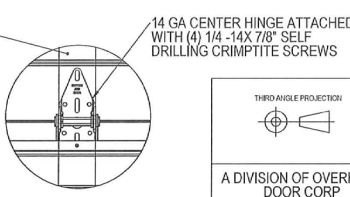

DETAIL J SCALE 1:4

Impact Frame Size	Daylight Opening (DLO)	Screw Qty
15-1/4 x 19-1/8	11-1/8 x 15	10
16-7/8 x 19-7/8	12-3/4 x 15-3/4	10
16-7/8 x 42-1/8	12-3/4 x 37-7/8	14
15-1/4 x 44-1/2	11-1/4 x 40-1/8	14
12-3/4 x 40	8-5/8 x 35-7/8	14
13 x 38	8-7/8 x 33-7/8	14



DWAYNE J. KORNISH, PE
4576 COUNTY ROAD 160
MOUNT HOPE, OHIO
FL PE 77945 TX PE 117868

PROFESSIONAL ENGINEER'S SEAL PROVIDED ONLY FOR VERIFICATION OF WINDLOAD CONSTRUCTION DETAILS.

PRODUCT REVISED
as complying with the Florida Building Code
NOA-No. 26-0820.09
Expiration Date 10/10/2029
By *[Signature]*
Miami-Dade Product Control

A DIVISION OF OVERHEAD DOOR CORP
3395 ADDISON DRIVE
PENSACOLA, FLORIDA 32514
(850) 474-9890


UNLESS OTHERWISE SPECIFIED
INTERPRET DIMS & TOLS PER ASME Y14.5M
ALL DIMS ARE IN INCHES
DO NOT SCALE
DIM'S CIRCLED WITH SYMBOL ARE CRITICAL TO QUALITY DESIGN
FEATURES & MUST MEET APPLICABLE IN-PROCESS INSPECTION STANDARDS.

APPROVALS
DRAWN E. CONRAD
CHECKED D. KORNISH
APPROVED
MATERIAL
FINISH
WINDLOAD SPECIFICATION OPTION CODE 2341


The Genuine, The Original.
LEWISVILLE, TEXAS
DESCRIPTION WINDLOAD MODELS
5745/5765/7565/7655/515/525, +46/-52PSF
DADE COUNTY, 16" MAX WIDTH
SIZE/DWG NO.
D D-411530
REV P-00
SCALE 1:12 UOM = EA SHEET 2 OF 4

NOTES: (UNLESS OTHERWISE SPECIFIED)


1. ONE 4" STRUT PER SECTION, AND ONE 3" STRUT PER BOTTOM SECTION, ATTACHED WITH 1/4-14X7/8" SELF DRILLING CRIMPITTE SCREWS.




TYPICAL TRACK AND JAMB FASTENERS DETAIL

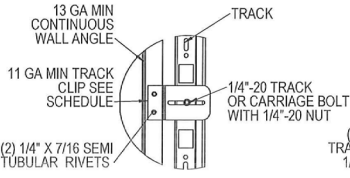

TYPICAL TRACK CLIP RIVETING DETAIL

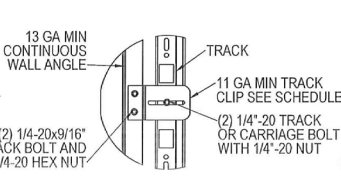

TYPICAL TRACK CLIP BOLTING DETAIL
OPTIONAL WALL ANGLE TRACK

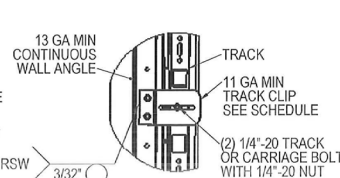

TYPICAL TRACK CLIP WELDING DETAIL

PRODUCT REVISED
as complying with the Florida
Building Code

NOA-No. 26-0820.09

Expiration Date 10/10/2029

By *RH*
Miami-Dade Product Control

(12) SECTION DOORS WITH
(12) 4" 16 GA 80 KSI U-BARS
(1) 3" 20 GA 80 KSI U-BARS
LOCATED AS SHOWN

(11) SECTION DOORS WITH
(11) 4" 16 GA 80 KSI U-BARS
(1) 3" 20 GA 80 KSI U-BARS
LOCATED AS SHOWN

(10) SECTION DOORS WITH
(10) 4" 16 GA 80 KSI U-BARS
(1) 3" 20 GA 80 KSI U-BARS
LOCATED AS SHOWN

(9) SECTION DOORS WITH
(9) 4" 16 GA 80 KSI U-BARS
(1) 3" 20 GA 80 KSI U-BARS
LOCATED AS SHOWN

(8) SECTION DOORS WITH
(8) 4" 16 GA 80 KSI U-BARS
(1) 3" 20 GA 80 KSI U-BARS
LOCATED AS SHOWN

(7) SECTION DOORS WITH
(7) 4" 16 GA 80 KSI U-BARS
(1) 3" 20 GA 80 KSI U-BARS
LOCATED AS SHOWN

(6) SECTION DOORS WITH
(6) 4" 16 GA 80 KSI U-BARS
(1) 3" 20 GA 80 KSI U-BARS
LOCATED AS SHOWN

(5) SECTION DOORS WITH
(5) 4" 16 GA 80 KSI U-BARS
(1) 3" 20 GA 80 KSI U-BARS
LOCATED AS SHOWN

(4) SECTION DOORS WITH
(4) 4" 16 GA 80 KSI U-BARS
(1) 3" 20 GA 80 KSI U-BARS
LOCATED AS SHOWN

4" STRUT OVERLAPPED ONTO HINGES,
ATTACHED WITH (2) 1/4-14x7/8" SELF
DRILLING CRIMPITTE SCREWS AT EACH
HINGE LOCATION AND (2) BETWEEN EACH
CENTER HINGE FOR EACH STRUT


DETAIL N
SCALE 1:4

3" STRUT ATTACHED WITH (2) 1/4-14x7/8"
SELF DRILLING CRIMPITTE SCREWS AT
EACH HINGE LOCATION AND (2) BETWEEN
EACH CENTER HINGE FOR EACH STRUT


DETAIL O
SCALE 1:4

STRUT LOCATIONS
SCALE 1:20

DETAIL M
SCALE 1:4




STANDARD LIFT
TRACK DETAIL




LOW HEADROOM
TRACK DETAIL

TRACK DETAIL
SCALE 1:12

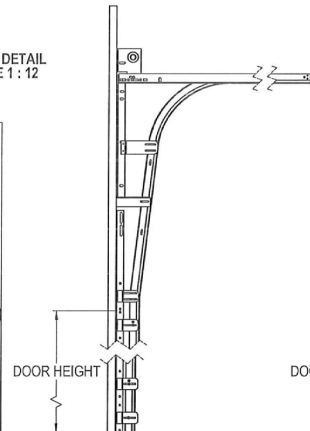


HIGH LIFT
TRACK DETAIL

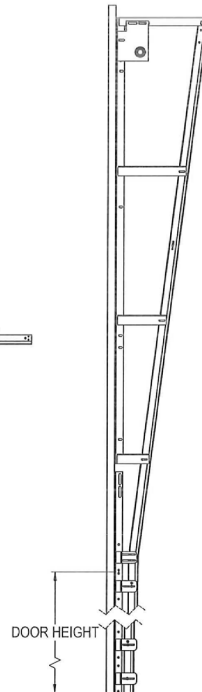

VERTICAL LIFT
TRACK DETAIL


THIRD ANGLE PROJECTION		UNLESS OTHERWISE SPECIFIED			APPROVALS		DATE		The Genuine, The Original.	
		INTERPRET DIMS & TOLS PER ASME Y14.5M			TOLERANCES:			E. CONRAD 8/28/18		
		ALL DIMS ARE IN INCHES			X = ± .1			D. KORNISH -		
		DO NOT SCALE			XX = ± .03			APPROVED -		
		DIMS CIRCLED WITH SYMBOL 'C' ARE CRITICAL TO QUALITY DESIGN			XXX = ± .010			MATERIAL -		
		FEATURES & MUST MEET APPLICABLE IN-PROCESS INSPECTION STANDARDS.			ANGULAR = ± .5°			FINISH -		
A DIVISION OF OVERHEAD DOOR CORP 3395 ADDISON DRIVE PENSACOLA, FLORIDA 32514 (850) 474-9890		DO NOT SCALE			HOLDS:			WINDLOAD SPECIFICATION OPTION CODE 2341		
		DIMS CIRCLED WITH SYMBOL 'C' ARE CRITICAL TO QUALITY DESIGN			< .0251 = +.004/- .003			WINDLOAD MODELS		
		FEATURES & MUST MEET APPLICABLE IN-PROCESS INSPECTION STANDARDS.			.0251-.0500 = +.006/- .003			5745/5765/7565/7655/515/525, +46/-52PSF		
		ALL GEOMETRY GOVERNED BY 3D CAD DATABASE:			> .500 = +.008/- .003			DADE COUNTY, 16" MAX WIDTH		
								SIZE/DWG NO.		
								D D-411530		
								SCALE 1:12 UOM = EA SHEET 3 OF 4		



DWAYNE J. KORNISH, PE
4576 COUNTY ROAD 160
MOUNT HOPE, OHIO
FL PE 77945 TX PE 117868


PROFESSIONAL ENGINEER'S SEAL PROVIDED ONLY FOR
VERIFICATION OF WINDLOAD CONSTRUCTION DETAILS.

NOTES: (UNLESS OTHERWISE SPECIFIED)
1. FOR DIMENSIONS AND NOTE REFERENCES, REFER TO INDIVIDUAL DRAWINGS.

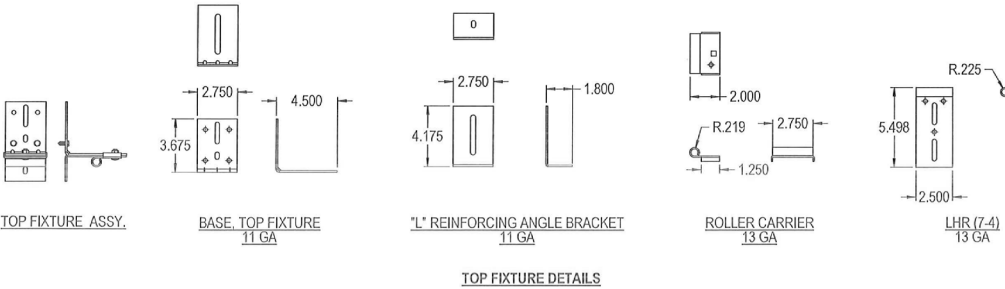


PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 26-0820.09
Expiration Date 10/10/2029


By *[Signature]*
Miami-Dade Product Control

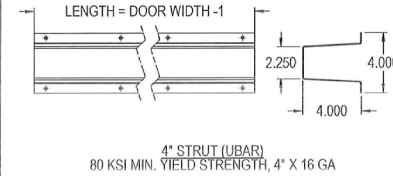


STRUT DETAILS

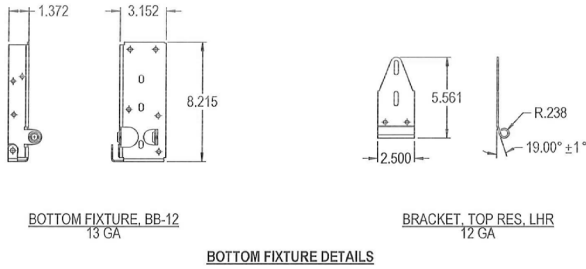

BOTTOM FIXTURE DETAILS

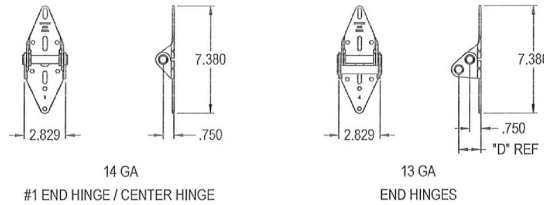


HINGE DETAILS

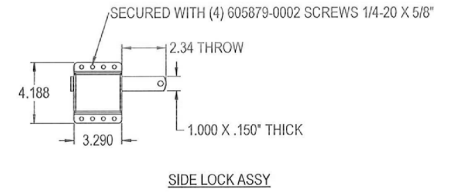

SIDE LOCK ASSY

LOCK DETAILS

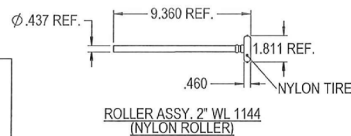


ROLLER ASSY, 2" WL 1144
(NYLON ROLLER)




ROLLER ASSY, 2" WL 1144
(STEEL ROLLER)


ROLLER STEM ASSY DETAILS



ROLLER ASSY, 3" WL 1144

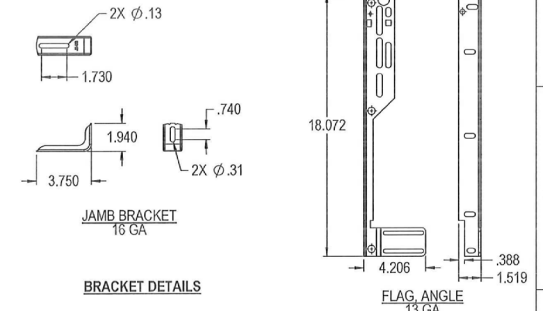

BRACKET DETAILS



DWAYNE J. KORNISH, PE
4576 COUNTY ROAD 160
MOUNT HOPE, OHIO
FL PE 77945 TX PE 117868

PROFESSIONAL ENGINEER'S SEAL PROVIDED ONLY FOR
VERIFICATION OF WINDLOAD CONSTRUCTION DETAILS.

PRODUCT RENEWED
as complying with the Florida
Building Code
NOA-No. 24-0814.07
Expiration Date 10/10/2029
By *[Signature]*
Miami-Dade Product Control

THIRD ANGLE PROJECTION 		UNLESS OTHERWISE SPECIFIED		APPROVALS DATE		The Genuine. The Original.									
		INTERPRET DIMS & TOLS PER ASME Y14.5M ALL DIMS ARE IN INCHES DO NOT SCALE DIMS CIRCLED WITH SYMBOL "C" ARE CRITICAL TO QUALITY DESIGN FEATURES & MUST MEET APPLICABLE IN-PROCESS INSPECTION STANDARDS.		TOLERANCES: X = ± .1 XX = ± .03 XXX = ± .010 ANGULAR = ± .5° HOLES: < Ø.251 = +.004/- .003 Ø.251-Ø.500 = +.006/- .003 > Ø.500 = +.008/- .003 ALL GEOMETRY GOVERNED BY 3D CAD DATABASE:		DRAWN E. CONRAD 8/28/18 CHECKED D. KORNISH APPROVED MATERIAL FINISH WINDLOAD SPECIFICATION OPTION CODE 2341		OVERHEAD DOOR® LEWISVILLE, TEXAS DESCRIPTION WINDLOAD MODELS 5745/5765/7565/515/525, +46/-52PSF DADE COUNTY, 162" MAX WIDTH SIZE DWG NO. D-411530		REV P-00					
A DIVISION OF OVERHEAD DOOR CORP 3395 ADDISON DRIVE PENSACOLA, FLORIDA 32514 (850) 474-9890										SCALE 1:12		UOM =		SHEET 4 OF 4	