



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

New Age Windows & Doors Corp.
7196 NW 77 Terr
Medley, FL 33166

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/ or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "HRW-300" Aluminum Horizontal Rolling Window – N.I.

APPROVAL DOCUMENT: Drawing No. **W99-80**, titled "Series HRW-300 Alum Horiz. Rolling Wdw. (N.I.)" sheets 1 through 6 of 6, dated 11/30/99, with revision **M** dated 08/14/26, prepared by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: None

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/ or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.


ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises NOA No. 25-0203.04** and consists of this page 1 and evidence pages E-1, E-2 and E-3, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**




9/15/26

NOA No. 26-0824.08
Expiration Date: December 14, 2029
Approval Date: September 24, 2026
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED


1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's

A. DRAWINGS

1. Manufacturer's die drawings and sections.
(Submitted under NOA No. 00-0519.02)
2. Drawing No. **W99-80** titled "Series HRW-300 Alum Horiz. Rolling Wdw. (N.I.)", sheets 1 through 6 of 6, dated 11/30/99, with revision **L** dated 06/07/23, prepared by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.
(Submitted under NOA No. 23-0710.12)

B. TESTS

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, per ASTM F588, and FBC TAS 202-94
along with marked-up drawings and installation diagram of an aluminum sliding glass window, prepared by QAI Laboratories, Test Report No. **MED-1123aR1**, dated 01/27/25, signed and sealed by Idalmis Ortega, P.E.
(Submitted under NOA No. 25-0203.04)
2. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, per ASTM F588, and FBC TAS 202-94
along with marked-up drawings and installation diagram of an aluminum sliding glass window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-5670**, dated 08/08/08, signed and sealed by Carlos S. Rionda, P.E.
(Submitted under NOA No. 08-0926.11)
3. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, per ASTM F588, and FBC TAS 202-94
along with marked-up drawings and installation diagram of an aluminum horizontal sliding window, prepared by Fenestration Testing Laboratory, Inc., Test Reports No. **FTL-2409, FTL-2412 and FTL-2413**, all dated 11/17/99, witnessed by Jose D. Mitrani, P.E. and Aldo P. Gonzales, P.E., signed and sealed by Aldo P. Gonzales, P.E.
(Submitted under NOA No. 00-0519.02)

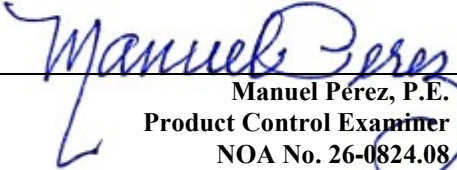
Manuel Pérez, P.E.
Product Control Examiner
NOA No. 26-0824.08
Expiration Date: December 14, 2029
Approval Date: September 24, 2026

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's (CONTINUED)

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC 5th Edition (2014), dated 08/06/14 and updated on 09/02/20 to comply with FBC 7th Edition (2020), prepared by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.
Previous anchor verification calculations and structural analysis checked to comply with FBC 8th Edition (2023), dated 01/24/25, prepared by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.
(Submitted under NOA No. 25-0203.04)
2. Glazing complies with **ASTM E1300-09**.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS


1. None.

F. STATEMENTS

1. Statement letter of conformance, complying with **FBC 8th Edition (2023)** and of no financial interest, dated January 24, 2025, issued by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.
(Submitted under NOA No. 25-0203.04)
2. Letter from manufacturer requesting a 1-year extension to allow time to perform verification test, dated June 9, 2023, issued by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.
(Submitted under NOA No. 23-0710.12)
3. Testing agreement letter dated June 20, 2023, between QAI Laboratories and New Age Windows and Doors, issued by QAI Laboratories and signed by Lusinda Delgado, Technical Report Writer.
(Submitted under NOA No. 23-0710.12)

G. OTHERS

1. Notice of Acceptance No. **23-0710.12**, issued to New Age Windows & Doors Corp. for their Series "HRW-300" Aluminum Horizontal Rolling Window – N.I., approved on 07/27/23 and expiring on 12/14/24.

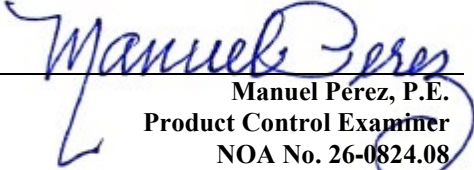
Manuel Perez, P.E.
Product Control Examiner
NOA No. 26-0824.08
Expiration Date: December 14, 2029
Approval Date: September 24, 2026

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

2. NEW EVIDENCE SUBMITTED

A. DRAWINGS

1. Drawing No. **W99-80** titled “Series HRW-300 Alum Horiz. Rolling Wdw. (N.I.)”, sheets 1 through 6 of 6, dated 11/30/99, with revision **M** dated 08/14/26, prepared by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.

B. TESTS

1. None.

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC 8th Edition (2023) and FBC 9th Edition (2026), dated 08/14/26, prepared by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.
2. Glazing complies with **ASTM E1300-16**.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS


1. None.

F. STATEMENTS


1. Statement letter of conformance, complying with **FBC 8th Edition (2023)**, with **FBC 9th Edition (2026)**, inclusive special limitation use of anchors for saltwater environment to comply with chapter 17; and of no financial interest, dated August 14, 2026, issued by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.

G. OTHERS

1. Notice of Acceptance No. **25-0203.04**, issued to New Age Windows & Doors Corp. for their Series “HRW-300” Aluminum Horizontal Rolling Window – N.I., approved on 02/20/25 and expiring on 12/14/29.

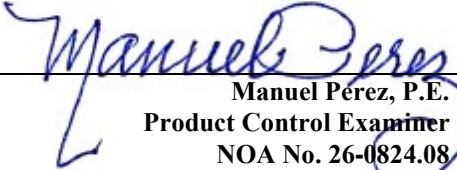
Manuel Pérez, P.E.
Product Control Examiner
NOA No. 26-0824.08
Expiration Date: December 14, 2029
Approval Date: September 24, 2026

The following pages in this document were submitted by the manufacturer (third party) to represent the product being approved and establish the limits of use. The pages may include technical drawings, schematics and installation details.

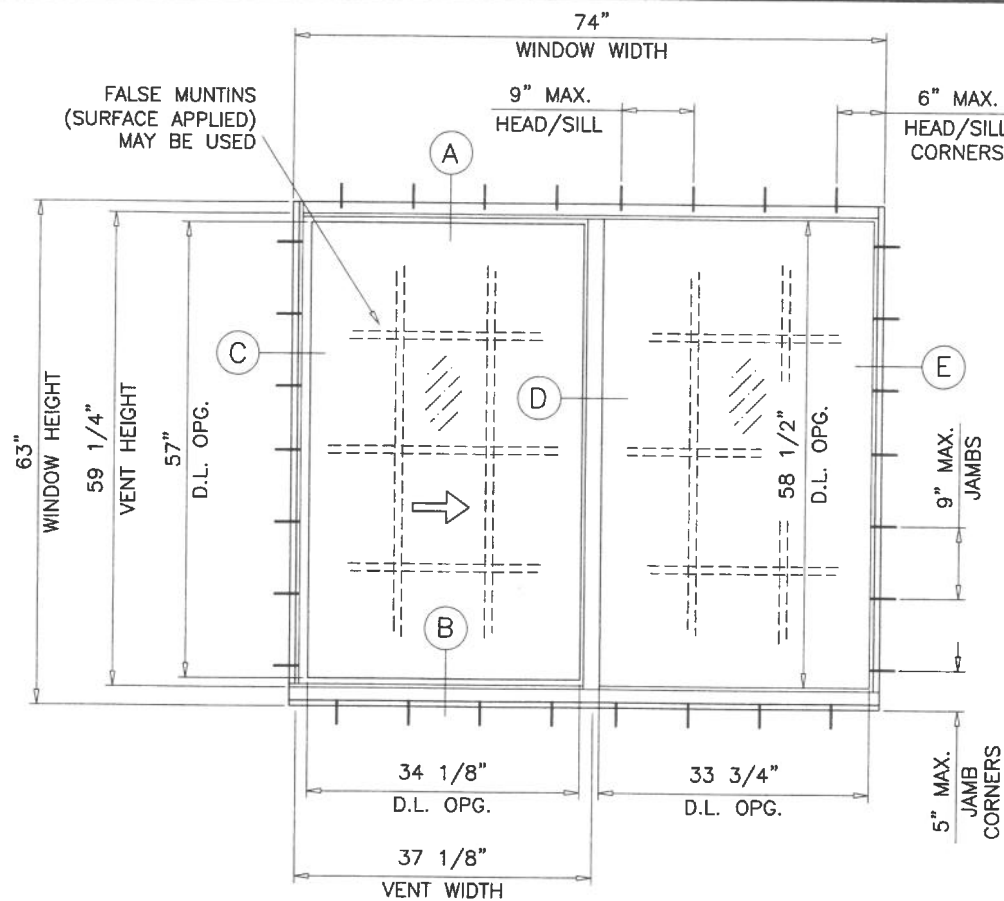


DAYLITE OPENINGS:

$$DLO \text{ WIDTH} = \frac{\text{WINDOW WIDTH} - 6.125}{2} \text{ (FIXED \& VENT)}$$

$$DLO \text{ HEIGHT} = \text{WINDOW HEIGHT} - 4.562 \text{ (FIXED LITE)}$$

$$= \text{WINDOW HEIGHT} - 5.938 \text{ (VENT.)}$$

TYPICAL ELEVATIONS

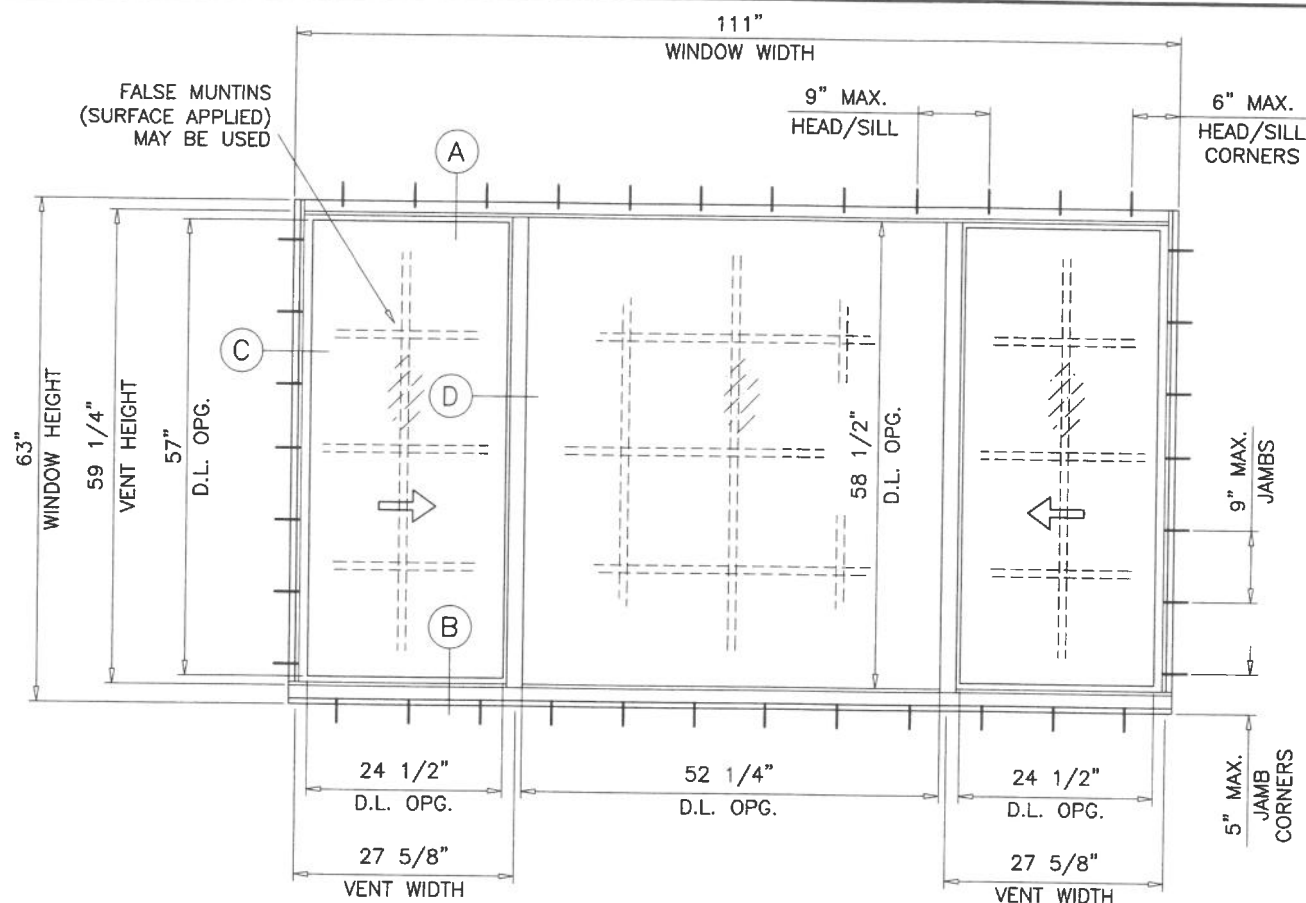

DAYLITE OPENINGS:

$$DLO \text{ WIDTH} = \frac{\text{WINDOW WIDTH} - 9.750}{2} \text{ (FIXED LITE)}$$

$$= \frac{\text{WINDOW WIDTH} - 9.750}{4} \text{ (VENT)}$$

$$DLO \text{ HEIGHT} = \text{WINDOW HEIGHT} - 4.562 \text{ (FIX. LITE)}$$

$$= \text{WINDOW HEIGHT} - 5.938 \text{ (VENT.)}$$

SERIES HRW-300

ALUMINUM HORIZONTAL ROLLING WDW.

DESIGN LOAD RATINGS FOR THESE WINDOWS TO BE AS PER CHARTS SHOWN ON SHEET 2.

APPROVAL APPLIES TO SINGLE UNITS OR SIDE BY SIDE

COMBINATIONS OF H.R./H.R. OR HORIZONTAL ROLLING WITH OTHER MIAMI-DADE COUNTY APPR'D WINDOWS USING MIAMI-DADE COUNTY APPROVED MULLIONS IN BETWEEN.

LOWER DESIGN PRESSURE FROM WINDOWS OR MULLION APPROVAL WILL APPLY TO ENTIRE SYSTEM.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE 2023 (8TH EDITION)/2026 (9TH EDITION) FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

1BY OR 2BY WOOD BUCKS & BUCK FASTENERS BY OTHERS, MUST BE DESIGNED AND INSTALLED ADEQUATELY TO TRANSFER APPLIED PRODUCT LOADS TO THE BUILDING STRUCTURE.

ANCHORS SHALL BE CORROSION RESISTANT, SPACED AS SHOWN ON DETAILS AND INSTALLED PER MANUF'S INSTRUCTIONS. SPECIFIED EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.


ALL SHIMS TO BE LOAD-BEARING, (HIGH DENSITY PLASTIC/COMPOSITE, METAL OR OTHER RIGID MATERIALS).

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE 2023/2026 FLORIDA BLDG. CODE & ADOPTED STANDARDS.

THIS PRODUCT APPROVAL IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT, i.e. LIFE SAFETY OF THIS PRODUCT, ADEQUACY OF STRUCTURE RECEIVING THIS PRODUCT AND SEALING AROUND OPENING FOR WATER INFILTRATION RESISTANCE ETC.

CONDITIONS NOT SHOWN IN THIS DRAWING ARE TO BE ANALYZED SEPARATELY, AND TO BE REVIEWED BY BUILDING OFFICIAL.

DESIGN LOADS SHOWN ARE BASED ON 'ALLOWABLE STRESS DESIGN (ASD)'.

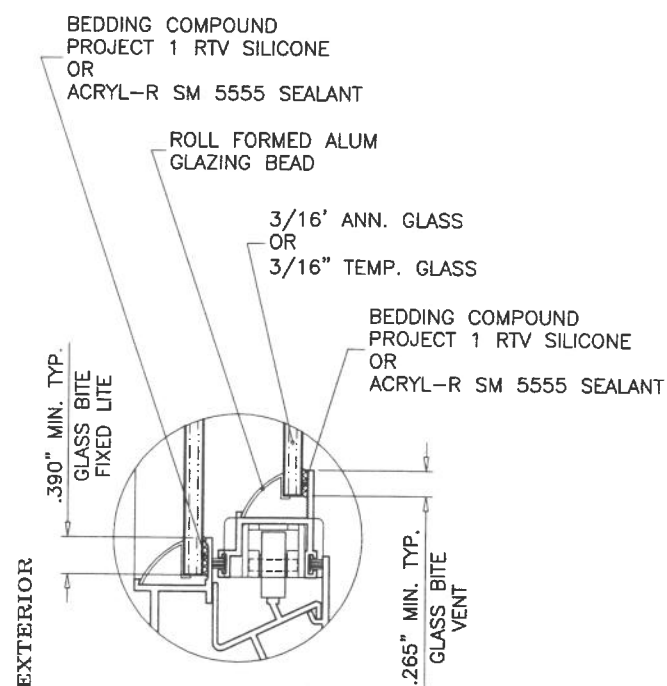

GLAZING DETAIL

FASTENERS AND CONNECTORS (AS APPLICABLE) SHOWN IN THIS APPROVAL MAY NOT MEET CORROSION RESISTANCE REQUIREMENTS FOR COASTAL OR SALT WATER EXPOSURE ZONES. COMPLIANCE WITH THESE CONDITIONS TO BE CHECKED PER FBC 1711.

INSTALLATION OF THIS PRODUCT IN THE HVHZ AREA REQUIRES THE USE OF APPROVED SHUTTERS OR EXTERNAL PROTECTION DEVICES COMPLYING WITH HVHZ REQUIREMENTS.

INSTALLATION OF THIS SYSTEM OUTSIDE THE HVHZ AREA SHALL MEET THE APPLICABLE REQUIREMENTS FOR WIND BORNE DEBRIS PROTECTION.

PRODUCT REVISED

As complying with the Florida Building Code


NOA-No. **26-0824.08**

Expiration Date: **12/14/2029**

By: *Manuel Perez*

Miami-Dade Product Control

AUG 18 2026

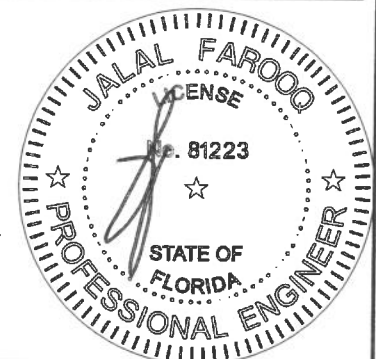

af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173 (C.A.N. 3538)
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W99-BONA

SERIES HRW-300 ALUM HORIZ. ROLLING WDW. (N.I.)

New Age Windows & Doors Corp.

7196 N.W. 77TH TERRACE
 MEDLEY, FL. 33166

TEL. (305) 889-0703 FAX. (305) 889-0710

revisions:	no	date	by	description
	I	08.08.14		UPDATED TO 2014 FBC
	J	10.12.17		UPDATED TO 2017 FBC
	K	07.14.20		UPDATED TO 2020 FBC
	L	06.07.23		UPDATED TO 2023 FBC
	M	08.14.26		UPDATED TO 2026 FBC

date: 11-30-99

scale: 1/2"=1'-0"

dr. by: TARIQ

chk. by:


drawing no.

W99-80

sheet 1 of 6

DESIGN LOAD CAPACITY - PSF (XO OR OX SIZES)								
WINDOW DIMS. WIDTH HEIGHT		A	ANCHORS TYPE 'A'		ANCHORS TYPE 'A'		ANCHORS TYPE 'B'	
			3/16" ANN. GLASS		3/16" TEMP. GLASS		3/16" TEMP. GLASS	
			EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
26-1/2"	26" (3)	3	70.0	125.0	70.0	210.0	70.0	210.0
37"		4	70.0	120.2	70.0	153.9	70.0	153.9
53-1/8"		6	70.0	86.6	70.0	110.8	70.0	110.8
74"		8	70.0	86.6	70.0	110.8	70.0	110.8
26-1/2"	38-3/8" (4)	3	70.0	125.0	70.0	194.8	70.0	194.8
37"		4	70.0	110.8	70.0	141.5	70.0	141.5
53-1/8"		6	70.0	79.0	70.0	101.1	70.0	101.1
74"		8	54.9	54.9	70.0	70.3	70.0	70.3
26-1/2"	50-5/8" (6)	3	70.0	125.0	70.0	158.0	70.0	186.1
37"		4	70.0	102.7	70.0	121.0	70.0	131.2
53-1/8"		6	70.0	75.4	70.0	94.4	70.0	96.3
74"		8	54.7	54.7	70.0	70.0	70.0	70.0
26-1/2"	63" (6)	3	70.0	121.0	70.0	121.0	70.0	151.5
37"		4	70.0	91.1	70.0	91.2	70.0	114.1
53-1/8"		6	60.7	60.7	69.1	69.1	70.0	86.4
74"		8	47.1	47.1	55.9	55.9	70.0	70.0
24"	24" (3)	3	70.0	125.0	70.0	210.0	70.0	210.0
36"		4	70.0	124.3	70.0	159.0	70.0	159.0
48"		5	70.0	95.5	70.0	122.2	70.0	122.2
60"		7	70.0	95.5	70.0	122.2	70.0	122.2
72"	36" (4)	8	70.0	95.5	70.0	122.2	70.0	122.2
24"		3	70.0	125.0	70.0	210.0	70.0	210.0
36"		4	70.0	115.9	70.0	148.0	70.0	148.0
48"		5	70.0	88.7	70.0	113.5	70.0	113.5
60"	48" (5)	7	68.9	68.9	70.0	88.2	70.0	88.2
72"		8	59.0	59.0	70.0	75.6	70.0	75.6
24"	60" (6)	3	70.0	125.0	70.0	183.6	70.0	210.0
36"		4	70.0	106.7	70.0	132.7	70.0	136.3
48"		5	70.0	83.1	70.0	106.1	70.0	106.1
60"		7	68.9	68.9	70.0	88.2	70.0	88.2
72"	72" (8)	8	56.4	56.4	70.0	72.1	70.0	72.1
24"		3	70.0	125.0	70.0	139.9	70.0	175.1
36"		4	70.0	98.6	70.0	99.2	70.0	124.1
48"		5	70.0	74.6	70.0	79.4	70.0	99.3
60"	72" (8)	7	55.8	55.8	68.1	68.1	70.0	82.7
72"		8	50.9	50.9	61.2	61.2	70.0	72.1


A = NO. OF ANCHORS PER HEAD & SILL
() = NO. OF ANCHORS PER JAMB

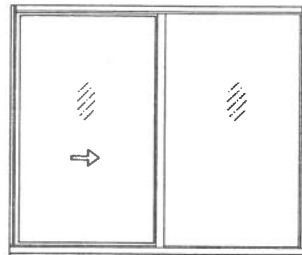

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-16 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

DESIGN LOAD CAPACITY - PSF (XOX SIZES)								
WINDOW DIMS. WIDTH HEIGHT		A	ANCHORS TYPE 'A'					
			3/16" ANN. GLASS		3/16" TEMP. GLASS			
			EXT.(+)	INT.(-)	EXT.(+)	INT.(-)		
74"	26" (3)	8	70.0	86.7	70.0	86.7		
106-1/4"		12	70.0	86.6	70.0	86.6		
111"		12	70.0	86.6	70.0	86.6		
74"	38-3/8" (4)	8	70.0	86.7	70.0	86.7		
106-1/4"		12	57.7	57.7	57.7	57.7		
111"		12	55.0	55.0	55.0	55.0		
74"	50-5/8" (6)	8	70.0	80.3	70.0	80.3		
106-1/4"		12	57.7	57.7	57.7	57.7		
111"		12	55.0	55.0	55.0	55.0		
74"	63" (6)	8	69.8	69.8	70.0	72.5		
106-1/4"		12	47.7	47.7	56.5	56.5		
111"		12	47.1	47.1	55.0	55.0		
72"	24" (3)	8	70.0	95.5	70.0	95.5		
84"		9	70.0	95.5	70.0	95.5		
96"		11	70.0	95.5	70.0	95.5		
108"	36" (4)	12	70.0	95.5	70.0	95.5		
72"		8	70.0	89.5	70.0	89.5		
84"		9	70.0	75.0	70.0	75.0		
96"	48" (5)	11	64.6	64.6	64.6	64.6		
108"		12	59.0	59.0	59.0	59.0		
72"	60" (6)	8	70.0	83.6	70.0	83.6		
84"		9	70.0	74.6	70.0	74.6		
96"		11	64.6	64.6	64.6	64.6		
108"	72" (8)	12	56.7	56.7	56.7	56.7		
72"		8	70.0	75.8	70.0	78.3		
84"		9	59.9	59.9	68.7	68.7		
96"	72" (8)	11	53.6	53.6	62.0	62.0		
108"		12	50.9	50.9	56.7	56.7		

A = NO. OF ANCHORS PER HEAD & SILL
() = NO. OF ANCHORS PER JAMB

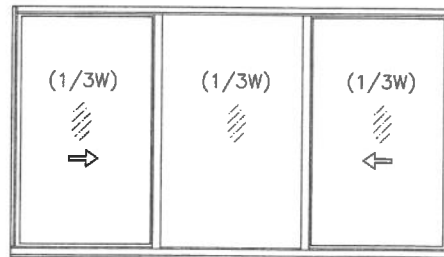


OPERATING VENTS TO BE 1/3 OF THE WINDOW WIDTH

ALL EXTERIOR(+) LOADS SHOWN ON THIS SHEET ARE FOR WINDOWS
WITH APPLIED RISER AT FRAME SILL.
FOR STD. SILL (NO RISER) LIMIT EXTERIOR(+) LOADS TO 56.7 PSF
SEE DETAIL ON SHEET 3.

DESIGN LOAD CAPACITY - PSF (XOX SIZES)								
WINDOW DIMS. WIDTH HEIGHT		A	ANCHORS TYPE 'A'					
			3/16" ANN. GLASS AT VENTS AND FIX. LITE		3/16" ANN. GLASS AT VENTS 3/16" TEMP. GLASS AT FIX. LITE		3/16" TEMP. GLASS AT VENTS AND FIX. LITE	
			EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
74"	26" (3)	8	70.0	111.2	70.0	111.2	70.0	111.2
106-1/4"		12	70.0	80.5	70.0	95.3	70.0	95.3
111"		12	70.0	77.2	70.0	94.0	70.0	94.0
74"	38-3/8" (4)	8	70.0	84.9	70.0	89.5	70.0	89.5
106-1/4"		12	59.8	59.8	70.0	72.3	70.0	72.3
111"		12	56.6	56.6	70.0	70.6	70.0	70.6
74"	50-5/8" (6)	8	64.5	64.5	70.0	75.9	70.0	75.9
106-1/4"		12	48.5	48.5	62.4	62.4	62.4	62.4
111"		12	47.1	47.1	62.4	62.4	62.4	62.4
74"	63" (6)	8	47.9	47.9	68.2	68.2	68.2	68.2
106-1/4"		12	41.0	41.0	56.1	56.1	56.1	56.1
111"		12	39.6	39.6	55.0	55.0	55.0	55.0
72"	24" (3)	8	70.0	118.9	70.0	118.9	70.0	118.9
84"		9	70.0	110.7	70.0	110.7	70.0	110.7
96"		11	70.0	101.1	70.0	105.5	70.0	105.5
108"	36" (4)	12	70.0	91.0	70.0	101.9	70.0	101.9
72"		8	70.0	91.9	70.0	92.3	70.0	92.3
84"		9	70.0	80.9	70.0	87.7	70.0	87.7
96"	48" (5)	11	70.0	70.1	70.0	79.5	70.0	79.5
108"		12	60.4	60.4	70.0	74.3	70.0	74.3
72"	60" (6)	8	70.0	70.0	70.0	79.6	70.0	79.6
84"		9	62.6	62.6	70.0	74.7	70.0	74.7
96"		11	54.7	54.7	66.6	66.6	66.6	66.6
108"	72" (8)	12	50.6	50.6	65.6	65.6	65.6	65.6
72"		8	51.8	51.8	70.0	71.0	70.0	71.0
84"		9	49.2	49.2	64.3	64.3	64.3	64.3
96"	72" (8)	11	46.0	46.0	60.3	60.3	60.3	60.3
108"		12	42.1	42.1	58.1	58.1	58.1	58.1


A = NO. OF ANCHORS PER HEAD & SILL
() = NO. OF ANCHORS PER JAMB

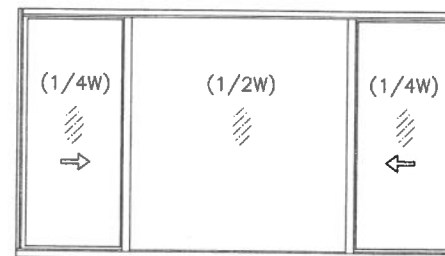

OPERATING VENTS TO BE 1/4 OF THE WINDOW WIDTH

PRODUCT REVISED
As complying with the Florida
Building Code
NOA-No. **26-0824.08**
Expiration Date: **12/14/2029**
By: *Manuel Perez*
Miami-Dade Product Control

AUG 18 2026

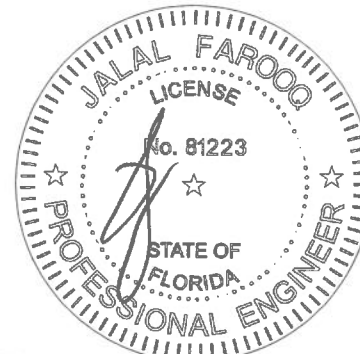

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W99-80NA


SERIES HRW-300 ALUM. HORIZ. ROLLING WDW. (N.I.)
New Age Windows & Doors Corp.
7196 N.W. 77TH TERRACE
MEDLEY, FL. 33166
TEL. (305) 889-0703 FAX. (305) 889-0710

revisions:	no	date	by	description
	I	08.08.14		NO CHANGE THIS SHEET
	J	10.12.17		UPDATED TO 2017 FBC
	K	07.14.20		EDITORIAL CHANGES
	L	06.07.23		NO CHANGE THIS SHEET
	M	08.14.26		UPDATED TO 2026 FBC

date: 11-30-99
scale: 1/2"=1'-0"
dr. by: TARIQ
chk. by:

drawing no.
W99-80


sheet 2 of 6

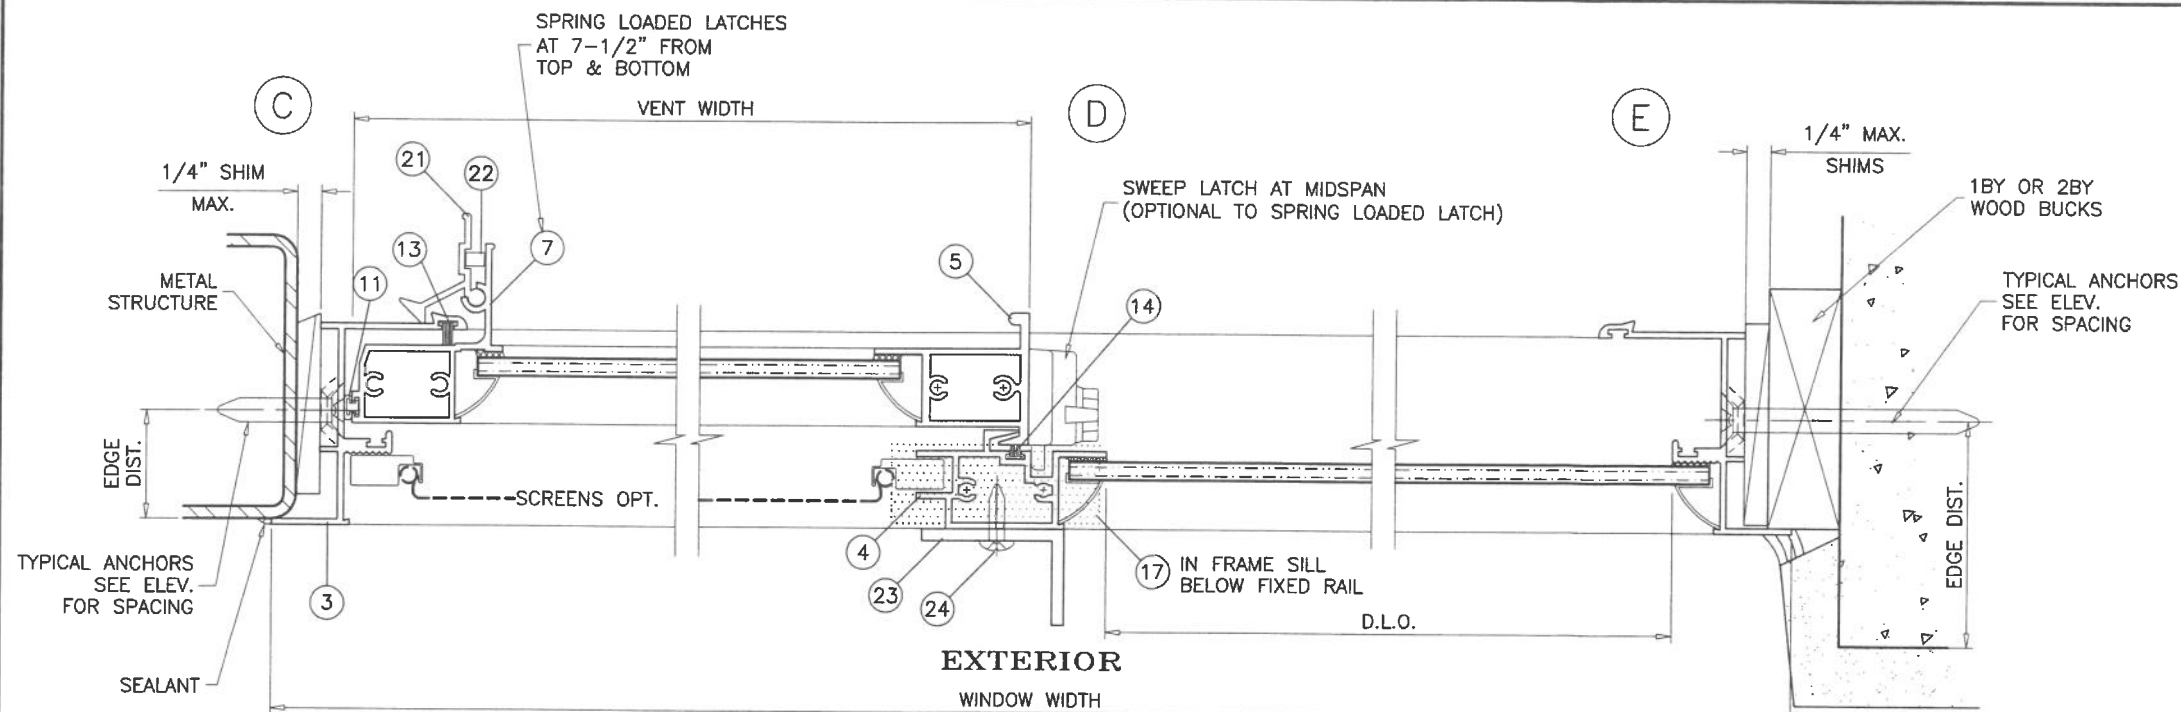

EXTERIOR

WINDOW WIDTH


XO LAYOUT
OX OPPOSITE

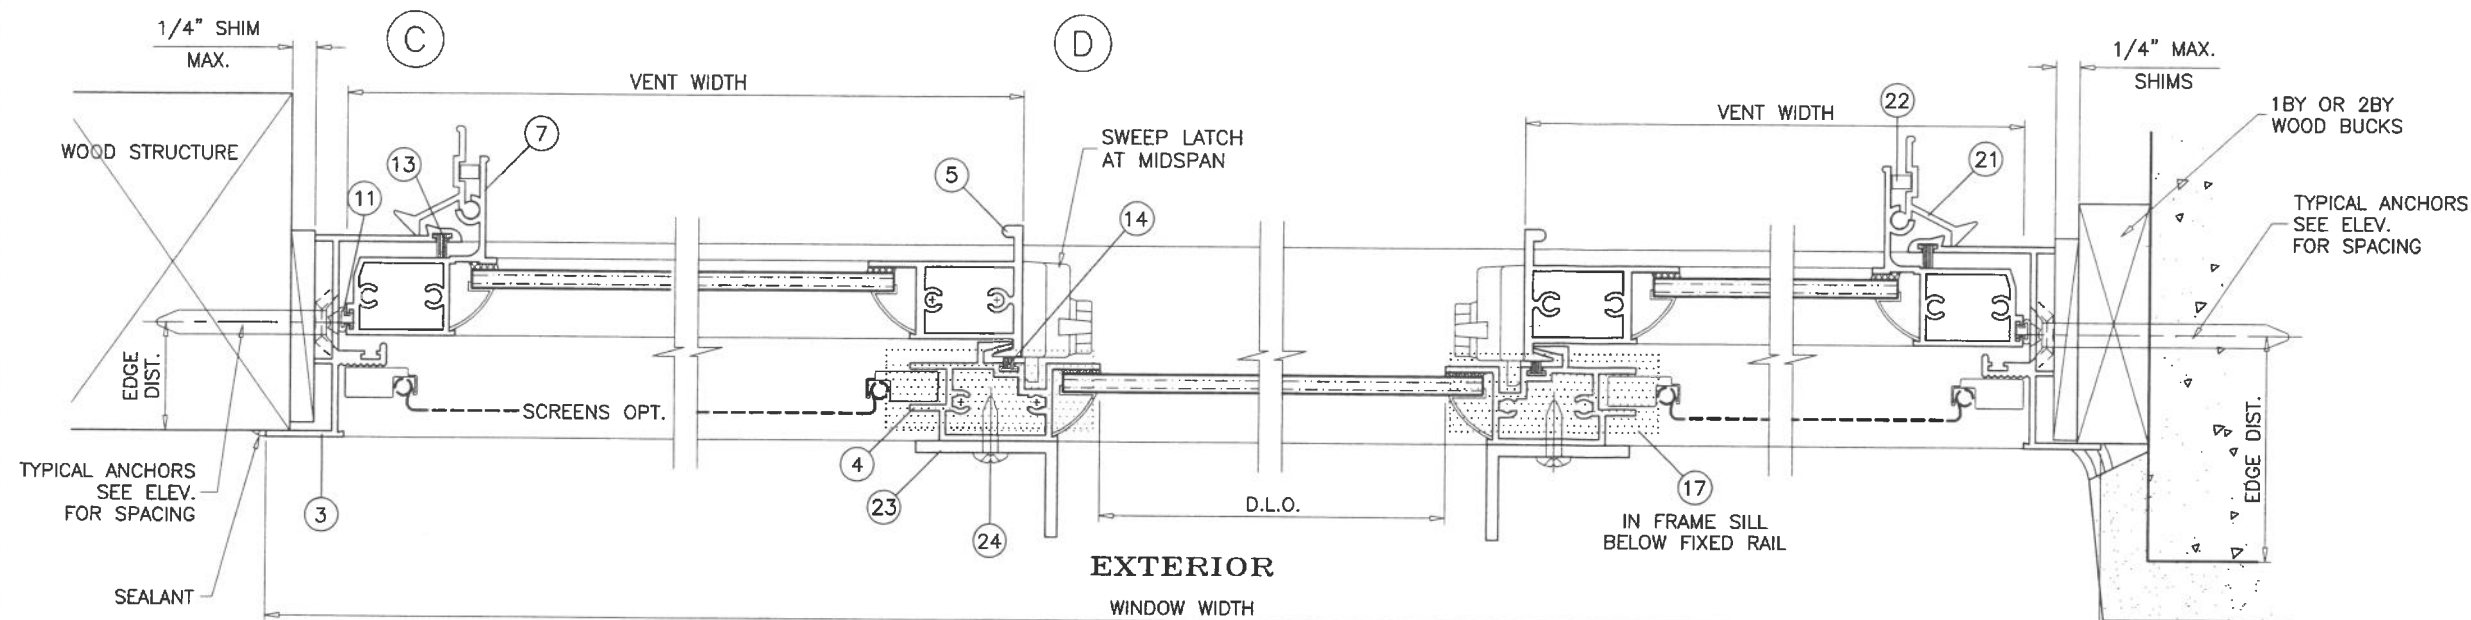

EXTERIOR


WINDOW WIDTH

XOX LAYOUT

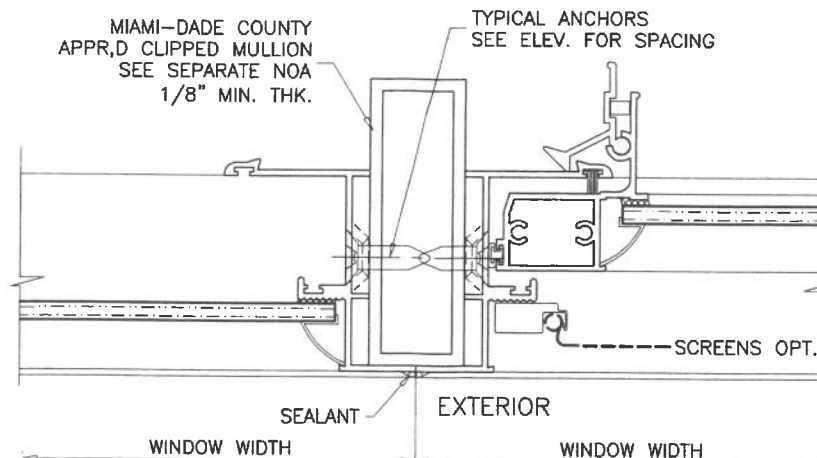

PRODUCT REVISED
As complying with the Florida Building Code
NOA-No. **26-0824.08**
Expiration Date: **12/14/2029**
By: *Manuel Fern*
Miami-Dade Product Control

AUG 18 2026

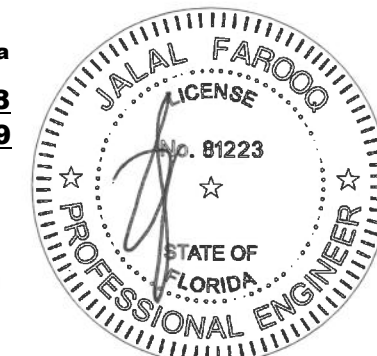


afC
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL W99-80NA

SERIES HRW-300 ALUM. HORIZ. ROLLING WDW. (N.I.)
New Age Windows & Doors Corp.
7196 N.W. 77TH TERRACE
MEDLEY, FL. 33166
TEL. (305) 889-0703 FAX. (305) 889-0710


revisions:		no	date	by	description
I	08.08.14				UPDATED TO 2014 FBC
J	10.12.17				UPDATED TO 2017 FBC
K	07.14.20				EDITORIAL CHANGES
L	06.07.23				NO CHANGE THIS SHEET
M	08.14.26				NO CHANGE THIS SHEET

date:	11-30-99
scale:	1/2" = 1"
dr. by:	TARIQ
chk. by:	


drawing no.	W99-80
sheet	4 of 6

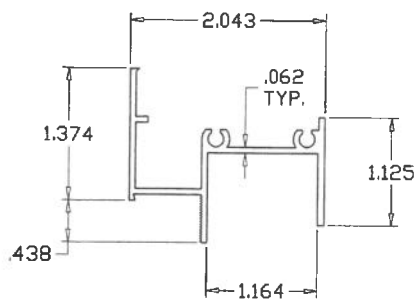


FRAME HEAD

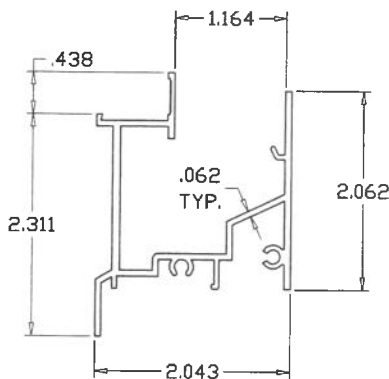


FRAME SILL




SILL TRACK

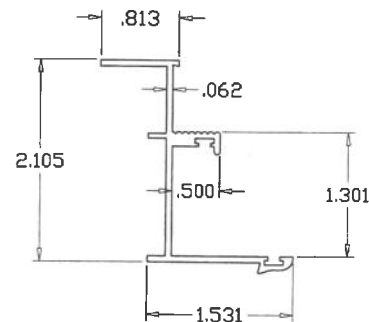


FRAME JAMB




VENT TOP/BOTTOM RAIL




VENT LATCH

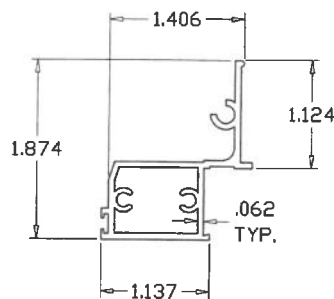

JAMB STILE

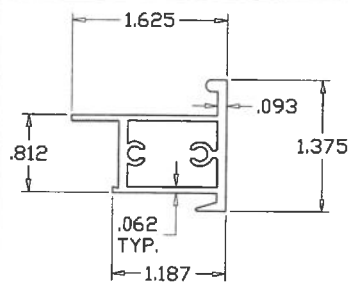


MEETING RAIL

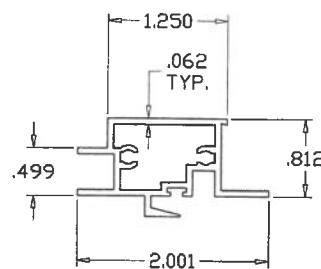

FIXED MTC. RAIL

ITEM	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	4386	1	FRAME HEAD	6063-T6	-
2	NAS-101	1	FRAME SILL	6063-T6	-
3	4333	2	FRAME JAMB	6063-T6	-
4	4331	1/ VENT	FIXED RAIL	6063-T6	-
5	BA-4638	1/ VENT	VENT MEETING RAIL	6063-T5	-
6	BA-4425	2/ VENT	TOP AND BOTTOM RAIL	6063-T5	-
7	43907	1/ VENT	JAMB STILE	6063-T6	-
8	069	AS REQD.	GLAZING BEAD	ALUMINUM	ROLL FORMED
9	#10 X 1"	AS REQD.	FRAME ASSEMBLY SCREWS	-	P.H. PHILLIPS SMS
10	#8 X 2-1/2"	2	FIX. RAIL SILL SCREWS (SILL END)	-	P.H. PHILLIPS SMS
11	-	AS REQD.	VENT JAMB RAIL W'STRIPPING	VINYL	1/4" DIA. BULB
12	W-3331	AS REQD.	WEATHERSTRIPPING	-	PILE WITH PLASTIC FIN
13	-	AS REQD.	WEATHERSTRIPPING	-	PILE WITH PLASTIC FIN
14	-	AS REQD.	FIN SEAL WEATHERSTRIPPING	-	-
15	NAW-45	1/ WEEP	BAFFLE	NYLON	-
16	#8 X 3/4"	2/ CORNER	VENT ASSEMBLY SCREWS	-	P.H. PHILLIPS SMS
17	-	-	ADHESIVE BACK CLOSED CELL FOAM	-	1/2" X 5/8" X 2-3/16" LONG
18	NAW-46	2/ VENT	VENT ROLLER HOUSING & GUIDE	NYLON	AT EACH END
19	1801	2/ VENT	VENT ROLLER/WHEEL	ST. STEEL	-
20	4332	1	SILL TRACK INSERT	6063-T5	-
21	44300	2/ VENT	VENT LATCH	6063-T6	AT 7-1/2" FROM ENDS
22	SP-27A	1/ LATCH	VENT LATCH SPRING	ST. STEEL	-
23	-	AS REQD.	FIX. RAIL REINFORCING ANGLE, FULL LENGTH	ALUMINUM	1" X 1-1/2" X 1/8"
24	#10 X 3/4"	AS REQD.	REINF. ANGLE SCREWS AT 10" O.C.	ST. STEEL	TRUSS HEAD SELF DRILLING


PRODUCT REVISED
As complying with the Florida
Building Code
NOA-No. **26-0824.08**
Expiration Date: **12/14/2029**
By: *Manuel Ferns*
Miami-Dade Product Control
AUG 18 2026

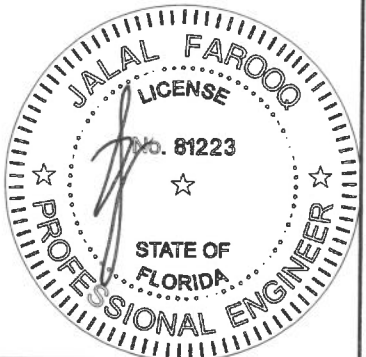


af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP - ANL \ W99 - 80NA

SERIES HRW-300 ALUM. HORIZ. ROLLING WDW. (N.I.)
New Age Windows & Doors Corp.
7196 N.W. 77TH TERRACE
MEDLEY, FL. 33166
TEL. (305) 889-0703 FAX. (305) 889-0710


revisions:		by description	
no	date	no	date
I	08.08.14	NO CHANGE THIS SHEET	
J	10.12.17	UPDATED TO 2017 FBC	
K	07.14.20	EDITORIAL CHANGES	
L	06.07.23	NO CHANGE THIS SHEET	
M	08.14.26	NO CHANGE THIS SHEET	
date: 11-30-99		scale: 1/2" = 1"	
		dr. by: TARIQ	
		chk. by:	
drawing no.		W99-80	
sheet 5 of 6			

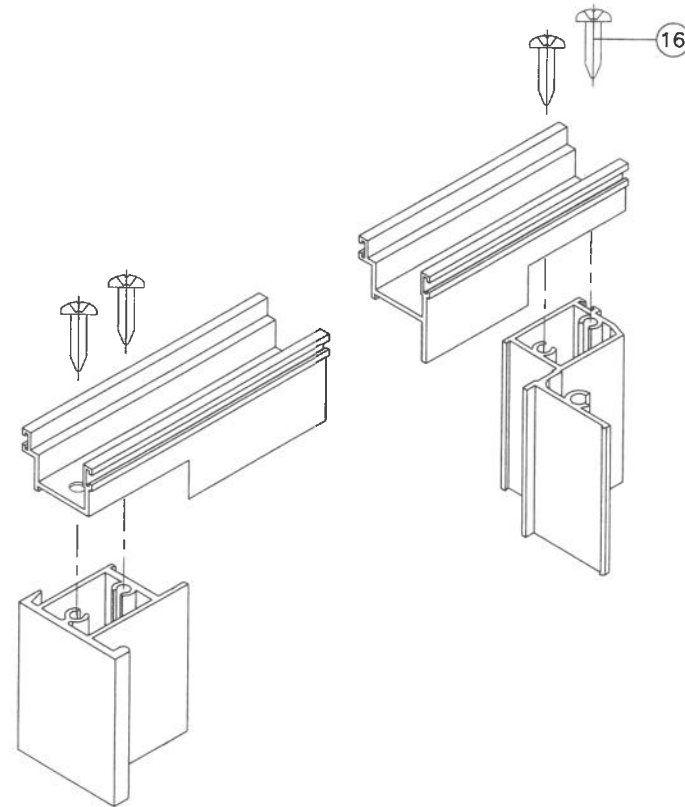


VENT TOP/BOTTOM CORNERS

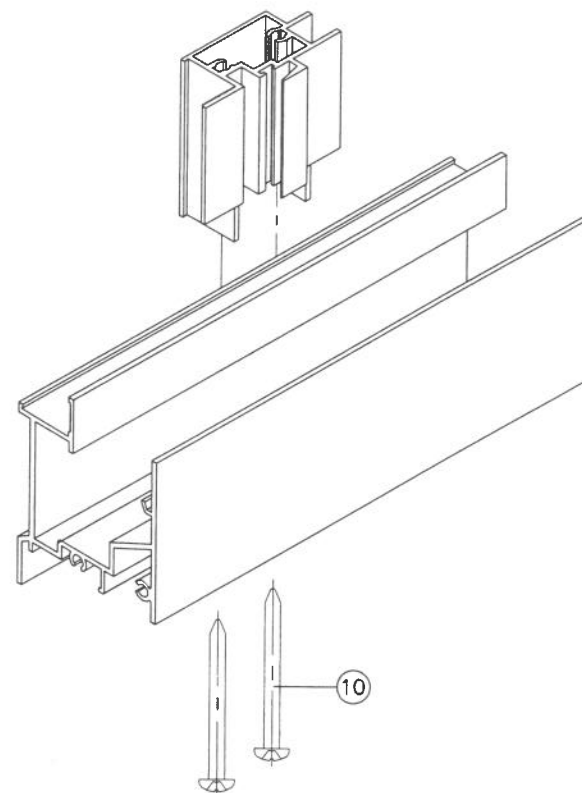

FIXED MTG. RAIL CORNER

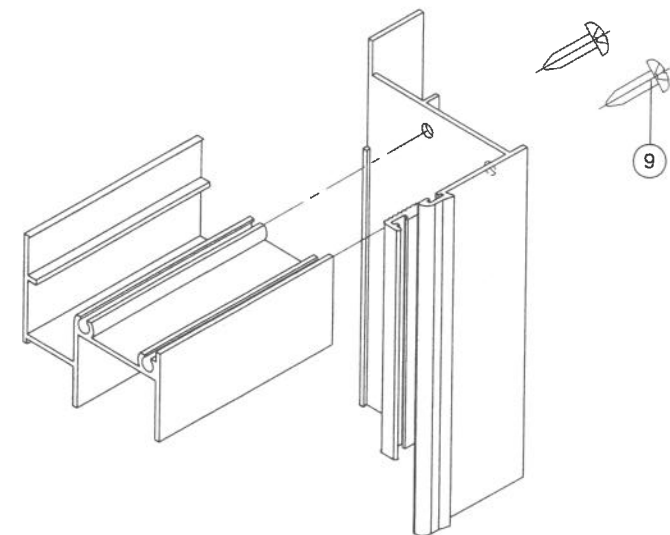


FRAME TOP CORNER

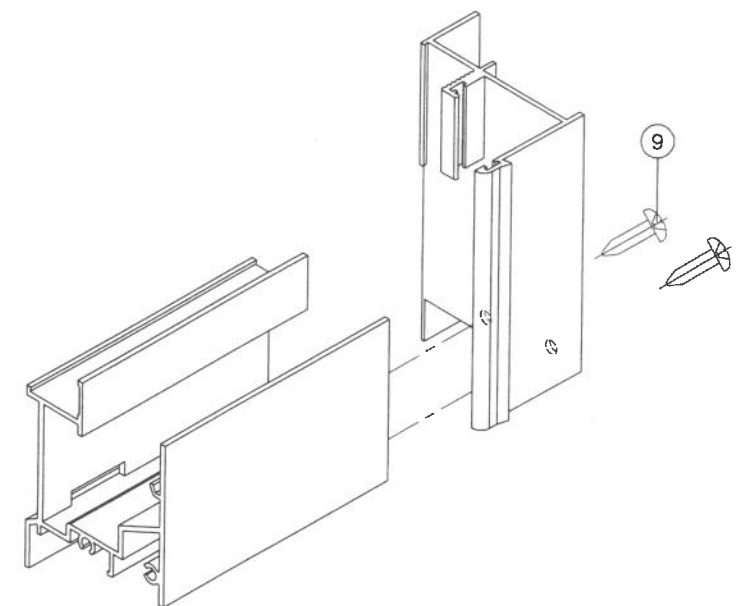

FRAME BOTTOM CORNER

PRODUCT REVISED
As complying with the Florida Building Code
NOA-No. **26-0824.08**
Expiration Date: **12/14/2029**
By: *Manuel Ferns*
Miami-Dade Product Control

AUG 18 2026

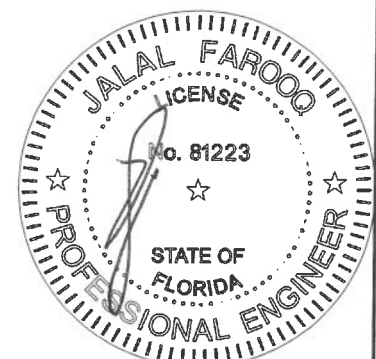

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978

SERIES HRW-300 ALUM. HORIZ. ROLLING WDW. (N.I.)
New Age Windows & Doors Corp.
7196 N.W. 77TH TERRACE
MEDLEY, FL. 33166
TEL. (305) 889-0703 FAX. (305) 889-0710

revisions:			no	date	by	description
	I	08.08.14				NO CHANGE THIS SHEET
	J	10.12.17				UPDATED TO 2017 FBC
	K	07.14.20				EDITORIAL CHANGES
	L	06.07.23				NO CHANGE THIS SHEET
	M	08.14.26				NO CHANGE THIS SHEET

date: 11-30-99
scale: 1/2" = 1"
dr. by: TARIQ
chk. by:

drawing no.
W99-80
sheet 6 of 6

COMP-ANL\W99-80NA