


PLAN VIEW

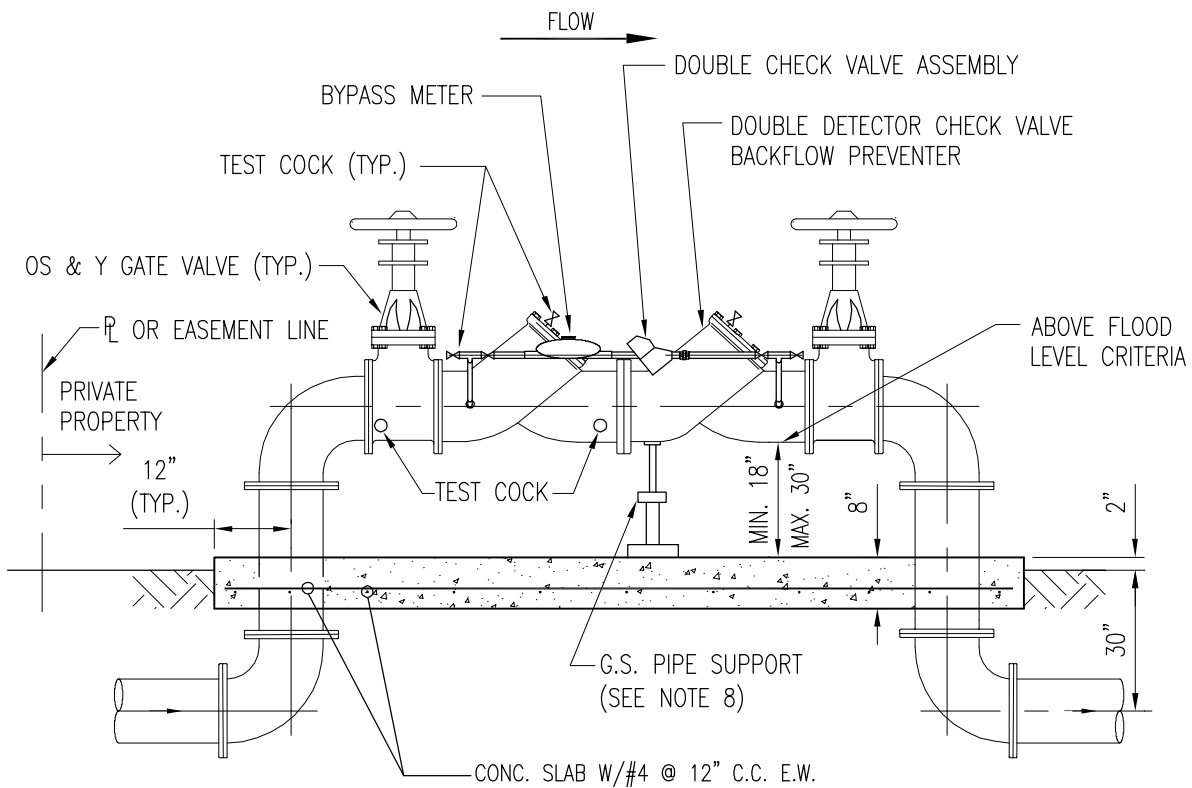

ELEVATION VIEW

NOTES:

PIPING SHALL BE DUCTILE IRON PIPE WITH FLANGED FITTINGS, IN ACCORDANCE WITH MDWASD "CONSTRUCTION SPECIFICATIONS FOR DONATION WATER MAINS".

GUARD POST DETAIL	WS 4.5	
ITEM	CROSS REF.	SPEC. REF.



ISSUE DATE	APPROVED BY
09/30/2009	V.F.C.

STANDARD DETAIL
DOUBLE DETECTOR CHECK VALVE ASSEMBLY FOR FIRELINE SERVICE

WS
4.20
 SHEET 2 OF 4